


Woodland Glen 2nd Plat With Fire Flow at Maximum Day Demand

	ID	Static Demand (gpm)	Static Pressure (psi)	Static Head (ft)	Fire-Flow Demand (gpm)	Residual Pressure (psi)	Hydrant Available Flow (gpm)	Hydrant Pressure at Available Flow (psi)
1	<input type="checkbox"/> 7948	0.00	91.88	1,192.06	1,000.00	84.29	3,697.80	20.00
2	<input type="checkbox"/> 7950	0.00	84.93	1,192.00	1,000.00	79.71	4,562.26	20.00
3	<input type="checkbox"/> 7952	0.00	90.15	1,192.06	1,000.00	84.56	4,510.03	20.00
4	<input type="checkbox"/> 7954	13.20	83.81	1,192.42	1,000.00	78.56	4,509.03	20.00
5	<input type="checkbox"/> 7956	0.00	86.71	1,192.45	1,000.00	80.49	4,065.00	20.00
6	<input type="checkbox"/> 7958	0.00	78.62	1,192.45	1,000.00	71.02	3,300.28	20.00



Woodland Glen 2nd Plat With No Fire Flow at Peak Hour Demand

		ID	Static Demand (gpm)	Static Pressure (psi)	Static Head (ft)	Fire-Flow Demand (gpm)	Residual Pressure (psi)	Hydrant Available Flow (gpm)	Hydrant Pressure at Available Flow (psi)
1	<input type="checkbox"/>	7948	0.00	82.68	1,170.81	0.00	82.68	3,270.90	20.00
2	<input type="checkbox"/>	7950	0.00	75.61	1,170.50	0.00	75.61	3,939.45	20.00
3	<input type="checkbox"/>	7952	0.00	80.94	1,170.81	0.00	80.94	3,953.46	20.00
4	<input type="checkbox"/>	7954	26.40	75.30	1,172.79	0.00	75.30	3,934.45	20.00
5	<input type="checkbox"/>	7956	0.00	78.26	1,172.95	0.00	78.26	3,575.80	20.00
6	<input type="checkbox"/>	7958	0.00	70.17	1,172.95	0.00	70.17	2,859.58	20.00

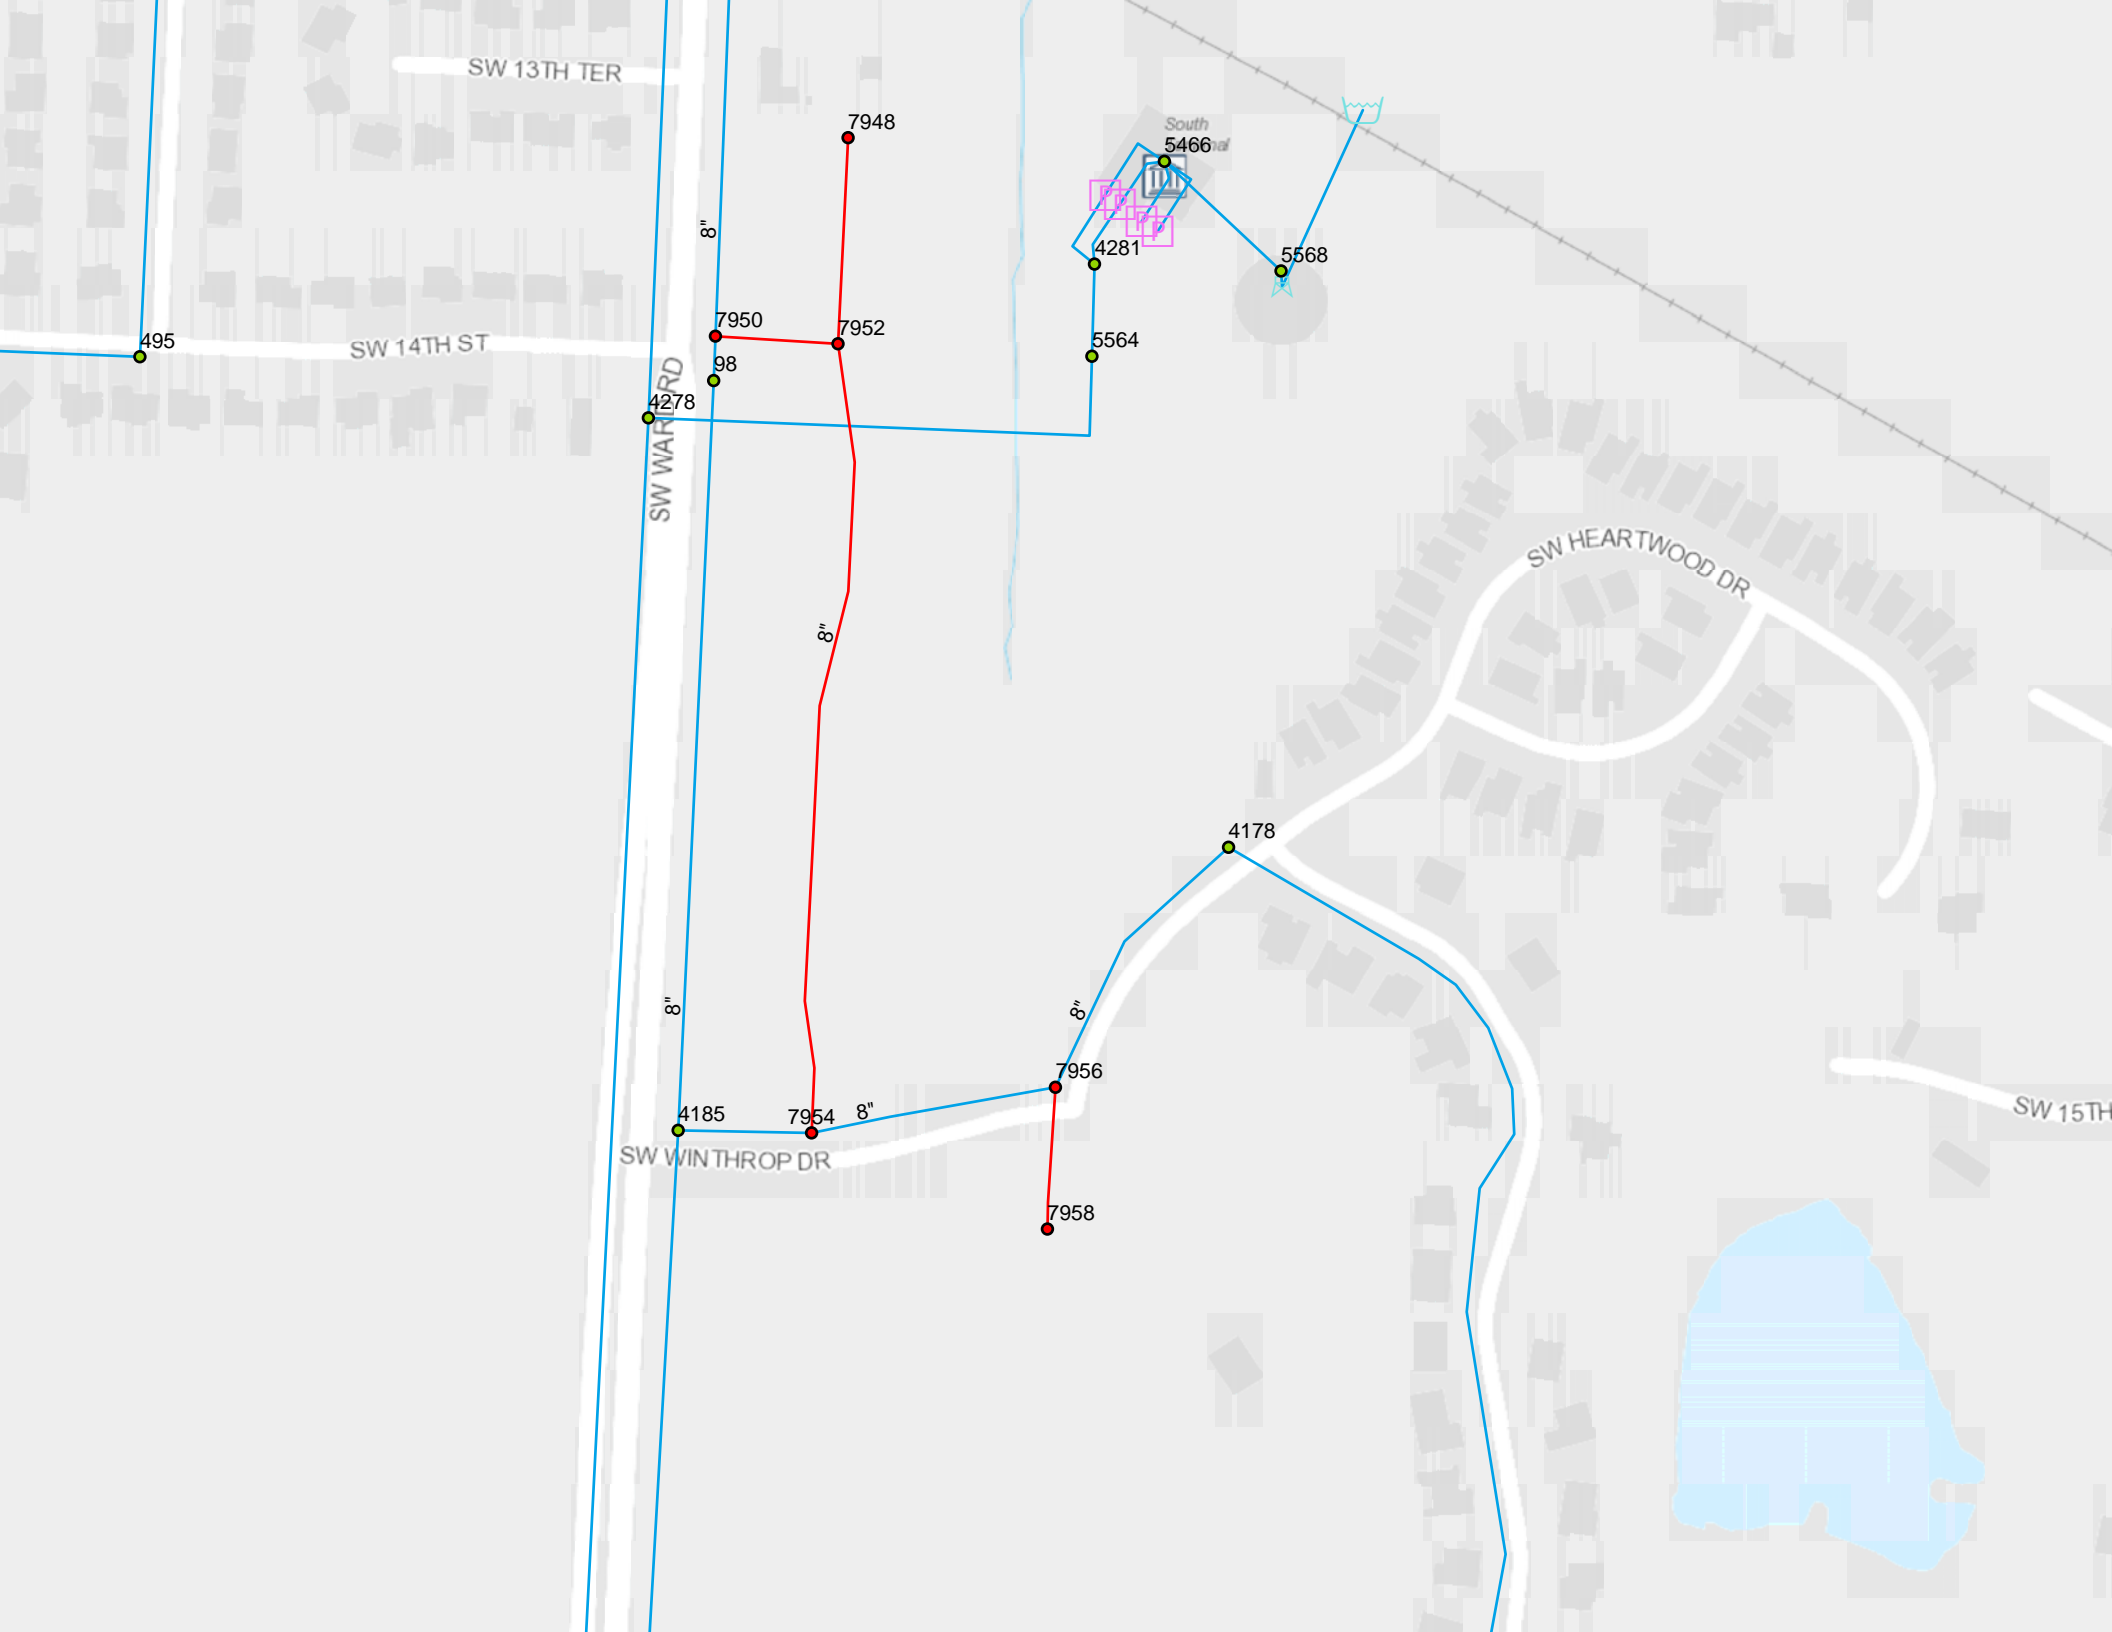

SW 13TH TER

SW 14TH ST

SW 15TH ST

SW WARD RD

SW HEARTWOOD DR

SW WINTHROP DR

7948

8"

7950

7952

4278

98

South 5466

4281

5568

5564

8"

8"

8"

4178

7956

8"

4185

7954

7958

495