




NOT FOR
CONSTRUCTION
Oct 21, 2020

Probable location of utility
entry including fire sprinkler
service entry and FDC.

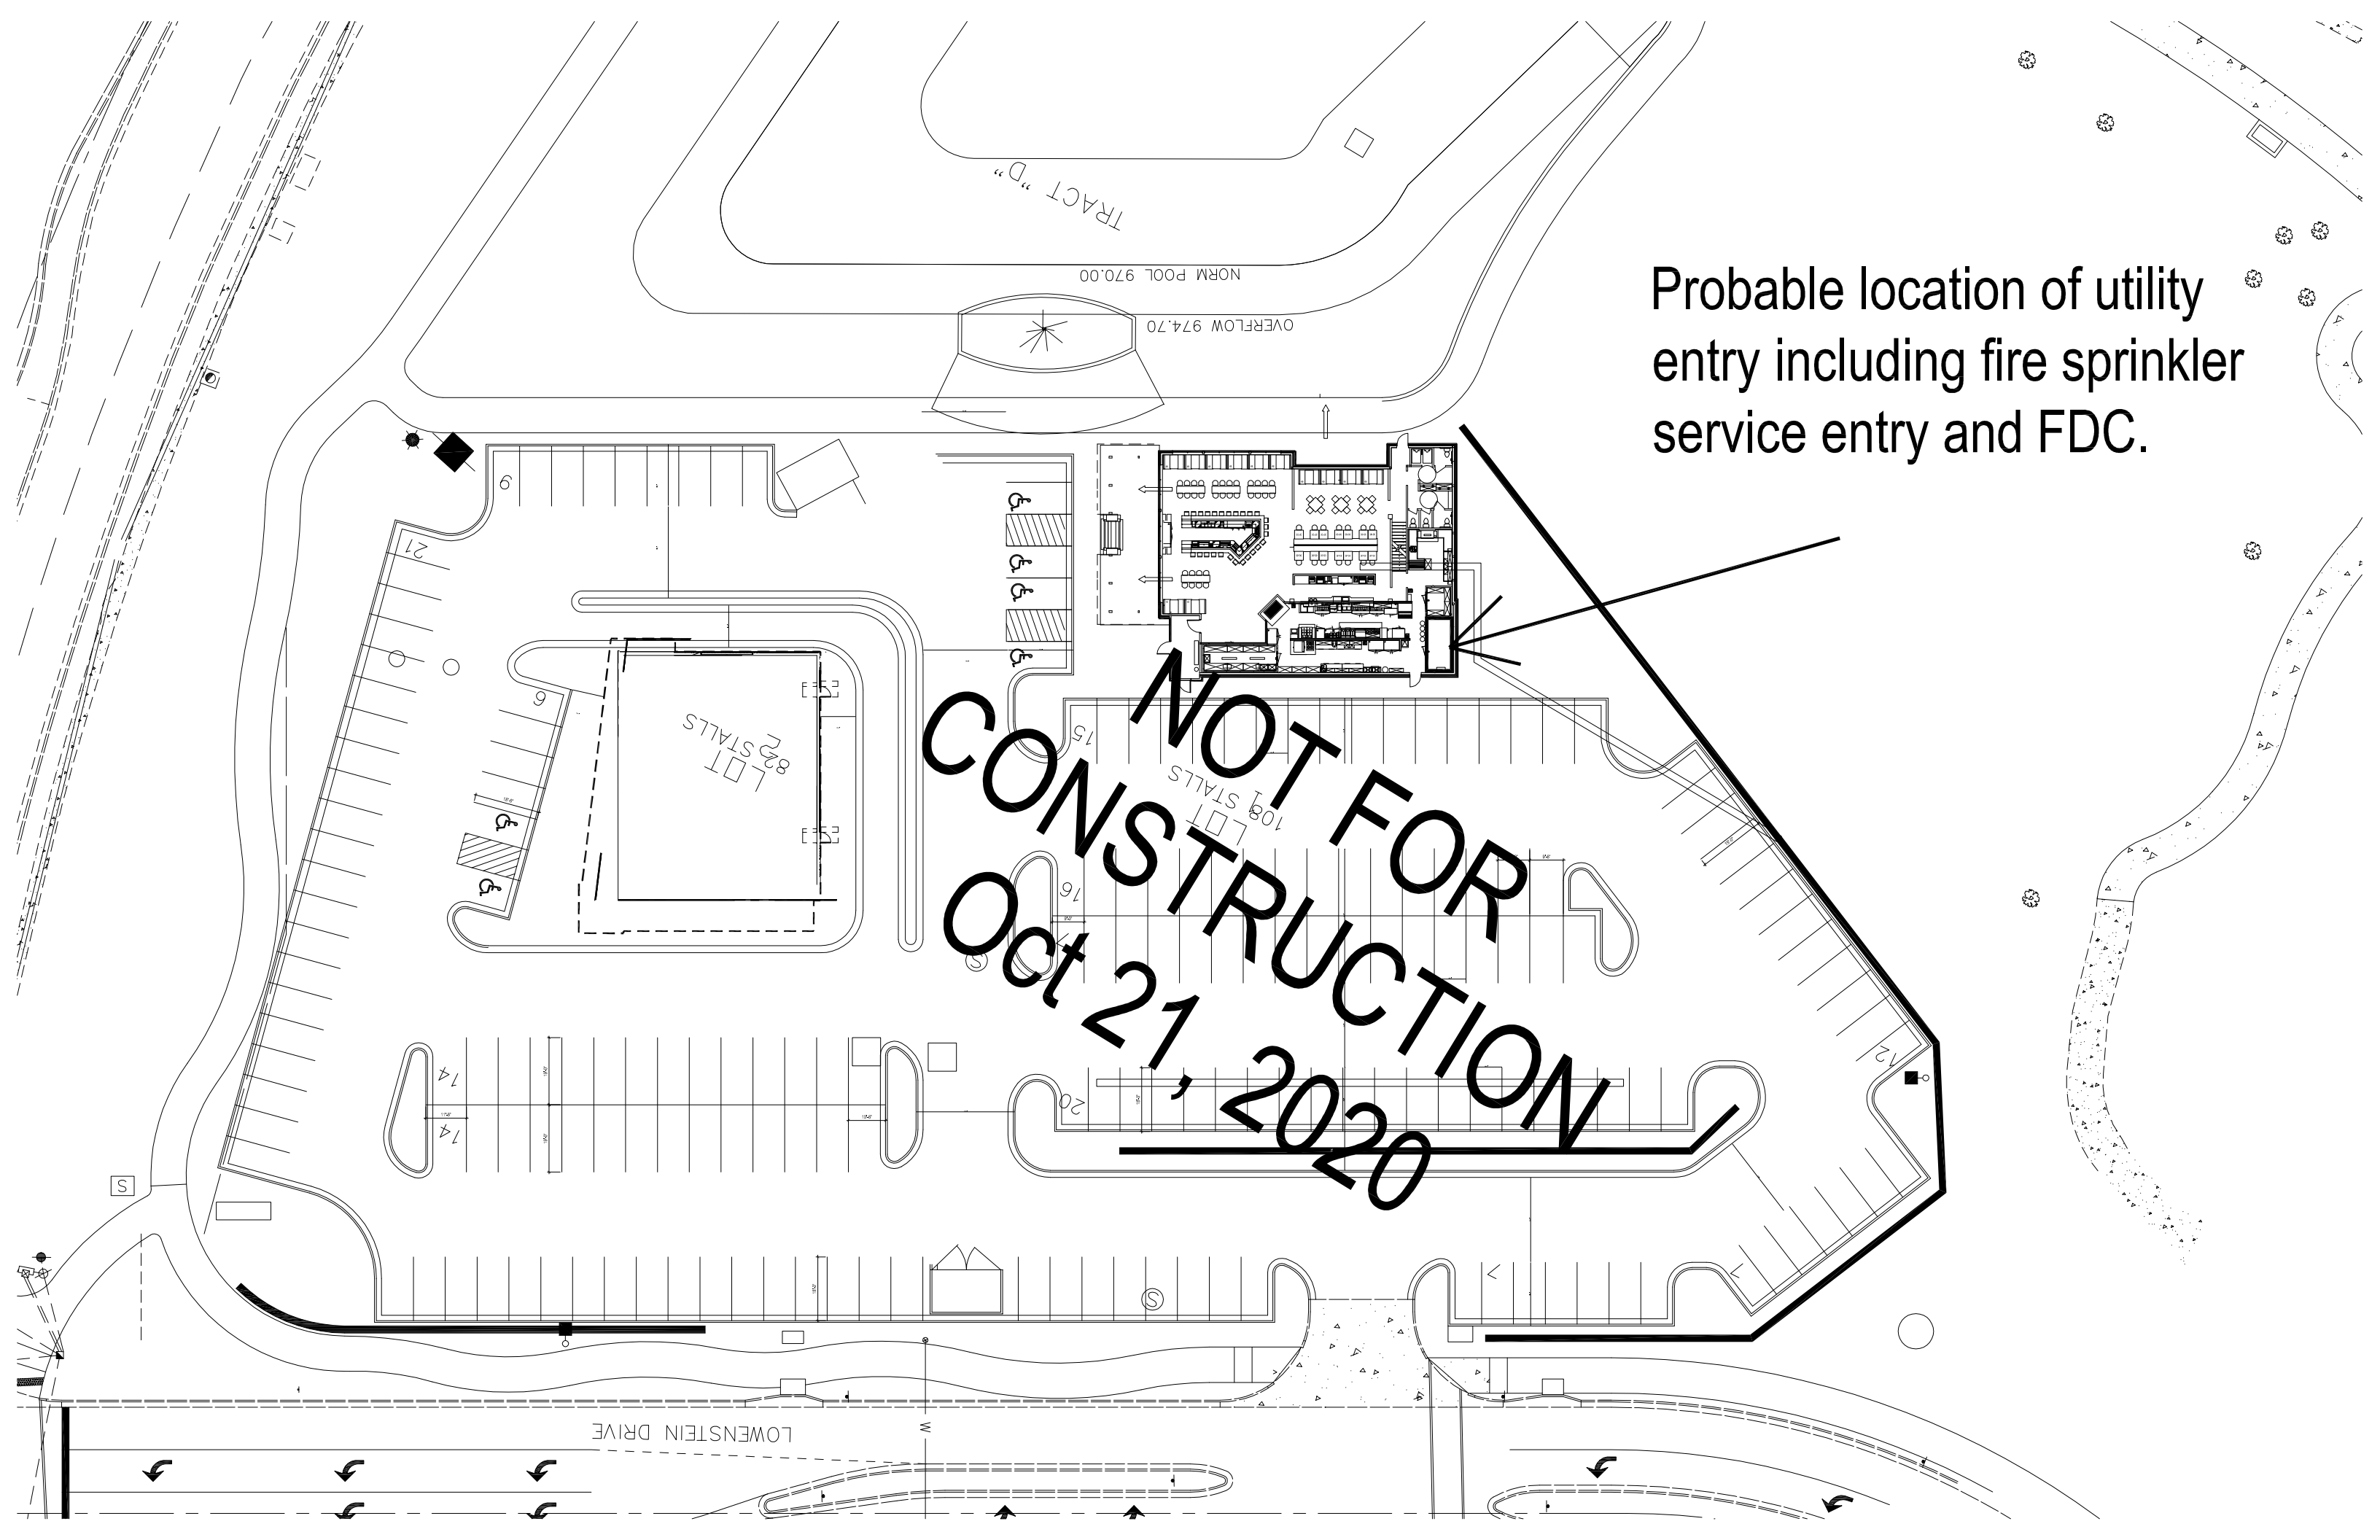