
LEGEND: ACCESS EASEMENT - BACK OF CURB BACK TO BACK BENCHMARK BUILDING LINE CO - CLEANOUT - TELEPHONE JUNCTION BOX - CURB AND GUTTER DRAINAGE EASEMENT - ELECTRICAL EASEMENT - ELEVATION FLOW LINE G/E GAS LINE EASEMENT HIGH-DENSITY POLYETHYLENE LANDSCAPE EASEMENT MINIMUM SERVICEABLE FLOOR **ELEVATION** POLYVINYL CHLORIDE PROPERTY LINE PUBLIC EASEMENT REINFORCED CONCRETE PIPE ROW or R/W - RIGHT-OF-WAY SANITARY SEWER EASEMENT SERVICE LINE - SIDEWALK TOP ELEVATION U/E UTILITY EASEMENT WATER SURFACE ELEVATION W/E WATERLINE EASEMENT **ASPHALT PAVEMENT - EXISTING** ASPHALT PAVEMENT - PROPOSED **CONCRETE PAVEMENT - EXISTING** CONCRETE SIDEWALK - EXISTING CONCRETE SIDEWALK - PROPOSED CURB & GUTTER CURB & GUTTER - EXISTING TREELINE ———— EXISTING LOT AND R/W LINES ———— EXISTING PLAT LINES P/L PROPERTY LINES SANITARY SEWER MAIN SANITARY SEWER MAIN - EXIST. STORM SEWER STORM SEWER - EXISTING ---- CATV_x ---- CABLE TV - EXISTING FIBER OPTIC CABLE - EXISTING TELEPHONE LINE - EXIST. ELECTRIC LINE - EXISTING ----- OHP_x ----- OVERHEAD POWER LINE - EXIST ----- UGE_Y ----- UNDERGROUND ELECTRIC - EX. —— G_x —— GAS LINE - EXISTING WATERLINE - EXISTING LIGHT - EXISTING **EXISTING MANHOLE** CLEANOUT EXISTING SANITARY MANHOLE PROPOSED SANITARY MANHOLE EXISTING AREA INLET **EXISTING CURB INLET EXISTING GRATE INLET**

EXISTING JUNCTION BOX

EXISTING STORM MANHOLE

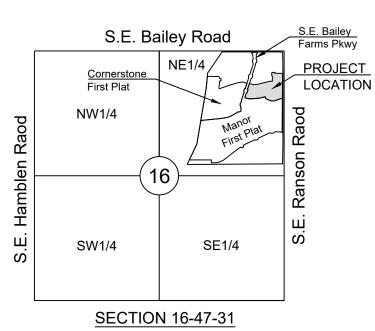

LOCATION MAP SCALE 1" = 2000' BASIS OF BEARINGS: MISSOURI COORDINATE SYSTEM 1983, WEST ZONE

UTILITY CONTACTS:

MISSOURI DEPARTMENT OF TRANSPORTATION (MODOT) Steve Holloway 600 NE Colbern Road Lee's Summit, MO 64086

MISSOURI GAS ENERGY (MGE)

Brent Jones 3025 SE Clover Drive Lee's Summit, MO 64082 (816) 399-9633 brent.jones@spireenergy.com

EVERGY Ron Dejarnette

(816) 607-2186

1300 SE Hamblin Road
Lee's Summit, MO 64081
Office: (816) 347-4316
Cell: (816) 810-5234
ron.dejarnette@evergy.com

CITY OF LEES SUMMIT PUBLIC WORKS

Dena Mezger 220 SE Green Street Lee's Summit, MO 64063 (816) 969-1800

AT&T

Mark Manion or Marty Loper 500 E. 8th Street, Room 370 Kansas City, MO 64106 (816) 275-2341 or (816) 275-1550

COMCAST CABLE

John Meadows 4700 Little Blue Parkway Independence, MO 64057 (816) 795-2257

CITY OF LEE'S SUMMIT WATER UTILITIES

Mark Schaufler 1200 SE Hamblen Road Lee's Summit, MO 64081 (816) 969-1900

NOTE:

SUMMARY OF QUANTITIES TABLE TO BE PROVIDED WITH 2ND SUBMITTAL.

SANITARY MAIN EXTENSION PLANS FOR RETREAT AT BAILEY FARMS, FIRST PLAT

IN THE CITY OF LEE'S SUMMIT JACKSON COUNTY, MO

GENERAL NOTES:

- 1. ALL CONSTRUCTION TO FOLLOW THE CITY OF LEE'S SUMMIT DESIGN AND CONSTRUCTION MANUAL AS ADOPTED BY ORDINANCE 5813.
- ALL WORKMANSHIP AND MATERIALS SHALL BE SUBJECT TO THE INSPECTION AND APPROVAL OF THE ENGINEERING DEPARTMENT OF THE CITY OF LEE'S SUMMIT, MISSOURI.
- 3. LINEAL FOOT MEASUREMENTS SHOWN ON THE PLANS ARE HORIZONTAL MEASUREMENTS, NOT SLOPE MEASUREMENTS. ALL PAYMENTS SHALL BE MADE ON HORIZONTAL MEASUREMENTS.
- 4. THE UTILITY LOCATIONS SHOWN ON THESE PLANS ARE TAKEN FROM UTILITY COMPANY RECORDS AND APPARENT FIELD LOCATIONS. THE CONTRACTOR SHALL VERIFY THE LOCATION AND DEPTH OF ALL UTILITIES PRIOR TO CONSTRUCTION
- 5. THE CONTRACTOR SHALL ADHERE TO THE PROVISIONS OF THE SENATE BILL NUMBER 583, 78TH GENERAL ASSEMBLY OF THE STATE OF MISSOURI. THE BILL REQUIRES THAT ANY PERSON OR FIRM DOING EXCAVATION ON PUBLIC RIGHT OF WAY DO SO ONLY AFTER GIVING NOTICE TO, AND OBTAINING INFORMATION FROM, UTILITY COMPANIES. STATE LAW REQUIRES 48 HOURS ADVANCE NOTICE. THE CONTRACTOR MAY ALSO UTILIZE THE FOLLOWING TOLL FREE PHONE NUMBER PROVIDED BY "MISSOURI ONE CALL SYSTEM, INC.": 1-800-DIG-RITE. THIS PHONE NUMBER IS APPLICABLE ANYWHERE WITHIN THE STATE OF MISSOURI. PRIOR TO COMMENCEMENT OF WORK, THE CONTRACTOR SHALL NOTIFY ALL THOSE COMPANIES WHICH HAVE FACILITIES IN THE NEAR VICINITY OF THE CONSTRUCTION TO BE PERFORMED.
- 6. PRIOR TO ORDERING PRECAST STRUCTURES, SHOP DRAWING SHALL BE SUBMITTED TO THE DESIGN ENGINEER FOR APPROVAL.
- 7. THE CONTRACTOR SHALL PROTECT ALL MAJOR TREES FROM DAMAGE. NO TREE SHALL BE REMOVED WITHOUT PERMISSION OF THE OWNER, UNLESS SHOWN OTHERWISE.
- 8. CLEARING AND GRUBBING OPERATIONS AND DISPOSAL OF ALL DEBRIS THEREFROM SHALL BE PERFORMED BY THE CONTRACTOR IN STRICT ACCORDANCE WITH ALL LOCAL CODES AND ORDINANCES.
- 9. ALL WASTE MATERIAL RESULTING FROM THE PROJECT SHALL BE DISPOSED OF OFF-SITE BY THE
- CONTRACTOR, OR AS DIRECTED BY THE OWNER AT NO ADDITIONAL COST.

 10. ALL EXCAVATIONS SHALL BE UNCLASSIFIED. NO SEPARATE PAYMENT WILL BE MADE FOR ROCK
- EXCAVATION.
- 11. THE CONTRACTOR SHALL CONTROL THE EROSION AND SILTATION DURING ALL PHASES OF CONSTRUCTION AND SHALL KEEP THE STREETS CLEAN OF MUD AND DEBRIS.
- 12. THE CONTRACTOR SHALL CONTACT THE CITY'S DEVELOPMENT SERVICES ENGINEERING INSPECTION TO SCHEDULE A PRE-CONSTRUCTION MEETING WITH AN INSPECTOR PRIOR TO ANY LAND DISTURBANCE WORLD AT (816) 969-1200
- 13. THE CONTRACTOR SHALL CONTACT THE RIGHT OF WAY INSPECTOR AT 816-969-1800 PRIOR TO ANY LAND DISTURBANCE ACTIVITIES WITHIN THE RIGHT OF WAY. THESE ACTIVITIES MAY REQUIRE A PERMIT.
- 14. THE CONTRACTOR SHALL PROVIDE AND MAINTAIN ALL TRAFFIC HANDLING MEASURES NECESSARY TO ENSURE THAT THE GENERAL PUBLIC IS PROTECTED AT ALL TIMES. TRAFFIC CONTROL SHALL CONFORM TO THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (MUTCD-LATEST EDITION).
- 5. ALL SANITARY SEWER LATERALS SHALL HAVE A TRENCH CHECK, CONSISTING OF FLOWABLE BACKFILL, INSTALLED DURING CONSTRUCTION. TRENCH CHECK SHALL EXTEND TO BOTTOM OF TRENCH, TO WIDTH OF TRENCH, TO 12 INCHES ABOVE PIPE, FOR A MINIMUM LENGTH OF 12 INCHES. TRENCH CHECK SHALL BE LOCATED AT LEAST 5 FEET FROM SANITARY MAIN.

UTILITIES:


- 1. Existing utilities have been shown to the greatest extent possible based upon information provided to the Engineer. The contractor is responsible for contacting the respective utility companies and field locating utilities prior to construction and identifying any potential conflicts. All conflicts shall immediately be brought to the attention of the Engineer.
- The contractor shall be responsible for coordinating any required utility relocations. Utilities damaged through the negligence of the contractor shall be repaired at the contractor's expense.
- Contractor shall verify flow-lines and structure tops prior to construction, and shall notify Engineer of any discrepancies.
 Provide shop drawings for all precast and manufactured utility structures for review by the Engineer prior to construction of the structures.
- 4. Utility Separation: Waterlines shall have a minimum of 10 feet horizontal and 2 feet vertical separation from all sanitary sewer lines, manholes, and sanitary sewer service laterals, as measured from edge to edge. If minimum separations can not be obtained, concrete encasement of the sanitary line shall be required 10 feet in each direction of the conflict.
- . Payment for trenching, backfilling, pipe embedment, flowable fill, backfill materials, clean up, seeding, sodding and any other items necessary for the construction of the utility line shall be included in the contract price for the utility installation.
- 6. The Contractor shall be responsible for contacting respective utility companies 48-hours in advance for the inspection of any proposed utility main extension or service line or service connection to any existing main.
- 7. Trench spoils shall be neatly placed onsite adjacent to the trench, and compacted to prevent saturation and excess sediment runoff. Unsuitable materials, excess rock and shale, asphalt, concrete, trees, brush etc. shall be properly disposed of offsite. Materials may be wasted onsite at the direction of the Owner or his appointed representative.
- 8. All excavation is considered unclassified, unless noted otherwise. Unclassified excavation for utility trenching is subsidiary to the unit price provided for the pipe. Any quantity provided for rock excavation is estimated based on the best information provided to the Project Engineer. The Engineer has the authority to identify and define the physical characteristics to determine the classification. Unit price quantities for rock excavation will be paid at a trench width of the nominal pipe diameter of the installed main plus 18 inches. Contractor is required to dispose of excess rock from their trenches by disposing it in areas as specified by the Project Engineer.

Sheet List Table	
Sheet Number	Sheet Title
1	COVER SHEET
2	GENERAL LAYOUT
3	LINE K PLAN AND PROFILE
4	LINE K PLAN AND PROFILE (2)
5	LINE M PLAN AND PROFILE
6	SANITARY SEWER DETAILS
·	·

e ROFILE ROFILE (2) ROFILE

ENGINEERS PLANNERS SURVEYORS LA 14920 West 107th Street • Lenexa, (913) 492-5158 • Fax: (913) 4 WWW.SCHLAGELASSOCIAT

PREPARED BY



SCHLAGEL & ASSOCIATES, P.A.

.

APPROVED BY:

CITY ENGINEER

APPROVED FOR ONE YEAR FROM THIS DATE

DATI

OWNER/DEVELOPER:

CLAYTON PROPERTIES GROUP INC., DBA SUMMIT HOMES BRAD KEMPF 120 SE 30TH STREET LEE'S SUMMIT, MISSOURI p (816) 246-6700 BRADLEY@SUMMITHOMESKC.COM



MISSOURI GEOGRAPHIC REFERENCE SYSTEM BENCHMARK:

BM JA-45, IS A KC METRO ALUMINUM GRS DISK SET IN CONCRETE AND ABOUT 3 INCHES BELOW THE PAVEMENT ON THE SHOULDER OF SE RANSON ROAD. IT IS STAMPED JA45, 1987.

ELEV. = 1046.25

 DRAWN BY:
 REVISION DATE
 DESCRIPT

 JRJ
 2

 CHECKED BY:
 3

 JLL
 4


 VTE PREPARED:
 6

 02/09/2022
 6

 ROJ. NUMBER:
 8

COVER SHEET

SHEET

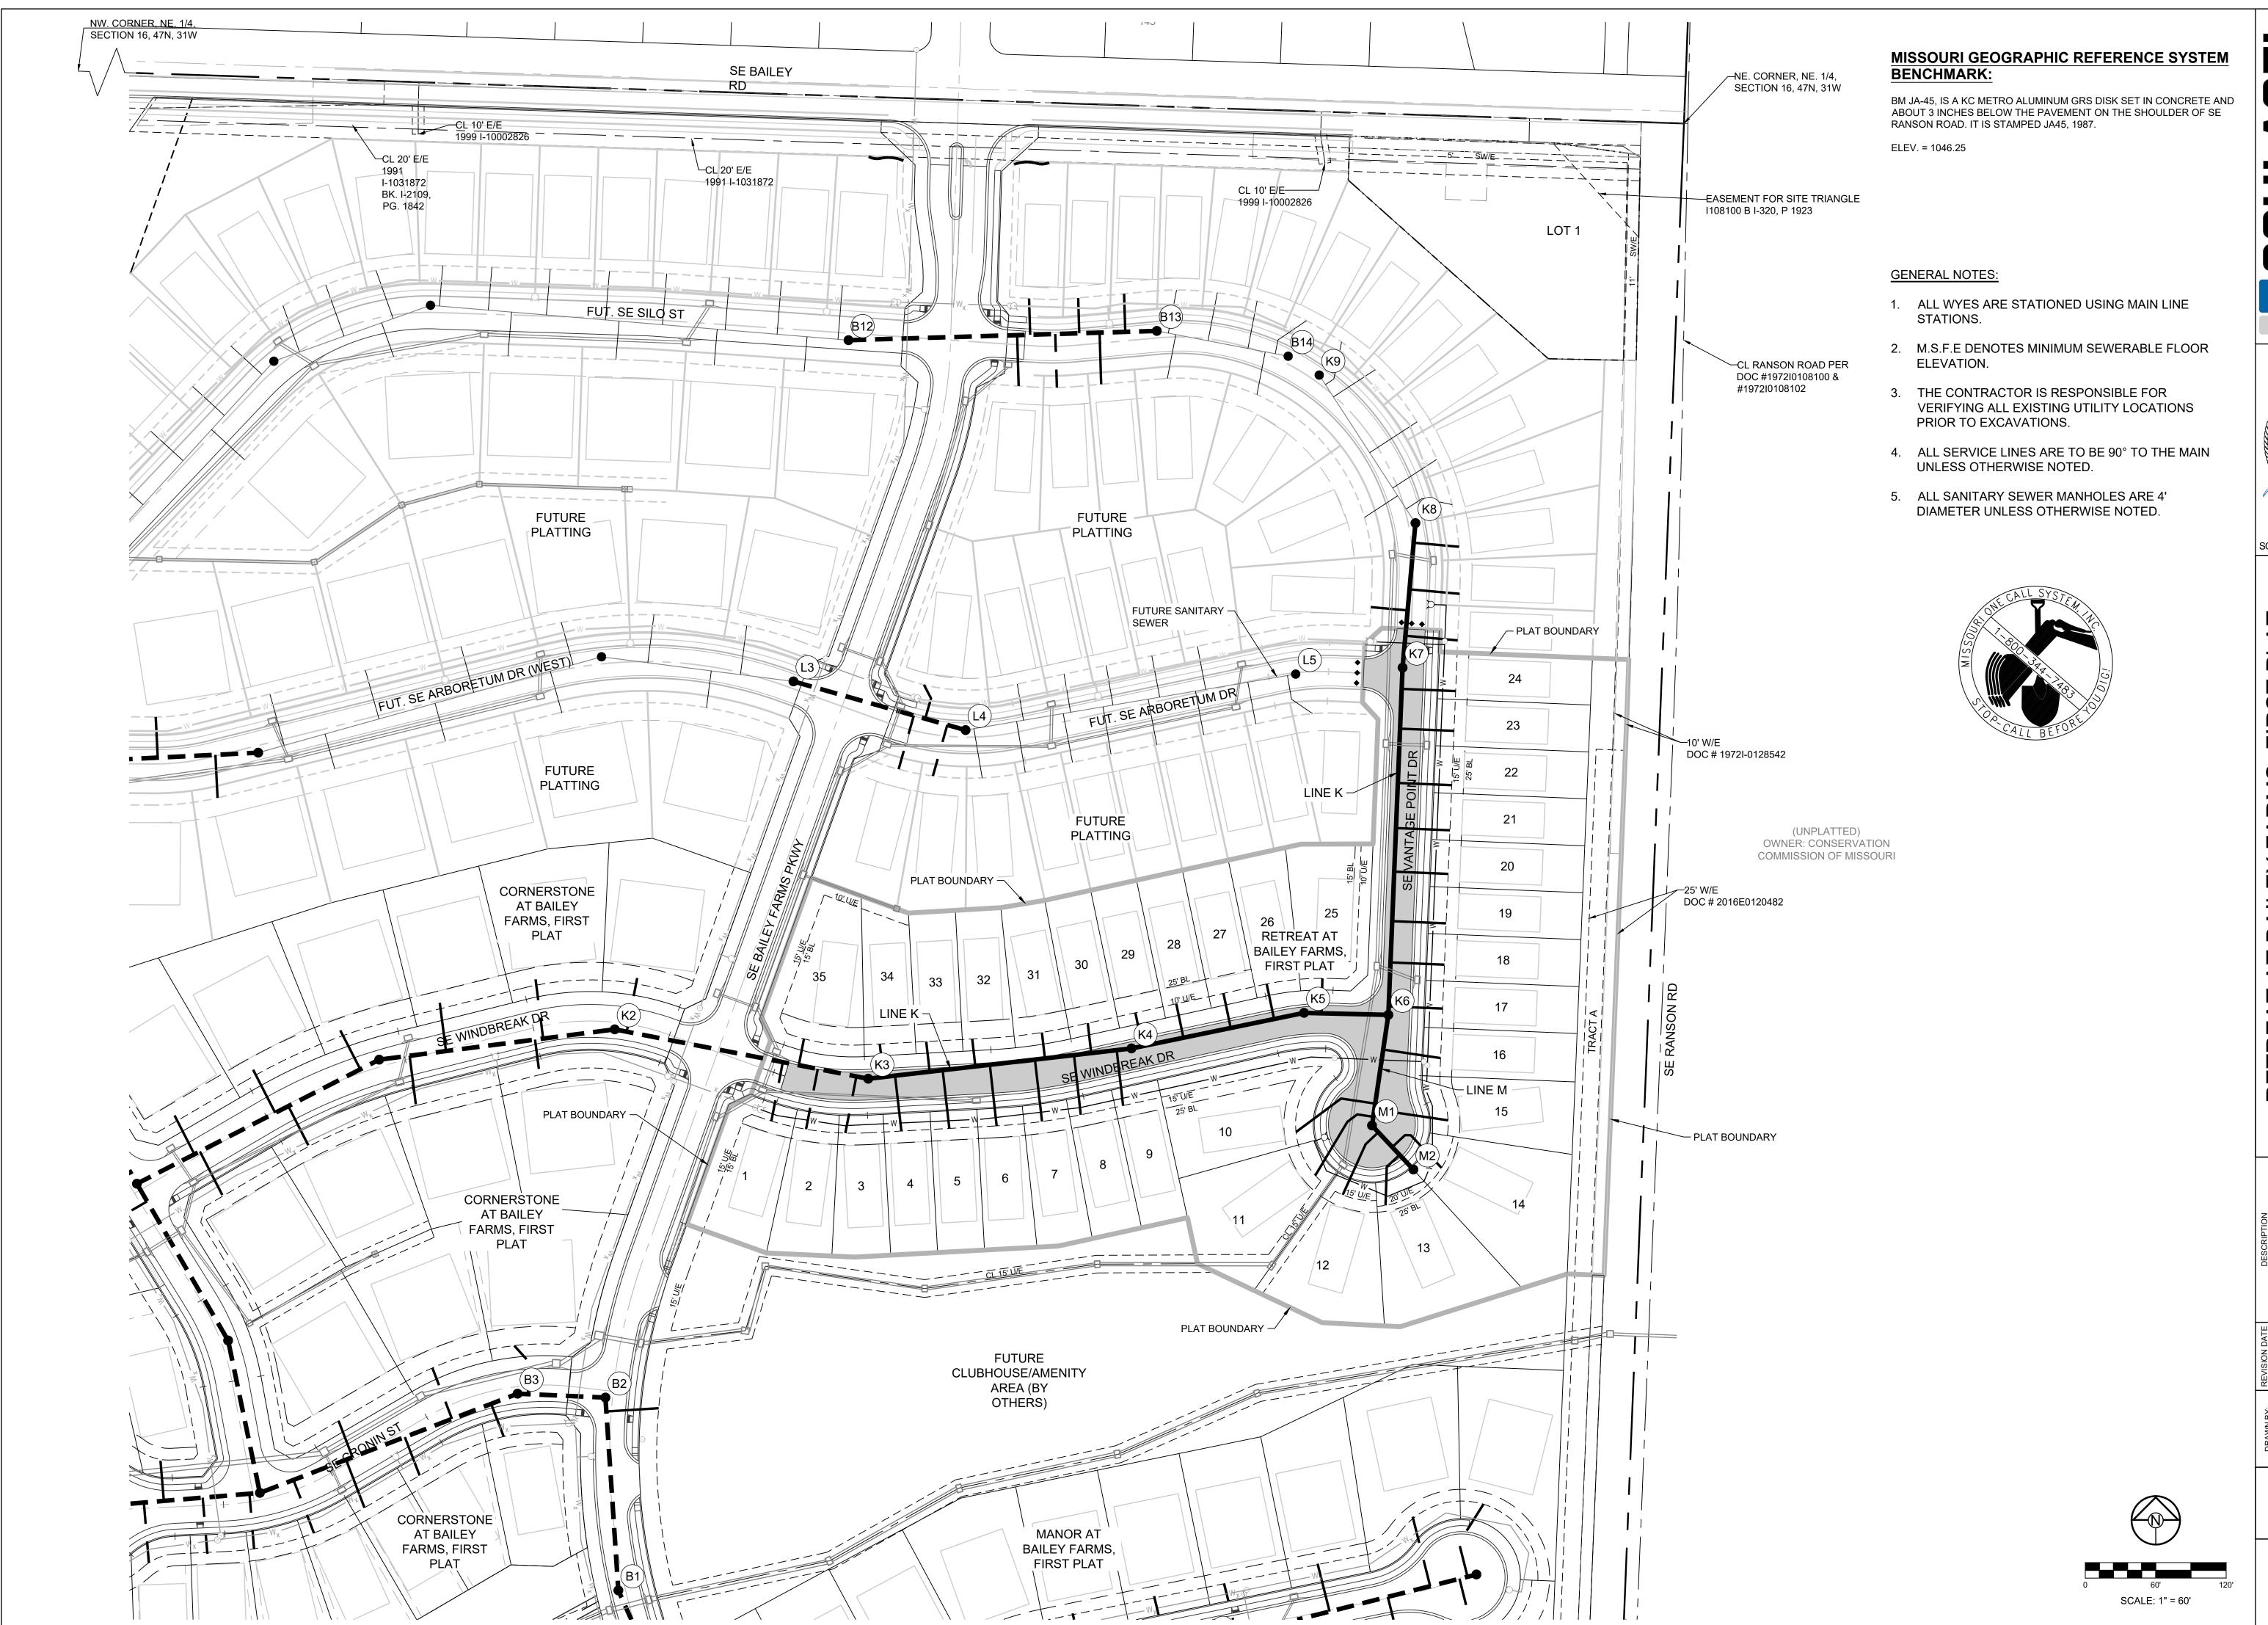

INEERS PLANNERS SURVEYORS LANDSCAPE ARCHITECT:
14920 West 107th Street • Lenexa, Kansas 66215
(913) 492-5158 • Fax: (913) 492-8400
WWW.SCHLAGELASSOCIATES.COM
Missouri State Certificates of Authority
#E2002003800-F #LAC2001005237 #LS2002008859-F

PREPARED BY:

JAMES L.
LONG

NUMBER
PE-2014010495

2/10/2022

SCHLAGEL & ASSOCIATES, P.A.

_

SANITARY MAIN EXTENSION PLANS
SE BAILEY ROAD & SE RANSON ROAD

JRJ (1)

HECKED BY: (3)

JLL (4)

TE PREPARED: (6)


02/09/2022 (6)

KOJ. NUMBER: (8)

21-133

GENERAL LAYOUT

SHEET

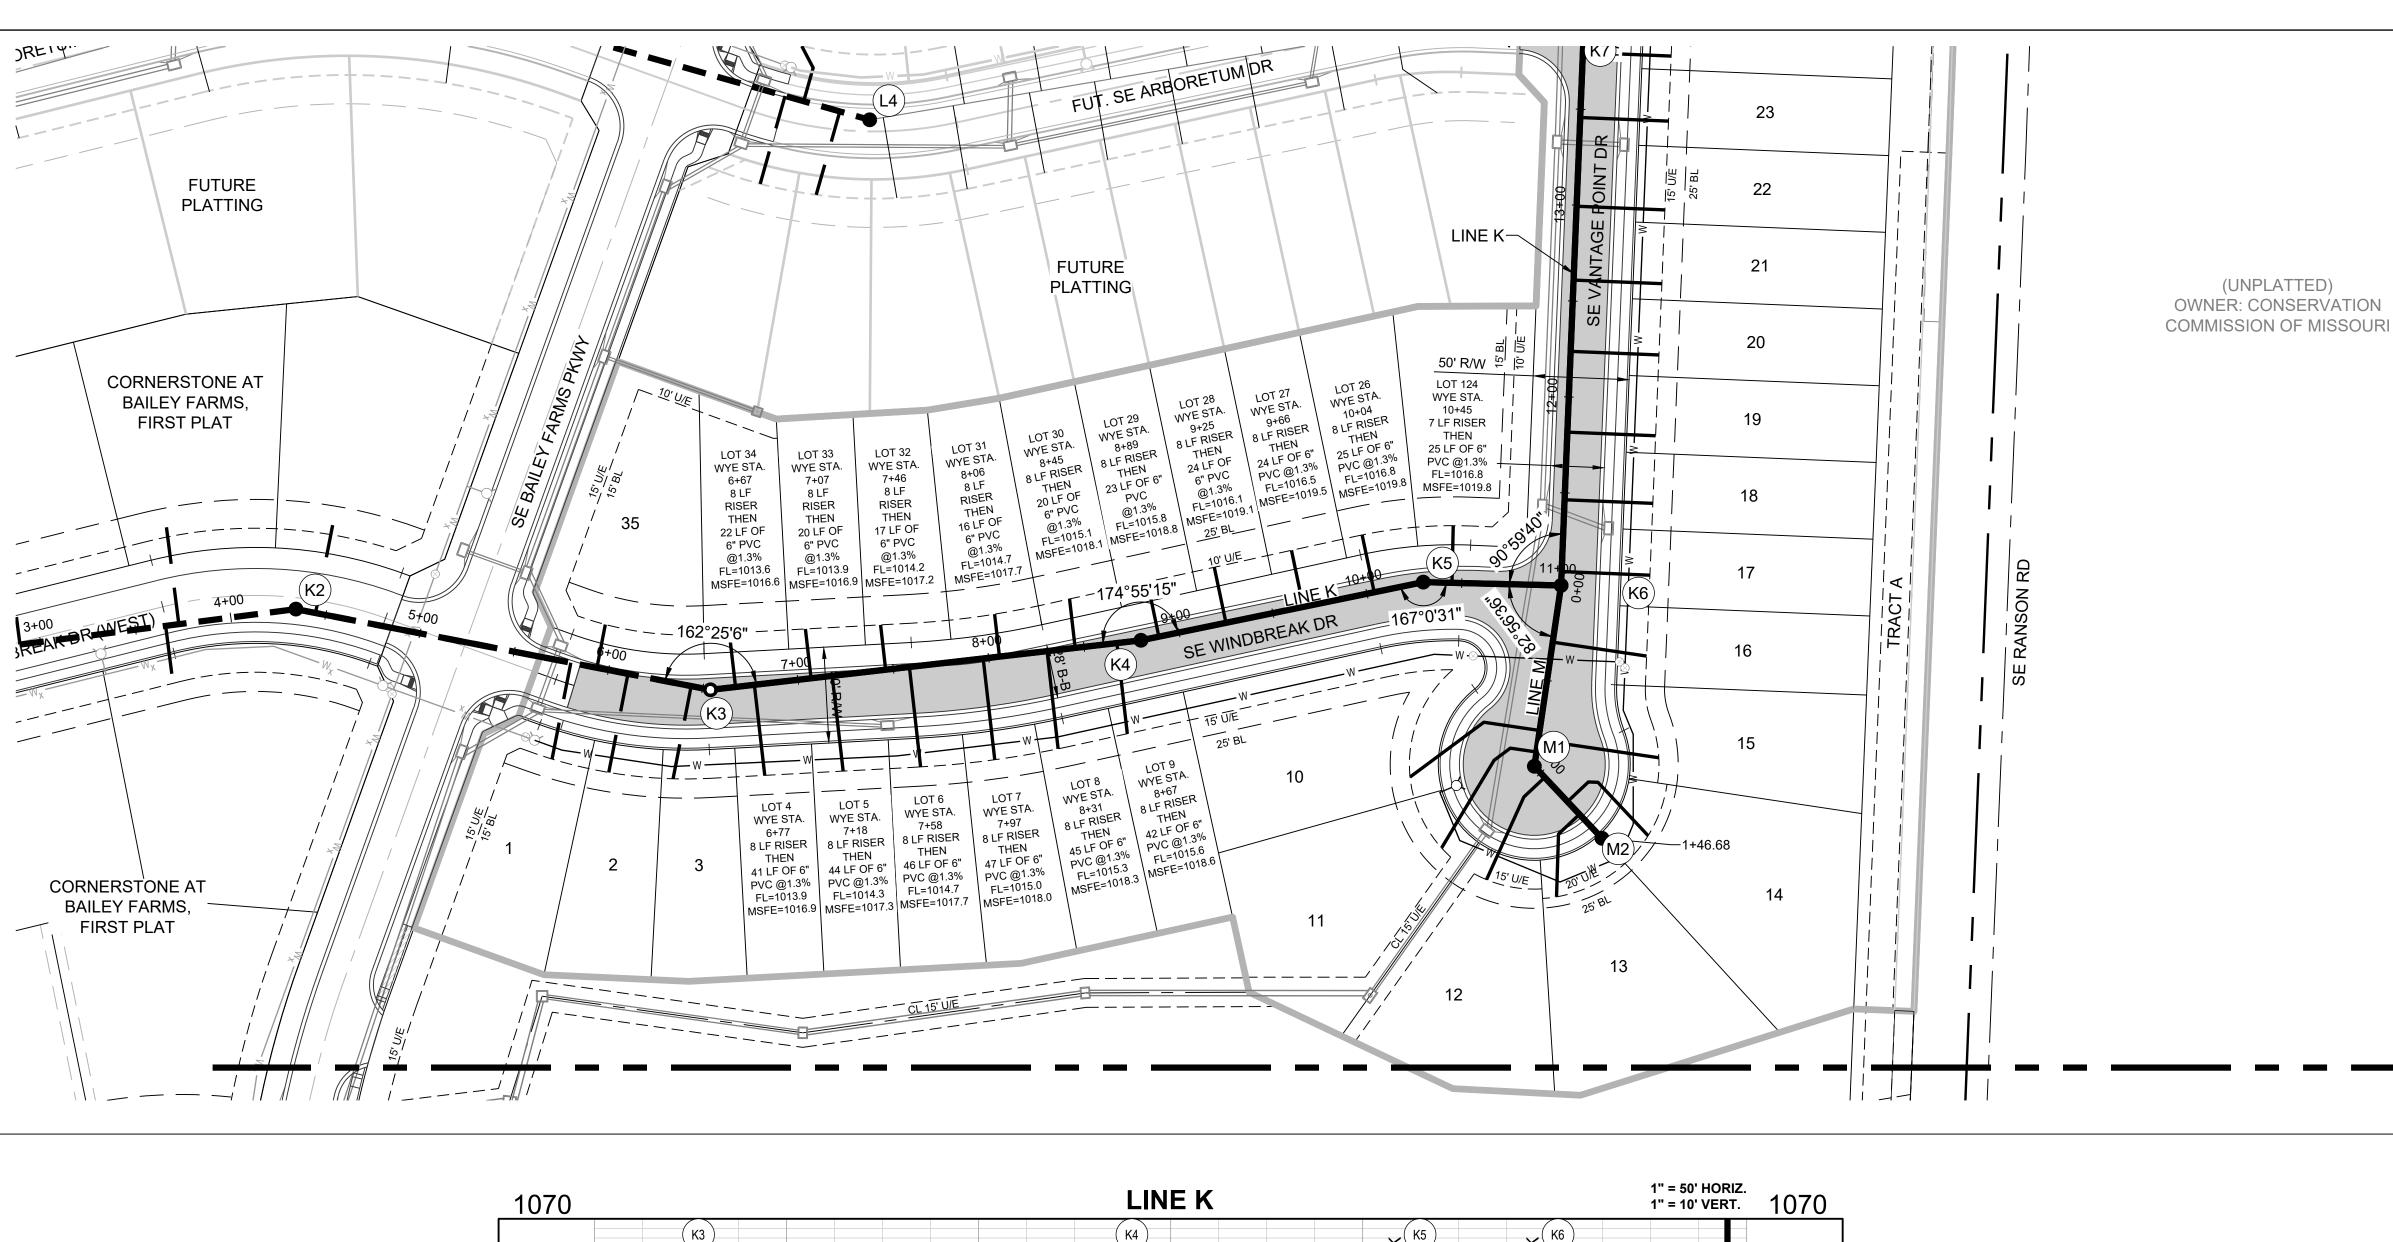

MISSOURI GEOGRAPHIC REFERENCE SYSTEM BENCHMARK:


BM JA-45, IS A KC METRO ALUMINUM GRS DISK SET IN CONCRETE AND ABOUT 3 INCHES BELOW THE PAVEMENT ON THE SHOULDER OF SE RANSON ROAD. IT IS STAMPED JA45, 1987.

ELEV. = 1046.25

GENERAL NOTES:

- 1. ALL WYES ARE STATIONED USING MAIN LINE STATIONS.
- 2. M.S.F.E DENOTES MINIMUM SEWERABLE FLOOR ELEVATION.
- 3. THE CONTRACTOR IS RESPONSIBLE FOR VERIFYING ALL EXISTING UTILITY LOCATIONS PRIOR TO EXCAVATIONS.
- 4. ALL SERVICE LINES ARE TO BE 90° TO THE MAIN UNLESS OTHERWISE NOTED.
- 5. ALL SANITARY SEWER MANHOLES ARE 4' DIAMETER UNLESS OTHERWISE NOTED





RETREAT AT BAILEY FARMS, FIRST SANITARY MAIN EXTENSION PLA

PREPARED BY:

2/10/2022

Y ROAD & LEE'S SUN


BAILEY


SCHLAGEL & ASSOCIATES, P.A.

DATE PREPARED: 6
02/09/2022
PROJ. NUMBER: 8

LINE K PLAN AND PROFILE

SHEET

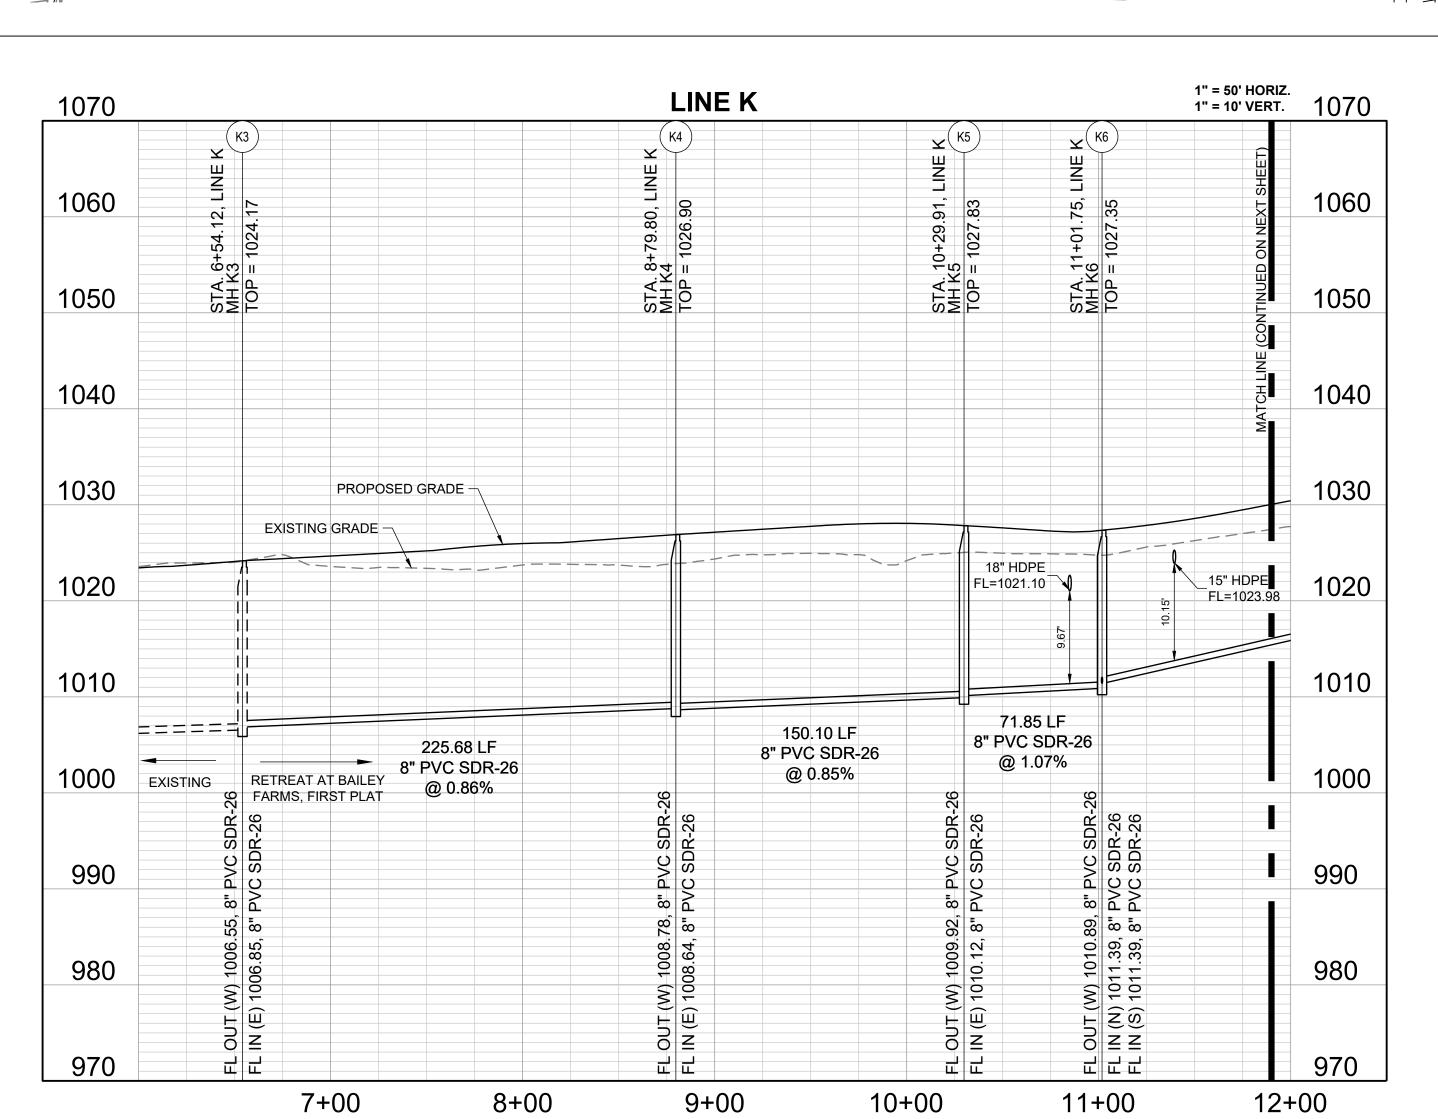

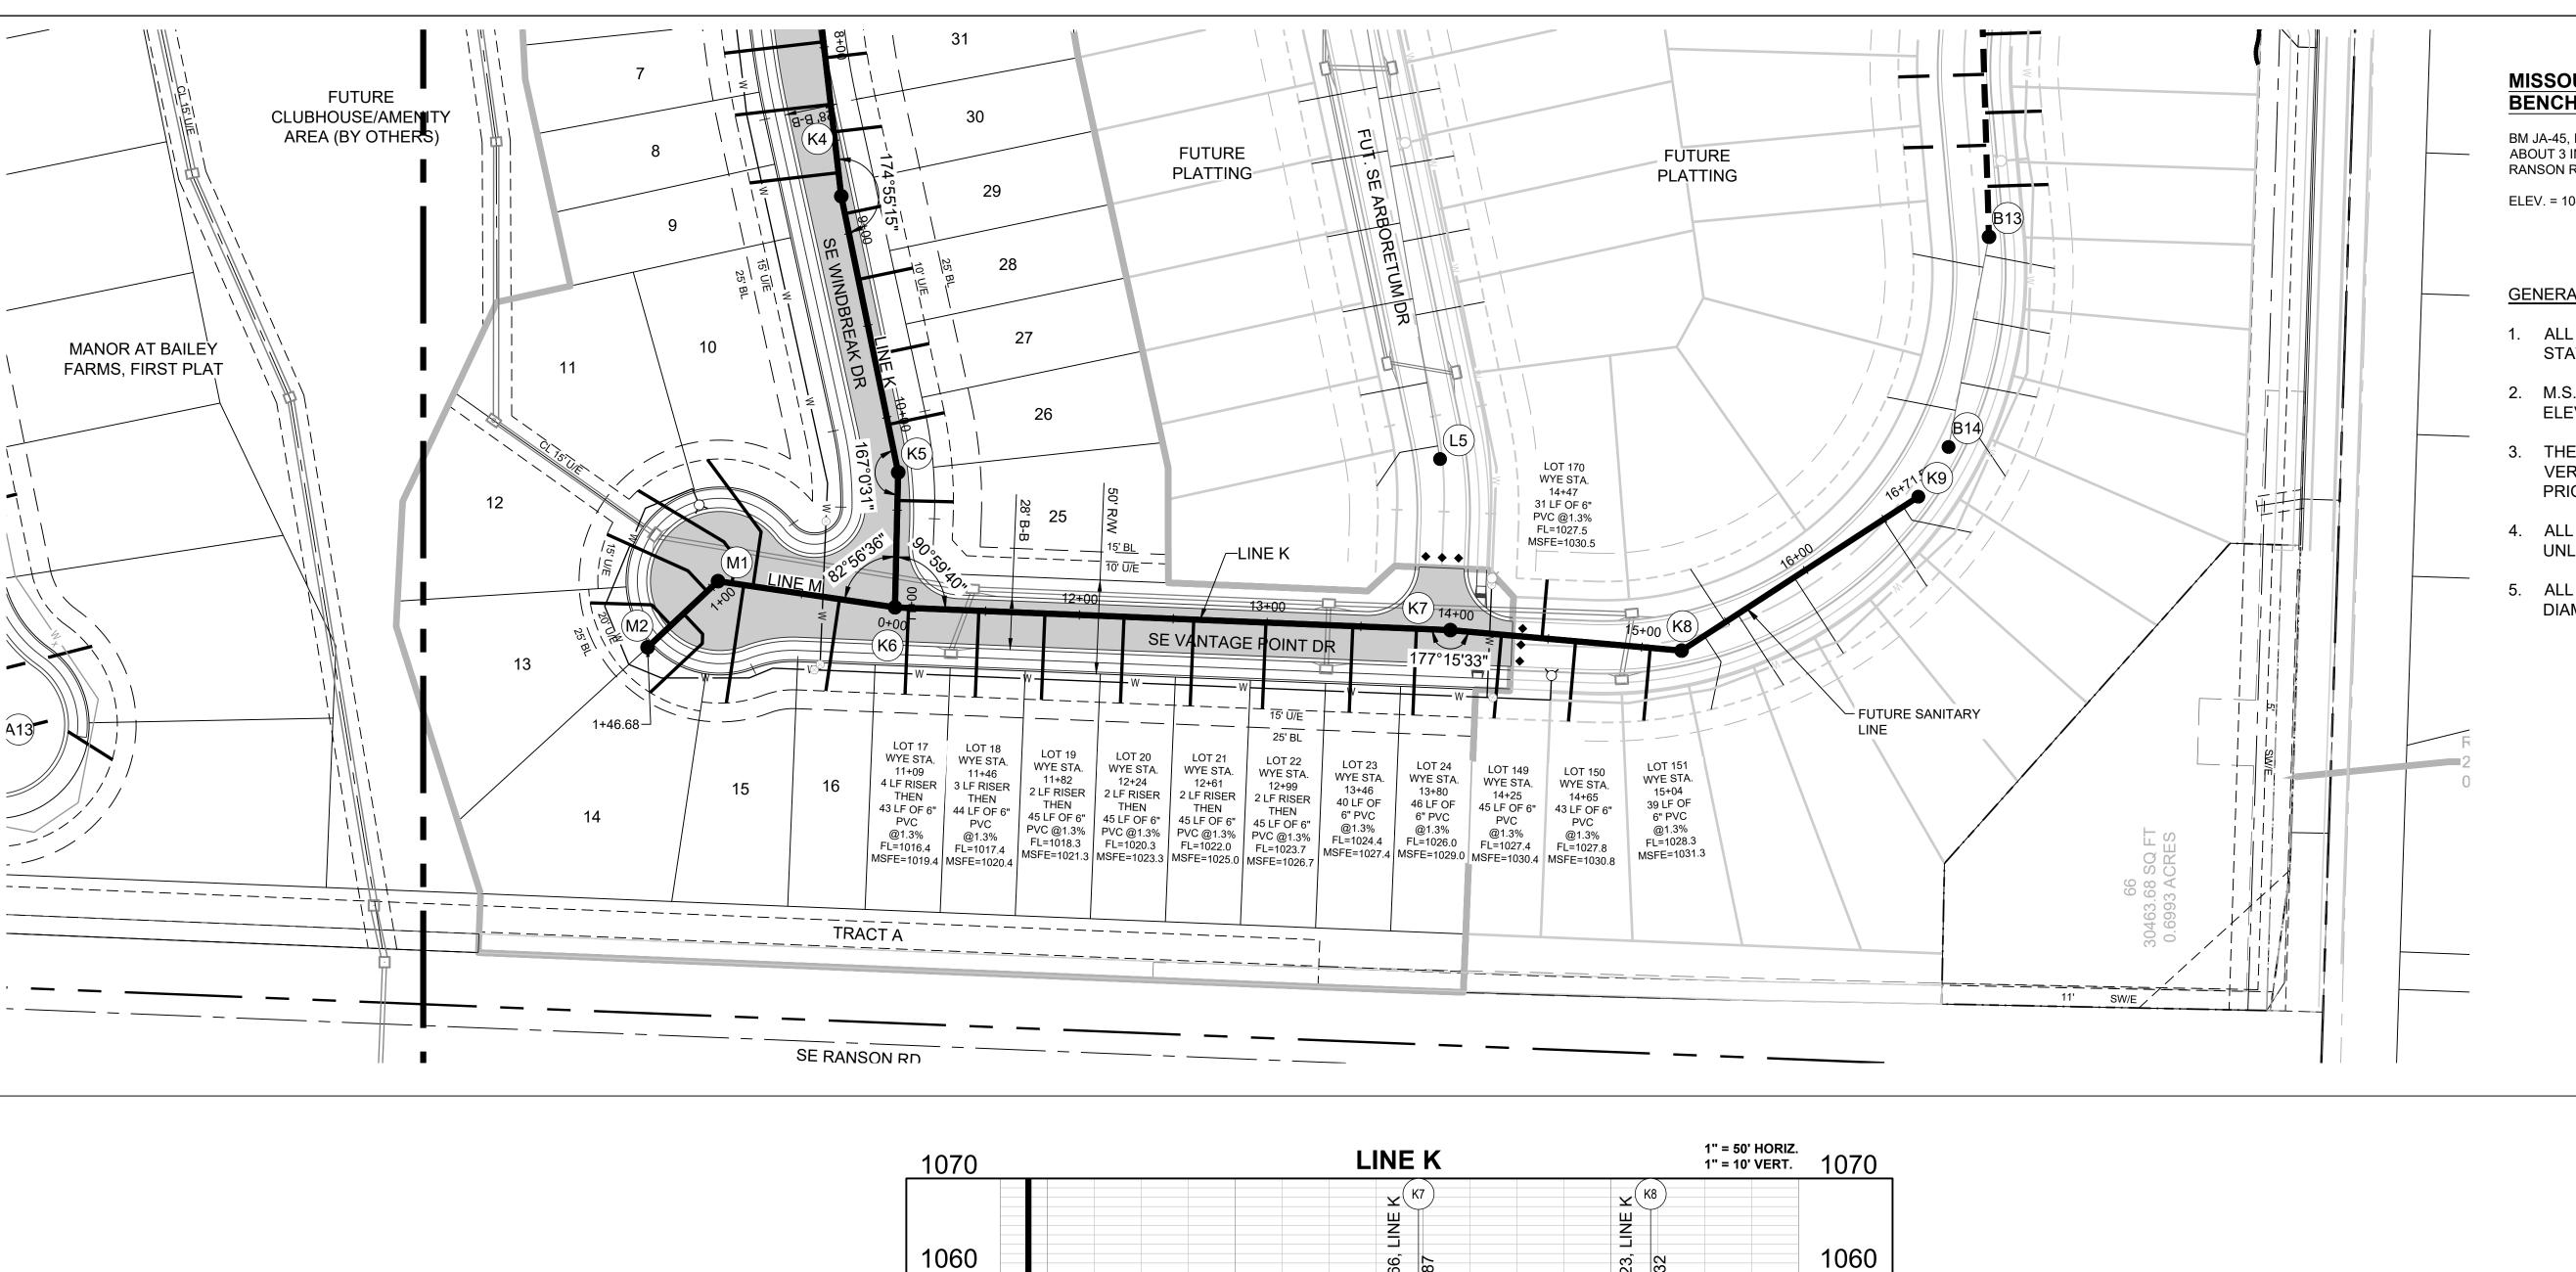

PROPOSED GRADE -

RETREAT AT BAILEY FARMS, FIRST PLAT

15+00

FL OUT (S) 1024.88, 8" PVC SDR-FL IN (N) 1025.08, 8" PVC SDR-26

14+00

FUTURE

1010

1000

990

980

970

16+00

EXISTING GRADE -

295.91 LF 8" PVC SDR-26 @ 4.56%

15" HDPE_ FL=1029.48

13+00

1050

1040

1030

1020

1000

990

980

970

12+00

MISSOURI GEOGRAPHIC REFERENCE SYSTEM **BENCHMARK:**


BM JA-45, IS A KC METRO ALUMINUM GRS DISK SET IN CONCRETE AND ABOUT 3 INCHES BELOW THE PAVEMENT ON THE SHOULDER OF SE RANSON ROAD. IT IS STAMPED JA45, 1987.

ELEV. = 1046.25

GENERAL NOTES

- 1. ALL WYES ARE STATIONED USING MAIN LINE STATIONS.
- 2. M.S.F.E DENOTES MINIMUM SEWERABLE FLOOR ELEVATION.
- 3. THE CONTRACTOR IS RESPONSIBLE FOR VERIFYING ALL EXISTING UTILITY LOCATIONS PRIOR TO EXCAVATIONS.
- 4. ALL SERVICE LINES ARE TO BE 90° TO THE MAIN UNLESS OTHERWISE NOTED.
- 5. ALL SANITARY SEWER MANHOLES ARE 4' DIAMETER UNLESS OTHERWISE NOTED.





SCALE: 1" = 50'

RETREAT AT BAILEY SANITARY MAIN E 1060 1050 1040 15" HDPE_____ FL=1033.90 1030 _8" Water FL=1032.65 123.57 LF 8" PVC SDR-26 @ 1.17% 1020

PREPARED BY:

JAMES L. LONG

NUMBER

SCHLAGEL & ASSOCIATES, P.A.


2/10/2022

Y ROAD & ! LEE'S SUN

BAILEY

LINE PROFILE (2)

SHEET

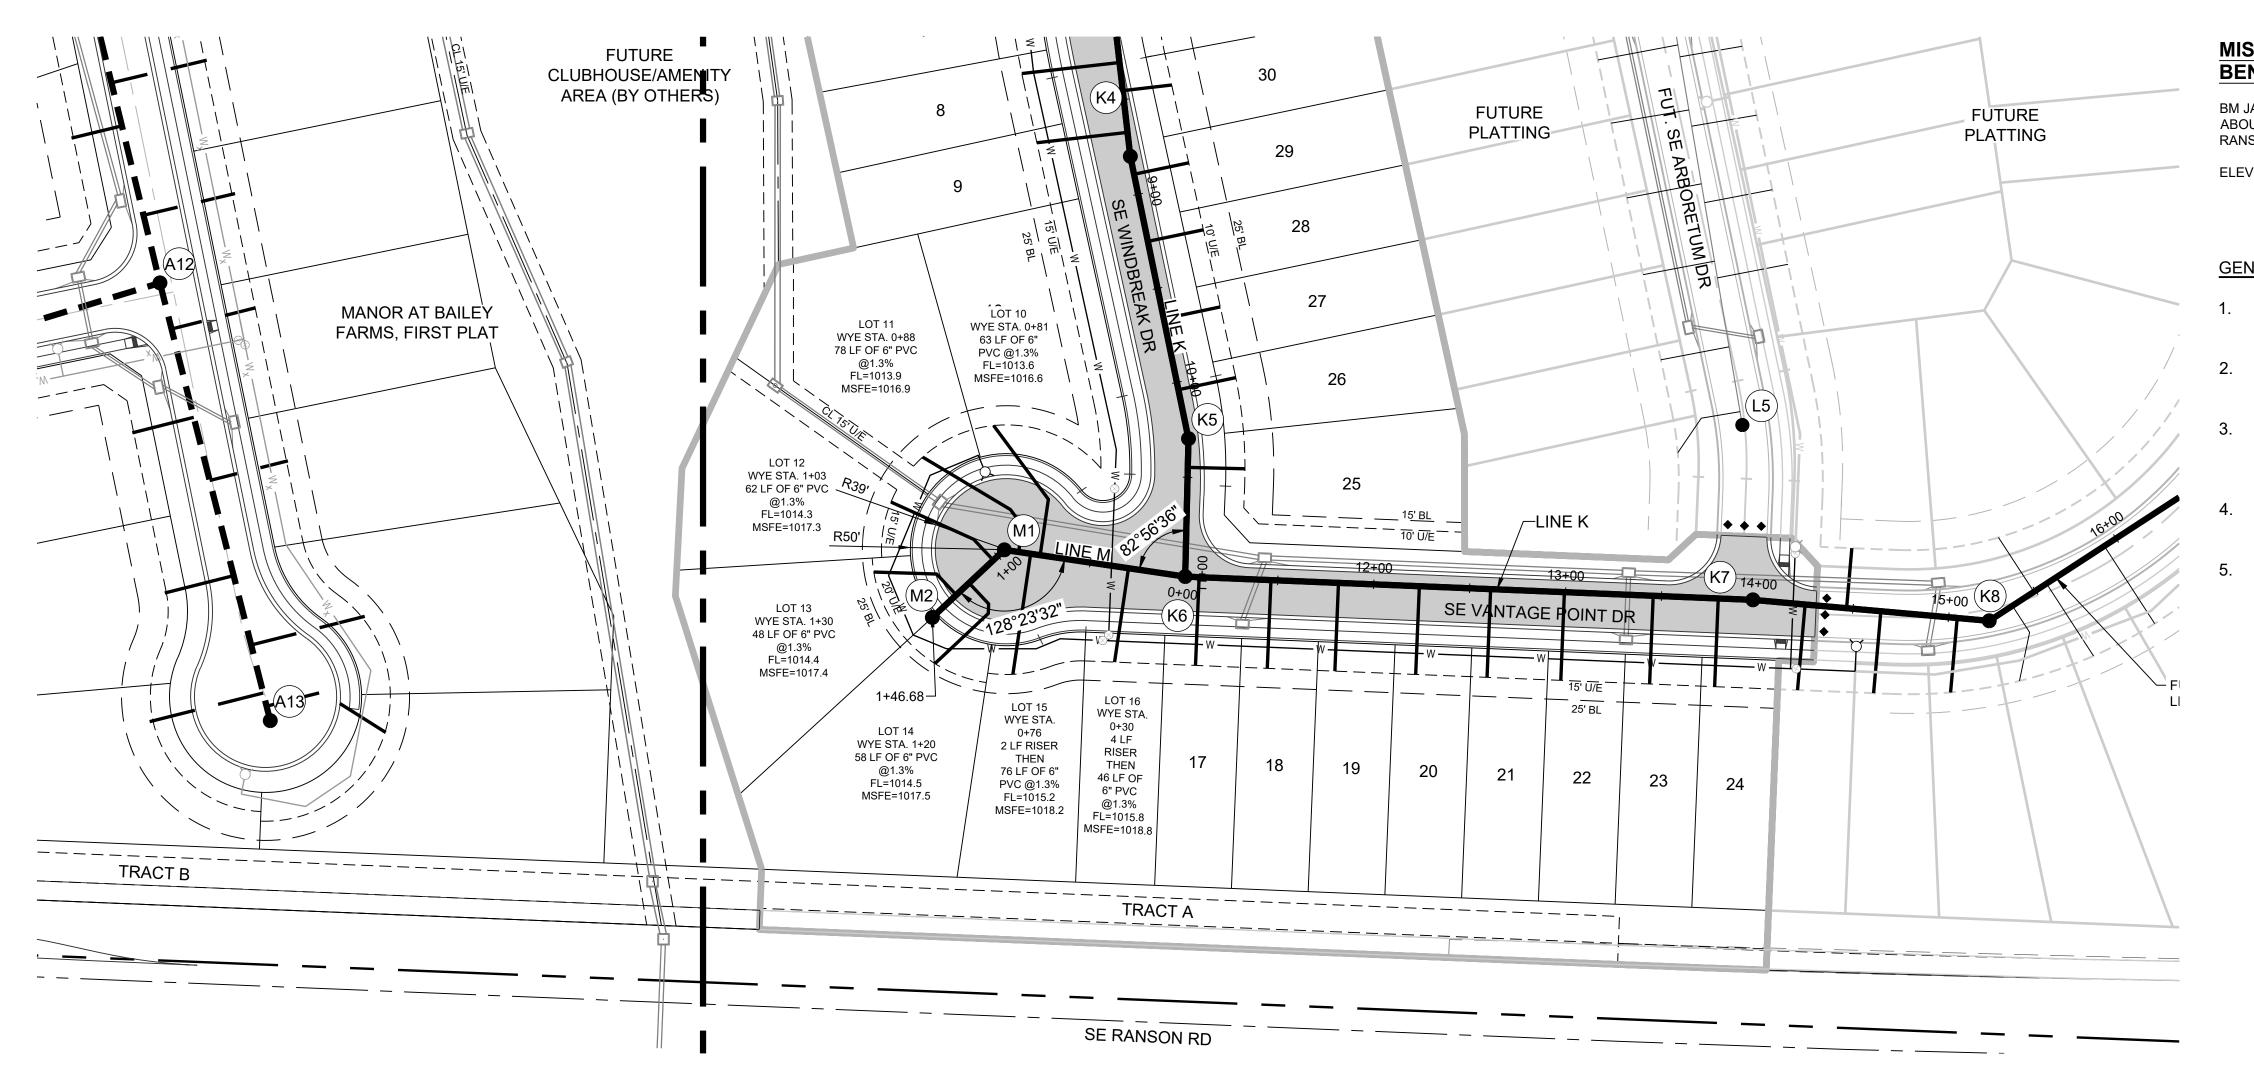

MISSOURI GEOGRAPHIC REFERENCE SYSTEM BENCHMARK:


BM JA-45, IS A KC METRO ALUMINUM GRS DISK SET IN CONCRETE AND ABOUT 3 INCHES BELOW THE PAVEMENT ON THE SHOULDER OF SE RANSON ROAD. IT IS STAMPED JA45, 1987.

ELEV. = 1046.25


GENERAL NOTES:

- ALL WYES ARE STATIONED USING MAIN LINE STATIONS.
- 2. M.S.F.E DENOTES MINIMUM SEWERABLE FLOOR ELEVATION.
- 3. THE CONTRACTOR IS RESPONSIBLE FOR VERIFYING ALL EXISTING UTILITY LOCATIONS PRIOR TO EXCAVATIONS.
- 4. ALL SERVICE LINES ARE TO BE 90° TO THE MAIN UNLESS OTHERWISE NOTED.
- 5. ALL SANITARY SEWER MANHOLES ARE 4' DIAMETER UNLESS OTHERWISE NOTED.





SCALE: 1" = 50'

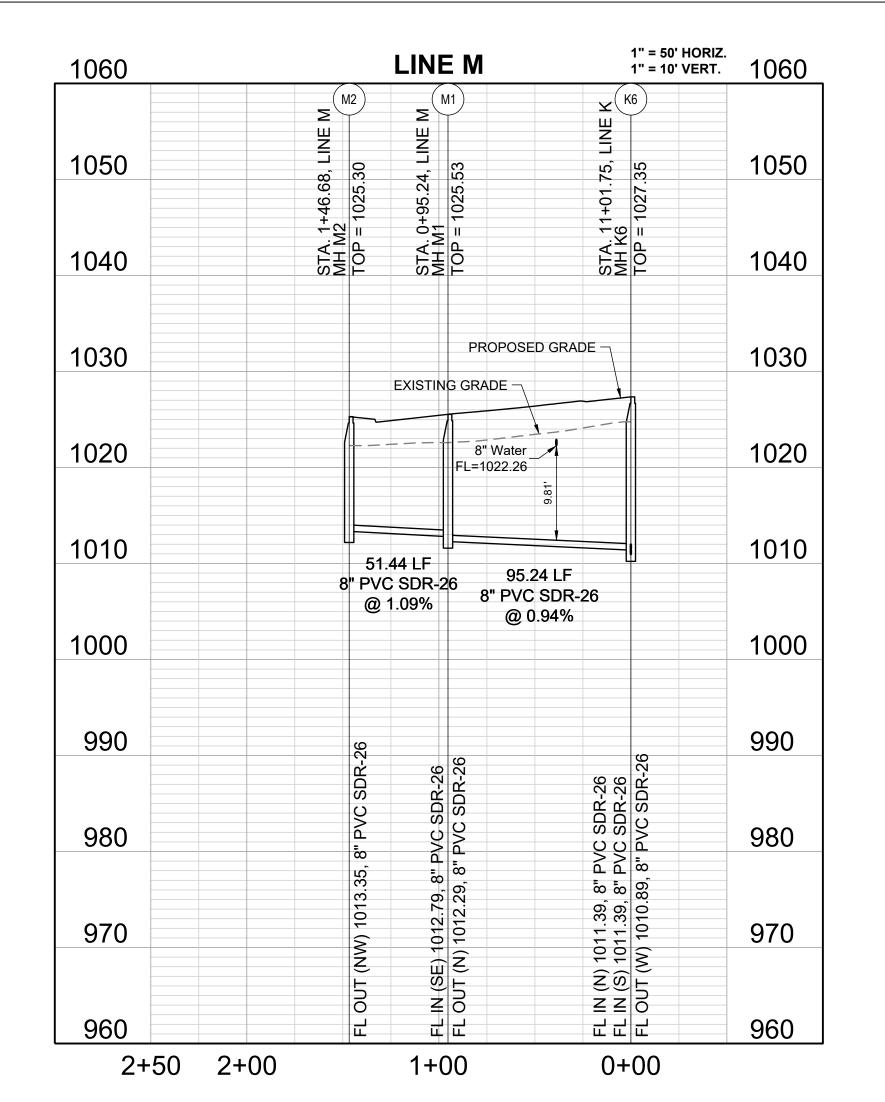

RETREAT AT BAILEY FARMS, FIRST PLAT SANITARY MAIN EXTENSION PLANS SE BAILEY ROAD & SE RANSON ROAD LEE'S SUMMIT, MO

PREPARED BY:

JAMES L. LONG

NUMBER

SCHLAGEL & ASSOCIATES, P.A.

2/10/2022

CHECKED BY:

JLL

JLL


DATE PREPAREI


02/09/2022

PROJ. NUMBER

LINE M PLAN AND PROFILE

SHEET

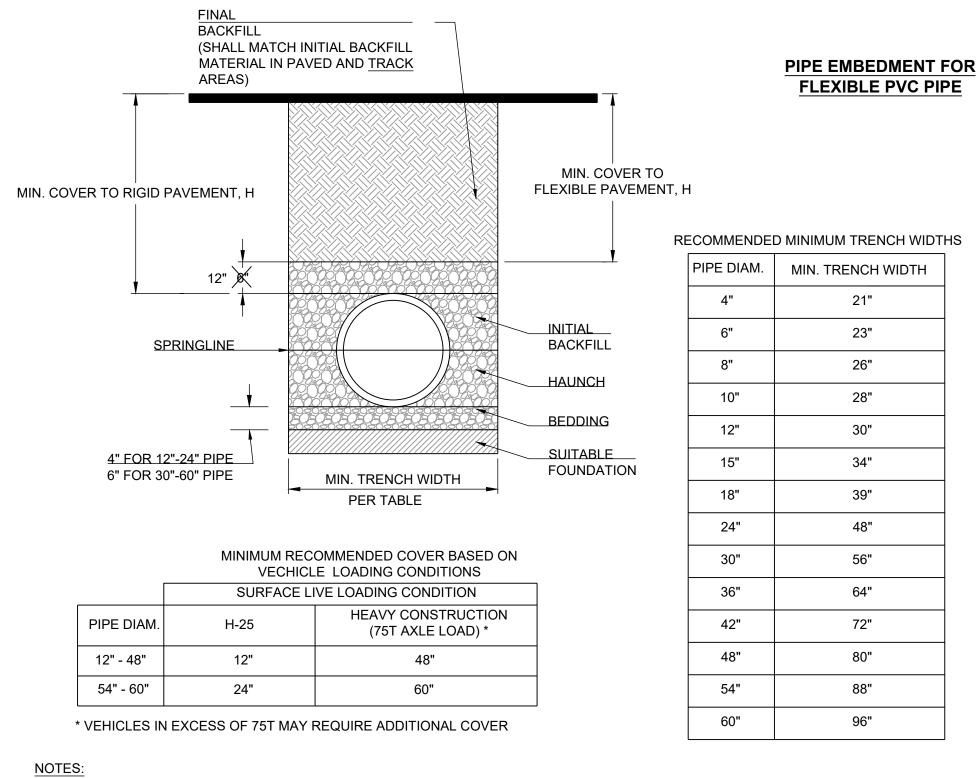

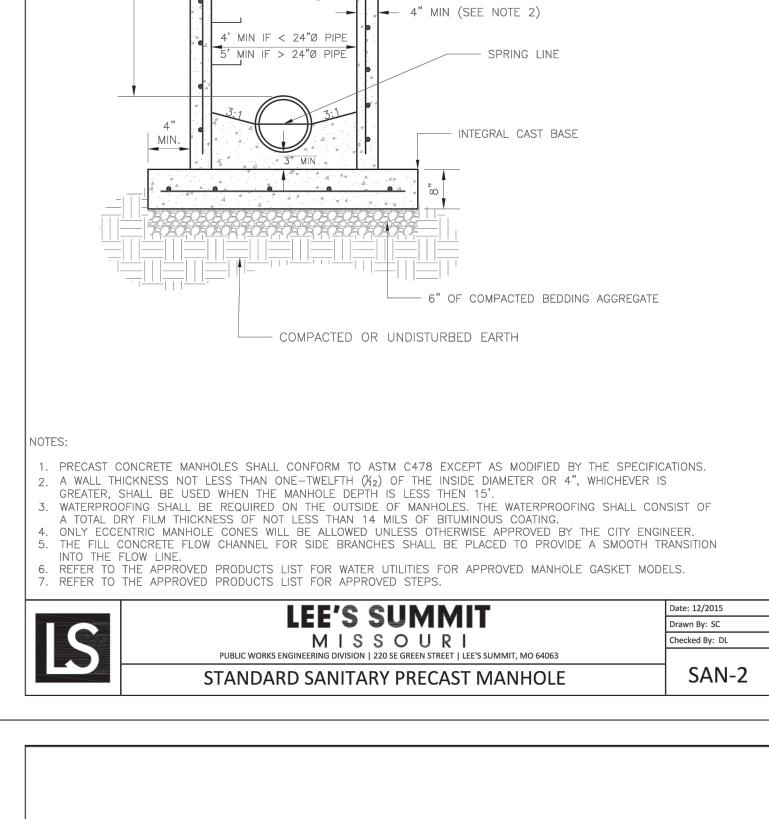

REFER TO THE APPROVED PRODUCTS LIST


FOR WATER UTILITIES FOR MANHOLE CASTINGS


--- FINISH GRADE


PROVIDE JOINT SEALANT BETWEEN ALL JOINTS AND WRAP EXTERIOR OF JOINTS IN ACCORDANCE WITH SECTION 3500

12" MAXIMUM ADJUSTING RINGS

AS REQUIRED

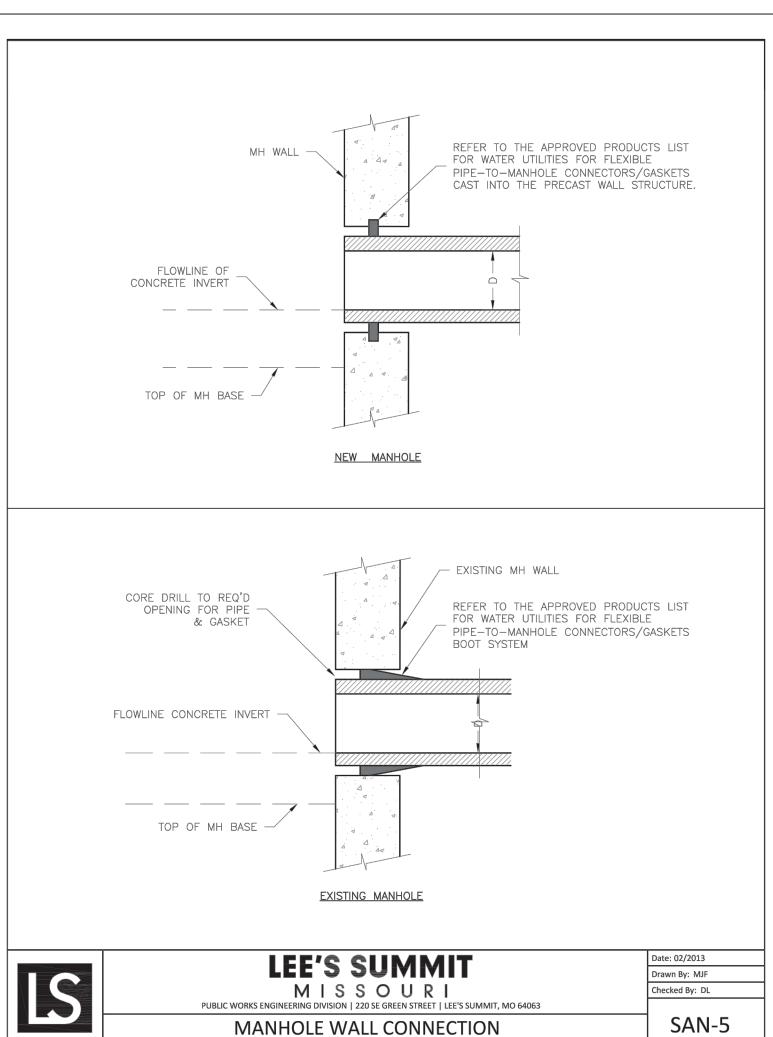

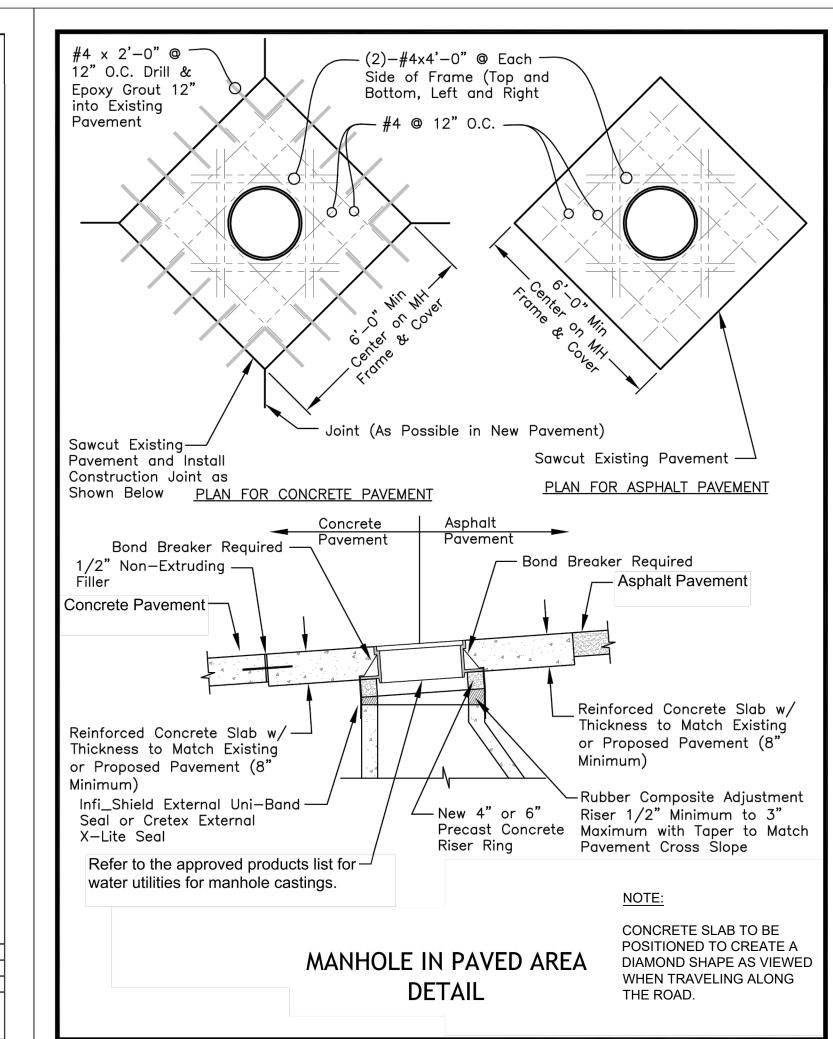

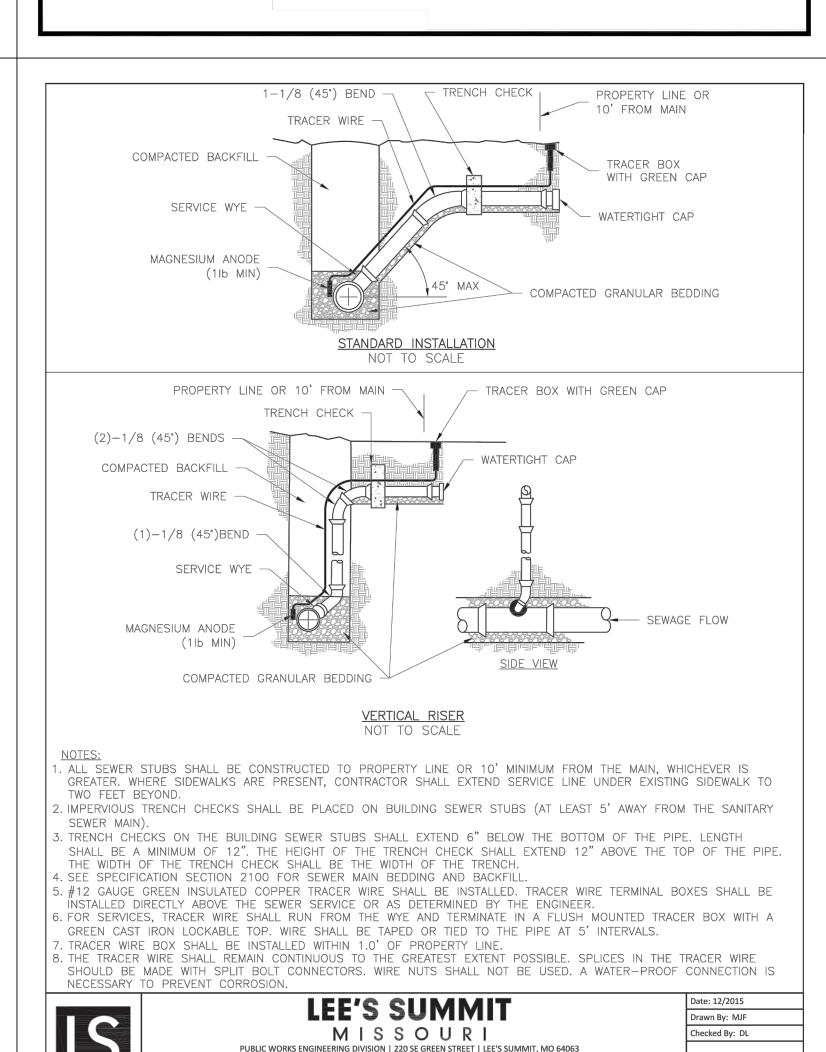


SANITARY SEWER STUB DETAIL




1. ALL PIPE SYSTEMS SHALL BE INSTALLED IN ACCORDANCE WITH ASTM D2321, "STANDARD PRACTICE FOR UNDERGROUND INSTALLATION OF THERMOPLASTIC PIPE FOR SEWERS AND OTHER GRAVITY FLOW APPLICATIONS", LATEST EDITION

- 2. MEASURES SHOULD BE TAKEN TO PREVENT MIGRATION OF NATIVE FINES INTO BACKFILL MATERIAL, WHEN REQUIRED.
- 3. FOUNDATION: WHERE THE TRENCH BOTTOM IS UNSTABLE, THE CONTRACTOR SHALL EXCAVATE TO A DEPTH REQUIRED BY THE ENGINEER AND REPLACE WITH SUITABLE MATERIAL AS SPECIFIED BY THE ENGINEER. AS AN ALTERNATIVE AND AT THE DISCRETION OF THE DESIGN ENGINEER, THE TRENCH BOTTOM MAY BE STABILIZED USING A GEOTEXTILE MATERIAL.
- 4. BEDDING: SUITABLE MATERIAL SHALL BE CLASS I, II OR III. THE CONTRACTOR SHALL PROVIDE DOCUMENTATION FOR MATERIAL SPECIFICATION TO ENGINEER. UNLESS OTHERWISE NOTED BY THE ENGINEER, MINIMUM BEDDING THICKNESS SHALL BE 4" (100mm) FOR 4"-24" (100mm-600mm); 6" (150mm) FOR 30"-60" (750mm-900mm).
- 5. INITIAL BACKFILL: SUITABLE MATERIAL SHALL BE CLASS I, II OR III IN THE PIPE ZONE EXTENDING NOT LESS THAN 6" ABOVE CROWN OF PIPE. THE CONTRACTOR SHALL PROVIDE DOCUMENTATION FOR MATERIAL SPECIFICATION TO ENGINEER. MATERIAL SHALL BE INSTALLED AS REQUIRED IN ASTM D2321, LATEST EDITION.

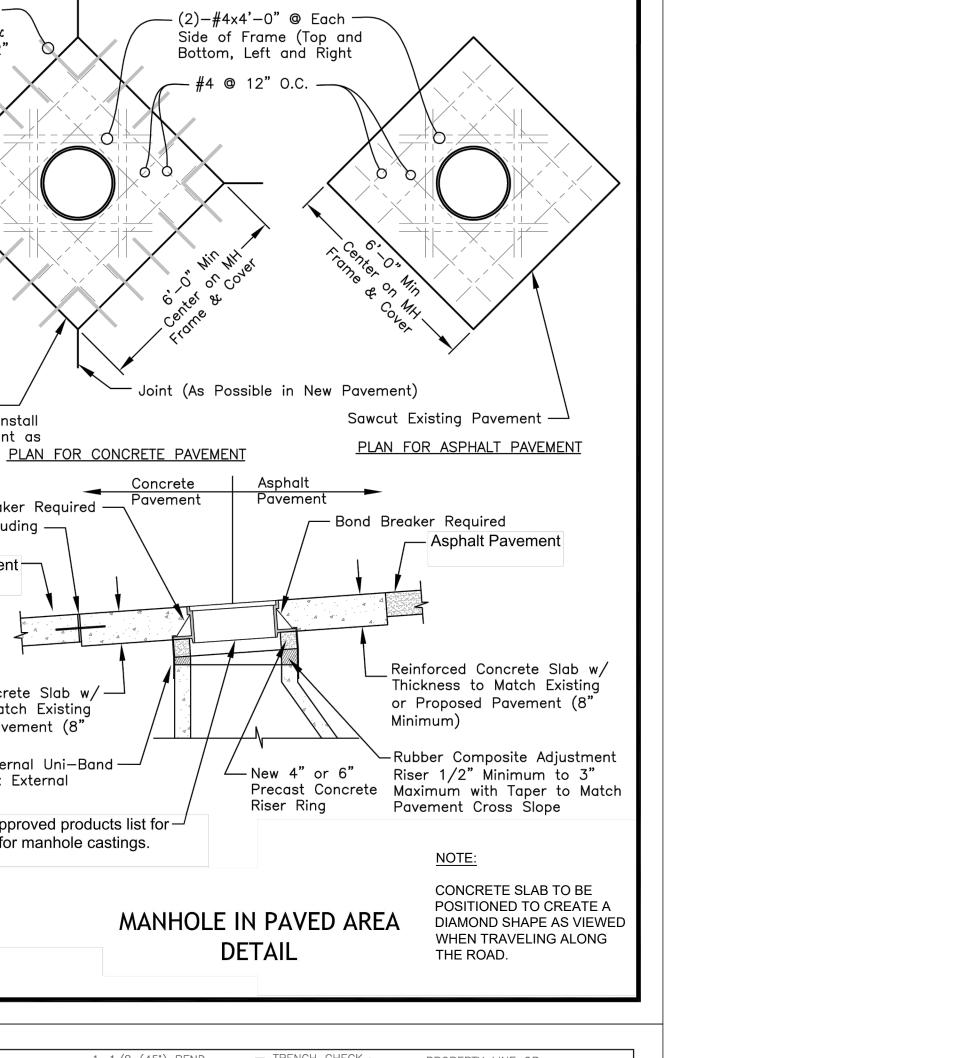

SAN-1

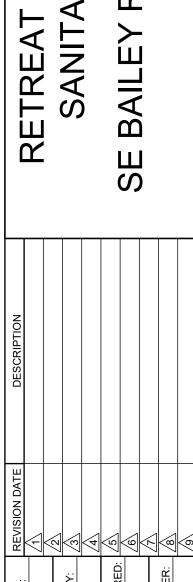

PREPARED BY:

JAMES L. LONG

NUMBER

SCHLAGEL & ASSOCIATES, P.A.

2/10/2022

0

Z

FARMS, F TENSION

SHEET

SANITARY

SEWER DETAILS