

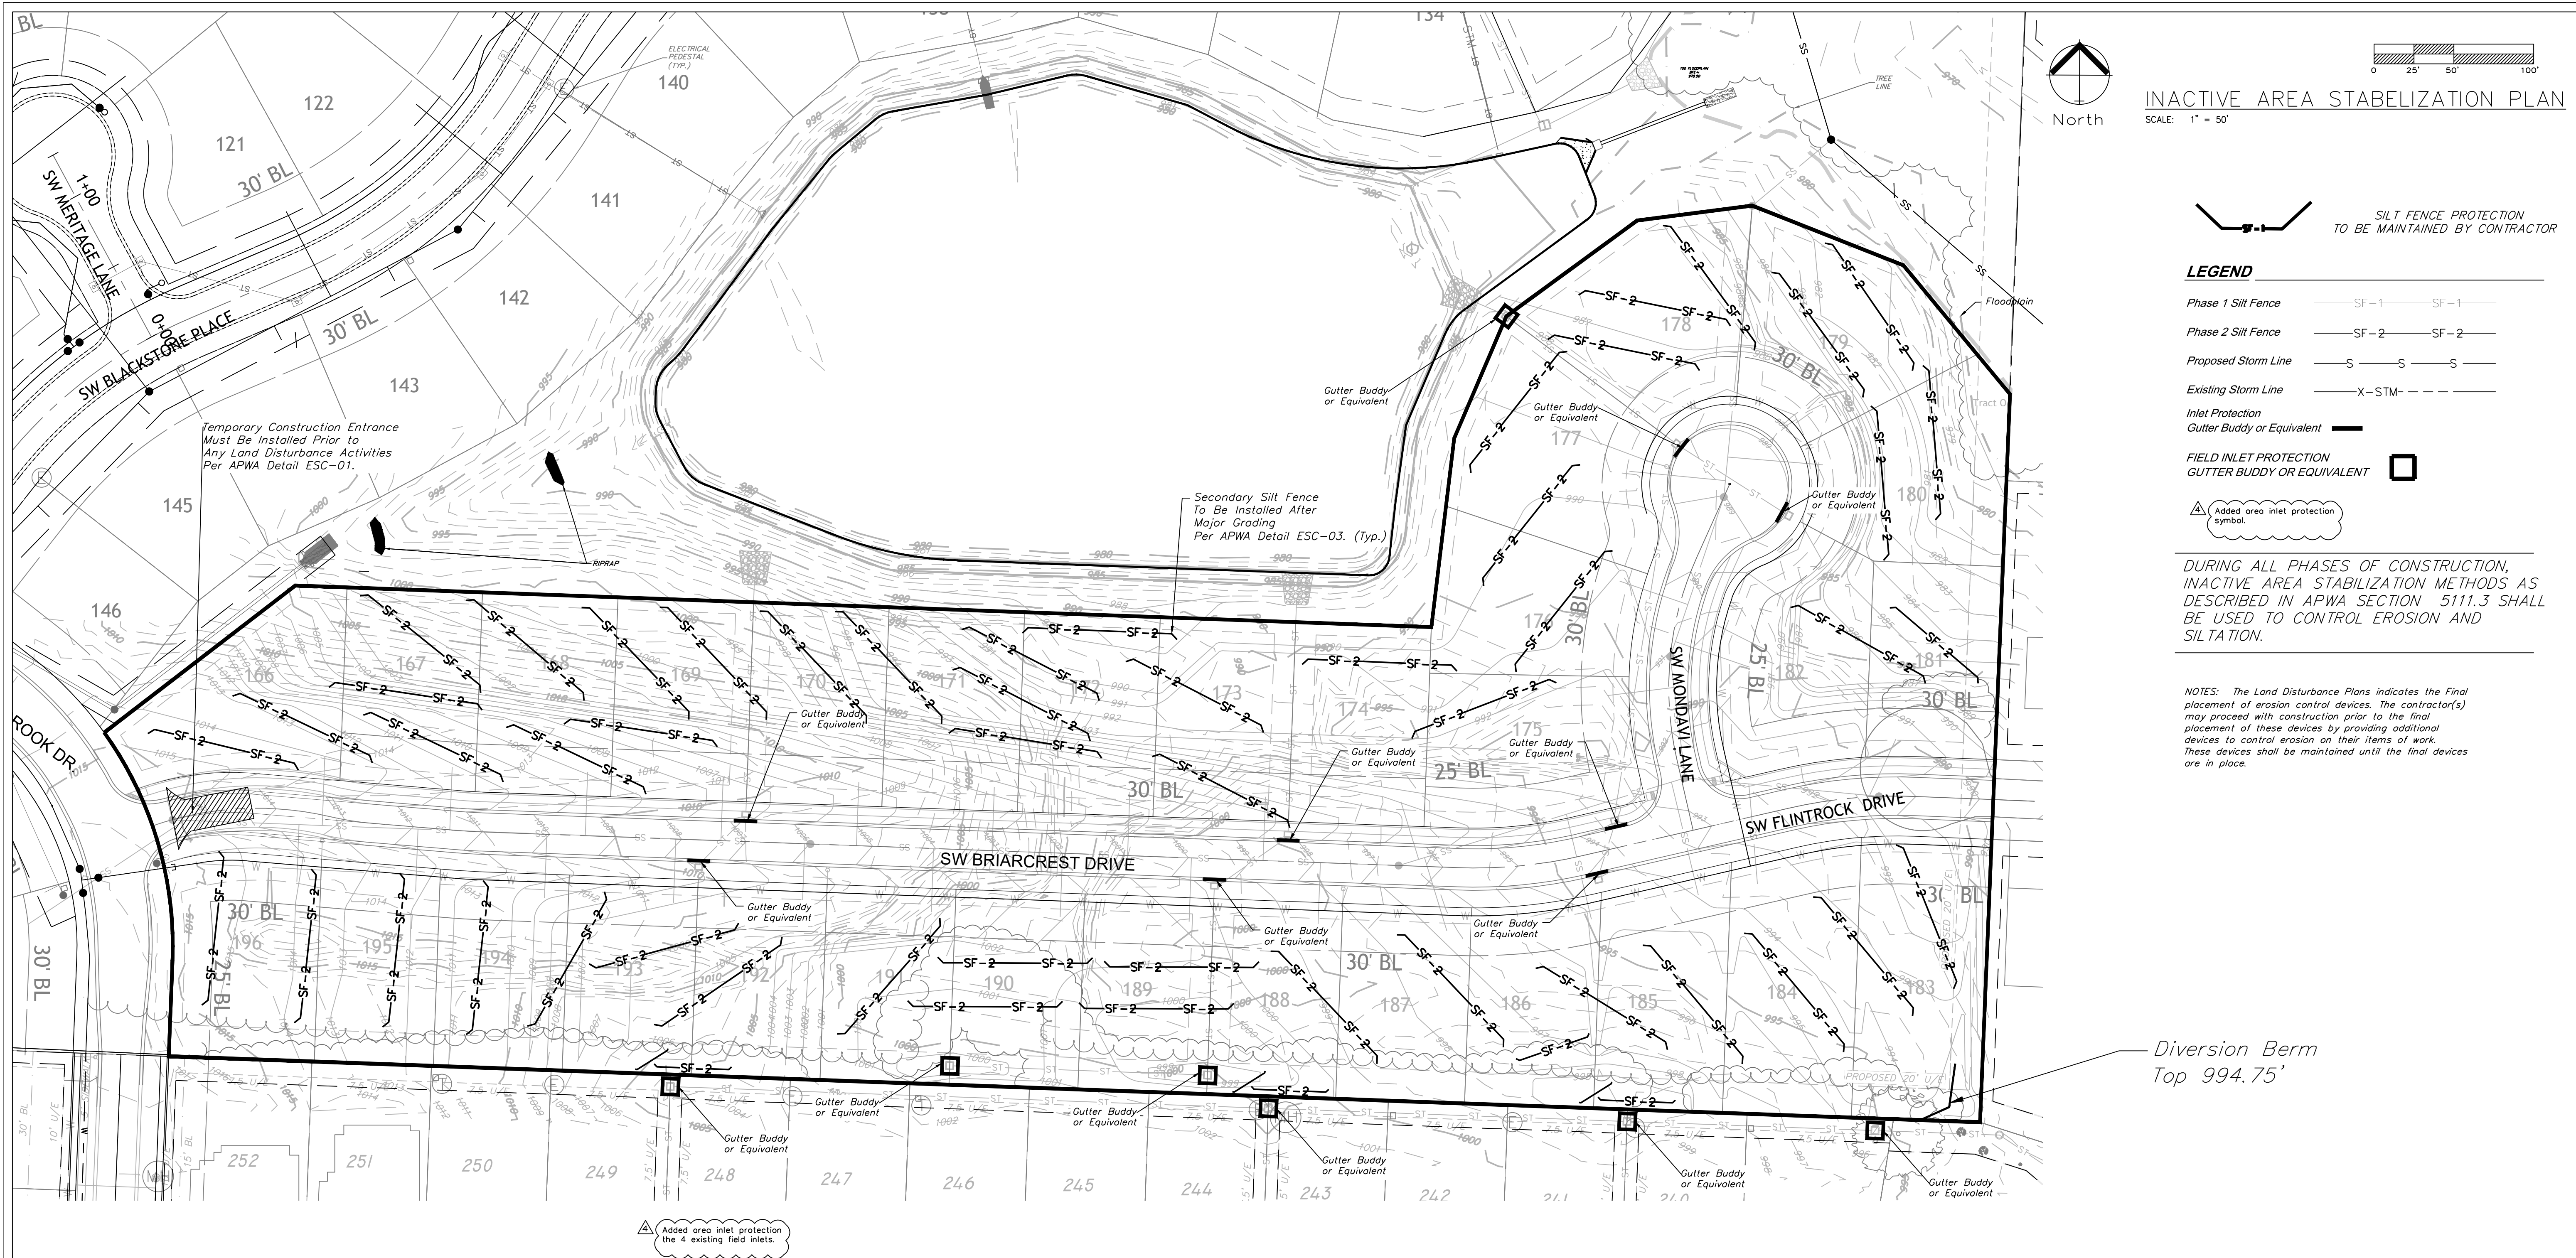


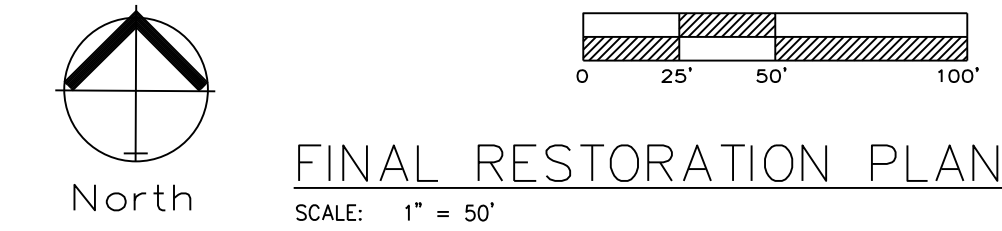

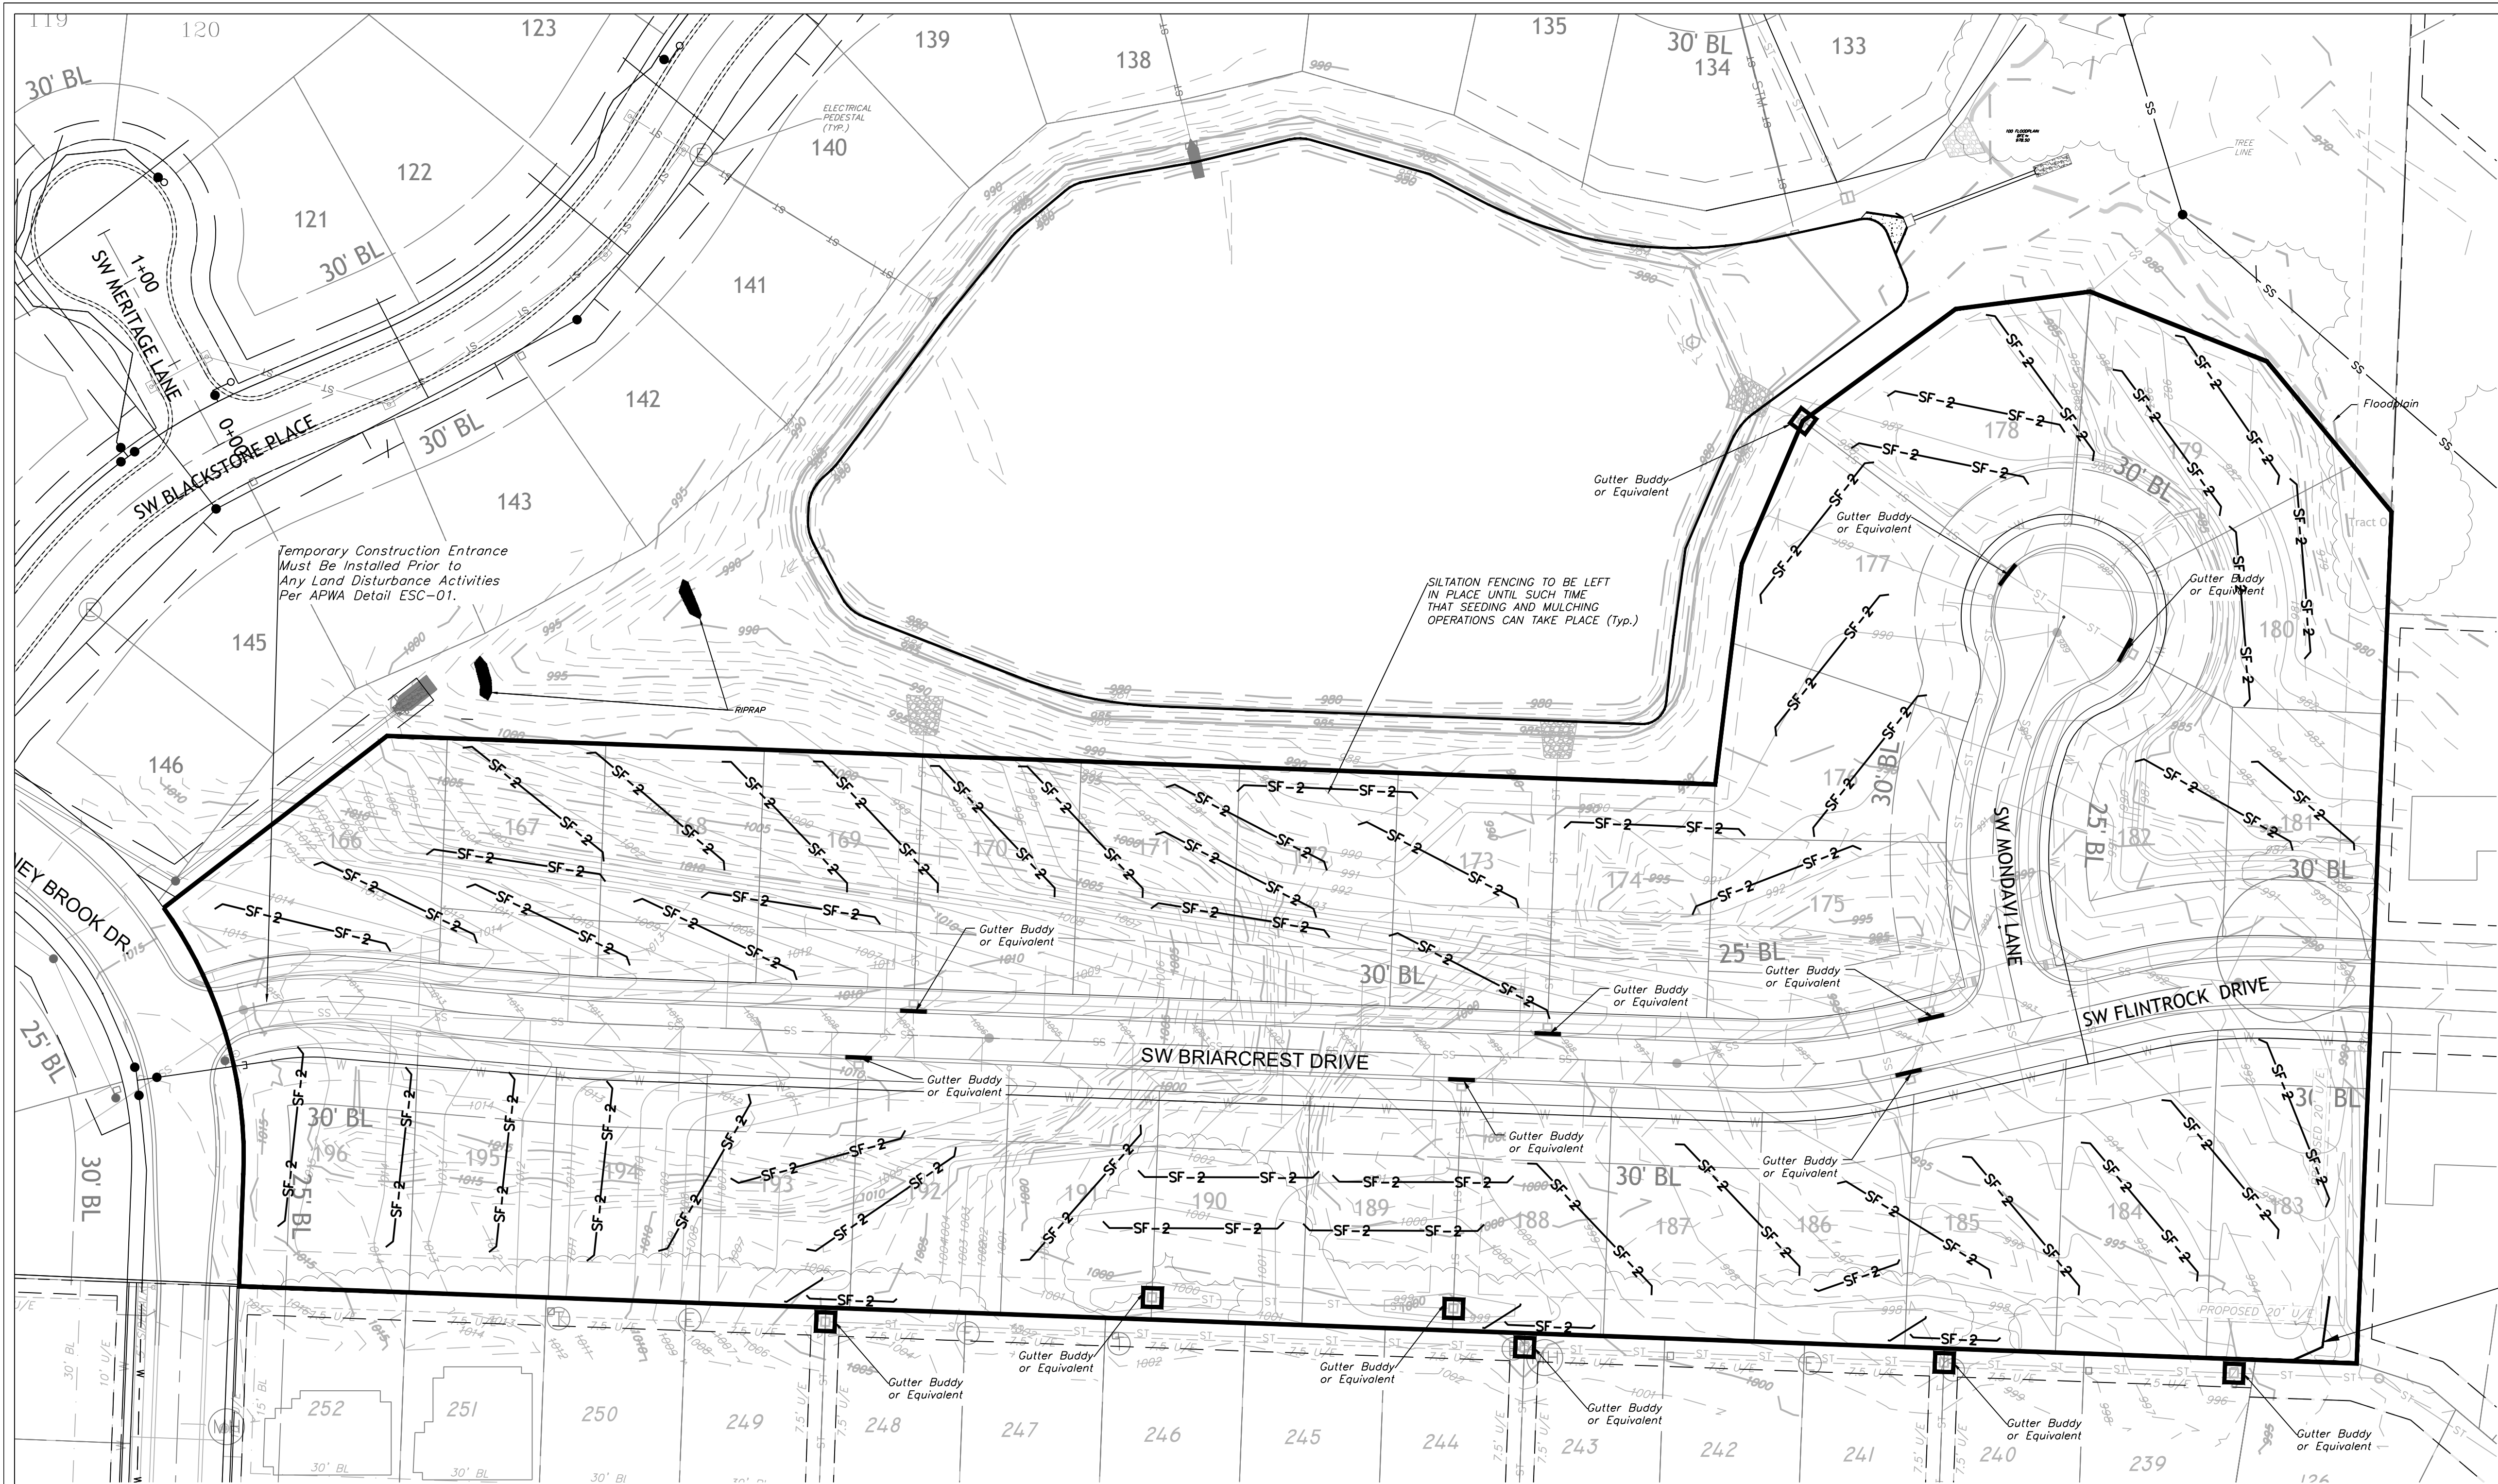

SILT FENCE PROTECTION
TO BE MAINTAINED BY CONTRACTOR

LEGEND

PHASE 1 SILT FENCE ———— SF-4 ———— SF-4 ————

PHASE 2 SILT FENCE ———— SF-2 ———— SF-2 ————

INLET PROTECTION
GUTTER BUDDY OR EQUIVALENT ————

FIELD INLET PROTECTION
GUTTER BUDDY OR EQUIVALENT □

Added area inlet protection
symbol.

DURING ALL PHASES OF CONSTRUCTION, INACTIVE AREA STABILIZATION
METHODS AS DESCRIBED IN APWA SECTION 5111.3 SHALL BE USED TO
CONTROL EROSION AND SILTATION.

ONCE SITE IS 90% VEGETATED ALL ESC DEVICES SHALL BE REMOVED
AND ANY DISTURBED AREAS SHALL BE RESTORED

NOTES:

- 1) The Land Disturbance Plans indicates the Final placement of erosion control devices. The contractor(s) may proceed with construction prior to the final placement of these devices by providing additional devices to control erosion on their items of work. These devices shall be maintained until the final devices are in place.
- 2) Per Unified Ordinance Section 14.090.B.2. All portions of the site not covered with paving or buildings shall be landscaped. Open areas not covered with other materials shall be covered with sod. Ground cover shall be utilized on all slopes in excess of 3:1 slope.

ONCE SITE IS 90% VEGETATED ALL ESC
DEVICES SHALL BE REMOVED AND ANY
DISTURBED AREAS SHALL BE RESTORED

Diversion Berm
Top 994.75'

Added area inlet protection
the 4 existing field inlets.

SEED AND MULCH NOTES:

Seeding shall be done before the proposed seedbed becomes eroded, crusted over, or dried out and shall not be done when the ground is frozen, or covered with snow. The seed shall comply with the requirements of the Missouri Seed Law and the Federal Seed Act. Also, it shall contain no seed of any plant on the Federal Noxious Weed List. Other weed seeds shall not exceed one percent by weight of mix

Seed and Fertilizer Rate:
Mix I - Rye Grass / Blue Grass ----- 100 lbs. per Acre
Mix II - Tall Fescue / Blue Grass ----- 195 lbs. per Acre
Lime -----2000 lbs per Acre (50 lbs. per 1000 sq. ft.)
Fertilizer -----800 to 1200 lbs per Acre (25 lbs per 1000 sq. ft.)

During the dates December 15th through May 31 ALL lime fertilizer, seed and mulch shall be applied to finished slopes of disturbed areas. During the months of June, July, October and November 1st through December 15th, lime fertilizer, seed and mulch shall be applied at the following rates:
Lime - 100% of specified quantity
Fertilizer - 75% of the specified quantity
Seed - 50% of the specified quantity
Mulch - 100% of the specified quantity

Mulch shall be Vegetative type, cereal straw from stalks of oats, rye, or barley, or approved equal. The straw shall be free of prohibited weed seed and relatively free of all other noxious and undesirable seed. Mulch shall be applied at the rate of 2 tons per acre, (70 to 90 lbs per 1000 sq. ft.). Mulch shall be embedded by a mulch anchoring tool or disk type roller having flat serrated disks spaced not more than 10 inches apart and cleaning scrapers shall be provided

REVISIONS

- REV. 9/28/2021
- REV. 12/6/2021
- REV. 1/3/2022
- REV. 2/7/2022

