



GREEN KS4130

FA#: 10000343

PACE ID: MRKSL045270

**LTE 3C/5G NR
146'-MONOPOLE**

**RELEASED FOR
CONSTRUCTION**
As Noted on Plans Review

Development Services Department
Lee's Summit, Missouri
03/15/2022



7801 FARLEY
OVERLAND PARK, KS 66204



BLACK & VEATCH

6800 W. 115TH ST, SUITE 2292
OVERLAND PARK, KS 66211
(913) 458-2000

PROJECT/PHASE NO: 129331.1183

DRAWN BY: AKJ

CHECKED BY: TD

SITE INFORMATION

PROPERTY OWNER:	AT&T MOBILITY LLC 5601 LEGACY DRIVE, MS--A3 PLANO, TX 75024
TOWER OWNER:	AT&T
SITE CONTACT:	NA
COUNTY:	JACKSON
LATITUDE (NAD 83):	38° 54' 50.00" N 38.9139
LONGITUDE (NAD 83):	94° 22' 27.01" W -94.3742
OCCUPANCY GROUP:	U
CONSTRUCTION TYPE:	V-B
POWER COMPANY:	AQUILA
TELEPHONE COMPANY:	AT&T

CONTACT INFORMATION

ENGINEER: BLACK & VEATCH CORPORATION
6800 W. 115TH ST, SUITE 2292
OVERLAND PARK, KS 66211


CONTACT: TYLER DAVISON
(913) 458-9654

CONSTRUCTION MANAGER: KELLY MORRISON
(836) 472-8559

SITE ACQUISITION MANAGER: MONICA BRAUTI
(913) 458-8349

RF ENGINEER: AMOR SIMEON
(636) 479-0138

SITE LOCATION MAP

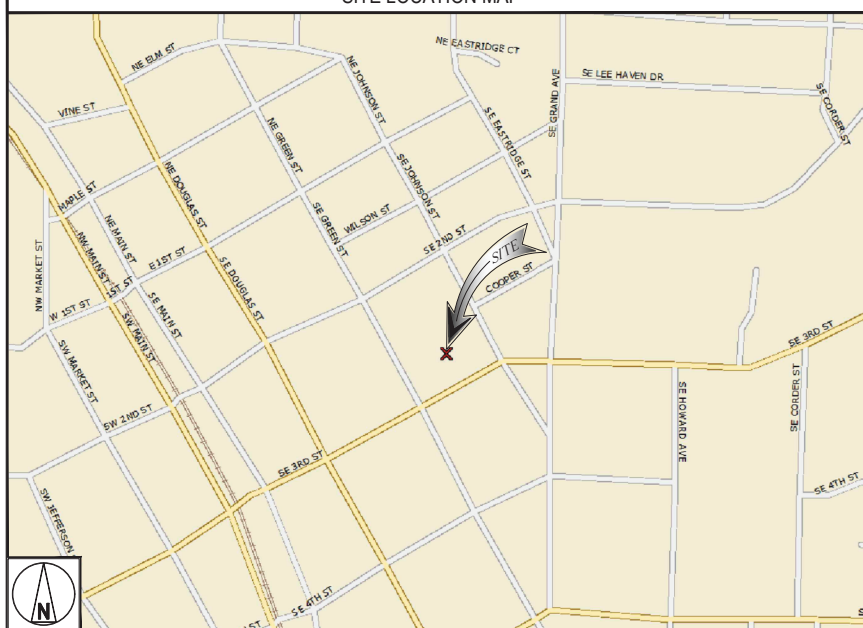

GENERAL NOTES

THE FACILITY IS UNMANNED AND NOT FOR HUMAN HABITATION. A TECHNICIAN WILL VISIT THE SITE AS REQUIRED FOR ROUTINE MAINTENANCE. THE PROJECT WILL NOT RESULT IN ANY SIGNIFICANT DISTURBANCE OR EFFECT ON DRAINAGE; NO SANITARY SEWER SERVICE, POTABLE WATER, OR TRASH DISPOSAL IS REQUIRED AND NO COMMERCIAL SIGNAGE IS PROPOSED.

ENGINEERING

2018 INTERNATIONAL BUILDING CODE OR ADOPTED CODE
2017 NATIONAL ELECTRIC CODE OR ADOPTED CODE
TIA/EIA-222-H OR ADOPTED CODE

DRAWING INDEX

SHEET NO:	SHEET TITLE
T-1	TITLE SHEET
C-1	EQUIPMENT LAYOUT
C-2	ELEVATION
C-3	ANTENNA LAYOUT AND SCHEDULE
C-4	EQUIPMENT DETAILS
RF-1	CABLE COLOR CODING
G-1	GROUNDING ONE-LINE ANTENNA EQUIPMENT
GN-1	LEGEND & ABBREVIATIONS
GN-2	GENERAL CONSTRUCTION NOTES
GN-3	GENERAL ELECTRICAL NOTES
-	RF PLUMBING DIAGRAMS ATTACHED


11"x17" PLOT WILL BE HALF SCALE UNLESS OTHERWISE NOTED

CONTRACTOR SHALL VERIFY ALL PLANS & EXISTING DIMENSIONS & CONDITIONS ON THE JOB SITE & SHALL IMMEDIATELY NOTIFY THE ENGINEER IN WRITING OF ANY DISCREPANCIES BEFORE PROCEEDING WITH THE WORK OR BE RESPONSIBLE FOR SAME



UNDERGROUND
SERVICE ALERT
UTILITIES PROTECTION CENTER, INC.
811

48 HOURS BEFORE YOU DIE




IT IS A VIOLATION OF LAW FOR ANY PERSON
UNLESS THEY ARE ACTING UNDER THE DIRECTION
OF A LICENSED PROFESSIONAL ENGINEER,
TO ALTER THIS DOCUMENT.

GREEN
KS4130
202 EAST THIRD STREET
LEE'S SUMMIT, MO 64063
LTE 3C/5G NR

SHEET TITLE
TITLE SHEET

SHEET NUMBER

T-1

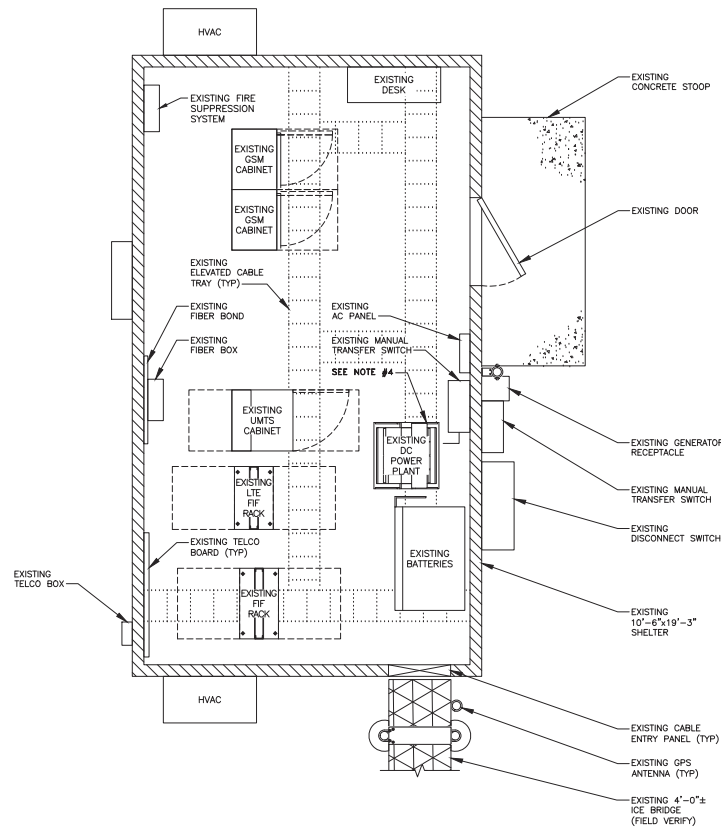

1. CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS.
2. CONTRACTOR SHALL FIELD VERIFY EXISTING HVAC UNITS. IF LESS THAN 3 TON RATING, CONTRACTOR SHALL REMOVE EXISTING UNITS AND REPLACE WITH 3 TON RATED UNITS, MATCHING EXISTING MANUFACTURER.
3. IF APPLICABLE, FSM4 BBU TO BE INSTALLED/UPGRADED AND GROUNDED BY OTHERS, PER AT&T INSTALLATION STANDARDS.
4. EXISTING RACK MOUNTED DC6 SURGE SUPPRESSION UNIT SHALL BE UPGRADED WITH PROPOSED MODULES OR SWAPPED OUT FOR PROPOSED RACK MOUNTED DC12 SURGE SUPPRESSION UNIT, WHEN REQUIRED FOR UPGRADE.
4. CONTRACTOR TO INSTALL POWER CONVERTERS IN DC CONVERTER FOR PROPOSED RRHs.

NOTES

**RELEASED FOR
CONSTRUCTION**
As Noted on Plans Review

Development Services Department
Lee's Summit, Missouri
03/15/2022



7801 FARLEY
OVERLAND PARK, KS 66204



BLACK & VEATCH

6800 W. 115TH ST, SUITE 2292
OVERLAND PARK, KS 66211
(913) 458-2000

PROJECT/PHASE NO: 129331.1183

DRAWN BY: AKJ

CHECKED BY: TD

REV	DATE	DESCRIPTION
1	07/27/21	SAC COMMENTS
0	07/13/21	ISSUED FOR CONSTRUCTION



IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.


GREEN
KS4130
202 EAST THIRD STREET
LEE'S SUMMIT, MO 64063
LTE 3C/5G NR

SHEET TITLE
EQUIPMENT LAYOUT


SHEET NUMBER

C-1


FINAL EQUIPMENT LAYOUT



THIS DOCUMENT WAS PREPARED BASED ON THE INFORMATION PROVIDED TO BLACK & VEATCH. IF EXISTING CONDITIONS DO NOT REFLECT THOSE REPRESENTED, THESE CONSTRUCTION DRAWINGS ARE NO LONGER VALID.

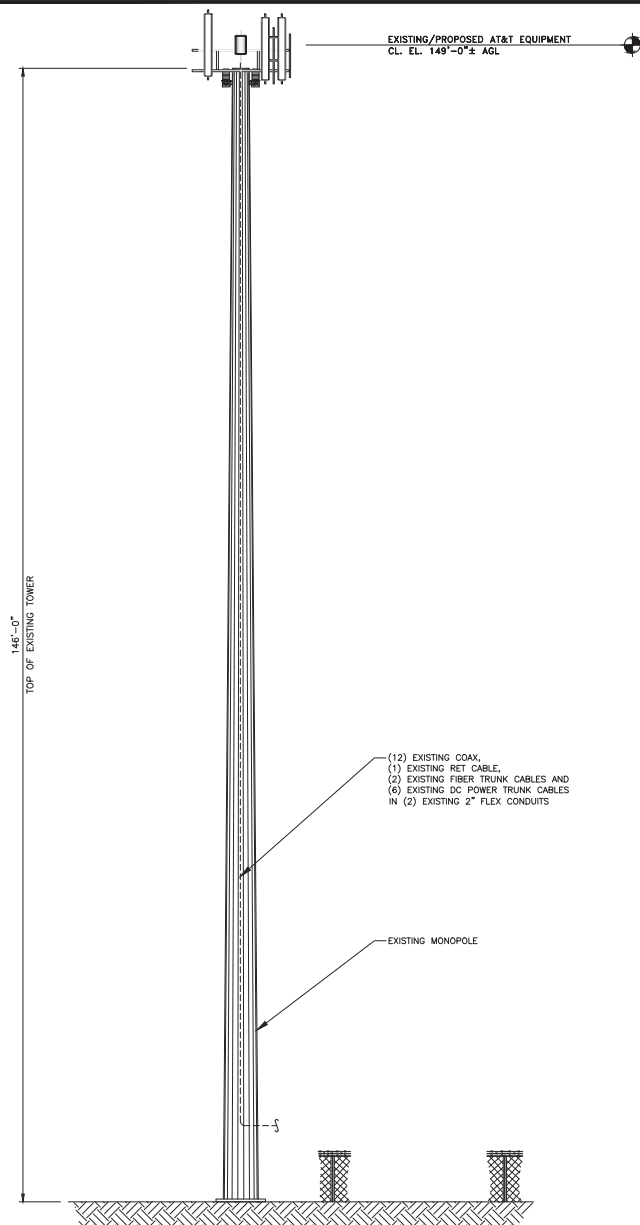

FINAL ELEVATION



- REMOVE:
- (3) EXISTING ANTENNAS
 - (6) EXISTING RRHs
- INSTALL:
- (3) PROPOSED ANTENNAS
 - (3) PROPOSED RRHs

**RELEASED FOR
CONSTRUCTION**
As Noted on Plans Review

Development Services Department
Lee's Summit, Missouri
03/15/2022

TOWER SCOPE OF WORK

B

THE PASSING STRUCTURAL ANALYSIS FOR THE EXISTING STRUCTURE WAS COMPLETED BY SINNOTT GERING AND SCHMITT TOWERS INC. ON 07/02/2021.

STRUCTURAL ANALYSIS NOTE

C

THE PASSING ANTENNA MOUNT ANALYSIS EVALUATION LETTER FOR THE EXISTING MOUNTS WAS COMPLETED BY BLACK & VEATCH ON 03/08/2021. THE MOUNT HAS SUFFICIENT CAPACITY FOR THE EXISTING AND PROPOSED LOADINGS OBSERVED ON THESE CONSTRUCTION DRAWINGS.

MOUNT ANALYSIS NOTE

D

1. GROUND EQUIPMENT NOT SHOWN FOR CLARITY.
2. ANY ADDITIONAL EQUIPMENT NOTED ON THE STRUCTURAL ANALYSIS SHOULD BE CONSIDERED AS RESERVED LOADING, WHICH COULD BE INSTALLED AT A FUTURE DATE.
3. CONTRACTOR SHALL REFER TO THE STRUCTURAL ANALYSIS FOR THE FINAL CABLE ROUTING, PLACEMENT, AND QUANTITY OF ALL AT&T CABLES.

GENERAL NOTES

E



7801 FARLEY
OVERLAND PARK, KS 66204



BLACK & VEATCH


6800 W. 115TH ST, SUITE 2292
OVERLAND PARK, KS 66211
(913) 458-2000

PROJECT/PHASE NO: 129331.1183

DRAWN BY: AKJ

CHECKED BY: TD

REV	DATE	DESCRIPTION
1	07/27/21	SAC COMMENTS
0	07/13/21	ISSUED FOR CONSTRUCTION



IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

GREEN
KS4130
202 EAST THIRD STREET
LEE'S SUMMIT, MO 64063
LTE 3C/5G NR

SHEET TITLE
ELEVATION

SHEET NUMBER

C-2

SECTOR	EXISTING						FINAL					
	ANTENNA MODEL NUMBER	TECHNOLOGY	AZIMUTH	TMA QUANTITY	RRH MODEL NUMBER	RRH MODEL NUMBER	ANTENNA MODEL NUMBER	TECHNOLOGY	AZIMUTH	TMA QUANTITY	RRH MODEL NUMBER	RRH MODEL NUMBER
A1	*POWERWAVE P90-15-XLH-RR	UMTS	4	1	--	--	QUINTEL QS86512-2	LTE 1C/2C 6C FIRSTNET	4	--	AIRSCALE TRIBAND RRH 4T4R B14/12/29 370W AHLBBA	ALCATEL-LUCENT B25 RRH4X30-4R
A2	--	--	--	--	--	--	QUINTEL QS86512-2	LTE 3C/5C	4	--	AIRSCALE RRH 4T4R B5 160W AHLCA	ALCATEL-LUCENT B66A RRH4X45
A3	QUINTEL QS86512-2	LTE 2C/6C FIRSTNET	4	--	*AIRSCALE FLEXI RRH 4T4R B14 160W FRBI	ALCATEL-LUCENT B25 RRH4X30-4R	NOKIA AEQK	5G NR C-BAND	4	--	(INTEGRATED RRH)	--
A4	QUINTEL QS86512-2	LTE 3C/5C	4	--	AIRSCALE RRH 4T4R B5 160W AHLCA	B66A RRH4X45-4R	--	--	--	--	--	--
A5	ANDREW SBNHH-1D65C	LTE 1C/4C	4	--	ALCATEL-LUCENT RRH4X25-WCS-4R	--	ANDREW SBNHH-1D65C	UMTS/LTE 4C	4	1	ALCATEL-LUCENT RRH4X25-WCS-4R	--
B1	--	--	124	--	--	--	QUINTEL QS86512-2	LTE 1C/2C 6C FIRSTNET	124	--	AIRSCALE TRIBAND RRH 4T4R B14/12/29 370W AHLBBA	ALCATEL-LUCENT B25 RRH4X30-4R
B2	*POWERWAVE P90-15-XLH-RR	UMTS	--	1	--	--	QUINTEL QS86512-2	LTE 3C/5C	124	--	AIRSCALE RRH 4T4R B5 160W AHLCA	ALCATEL-LUCENT B66A RRH4X45
B3	QUINTEL QS86512-2	LTE 2C/6C FIRSTNET	124	--	*AIRSCALE FLEXI RRH 4T4R B14 160W FRBI	ALCATEL-LUCENT B25 RRH4X30-4R	NOKIA AEQK	5G NR C-BAND	124	--	(INTEGRATED RRH)	--
B4	QUINTEL QS86512-2	LTE 3C/5C	124	--	AIRSCALE RRH 4T4R B5 160W AHLCA	ALCATEL-LUCENT B66A RRH4X45	--	--	--	--	--	--
B5	ANDREW SBNHH-1D65C	LTE 1C/4C	124	--	ALCATEL-LUCENT RRH4X25-WCS-4R	*ALCATEL-LUCENT RRH2X40W-7L	ANDREW SBNHH-1D65C	UMTS/LTE 4C	124	1	ALCATEL-LUCENT RRH4X25-WCS-4R	--
C1	--	--	244	--	--	--	QUINTEL QS86512-2	LTE 1C/2C 6C FIRSTNET	244	--	AIRSCALE TRIBAND RRH 4T4R B14/12/29 370W AHLBBA	ALCATEL-LUCENT B25 RRH4X30-4R
C2	*POWERWAVE P90-15-XLH-RR	UMTS	--	1	--	--	QUINTEL QS86512-2	LTE 3C/5C	244	--	AIRSCALE RRH 4T4R B5 160W AHLCA	ALCATEL-LUCENT B66A RRH4X45
C3	QUINTEL QS86512-2	LTE 2C/6C FIRSTNET	244	--	*AIRSCALE FLEXI RRH 4T4R B14 160W FRBI	ALCATEL-LUCENT B25 RRH4X30-4R	NOKIA AEQK	5G NR C-BAND	244	--	(INTEGRATED RRH)	--
C4	QUINTEL QS86512-2	LTE 3C/5C	244	--	AIRSCALE RRH 4T4R B5 160W AHLCA	ALCATEL-LUCENT B66A RRH4X45	--	--	--	--	--	--
C5	ANDREW SBNHH-1D65B	LTE 1C/4C	244	--	ALCATEL-LUCENT RRH4X25-WCS-4R	*ALCATEL-LUCENT RRH2X40W-7L	ANDREW SBNHH-1D65B	UMTS/LTE 4C	244	1	ALCATEL-LUCENT RRH4X25-WCS-4R	--

RFDS VERSION: CONTRACTOR IS TO REFER TO AT&T'S MOST CURRENT RADIO FREQUENCY DATA SHEET (RFDS) PRIOR TO CONSTRUCTION.
*EXISTING EQUIPMENT TO BE REMOVED.

- SEE ANTENNA CONFIGURATION FOR MODEL NUMBERS AND AZIMUTHS.
- EXACT PLACEMENT OF RRHs TO BE FIELD VERIFIED AND NOT EXCEED ANTENNA DIMENSIONS ON TOWER.
- PROPOSED EQUIPMENT MOUNTED TO THE TOWER LEG TO BE INSTALLED IN A MANNER THAT DOES NOT INTERFERE WITH CLIMBING APPARATUS.
- ANTENNAS SHALL BE LOCATED SPECIFICALLY AS SHOWN, PER THE ANTENNA MOUNT ANALYSIS, FOR LOAD DISTRIBUTION.
- WHEN STACKING COAX 3 OR MORE DEEP, USE STACKABLE SNAP-INS, TALLEY PART NUMBER SSH-158-3 OR ENGINEER-APPROVED EQUAL.
- CONTRACTOR SHALL REFERENCE THE MOUNT ANALYSIS LETTER AND INSTALL PROPOSED MOUNT IN ACCORDANCE WITH MANUFACTURERS SPECIFICATIONS IF APPLICABLE.
- WHEN REMOVING COAX, CONTRACTOR TO FIELD VERIFY EXACT COAX TO BE REMOVED AND RE-STACK TO MATCH STRUCTURAL ANALYSIS.
- CONTRACTOR TO REMOVE EXISTING EQUIPMENT MOUNTING HARDWARE ON CORNERS OF PLATFORM.

RELEASED FOR CONSTRUCTION
As Noted on Plans Review

Development Services Department
Lee's Summit, Missouri
03/15/2022



7801 FARLEY
OVERLAND PARK, KS 66204



BLACK & VEATCH

6800 W. 115TH ST, SUITE 2292
OVERLAND PARK, KS 66211
(913) 458-2000

PROJECT/PHASE NO: 129331.1183

DRAWN BY: AKJ

CHECKED BY: TD

REV	DATE	DESCRIPTION
1	07/27/21	SAC COMMENTS
0	07/13/21	ISSUED FOR CONSTRUCTION



IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

GREEN
KS4130
202 EAST THIRD STREET
LEE'S SUMMIT, MO 64063
LTE 3C/5G NR

SHEET TITLE
ANTENNA LAYOUT AND SCHEDULE

SHEET NUMBER
C-3


ANTENNA CONFIGURATION

NO SCALE

A

CONSTRUCTION NOTES


B

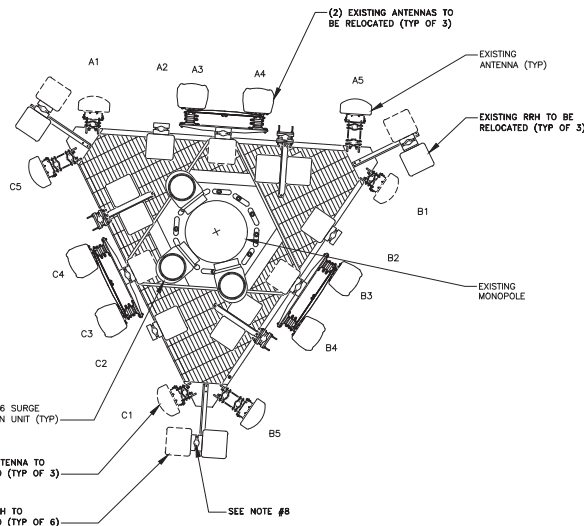

EXISTING ANTENNA LAYOUT

NO SCALE

C


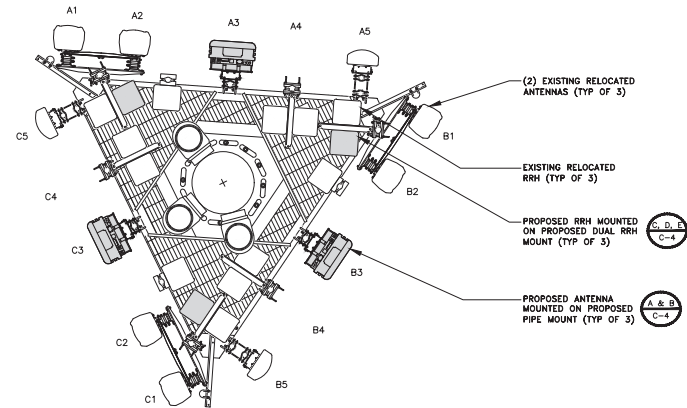


PROPOSED ANTENNA LAYOUT


NO SCALE

D

DIMENSIONS, HxWxD: 29.5"x17.7"x9.5" (749x450x241mm)
WEIGHT: 99.2 lbs (45kg)

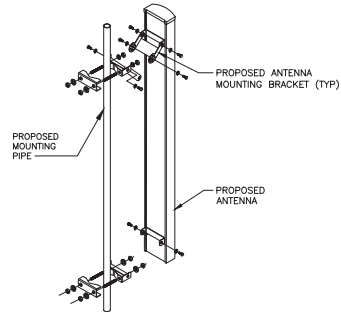


DIMENSIONS, HxWxD:	24"x14.9"x12.7" (610x358x189mm)
WEIGHT:	101.4 lbs (46kg)

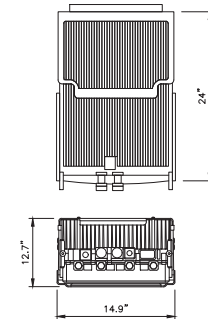**BLACK & VEATCH**

C

NOTE:
2" STD AUX PIPE TO BE
INSTALLED WITH HALF-CLAMPS
AND TYPICAL BOLTING
HARDWARE WHEN REQUIRED
FOR MOUNTING WCS RRHs
ONLY.

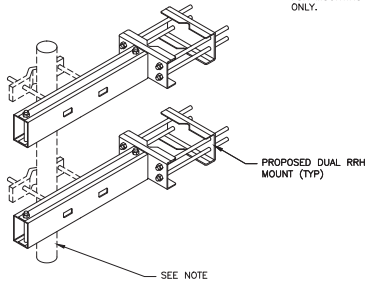

**RELEASED FOR
CONSTRUCTION**
As Noted on Plans Review

**Development Services Department
Lee's Summit, Missouri
03/15/2022**

1	07/27/21	SAC COMMENTS
0	07/13/21	ISSUED FOR CONSTRUCTION
REV	DATE	DESCRIPTION



IT IS A VIOLATION OF LAW FOR ANY PERSON,
UNLESS THEY ARE ACTING UNDER THE DIRECTION
OF A LICENSED PROFESSIONAL ENGINEER,
TO ALTER THIS DOCUMENT.

GREEN
KS4130
202 EAST THIRD STREET
LEE'S SUMMIT, MO 64063
LTE 3C/5G NR

SHEET TITLE

EQUIPMENT DETAILS

SHEET NUMBER

C-4

J

1. CLOSEOUT DELIVERABLE SHALL INCLUDE PHOTOS OF ALL MOUNTING HARDWARE INSTALLED TIGHT AND MARKED.
2. CONTRACTOR SHALL UTILIZE SPECIFIED EQUIPMENT MOUNTING HARDWARE UNLESS OTHERWISE APPROVED BY ENGINEERING.
3. CONTRACTOR SHALL REFER TO THE MOUNT ANALYSIS FOR ANTENNA MAST PIPE SIZING.

Cable #	Sector A			
	SECTOR	FREQ	PORT	
700 MHz TX1/RX1	RED	RED	RED	
700 MHz TX2/RX2	RED	RED	ORANGE	
850 MHz TX1/RX1	RED	ORANGE	RED	
850 MHz TX2/RX2	RED	ORANGE	ORANGE	
1900 MHz TX1/RX1	RED	YELLOW	RED	
1900 MHz TX2/RX2	RED	YELLOW	ORANGE	
1900 MHz TX3/RX3	RED	YELLOW	YELLOW	
1900 MHz TX4/RX4	RED	YELLOW	WHITE	
2100 MHz TX1/RX1	RED	WHITE	RED	
2100 MHz TX2/RX2	RED	WHITE	ORANGE	
2100 MHz TX3/RX3	RED	WHITE	YELLOW	
2100 MHz TX4/RX4	RED	WHITE	WHITE	
2300 MHz TX1/RX1	RED	BROWN	RED	
2300 MHz TX2/RX2	RED	BROWN	ORANGE	
2300 MHz TX3/RX3	RED	BROWN	YELLOW	
2300 MHz TX4/RX4	RED	BROWN	WHITE	

Cable #	Sector B			
	SECTOR	FREQ	PORT	
700 MHz TX1/RX1	BLUE	RED	RED	
700 MHz TX2/RX2	BLUE	RED	ORANGE	
850 MHz TX1/RX1	BLUE	ORANGE	RED	
850 MHz TX2/RX2	BLUE	ORANGE	ORANGE	
1900 MHz TX1/RX1	BLUE	YELLOW	RED	
1900 MHz TX2/RX2	BLUE	YELLOW	ORANGE	
1900 MHz TX3/RX3	BLUE	YELLOW	YELLOW	
1900 MHz TX4/RX4	BLUE	YELLOW	WHITE	
2100 MHz TX1/RX1	BLUE	WHITE	RED	
2100 MHz TX2/RX2	BLUE	WHITE	ORANGE	
2100 MHz TX3/RX3	BLUE	WHITE	YELLOW	
2100 MHz TX4/RX4	BLUE	WHITE	WHITE	
2300 MHz TX1/RX1	BLUE	BROWN	RED	
2300 MHz TX2/RX2	BLUE	BROWN	ORANGE	
2300 MHz TX3/RX3	BLUE	BROWN	YELLOW	
2300 MHz TX4/RX4	BLUE	BROWN	WHITE	

Cable #	Sector C			
	SECTOR	FREQ	PORT	
700 MHz TX1/RX1	GREEN	RED	RED	
700 MHz TX2/RX2	GREEN	RED	ORANGE	
850 MHz TX1/RX1	GREEN	ORANGE	RED	
850 MHz TX2/RX2	GREEN	ORANGE	ORANGE	
1900 MHz TX1/RX1	GREEN	YELLOW	RED	
1900 MHz TX2/RX2	GREEN	YELLOW	ORANGE	
1900 MHz TX3/RX3	GREEN	YELLOW	YELLOW	
1900 MHz TX4/RX4	GREEN	YELLOW	WHITE	
2100 MHz TX1/RX1	GREEN	WHITE	RED	
2100 MHz TX2/RX2	GREEN	WHITE	ORANGE	
2100 MHz TX3/RX3	GREEN	WHITE	YELLOW	
2100 MHz TX4/RX4	GREEN	WHITE	WHITE	
2300 MHz TX1/RX1	GREEN	BROWN	RED	
2300 MHz TX2/RX2	GREEN	BROWN	ORANGE	
2300 MHz TX3/RX3	GREEN	BROWN	YELLOW	
2300 MHz TX4/RX4	GREEN	BROWN	WHITE	

Cable #	Sector D			
	SECTOR	FREQ	PORT	
700 MHz TX1/RX1	ORANGE	RED	RED	
700 MHz TX2/RX2	ORANGE	RED	ORANGE	
850 MHz TX1/RX1	ORANGE	ORANGE	RED	
850 MHz TX2/RX2	ORANGE	ORANGE	ORANGE	
1900 MHz TX1/RX1	ORANGE	YELLOW	RED	
1900 MHz TX2/RX2	ORANGE	YELLOW	ORANGE	
1900 MHz TX3/RX3	ORANGE	YELLOW	YELLOW	
1900 MHz TX4/RX4	ORANGE	YELLOW	WHITE	
2100 MHz TX1/RX1	ORANGE	WHITE	RED	
2100 MHz TX2/RX2	ORANGE	WHITE	ORANGE	
2100 MHz TX3/RX3	ORANGE	WHITE	YELLOW	
2100 MHz TX4/RX4	ORANGE	WHITE	WHITE	
2300 MHz TX1/RX1	ORANGE	BROWN	RED	
2300 MHz TX2/RX2	ORANGE	BROWN	ORANGE	
2300 MHz TX3/RX3	ORANGE	BROWN	YELLOW	
2300 MHz TX4/RX4	ORANGE	BROWN	WHITE	

Cable #	Sector E			
	SECTOR	FREQ	PORT	
700 MHz TX1/RX1	YELLOW	RED	RED	
700 MHz TX2/RX2	YELLOW	RED	ORANGE	
850 MHz TX1/RX1	YELLOW	ORANGE	RED	
850 MHz TX2/RX2	YELLOW	ORANGE	ORANGE	
1900 MHz TX1/RX1	YELLOW	YELLOW	RED	
1900 MHz TX2/RX2	YELLOW	YELLOW	ORANGE	
1900 MHz TX3/RX3	YELLOW	YELLOW	YELLOW	
1900 MHz TX4/RX4	YELLOW	YELLOW	WHITE	
2100 MHz TX1/RX1	YELLOW	WHITE	RED	
2100 MHz TX2/RX2	YELLOW	WHITE	ORANGE	
2100 MHz TX3/RX3	YELLOW	WHITE	YELLOW	
2100 MHz TX4/RX4	YELLOW	WHITE	WHITE	
2300 MHz TX1/RX1	YELLOW	BROWN	RED	
2300 MHz TX2/RX2	YELLOW	BROWN	ORANGE	
2300 MHz TX3/RX3	YELLOW	BROWN	YELLOW	
2300 MHz TX4/RX4	YELLOW	BROWN	WHITE	

Cable #	Sector F			
	SECTOR	FREQ	PORT	
700 MHz TX1/RX1	WHITE	RED	RED	
700 MHz TX2/RX2	WHITE	RED	ORANGE	
850 MHz TX1/RX1	WHITE	ORANGE	RED	
850 MHz TX2/RX2	WHITE	ORANGE	ORANGE	
1900 MHz TX1/RX1	WHITE	YELLOW	RED	
1900 MHz TX2/RX2	WHITE	YELLOW	ORANGE	
1900 MHz TX3/RX3	WHITE	YELLOW	YELLOW	
1900 MHz TX4/RX4	WHITE	YELLOW	WHITE	
2100 MHz TX1/RX1	WHITE	WHITE	RED	
2100 MHz TX2/RX2	WHITE	WHITE	ORANGE	
2100 MHz TX3/RX3	WHITE	WHITE	YELLOW	
2100 MHz TX4/RX4	WHITE	WHITE	WHITE	
2300 MHz TX1/RX1	WHITE	BROWN	RED	
2300 MHz TX2/RX2	WHITE	BROWN	ORANGE	
2300 MHz TX3/RX3	WHITE	BROWN	YELLOW	
2300 MHz TX4/RX4	WHITE	BROWN	WHITE	

ANTENNA COLOR CODE TABLES

Frequency Colors	
RED	700 LTE
ORANGE	850 LTE
YELLOW	1900 LTE
WHITE	2100 LTE
BROWN	2300 LTE
BLUE	850 UMTS
GREEN	1900 UMTS
VIOLET	2nd LTE 2100
SLATE	2nd LTE 1900

Sector	Color
Sector A	RED
Sector B	BLUE
Sector C	GREEN
Sector D	ORANGE
Sector E	YELLOW
Sector F	WHITE

Sector	Color
Sector A	RED
Sector B	BLUE
Sector C	GREEN
Sector D	ORANGE
Sector E	YELLOW
Sector F	WHITE

1st color	2nd color	Power Trunk
RED	RED	1st power cable
RED	RED	2nd power cable
BLUE	BLUE	3rd power cable
BLUE	BLUE	4th power cable
GREEN	GREEN	5th power cable
GREEN	GREEN	6th power cable

Fiber Color	Fiber
RED	1st fiber cable
BLUE	2nd fiber cable

GPS color	GPS cable
RED	1st GPS cable
BLUE	2nd GPS cable

Sector	Color	Squid (Internal)
Sector A	RED	1st Squid
Sector B	BLUE	2nd Squid
Sector C	GREEN	3rd Squid


RET Frequency	Color
700 LTE	RED
850 LTE	ORANGE
1900 LTE	YELLOW
2100 LTE	WHITE
2300 LTE	BROWN
850 UMTS	BLUE
1900 UMTS	GREEN
2nd LTE 2100	VIOLET
2nd LTE 1900	SLATE

Sector	RET Sector
Sector A	RED
Sector B	BLUE
Sector C	GREEN
Sector D	ORANGE
Sector E	YELLOW
Sector F	WHITE

CABLE MARKING LOCATIONS TABLE	
NO	LOCATIONS
①	EACH TOP-JUMPER SHALL BE COLOR CODED WITH (1) SET OF 3" WIDE BANDS.
②	EACH CABLE SHALL BE COLOR CODED WITH (1) SET OF 3" WIDE BANDS NEAR THE TOP OF MAIN LINE AND WITH (1) SET OF 3/4" WIDE COLOR BANDS JUST PRIOR TO ENTERING THE SHELTER/OUTDOOR EQUIPMENT
③	EACH CABLE SHALL BE COLOR CODED WITH (1) SET OF 3/4" WIDE BANDS JUST WITHIN THE SHELTER NEAR THE HATCH PLATE (ONLY INDOOR SITES)
④	EACH CABLE SHALL BE COLOR CODED WITH (1) SET OF 3/4" WIDE BANDS AT THE ENTRANCE OF THE EQUIPMENT

NOTES

1. COLORED TAPES MUST BE 3/4" WIDE & UV RESISTANT VINYL ELECTRICAL COLOR CODING TAPE AND SHOULD BE READY AVAILABLE TO THE ELECTRICIAN OR CONTRACTOR ON SITE.
2. ALL COLOR CODE TAPE SHALL BE 3M-35 AND SHALL BE INSTALLED USING A MINIMUM OF (3) THREE WRAPS OF TAPE AND SHALL BE NEATLY TRIMMED AND SMOOTHED OUT SO AS TO AVOID UNRAVELING.
3. ALL COLOR BANDS INSTALLED AT THE TOP OF THE TOWER SHALL BE A MINIMUM OF 3" WIDE AND SHALL HAVE A MINIMUM OF 1" OF SPACE BETWEEN EACH COLOR. EXCEPT AT RRH WHERE LABELED END OF JUMPERS CONNECTS, COLOR BANDS SHALL BE 3/4" WIDE WITH 3/4" SPACE. ALL COLOR BANDS INSTALLED AT THE BASE OF THE TOWER SHALL BE A MINIMUM OF 3/4" WIDE AND SHALL HAVE A MINIMUM OF 3/4" OF SPACE BETWEEN EACH COLOR.
4. ALL COLOR CODES SHALL BE INSTALLED SO AS TO ALIGN NEATLY WITH ONE ANOTHER FROM SIDE-TO-SIDE.
5. IF EXISTING CABLES AT THE SITE ALREADY HAVE A COLOR CODING SCHEME AND THEY ARE NOT INTENDED TO BE REUSED OR SHARED, THE EXISTING COLOR CODING SCHEME SHALL REMAIN UNTOUCHED.
6. FACTORY MADE JUMPERS SHALL BE INSTALLED SO THE LABELS ARE AT THE RADIO END AND COLOR CODE TAPE SHALL BE INSTALLED SUCH THAT IT DOES NOT COVER THE FACTORY LABELS.

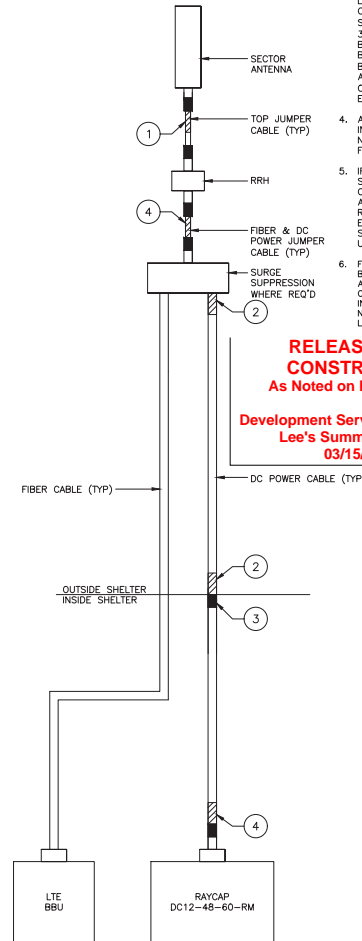

LTE DIAGRAM



PROJECT/PHASE NO: 129331.1183
DRAWN BY: AKJ
CHECKED BY: TD

REV	DATE	DESCRIPTION
1	07/27/21	SAC COMMENTS
2	07/13/21	ISSUED FOR CONSTRUCTION



IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

GREEN
KS4130
202 EAST THIRD STREET
LEE'S SUMMIT, MO 64063
LTE 3C/5G NR

SHEET TITLE
CABLE COLOR CODING

SHEET NUMBER
RF-1

COLOR CODE TABLES



- LEGEND**

- | |
|---|
| 1. GROUNDING IS SHOWN DIAGRAMMATICALLY ONLY. |
| 2. CONTRACTOR SHALL GROUND ALL EQUIPMENT AS A COMPLETE SYSTEM. GROUNDING SHALL BE IN COMPLIANCE WITH NEC SECTION 250 AND AT&T GROUNDING AND BONDING REQUIREMENTS (ATT-P-76416) AND MANUFACTURER'S SPECIFICATIONS. |
| 3. ALL GROUND CONDUCTORS SHALL BE COPPER; NO ALUMINUM CONDUCTORS SHALL BE USED. |
| 4. FOR ALCATEL-LUCENT 850 AND 1900 RHH's, TWO GROUNDS ARE REQUIRED (TOP AND BOTTOM). |

NOTES

- (A) EXTERIOR GROUND RING: #2 AWG SOLID COPPER, BURIED AT A DEPTH OF AT LEAST 30 INCHES BELOW GRADE, OR 6 INCHES BELOW THE FROST LINE AND APPROXIMATELY 24 INCHES FROM THE EXTERIOR WALL OR FOOTING. (ATT--TP-76416 2.2.3.5/7.5.1)
- (B) TOWER GROUND RING: THE GROUND RING SYSTEM SHALL BE INSTALLED AROUND AN ANTENNA TOWER LEGS, AND/OR GUY ANCHORS, WHERE SEPARATE SYSTEMS HAVE BEEN PROVIDED FOR THE TOWER AND THE BUILDING, AT LEAST TWO BONDS SHALL BE MADE BETWEEN THE TOWER GROUND RING SYSTEM AND THE BUILDING GROUND RING SYSTEM USING MINIMUM #2 AWG SOLID COPPER CONDUCTORS. (ATT--TP-76416 7.5.1)
- (C) INTERIOR GROUND RING: #2 AWG STRANDED GREEN INSULATED COPPER CONDUCTOR EXTENDED AROUND THE PERIMETER OF THE EQUIPMENT AREA. ALL NON-TELECOMMUNICATIONS RELATED METALLIC OBJECTS FOUND WITHIN A SITE SHALL BE GROUNDING TO THE INTERIOR GROUND RING WITH #6 AWG STRANDED GREEN INSULATED CONDUCTOR. (ATT--TP-76416 7.6.4)
- (D) BOND TO INTERIOR GROUND RING: #2 AWG SOLID TINNED COPPER WIRE PRIMARY BONDS SHALL BE PROVIDED AT LEAST AT FOUR POINTS ON THE INTERIOR GROUND RING, LOOKING AT THE CORNERS OF THE BUILDING. (ATT--TP-76416 7.5.2.2)
- (E) GROUND ROD: UL LISTED COPPER CLAD STEEL, MINIMUM 5/8" DIAMETER BY EIGHT FEET LONG. ALL GROUND RODS MAY BE INSTALLED WITH INSPECTION SLEEVES. GROUND RODS SHALL BE DRIVEN TO THE DEPTH OF GROUND RING CONDUCTOR. (ATT--TP-76416 1.4 / 2.2.3.10)
- (F) CELL REFERENCE GROUND BAR: POINT OF GROUND REFERENCE FOR ALL COMMUNICATIONS EQUIPPED FRAMES, ALL BONDS ARE MADE WITH #2 AWG STRANDED GREEN INSULATED COPPER CONDUCTORS, BOND TO GROUND RING WITH (2) #2 SOLID TINNED COPPER CONDUCTORS. (ATT--TP-76416 7.6.7)
- (G) HATCH PLATE GROUND BAR: BOND TO THE INTERIOR GROUND RING WITH TWO #2 AWG STRANDED GREEN INSULATED COPPER CONDUCTORS, WHEN A HATCH-PLATE AND CELL REFERENCE GROUND BAR ARE BOTH PRESENT, THE ORGB MUST BE CONNECTED TO THE HATCH-PLATE AND TO THE INTERIOR GROUND RING USING TWO #2 AWG STRANDED GREEN INSULATED COPPER CONDUCTORS.
- (H) EXTERIOR CABLE ENTRY PORT GROUND BARS: LOCATED AT THE ENTRANCE TO THE CELL SITE BUILDING, BOND TO GROUND RING WITH A #2 AWG SOLID TINNED COPPER CONDUCTORS WITH AN EXOTHERMIC WELD AND INSPECTION SLEEVE. (ATT--TP-76416 7.6.7.2)
- (J) TOWER EXIT GROUND BAR: #2 AWG SOLID TINNED COPPER BOND TO THE TOWER GROUND RING. (ATT--TP-76416 7.5.5)
- (K) TELCO GROUND BAR: BOND TO BOTH CELL REFERENCE GROUND BAR AND EXTERIOR GROUND RING. (ATT--TP-76416 7.6.8)
- (L) FRAME BONDING: THE BONDING POINT FOR TELECOM EQUIPMENT FRAMES SHALL BE THE GROUND BUS THAT IS NOT ISOLATED FROM THE EQUIPMENTS METAL FRAMEWORK, BOND THE FRAME GROUND BUS TO THE "I" SECTION OF THE CELL REFERENCE GROUND BAR. (ATT--TP-76416 7.8)
- (M) INTERIOR UNIT BONDS: METAL FRAMES, CABINETS AND INDIVIDUAL METALLIC UNITS LOCATED WITHIN THE AREA OF THE INTERIOR GROUND RING REQUIRE A #6 AWG STRANDED GREEN INSULATED COPPER BOND TO THE INTERIOR GROUND RING. (ATT--TP-76416 7.12.3.1)
- (N) FENCE AND GATE GROUNDING: METAL FENCES WITHIN 7 FEET OF THE EXTERIOR GROUND RING OR OBJECTS BONDED TO THE EXTERIOR GROUND RING SHALL BE BONDED TO THE GROUND RING WITH A #2 AWG SOLID TINNED COPPER CONDUCTOR AT AN INTERVAL NOT EXCEEDING 25 FEET. SERVICES CONTRACTORS VERIFY ALL DC POWER SYSTEMS ARE EQUIPPED WITH A MASTER DC SYSTEM REFERENCE GROUND CONDUCTOR FROM THE DC POWER SYSTEM COMMON RETURN BAR DIRECTLY CONNECTED TO THE CELL SITE REFERENCE GROUND BAR (ORGP PER TP76300 SECTION H 6 AND TP76416 FIGURE 7-11 REQUIREMENTS.
- (P) EXTERIOR UNIT BONDS: METALLIC OBJECTS, EXTERNAL TO OR MOUNTED TO THE BUILDING, SHALL BE BONDED TO THE EXTERIOR GROUND RING. (ATT--TP-76416 7.12.2)
- (Q) ICE BRIDGE SUPPORTS: EACH ICE BRIDGE LEG SHALL BE BONDED TO THE GROUND RING WITH #2 AWG BARE TINNED COPPER CONDUCTOR, PROVIDE EXOTHERMIC WELDS AT BOTH THE ICE BRIDGE LEG AND BURIED GROUND RING. (ATT--TP-76416 7.4.2.6)
- (R) DURING ALL DC POWER SYSTEM CHANGES INCLUDING DC SYSTEM CHANGE OUTS, RECTIFIER REPLACEMENTS OR ADDITIONS, BREAKER DISTRIBUTION CHANGES, BATTERY ADDITIONS, BATTERY REPLACEMENTS AND INSTALLATIONS OR CHANGES TO THE RECTIFIER SYSTEM, THE BATTERY CONTRACTOR SHALL HAVE SERVICES CONTRACTORS VERIFY ALL DC POWER SYSTEMS ARE EQUIPPED WITH A MASTER DC SYSTEM REFERENCE GROUND CONDUCTOR FROM THE DC POWER SYSTEM COMMON RETURN BAR DIRECTLY CONNECTED TO THE CELL SITE REFERENCE GROUND BAR (ORGP PER TP76300 SECTION H 6 AND TP76416 FIGURE 7-11 REQUIREMENTS.



6800 W. 115TH ST, SUITE 2292
OVERLAND PARK, KS 66211
(913) 458-2000

PROJECT/PHASE NO: 129331.1183

DRAWN BY: AKJ

CHECKED BY: _____ TD _____

1	07/27/21	SAC COMMENTS
0	07/13/21	ISSUED FOR CONSTRUCTION
REV	DATE	DESCRIPTION



IT IS A VIOLATION OF LAW FOR ANY PERSON,
UNLESS THEY ARE ACTING UNDER THE DIRECTION
OF A LICENSED PROFESSIONAL ENGINEER,
TO ALTER THIS DOCUMENT.

GREEN
KS4130
202 EAST THIRD STREET
LEE'S SUMMIT, MO 64063
LTE 3C/5G NR

SHEET TITLE

GROUNDING ONE-LINE
ANTENNA EQUIPMENT

SHEET NUMBER

G-1

TOWER ANTENNA EQUIPMENT GROUNDING ONE-LINE

NO SCALE

A

GROUNDING KEY NOTES

EXOTHERMIC CONNECTION
MECHANICAL CONNECTION
CHEMICAL ELECTROLYTIC GROUNDING SYSTEM
TEST CHEMICAL ELECTROLYTIC GROUNDING SYSTEM
EXOTHERMIC WITH INSPECTION SLEEVE
GROUNDING BAR
GROUND ROD
TEST GROUND ROD WITH INSPECTION SLEEVE
SINGLE POLE SWITCH


DUPLEX RECEPTACLE

DUPLEX GFCI RECEPTACLE


FLUORESCENT LIGHTING FIXTURE
(2) TWO LAMPS 48-T8

SMOKE DETECTION (DC)


EMERGENCY LIGHTING (DC)
SECURITY LIGHT W/PHOTOCELL LITHONIA ALXW
LED-1-25A400/51K-SR4-120-PE-DBDXTD

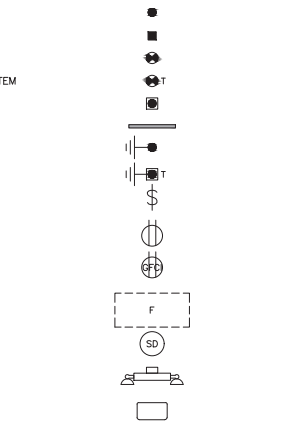

CHAINLINK FENCE
WOOD/WROUGHT IRON FENCE
WALL STRUCTURE
LEASE AREA
PROPERTY LINE (PL)
SETBACKS
ICE BRIDGE
CABLE TRAY
WATER LINE
UNDERGROUND POWER
UNDERGROUND TELCO
OVERHEAD POWER
OVERHEAD TELCO
UNDERGROUND TELCO/POWER
ABOVE GROUND POWER
ABOVE GROUND TELCO
ABOVE GROUND TELCO/POWER
WORKPOINT

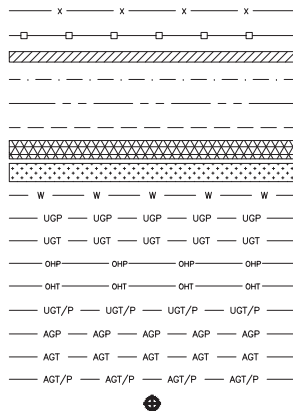

SECTION REFERENCE
DETAIL REFERENCE
ELEVATION MARKER



AB ANCHOR BOLT
ABV ABOVE
AC ALTERNATING CURRENT
ADDL ADDITIONAL
AFF ABOVE FINISHED FLOOR
AFG ABOVE FINISHED GRADE
AIC AMPERAGE INTERRUPTION CAPACITY
ALUM ALUMINUM
ALT ALTERNATE
ANT ANTENNA
APPROX APPROXIMATE
ARCH ARCHITECTURAL
ATS AUTOMATIC TRANSFER SWITCH
AWG AMERICAN WIRE GAUGE
BATT BATTERY
BLDG BUILDING
BLK BLOCK
BLKG BLOCKING
BM BEAM
BTC BARE TINNED COPPER CONDUCTOR
BOF BOTTOM OF FOOTING
CAB CABINET
CANT CANTILEVERED
CHG CHARGING
CLG CEILING
CLR CLEAR
COL COLUMN
COMM COMMON
CONC CONCRETE
CONSTR CONSTRUCTION
DBL DOUBLE
DC DIRECT CURRENT
DEPT DEPARTMENT
DF DOUGLAS FIR
DIA DIAMETER
DIAG DIAGONAL
DIM DIMENSION
DWG DRAWING
DWL DOWEL
(E) EXISTING
EA EACH
EC ELECTRICAL CONDUCTOR
EL ELEVATION
ELEC ELECTRICAL
EMT ELECTRICAL METALLIC TUBING
ENG ENGINEER
EQ EQUAL
EXP EXPANSION
EXT EXTERIOR
FAB FABRICATION
FF FINISH FLOOR
FG FINISH GRADE
FIF FACILITY INTERFACE FRAME
FIN FINISH(ED)
FLR FLOOR
FDN FOUNDATION
FOC FACE OF CONCRETE
FOM FACE OF MASONRY
FOS FACE OF STUD
FOW FACE OF WALL
FS FINISH SURFACE
FT FOOT
FTG FOOTING
GA GAUGE
GEN GENERATOR
GFCI GROUND FAULT CIRCUIT INTERRUPTER
GLB GLUE LAMINATED BEAM
GLV GALVANIZED
GPS GLOBAL POSITIONING SYSTEM
GND GROUND
GSM GLOBAL SYSTEM FOR MOBILE
HDR HEADER
HOR HANGER
HVAC HEAT/VENTILATION/AIR CONDITIONING
HT HEIGHT
IGR INTERIOR GROUND RING
IN INCH
INT INTERIOR

LB(S) POUND(S)
LF LINEAR FEET
LTE LONG TERM EVOLUTION
MAS MASONRY
MAX MAXIMUM
MB MACHINE BOLT
MECH MECHANICAL
MFR MANUFACTURER
MGB MASTER GROUND BAR
MIN MINIMUM
MISC MISCELLANEOUS
MTL METAL
MTS MANUAL TRANSFER SWITCH
MW MICROWAVE
(N) NEW
NEC NATIONAL ELECTRIC CODE
NO.(#) NUMBER
NTS NOT TO SCALE
OC ON CENTER
OPNG OPENING
(P) PROPOSED
P/C PRECAST CONCRETE
PCS PERSONAL COMMUNICATION SERVICES
PCU PRIMARY CONTROL UNIT
PRC PRIMARY RADIO CABINET
PP POLARIZING PRESERVING
PSF POUNDS PER SQUARE FOOT
PSI POUNDS PER SQUARE INCH
PT PRESSURE TREATED
PWR POWER CABINET
QTY QUANTITY
RAD RADIUS
RECT RECTIFIER
REF REFERENCE
REINF REINFORCEMENT
REQ'D REQUIRED
RET REMOTE ELECTRIC TILT
RMC RIGID METALLIC CONDUIT
RRH REMOTE RADIO HEAD
RRU REMOTE RADIO UNIT
RWY RACEWAY
SCH SCHEDULE
SHT SHEET
SIAD SMART INTEGRATED DEVICE
SIM SIMILAR
SPEC SPECIFICATION
SQ SQUARE
SS STAINLESS STEEL
STD STANDARD
STL STEEL
STRUCT STRUCTURAL
TEMP TEMPORARY
THK THICKNESS
TMA TOWER MOUNTED AMPLIFIER
TN TOE NAIL
TOA TOP OF ANTENNA
TOC TOP OF CURB
TOF TOP OF FOUNDATION
TOP TOP OF PLATE (PARAPET)
TOS TOP OF STEEL
TOW TOP OF WALL
TVSS TRANSIENT VOLTAGE SUPPRESSION SYSTEM
TYP TYPICAL
UG UNDERGROUND
UL UNDERWRITERS LABORATORY
UNO UNLESS NOTED OTHERWISE
UMTS UNIVERSAL MOBILE TELECOMMUNICATIONS SYSTEM
UPS UNINTERRUPTIBLE POWER SYSTEM (DC POWER PLANT)
VIF VERIFIED IN FIELD
W WIDE
W/ WITH
WD WOOD
W.P. WORK POINT
WP WEATHERPROOF
WT WEIGHT

RELEASED FOR
CONSTRUCTION
As Noted on Plans Review
Development Services Department
Lee's Summit, Missouri
03/15/2022



PROJECT/PHASE NO: 129331.1183
DRAWN BY: AKJ
CHECKED BY: TD

REV	DATE	DESCRIPTION
1	07/27/21	SAC COMMENTS
0	07/13/21	ISSUED FOR CONSTRUCTION



IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

GREEN
KS4130
202 EAST THIRD STREET
LEE'S SUMMIT, MO 64063
LTE 3C/5G NR

SHEET TITLE
LEGEND &
ABBREVIATIONS

SHEET NUMBER
GN-1

GENERAL CONSTRUCTION NOTES

GENERAL CONSTRUCTION

1. FOR THE PURPOSE OF CONSTRUCTION DRAWINGS, THE FOLLOWING DEFINITIONS SHALL APPLY:

GENERAL CONTRACTOR: OVERLAND CONTRACTING INC. (B&V)
CONTRACTOR: (CONSTRUCTION)
OWNER – AT&T

2. ALL SITE WORK SHALL BE COMPLETED AS INDICATED ON THE DRAWINGS AND AT&T PROJECT SPECIFICATIONS.

3. GENERAL CONTRACTOR SHALL VISIT THE SITE AND SHALL FAMILIARIZE HIMSELF WITH ALL CONDITIONS AFFECTING THE PROPOSED WORK AND SHALL MAKE PROVISIONS. GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR FAMILIARIZING HIMSELF WITH ALL CONTRACT DOCUMENTS, FIELD CONDITIONS, DIMENSIONS, AND CONFIRMING THAT THE WORK MAY BE ACCOMPLISHED AS SHOWN PRIOR TO PROCEEDING WITH CONSTRUCTION, AND ANY DISCREPANCIES SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER PRIOR TO THE COMMENCEMENT OF WORK.

4. ALL MATERIALS FURNISHED AND INSTALLED SHALL BE IN STRICT ACCORDANCE WITH ALL APPLICABLE CODES, REGULATIONS, AND ORDINANCES. GENERAL CONTRACTOR SHALL ISSUE ALL APPROPRIATE NOTICES AND COMPLY WITH ALL LAWS, ORDINANCES, RULES, REGULATIONS, AND LAWFUL ORDERS OF ANY PUBLIC AUTHORITY REGARDING THE PERFORMANCE OF WORK.

5. ALL WORK CARRIED OUT SHALL COMPLY WITH ALL APPLICABLE MUNICIPAL AND UTILITY COMPANY SPECIFICATIONS AND LOCAL JURISDICTIONAL CODES, ORDINANCES, AND APPLICABLE REGULATIONS.

6. UNLESS NOTED OTHERWISE, THE WORK SHALL INCLUDE FURNISHING MATERIALS, EQUIPMENT, APPURTENANCES, AND LABOR NECESSARY TO COMPLETE ALL INSTALLATIONS AS INDICATED ON THE DRAWINGS.

7. PLANS ARE NOT TO BE SCALED, THESE PLANS ARE INTENDED TO BE A DIAGRAMMATIC OUTLINE ONLY UNLESS OTHERWISE NOTED. DIMENSIONS SHOWN ARE TO FINISH SURFACES UNLESS OTHERWISE NOTED. SPACING BETWEEN EQUIPMENT IS THE MINIMUM REQUIRED CLEARANCE, THEREFORE, IT IS CRITICAL TO FIELD VERIFY DIMENSIONS, SHOULD THERE BE ANY QUESTIONS REGARDING THE CONTRACT DOCUMENTS, THE CONTRACTOR SHALL OBTAINING A CLARIFICATION FROM THE ENGINEER PRIOR TO PROCEEDING WITH THE WORK. DETAILS ARE INTENDED TO SHOW DESIGN INTENT. MODIFICATIONS MAY BE REQUIRED TO SUIT JOB DIMENSIONS OR CONDITIONS AND SUCH MODIFICATIONS SHALL BE INCLUDED AS PART OF WORK AND PREPARED BY THE ENGINEER PRIOR TO PROCEEDING WITH WORK.

8. THE CONTRACTOR SHALL INSTALL ALL EQUIPMENT AND MATERIALS IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS UNLESS SPECIFICALLY STATED OTHERWISE.

9. IF THE SPECIFIED EQUIPMENT CANNOT BE INSTALLED AS SHOWN ON THESE DRAWINGS, THE CONTRACTOR SHALL PROPOSE AN ALTERNATIVE INSTALLATION SPACE FOR APPROVAL BY THE ENGINEER PRIOR TO PROCEEDING.

10. GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR THE SAFETY OF WORK AREA, ADJACENT AREAS AND BUILDING OCCUPANTS THAT ARE LIKELY TO BE AFFECTED BY THE WORK UNDER THIS CONTRACT. WORK SHALL CONFORM TO ALL OSHA REQUIREMENTS AND THE LOCAL JURISDICTION.

11. GENERAL CONTRACTOR SHALL COORDINATE WORK AND SCHEDULE WORK ACTIVITIES WITH OTHER DISCIPLINES.

12. ERECTION SHALL BE DONE IN A WORKMANLIKE MANNER BY COMPETENT EXPERIENCED WORKMAN IN ACCORDANCE WITH APPLICABLE CODES AND THE BEST ACCEPTED PRACTICE. ALL MEMBERS SHALL BE LAID PLUMB AND TRUE AS INDICATED ON THE DRAWINGS.

13. SEAL PENETRATIONS THROUGH FIRE RATED AREAS WITH UL LISTED MATERIALS APPROVED BY LOCAL JURISDICTION. CONTRACTOR SHALL KEEP AREA CLEAN, HAZARD FREE, AND DISPOSE OF ALL DEBRIS.

14. WORK PREVIOUSLY COMPLETED IS REPRESENTED BY LIGHT SHADED LINES AND NOTES. THE SCOPE OF WORK FOR THIS PROJECT IS REPRESENTED BY DARK SHADED LINES AND NOTES. CONTRACTOR SHALL NOTIFY THE GENERAL CONTRACTOR OF ANY EXISTING CONDITIONS THAT DEVIATE FROM THE DRAWINGS PRIOR TO BEGINNING CONSTRUCTION.

15. CONTRACTOR SHALL PROVIDE WRITTEN NOTICE TO THE CONSTRUCTION MANAGER 48 HOURS PRIOR TO COMMENCEMENT OF WORK.

16. THE CONTRACTOR SHALL PROTECT EXISTING IMPROVEMENTS, PAVEMENTS, CURBS, LANDSCAPING AND STRUCTURES. ANY DAMAGED PART SHALL BE REPAIRED AT CONTRACTOR'S EXPENSE TO THE SATISFACTION OF THE OWNER.

17. THE CONTRACTOR SHALL CONTACT UTILITY LOCATING SERVICES PRIOR TO THE START OF CONSTRUCTION.

18. GENERAL CONTRACTOR SHALL COORDINATE AND MAINTAIN ACCESS FOR ALL TRADES AND CONTRACTORS TO THE SITE AND/OR BUILDING.

19. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR SECURITY OF THE SITE FOR THE DURATION OF CONSTRUCTION UNTIL JOB COMPLETION.

20. THE GENERAL CONTRACTOR SHALL MAINTAIN IN GOOD CONDITION ONE COMPLETE SET OF PLANS WITH ALL REVISIONS, ADDENDA, AND CHANGE ORDERS ON THE PREMISES AT ALL TIMES.

21. THE GENERAL CONTRACTOR SHALL PROVIDE PORTABLE FIRE EXTINGUISHERS WITH A RATING OF NOT LESS THAN 2-A, 0 TO 2-A10-BC AND SHALL BE WITHIN 25 FEET OF TRAVEL DISTANCE TO ALL PORTIONS OF WHERE THE WORK IS BEING COMPLETED DURING CONSTRUCTION.

22. ALL EXISTING ACTIVE SEWER, WATER, GAS, ELECTRIC, AND OTHER UTILITIES SHALL BE PROTECTED AT ALL TIMES, AND WHERE REQUIRED FOR THE PROPER EXECUTION OF THE WORK, SHALL BE RELOCATED AS DIRECTED BY THE ENGINEER. EXTREME CAUTION SHOULD BE USED BY THE CONTRACTOR WHEN EXCAVATING OR DRILLING PIERs AROUND OR NEAR UTILITIES. CONTRACTOR SHALL PROVIDE SAFETY TRAINING FOR THE WORKING CREW. THIS SHALL INCLUDE BUT NOT BE LIMITED TO A) FALL PROTECTION, B) CONFINED SPACE, C) ELECTRICAL SAFETY, AND D) TRENCHING & EXCAVATION.

23. ALL EXISTING INACTIVE SEWER, WATER, GAS, ELECTRIC, AND OTHER UTILITIES, WHICH INTERFERE WITH THE EXECUTION OF THE WORK, SHALL BE REMOVED, CAPPED, PLUGGED OR OTHERWISE DISCONNECTED AT POINTS WHICH WILL NOT INTERFERE WITH THE EXECUTION OF THE WORK, AS DIRECTED BY THE RESPONSIBLE ENGINEER, AND SUBJECT TO THE APPROVAL OF THE OWNER AND/OR LOCAL UTILITIES.

24. THE AREAS OF THE OWNER'S PROPERTY DISTURBED BY THE WORK AND NOT COVERED BY THE TOWER, EQUIPMENT OR DRIVEWAY, SHALL BE GRADED TO A UNIFORM SLOPE, AND STABILIZED TO PREVENT EROSION.

25. CONTRACTOR SHALL MINIMIZE DISTURBANCE TO THE EXISTING SITE DURING CONSTRUCTION. EROSION CONTROL MEASURES, IF REQUIRED DURING CONSTRUCTION, SHALL BE IN CONFORMANCE WITH THE FEDERAL AND LOCAL JURISDICTION FOR EROSION AND SEDIMENT CONTROL.

26. NO FILL OR EMBANKMENT MATERIAL SHALL BE PLACED ON FROZEN GROUND, FROZEN MATERIALS, SNOW OR ICE SHALL NOT BE PLACED IN ANY FILL OR EMBANKMENT.

27. THE SUBGRADE SHALL BE BROUGHT TO A SMOOTH UNIFORM GRADE AND COMPACTED TO 95 PERCENT STANDARD PROCTOR DENSITY UNDER THE PRESENCE OF STRUCTURES AND 80 PERCENT STANDARD PROCTOR DENSITY IN OPEN SPACE. ALL TRENCHES IN PUBLIC RIGHT OF WAY SHALL BE BACKFILLED WITH FLOWABLE FILL OR OTHER MATERIAL PRE-APPROVED BY THE LOCAL JURISDICTION.

28. ALL NECESSARY RUBBISH, STUMPS, DEBRIS, STICKS, STONES, AND OTHER REFUSE SHALL BE REMOVED FROM THE SITE AND DISPOSED OF IN A LAWFUL MANNER.

29. ALL BROCHURES, OPERATING AND MAINTENANCE MANUALS, CATALOGS, SHOP DRAWINGS, AND OTHER DOCUMENTS SHALL BE TURNED OVER TO THE GENERAL CONTRACTOR AT COMPLETION OF CONSTRUCTION AND PRIOR TO PAYMENT.

30. CONTRACTOR SHALL SUBMIT A COMPLETE SET OF AS-BUILT REDLINES TO THE GENERAL CONTRACTOR UPON COMPLETION OF PROJECT AND PRIOR TO FINAL PAYMENT.

31. CONTRACTOR SHALL LEAVE PREMISES IN A CLEAN CONDITION.

32. THE PROPOSED FACILITY WILL BE UNMANNED AND DOES NOT REQUIRE POTABLE WATER OR SEWER SERVICE, AND IS NOT FOR HUMAN HABITAT (NO HANDICAP ACCESS REQUIRED).

33. OCCUPANCY IS LIMITED TO PERIODIC MAINTENANCE AND INSPECTION, APPROXIMATELY 2 TIMES PER MONTH, BY AT&T TECHNICIANS.

34. NO OUTDOOR STORAGE OR SOLID WASTE CONTAINERS ARE PROPOSED.

35. ALL MATERIAL SHALL BE FURNISHED AND WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE LATEST REVISION AT&T MOBILITY GROUNDING STANDARD TECHNICAL SPECIFICATION FOR CONSTRUCTION OF GSM/GPRS WIRELESS SITES" AND "TECHNICAL SPECIFICATION FOR FACILITY GROUNDING". IN CASE OF A CONFLICT BETWEEN THE CONSTRUCTION SPECIFICATION AND THE DRAWINGS, THE DRAWINGS SHALL GOVERN.

36. CONTRACTORS SHALL BE RESPONSIBLE FOR OBTAINING ALL PERMITS AND INSPECTIONS REQUIRED FOR CONSTRUCTION. IF CONTRACTOR CANNOT OBTAIN A PERMIT, THEY MUST NOTIFY THE GENERAL CONTRACTOR IMMEDIATELY.

37. CONTRACTOR SHALL REMOVE ALL TRASH AND DEBRIS FROM THE SITE ON A DAILY BASIS.

38. INFORMATION SHOWN ON THESE DRAWINGS WAS OBTAINED FROM SITE VISITS AND/OR DRAWINGS PROVIDED BY THE SITE OWNER. CONTRACTORS SHALL NOTIFY THE ENGINEER OF ANY DISCREPANCIES PRIOR TO ORDERING MATERIAL OR PROCEEDING WITH CONSTRUCTION.

39. NO WHITE STROBE LIGHTS ARE PERMITTED. LIGHTING IF REQUIRED, WILL MEET FAA STANDARDS AND REQUIREMENTS.

40. ALL COAXIAL CABLE INSTALLATIONS TO FOLLOW MANUFACTURER'S INSTRUCTIONS AND RECOMMENDATIONS.

ANTENNA MOUNTING

41. DESIGN AND CONSTRUCTION OF ANTENNA SUPPORTS SHALL CONFORM TO CURRENT ANSI/TIA-222 OR APPLICABLE LOCAL CODES.

42. ALL STEEL MATERIALS SHALL BE GALVANIZED AFTER FABRICATION IN ACCORDANCE WITH ASTM A123 "ZINC (HOT-DIP GALVANIZED) COATINGS ON IRON AND STEEL PRODUCTS", UNLESS NOTED OTHERWISE.

43. ALL BOLTS, ANCHORS AND MISCELLANEOUS HARDWARE SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM A153 "ZINC-COATING (HOT-DIP) ON IRON AND STEEL HARDWARE", UNLESS NOTED OTHERWISE.

44. DAMAGED GALVANIZED SURFACES SHALL BE REPAIRED BY COLD GALVANIZING IN ACCORDANCE WITH ASTM A780.

45. ALL ANTENNA MOUNTS SHALL BE INSTALLED WITH LOCK NUTS, LOCK WASHERS OR DOUBLE NUTS AND SHALL BE TORQUED TO MANUFACTURER'S RECOMMENDATIONS.

46. CONTRACTOR SHALL INSTALL ANTENNA PER MANUFACTURER'S RECOMMENDATION FOR INSTALLATION AND GROUNDING.

47. ALL UNUSED PORTS ON ANY ANTENNAS SHALL BE TERMINATED WITH A 50-OHM LOAD TO ENSURE ANTENNAS PERFORM AS DESIGNED.

48. PRIOR TO SETTING ANTENNA AZIMUTHS AND DOWNTILTS, ANTENNA CONTRACTOR SHALL CHECK THE ANTENNA MOUNT FOR TIGHTNESS AND ENSURE THAT THEY ARE PLUMB. ANTENNA AZIMUTHS SHALL BE SET FROM TRUE NORTH AND BE ORIENTED WITHIN +/- 5% AS DEFINED BY THE RFDS. ANTENNA DOWNTILTS SHALL BE WITHIN +/- 0.5% AS DEFINED BY THE RFDS. REFER TO ND-00246.

49. JUMPERS FROM THE TMA'S MUST TERMINATE TO OPPOSITE POLARIZATIONS IN EACH SECTOR.

50. CONTRACTOR SHALL RECORD THE SERIAL #, SECTOR, AND POSITION OF EACH ACTUATOR INSTALLED AT THE ANTENNA AND PROVIDE THE INFORMATION TO AT&T.

51. TMA'S SHALL BE MOUNTED ON PIPE DIRECTLY BEHIND ANTENNAS AS CLOSE TO ANTENNA AS FEASIBLE IN A VERTICAL POSITION.

52. ANTENNAS SHALL HAVE A 4'-0" MIN CENTER TO CENTER HORIZONTAL SEPARATION.

TORQUE REQUIREMENTS

53. ALL RF CONNECTIONS SHALL BE TIGHTENED BY A TORQUE WRENCH.

54. ALL RF CONNECTIONS, GROUNDING HARDWARE AND ANTENNA HARDWARE SHALL HAVE A TORQUE MARK INSTALLED IN A CONTINUOUS STRAIGHT LINE FROM BOTH SIDES OF THE CONNECTION.

55. RF CONNECTION BOTH SIDES OF THE CONNECTOR.

56. GROUNDING AND ANTENNA HARDWARE ON THE NUT SIDE STARTING FROM THE THREADS TO THE SOLID SURFACE. EXAMPLE OF SOLID SURFACE: GROUND BAR, ANTENNA BRACKET METAL.

57. ALL 8M ANTENNA HARDWARE SHALL BE TIGHTENED TO 9 LB-FT (12 NM).

58. ALL 12M ANTENNA HARDWARE SHALL BE TIGHTENED TO 43 LB-FT (58 NM).

59. ALL GROUNDING HARDWARE SHALL BE TIGHTENED UNTIL THE LOCK WASHER COLLAPSES AND THE GROUNDING HARDWARE IS NO LONGER LOOSE.

60. ALL DIN TYPE CONNECTIONS SHALL BE TIGHTENED TO 18-22 LB-FT (24.4 – 29.8 NM).

61. ALL N TYPE CONNECTIONS SHALL BE TIGHTENED TO 15-20 LB-IN (1.7 – 2.3 NM).

FIBER & POWER CABLE MOUNTING

62. THE FIBER OPTIC TRUNK CABLES SHALL BE INSTALLED INTO CONDUITS, CHANNEL CABLE TRAYS, OR CABLE TRAY WHEN INSTALLING FIBER OPTIC TRUNK CABLES INTO A CABLE TRAY SYSTEM, THEY SHALL BE INSTALLED INTO AN INTER DUCT AND A PARTITION BARRIER SHALL BE INSTALLED BETWEEN THE 600 VOLT CABLES AND THE INTER DUCT IN ORDER TO SEGREGATE CABLE TYPES. OPTIC FIBER TRUNK CABLES SHALL HAVE APPROVED CABLE RESTRAINTS EVERY (60) SIXTY FEET AND SECURELY FASTENED TO THE CABLE TRAY SYSTEM. NFPA 70 (NEC) ARTICLE 770 RULES SHALL APPLY.

63. THE TYPE TC-ER CABLES SHALL BE INSTALLED INTO CONDUITS, CHANNEL CABLE TRAYS, OR CABLE TRAY AND SHALL BE SECURED AT INTERVALS NOT EXCEEDING (6) SIX FEET. AN EXCEPTION: WHERE TYPE TC-ER CABLES ARE NOT SUBJECT TO PHYSICAL DAMAGE, CABLES SHALL BE PERMITTED TO MAKE A TRANSITION BETWEEN CONDUITS, CHANNEL CABLE TRAYS, OR CABLE TRAY WHICH ARE SERVING UTILIZATION EQUIPMENT OR DEVICES. A DISTANCE (6) SIX FEET SHALL NOT BE EXCEEDED WITHOUT CONTINUOUS SUPPORTING. NFPA 70 (NEC) ARTICLES 336 AND 392 RULES SHALL APPLY.

64. WHEN INSTALLING OPTIC FIBER TRUNK CABLES OR TYPE TC-ER CABLES INTO CONDUITS, NFPA 70 (NEC) ARTICLE 300 RULES SHALL APPLY.

COAXIAL CABLE NOTES

63. TYPES AND SIZES OF THE ANTENNA CABLE ARE BASED ON ESTIMATED LENGTHS. PRIOR TO ORDERING CABLE, CONTRACTOR SHALL VERIFY ACTUAL LENGTH BASED ON CONSTRUCTION LAYOUT AND NOTIFY THE PROJECT MANAGER IF ACTUAL LENGTHS EXCEED ESTIMATED LENGTHS.

64. CONTRACTOR SHALL VERIFY THE DOWN-TILT OF EACH ANTENNA WITH A DIGITAL LEVEL.

65. CONTRACTOR SHALL CONFIRM COAX COLOR CODING PRIOR TO CONSTRUCTION. REFER TO "ANTENNA SYSTEM LABELING STANDARD" ND-00027 LATEST VERSION.

66. ALL JUMPERS TO THE ANTENNAS FROM THE MAIN TRANSMISSION LINE SHALL BE 1/2" DIA. LDF AND SHALL NOT EXCEED 6'-0".

67. ALL COAXIAL CABLE SHALL BE SECURED TO THE DESIGNED SUPPORT STRUCTURE, IN AN APPROVED MANNER, AT DISTANCES NOT TO EXCEED 4'-0" OC.

68. CONTRACTOR SHALL FOLLOW ALL MANUFACTURER'S RECOMMENDATIONS REGARDING BOTH THE INSTALLATION AND GROUNDING OF ALL COAXIAL CABLES, CONNECTORS, ANTENNAS, AND ALL OTHER EQUIPMENT.

69. CONTRACTOR SHALL WEATHERPROOF ALL ANTENNA CONNECTORS WITH SELF AMALGAMATING TAPE. WEATHERPROOFING SHALL BE COMPLETED IN STRICT ACCORDANCE WITH AT&T STANDARDS.

GENERAL CABLE AND EQUIPMENT NOTES

70. CONTRACTOR SHALL BE RESPONSIBLE TO VERIFY ANTENNA, TMA'S, DIPLEXERS, AND COAX CONFIGURATION, MAKE AND MODELS PRIOR TO INSTALLATION.

71. ALL CONNECTIONS FOR HANGERS, SUPPORTS, BRACING, ETC. SHALL BE INSTALLED PER TOWER MANUFACTURER'S RECOMMENDATIONS.

72. CONTRACTOR SHALL REFERENCE THE TOWER STRUCTURAL ANALYSIS/DESIGN DRAWINGS FOR DIRECTIONS ON CABLE DISTRIBUTION/ROUTING.

73. ALL OUTDOOR RF CONNECTORS/CONNECTIONS SHALL BE WEATHERPROOFED, EXCEPT THE RET CONNECTORS, USING BUTYL TAPE AFTER INSTALLATION AND FINAL CONNECTIONS ARE MADE. BUTYL TAPE SHALL HAVE A MINIMUM OF ONE-HALF TAPE WIDTH OVERLAP ON EACH TURN AND EACH LAYER SHALL BE WRAPPED THREE TIMES. WEATHERPROOFING SHALL BE SMOOTH WITHOUT BUCKLING. BUTYL BLEEDING IS NOT ALLOWED.

74. IF REQUIRED TO PAINT ANTENNAS AND/OR COAX:

A. TEMPERATURE SHALL BE ABOVE 50° F.

B. PAINT COLOR MUST BE APPROVED BY BUILDING OWNER/LANDLORD.

C. FOR REGULATED TOWERS, FAA/FCC APPROVED PAINT IS REQUIRED.

D. DO NOT PAINT OVER COLOR CODING OR ON EQUIPMENT MODEL NUMBERS.

75. ALL CABLES SHALL BE GROUNDED WITH COAXIAL CABLE GROUND KITS. FOLLOW THE MANUFACTURER'S RECOMMENDATIONS.

A. GROUNDING AT THE ANTENNA LEVEL.

B. GROUNDING AT MID LEVEL. TOWERS WHICH ARE OVER 200'-0", ADDITIONAL CABLE GROUNDING REQUIRED.

C. GROUNDING AT BASE OF TOWER PRIOR TO TURNING HORIZONTAL.

D. GROUNDING OUTSIDE THE EQUIPMENT SHELTER AT ENTRY PORT.

E. GROUNDING INSIDE THE EQUIPMENT SHELTER AT THE ENTRY PORT.

76. ALL PROPOSED GROUND BAR DOWNLEADS ARE TO BE TERMINATED TO THE EXISTING ADJACENT GROUND BAR DOWNLEADS A MINIMUM DISTANCE OF 4'-0" BELOW GROUND BAR. TERMINATIONS MAY BE EXOTHERMIC OR COMPRESSION.

77. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING THE ANTENNA AND THE COAX CONFIGURATION IS THE CORRECT MAKE AND MODELS, PRIOR TO INSTALLATION.

78. ALL CONNECTIONS FOR HANGERS, SUPPORTS, BRACING, ETC. SHALL BE INSTALLED PER TOWER MANUFACTURER'S SPECIFICATION & RECOMMENDATIONS.

79. ANTENNA CONTRACTOR SHALL FURNISH AND INSTALL A 12'-0" T-BROOM SECTOR ANTENNA MOUNT, IF APPLICABLE, INCLUDING ALL HARDWARE.

80. CLOSEOUT DELIVERABLES SHALL INCLUDE PHOTOS OF ALL MOUNTING HARDWARE INSTALLED TIGHT AND MARKED.

81. INSTALLATION MANUALS FOR RAYCAP REDLINED TO COMPLY WITH AT&T SPECIFICATIONS CAN BE ACCESSED IN THE BLACK & VEATCH TURF SOW LIBRARY VIA THE FOLLOWING URL:

https://blackandveatch.sharepoint.com/teams/ESS/Telecom/Projects/PublicNetworks/ATT/ATTurf/ATTurfScopeofworkdocuments/_layouts/15/start.aspx#/Shared%20Documents/Forms/AllItems.aspx

RELEASED FOR
CONSTRUCTION
As Noted on Plans Review

Development Services Department
Lee's Summit, Missouri
03/15/2022



7801 FARLEY
OVERLAND PARK, KS 66204



BLACK & VEATCH

6800 W. 115TH ST, SUITE 2292
OVERLAND PARK, KS 66211
(913) 458-2000

PROJECT/PHASE NO: 129331.1183

DRAWN BY: AKJ

CHECKED BY: TD

REV	DATE	DESCRIPTION
1	07/27/21	SAC COMMENTS
0	07/13/21	ISSUED FOR CONSTRUCTION



IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

GREEN
KS4130
202 EAST THIRD STREET
LEE'S SUMMIT, MO 64063
LTE 3C/5G NR

SHEET TITLE
GENERAL CONSTRUCTION
NOTES

SHEET NUMBER
GN-2

GENERAL ELECTRICAL NOTES

PART 1 - GENERAL

1.1 GENERAL CONDITIONS

A. CONTRACTOR SHALL INSPECT THE EXISTING SITE CONDITIONS PRIOR TO SUBMITTING BID. ANY QUESTIONS ARISING DURING THE BID PERIOD IN REGARDS TO THE CONTRACTORS FUNCTIONS, THE SCOPE OF WORK, OR ANY OTHER MATTER RELATED TO THIS PROJECT SHALL BE BROUGHT UP DURING THE BID PERIOD WITH THE PROJECT MANAGER FOR CLARIFICATION, NOT AFTER THE CONTRACT HAS BEEN AWARDED.

B. THE CONTRACTOR SHALL OBTAIN PERMITS, LICENSES, MAKE ALL DEPOSITS, AND PAY ALL FEES REQUIRED FOR THE CONSTRUCTION PERFORMANCE FOR THE WORK UNDER THIS SECTION.

C. DRAWINGS SHOW THE GENERAL ARRANGEMENT OF ALL SYSTEMS AND COMPONENTS COVERED UNDER THIS SECTION. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS. DRAWING SHALL NOT BE SCALED TO DETERMINE DIMENSIONS.

1.2 LAWS, REGULATIONS, ORDINANCES, STATUTES AND CODES.

A. ALL WORK SHALL BE INSTALLED IN ACCORDANCE WITH THE LATEST EDITION OF THE NATIONAL ELECTRICAL CODE, AND ALL APPLICABLE LOCAL LAWS, REGULATIONS, ORDINANCES, STATUTES AND CODES. CONDUIT BENDS SHALL BE THE RADIUS BEND FOR THE TRADE SIZE OF CONDUIT IN COMPLIANCE WITH THE LATEST EDITIONS OF NEC.

1.3 REFERENCES

A. THE PUBLICATIONS LISTED BELOW ARE PART OF THIS SPECIFICATION. EACH PUBLICATION SHALL BE THE LATEST REVISION AND ADDENDUM IN EFFECT ON THE DATE. THIS SPECIFICATION IS ISSUED FOR CONSTRUCTION UNLESS OTHERWISE NOTED. EXCEPT AS MODIFIED BY THE REQUIREMENT SPECIFIED HEREIN OR THE DETAILS OF THE DRAWINGS, WORK INCLUDED IN THIS SPECIFICATION SHALL CONFORM TO THE APPLICABLE PROVISION OF THESE PUBLICATIONS.

1. ANSI/IEEE (AMERICAN NATIONAL STANDARDS INSTITUTE)
2. ASTM (AMERICAN SOCIETY FOR TESTING AND MATERIALS)
3. ICE (INSULATED CABLE ENGINEERS ASSOCIATION)
4. NEMA (NATIONAL ELECTRICAL MANUFACTURER'S ASSOCIATION)
5. NFPA (NATIONAL FIRE PROTECTION ASSOCIATION)
6. OSHA (OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION)
7. UL (UNDERWRITERS LABORATORIES, INC.)
8. AT&T GROUNDING AND BONDING STANDARDS TP-76416

1.4 SCOPE OF WORK

A. WORK UNDER THIS SECTION SHALL CONSIST OF FURNISHING ALL LABOR, MATERIAL, AND ASSOCIATED SERVICES REQUIRED TO COMPLETE REQUIRED CONSTRUCTION AND BE OPERATIONAL.

B. ALL ELECTRICAL EQUIPMENT UNDER THIS CONTRACT SHALL BE PROPERLY TESTED, ADJUSTED, AND ALIGNED BY THE CONTRACTOR.

C. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL EXCAVATING, DRAINING, TRENCHES, BACKFILLING, AND REMOVAL OF EXCESS DIRT.

D. THE CONTRACTOR SHALL FURNISH TO THE OWNER WITH CERTIFICATES OF A FINAL INSPECTION AND APPROVAL FROM THE INSPECTION AUTHORITIES HAVING JURISDICTION.

E. THE CONTRACTOR SHALL PREPARE A COMPLETE SET OF AS-BUILT DRAWINGS, DOCUMENT ALL WIRING EQUIPMENT CONDITIONS, AND CHANGES WHILE COMPLETING THIS CONTRACT. THE AS-BUILT DRAWINGS SHALL BE SUBMITTED AT COMPLETION OF THE PROJECT.

PART 2 - PRODUCTS

2.1 GENERAL

A. ALL MATERIALS AND EQUIPMENT SHALL BE UL LISTED, NEW, AND FREE FROM DEFECTS.

B. ALL ITEMS OF MATERIALS AND EQUIPMENT SHALL BE ACCEPTABLE TO THE AUTHORITY HAVING JURISDICTION AS SUITABLE FOR THE USE INTENDED.

C. ALL EQUIPMENT SHALL BEAR THE UNDERWRITERS LABORATORIES LABEL OF APPROVAL, AND SHALL CONFORM TO REQUIREMENT OF THE NATIONAL ELECTRICAL CODE.

D. ALL OVERCURRENT DEVICES SHALL HAVE AN INTERRUPTING CURRENT RATING THAT SHALL BE GREATER THAN THE SHORT CIRCUIT CURRENT TO WHICH THEY ARE SUBJECTED, 10,000 ACI MINIMUM. VERIFY AVAILABLE SHORT CIRCUIT CURRENT DOES NOT EXCEED THE RATING OF ELECTRICAL EQUIPMENT IN ACCORDANCE WITH ARTICLE 110.24 NEC OR THE MOST CURRENT ADOPTED CODE PER THE GOVERNING JURISDICTION.

2.2 MATERIALS AND EQUIPMENT

A. CONDUIT

1. RIGID METAL CONDUIT (RMC) SHALL BE HOT-DIPPED GALVANIZED INSIDE AND OUTSIDE INCLUDING ENDS AND THREADS AND ENAMELED OR LAQUERED INSIDE IN ADDITION TO GALVANIZING.

2. LIQUDTIGHT FLEXIBLE METAL CONDUIT SHALL BE UL LISTED.

3. CONDUIT CLAMPS, STRAPS AND SUPPORTS SHALL BE STEEL OR MALLEABLE IRON. ALL FITTINGS SHALL BE COMPRESSION AND CONCRETE TIGHT TYPE. GROUNDING BUSHINGS WITH INSULATED THROATS SHALL BE INSTALLED ON ALL CONDUIT TERMINATIONS.

4. NONMETALLIC CONDUIT AND FITTINGS SHALL BE SCHEDULE 40 PVC. INSTALL USING SOLVENT-CEMENT-TYPE JOINTS AS RECOMMENDED BY THE MANUFACTURER.

B. CONDUCTORS AND CABLE

1. AC CONDUCTORS SHALL BE FLAME-RETARDANT, MOISTURE AND HEAT RESISTANT THERMOPLASTIC, SINGLE CONDUCTOR, COPPER, TYPE THHN/THWN-2, 600 VOLT, SIZE AS INDICATED. #12 AWG SHALL BE THE MINIMUM SIZE CONDUCTOR USED.

2. #10 AWG AND SMALLER CONDUCTOR SHALL BE SOLID OR STRANDED AND #8 AWG AND LARGER CONDUCTORS SHALL BE STRANDED.

3. SOLDERLESS, COMPRESSION-TYPE CONNECTORS SHALL BE USED FOR TERMINATION OF ALL STRANDED CONDUCTORS.

4. STRAIN-RELIEF SUPPORTS GRIPS SHALL BE HUBBELL KELLEMS OR APPROVED EQUAL. CABLES SHALL BE SUPPORTED IN ACCORDANCE WITH THE NEC AND CABLE MANUFACTURER'S RECOMMENDATIONS.

5. ALL CONDUCTORS SHALL BE TAGGED AT BOTH ENDS OF THE CONDUCTOR, AT ALL PULL BOXES, J-BOXES, EQUIPMENT AND CABINETS AND SHALL BE IDENTIFIED WITH APPROVED PLASTIC TAGS (ACTION CRAFT, BRADY, OR APPROVED EQUAL).

C. DISCONNECT SWITCHES

1. DISCONNECT SWITCHES SHALL BE HEAVY DUTY, DEAD-FRONT, QUICK-MAKE, QUICK-BREAK, EXTERNALLY OPERABLE AND NO INTERLOCK WITH COVER IN CLOSED POSITION, RATING AS INDICATED, UL LABELED FURNISHED IN NEMA 3R ENCLOSURE, SQUARE-D OR ENGINEERED APPROVED EQUAL.

D. CHEMICAL ELECTROLYTIC GROUNDING SYSTEM:

1. INSTALL CHEMICAL GROUNDING AS REQUIRED. THE SYSTEM SHALL BE ELECTROLYTIC MAINTENANCE FREE ELECTRODE CONSISTING OF RODS WITH A MINIMUM #2 AWG CU EXOTHERMICALLY WELDED PISTAL, PROTECTIVE BOXES, AND BACKFILL MATERIAL. MANUFACTURER SHALL BE LYNCOLE AT&T GROUNDING ROD TYPES K2-(*)CS OR K2L-(*)CS (*) LENGTH AS REQUIRED.

2. GROUND ACCESS BOX SHALL BE A POLYPLASTIC BOX FOR NON-TRAFFIC APPLICATIONS, INCLUDING BOLT DOWN FLUSH COVER WITH "BREATHER" HOLES. KIT MODEL #89-22. ALL DISCONNECT SWITCHES AND CONTROLLING DEVICES SHALL BE PROVIDED WITH ENGRAVED LAMICOD NAMEPLATES INDICATING EQUIPMENT CONTROLLED, BRANCH CIRCUITS ID NUMBERING, AND THE ELECTRICAL POWER SOURCE.

3. BACKFILL MATERIAL SHALL BE LYNCOINTE AND LYNCOLE GROUNDING GRAVEL.

E. SYSTEM GROUNDING:

1. ALL GROUNDING COMPONENTS SHALL BE TINNED AND GROUNDING CONDUCTOR SHALL BE #2 AWG BARE, SOLID, TINNED, COPPER. ABOVE GRADE GROUNDING CONDUCTORS SHALL BE SUNLIGHT RESISTANT TINNED STRANDED COPPER AND INSULATED WHERE NOTED.

2. GROUNDING BUSES SHALL BE BARE, TINNED, ANNEALED COPPER BARS OF RECTANGULAR CROSS SECTION. STANDARD BUS BARS MGB, SHALL BE FURNISHED AND INSTALLED BY THE CONTRACTOR. THEY SHALL NOT BE FABRICATED OR MODIFIED IN THE FIELD. ALL GROUNDING BUSES SHALL BE IDENTIFIED WITH MINIMUM 3/4" LETTERS BY WAY OF STENCILING OR DESIGNATION PLATE.

3. CONNECTORS SHALL BE HIGH-CONDUCTIVITY, HEAVY DUTY, LISTED AND LABELED AS GROUNDING CONNECTORS FOR THE MATERIALS USED, USE TWO-HOLE COMPRESSION LUGS WITH HEAT SHRINK FOR MECHANICAL CONNECTIONS. INTERIOR CONNECTIONS USE TWO-HOLE COMPRESSION LUGS WITH INSPECTION WINDOW AND CLEAR HEAT SHRINK.

4. EXOTHERMIC WELDED CONNECTIONS SHALL BE PROVIDED IN KIT FORM AND SELECTED FOR THE SPECIFIC TYPES, SIZES, AND COMBINATIONS OF CONDUCTORS AND OTHER ITEMS TO BE CONNECTED.

5. GROUND RODS SHALL BE ERICO #615800, COPPER-CLAD STEEL WITH HIGH-STRENGTH STEEL CORE AND ELECTROLYTIC-GRADE COPPER OUTER SHEATH, WOLMEN WELDED TO CORE, 5/8"x10'-0". ALL GROUNDING RODS SHALL BE INSTALLED WITH INSPECTION SLEEVES.

6. INSTALL AN EQUIPMENT GROUNDING CONDUCTOR IN ALL CONDUITS IN COMPLIANCE WITH THE AT&T SPECIFICATIONS AND NEC. THE EQUIPMENT GROUNDING CONDUCTORS SHALL BE BONDED AT ALL JUNCTION BOXES, PULLBOXES, DISCONNECT SWITCHES, STARTERS, AND EQUIPMENT CABINETS.

F. OTHER MATERIALS:

1. THE CONTRACTOR SHALL PROVIDE OTHER MATERIALS, THOUGH NOT SPECIFICALLY DESCRIBED, WHICH ARE REQUIRED FOR A COMPLETELY OPERATIONAL SYSTEM AND PROPER INSTALLATION OF THE WORK.

2. PROVIDE PULL BOXES AND JUNCTION BOXES WHERE SHOWN OR REQUIRED BY NEC.

G. PANELS AND LOAD CENTERS:

1. ALL PANEL DIRECTORIES SHALL BE TYPEWRITTEN.

PART 3 - EXECUTION

3.1 GENERAL:

A. ALL MATERIAL AND EQUIPMENT SHALL BE INSTALLED IN STRICT ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.

B. EQUIPMENT SHALL BE TIGHTLY COVERED AND PROTECTED AGAINST DIRT OR WATER, AND AGAINST CHEMICAL OR MECHANICAL INJURY DURING INSTALLATION AND CONSTRUCTION PERIODS.

3.2 LABOR AND WORKMANSHIP:

A. ALL LABOR FOR THE INSTALLATION OF MATERIALS AND EQUIPMENT FURNISHED FOR THE ELECTRICAL SYSTEM SHALL BE INSTALLED BY EXPERIENCED WIREMEN, IN A NEAT AND WORKMAN-LIKE MANNER.

B. ALL ELECTRICAL EQUIPMENT SHALL BE ADJUSTED, ALIGNED AND TESTED BY THE CONTRACTOR AS REQUIRED TO PRODUCE THE INTENDED PERFORMANCE.

C. UPON COMPLETION OF WORK, THE CONTRACTOR SHALL THOROUGHLY CLEAN ALL EXPOSED EQUIPMENT, REMOVE ALL LABELS AND ANY DEBRIS, CRATING OR CARTONS AND LEAVE THE INSTALLATION FINISHED AND READY FOR OPERATION.

3.3 COORDINATION:

A. THE CONTRACTOR SHALL COORDINATE THE INSTALLATION OF ELECTRICAL ITEMS WITH THE OWNER-FURNISHED EQUIPMENT DELIVERY SCHEDULE TO PREVENT UNNECESSARY DELAYS IN THE TOTAL WORK.

3.4 INSTALLATION:

A. CONDUIT:

1. ALL ELECTRICAL WIRING SHALL BE INSTALLED IN CONDUIT AS SPECIFIED. NO CONDUIT OR TUBING OF LESS THAN 3/4 INCH TRADE SIZE.

2. PROVIDE RIGID PVC SCHEDULE 80 CONDUITS FOR ALL RISERS, RMC OTHERWISE NOTED. EMT MAY BE INSTALLED FOR EXTERIOR CONDUITS WHERE NOT SUBJECT TO PHYSICAL DAMAGE.

3. INSTALL SCH. 40 PVC CONDUIT WITH A MINIMUM COVER OF 24" UNDER ROADWAYS, PARKING LOTS, STREETS, AND ALLEYS. CONDUIT SHALL HAVE A MINIMUM COVER OF 18" IN ALL OTHER NON-TRAFFIC APPLICATIONS (REFER TO 2008 NEC, TABLE 300.5).

4. USE GALVANIZED FLEXIBLE STEEL CONDUIT WHERE DIRECT CONNECTION TO EQUIPMENT WITH MOVEMENT, VIBRATION, OR FOR EASE OF MAINTENANCE. USE LIQUID TIGHT, FLEXIBLE METAL CONDUIT FOR OUTDOOR APPLICATIONS. INSTALL GALVANIZED FLEXIBLE STEEL CONDUIT AT ALL POINTS OF CONNECTION TO EQUIPMENT MOUNTED ON SUPPORT TO ALLOW FOR EXPANSION AND CONTRACTION.

5. A RUN OF CONDUIT BETWEEN BOXES OR EQUIPMENT SHALL NOT CONTAIN MORE THAN THE EQUIVALENT OF THREE QUARTER-BENDS. CONDUIT BEND SHALL BE MADE WITH THE UL LISTED BENDER OR FACTORY 90 DEGREE ELBOWS MAY BE USED.

6. FIELD FABRICATED CONDUITS SHALL BE CUT SQUARE WITH A CONDUIT CUTTING TOOL AND REAMED TO PROVIDE A SMOOTH INSIDE SURFACE.

7. PROVIDE INSULATED GROUNDING BUSHING FOR ALL CONDUITS.

8. CONTRACTOR IS RESPONSIBLE FOR PROTECTING ALL CONDUITS DURING CONSTRUCTION. TEMPORARY OPENINGS IN THE CONDUIT SYSTEM SHALL BE PLUGGED OR CAPPED TO PREVENT ENTRANCE OF MOISTURE OR FOREIGN MATTER. CONTRACTOR SHALL REPLACE ANY CONDUITS CONTAINING FOREIGN MATERIALS THAT CANNOT BE REMOVED.

9. ALL CONDUITS SHALL BE SWABBED CLEAN BY PULLING AN APPROPRIATE SIZE MANDREL THROUGH THE CONDUIT BEFORE INSTALLATION OF CONDUCTORS OR CABLES. CONDUIT SHALL BE FREE OF DIRT AND DEBRIS.

10. INSTALL PULL STRINGS IN ALL CLEAN EMPTY CONDUITS. IDENTIFY PULL STRINGS AT EACH END.

11. INSTALL 2" HIGHLY VISIBLE AND DETECTABLE TAPE 12" ABOVE ALL UNDERGROUND CONDUITS AND CONDUCTORS.

12. CONDUITS SHALL BE INSTALLED IN SUCH A MANNER AS TO ENSURE AGAINST COLLECTION OF TRAPPED CONDENSATION.

13. PROVIDE CORE DRILLING AS NECESSARY FOR PENETRATIONS TO ALLOW FOR RACEWAYS AND CABLES TO BE ROUTED THROUGH THE BUILDING. DO NOT PENETRATE STRUCTURAL MEMBERS, SLEEVES AND/OR PENETRATIONS IN FIRE RATED CONSTRUCTION SHALL BE EFFECTIVELY SEALED WITH FIRE RATED MATERIAL WHICH SHALL MAINTAIN THE FIRE RATING OF THE WALL OR STRUCTURE. FIRE STOPS AT FLOOR PENETRATIONS SHALL PREVENT PASSAGE OF WATER, SMOKE, FIRE, AND FUMES. ALL MATERIAL SHALL BE UL APPROVED FOR THIS PURPOSE.

B. CONDUCTORS AND CABLE

1. ALL POWER WIRING SHALL BE COLOR CODED AS FOLLOWS:

DESCRIPTION	208/240/120 VOLT SYSTEMS
PHASE A	BLACK
PHASE B	RED
PHASE C	BLUE
NEUTRAL	WHITE
GROUNDING	GREEN

2. SPLICES SHALL BE MADE ONLY AT OUTLETS, JUNCTION BOXES, OR ACCESSIBLE RACEWAY CONDULETS APPROVED FOR THIS PURPOSE.

3. PULLING LUBRICANTS SHALL BE UL APPROVED. CONTRACTOR SHALL USE NYLON OR HEMP ROPE FOR PULLING CONDUCTOR OR CABLES INTO THE CONDUIT.

4. CABLES SHALL BE NEATLY TRAINED, WITHOUT INTERLACING, AND BE OF SUFFICIENT LENGTH IN ALL BOXES & EQUIPMENT TO PERMIT MAKING A NEAT ARRANGEMENT. CABLES SHALL BE SECURED IN A MANNER TO AVOID TENSION ON CONDUCTORS OR TERMINALS. CONDUCTORS SHALL BE PROTECTED FROM MECHANICAL INJURY AND MOISTURE. SHARP BENDS OVER CONDUIT BUSHINGS IS PROHIBITED. DAMAGED CABLES SHALL BE REMOVED AND REPLACED AT THE CONTRACTOR'S EXPENSE.

C. DISCONNECT SWITCHES

1. INSTALL DISCONNECT SWITCHES LEVEL AND PLUMB. CONNECT TO WIRING SYSTEM AND GROUNDING SYSTEM AS INDICATED.

D. GROUNDING

1. ALL METALLIC PARTS OF ELECTRICAL EQUIPMENT WHICH DO NOT CARRY CURRENT SHALL BE GROUNDED IN ACCORDANCE WITH THE REQUIREMENTS OF THE BUILDING MANUFACTURER, AT&T GROUNDING AND BONDING STANDARDS TP-76416, ND-00135, AND THE NATIONAL ELECTRICAL CODE.

2. PROVIDE ELECTRICAL GROUNDING AND BONDING SYSTEM INDICATED WITH ASSEMBLY OF MATERIALS, INCLUDING GROUNDING ELECTRODES, BONDING JUMPERS AND ADDITIONAL ACCESSORIES AS REQUIRED FOR A COMPLETE INSTALLATION.

3. ALL GROUNDING CONDUCTORS SHALL PROVIDE A STRAIGHT DOWNWARD PATH TO GROUND WITH GRADUAL BEND AS REQUIRED. GROUNDING CONDUCTORS SHALL NOT BE LOOPED OR SHARPLY BENT. ROUTE GROUNDING CONNECTIONS AND CONDUCTORS TO GROUND IN THE SHORTEST AND STRAIGHTEST PATHS POSSIBLE TO MINIMIZE TRANSIENT VOLTAGE RISES.

4. BUILDINGS AND/OR NEW TOWERS GREATER THAN 75 FEET IN HEIGHT AND WHERE THE MAIN GROUNDING CONDUCTORS ARE REQUIRED TO BE ROUTED TO GRADE, THE CONTRACTOR SHALL ROUTE TWO GROUNDING CONDUCTORS FROM THE ROOFTOP, TOWERS, AND WATER TOWERS GROUND RING, TO THE EXISTING GROUNDING SYSTEM. THE GROUNDING CONDUCTORS SHALL NOT BE SMALLER THAN 2/0 AWG COPPER. ROOFTOP GROUND RING SHALL BE BONDED TO THE EXISTING GROUNDING SYSTEM, THE BUILDING STEEL COLUMNS, LIGHTNING PROTECTION SYSTEM, AND BUILDING MAIN WATER LINE (FERROUS OR NONFERROUS METAL PIPING ONLY). SEE STANDARD 6.3.2.2.

5. TIGHTEN GROUNDING AND BONDING CONNECTIONS, INCLUDING SCREWS AND BOLTS, IN ACCORDANCE WITH MANUFACTURER'S PUBLISHED TORQUE TIGHTENING VALUES FOR CONNECTORS AND BOLTS. WHERE MANUFACTURER'S TORQUING REQUIREMENTS ARE NOT AVAILABLE, TIGHTEN CONNECTIONS TO COMPLY WITH TIGHTENING TORQUE VALUES SPECIFIED IN UL TO ENSURE PERMANENT AND EFFECTIVE GROUNDING.

6. CONTRACTOR SHALL VERIFY THE LOCATIONS OF GROUNDING TIE-IN-POINTS TO THE EXISTING GROUNDING SYSTEM. ALL UNDERGROUND GROUNDING CONNECTIONS SHALL BE MADE BY THE EXOTHERMIC WELD PROCESS AND INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.

7. ALL GROUNDING CONNECTIONS SHALL BE INSPECTED FOR TIGHTNESS. EXOTHERMIC WELDED CONNECTIONS SHALL BE APPROVED BY THE INSPECTOR HAVING JURISDICTION BEFORE BEING PERMANENTLY CONCEALED.

8. APPLY CORROSION-RESISTANCE FINISH TO FIELD CONNECTIONS AND PLACES WHERE FACTORY APPLIED PROTECTIVE COATINGS HAVE BEEN DESTROYED. USE KOPR-SHIELD ANTI-OXIDATION COMPOUND ON ALL COMPRESSION GROUNDING CONNECTIONS.

9. A SEPARATE, CONTINUOUS, INSULATED EQUIPMENT GROUNDING CONDUCTOR SHALL BE INSTALLED IN ALL FEEDER AND BRANCH CIRCUITS.

10. BOND ALL INSULATED GROUNDING BUSHINGS WITH A BARE 6 AWG GROUNDING CONDUCTOR TO A GROUND BUS.

11. DIRECT BURIED GROUNDING CONDUCTORS SHALL BE INSTALLED AT A NOMINAL DEPTH OF 36" MINIMUM BELOW GRADE, OR 6" BELOW THE FROST LINE, USING THE GREATER OF THE TWO DISTANCES.

12. ALL GROUNDING CONDUCTORS EMBEDDED IN OR PENETRATING CONCRETE SHALL BE INSTALLED IN SCHEDULE 40 PVC CONDUIT.

13. THE INSTALLATION OF CHEMICAL ELECTROLYTIC GROUNDING SYSTEM IN STRICT ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS. REMOVE SEALING TAPE FROM LEACHING AND BREATHER HOLES. INSTALL PROTECTIVE BOX FLUSH WITH GRADE.

14. DRIVE GROUND RODS UNTIL TOPS ARE A MINIMUM DISTANCE OF 36" DEPTH OR 6" BELOW FROST LINE, USING THE GREATER OF THE TWO DISTANCES.

15. IF COAX ON THE ICE BRIDGE IS MORE THAN 6 FT. FROM THE GROUND BAR AT THE BASE OF THE TOWER, A SECOND GROUND BAR WILL BE NEEDED AT THE END OF THE ICE BRIDGE, TO GROUND THE COAX CABLE GROUNDING KITS AND IN-LINE ARRESTORS.

16. CONTRACTOR SHALL REPAIR, AND/OR REPLACE, EXISTING GROUNDING SYSTEM COMPONENTS DAMAGED DURING CONSTRUCTION AT THE CONTRACTORS EXPENSE.

3.5 ACCEPTANCE TESTING

A. CERTIFIED PERSONNEL USING CERTIFIED EQUIPMENT SHALL PERFORM REQUIRED TESTS AND SUBMIT WRITTEN TEST REPORTS UPON COMPLETION.

B. WHEN MATERIAL AND/OR WORKMANSHIP IS FOUND NOT TO COMPLY WITH THE SPECIFIED REQUIREMENTS, THE NON-COMPLYING ITEMS SHALL BE REMOVED FROM THE PROJECT SITE AND REPLACED WITH ITEMS COMPLYING WITH THE SPECIFIED REQUIREMENTS PROMPTLY AFTER RECEIPT OF NOTICE FOR NON-COMPLIANCE.

C. TEST PROCEDURES

1. ALL FEEDERS SHALL HAVE INSULATION TESTED AFTER INSTALLATION, BEFORE CONNECTION TO DEVICES, THE CONDUCTORS SHALL TEST FREE FROM SHORT CIRCUITS AND GROUNDS. TESTING SHALL BE FOR ONE MINUTE USING 1000V DC. PROVIDE WRITTEN DOCUMENTATION FOR ALL TEST RESULTS.

2. PRIOR TO ENERGIZING CIRCUITRY, TEST WIRING DEVICES FOR ELECTRICAL CONTINUITY AND PROPER POLARITY CONNECTIONS.

3. MEASURE AND RECORD VOLTAGES BETWEEN PHASES AND BETWEEN PHASE CONDUCTORS AND NEUTRALS. SUBMIT A REPORT OF MAXIMUM AND MINIMUM VOLTAGES.

4. PERFORM GROUNDING TEST TO MEASURE GROUNDING RESISTANCE OF GROUNDING SYSTEM USING THE IEEE STANDARD 3-POINT "FALL-OF-POTENTIAL" METHOD. PROVIDE PLOTTED TEST VALUES AND LOCATION SKETCH. NOTIFY THE ENGINEER IMMEDIATELY IF MEASURED VALUE IS OVER 5 OHMS.

RELEASED FOR CONSTRUCTION
As Noted on Plans Revision
Development Services Department
Lee's Summit, Missouri
03/15/2022



7801 FARLEY
OVERLAND PARK, KS 66204



6800 W. 115TH ST, SUITE 2292
OVERLAND PARK, KS 66211
(913) 458-2000

PROJECT/PHASE NO: 129331.1183

DRAWN BY: AKJ

CHECKED BY: TD

REV	DATE	DESCRIPTION
1	07/27/21	SAC COMMENTS
0	07/13/21	ISSUED FOR CONSTRUCTION



GREEN
KS4130
202 EAST THIRD STREET
LEE'S SUMMIT, MO 64063
LTE 3C/5G NR

SHEET TITLE
GENERAL
ELECTRICAL NOTES

SHEET NUMBER
GN-3

