



VICINITY MAP

# 7 BREW COFFEE

# LEE'S SUMMIT, MO

22033 7BLS

PERMIT SET

APRIL 22, 2022

## SHEET INDEX

### GENERAL

- G0.0 COVER SHEET  
G0.1 GENERAL NOTES & SCHEDULES

### CIVIL

- C-001 GENERAL NOTES  
C-101 DEMOLITION PLAN  
C-201 SITE PLAN  
C-301 GRADING PLAN  
C-401 UTILITY PLAN  
C-501 EROSION CONTROL PLAN  
C-701 DETAILS

### STRUCTURAL

- S0.0 GENERAL NOTES  
S1.0 FOUNDATION & DETAILS  
S1.1 FRAMING PLANS  
S1.2 ELEVATIONS & SECTIONS  
S1.3 TRUSS SHEET  
S2.1 DETAILS  
S3.1 DRIVE-THRU CANOPY  
S3.2 CANOPY DETAILS

### ARCHITECTURAL

- A1.1 FLOOR PLANS  
A1.2 ROOF PLAN / EGRESS PLAN  
A1.3 REFLECTED CEILING PLANS  
A2.1 EXTERIOR ELEVATIONS  
A2.2 EXTERIOR ELEVATIONS  
A3.1 SECTIONS AND DETAILS  
A3.2 SECTIONS AND DETAILS  
A4.1 DOORS AND WINDOWS  
A5.1 RESTROOMS  
A6.1 TRASH ENCLOSURE DETAILS

### SITE UTILITIES

- SU1.1 SITE UTILITIES PLAN

### MECHANICAL

- M1.1 PLUMBING PLAN  
M2.1 HVAC PLAN  
M3.1 SCHEDULES AND DETAILS

### ELECTRICAL

- E1.1 ELECTRICAL PLAN  
E1.2 SCHEDULES AND DETAILS

## BUILDING SUPPLIER



DREW RODIGER  
PROJECT MANAGER  
C: 417-425-4546  
E: DREW@CMCMOD.COM

LEE LOVEALL  
OWNER/DESIGN  
CONSULTANT  
C: 417-353-1865  
E: LEE@CMCMOD.COM

## BUILDING CODE INFORMATION

AUTHORITY HAVING JURISDICTION: CITY OF LEE'S SUMMIT

APPLICABLE BUILDING CODES: 2018 IBC, 2017 NEC, 2010 ADA, 2018 INTERNATIONAL FIRE CODE

CURRENT ZONING: CP-2, PLANNED COMMUNITY COMMERCIAL

USE GROUPS: B, BUSINESS

CONSTRUCTION TYPE: V-B

BUILDING LIMITATIONS:

ALLOWABLE HEIGHT: 2 STORIES, 40' (BASED ON B USE GROUP, IBC 2018, 504.3)  
ACTUAL HEIGHT: 2 STORIES, 19'-8"  
ALLOWABLE AREA: 9,000 S.F. (BASED ON B USE GROUP, IBC 2018, 506.2)  
ACTUAL AREAS: 723 S.F. TOTAL (SERVING AREA - 468 S.F., MECHANICAL ACCESS - 131 S.F., COOLER - 124 S.F.)  
SEE EGRESS PLAN FOR ADDITIONAL ITEMS

OTHER CODE ITEMS:

## PROJECT DESCRIPTION

PREFABRICATED FREESTANDING BUILDING WITH ACCOMPANYING WALK-IN COOLER DELIVERS COFFEE, TEA, AND ENERGY DRINKS TO CUSTOMERS VIA DRIVE-THROUGH LANE. NO INTERIOR OR EXTERIOR DINING COMPONENT IS PROVIDED; THE INTERIOR IS ONLY OCCUPIED BY STAFF. DRINK ITEMS ARE THE ONLY ITEMS OFFERED ON THE MENU.

## GENERAL NOTES

ALL CONSTRUCTION SHALL FOLLOW THE CITY OF LEE'S SUMMIT DESIGN AND CONSTRUCTION MANUAL AS ADOPTED BY ORDINANCE 5831. WHERE DISCREPANCIES EXIST BETWEEN THESE PLANS AND THE DESIGN AND CONSTRUCTION MANUAL, THE DESIGN AND CONSTRUCTION MANUAL SHALL PREVAIL.

THE CONTRACTOR SHALL CONTACT THE CITY'S DEVELOPMENT SERVICES ENGINEERING INSPECTION TO SCHEDULE A PRE-CONSTRUCTION MEETING WITH A FIELD ENGINEERING INSPECTOR PRIOR TO ANY LAND DISTURBANCE WORK AT (816) 969-1200.


## CONSULTANTS

CIVIL ENGINEER:



8040 NORTH OAK TRAFICWAY  
KANSAS CITY, MO 64118  
(816) 468-5858

STRUCTURAL ENGINEER:

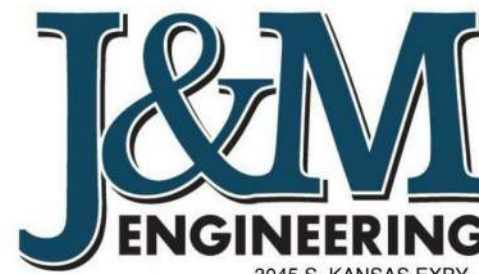

3045 S. KANSAS EXPY.  
SPRINGFIELD, MO 65807  
PHONE: 417-708-9315  
www.jandmstructural.com

MECHANICAL ELECTRICAL PLUMBING ENGINEER:



2225 WEST CHESTERFIELD  
BOULEVARD, SUITE 200  
SPRINGFIELD, MO 65807  
(417) 877-1700

TORGERSON  
DESIGN PARTNERS  
ARCHITECTURE / REAL ESTATE / DEVELOPMENT



116 NORTH 2ND AVENUE - OZARK, MO 65721 - P (417) 581-8889 - F (417) 581-9002  
ARCHITECTURAL CORPORATION MISSOURI LICENSE NUMBER: A-2030011427



7 BREW COFFEE  
LEE'S SUMMIT, MO

1430 NE DOUGLAS ST.  
LEE'S SUMMIT, MO 64086



ARCHITECT OF RECORD:

NAME: ADAM KREHER

LICENSE NO. 2011002764

PROJECT NUMBER:

22033 7BLS

REVISION:

ADD 001  
6/17/22

G0.0

COVER SHEET

DATE: APRIL 22, 2022



EQUIPMENT AND FIXTURE SCHEDULE						
ITEM NO.	QTY.	MANUFACTURER	PRODUCT	PRODUCT NO.	SIZE	NOTES
EQ-1	1	NOLAKE	REMOTE WALK-IN COOLER	KOBB77104-C	675 CUBIC SF	
EQ-2	1	BUNN WATER HEATER	HOT WATER MACHINE	HSX- ELEMENT		
EQ-3	2	LA MARZOCCO	ESPRESSO MACHINE	LINEA PB (AV)- 3		
EQ-4	1	LA MARZOCCO	ESPRESSO MACHINE	LINEA PB (AV)- 4		
EQ-5	2	MANITOWOC	ICE MAKER HEADS	IYF 1800 C		REMOTE CONDENSOR - IF 1800C
EQ-6	1	MANITOWOC	ICE MAKER BIN	LB 1760	60"	
EQ-7	27	TORRANI	SYRUP RACK			
EQ-8	3	VITAMIX	BLENDER			
EQ-9	4	EAGLE GROUP	STAINLESS STEEL STORAGE SHELVING	(1) SS 1872 - PZ86S (2) SS 1424 - PZ86S (3) SS 1436 - PZ86S (4) SS 1436 - PZ86S		
EQ-10	2	SPACEMAN	CHILLER MACHINE	6695-C		
EQ-11	3	MAZZER	COFFEE BEAN GRINDER	ROBUR S NERO		
EQ-12	1	MAZZER	DECAF COFFEE BEAN GRINDER	SUPER JOILY PRO V (E) NERO		
EQ-13	1	RUBBERMAID	TRASH CONTAINER			
EQ-14	1	ATOSA	REACH-IN COOLER	MCF8723GR		
EQ-15	3	LA CROSSR	MOBILE ICE BINS	513034 CL-24(CCCAB-31		
EQ-16	1	CONTINENTAL	UNERCOUNTER COOLER	SW36NGD-U		
EQ-17	3	STRONGWAY	AIR CURTAIN	49947		
EQ-18	3		RAPID RINSER			

EQUIPMENT SCHEDULE NOTES:

- a. ALL EQUIPMENT TO BE INSTALLED BY A LICENSED INSTALLER AND THE MANUFACTURERS SPECIFICATIONS.

GENERAL SCHEDULE NOTES:

THE ITEMS IDENTIFIED ON THE FINISH MATERIALS SCHEDULE, EQUIPMENT AND FIXTURE SCHEDULES HAVE BEEN SELECTED AND APPROVED FOR THE USE ON 7 BREW COFFEE PROJECTS AS "STANDARDS". ITEMS SPECIFIED MAY OR MAY NOT ACTUALLY APPEAR ON THE DRAWINGS. THE DESCRIPTIONS ARE TO IDENTIFY THE PRODUCTS AND NOT TO DETERMINE THE INCLUSION OR USE OF ANY PARTICULAR ITEM.

FINISH MATERIALS SCHEDULE			
SYMBOL	ITEM	DESCRIPTION	REMARKS
FRP-1	MEG-WALLS	WHITE	MEG PANELS
MP-1	METAL SIDING	CUSTOM COLOR: ZINC GRAY FINISH: SMOOTH	EXTERIOR SIDING
MP-2	BRAKE METAL	COLOR: SLATE BLUE FINISH: SMOOTH	METAL ROOF, COPING AND CANOPY COLUMNS
MP-3	BRAKE METAL	COLOR: MATTE BLACK FINISH: SMOOTH	METAL SOFFIT AND COPING
MP-4	BRAKE METAL	COLOR: ZINC GRAY FINISH: SMOOTH	METAL COPING AT SIDE WALLS
MP-5	BRAKE METAL	COLOR: COLONIAL RED FINISH: SMOOTH	METAL COPING
PL-1	DECORATIVE PANEL	NICHIIHA MODERN BRICK COLOR: MIDNIGHT FIBER CEMENT PANEL	EXTERIOR FINISH
PL-2	DECORATIVE PANEL	NICHIIHA CANYON BRICK COLOR: SHALE BROWN FIBER CEMENT PANEL	EXTERIOR FINISH
WC-1	DECORATIVE WALL COVERING	CUSTOM VINYL WALL COVERING	COOLER WALLS
VT-1	RESILIENT VINYL FLOORING	PROTECT-ALL FLOORING COLOR: LIGHT GRAY	SERVICE AREA AND TOILET
VB-1	RESILIENT VINYL BASE	PROTECT-ALL BASE COLOR: LIGHT GRAY	SERVICE AREA AND TOILET

FINISH MATERIALS SCHEDULE NOTES:

- a. PROVIDED BY 7 BREW AND INSTALLED BY GENERAL CONTRACTOR.
- b. ALL MATERIALS AND WORK PROVIDED AND INSTALLED BY GENERAL CONTRACTOR.
- c. PROVIDE A MINIMUM OF TWO (2) COATS PAINT OVER ONE (1) COAT PRIMER ON ALL EXPOSED GYP BD IN SERVICE AREA AND TOILET
- d. CEILING AND WALL TO BE SATIN FINISH. DOORS AND DOOR FRAMES TO BE SEMI-GLOSS.

GENERAL CONSTRUCTION PROCEDURES

- ALL CONSTRUCTION SHALL BE EXECUTED IN STRICT COMPLIANCE WITH ALL LOCAL CODES AND ORDINANCES. GENERAL CONTRACTOR SHALL COMPLY WITH ALL CONSTRUCTION REGULATIONS AND PROCEDURES ESTABLISHED BY THE LANDLORD.
- THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR MAKING APPLICATION FOR AND PROCURING ALL PERMITS AND CERTIFICATES AS MIGHT BE REQUIRED BY GOVERNING AGENCIES AND SHALL BEAR THE COST FOR SUCH PERMITS AND CERTIFICATES. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING ALL EXISTING CONDITIONS OF THE SITE.
- EVERY EFFORT HAS BEEN MADE TO ASSURE ACCURATE CONSTRUCTION DOCUMENTS, BUT IF A CONFLICT EXISTS THE GENERAL CONTRACTOR SHALL CONTACT THE ARCHITECT IMMEDIATELY FOR CLARIFICATION. THESE DOCUMENTS INDICATE THE DESIGN INTENT AND IF EXISTING CONDITIONS ARE IN CONFLICT THE GENERAL CONTRACTOR SHALL CONTACT THE ARCHITECT IMMEDIATELY FOR CLARIFICATION.
- THE GENERAL CONTRACTOR SHALL MAINTAIN DIRECT SUPERVISION OVER ALL SUBCONTRACTORS AND SHARE RESPONSIBILITY FOR THEIR PERFORMANCE AND QUALITY OF WORK. A LIST OF ALL SUBCONTRACTORS SHALL BE PROVIDED TO THE OWNER AND THE ARCHITECT. A COPY OF THIS LIST SHALL BE POSTED ON THE JOB SITE.
- ALL SIGNAGE AND MOUNTING DEVICES SHALL BE PROVIDED, AND ALL SIGNAGE APPROVALS OBTAINED, BY OWNERS SIGN CONTRACTOR. GENERAL CONTRACTOR SHALL PROVIDE ELECTRICAL POWER AS REQUIRED AND INSURE SUFFICIENT SPACE AND CLEARANCE IS PROVIDED FOR PROPER INSTALLATION. SIGNAGE CONTRACTOR SHALL APPLY FOR AND SECURE ALL APPROVALS REQUIRED BY ALL LOCAL GOVERNING AGENCIES AND SUPPLY ANY DRAWINGS OR GRAPHIC REPRESENTATIONS REQUIRED BY LANDLORD.
- ALL CONCEALED WOOD BLOCKING USED IN CONSTRUCTION SHALL BE FIRE-RETARDANT TREATED (IF APPLICABLE).
- GENERAL CONTRACTOR SHALL PERFORM AND/OR CAUSE TO BE PERFORMED ALL WORK IN A FIRST-CLASS WORKMANLIKE MANNER AND IN ACCORDANCE WITH EACH TRADE'S ESTABLISHED PROCEDURES AND MANUFACTURER'S RECOMMENDATIONS FOR PRODUCT USE AND INSTALLATION.
- ALL PRODUCTS USED ON THIS PROJECT SHALL BE FIRST QUALITY, NEW AND FREE OF ASBESTOS OR OTHER ENVIRONMENTALLY UNSAFE SUBSTANCES.
- MILLWORK, BASE, DESIGNATED TRIM, ETC. SHALL BE PROVIDED BY OWNER AND INSTALLED BY CONTRACTOR WHERE INDICATED ON THE DRAWINGS AND/OR SCHEDULES.
- GENERAL CONTRACTOR SHALL CONTACT ARCHITECT PRIOR TO CONSTRUCTION START DATE TO CONFIRM THAT HE/SHE HAS LATEST APPROVED CONSTRUCTION DOCUMENTS FOR THIS LOCATION.

SUSTAINABILITY GUIDELINES

THE FOLLOWING GUIDELINES TO BE USED BY GENERAL CONTRACTOR ARE VOLUNTARY IN NATURE. IT IS HIGHLY RECOMMENDED THAT THE GENERAL CONTRACTOR FOLLOW THESE GUIDELINES TO THE EXTENT IT IS FEASIBLE.

- IMPROVE INDOOR AIR QUALITY:
  - REDUCE CONSTRUCTION DUST AND AIR PARTICULATES WITH DUST CONTAINMENT SYSTEMS AND/OR SHUT OFF CIRCULATING AIR.
  - CHANGE HVAC FILTERS AT THE CONCLUSION OF THE JOB.
  - USE LOW V.O.C. PAINTS, ADHESIVES, SEALANTS, ETC

PREFABRICATED BUILDING

THIS BUILDING IS BEING FABRICATED IN A CONTROLLED ENVIRONMENT AND TRANSFERRED TO THE JOB SITE. CJD ENGINEERING GROUP HAS BEEN ENGAGED TO CONDUCT 3rd PARTY INSPECTIONS OF ALL FABRICATION WITHIN THE 7 BREW COFFEE WAREHOUSE. THE INSPECTION WILL INCLUDE STRUCTURAL, FRAMING, BUILDING, PLUMBING AND ELECTRICAL.

TYPICAL SYMBOL LEGEND

DETAIL DESIGNATION DETAIL NUMBER 12/A3.4	SHEET NUMBER	ELEVATION HEIGHT T.O. WALL 106'-0"
SQUARE FOOTAGE ROOM TAG 101 150 SF	ROOM NAME 101 ROOM NUMBER	ELEVATION TAG 1 A1.1 1 A1.1 1
DOOR TAG 101		CEILING HEIGHT 0'-0"
SECTION CUT TAG 1 101		WINDOW TAG W1
ROOF SLOPE 12 2		REVISION DELTA 1
WALL TYPE/ PARTITION TYPE W1		GRID BUBBLE 0
WALL PARTITION		ENLARGED DETAIL 1 101
EXISTING WALL		FINISH TAG PT-1

MATERIAL INDICATION

CONCRETE		FINISHED WOOD	
DIMENSIONAL LUMBER		GYPSUM BOARD	
RIGID INSULATION		PLYWOOD	
BATT OR BLOWN INSULATION		GLASS	
EARTH/BACKFILL		CMU	

ABBREVIATIONS

ACCOUST. ADD A.F.F. AF AI ALT. ALUM. ANCH. ARCH. @ B.B. B.F. BD BKT. BLDG. BLK'G BM B.O. BRG BSMT C.S. CAB. C.C. CEM. CF CFCI CI CLG C.O. COL CONC CONF CONN CONSTR CONT CONTR COORD CORR CTR CYL £ C.W. DP DBL DEG D.F. DEMO DIA Ø DIAG DIM D.O. DTL DR D.S. EA ELEC ELEV ELEV E.W.C. EQUIP EXIST'G EXP EXT F.B.O. F.D. F.E. F.E.C. F.E.B. FIN FINISH F.G. FL FLASH'G FLR F.O.M FND	ACOUSTICAL ADDITIONAL ABOVE FINISH FLOOR AS FURNISHED AS INSTALLED ALTERNATE ALUMINUM ANCHOR ARCHITECT AT BOTTOM OF BEAM BOTTOM OF FOOTING BOARD BRACKET BUILDING BLOCKING BENCH MARK BOTTOM OF BEARING BASEMENT COUNTERSUNK CABINET CENTER-TO-CENTER CEMENT CONTRACTOR FURNISHED CONTRACTOR INSTALLED CONTRACTOR INSTALLED CEILING CLEAN OUT COLUMN CONCRETE CONFERENCE CONNECTION CONTINUOUS CONTRACTOR COORDINATE CORRUGATED/ CORRIDOR CENTER CYLINDER CENTERLINE COLD WATER DEEP DOUBLE DEGREE DRINKING FOUNTAIN DEMOLITION DIAGONAL DIMENSION DO-OVER DETAIL DOOR DOWNSPOUT EACH ELECTRICAL ELEVATOR (VIEW) ELEVATOR ELECTRIC WATER COOLER EQUIPMENT EXISTING EXPOSED EXTERIOR / EXTENSION FURNISHED BY OTHERS FLOOR DRAIN FIRE EXTINGUISHER FIRE EXTINGUISHER CABINET FIRE EXTINGUISHER BRACKET FINISH FINISH GRADE FLOW LINE FLASHING FLOOR FACE OF MASONRY FOUNDATION	FR FRAM FURN F.R.T. FTG FUR GA GALV GC G.I. GLAZ GOV'T GS. GEN GYP HDWR H.C. HOL HORIZ H HIGH HT. HTG. HTR H.W. I.D. INSUL INT. INV JNT JSTS K.E.S. LAM LAV LG L.H.B. L.H.R.B. LIN LVR MAS MATL MAX MEZZ MFR MID MIN MISK MISC MTD MTL MULL NOM NTS NOT TO SCALE OVERALL ON CENTER OUTSIDE DIAMETER OWNER FURNISHED CONTRACTOR INSTALLED OWNER FURNISHED OWNER INSTALLED OVERHEAD OPENING OPPOSITE PARTITION PRE-ENGINEERED METAL BUILDING PERIMETER PRESENT GRADE PLAS PLAS PL PLUMB'G PLYWOOD P.P. POWER POLE PR PAIR PVC QUARRY TILE Q.T. R	FIRE RETARDANT FRAME FURNISHED FIRE RETARDANT TREATED FOOTING FURRING GAUGE GALLON GALVANIZED GENERAL CONTRACTOR GALVANIZED IRON GLAZING GOVERNMENT GRAVEL STOP GENERAL GYPSUM HARDWARE HOLLOW CORE HOLLOW HORIZONTAL HIGH HEIGHT HEATING HEATER HOT WATER INSIDE DIAMETER INSULATION INTERIOR INVERT JOINT JOISTS KITCHEN EQUIPMENT SUPPLIER LAMINATE LAVATORY LONG LEFT HAND BEVEL LEFT HAND REVERSE BEVEL LINEAR / LINEAL LOUVER MASONRY MATERIAL MAXIMUM MEZZANINE MANUFACTURED MANUFACTURER MIDDLE MINIMUM MISCELLANEOUS MARK MASONRY OPENING MOUNTED METAL MULLION NONMINIMAL NOT TO SCALE OVERALL ON CENTER OUTSIDE DIAMETER OWNER FURNISHED CONTRACTOR INSTALLED OWNER FURNISHED OWNER INSTALLED OVERHEAD OPENING OPPOSITE PARTITION PRE-ENGINEERED METAL BUILDING PERIMETER PRESENT GRADE PLASTIC LAMINATE PLASTIC PROPERTY LINE PLUMBING PLYWOOD POWER POLE PAIR POLYVINYL CHLORIDE QUARRY TILE RADIUS	RCP REINFORCED CONCRETE PIPE REFER R.H.B. RIGHT HAND REVERSE BEVEL R.H.R.B. RAIN LEADER RM ROOM ROUGH OPENING RES. RESILIENT TILE REQ'D REQUIRED REQUIREMENT R.T.V. ROTARY-TURBINE VENT REG. REGULAR SAF. SAFETY SAN. SANITARY SCHED. SCHEDULE S.C. SOLID CORE SECT. SECTION SHT. SHEET SIM. SIMILAR SPEC. SPECIFICATION STND. STANDARD STD. STUD STL. STEEL STOR. STORAGE STRUCT. STRUCTURE / STRUCTURAL SURF. SURFACE SUSP. SUSPENDED SYST. SYSTEM S.W. STORM WATER TYP. TYPICAL T.O. TOP OF UN.O. UNLESS NOTED OTHERWISE VCP. VITRIFIED-CLAY-PIPE VEST. VESTIBULE VERT. VERTICAL VOL. VOLUME V.T.R. VENT-THRU-ROOF VCT. VINYL COMPOSITION TILE W. WIDE W. WITH WD. WOOD WD.D. WINDOW DIMENSION WDW. WINDOW WRB. WEATHER RESISTANT BARRIER WWF. WELDED WIRE FABRIC W.P. WEATHER PROOF WT. WEIGHT
--	---	--	--	--




ARCHITECT OF RECORD:

NAME: ADAM KREHER

LICENSE NO. 2011002764

PROJECT NUMBER:  
220333 7BL5

REVISION:  ADD 001  
6/17/22





LEGEND

○

MONUMENT FOUND, ORIGIN UNDETERMINED  
UNLESS OTHERWISE NOTED

●

1/2" x 24" REBAR W/LS 214F CAP SET

(P)

PLATTED

(M)

MEASURED

⊞

ELECTRIC METER

⊞

ELECTRIC TRANSFORMER

⊞

FIRE HYDRANT

⊞

STORM MANHOLE

⊞

SAN SEWER MANHOLE

⊞

GAS SIGN

⊞

WATER VALVE

— E —

UNDERGROUND ELECTRIC LINE

— G —

GAS LINE

— T —

UNDERGROUND TELEPHONE

— W(R) —

WATER LINE(RECORDED)

— 725 —

1' CONTOUR INTERVAL

UTILITY CONTACTS

WATER AND SEWER SERVICE

CITY OF LEE'S SUMMIT WATER UTILITIES  
1200 SE HAMBLEN ROAD  
LEE'S SUMMIT, MO 64081  
816-969-1900

GAS SERVICE

SPIRE INC.  
7500 E 35TH ST,  
KANSAS CITY, MO 64129  
816-756-5252

ELECTRICAL SERVICE

EVERGY  
1200 MAIN ST,  
KANSAS CITY, MO 64105  
888-471-5275

TELECOMMUNICATION

AT&T

2121 E. 63RD STREET  
KANSAS CITY, MO 64130  
800-403-3302

SPECTRUM

550 WESTPORT ROAD  
KANSAS CITY, MO 64111  
866-874-2389

FINAL DEVELOPMENT PLAN FOR

7 BREW

1410 NE DOUGLAS STREET

LEE'S SUMMIT, JACKSON COUNTY, MISSOURI

DEVELOPER:

P2 BREW, LLC.  
91 CHAMPIONS BLVD.  
ROGERS, AR 72712  
CONTACT: JASON PULLMAN  
EMAIL: JPCOMPANIES@GMAIL.COM

ARCHITECT:


ARCHITECTURAL DESIGN CONCEPTS  
2821 UNIT D W CHESTNUT  
SPRINGFIELD, MO 65802

PREPARED BY:

KAW VALLEY ENGINEERING  
8040 N. OAK TRAFFICWAY  
KANSAS CITY, MO. 64118  
CONTACT: MARTIN ARLING  
PHONE: 816-468-5858  
EMAIL: arling@kaveng.com

PROJECT INFORMATION:

PROJECT: 7BREW  
LOCATION: 1410 NE DOUGLAS STREET  
PARCEL ID: 52-900-02-35-00-0-00-000  
AREA: 0.939 AC.  
ZONING: GP-2  
LEGAL DESCRIPTION: LOT 3, OAKVIEW LOTS 1-5

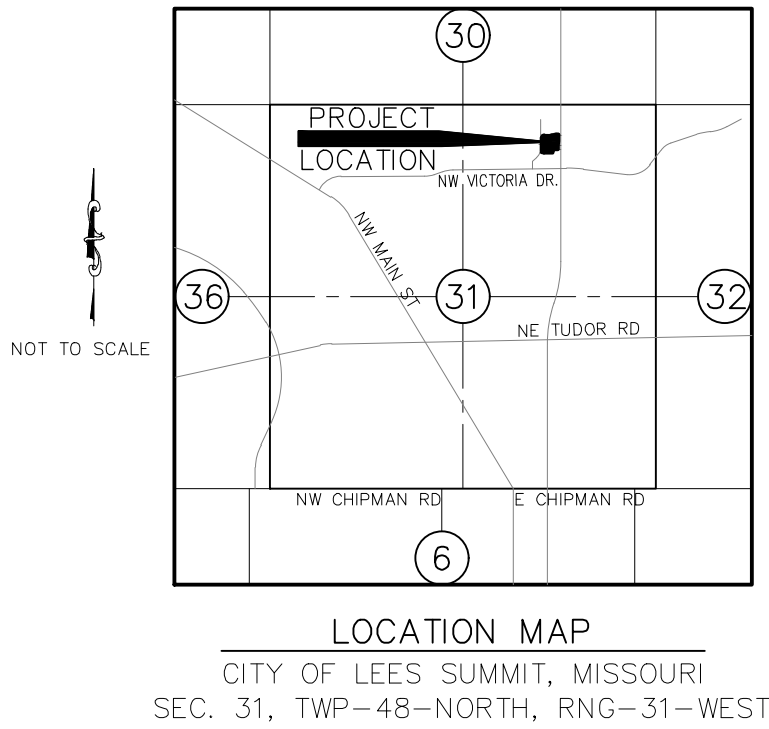

INDEX OF SHEETS

PAGE	DESCRIPTION
C001	COVER SHEET
C100	EXISTING CONDITIONS / DEMOLITION PLAN
C200	SITE PLAN
C300	DIMENSION PLAN
C400	GRADING PLAN
C401	GRADING PLAN NOTES
C500	UTILITY PLAN
C600	EROSION CONTROL PLAN
C700	DETAIL SHEET 01
C701	DETAIL SHEET 02
C702	DETAIL SHEET 03
C703	DETAIL SHEET 04
C704	DETAIL SHEET 05
L100	LANDSCAPE PLAN

**FLOOD STATEMENT:**  
THE ACCURACY OF ANY FLOOD HAZARD DATA SHOWN HEREON IS SUBJECT TO MAP SCALE UNCERTAINTY AND TO ANY OTHER UNCERTAINTY IN LOCATION OR ELEVATION ON THE REFERENCED FLOOD INSURANCE RATE MAP. THE SURVEYED PROPERTY LIES WITHIN FLOOD HAZARD ZONE "X, NON-SHADED" AS SAID PROPERTY PLOTS BY SCALE ON THE FLOOD INSURANCE RATE MAP CITY OF LEE'S SUMMIT, COMMUNITY PANEL NO. 29095C0409G, EFFECTIVE ON 01/20/2017.

**DATUM BENCHMARK:**  
DATUM IS U.S. SURVEY FEET AND REFERS TO NAVD88 DATUM DERIVED FROM CONNECTIONS TO NATIONAL CORS NETWORK VIA GPS STATIC SESSIONS ON PROJECT CONTROL PROCESSED WITH THE NATIONAL GEODETIC SURVEY'S OPUS PROJECTS UTILITY. ORTHOMETRIC HEIGHT WAS CALCULATED USING THE GEOID12B MODEL.

**BENCHMARKS:**  
JA-43: 3" ALUM DISK STAMPED JA-43 ON THE WEST SIDE OF DOUGLAS AND 44'± SOUTH OF THE S.E. BOUNDARY CORNER OF THE SURVEY. ELEV= 1034.77  
BS#60: FOUND "SQUARE" CUT ON THE BACK OF CURB ON THE SOUTH SIDE OF A PRIVATE DRIVE ON THE NORTH SIDE OF LOT 3 AND LOCATED NEAR THE NORTHEAST BOUNDARY CORNER, MARKED BY OTHERS 1028.00. ELEV= 1028.03

**NOTES:**  
1. THERE ARE NO ACTIVE, INACTIVE OR CAPPED WELLS ON THE SITE BASED ON THE MO 2017 WELLS-STATE OF MISSOURI WELLHEAD INFORMATION.  
2. THERE ARE NO WETLANDS ON THE SITE PER THE NATIONAL WETLANDS INVENTORY MAP.

PARKING SUMMARY

DESCRIPTION	REQUIRED
REQUIRED STALLS	9
DESCRIPTION	PROPOSED
ACCESSIBLE PARKING STALLS	1
STANDARD PARKING STALLS	11
TOTAL PARKING STALLS	12

LAND USE SCHEDULE

DWELLING UNITS	0	
LAND AREA	0.939	UNITS/ACRE
PROPOSED IMPERVIOUS AREA	20,953	SQ.FT.
TOTAL FLOOR AREA	723	SQ.FT.
FLOOR AREA RATIO	0.017	
REQUIRED STALLS	9	
PROPOSED ACCESSIBLE PARKING STALLS	1	
PROPOSED STANDARD PARKING STALLS	11	
TOTAL PROPOSED PARKING STALLS	12	

**UTILITY STATEMENT:**  
THE UNDERGROUND UTILITIES SHOWN HEREON ARE FROM FIELD SURVEY INFORMATION OF ONE-CALL LOCATED UTILITIES, FIELD SURVEY INFORMATION OF ABOVE GROUND OBSERVABLE EVIDENCE, AND/OR THE SCALING AND PLOTTING OF EXISTING UTILITY MAPS AND DRAWINGS AVAILABLE TO THE SURVEYOR AT THE TIME OF SURVEY. THE SURVEYOR MAKES NO GUARANTEE THAT THE UNDERGROUND UTILITIES SHOWN COMPRISE ALL SUCH UTILITIES IN THE AREA, EITHER IN SERVICE OR ABANDONED. FURTHERMORE, THE SURVEYOR DOES NOT WARRANT THAT THE UNDERGROUND UTILITIES SHOWN ARE IN THE EXACT LOCATION INDICATED. THE SURVEYOR HAS NOT PHYSICALLY LOCATED THE UNDERGROUND UTILITIES BY EXCAVATION UNLESS OTHERWISE NOTED ON THIS SURVEY.

**SAFETY NOTICE TO CONTRACTOR:**  
IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES, THE CONTRACTOR WILL BE SOLELY AND COMPLETELY RESPONSIBLE FOR CONDITIONS OF THE JOB SITE, INCLUDING SAFETY OF ALL PERSONS AND PROPERTY DURING PERFORMANCE OF THE WORK. THIS REQUIREMENT WILL APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS.

**WARRANTY / DISCLAIMER:**  
THE DESIGNS REPRESENTED IN THESE PLANS ARE IN ACCORDANCE WITH ESTABLISHED PRACTICES OF CIVIL ENGINEERING FOR THE DESIGN FUNCTIONS AND USES INTENDED BY THE OWNER AT THIS TIME. HOWEVER, NEITHER KAW VALLEY ENGINEERING, INC NOR ITS PERSONNEL CAN OR DO WARRANTY THESE DESIGNS OR PLANS AS CONSTRUCTED, EXCEPT IN THE SPECIFIC CASES WHERE KAW VALLEY ENGINEERING PERSONNEL INSPECT AND CONTROL THE PHYSICAL CONSTRUCTION ON A CONTEMPORARY BASIS AT THE SITE.

**CAUTION -- NOTICE TO CONTRACTOR:**  
THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE LOCATION AND/OR ELEVATION OF EXISTING UTILITIES AS SHOWN ON THESE PLANS IS BASED ON RECORDS OF THE VARIOUS UTILITY COMPANIES AND, WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. THE INFORMATION IS NOT TO BE RELIED ON AS BEING EXACT OR COMPLETE. THE CONTRACTOR MUST CALL THE APPROPRIATE UTILITY COMPANY AT LEAST 48 HOURS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATION OF UTILITIES. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES WHICH CONFLICT WITH PROPOSED IMPROVEMENTS SHOWN ON THE PLANS. THE CONTRACTOR SHALL EXPOSE EXISTING UTILITIES AT LOCATIONS OF POSSIBLE CONFLICTS PRIOR TO ANY CONSTRUCTION.



7 BREW

1410 N.E. DOUGLAS STREET

LEE'S SUMMIT, MO. 64086

FINAL DEVELOPMENT PLAN

COVER SHEET

PROJ. NO.

B21D4397

DESIGNER

MTA

DRAWN BY

JNG

CFN

4397DEMO

SHEET

FDP

REV

3

8040 N. OAK TRAFFICWAY  
KANSAS CITY, MISSOURI 64118  
PH: (816) 468-5858  
fcd@kaveng.com | www.kaveng.com

KAW VALLEY ENGINEERING

KAW VALLEY ENGINEERING, INC. IS AUTHORIZED TO OFFER ENGINEERING SERVICES BY MISSOURI STATE CERTIFICATE OF AUTHORITY # 000842. EXPIRES 12/31/23

MARTIN T. ARLING

ENGINEER

MO # 2009002955

STATE OF MISSOURI

PROFESSIONAL ENGINEER

MARTIN T. ARLING

NUMBER

PE-2009002955

PER CITY COMMENTS

PER OWNER COMMENTS

CHECK SET

INITIAL ISSUE

REV

DATE

DESCRIPTION

JNG

MTA

JNG

MTA

JNG

ARM

JNG

MTA


CHK

DSN

DWN

THIS DRAWING SHALL NOT BE UTILIZED BY ANY PERSON, FIRM, OR CORPORATION IN WHOLE OR IN PART WITHOUT THE SPECIFIC PERMISSION OF K&W VALLEY ENGINEERING, INC.



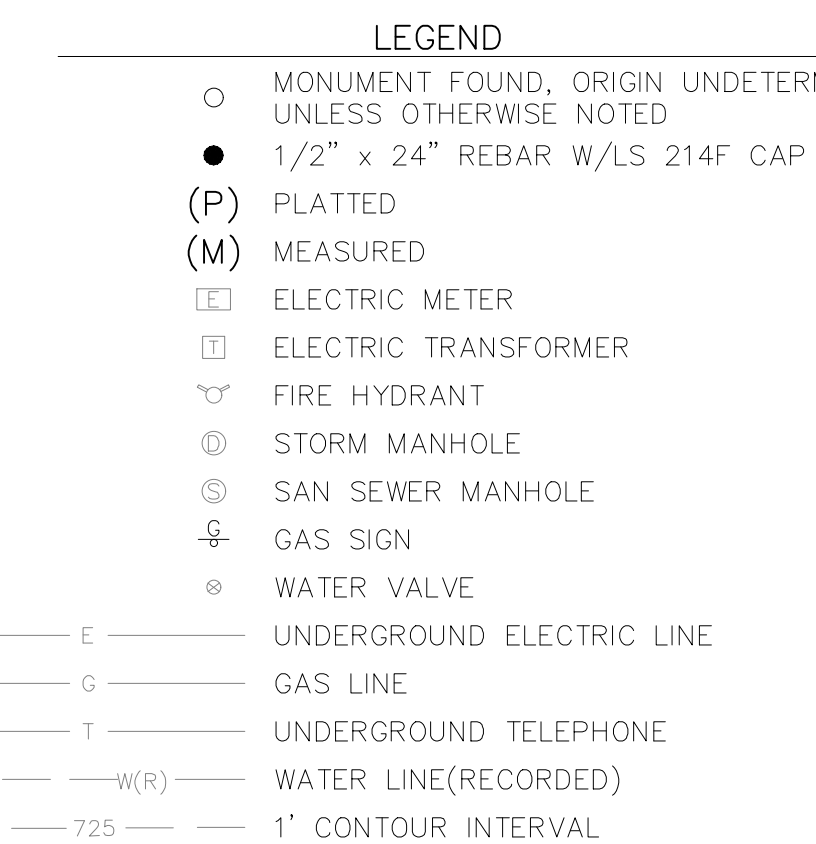

— E ——— UNDERGROUND ELECTRIC LINE  
— G ——— GAS LINE  
— T ——— UNDERGROUND TELEPHONE  
— W(R) ——— WATER LINE(RECORDED)  
— 725 ——— 1' CONTOUR INTERVAL

1. CONTRACTOR SHALL VERIFY SITE CONDITIONS PRIOR TO BIDDING. CONTRACTOR SHALL REMOVE AS SHOWN, IN ACCORDANCE WITH THE SPECIFICATIONS AND THE CITY AND STATE REGULATIONS.
2. ALL STRUCTURES AND MATERIAL WITHIN DEMOLITION LIMITS TO BE REMOVED AND DISPOSED OF IN CONFORMANCE WITH LOCAL, STATE AND FEDERAL REGULATIONS.
3. ALL HAZARDOUS ASBESTOS AND OTHER HAZARDOUS MATERIALS MUST BE IDENTIFIED AND REMOVED PRIOR TO ANY BUILDING DEMOLITION, IN STRICT CONFORMANCE WITH LOCAL, STATE AND FEDERAL REGULATIONS.
4. DRIVES, PAVING AND OTHER STRUCTURES ON STREET OR HIGHWAY RIGHT-OF-WAY SHALL BE REMOVED AS NECESSARY TO CONSTRUCT IMPROVEMENTS SHOWN ON THESE PLANS. REMOVAL AND DISPOSAL SHALL BE IN CONFORMANCE WITH LOCAL, STATE AND FEDERAL REGULATIONS.
5. ALL PAVING WITHIN PROPERTY TO BE REMOVED AND DISPOSED OF IN CONFORMANCE WITH LOCAL, STATE AND FEDERAL REGULATIONS.


THE ACCURACY OF ANY FLOOD HAZARD DATA SHOWN HEREON IS SUBJECT TO MAP SCALE UNCERTAINTY AND TO ANY OTHER UNCERTAINTY IN LOCATION OR ELEVATION ON THE REFERENCED FLOOD INSURANCE RATE MAP. THE SURVEYED PROPERTY LIES WITHIN FLOOD HAZARD ZONE "X, NON-SHADED" AS SAID PROPERTY PLOTS BY SCALE ON THE FLOOD INSURANCE RATE MAP CITY OF LEE'S SUMMIT, COMMUNITY PANEL NO. 29095C0409G, EFFECTIVE ON 01/20/2017.

DATUM IS U.S. SURVEY FEET AND REFERS TO NAVD88 DATUM DERIVED FROM CONNECTIONS TO NATIONAL CORS NETWORK VIA GPS STATIC SESSIONS ON PROJECT CONTROL PROCESSED WITH THE NATIONAL GEODETIC SURVEY'S OPUS PROJECTS UTILITY. ORTHOMETRIC HEIGHT WAS CALCULATED USING THE GEOID12B MODEL.

JA-43: 3" ALUM DISK STAMPED JA-43 ON THE WEST SIDE OF DOUGLAS AND 44± SOUTH OF THE S.E. BOUNDARY CORNER OF THE SURVEY. ELEV= 1034.77

BS#60: FOUND "SQUARE" CUT ON THE BACK OF CURB ON THE SOUTH SIDE OF A PRIVATE DRIVE ON THE NORTH SIDE OF LOT 3 AND LOCATED NEAR THE NORTHEAST BOUNDARY CORNER, MARKED BY OTHERS 1028.00. ELEV= 1028.03

3	06/22/22	PER CITY COMMENTS	MTA	JNG
2	05/06/22	PER OWNER COMMENTS	MTA	JNG
1	04/08/22	CHECK SET	MTA	JNG
0	03/02/22	INITIAL ISSUE	ARM	JNG
REV	DATE	DESCRIPTION	DSN	DWN
			CHK	

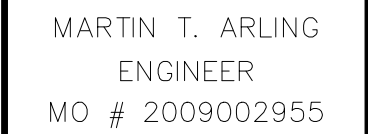

**KAW VALLEY ENGINEERING**

KAW VALLEY ENGINEERING, INC. IS AUTHORIZED TO OFFER ENGINEERING SERVICES BY MISSOURI STATE CERTIFICATE OF AUTHORITY # 000842.  
EXPIRES 12/31/23

**KV**

8040 N. OAK ST. TRAFFICWAY  
KANSAS CITY, MISSOURI 64118  
PH. (816) 468-5858 | FAX (816) 468-4651  
kce@kveeng.com | www.kveeng.com

**7 BREW**  
1410 N.E. DOUGLAS STREET  
LEE'S SUMMIT, MO. 64086


**FINAL DEVELOPMENT PLAN  
EXISTING SITE CONDITIONS / DEMOLITION PLAN**



PROJ. NO.		B21D4397	
DESIGNER		DRAWN BY	
MTA		JNG	
CFN			
4397DEMO			
SHEET		REV	
C100		3	

THIS DRAWING SHALL NOT BE UTILIZED BY ANY PERSON, FIRM OR CORPORATION IN WHOLE OR IN PART WITHOUT THE SPECIFIC PERMISSION OF KAW VALLEY ENGINEERING, INC.






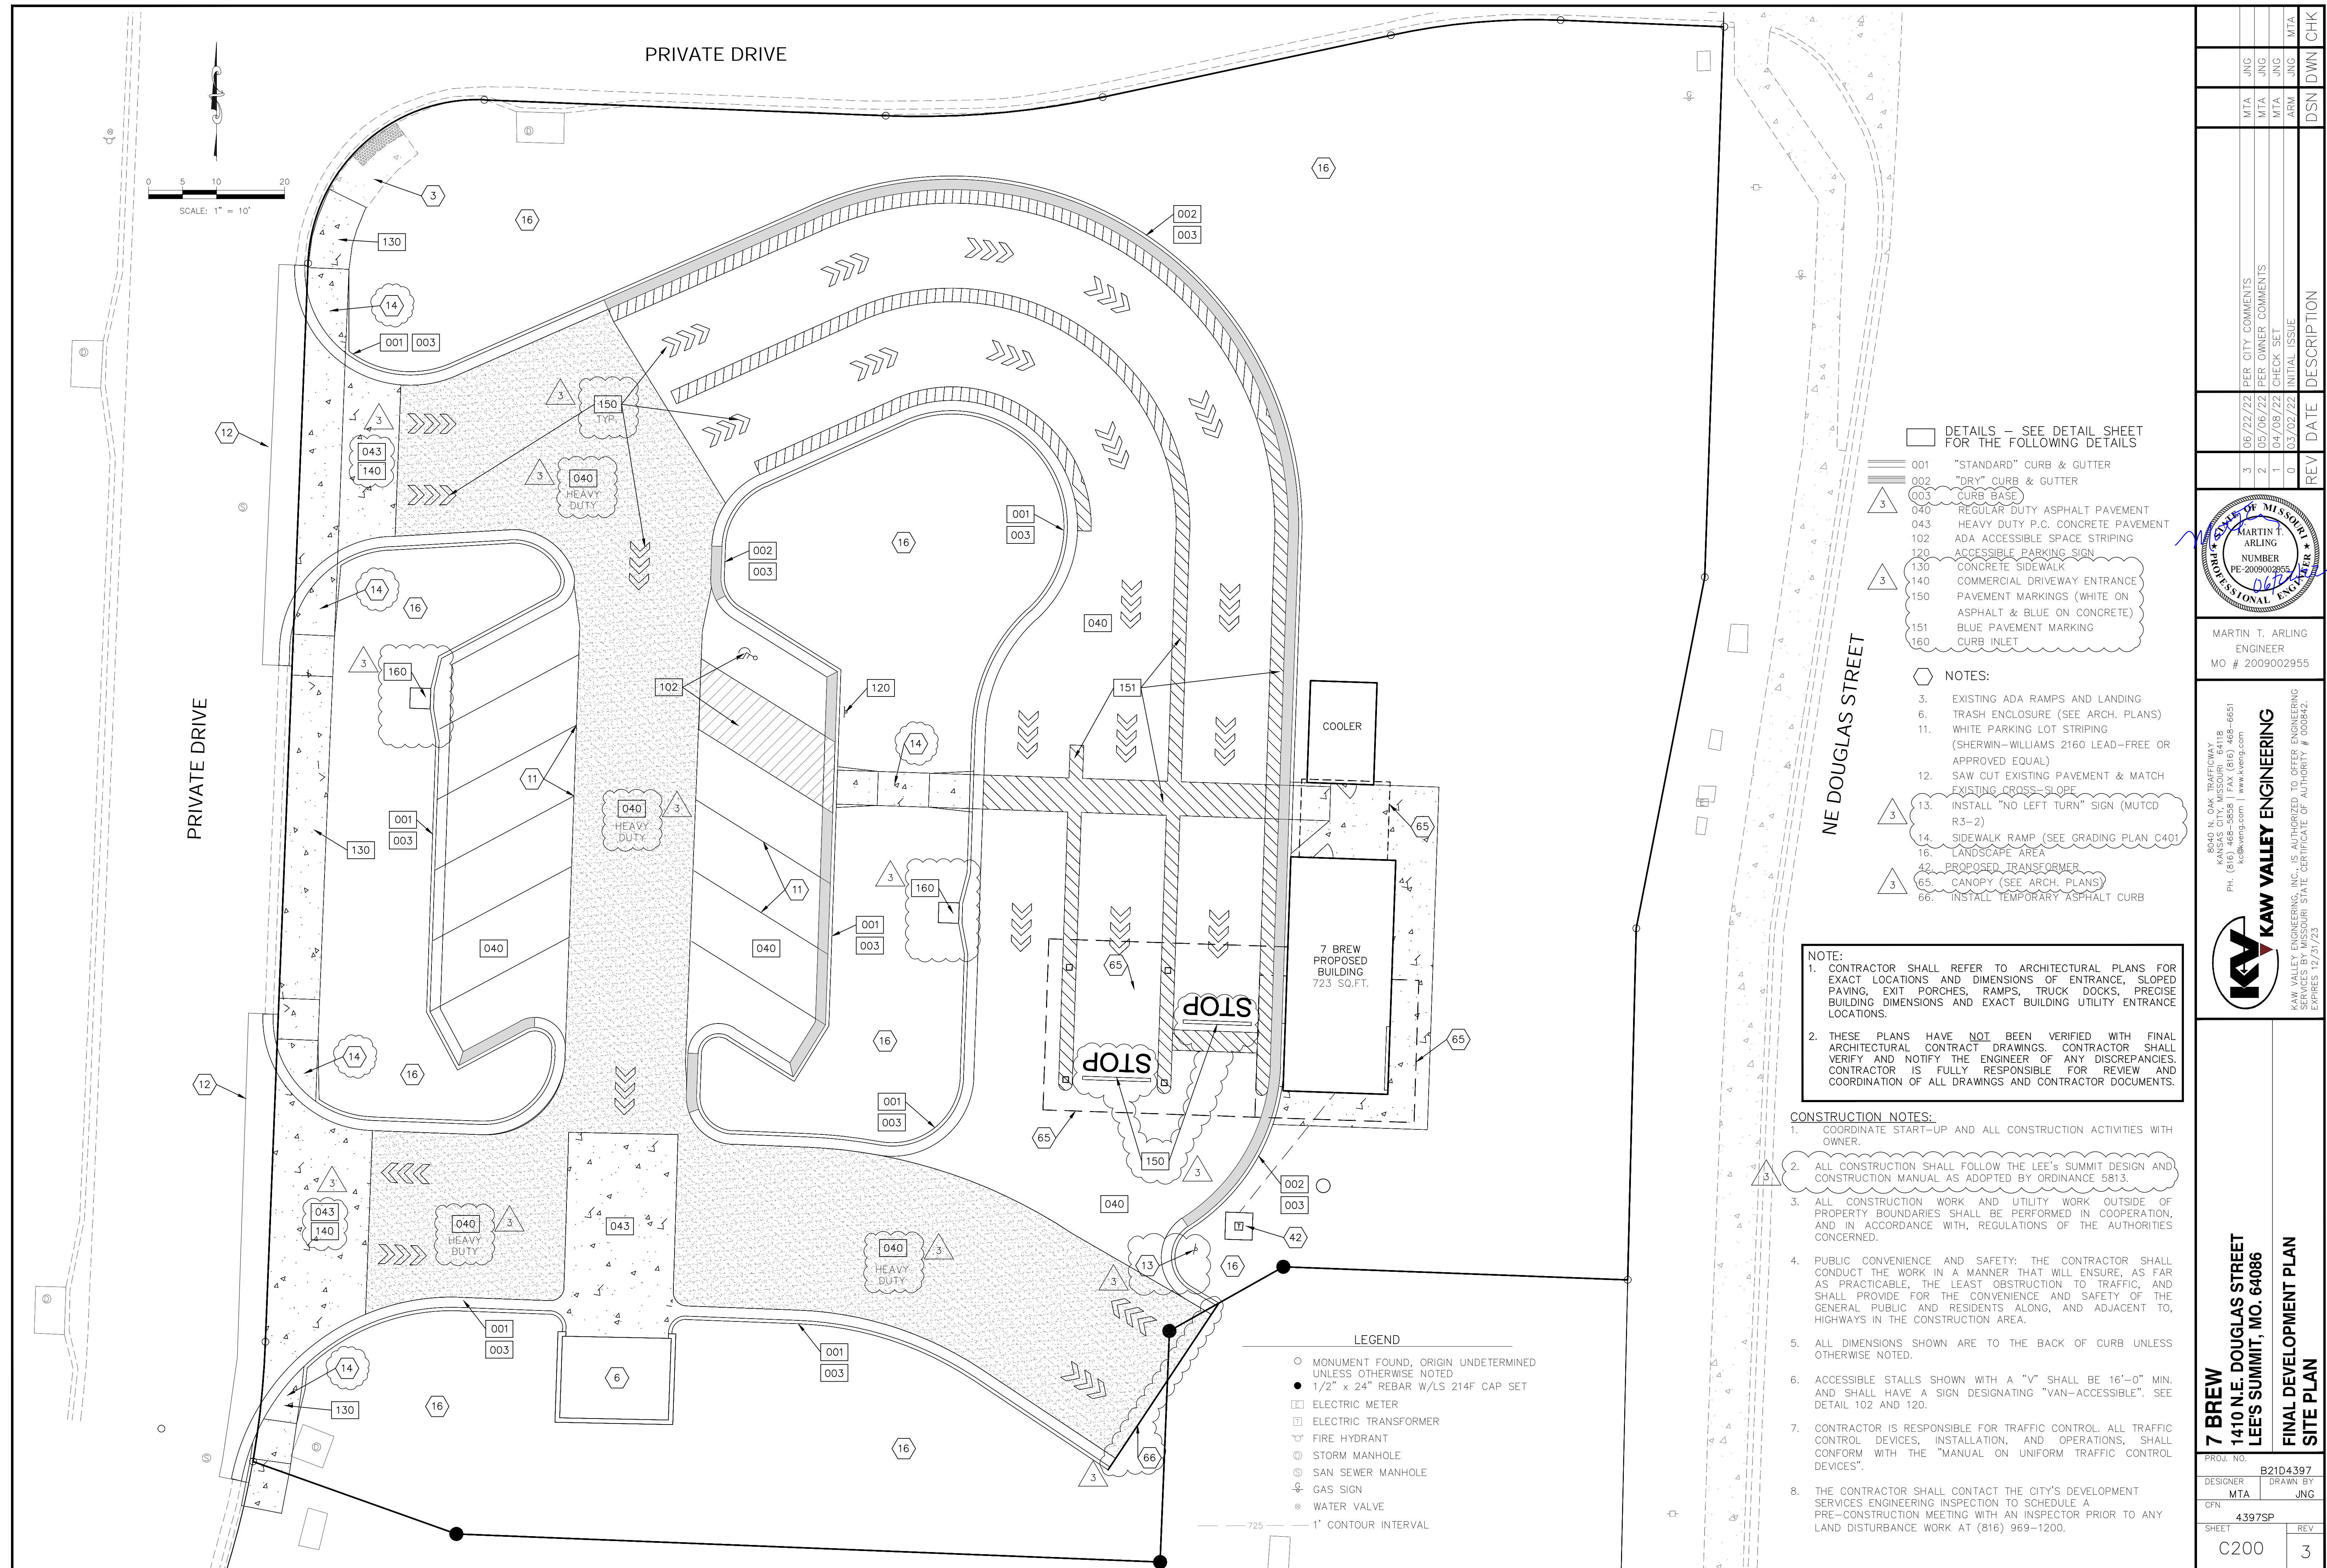

7 BREW 1410 N.E. DOUGLAS STREET LEE'S SUMMIT, MO. 64086	PROJ. NO. B21D4397	DESIGNER	MTA	DRAWN BY	JNG	SHEET C200	REV 3																												
		CPN	4397SP																																
<div><div><div><b>KAW VALLEY ENGINEERING</b> KAW VALLEY ENGINEERING, INC. IS AUTHORIZED TO OFFER ENGINEERING SERVICES BY MISSOURI STATE. CERTIFICATE OF AUTHORITY # 000842. EXPIRES 12/31/23</div></div><div>8940 N. OAK TRAFFICWAY KANSAS CITY, MISSOURI 64114 PH. (816) 468-2858   FAX (816) 468-6651 kce@kveeng.com   www.kveeng.com</div></div>																																			
<div><div><div><b>MARTIN T. ARLING</b> ENGINEER MO # 2009002955</div></div><div><b>KAW VALLEY ENGINEERING</b> KAW VALLEY ENGINEERING, INC. IS AUTHORIZED TO OFFER ENGINEERING SERVICES BY MISSOURI STATE. CERTIFICATE OF AUTHORITY # 000842. EXPIRES 12/31/23</div></div>																																			
<div><div><b>MARTIN T. ARLING</b> ENGINEER MO # 2009002955</div><div><table><tr><th>REV</th><th>DATE</th><th>DESCRIPTION</th><th>DSN</th><th>DWN</th><th>CHK</th></tr><tr><td>3</td><td>06/22/22</td><td>PER CITY COMMENTS</td><td>MTA</td><td>JNG</td><td></td></tr><tr><td>2</td><td>05/06/22</td><td>PER OWNER COMMENTS</td><td>MTA</td><td>JNG</td><td></td></tr><tr><td>1</td><td>04/08/22</td><td>CHECK SET</td><td>ARM</td><td>JNG</td><td></td></tr><tr><td>0</td><td>03/02/22</td><td>INITIAL ISSUE</td><td>ARM</td><td>JNG</td><td></td></tr></table></div></div>						REV	DATE	DESCRIPTION	DSN	DWN	CHK	3	06/22/22	PER CITY COMMENTS	MTA	JNG		2	05/06/22	PER OWNER COMMENTS	MTA	JNG		1	04/08/22	CHECK SET	ARM	JNG		0	03/02/22	INITIAL ISSUE	ARM	JNG	
REV	DATE	DESCRIPTION	DSN	DWN	CHK																														
3	06/22/22	PER CITY COMMENTS	MTA	JNG																															
2	05/06/22	PER OWNER COMMENTS	MTA	JNG																															
1	04/08/22	CHECK SET	ARM	JNG																															
0	03/02/22	INITIAL ISSUE	ARM	JNG																															



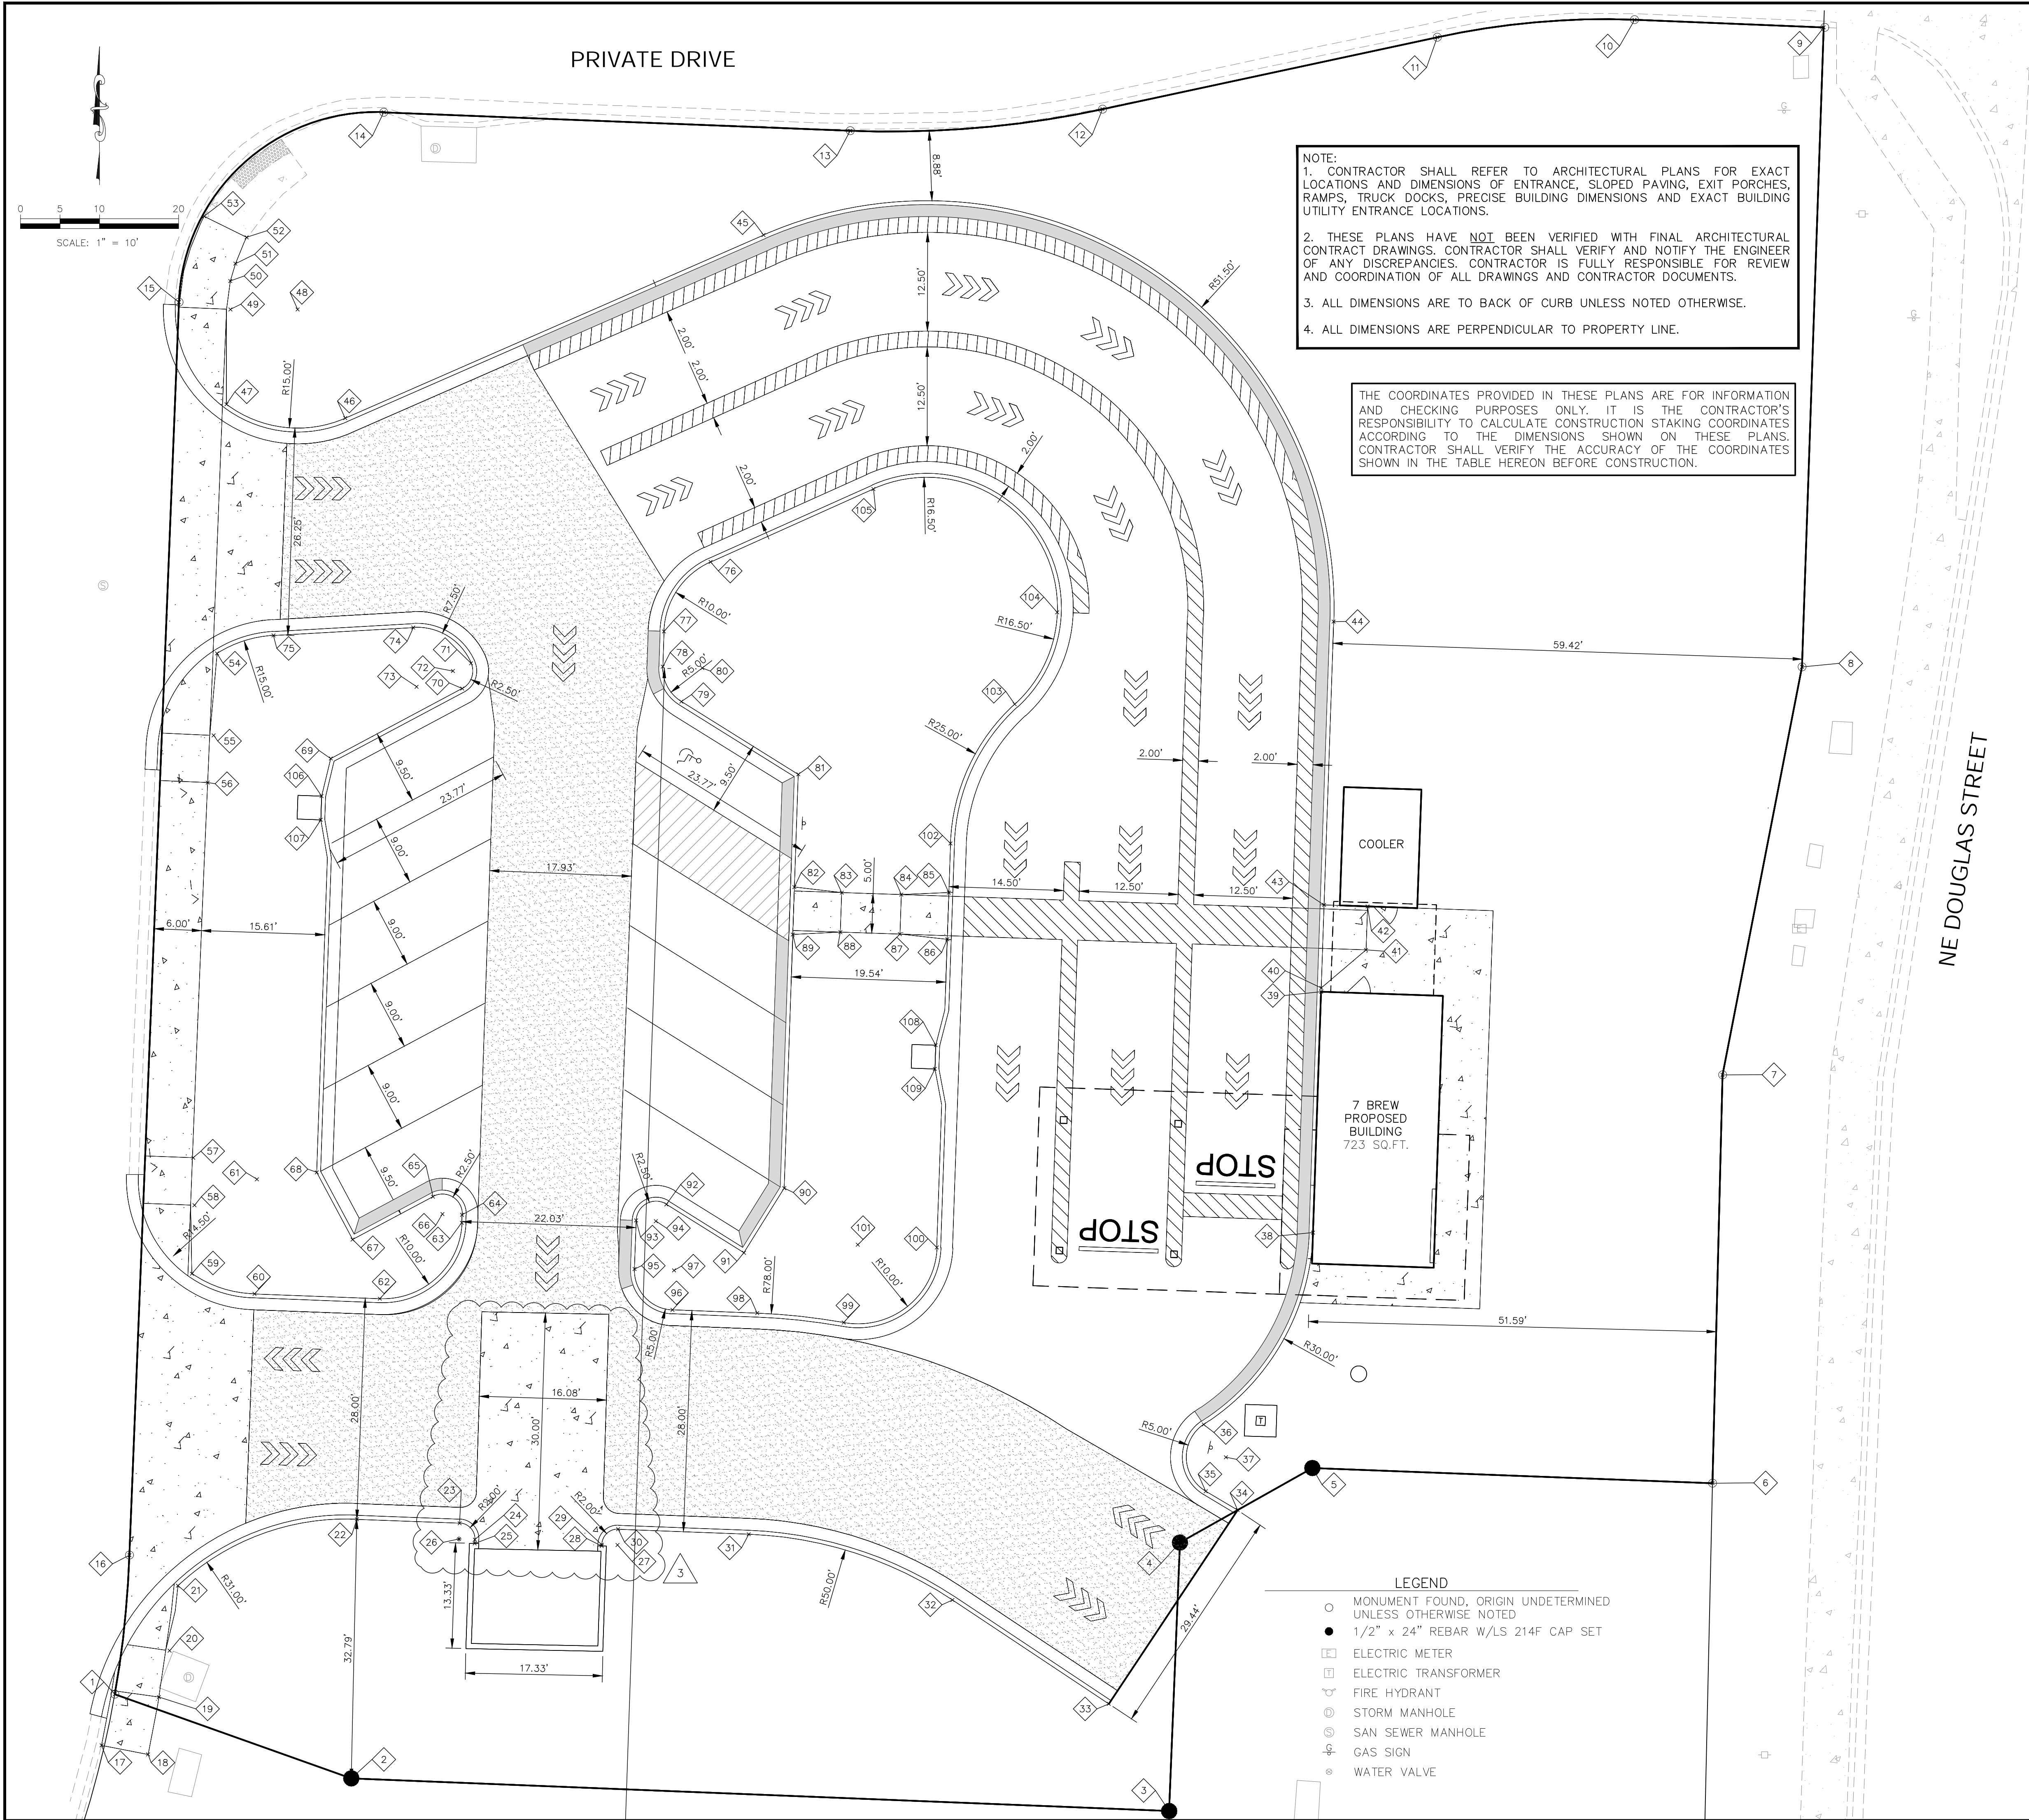

NOTE:  
1. CONTRACTOR SHALL REFER TO ARCHITECTURAL PLANS FOR EXACT LOCATIONS AND DIMENSIONS OF ENTRANCE, SLOPED PAVING, EXIT PORCHES, RAMPS, TRUCK DOCKS, PRECISE BUILDING DIMENSIONS AND EXACT BUILDING UTILITY ENTRANCE LOCATIONS.  
2. THESE PLANS HAVE NOT BEEN VERIFIED WITH FINAL ARCHITECTURAL CONTRACT DRAWINGS. CONTRACTOR SHALL VERIFY AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES. CONTRACTOR IS FULLY RESPONSIBLE FOR REVIEW AND COORDINATION OF ALL DRAWINGS AND CONTRACTOR DOCUMENTS.  
3. ALL DIMENSIONS ARE TO BACK OF CURB UNLESS NOTED OTHERWISE.  
4. ALL DIMENSIONS ARE PERPENDICULAR TO PROPERTY LINE.

THE COORDINATES PROVIDED IN THESE PLANS ARE FOR INFORMATION AND CHECKING PURPOSES ONLY. IT IS THE CONTRACTOR'S RESPONSIBILITY TO CALCULATE CONSTRUCTION STAKING COORDINATES ACCORDING TO THE DIMENSIONS SHOWN ON THESE PLANS. CONTRACTOR SHALL VERIFY THE ACCURACY OF THE COORDINATES SHOWN IN THE TABLE HEREON BEFORE CONSTRUCTION.

- LEGEND
- MONUMENT FOUND, ORIGIN UNDETERMINED UNLESS OTHERWISE NOTED
  - 1/2" x 24" REBAR W/LS 214F CAP SET
  - ELECTRIC METER
  - ELECTRIC TRANSFORMER
  - ⋈ FIRE HYDRANT
  - ⊙ STORM MANHOLE
  - ⊙ SAN SEWER MANHOLE
  - ⊕ GAS SIGN
  - ⊙ WATER VALVE

COORDINATE TABLE				COORDINATE TABLE			
	NORTHING	EASTING	DESCRIPTION		NORTHING	EASTING	DESCRIPTION
1	1008966.45	2823007.09	PL	61	1009031.62	2823025.07	RP
2	1008955.80	2823037.01	PL	62	1009016.49	2823040.61	BC
3	1008951.67	2823140.48	PL	63	1009026.11	2823050.98	BC
4	1008985.64	2823141.83	PL	64	1009027.11	2823051.02	BC
5	1008995.08	2823158.59	PL	65	1009029.42	2823047.35	BC
6	1008993.15	2823209.21	PL	66	1009027.21	2823048.53	RP
7	1009044.83	2823210.47	PL	67	1009023.99	2823037.17	BC
8	1009096.44	2823220.54	PL	68	1009032.49	2823032.63	BC
9	1009177.36	2823223.28	PL	69	1009084.84	2823034.40	BC
10	1009178.30	2823199.35	PL	70	1009093.71	2823051.03	BC
11	1009176.11	2823174.40	PL	71	1009096.90	2823052.15	BC
12	1009167.01	2823132.03	PL	72	1009095.91	2823049.85	RP
13	1009164.28	2823100.12	PL	73	1009093.93	2823045.26	RP
14	1009166.62	2823041.11	PL	74	1009101.42	2823044.84	BC
15	1009142.59	2823015.20	PL	75	1009100.42	2823027.16	BC
16	1008984.04	2823008.93	PL	76	1009109.72	2823082.46	BC
17	1008959.98	2823005.41	SW	77	1009100.93	2823076.56	BC
18	1008958.84	2823011.30	SW	78	1009096.47	2823076.41	BC
19	1008966.09	2823012.66	SW	79	1009092.06	2823078.76	BC
20	1008971.96	2823014.03	SW	80	1009096.30	2823081.41	RP
21	1008980.19	2823015.08	SW	81	1009082.84	2823093.55	BC
22	1008988.58	2823037.71	BC	82	1009068.58	2823093.07	SW
23	1008988.09	2823050.70	BC	83	1009067.88	2823099.04	SW
24	1008986.02	2823052.63	BC	84	1009067.63	2823106.58	SW
25	1008985.53	2823052.62	BC	85	1009067.89	2823112.60	SW
26	1008986.09	2823050.63	RP	86	1009061.97	2823112.40	SW
27	1008985.33	2823070.69	RP	87	1009062.63	2823106.42	SW
28	1008985.20	2823068.69	BC	88	1009062.89	2823098.88	SW
29	1008985.37	2823068.69	BC	89	1009062.59	2823092.86	SW
30	1008987.33	2823070.77	BC	90	1009030.49	2823091.78	BC
31	1008986.70	2823087.29	BC	91	1009022.31	2823086.68	BC
32	1008978.37	2823113.06	BC	92	1009028.43	2823076.86	BC
33	1008965.24	2823132.83	BC	93	1009026.40	2823073.04	BC
34	1008989.75	2823149.13	BC	94	1009026.31	2823075.54	RP
35	1008992.15	2823145.10	BC	95	1009020.25	2823072.83	BC
36	1009000.58	2823144.84	BC	96	1009015.09	2823077.64	BC
37	1008996.44	2823147.65	BC	97	1009020.08	2823077.83	RP
38	1009024.86	2823158.67	BC	98	1009014.68	2823088.35	BC
39	1009055.33	2823159.70	BC	99	1009013.48	2823099.30	BC
40	1009055.82	2823159.72	SW	100	1009022.98	2823111.08	BC
41	1009060.63	2823165.38	SW	101	1009023.32	2823101.08	RP
42	1009066.14	2823165.57	SW	102	1009074.10	2823112.81	BC
43	1009066.32	2823160.07	SW	103	1009091.72	2823120.94	BC
44	1009102.16	2823161.28	BC	104	1009103.34	2823126.30	BC
45	1009151.08	2823089.17	BC	105	1009118.96	2823103.06	BC
46	1009127.92	2823036.24	BC	106	1009080.09	2823033.24	BC
47	1009129.67	2823021.21	BC	107	1009077.09	2823033.14	BC
48	1009141.66	2823030.22	RP	108	1009048.58	2823110.94	BC
49	1009141.68	2823021.72	SW	109	1009045.58	2823110.84	BC
50	1009145.27	2823021.69	SW				
51	1009147.47	2823022.34	SW				
52	1009150.80	2823023.76	SW				
53	1009153.47	2823018.38	SW				
54	1009098.15	2823020.03	SW				
55	1009087.78	2823019.60	SW				
56	1009081.80	2823018.84	SW				
57	1009034.34	2823017.01	SW				
58	1009028.33	2823017.17	SW				
59	1009019.65	2823016.84	SW				
60	1009017.10	2823024.75	BC				

COORDINATE  
TABLE LEGEND

BC

SW

RP

PL

= BACK OF CURB

= EDGE OF SIDEWALK

= RADIUS POINT

= PROPERTY LINE

COORDINATE TABLE LEGEND  
BC = BACK OF CURB  
SW = EDGE OF SIDEWALK  
RP = RADIUS POINT  
PL = PROPERTY LINE

STATE OF MISSOURI  
MARTIN T. ARLING  
NUMBER  
PE-2009002955  
06/22/22

MARTIN T. ARLING  
ENGINEER  
MO # 2009002955

8040 N. OAK TRAFFICWAY  
KANSAS CITY, MISSOURI 64118  
PH: (816) 466-1238  
lic@kaweng.com | www.kaweng.com

KAW VALLEY ENGINEERING

KAW VALLEY ENGINEERING, INC. IS AUTHORIZED TO OFFER ENGINEERING SERVICES BY MISSOURI STATE CERTIFICATE OF AUTHORITY # 000842.  
EXPIRES 12/31/23

7 BREW  
1410 N.E. DOUGLAS STREET  
LEE'S SUMMIT, MO. 64086

FINAL DEVELOPMENT PLAN  
DIMENSION PLAN

PROJ. NO.  
B21D4397

DESIGNER  
MTA

DRAWN BY  
JNG

CFN  
4397DIM

SHEET  
C300


REV  
3








3. THE CONSTRUCTION AREA SHALL BE CLEARED, GRUBBED, AND STRIPPED OF TOPSOIL AND ORGANIC MATTER FROM ALL AREAS TO BE OCCUPIED BY BUILDING AND PAVING. TOPSOIL FOR REPLACEMENT ON SLOPES MAY BE STOCKPILED ON SITE. EXCESS TOPSOIL MAY BE WASTED IN FILL SLOPES PROVIDED THAT NO TOPSOIL WILL BE WASTED WITHIN 10 FEET OF THE EDGE OF THE BUILDING OR PARKING AREA. BURNING OF TIMBER WILL NOT BE PERMITTED UNLESS APPROVAL IS OBTAINED FROM GOVERNING OFFICIALS. STRIPPING EXISTING TOPSOIL AND ORGANIC MATTER SHALL BE TO A MINIMUM DEPTH OF 6 INCHES.
4. AREAS TO RECEIVE FILL SHALL BE SCARIFIED AND THE TOP 8-INCH DEPTH COMPACTED TO 95% STANDARD PROCTOR DENSITY. ANY UNSUITABLE AREAS SHALL BE UNDERCUT AND REPLACED WITH SUITABLE MATERIAL BEFORE ANY FILL MATERIAL CAN BE APPLIED.
5. OFF-SITE FILL MATERIAL SHALL HAVE A PLASTICITY INDEX OF 25 OR LESS, A LIQUID LIMIT OF 45 OR LESS AND CONTAIN NO ROCK LARGER THAN FOUR INCHES. OFF-SITE FILL MATERIAL SHALL BE APPROVED BY THE OWNER PRIOR TO BRINGING ON SITE.
6. EARTHWORK UNDER THE BUILDING SHALL COMPLY WITH THE PROJECT ARCHITECTURAL PLANS. OTHER FILL MATERIAL SHALL BE MADE IN LIFTS NOT TO EXCEED EIGHT INCHES DEPTH COMPACTED TO 95% STANDARD PROCTOR DENSITY. FILL MATERIAL MAY INCLUDE ROCK FROM ON-SITE EXCAVATION IF CAREFULLY PLACED SO THAT LARGE STONES ARE WELL DISTRIBUTED AND VOIDS ARE COMPLETELY FILLED WITH SMALLER STONES, EARTH, SAND OR GRAVEL TO FURNISH A SOLID EMBANKMENT. NO ROCK LARGER THAN THREE INCHES IN ANY DIMENSION NOR ANY SHALE SHALL BE PLACED IN THE TOP 12 INCHES OF EMBANKMENT.
7. AREAS THAT ARE TO BE CUT TO SUBGRADE LEVELS SHALL BE PROOF ROLLED WITH A MODERATELY HEAVY LOADED DUMP TRUCK OR SIMILAR APPROVED CONSTRUCTION EQUIPMENT TO DETECT UNSUITABLE SOIL CONDITIONS.
8. IN ALL AREAS OF EXCAVATION, IF UNSUITABLE SOIL CONDITIONS ARE ENCOUNTERED, A QUALIFIED GEOTECHNICAL ENGINEER SHALL RECOMMEND TO THE OWNER THE METHODS OF UNDERCUTTING AND REPLACEMENT OF PROPERLY COMPACTED, APPROVED FILL MATERIAL. ALL PROOFROLLING AND UNDERCUTTING SHOULD BE PERFORMED DURING A PERIOD OF DRY WEATHER.
9. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE CONTROL OF DUST AND DIRT RISING AND SCATTERING IN THE AIR DURING CONSTRUCTION AND SHALL PROVIDE WATER SPRINKLING OR OTHER SUITABLE METHODS OF CONTROL. THE CONTRACTOR SHALL COMPLY WITH ALL GOVERNING REGULATIONS PERTAINING TO ENVIRONMENTAL PROTECTION.
10. ALL SLOPES ARE TO BE 3:1 OR FLATTER UNLESS OTHERWISE INDICATED.
11. ALL SLOPES EXCEEDING 3:1 SHALL BE PROTECTED BY RIP RAP, CONCRETE PAVING, OR OTHER METHODS INDICATED ON THESE PLANS, THAT WILL PREVENT EROSION AND PLACED SUCH THAT THE SURFACE IS FLUSH WITH SURROUNDING GROUND AND SHAPED TO CHANNEL WATER IN DIRECTIONS INDICATED.
12. ALL SLOPES AND AREAS DISTURBED BY CONSTRUCTION SHALL BE GRADED SMOOTH AND FOUR INCHES OF TOPSOIL APPLIED. IF ADEQUATE TOPSOIL IS NOT AVAILABLE ON-SITE, THE CONTRACTOR SHALL PROVIDE TOPSOIL, APPROVED BY THE OWNER, AS NEEDED. THE AREA SHALL THEN BE SEEDED, FERTILIZED, MULCHED, WATERED AND MAINTAINED UNTIL HARDY GRASS GROWTH IS ESTABLISHED IN ALL AREAS. ANY AREAS DISTURBED FOR ANY REASON SHALL BE CORRECTED BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE OWNER PRIOR TO FINAL ACCEPTANCE OF THE PROJECT.
13. CONTRACTOR SHALL USE SILT FENCE, BALES OF HAY OR OTHER MEANS OF CONTROLLING EROSION ALONG THE EDGE OF THE PROPERTY OR OTHER BOTTOM OF SLOPE LOCATIONS.
14. CONTRACTOR IS TO REMOVE AND DISPOSE OF ALL DEBRIS, RUBBISH AND OTHER MATERIALS RESULTING FROM PREVIOUS AND CURRENT DEMOLITION OPERATIONS.
15. THE CONTRACTOR SHALL TAKE ALL PRECAUTIONS NECESSARY TO AVOID PROPERTY DAMAGE TO ADJACENT PROPERTIES DURING THE CONSTRUCTION PHASES OF THIS PROJECT. THE CONTRACTOR WILL BE HELD SOLELY RESPONSIBLE FOR ANY DAMAGES TO THE ADJACENT PROPERTIES OCCURRING DURING THE CONSTRUCTION PHASES OF THIS PROJECT.
16. IT IS NOT THE DUTY OF THE ENGINEER OR THE OWNER TO REVIEW THE ADEQUACY OF THE CONTRACTOR'S SAFETY MEASURES, IN, ON OR NEAR THE CONSTRUCTION SITE AT ANY TIME DURING CONSTRUCTION.
17. HANDICAP STALLS SHALL MEET ADA REQUIREMENTS AND SHALL NOT EXCEED 2% SLOPE IN ANY DIRECTION AT THE BUILDING ENTRY AND ACCESSIBLE PARKING STALLS. SLOPES EXCEEDING 2.0% WILL BE REPLACED AT THE CONTRACTOR'S EXPENSE.
18. PIPE LENGTHS ARE CENTER TO CENTER OF STRUCTURE OR TO END OF END SECTIONS.

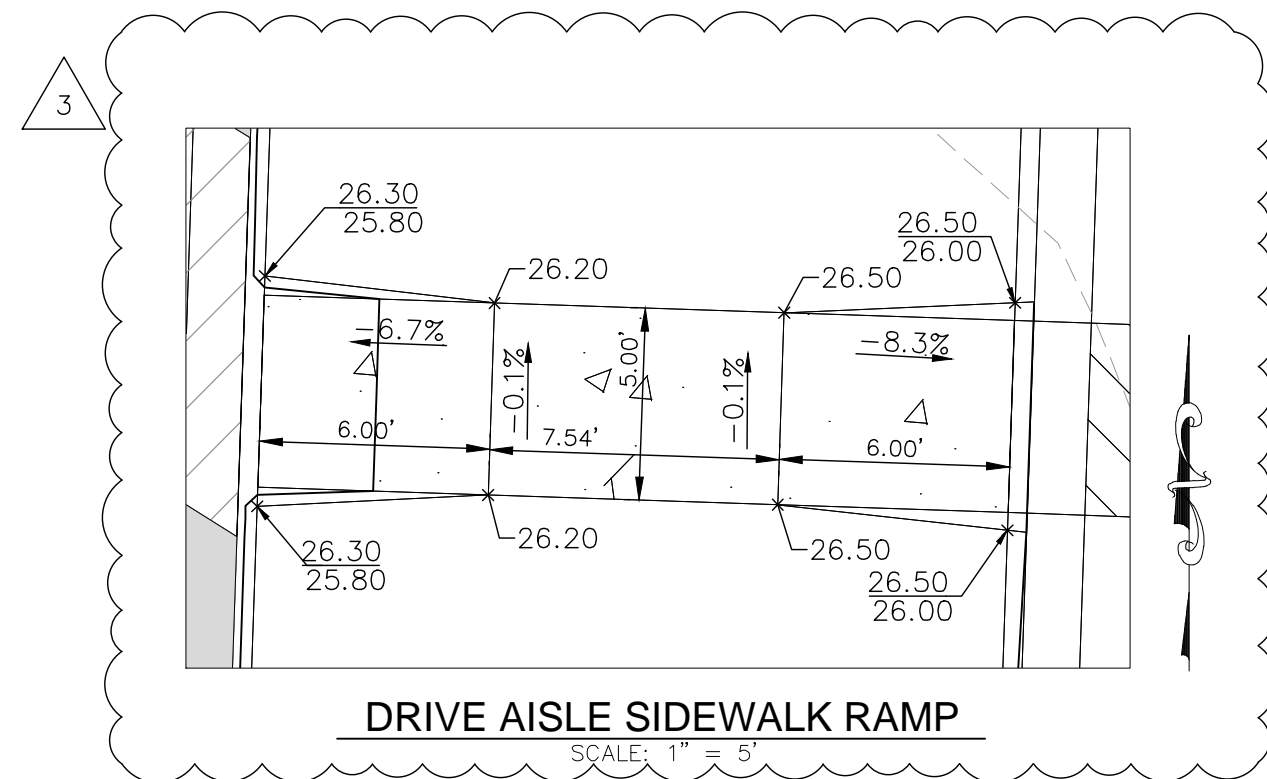


**Know what's below.  
Call before you dig.**


<b>7 BREW</b> <b>1410 N.E. DOUGLAS STREET</b> <b>LEE'S SUMMIT, MO. 64086</b>		 <b>KAW VALLEY ENGINEERING</b> <small>9540 N. HWY. 174 E. COLUMBIA, MISSOURI 64118          PH. (816) 468-3558   FAX (816) 468-6651          kce@kveing.com   www.kveing.com</small>				MARTIN T. ARLING ENGINEER MO # 2009002955		KAW VALLEY ENGINEERING, INC., IS AUTHORIZED TO OFFER ENGINEERING SERVICES BY MISSOURI STATE CERTIFICATE OF AUTHORITY # 000842. EXPIRES 12/31/23			
<b>FINAL DEVELOPMENT PLAN</b> <b>GRADING PLAN NOTES</b>		PROJ. NO. <b>B21D4397</b>		DESIGNER <b>MTA</b> DRAWN BY <b>JNG</b>		CFN <b>4397GP</b>		REV			
<b>C401</b>		SHEET		3		DATE		DESCRIPTION			
3		06/22/22		PER CITY COMMENTS		MTA		JNG			
2		05/06/22		PER OWNER COMMENTS		MTA		JNG			
1		04/08/22		CHECK SET		MTA		JNG			
0		03/02/22		INITIAL ISSUE		ARM		JNG			
REV		DATE		DESCRIPTION		DSN		DWN		CHK	



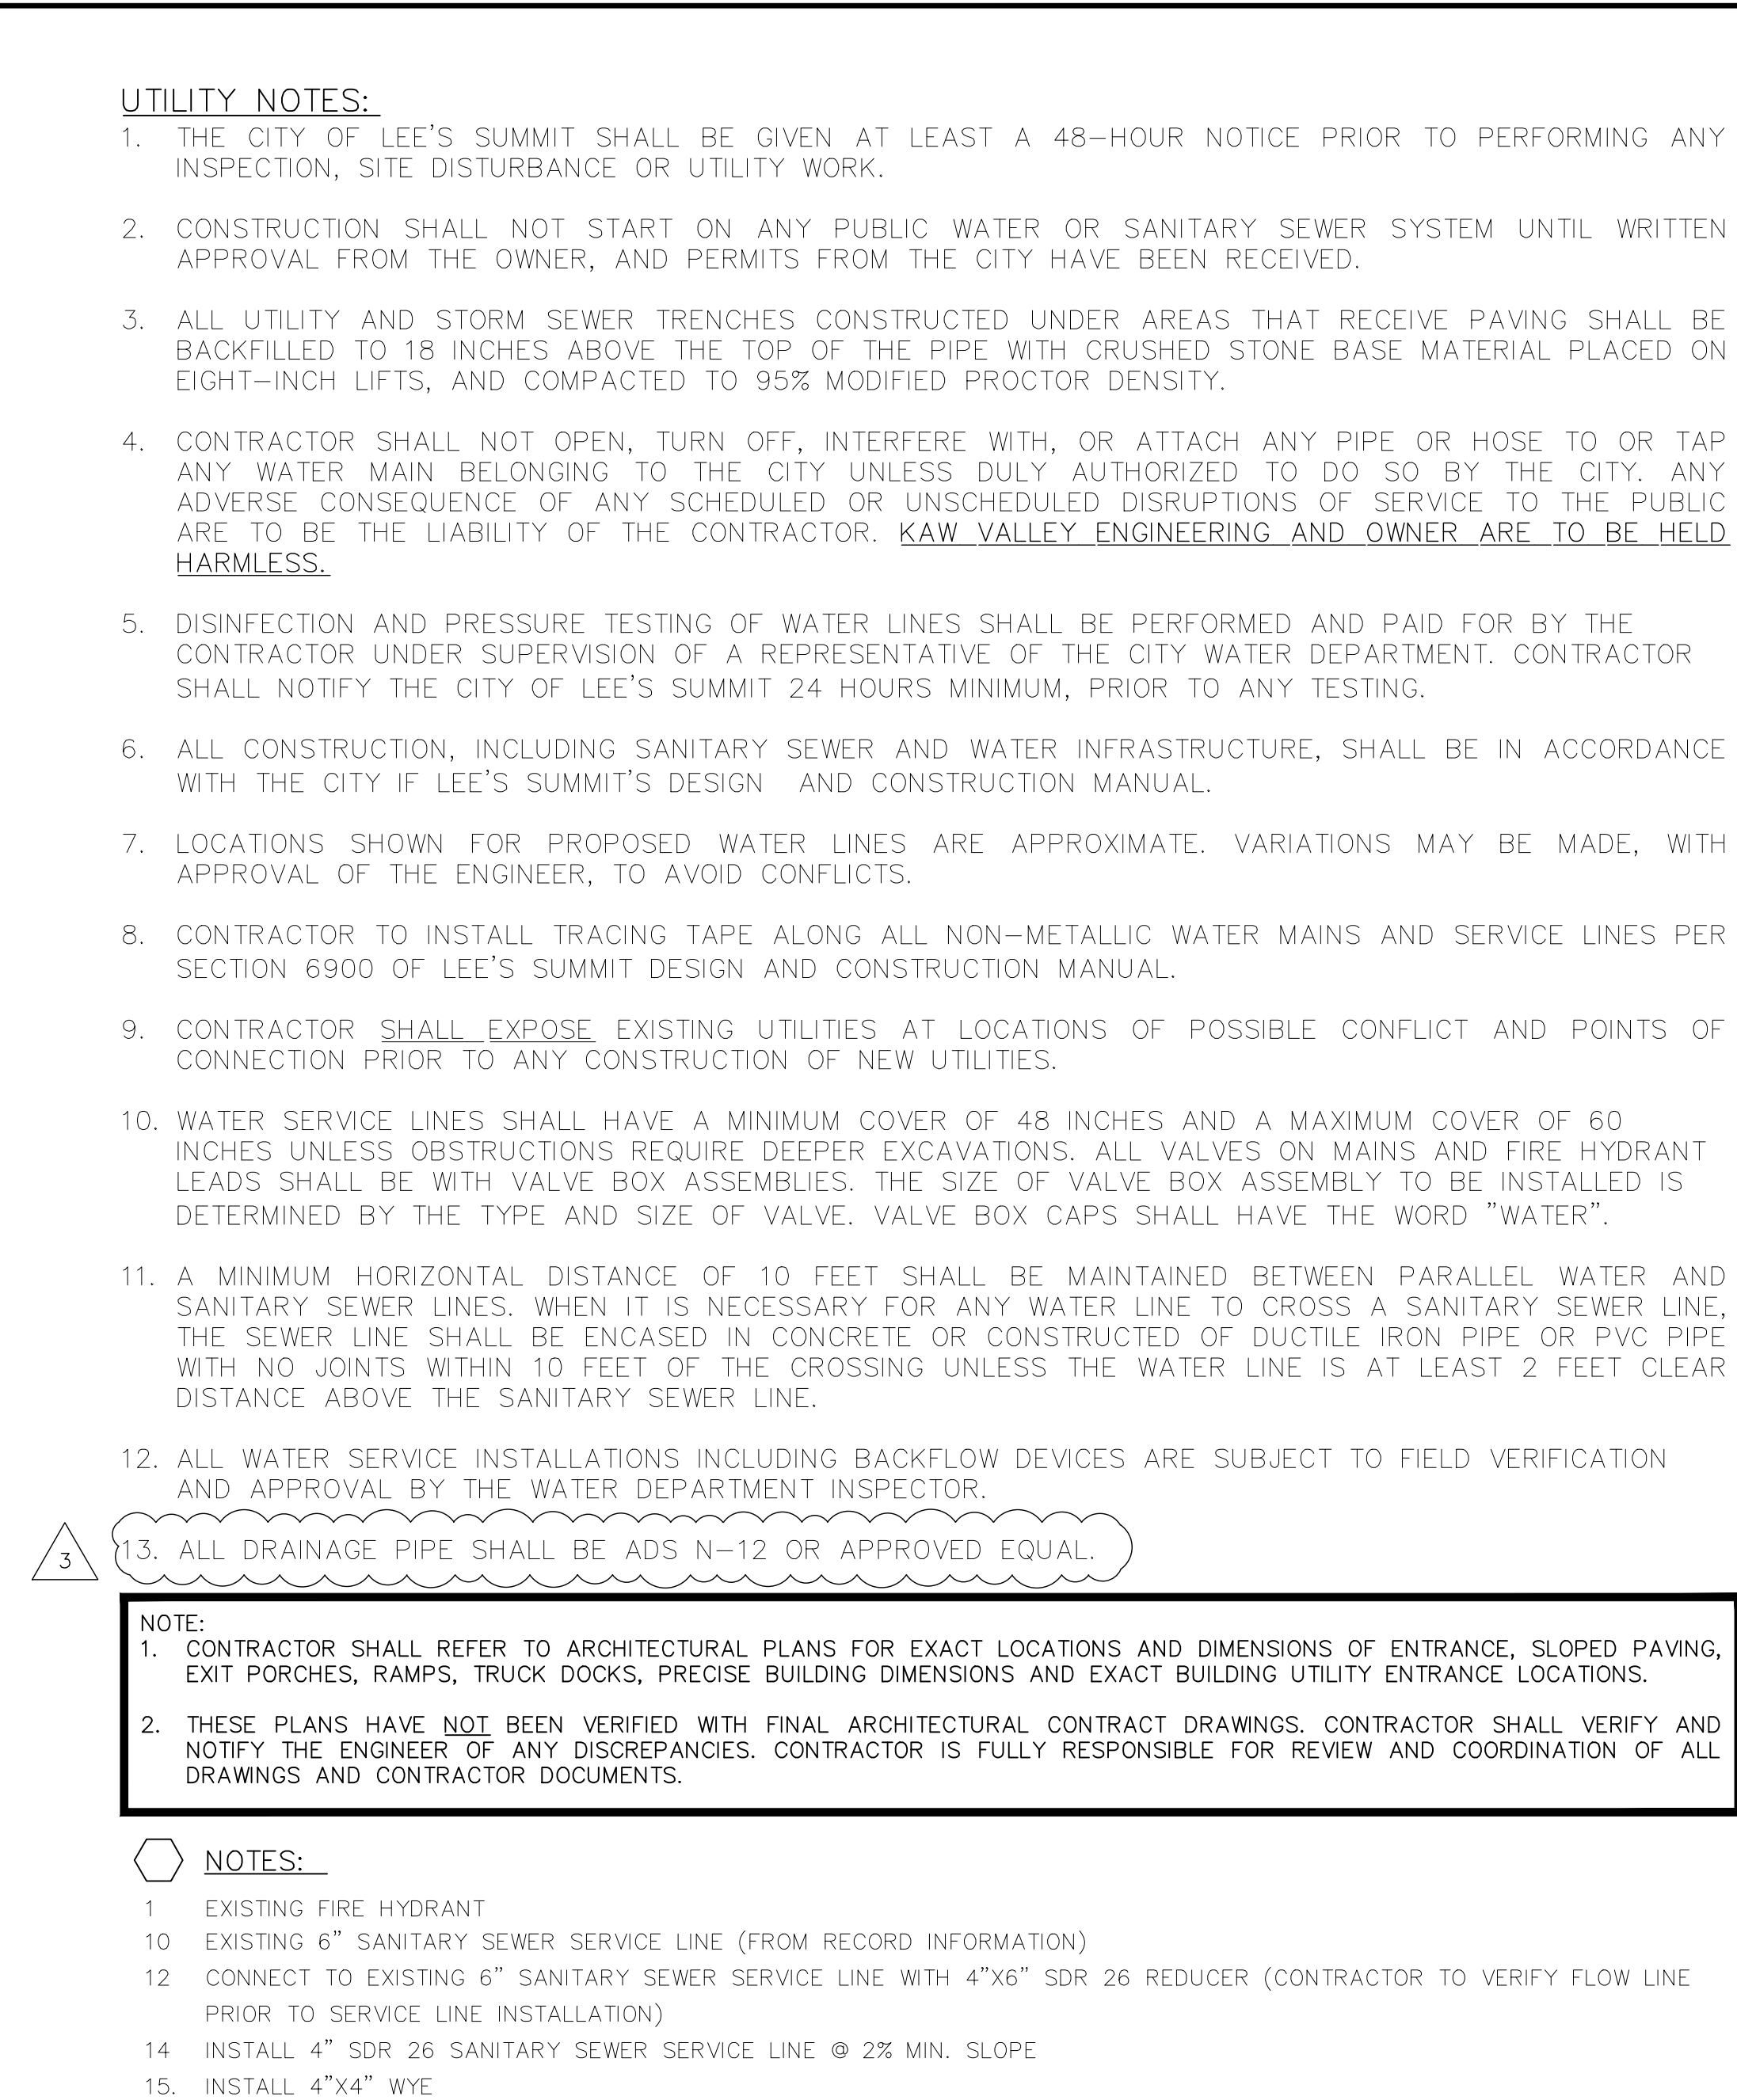

7 BREW 1410 N.E. DOUGLAS STREET LEE'S SUMMIT, MO. 64086		 <b>KAW VALLEY ENGINEERING</b>  KAW VALLEY ENGINEERING, INC., IS AUTHORIZED TO OFFER ENGINEERING SERVICES BY MISSOURI STATE CERTIFICATE OF AUTHORITY # 000842. EXPIRES 12/31/23		8040 N. OAK TRAFFICWAY KANSAS CITY, MO 64118 PH. (816) 468-5858   FAX (816) 468-6651 kce@kveeng.com   www.kveeng.com		<div><div><div>STATE OF MISSOURI</div><div>MARTIN T. ARLING</div><div>ENGINEER</div><div>NUMBER</div><div>PE-2009002955</div><div>06/27</div><div>PROFESSIONAL ENGINEER</div></div><div>MO # 2009002955</div></div>		<div><div>REV</div><div>DATE</div><div>DESCRIPTION</div></div> <div><div>3</div><div>06/22/22</div><div>PER CITY COMMENTS</div></div> <div><div>2</div><div>05/06/22</div><div>PER OWNER COMMENTS</div></div> <div><div>1</div><div>04/08/22</div><div>CHECK SET</div></div> <div><div>0</div><div>03/02/22</div><div>INITIAL ISSUE</div></div>		JNG J	
---	--	--	--	---	--	---	--	---	--	---	--





- PROPERTY LINE IS LIMITS OF CONSTRUCTION EXCEPT AS SHOWN.
2. THE CONTRACTOR SHALL INSTALL EROSION CONTROL MEASURES AS SHOWN ON THE DRAWINGS PRIOR TO BEGINNING EARTHWORK OPERATIONS AND DURING APPROPRIATE PHASING AS CONSTRUCTION PROGRESSES.
3. THE CONTRACTOR SHALL MAINTAIN ALL SILT CONTROL MEASURES DURING CONSTRUCTION. BUILDERS AND OR DEVELOPER TO MAINTAIN EROSION CONTROL AND SILT CONTROL UPON COMPLETION OF THIS PROJECT.
4. ALL SILT SHALL REMAIN ON SITE AND SURROUNDING STREETS SHALL BE KEPT CLEAR OF ALL MUD AND DEBRIS.
5. SEDIMENTATION BARRIERS ARE TO BE INSTALLED AS SHOWN AND AT ANY ADDITIONAL AREAS OF CONCENTRATED FLOWS NOT SHOWN ON PLANS.
6. ACCUMULATED SEDIMENT SHALL BE REMOVED AND THE SEDIMENTATION BARRIERS MAINTAINED AS NEEDED TO PREVENT SEDIMENTATION BYPASS OF THE BARRIER.
7. SLOPES ARE TO BE LEFT IN A ROUGH CONDITION DURING GRADING.
8. CURB INLET SEDIMENTATION BARRIERS ARE TO BE INSTALLED AROUND INLETS AND WEIRS WHERE SEDIMENTATION IS A CONCERN. INLET BARRIERS SHALL BE FILTERS, OR SILT FENCE, OR STRAW BALES (PRIOR TO PAVING PLACEMENT). AFTER PAVEMENT IS IN PLACE, PROVIDE FILTER PROTECTION THAT CANNOT BE WASHED INTO INLETS OR WASHED AWAY. STRAW/HAY BALES WILL NOT BE ALLOWED ON CONCRETE OR ASPHALT PAVING.
9. SEDIMENT IS TO BE REMOVED FROM STORM WATER DRAINAGE SYSTEMS. ALL SEDIMENT CONTROL MEASURES TO BE INSPECTED AND REPAIRED IMMEDIATELY AND ON A REGULAR BASIS AFTER ALL RAIN STORMS.
10. THE CONTRACTOR SHALL CONTACT THE CITY'S DEVELOPMENT SERVICES ENGINEERING INSPECTION TO SCHEDULE A PRE-CONSTRUCTION MEETING WITH AN INSPECTOR PRIOR TO ANY LAND DISTURBANCE WORK AT (816) 969-1200.
11. CONTRACTOR IS RESPONSIBLE FOR INSTALLING ANY ADDITIONAL EROSION CONTROL AS HE/SHE DEEMS NECESSARY TO PREVENT SEDIMENT FROM ENTERING STORM DRAINS, STREETS, AND WATERWAYS.
12. THE CONTRACTOR SHALL PROVIDE ALL MATERIALS, TOOLS, EQUIPMENT AND LABOR AS NECESSARY TO INSTALL AND MAINTAIN ADEQUATE EROSION AND SILTATION CONTROLS REQUIRED TO PREVENT SOIL EROSION FROM LEAVING THE PROJECT SITE. IT SHALL BE THE CONTRACTOR'S SOLE RESPONSIBILITY TO ENSURE THAT METHODS UTILIZED ARE ADEQUATE AND COMPLY WITH REQUIREMENTS OF THE SPECIFICATIONS AND GOVERNMENTAL AGENCIES HAVING JURISDICTION OVER THE WORK.
13. TEMPORARY SEDIMENT FENCE EROSION CONTROL MEASURES TO REMAIN UNTIL ADEQUATE VEGETATION IS ESTABLISHED. ON PROJECTS THAT ARE NOT EXPECTING IMMEDIATE DEVELOPMENT (I.E.- INTERCEPTOR SEWERS, OFFSITE IMPROVEMENTS, ETC.) EROSION CONTROL MEASURES ARE TO BE REMOVED BY CONTRACTOR AS SOON AS ADEQUATE VEGETATION IS ESTABLISHED.
14. MUD, SILT, AND DEBRIS SHALL BE CLEANED UP AT THE CONCLUSION OF EACH WORKING DAY, OR AFTER EACH RAINFALL.
15. INSPECTION, MAINTENANCE AND REPAIR OF EROSION CONTROL DEVICES SHALL BE ON GOING THROUGHOUT THE LIFE OF INFRASTRUCTURE AND BUILDING CONSTRUCTION TO KEEP THE DEVICES IN OPERABLE CONDITION AT ALL TIMES. ADDITIONAL MEASURES SHALL BE INSTALLED AS REQUIRED BY ACTUAL FIELD CONDITIONS AND/OR GOVERNING INSPECTION AGENCIES. NOTE: ALTHOUGH EXTENSIVE EFFORT IS PUT INTO THE DESIGN OF THE EROSION CONTROL PLAN BY THE ENGINEER, IT IS THE RESPONSIBILITY OF THE CONTRACTOR/DEVELOPER TO ENSURE THAT ANY ADDITIONAL REQUIRED EROSION CONTROL MEASURES ARE INSTALLED AND MAINTAINED AT NO ADDITIONAL COST TO THE OWNER.
16. INSTALL AND MAINTAIN CONSTRUCTION ENTRANCE(S) AT ANY POINT WHERE TRAFFIC WILL BE ENTERING OR LEAVING THE SITE AND AS SHOWN ON PLANS.
17. AT COMPLETION OF SITE GRADING AND OTHER RELATED CONSTRUCTION ACTIVITIES, ALL DISTURBED AREAS WITHIN THE PROJECT SITE SHALL BE SEEDDED, SODDED, OR LANDSCAPED. FLAT LOTS WILL NOT REQUIRE SEEDING BUT ALL SLOPES, DISTURBED AREAS AND STREET RIGHT-OF-WAYS WILL BE SEEDDED.
18. TOPSOIL IS TO BE PLACED IN AREAS UNSUITABLE FOR VEGETATIVE GROWTH.
19. STRIP TOPSOIL PRIOR TO EXCAVATION, STOCKPILE AND SPREAD ONTO DISKED SUBGRADE (4" MIN) A THICKNESS OF 4 INCHES.
20. THE CONTRACTOR SHALL HAVE THE RESPONSIBILITY FOR RESOLVING COMPLAINTS IN THE EVENT THAT COMPLAINTS OR DAMAGE CLAIMS ARE FILED DUE TO DAMAGES OCCURRING, ADJACENT TO OR DOWNSTREAM FROM PROPERTY, BY SEDIMENT RESULTING FROM EROSION ON THE PROJECT SITE.
21. GOOD HOUSEKEEPING PRACTICES SHALL BE MAINTAINED ON SITE TO KEEP SOLID WASTE FROM ENTRY INTO WATERS.
22. ALL FUELING FACILITIES PRESENT ON SITE SHALL ADHERE TO APPLICABLE FEDERAL AND STATE REQUIREMENTS CONCERNING UNDERGROUND STORAGE, ABOVE GROUND STORAGE AND DISPENSERS, INCLUDING SPILL PREVENTION, CONTROL AND COUNTER MEASURES.
23. MINIMAL WASHING OF CONCRETE EQUIPMENT ALLOWED (CHUTE, TOOLS, ETC.) AT A CONTRACTOR DEFINED LOCATION. CONCRETE WASHOUT OF THE DRUM IS NOT ALLOWED. ANY PIT/WASHOUT AREA NEEDS TO BE MAINTAINED IN A NON-DISCHARGING MANNER AND ANY WASTE RESIDUE WILL NEED TO BE CLEANED OUT AND REMOVED AT THE END OF PROJECT.
24. DEVELOPER IS RESPONSIBLE FOR HAVING LOT BUILDERS FOLLOW THE GUIDELINES OF "CONTROLLING EROSION WHEN BUILDING YOUR HOME" PROVIDED BY MISSOURI DEPARTMENT OF HEALTH AND ENVIRONMENT.
25. EROSION CONTROL STRAW/FIBER WATTLES TO BE INSTALLED 1'-0" BEHIND CURB & GUTTER UPON COMPLETION OF BACKFILL OF CURB IN ALL AREAS WHERE SLOPES FROM LOT DRAIN TOWARDS CURB. UPON COMPLETION OF FINAL GRADING THE TOES OF ALL EMBANKMENTS IN EXCESS OF TWO FEET IN HEIGHT WILL HAVE EROSION CONTROL SEDIMENT FENCE INSTALLED.
26. THE CITY OF LEE'S SUMMIT SHALL BE GIVEN AT LEAST A 48-HOUR NOTICE PRIOR TO PERFORMING ANY INSPECTION, SITE DISTURBANCE OR UTILITY WORK.

TO PROVIDE PROMPT EROSION CONTROL N PROJECT TEMPORARY SEEDING MAY BE REQUIRED WHICH WILL DEPEND ON THE CONTRACTORS WORK SCHEDULE. TEMPORARY SEEDING WILL BE REQUIRED IN THE FOLLOWING AREAS:

1. IN SLOPES AND AREAS OF CONCENTRATED FLOW WITHIN 28 DAYS OF ROUGH GRADING.
2. IN AREAS THAT REQUIRE SEEDING BUT IS NOT WITHIN THE SEASON FOR PERMANENT SEEDING AS PER THE TECHNICAL SPECIFICATIONS.

PLANT SELECTION - ANNUAL RYE GRASS, WHEAT OR OATS FOR TEMPORARY SEEDING

SEEDING - EVENLY APPLY SEED USING A CYCLONE SEEDER (BROADCAST), DRILL, CULTPACKER SEEDER OR HYDROSEEDER. ANNUAL RYE GRASS SHOULD BE APPLIED AT A RATE OF 120 LBS/ACRE, WHEAT OR OATS SHOULD BE APPLIED AT A RATE OF 100 LBS/ACRE. BROADCAST SEEDING AND HYDROSEEDING ARE APPROPRIATE FOR STEEP SLOPES WHERE EQUIPMENT CANNOT BE DRIVEN. HAND BROADCASTING IS NOT RECOMMENDED BECAUSE OF THE DIFFICULTY IN ACHIEVING A UNIFORM DISTRIBUTION. SMALL GRAINS SHOULD BE PLANTED NO MORE THAN 1 INCH DEEP, AND GRASSES AND LEGUMES NO MORE THAN 1/2 INCH. BROADCAST SEED MUST BE COVERED BY RAKING OR CHAIN DRAGGING, AND THEN LIGHTLY FIRMED WITH A ROLLER OR CULTPACKER. HYDROSEEDED MIXTURES SHOULD INCLUDE A WOOD FIBER (CELLULOSE) MULCH.

MULCHING - THE USE OF MULCH WILL HELP ENSURE ESTABLISHMENT UNDER NORMAL CONDITIONS AND IS ESSENTIAL TO SEEDING SUCCESS UNDER HARSH CONDITIONS SUCH AS SEEDING IN FALL OR WINTER COVER (WOOD FIBER MULCHES ARE NOT CONSIDERED ADEQUATE FOR THIS USE). SLOPES STEEPER THAN 3:1, EXCESSIVELY HOT OR DRY WEATHER, ADVERSE SOILS (SHALLOW, ROCKY, HIGH IN CLAY OR SAND), AND AREAS RECEIVING CONCENTRATED FLOW. IF AREAS TO BE MULCHED IS SUBJECT TO CONCENTRATED WATERFLOW, AS IN CHANNELS, ANCHOR MULCH WITH NETTING.

MAINTENANCE - RESEED, REFERTILIZE AND MULCH AREAS OF INSUFFICIENT GROWTH. RESEED, REFERTILIZE AND MULCH IMMEDIATELY FOLLOWING EROSION OR OTHER DAMAGE.

SEE LANDSCAPE PLAN FOR PERMANENT SEEDING REQUIREMENTS.

IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES, THE CONTRACTOR WILL BE SOLELY AND COMPLETELY RESPONSIBLE FOR CONDITIONS OF THE JOB SITE, INCLUDING SAFETY OF ALL PERSONS AND PROPERTY DURING PERFORMANCE OF THE WORK. THIS REQUIREMENT WILL APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS.

THE DESIGNS REPRESENTED IN THESE PINS ARE IN ACCORDANCE WITH ESTABLISHED PRACTICES OF CIVIL ENGINEERING FOR THE DESIGN FUNCTIONS AND USES INTENDED BY THE OWNER AT THIS TIME. HOWEVER, NEITHER KAW VALLEY ENGINEERING, INC NOR ITS PERSONNEL CAN OR DO WARRANTY THESE DESIGNS OR PLANS AS CONSTRUCTED, EXCEPT IN THE SPECIFIC CASES WHERE KAW VALLEY ENGINEERING PERSONNEL INSPECT AND CONTROL THE PHYSICAL CONSTRUCTION ON A CONTEMPORARY BASIS AT THE SITE.

THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE LOCATION AND/OR ELEVATION OF EXISTING UTILITIES AS SHOWN ON THESE PLANS IS BASED ON RECORDS OF THE VARIOUS UTILITY COMPANIES AND, WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. THE INFORMATION IS NOT TO BE RELIED ON AS BEING EXACT OR COMPLETE. THE CONTRACTOR MUST CALL THE APPROPRIATE UTILITY COMPANY AT LEAST 48 HOURS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATION OF UTILITIES. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES WHICH CONFLICT WITH PROPOSED IMPROVEMENTS SHOWN ON THE PLANS.



**THE CONTRACTOR SHALL EXPOSE EXISTING UTILITIES AT LOCATIONS OF POSSIBLE CONFLICTS PRIOR TO ANY CONSTRUCTION.**

**7 BREW**  
1410 N.E. DOUGLAS STREET  
LEE'S SUMMIT, MO. 64086


---

**FINAL DEVELOPMENT PLAN**  
**EROSION CONTROL PLAN**




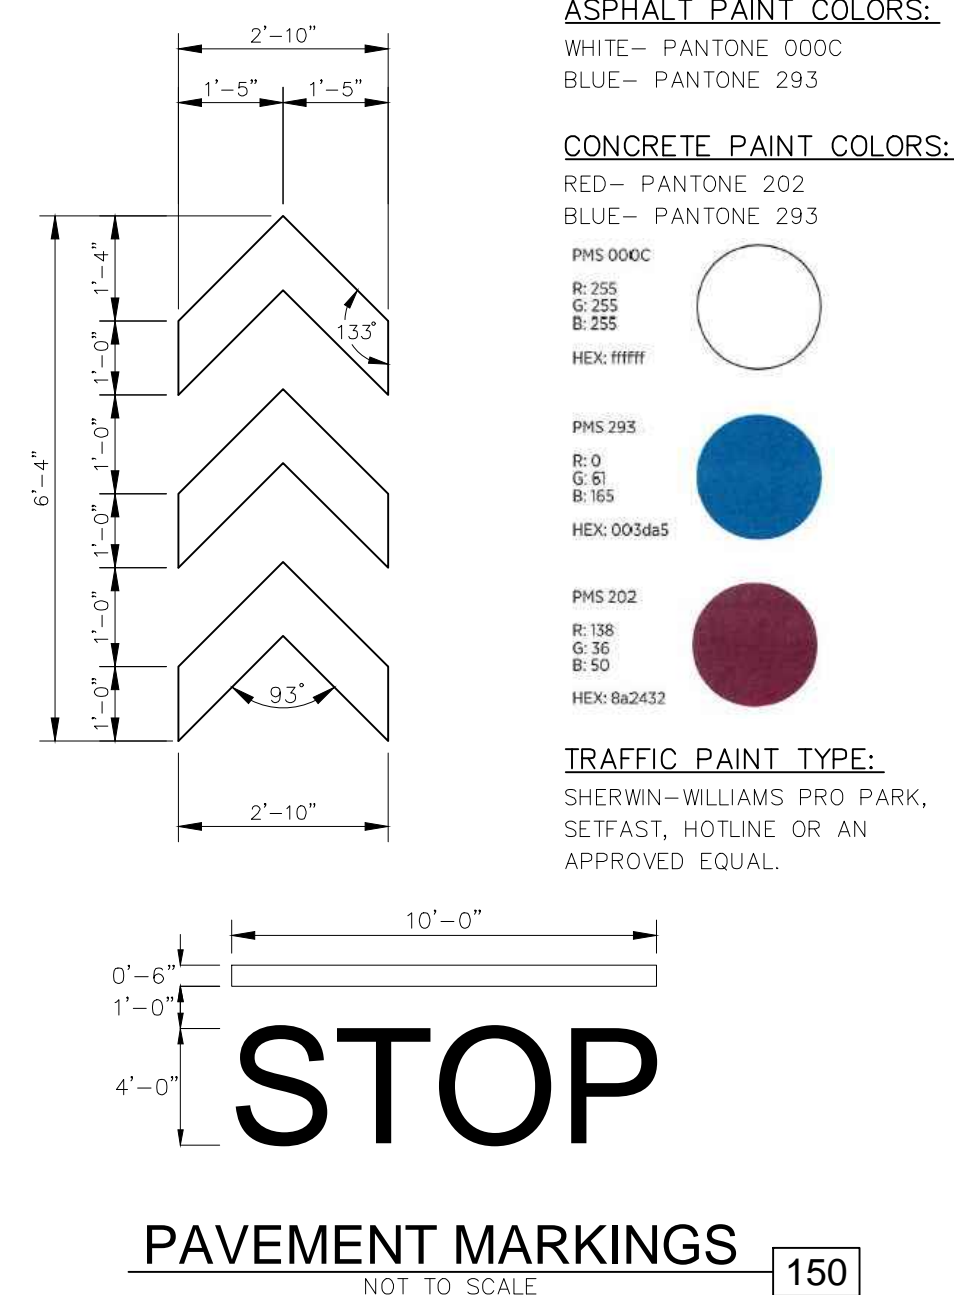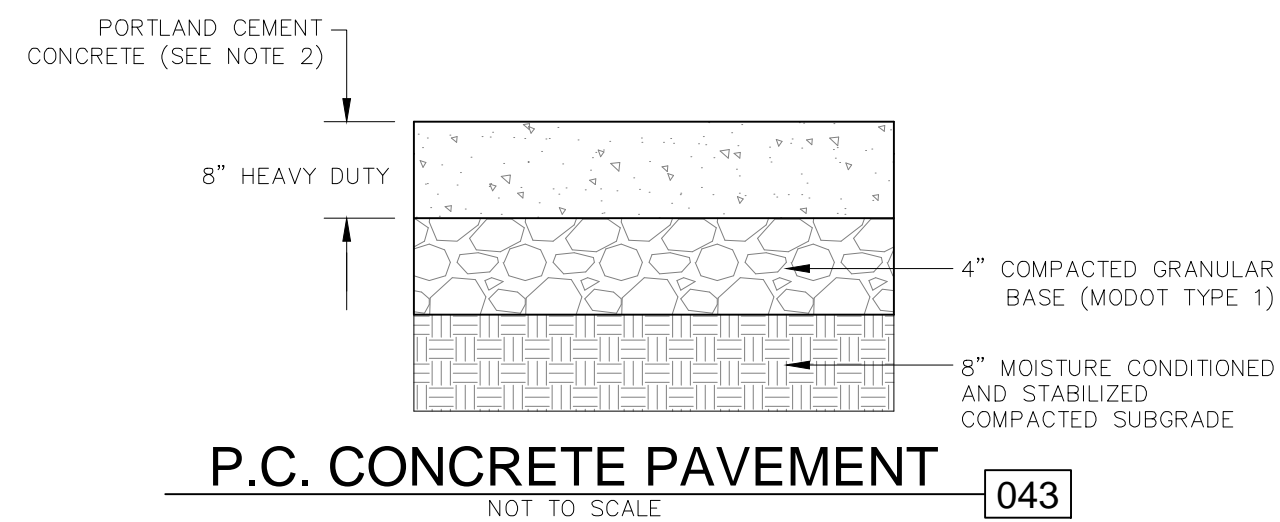

5. IF A MARSHALL DESIGNED MIX IS DESIRED, ANY 50-BLOW MARSHALL MIX MAY BE SELECTED MEETING THE AGGREGATE AND GRADATION REQUIREMENTS OF APWA TYPE 2 OR 3, MODOT BP-1 OR 2, OR OTHER LOCALLY PRODUCED MARSHALL MIX THAT IS EQUIVALENT TO KDOT BM-2. ANY SUBMITTED 50-BLOW MARSHALL MIX DESIGN SHOULD ALSO BE CHECKED FOR RESISTANCE TO STRIPPING DURING DESIGN USING AASHTO T 283 TO DETERMINE IF AN ANTISTRIPPING AGENT IS NEEDED FOR THE SAME ASPHALT CONCRETE CHOSEN FOR THE PROJECT. THE INDEX OF RETAINED STRENGTH SHALL EXCEED 75%.

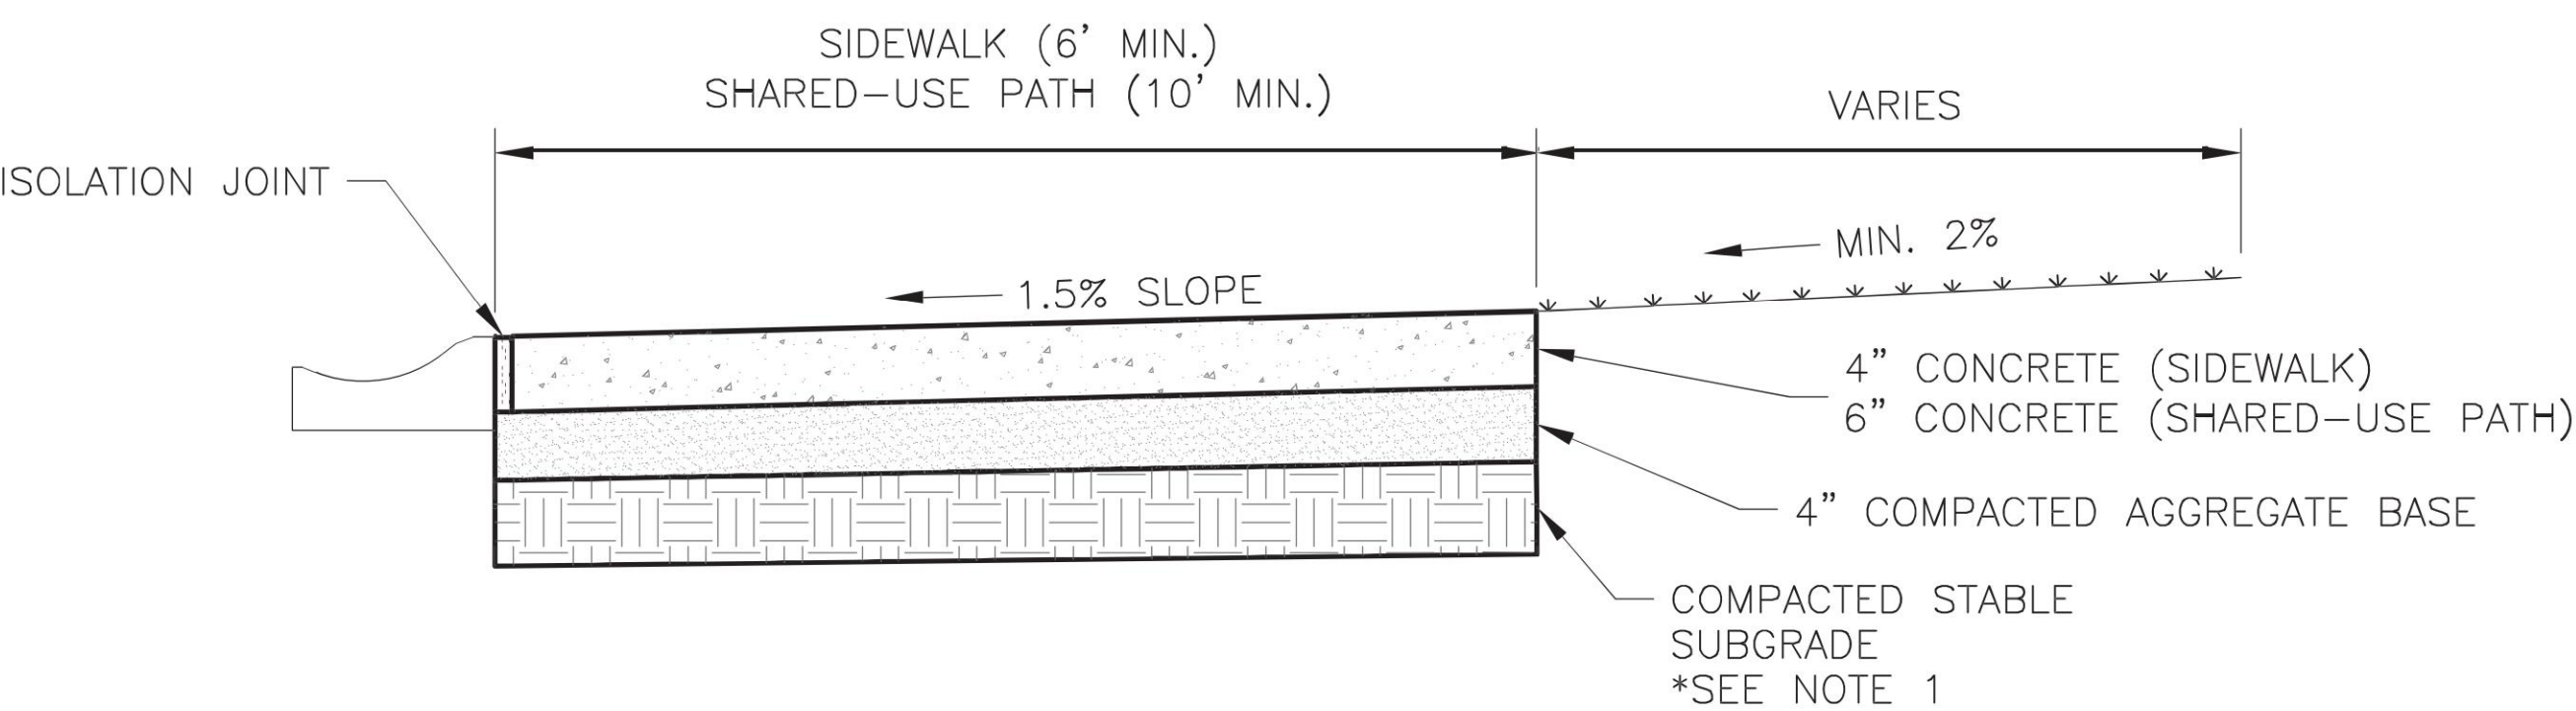


SIDEWALK/SHARED-USE PATH WITHOUT BUFFER  
NOT TO SCALE

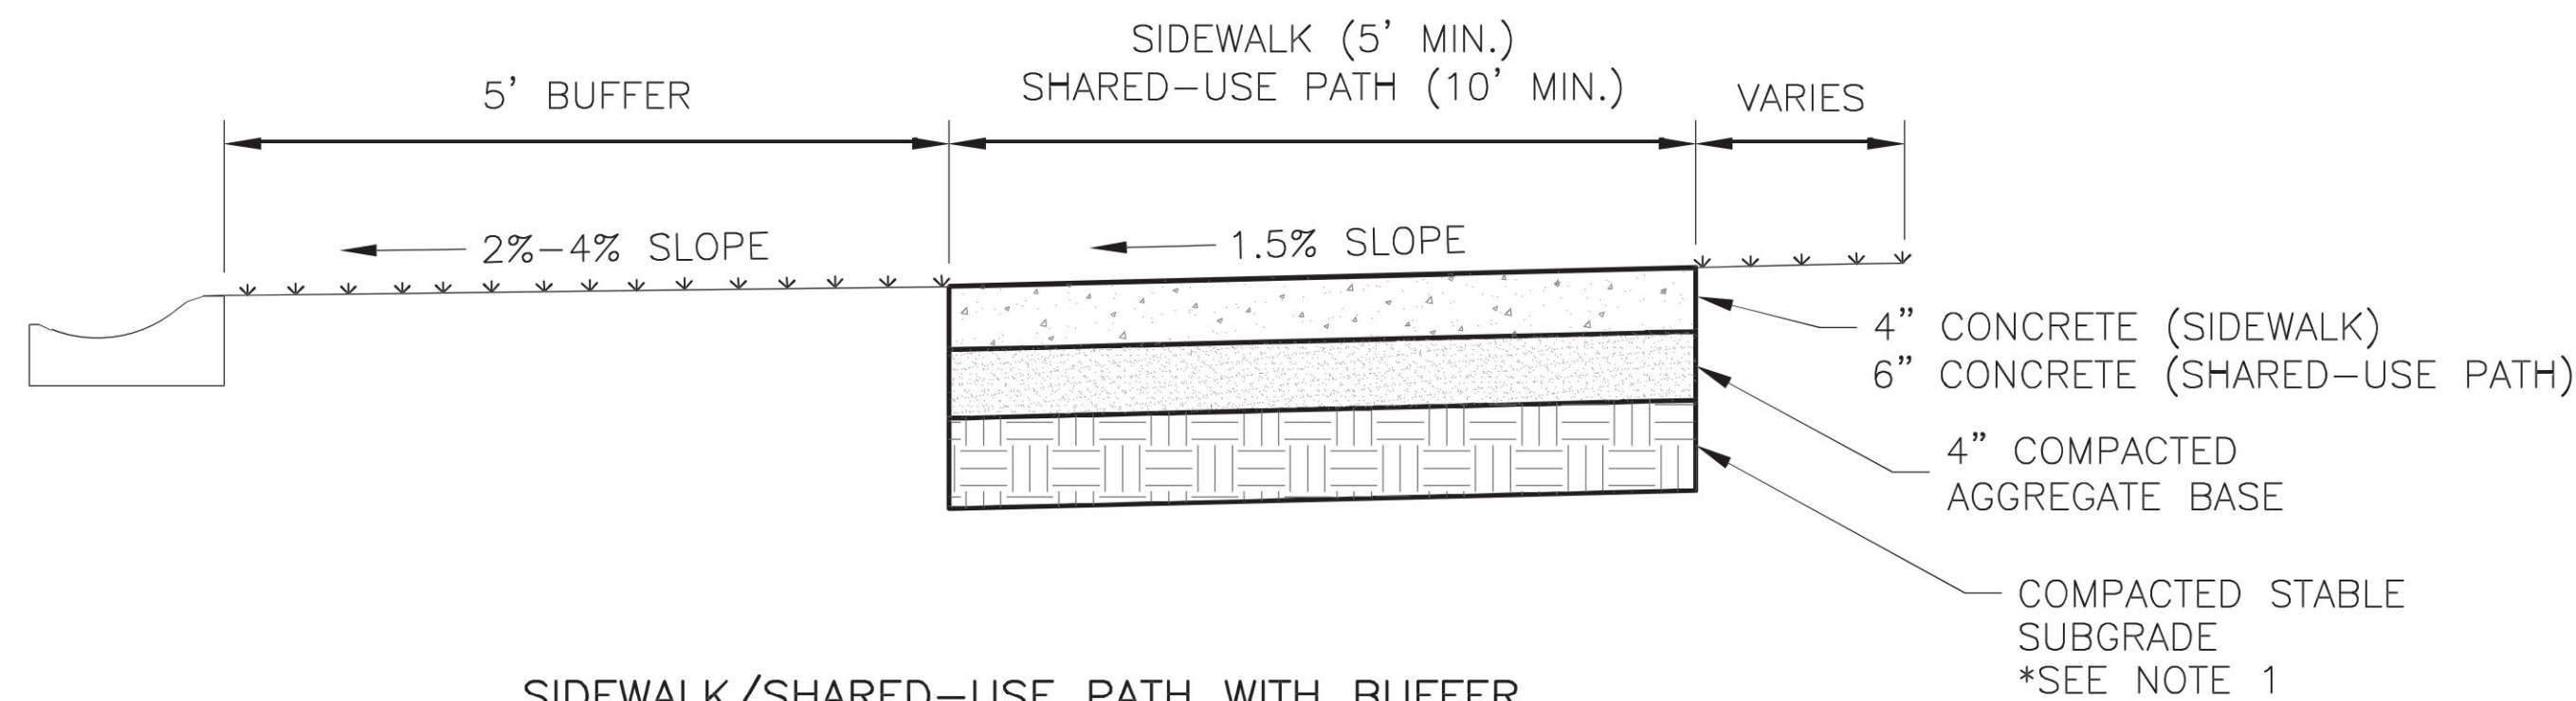

SIDEWALK/SHARED-USE PATH WITH BUFFER  
NOT TO SCALE

CONCRETE SIDEWALK  
NOT TO SCALE

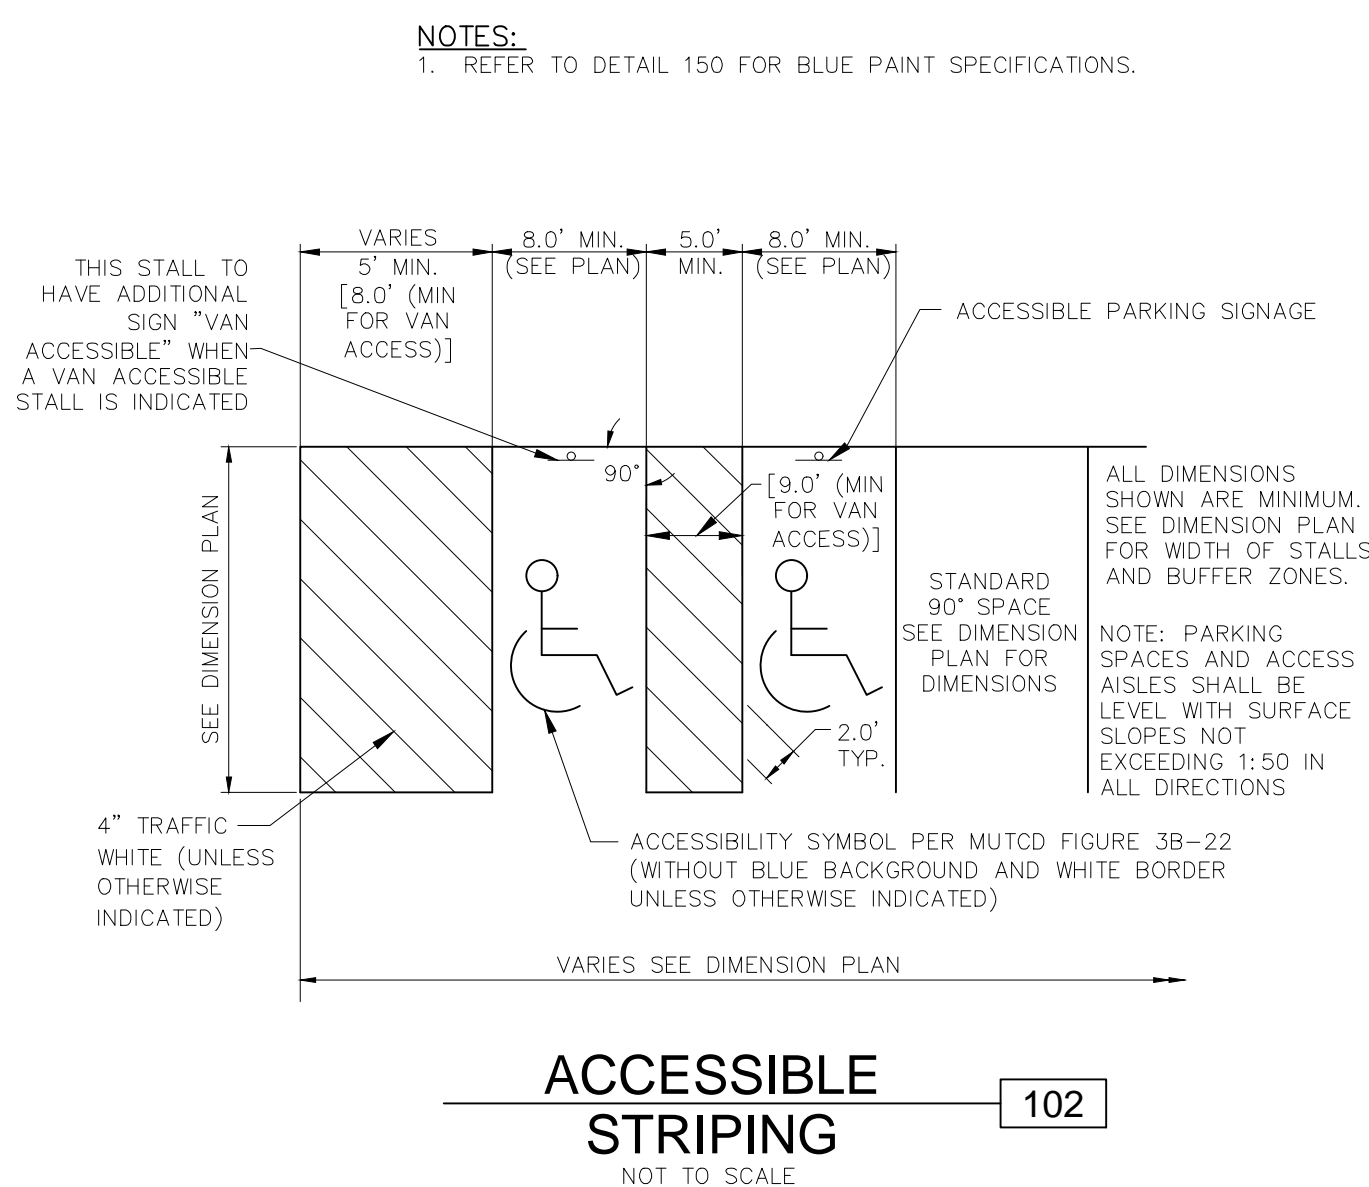

3. ADA PARKING SPACES AND ACCESS ISLES SHALL BE LEVEL WITH SURFACE SLOPES NOT EXCEEDING 1:50 IN ALL DIRECTIONS.



# LEE'S SUMMIT


## MISSOURI

PUBLIC WORKS ENGINEERING DIVISION | 220 SE GREEN STREET | LEE'S SUMMIT, MO 64063

## SIDEWALK/SHARED-USE PATH DETAIL


Checked By: DL

## GEN-2

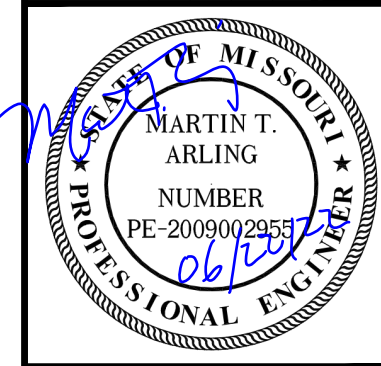[illegible]

MARTIN T. ARLING  
ENGINEER  
MO # 2009002955

8040 N. OAK TRAFFICWAY  
KANSAS CITY, MISSOURI 64118  
PH. (816) 468-5558 | FAX (816) 468-6651  
kc@kveeng.com | www.kveeng.com



KAW VALLEY ENGINEERING, INC., IS AUTHORIZED TO OFFER ENGINEERING SERVICES BY MISSOURI STATE CERTIFICATE OF AUTHORITY # 000842.

**7 BREW  
1410 N.E. DOUGLAS STREET  
LEE'S SUMMIT, MO. 64086**

**FINAL DEVELOPMENT PLAN  
DETAIL SHEET**

PROJ. NO.		B21D4397	
DESIGNER		DRAWN BY	
MTA		JNG	
CFN			
4397DET			
SHEET		REV	
C700		3	










THIS DRAWING SHALL NOT BE UTILIZED BY ANY PERSON, FIRM, OR CORPORATION IN WHOLE OR IN PART WITHOUT THE SPECIFIC PERMISSION OF KAW VALLEY ENGINEERING, INC.








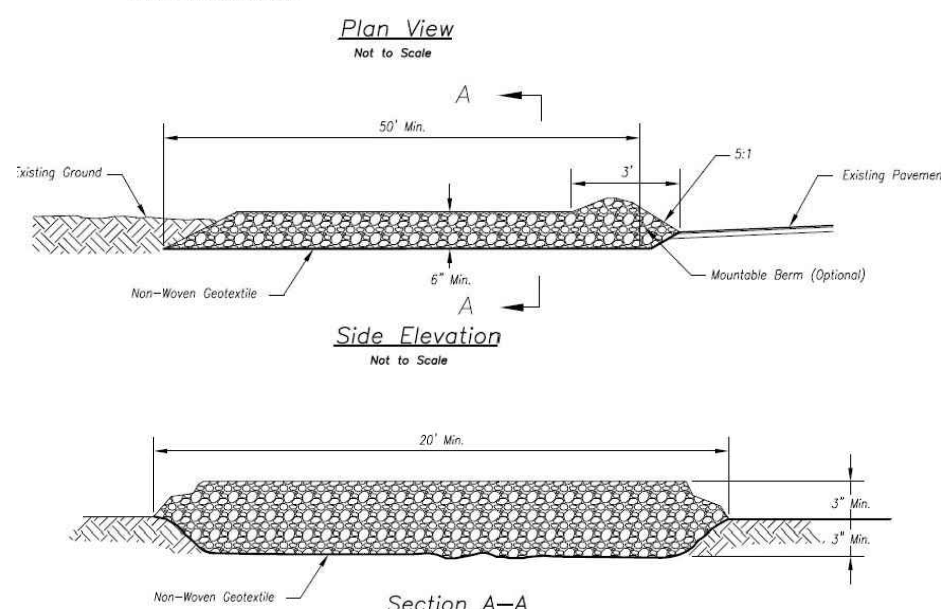


1. CONCRETE WASHOUT AREAS SHALL BE INSTALLED PRIOR TO ANY CONCRETE PLACEMENT ON SITE.
2. CONCRETE WASHOUT AREA SHALL INCLUDE A FLAT SUBSURFACE PIT SIZED RELATIVE TO THE AMOUNT OF CONCRETE TO BE PLACED ON SITE, THE SLOPES LEADING OUT OF THE SUBSURFACE PIT SHALL BE 3:1. THE VEHICLE TRACKING PAD SHALL BE SLOPED TOWARDS THE CONCRETE WASHOUT AREA.
3. VEHICLE TRACKING CONTROL IS REQUIRED AT THE ACCESS POINT TO ALL CONCRETE WASHOUT AREAS.
4. SIGNS SHALL BE PLACED AT THE CONSTRUCTION SITE ENTRANCE, WASHOUT AREA AND ELSEWHERE AS NECESSARY TO CLEARLY INDICATE THE LOCATION(S) OF THE CONCRETE WASHOUT AREAS OF THE PROJECT. CONCRETE WASHOUT AREAS SHALL BE MARKED BY A ONE-PIECE IMPERVIOUS LINER MAY BE REQUIRED ALONG THE BOTTOM AND SIDES OF THE SUBSURFACE PIT IN SANDY OR GRAVELLY SOILS.
- 5.


1. CONCRETE WASHOUT MATERIALS SHALL BE REMOVED ONCE THE MATERIALS HAVE FILLED THE EXCAVATION.
2. CONCRETE WASHOUT AREAS SHALL BE ENLARGED AS NECESSARY TO MAINTAIN CAPACITY FOR WASTED CONCRETE.
3. EXCESS CONCRETE AND WATER, WASTED PIECES OF CONCRETE AND ALL OTHER DEBRIS IN THE SUSTAINED PIT SHALL BE TRANSPORTED FROM THE JOB SITE IN A WATER-TIGHT CONTAINER AND TO AN APPROPRIATE DISPOSAL SITE.
4. CONCRETE WASHOUT AREAS SHALL REMAIN IN PLACE UNTIL ALL CONCRETE FOR THE PROJECT IS PLACED.
5. CONCRETE WASHOUT AREAS ARE REMOVED, EXCAVATIONS SHALL BE FILLED WITH SUITABLE COMPACTED BACKFILL AND TOPSOIL, ANY DISTURBED AREAS ASSOCIATED WITH THE EXCAVATION, MAINTENANCE, AND/OR REMOVAL OF THE CONCRETE WASHOUT AREAS SHALL BE STABILIZED.

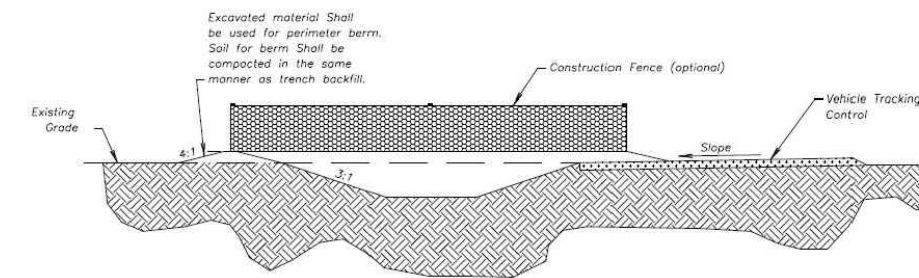

<b>AMERICAN PUBLIC WORKS ASSOCIATION</b> <small>Kansas City Metro Chapter</small>  <small>AMERICAN PUBLIC WORKS ASSOCIATION</small>		<b>KANSAS CITY METRO CHAPTER</b>
<b>CONSTRUCTION ENTRANCE AND CONCRETE WASHOUT</b>		<b>STANDARD DRAWING NUMBER ESC-01</b> <b>ADOPTED:</b> 10/24/2016

2. AVOID LOCATING ON STEEP SLOPES, AT CURVES ON PUBLIC ROADS, OR DOWNHILL OF DISTURBED AREA.
3. REMOVE ALL VEGETATION AND OTHER UNSUITABLE MATERIAL FROM THE FOUNDATION AREA, GRADE, AND CROWN FOR POSITIVE DRAINAGE.
4. IF SLOPE LOWER THAN THE PUBLIC ROAD EXCEEDS 2% CONSTRUCT A 6- TO 8-INCH HIGH RIDGE WITH 3%:1 VERT SLOPES ACROSS THE FOUNDATION APPROXIMATELY 15 FEET FROM THE EDGE OF THE PUBLIC ROAD TO DIRECT RUNOFF FROM IT.
5. INSTALL PIPE UNDER THE ENTRANCE IF NEEDED TO MAINTAIN KILNS LEAVE DITCHES ALONG PUBLIC ROADS.
6. SLOPE STEPS TO DIMENSIONS AND GRADE AS SHOWN. GRADE SURFACE SLOPED FOR DRAINAGE.
7. DIVERT ALL SURFACE RUNOFF AND DRAINAGE FROM THE ENTRANCE TO SEDIMENT CONTROL DEVICE.
8. IF CONDITIONS WARRANT, PLACE GEOTEXTILE FABRIC ON THE GRADED FOUNDATION TO IMPROVE STABILITY.


1. RESHAPE ENTRANCE AS NEEDED TO MAINTAIN FUNCTION AND INTEGRITY OF INSTALLATION. TOP DRESS WITH CLEAN AGGREGATE AS NEEDED.




### SILT FENCE DETAILS




SILT FENCE LAYOUT  
Not to Scale

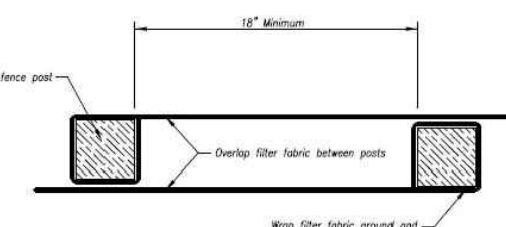


### JOINING FENCE SECTION

<b>AMERICAN PUBLIC WORKS ASSOCIATION</b> <small>Keeping City Streets Clean</small> 		KANSAS CITY METRO CHAPTER
SILT FENCE		STANDARD DRAWING NUMBER ESC-03 ADOPTED: 10/24/2016

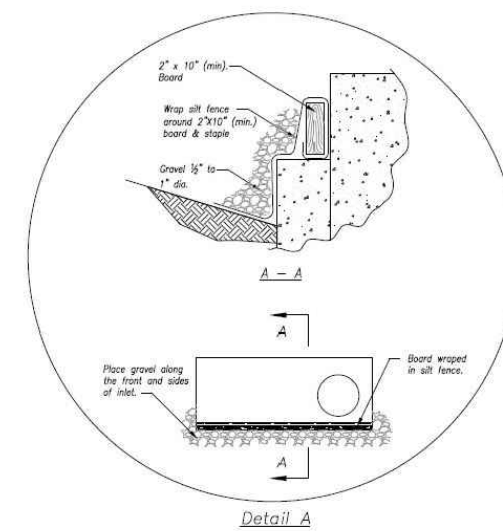


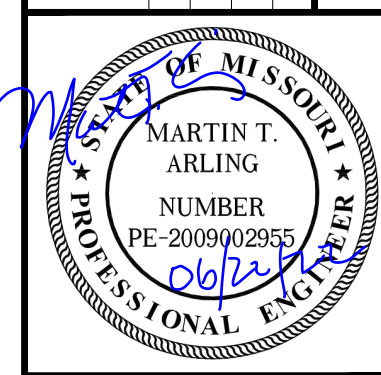
EARLY STAGE CURB INLET  
(Open Box and Prior to Pouring  
Curb and Inlet Throat)

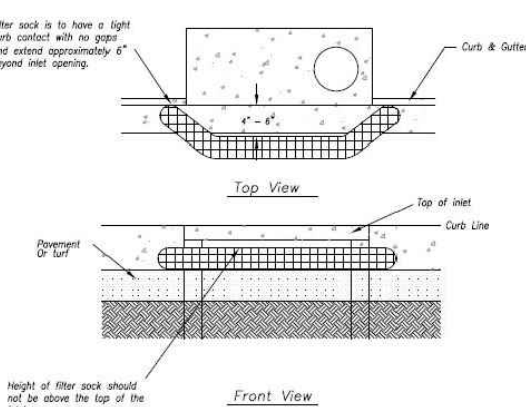

Sump Inlet Sediment Filter

LATE STAGE CURB INLET  
(After Pouring Curb and Inlet Throat)

<b>AMERICAN PUBLIC WORKS ASSOCIATION</b> 		<b>KANSAS CITY METRO CHAPTER</b>
<b>CURB INLET PROTECTION</b>		<b>STANDARD DRAWING NUMBER FSC-06 ADOPTED</b> 10/24/2006

[illegible]

MARTIN T. ARLING  
ENGINEER  
MO # 2009002955

**KAW VALLEY ENGINEERING**  
KAW VALLEY ENGINEERING, INC. IS AUTHORIZED TO OFFER ENGINEERING SERVICES BY MISSOURI STATE CERTIFICATE OF AUTHORITY # 000842.

**7 BREW**  
1410 N.E. DOUGLAS STREET  
LEE'S SUMMIT, MO. 64086

**FINAL DEVELOPMENT PLAN  
DETAIL SHEET**

PROJ. NO.		B21D4397	
DESIGNER		DRAWN BY	
MTA		JNG	
CFN			
4397DET			
SHEET		REV	
C704		3	








LOADING TABLE AND CODE INFORMATION			
BUILDING CODE 2018 IBC			
1. DEAD LOADS			
A. ROOF DEAD LOAD		20	PSF
B. TYPICAL ATTIC / FLOOR DEAD LOAD		50	PSF
2. COLLATERAL LOADS (NON-REDUCIBLE)			
A. ROOF COLLATERAL LOAD		10	PSF
3. LIVE LOADS			
A. ROOF LIVE LOAD (W/ TRIBUTARY REDUCTION)		20	PSF
B. TYPICAL FLOOR LIVE LOAD		40	PSF
C. STAIRS AND CORRIDORS FLOOR LIVE LOAD		100	PSF
4. SNOW LOAD			
A. GROUND SNOW LOAD, P <sub>g</sub>		20	PSF
B. FLAT ROOF SNOW LOAD, P <sub>f</sub>		20	PSF
C. SNOW EXPOSURE FACTOR, C <sub>e</sub>		1.0	
D. SNOW LOAD IMPORTANCE FACTOR		1.0	
E. THERMAL FACTOR, C <sub>t</sub>		1.0	
F. SNOW DRIFT		PER CODE	
5. WIND LOAD			
A. ULTIMATE WIND SPEED, V <sub>ult</sub>		109	MPH
B. RISK CATEGORY			
C. WIND IMPORTANCE FACTOR		1.0	
D. WIND EXPOSURE CATEGORY		C	
E. INTERNAL PRESSURE COEFFICIENT		±0.18	
6. SEISMIC DESIGN CRITERIA			
A. RISK CATEGORY		II	
B. SEISMIC IMPORTANCE FACTOR, I <sub>e</sub>		1.0	
C. SPECTRAL RESPONSE ACCELERATIONS AND COEFFICIENTS			
i. S <sub>s</sub>		0.100	
ii. S <sub>1</sub>		0.068	
S <sub>ds</sub>		0.106	
iv. S <sub>d1</sub>		0.109	
D. SITE CLASS			
		D	
E. SEISMIC DESIGN CATEGORY		B	
F. BASIS SEISMIC FORCE-RESISTING SYSTEM		LFWS	ELB
G. ANALYSIS PROCEDURE		FSF	
H. RESPONSE MODIFICATION COEFFICIENT, R		4	
I. SYSTEM OVERSTRENGTH FACTOR,		3	
J. DEFLECTION AMPLIFICATION FACTOR, C <sub>d</sub>		4	

### COLD-FORMED STEEL NOTES

#### PRODUCT IDENTIFICATION

THE AMERICAN IRON AND STEEL INSTITUTE STANDARDS ARE USED IN THIS PACKAGE. ANY MANUFACTURER WHOSE PRODUCT GEOMETRIES MEETS OR EXCEED AISI STANDARDS ARE ACCEPTABLE.

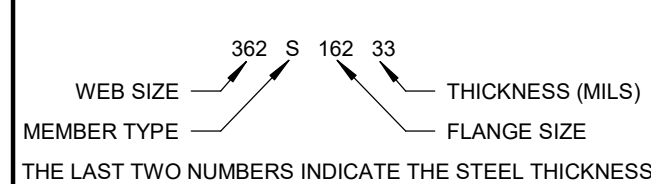

- COLD-FORMED STEEL FABRICATION AND INSTALLATION SHALL BE IN ACCORDANCE WITH AISI "STANDARD FOR COLD-FORMED STEEL FRAMING - GENERAL PROVISIONS".
- WELDING OF COLD-FORMED STEEL SHALL BE IN ACCORDANCE WITH THE STANDARD CODE OF ARC AND GAS WELDING IN BUILDING CONSTRUCTION. AXIALLY LOADED STUDS SHALL BE POSITIONED DIRECTLY UNDER JOIST BEARING POINTS WHENEVER POSSIBLE.
- STUDS SHALL NOT BE SPLICED.
- PROVIDE MANUFACTURER'S STANDARD BRIDGING AS NOTED ON STUD TABLES (4 MAX U.N.O.).
- PROVIDE DOUBLE STUDS, MINIMUM AT ALL PARTITION ENDS, EACH SIDE OF OPENINGS, AND WHERE INDICATED ON DRAWINGS.
- PROVIDE DEFLECTION TRACK OR CLIPS AT HEADS OF ALL NON LOAD-BEARING WALLS.
- MINIMUM TRACK SIZE SHALL MATCH STUD SIZE U.N.O.
- SEE STANDARD LIGHT GAGE DETAILS AND STUD CHARTS FOR ADDITIONAL INFORMATION.
- ALIGN WEB PUNCHOUTS IN STUD WALLS. WEB PUNCHOUTS MUST BE LOCATED A MINIMUM OF 10" AWAY FROM THE STUD END.
- MINIMUM YIELD STRENGTH FOR 18 AND 20 GA COLD-FORMED MEMBERS SHALL BE 33 KSI. MINIMUM YIELD STRENGTH FOR 16 GA AND HEAVIER COLD-FORMED MEMBERS SHALL BE 50 KSI.
- HEADERS AND BULKHEADS SHALL BE FORMED FROM UNPUNCHED MEMBERS.
- STUDS SHALL NOT BE NOTCHED, SPLICED, OR COPED WITHOUT WRITTEN APPROVAL OF ENGINEER.
- CUTTING OF STUDS SHALL BE DONE BY SAWING, SHEARING, OR PLASMA CUTTING. OTHER METHODS OF CUTTING ARE NOT PERMITTED WITHOUT APPROVAL OF ENGINEER.
- SEE SPECIFICATIONS FOR ADDITIONAL STRUCTURAL COLD-FORMED FRAMING REQUIREMENTS. SEE SPECIFICATION SECTION 0526 FOR ADDITIONAL REQUIREMENTS FOR COLD-FORMED DRYWALL COMPONENTS. ALL MATERIALS AND WORK SHALL CONFORM TO THE CODE LISTED IN THESE DRAWINGS. THESE NOTES GIVE MINIMUM REQUIREMENTS. WHERE CONFLICTS ARISE BETWEEN THE CODE, THE DRAWINGS, AND THE STRUCTURAL NOTES, THE MORE STRINGENT REQUIREMENT SHALL CONTROL.

#### ADDITIONAL COLD-FORMED STEEL NOTES

- CONTRACTOR SHALL PROVIDE LIGHT GAGE FRAMING SHOP DRAWING SUBMITTAL. SUBMITTAL SHALL INCLUDE LIGHT GAGE FRAMING PLANS, DETAILS, SECTIONS AND ACCESSORIES.
- LIMIT STUD/HEADER DEFLECTIONS TO L/800 FOR MEMBERS SUPPORTING BRICK VENEER AND L/360 FOR ALL OTHERS.
- SUBMITTAL SHALL INCLUDE INTERIOR AND EXTERIOR STUDS AND CEILING/SOFT MEMBERS.
- COORD DEFLECTION TRACK AT NON-LOADING BEARING WALLS AND FIRE-RATING REQUIREMENTS W/ ARCH. TRACK (OR CLIPS) SHALL ALLOW 3/4" VERTICAL MOVEMENT UP OR DOWN.
- PROVIDE DEFLECTION CLIPS AT TOP OF ALL EXTERIOR NON-LOAD BEARING JAMB MEMBERS.
- PUNCHOUTS SHALL ALIGN AND SHALL NOT BE LOCATED WITHIN 10" OF BASE.

#### STATEMENT OF SPECIAL INSPECTIONS

- SPECIAL INSPECTIONS ARE REQUIRED FOR THIS STRUCTURE IN ACCORDANCE WITH CHAPTER 17 OF THE INTERNATIONAL BUILDING CODE FOR THE ITEMS NOTED IN THE TABLE ON THIS SHEET.
- TESTING SHALL BE PERFORMED BY A QUALIFIED TESTING LABORATORY RETAINED BY THE OWNER AND APPROVED BY THE ENGINEER.
- A LETTER OF SUBSTANTIAL COMPLETION SHALL BE SUBMITTED TO THE BUILDING DEPARTMENT BY THE SPECIAL INSPECTION PROVIDER PRIOR TO THE FINAL INSPECTION.

IBC TABLE 1705.6 REQUIRED VERIFICATION AND INSPECTION OF SOILS			
VERIFICATION AND INSPECTION TASK	CONTINUOUS	PERIODIC	
1. VERIFY MATERIALS BELOW SHALLOW FOUNDATIONS ARE ADEQUATE TO ACHIEVE THE DESIGN BEARING CAPACITY.	—	X	
2. VERIFY EXCAVATIONS ARE EXTENDED TO PROPER DEPTH AND HAVE REACHED PROPER MATERIAL.	—	X	
3. PERFORM CLASSIFICATION AND TESTING OF COMPACTED FILL MATERIALS.	—	X	
4. VERIFY USE OF PROPER MATERIALS, DENSITIES AND LIFT THICKNESSES DURING PLACEMENT AND COMPACTION OF COMPACTED FILL.	X	—	
5. PRIOR TO PLACEMENT OF COMPACTED FILL, INSPECT SUBGRADE AND VERIFY THAT SITE HAS BEEN PREPARED PROPERLY.	—	X	

### SCHEDULE - SPECIAL INSPECTIONS

#### ABBREVIATIONS

- A.B.= ANCHOR BOLT
- ACI= AMERICAN CONCRETE INSTITUTE
- AISC= AMERICAN INSTITUTE OF STEEL CONSTRUCTION
- AISI= AMERICAN IRON AND STEEL INSTITUTE
- ARCH= ARCHITECTURE/ARCHITECT
- ASTM= AMERICAN SOCIETY FOR TESTING AND MATERIALS
- A.W.= AFTER WELDING
- AWSS= AMERICAN WELDING SOCIETY
- BAR= REBAR
- B.O.= BOTTOM OF
- B.O.A.= BACK OF ANGLE
- B.O.F.= BOTTOM OF FINISHING
- B.O.S.= BOTTOM OF STEEL
- BRG= BEARING
- BTM= BOTTOM
- CANT= CANTILEVERED
- C.I.P.= CAST-IN-PLACE
- C.J.P.= COMPLETE JOINT PENETRATION WELD
- CL= CENTERLINE
- CLR= CLEAR
- CMU= CONCRETE MASONRY UNIT
- COL= COLUMN
- CONC= CONCRETE
- CONN= CONNECTION
- CONT= CONTINUOUS
- D.B.= DECK BEARING
- D.B.A.= DEFORMED BAR ANCHOR
- D.E.= DECK EDGE
- DIA= DIAMETER
- DL= DEAD LOAD
- DTL= DETAIL
- DWG= DRAWING
- EX= EXISTING
- EACH= EACH
- E.F.= EACH FACE
- EL= ELEVATION
- EPS= EXPANDED POLYSTYRENE
- EQ= EQUAL
- E.W.= EACH WAY
- EXT= EXTERIOR
- EXT= CONCRETE COMPRESSIVE STRENGTH
- F.F.= FINISHED FLOOR
- FND= FOUNDATION
- F.O.W.= FACE OF WALL
- F.S.= FAR SIDE
- FTG= FOOTING
- F.V.= FIELD VERIFY
- GA= GAGE / GAUGE
- GALV= GALVANIZED
- G.B.= GRADE BEAM
- G.C.= GENERAL CONTRACTOR
- (H)= HIGH
- H.L.= HIGH & LOW
- H.A.S.= HEADED ANCHOR STUD
- HORIZ= HORIZONTAL
- IBC= INTERNATIONAL BUILDING CODE
- I.D.= INSIDE DIAMETER
- INFO= INFORMATION
- INT= INTERIOR
- J.B.= JOIST BEARING
- J.B.E.= JOIST BEARING ELEVATION
- KIP= 1000 POUNDS
- KSI= KIPS PER SQUARE INCH
- (L)= LOW
- LE= LENGTH
- LB= POUND
- LGFS= LIGHT-GAGE STEEL FRAMING
- LL= LIVE LOAD
- LLH= LONG LEG HORIZONTAL
- LLV= LONG LEG VERTICAL
- LONG= LONGITUDINAL
- LP= LAYOUT POINT
- LVL= LAMINATED VENEER LUMBER
- LGW= LIGHTWEIGHT
- MAX= MAXIMUM
- MECH= MECHANICAL
- MEP= MECHANICAL, ELECTRICAL, PLUMBING
- MFR= MANUFACTURER
- MIL= THOUSANDS OF AN INCH
- MIN= MINIMUM
- MISC= MISCELLANEOUS
- MTL= METAL
- N.I.C.= NOT IN CONTRACT
- N.S.= NEAR SIDE
- N.T.S.= NOT TO SCALE
- N.W.= NORMAL WEIGHT
- O.C.= ON CENTER
- O.D.= OUTSIDE DIAMETER
- OPP= OPPOSITE / OPPOSITE HAND
- PAF= POWDER ACTUATED FASTENER
- P.C.F.= POUNDS PER CUBIC FOOT
- P.E.= PRE-ENGINEERED METAL BUILDING
- PLF= POUNDS PER LINEAR FOOT
- PPT= PRESERVATIVE PRESSURE TREATED
- PSF= POUNDS PER SQUARE FOOT
- PSI= POUNDS PER SQUARE INCH
- PT= POST TENSIONED
- REIN= REINFORCING
- REQ= REQUIRE
- RTU= ROOF TOP UNIT
- S.C.= SLIP CRITICAL
- SCH= SCHEDULE
- SDI= STEEL DECK INSTITUTE
- SIM= SIMILAR
- SJI= STEEL JOIST INSTITUTE
- SNOW= SNOW LOAD
- S.O.G.= SLAB ON GRADE
- 108 SPECS= SPECIFICATIONS
- STD= STANDARD
- STL= STEEL
- T= THICKNESS
- TAB= TOP AND BOTTOM
- T.O.= TOP OF
- T.O.F.= TOP OF FOOTING
- T.O.P.= TOP OF PEDESTAL
- T.O.S.= TOP OF STEEL
- T.O.W.= TOP OF WALL
- TYP= TYPICAL
- UL= ULTIMATE LOAD
- U.N.O.= UNLESS NOTED OTHERWISE
- VERT= VERTICAL
- VLD= VERTICAL LEG DOWN
- W= WIDTH
- WL= WIND LOAD
- W.P.= WORK POINT
- WWF= WELDED WIRE FABRIC
- (#)= QUANTITY

#### POST-INSTALLED ANCHOR NOTES

- CONTINUOUS INSPECTIONS ARE REQUIRED FOR POST INSTALLED ANCHOR BOLTS INCLUDING TYPE, SIZE, LENGTH, DRILLING METHOD, HOLE CLEANING PROCEDURES, AND ANCHOR INSTALLATION AND SETTING PROCEDURES.
- ADHESIVE ANCHORS SHALL BE INSTALLED BY AN ADHESIVE ANCHOR INSTALLER WHO HAS BEEN CERTIFIED BY ACI AND TRAINED BY THE MANUFACTURER.
- ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S PRINTED INSTALLATION INSTRUCTIONS.

#### REQUIRED VERIFICATION AND INSPECTION OF STEEL CONSTRUCTION OTHER THAN STRUCTURAL STEEL

VERIFICATION AND INSPECTION	CONTINUOUS	PERIODIC	REFERENCED STANDARD
1. MATERIAL VERIFICATION OF COLD-FORMED STEEL DECK:			
A. IDENTIFICATION MARKINGS TO CONFORM TO ASTM STANDARDS SPECIFIED IN THE APPROVED CONSTRUCTION DOCUMENTS.	—	X	APPLICABLE ASTM MATERIAL STANDARDS
B. MANUFACTURER'S CERTIFIED TEST REPORTS	—	X	
2. INSPECTION OF WELDING:			
A. COLD-FORMED STEEL DECK:			
a. FLOOR AND ROOF DECK WELDS.	X	—	AWS D1.3
B. REINFORCING STEEL:			
a. VERIFICATION OF WELDABILITY OF REINF STEEL OTHER THAN ASTM A 706.	—	X	
b. REINFORCING STEEL RESISTING FLEXURAL AND AXIAL FORCES IN INTERMEDIATE AND SPECIAL MOMENT FRAMES, AND BOUNDARY ELEMENTS OF SPECIAL STRUCTURAL WALLS OF CONCRETE AND SHEAR REINFORCEMENT.	X	—	AWS D1.4 ACI 318 SECTION 3.5.2
c. SHEAR REINFORCEMENT.	X	—	
d. OTHER REINFORCING STEEL.	—	X	

#### CONCRETE NOTES

- CONCRETE FOR FOUNDATIONS, FOOTINGS AND INTERIOR SLABS ON GRADE SHALL BE AS FOLLOWS:
  - 28-DAY COMPRESSIVE STRENGTH: 3000 PSI
  - MAXIMUM WATER TO CEMENT RATIO: 0.52
  - SUMP: 4" ±1"
- CONCRETE FOR EXTERIOR USES, SIDEWALKS, RETAINING WALLS, BASEMENT WALLS, AND EXTERIOR SLABS ON GRADE SHALL BE AS FOLLOWS:
  - 28-DAY COMPRESSIVE STRENGTH: 4000 PSI
  - MAXIMUM WATER TO CEMENT RATIO: 0.45
  - SUMP: 4" ±1"
  - AIR-ENTRAINMENT: 0.06-13%
  - AIR-ENTRAINING ADMIXTURE SHALL CONFORM TO ASTM C260
- CONCRETE FOR ELEVATED SLABS ON METAL DECK SHALL BE AS FOLLOWS:
  - 28-DAY COMPRESSIVE STRENGTH: 4000 PSI
  - MAXIMUM WATER TO CEMENT RATIO: 0.45
  - SUMP: 4" ±1"
- NO LIME SAND FINE AGGREGATE MAY BE USED IN CONCRETE EXPOSED TO WEATHER, VIEW, OR IN HORIZONTAL APPLICATIONS.
- ALL REINFORCING STEEL SHALL CONFORM TO ASTM A615 GRADE 60
- WELDED WIRE FABRIC SHALL CONFORM TO ASTM A185 LAP FABRIC 9" ON SIDES AND ENDS. MAINTAIN WIRE 1" TO 2" BELOW TOP SURFACE OF SLABS ON GRADE. PROVIDE CHAIRS, BOLSTERS OR OTHER APPROVED MEANS TO PROPERLY LOCATE REINFORCING.
- IF ADDITIONAL FLOWABILITY IS REQUIRED FOR PLACEMENT OF ANY CONCRETE MIX, A WATER-REDUCING ADDITIVE CONFORMING TO ASTM C494, TYPE A, D, E OR F SHALL BE USED. NO ADDITIONAL WATER MAY BE ADDED TO THE MIX AT THE SITE. SLUMP FOR CONCRETE CONTAINING WATER-REDUCING OR HIGH-RANGE WATER-REDUCING ADMIXTURE SHALL NOT EXCEED 8" AFTER ADMIXTURE IS ADDED TO CONCRETE WITH A 2'-4" SLUMP.
- INTERIOR SLABS SHALL HAVE SMOOTH TROWELED FINISH AND EXTERIOR SLABS SHALL HAVE LIGHT BROOM FINISH. UNO. ALL SLABS SHALL HAVE A CURING COMPOUND COMPLYING WITH ASTM C309 APPLIED TO SURFACE. EXCEPTIONS ARE WHERE FLOOR FINISHES REQUIRE SCRATCH FINISH AND WHERE CURING COMPOUNDS ARE NOT COMPATIBLE WITH ADHESIVES, ETC.
- CONTRACTOR SHALL COORDINATE ALL CONCRETE SEALERS, CURING COMPOUNDS, ETC TO ENSURE COMPATIBILITY WITH FLOORING ADHESIVES FOR FLOORING INDICATED IN THE FLOOR PLANS AND FLOOR FINISH PLANS AS APPLICABLE.
- TESTING OF FRESH CONCRETE SHALL BE DONE BY A QUALIFIED TESTING LABORATORY RETAINED BY THE OWNER AND APPROVED BY THE ENGINEER. TESTING SHALL INCLUDE:
  - SUMP
  - AIR CONTENT
  - CONCRETE TEMPERATURE
  - 28 DAY COMPRESSIVE STRENGTH
  - NOTE ANY WATER OR ADMIXTURES ADDED ON-SITE
- REFER TO ASTM C172 AND C94. PERFORM ONE SLUMP AND ONE AIR CONTENT TEST FOR EACH DAYS POUR AND ADDITIONAL TESTS WHEN THE CONCRETE CONSISTENCY SEEMS TO HAVE CHANGED. OBTAIN OPINION OF THE INSPECTOR. REFER TO ASTM C143, C173 AND C231. PERFORM TEMPERATURE TESTS HOURLY WHEN THE AMBIENT AIR TEMPERATURE BELOW 40 DEGREES F OR ABOVE 80 DEGREES F AND ONE TEMPERATURE TEST FOR EACH SET OF COMPRESSIVE STRENGTH SPECIMENS. REFER TO ASTM C1064. PERFORM ONE COMPRESSIVE-STRENGTH TEST FOR EACH DAYS POUR AND AN ADDITIONAL TEST FOR EACH 50 CUBIC YARD MORE THAN THE FIRST 25 CUBIC YARD. TEST ONE SPECIMEN AT 7 DAYS AND 2 SPECIMENS AT 28 DAYS.
- WHERE FOOTINGS, WALLS, OR OTHER STRUCTURAL ELEMENTS INTERSECT, CORNER OR TEE, PROVIDE CORNER BARS WITH REQUIRED LAP LENGTHS TO PROVIDE CONTINUITY OF HORIZONTAL STEEL REINFORCING UNO.
- PROVIDE A MINIMUM OF 3" COVER FOR ANCHOR BOLTS AND LOCATE HORIZONTAL REINFORCEMENT TO THE OUTSIDE FOR ANCHOR BOLT CONTAINMENT, UNO.
- PROVIDE TEMPORARY SHORING AND BRACING OF ALL STRUCTURAL AND MISCELLANEOUS ELEMENTS UNTIL CONCRETE HAS OBTAINED 80% OF DESIGN STRENGTH AND ALL PERMANENT BRACING ELEMENTS ARE INSTALLED.
- UNLESS NOTED OTHERWISE, PROVIDE CONSTRUCTION JOINTS IN SLABS ON GRADE AT APPROXIMATELY 10 FEET IN EACH DIRECTION. PROVIDE CONTROL JOINTS IN SLABS ON GRADE AT APPROXIMATELY 10 FEET ON CENTER IN EACH DIRECTION. JOINTS SHALL FORM NEARLY SQUARE SHAPES. CONTRACTOR SHALL COORDINATE JOINT LOCATIONS WITH LAYOUT AS SHOWN IN THE FLOOR PLANS AND FLOOR FINISH PLANS AS APPLICABLE.
- WHERE DOWELS, BOLTS OR INSERTS ARE CALLED TO BE ANCHORED TO CAST-IN OR PRECAST CONCRETE ELEMENTS USING EPOXY ADHESIVES, USE ANCHORAGE SYSTEM EQUAL TO "HLTI" HIT RE 500 INJECTION ADHESIVE. FOLLOW ALL MANUFACTURER'S RECOMMENDATIONS. ALTERNATE ANCHORAGE SYSTEMS MAY BE USED WITH ENGINEER'S PRIOR APPROVAL.
- SAWY CONTROL JOINTS SHALL BE PLACED AS SOON AS CONCRETE IS ABLE TO BE SAWN WITHOUT PULLING OUT AGGREGATE FROM FLOOR. SLABS SHALL NOT BE LEFT OVERNIGHT, OR ANY REASONABLE AMOUNT OF TIME, WITHOUT SAWING JOINTS. WEATHER IS CRITICAL TO SCHEDULE OF SAWY JOINTS. IF LARGE AREAS OF SLAB ARE POURED AT ONE TIME, SEVERAL SAWS MAY BE REQUIRED TO PROVIDE JOINTS IN TIME TO PREVENT SHRINKAGE CRACKING. PROPER JOINTING OF SLAB IS CRITICAL. REFER TO ACI MANUAL OF CONCRETE PRACTICE FOR PROPER JOINTING TECHNIQUES.
- DETAILING MATERIALS AND INSTALLATION OF CONCRETE REINFORCING STEEL SHALL MEET REQ. AS SET FORTH BY CRSI AND THE AMERICAN CONCRETE INSTITUTE AND THE APPLICABLE BUILDING CODE. SHOP DRAWINGS SHALL BE SUBMITTED INDICATING COMPLETE INFORMATION REQUIRED FOR CONSTRUCTION OF THE REINFORCED CONCRETE ELEMENTS. SHOP DRAWINGS SHALL INCLUDE LAYOUT AND DIMENSIONS OF REINFORCING INCLUDING ANY OPENINGS, CONVENTIONAL REINFORCEMENT DETAILS, CONNECTION DETAILS, REINFORCEMENT SEQUENCES ETC.
- WHEN PLACING CONCRETE IN HOT WEATHER, REFER TO ACI 301. WHEN PLACING CONCRETE IN COLD WEATHER, REFER TO ACI 308.1.

#### GENERAL FOUNDATION & SLAB ON GRADE NOTES (NO SPECS, NO GEOTECH)

- IN AREA OF THE STRUCTURE, EXISTING ORGANIC MATERIAL, UNSUITABLE SOIL, ABANDONED FOOTINGS AND ANY OTHER EXISTING UNSUITABLE MATERIALS SHALL BE REMOVED. ANY FILL MATERIAL REQUIRED AT THE SITE SHALL BE OF A SIMILAR TYPE SOIL THAT IS PRESENT. THIS SITE EXHIBITING LIQUID LIMIT VALUES BELOW 50 AND PLASTIC INDEX VALUES BELOW 10. ROCKS GREATER THAN 6 IN. IN SHAPE BE EXCLUDED FROM STRUCTURAL FILL LIFTS. FILL MATERIAL SHALL BE PLACED IN LOOSE LIFTS NO GREATER THAN 8 INCHES IN DEPTH AND SHALL BE EXCLUDED FROM 95% OF MAXIMUM DENSITY BASED ON STANDARD PROCTOR DENSITIES (ASTM D-698). ADEQUATE FIELD DENSITY AND MOISTURE CORRELATION TESTS SHALL BE PERFORMED TO ENSURE COMPLIANCE WITH REQUIREMENTS.
- TESTING OF CONTROLLED STRUCTURAL FILL SHALL BE DONE BY A QUALIFIED TESTING LABORATORY RETAINED BY THE OWNER. SEE STRUCTURAL DRAWINGS FOR REQUIRED TESTING. CONTRACTOR IS RESPONSIBLE FOR COORDINATING WORK WITH INSPECTOR.
  - AFTER STRIPPING SITE AND PRIOR TO PLACEMENT OF ANY FILL, NOTIFY SPECIAL INSPECTOR/TESTING AGENCY FOR INSPECTION OF SOIL CONDITIONS. INSPECTION SHALL INCLUDE PROOF ROLLING SITE WITH HEAVY EQUIPMENT PROVIDED BY THE CONTRACTOR.
  - AFTER EXCAVATION FOR FOUNDATIONS AND PRIOR TO PLACEMENT OF STEEL REINFORCEMENT OR CONCRETE, NOTIFY SPECIAL INSPECTOR/TESTING AGENCY FOR INSPECTION OF SOIL CONDITIONS. WHEN SOIL OF INADEQUATE STRENGTH IS NOTED, CONTRACTOR SHALL FURTHER DEEPEEN EXCAVATIONS UNTIL SUITABLE BEARING CONDITIONS ARE VERIFIED BY TESTING. OVEREXCAVATIONS MAY BE BACKFILLED WITH SUITABLE COMPACTED ENGINEERED FILL TO A SUITABLE GRANULAR BASE OR STRUCTURAL CONCRETE BACKFILL.
- EXTERIOR FOOTINGS SHALL BEAR AT MIN. DEPTHS AS NOTED IN FOOTING SECTIONS AND PLANS, 30" BELOW EXTERIOR FINISH GRADE, OR INTO APPROVED BEARING STRATA, WHICHEVER DEPTH IS GREATER. NOTE THAT FOOTING BEARING ELEVATIONS GIVEN ON THE PLANS ARE ESTIMATED DEPTHS ONLY. WHERE UNSUITABLE SOIL IS ENCOUNTERED, FOOTING DEPTHS MAY VARY. EXCAVATION FOR FOOTINGS SHALL BE CUT TO ACCURATE SIZE AND DIMENSIONS AS SHOWN ON PLANS. ALL SOIL BELOW SLABS AND FOOTINGS SHALL BE PROPERLY COMPACTED AND SUBGRADE BROUGHT TO A REASONABLE TRUE AND LEVEL PLANE BEFORE PLACING CONCRETE.
  - CONTINUOUS FOOTINGS AND INDIVIDUAL FOOTINGS ARE DESIGNED FOR A NET ALLOWABLE SOIL BEARING OF:
    - CONTINUOUS FOOTINGS: 1500 PSF
    - INDIVIDUAL FOOTINGS: 1500 PSF
  - FOR EITHER NATURALLY OCCURRING SOIL OR COMPACTED ENGINEERED FILL.
- TYPICAL SLABS ON GRADE
  - THICKNESS: 4" THICK NORMAL WEIGHT CONCRETE
  - REINFORCING: 6x6-W1 4xW1.4 WELDED WIRE FABRIC (WWF)
  - VAPOR BARRIER: 15 MIL. (ASTM E1745 CLASS A)
  - SUBGRADE: A MINIMUM OF 4" OF FREE-DRAINING GRANULAR BASE, COMPACTED PER RECOMMENDATIONS OF GEOTECHNICAL ENGINEER.
- MAINTAIN REINFORCING 1"-2" BELOW TOP SURFACE OF SLABS ON GRADE. PROVIDE BOLSTERS, CHAIRS OR OTHER MEANS APPROVED IN WRITING BY THE ENGINEER TO PROPERLY LOCATE REINFORCING. GRANULAR BASE SHALL BE #57 STONE OR APPROVED EQUAL UNLESS OTHERWISE INDICATED IN GEOTECHNICAL REPORT. REFER TO ASTM D448 FOR GRADATION.
  - IN SOME CASES 1.5 POUNDS (MIN) OF POLYPROPYLENE FIBRILLATED FIBERS PER CUBIC YARD REINFORCING MAY BE SUBSTITUTED FOR THE WWF REINFORCING. ANY VISIBLE FIBERS REMAINING AFTER CONCRETE HAS CURED SHALL BE TORCHED OFF. THIS SUBSTITUTION IS NOT ALWAYS APPROPRIATE AND SHALL NOT BE MADE WITHOUT WRITTEN APPROVAL OF THE ENGINEER.
- DRAINAGE FILL SHALL BE A FREE-DRAINING GRANULAR MATERIAL. USE #57 STONE OR EQUAL. REFER TO ASTM D448 FOR GRADATION. CONTRACTOR IS RESPONSIBLE TO MAINTAIN EXCAVATIONS AND BACKFILL MATERIAL AT AN APPROPRIATE MOISTURE CONTENT FOR PROPER SOIL BEARING CAPACITY AND COMPACTION. CONTRACTOR SHALL COORDINATE WITH THE CIVIL / SITE DRAWINGS TO DETERMINE WHETHER FOUNDATION DRAINS AROUND PERIMETER OF BUILDING AND/OR UNDER THE SLAB-ON-GRADE SHALL BE REQUIRED AND, IF SO, SHALL RUN TO DAYLIGHT OR EXTENDED TO THE STORM SEWER. AT RETAINING WALLS FILTER FABRIC SHALL BE PLACED AT THE INTERFACE BETWEEN THE DRAINAGE FILL AND EITHER NATURAL OR COMPACTED SUBGRADE. PERFORATED DRAINS SHALL ALSO BE WRAPPED WITH FILTER FABRIC.
- ELEMENTS WITH TRIBUTARY AREAS GREATER THAN 700 SQUARE FEET SHALL BE PERMITTED TO BE DESIGNED USING THE PROVISIONS FOR MWFRS.

#### COMPONENTS AND CLADDING WIND PRESSURE

- BUILDING ELEMENTS SHALL BE DESIGNED FOR THE APPROPRIATE COMPONENTS AND CLADDING WIND PRESSURES GIVEN IN THE TABLES BELOW BASED ON THE ELEMENT'S ZONE AND EFFECTIVE WIND AREA. PRESSURES PROVIDED ARE ULTIMATE AND ARE UNFACTORED.
- ZONE 2, 3 AND 5 PRESSURES SHALL BE APPLIED WITHIN 1'-4" OF ALL WALL AND ROOF EDGES AND CORNERS PER ASCE 7-10 FIGURES 30.4-1 & 30.4-2A.
- ELEMENTS WITH TRIBUTARY AREAS GREATER THAN 700 SQUARE FEET SHALL BE PERMITTED TO BE DESIGNED USING THE PROVISIONS FOR MWFRS.


ROOF C&C PRESSURES			
GROSS UPLIFT			
OPEN WEB JOISTS	ZONE 1	27 PSF	
	ZONE 2	32 PSF	
	ZONE 3	32 PSF	
METAL DECK	ZONE 1	29 PSF	
	ZONE 2	49 PSF	
	ZONE 3	73 PSF	
NET UPLIFT			
OPEN WEB JOISTS	ZONE 1	24 PSF	
	ZONE 2	29 PSF	
	ZONE 3	29 PSF	
METAL DECK	ZONE 1	27 PSF	
	ZONE 2	47 PSF	
	ZONE 3	71 PSF	

WALL C&C PRESSURES			
EFFECTIVE WIND AREA (FT²)	ZONE 4 NEG. PRESSURE	ZONE 5 NEG. PRESSURE	
10	41 PSF	50 PSF	
20	39 PSF	47 PSF	
50	37 PSF	42 PSF	
100	34 PSF	39 PSF	
500+	31 PSF	31 PSF	



#### WOOD SHEATHING & DECKING NOTES ANCHORED TO LIGHT GAUGE

- TYPICAL WALL SHEATHING SHALL BE 7/16" (1/2") APA RATED 24/16 STRUCTURAL, 1 EXPOSURE 1 PANELS. SCREW TO SUPPORTS WITH #8 PAN HEAD TEK SCREWS AT 6" O.C. AT PANEL EDGES AND 12" O.C. AT INTERMEDIATE SUPPORTS. PROVIDE LIGHT GAUGE BLOCKING AT ALL PANEL EDGES. SEE SHEAR WALL SCHEDULE FOR REQUIREMENTS AT SHEAR WALLS.
- ROOF DECKING SHALL BE 19/32" (5/8") STRUCTURAL I EXPOSURE I APA RATED 40/20 TONGUE AND GROOVE PANELS. "H" CLIPS MAY BE USED AT THE CONTRACTOR'S OPTION IN LIEU OF T&G. SCREW TO SUPPORTS WITH #8 PAN HEAD TEK SCREWS AT 8" O.C. AT PANEL EDGES AND 12" O.C. AT INTERIOR SUPPORTS. REDUCE SPACING TO 4" O.C. AT EDGES AND INTERIOR SUPPORTS WITHIN 4'-0" OF BUILDING CORNERS.
- FLOOR DECKING SHALL BE 23/32" (3/4") ADVANTECH PANELS T&G. GLUE AND SCREW TO SUPPORTS WITH #8 PAN HEAD TEK SCREWS AT 8" O.C. AT PANEL EDGES AND 12" O.C. AT INTERMEDIATE SUPPORTS. GLUE SHALL MEET APA SPEC AF-01.
- WOOD STRUCTURAL PANELS SHALL BE OSB OR PLYWOOD WITH (4) OR MORE PLYS AND SHALL COMPLY WITH DOC PS 1 OR PS 2.
- PANELS SHALL BE INSTALLED WITH THE STRENGTH AXIS (LONG DIRECTION) PERPENDICULAR TO SUPPORTS.

#### ISOMETRIC VIEWS FOR REFERENCE ONLY

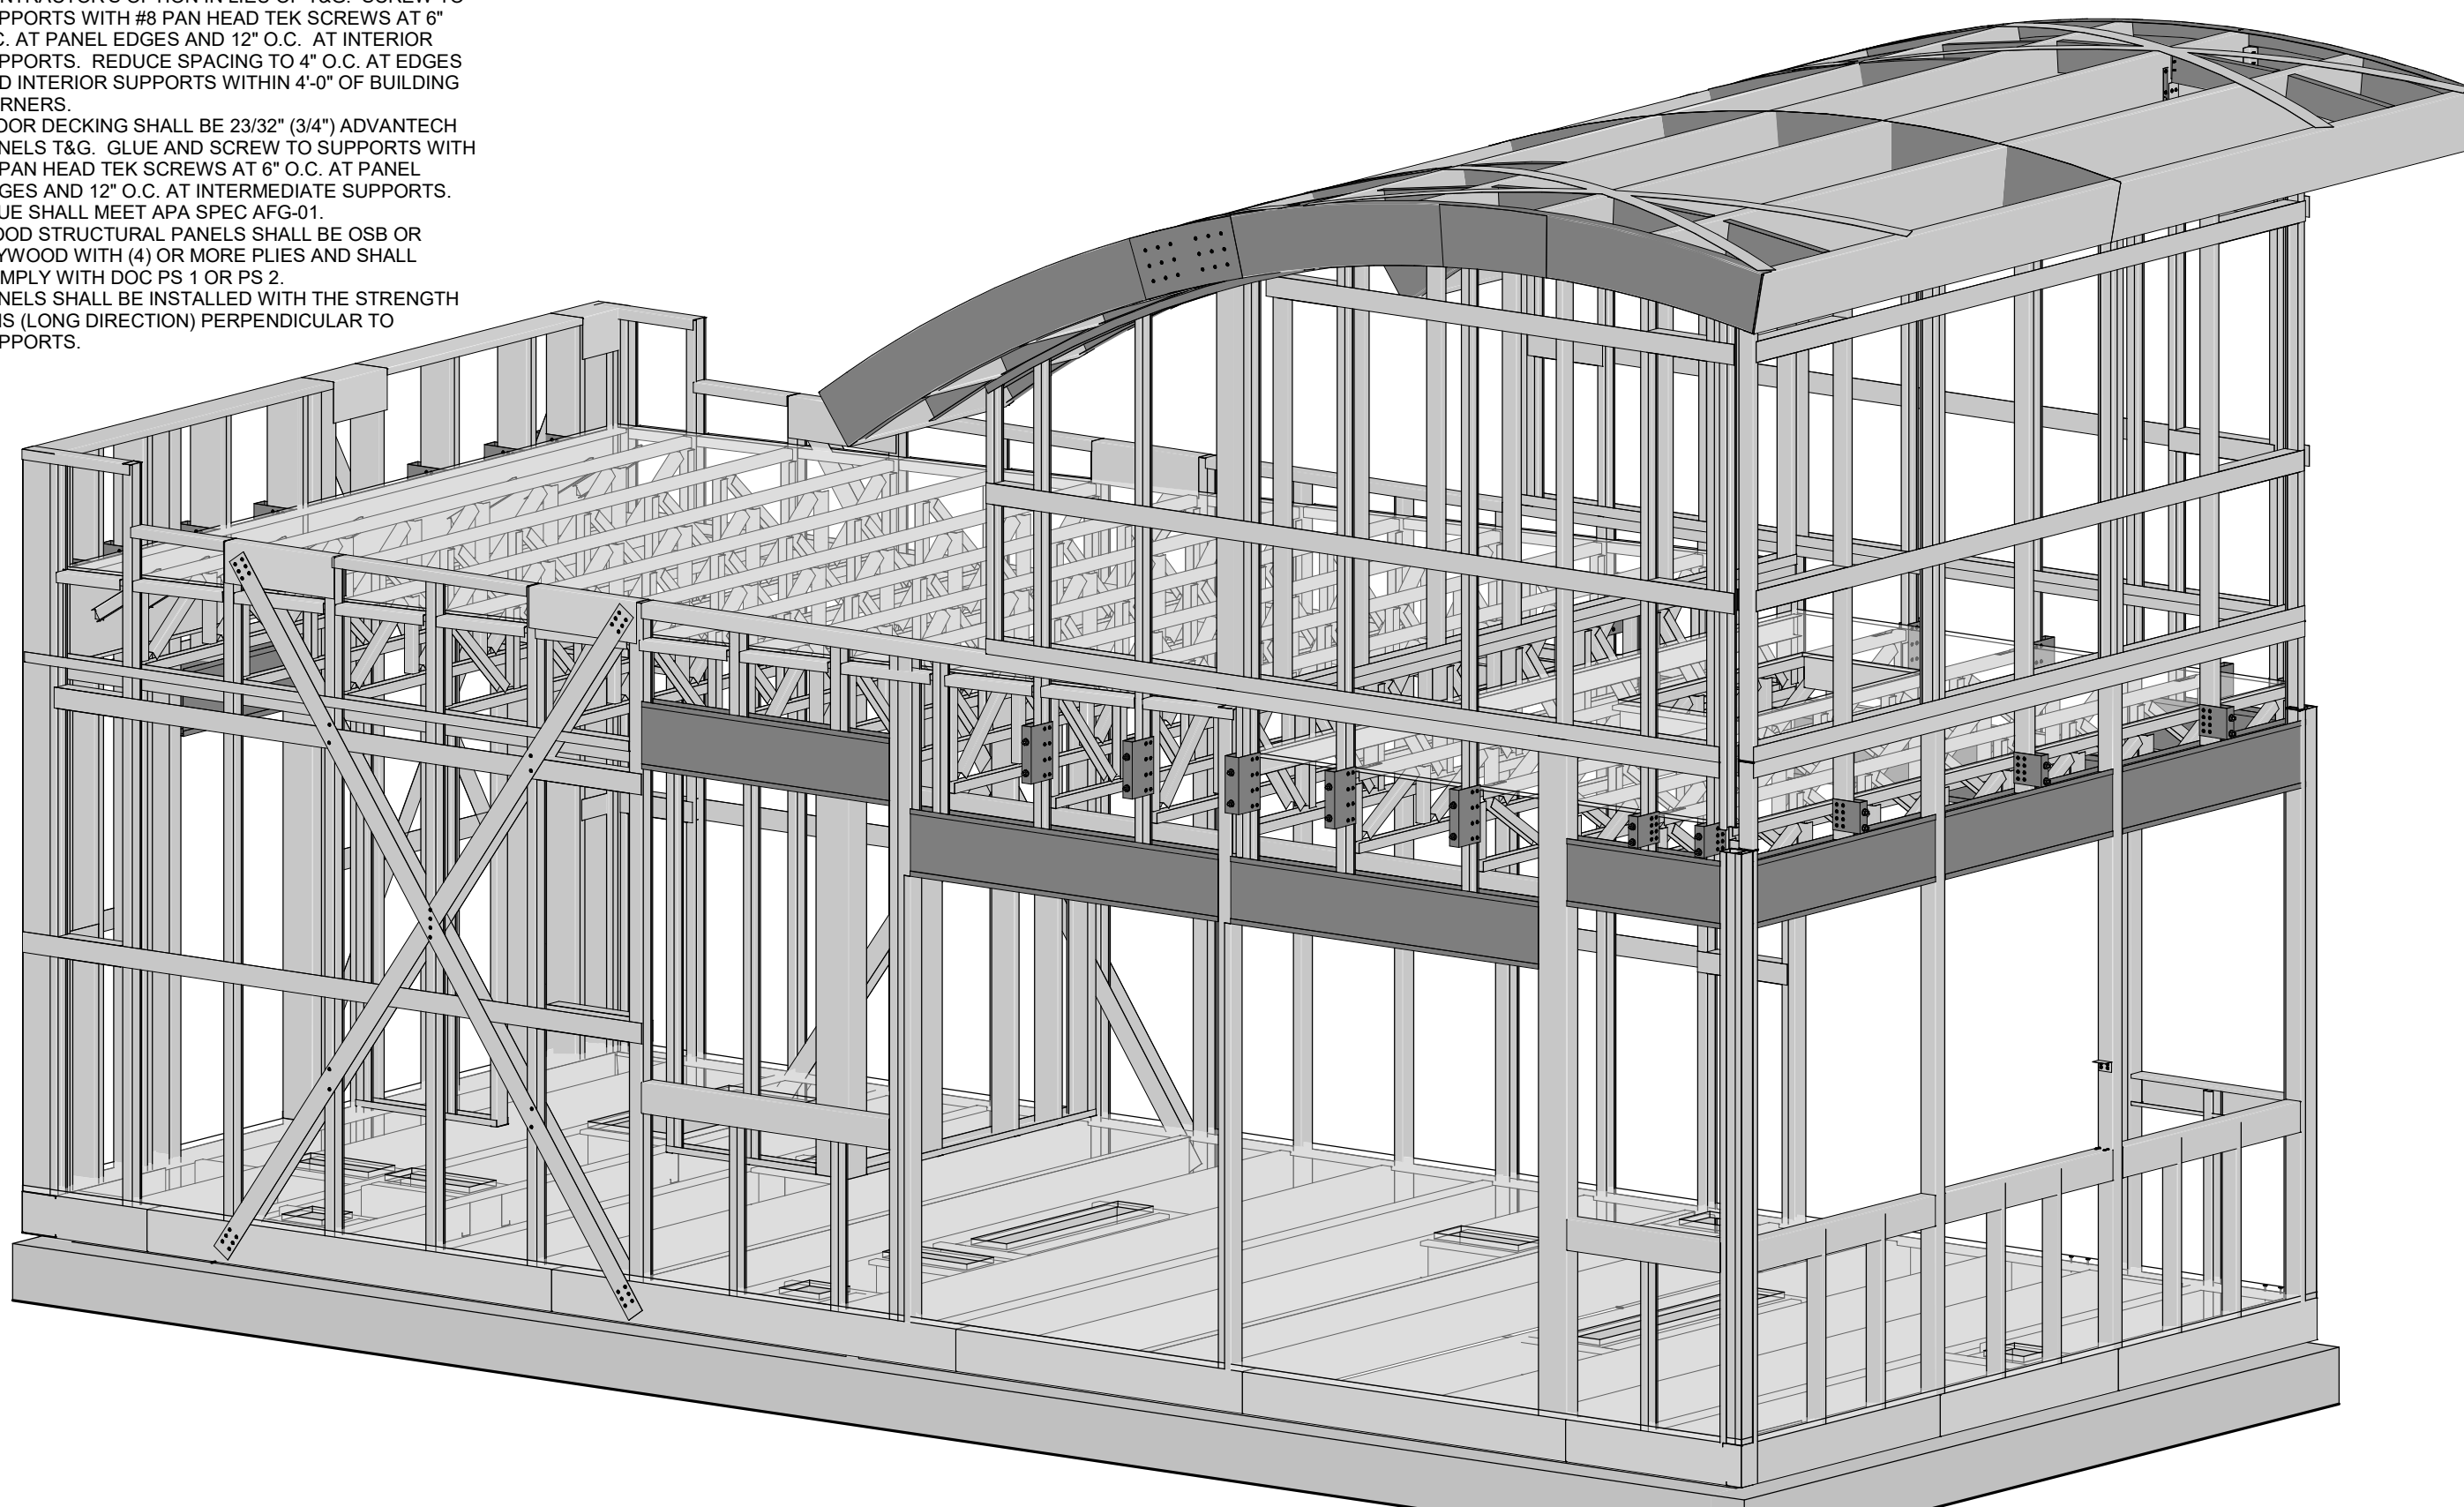

#### ISOMETRIC VIEW FRONT SIDE (MODULAR BUILDING)

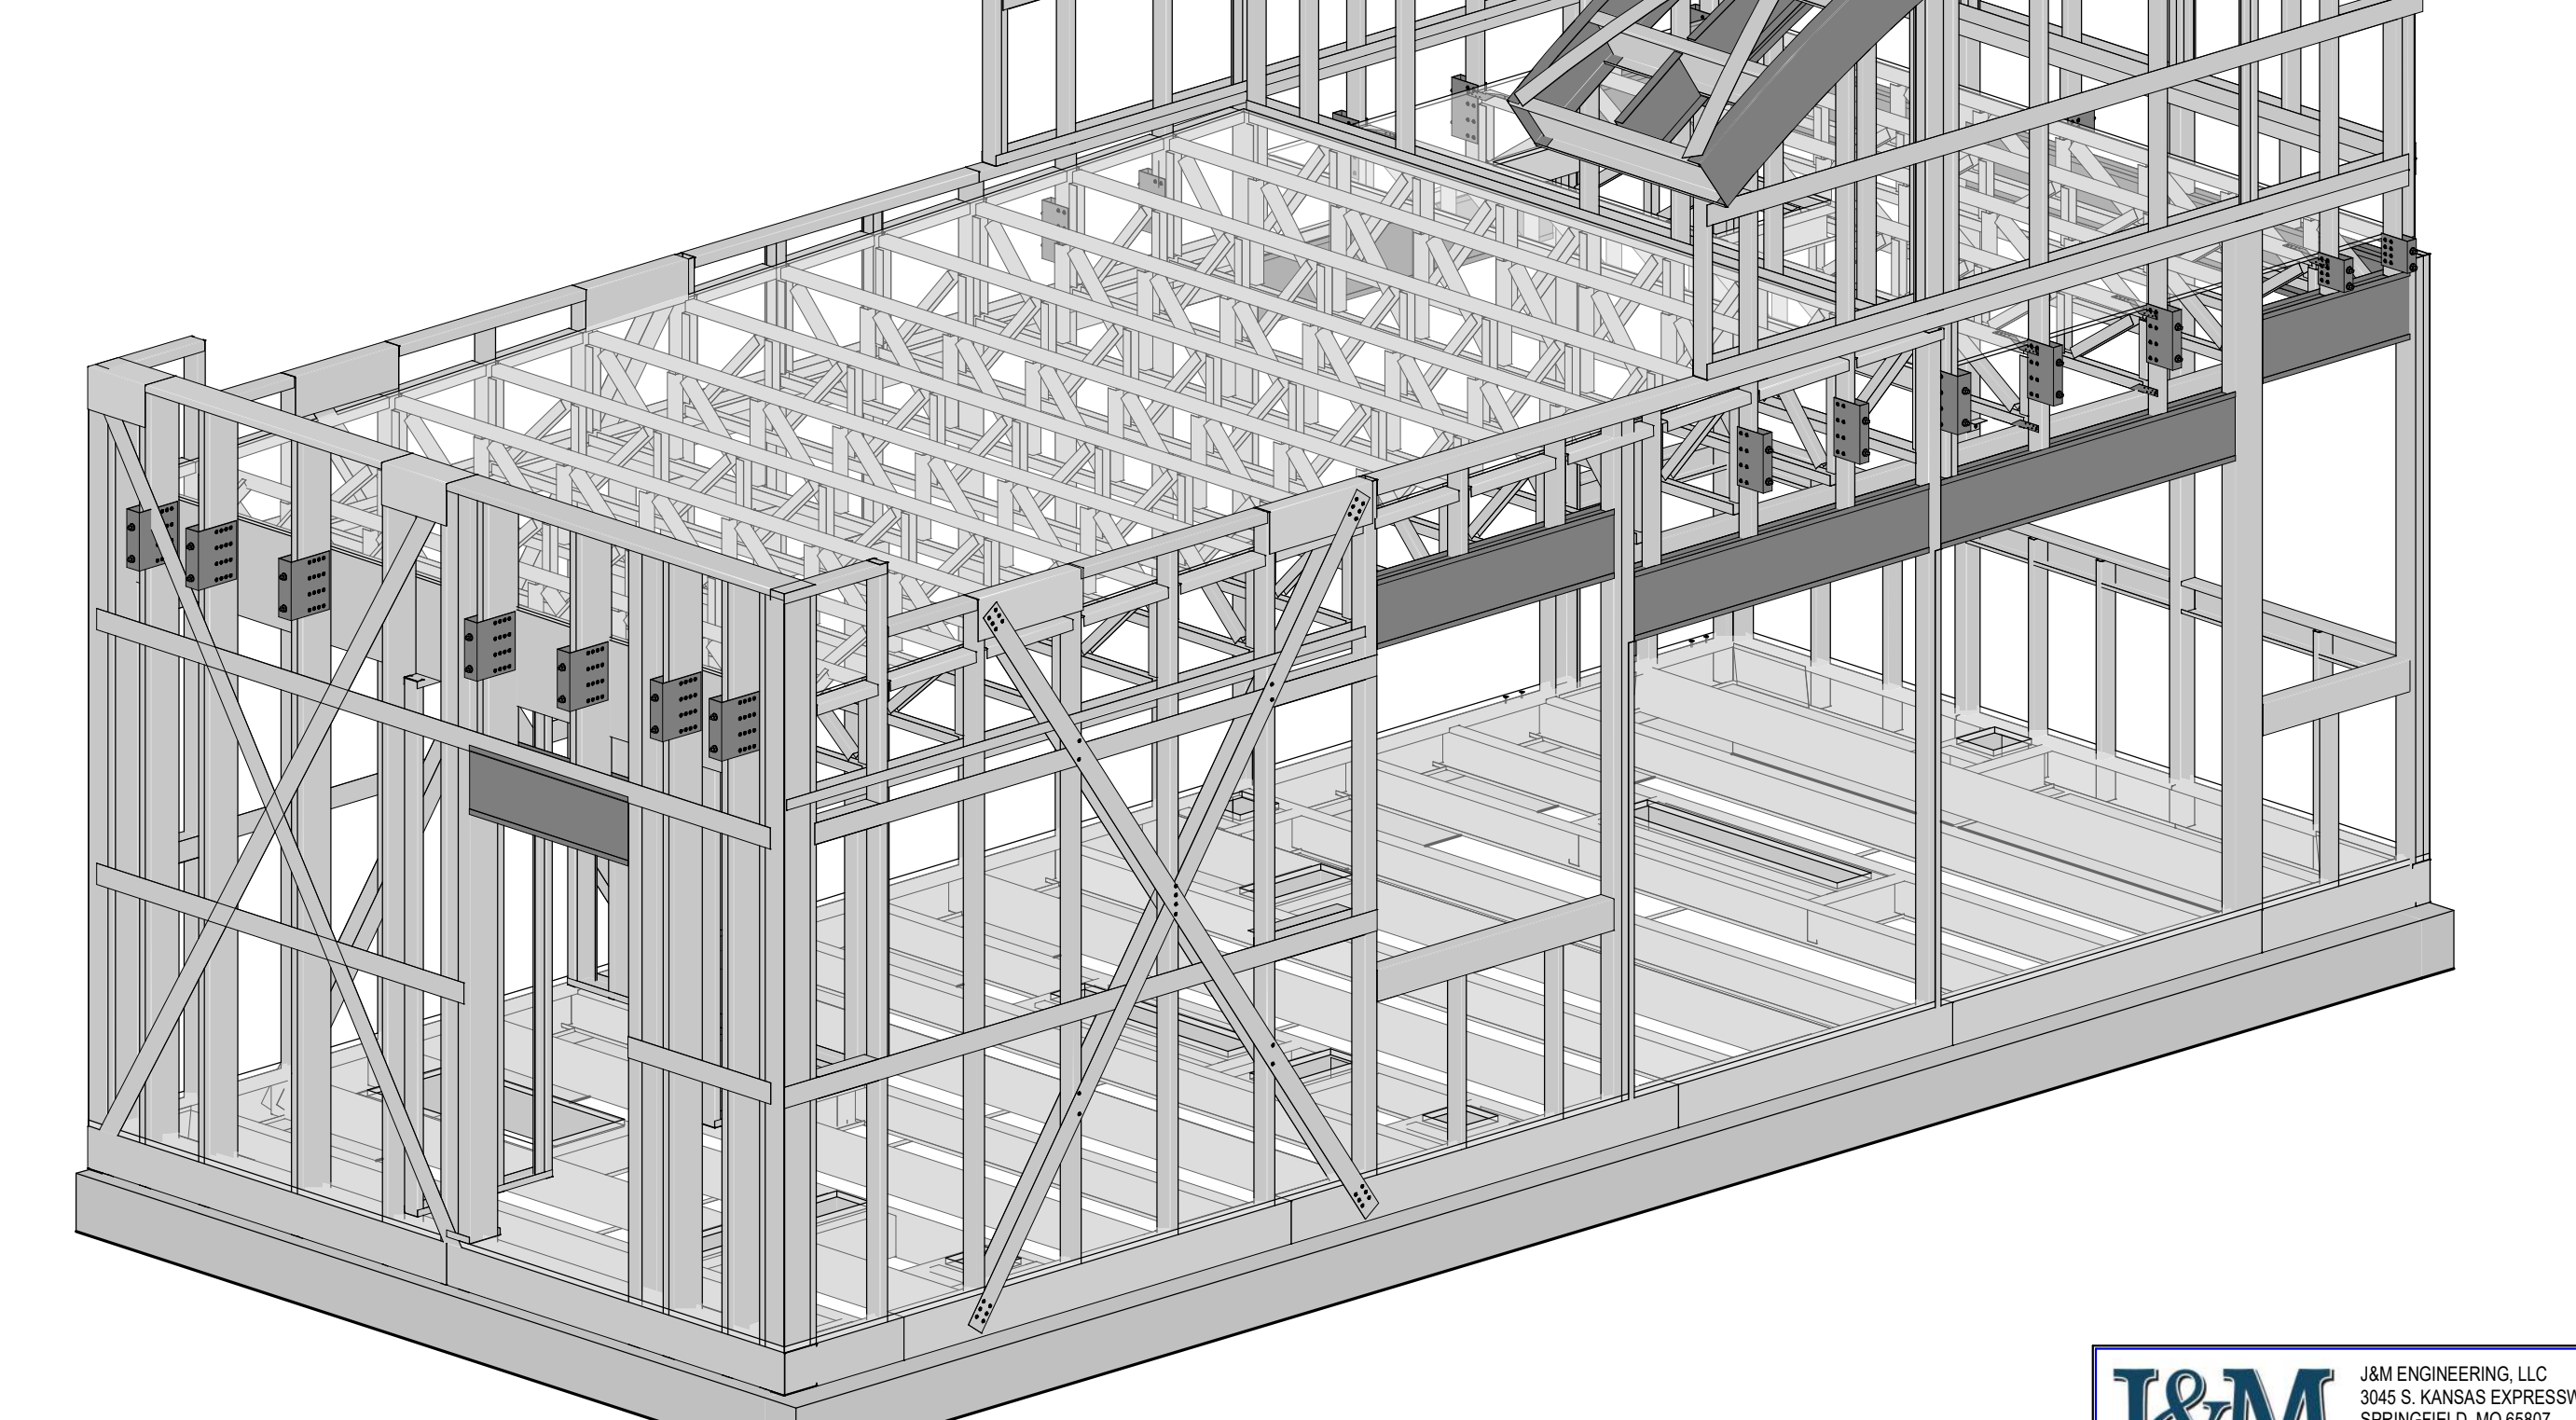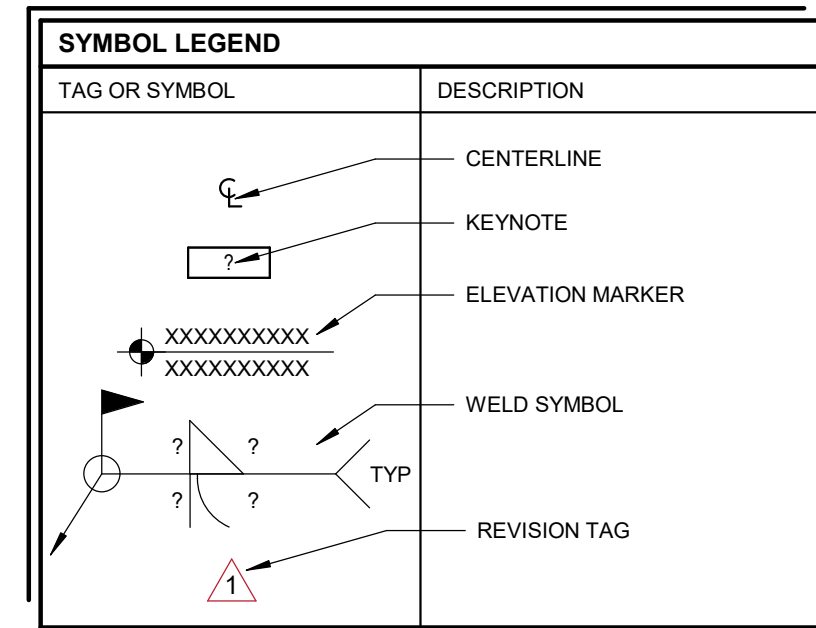

#### ISOMETRIC VIEW BACK SIDE (MODULAR BUILDING)


#### BUILDING SUPPLIER / ERECTOR CREATIVE MODULAR CONSTRUCTION

**TORGERSON**  
**DESIGN PARTNERS**  
ARCHITECTURE / REAL ESTATE / DEVELOPMENT



**CMC**  
CREATIVE MODULAR CONSTRUCTION

7 BREW COFFEE  
LEE'S SUMMIT, MO  
LEE'S SUMMIT, MISSOURI 64086

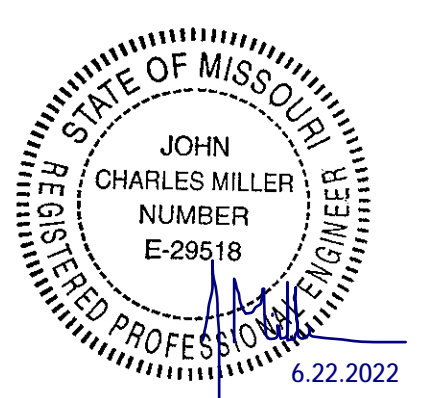

ENGINEER OF RECORD:  
JOHN C. MILLER  
E-29518  
E-2011011004

PROJECT NUMBER:  
220337BL5

REVISION:


**S0.0**  
GENERAL NOTES

DATE: 04/22/2022



J&M ENGINEERING, LLC  
3045 S. KANSAS EXPRESSWAY  
SPRINGFIELD, MO 65807  
PHONE: 417.708.9315  
www.jandmstructural.com  
E-2011011004




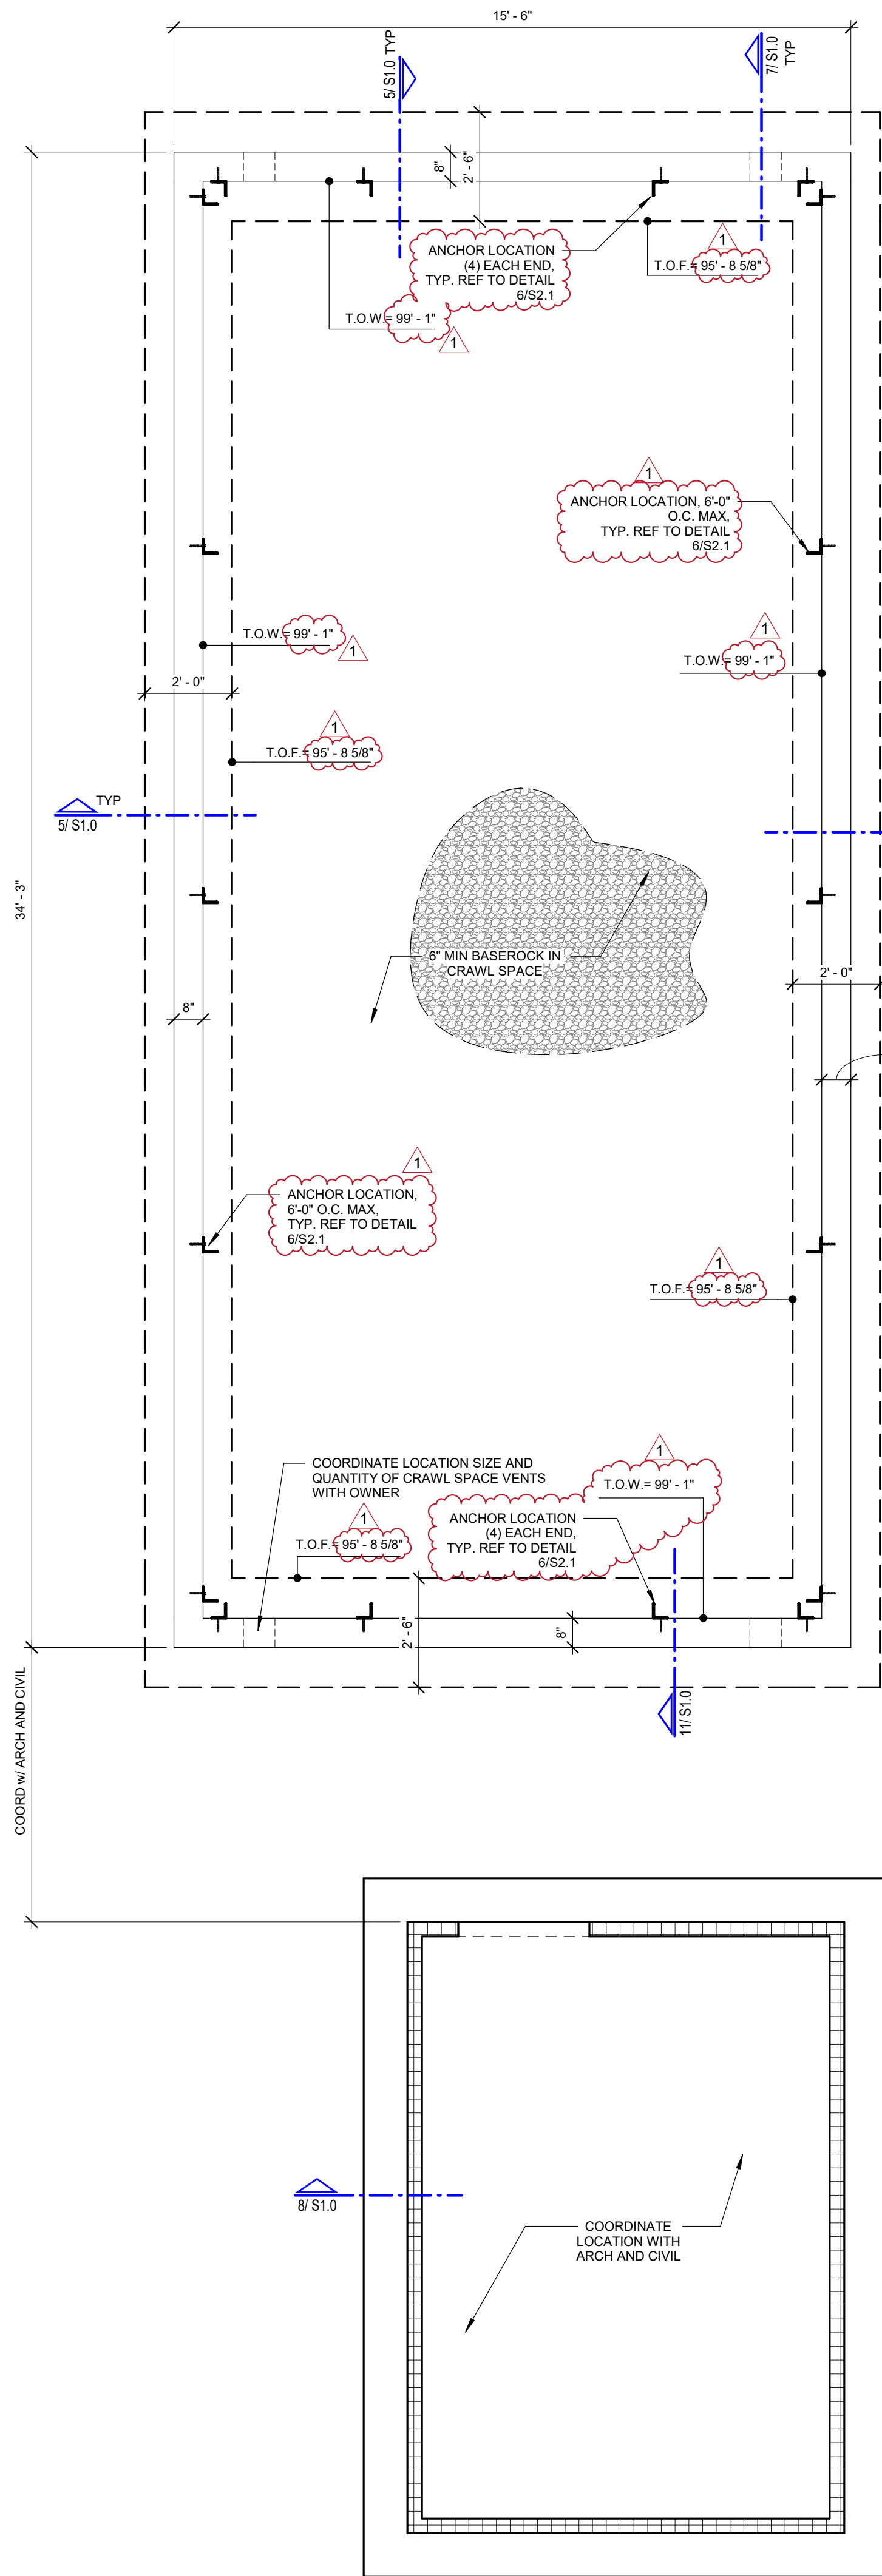

1 FLOOR PLAN  
3/8" = 1'-0"

BAR SIZE	STRAIGHT DOWEL DEVELOPMENT LENGTHS (INCHES)								
	TENSION						COMPRESSION		
	OTHER BARS			TOP BARS					
	3000 PSI CONCRETE	4000 PSI CONCRETE	5000 PSI CONCRETE	3000 PSI CONCRETE	4000 PSI CONCRETE	5000 PSI CONCRETE	3000 PSI CONCRETE	4000 PSI CONCRETE	5000 PSI CONCRETE
#3	17	15	13	22	19	17	9	8	8
#4	22	19	17	29	25	22	11	10	9
#5	28	24	22	36	31	28	14	12	12
#6	33	29	26	43	37	33	17	15	14
#7	48	42	37	63	54	49	20	17	16
#8	55	48	43	72	62	55	22	19	18
#9	62	54	48	81	70	63	25	22	21
#10	70	61	54	91	79	70	28	25	23
#11	78	67	60	101	87	78	31	27	25


NOTES:  
1. TOP BARS ARE HORIZONTAL REINFORCEMENT PLACED SO THAT MORE THAN 12" OF FRESH CONCRETE IS CAST IN THE MEMBER BELOW THE REINFORCEMENT.  
2. LAP SPlice LENGTHS ARE BASED ON BARS SPACED AT (2) BAR DIAMETERS OR MORE ON CENTER W/ (1) BARS DIAMETER MINIMUM ON CONCRETE COVER. NOTIFY ENGINEER IF SPACING IS LESS THAN (2) BAR DIAMETERS.

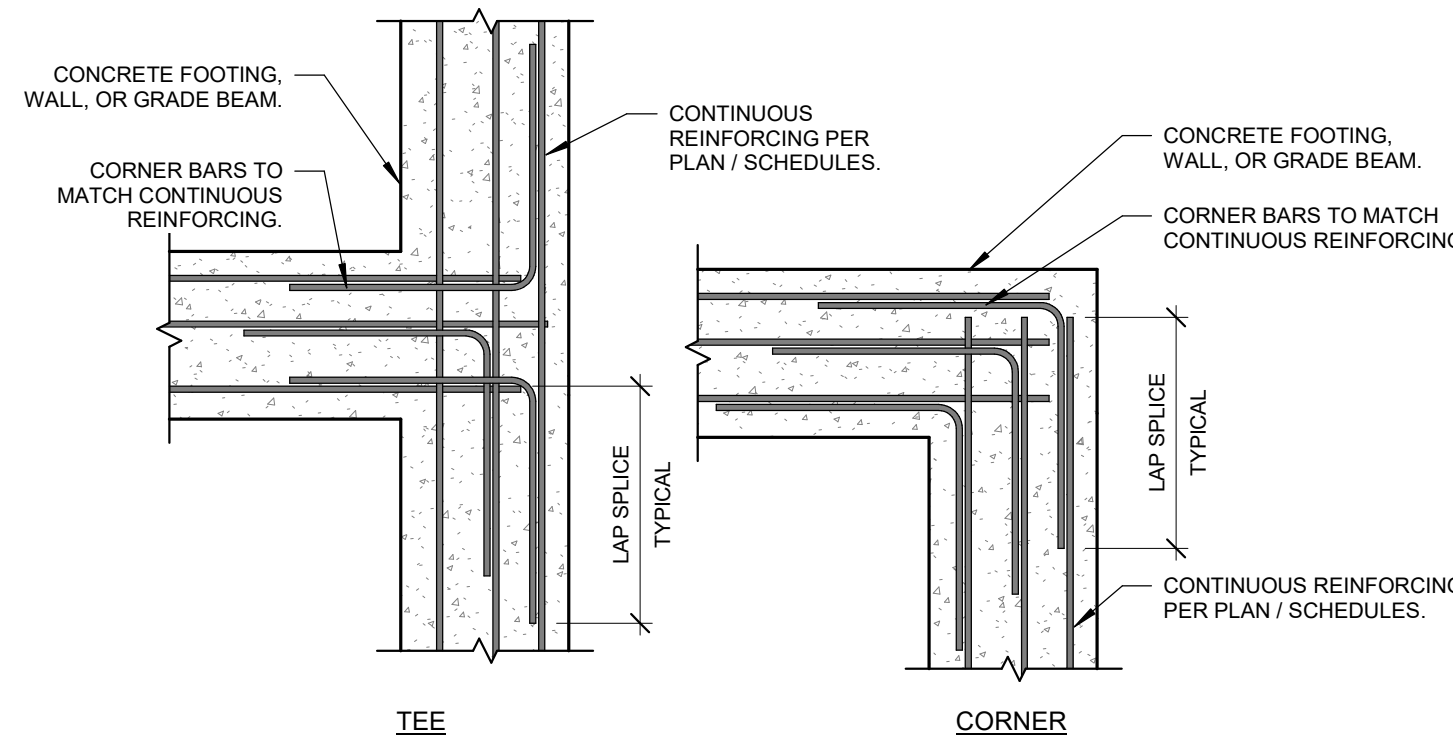

2 TYPICAL CORNER BAR REINFORCING  
3/4" = 1'-0"

BAR SIZE	LAP SPlice LENGTHS (INCHES)								
	TENSION (CLASS B SPlice)						COMPRESSION		
	OTHER BARS			TOP BARS					
	3000 PSI CONCRETE	4000 PSI CONCRETE	5000 PSI CONCRETE	3000 PSI CONCRETE	4000 PSI CONCRETE	5000 PSI CONCRETE	3000 PSI CONCRETE	4000 PSI CONCRETE	5000 PSI CONCRETE
#3	22	19	17	28	24	22	12		
#4	29	25	22	37	32	29	15		
#5	36	31	28	47	40	36	19		
#6	43	37	33	56	48	43	23		
#7	63	54	49	81	70	63	27		
#8	72	62	55	93	80	72	30		
#9	81	70	63	105	91	81	34		
#10	91	79	70	118	102	91	38		
#11	101	87	78	131	113	101	43		


NOTES:  
1. TOP BARS ARE HORIZONTAL REINFORCEMENT PLACED SO THAT MORE THAN 12" OF FRESH CONCRETE IS CAST IN THE MEMBER BELOW THE REINFORCEMENT.  
2. LAP SPlice LENGTHS ARE BASED ON BARS SPACED AT (2) BAR DIAMETERS OR MORE ON CENTER W/ (1) BAR DIAMETER MINIMUM OF CONCRETE COVER. NOTIFY ENGINEER IF SPACING IS LESS THAN (2) BAR DIAMETERS.

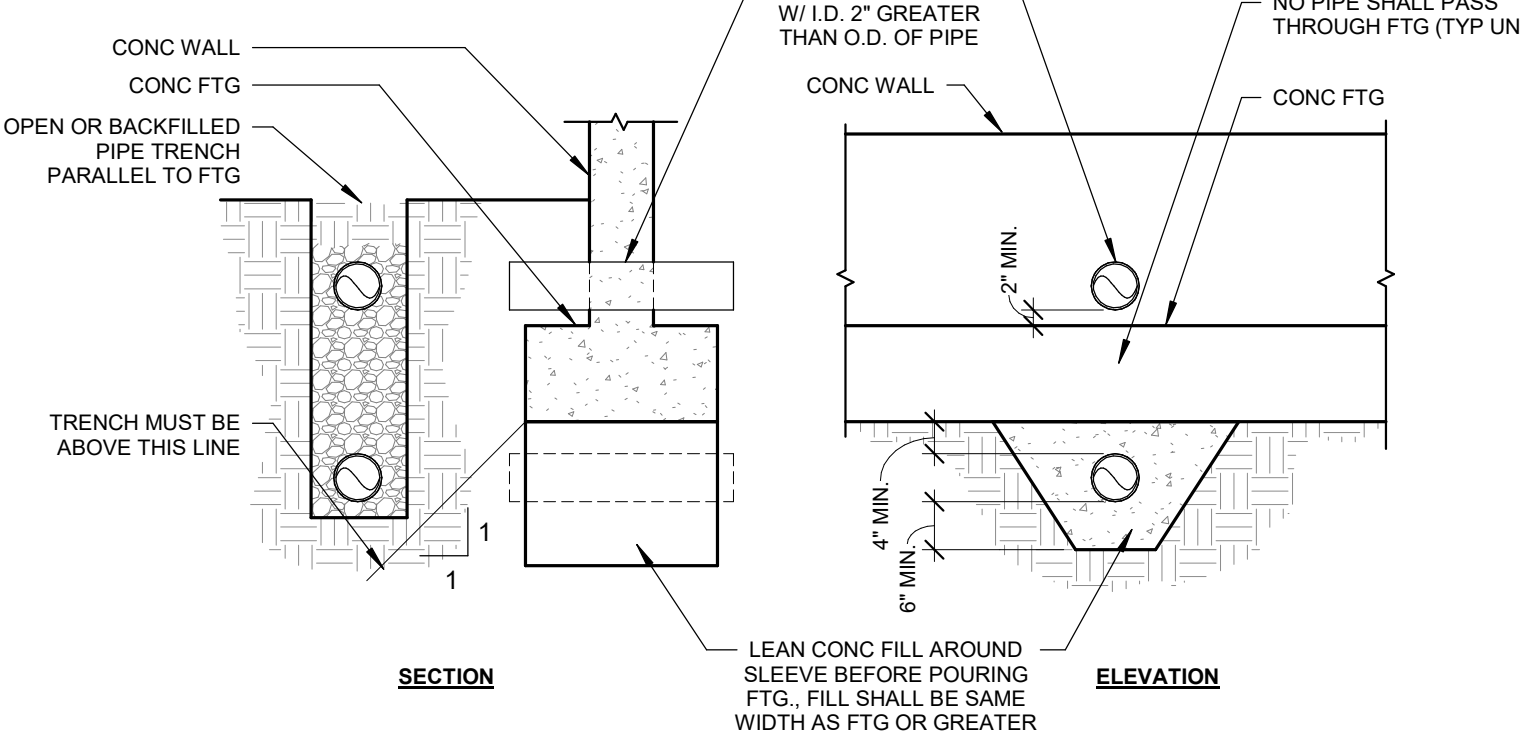


3 PIPE PENETRATION DETAIL  
1/2" = 1'-0"

BAR SIZE	HOOKED DOWEL DEVELOPMENT LENGTHS IN TENSION (INCHES)					
	EMBEDMENT			EXTENSION		MINIMUM RADIUS OF BEND (INCHES)
	3000 PSI CONCRETE	4000 PSI CONCRETE	5000 PSI CONCRETE	90 DEG HOOK	180 DEG HOOK	
#3	8	7	6	4.5	2.5	1.50
#4	11	9	8	6.0	2.5	2.00
#5	14	12	11	7.5	2.5	2.50
#6	16	14	13	9.0	3.0	3.00
#7	19	17	15	10.5	3.5	3.50
#8	22	19	17	12.0	4.0	4.00
#9	25	21	19	13.5	4.5	5.64
#10	28	24	22	15.2	5.1	6.35
#11	31	27	24	16.9	5.6	7.05


NOTES:  
RADIUS OF BEND  
EXTENSION  
90 DEG HOOK  
RADIUS OF BEND  
EXTENSION  
180 DEG HOOK

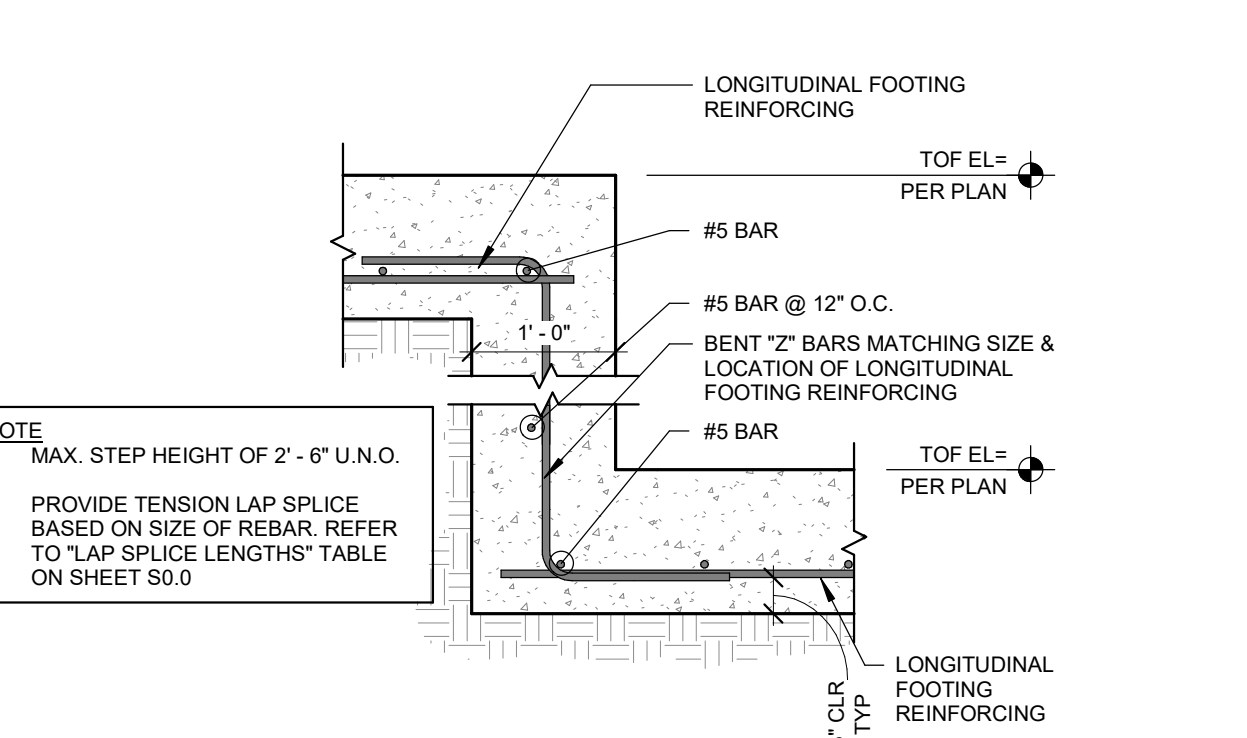


4 TYPICAL FOOTING STEP  
3/4" = 1'-0"

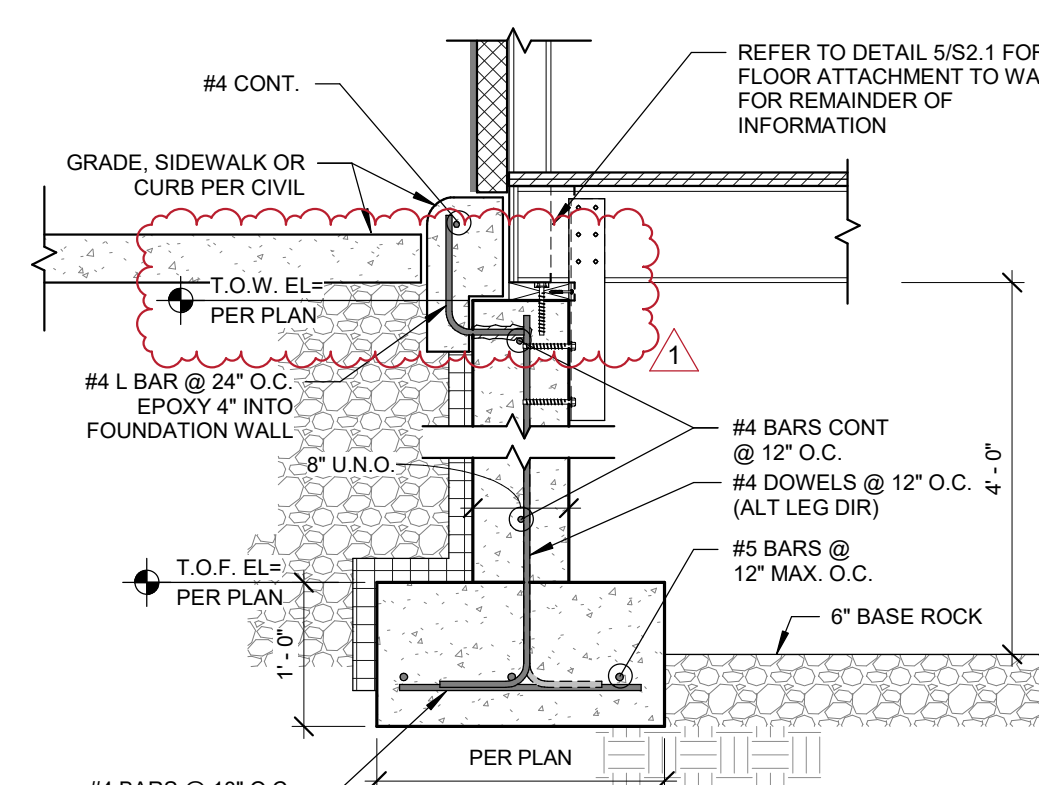


5 TYPICAL EXTERIOR STEM WALL  
3/4" = 1'-0"

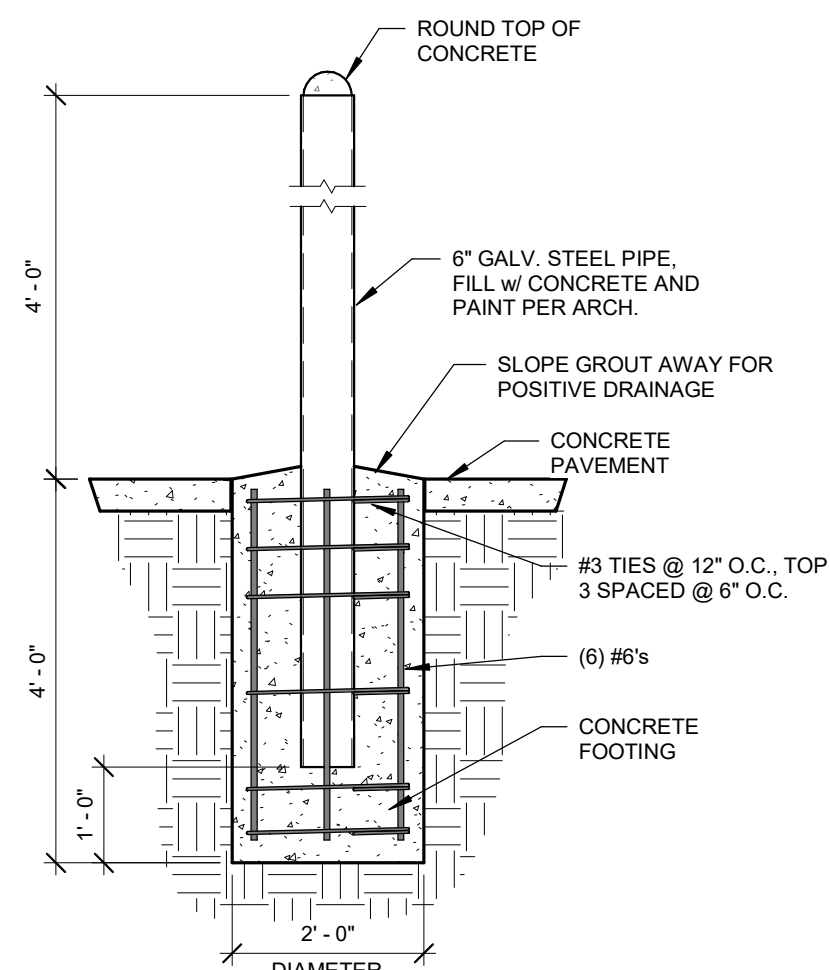


6 BOLLARD DETAIL  
1/2" = 1'-0"

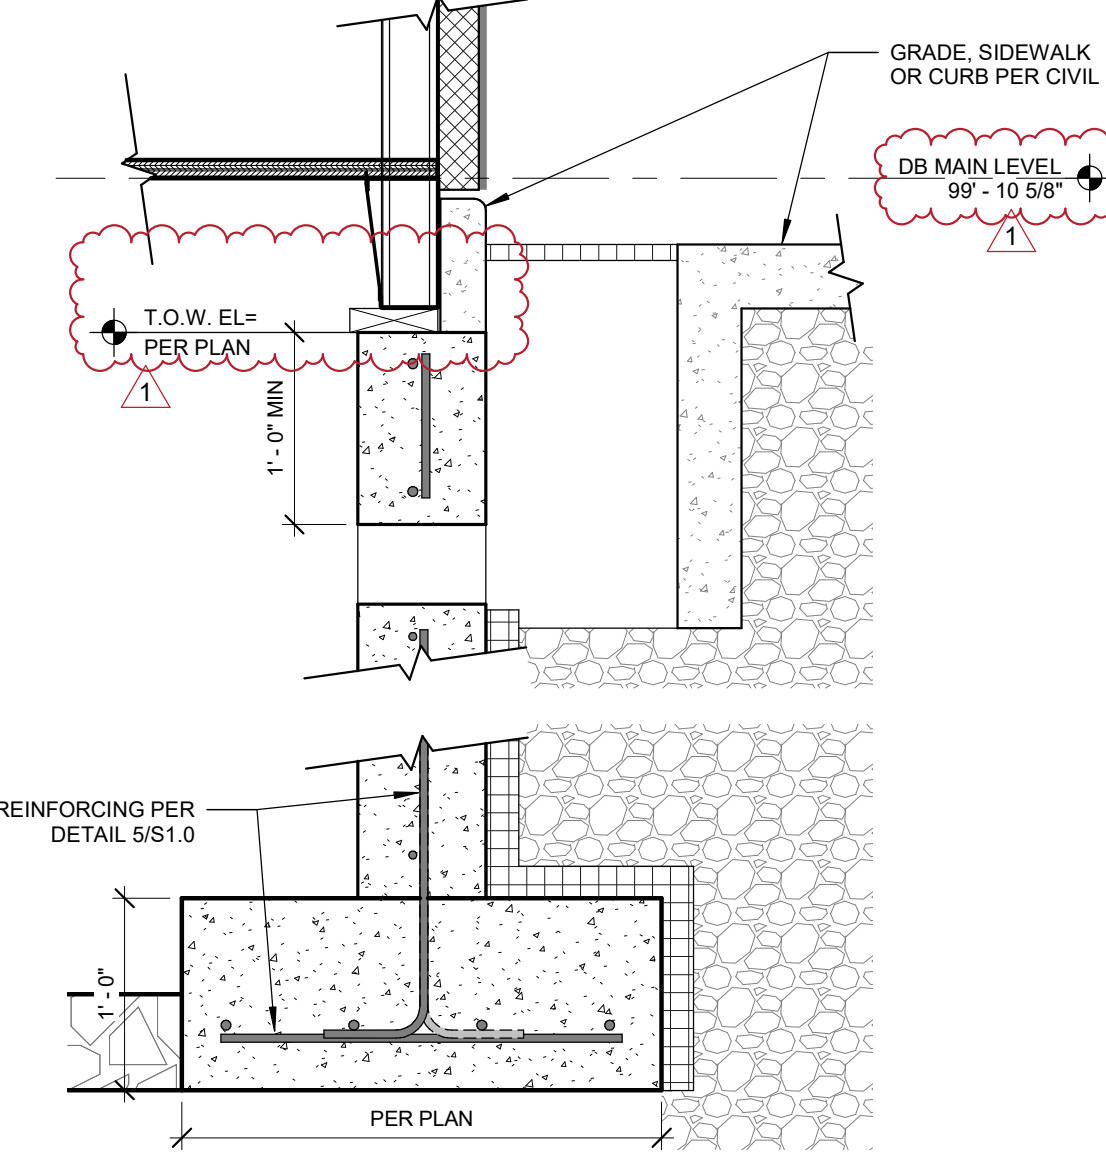


7 SECTION FOR CRAWSPACE VENT  
1" = 1'-0"

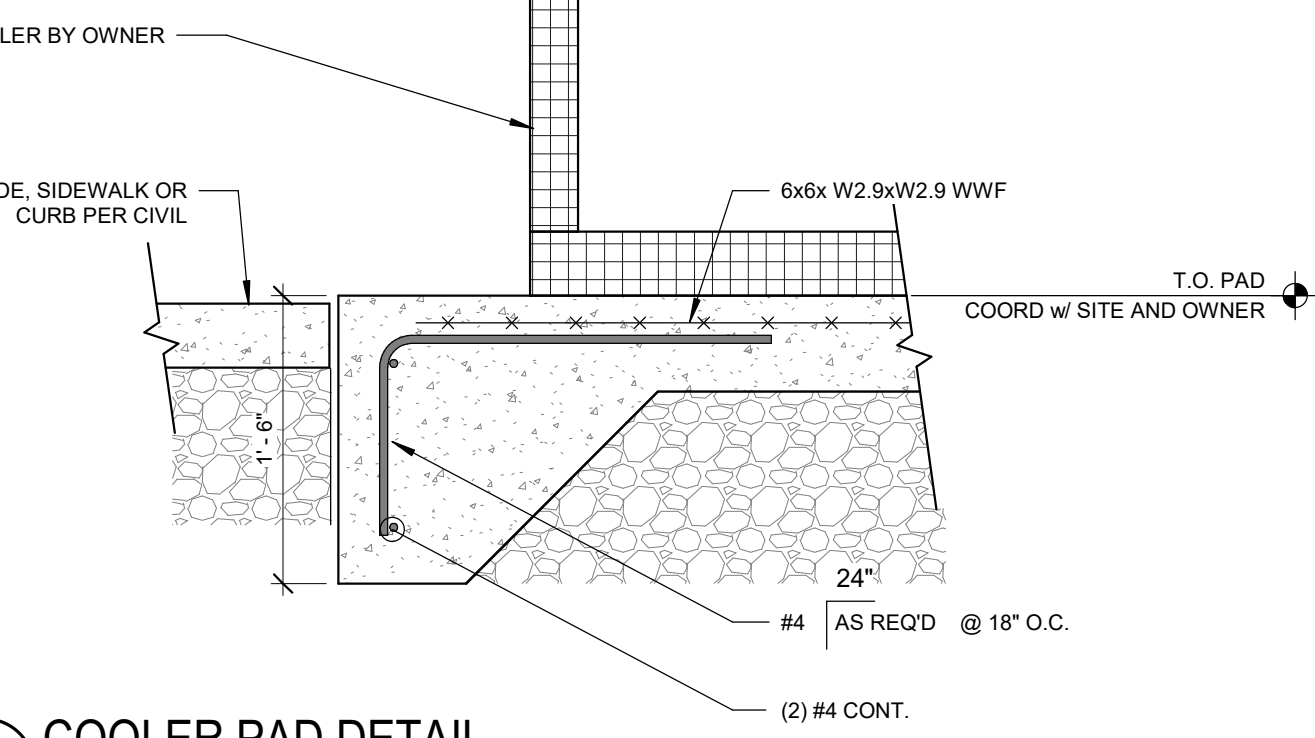


8 COOLER PAD DETAIL  
1" = 1'-0"

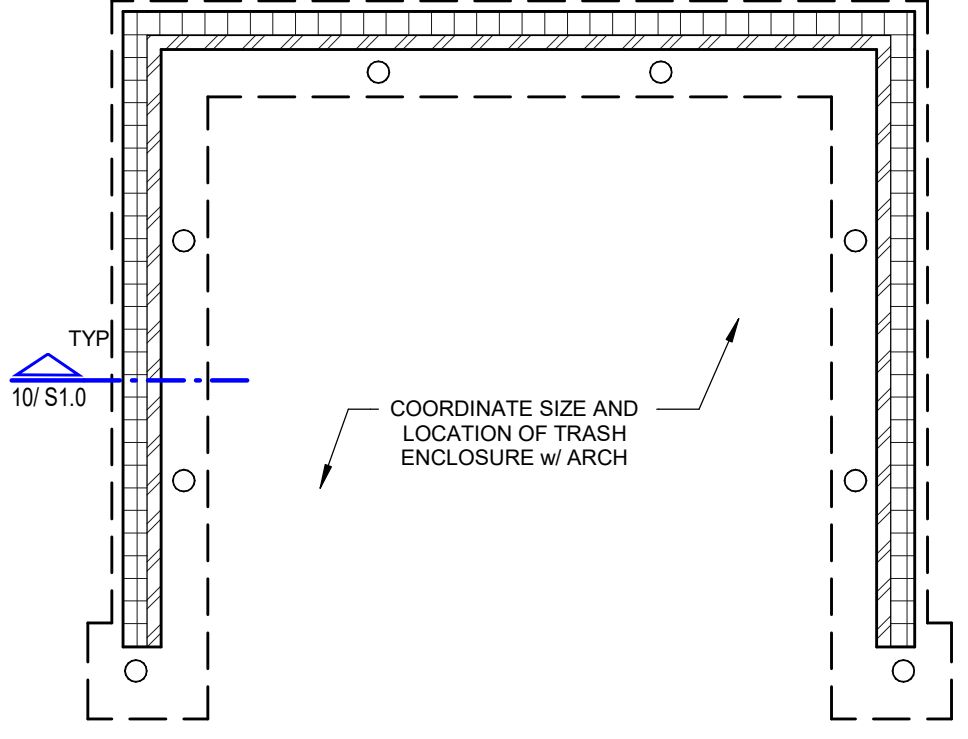

9 TRASH ENCLOSURE PLAN  
1/4" = 1'-0"

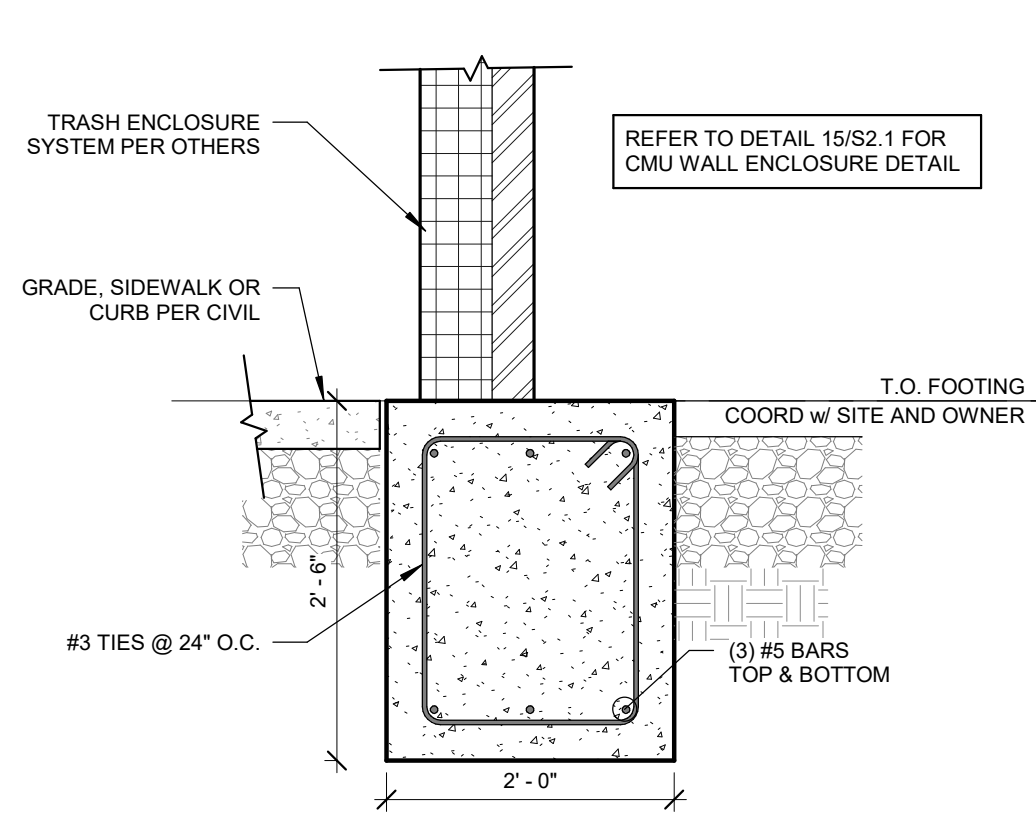


10 TRASH ENCLOSURE FOUNDATION  
3/4" = 1'-0"

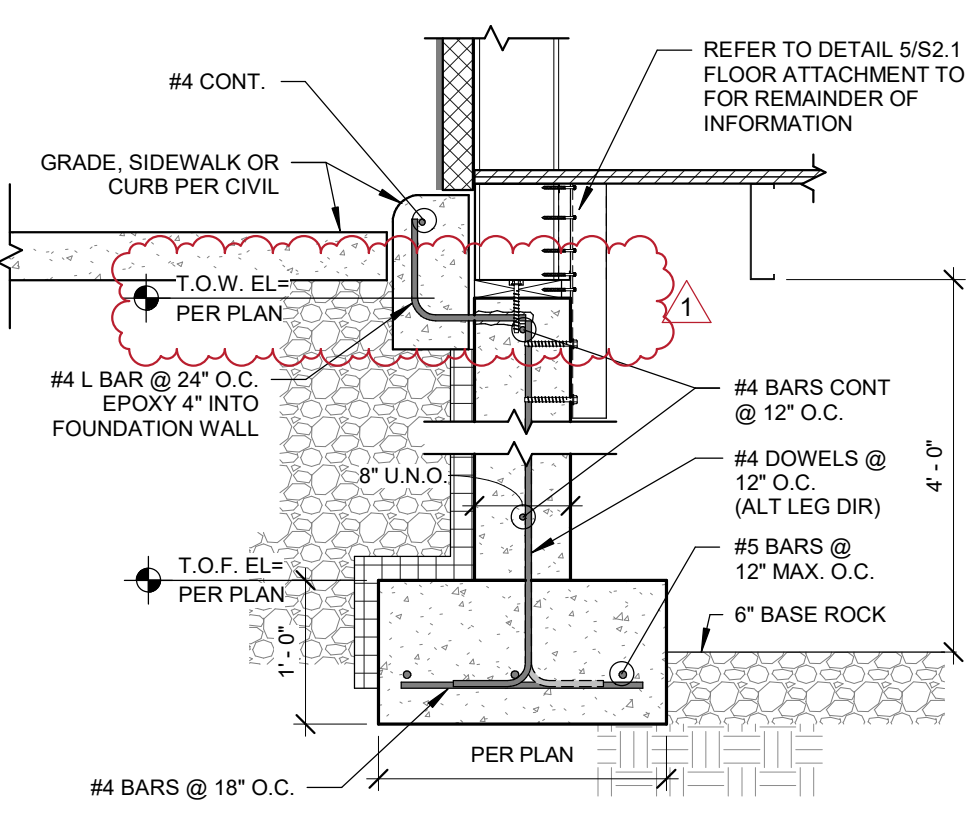


11 EXTERIOR STEM WALL NO OVERHANG  
3/4" = 1'-0"






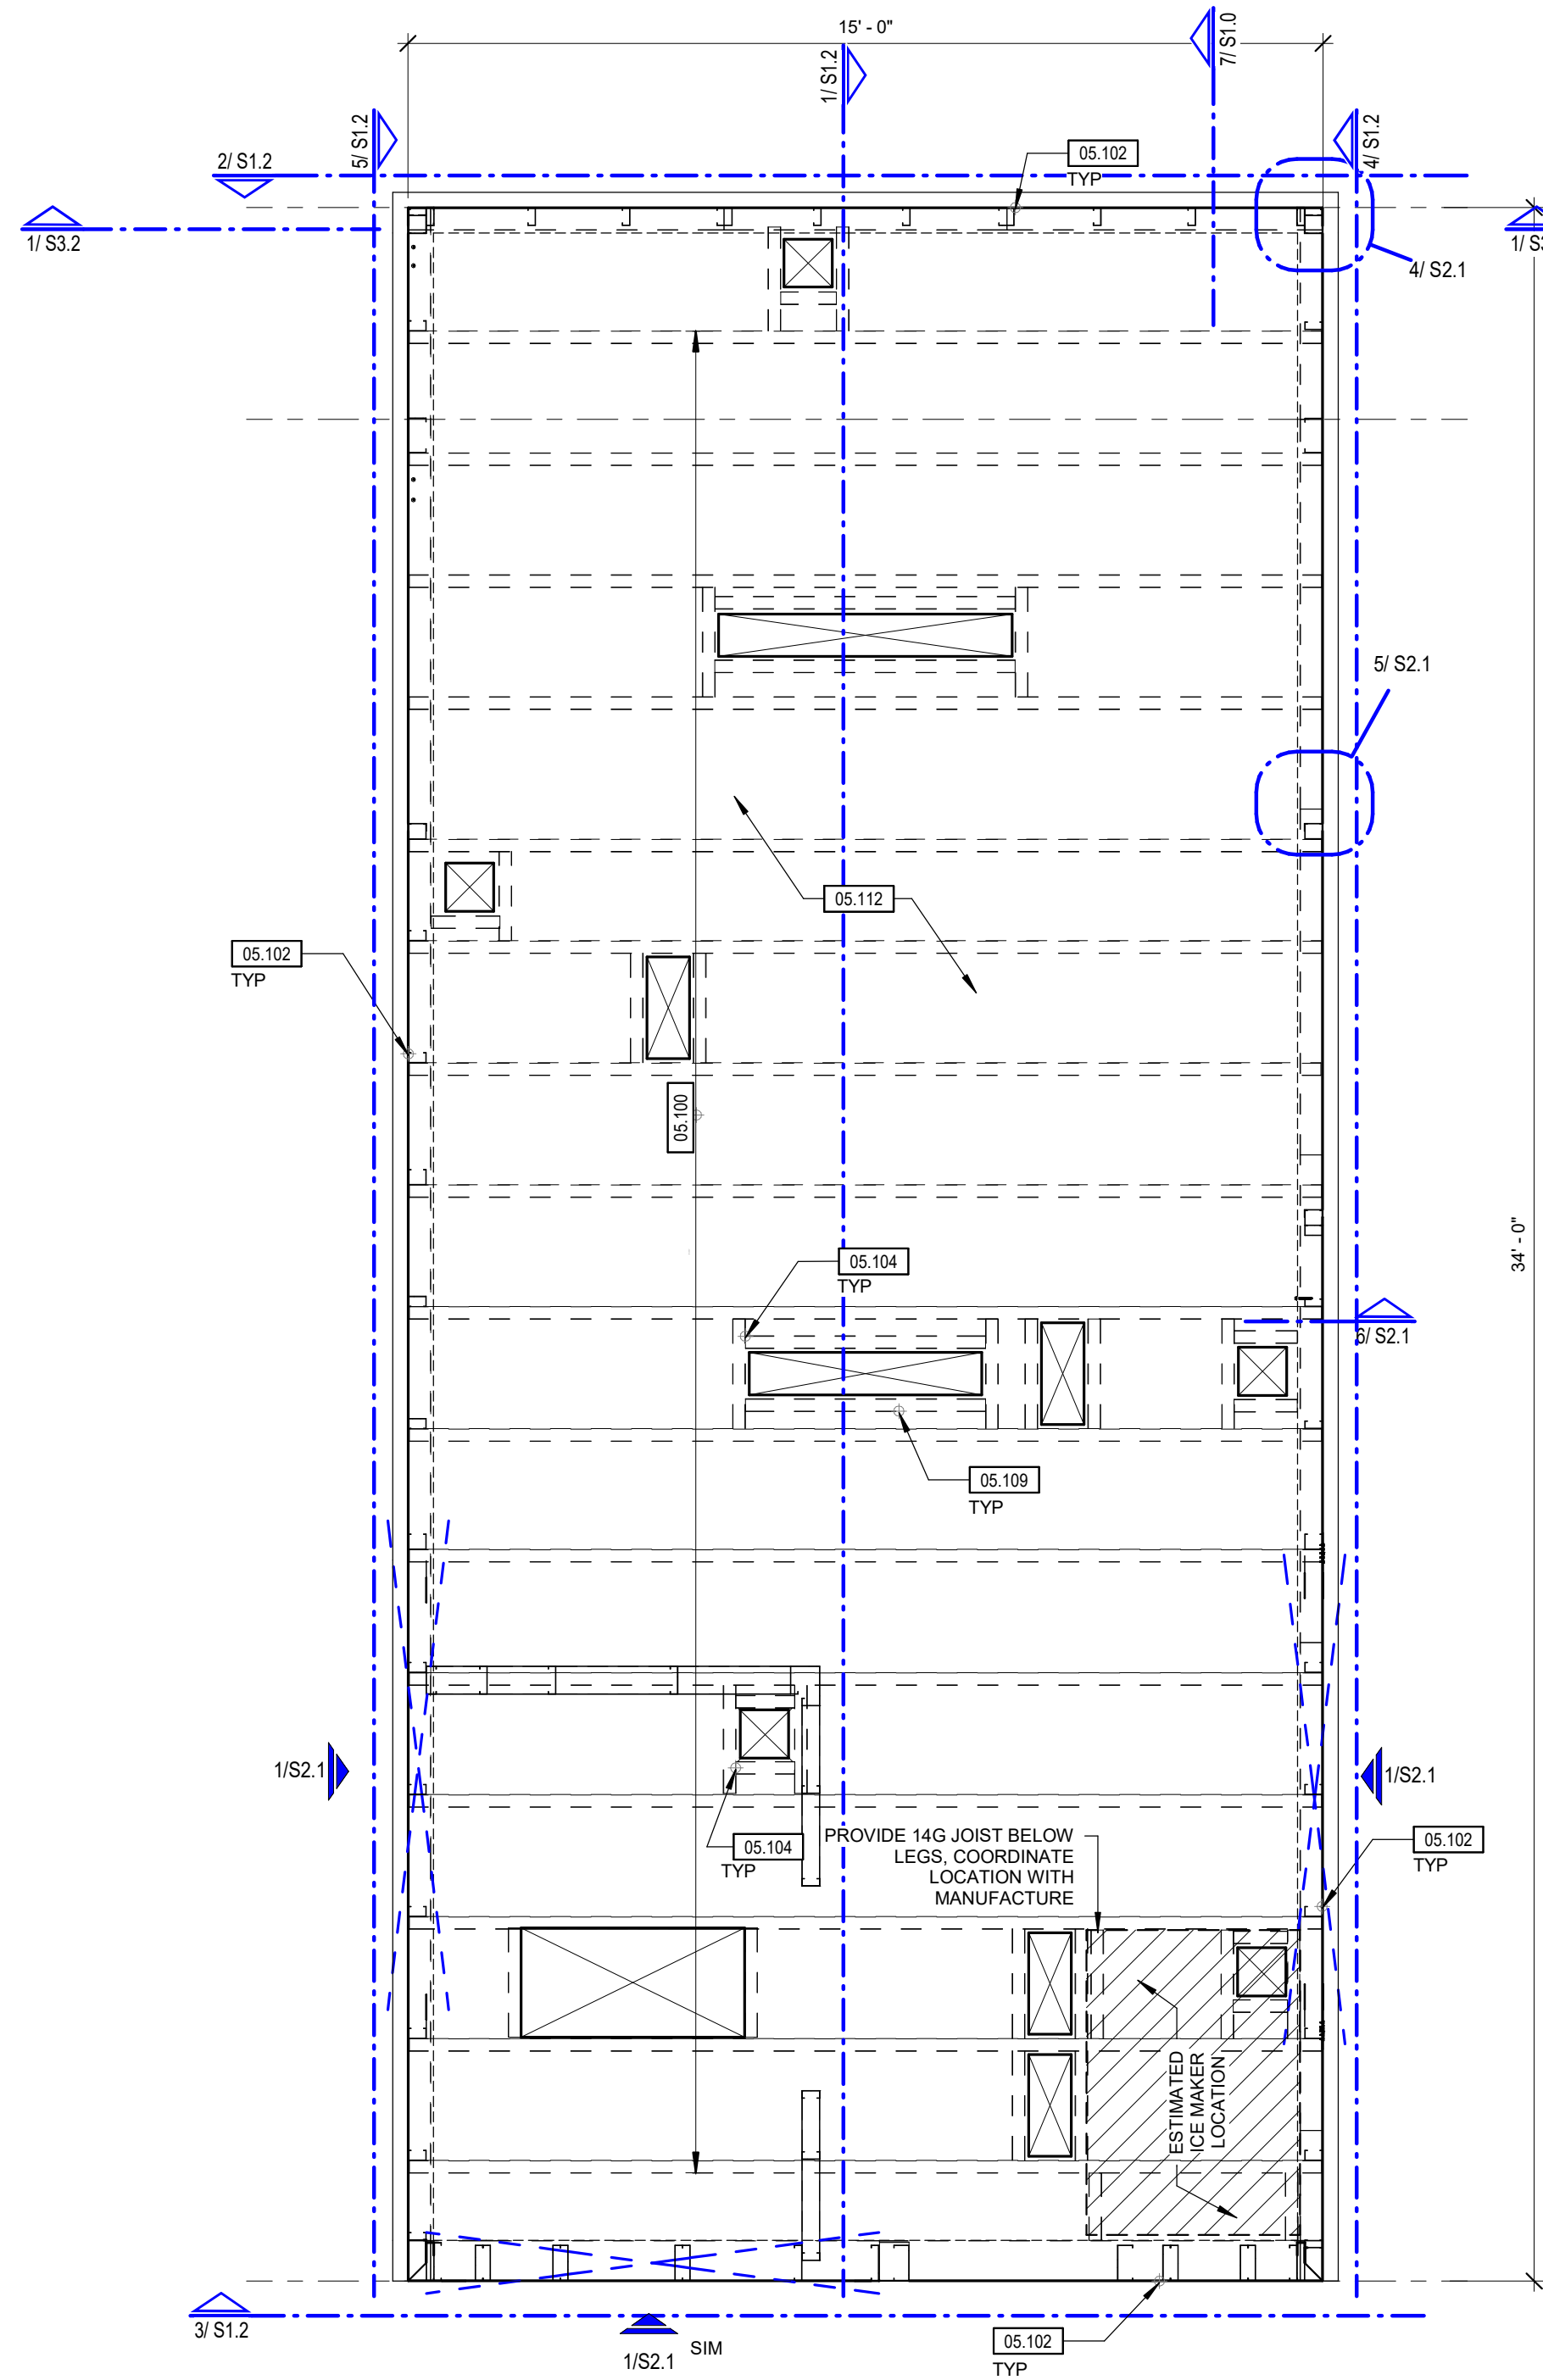

1 FLOOR PLAN  
3/8" = 1'-0"

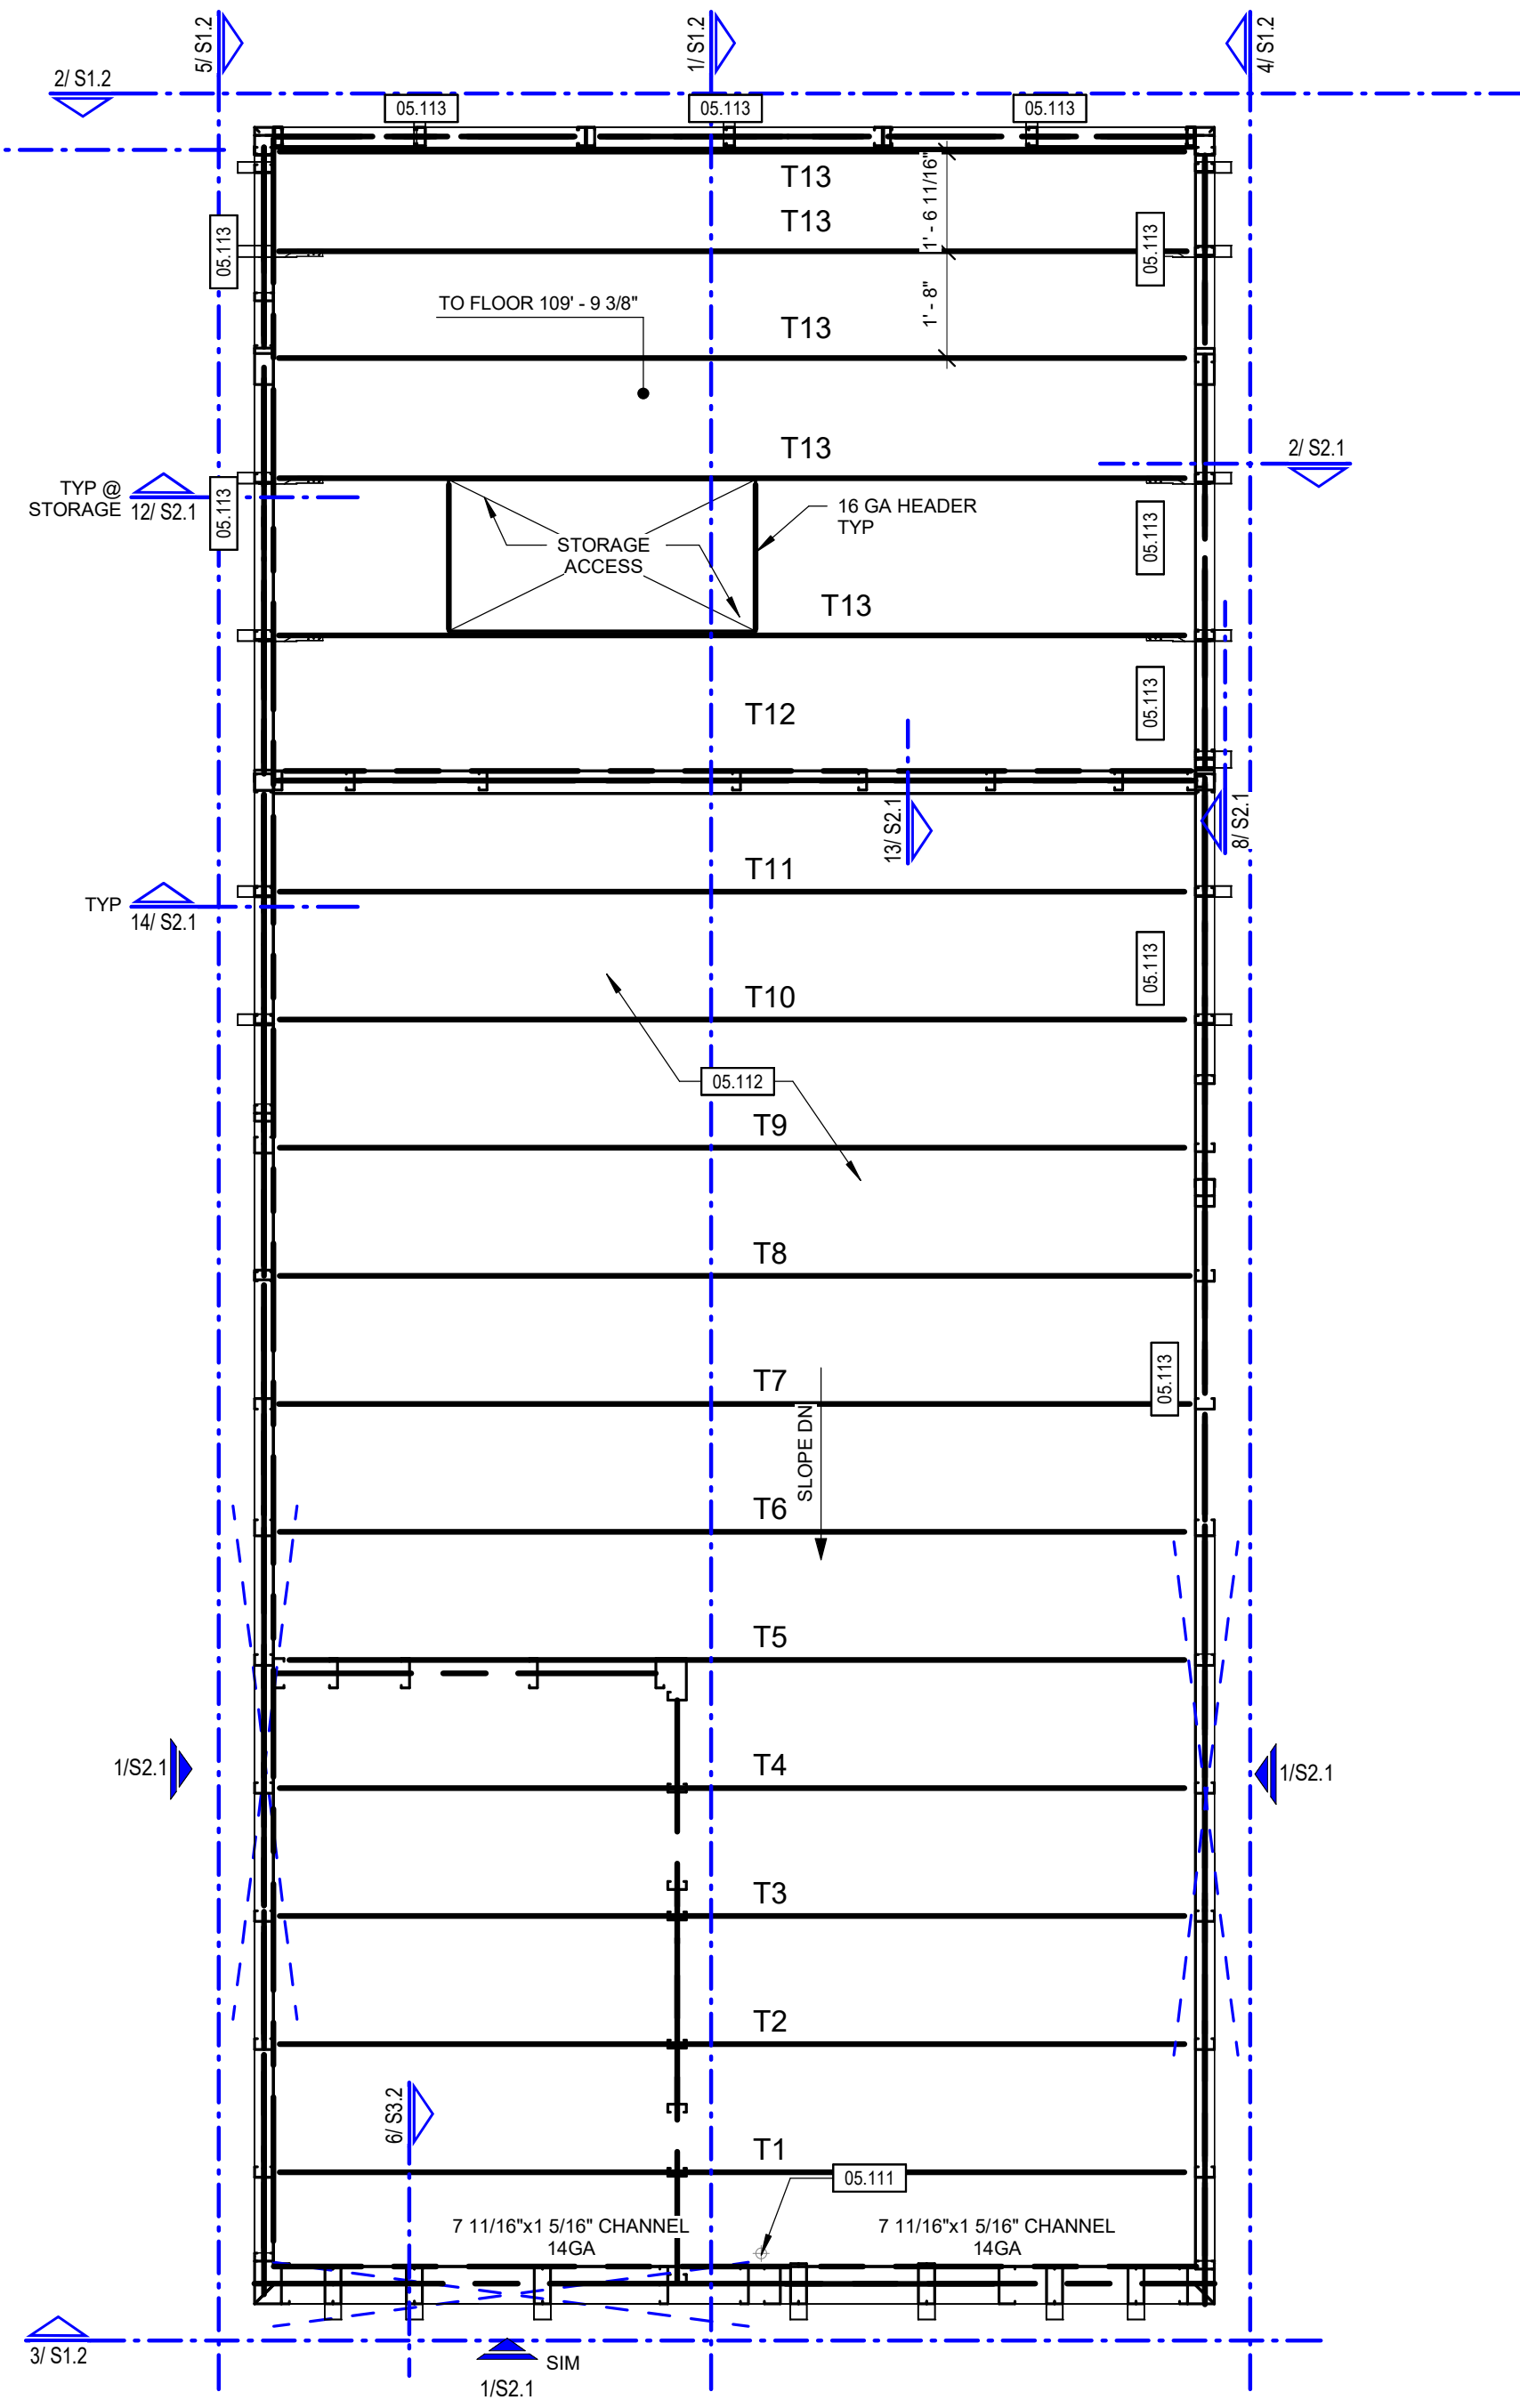

2 ROOF AND STORAGE  
3/8" = 1'-0"

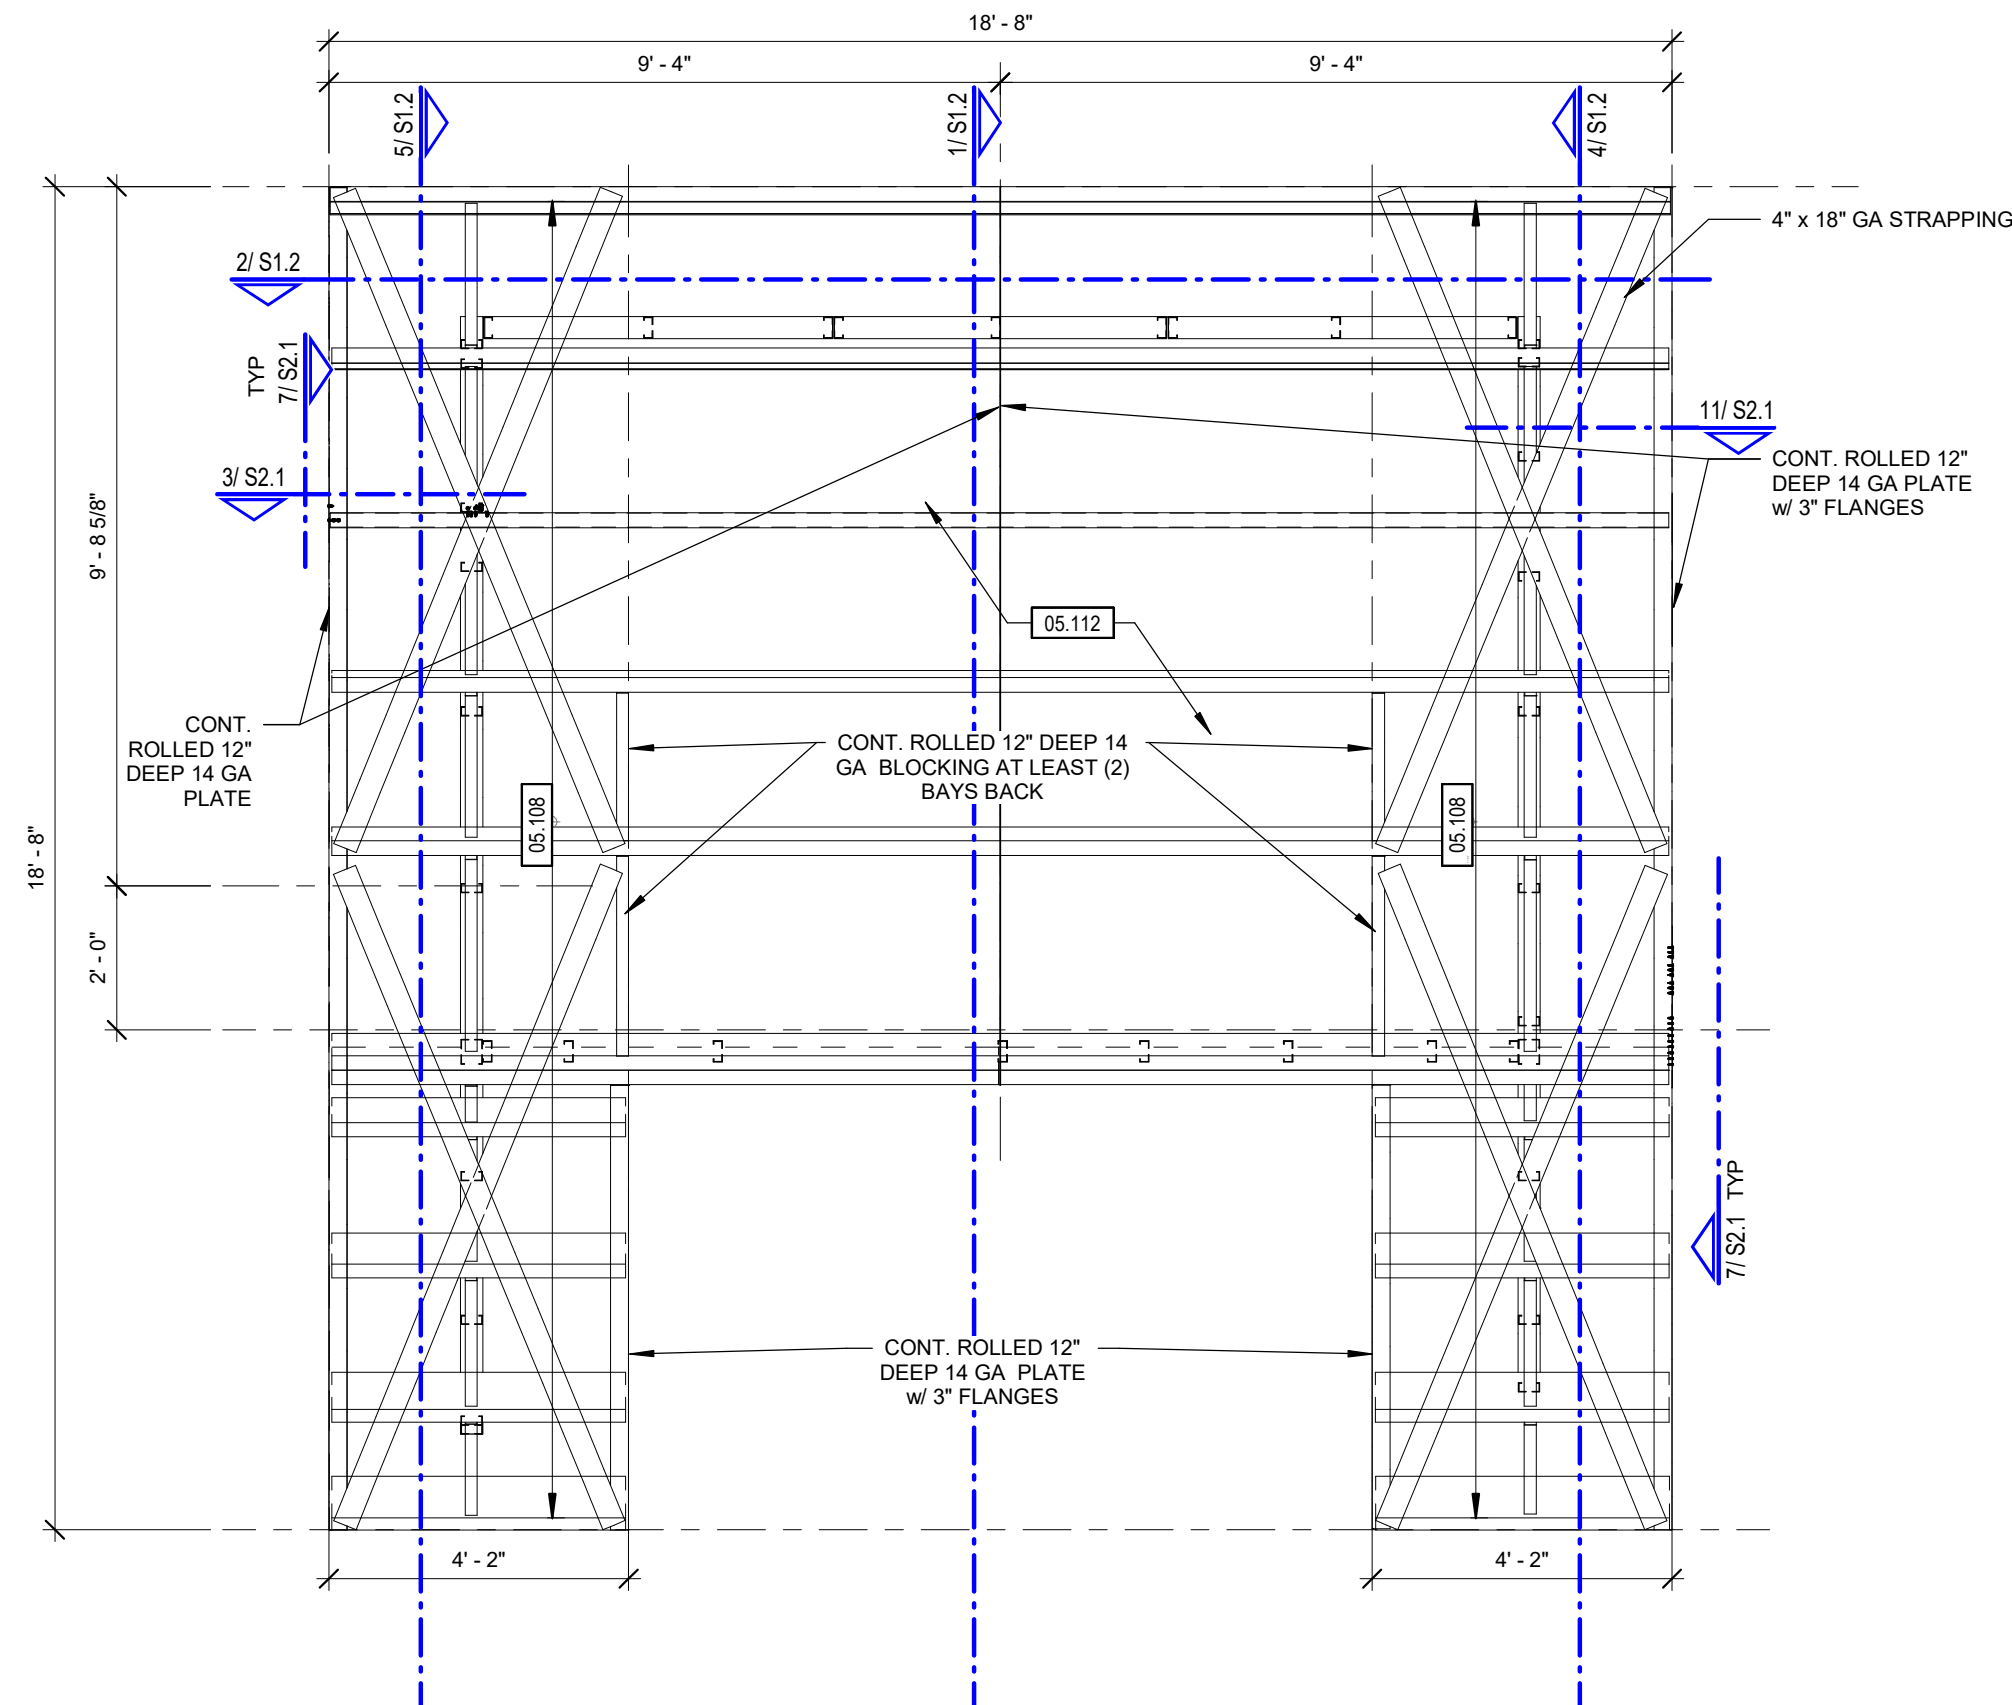

3 ARC ROOF CANOPY  
3/8" = 1'-0"

- PLAN NOTES - FRAMING**
- MECHANICAL EQUIPMENT WEIGHTS AND LOCATIONS ARE ESTIMATED ONLY. COORDINATE ALL RTU EQUIPMENT LOCATIONS AND CURBS WITH MEP AND ARCH.
  - COORDINATE ROOF OPENINGS WITH MEP AND ARCH. PROVIDE SUPPLEMENTAL FRAMING PER NOTES AND DETAILS AT OPENINGS.
  - MECHANICAL HANGERS AND OTHER ITEMS SUPPORTED FROM TRUSS FRAMING ARE TO BE SUPPORTED AT PANEL POINTS ONLY.
  - PROVIDE (2) 3/4" BOLTS AT EACH LIFTING POINT LOCATION.


KEYNOTE	DESCRIPTION
05.100	7.840" x 2 1/2" 14 GA FLOOR JOIST SPACING @ 24" O.C. MAX.
05.102	16 GA STUD WITH A TOP AND BOTTOM 16 GA TRACK WITH 2" VERTICAL LEGS
05.104	12 GA CLIP
05.108	12" x 2 1/2" 14 GA ROOF JOIST SPACED @ 24" O.C. MAX.
05.109	PROVIDE FLOOR JOIST BOX FRAME AT ALL OPENINGS, MATCH GA OF FLOOR JOIST.
05.111	18 1/8" x 2 1/2" 14 GA JOIST, @ ROOF DECK BEARING.
05.112	ALL EXACT MEMBER SIZES PER MODULAR BUILDING SUPPLIERS ENGINEERING.
05.113	HEADER PER MODULAR BUILDING SUPPLIERS ENGINEERING.

THESE DRAWINGS INDICATE THE GENERAL REQUIREMENTS FOR A CUSTOM FABRICATED STRUCTURAL SYSTEM, BY CREATIVE MODULAR CONSTRUCTION








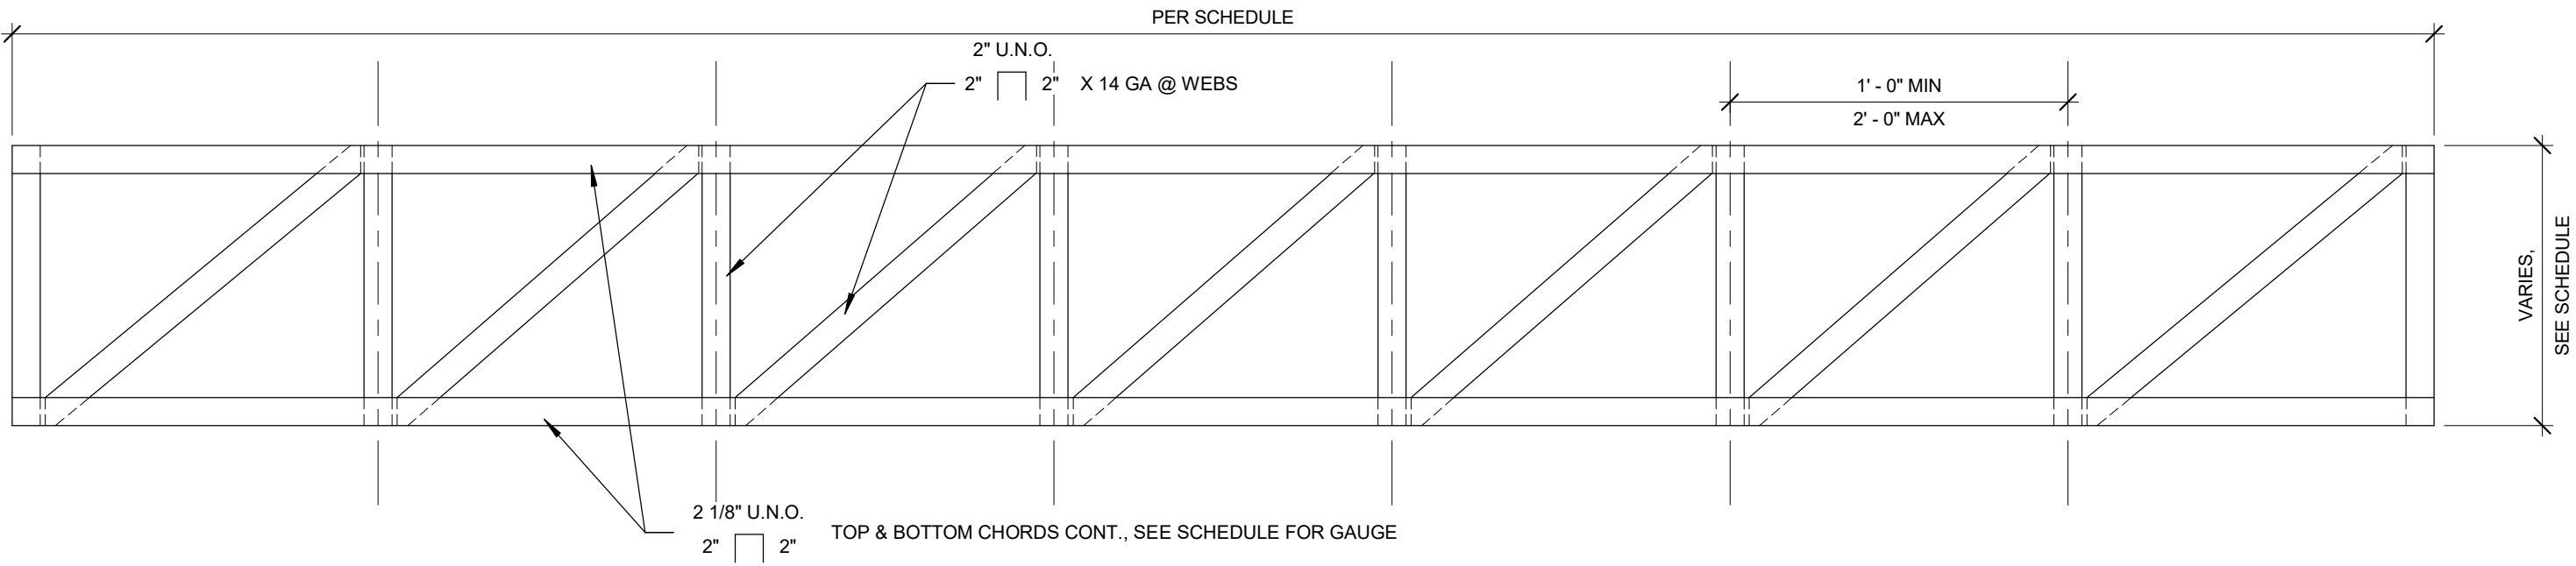


TRUSS	DEPTH	WEB WIDTH	LENGTH	CHORD GAUGE
T1	18 9/16"	2.5"	14' - 4 5/8"	14
T2	19 3/16"	2.5"	14' - 4 5/8"	14
T3	19 13/16"	2.5"	14' - 4 5/8"	14
T4	20 7/16"	2.5"	14' - 4 5/8"	14
T5	21 1/16"	2.5"	14' - 4 5/8"	14
T6	21 11/16"	2.5"	14' - 4 5/8"	14
T7	22 5/16"	2.5"	14' - 4 5/8"	14
T8	22 15/16"	2.5"	14' - 4 5/8"	14
T9	23 1/2"	2.5"	14' - 4 5/8"	14
T10	24 1/8"	2.5"	14' - 4 5/8"	14
T11	24 3/4"	2.5"	14' - 4 5/8"	14
T12	25 3/8"	2.5"	14' - 4 5/8"	14
T13	16"	2.5"	14' - 11 3/4"	14


1 TYPICAL LONG TRUSS ELEVATION  
1" = 1'-0"

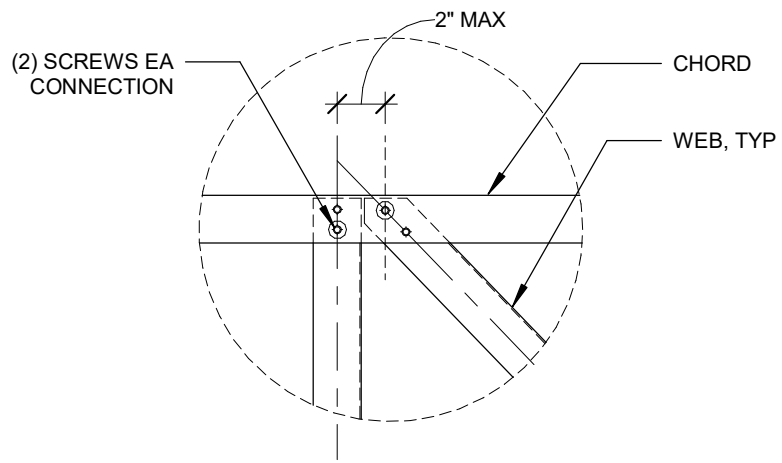

2 TYPICAL TRUSS MEMBER CONNECTION  
1 1/2" = 1'-0"

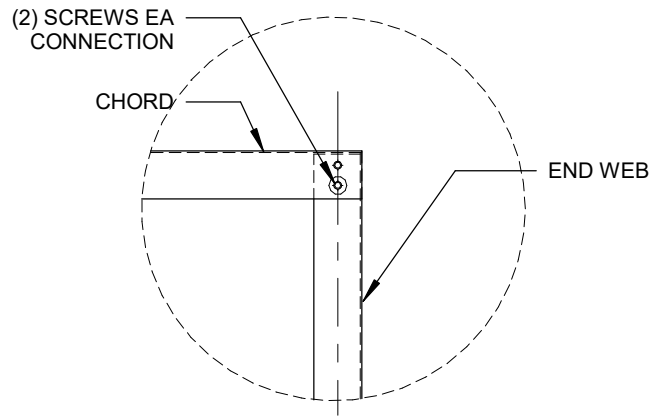

3 TYPICAL TRUSS END MEMBER CONNECTION  
1 1/2" = 1'-0"

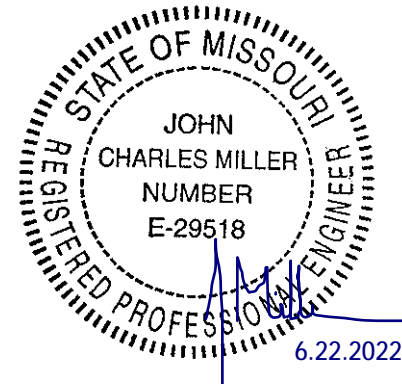

ENGINEER OF RECORD:  
JOHN C. MILLER  
E-29518  
E-2011011004


PROJECT NUMBER:  
22033 7BLS

REVISION:









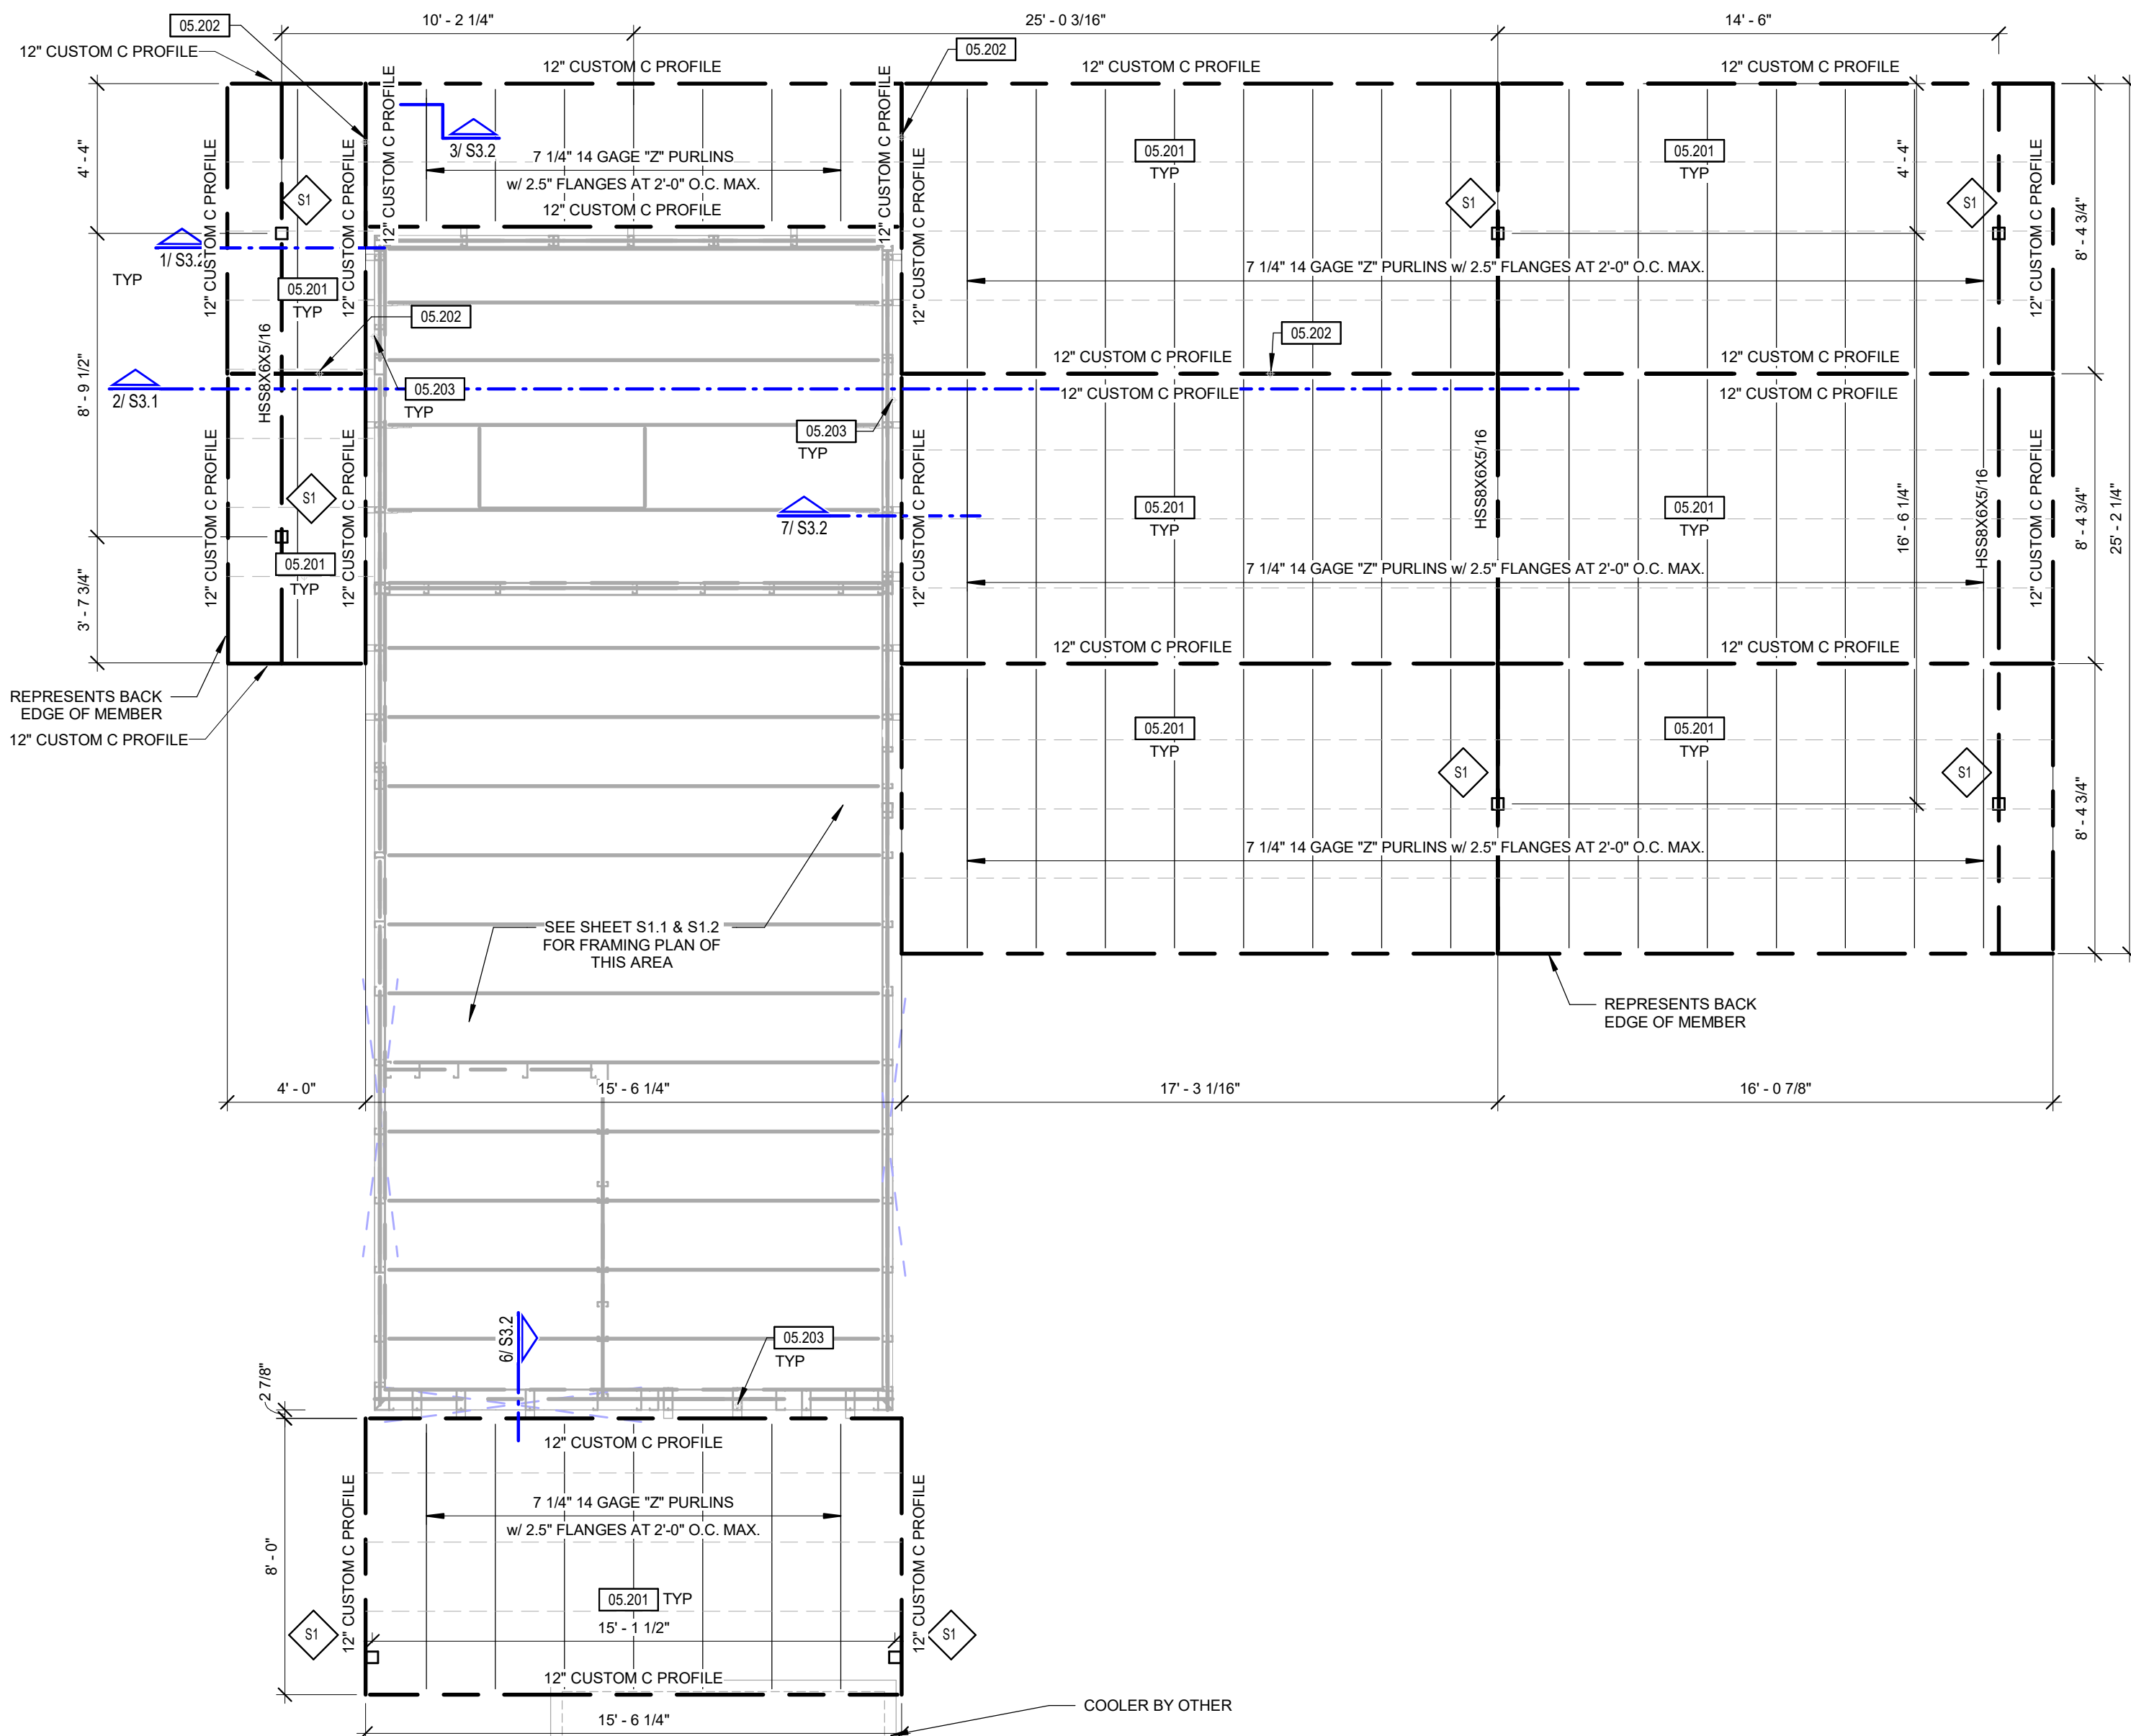

1 ROOF AND STORAGE WITH BASE CANOPY ADDITION  
1/4" = 1'-0"

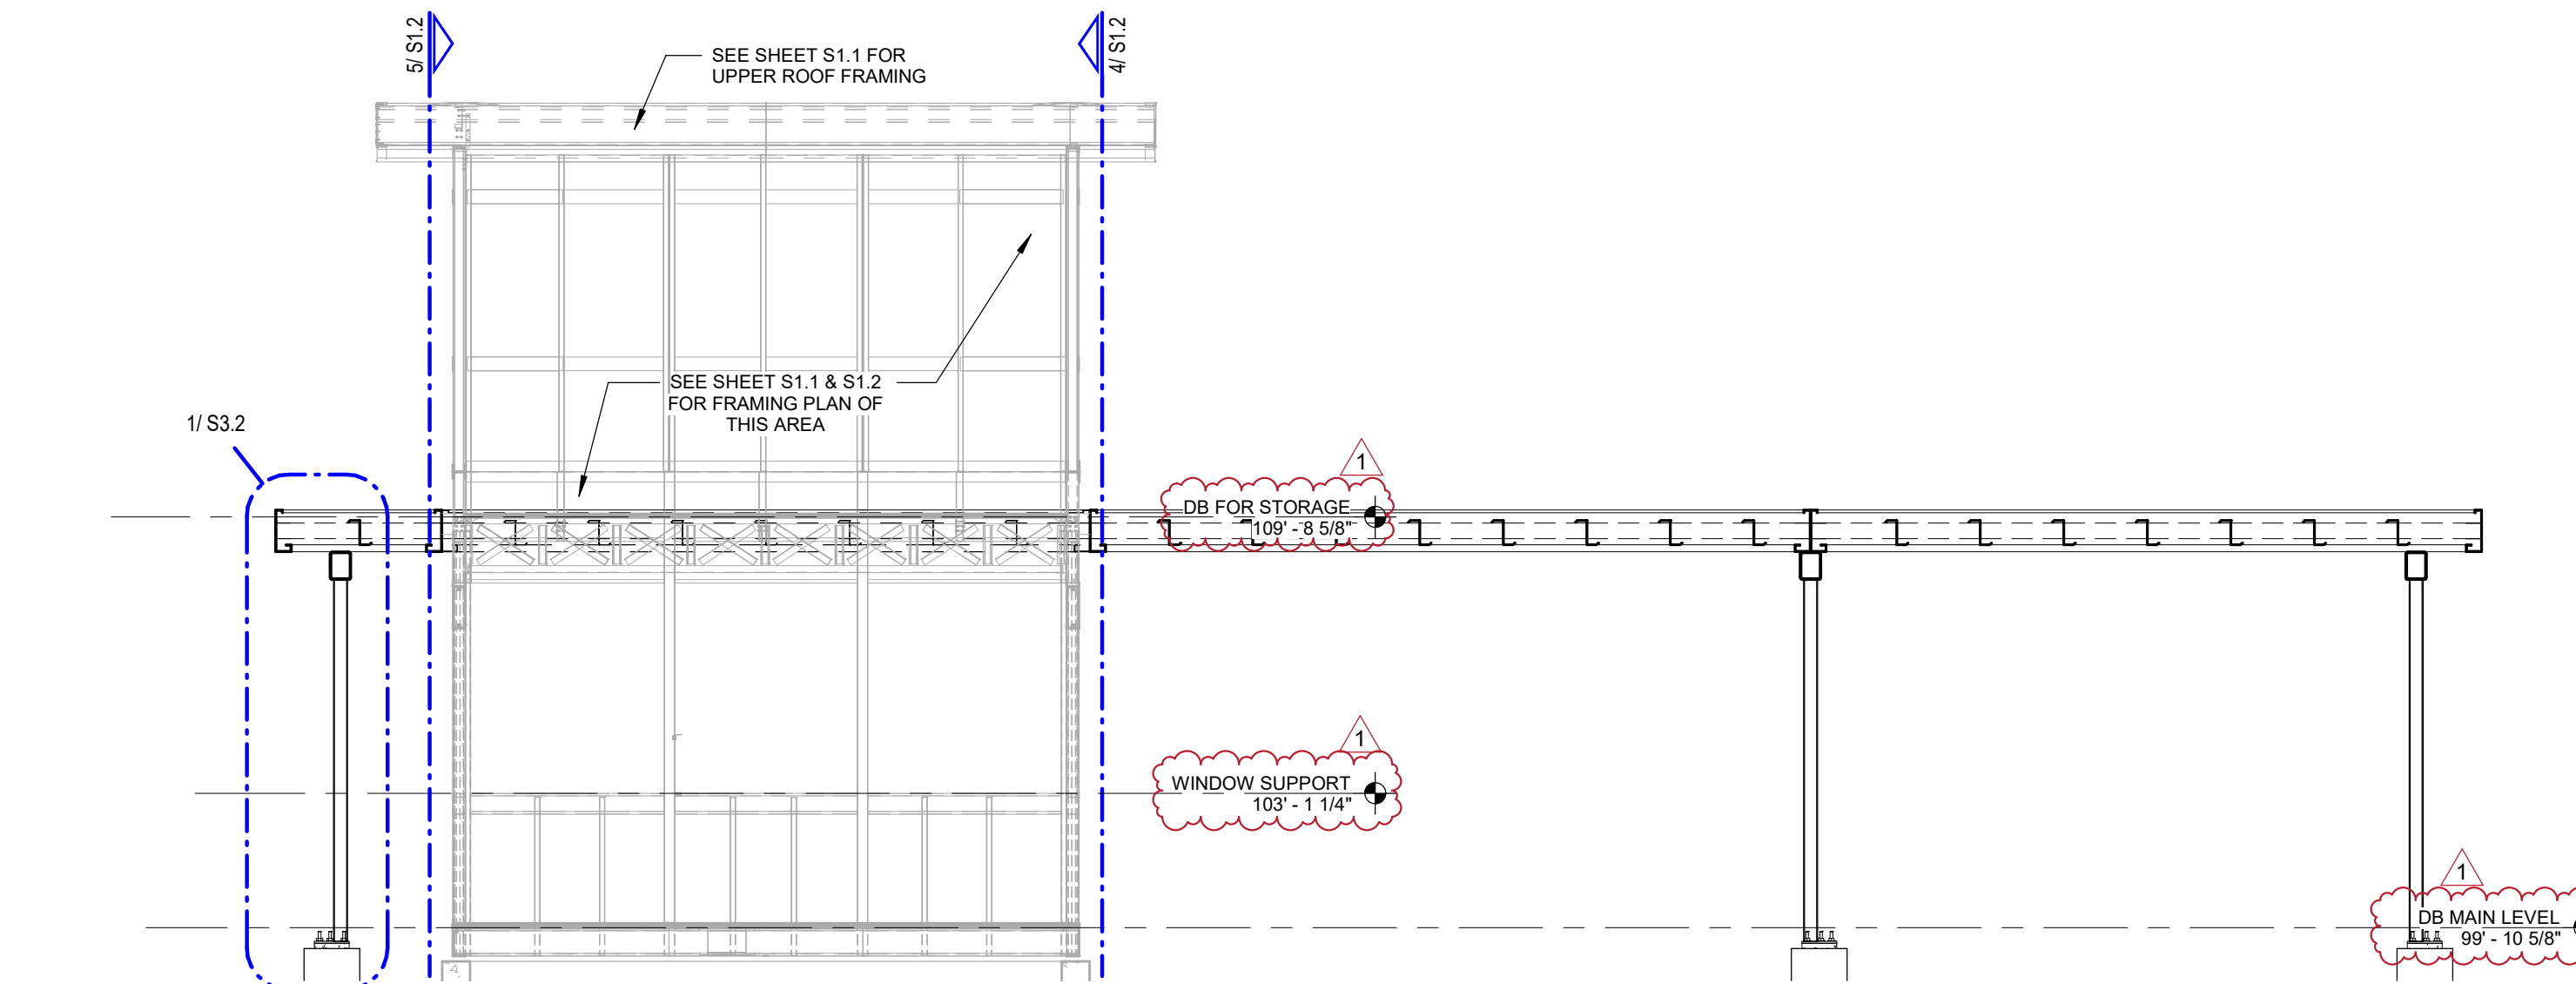


2 CROSS SECTION WITH CANOPY  
1/4" = 1'-0"

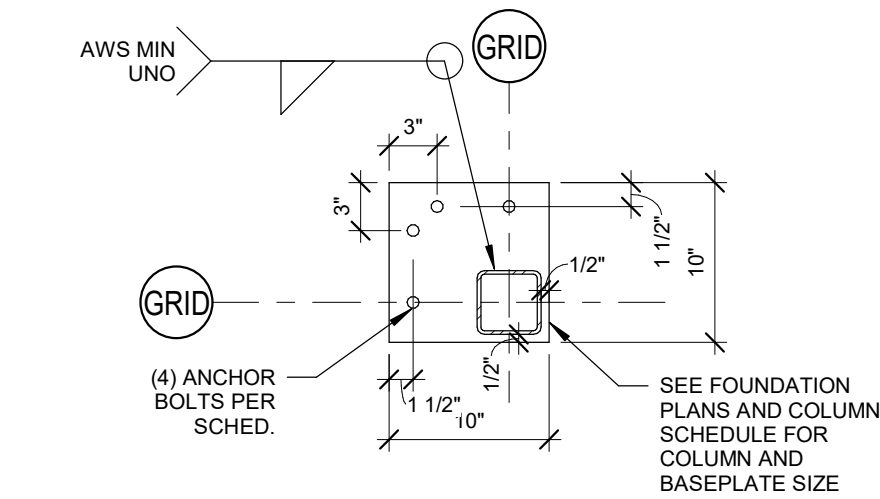

CANOPY BASEPLATE

ISOMETRIC VIEWS FOR REFERENCE ONLY

COORDINATE EXACT SIZE AND SHAPE OF  
CANOPY WITH OWNER AND CANOPY  
SUPPLIER

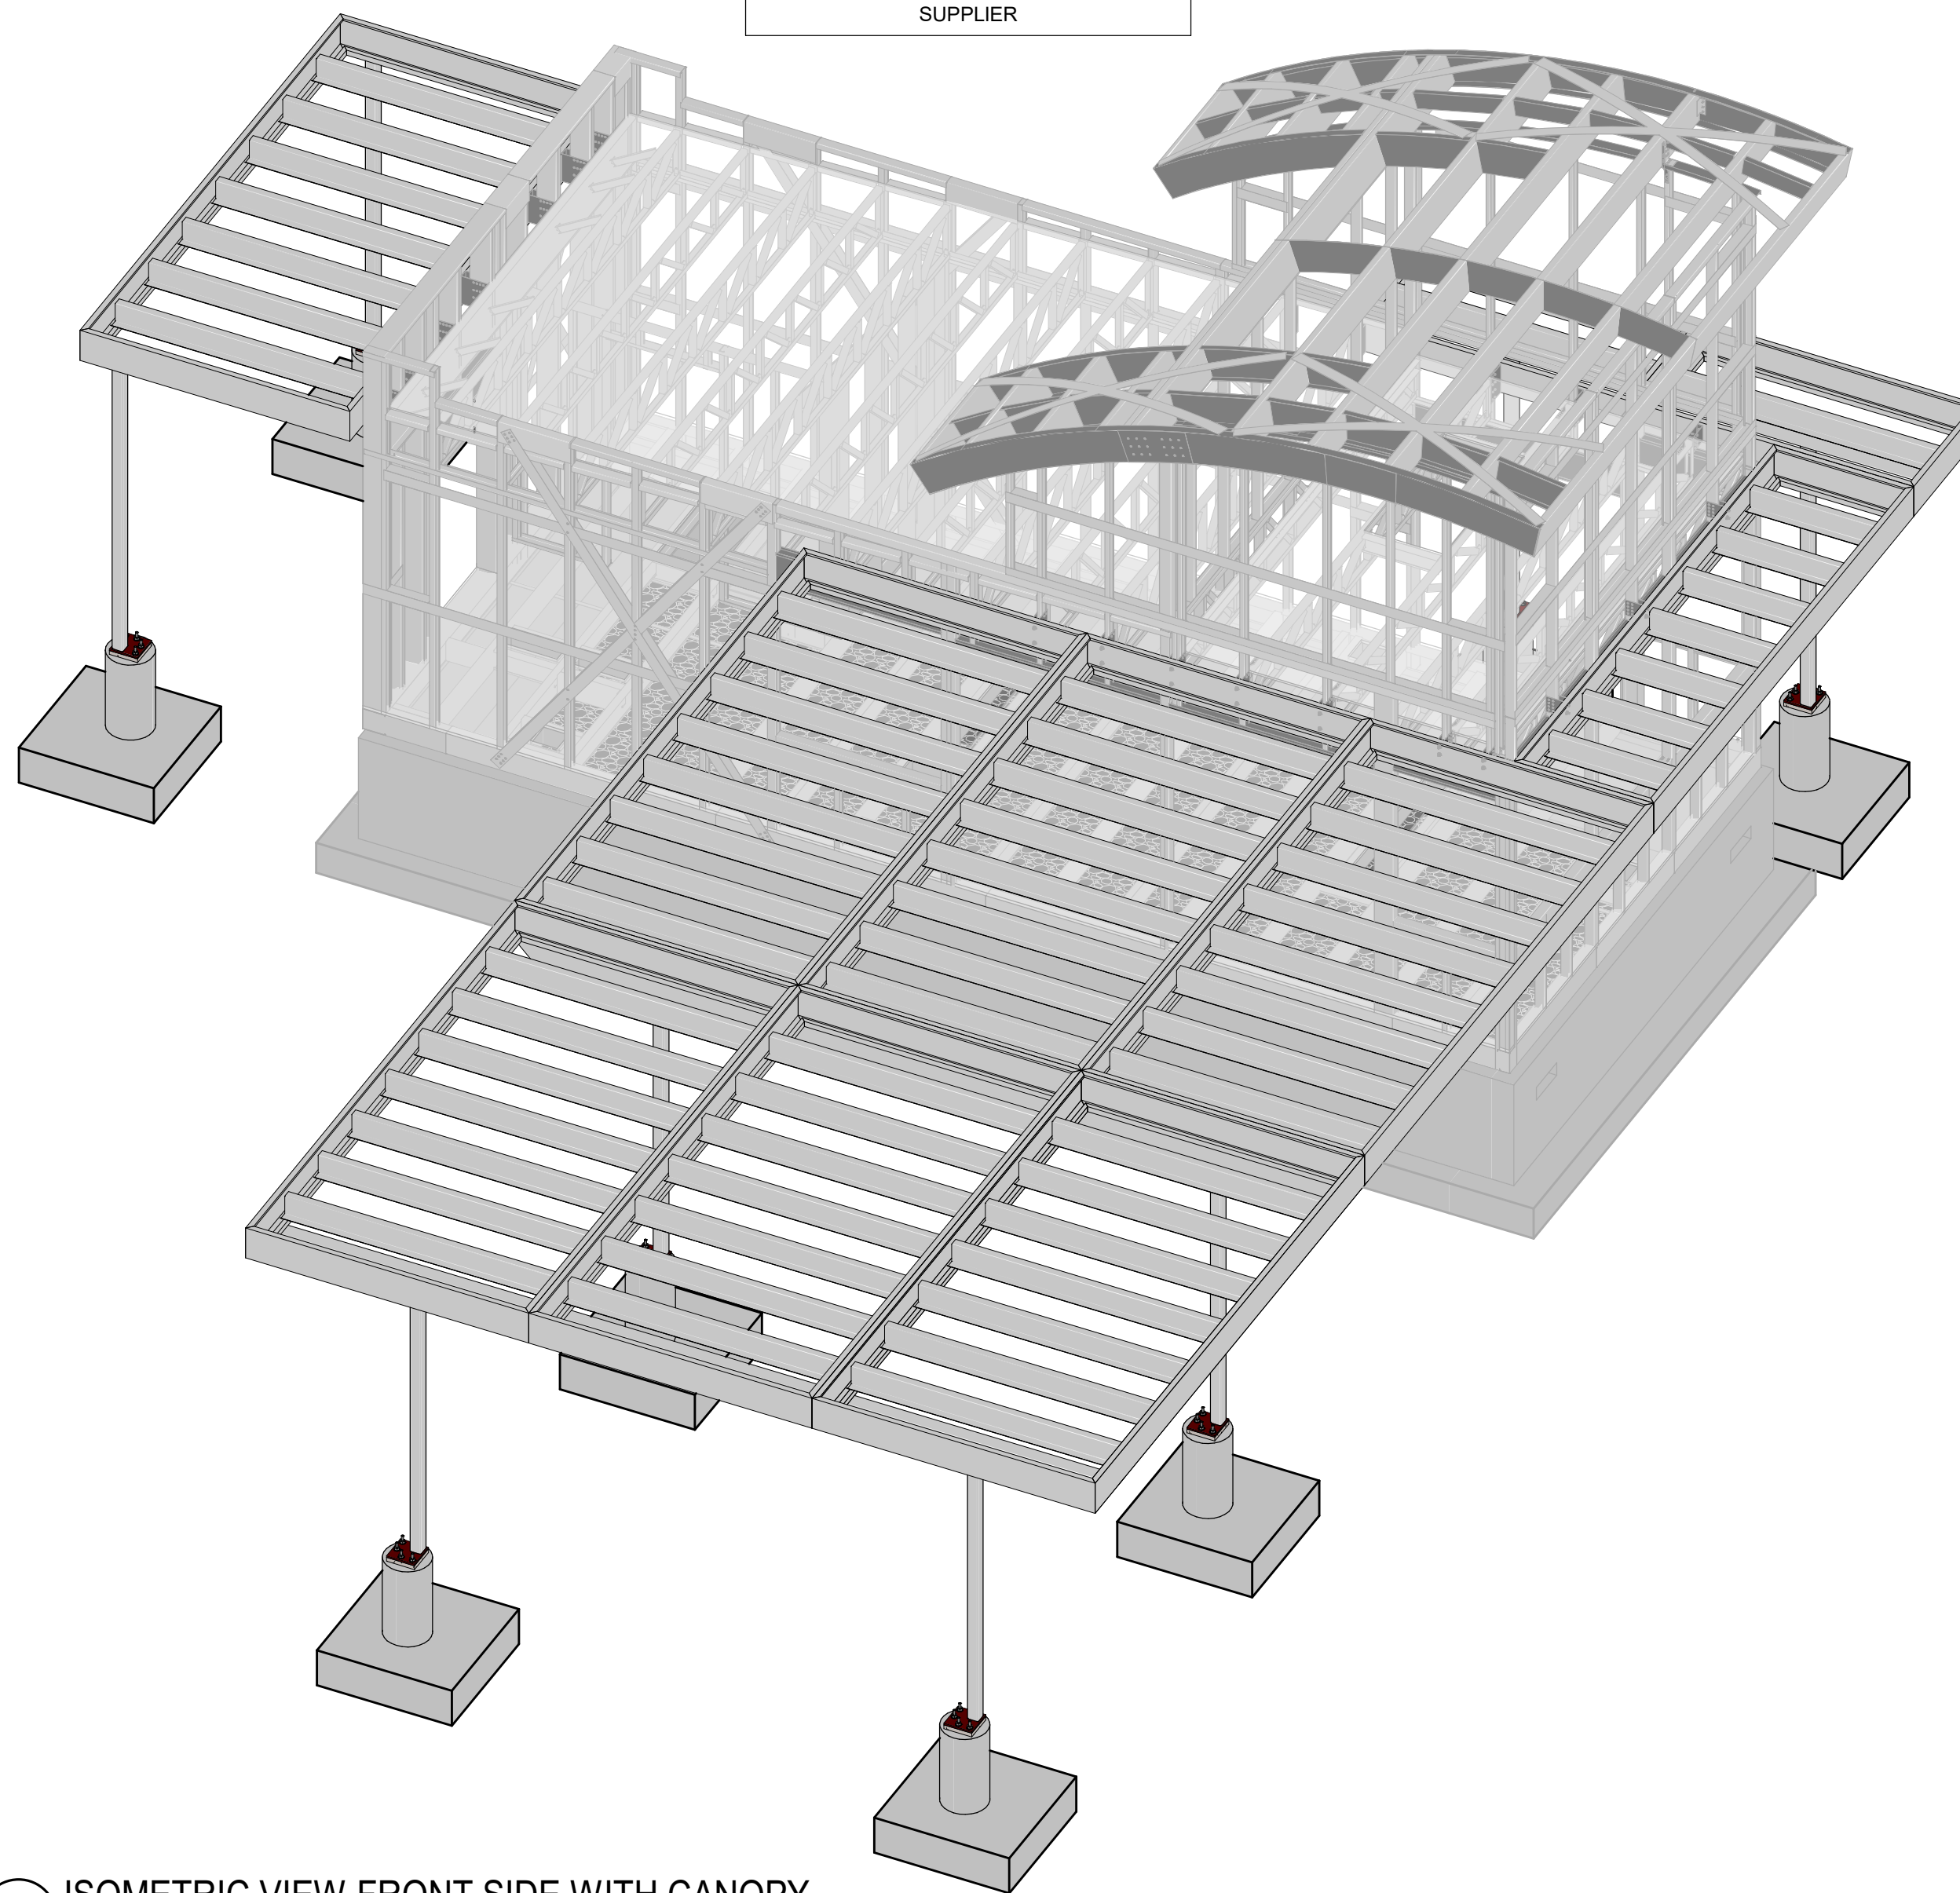

3 ISOMETRIC VIEW FRONT SIDE WITH CANOPY

KEYNOTE	DESCRIPTION
05.201	PROVIDE STRAP BRIDGING @ 24" O.C. w/ BLOCKING PIECES EACH END.
05.202	PLACE "C" PROFILE BACK TO BACK, ATTACH w/ (3) SCREWS AT 12" MAX. ON CENTER.
05.203	ANCHOR CHANNEL TO WALL w/ (4) #12 GALV. TEK SCREWS @ EACH STUD.

COLUMN SCHEDULE				
TYPE	COLUMN SIZE	BASE PLATE TYPE & SIZE	ANCHOR BOLT SIZE	NOTES
S1	HSS4X4X1/4	5/8"x10" SQ	(4) 3/4" DIA w/ 18" EMBEDMENT	




J&M ENGINEERING, LLC  
3045 S. KANSAS EXPRESSWAY  
SPRINGFIELD, MO 65807  
PHONE: 417.708.9315  
www.jandmstructural.com  
E-2011011004



116 NORTH 2ND AVENUE - OZARK, MO 65721 - P (417) 591-8889 - F (417) 591-9002  
ARCHITECTURAL CORPORATION MISSOURI LICENSE NUMBER: A-2010011427



7 BREW COFFEE  
LEE'S SUMMIT, MO  
1410 NE DOUGLAS STREET  
LEE'S SUMMIT, MISSOURI 64086

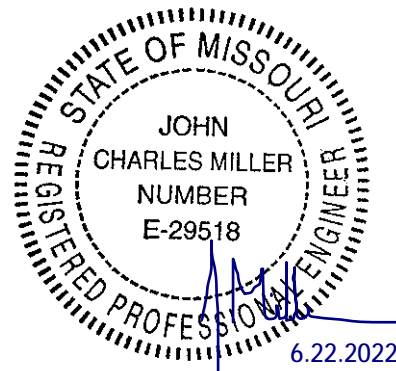

ENGINEER OF RECORD:  
JOHN C. MILLER  
E-29518  
E-2011011004

PROJECT NUMBER:  
220333 7BLS


REVISION:  
1 06/22/2022 ADD 001

S3.1

DRIVE THRU  
CANOPY

DATE: 04/22/2022





ENGINEER OF RECORD:

JOHN C. MILLER  
E-29518  
E-2011011004

PROJECT NUMBER:  
22033 7BLS

REVISION:


1 06/22/2022 ADD 001

## S3.2


## CANOPY DETAILS

DATE: 04/22/2022



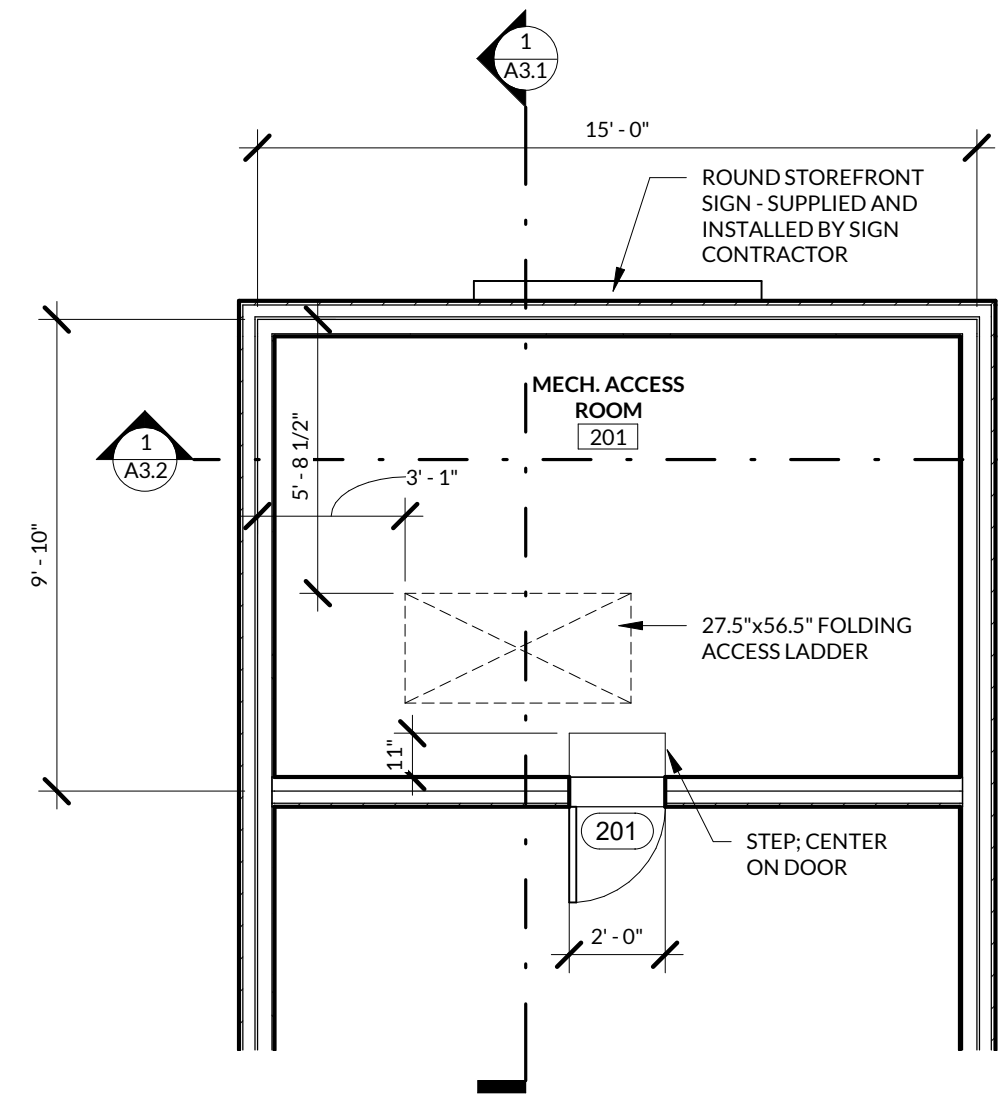


1 ATTIC FLOOR  
1/4" = 1'-0"

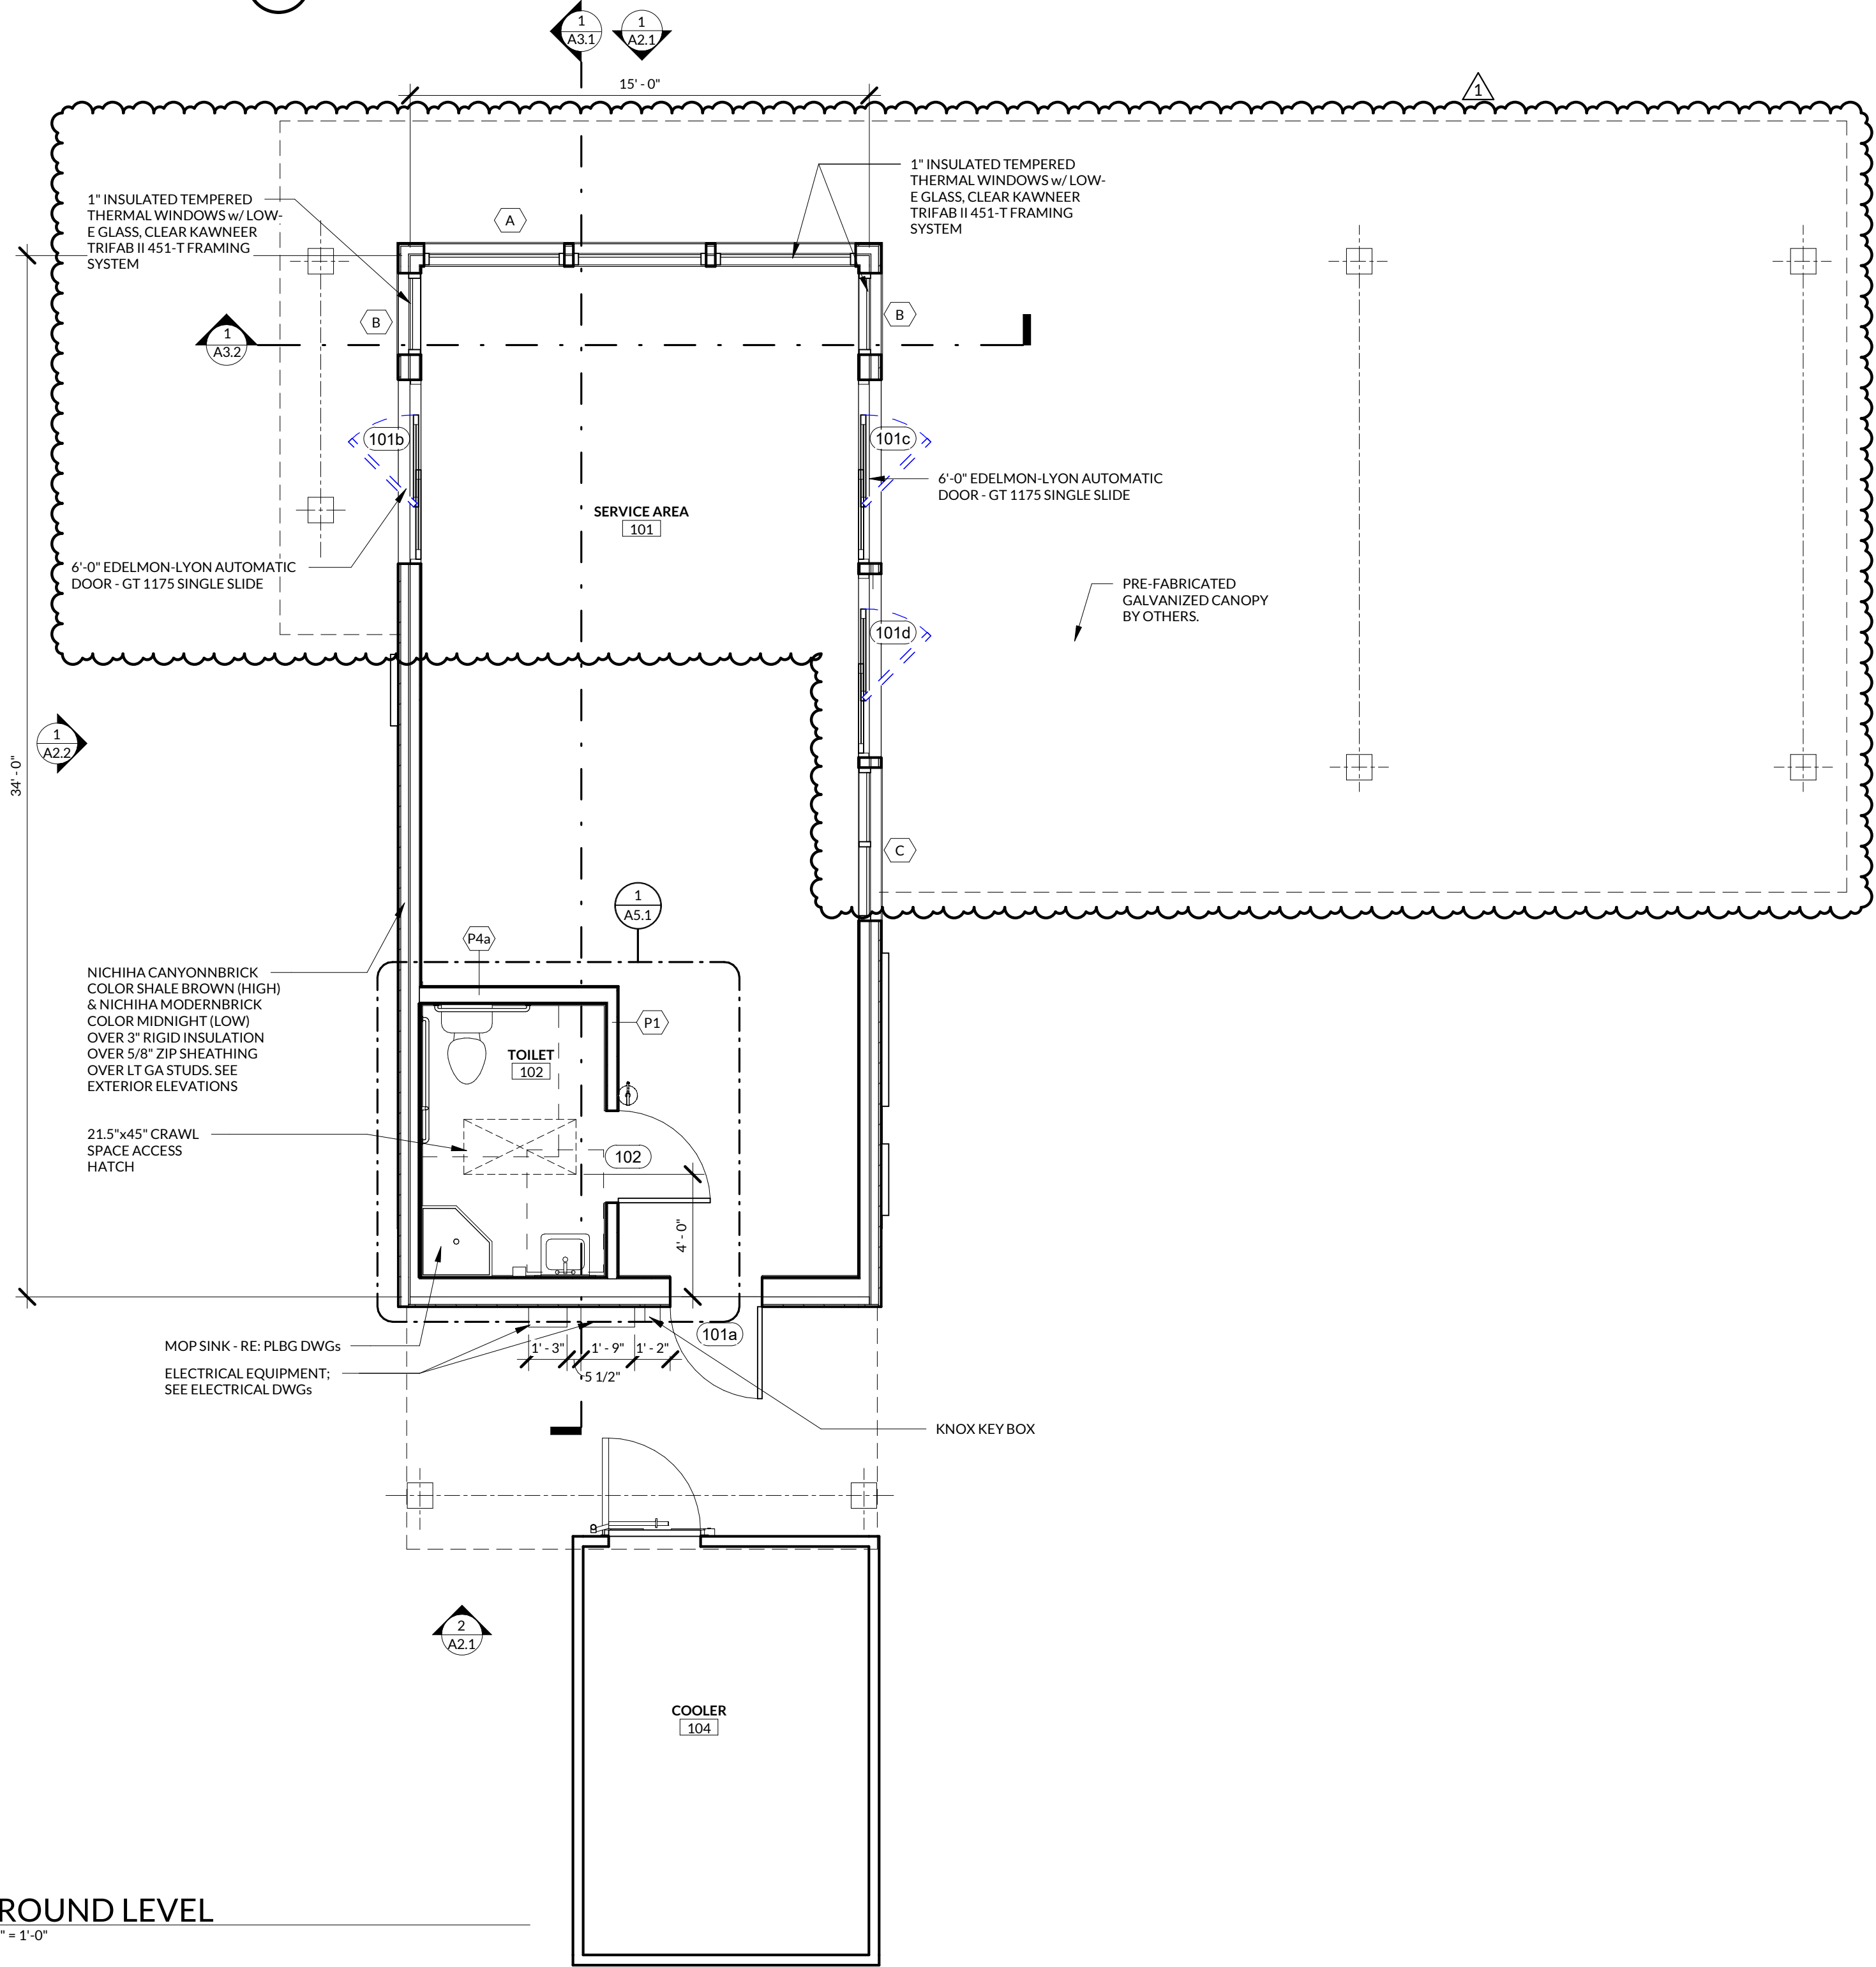

2 GROUND LEVEL  
1/4" = 1'-0"

## PARTITION TYPES

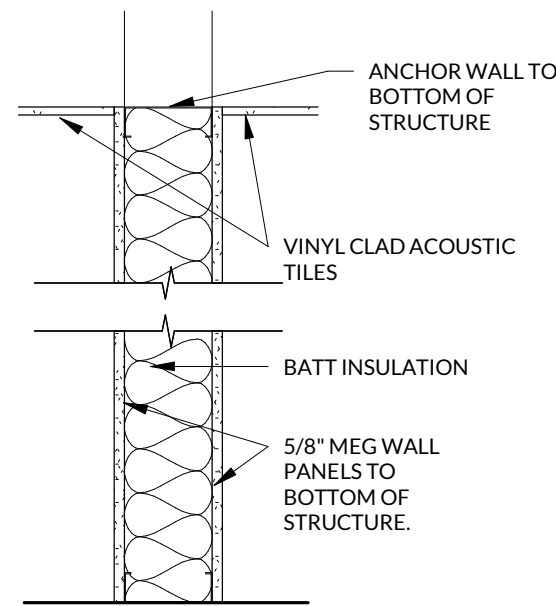

P4a USES 6" METAL STUDS

P1 USES 3-5/8" METAL STUDS

## ROOM FINISH SCHEDULE

RM NO.	RM NAME	FLR	BASE	WALLS				CLG	CLG HGT	NOTE
				TOP	RT	BOT	LT			
101	SERVICE AREA	F1	B1	W1/2	W1/2	W1	W1/2	C1	VERIFY	-
102	TOILET	F1	B1	W1	W1	W1	W1	C1	VERIFY	-
201	MECH ACCESS RM	F2	B2	W3	W3	W3	W3	C2	VARIES	-

### FINISH LEGEND:


FLOORS	BASE	WALLS	CEILING
F1 PROTECT-ALL VINYL	B1 PROTECT-ALL VINYL COVE BASE	W1 MEG WALL PANELS	C1 VINYL CLAD ACOUSTICAL TILES
F2 UNFINISHED PLYWOOD	B2 NONE	W2 ALUM STOREFRONT SYSTEM	C2 EXPOSED STRUCTURE
		W3 EXPOSED STRUCTURE	

### ROOM FINISH SCHEDULE NOTES:


FRP PANELS PROVIDED AND INSTALLED BY CONTRACTOR

### NOTES:

- CONTRACTOR IS RESPONSIBLE FOR HAVING A THOROUGH KNOWLEDGE OF THE LANDLORDS CRITERIA PRIOR TO CONSTRUCTION. FAILURE TO ACCOUNT HIMSELF WITH THIS KNOWLEDGE DOES NOT RELIEVE HIM FROM ANY RESPONSIBILITY.
- CONTRACTOR SHALL THOROUGHLY VERIFY ALL EXISTING CONDITIONS PRIOR TO BIDDING AND CONSTRUCTION. ALL DISCREPANCIES BETWEEN EXISTING CONDITIONS AND THESE DOCUMENTS SHALL BE REPORTED IMMEDIATELY TO THE ARCHITECT.

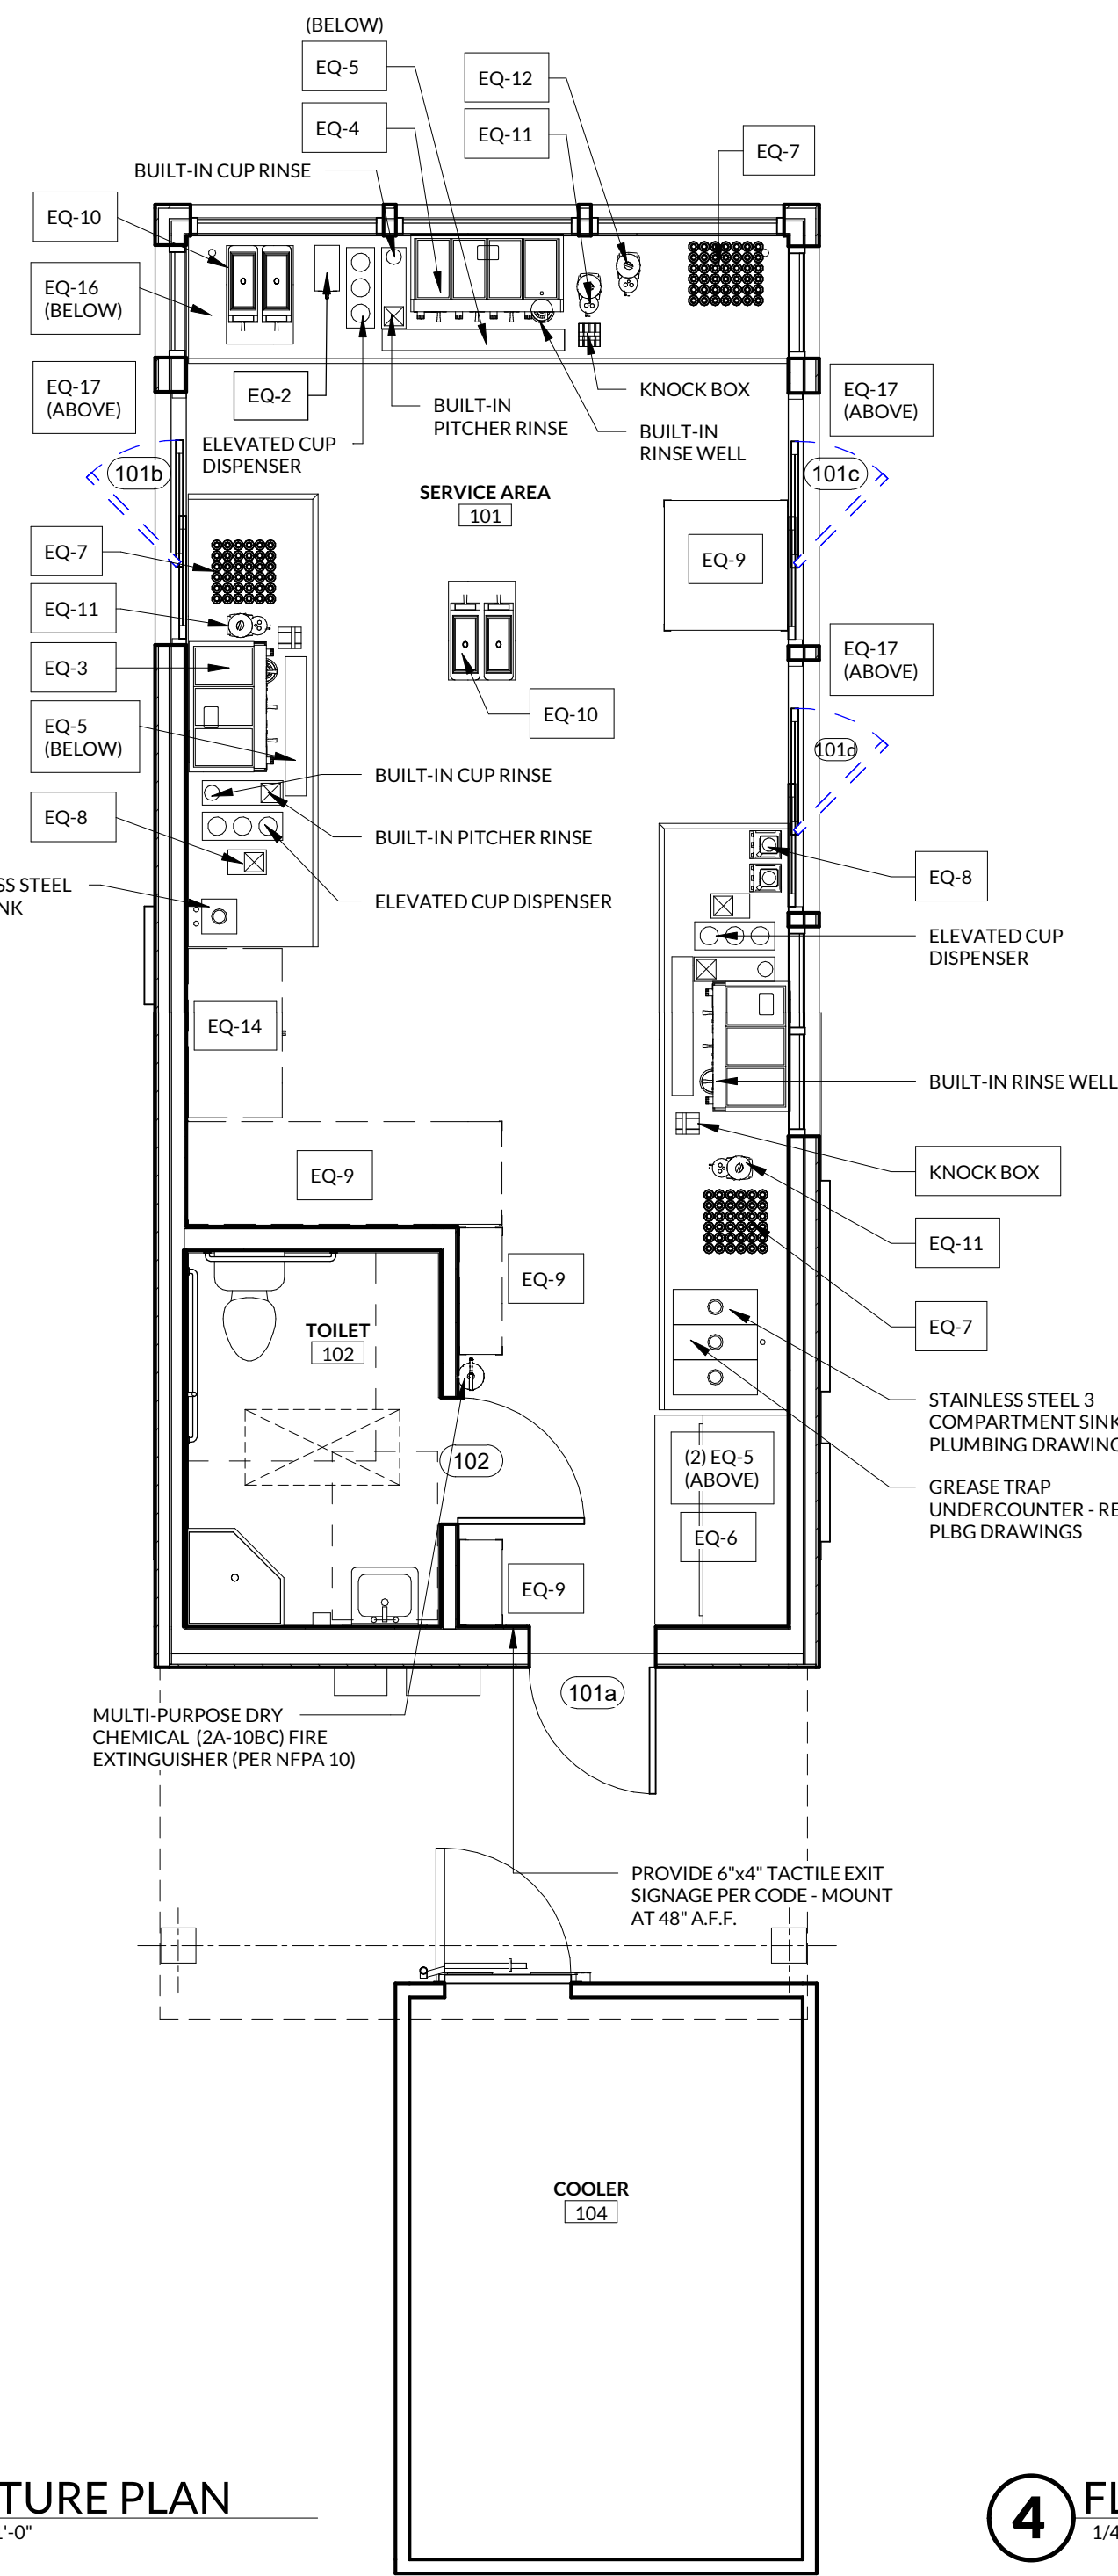

3 FIXTURE PLAN  
1/4" = 1'-0"

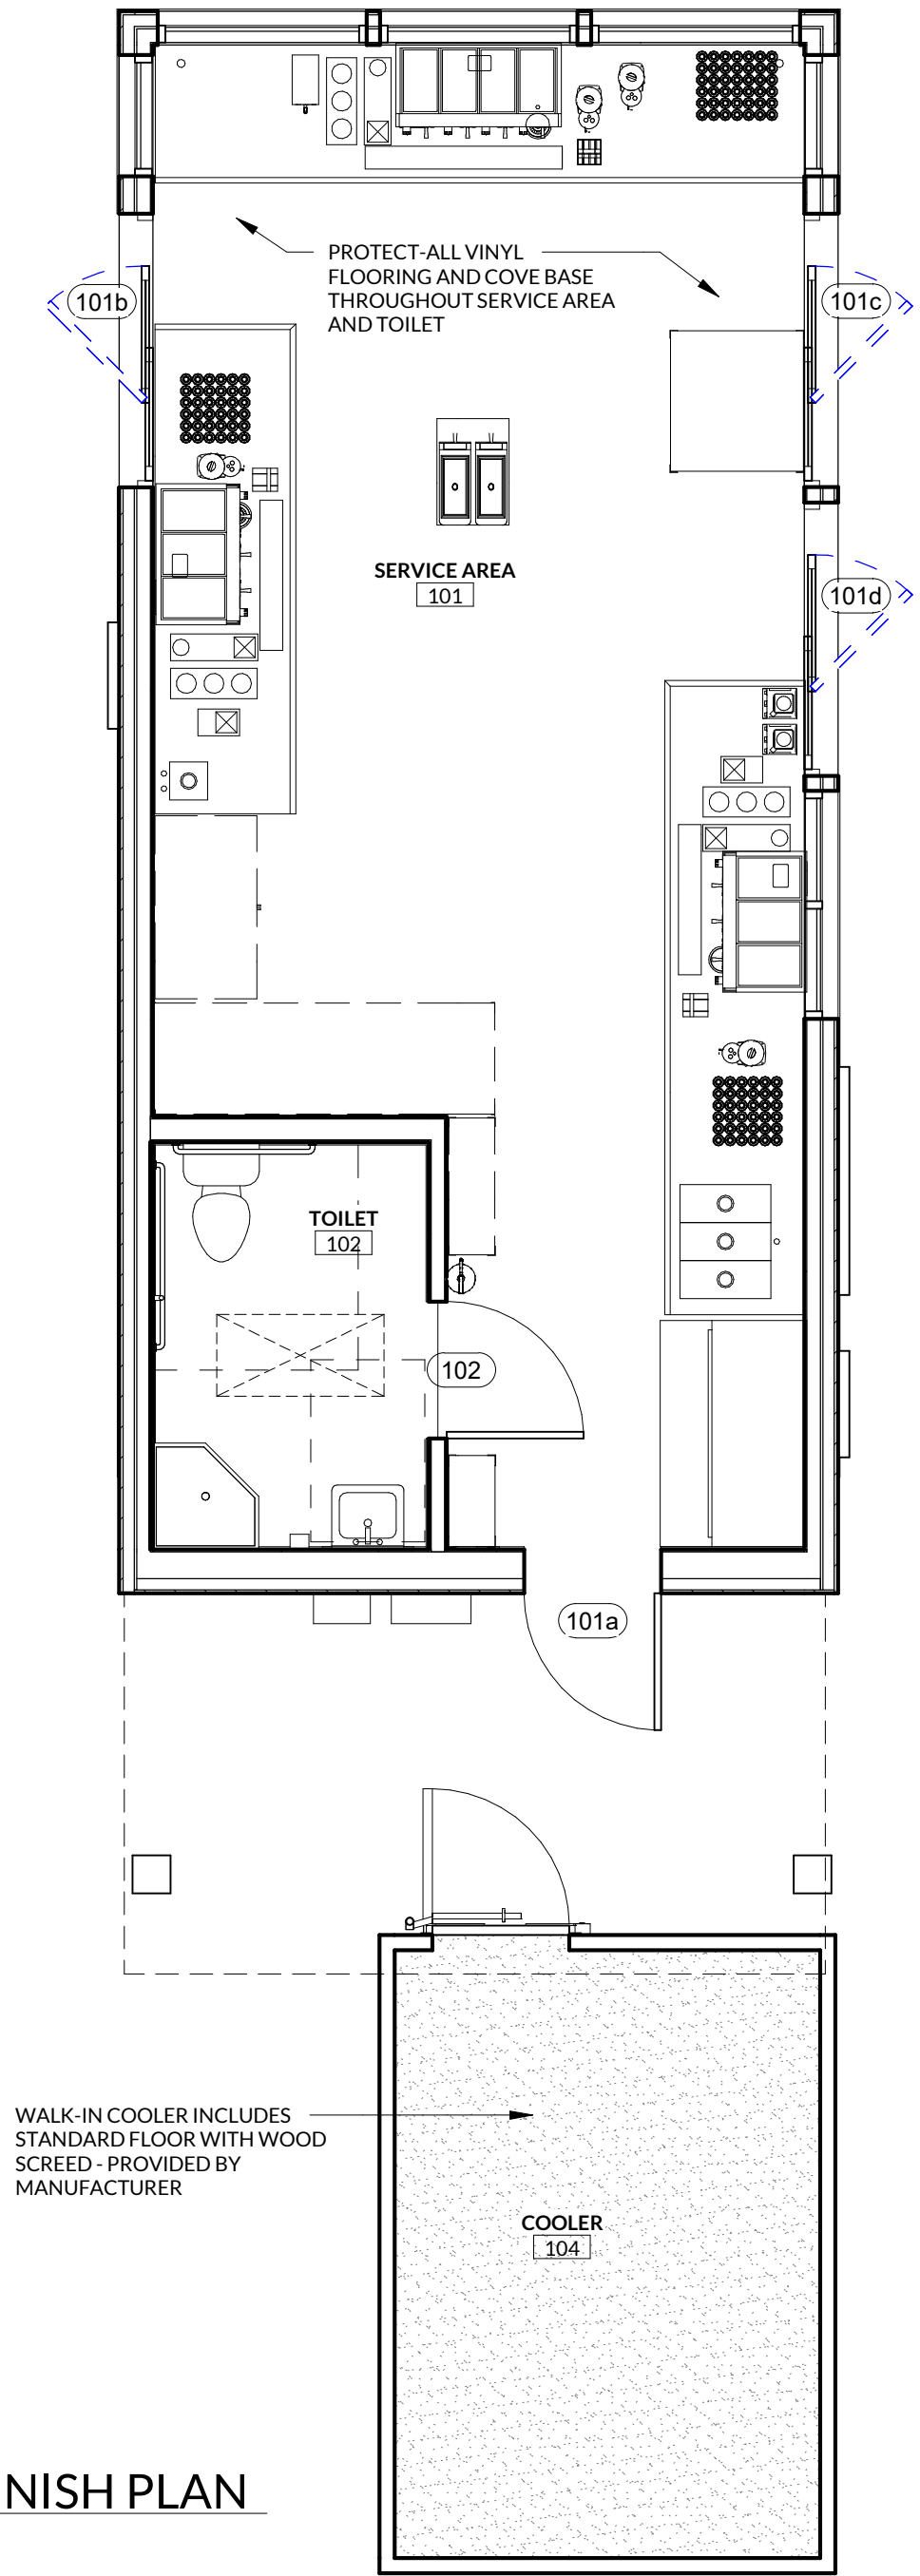

4 FLOOR FINISH PLAN  
1/4" = 1'-0"



EGRESS LEGEND

PATH OF EGRESS TRAVELED: - - - - ->

SPACE OCCUPANCY:

ROOM NAME  
101

### SF  
468

FUNCTION  
KITCHEN

100 OCC.

ROOM NAME AND NUMBER

ROOM AREA, SQUARE FOOTAGE

USE GROUP PER IBC SECTION 3

OCCUPANCY: AREA OF SPACE/AREA ALLOWANCES PER IBC TABLE 1004.1.2

DOOR EXIT CAPACITY:

DOOR EXIT  
000 OCC.

00" REQD.

00" PROVIDED

EXIT TYPE (DOOR, STAIR, ETC)

NUMBER OF OCCUPANTS USING THE EXIT.

EGRESS WIDTH REQUIRED FOR NUMBER OF OCCUPANTS USING THE EXIT PER IBC SECTION 1005.

EGRESS WIDTH PROVIDED.

EGRESS LOADING INFORMATION

OCCUPANCY LOADING CALCULATIONS  
PER IBC 2018: TABLE 1004.1.2

KITCHENS: 200 S.F. PER OCCUPANT  
STORAGE: 300 S.F. PER OCCUPANT

#	ROOM	OCCUPANCY	CALCULATION	OCCUPANTS
101	SERVICE AREA	KITCHEN	468 SF/200 SF	3
104	COOLER	STORAGE	124 SF/300 SF	1
201	MECH. ACCESS ROOM	STORAGE	131 SF/300 SF	1

5

EXIT CAPACITY:  
EGRESS WIDTH REQUIRED: 5 OCCUPANTS X 0.2" PER OCCUPANT REQUIRED = 1.0"  
EGRESS WIDTH PROVIDED: 36"  
EGRESS WIDTH OF 0.2" PER OCCUPANT USED FOR DOORS PER IBC TABLE 1005.

NUMBER OF EXITS REQUIRED:  
(1) EXIT REQUIRED FOR PER STORY FOR LESS THAN 49 OCCUPANTS PER IBC TABLE 1006.2.1.  
(1) EXIT PROVIDED.

MAXIMUM TRAVEL DISTANCE:  
200'-0" PER IBC TABLE 1017.2  
ACTUAL MAX TRAVEL DISTANCE TO EXIT: 32'-0"

DEAD END CORRIDOR:  
20'-0" MAX LENGTH OF DEAD END CORRIDOR PER IBC SECTION 1018

RESTROOM LOADING

OCCUPANCY:  
5 OCCUPANTS

RESTROOM FIXTURES REQUIRED/PROVIDED - USE GROUP: BUSINESS

TOILET COUNT: = 1 PER 25 FOR THE FIRST 50 AND 1 PER 50 FOR THE REMAINDER EXCEEDING 50

LAVATORY COUNT: = 1 PER 40 FOR THE FIRST 80 AND 1 PER 80 FOR THE REMAINDER EXCEEDING 80

TUB/ SHOWERS: = NOT REQUIRED

DRINKING FOUNTAINS: = 1 PER 100

OTHER: = 1 SERVICE SINK

PLUMBING FIXTURE COUNT PER IBC TABLE 2902.1

TOILET COUNT: WATER CLOSETS REQUIRED: 5 OCCUPANTS / 25 = 1 WATER CLOSET REQUIRED  
WATER CLOSETS PROVIDED: 1 UNISEX WATER CLOSET PROVIDED

LAVATORY COUNT: SINKS REQUIRED: 5 OCCUPANTS / 40 = 1 REQUIRED  
SINKS PROVIDED: 1 PROVIDED


DRINKING FOUNTAIN COUNT: DRINKING FOUNTAINS REQUIRED: 5 OCCUPANTS / 100 = 1 REQUIRED  
DRINKING FOUNTAIN PROVIDED: WATER WILL BE PROVIDED FOR FREE UPON REQUEST.

SERVICE SINK COUNT: SERVICE SINKS REQUIRED: 1 REQUIRED  
SERVICE SINK PROVIDED: 1 PROVIDED


FIRE EXTINGUISHER NOTES

F1 10 LBS, ABC FIRE EXTINGUISHER ON WALL MOUNTED BRACKET. MOUNT HANDLE @ 4'-0".

75'-0" RADIUS FROM FIRE EXTINGUISHER @ F1 (NOT SHOWN, ENCOMPASSES ENTIRE BUILDING)

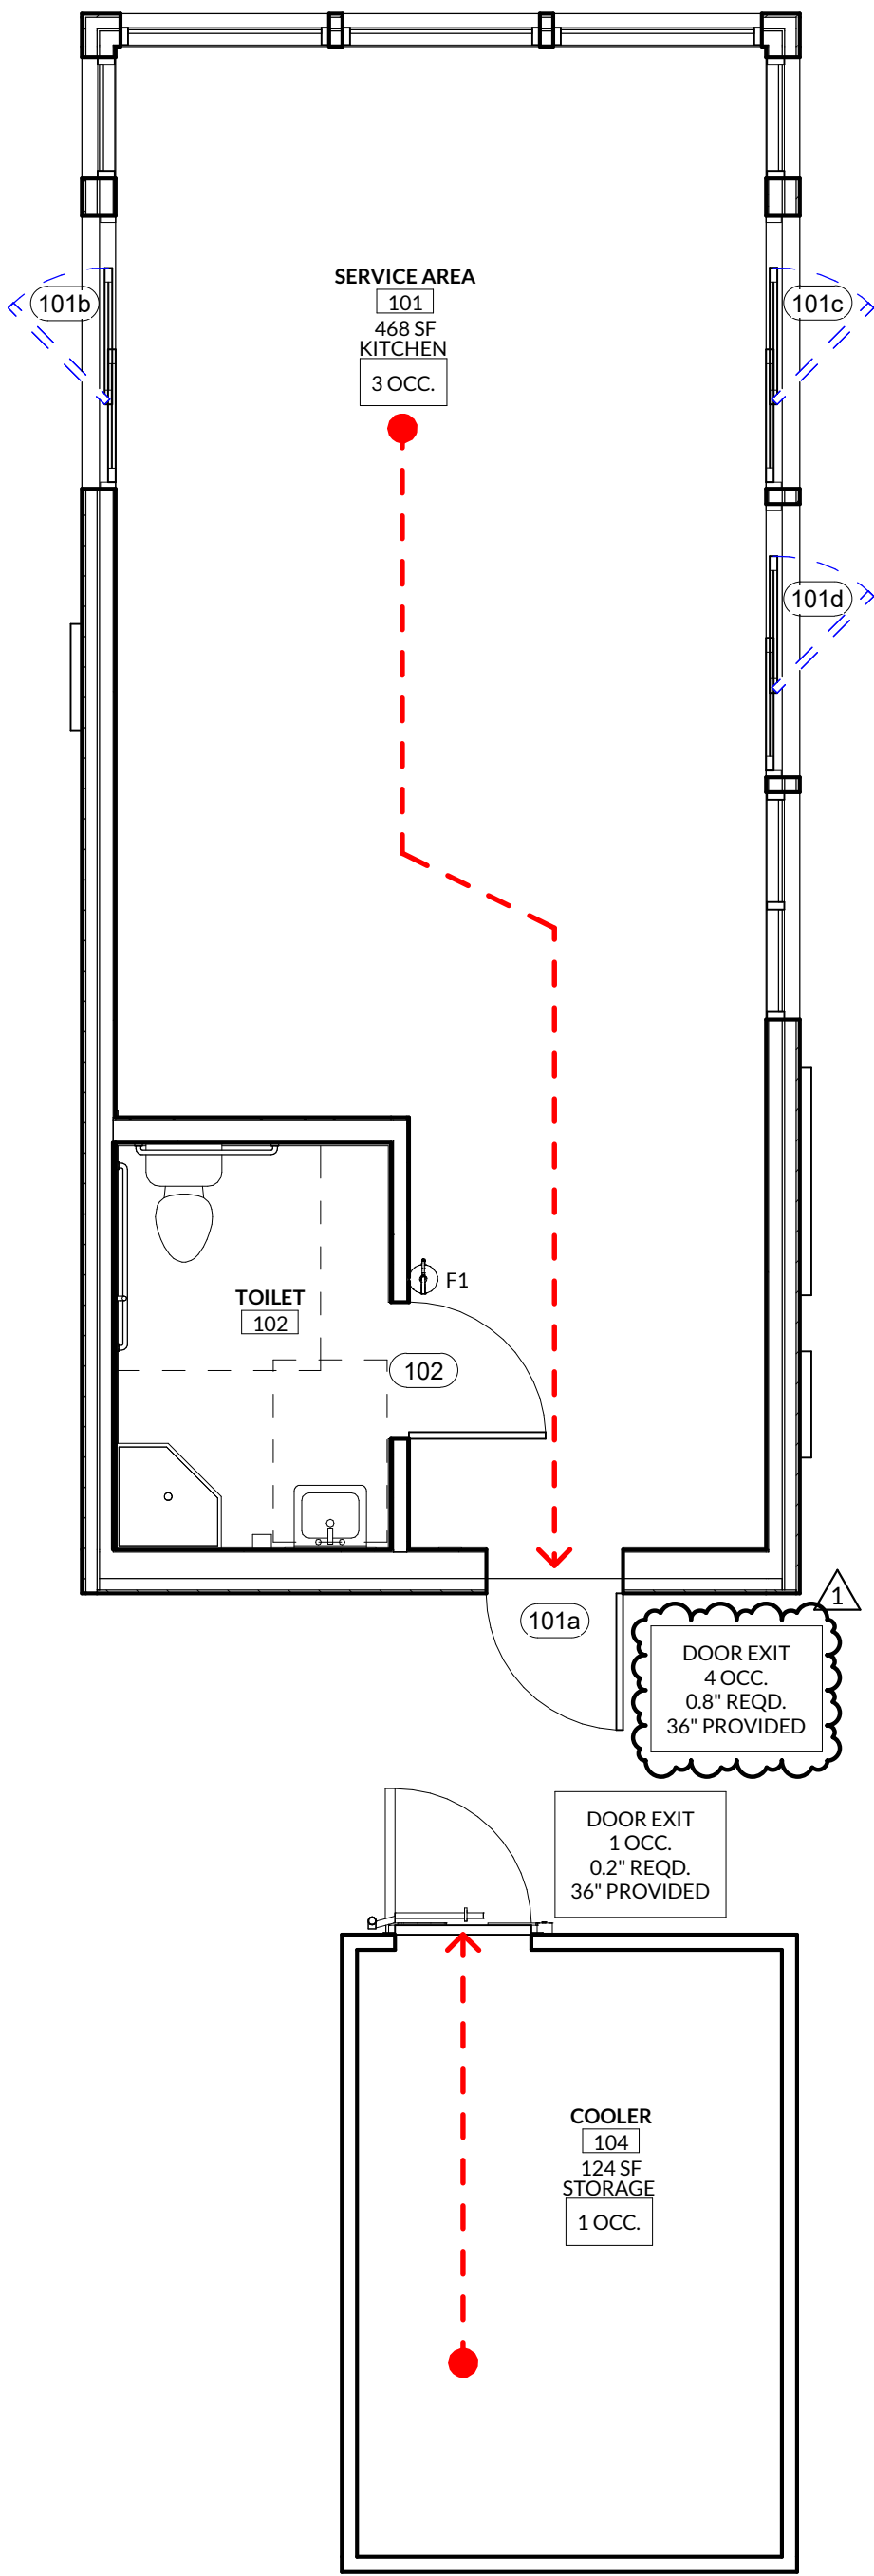


1 EGRESS PLAN  
1/4" = 1'-0"

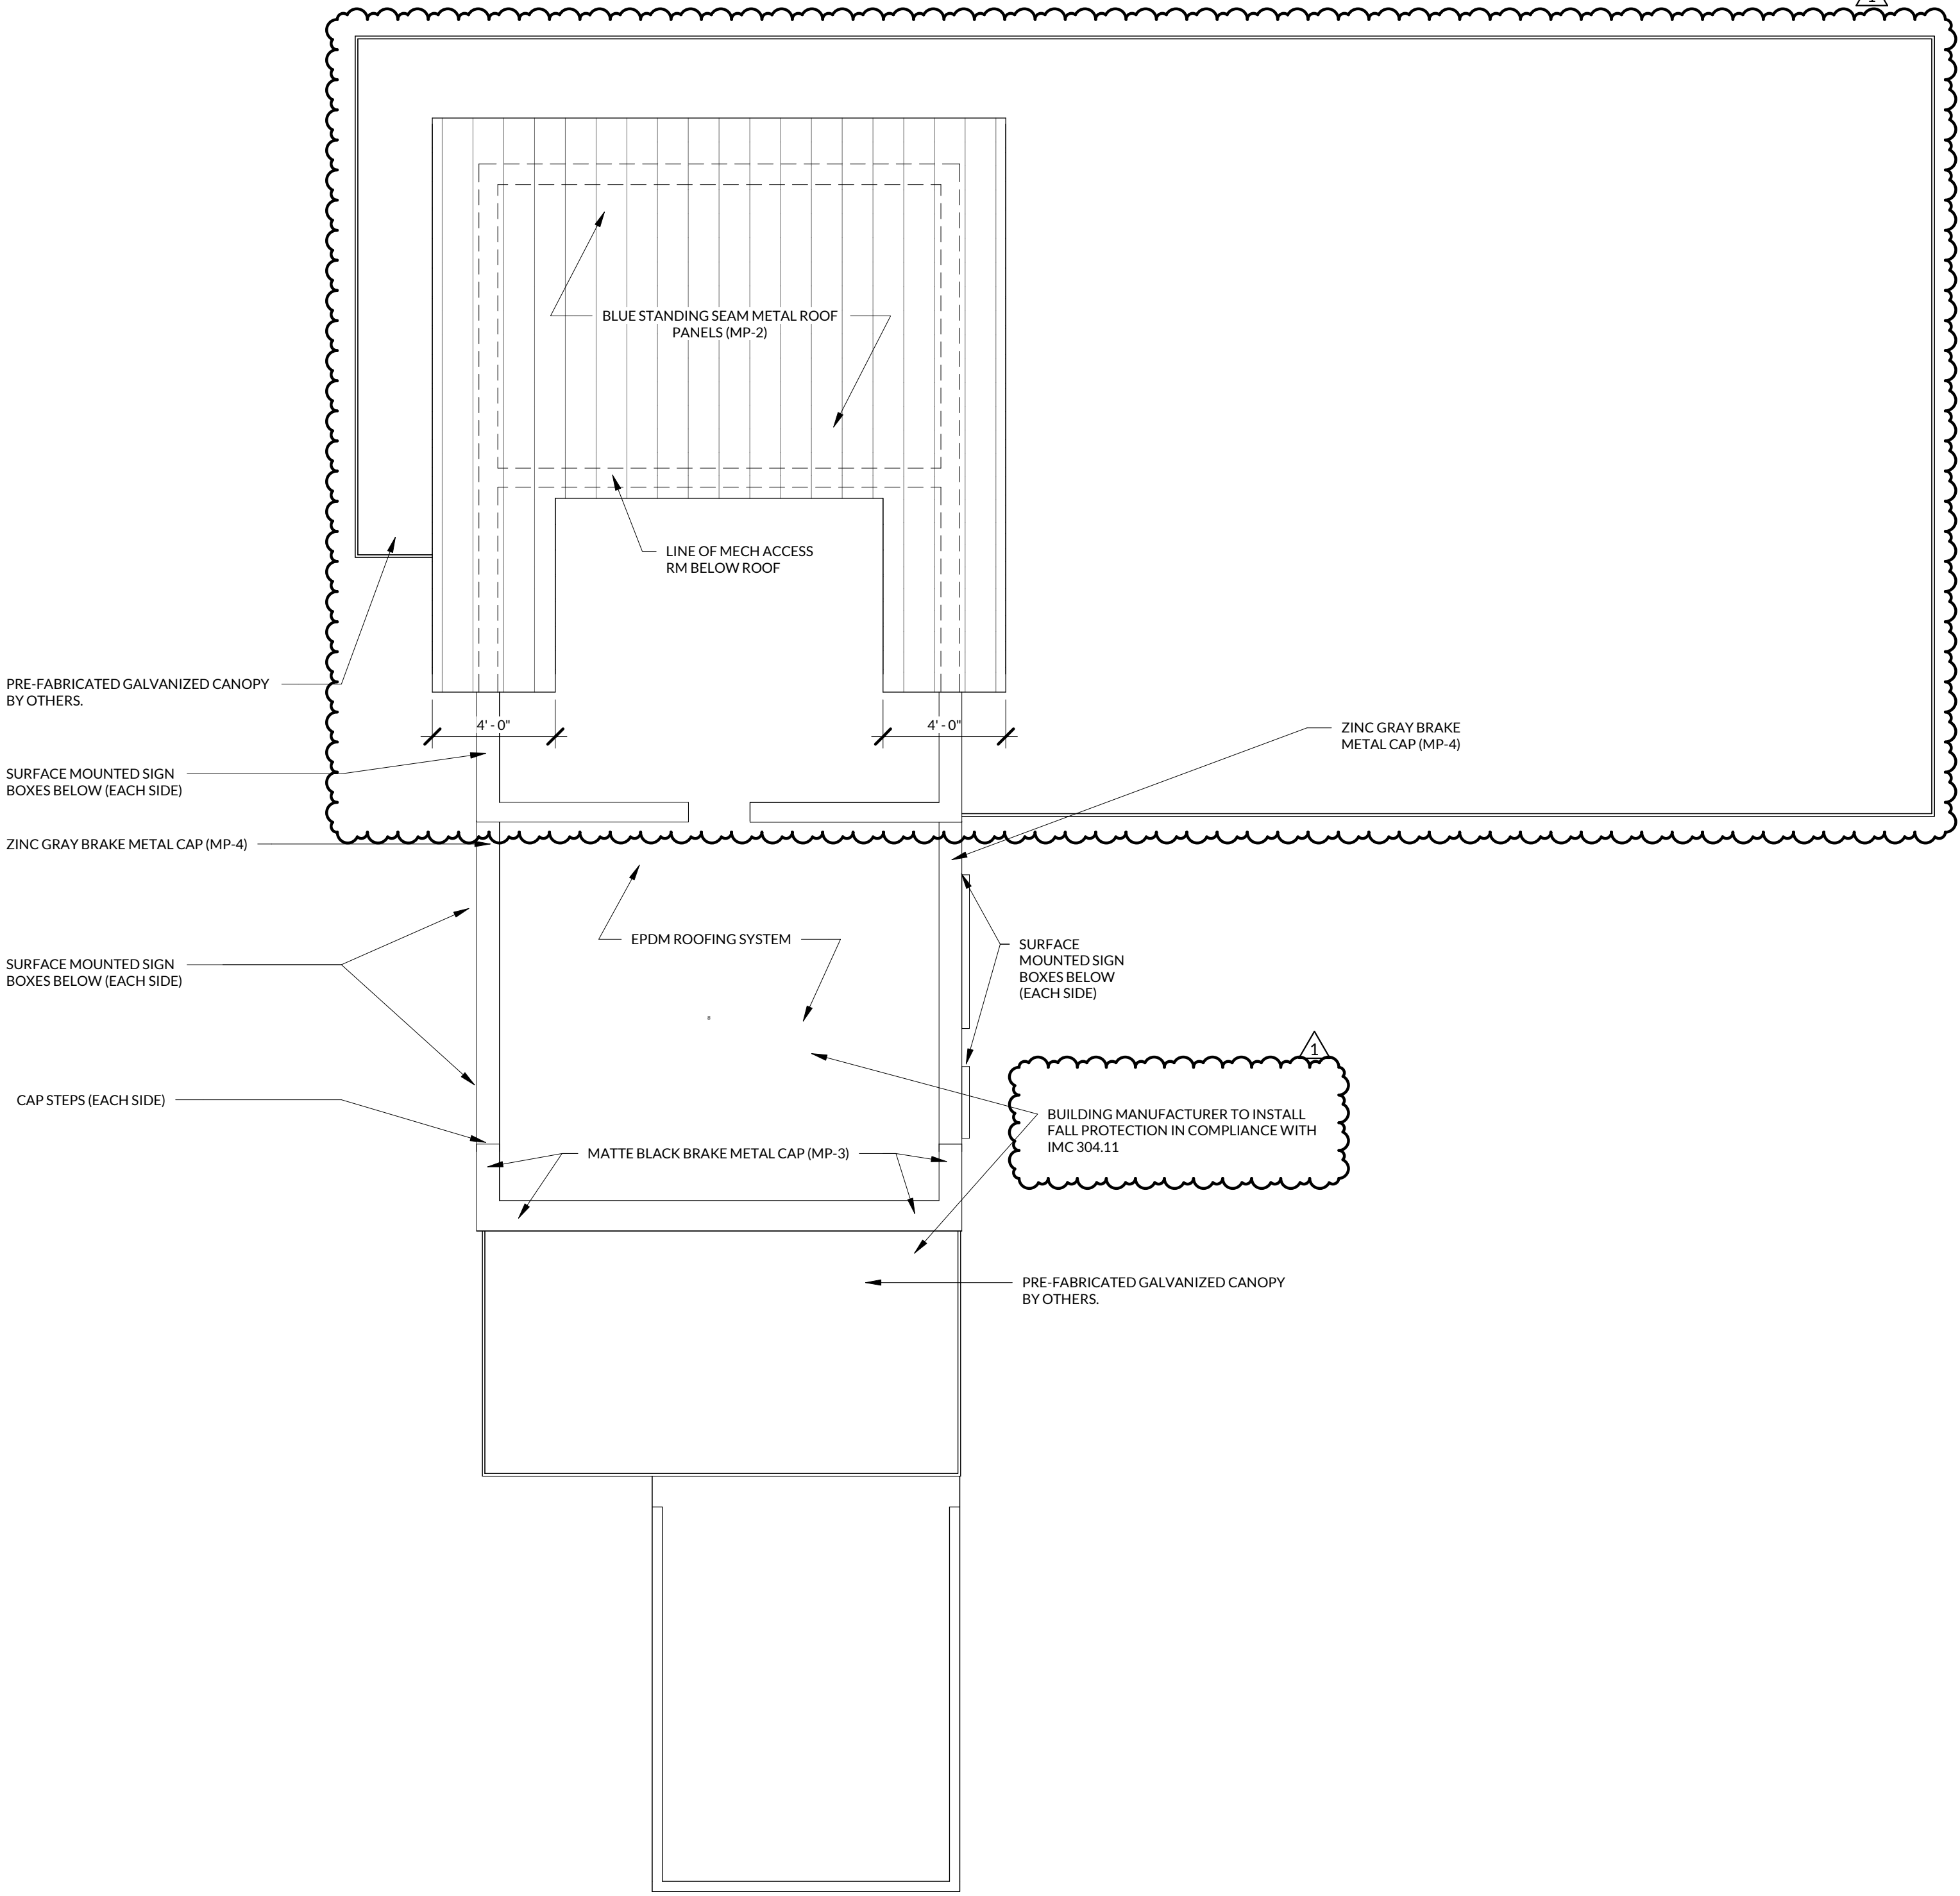


2 ROOF PLAN  
1/4" = 1'-0"




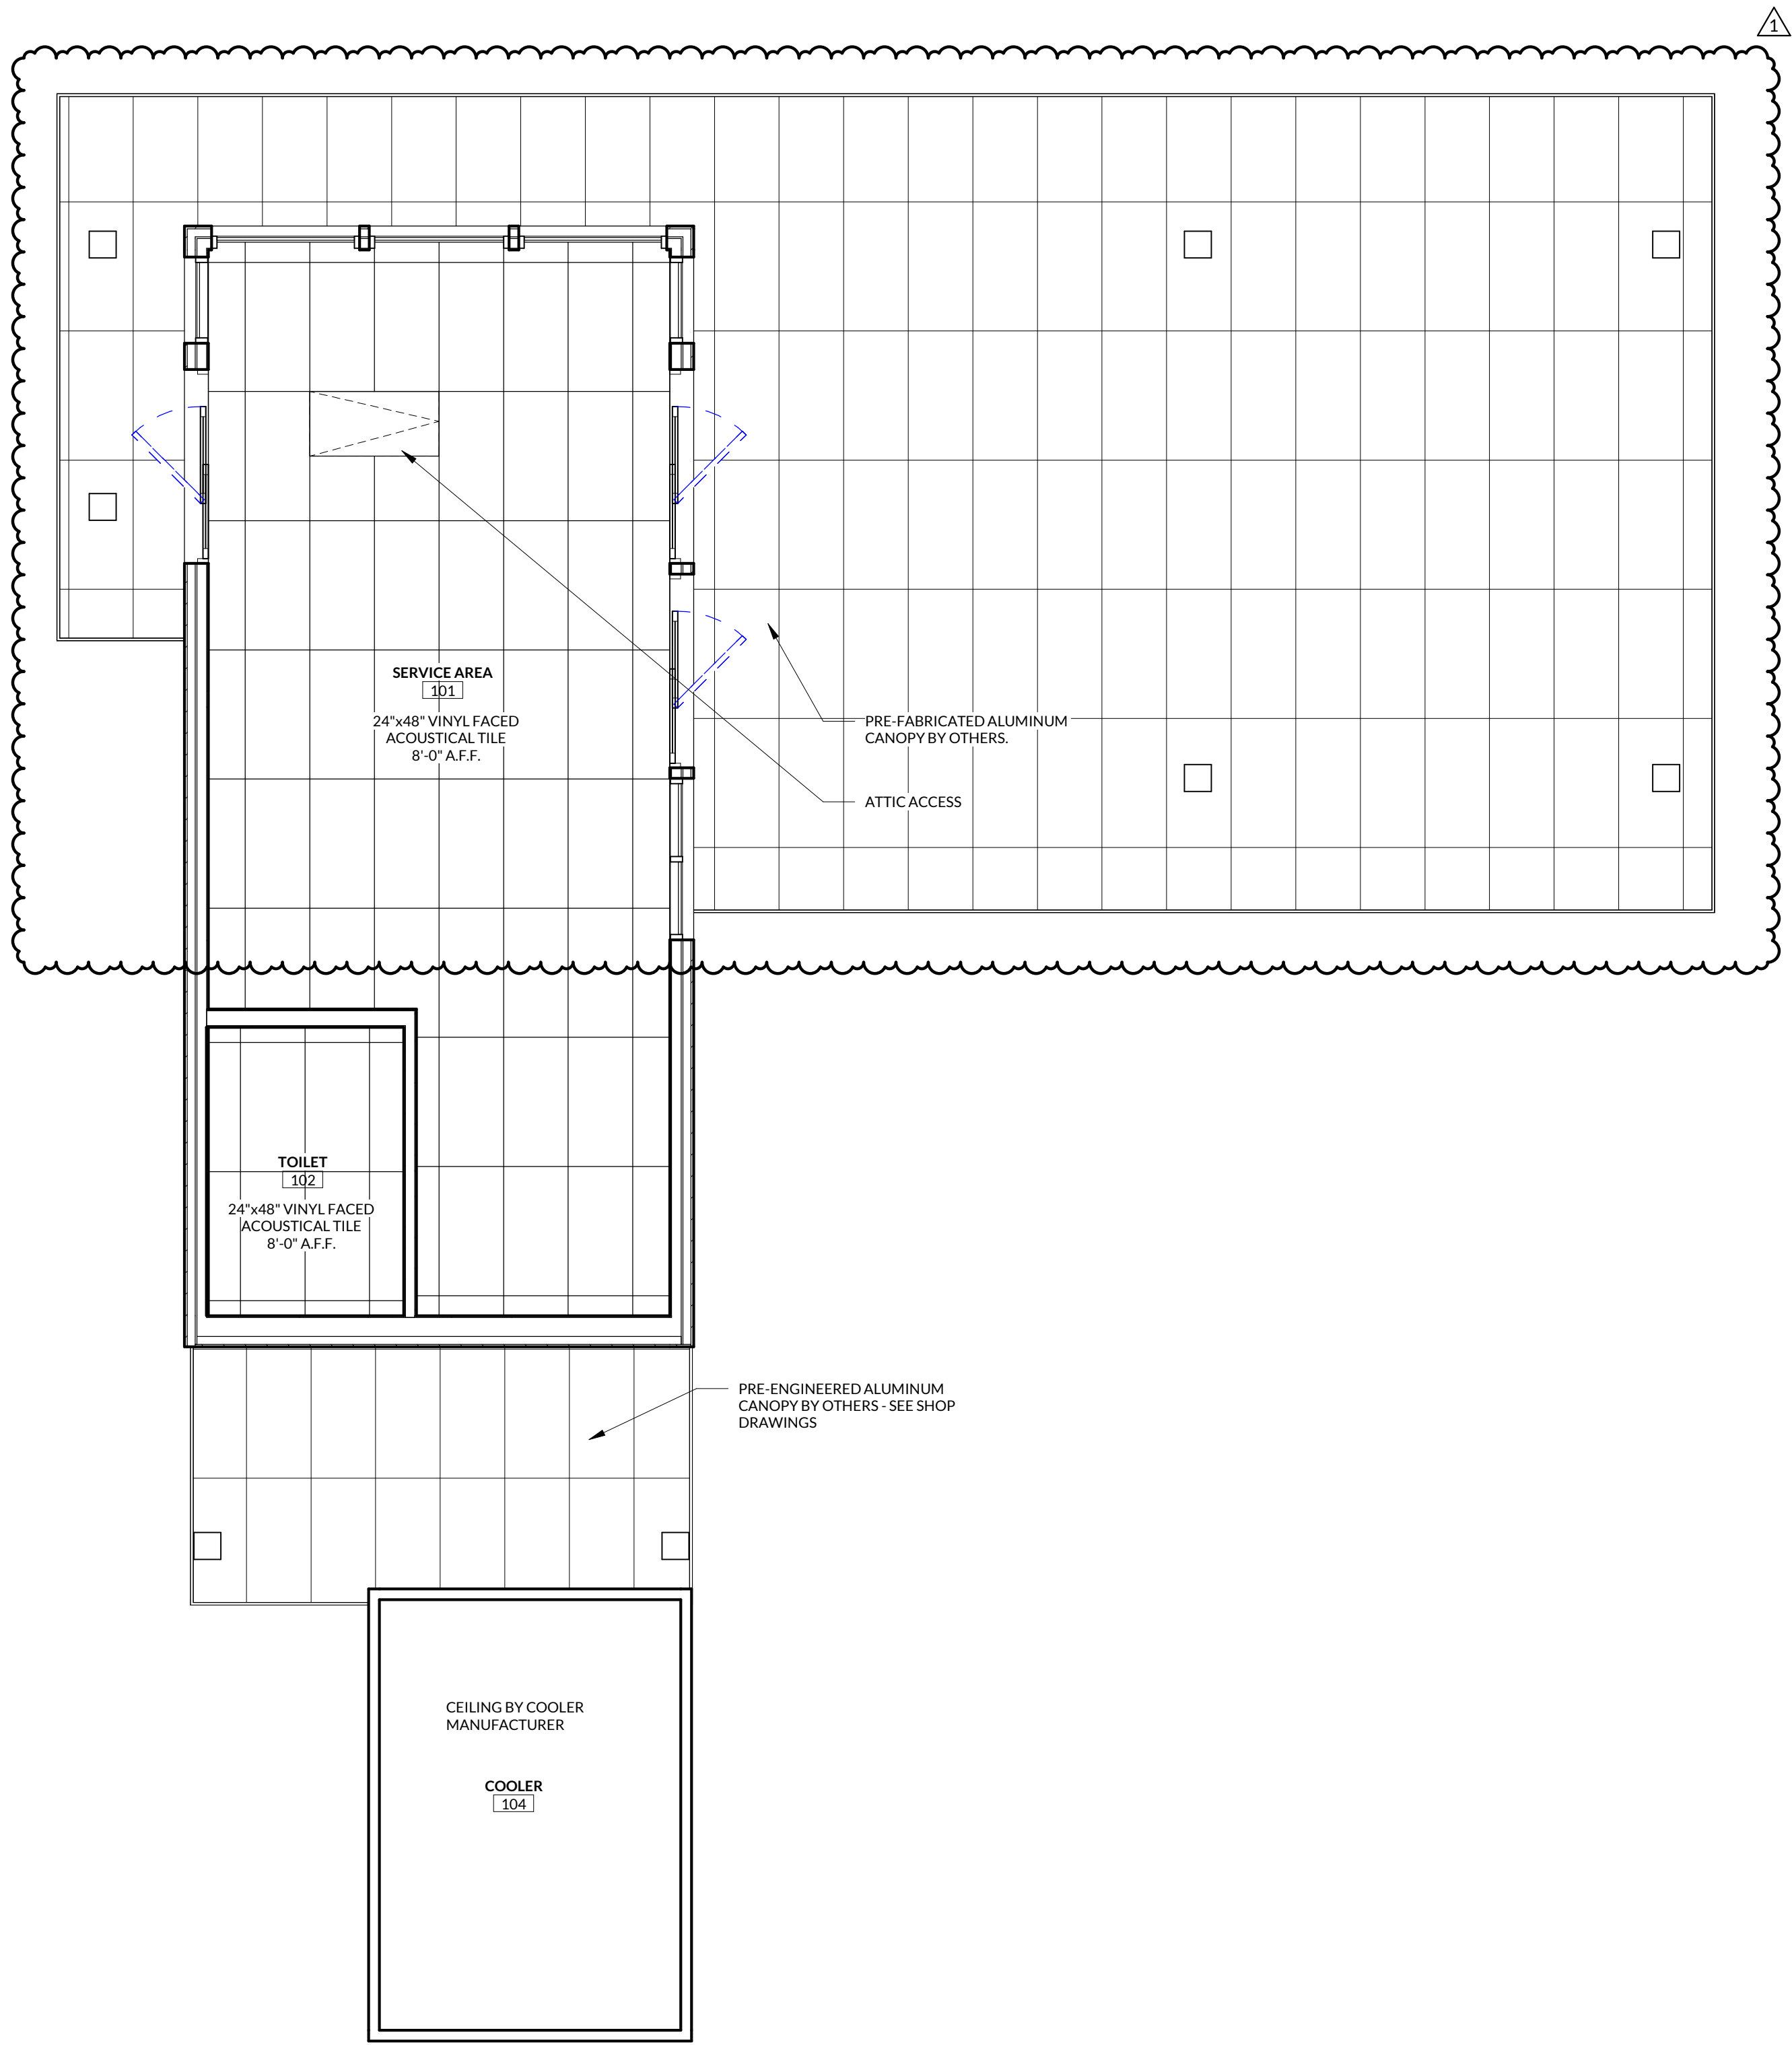


1 RCP - GROUND LEVEL  
1/4" = 1'-0"

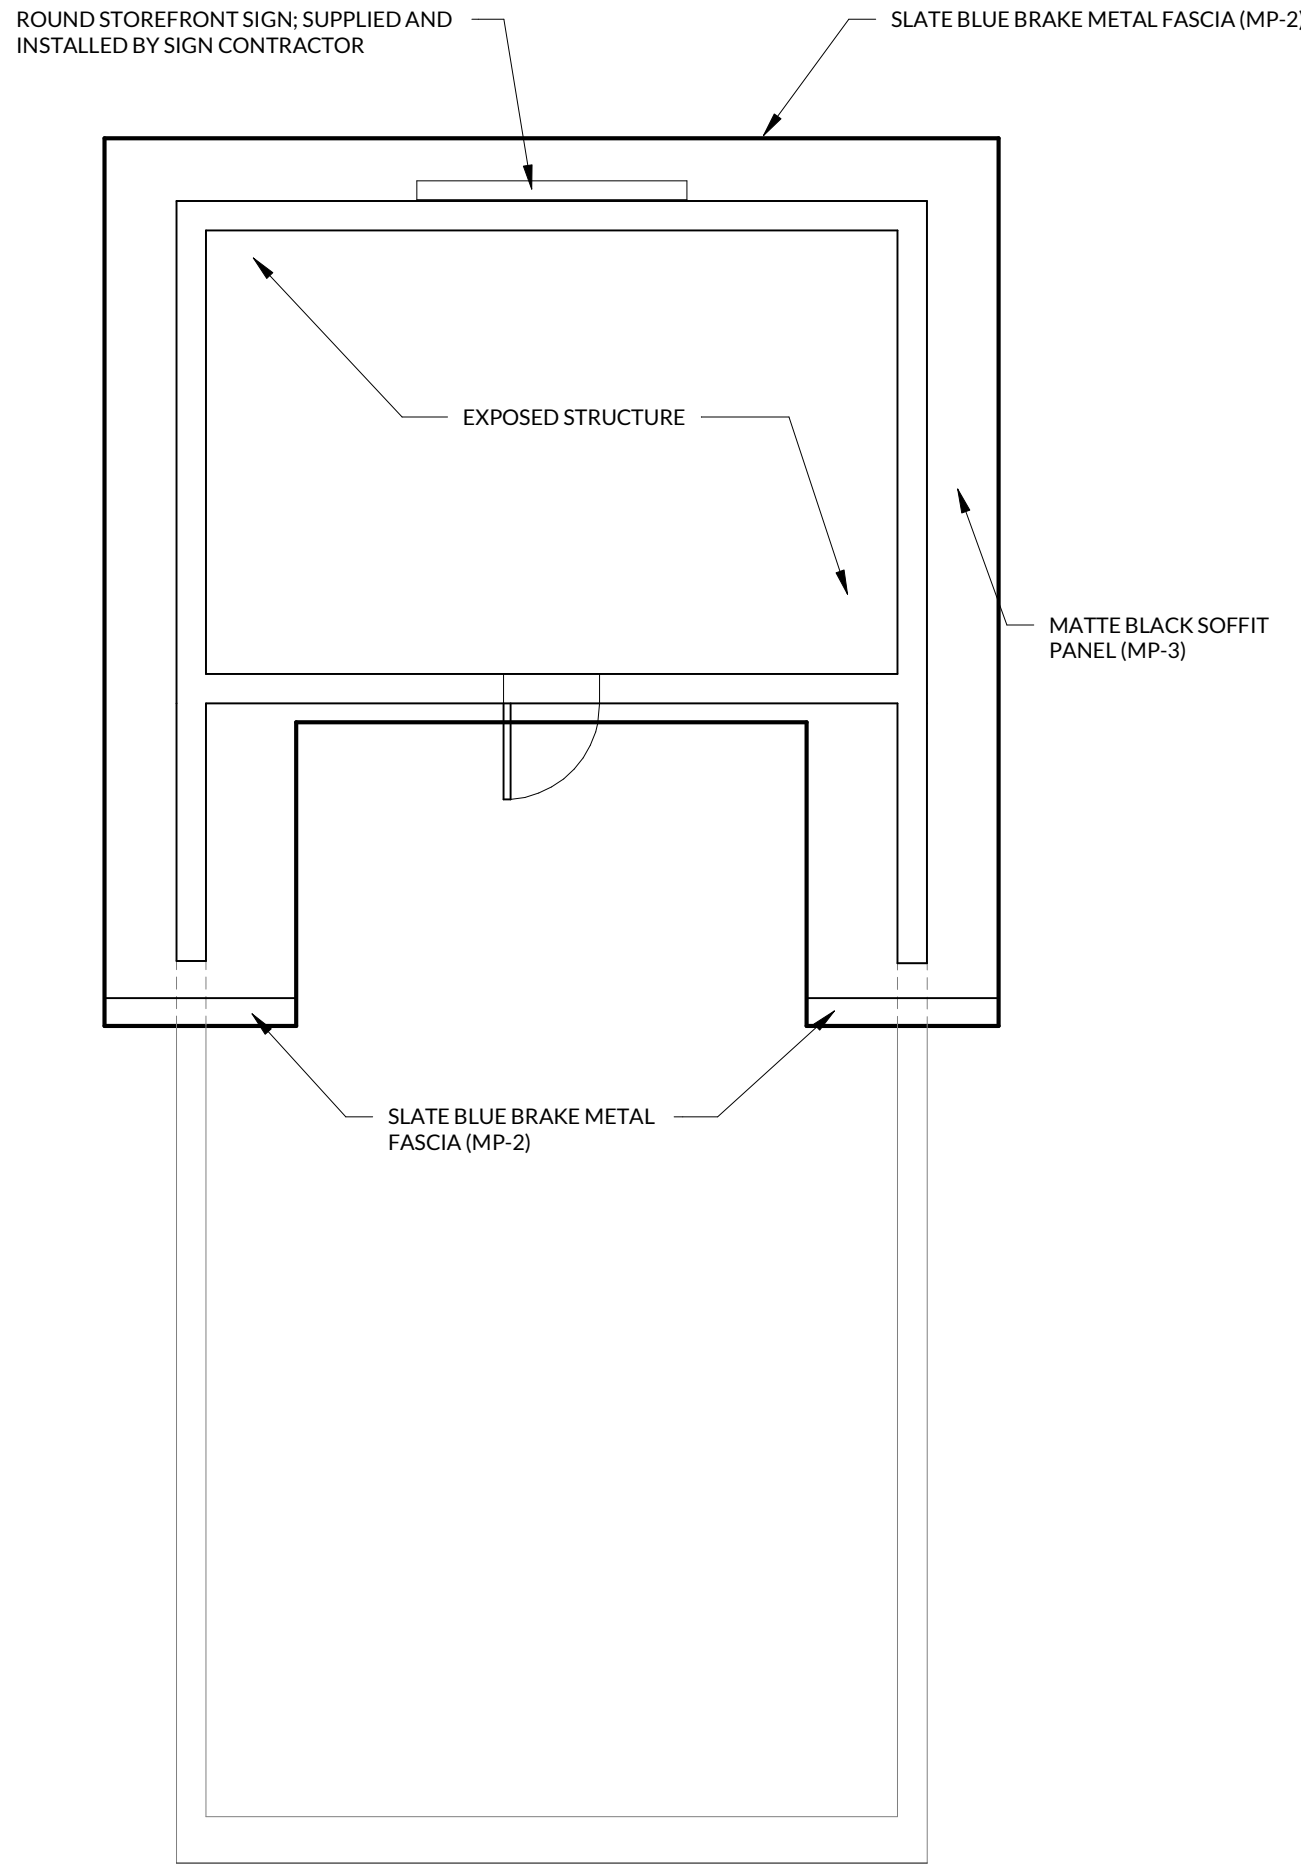


2 RCP - ATTIC FLOOR  
1/4" = 1'-0"




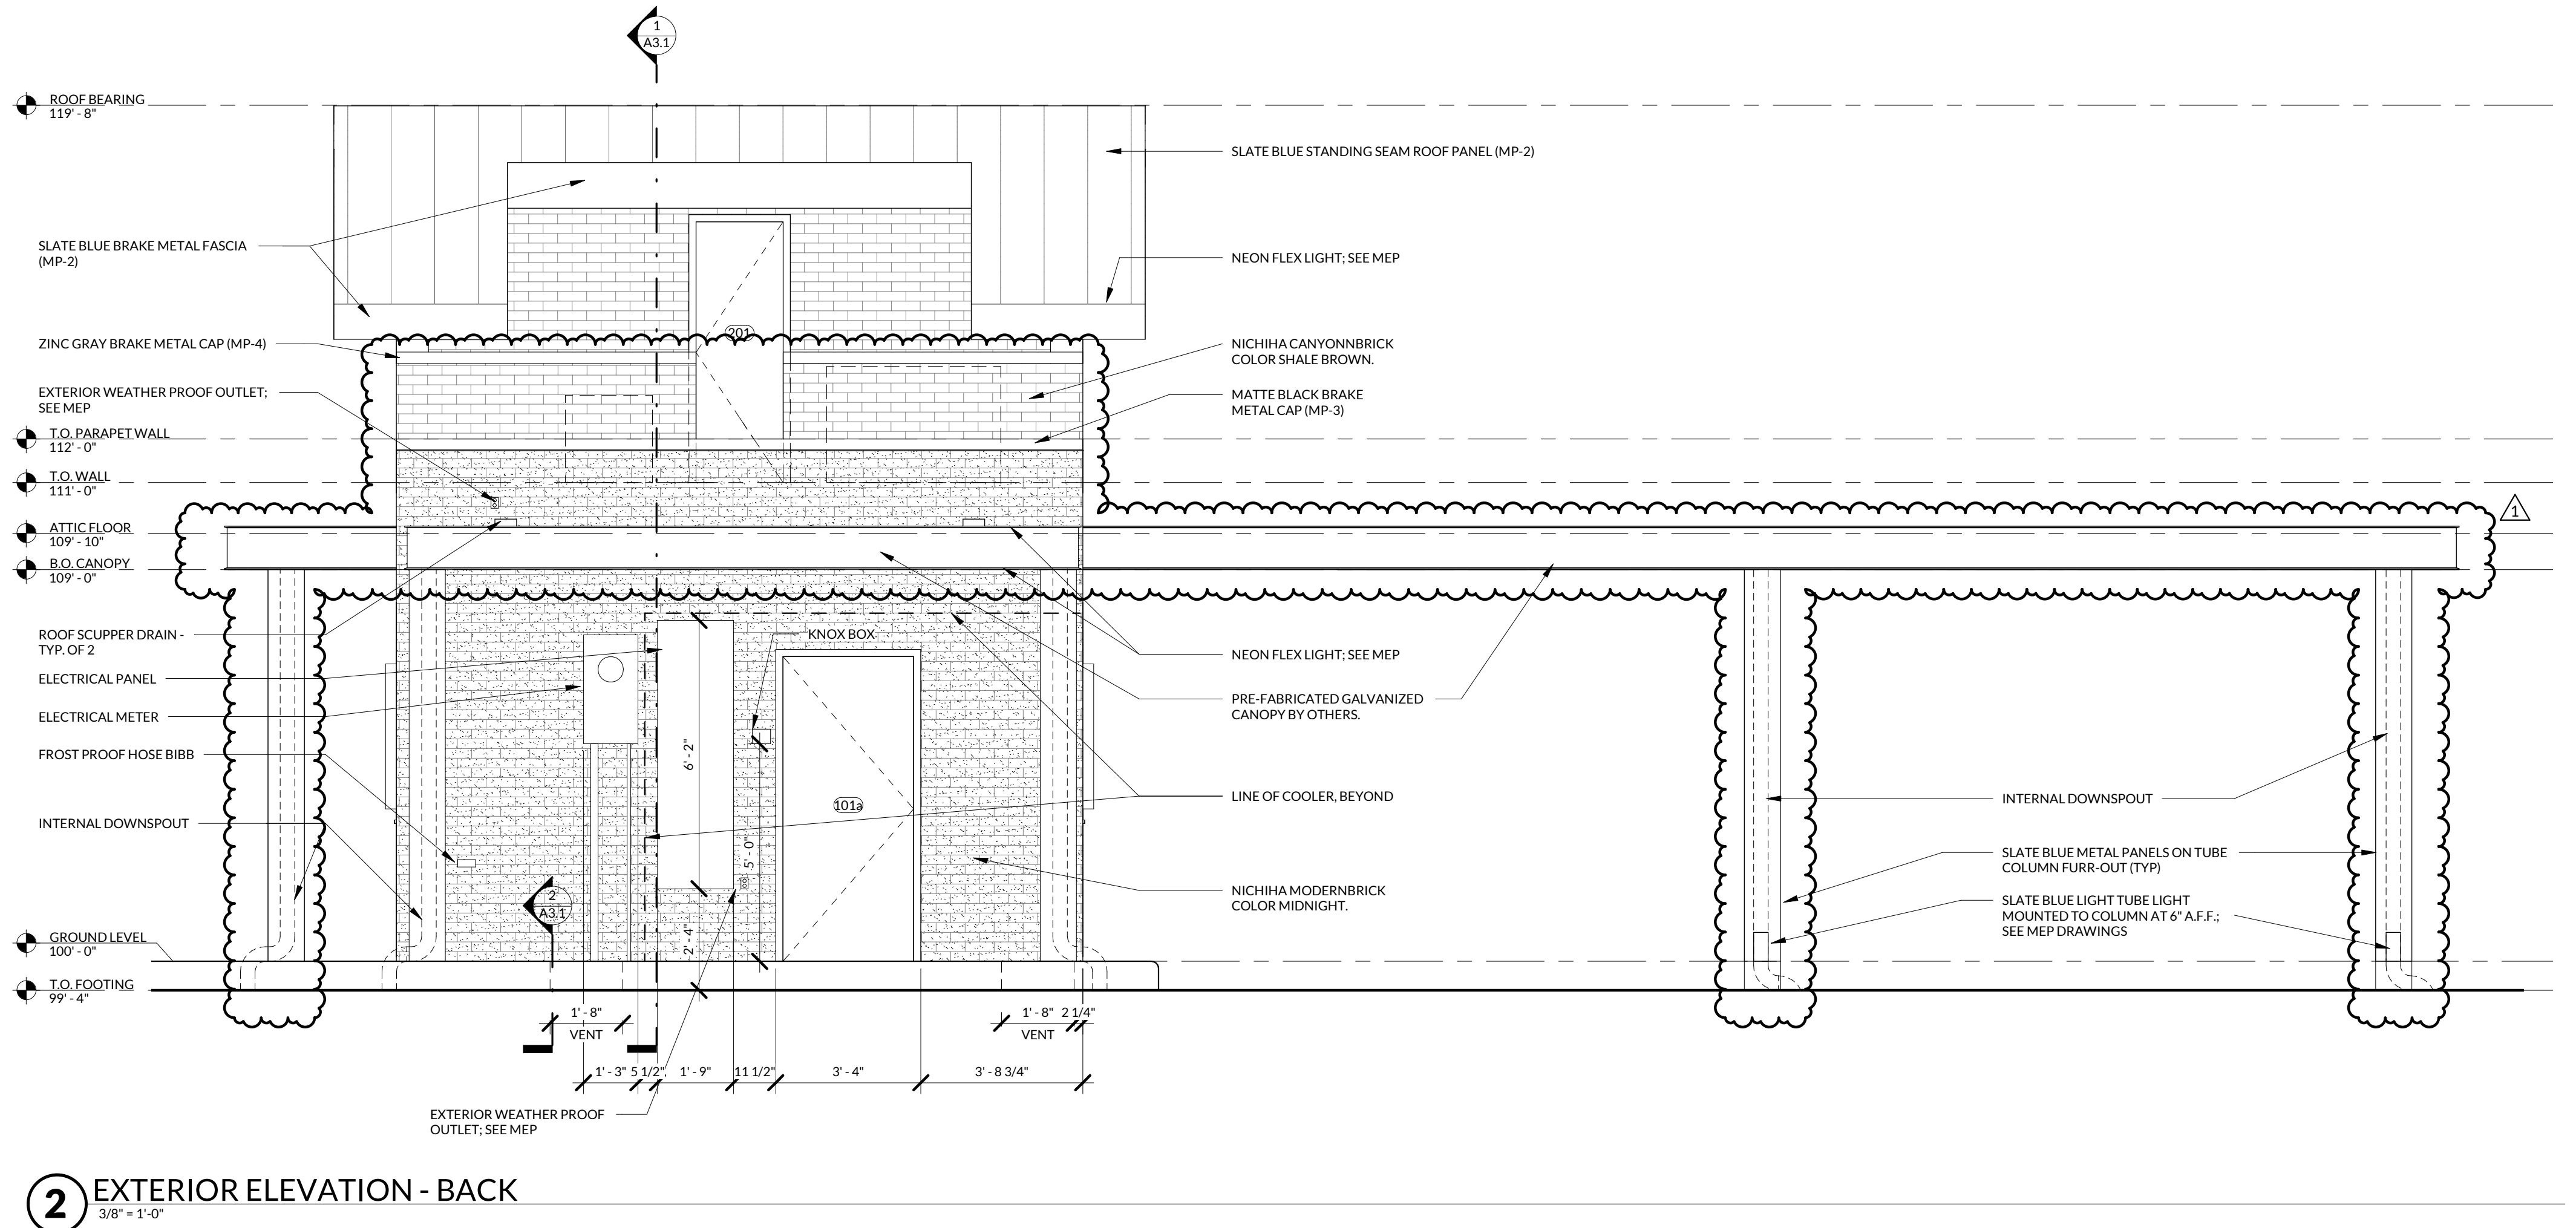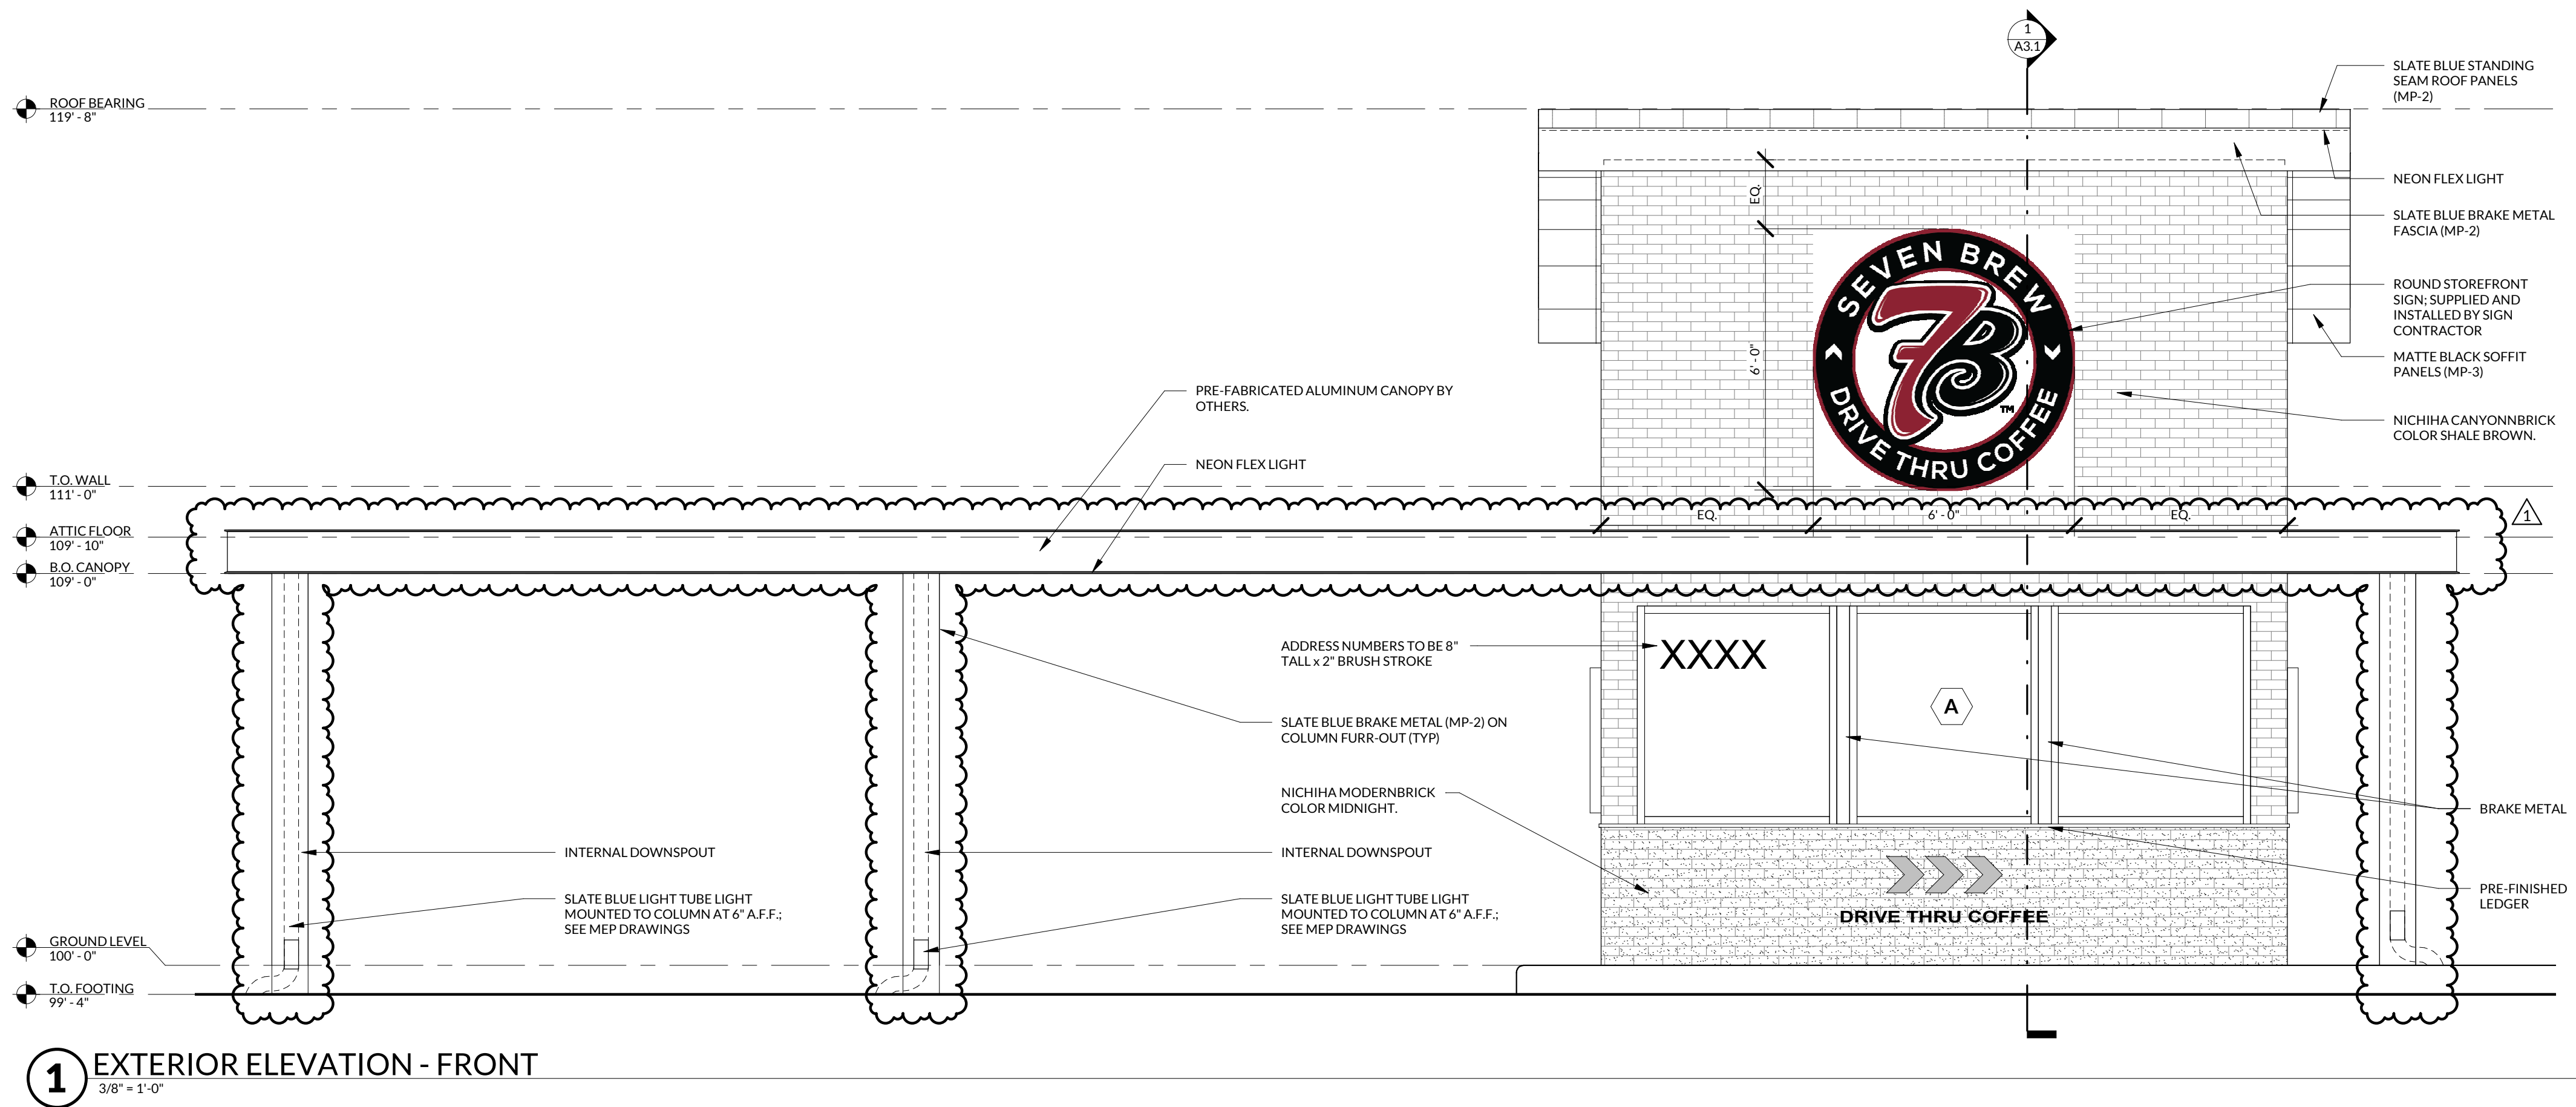



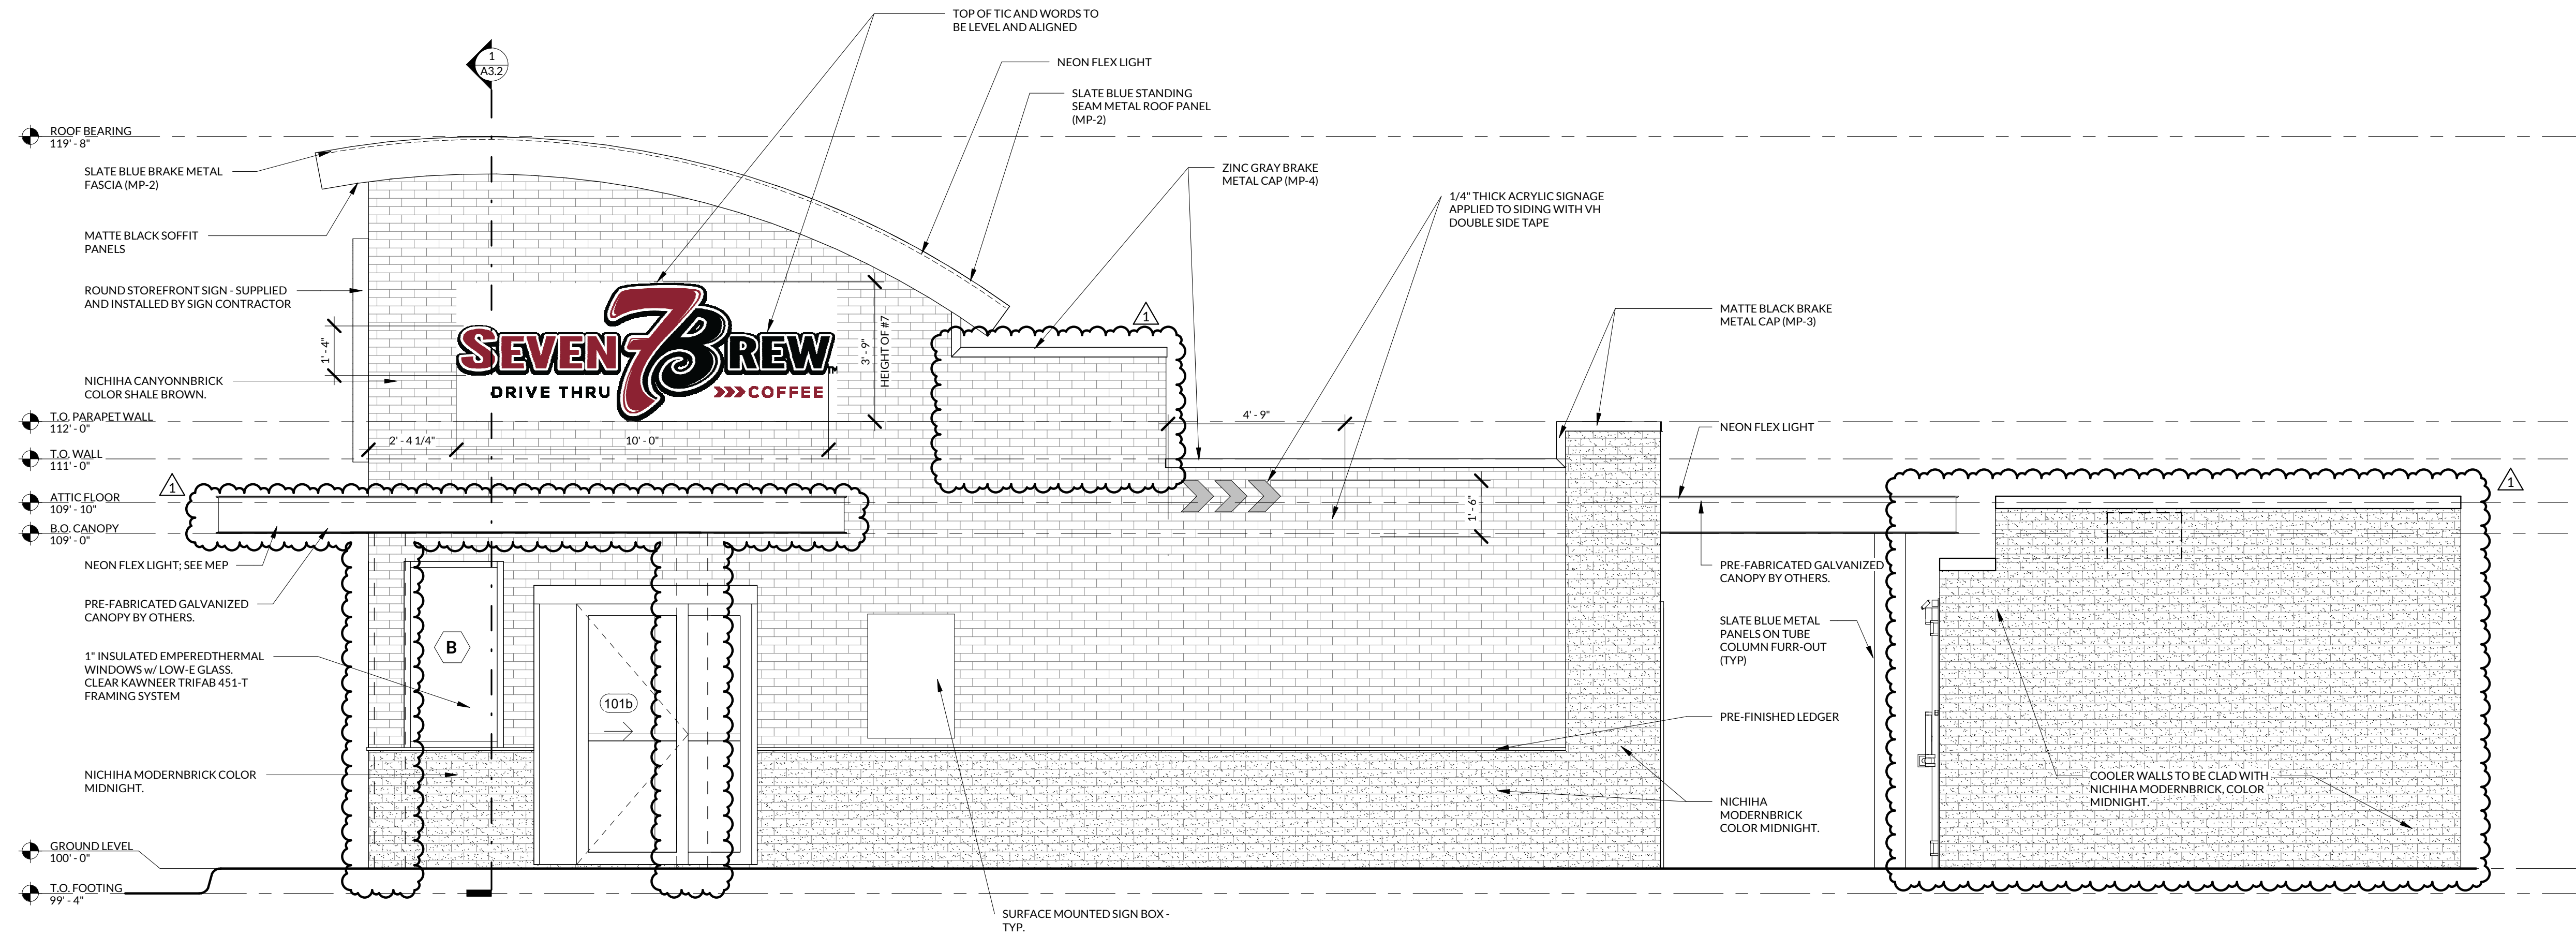


1 EXTERIOR ELEVATION - RIGHT SIDE  
3/8" = 1'-0"

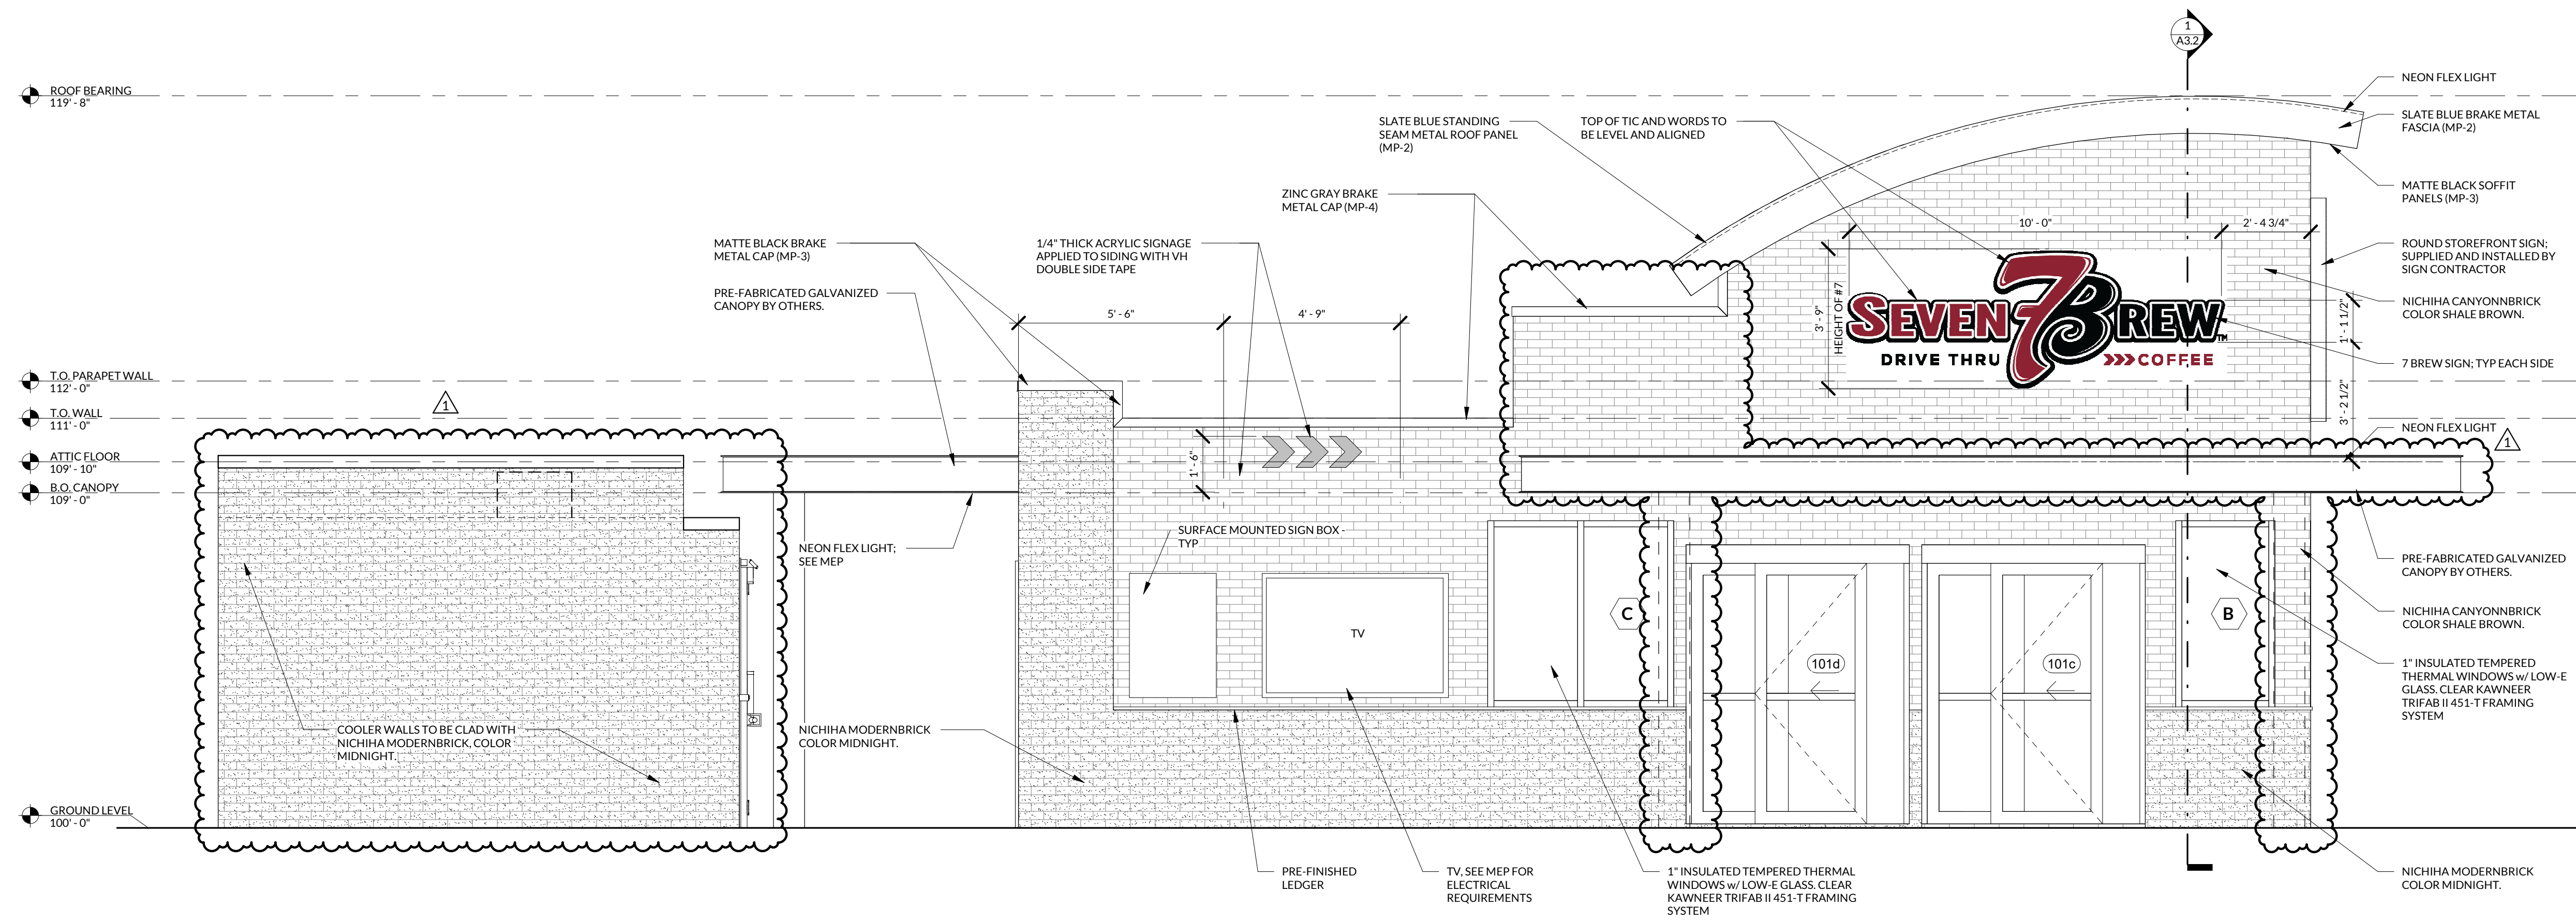


2 EXTERIOR ELEVATION - LEFT SIDE  
3/8" = 1'-0"



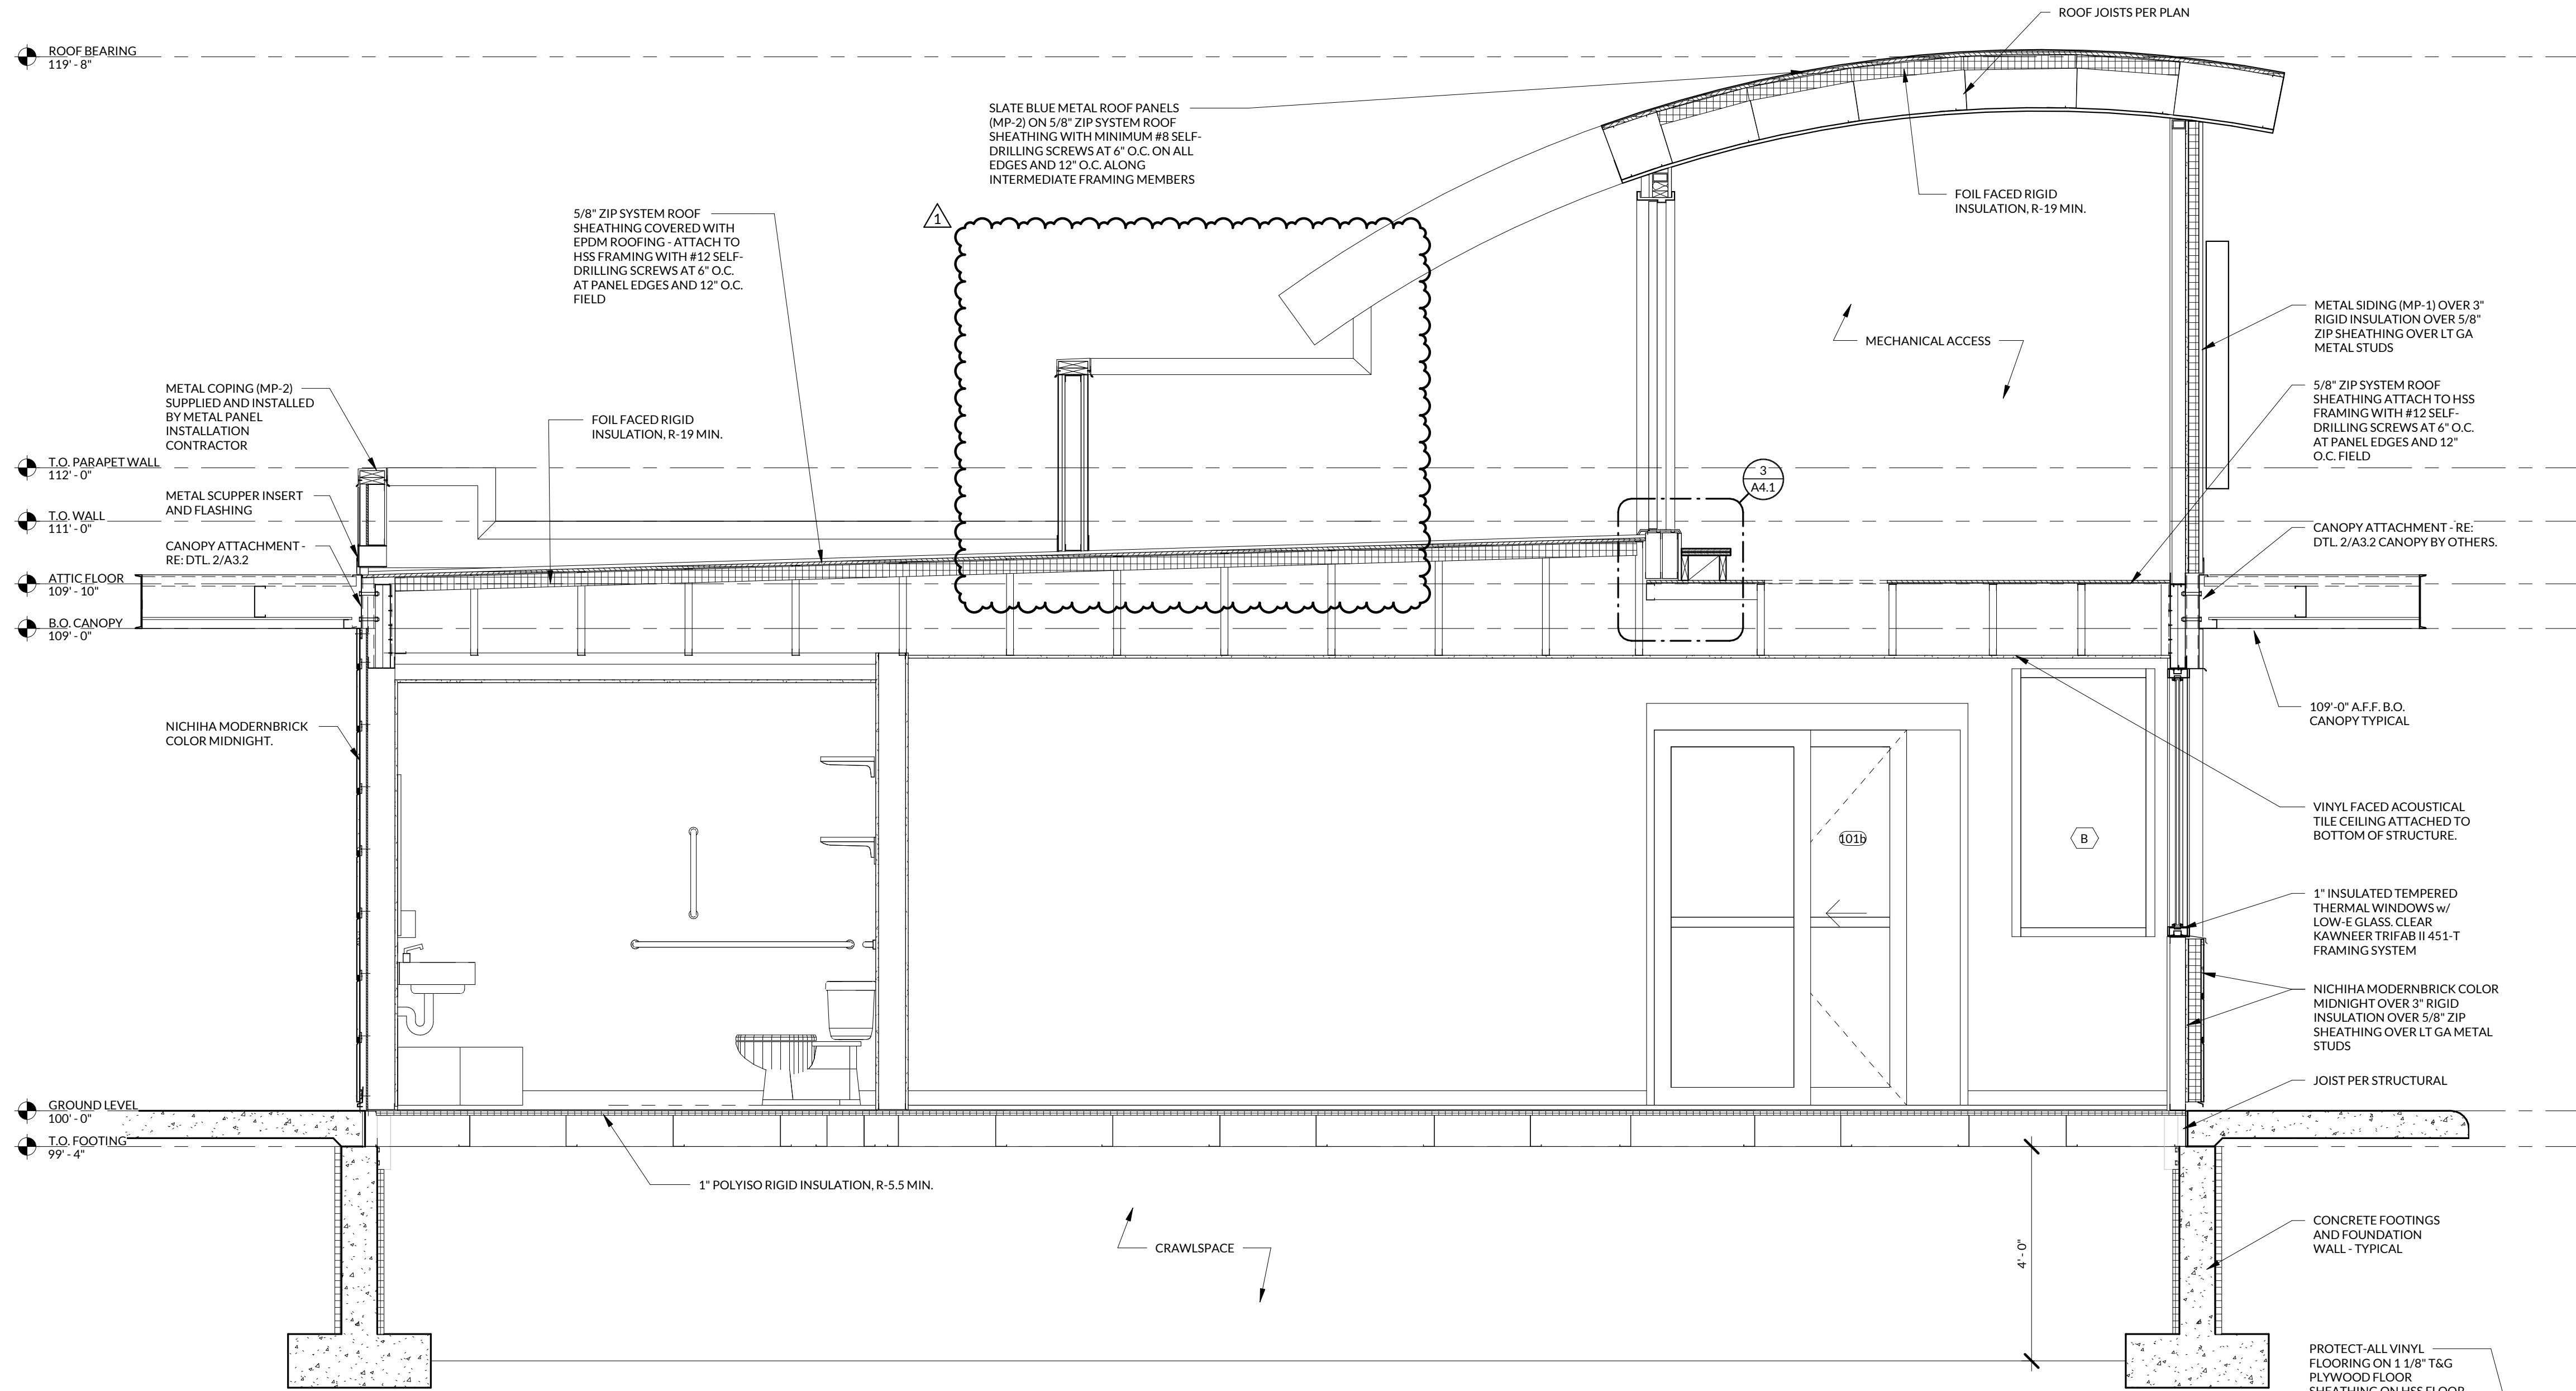


1 BUILDING SECTION  
1/2" = 1'-0"

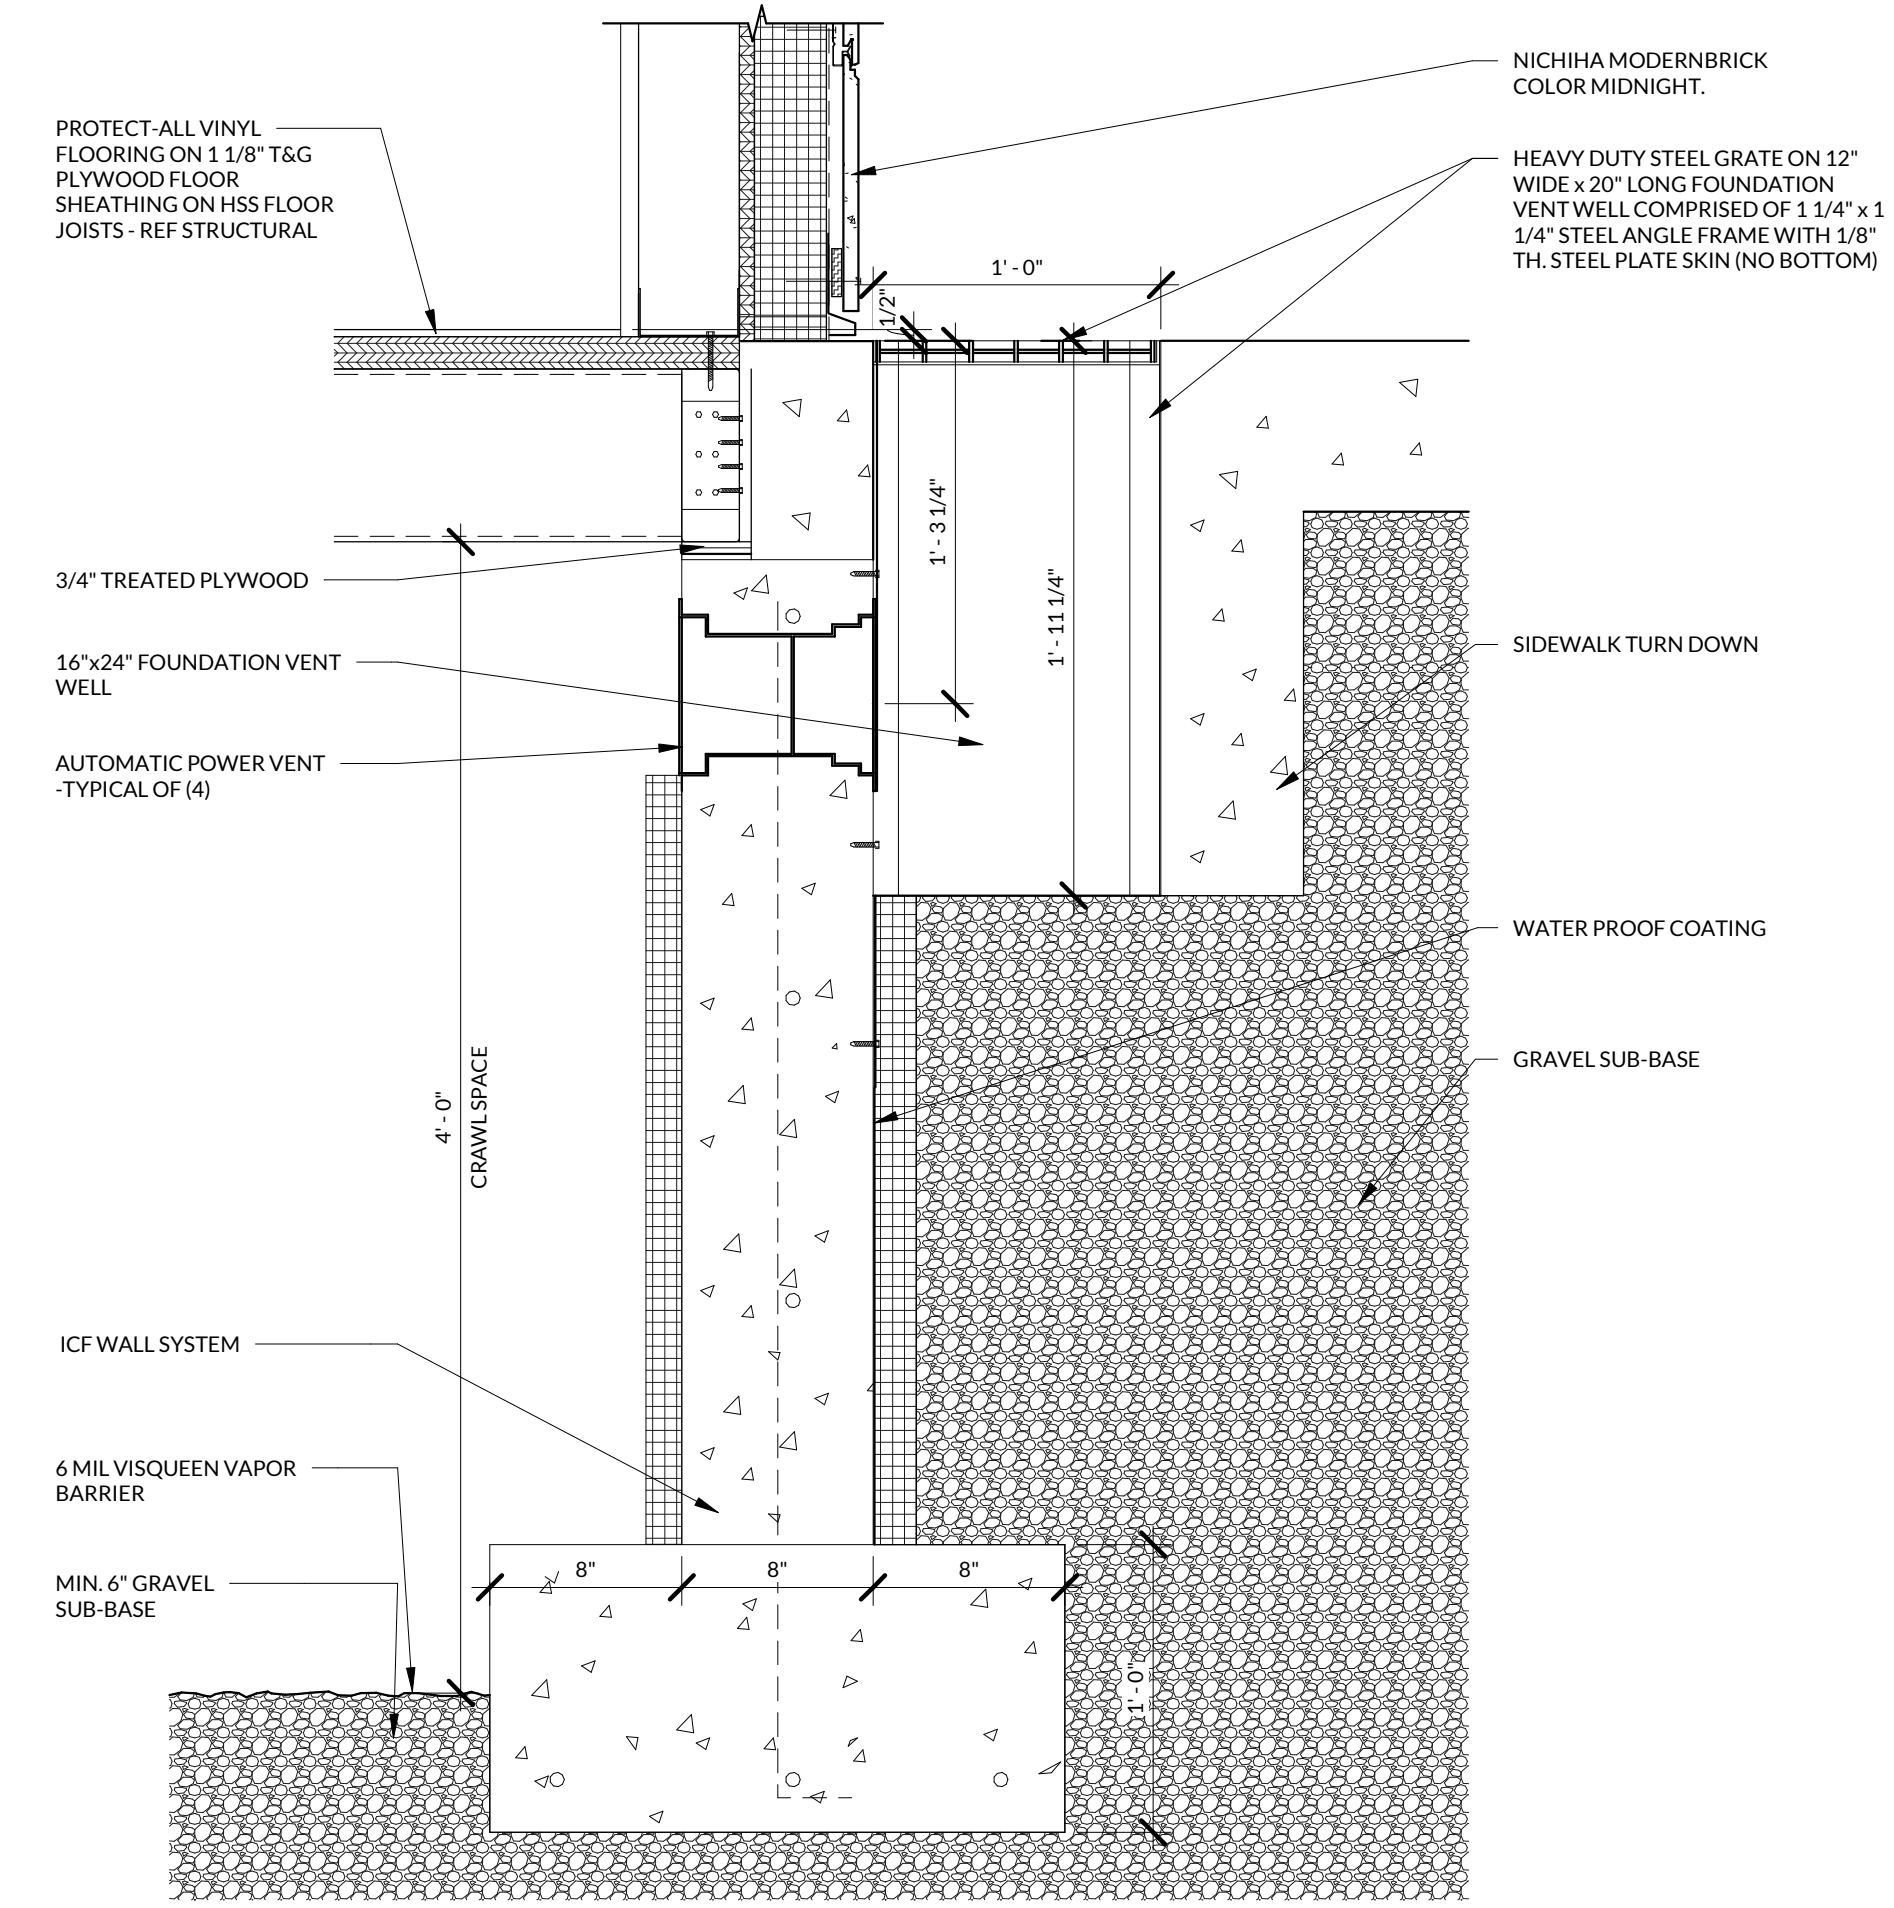

2 FOUNDATION VENT WELL DETAIL  
1 1/2" = 1'-0"

7 BREW COFFEE  
**LEE'S SUMMIT, MO**

1430 NE DOUGLAS ST.  
LEE'S SUMMIT, MO 64086

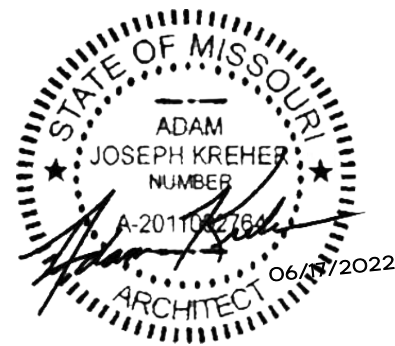

ARCHITECT OF RECORD:  
NAME: ADAM KREHER  
LICENSE NO. 2011002764


PROJECT NUMBER:  
220337BLS

REVISION: ADD 001  
6/17/22


**A3.1**

SECTIONS AND  
DETAILS  
DATE: APRIL 22, 2022




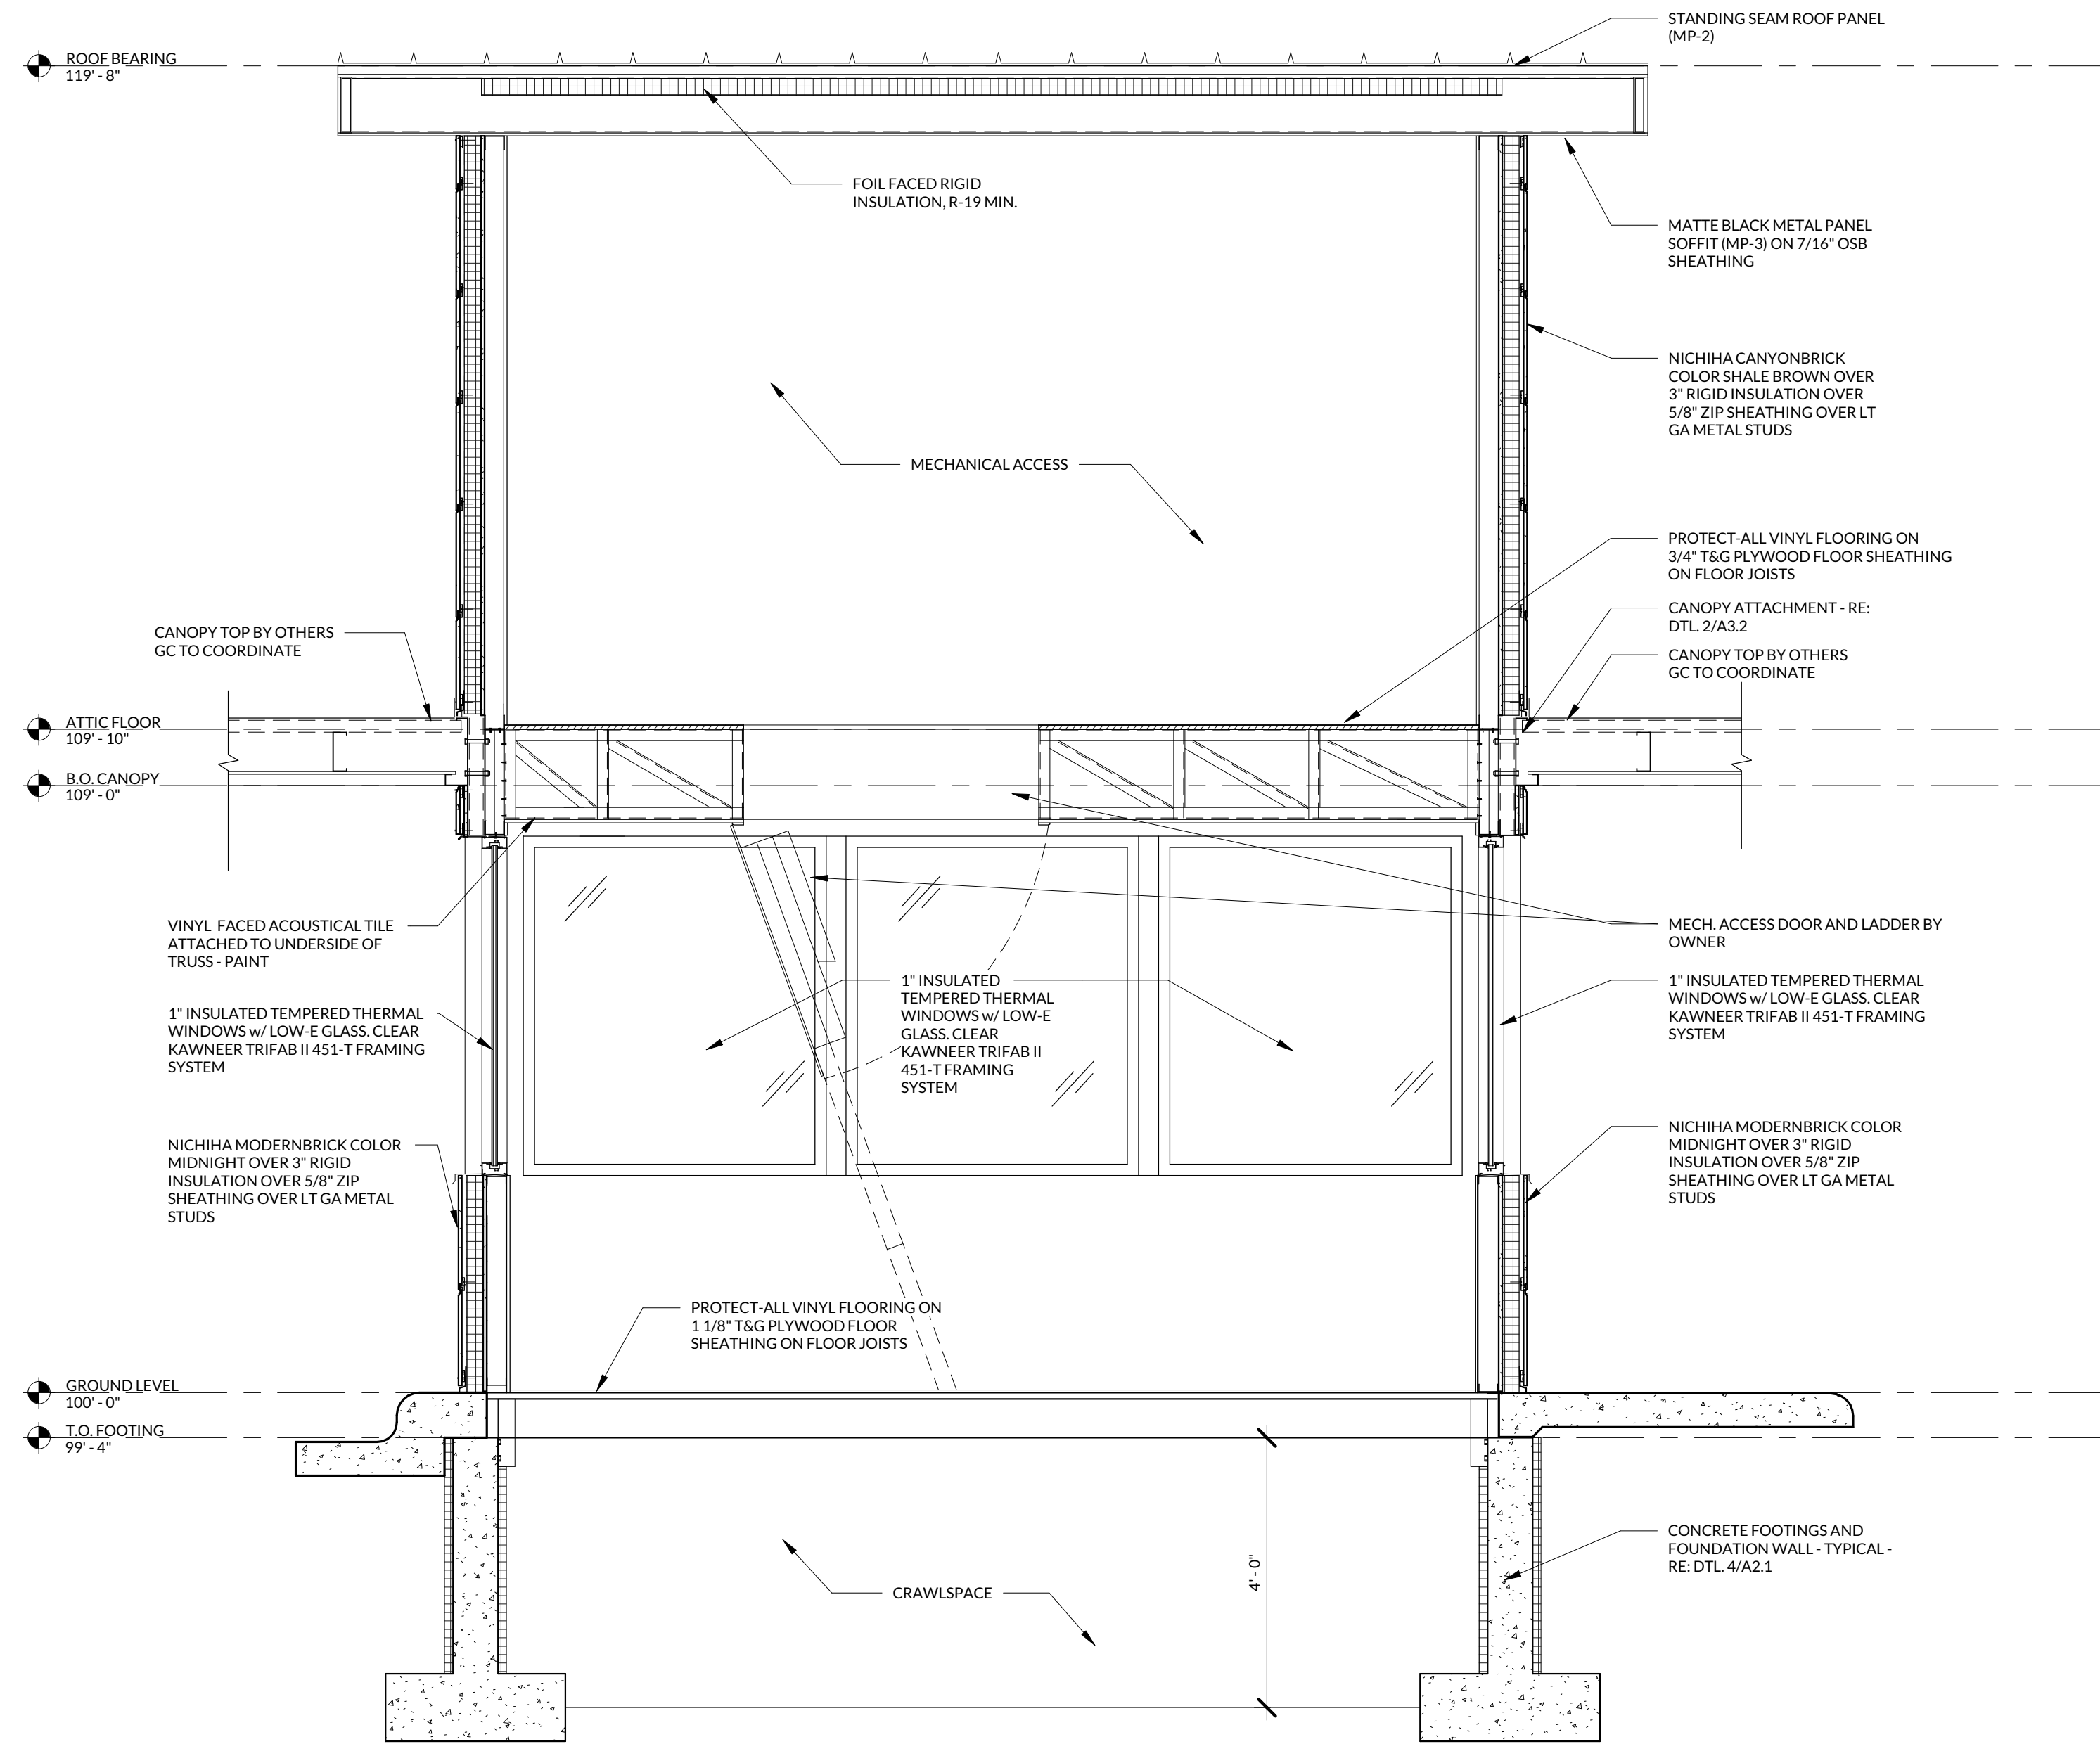


**1** BUILDING SECTION  
1/2" = 1'-0"

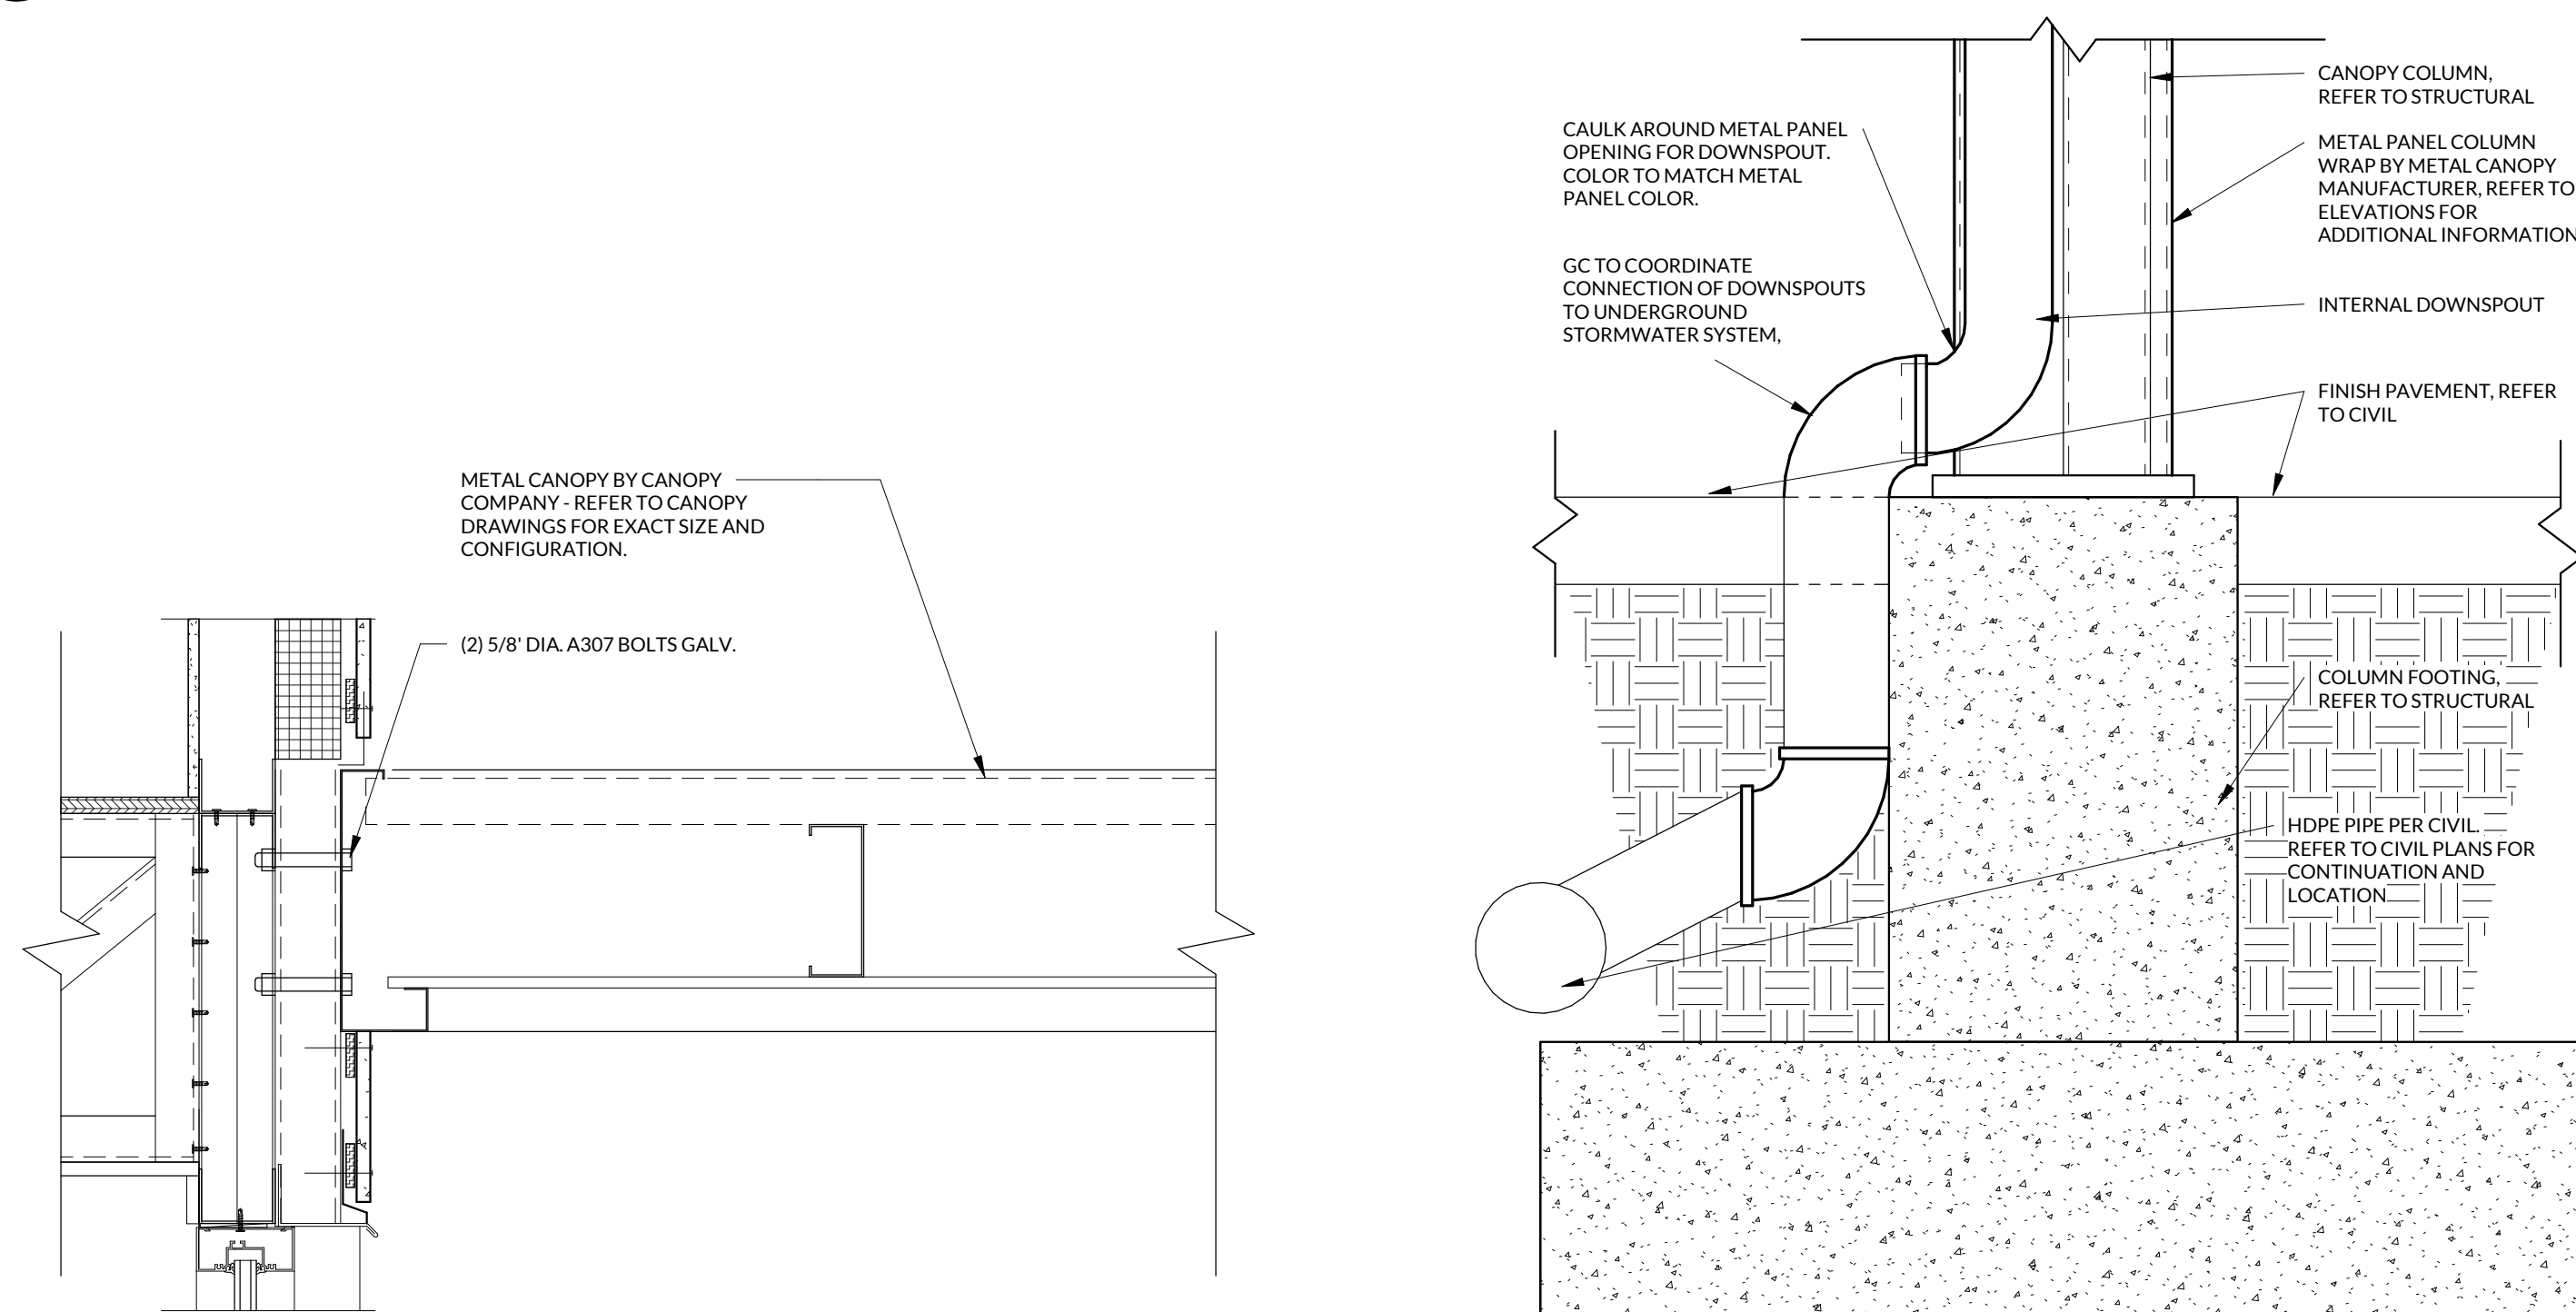


**2** DETAIL - CANOPY CONNECTION DETAIL  
1 1/2" = 1'-0"

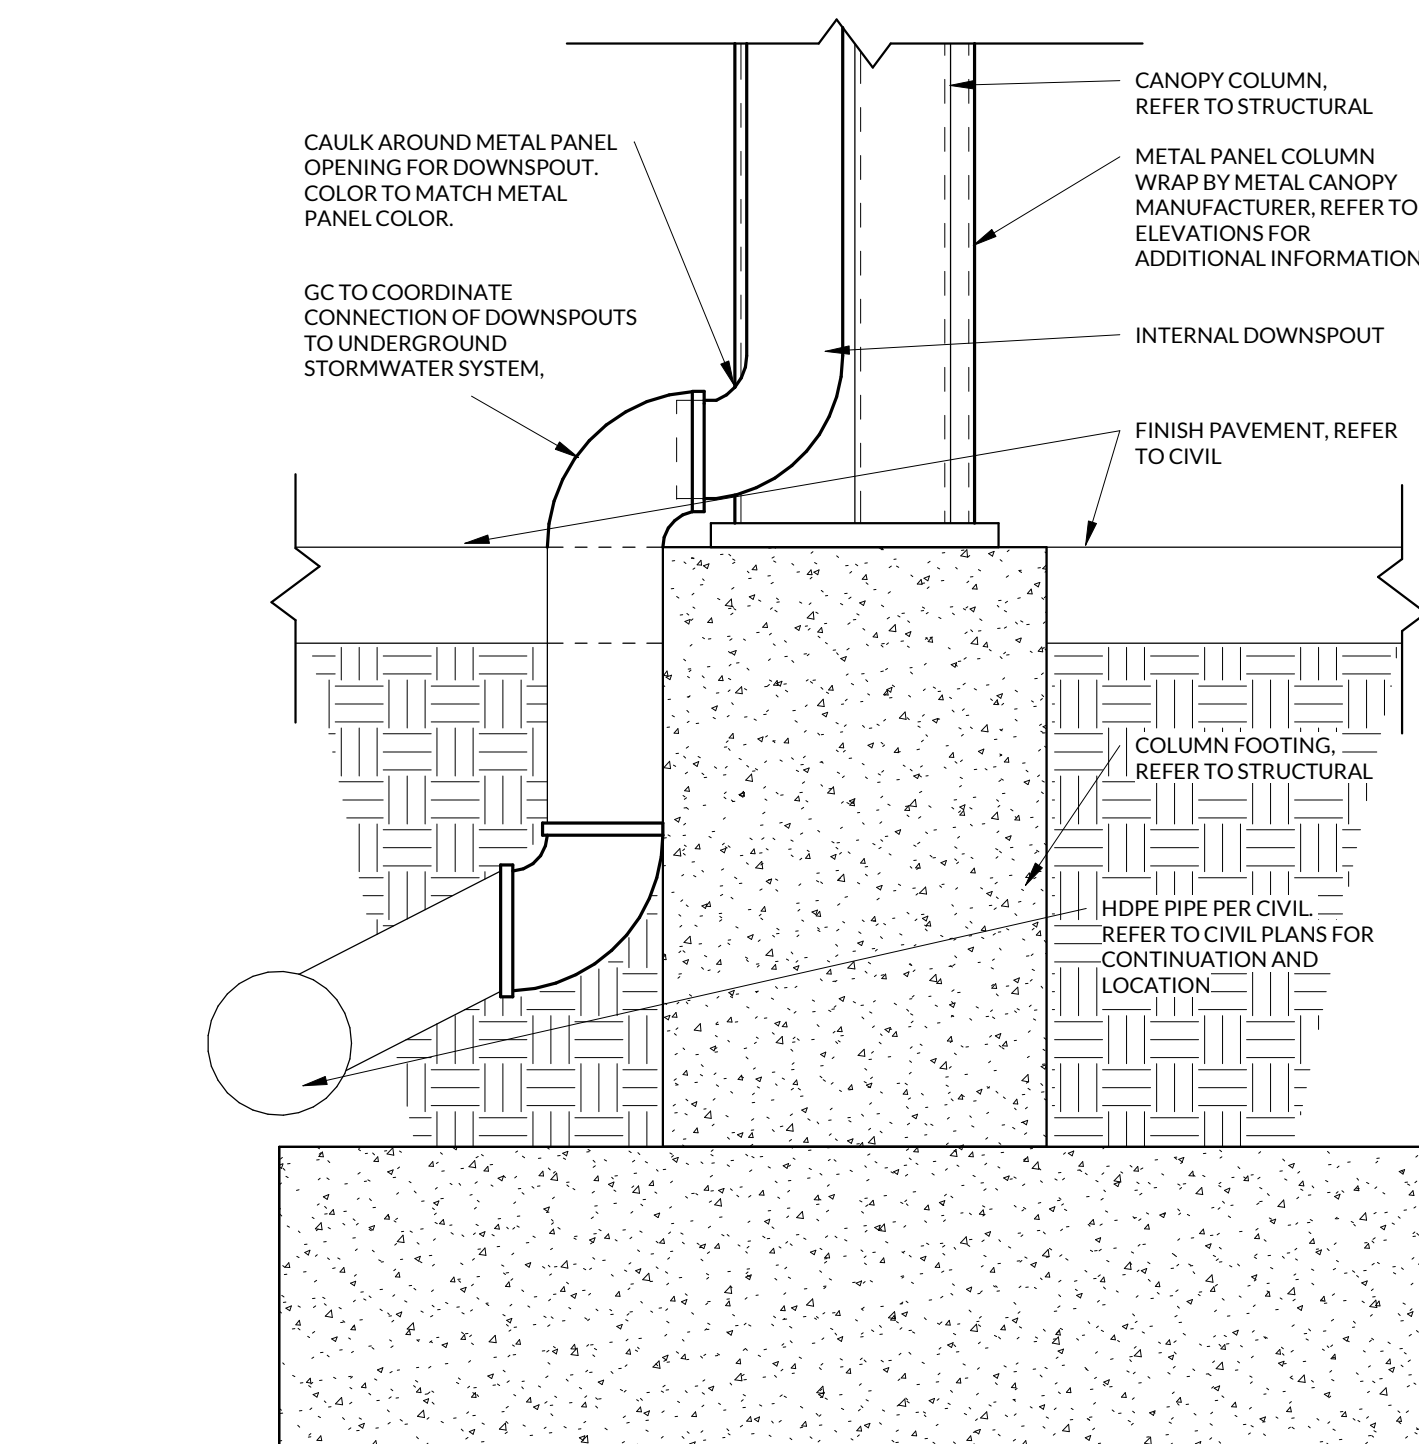

**3** DETAIL - DOWNSPOUT COLLECTION CONNECTION  
1 1/2" = 1'-0"

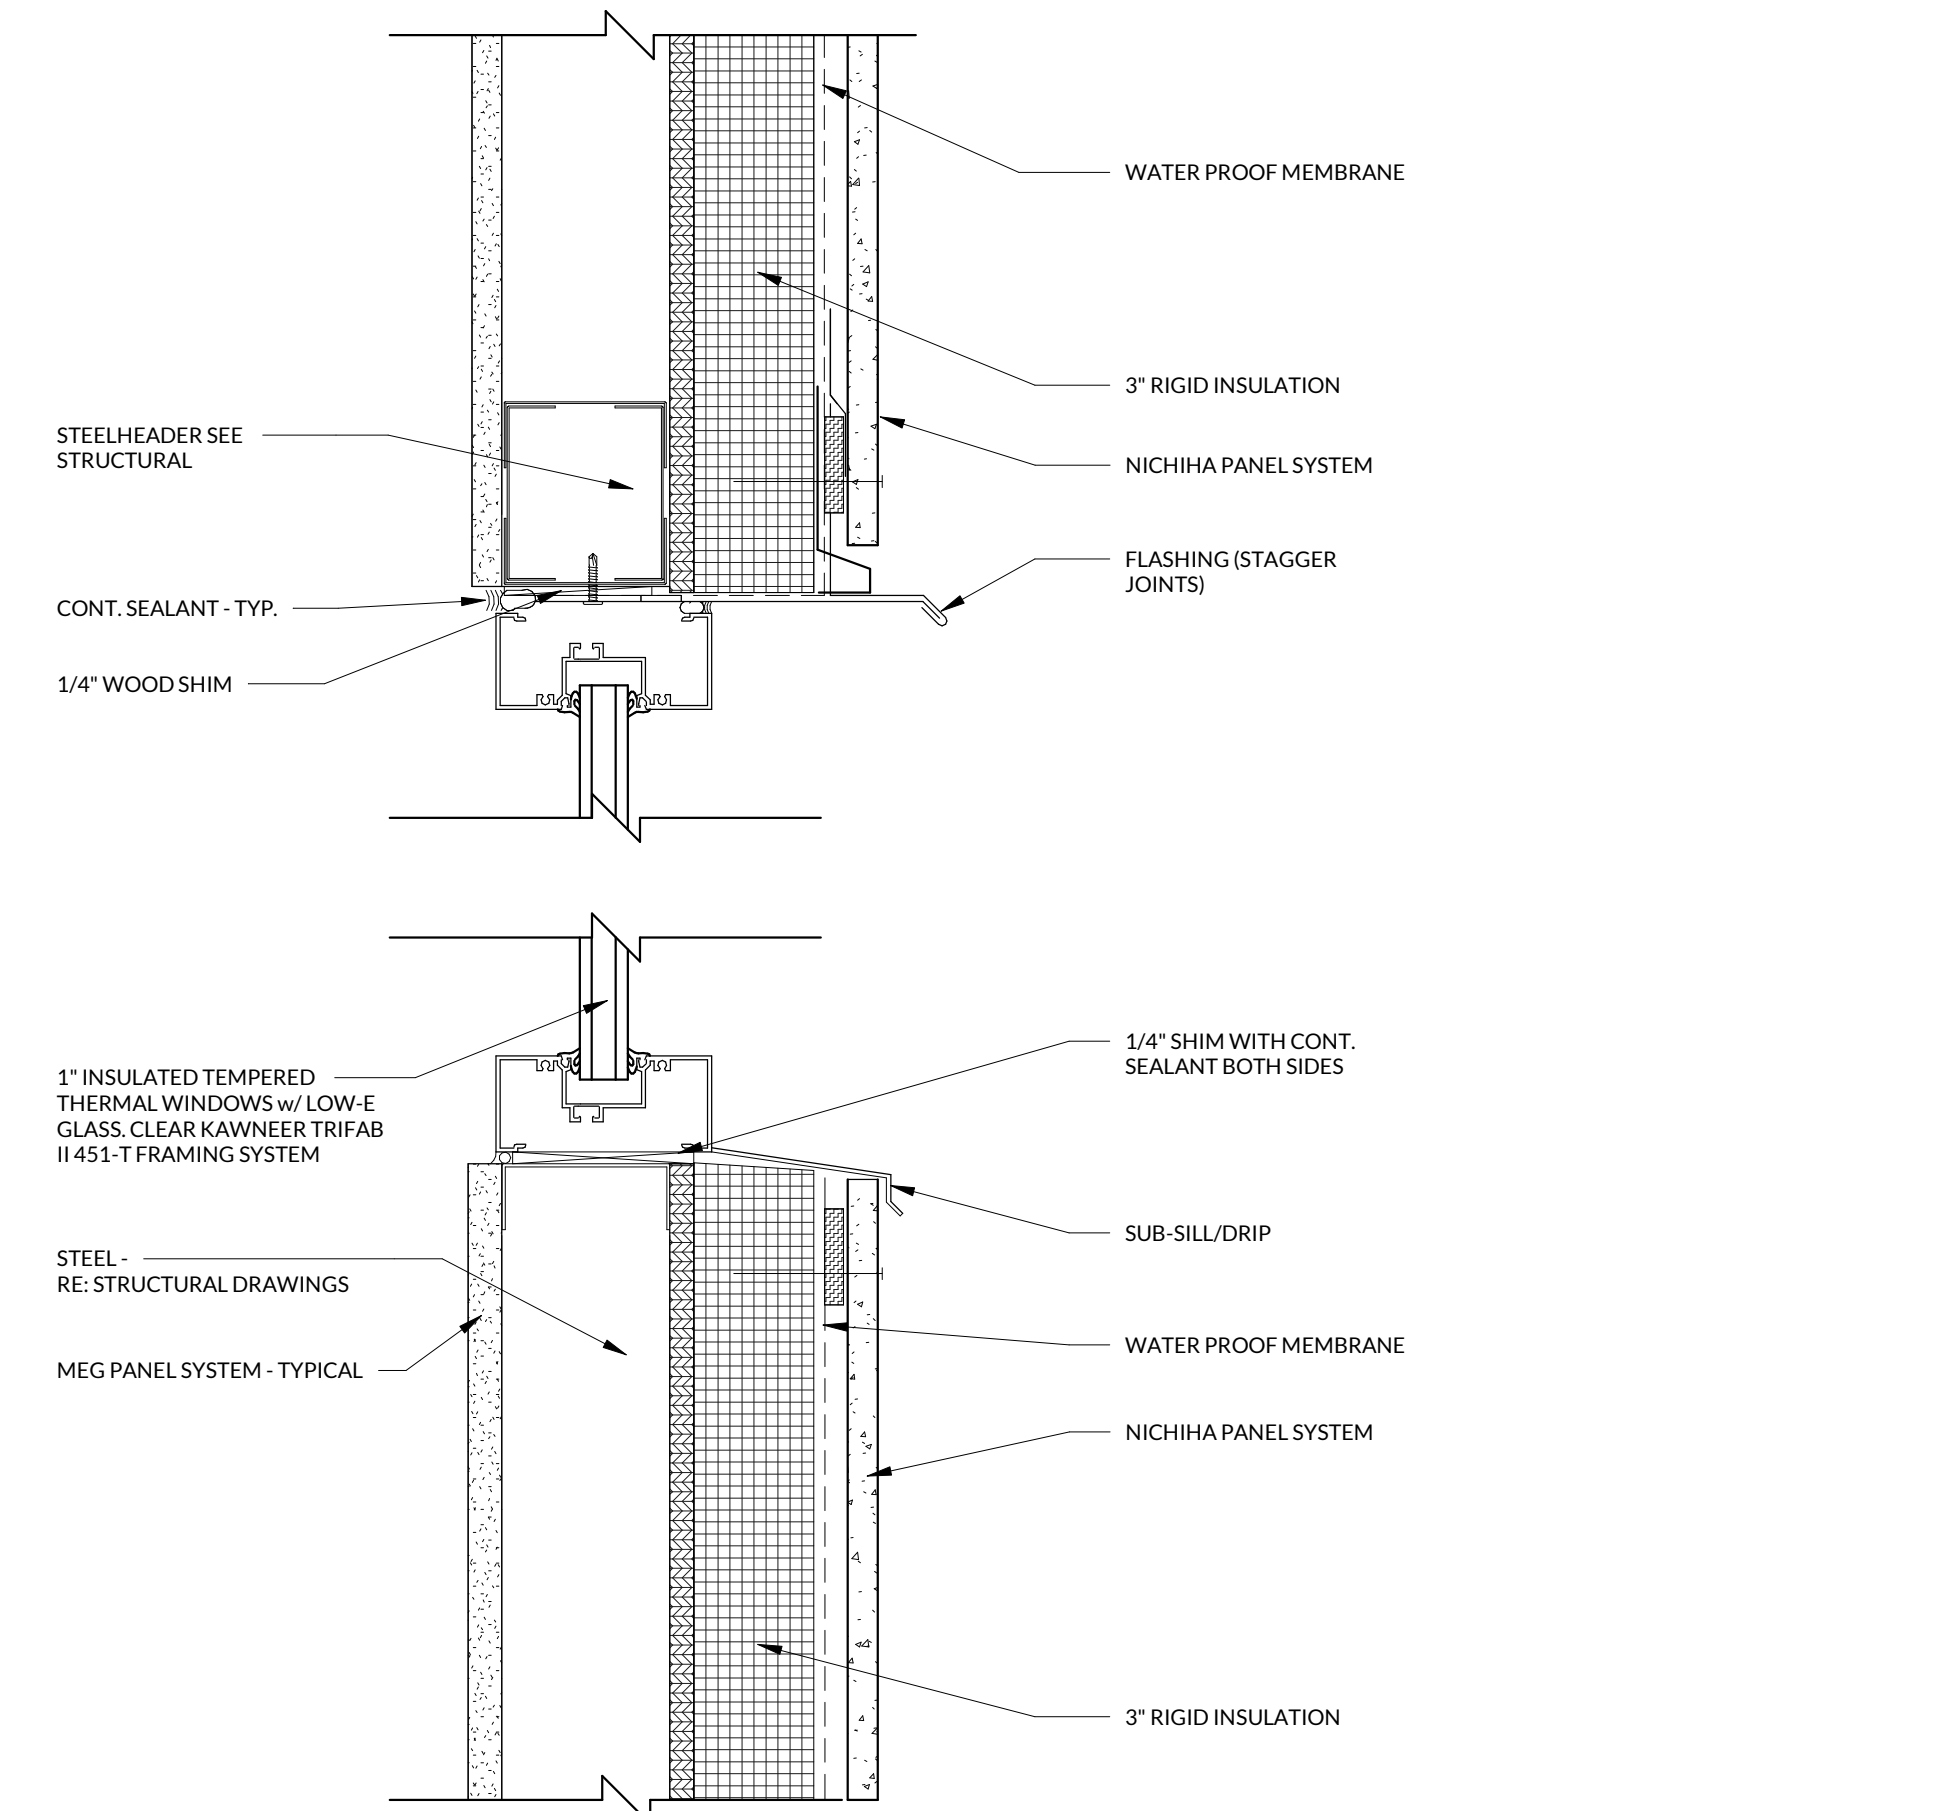

**4** ENLARGED WALL SECTION AT WINDOW  
3" = 1'-0"

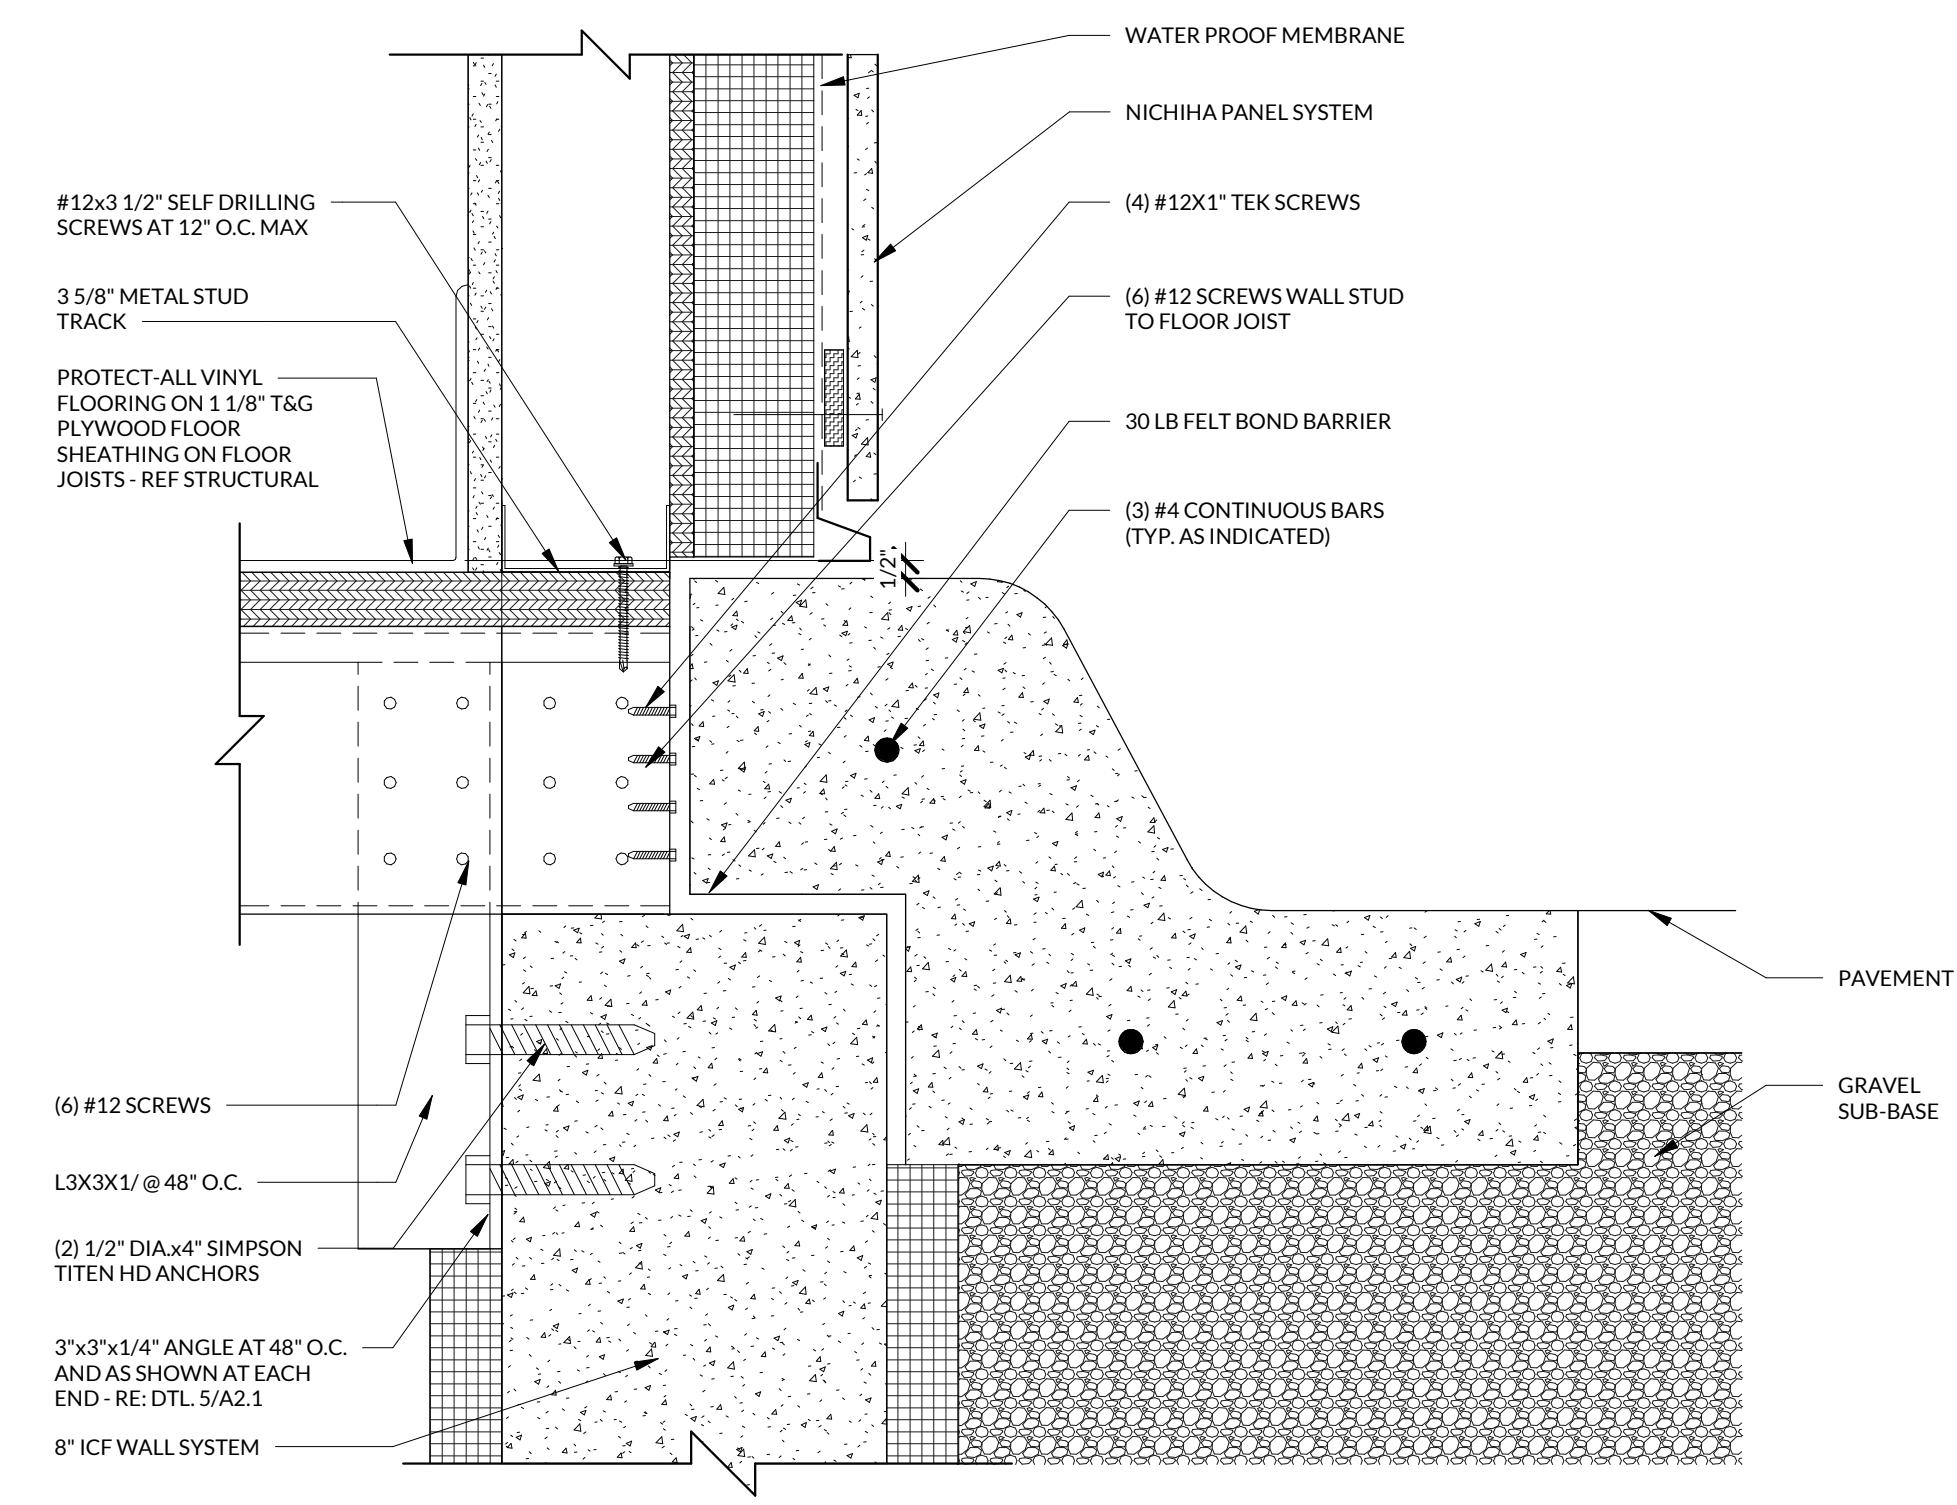

**7 BREW COFFEE**  
**LEE'S SUMMIT, MO**

NW CORNER OF NE DOUGLAS ST AND NE VICTORIA DR  
LEE SUMMIT, MO 64086



ARCHITECT OF RECORD:  
NAME: ADAM KREHER  
LICENSE NO. 2011002764


PROJECT NUMBER:  
220337BLS

REVISION:


**A3.2**

SECTIONS AND  
DETAILS  
DATE: APRIL 22, 2022



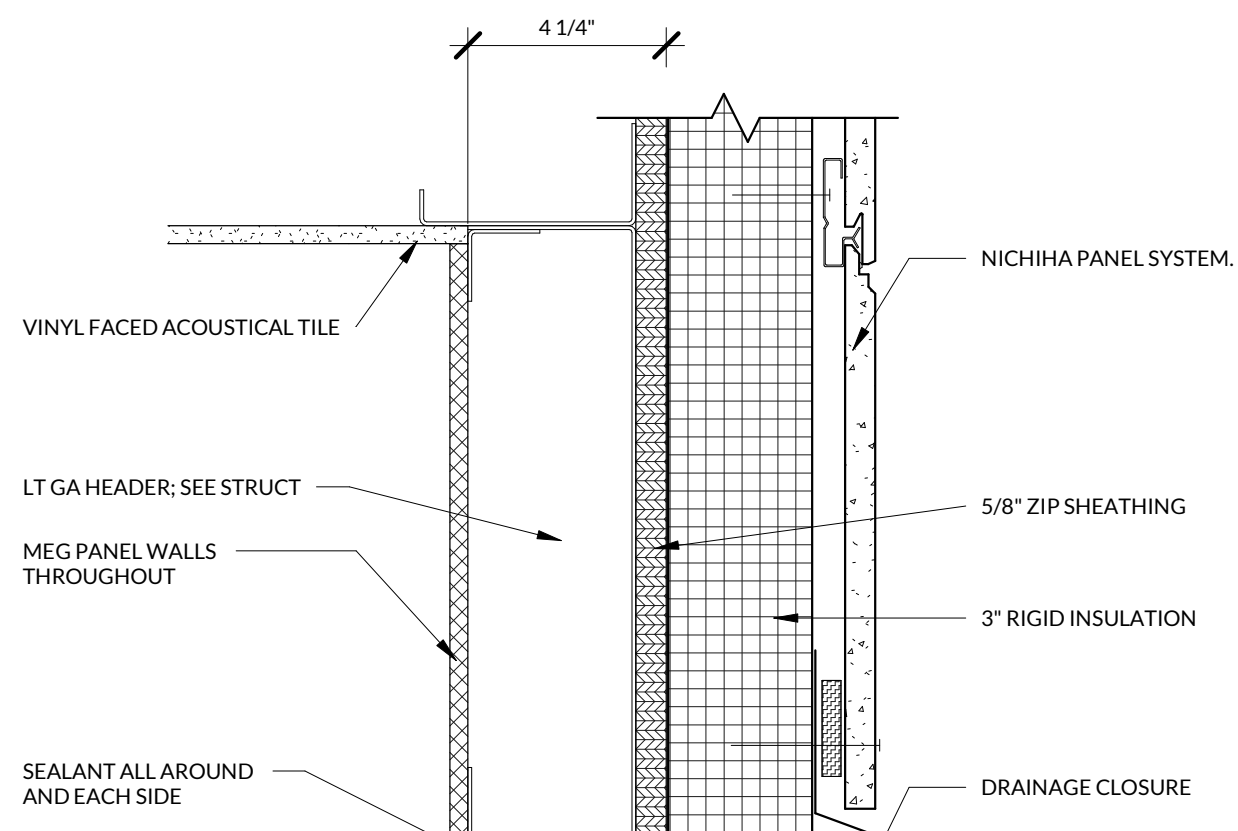


2 DOOR HEAD @ 3" INSUL PANEL  
3" = 1'-0"

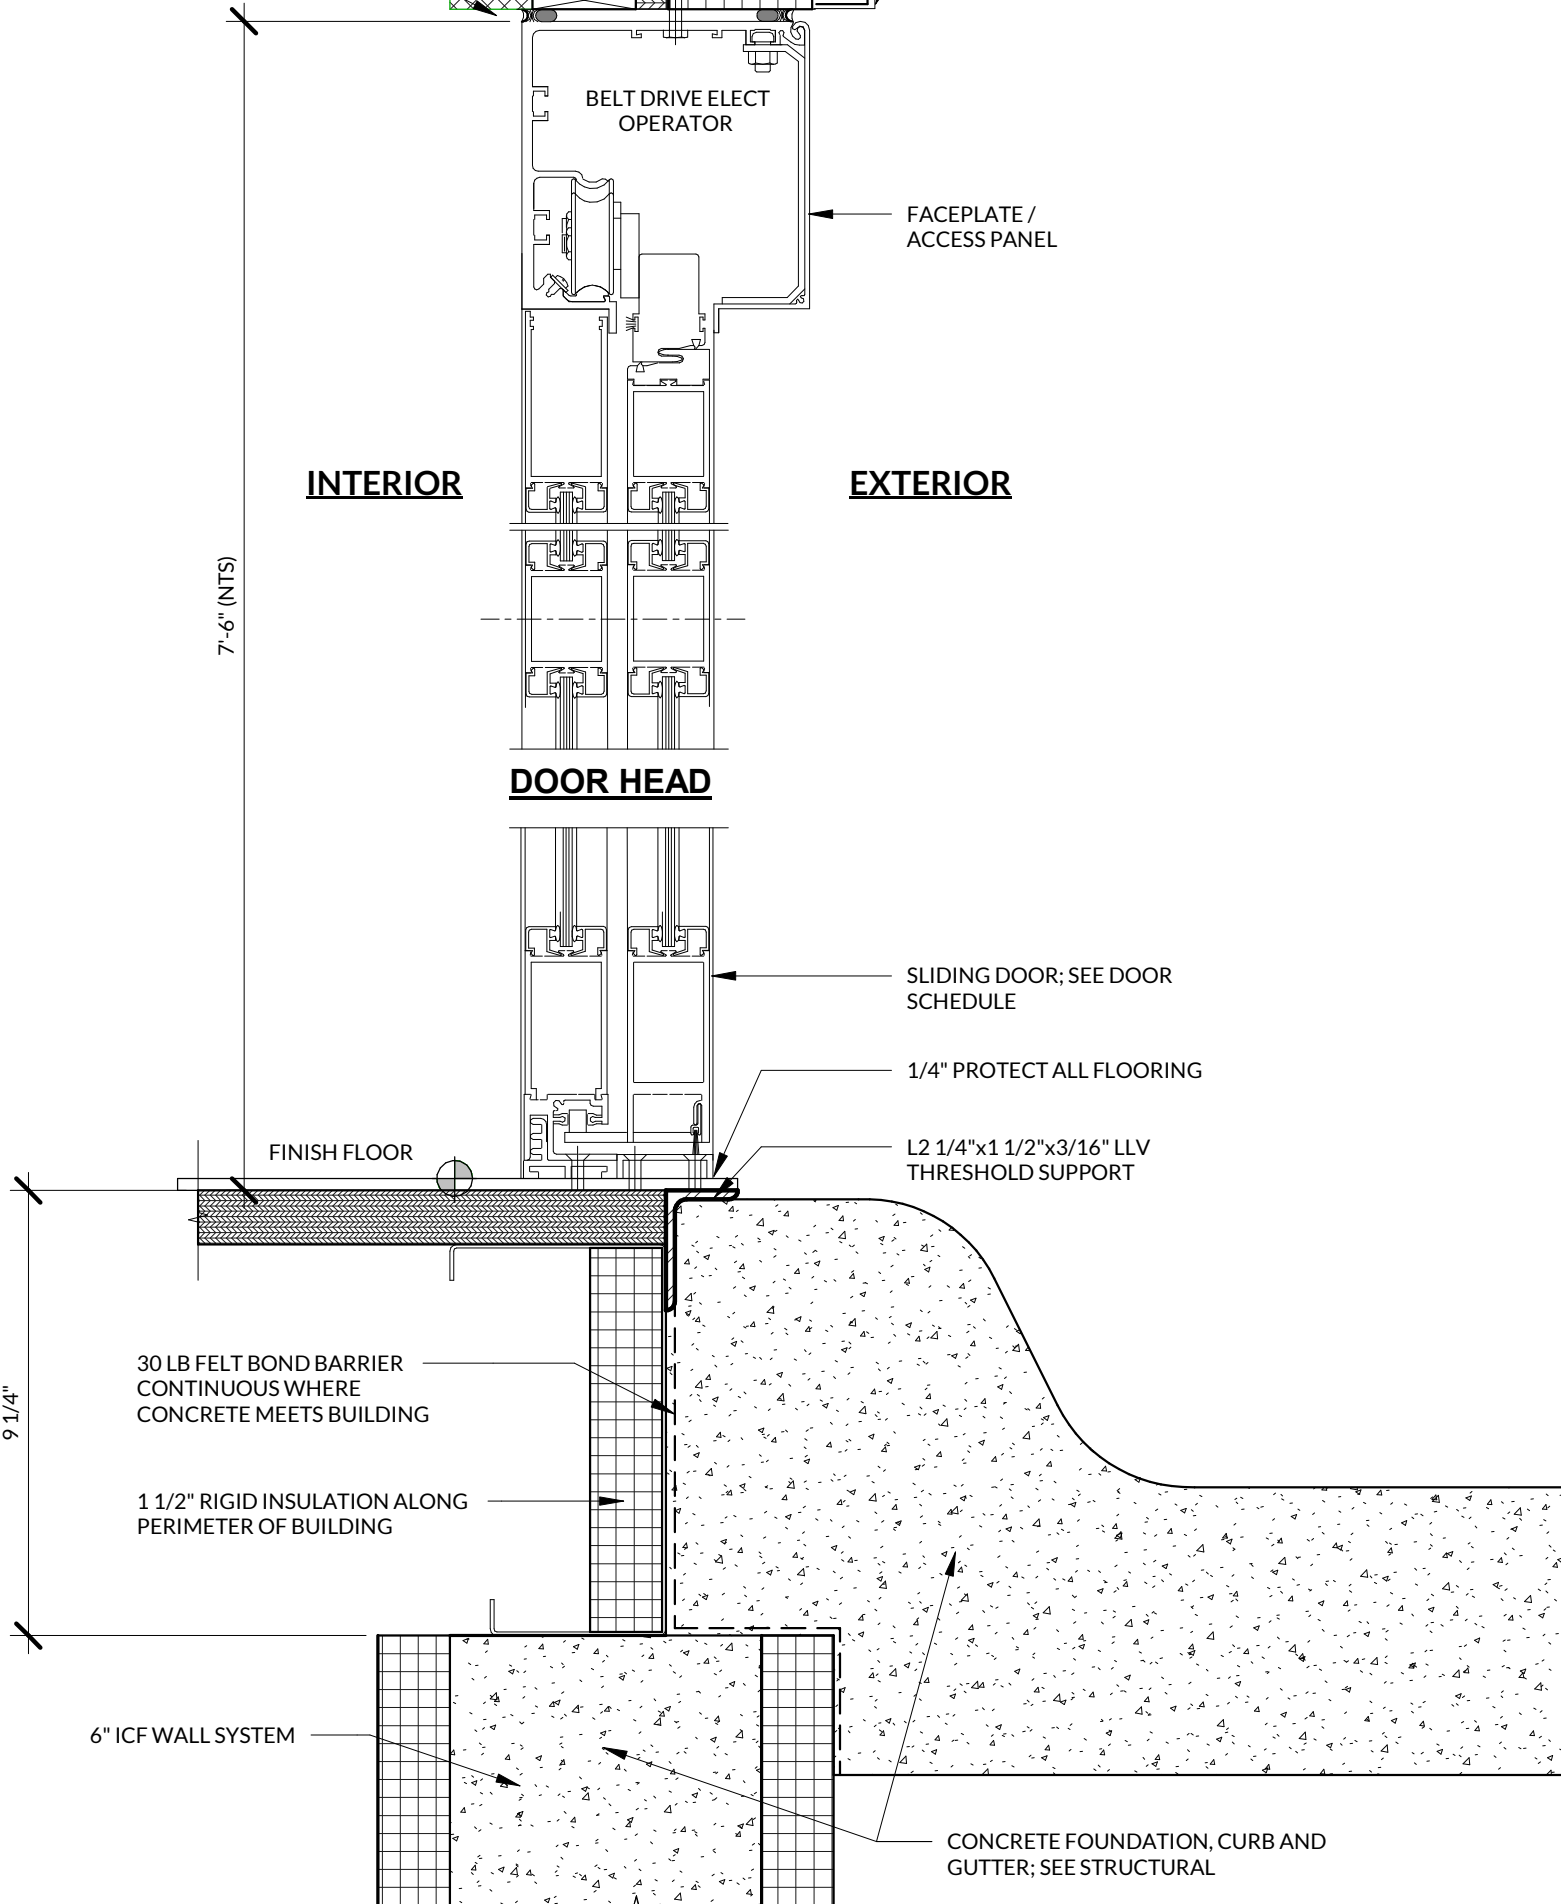


**DOOR THRESHOLD**

**5** SLIDING DOOR HEAD/THRESHOLD  
3" = 1'-0"

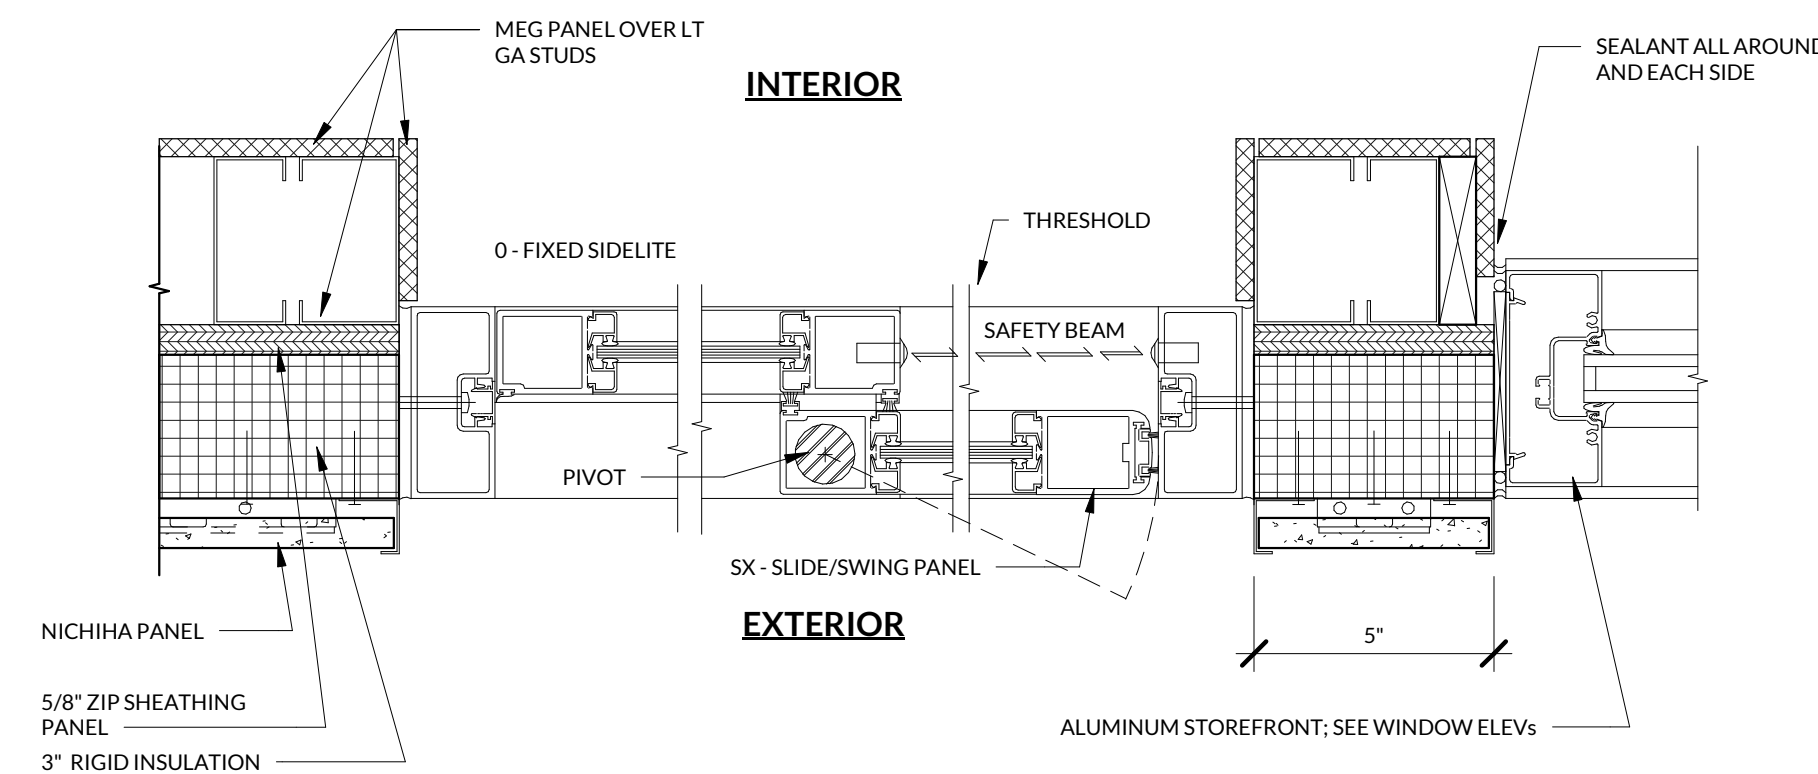


## 6 SLIDING DOOR JAMB

## DOOR ELEVATIONS

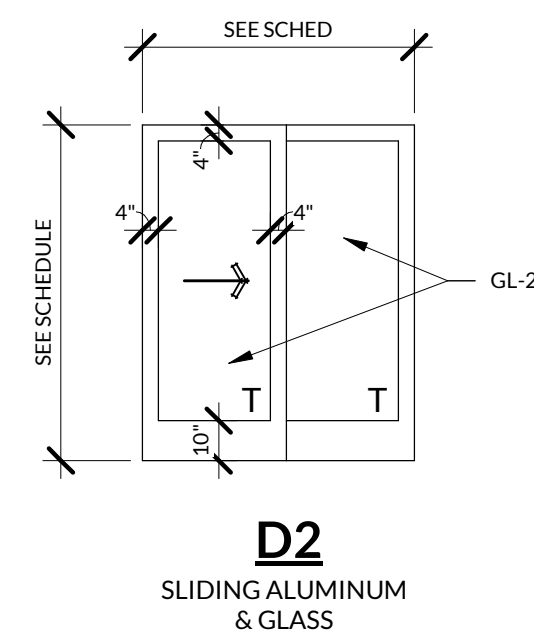

## FRAME ELEVATIONS

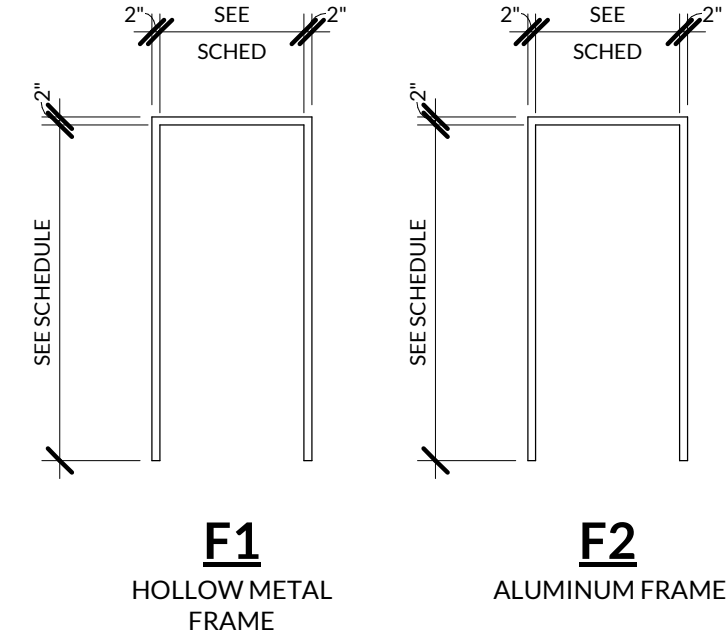

### HARDWARE SETS:

- SET #1:**
- CLOSER
  - SEALS
  - PANIC HARDWARE; "DETEX" ECL-600 (OR EQUAL)
  - 1 1/2 PAIR STANLEY #CB0700 TWO KNUCKLE HINGES
  - STANLEY #B03969 (OR EQUAL) STEEL-BRIGHT BRASS
  - 170 DEGREE, WIDE ANGLE DOOR VIEWER; SEE ELEV FOR LOCATION
  - KEYPED LOCK ON EXTERIOR
  - THUMB TURN DEADBOLT KNOB ON INTERIOR

SET #2:

- CLOSER
- SCHLAGE PRIVACY LOCK
- "SATURN" LEVER HANDLE (BRUSHED ALUMINUM)
- 1 1/2 PAIR BUTT HINGES


SET#3

- SEALS
- 1 1/2 PAIR STANLY #CB0700 TWO KNUCKLE HINGES
- THUMB TURN DEADBOLT KNOB ON INTERIOR
- KEYED LOCK ON EXTERIOR


GLAZING SCHEDULE

- |      |                              |
|------|------------------------------|
| GL-1 | 1/4" FULLY TEMPERED GLASS    |
| GL-2 | 1" INSULATED SAFETY GLASS    |
| GL-3 | 1" INSULATED TEMPERED GLASS  |
| GL-4 | 5/8" INSUL SAFETY DOOR GLASS |

## WINDOW ELEVATIONS

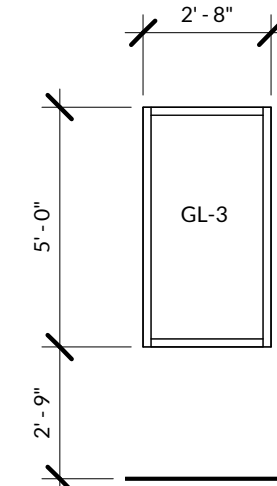


## B ALUMINUM STOREFRONT

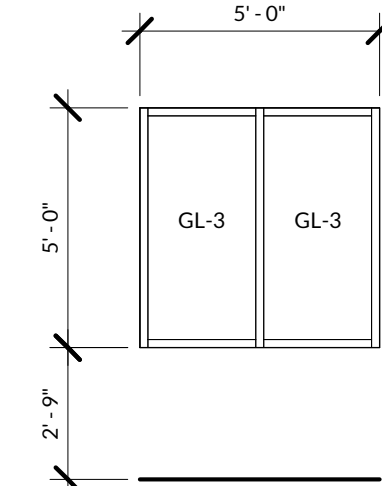


**C**  
ALUMINUM STOREFRONT




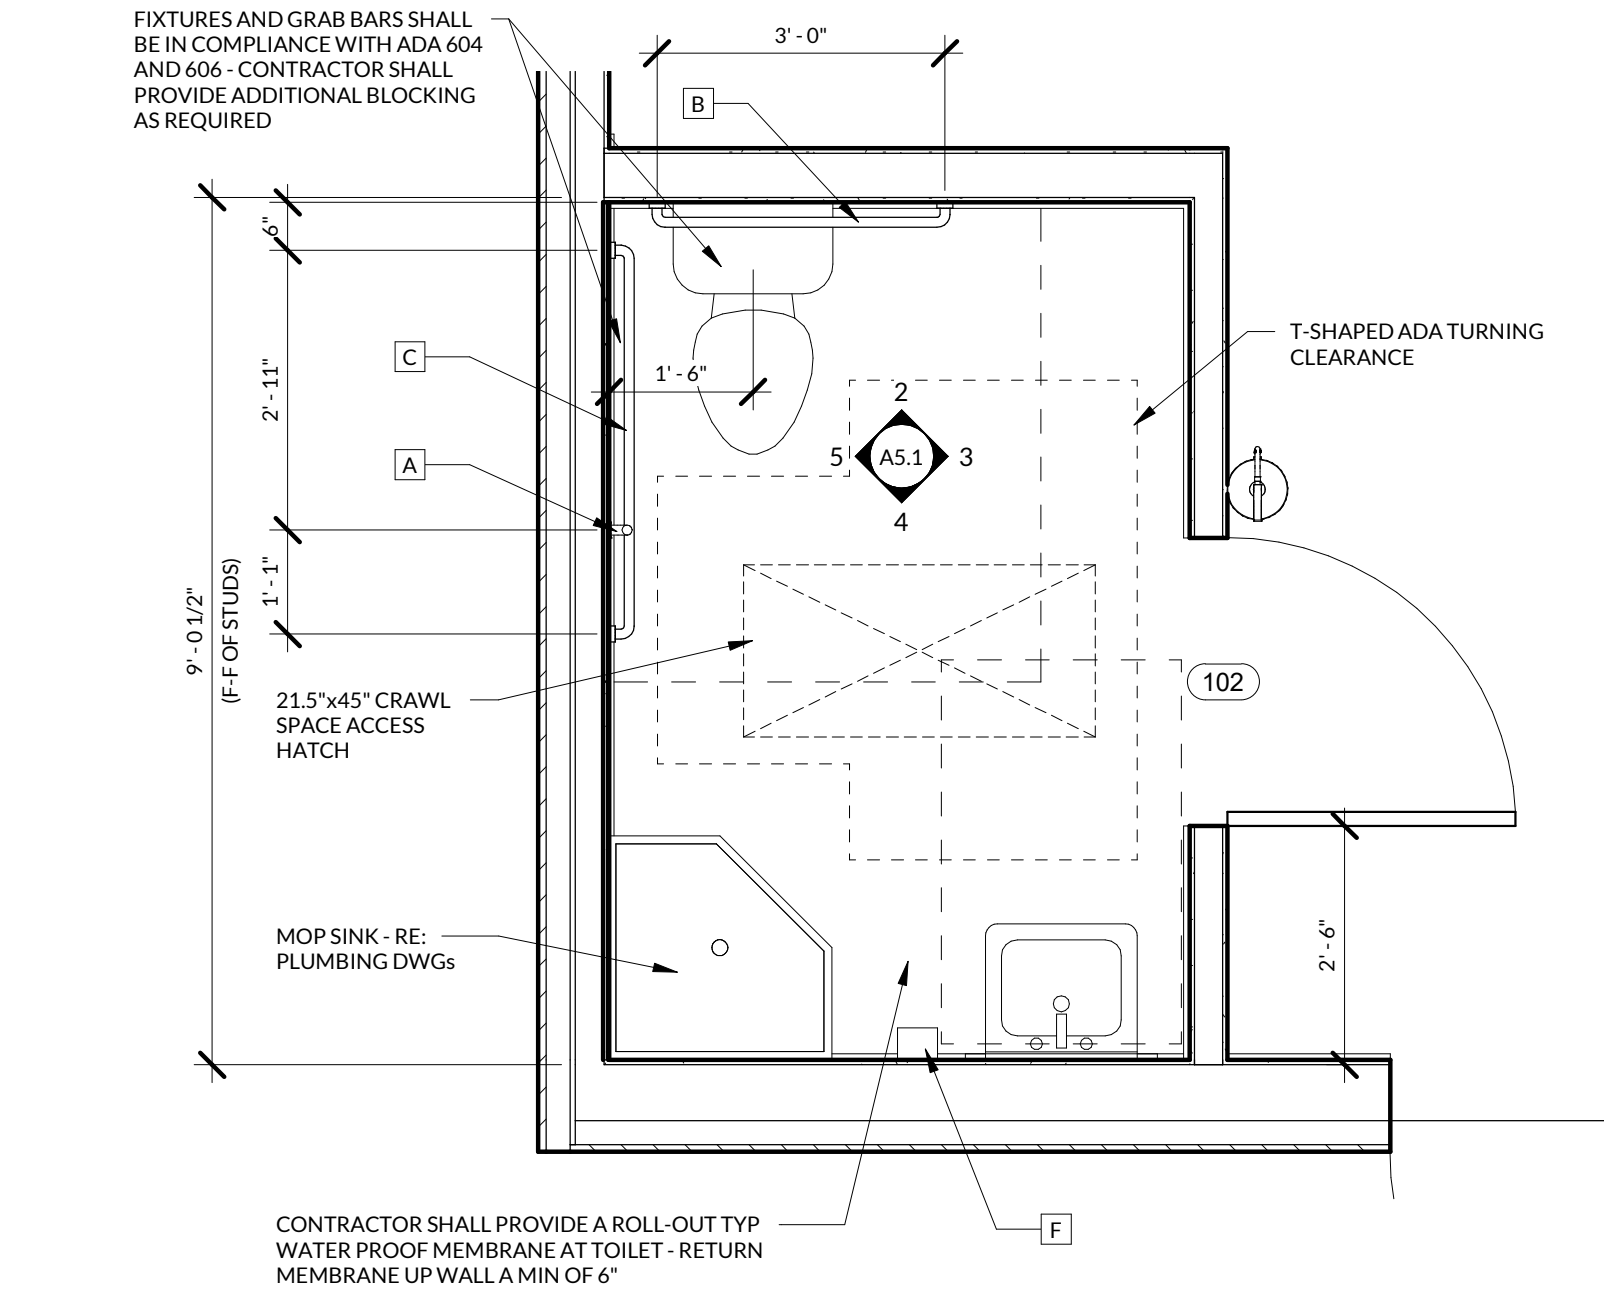


1 ENLARGED RESTROOM PLAN  
1/2" = 1'-0"

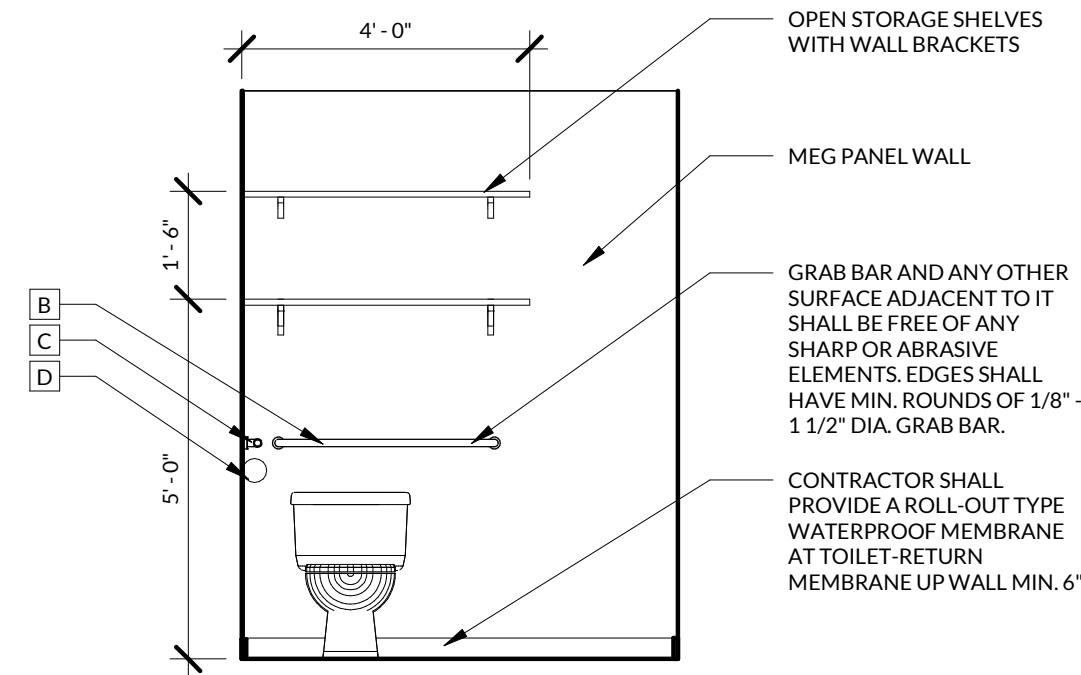


2 RR 102 - NORTH ELEVATION  
3/8" = 1'-0"

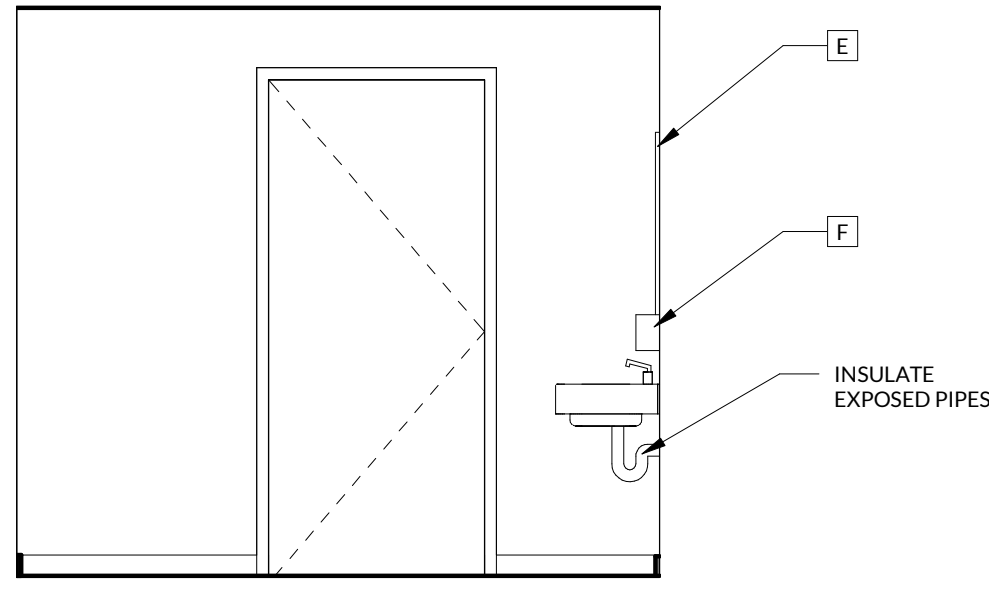

3 RR 102 - EAST ELEVATION  
3/8" = 1'-0"

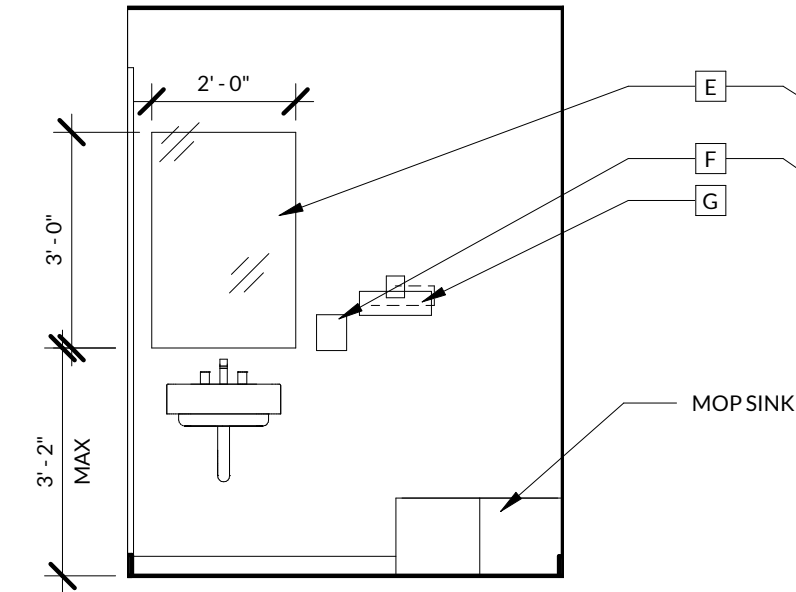


4 RR 102 - SOUTH ELEVATION  
3/8" = 1'-0"

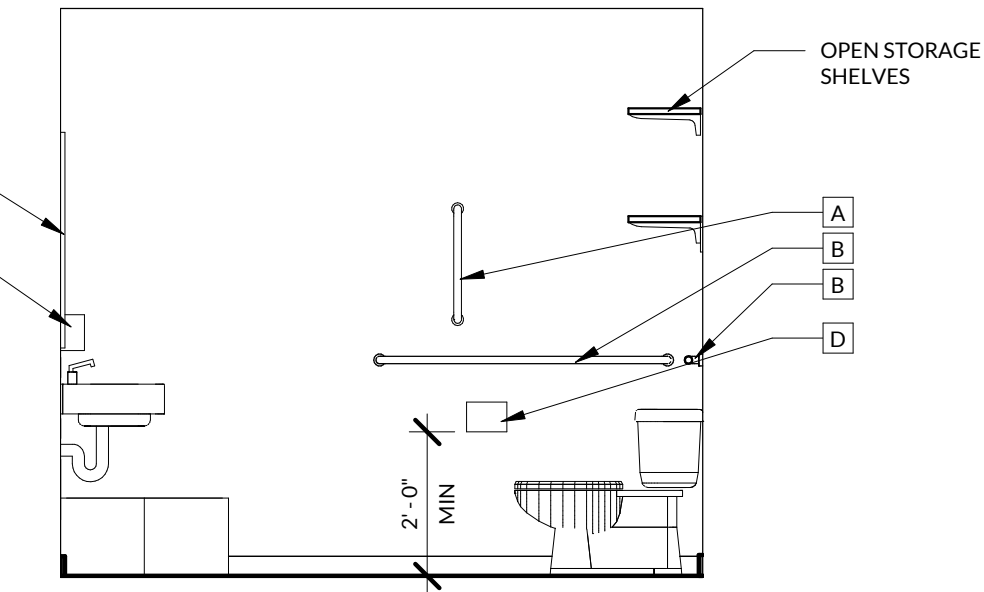

5 RR 102 - WEST ELEVATION  
3/8" = 1'-0"

## RESTROOM SIGNAGE

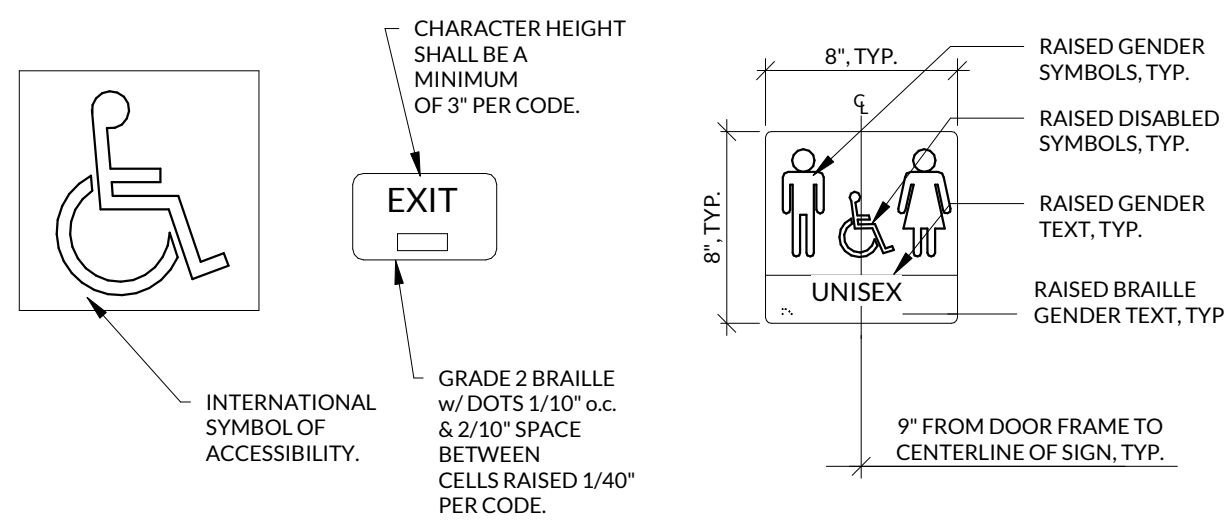

### NOTES:

- SIGNS SHALL CONFORM TO ANSI OR LOCAL ACCESSIBILITY GUIDELINES WHICHEVER IS MORE STRINGENT.
- ALL BUILDINGS AND ENTRANCES THAT ARE ACCESSIBLE AND USABLE BY PERSONS WITH DISABILITIES SHALL BE IDENTIFIED WITH A MINIMUM OF ONE INTERNATIONAL SYMBOL OF ACCESSIBILITY.
- G.C. TO PROVIDE TACTILE "EXIT" SIGNS AT ALL GRADE LEVEL EXIT DOORS PER CODE.
- SIGNS TO BE INSTALLED ON THE LATCH SIDE OF THE DOOR, OR IF NO SPACE ON THE NEAREST WALL PREFERABLY ON THE RIGHT. SIGNAGE SHALL HAVE NON GLARE FINISH W/ A CONTRASTING BACKGROUND.


## RESTROOM SCHEDULE

MARK	ITEM	DESCRIPTION	NOTES
A	18" STRAIGHT GRAB BAR	EQ. TO BOBBRICK B-5806x18, VERTICAL	FINISH TO BE STAINLESS STEEL
B	36" STRAIGHT GRAB BAR	EQ. TO BOBBRICK B-5806x36, HORIZONTAL	FINISH TO BE STAINLESS STEEL
C	48" STRAIGHT GRAB BAR	EQ. TO BOBBRICK B-5806x48, HORIZONTAL	FINISH TO BE STAINLESS STEEL
D	TOILET PAPER DISPENSER		FINISH TO BE STAINLESS STEEL
E	MIRROR	EQ. TO BOBBRICK B-165 2436	FINISH TO BE STAINLESS STEEL
F	SOAP DISPENSER		FINISH TO BE STAINLESS STEEL
G	PAPER TOWEL DISPENSER		FINISH TO BE STAINLESS STEEL


### NOTES:

- MOUNTING HEIGHT TO COMPLY WITH ADA REQUIREMENTS. CONTRACTOR IS TO PROVIDE ALL BLOCKING NECESSARY FOR PROPER INSTALLATION. INSTALL PER MANF. RECOMMENDATIONS.
- EQUIPMENT SHOWN MAY NOT REFLECT APPEARANCE OF FINAL EQUIPMENT SELECTION.
- ALL EQUIPMENT SHALL BE EQUAL TO THAT SPECIFIED CONTRACTOR TO SUBMIT SHOP DRAWINGS/ CUT SHEETS FOR APPROVAL ON FINAL SELECTION.
- ALL DIMENSIONS TO BE VERIFIED WITH PRODUCT REQUIREMENTS. INSTALL PER MANF. RECOMMENDATIONS.


## RESTROOM CLEARANCE AND MOUNTING HEIGHTS

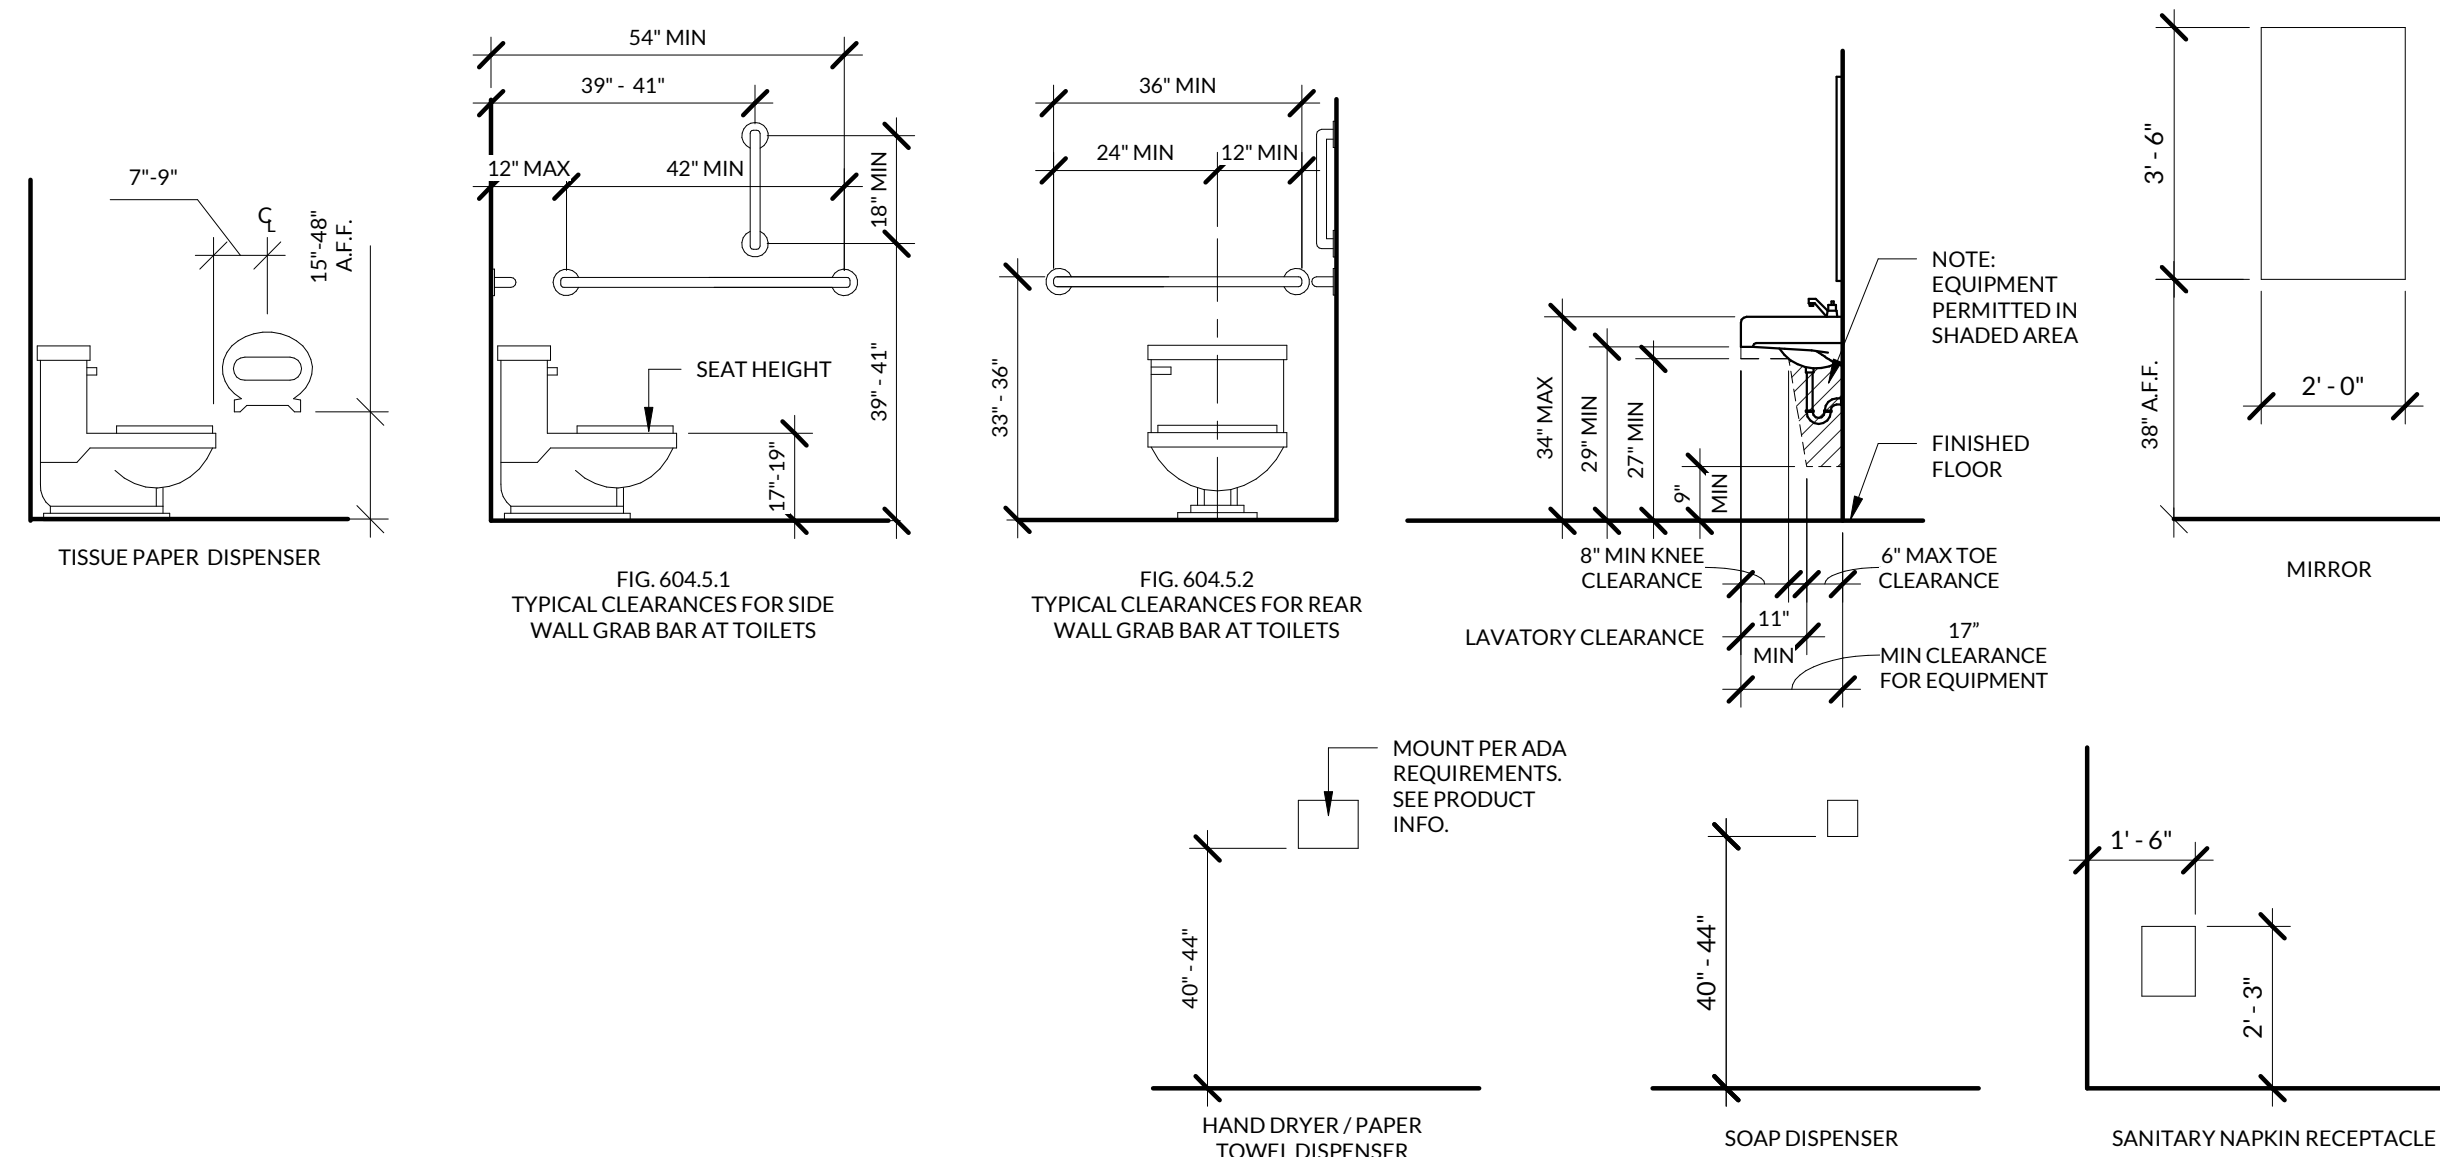




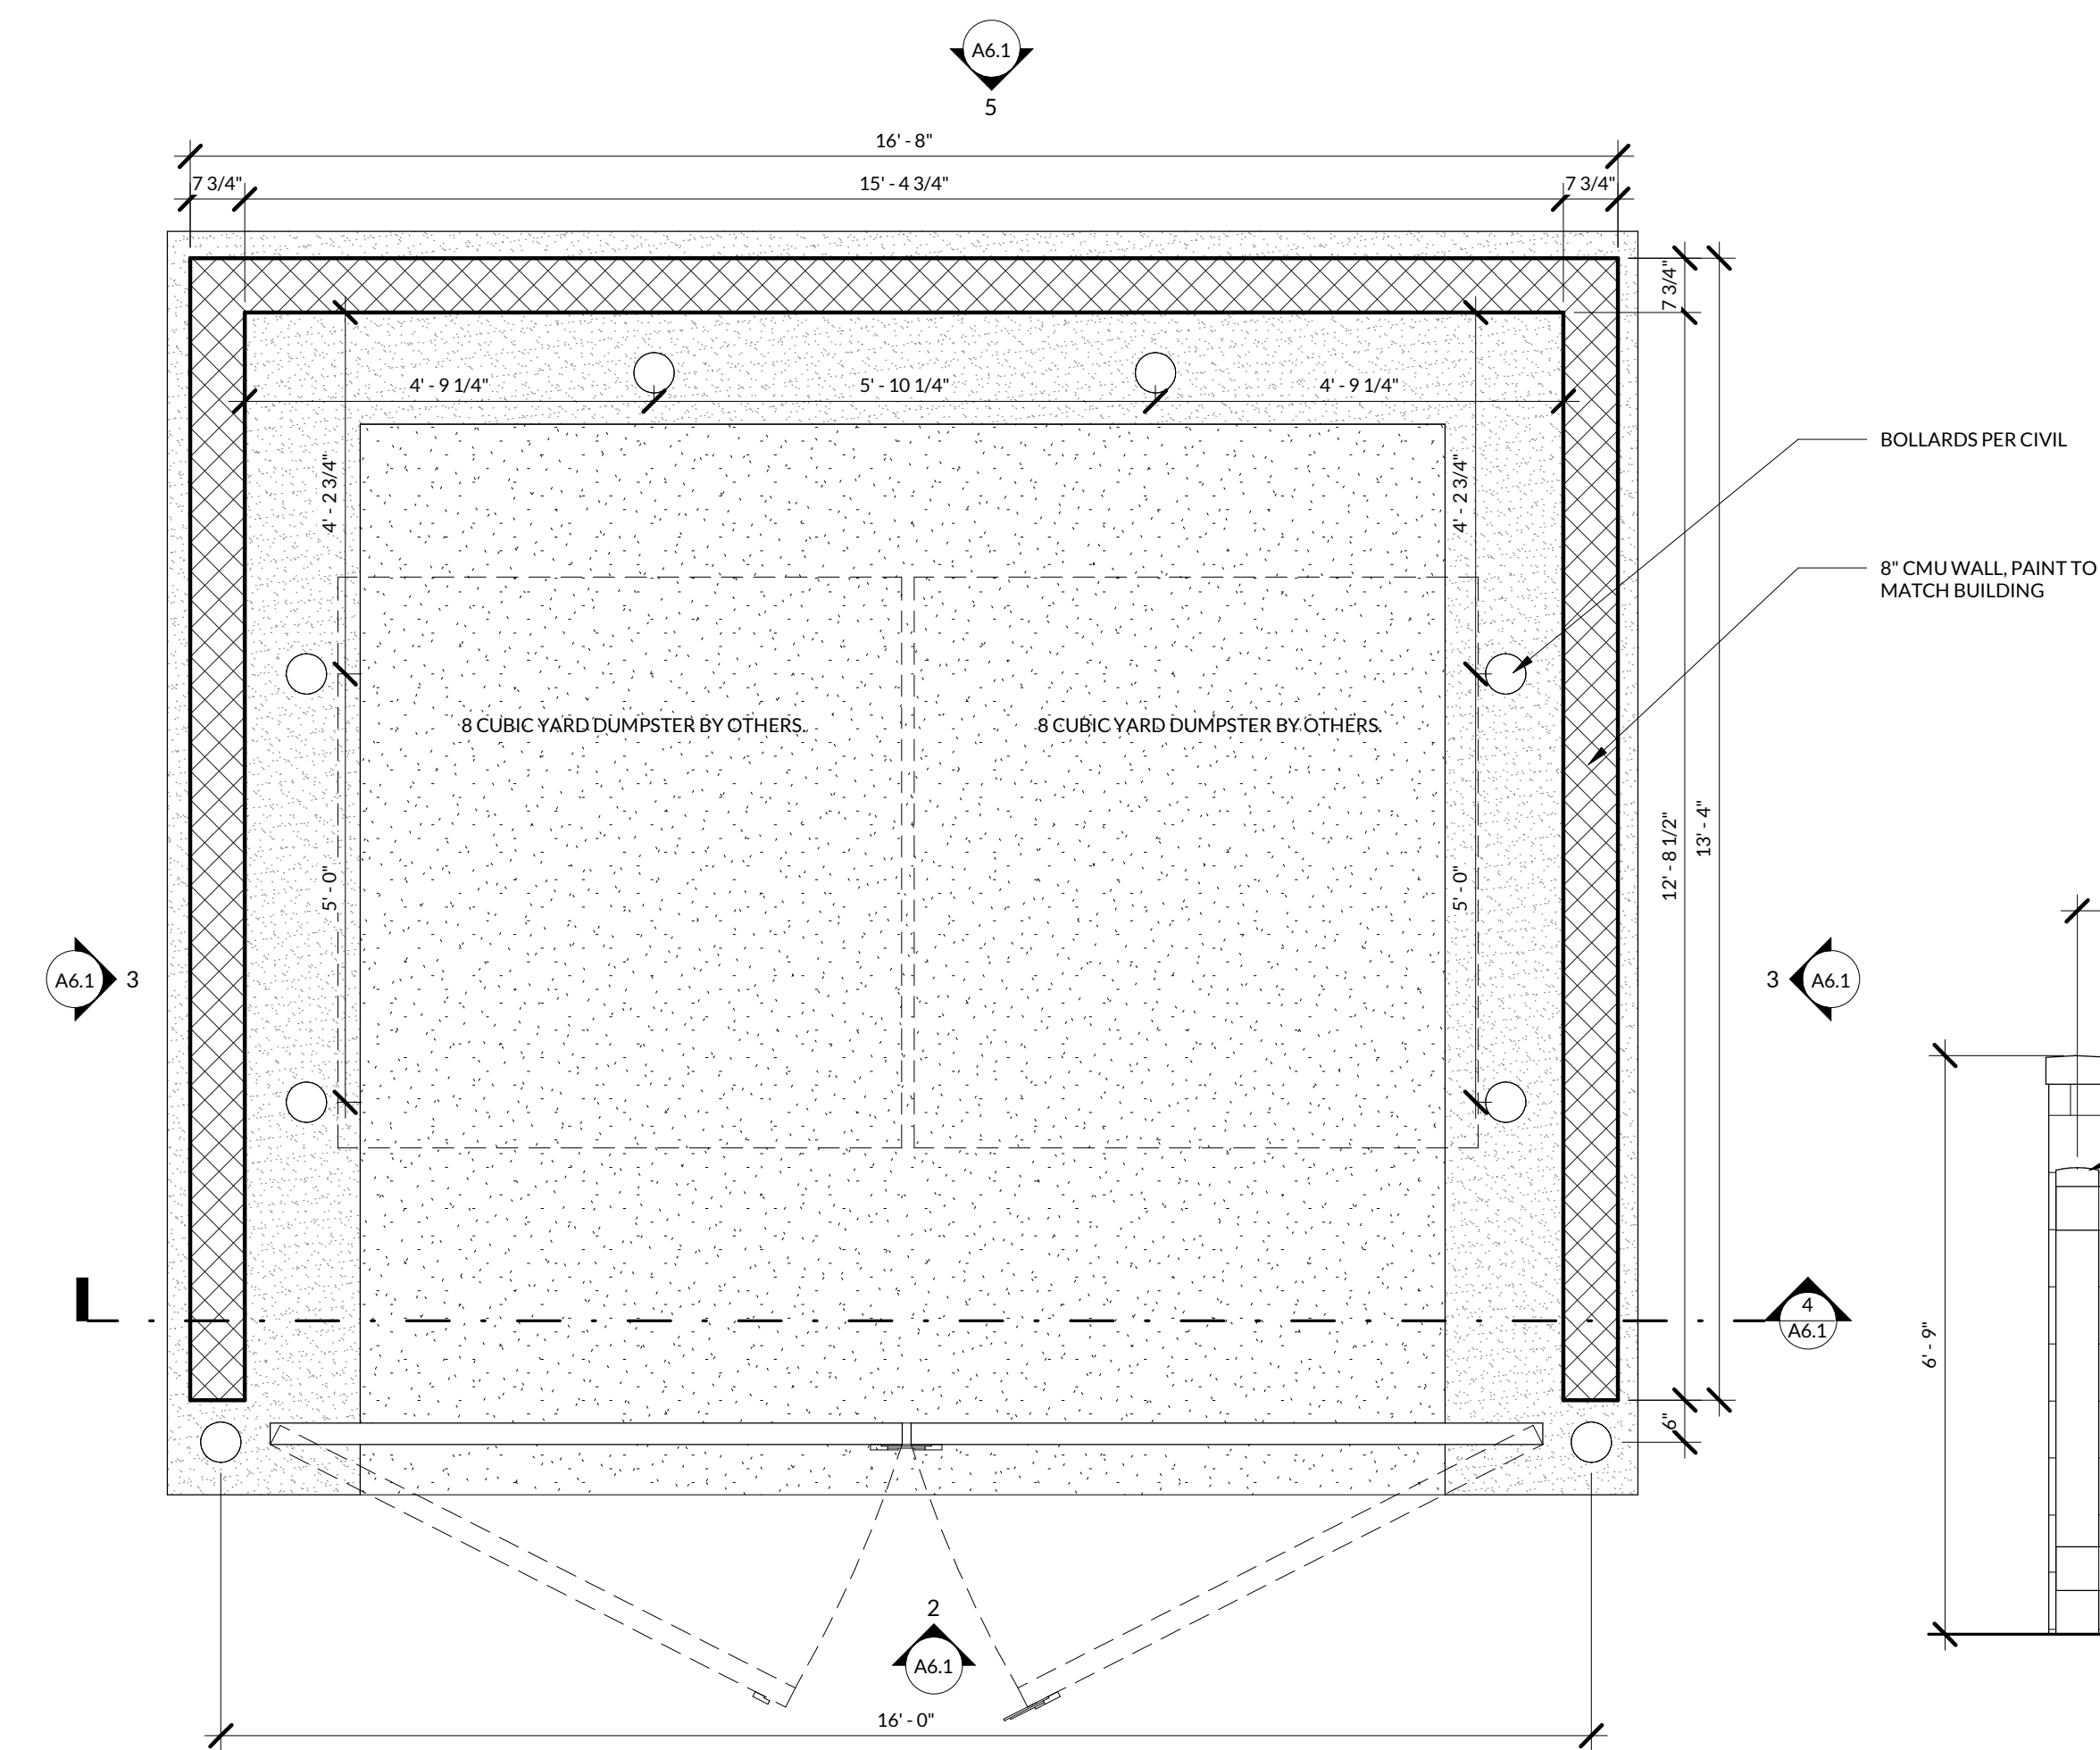


**1** TRASH ENCLOSURE  
1/2" = 1'-0"

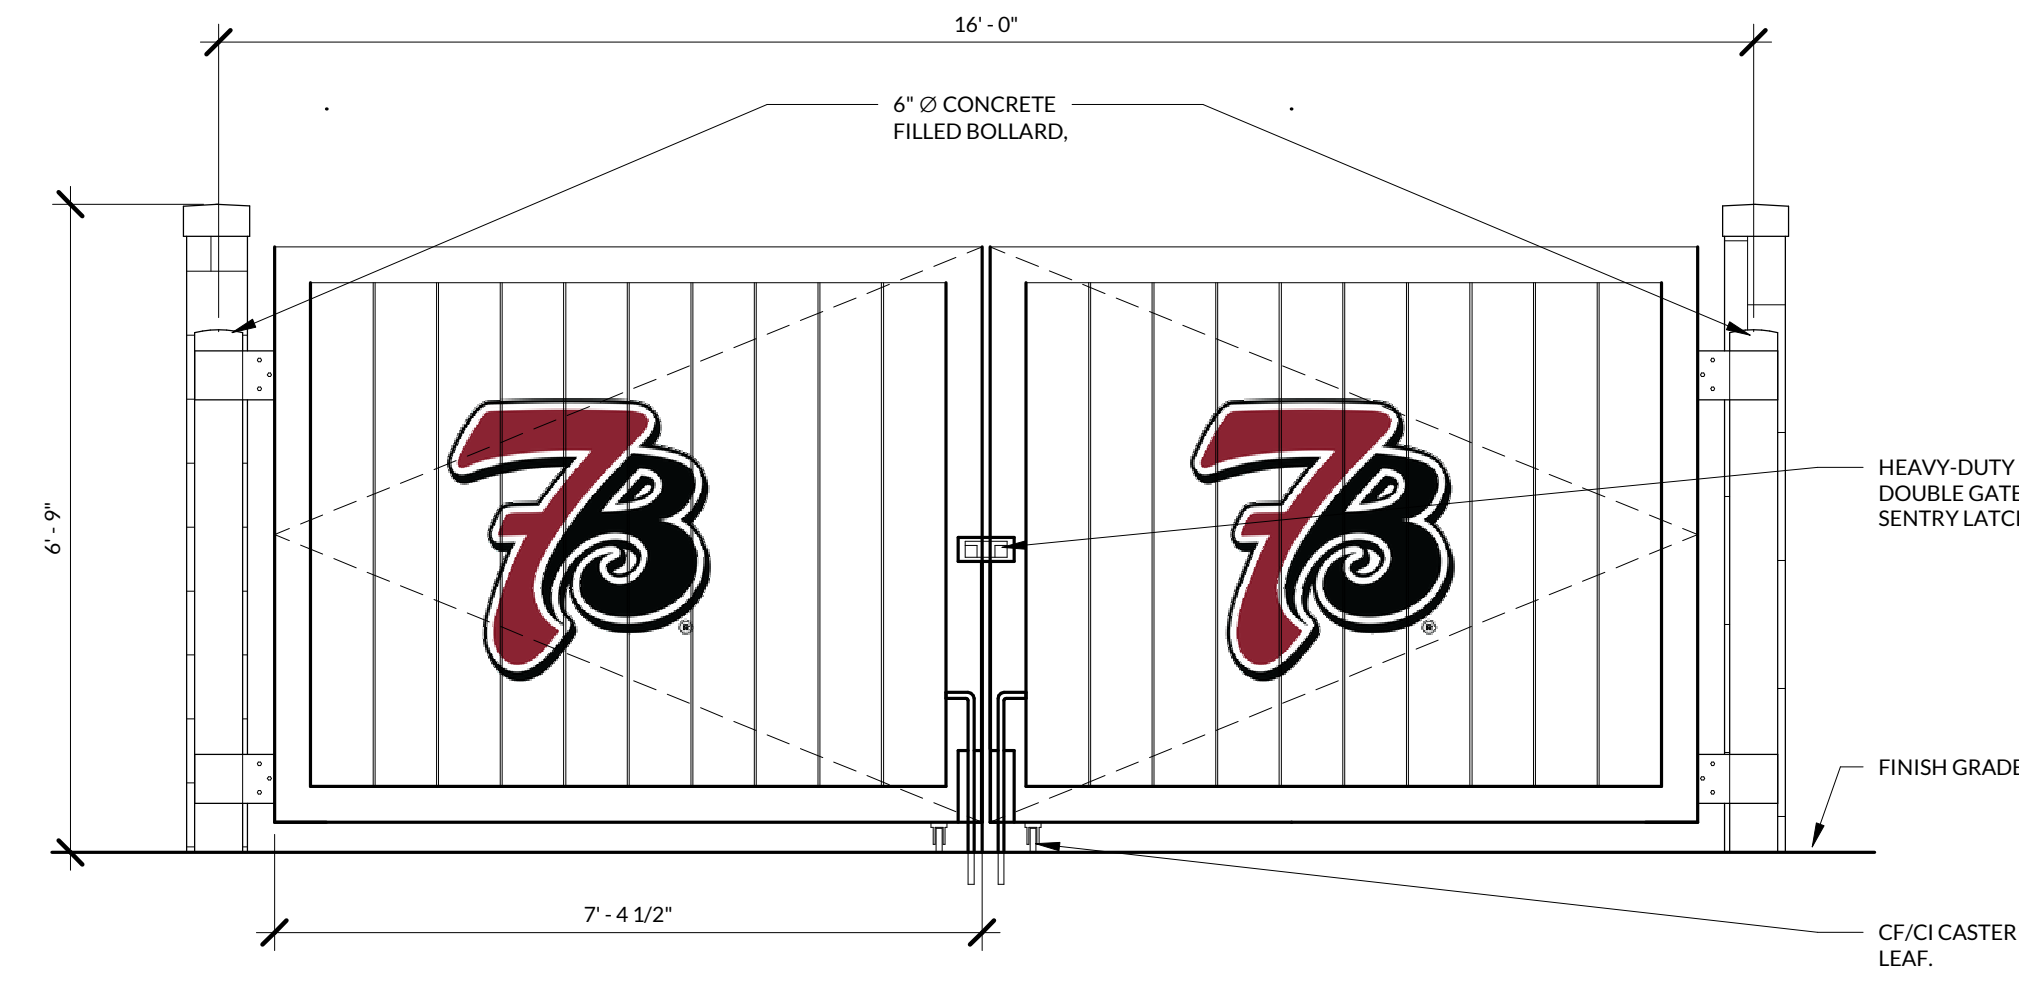


**2** TRASH ENCLOSURE - FRONT ELEVATION  
1/2" = 1'-0"

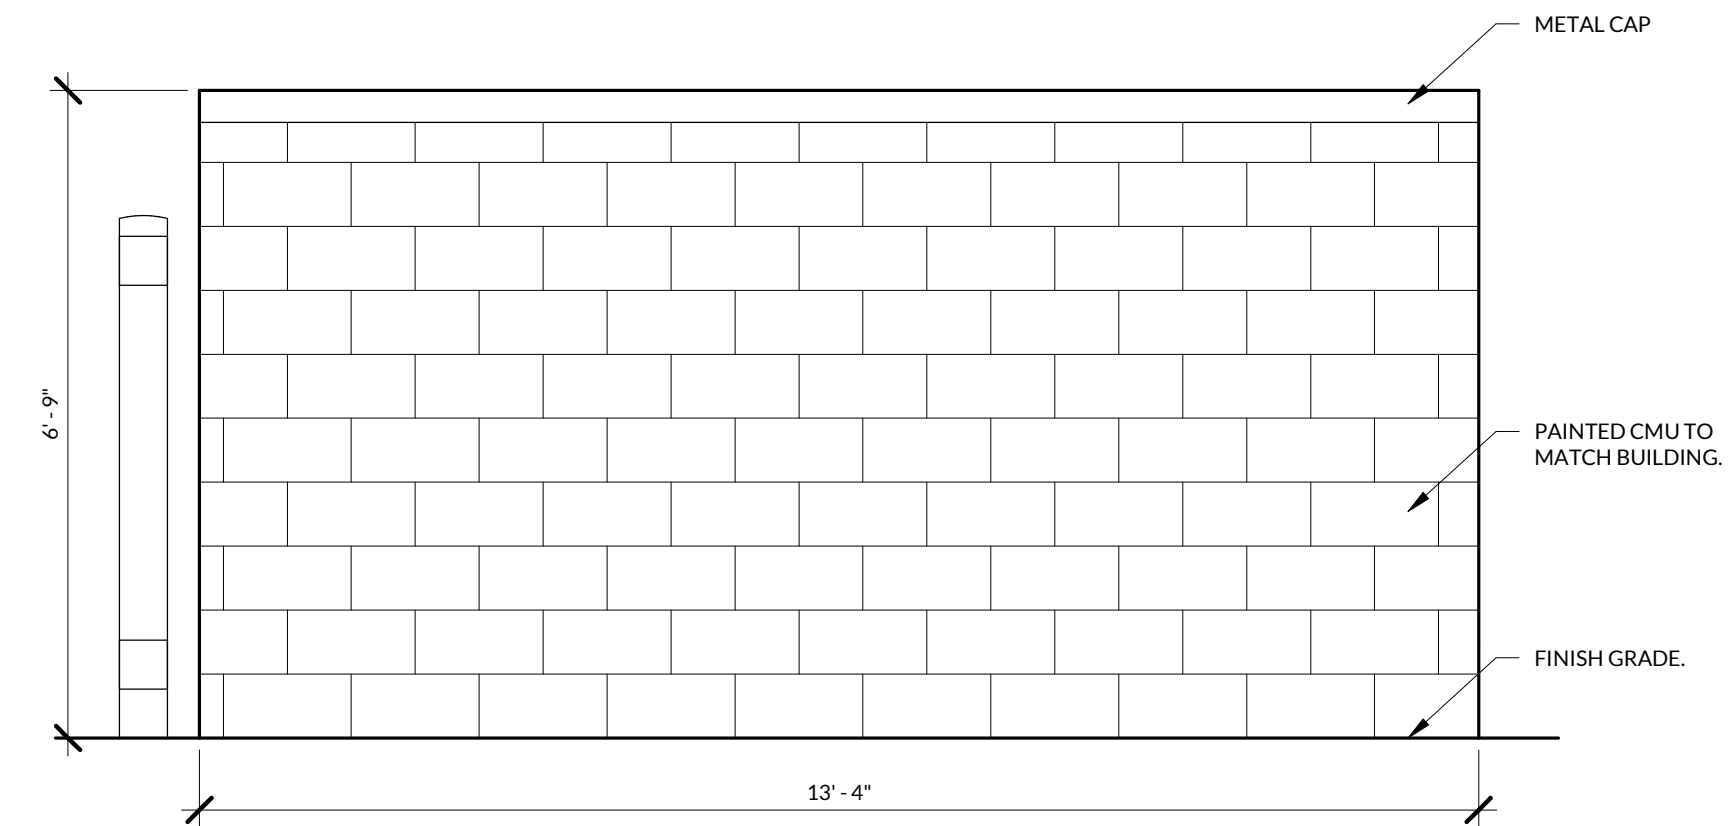



**3** TRASH ENCLOSURE - SIDE ELEVATION  
1/2" = 1'-0"

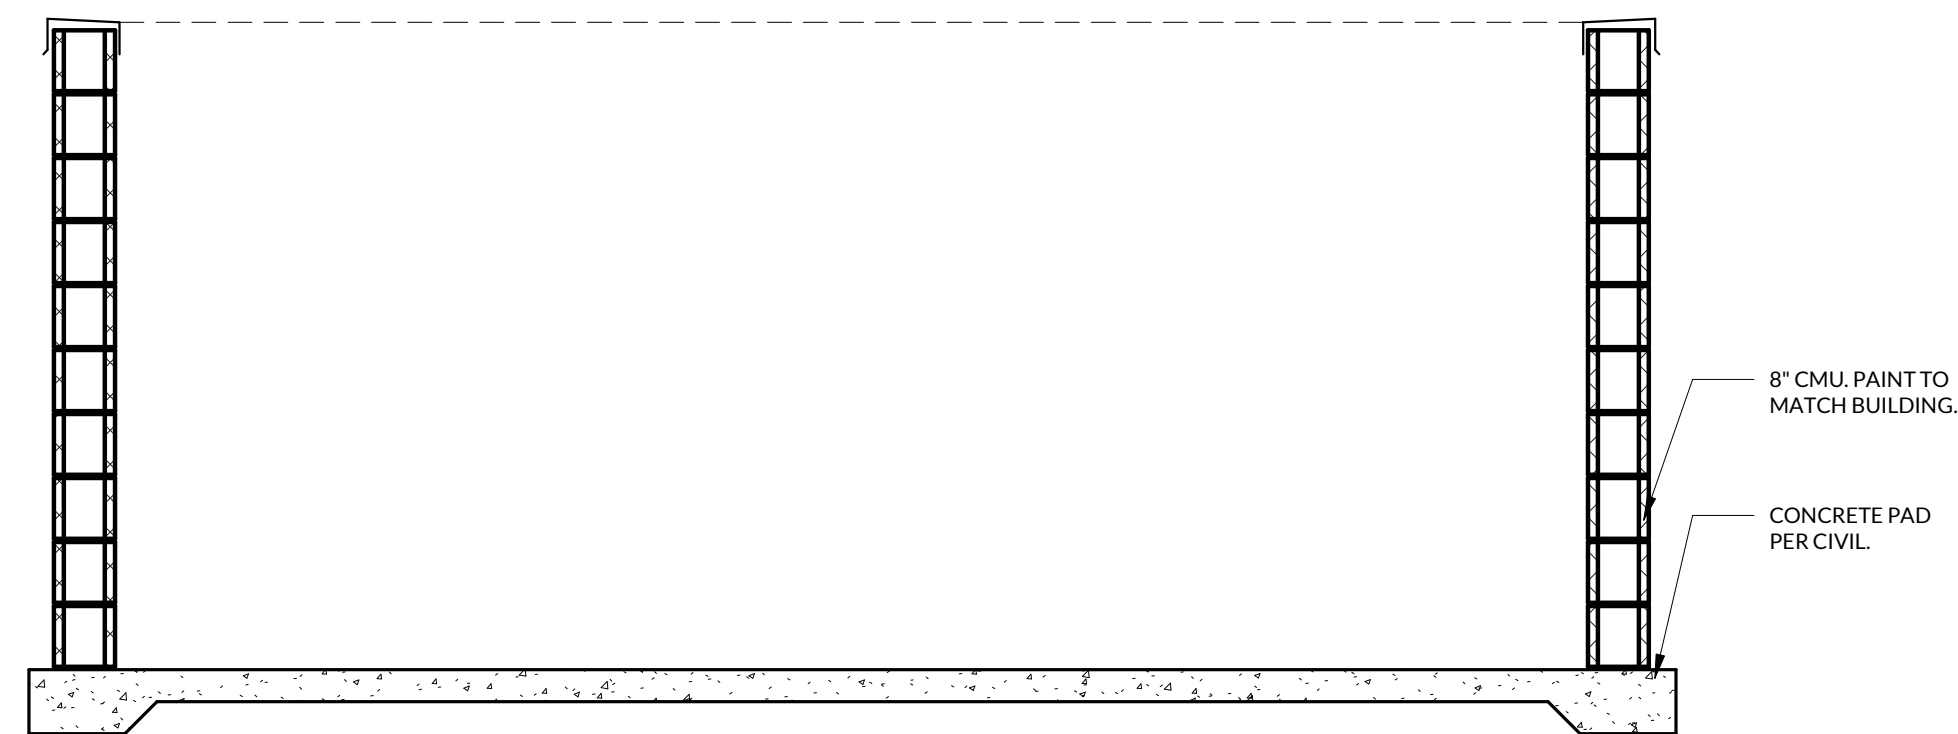

**4** TRASH ENCLOSURE - SECTION DETAIL  
1/2" = 1'-0"

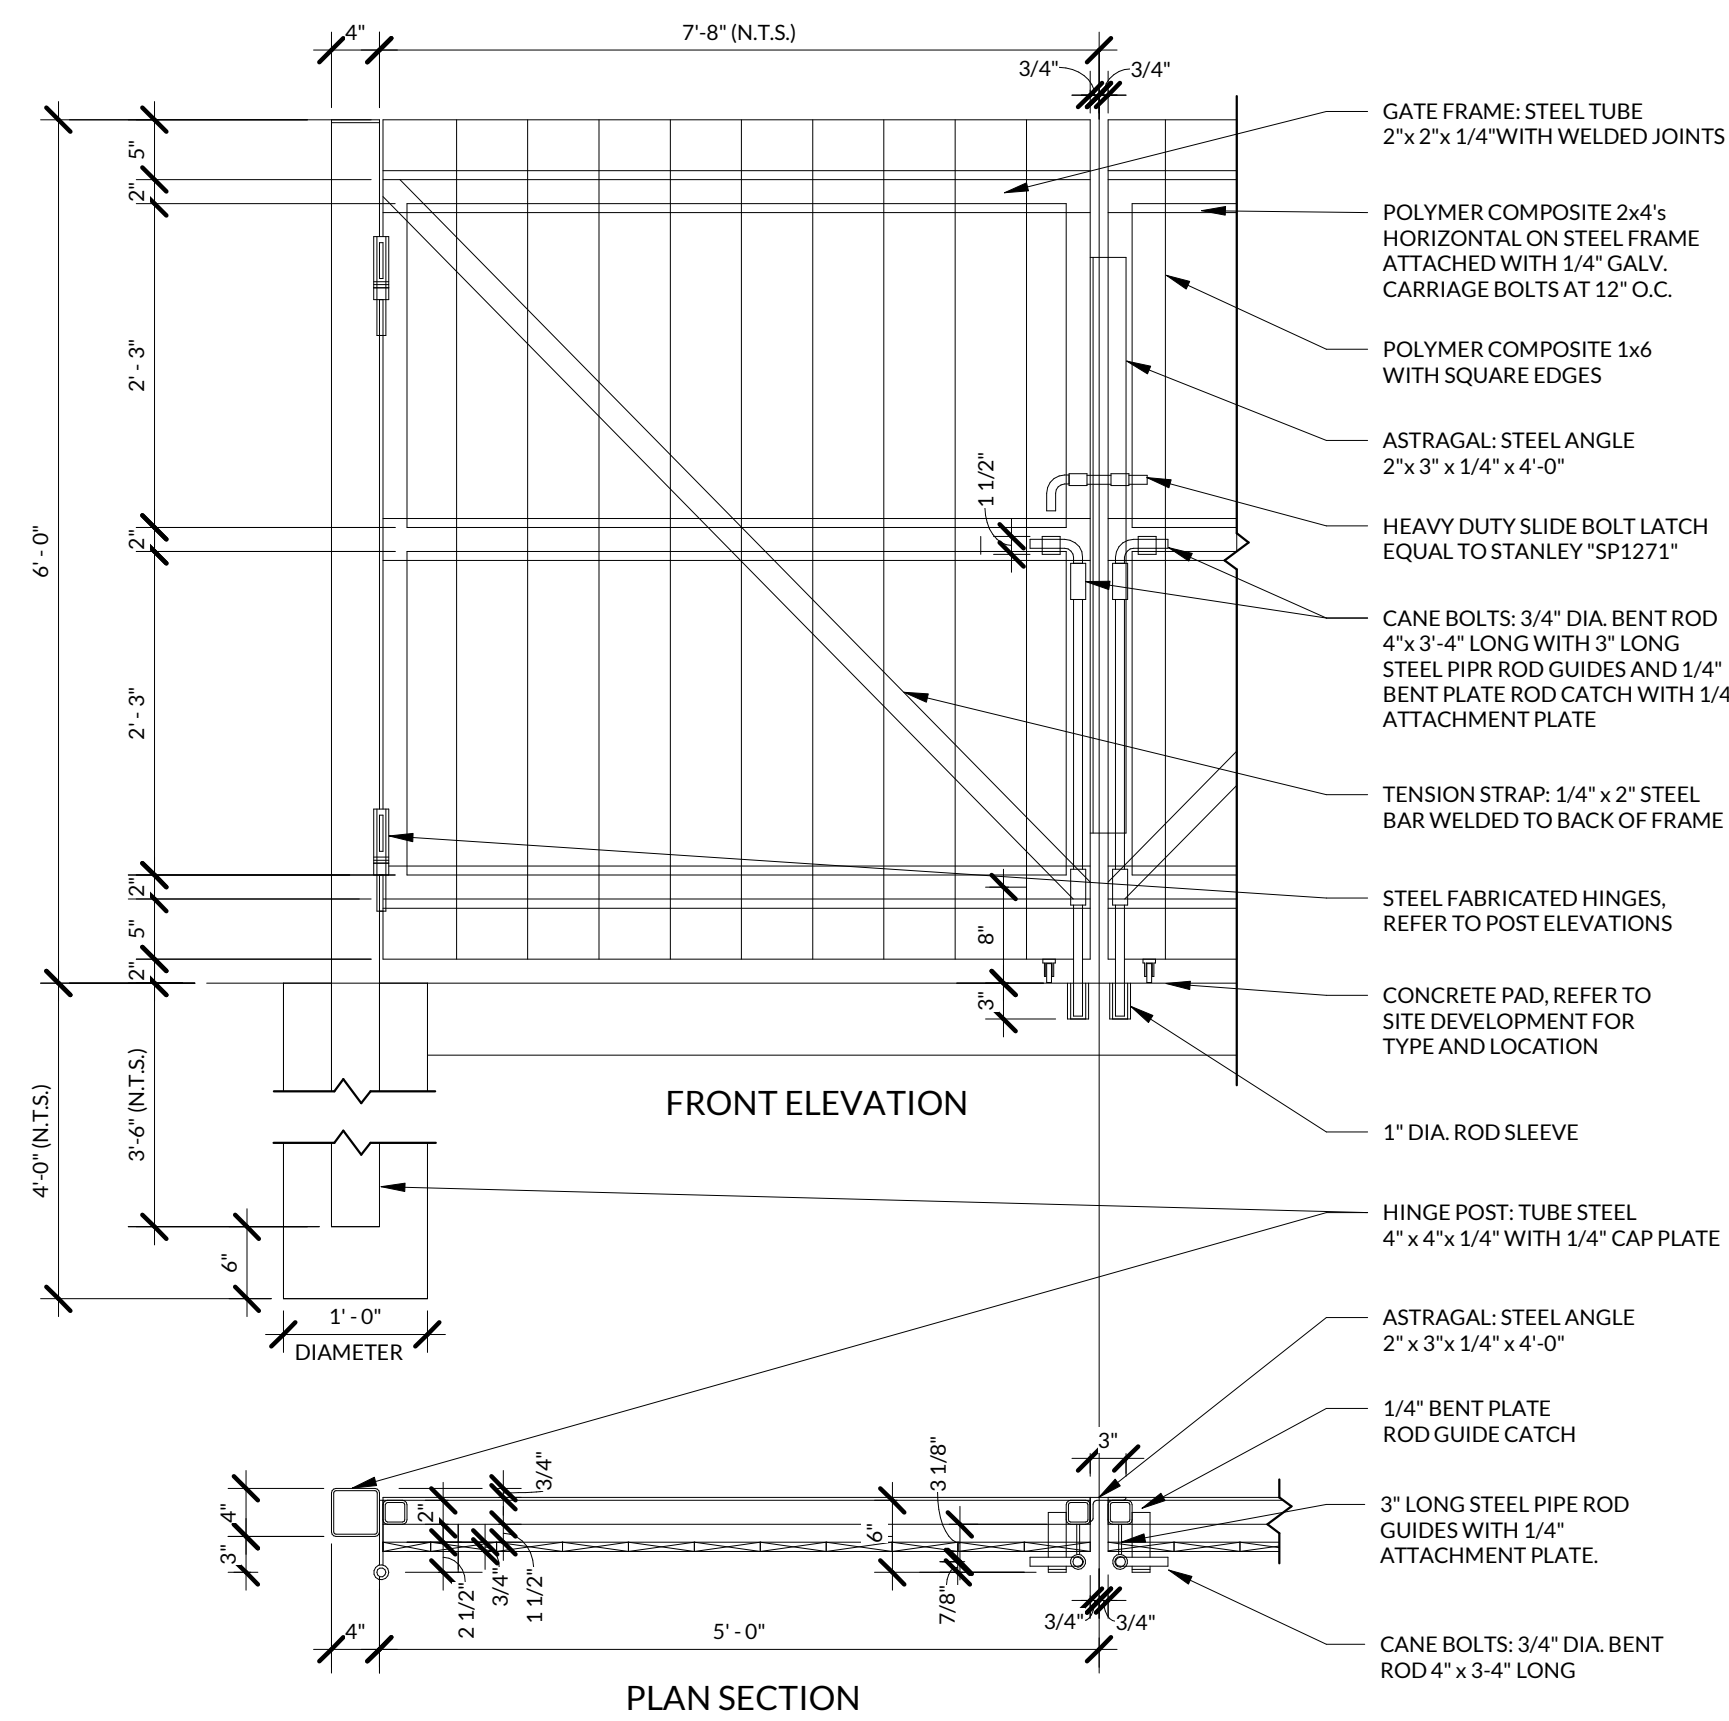


**6** TRASH ENCLOSURE GATE DETAILS  
3/4" = 1'-0"

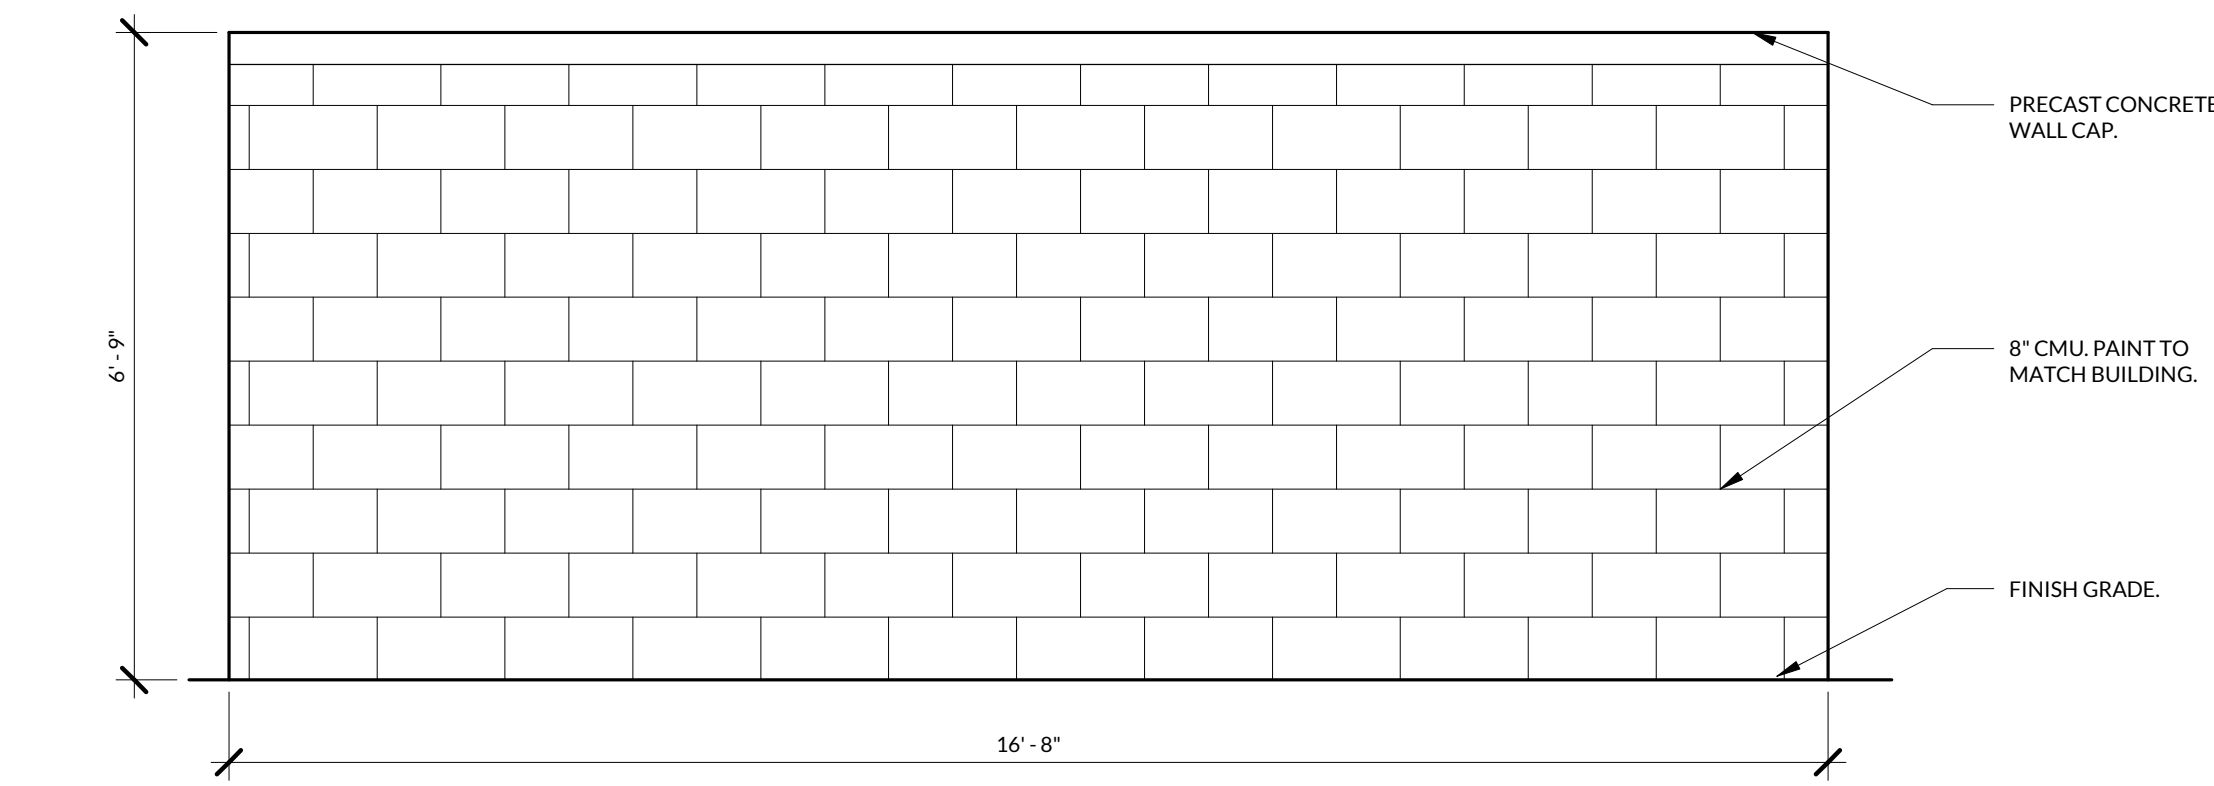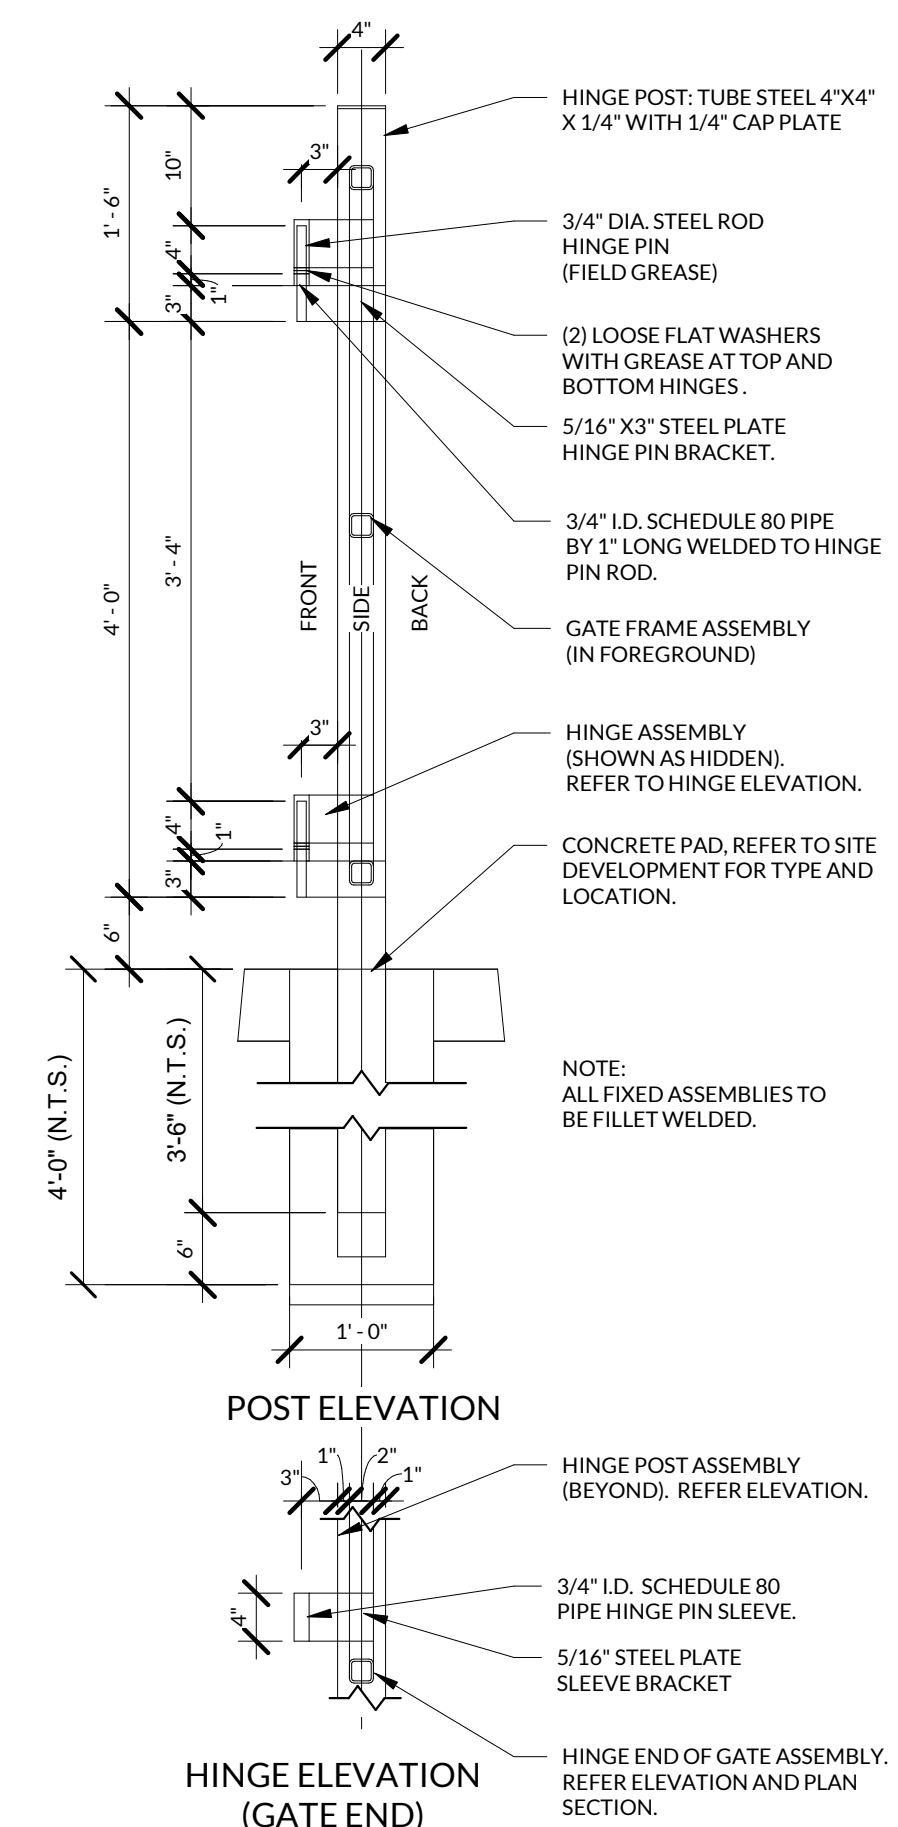


**5** TRASH ENCLOSURE - BACK ELEVATION  
1/2" = 1'-0"




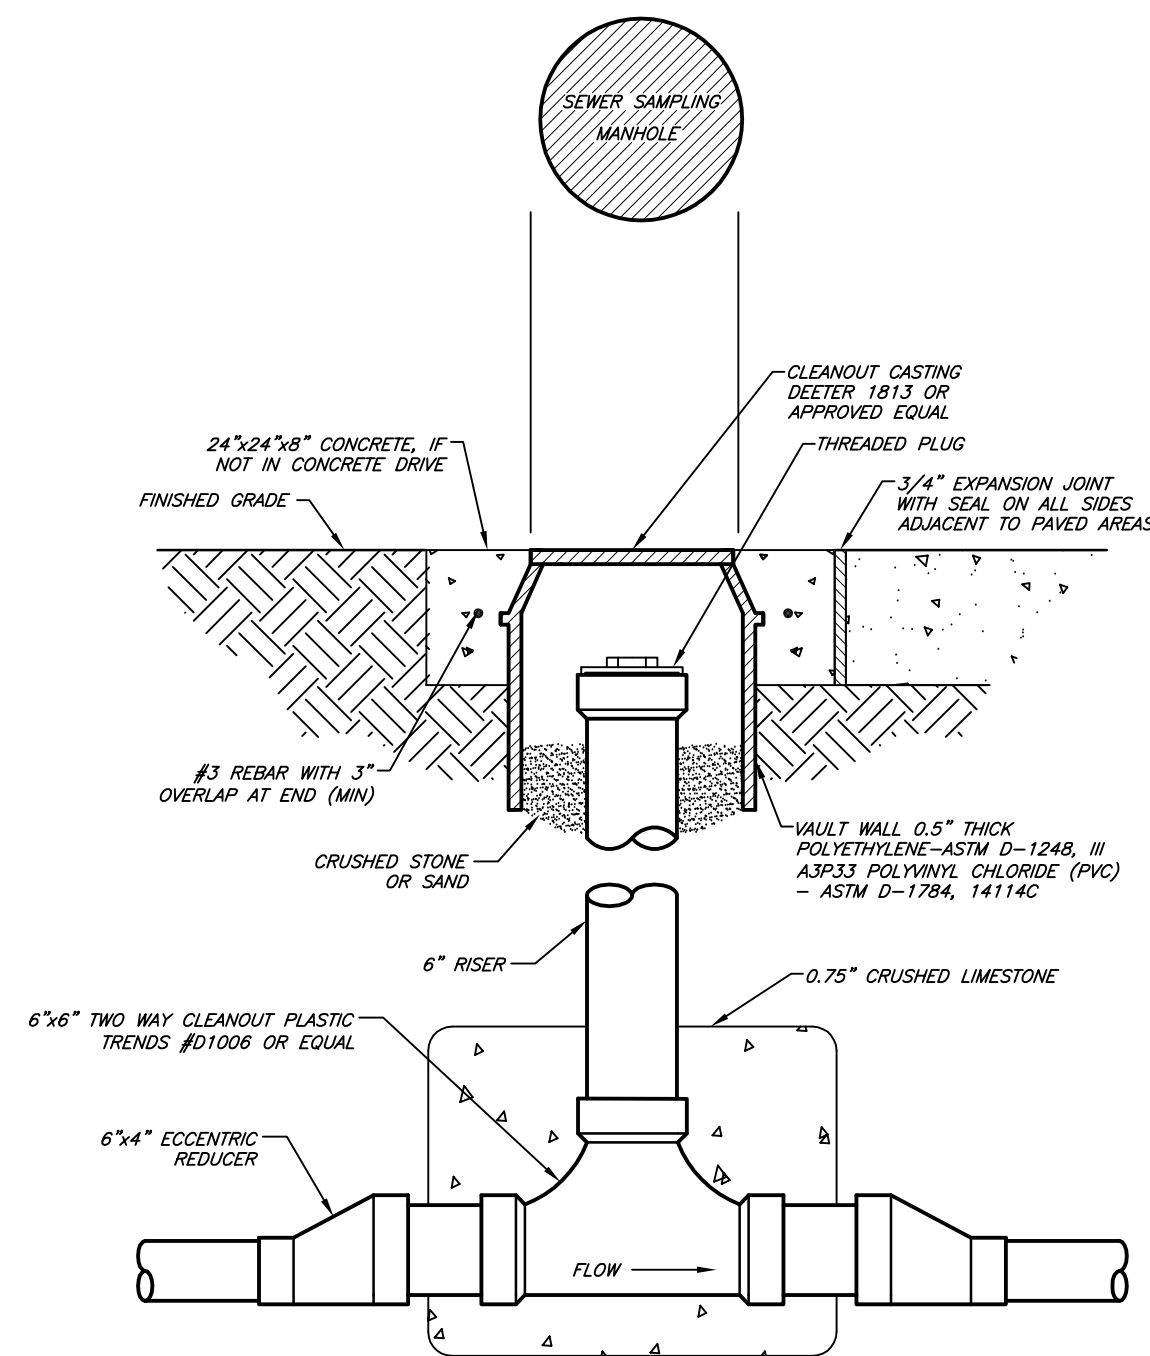


**4 FINISH GRADE SAMPLING MANHOLE DETAIL**  
NO SCALE

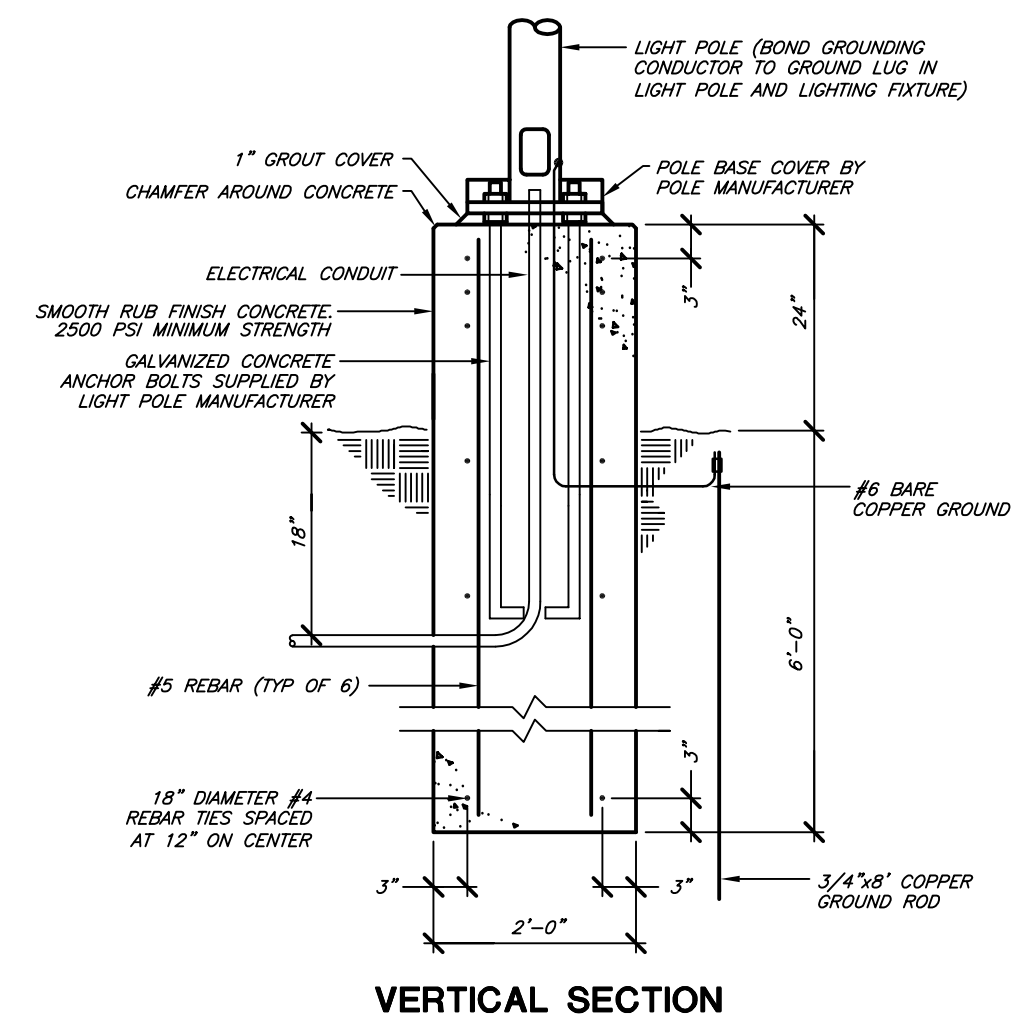

**3 LIGHT POLE CONCRETE BASE**  
NO SCALE

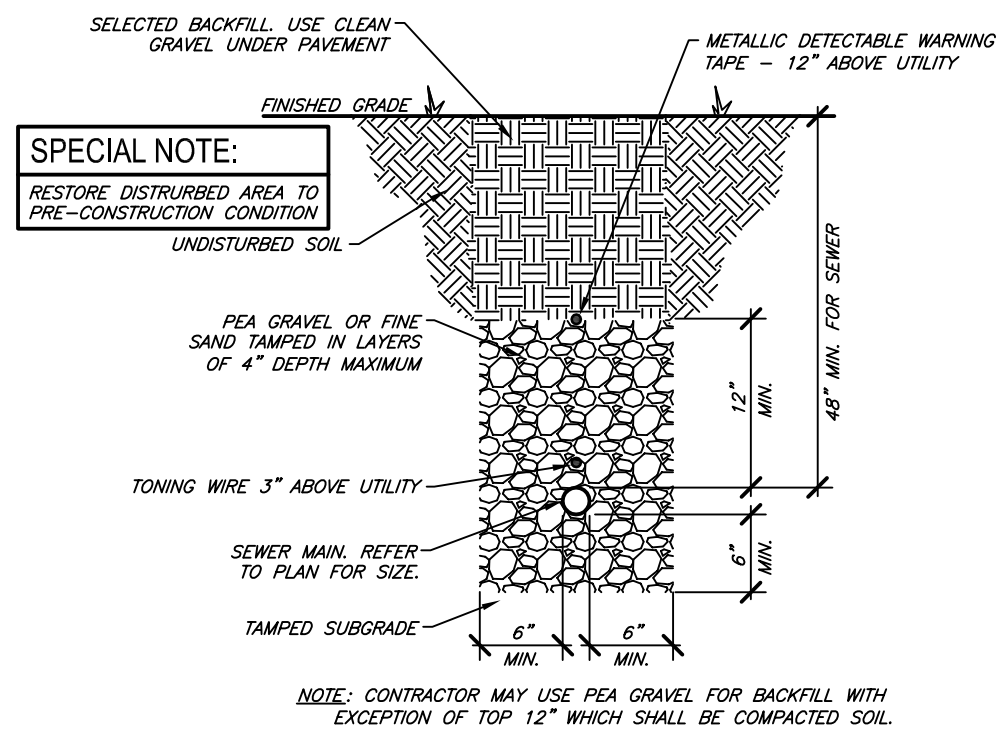

**2 SEWER TRENCH DETAIL**  
NO SCALE

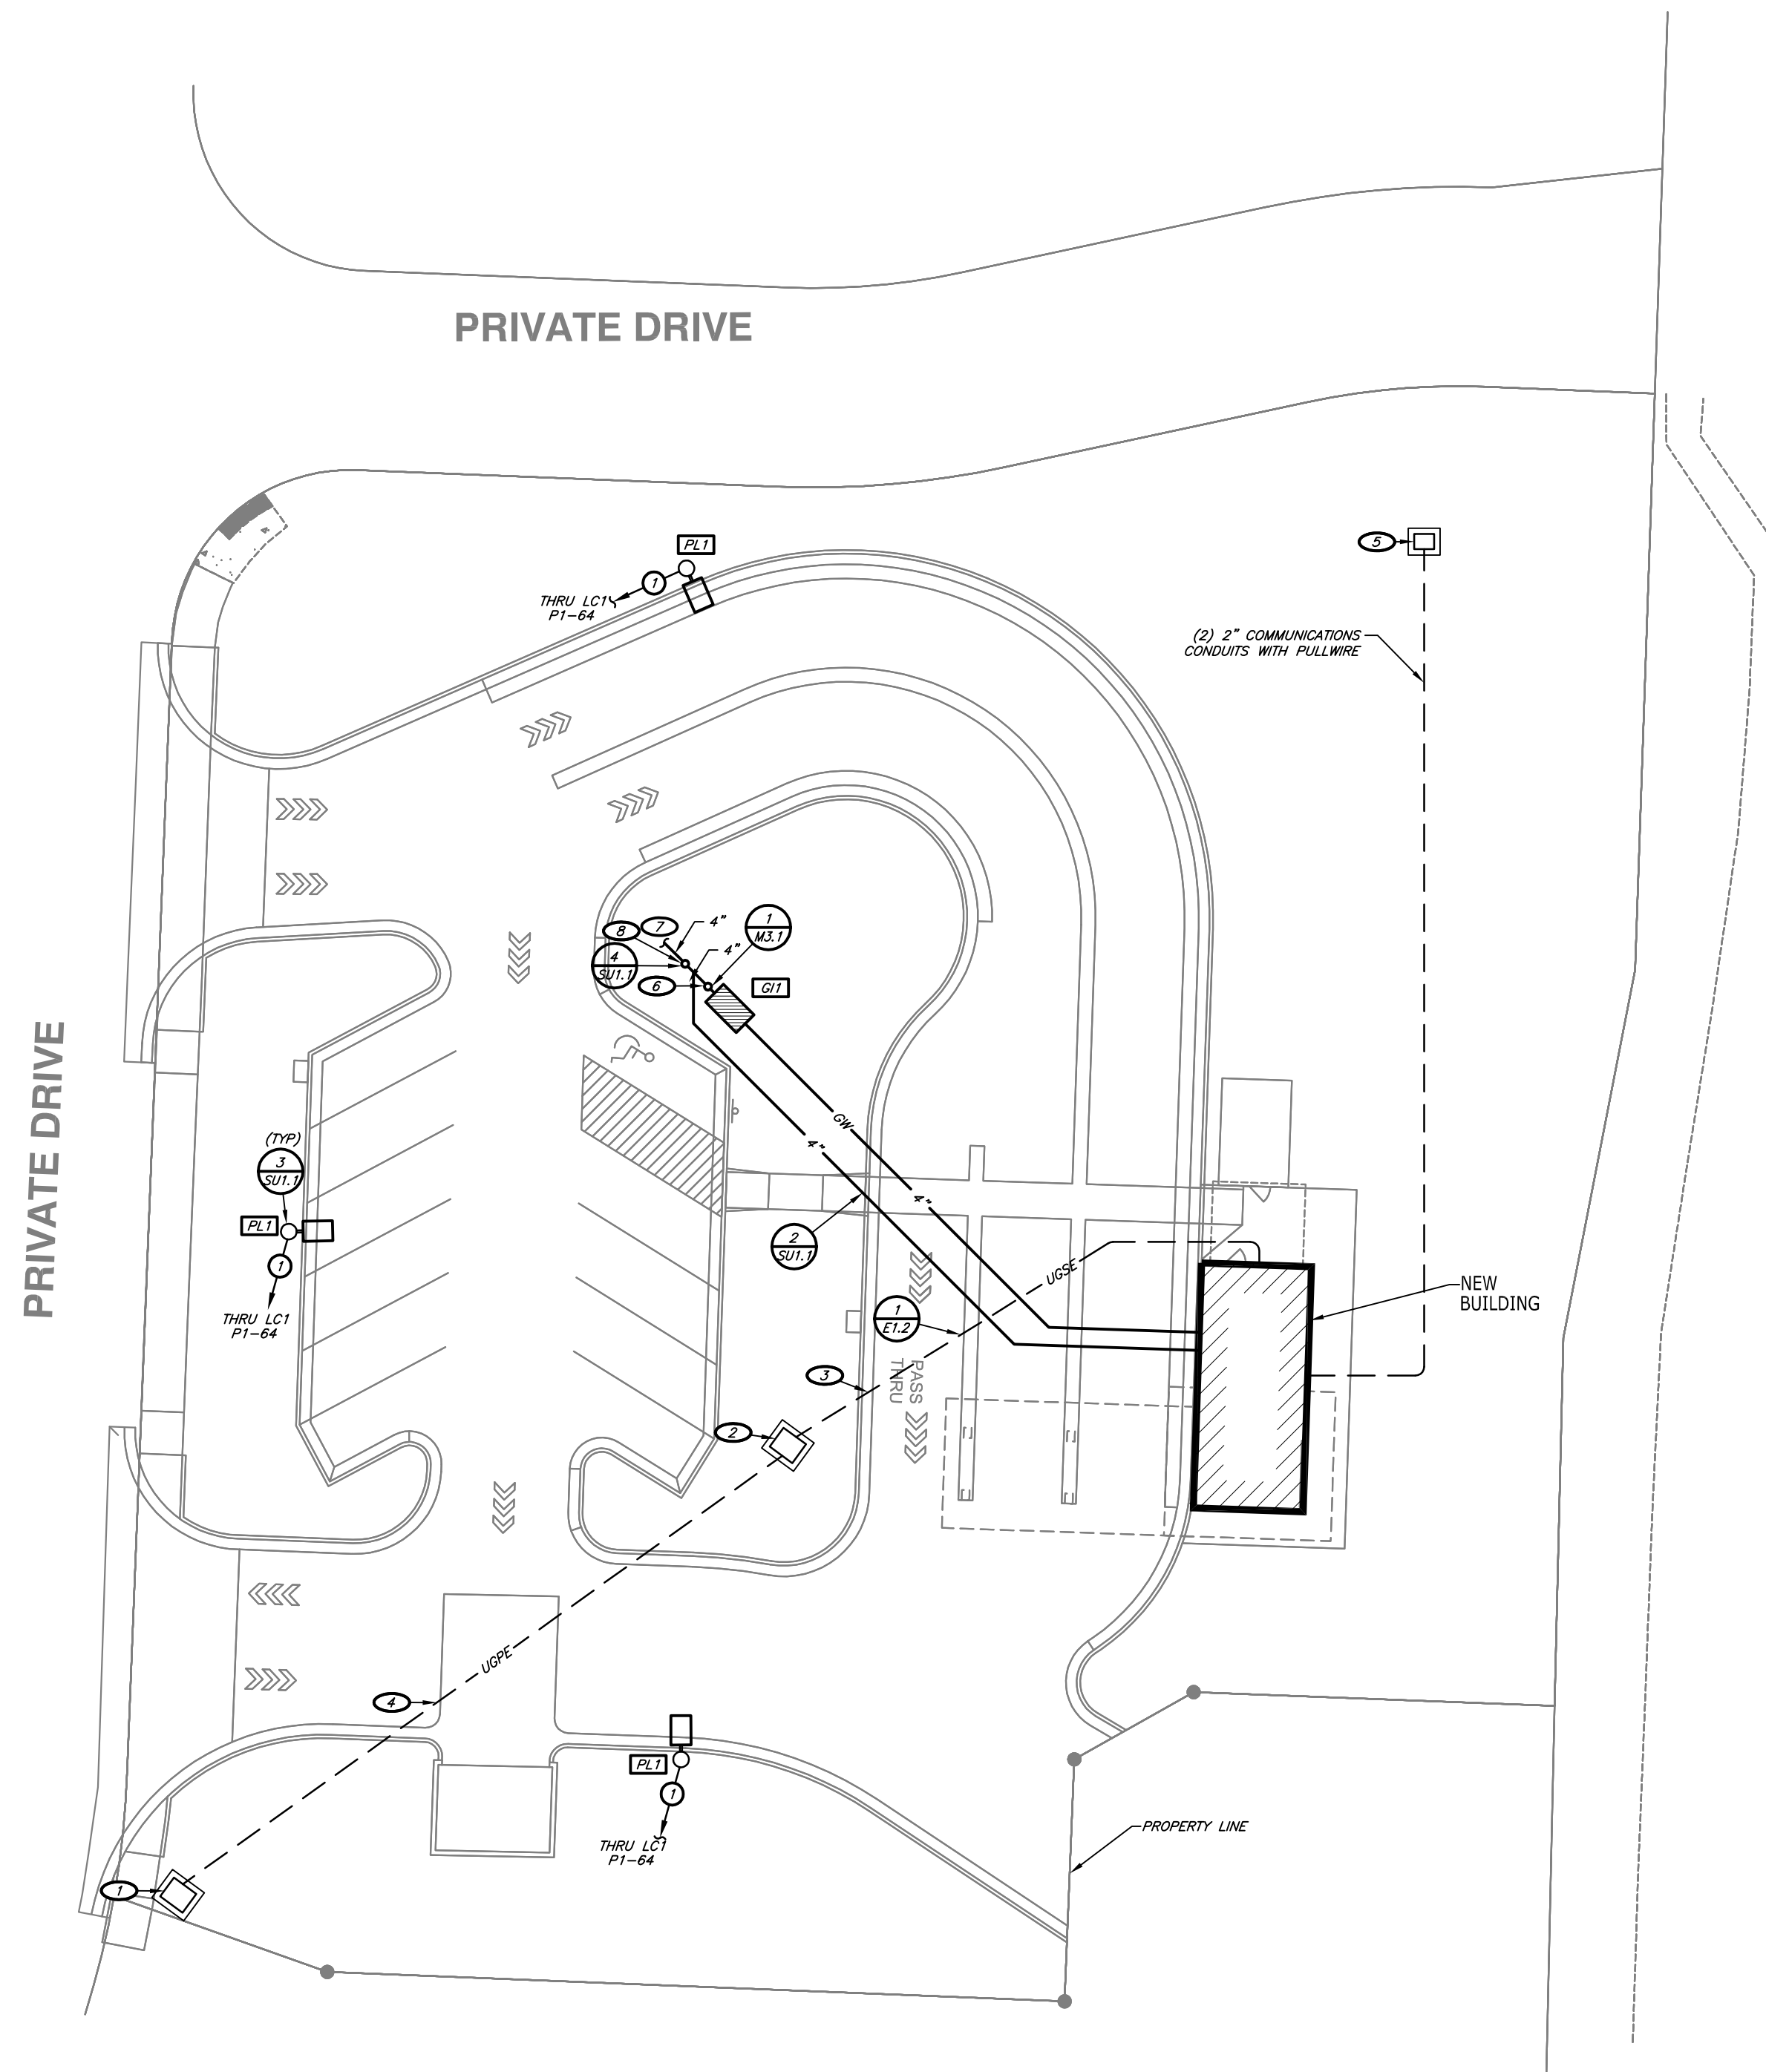

**1 SITE PLAN**  
1" = 20'-0"  
NORTH

## KEYNOTES:

- EXISTING PRIMARY JUNCTION BOX IN THIS AREA. COORDINATE EXACT LOCATION AND REQUIREMENTS WITH UTILITY COMPANY.
- PADMOUNT 120/240-VOLT SINGLE-PHASE TRANSFORMER BY UTILITY COMPANY. CONCRETE PAD BY CONTRACTOR. EXACT LOCATION SHALL BE FIELD DETERMINED/COORDINATED.
- SECONDARY CONDUIT AND CONDUCTORS BY CONTRACTOR. FIELD COORDINATE EXACT ROUTINGS.
- PRIMARY CONDUITS AND CONDUCTORS BY UTILITY COMPANY. VERIFY EXACT ROUTING, TERMINATION LOCATION, AND REQUIREMENTS WITH THE UTILITY COMPANY. COORDINATE WITH UTILITY COMPANY FOR CONDUCTOR/CONDUIT SIZES.
- PROVIDE 18x18 2-BOLT, OPEN BOTTOM, HEAVY DUTY PULL BOX EQUIVALENT TO HUBBELL-QUANTE MODEL DT12123232. "COMMUNICATIONS" SHALL BE INSCRIBED ON THE LID. INSTALL TOP OF BOX FLUSH WITH FINISH GRADE. PROVIDE EXTENSION AS REQUIRED TO MATCH CONDUIT BURIAL DEPTH. VERIFY/COORDINATE EXACT SERVICE LOCATION AND ALL REQUIREMENTS WITH SERVICE PROVIDER(S) PRIOR TO CONDUIT AND COMMUNICATION BOX INSTALLATION.
- 4" WASTE UP TO FINISH GRADE CLEANOUT.
- REFER TO CIVIL PLAN FOR CONTINUATION.
- 4" WASTE UP TO SAMPLING MANHOLE.

## CONDUIT & CONDUCTOR SCHEDULE:


- (2) #10 AND (1) #10 GROUND IN 0.75" CONDUIT.

## GENERAL NOTES:

- UTILITY ROUTINGS ARE DIAGRAMMATIC. ADJUST EXACT ROUTING TO ACCOMMODATE FIELD CONDITIONS. REFER TO CIVIL AND PUBLIC IMPROVEMENT PLANS FOR NEW SEWER, WATER AND STORMWATER PIPING.
- REFER TO CIVIL AND PUBLIC IMPROVEMENT PLANS FOR LOCATION AND COORDINATION OF ALL EASEMENTS.
- REVIEW ALL CIVIL AND PUBLIC IMPROVEMENT PLANS AND COORDINATE ALL WORK WITH DIFFERENT DISCIPLINES. REVIEW AND OBTAIN APPROVAL FROM CITY UTILITIES AND CITY OF SPRINGFIELD PRIOR TO PERFORMING ANY UTILITY WORK.
- THE CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING HIS BID. NO EXTRAS WILL BE PAID DUE TO UNANTICIPATED EXISTING CONDITIONS. PLANS ARE DIAGRAMMATIC AND SHALL NOT BE SCALED. REFER TO ARCHITECTURAL AND CIVIL DRAWINGS FOR DIMENSIONS.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING TEMPORARY TELEPHONE, ELECTRICAL AND WATER SERVICES REQUIRED DURING CONSTRUCTION, AND SHALL PAY ALL ASSOCIATED COSTS.
- THE CONTRACTOR SHALL CONTACT EVERGY AT (888) 471-5275 AND ARRANGE FOR ELECTRICAL SERVICES AS INDICATED ON DRAWINGS. THE CONTRACTOR SHALL INCLUDE ALL FEES, CHARGES, ETC. INCURRED BY THE UTILITY COMPANY INTO BID. THE CONTRACTOR SHALL PROVIDE ALL MATERIALS AS REQUIRED BY THE LOCAL AUTHORITIES FOR SERVICE INSTALLATION. ALL WORK SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF LOCAL AUTHORITIES.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING WITH TELECOMMUNICATIONS AND CABLE TELEVISION SERVICE PROVIDERS TO FACILITATE AND SCHEDULE INSTALLATION OF SERVICES. CONTRACTOR SHALL COORDINATE WITH OWNED FOR SERVICE PROVIDER CONTACT. THE OWNER SHALL BE RESPONSIBLE FOR ALL COSTS, CHARGES, FEES, ETC. INCURRED BY SERVICE PROVIDERS. PROVIDE ALL MATERIALS AS REQUIRED BY LOCAL AUTHORITIES FOR SERVICE INSTALLATION. ALL WORK SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS OF LOCAL AUTHORITIES.
- ALL SITE ELECTRICAL INSTALLATIONS AND CONSTRUCTION SHALL BE PER THE MOST RECENT REVISIONS OF THE NATIONAL ELECTRIC SAFETY CODE (NEC) AND THE NATIONAL ELECTRIC CODE (NEC) STANDARDS AND SPECIFICATIONS.
- COORDINATE ALL TRANSFORMER LOCATIONS WITH OTHER UTILITIES INDICATED ON CIVIL PLANS.
- REFER TO CIVIL PLANS FOR ALL SITE SANITARY SEWER WORK.

## SITE UTILITIES SYMBOLS:

— OHE —	OVERHEAD ELECTRIC
--- UGPE ---	UNDERGROUND PRIMARY ELECTRIC
--- UGSE ---	UNDERGROUND SECONDARY ELECTRIC
--- LCT ---	UNDERGROUND TELECOMMUNICATIONS
--- UGCT ---	UNDERGROUND CABLE TV

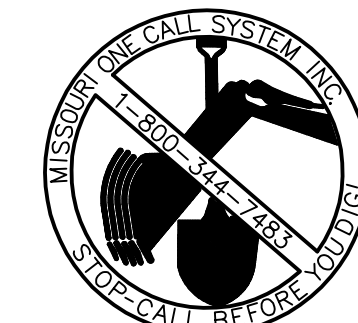

Engineering | Energy | Innovation  
2225 West Chesterfield Boulevard, Suite 200, Springfield, MO 65807  
P: 417.877.1700 F: 417.324.7735 www.cjd-eng.com  
Missouri State Certificate of Authority #2005026903

Special Notice: Drawings prepared by CJD LLC are instruments of service for use solely with respect to this project. CJD LLC retains ownership and all common law, statutory and other reserved rights including copyrights. This drawing shall not be reused in part or in full for any other work without prior written consent by CJD and appropriate compensation to CJD LLC. If necessary, changes to the design without prior written approval from CJD LLC, shall be at the client's expense and shall constitute a new contract. CJD LLC shall not be responsible for any damages, liabilities or costs resulting directly or indirectly from such changes to the fullest extent of the law.



7 BREW COFFEE  
LEE'S SUMMIT, MO



ENGINEER OF RECORD:  
NAME: RYAN JONES  
LICENSE NO. PE-2004017193

PROJECT NUMBER:  
21334 7BSM

REVISION:

SU1.1  
SITE UTILITIES  
PLAN  
DATE: APRIL 26, 2022

116 NORTH 2ND AVENUE - OZARK, MO 65721 - P (417) 581-8889  
F (417) 581-9002  
ARCHITECTURAL CORPORATION MISSOURI LICENSE NUMBER: A-2010011427

1410 NE DOUGLAS STREET  
LEE'S SUMMIT, MO 64086



TUBE ARCHITECTURAL DS-WS05  
LED Wall Mounts




WAC LIGHTING

Fixture Type:   
Catalog Number:   
Project:   
Location:


- PRODUCT DESCRIPTION**  
The latest energy efficient LED technology in an appealing cylindrical profile delivers accent and wash lighting. Comes in various light distribution and beam angle options.
- FEATURES**
- High performance exterior rated LED wall mount light
  - Fixture can install upside down to allow light distribution
  - Solid aluminum construction
  - 5 year warranty
- SPECIFICATIONS**
- Input:** Universal voltage 120V-277VAC, 50/60Hz  
**Dimming:** Electronic low voltage (ELV): 100%-5%  
0-10V, 0-5V, 1-5V
- Light Sources:** High output 3 Step Mac Adam Ellipse COB  
Rated life of 60,000 hours at L70
- Finish:** Electrostatically powder coated, white, black, bronze and graphite  
**Standards:** IP65 rated, ETL & UL wet location listed  
**Energy Star:** 2.2 rated, Title 24 (AS 2005) Compliant  
**Operating Temp:** 13°F to 122°F (-20°C to 50°C)

Ordering Number	Beam	Beam Angle	Color Temp	CRF	Reference Output Lumen	CRP	Efficiency lm/w	Light Distribution	Finish
S Spot	10°	9275	2700K	80	1825	10000	73		
		1750	2700K	80	3650	10000	73		
		2625	2700K	80	5475	10000	73		
		3500	2700K	80	7300	10000	73		
		4375	2700K	80	9125	10000	73		
H Straight up	25°	9275	2700K	80	1810	5280	72		
		1750	2700K	80	3710	5331	69		
		2625	2700K	80	5480	5478	75		
		3500	2700K	80	7350	5529	72		
		4375	2700K	80	9220	5580	93		
DS-WS05 S	25°	9275	2700K	80	1800	4511	76		WT Black GR White GR Graphite
		1750	2700K	80	3770	4661	76		
		2625	2700K	80	5640	4811	76		
		3500	2700K	80	7510	4961	76		
		4375	2700K	80	9380	5112	76		
DS-WS05T S	17°	9275	2700K	80	2445	5812	78		
		1750	2700K	80	4890	5870	78		
		2625	2700K	80	7335	5928	78		
		3500	2700K	80	9780	5987	78		
		4375	2700K	80	12225	6045	78		
F Flood	30°	9275	2700K	80	2600	2600	100		
		1750	2700K	80	2600	2600	100		
		2625	2700K	80	2600	2600	100		
		3500	2700K	80	2600	2600	100		
		4375	2700K	80	2600	2600	100		
F Flood	N/A	1078	2700K	80	2600	2600	100		
		278	2700K	80	2600	2600	100		
		548	2700K	80	2600	2600	100		
		818	2700K	80	2600	2600	100		
		1088	2700K	80	2600	2600	100		




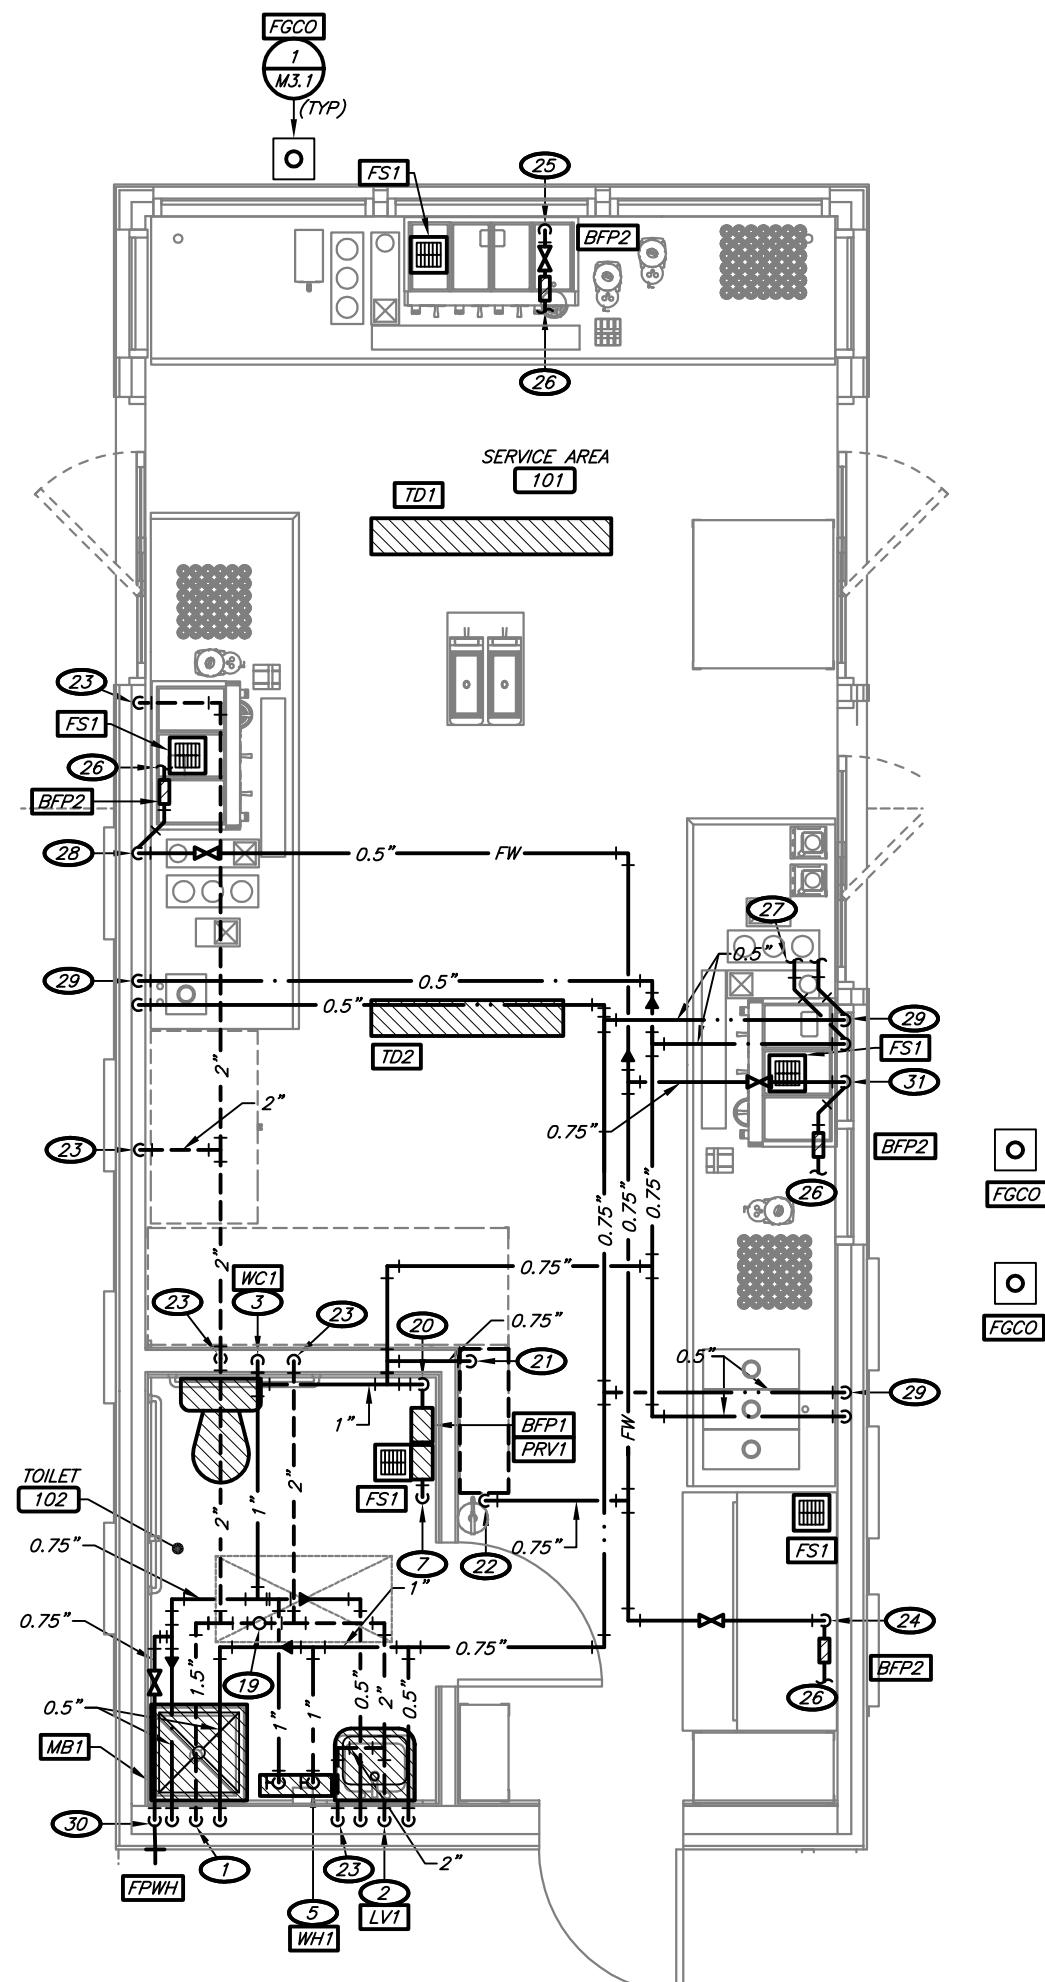

2 GROUND LEVEL PLUMBING PLAN  
1/4" = 1'-0"

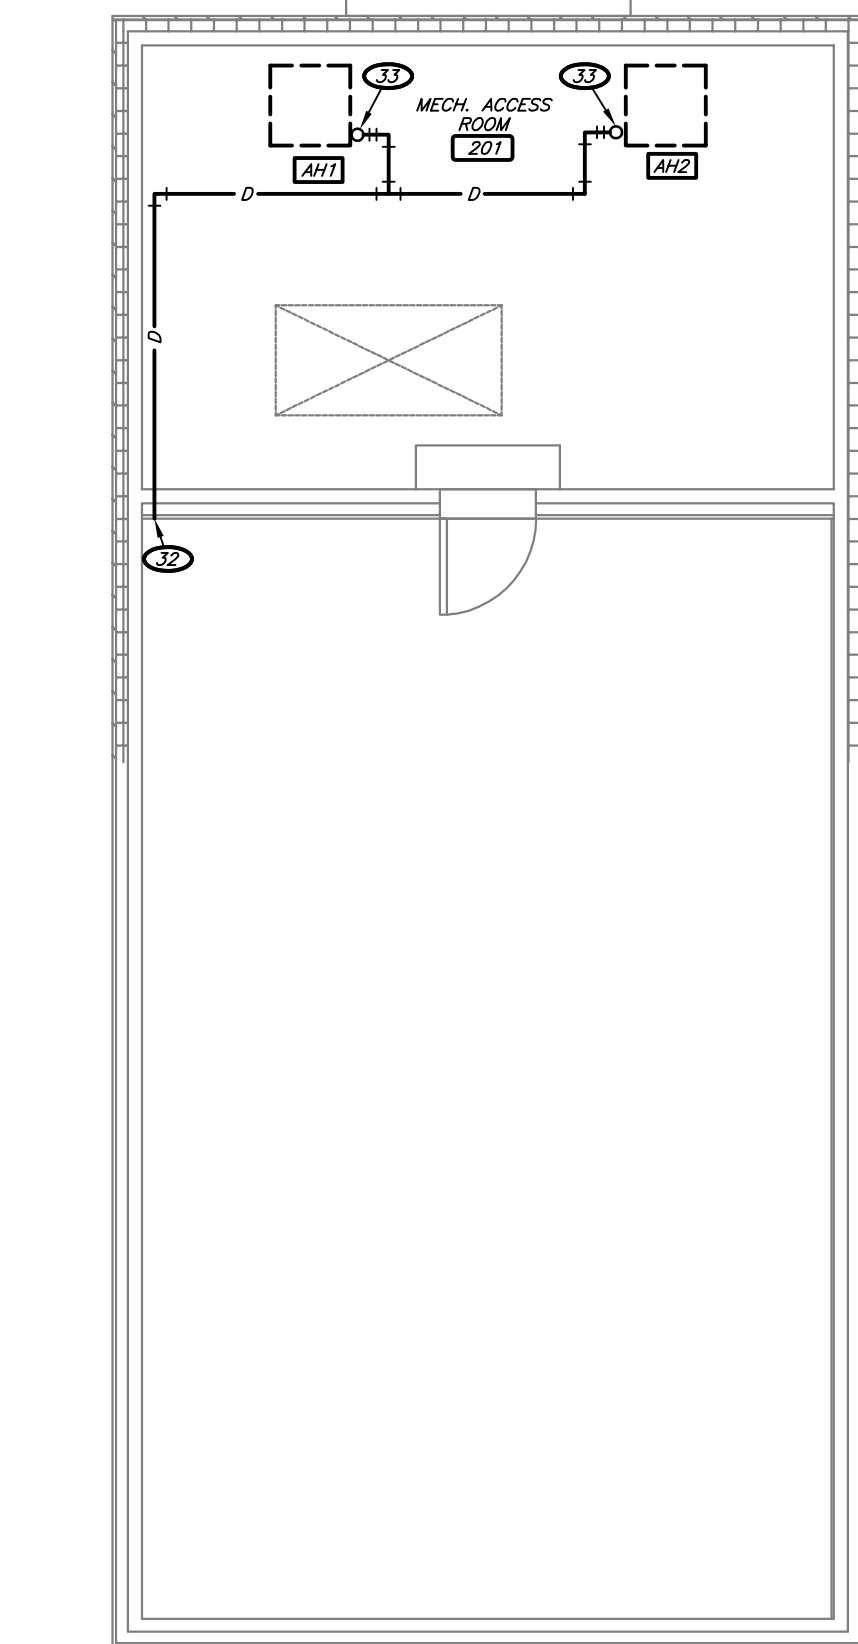

3 ROOF AND ATTIC PLUMBING PLAN  
1/4" = 1'-0"

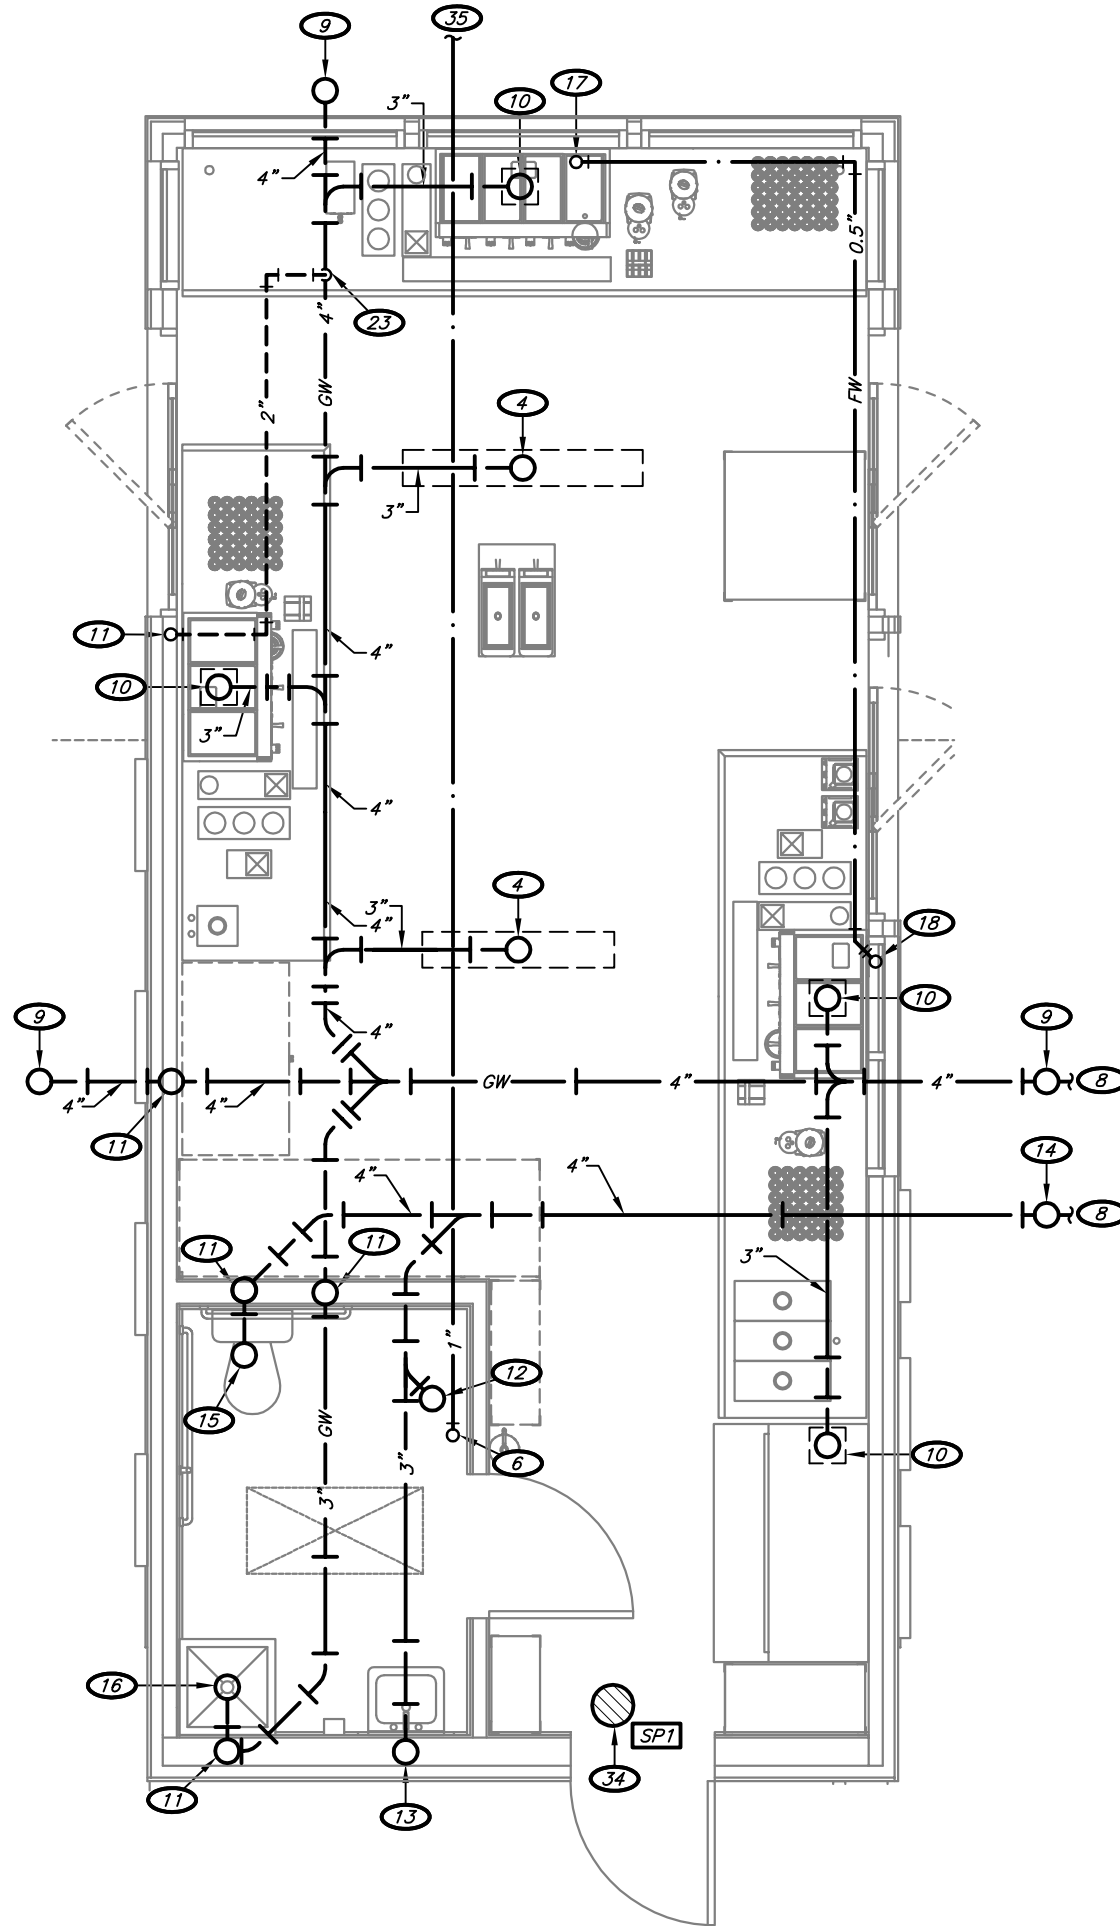

1 UNDERSLAB PLUMBING PLAN  
1/4" = 1'-0"



GREASE INTERCEPTOR CALCULATION  
VOLUME OF 3-COMPARTMENT SINK: 7800 CUBIC IN.  
VOLUME OF MOP BASIN: 3760 CUBIC IN.  
VOLUME OF RINSER SINK: 770 CUBIC IN.  
VOLUME OF RINSER SINK: 1000 CUBIC IN.  
VOLUME OF RINSER SINK: 770 CUBIC IN.  
TOTAL: 16100 CUBIC IN.  
— CONVERSIONS TO GALLONS: 70 GALLONS  
GREASE INTERCEPTOR IS SIZED FOR 75-GPM.

## KEYNOTES:

- 1.5" VENT, 0.5" HOT AND COLD WATER DOWN TO MOP BASIN.
- 1.5" VENT, 0.5" HOT AND COLD WATER DOWN TO LAVATORY.
- 0.5" COLD WATER DOWN TO WATER CLOSET.
- 3" TRAPPED GREASE WASTE UP TO TRENCH DRAIN.
- 1" HOT AND COLD WATER DOWN TO TANKLESS WATER HEATER.
- 1" WATER SERVICE UP. REFER TO 2/M1.1 FOR CONTINUATION.
- 1" WATER SERVICE DOWN. REFER TO 1/M1.1 FOR CONTINUATION.
- REFER TO SU1.1 DRAWINGS FOR CONTINUATION.
- 4" GREASE WASTE UP TO FINISH GRADE CLEANOUT.
- 3" TRAPPED GREASE WASTE UP TO FLOOR SINK.
- 2" VENT UP.
- 3" TRAPPED WASTE UP TO FLOOR SINK.
- 2" WASTE UP TO LAVATORY.
- 4" WASTE UP TO FINISH GRADE CLEANOUT.
- 4" WASTE UP TO WATER CLOSET.
- 3" TRAPPED GREASE WASTE UP TO MOP BASIN.
- 0.5" FILTERED WATER UP TO BEVERAGE EQUIPMENT.
- 0.5" FILTERED WATER UP.
- 2" VENT UP TO 3" VENT THROUGH ROOF.
- 1" COLD WATER DOWN TO BACKFLOW PREVENTER AND PRESSURE REDUCING VALVE.
- 0.75" COLD WATER DOWN TO WATER FILTER. COORDINATE CONNECTION REQUIREMENTS WITH EQUIPMENT PROVIDER.
- 0.75" FILTERED WATER DOWN TO WATER FILTER. COORDINATE CONNECTION REQUIREMENTS WITH EQUIPMENT PROVIDER.
- 2" VENT DOWN.
- PROVIDE 0.5" FILTERED WATER WITH SHUT-OFF VALVE TO ICE MAKER WITH BACKFLOW PREVENTER. PROVIDE 0.75" INDIRECT DRAIN FROM ICE-MAKER TO FLOOR SINK AS REQUIRED.
- 0.5" FILTERED WATER DOWN.
- CONNECT FILTERED WATER PIPING TO KITCHEN EQUIPMENT. PROVIDE BACKFLOW PREVENTER AS REQUIRED.
- 0.5" HOT AND COLD WATER ROUTED IN OWNER PROVIDED COUNTER TO SINK.
- PROVIDE 0.5" FILTERED WATER WITH SHUT-OFF VALVE TO ESPRESSO MAKER WITH BACKFLOW PREVENTER.
- 0.5" HOT AND COLD WATER DOWN TO SINK. TERMINATE WASTE PIPING AT ADJACENT FLOOR SINK.
- 0.75" COLD WATER DOWN TO FREEZE-PROOF WALL HYDRANT.
- 0.75" COLD WATER DOWN. TEE OFF 0.5" FILTERED WATER WITH SHUT-OFF VALVE TO ESPRESSO MAKER WITH BACKFLOW PREVENTER. CONTINUE 0.5" FILTERED WATER UNDERSLAB. REFER TO 1/M1.1 FOR CONTINUATION. SHOWN OFF-SET FOR CLARITY.
- CONDENSATE SHALL PENETRATE THROUGH WALL AND DISCHARGE ONTO ROOF SURFACE.
- CONDENSATE UP TO AIR HANDLER.
- COORDINATE SUMP PUMP LOCATION WITH OWNER.
- REFER TO CIVIL DRAWINGS FOR CONTINUATION.

## PLUMBING SYMBOLS:

- |                |  |
|----------------|--|
| — GW —         | GREASE WASTE PIPING BELOW SLAB                         |
| - - - GW - - - | GREASE COMBINATION WASTE AND VENT PIPING               |
| — GW —         | GREASE WASTE PIPING ABOVE SLAB                         |
| - - - GW - - - | GREASE COMBINATION WASTE AND VENTING PIPING ABOVE SLAB |
| — RD —         | ROOF DRAIN PIPING ABOVE SLAB                           |
| — ORD —        | OVERFLOW ROOF DRAIN PIPING ABOVE SLAB                  |
| — S —          | SANITARY WASTE PIPING BELOW SLAB                       |
| - - - S - - -  | SANITARY COMBINATION WASTE AND VENT PIPING             |
| — S —          | SANITARY WASTE PIPING ABOVE SLAB                       |
| - - - S - - -  | SANITARY COMBINATION WASTE AND VENT PIPING ABOVE SLAB  |
| — D —          | DOMESTIC COLD WATER PIPING                             |
| — HW —         | DOMESTIC FILTERED COLD WATER PIPING                    |
| — H —          | DOMESTIC HOT WATER PIPING                              |
| — V —          | PLUMBING VENT PIPING                                   |
| — D —          | CONDENSATE DRAIN PIPING                                |
| — S —          | SHUT-OFF VALVE   |
| — U —          | UNION  |
| — T —          | TEE / ELBOW DOWN WITH VALVE IN VERTICAL PIPE           |
| — F —          | FREEZEPROOF WALL HYDRANT / HOSE BIBB                   |
| — B —          | BACKFLOW PREVENTER                                     |
| — F —          | FLOOR DRAIN / FLOOR SINK                               |
| — C —          | FINISH GRADE CLEANOUT                                  |
| — F —          | FINISH FLOOR CLEANOUT                                  |



7 BREW COFFEE  
LEE'S SUMMIT, MO

1410 NE DOUGLAS STREET  
LEE'S SUMMIT, MO 64086



ENGINEER OF RECORD:  
NAME: RYAN JONES  
LICENSE NO. PE-2004017193  
PROJECT NUMBER:  
21334 7BSM  
REVISION:


M1.1  
PLUMBING PLAN

DATE: APRIL 26, 2022




Engineering | Energy | Innovation  
2225 West Chesterfield Boulevard, Suite 200, Springfield, MO 65807  
P: 417.877.1700 P: 417.324.7735 www.cjd-eng.com  
Missouri State Certificate of Authority #2005026903  
Special Notice: Drawings prepared by CJD LLC are instruments of service for use solely with respect to this project. CJD LLC retains ownership and all common law, statutory and other reserved rights including copyrights. This drawing shall not be re-used in part or in full for any other work without prior written consent by and appropriate compensation to CJD LLC. Without changing the design without prior written approval from CJD LLC, those in all their own and assuming full responsibility for any damages, liabilities or costs resulting directly or indirectly from such changes to the fullest extent of the law.



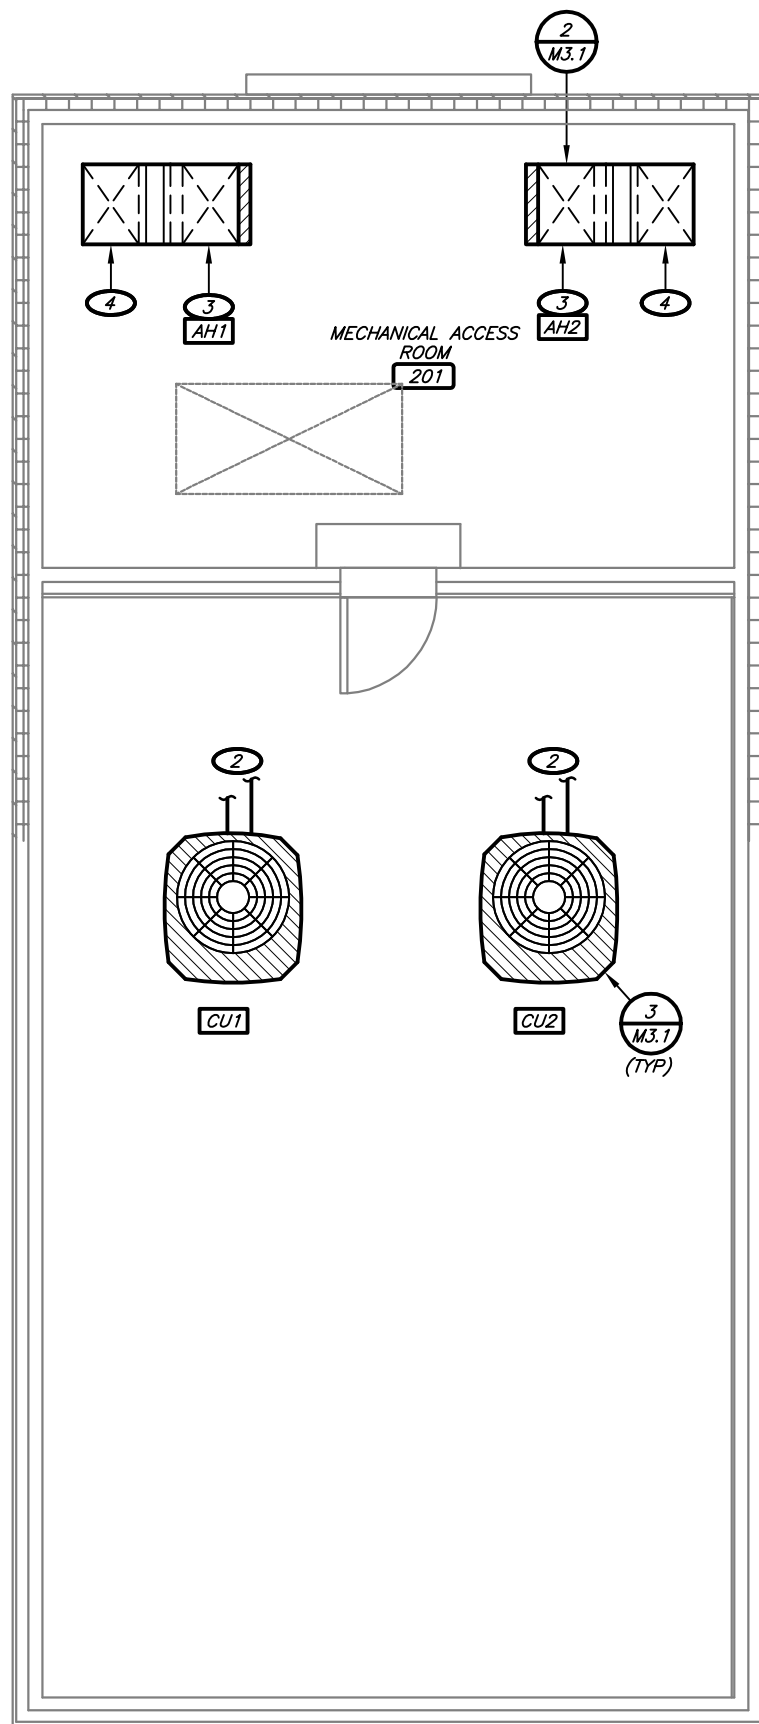

2 PARTIAL ROOF AND ATTIC HVAC PLAN  
1/4" = 1'-0" NORTH

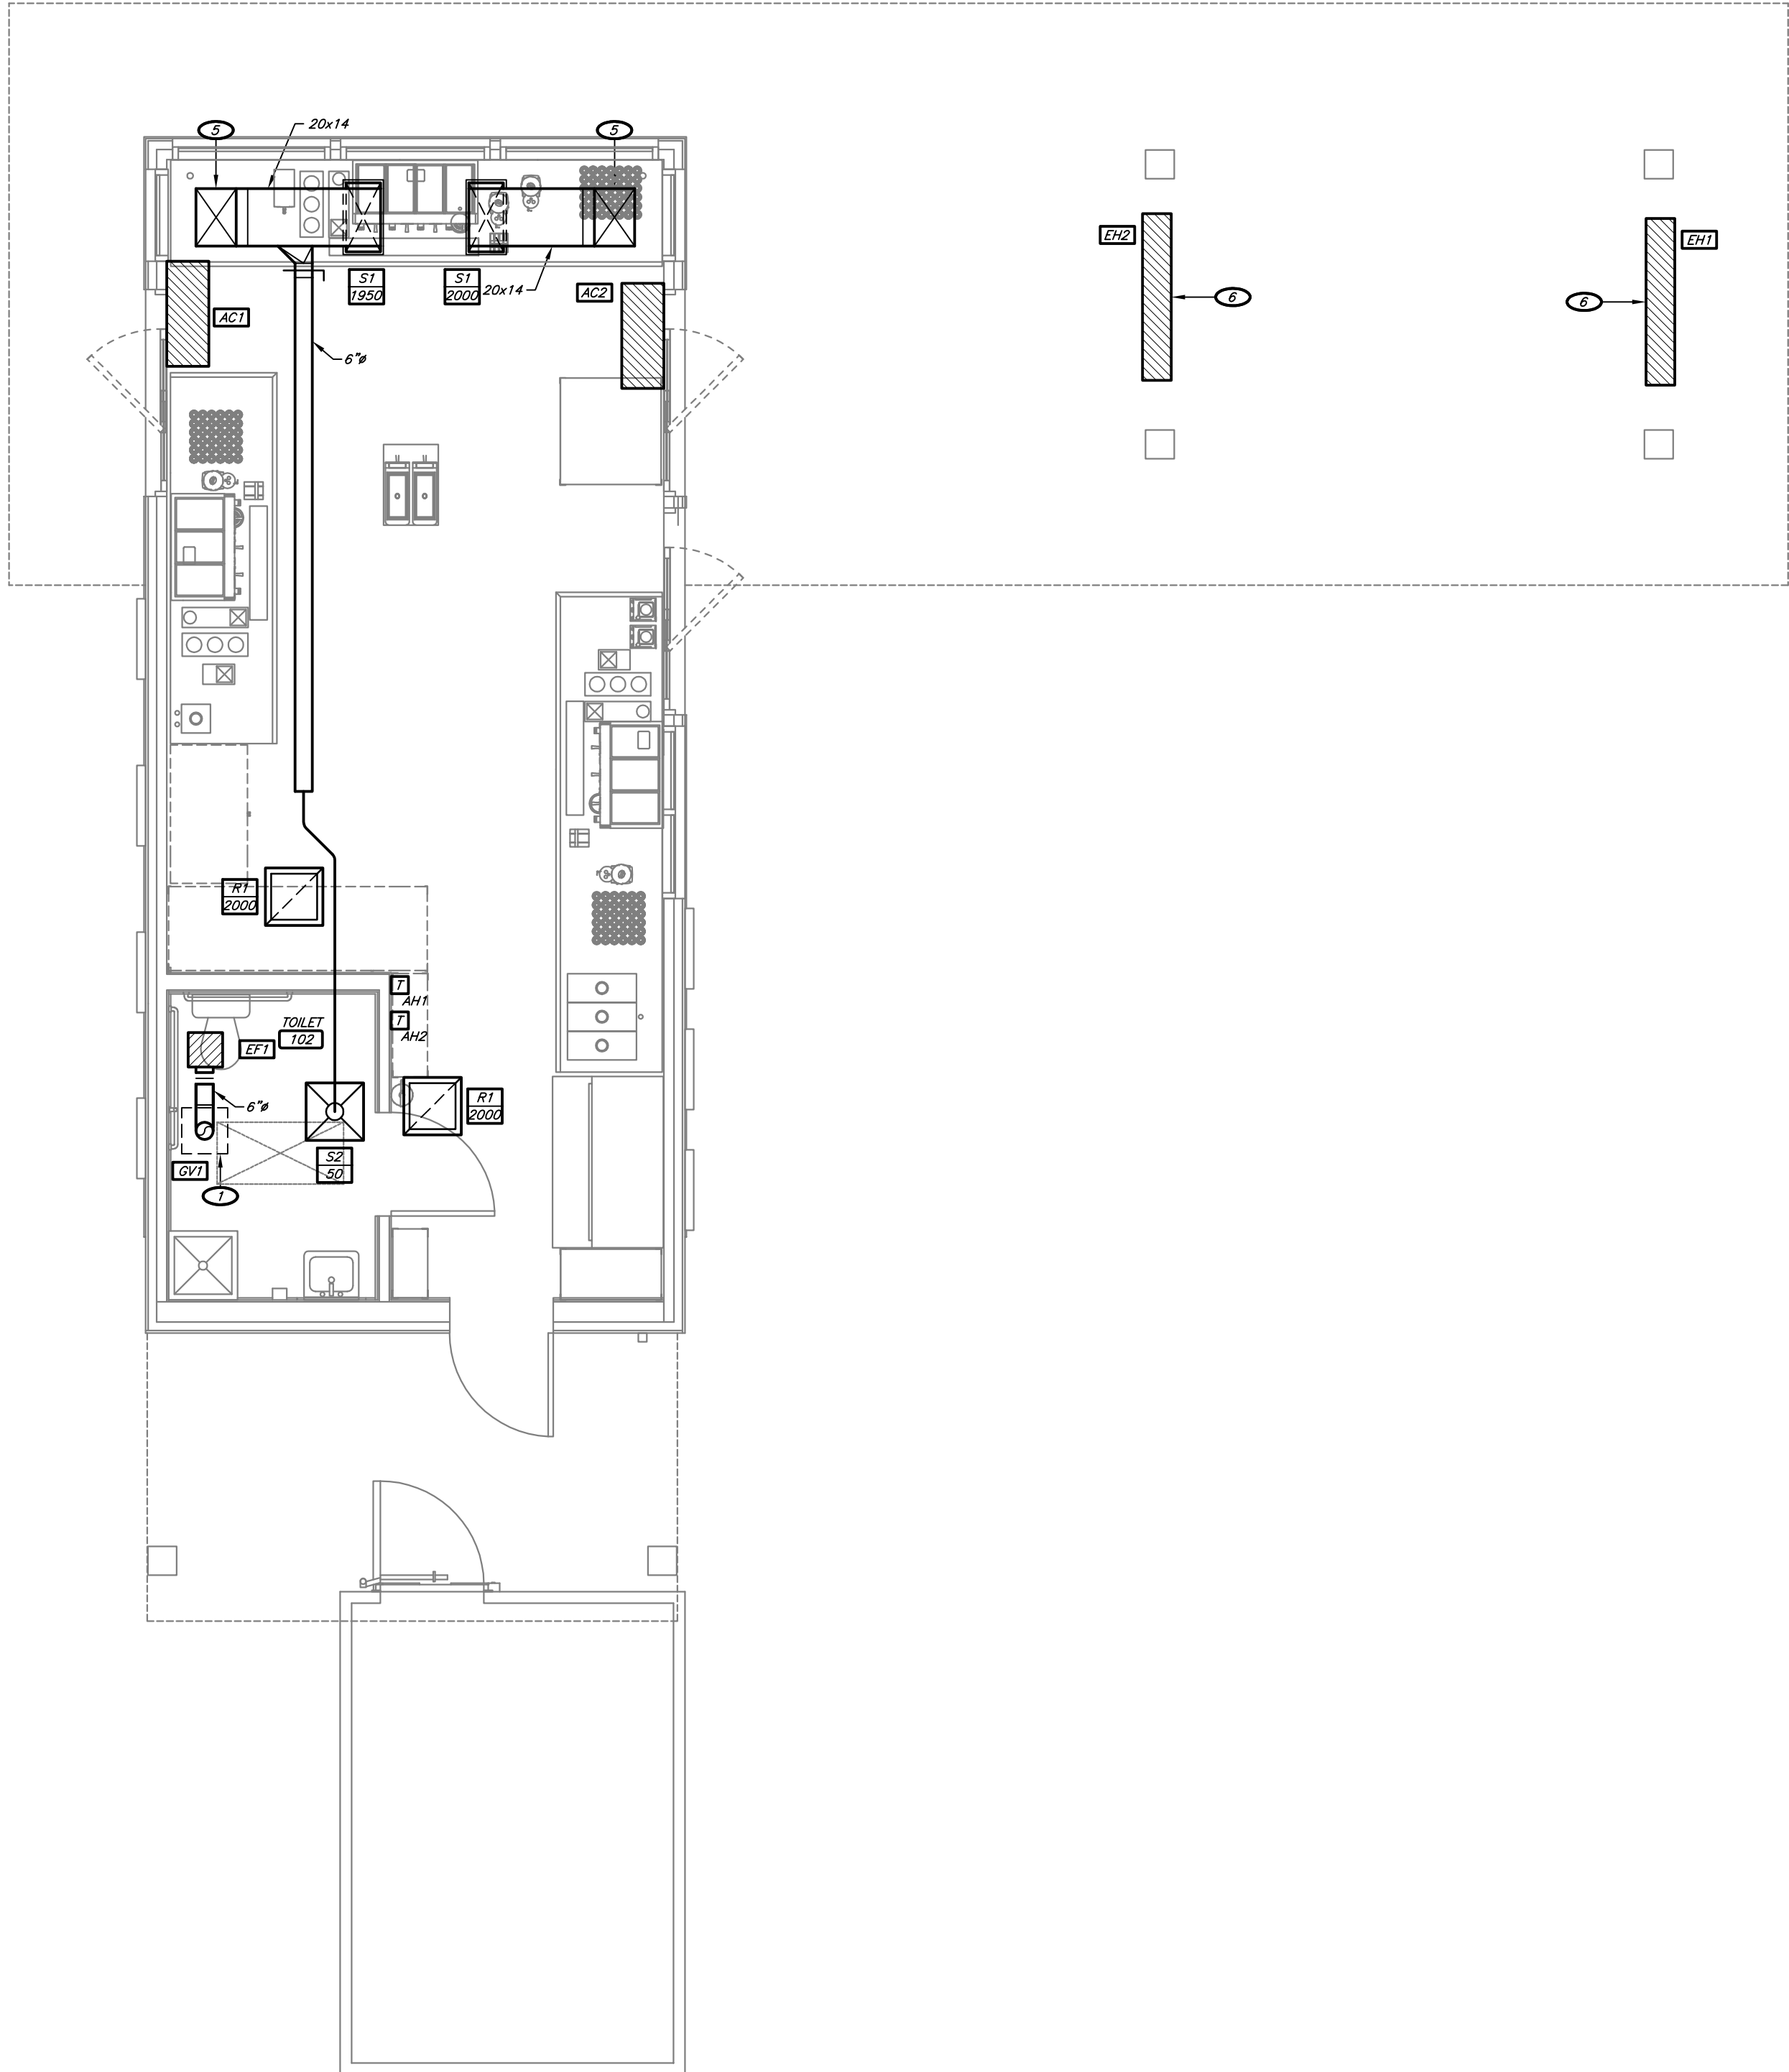

1 GROUND LEVEL HVAC PLAN  
1/4" = 1'-0" NORTH

KEYNOTES:

- 6" EXHAUST DUCT UP TO GRAVITY VENTILATOR (WITH 8" CURB).
- PROVIDE REFRIGERANT LINE ASSOCIATED AIR HANDLER. SIZE AND INSTALL PER MANUFACTURER'S RECOMMENDATIONS.
- 20x14 SUPPLY DOWN TO AIR HANDLER TRANSITION AS REQUIRED AND PROVIDE FLEXIBLE CONNECTION. 20x16 RETURN DUCT UP TO BOTTOM OF AIR HANDLER FROM BELOW TRANSITION TO UNIT AS REQUIRED.
- 20x14 SUPPLY DOWN. REFER TO 1/M2.1 FOR CONTINUATION.
- 20x14 SUPPLY UP. REFER TO 2/M2.1 FOR CONTINUATION.
- ELECTRIC HEATER. COORDINATE MOUNTING HEIGHT WITH OWNER.

HVAC SYMBOLS:

	FLEXIBLE DUCTWORK
	CEILING RETURN/EXHAUST GRILLE
	CEILING SUPPLY DIFFUSER
	TEMPERATURE SENSOR
	DUCTWORK (WIDTH/HEIGHT) WITH DAMPER
	FLEXIBLE CONNECTION
	DIFFUSER TYPE AND CFM
	RECTANGULAR TO ROUND TAKE-OFF

TORGERSON DESIGN PARTNERS

ARCHITECTURE / INTERIOR DESIGN / DEVELOPMENT

116 NORTH 2ND AVENUE - OZARK, MO 65721 - P (417) 581-8889  
F (417) 581-9002  
ARCHITECTURAL CORPORATION MISSOURI LICENSE NUMBER: A-2010011427

7 BREW COFFEE  
LEE'S SUMMIT, MO  
1410 NE DOUGLAS STREET  
LEE'S SUMMIT, MO 64086



ENGINEER OF RECORD:  
NAME: RYAN JONES  
LICENSE NO. PE-2004017193  
PROJECT NUMBER:  
21334 7BSM  
REVISION:

CJD LLC

Engineering | Energy | Innovation  
2225 West Chesterfield Boulevard, Suite 200, Springfield, MO 65807  
P: 417.877.1700 P: 417.324.7735 www.cjd-eng.com  
Missouri State Certificate of Authority #2005026903

Special notice: Drawings prepared by CJD LLC are instruments of service for use solely with respect to this project. CJD LLC retains ownership and all common law, statutory and other reserved rights including copyrights. This drawing shall not be reused in part or in full for any other work without prior written consent by and appropriate compensation to CJD LLC. Whenever changes to the design without prior written approval from CJD LLC, those in all their own and assumed full responsibility for any damages, liabilities or costs resulting directly or indirectly from such changes to the fullest extent of the law.

M2.1  
HVAC PLAN  
DATE: APRIL 26, 2022




PIPING MATERIAL SCHEDULE													
SYSTEM	PIPING					FITTINGS		MAXIMUM WORKING		FIELD TEST		NOTES	
	SIZE	TYPE	SCHEDULE	GRADE	ASTM	MATERIAL	MATERIAL	TYPE	PRESSURE (PSI)	TEMP (DEG F)	PRESSURE (PSI)		TIME (HOURS)
DOMESTIC WATER ABOVE AND BELOW GRADE	0.5"-2"	PEX	-	-	A877	PEX	BRONZE	MJ	120	40-180	150	1	-
GREASE WASTE AND VENT ABOVE GRADE	ALL	DWV	40	-	2665	PVC	PVC	DR/SW	10 FT	50-180	10 FT	1	1
GREASE WASTE BELOW GRADE	ALL	DWV	40	-	2665	PVC	PVC	DR/SW	10 FT	50-180	10 FT	1	1
SANITARY WASTE BELOW GRADE	ALL	DWV	40	-	2665	PVC	PVC	DR/SW	10 FT	50-180	10 FT	1	1
SANITARY WASTE & VENT ABOVE GRADE	ALL	DWV	40	-	2665	PVC	PVC	DR/SW	10 FT	50-180	10 FT	1	1
TEMPERATURE & PRESSURE RELIEF DRAIN	ALL	M	-	-	B88	COPPER	COPPER	DR/SJ	10 FT	40-70	10 FT	1	-
NOTES:													
1. USE OF CELLULAR CORE DWV PIPING IS STRICTLY PROHIBITED.													
ABBREVIATIONS:													
CI	- CAST IRON	DR	- DRAINAGE FITTING			NH	- NO-HUB						
CS	- CARBON STEEL	DWV	- DRAINAGE WASTE AND VENT			SJ	- 95.5 TIN-ANTIMONY SOLDER JOINT						
CW	- CONTINUOUS WELD	MI	- MALLEABLE IRON			SS	- STANDARD STRENGTH / SERVICE WEIGHT						
DI	- DUCTILE IRON	MJ	- MECHANICAL JOINT			SW	- SOLVENT WELD						


PLUMBING FIXTURE & EQUIPMENT SCHEDULE										
MARK	DESCRIPTION	MANUFACTURER	MODEL NUMBER	ACCESSORIES	PIPING CONNECTION SIZES				NOTES	EQUIVALENT MANUFACTURERS
					COLD WATER	HOT WATER	WASTE	VENT		
BFP1	BACK FLOW PREVENTER	WATTS	LF009	LEAD FREE BRONZE CONSTRUCTION. TWO IN LINE INDEPENDENT CHECK VALVES, REPLACEABLE CHECK SEATS WITH AN INTERMEDIATE RELIEF VALVE, AND BALL VALVE TEST COCKS.	1"	-	-	-	-	FEBCO
BFP2	BACKFLOW PREVENTER	WATTS	SD-3	DUAL CHECK VALVE WITH ATMOSPHERIC PORT AND STRAINER FOR CARBONATED BEVERAGE MACHINES	0.5"	-	-	-	-	FEBCO
TD1	FLOOR DRAIN	-	-	CUSTOM STAINLESS STEEL TRENCH DRAIN BY OWNER	-	-	SEE PLAN	SEE PLAN	2	ZURN
TD2	FLOOR DRAIN	-	-	CUSTOM STAINLESS STEEL TRENCH DRAIN BY OWNER	-	-	SEE PLAN	SEE PLAN	2	ZURN
FGCO	FINISH GRADE CLEANOUT	ZURN	ZN1400-HD	-	-	-	SEE PLAN	-	-	SIOUX CHIEF, SMITH, WAGE
FPWH	FREEZE-PROOF WALL HYDRANT	JAY R. SMITH	#5609	NICKEL BRONZE-FACE, KEY OPERATED, INTEGRAL VACUUM BREAKER	0.75"	-	-	-	3	SMITH, WOODFORD
FS1	FLOOR SINK	JAY R. SMITH	#3161	CAST IRON RECEPTOR, A.R.E. INTERIOR 12"x12" NICKEL BRONZE STRAINER, SEDIMENT BUCKET	-	-	3"	SEE PLAN	1	-
GI1	GREASE INTERCEPTOR	SCHIER	GB-75	75 GPM, 125 GALLON CAPACITY, 616 lbs. GREASE CAPACITY, PEDESTRIAN RATED COVER, PROVIDE 24" COVER RISER.	-	-	4"	-	-	SUBMIT FOR APPROVAL
LV1	WALL HUNG ADA LAVATORY	AMERICAN STANDARD	#355.012	#2385.130 FAUCET, WITH SINGLE METAL LEVER HANDLE #723.018, 1.25" TALLFACE AND TRAP, SUPPLIES AND STOP VALVES, INSULATE WITH PROWRAP SEAMLESS MOLDED CLOSED CELL VINYL INSULATION, PROVIDE WATTS LF056-B MIXING VALVE.	0.5"	0.5"	2"	1.5"	1,3.	CRANE, KOHLER, TOTO, ZURN
MB1	MOP BASIN	FIAT	MSB-2424	830-AA FAUCET, 839-AA HOSE AND BRACKET, 889-CC MOP HANGER, MS02424 WALL GUARD	0.5"	0.5"	3"	1.5"	1	STERN WILLIAMS
PRV1	PRESSURE REDUCING VALVE	CASH/ACME	EB25	SET TO MAX DELIVERY PRESSURE OF 80-PSI	SEE PLAN	-	-	-	-	FEBCO, WILKINS
WC1	ADA FLUSH TANK WATER CLOSET	AMERICAN STANDARD	2467.016	1.6 GALLON FLUSH, 16.5" HIGH ELONGATED BOWL, FLOOR MOUNTED, TANK TYPE, VITREOUS CHINA, OPEN FRONT SEAT WITH CHECK HINGE AND LEVER COVER, CHROME PLATED ANGLE STOP AND RISER, HANDLE ON WIDE SIDE OF FIXTURE.	0.5"	-	4"	2"	1,4	ELIJER, KOHLER, TOTO
NOTES: 1. ACCESSORIES SHALL BE SAME MANUFACTURER AS FIXTURE / EQUIPMENT UNLESS NOTED OTHERWISE. 2. REFER TO ARCHITECTURAL DRAWINGS FOR MOUNTING HEIGHT. 3. INSTALL ACCESSORIES AS RECOMMENDED BY MANUFACTURER FOR ADA COMPLIANCE. 4. FIELD COORDINATE/VERIFY FRAMING ROUGH-IN DIMENSIONS WITH ASSOCIATED CONTRACTOR BEFORE ORDERING. 5. PROVIDE WALL CARRIER OR BRACKET AS RECOMMENDED BY MANUFACTURER FOR WALL MOUNTED INSTALLATION.										

PUMP SCHEDULE														
MARK	MANUFACTURER	SERIES	INLET	DISCH.	GPM	HEAD (FT.)	NPSH	TYPE	WORKING CLASS	H.P.	RPM	VOLTAGE/ PHASE	CONST.	FLUID TYPE
SP1	ZOELLER	1043-0006	-	1"	35	20	-	SUMP	-	1/3	-	115V	CI	WATER
NOTES/ACCESSORIES: 1. PROVIDE ZOELLER 30-0152 CHECK VALVE INSTALLED ON PUMP DISCHARGE PER MANUFACTURER'S INSTALLATION INSTRUCTIONS.														
ABBREVIATIONS: NPSH - NET POSITIVE SUCTION HEAD CW - CHILLED WATER CHW - CHILLED/HOT WATER CDW - CONDENSER WATER HW - HEATING HOT WATER DHW - DOMESTIC HOT WATER BFCI - BRONZE FITTED CAST IRON AB - ALL BRONZE AI - ALL IRON AS - AQUASTAT KIT BSES - BASE MOUNTED END SUCTION IL - IN-LINE														


WATER HEATER SCHEDULE									
MARK	MANUFACTURER	MODEL #	TYPE	GALLON CAPACITY	RECOVERY GPH @ 85F	KW	VOLTAGE/ PHASE	ACCESSORIES	
WH1	RHEEM	RTEX-18	ELEC	-	-	18.0	240V1	1,2,3	
ACCESSORIES: 1. THERMAL EXPANSION TANK EQUIVALENT TO AMTROL MODEL ST-5 2. DRAIN VALVE WITH THREADED HOSE CONNECTION 3. PRESSURE & TEMPERATURE RELIEF VALVE									

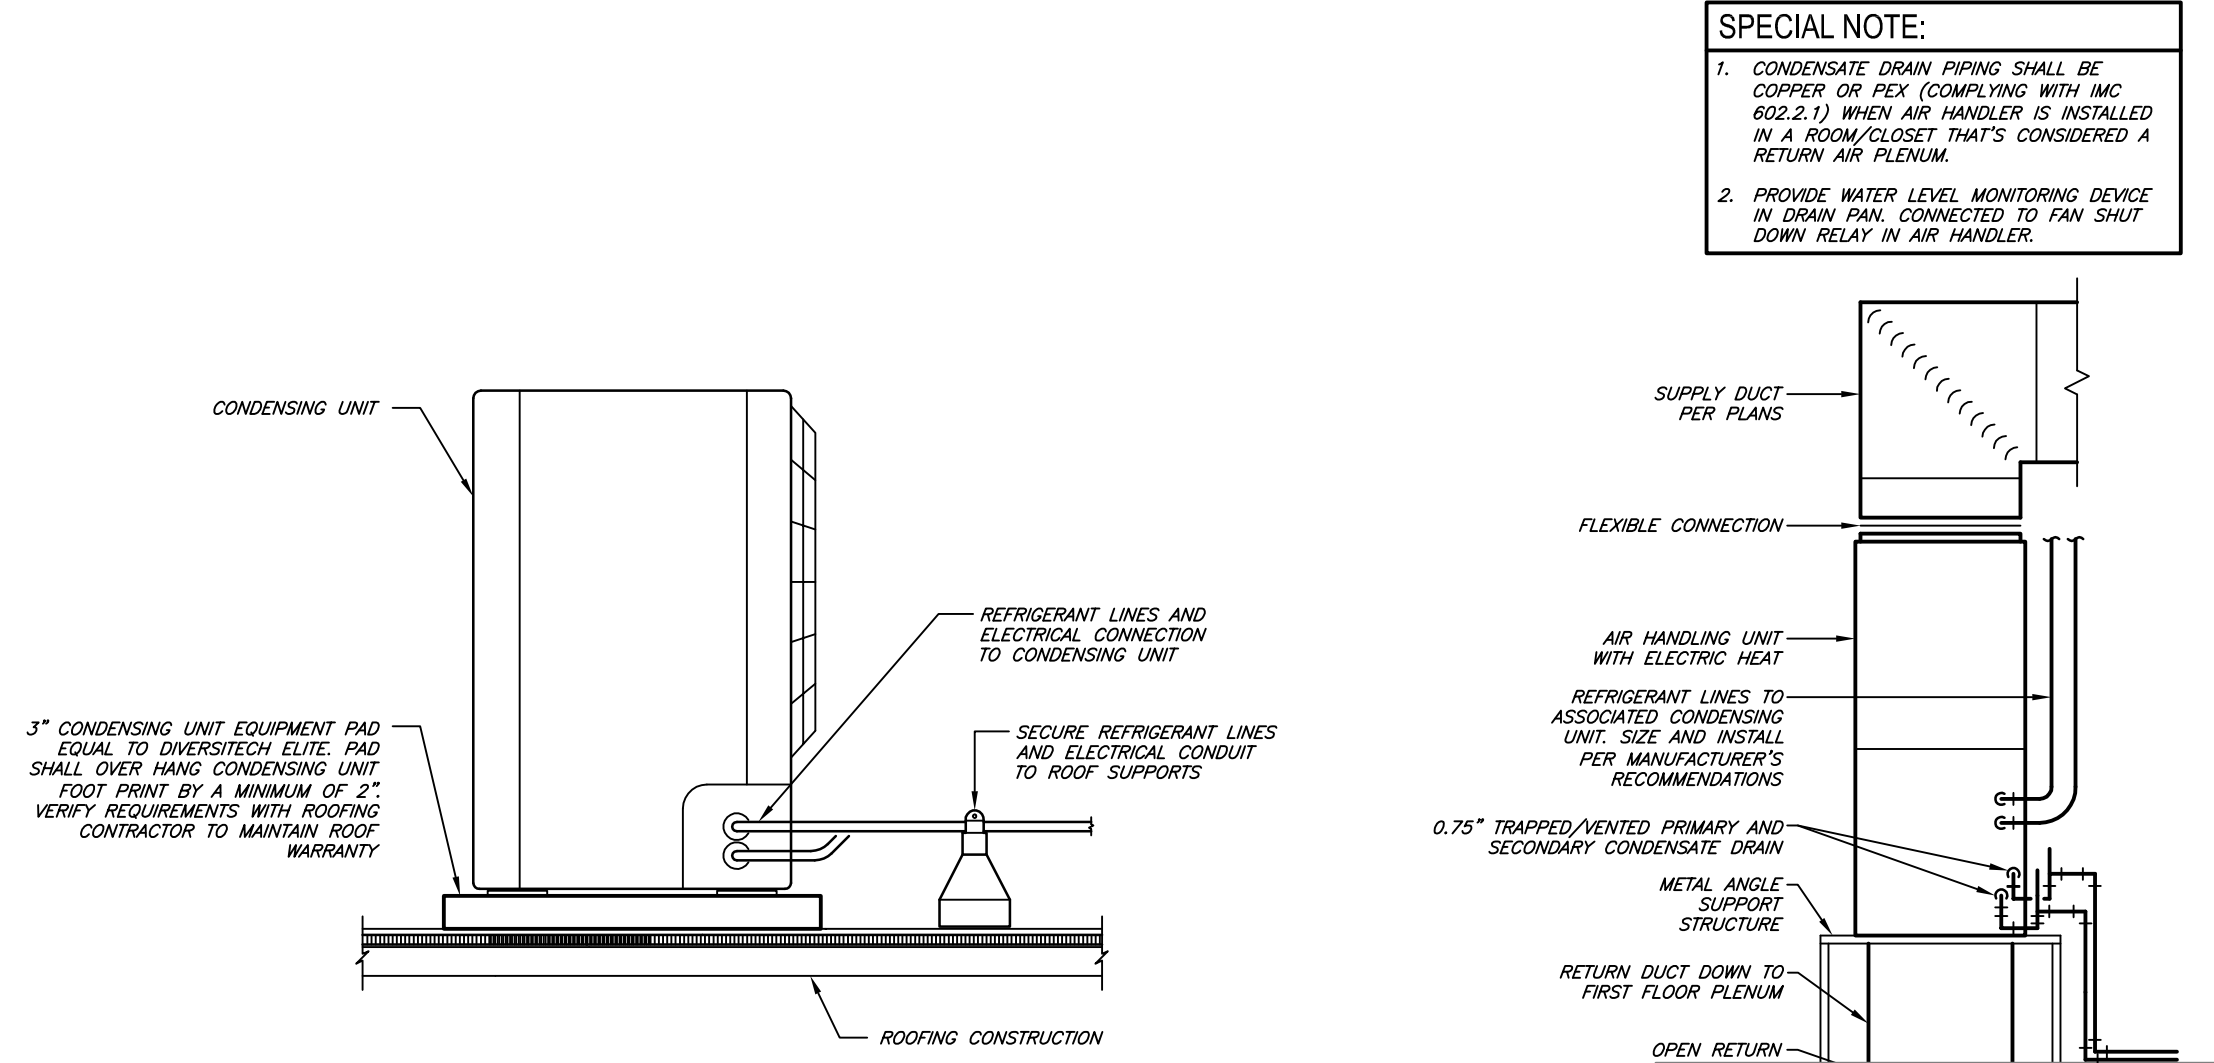

3 ROOF MOUNTED CONDENSING UNIT DETAIL  
NO SCALE

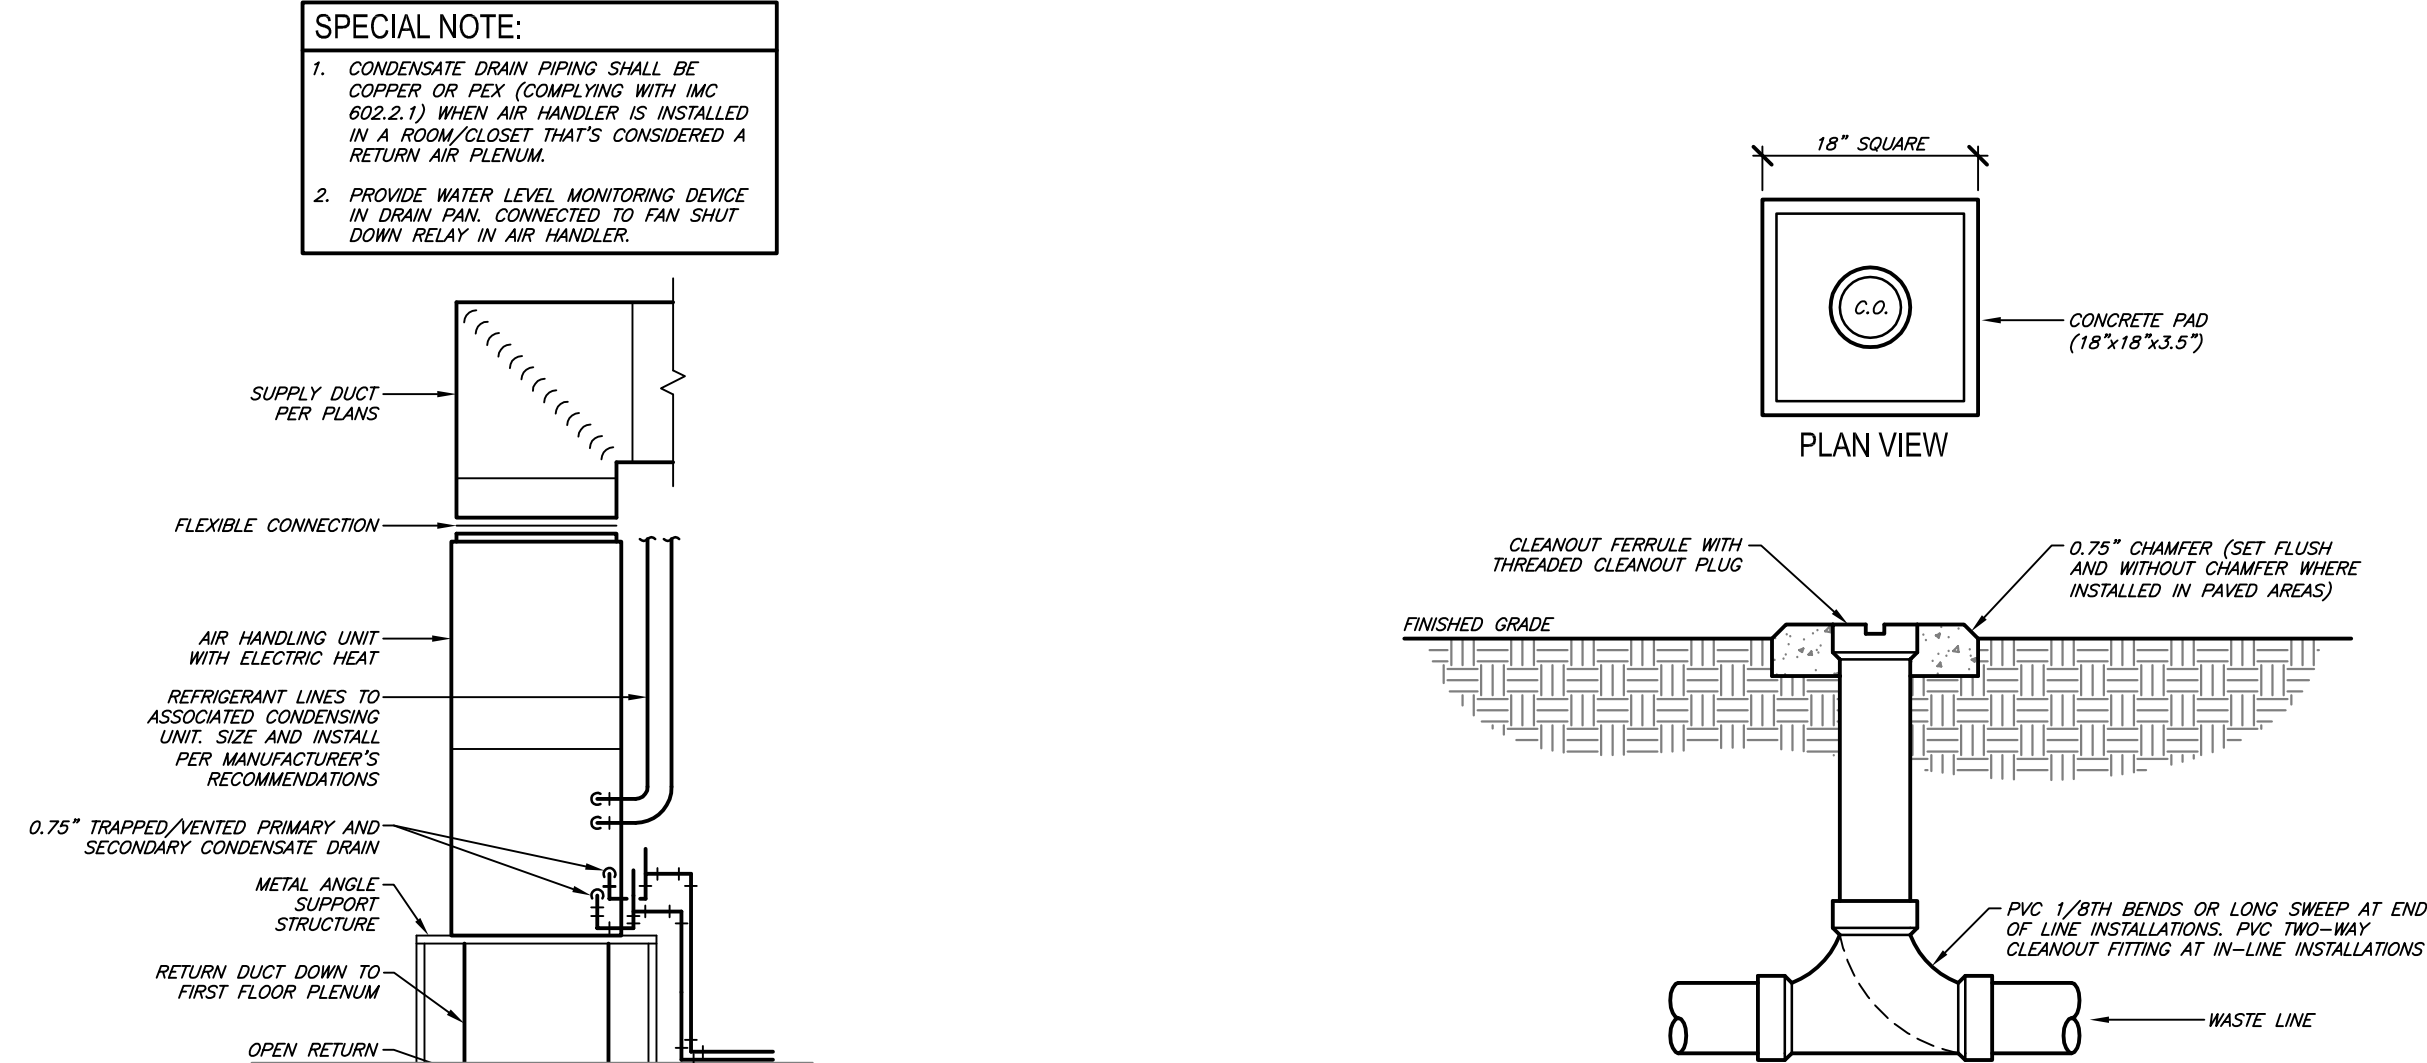

2 AIR HANDLER DETAIL  
NO SCALE

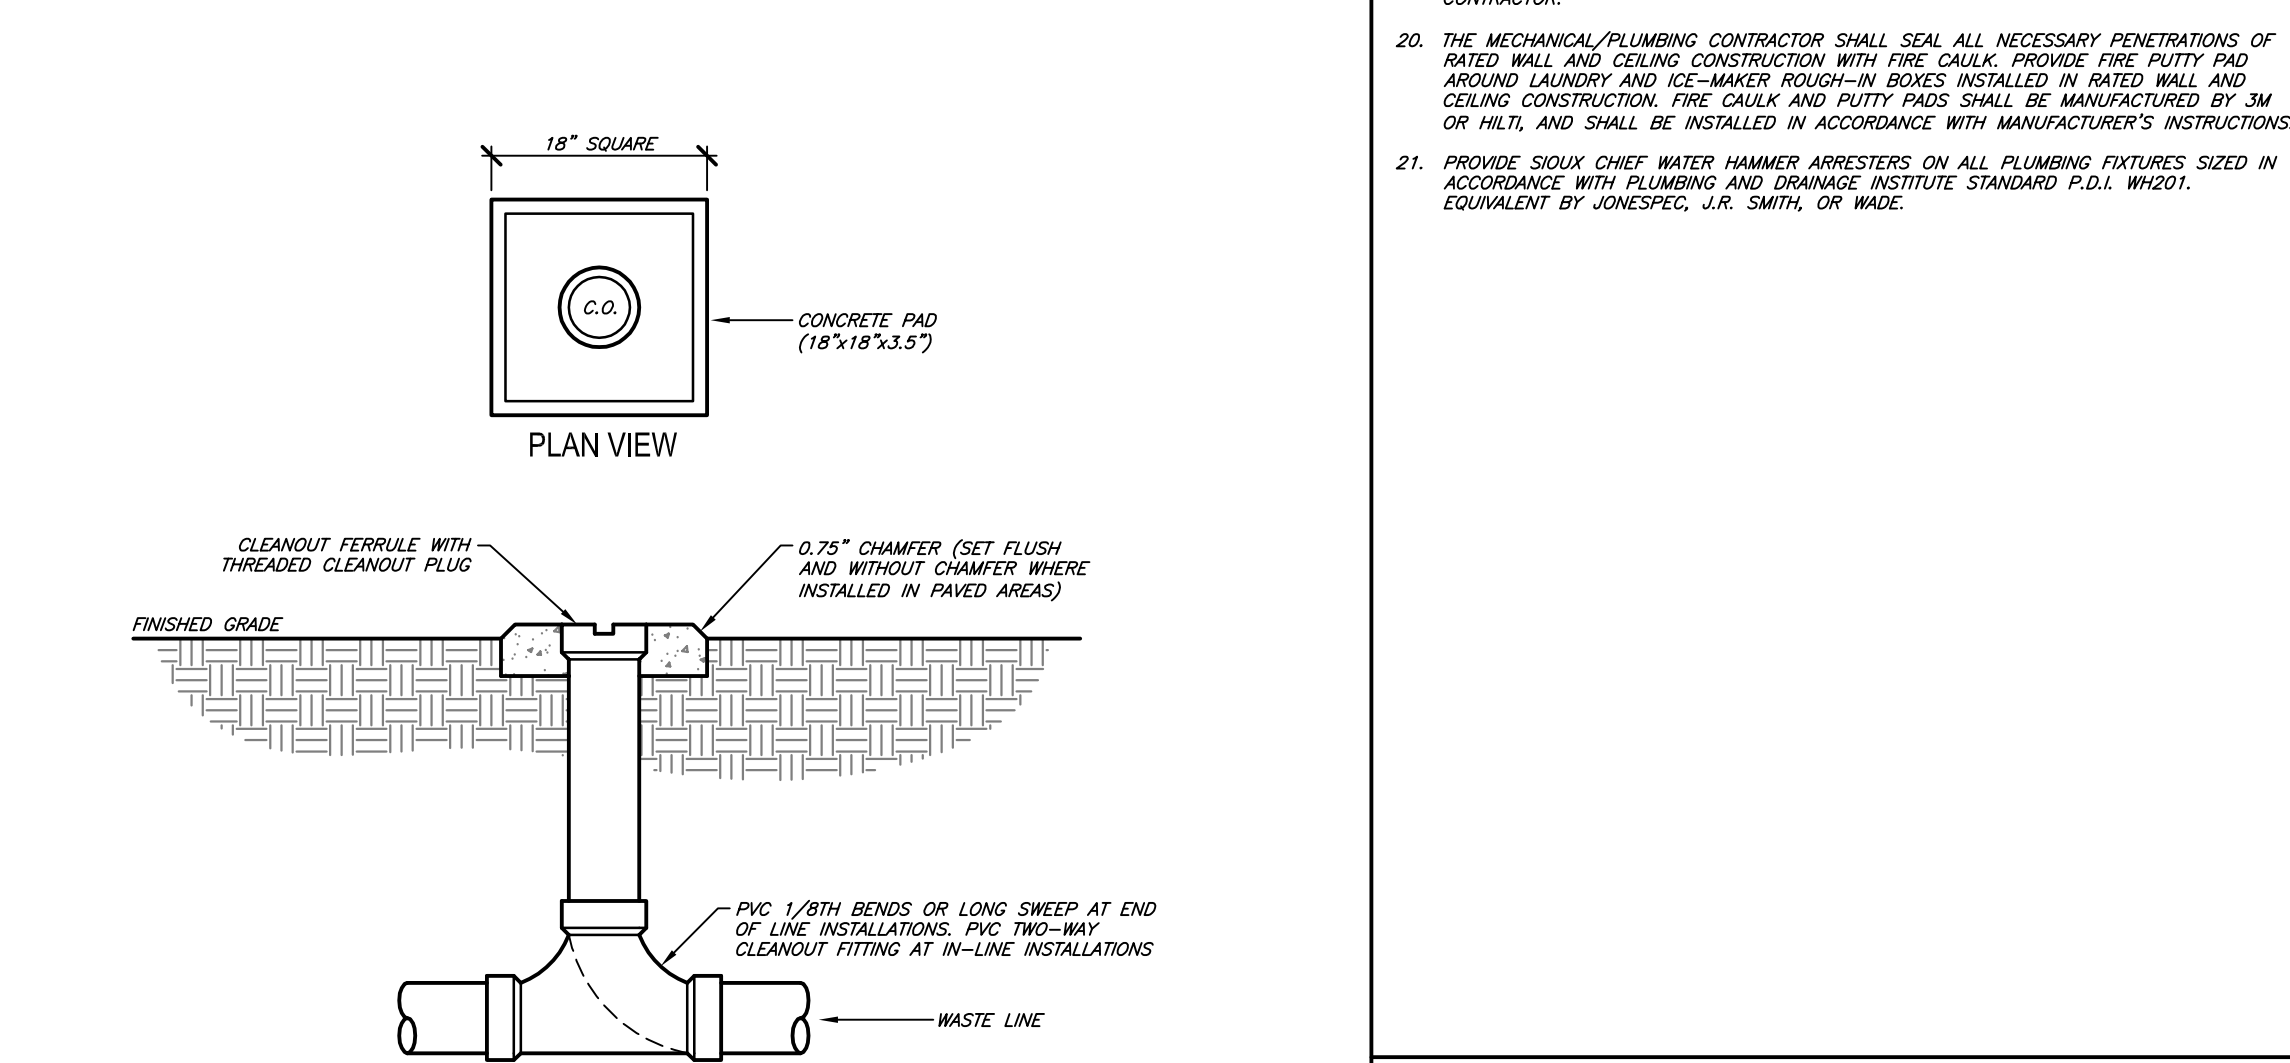

1 FINISH GRADE CLEANOUT DETAIL  
NO SCALE

GRAVITY VENTILATOR SCHEDULE										
MARK	MANUFACTURER	MODEL #	SERVICE	CFM	DELTA P (STATIC)	THROAT AREA MIN (SQ.FT.)	FACE AREA MIN (SQ.FT.)	FACE VELOCITY (FPM)	NOTES AND ACCESSORIES	
GV1	COOK	PR8	EXHAUST	75	0.1"	0.394	1.38	54.3	1,2,3,4	
NOTES AND ACCESSORIES: 1. FACTORY FABRICATED INSULATED ROOF CURB WITH CUSTOM HEIGHT OF 14" MINIMUM ABOVE FINISH ROOF SURFACE. 2. PROVIDE COUNTER BALANCE BACKRAFT DAMPER. 3. PROVIDE ANTI-CONDENSATE COATING. 4. PROVIDE BIRD SCREEN.										

AIR HANDLER/COIL/CONDENSING UNIT SCHEDULE										
AIR HANDLER										
MARK	MANUFACTURER	MODEL #	SA (CFM)	OA (CFM)	EXTERNAL STATIC	ELEC HEAT (KW/STAGES)	VOLTAGE/ PHASE	MCA	MOCP	NOTES
AH1	OMNIGUARD	BCSE60	1810	-	0.5"	14.4/1	240V1	96	100	1,2,3,4,5
AH2	OMNIGUARD	BCSE60	1810	-	0.5"	14.4/1	240V1	96	100	1,2,3,4,5
AIR HANDLER NOTES: 1. EXTERNAL STATIC PRESSURE INCLUDES WET COIL, EXCLUDES FILTER LOSS. 2. PROVIDE FRONT ACCESSIBLE FILTER RACK AND 2" FILTER EQUAL TO FARR 3030 WITH MERV 7 MINIMUM RATING. 3. PROVIDE SINGLE POINT POWER CONNECTION WITH CIRCUIT BREAKER DISCONNECTING MEANS. 4. PROVIDE ENERGY STAR RATED 7-DAY PROGRAMMABLE THERMOSTAT 5. PROVIDE WATER LEVEL MONITORING DEVICE IN DRAIN CONNECTED TO FAN SHUT DOWN RELAY IN AIR HANDLER.										
COIL / CONDENSING UNIT										
MARK	MANUF	EVAP COIL MODEL #	COND. UNIT MODEL #	ENTERING AIR DBWB	SENSIBLE MBH	TOTAL MBH	VOLTAGE/ PHASE	MCA	MOCP	NOTES
CU1	OMNIGUARD	WI-AHU	4AC16L60P-50	80 / 67	45.4	60.5	240V1	29.6	50	1,2,3
CU2	OMNIGUARD	WI-AHU	4AC16L60P-50	80 / 67	45.4	60.5	240V1	29.6	50	1,2,3
COIL / CONDENSING UNIT NOTES: 1. PROVIDE REFRIGERANT LINE SET(S) SIZED PER MANUFACTURER'S RECOMMENDATIONS. 2. PROVIDE ALL REFRIGERATION SYSTEM ACCESSORIES REQUIRED BY MANUFACTURER FOR GIVEN LINE SET ROUTING. 3. PROVIDE LOW AMBIENT CRANK CASE HEATER (10 DEG. F)										

AIR CURTAIN SCHEDULE												
MARK	MANUFACTURER	MODEL #	MOUNTING	HEATING (KW)	AMCA LAB AIRFLOW (SCFM)	NOZZLE WIDTH	MAX. VELOCITY @ NOZZLE (FPM)	VOLTAGE/ PHASE	MCA	MOCP	NOTES	
AC1	STRONGWAY	49947	WALL	-	816	36"	3,937	120V1	2.9	15	1 THRU 8	
AC2	STRONGWAY	49947	WALL	-	816	36"	3,937	120V1	2.9	15	1 THRU 8	
NOTES: 1. PROVIDE FACTORY INSTALLED DISCONNECT. 2. FACTORY INSTALLED UNIT MOUNTED CONTROLS WITH TWO SPEED CONTROL. 3. WARMING DOOR UNIT SWITCH. 4. FACTORY MOUNTED MOTOR CONTROL PANEL. 5. CLEANABLE FILTER. 6. FIELD COORDINATE EXACT MOUNTING REQUIREMENTS AND PROVIDE ALL REQUIRED ACCESSORIES 7. UNIT SHALL BE RATED FOR OUTDOOR CONDITIONS 8. COORDINATE FIRST WITH OWNER.												

FAN SCHEDULE										
MARK	MANUFACTURER	MODEL #	CFM	ESP (IN. W.C.)	MOUNTING	FINISH	DAMPER	VOLTAGE/ PHASE	MOTOR HP/WATTS	NOTES
EFF	COOK	GC-146	75	0.25"	CEILING	STD	-	120V1	31W	1,2,3
NOTES: 1. FACTORY MOUNTED DISCONNECTING MEANS. 2. GRAVITY BACKRAFT DAMPER. 3. PROVIDE BIRD SCREEN.										

ELECTRIC HEATER SCHEDULE										
MARK	MANUFACTURER	MODEL #	MOUNTING	FINISH	CFM	HEATING (WATTS)	VOLTAGE/ PHASE	MCA	MOCP	NOTES
EH1	INFRA TECH	CL3024SS	SUSPENDED	ARCH	-	3000	240V1	12.5	20	1
EH2	INFRA TECH	CL3024SS	SUSPENDED	ARCH	-	3000	240V1	12.5	20	1
EH3	INFRA TECH	CL3024SS	SUSPENDED	ARCH	-	3000	240V1	12.5	20	1
NOTES: 1. PROVIDE FACTORY MOUNTED DISCONNECTING MEANS.										

AIR DEVICE SCHEDULE												
MARK	MANUFACTURER	MODEL #	DUCT CONNECTION SIZE	SERVICE	MODULE SIZE	FRAME	FINISH	DAMPER	MAX. NC	THROW (FT)	DELTA P (STATIC)	NOTES
S1	OWNER PROVIDED		12x24, 0-2000 CFM	SUPPLY	-	SURFACE	WHITE	-	30	20	0.1"	-
S2	OWNER PROVIDED		6", 0-75 CFM	SUPPLY	-	SURFACE	WHITE	-	30	20	0.1"	-
R1	OWNER PROVIDED		22x22, 0-2000 CFM	RETURN	-	SURFACE	WHITE	-	30	-	0.1"	-
NOTES: 1. PROVIDE FACTORY MOUNTED DISCONNECTING MEANS.												

SPECIAL NOTE:

- CONDENSATE DRAIN PIPING SHALL BE COPPER OR PEX (COMPLYING WITH IMC 602.2.1) WHEN AIR HANDLER IS INSTALLED IN A ROOM/CLOSET THAT'S CONSIDERED A RETURN AIR PLENUM.
- PROVIDE WATER LEVEL MONITORING DEVICE IN DRAIN PAN CONNECTED TO FAN SHUT DOWN RELAY IN AIR HANDLER.

## GENERAL MECHANICAL NOTES:

GENERAL


- GENERAL MECHANICAL NOTES APPLY TO ALL MECHANICAL SHEETS.
- CJD ENGINEERING LLC, BEING THE AUTHOR OF THESE CONSTRUCTION DOCUMENTS, RESERVES THE RIGHT OF FINAL INTERPRETATION AS TO THEIR INTENT AND MEANING. ANY ADDITIONAL WORK OR COSTS RESULTING FROM THE CONTRACTOR'S OWN INTERPRETATION AS TO THE INTENT OR MEANING WITHOUT CONSULTATION WITH CJD ENGINEERING LLC SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR AT NO COST TO OWNER OR A/E.
- THE INTENT OF THE WORK INDICATED ON THESE CONSTRUCTION DOCUMENTS IS TO PROVIDE A FULLY FUNCTIONING SYSTEM IN COMPLETE WORKING ORDER. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR AND THE CONTRACTOR'S SUPPLIERS TO INCLUDE ALL ACCESSORIES, COMPONENTS, PARTS, ETC. THAT MAY NOT BE INDICATED ON THESE CONSTRUCTION DOCUMENTS TO PROVIDE BUILDING CODE COMPLIANT SYSTEMS AND EQUIPMENT THAT OPERATE SATISFACTORILY AS DESIGNED AND INTENDED.
- DRAWINGS ARE NOT SET UP SPECIFICALLY ACCORDING TO TRADE AND EACH CONTRACTOR AND SUB-CONTRACTOR OR TRADE IS REQUIRED TO REVIEW THE CONSTRUCTION DOCUMENTS AS A WHOLE AND PROVIDE ANY MSG. ITEMS, MATERIALS, WORK, ETC. REQUIRED TO COMPLETE THE WORK AS SHOWN ON ALL DOCUMENTS. THIS REQUIREMENT APPLIES TO ALL TRADES: STRUCTURAL, MECHANICAL, ELECTRICAL, AND PLUMBING REQUIREMENTS AND RELATED WORK ARE THROUGHOUT THE DOCUMENTS AND SHOULD BE REVIEWED WITH EACH FOR OVERALL SCOPE OF WORK.
- ALL MECHANICAL WORK SHALL BE PERFORMED BY LICENSED PLUMBING AND MECHANICAL CONTRACTORS AND SHALL BE IN ACCORDANCE WITH REQUIREMENTS OF THE 2018 INTERNATIONAL BUILDING, PLUMBING, FUEL GAS AND MECHANICAL CODES, AND ALL APPLICABLE LOCAL CODES AS ADOPTED BY LOCAL AUTHORITIES.
- THE CONTRACTOR SHALL INCLUDE ALL PERMIT AND INSPECTION FEES IN BID.
- THE PLANS ARE DIAGRAMMATIC AND SHALL NOT BE SCALED. REFER TO CIVIL, STRUCTURAL, AND ARCHITECTURAL DRAWINGS AND EXISTING CONDITIONS FOR DIMENSIONS. FIELD VERIFY ALL DIMENSIONS.
- PIPING AND DUCTWORK LAYOUTS ARE DIAGRAMMATIC. FIELD COORDINATE EXACT LOCATIONS AND ROUTINGS WITH STRUCTURE, LIGHT FIXTURES, CONDUITS, ETC. FINAL RESULT SHALL BE EQUIVALENT TO THAT INDICATED ON DRAWINGS.
- COOPERATE CLOSELY WITH ALL OTHER TRADES TO EXPEDITE CONSTRUCTION AND AVOID INTERFERENCES AND CONFLICTS BEFORE ANY PIPING, DUCTWORK, CONDUIT, ETC. IS INSTALLED. IT SHALL BE COORDINATED CAREFULLY BETWEEN ALL TRADES.
- MAINTAIN ALL CLEARANCES REQUIRED BY PLUMBING AND HVAC EQUIPMENT. COORDINATE WITH ELECTRICAL CONTRACTOR TO MAINTAIN ALL CLEARANCES REQUIRED FOR EQUIPMENT. DO NOT ROUTE PIPING, DUCTWORK, ETC. ABOVE ELECTRICAL PANELS.
- DRAWINGS REPRESENT FINAL RESULT. REMOVE, RELOCATE, MODIFY EXISTING EQUIPMENT, DUCTWORK, PIPING, ETC. AS REQUIRED. FIELD VERIFY EXISTING CONDITIONS AND EXACT REQUIREMENTS. NO EXTRAS WILL BE PAID DUE TO UNANTICIPATED EXISTING CONDITIONS.
- IF CONTRACTOR WISHES TO INCORPORATE PRODUCTS OTHER THAN THOSE NAMED IN SPECIFICATIONS IN HIS BID OR PRODUCTS BY MANUFACTURERS OTHER THAN THOSE LISTED AS APPROVED MANUFACTURERS, THE CONTRACTOR SHALL SUBMIT A WRITTEN REQUEST FOR REVIEW AND APPROVAL OF PROPOSED SUBSTITUTIONS TO CJD ENGINEERING LLC NOT LESS THAN FIVE WORKING DAYS PRIOR TO BID DATE. APPROVAL OR ACCEPTANCE OF PROPOSED SUBSTITUTION OF MANUFACTURERS OR ITEMS IS FOR THE PURPOSES OF BIDDING ONLY AND DOES NOT RELIEVE THE PROPOSED SUBSTITUTION FROM THE SUBMITTAL/SHOP DRAWING REVIEW AND DOES NOT CONSTITUTE PRIOR APPROVAL OF PROPOSED SUBSTITUTIONS.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE COSTS OF LARGER WIRING, CONDUIT, ENCLOSURES, CONTROL, AND OVERCURRENT PROTECTIVE DEVICES, ETC. RESULTING FROM SUBSTITUTION OF EQUIPMENT OTHER THAN THAT WHICH WAS THE BASIS OF DESIGN AT NO COST TO OWNER OR A/E.
- THE CONTRACTOR SHALL PROVIDE ELECTRIC SHOP DRAWINGS/SUBMITTALS OF ALL FIXTURES AND EQUIPMENT FURNISHED UNDER THIS CONTRACT.
- THE CONTRACTOR SHALL PERFORM A PRELIMINARY FUNCTIONAL TEST AND BALANCE FOR ALL EQUIPMENT INSTALLED UNDER THIS CONTRACT. THE CONTRACTOR SHALL THEN OBTAIN THE SERVICES OF AN INDEPENDENT FIRM CERTIFIED WITH ASSOCIATED AIR BALANCING COUNCIL OR NATIONAL ENVIRONMENTAL BALANCING BUREAU TO PERFORM THE HVAC SYSTEM TESTING AND BALANCING IN ACCORDANCE WITH ASHRAE OR NEBB NATIONAL STANDARDS.
- THE CONTRACTOR SHALL GUARANTEE ALL EQUIPMENT, ACCESSORIES, AND MATERIAL FURNISHED BY HIM FOR A PERIOD OF ONE YEAR FROM FINAL ACCEPTANCE AGAINST ALL DEFECTS.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR ENSURING COSTS TO CUT, PATCH AND REPAIR EXISTING WALL, FLOOR AND CEILING CONSTRUCTION AS REQUIRED TO INSTALL NEW PLUMBING FIXTURES, DUCTWORK, EQUIPMENT, PIPING, ETC. ARE INCLUDED IN THE BID PRICE.

## GENERAL MECHANICAL NOTES:

PRODUCTS

- ALL SHUTOFF VALVES ON DOMESTIC WATER SHALL BE BRONZE FULL-PORT BALL VALVE TYPE.
- P-TRAPS SHALL INCLUDE INTEGRAL CLEANOUT.
- DUCT CONSTRUCTION:  
ALL DUCTWORK SHALL BE FABRICATED OF G90 GALVANIZED STEEL AND INSTALLED IN ACCORDANCE WITH THE SMACNA HVAC DUCT CONSTRUCTION STANDARDS - METAL AND FLEXIBLE MANUAL. ALL SUPPLY AND RETURN AIR DUCT PRESSURE CLASSES SHALL BE THE SAME AS THE EXTERNAL STATIC PRESSURE OF THE EQUIPMENT SUPPLYING THE DUCT. THE EQUIPMENT ESP SHALL BE THE PRESSURE CLASS FOR THE ENTIRE SUPPLY DUCT SYSTEM.  
CONCEALED ROUND SUPPLY AIR DUCT - 3" PRESSURE CLASS OR LESS. GALVANIZED SNAP-LOCK PIPE WITH TRANSVERSE JOINTS AND CONNECTIONS SEALED. WRAP SUPPLY AND OUTSIDE AIR DUCTS WITH SPECIFIED INSULATION.  
CONCEALED ROUND RETURN AND EXHAUST DUCT - 3" PRESSURE CLASS OR LESS. GALVANIZED SNAP-LOCK PIPE WITH TRANSVERSE JOINTS AND CONNECTIONS SEALED WITH SPECIFIED INSULATION.  
RECTANGULAR SUPPLY AND RETURN AIR DUCT - 3" PRESSURE CLASS OR LESS. GALVANIZED SHEET METAL LINE SUPPLY, RETURN, OUTDOOR AIR AND MAKE-UP AIR DUCTWORK WITH SPECIFIED INSULATION.  
FLEXIBLE DUCTWORK: FLEXMASTER USA TYPE BB, UL 181 CLASS 1 RATED PEX-INSULATED ACoustical FLEX DUCT WITH ME




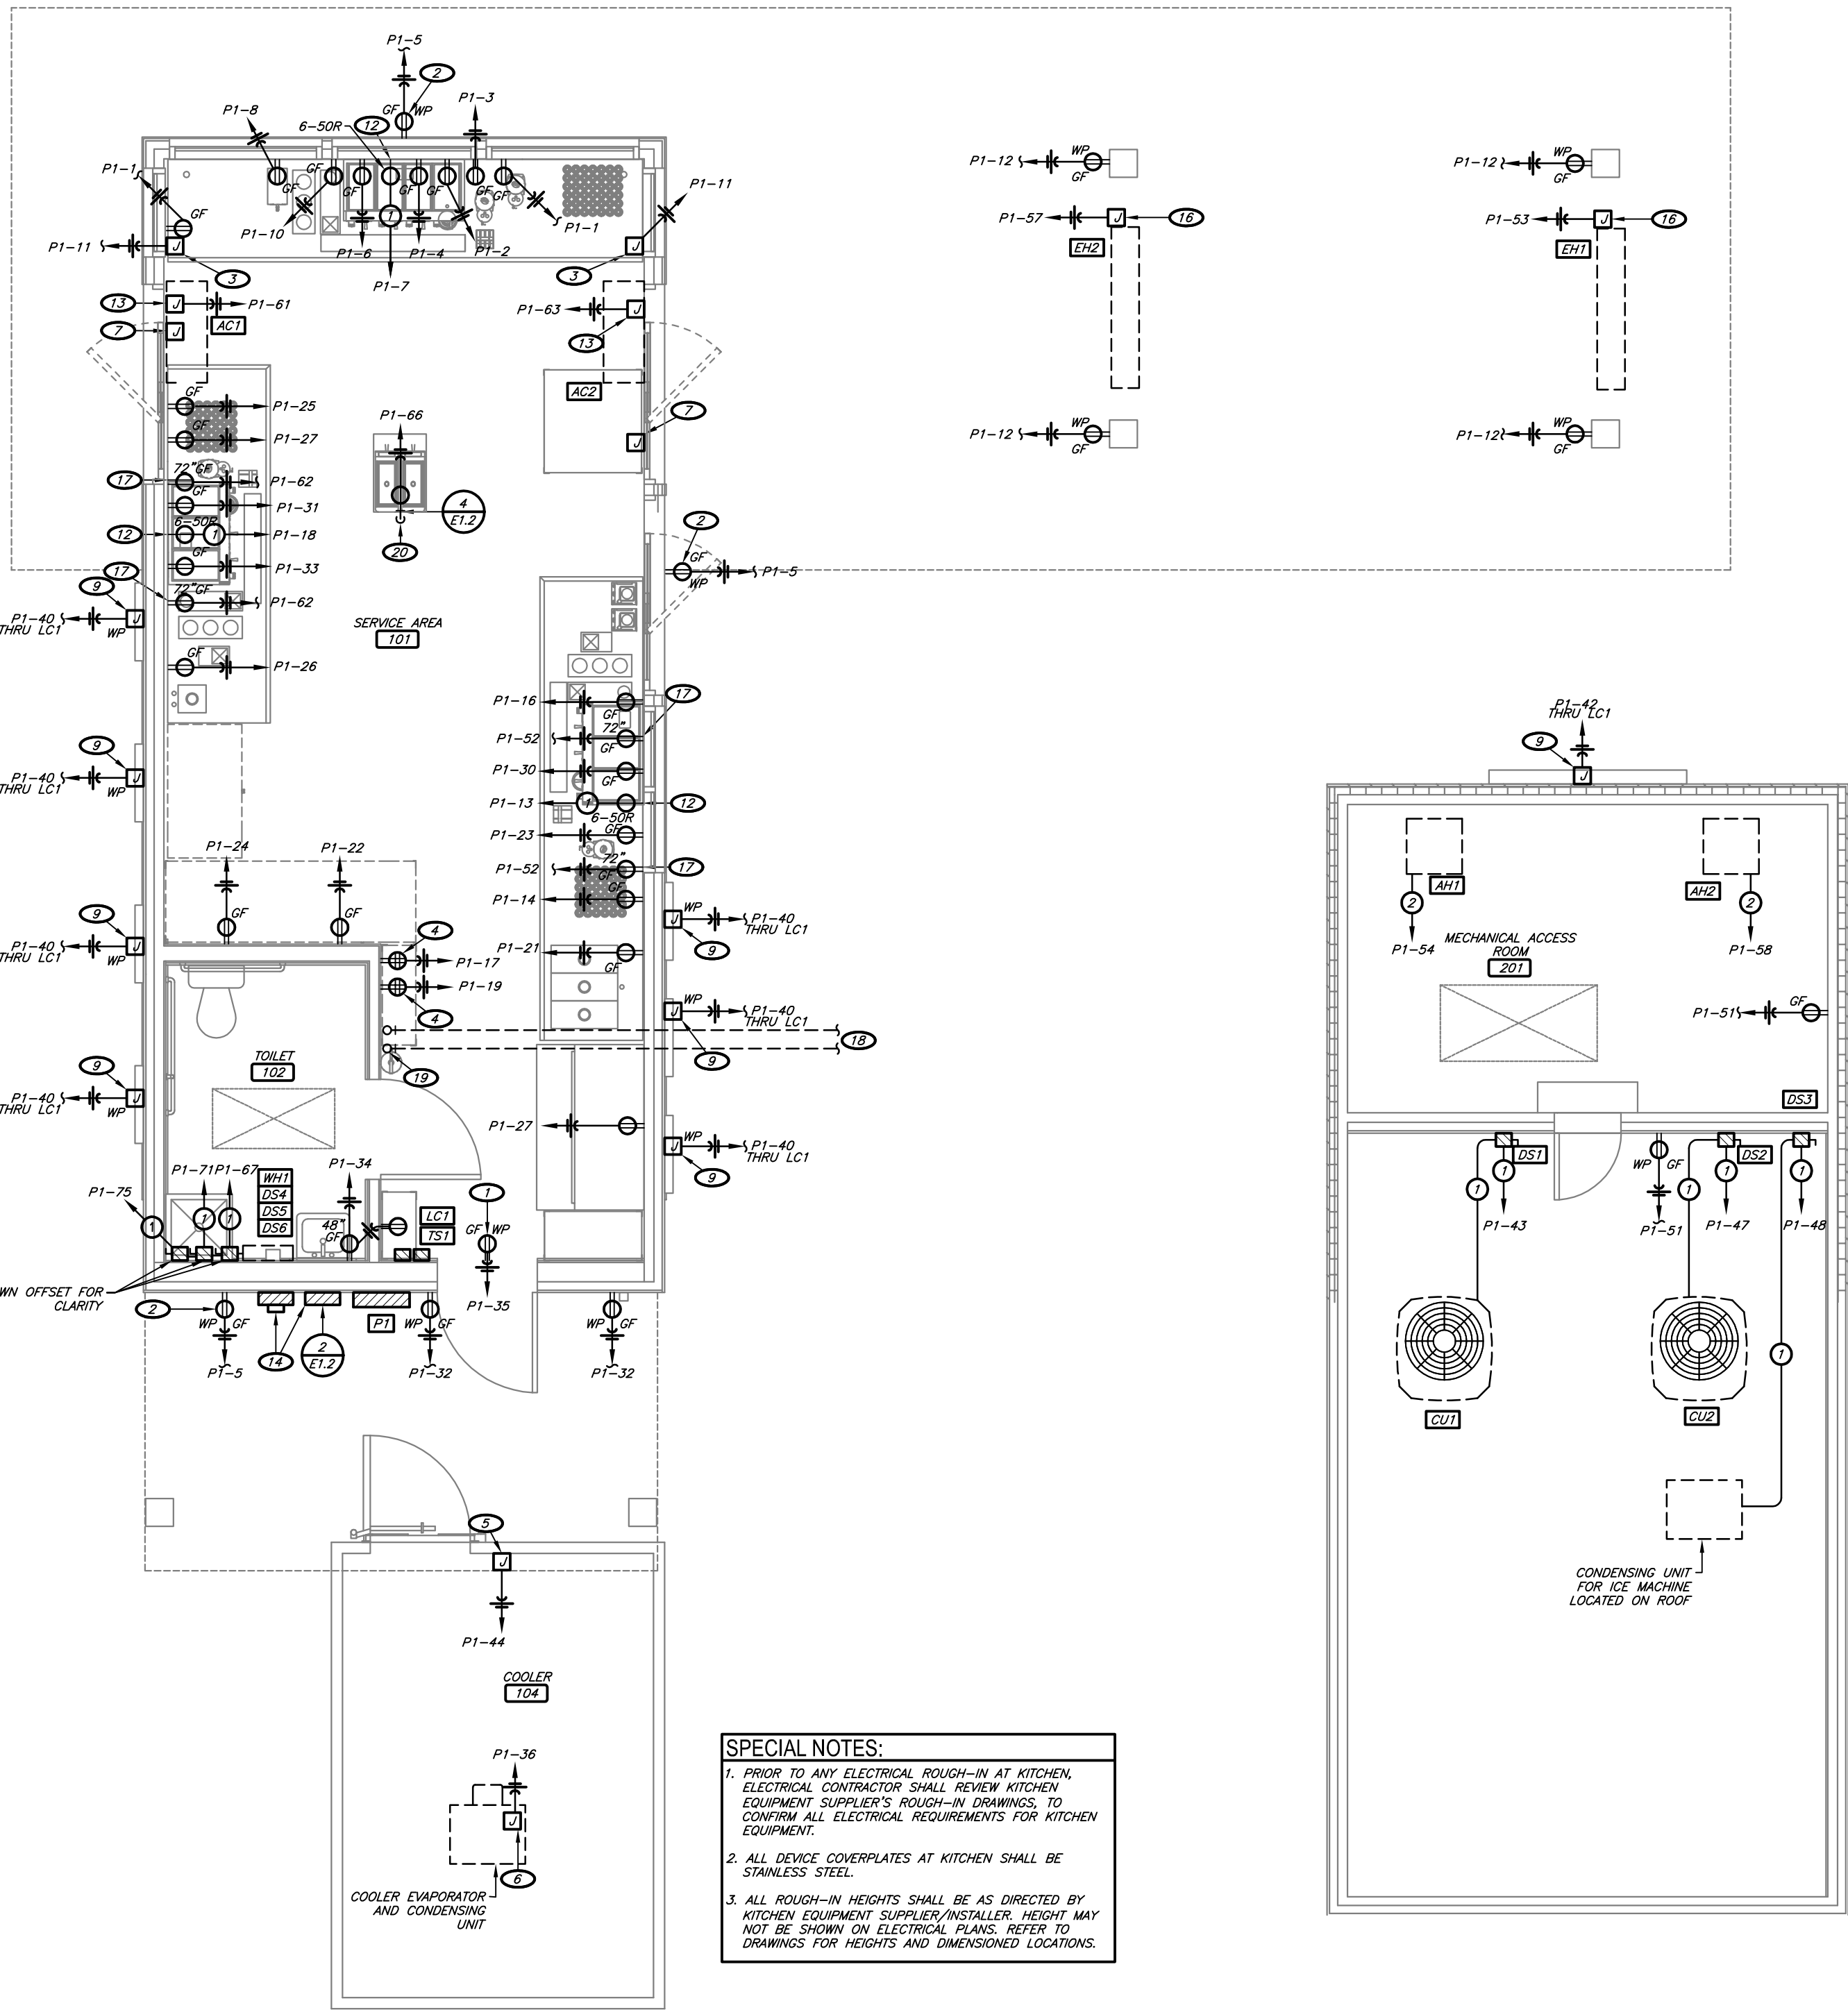


3 GROUND LEVEL POWER PLAN  
1/4" = 1'-0"



2 ROOF AND ATTIC POWER PLAN  
1/4" = 1'-0"

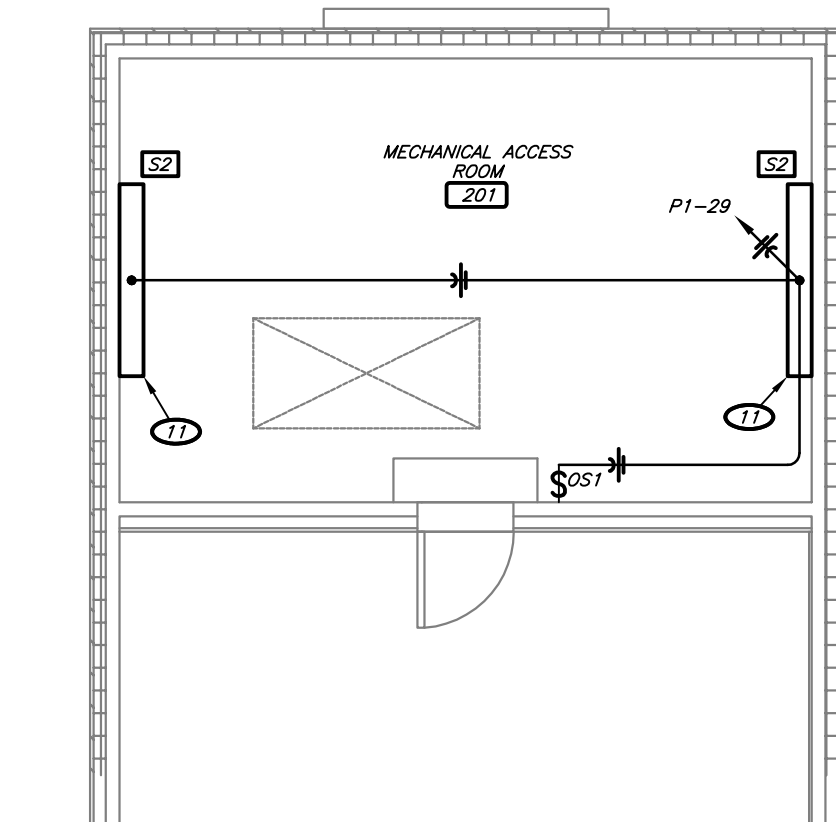

4 PARTIAL ROOF AND ATTIC LIGHTING PLAN  
1/4" = 1'-0"

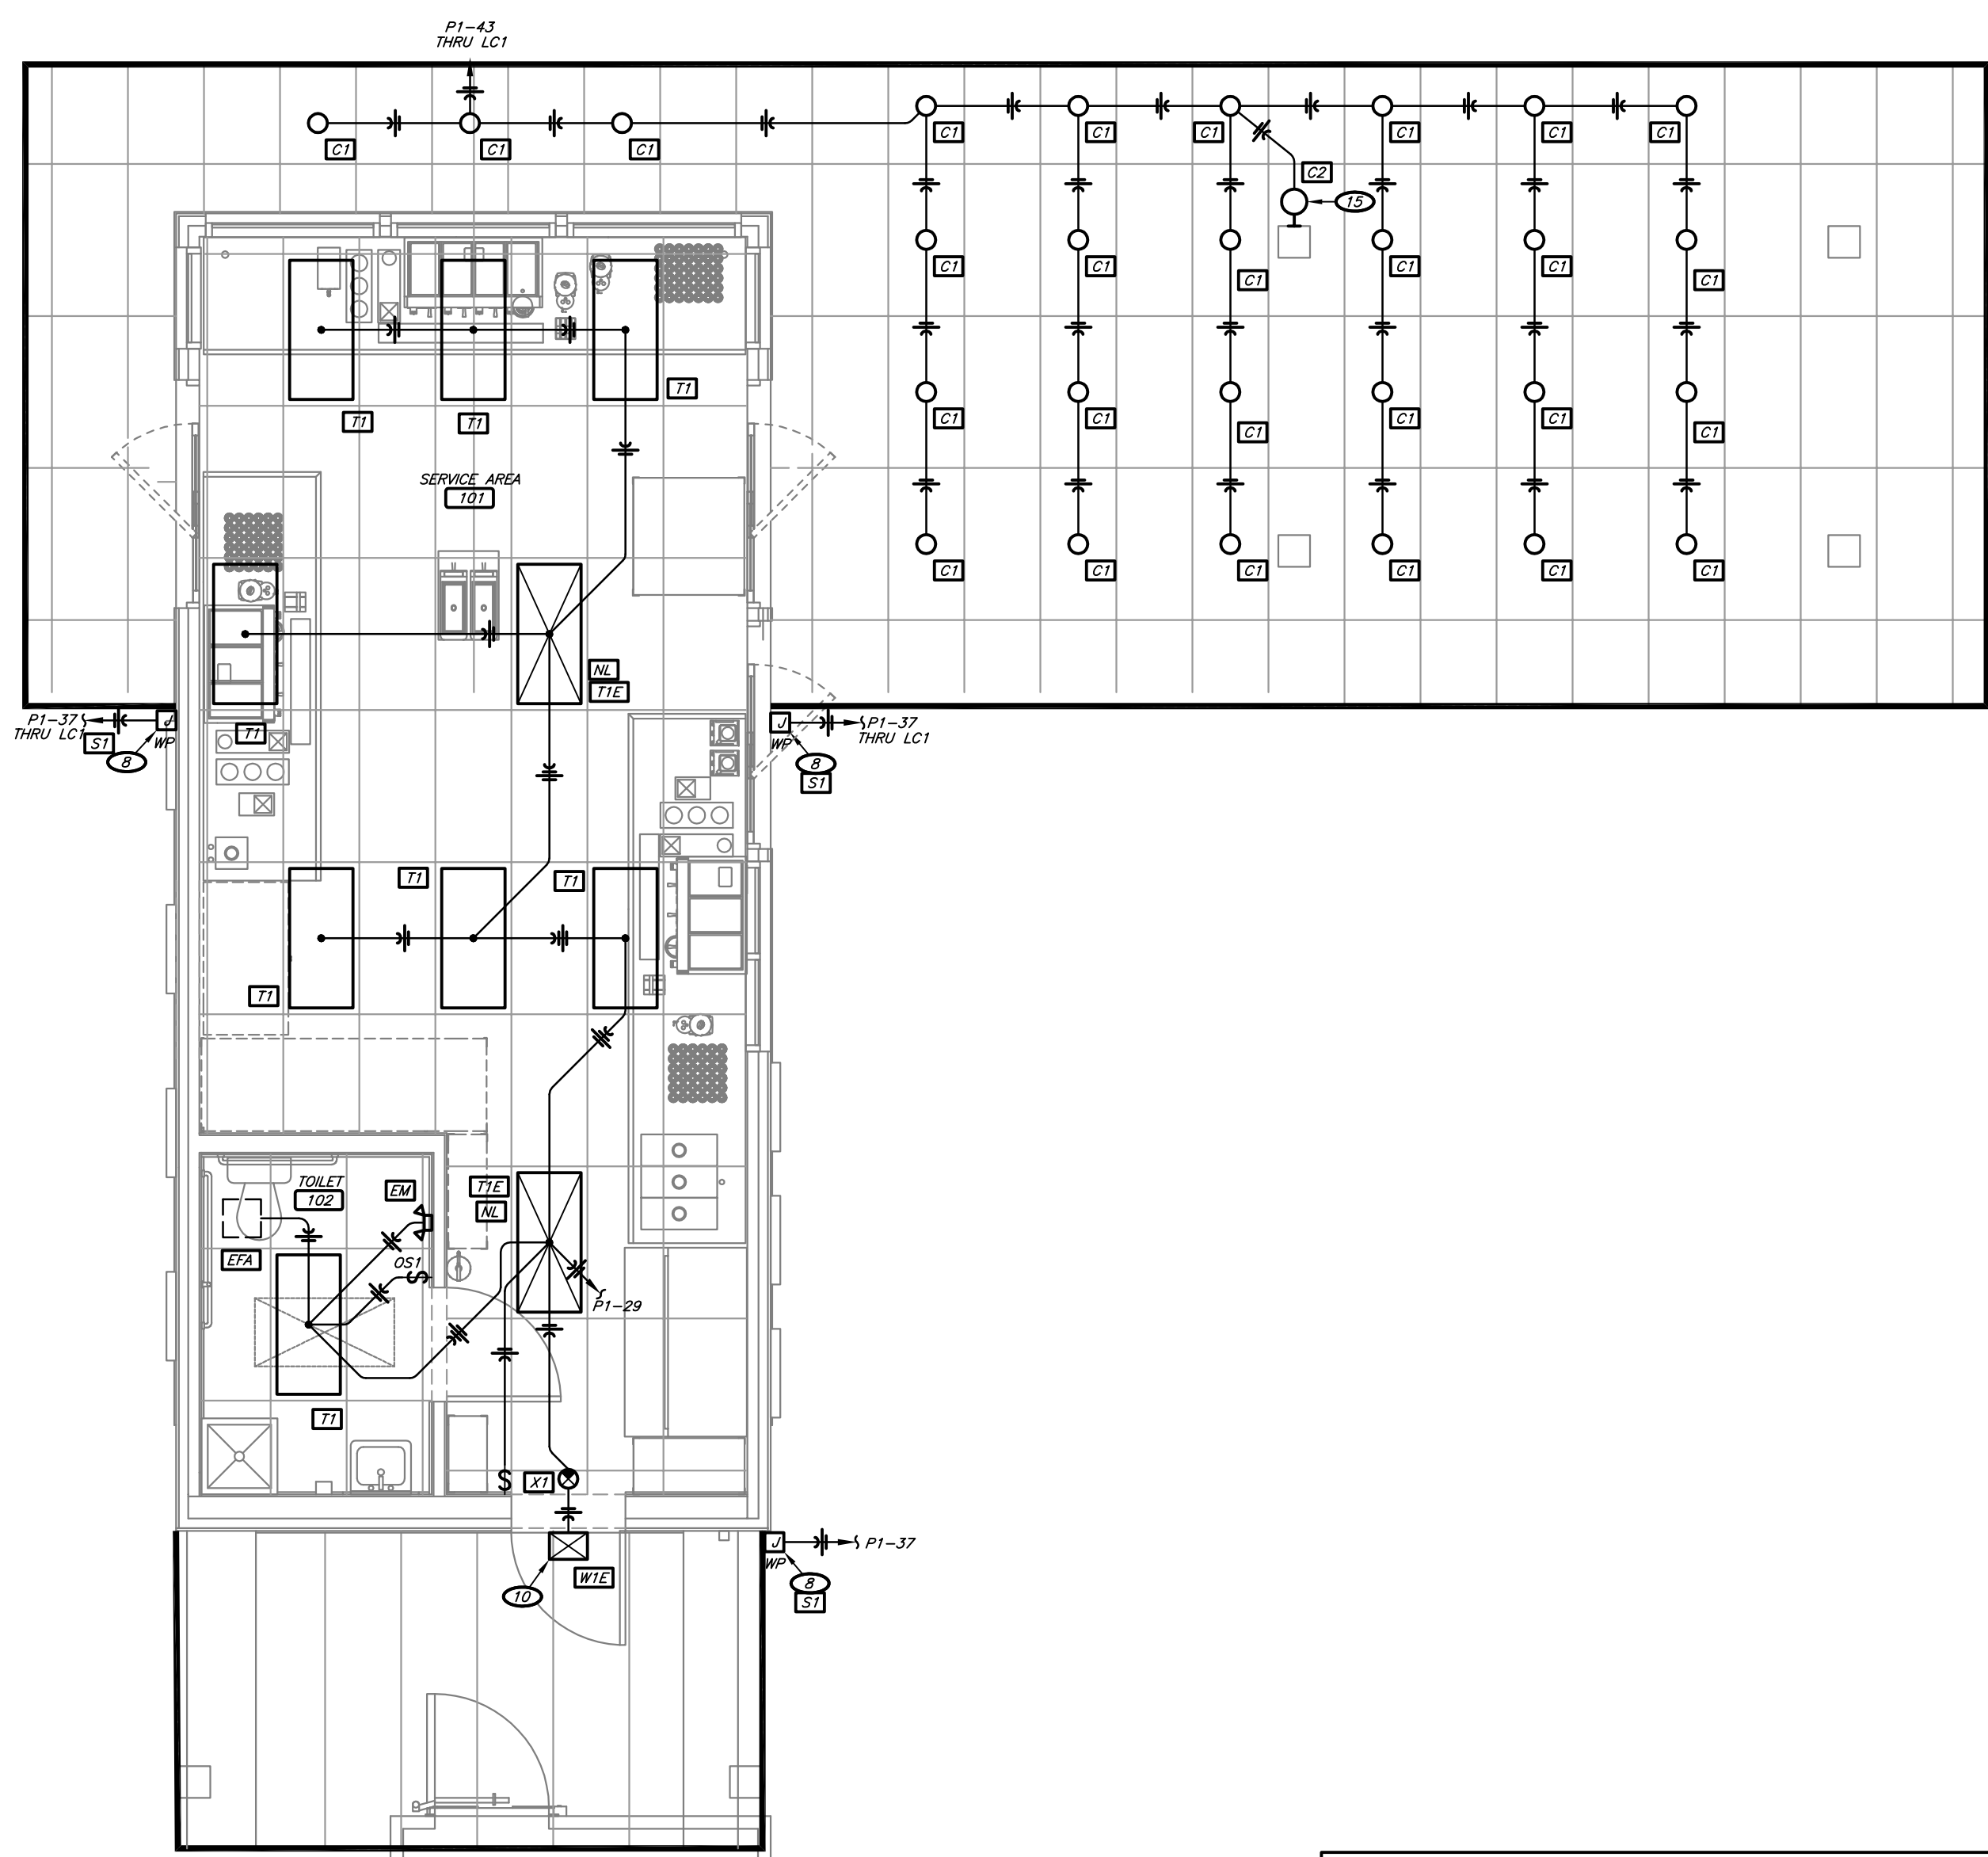

1 GROUND LEVEL LIGHTING PLAN  
1/4" = 1'-0"



## ELECTRICAL SYMBOLS:

- SIMPLEX RECEPTACLE; 2P, 3W, 20A, 125V
- 14-30 SIMPLEX RECEPTACLE; NEMA CONFIGURATION AS INDICATED
- 42" DUPLEX RECEPTACLE; 2P, 3W, 20A, 125V
- 42" DUPLEX RECEPTACLE; MOUNTED 6" ABOVE FINISHED FLOOR
- AC DUPLEX RECEPTACLE; MOUNTED 6" ABOVE COUNTERTOP BACKSPASH
- GF DUPLEX RECEPTACLE W/ GROUND FAULT INTERRUPTER
- WP DUPLEX RECEPTACLE; WEATHERPROOF
- DOUBLE DUPLEX RECEPTACLE WITH COMMON FACEPLATE
- TELECOMMUNICATIONS OUTLET; ROUGH-IN JUNCTION BOX OR PLASTER RING ONLY. MAY BE USED FOR VOICE, DATA, FAX, MODEM, OR ANY COMBINATION THEREOF. CABLE, COVER PLATE & JACKS PROVIDED BY OTHERS.
- CABLE TV OUTLET; ROUGH-IN JUNCTION BOX OR PLASTER RING ONLY. CABLE, COVER PLATE & JACKS PROVIDED BY OTHERS.
- EXIT LIGHT; WALL MOUNTED / CEILING MOUNTED
- EMERGENCY LIGHT
- EXIT/EMERGENCY LIGHT
- LED LIGHT FIXTURE
- NIGHT LIGHT FIXTURE
- LIGHT SWITCH
- 3-WAY LIGHT SWITCH
- OCCUPANCY SENSOR LIGHT SWITCH
- CEILING MOUNTED OCCUPANCY SENSOR
- JUNCTION BOX
- LIGHTING & POWER PANELBOARD
- CONDUIT CONCEALED IN CEILING OR WALL
- CONDUIT BELOW GRADE
- HOME RUN; TICK MARKS INDICATE NUMBER OF WIRES, ARROWS INDICATE NUMBER OF CIRCUITS
- GROUND WIRE
- FEEDER PER SCHEDULE
- DISCONNECT SWITCH

## KEYNOTES:

1. INSTALL RECEPTACLE IN CRAWL SPACE FOR SUMP PUMP. VERIFY LOCATION AND MOUNTING HEIGHT WITH OWNER PRIOR TO ROUGH-IN.
2. RECEPTACLE TO BE MOUNTED ABOVE CANSOPY. VERIFY LOCATION AND MOUNTING HEIGHT WITH OWNER PRIOR TO ROUGH-IN.
3. PROVIDE JUNCTION BOX AND POWER FOR HORTON SLIDING DOOR.
4. RECEPTACLES FOR SECURITY AND AUDIO.
5. PROVIDE JUNCTION BOX AND POWER FOR COOLER CONTROLS/LIGHTS. FIELD VERIFY EXACT LOCATION AND REQUIREMENTS.
6. PROVIDE JUNCTION BOX AND POWER FOR COOLER EVAPORATOR. FIELD VERIFY EXACT LOCATION AND REQUIREMENTS.
7. PROVIDE JUNCTION BOX FOR OUTDOOR HEATER CONTROLS 6" ABOVE SLIDING GLASS DOOR. COORDINATE ROUGH-IN AND WIRING REQUIREMENTS WITH OWNER.
8. PROVIDE JUNCTION BOX FOR POWER CONNECTION TO BUILDING LED TAPE LIGHT. REFER TO ARCHITECTURAL ELEVATIONS FOR EXACT LOCATION AND LINEAR FOOTAGE OF FIXTURE. CONNECT POWER TO LED STRIPS PER MANUFACTURE'S INSTRUCTION.
9. PROVIDE WEATHER PROOF JUNCTION BOX AND TOGGLE SWITCH LOCATED ON SIGN IN CONCEALED LOCATION FOR EXTERIOR SIGNAGE PER REQ. COORDINATE EXACT LOCATION OF JUNCTION BOX WITH THE SIGNAGE PROVIDER PRIOR TO INSTALLATION. CONTRACTOR SHALL PULL ALL WIRING TO THE JUNCTION BOXES AND MAKE FINAL CONNECTIONS. COORDINATE ALL REQUIREMENTS WITH THE SIGNAGE PROVIDER.
10. INSTALL FIXTURE 12" ABOVE TOP OF DOOR. FIELD VERIFY EXACT LOCATION WITH OWNER.
11. INSTALL FIXTURE 7" ABOVE FINISH FLOOR. FIELD VERIFY MOUNTING HEIGHT WITH OWNER.
12. RECEPTACLE FOR ESPRESSO MACHINE. PROVIDE CORD AND PLUG CONNECTION.
13. POWER CONNECTION FOR AIR CURTAIN. COORDINATE ROUGH-IN, WIRING REQUIREMENTS, AND MOUNTING HEIGHT WITH OWNER.
14. CT CABINET AND METER.
15. COORDINATE INSTALLATION HEIGHT WITH ARCHITECT
16. POWER CONNECTION FOR ELECTRIC HEATER. COORDINATE INSTALLATION HEIGHT WITH OWNER.
17. RECEPTACLE FOR IPAD. COORDINATE INSTALLATION HEIGHT WITH OWNER.
18. REFER TO 1/SU1.1 FOR CONTINUATION.
19. (2) 2" COMMUNICATION CONDUITS WITH PULL-WIRE. COORDINATE TERMINATION WITH OWNER PRIOR TO INSTALLATION.
20. COORDINATE LOCATION AND RECEPTACLE TYPE WITH EQUIPMENT PROVIDER.

## CONDUIT & CONDUCTOR SCHEDULE:

1. (2) #8 AND (1) #10 GROUND, IN 0.75" CONDUIT.
2. (2) #3 AND (1) #8 GROUND IN 1.25" CONDUIT.



7 BREW COFFEE  
LEE'S SUMMIT, MO

1410 NE DOUGLAS STREET  
LEE'S SUMMIT, MO 64086



ENGINEER OF RECORD:  
NAME: RYAN JONES  
LICENSE NO. PE-2004017193  
PROJECT NUMBER:  
21334 7BSM  
REVISION:

E1.1  
ELECTRICAL PLAN

DATE: APRIL 26, 2022

**CJD LLC**  
Engineering | Energy | Innovation  
2225 West Chesterfield Boulevard, Suite 200, Springfield, MO 65807  
P: 417.877.1700 F: 417.324.7735 www.cjd-eng.com  
Missouri State Certificate of Authority #2005026903  
Special Notice: Drawings prepared by CJD LLC are instruments of service for use solely with respect to this project. CJD LLC retains ownership and all common law, statutory and other reserved rights including copyrights. This drawing shall not be re-used in part or in full for any other work without prior written consent by and appropriate compensation to CJD LLC. Without changing the design without prior written approval from CJD LLC, reuse or other use of this drawing is prohibited. CJD LLC shall not be held responsible for any damages, liabilities or costs resulting directly or indirectly from such changes to the fullest extent of the law.



LIGHTING FIXTURE SCHEDULE										
MARK	MANUFACTURER	MODEL #	FINISH	MOUNTING	LAMPS		FIXTURE	VOLTAGE	APPROVED	NOTES
					TYPE	CODE	QTY.	WATTS		
T1	WILLIAMS	LP-24-L50/835-DIM-UNV	WHITE	RECESSED	LED	WITH FIXTURE	-	50	UNV	SUBMIT
T1E	WILLIAMS	LP-24-L50/835-EM/120VMM-DIM-UNV	WHITE	RECESSED	LED	WITH FIXTURE	-	50	UNV	SUBMIT
C1	HALO	SDM6665SWH	WHITE	SURFACE	LED	WITH FIXTURE	-	10	UNV	SUBMIT
C2	WAC LIGHTING	D5-W505-F-B-CC-BK	BLACK	SURFACE	LED	WITH FIXTURE	-	35	UNV	SUBMIT
S1	LED NEONFLEX	LN-11X29-24-RGB	WHITE	SURFACE	LED	WITH FIXTURE	-	1.88/FT	UNV	SUBMIT
S2	WILLIAMS	78-4-L53/830-DIM-UNV	WHITE	SURFACE	LED	WITH FIXTURE	-	35	UNV	SUBMIT
PL1	LUMARK	PRV-C25-D-UNV-T3-SA-BZ-HSS	BRONZE	POLE	LED	WITH FIXTURE	-	96	UNV	SUBMIT
W1E	WILLIAMS	WPAS-134/850-BZ-PC-EM/6W-UNV	BRONZE	SURFACE	LED	WITH FIXTURE	-	45	UNV	SUBMIT
X1	WILLIAMS	EXIT/EM/LED-R-WHT	WHITE	SURFACE	LED	WITH FIXTURE	-	10	120	SUBMIT
NOTES: 1. FIXTURE SHALL BE TESTED FOR OUTDOOR USE AND SHALL BE TESTED FOR DAMP OR WET LOCATION AS REQUIRED. 2. COORDINATE WITH ARCHITECT FOR EXACT MOUNTING HEIGHT AND LOCATION. 3. PROVIDE FIXTURE WITH EMERGENCY BATTERY BACK-UP FOR MINIMUM 90 MINUTES OPERATION. 4. COORDINATE WITH ARCHITECT/DRAWER FOR EXACT FINISH. 5. REFER TO PLANS AND COORDINATE WITH OWNER/ARCHITECT FOR MOUNTING TYPE, FACE ORIENTATION, AND CHEVRON DIRECTION AS APPLICABLE. 6. FIXTURE LAMP AND BALLAST SHALL BE CAPABLE OF OPERATING DOWN TO 0 DEGREES F AND UP TO 110 DEGREES F AS REQUIRED. 7. PROVIDE 2X STRAIGHT STEEL POLE AND ACCESSORIES AS REQUIRED FOR COMPLETE INSTALLATION. 8. PROVIDE ALL ACCESSORIES AS REQUIRED FOR COMPLETE INSTALLATION. POLE AND ACCESSORIES SHALL BE SAME COLOR AS FIXTURE HEAD. 9. PROVIDE FIXTURE WITH LUMARY NEMA PHOTOCONTROL, DA/R4304										

PANELBOARD SCHEDULE											P1	
VOLTAGE: 120/240		POLES: 1/3		84		MOUNTING: 22K		SURFACE		ENCLOSURE: NEMA 3R		
PHASE / WIRE: 1/3		KAIC AMPS (RMS): 600		22K		LOCATION: 22K		EXTERIOR		MANUFACTURER: SQUARE D		
AMPS: 600		MAIN BREAKER / MLO:		MLO		FED FROM:		UTILITY XPMR		NO		
CIRC NO	EQUIPMENT SERVED	C/B AMPS	C/B POLES	C/B ACC	LOAD (VA)	PHASE LOADS (VA)	LOAD (VA)	C/B ACC	C/B POLES	C/B AMPS	EQUIPMENT SERVED	CIRC NO
					A	B						
1	POINT OF SALE RECEIPTABLES	20	1	-	400	1050	650	-	1	20	GRINDER	2
3	FRONT BAR RECEIPTABLE	20	1	-	180	630	650	-	1	20	GRINDER	4
5	EXTERIOR RECEIPTABLES	20	1	-	540	720	180	-	1	20	FRONT BAR RECEIPTABLE	6
7	ESPRESSO MACHINE 4 GROUP	50	2	-	4000	5800	1800	-	1	20	HOT WATER RECEIPTABLE	8
9	*				4000	5284	1284	-	1	20	ICE MAKER	10
11	HORTON SLIDING DOOR	20	1	-	500	1220	720	-	1	20	EXTERIOR RECEIPTABLES	12
13	ESPRESSO MACHINE 3 GROUP	50	2	-	3050	4334	1284	-	1	20	BLENDER	14
15	*				3050	4334	1284	-	1	20	ICE MAKER	16
17	SECURITY RECEIPTABLES	20	1	-	360	3410	3050	-	2	50	ESPRESSO MACHINE 3 GROUP	18
19	SECURITY RECEIPTABLES	20	1	-	360	3410	3050				*	20
21	SIDE BAR RECEIPTABLE	20	1	-	180	360	180	-	1	20	SERVICE AREA RECEIPTABLE	22
23	SIDE BAR RECEIPTABLE	20	1	-	180	360	180	-	1	20	SERVICE AREA RECEIPTABLE	24
25	SIDE BAR RECEIPTABLE	20	1	-	180	1464	1284	-	1	20	BLENDER	26
27	ICE MAKER	20	1	-	1284	1554	270	-	1	20	EXTERIOR LIGHTS	28
29	INTERIOR LIGHTS	20	1	-	700	1984	1284	-	1	20	BLENDER	30
31	SIDE BAR RECEIPTABLE	20	1	-	180	540	360	-	1	20	EXTERIOR RECEIPTABLES	32
33	BLENDER	20	1	-	1284	1644	360	-	1	20	BATHROOM RECEPTACLE	34
35	CRAWL SPACE RECEPTACLE	20	1	-	180	970	790	HACR	2	20	WALK IN COOLER	36
37	EXTERIOR LED LIGHTS	20	1	-	500	1290	790				*	38
39	SPARE	20	1	-		1200	1200	-	1	20	BUILDING SIGNAGE	40
41	SPARE	20	1	-		1200	1200	-	1	20	BUILDING SIGNAGE	42
43	CONDENSING UNIT CUI1	50	2	HACR	3078	3278	200	-	1	20	COOLER LIGHT	44
45	*				3078	3218	140	HACR	1	15	ICE MACHINE	46
47	CONDENSING UNIT CUI2	50	2	HACR	3078	6918	3840	HACR	2	40	REMOTE CONDENSING UNIT	48
49	*				3078	6918	3840				*	50
51	MECHANICAL ACCESS RECEPTACLE	20	1	-	360	720	360	-	1	20	IPAD RECEPTABLES	52
53	ELECTRIC HEATER EH1	20	2	-	1500	11484	9984	HACR	2	100	AIR HANDLER AH1	54
55	*				1500	11484	9984				*	56
57	ELECTRIC HEATER EH2	20	2	-	1500	11484	9984	HACR	2	100	AIR HANDLER AH2	58
59	*				1500	11484	9984				*	60
61	AIR CURTAIN AC1	15	1	HACR	768	1128	360	-	1	20	IPAD RECEPTABLES	62
63	AIR CURTAIN AC2	15	1	HACR	768	1068	300	-	1	20	SITE LIGHTING	64
65	SPARE	20	1	-	0	0	0	-	1	20	SPARE	66
67	WATER HEATER WH1	40	2	-	4000	4000	4000	-	1	20	SPARE	68
69	*				4000	4000	4000	-	1	20	SPARE	70
71	WATER HEATER WH1	40	2	-	4000	4000	4000	-	1	20	SPARE	72
73	*				4000	4000	4000	-	1	20	SPARE	74
75	WATER HEATER WH1	40	2	-	4000	4000	4000	-	1	20	SPARE	76
77	*				4000	4000	4000	-	1	20	SPARE	78
79	SPARE	20	1	-	0	0	0	-	1	20	SPARE	80
81	SPARE	20	1	-	0	0	0	-	1	20	SPARE	82
83	SPARE	20	1	-	0	0	0	-	1	20	SPARE	84
ENCLOSURE ACCESSORIES: CH, FL											PANELBOARD ACCESSORIES: GB, CBB	
CIRCUIT BREAKER ACCESSORIES:											PANELBOARD ACCESSORIES:	
ACU	AUXILIARY CONTACTS	CH			COXCELED HINGE	FL				SFB	SUB-FEED CIRCUIT BREAKER	
ECR	ELECTRICAL OPERATOR	CH			COLUMN MOUNT PANEL	FL				SFB	SUB-FEED LUGS	
GDF	GROUND-FAULT INTERRUPTING	DWD			HINGED GROUND WITH HINGED DOOR	GB				GB	3/4 IN PLATED COPPER BUS BARS	
HCR	HATCH RATING	ECW			EXTENDED TOP TRIP	GB				GB	INSULATED ALUMINUM BUS BARS	
HLP	HANDLE-LOCK OFF	EGF			EXTENDED GUTTER BOTTOM	NBK				GB	NEUTRAL BONDING KIT	
NLN	HANDLE LOCK-ON	EGSL			EXTENDED GUTTER LEFT HAND SIDE	PS				TRN	200% RATED NEUTRAL BUS BAR	
SR	SWITCH RATING	EGSR			EXTENDED GUTTER RIGHT HAND SIDE	SR				TVSS	TRANSIENT VOLTAGE SURGE SUPPRESSION	
ST	SHUNT TRIP	FLSR			FLUSH LOCK(S)	SEB					SERVICE ENTRANCE RATING	