

ALTERNATES LIST:

Base Bid: existing finish to remain.

- 1) Paint ALL exterior of existing metal panel and CMU on Building D and Building E
- Replace existing Robotics space general lighting in Building D with efficient

 LED
 Base Bid: existing lighting to remain.
- 3) Replace existing weight room, new weight room, and new GiC space general lighting in Building E with efficient LED.
- Base Bid: existing lighting to remain.
- 4) Exclude exterior canopy scope at GiC space North of Building E.
 Base Bid: as documented in Construction Documents.



LSR7 Robotics, GiC & Phys Education: Construction Documents

OWNEr:
Lee's Summit R-7 School District

Lee's Summit R-7 School D 301 NE Tudor Road Lee's Summit, MO 64086

architect:
Multistudio

4200 Pennsylvania Avenue
Kansas City, MO 64111
816.931.6655
www.multi.studio

civil engineer:
Kaw Valley Engineering
14700 West 114th Terrace
Lenexa, KS 66215
913.485.0318
kveng.com

kveng.com

MEPFT/Code::
Henderson Engineers


8345 Lenexa Drive, Suite 300
Lenexa, KS 66214

816.742.5000
www.hendersonengineers.com

structural engineer:
Bob D. Campbell & Company,
4338 Belleview
Kansas City, MO 64111
816.531.4144
www.bdc-engrs.com

LSN: 901 NE Douglas St., Lee's Summit MO 64086 LSW: 2600 SW Ward Rd, Lee's Summit MO 64082 LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063 Project Number: 0121-0100 Issue Date: September 9, 2022



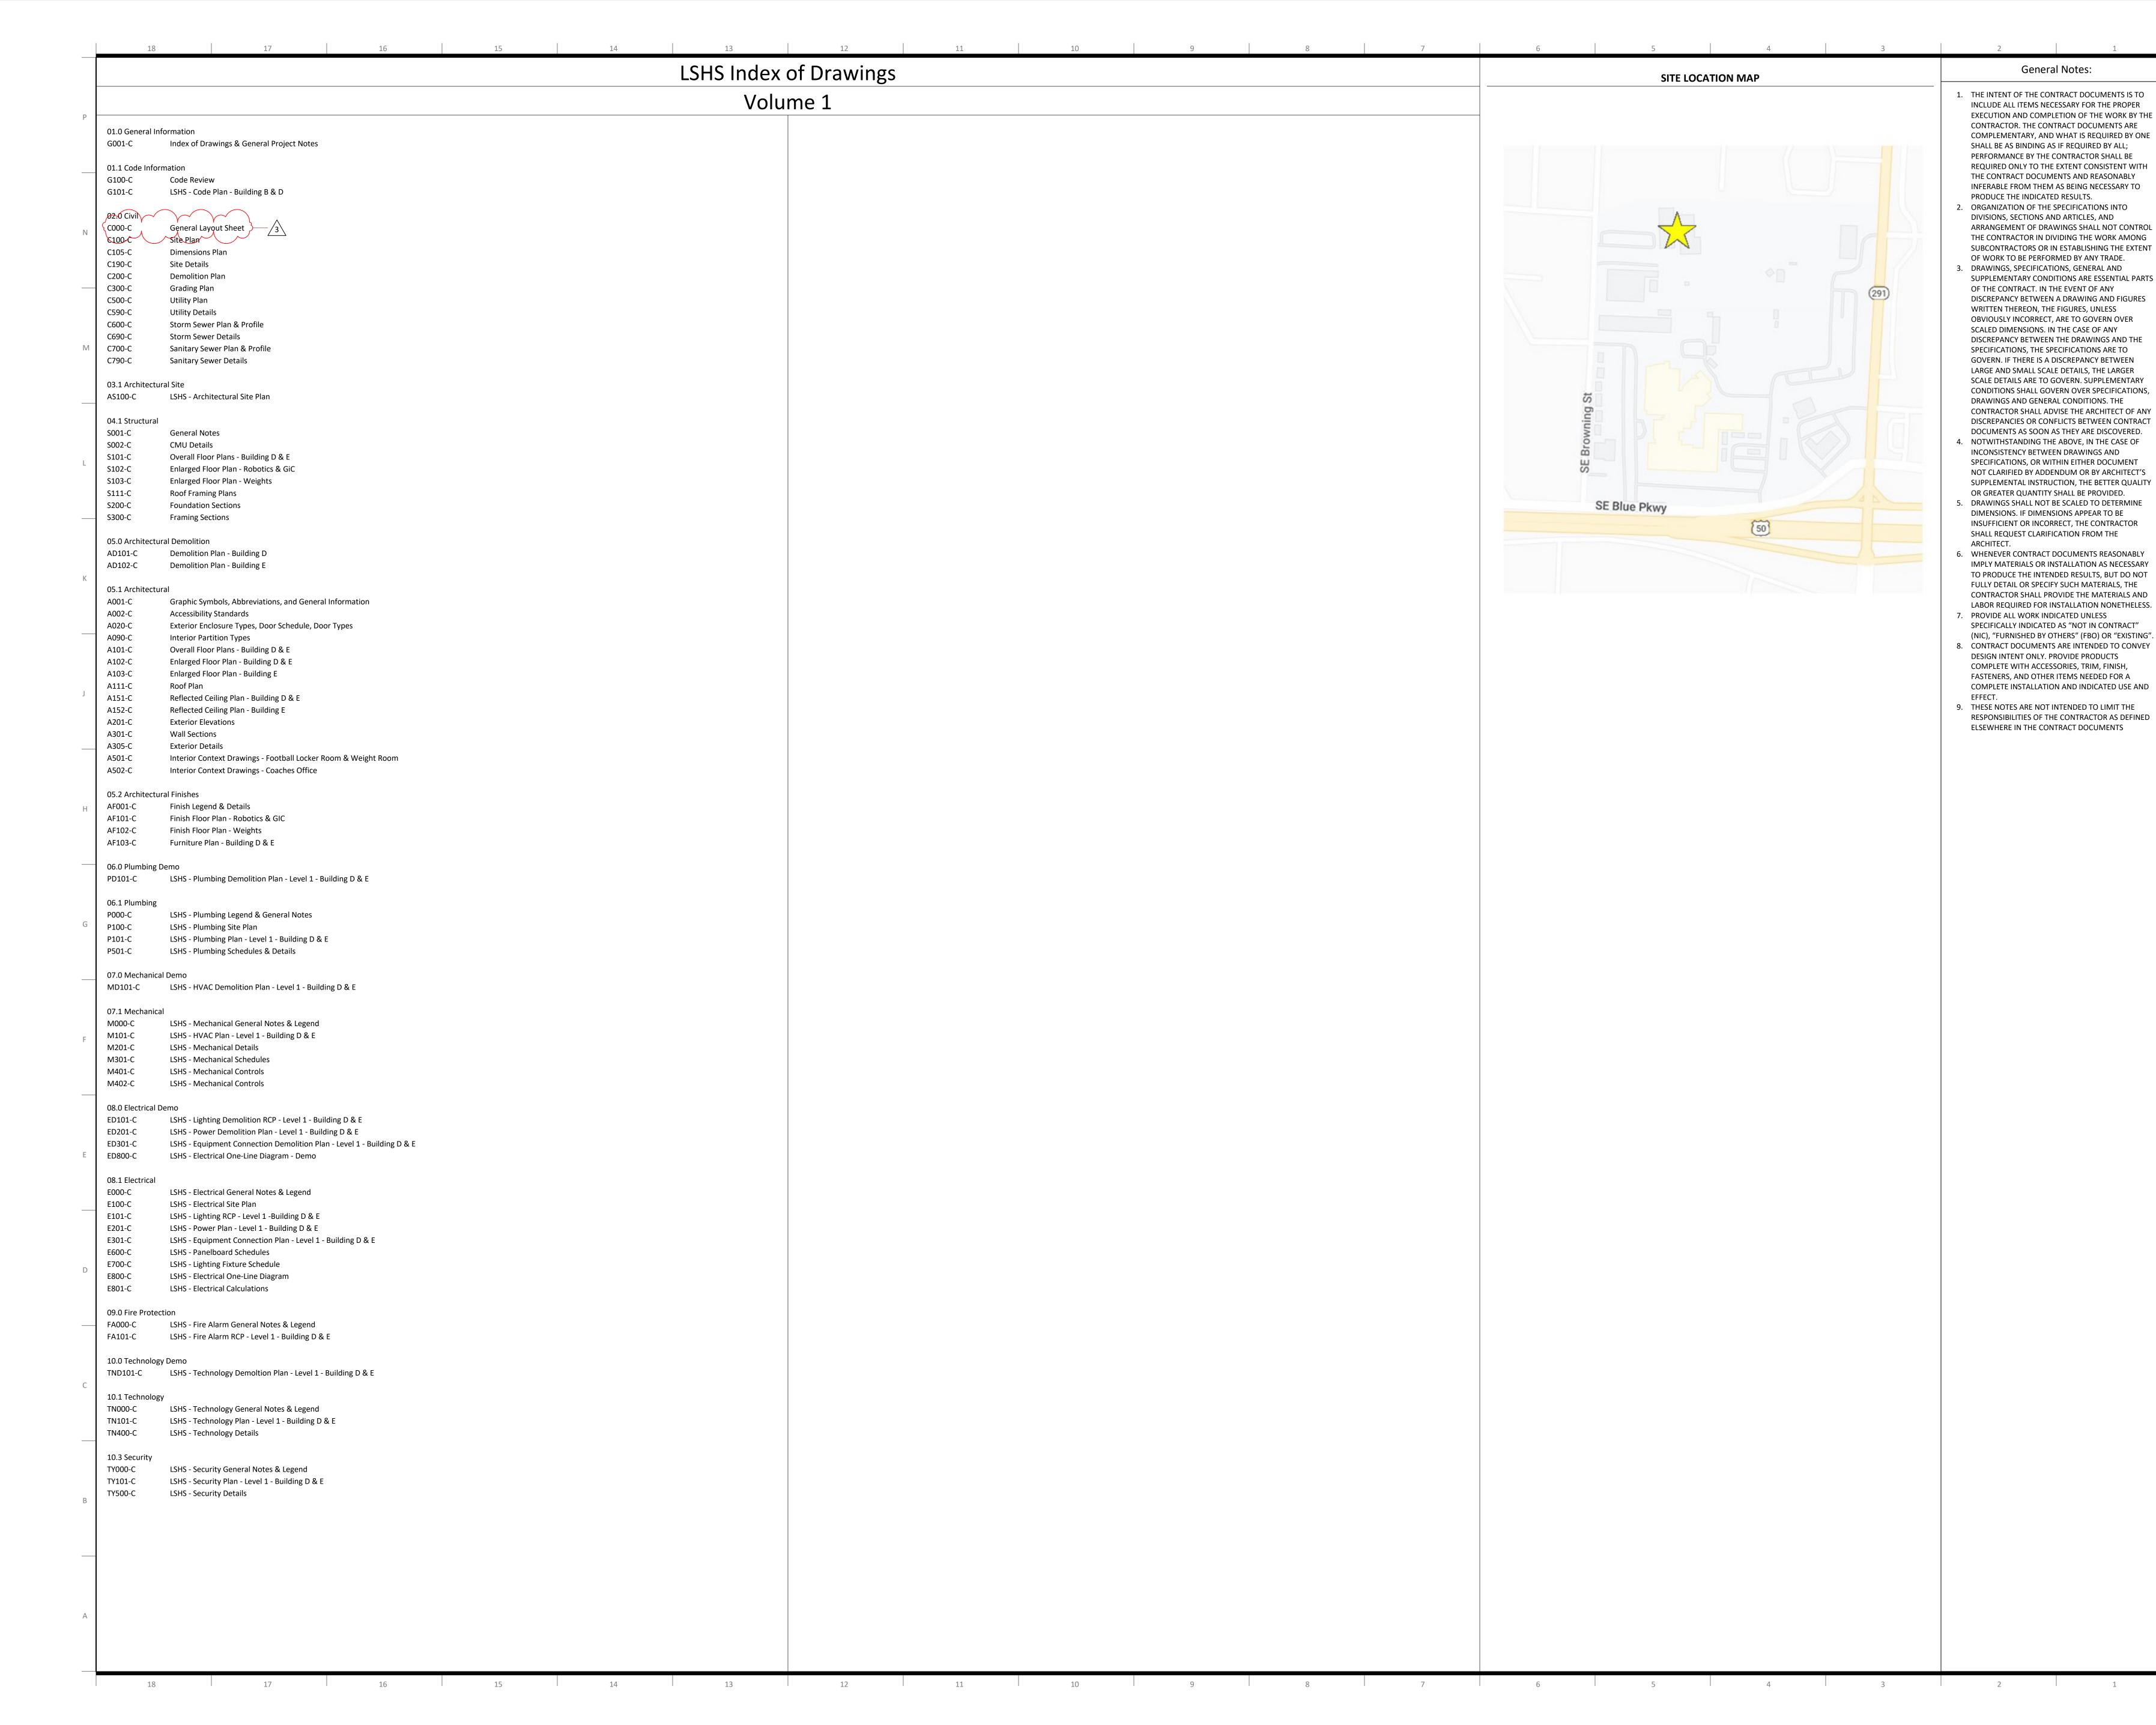

General Notes:

PRODUCE THE INDICATED RESULTS.

DISCREPANCY BETWEEN A DRAWING AND FIGURES

WRITTEN THEREON, THE FIGURES, UNLESS

DIMENSIONS. IF DIMENSIONS APPEAR TO BE

INSUFFICIENT OR INCORRECT, THE CONTRACTOR

LSR7 Robotics, GiC & **Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO LSW: 2600 SW Ward Rd, Lee's Summit MO LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: Lee's Summit R-7 School Multistudio 301 NE Tudor Road 4200 Pennsylvania Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655 multi.studio

structural engineer: Kaw Valley Engineering Bob D. Campbell & 14700 West 114th Terrace 4338 Belleview Lenexa, KS 66215 Kansas City, MO 64111 913.485.0318 816.531.4144 www.bdc-engrs.com kveng.com MEPFT/Code:: **Henderson Engineers**

8345 Lenexa Drive, Suite Lenexa, KS 66214 816.742.5000 www.hendersonengineers.com


ASI01 - Code Comments

September 9, 2022


Issue Date:

Revisions

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



Index of Drawings & **General Project Notes**

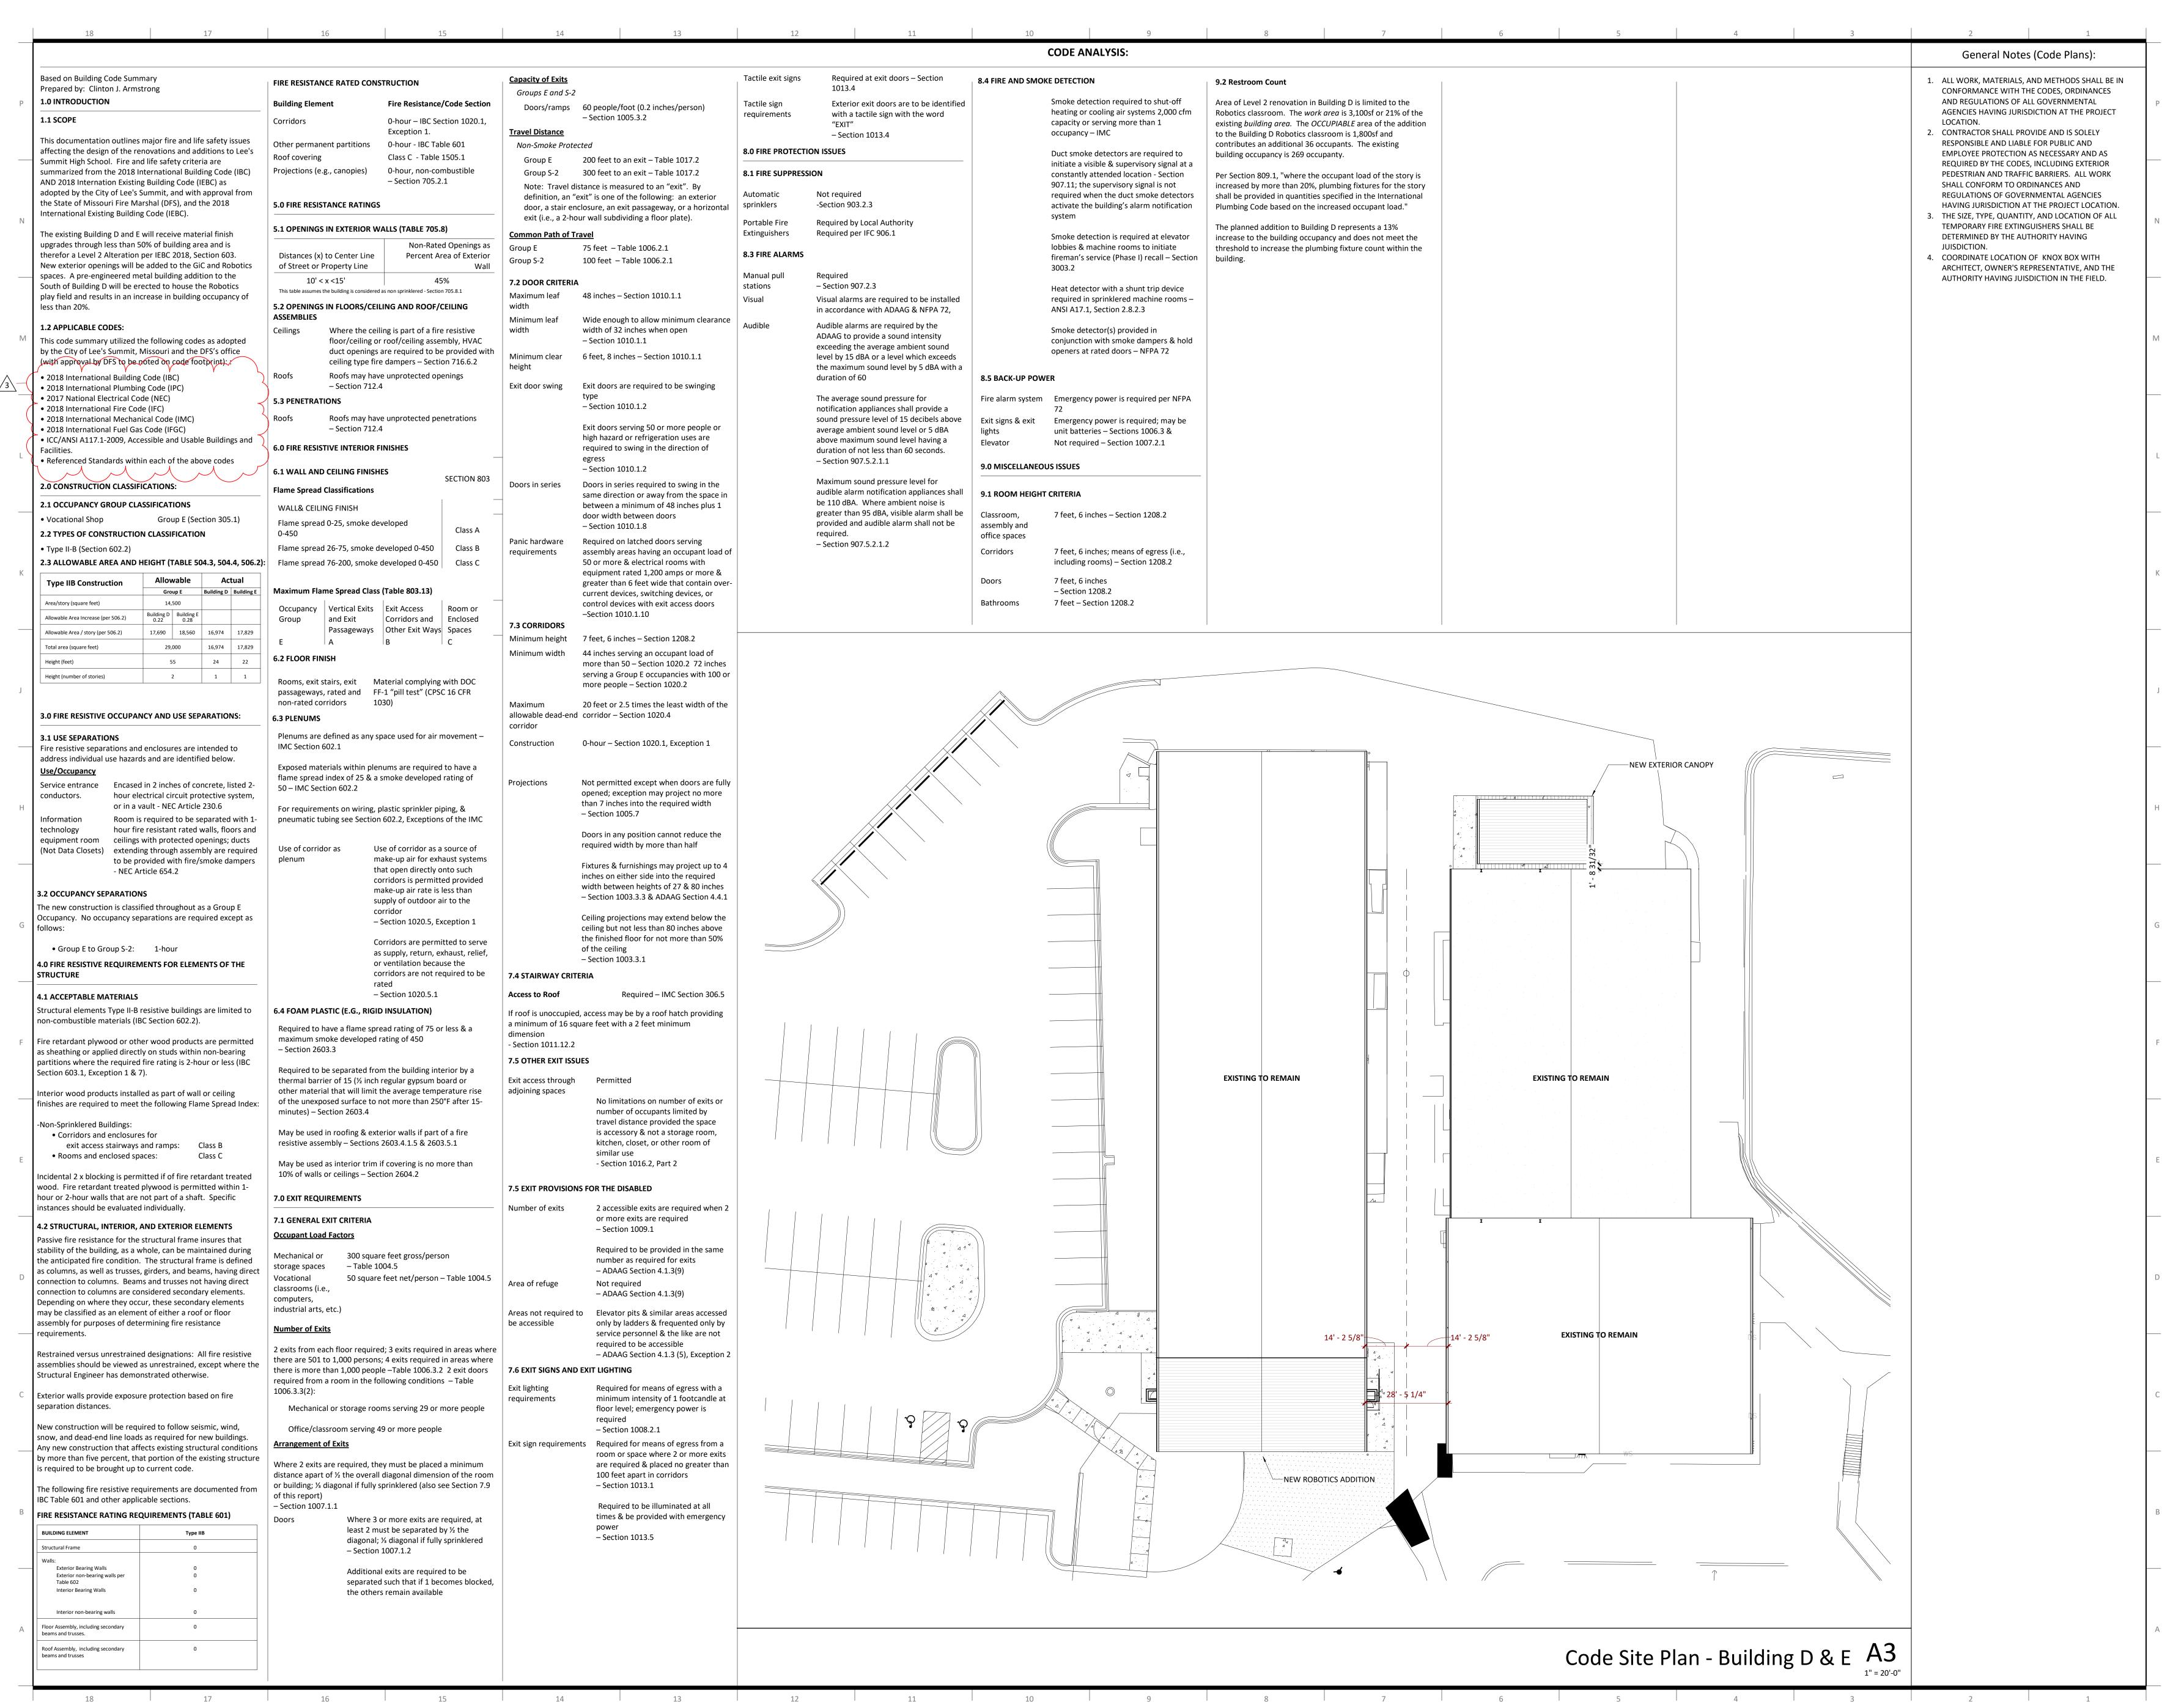

multistudio the evolution of gould evans

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086 LSW: 2600 SW Ward Rd, Lee's Summit MO 64082 LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0

owner: architect:
Lee's Summit R-7 School

301 NE Tudor Road 4200 Pennsylvania
Lee's Summit, MO 64086 Kansas City, MO 64111
816.931.6655
multi.studio

civil engineer:

Kaw Valley Engineering

14700 West 114th Terrace
Lenexa, KS 66215

913.485.0318

kveng.com

MEPFT/Code::

Henderson Engineers

8345 Leneva Drive Suite


8345 Lenexa Drive, Suite 300 Lenexa, KS 66214 816.742.5000 www.hendersonengineers.com

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION


September 9, 2022

Issue Date:

Revisions



Code Review
G100-C

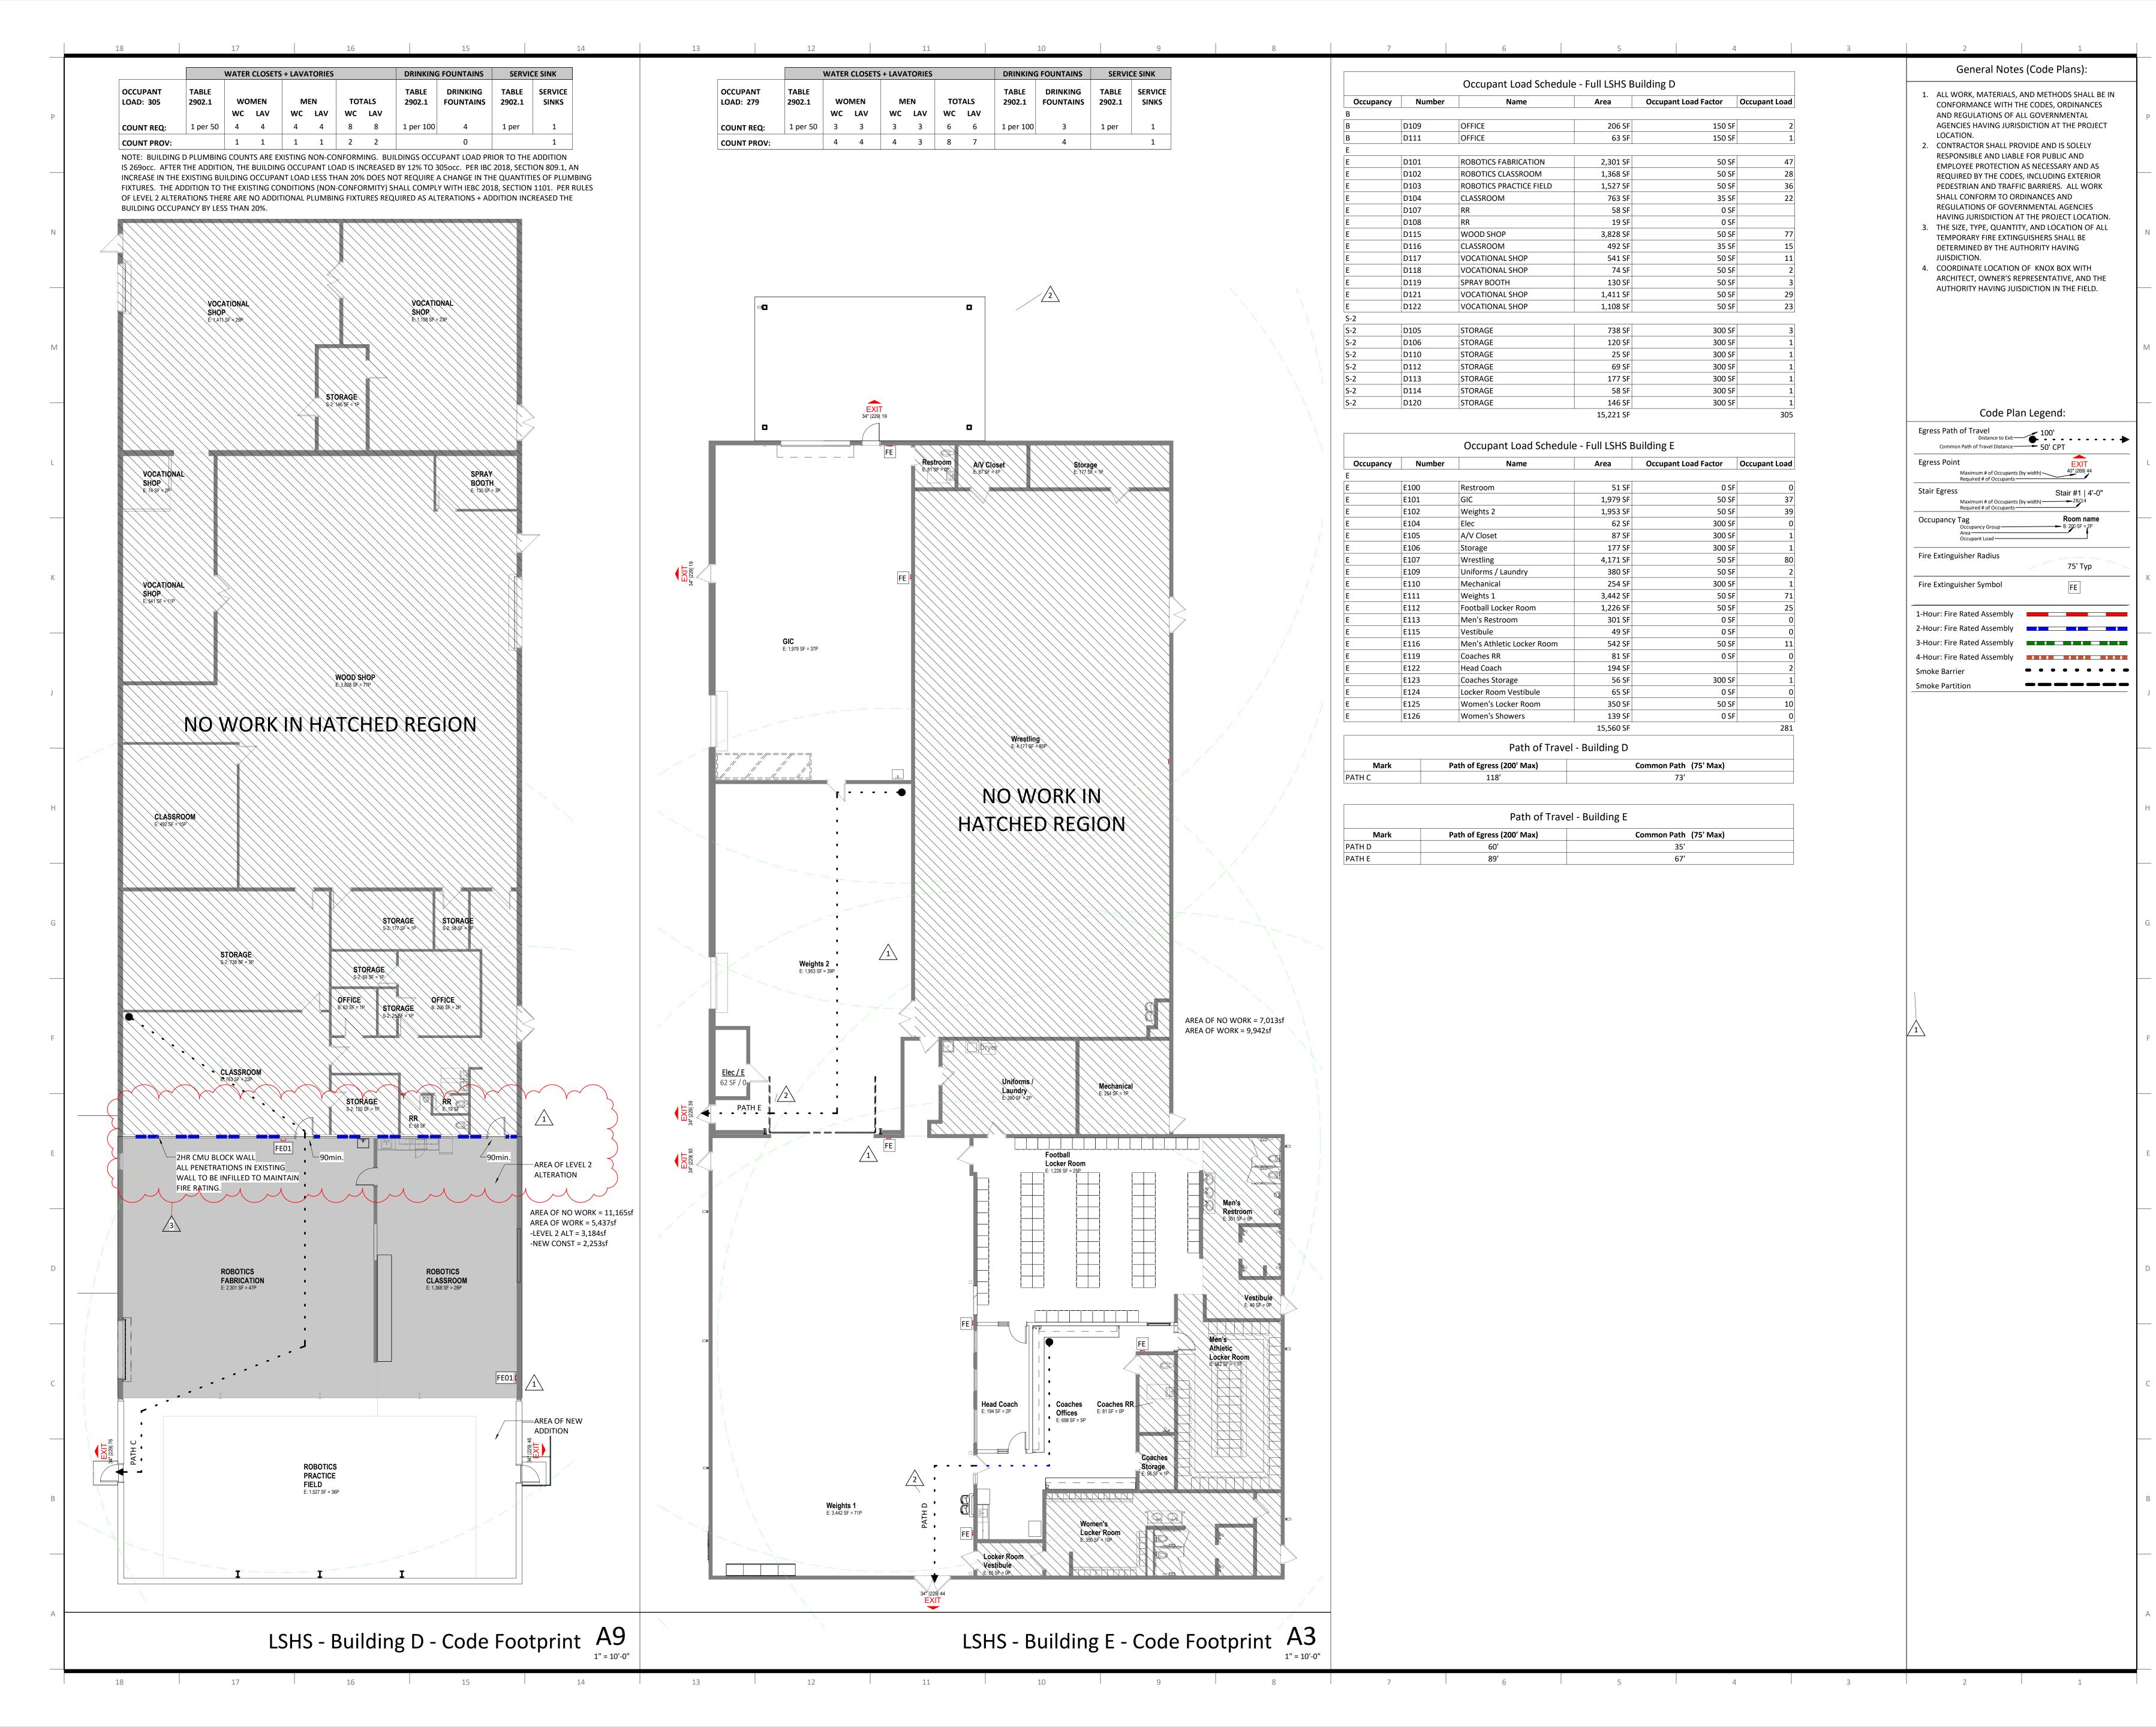

LSR7 Robotics, GiC & **Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO LSW: 2600 SW Ward Rd, Lee's Summit MO

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: Lee's Summit R-7 School Multistudio 301 NE Tudor Road 4200 Pennsylvania Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655

multi.studio structural engineer: Kaw Valley Engineering Bob D. Campbell & 14700 West 114th Terrace 4338 Belleview Lenexa, KS 66215 Kansas City, MO 64111 913.485.0318 816.531.4144 www.bdc-engrs.com kveng.com

MEPFT/Code:: **Henderson Engineers** 8345 Lenexa Drive, Suite Lenexa, KS 66214 816.742.5000

www.hendersonengineers.com

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR

CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

September 9, 2022


09/23/2022




LSHS - Code Plan -Building B & D G101-C

LEE'S SUMMIT HIGH SCHOOL GENERAL LAYOUT SHEET


400 SE BLUE PARKWAY, LEE'S SUMMIT, MO 64063 SECTION 8 - TOWNSHIP 47 N - RANGE 31 W

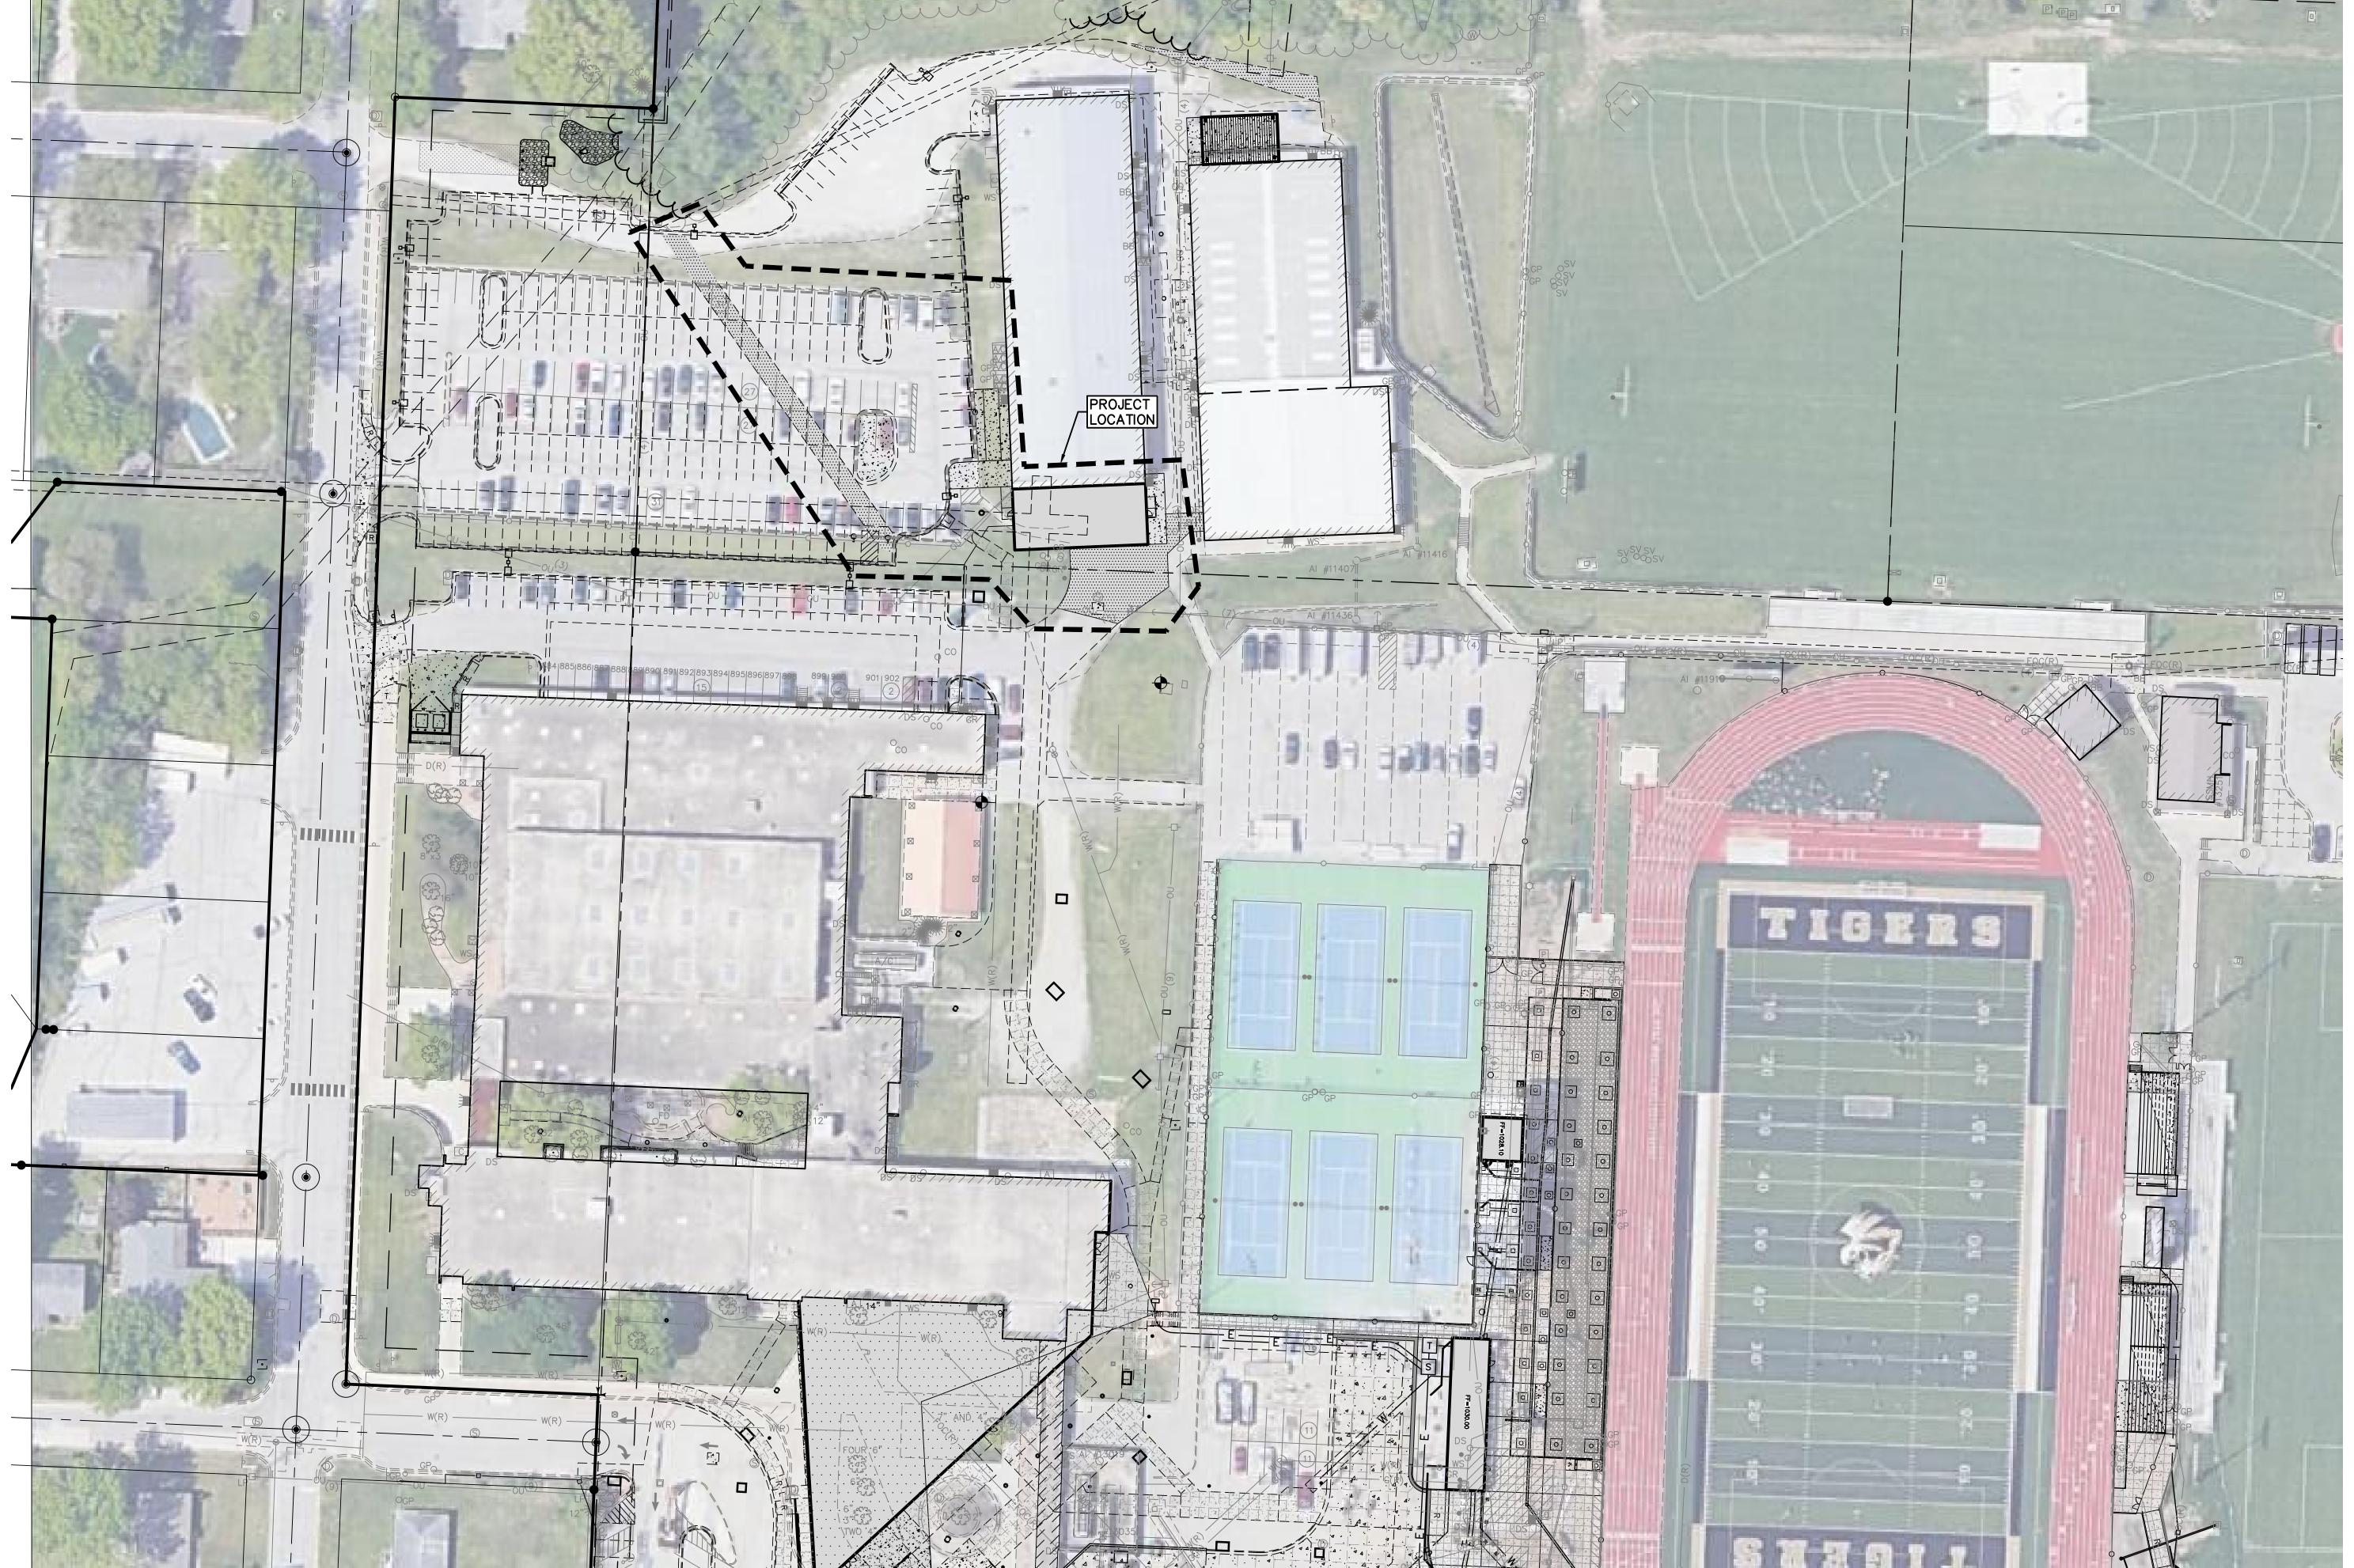

| 18 | PRINT DATE/TIME: 11/8/2022 3:20 PM

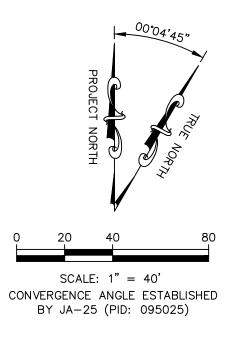



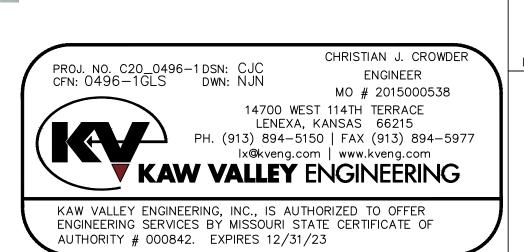



Lee's Summit Robotics, GiC & Phys Educaiton

LSN: 901 NE Douglas St., Lee's Summit MO 64086 LSW: 2600 SW Ward Rd, Lee's Summit MO 64082 LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number:	0121-0100
owner: Lee's Summit R-7 School	architect: Multistudio
301 NE Tudor Road	4200 Pennsylvania

301 NE Tudor Road
Lee's Summit, MO 64086
Lee's Summit, MO 64086
Kansas City, MO 64111
816.931.6655
multi.studio

civil engineer:
Kaw Valley Engineering
14700 West 114th Terrace
Lenexa, KS 66215
Kansas City, MO 64111

913.485.0318 816 kveng.com ww MEPFT/Code:: Henderson Engineers 8345 Lenexa Drive, Suite 300 Lenexa, KS 66214 816.742.5000

www.hendersonengineers.com

Revisions

NUMBER DESCRIPTION DAT

1 ADDENDUM 2 9/23/202
2 ASI 01 - CODE COMMENTS 11/8/202

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

OF MISSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

OF MISSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED. THE PROPERTY OF THE PROPERTY

Kaw Valley Engineering, Inc.


Missouri Certificate of Authority: 000842

Christian Crowder Date: 9/23/2022

Engineer License No. PE-2015000538

GENERAL LAYOUT SHEET

C000-C

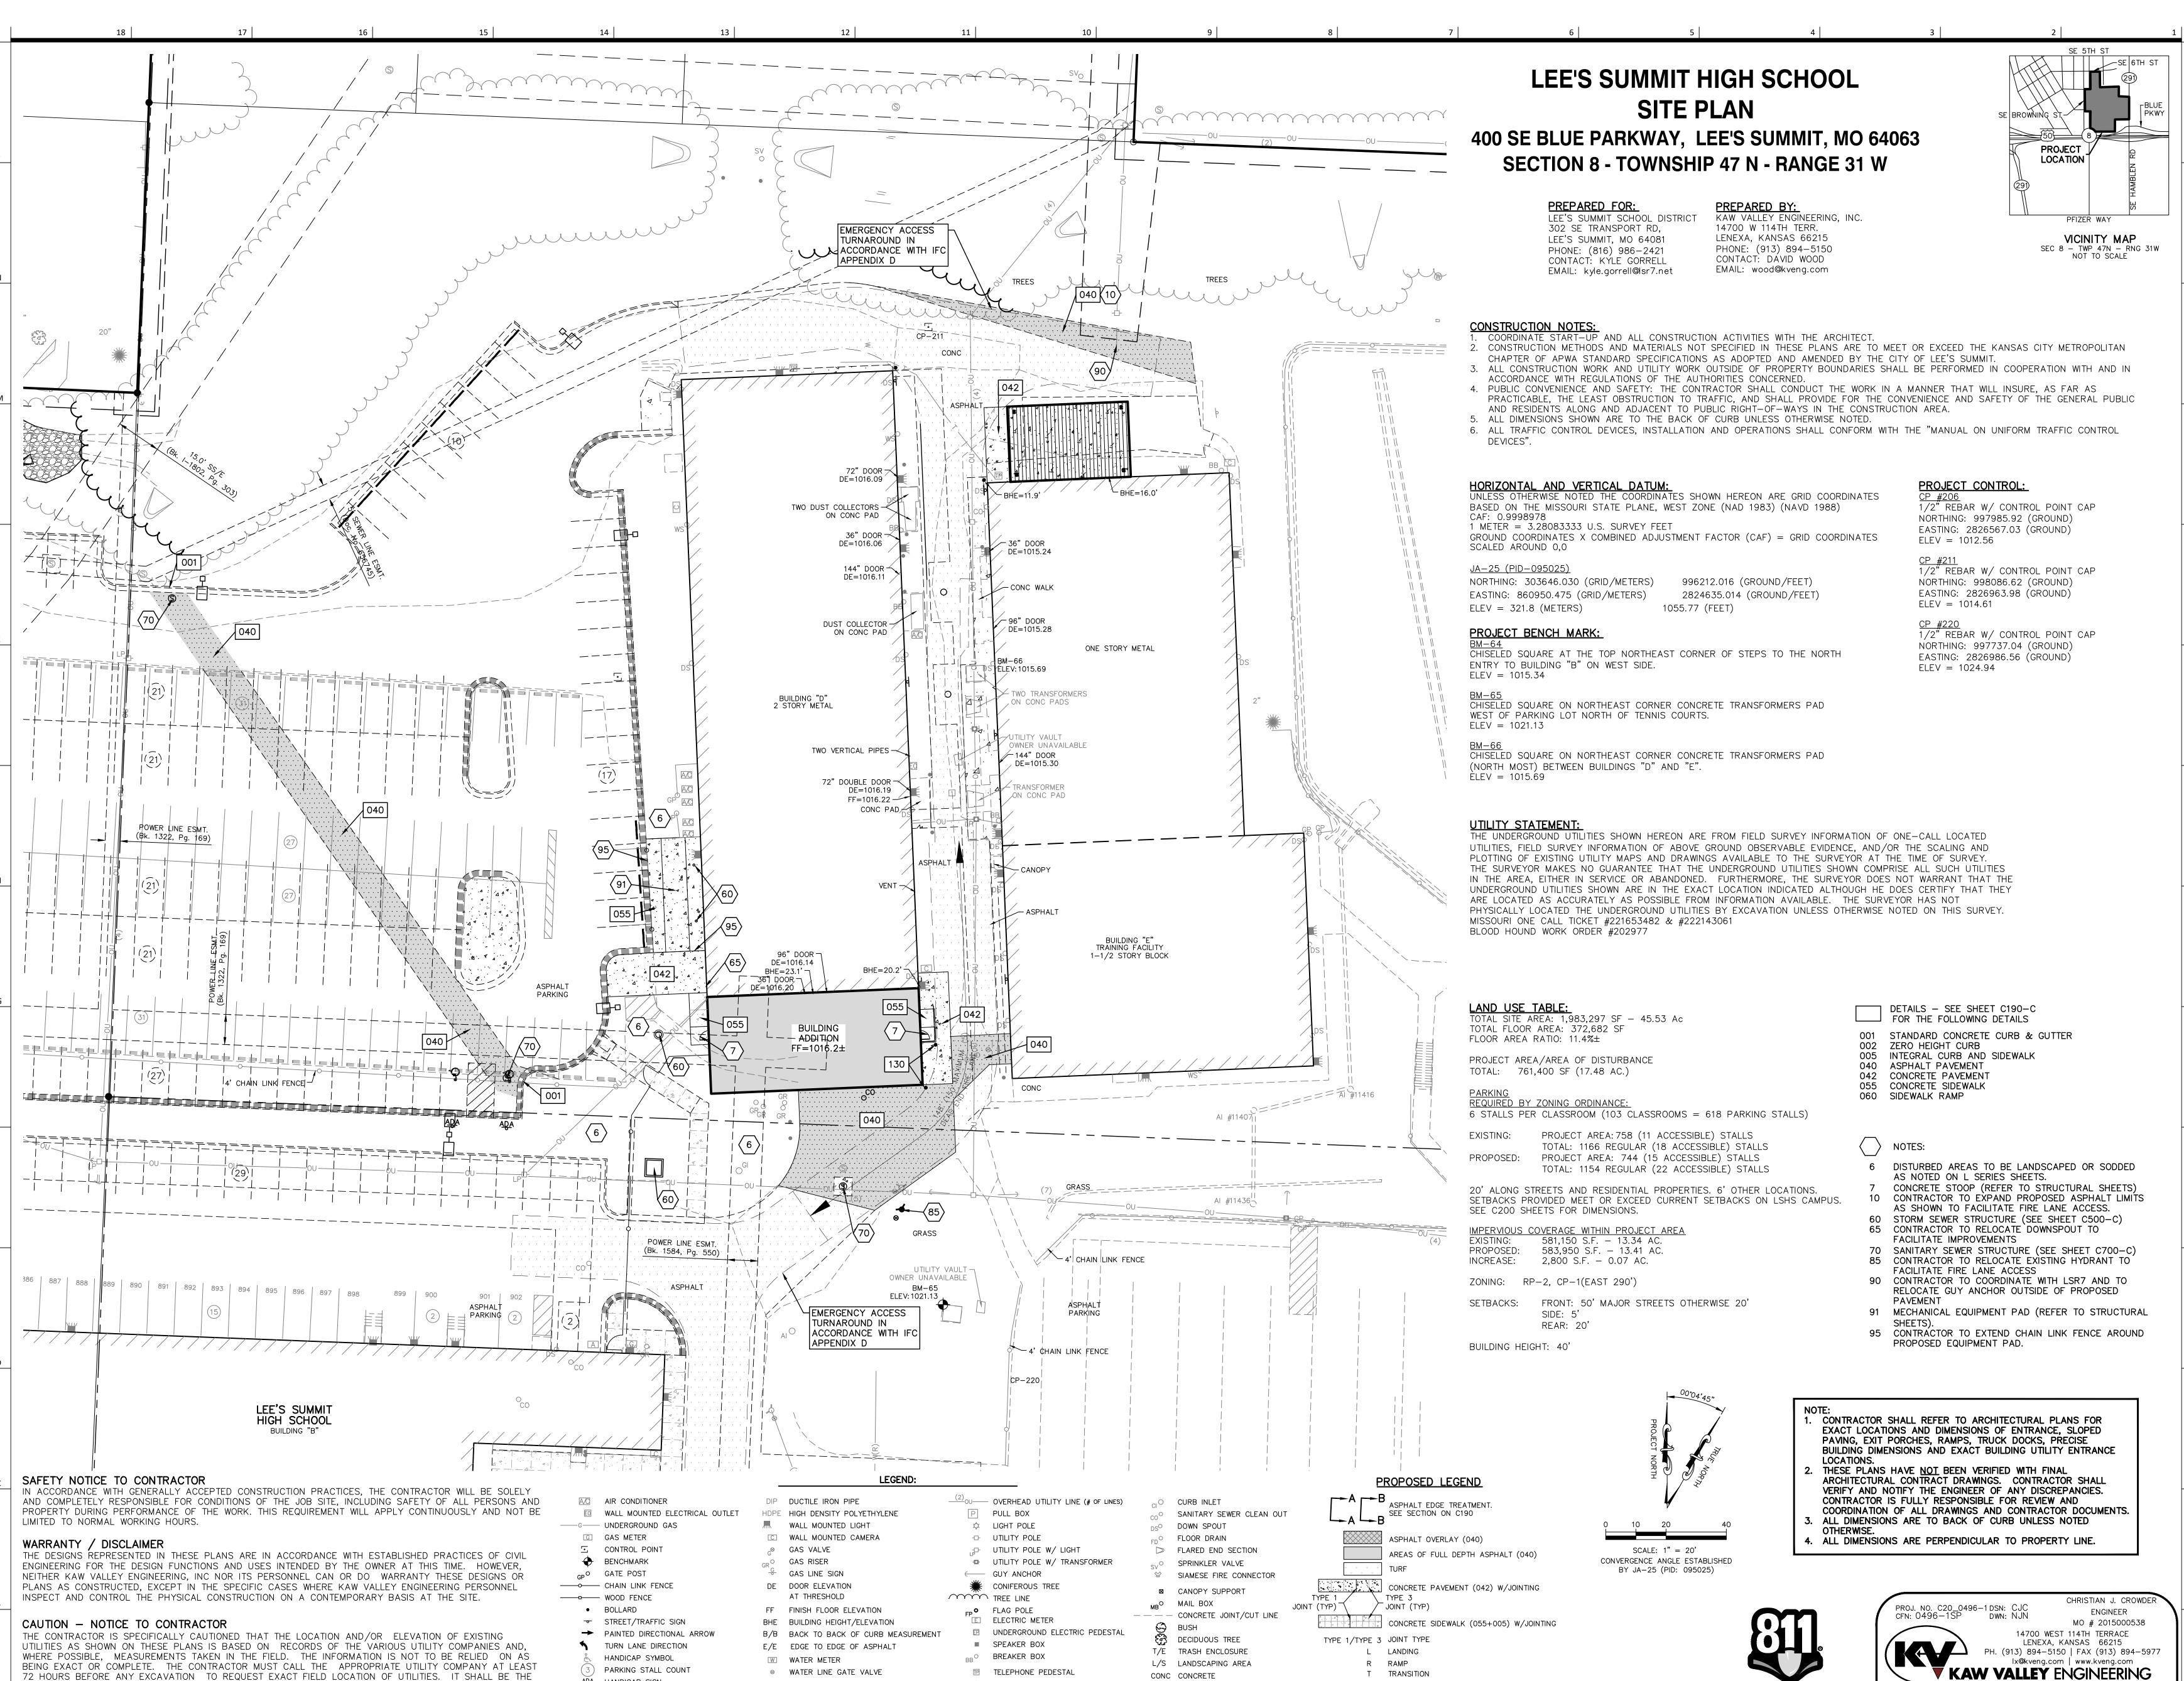

S SANITARY SEWER MANHOLE

STORM SEWER MANHOLE

AREA INLET

11 |

LW LOWEST WIRE HEIGHT

PROJECT AREA (LIMITS OF DISTURBANCE)

Know what's below.

Call before you dig.

KAW VALLEY ENGINEERING, INC., IS AUTHORIZED TO OFFER

AUTHORITY # 000842. EXPIRES 12/31/23

ENGINEERING SERVICES BY MISSOURI STATE CERTIFICATE OF

ADA HANDICAP SIGN

HRMP HANDICAP RAMP

₩HEEL STOP

14

15 [|]

RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES WHICH CONFLICT WITH PROPOSED

THE CONTRACTOR SHALL EXPOSE EXISTING UTILITIES AT LOCATIONS OF POSSIBLE CONFLICTS PRIOR TO ANY

17

IMPROVEMENTS SHOWN ON THE PLANS.

11/8/2022 3:20 PM

CONSTRUCTION.

PRINT DATE/TIME:

♥ FIRE HYDRANT

W WATER MANHOLE

13

SPRINKLER CONTROL BOX

12

multistudio

Lee's Summit Robotics, **GiC & Phys Educaiton**

LSN: 901 NE Douglas St., Lee's Summit MO LSW: 2600 SW Ward Rd, Lee's Summit MO

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063 Project Number: 301 NE Tudor Road

Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655 structural enginee Kaw Valley Engineering Bob D. Campbell & 14700 West 114th Terrace Lenexa, KS 66215 913.485.0318 816.531.4144 kveng.com

MEPFT/Code:: **Henderson Engineers** 8345 Lenexa Drive, Suite Lenexa, KS 66214 816.742.5000

www.bdc-engrs.com

www.hendersonengineers.com


Issue Date: September 9, 2022

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED. THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION RECORDING PURPOSES OR IMPLEMENTATION

ONAL !

Kaw Valley Engineering, Inc. Missouri Certificate of Authority: 000842
Christian Crowder Date: 9/23/2022
Engineer License No. PE-2015000538

SITE PLAN

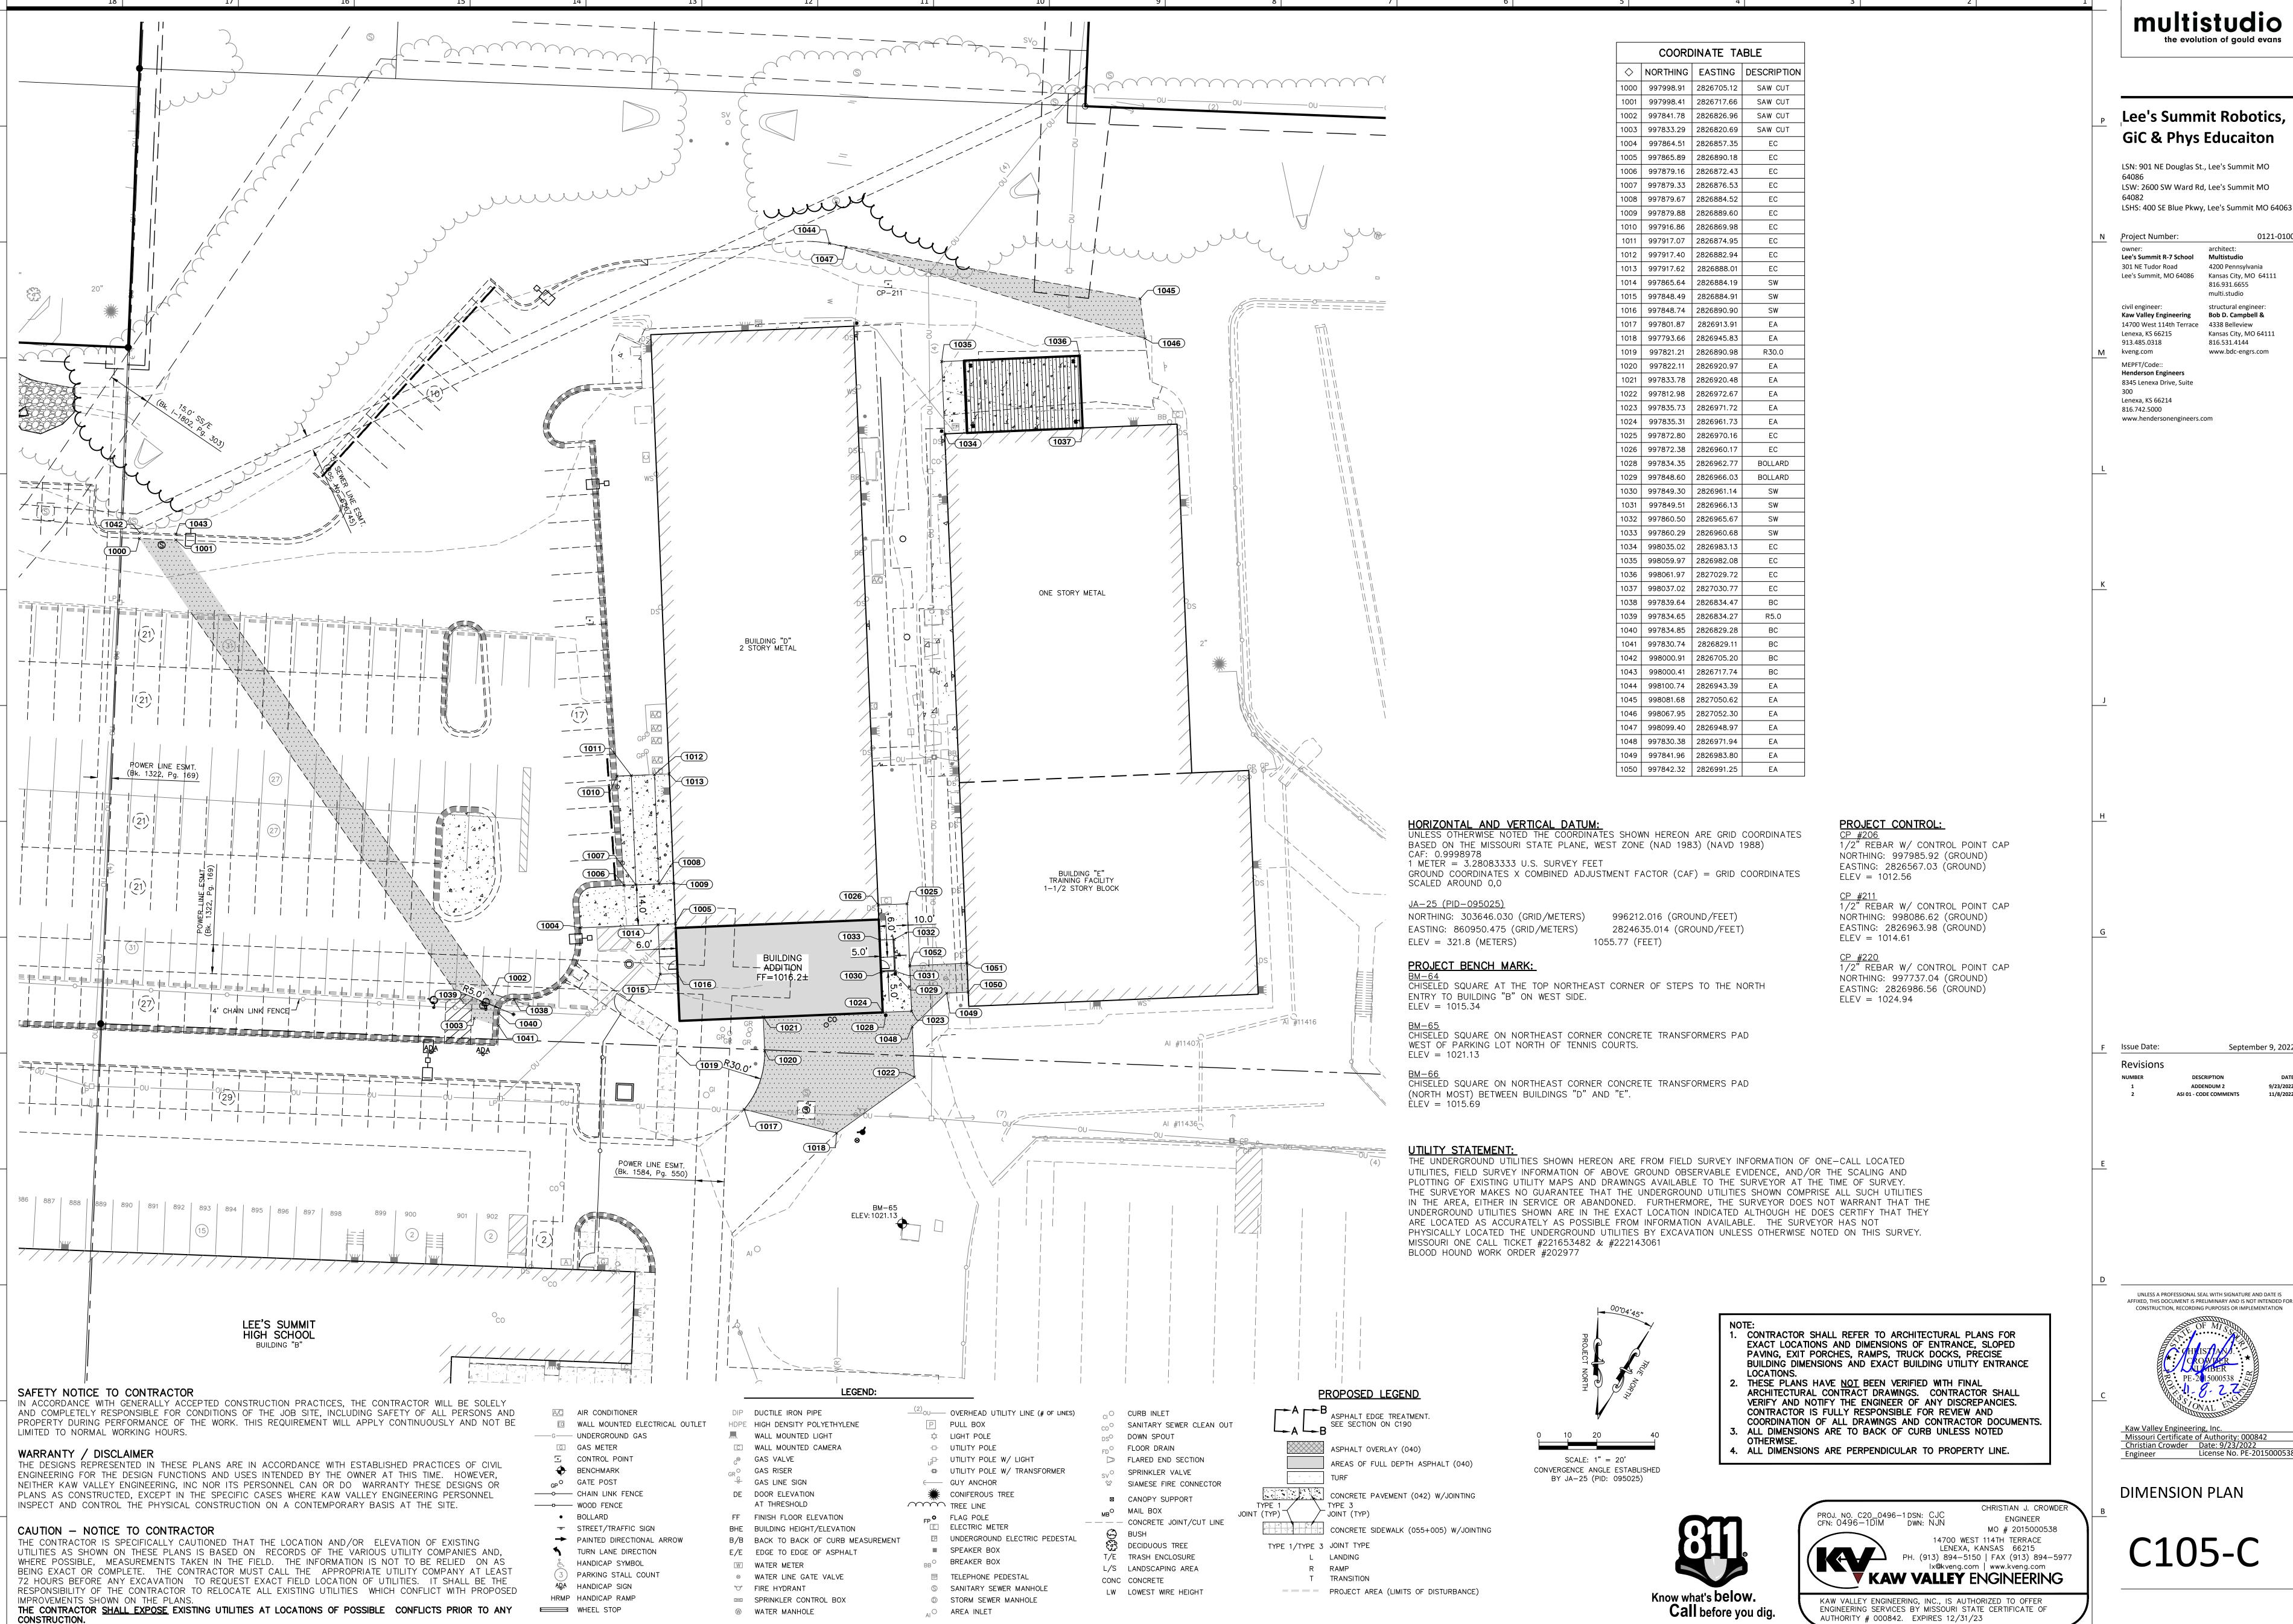

17

PRINT DATE/TIME:

11/8/2022 3:21 PM

15

14

16

13

12

11

10

multistudio

Lee's Summit Robotics, **GiC & Phys Educaiton**

LSN: 901 NE Douglas St., Lee's Summit MO LSW: 2600 SW Ward Rd, Lee's Summit MO

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063 Project Number: 301 NE Tudor Road


Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655 multi.studio structural engineer Kaw Valley Engineering Bob D. Campbell & 14700 West 114th Terrace Lenexa, KS 66215 Kansas City, MO 6411 913.485.0318 816.531.4144 www.bdc-engrs.com kveng.com

MEPFT/Code:: **Henderson Engineers** 8345 Lenexa Drive, Suite Lenexa, KS 66214

DONAL ELS Kaw Valley Engineering, Inc. Missouri Certificate of Authority: 000842
Christian Crowder Date: 9/23/2022
Engineer License No. PE-2015000538

September 9, 2022

DIMENSION PLAN

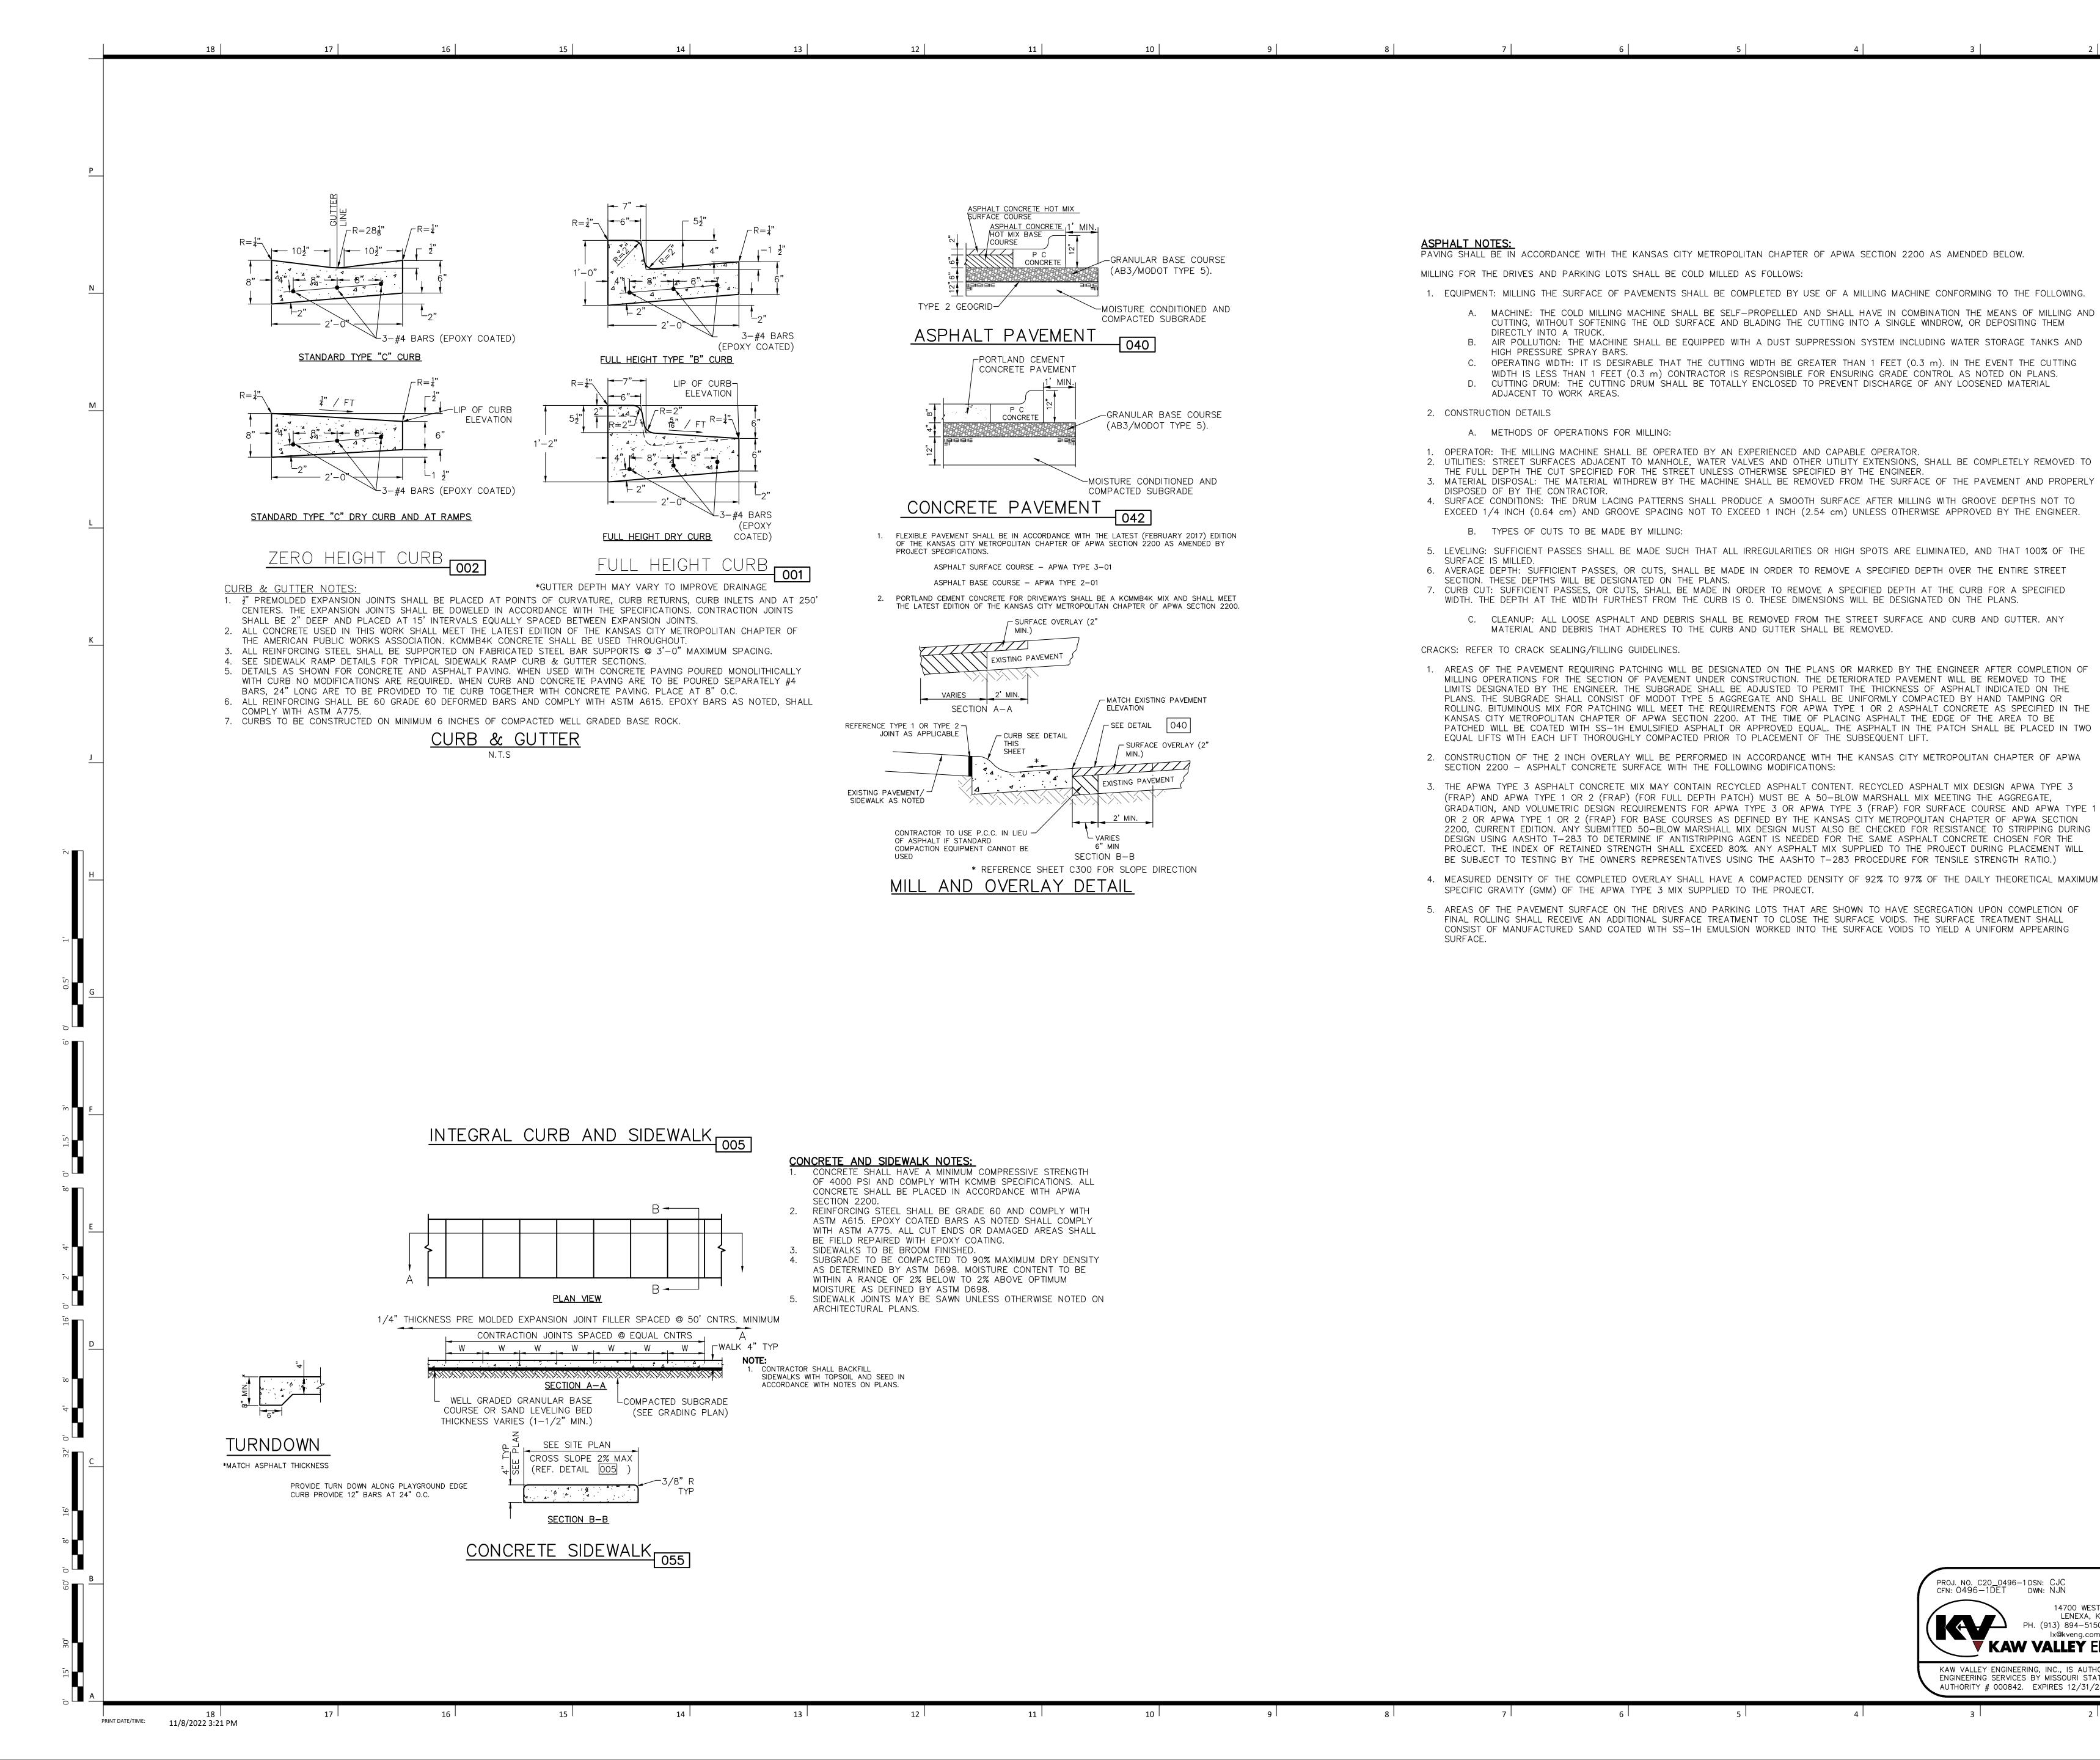

Lee's Summit Robotics, **GiC & Phys Educaiton**

LSN: 901 NE Douglas St., Lee's Summit MO LSW: 2600 SW Ward Rd, Lee's Summit MO

Project Number: Lee's Summit R-7 School 301 NE Tudor Road 4200 Pennsylvania Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

multi.studio structural engineer Bob D. Campbell & Kaw Valley Engineering 14700 West 114th Terrace Lenexa, KS 66215 913.485.0318

kveng.com MEPFT/Code:: **Henderson Engineers** 8345 Lenexa Drive, Suite Lenexa, KS 66214 816.742.5000

www.hendersonengineers.com

4338 Belleview Kansas City, MO 64111 816.531.4144 www.bdc-engrs.com

Issue Date: September 9, 2022 Revisions

ADDENDUM 2

9/23/2022

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

Kaw Valley Engineering, Inc. Missouri Certificate of Authority: 000842
Christian Crowder Date: 9/23/2022
Engineer License No. PE-2015000538

SITE DETAILS

CHRISTIAN J. CROWDER

ENGINEER MO # 2015000538

14700 WEST 114TH TERRACE

LENEXA, KANSAS 66215 PH. (913) 894-5150 | FAX (913) 894-5977 lx@kveng.com | www.kveng.com


KAW VALLEY ENGINEERING

KAW VALLEY ENGINEERING, INC., IS AUTHORIZED TO OFFER ENGINEERING SERVICES BY MISSOURI STATE CERTIFICATE OF

AUTHORITY # 000842. EXPIRES 12/31/23

PROJ. NO. C20_0496-1DSN: CJC CFN: 0496-1DET DWN: NJN

C190-C

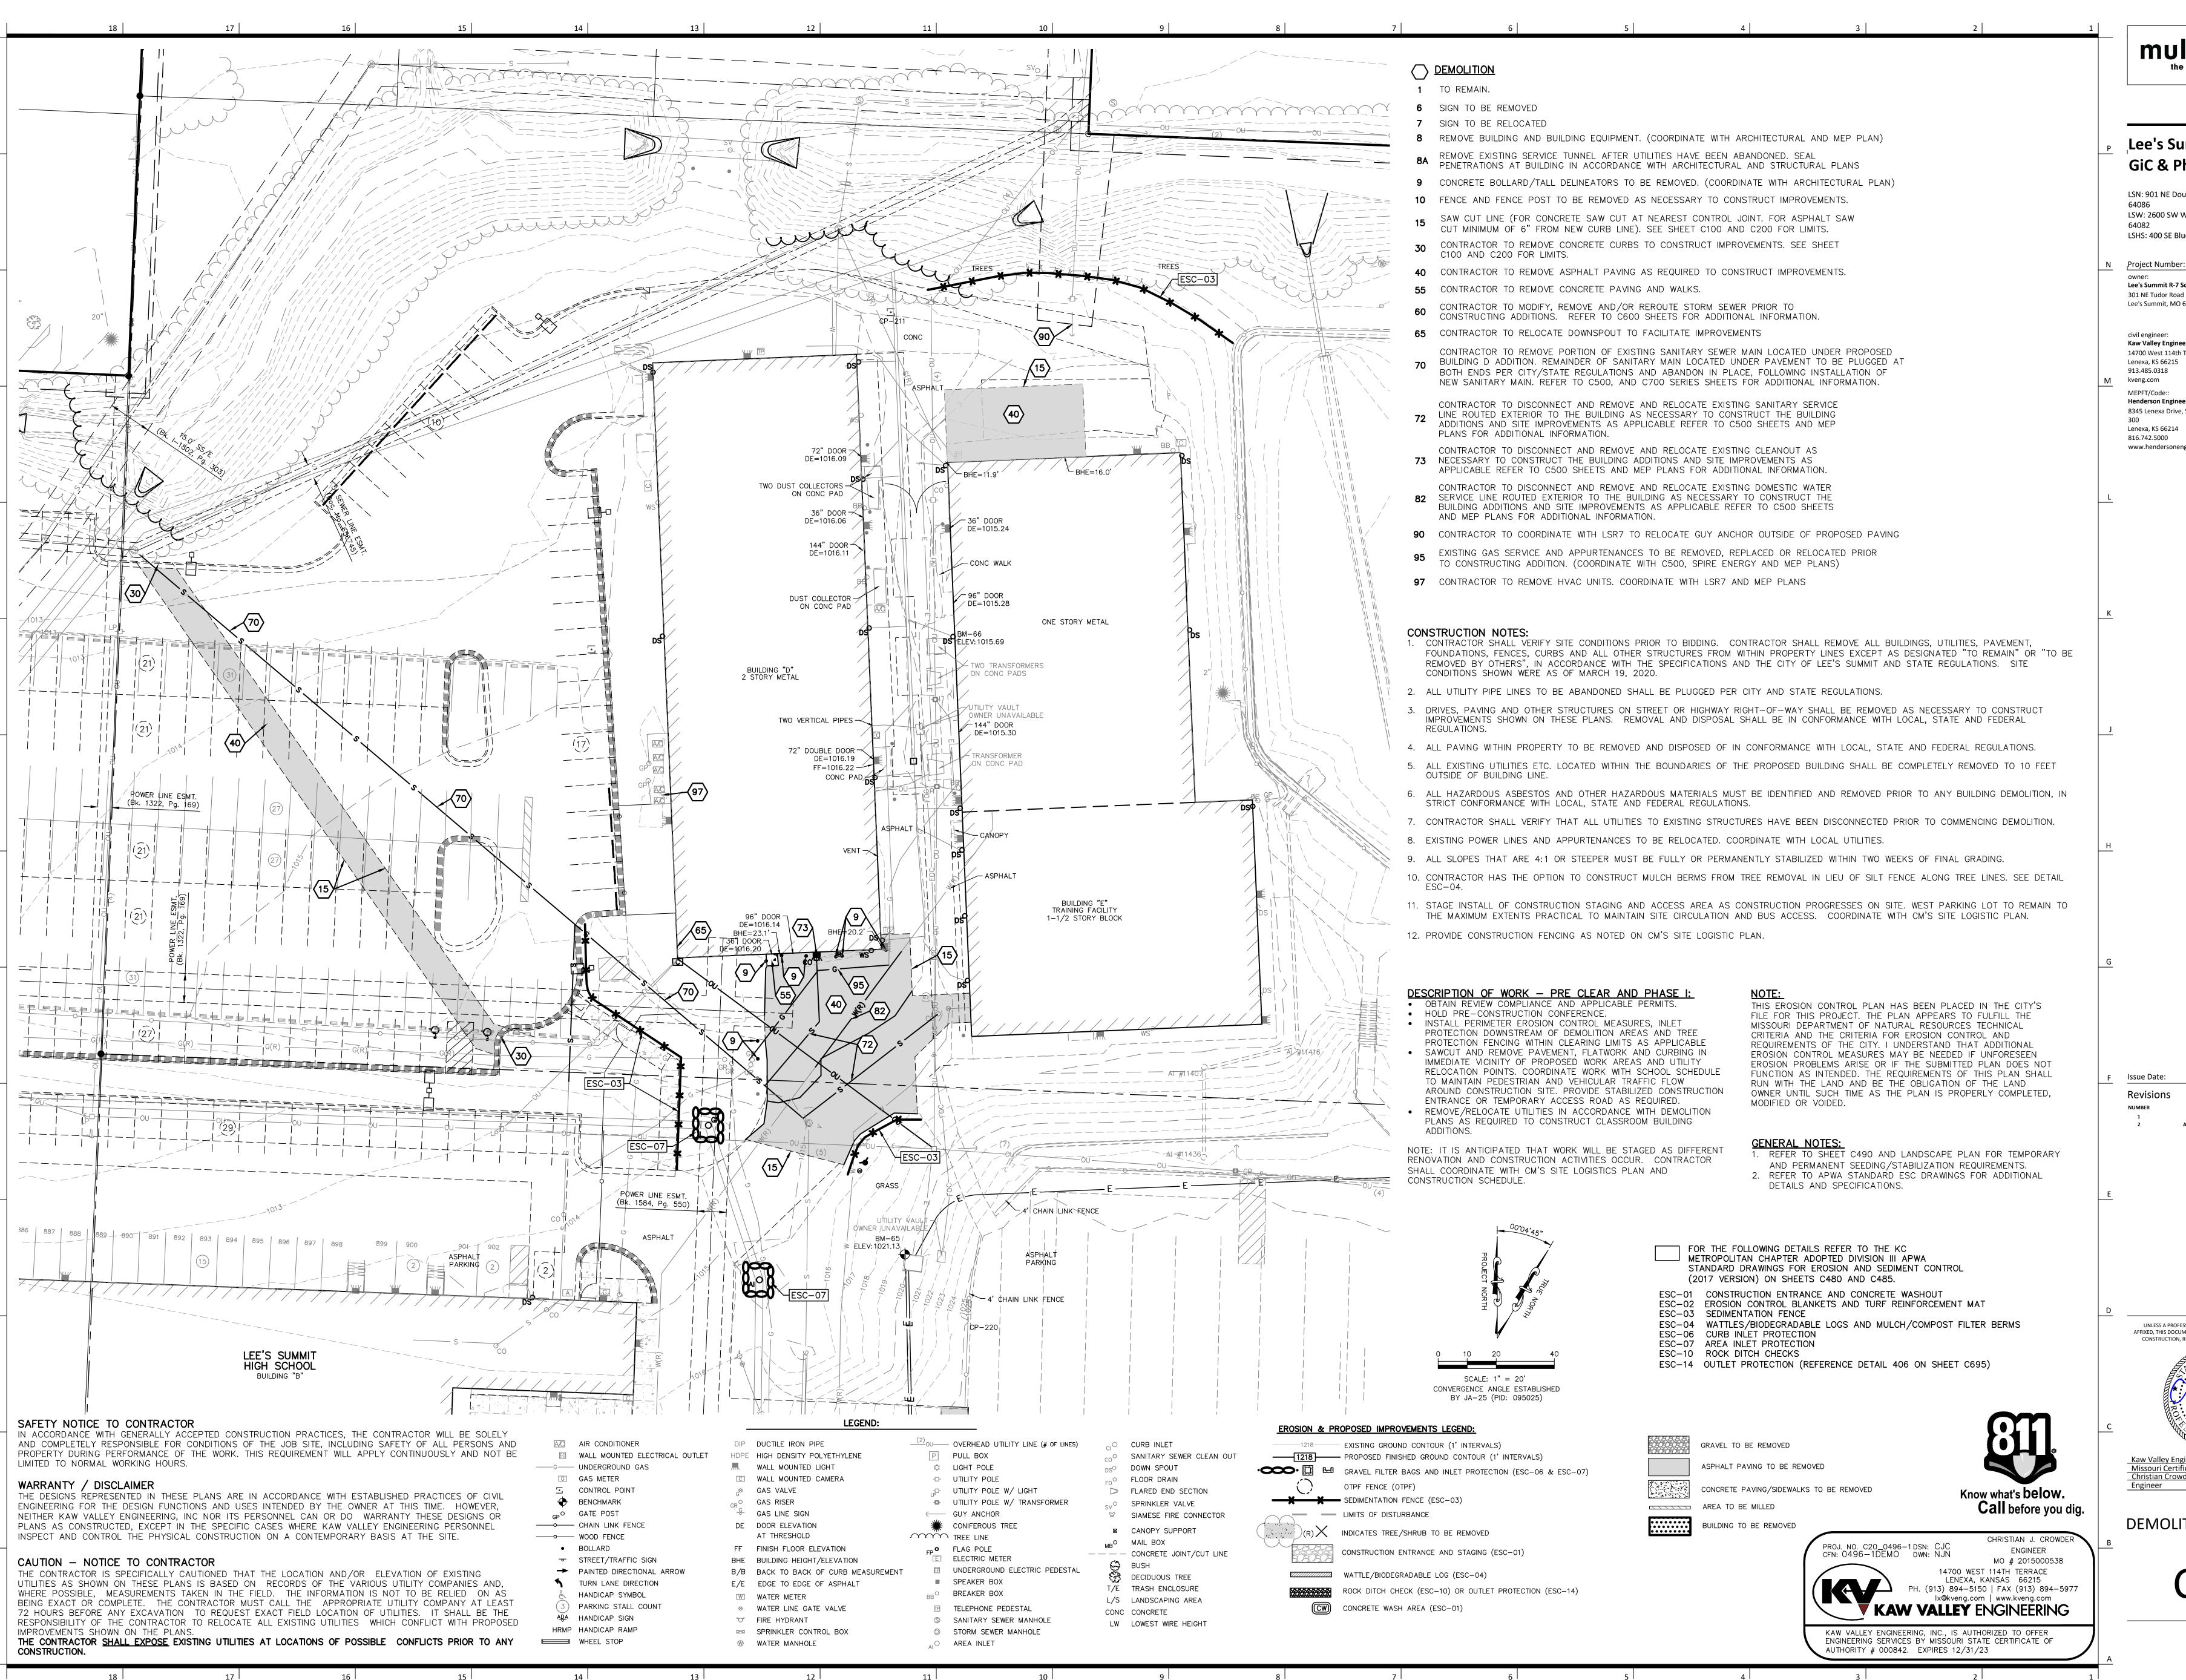

PRINT DATE/TIME:

11/8/2022 3:21 PM

Lee's Summit Robotics, **GiC & Phys Educaiton**

LSN: 901 NE Douglas St., Lee's Summit MO LSW: 2600 SW Ward Rd, Lee's Summit MO

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Lee's Summit R-7 School 4200 Pennsylvania Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655 multi.studio

Bob D. Campbell Kaw Valley Engineering 14700 West 114th Terrace Lenexa, KS 6621 816.531.4144 www.bdc-engrs.con

Henderson Engineers 8345 Lenexa Drive, Suite

Lenexa, KS 66214 www.hendersonengineers.com


September 9, 2022 ADDFNDUM 2

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED. THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

ONAL !

Kaw Valley Engineering, Inc. Missouri Certificate of Authority: 000842
Christian Crowder Date: 9/23/2022
Engineer License No. PE-2015000538

DEMOLITION PLAN

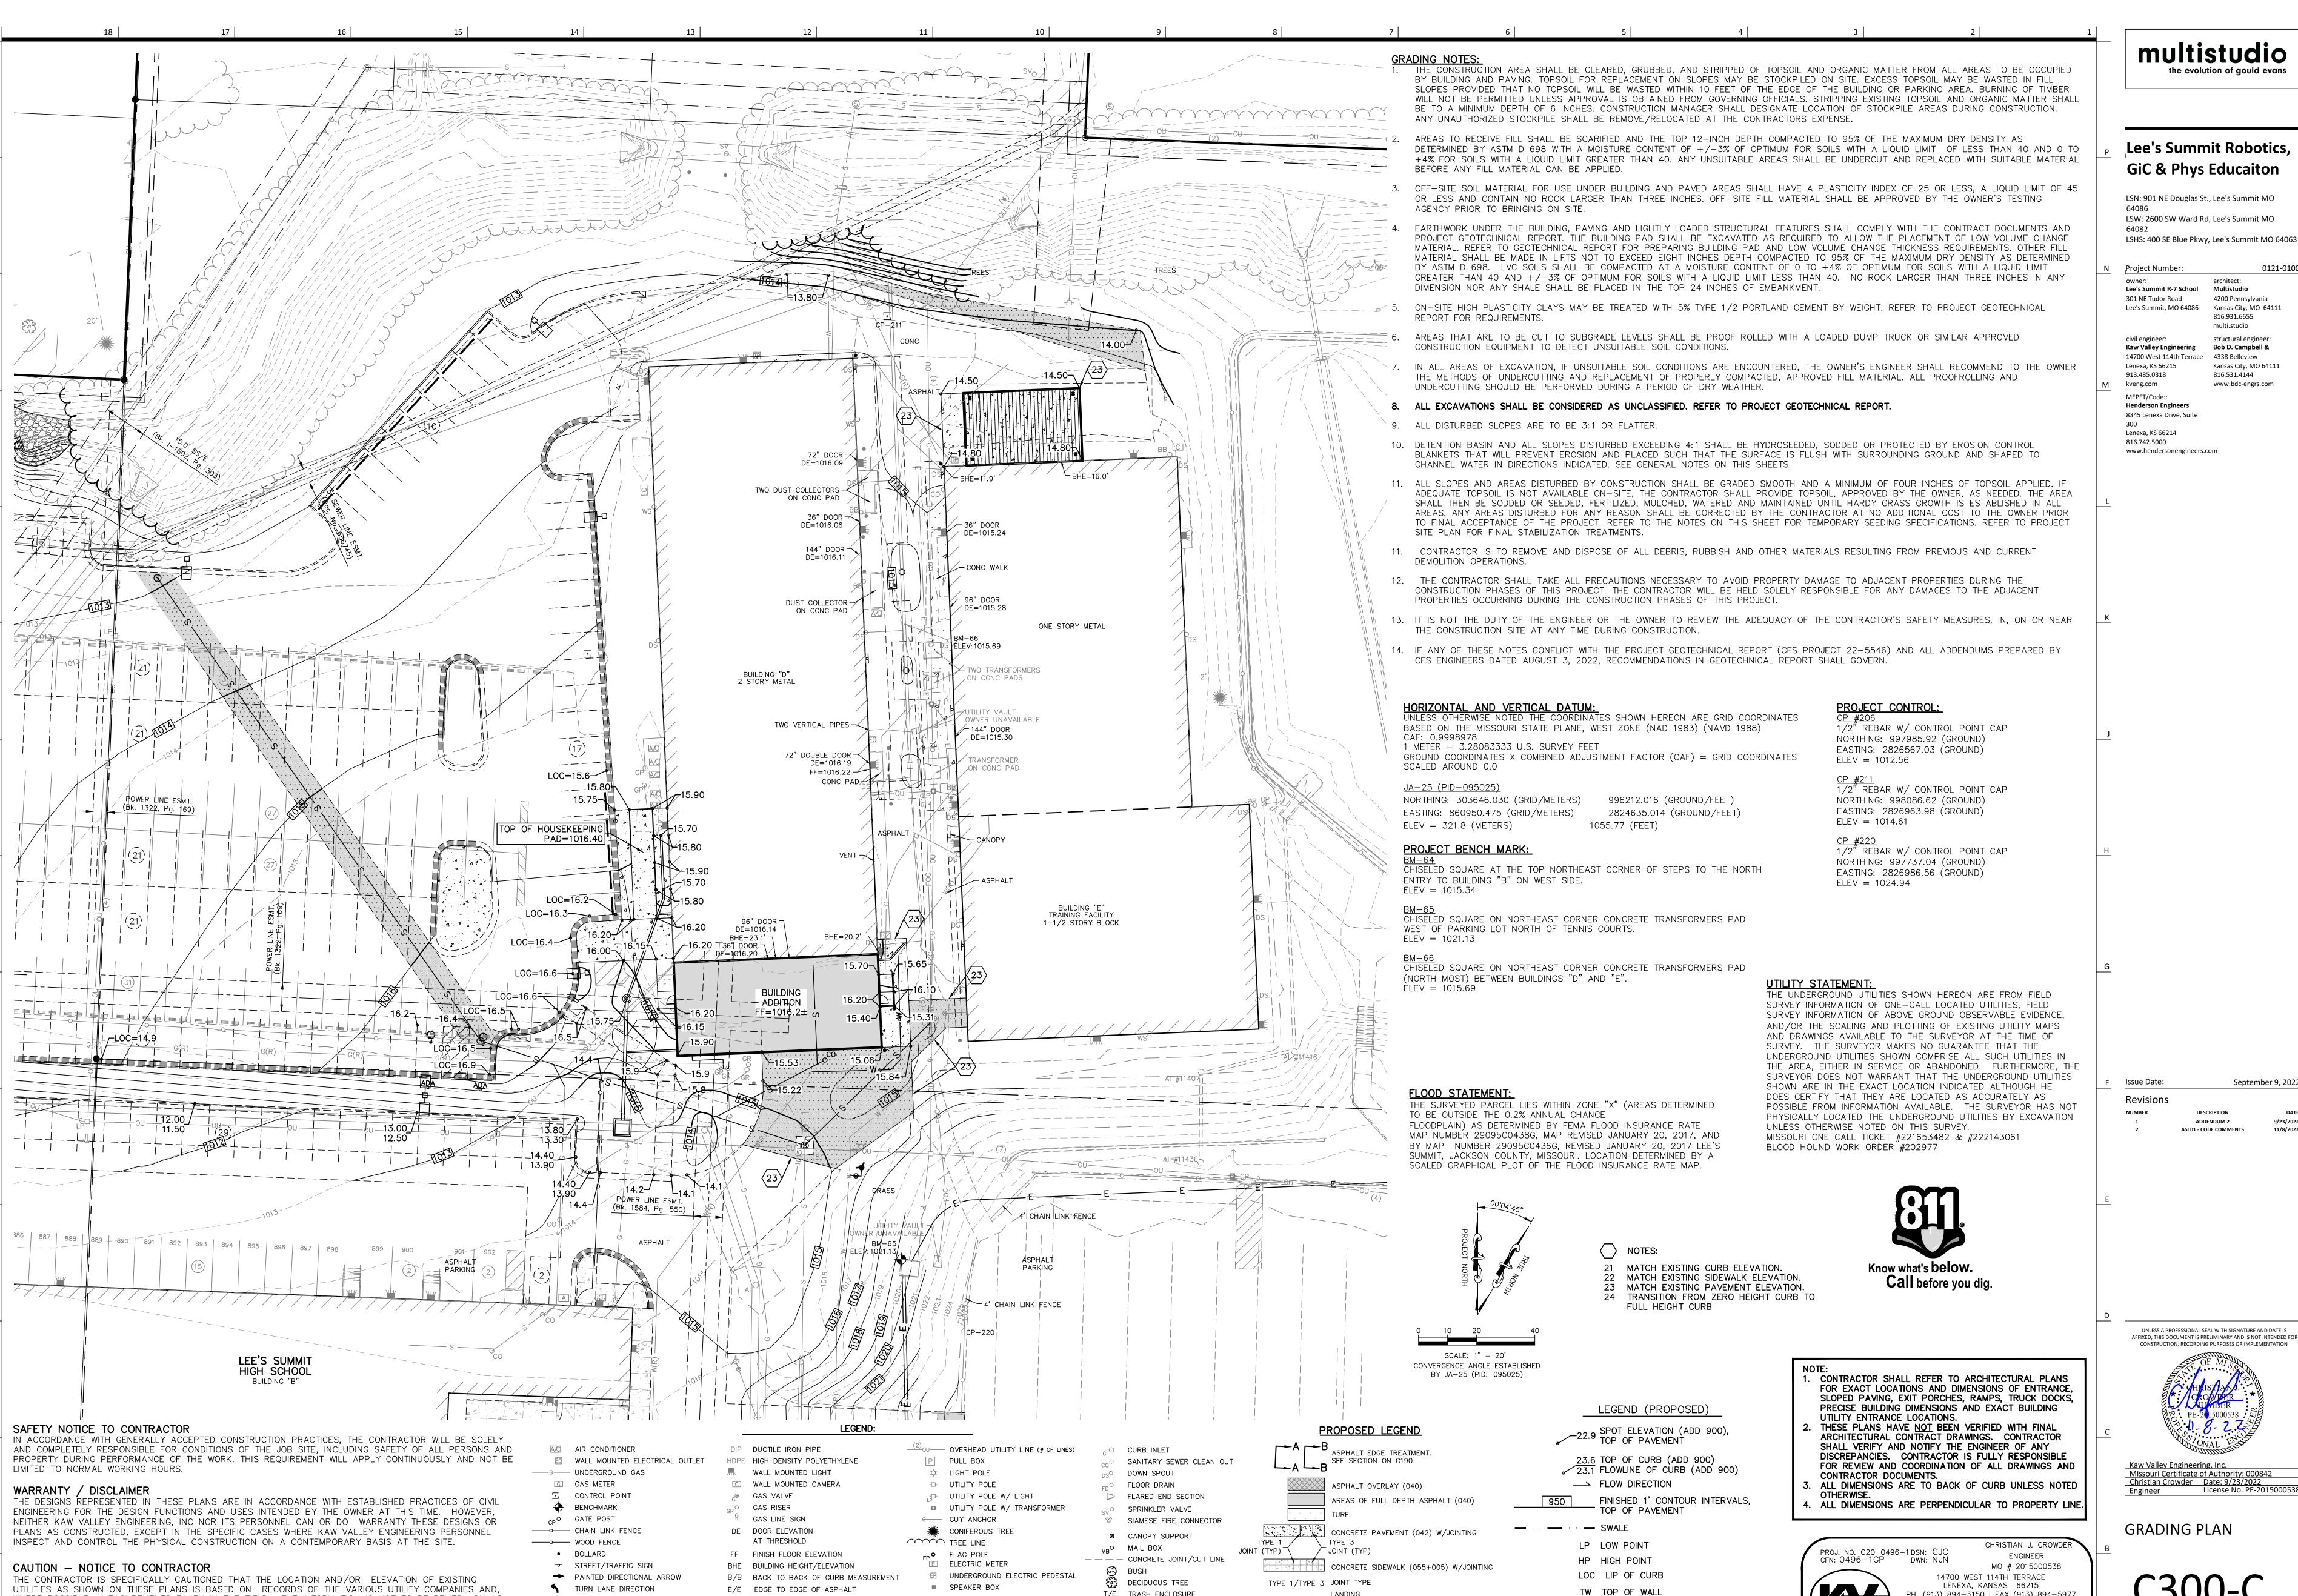

T/E TRASH ENCLOSURE

L/S LANDSCAPING AREA

LW LOWEST WIRE HEIGHT

CONC CONCRETE

BREAKER BOX

AREA INLET

11 |

TELEPHONE PEDESTAL

STORM SEWER MANHOLE

S SANITARY SEWER MANHOLE

10

WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. THE INFORMATION IS NOT TO BE RELIED ON AS

BEING EXACT OR COMPLETE. THE CONTRACTOR MUST CALL THE APPROPRIATE UTILITY COMPANY AT LEAST

72 HOURS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATION OF UTILITIES. IT SHALL BE THE

RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES WHICH CONFLICT WITH PROPOSED

THE CONTRACTOR SHALL EXPOSE EXISTING UTILITIES AT LOCATIONS OF POSSIBLE CONFLICTS PRIOR TO ANY

16

15 [|]

17

IMPROVEMENTS SHOWN ON THE PLANS.

11/8/2022 3:22 PM

CONSTRUCTION.

PRINT DATE/TIME:

HANDICAP SYMBOL

ADA HANDICAP SIGN

HRMP HANDICAP RAMP

₩HEEL STOP

14

PARKING STALL COUNT

W WATER METER

♥ FIRE HYDRANT

W WATER MANHOLE

13

⊗ WATER LINE GATE VALVE

SPRINKLER CONTROL BOX

12

L LANDING

T TRANSITION

PROJECT AREA (LIMITS OF DISTURBANCE)

BW BOTTOM OF WALL

SW SIDEWALK ELEVATION

P PAVEMENT ELEVATION

R RAMP

Lee's Summit Robotics, **GiC & Phys Educaiton**

LSN: 901 NE Douglas St., Lee's Summit MO LSW: 2600 SW Ward Rd, Lee's Summit MO

Project Number: Lee's Summit R-7 School 301 NE Tudor Road 4200 Pennsylvania Lee's Summit, MO 64086 Kansas City, MO 64111

816.931.6655

multi.studio structural enginee Kaw Valley Engineering Bob D. Campbell & 14700 West 114th Terrace Lenexa, KS 66215 Kansas City, MO 6413 913.485.0318 816.531.4144 www.bdc-engrs.com

kveng.com MEPFT/Code:: **Henderson Engineers** 8345 Lenexa Drive, Suite Lenexa, KS 66214

816.742.5000 www.hendersonengineers.com

Issue Date: September 9, 2022

ADDENDUM 2

Kaw Valley Engineering, Inc. Missouri Certificate of Authority: 000842
Christian Crowder Date: 9/23/2022
Engineer License No. PE-2015000538

PH. (913) 894-5150 | FAX (913) 894-5977

KAW VALLEY ENGINEERING

KAW VALLEY ENGINEERING, INC., IS AUTHORIZED TO OFFER


AUTHORITY # 000842. EXPIRES 12/31/23

ENGINEERING SERVICES BY MISSOURI STATE CERTIFICATE OF

lx@kveng.com | www.kveng.com

GRADING PLAN

MONAL !

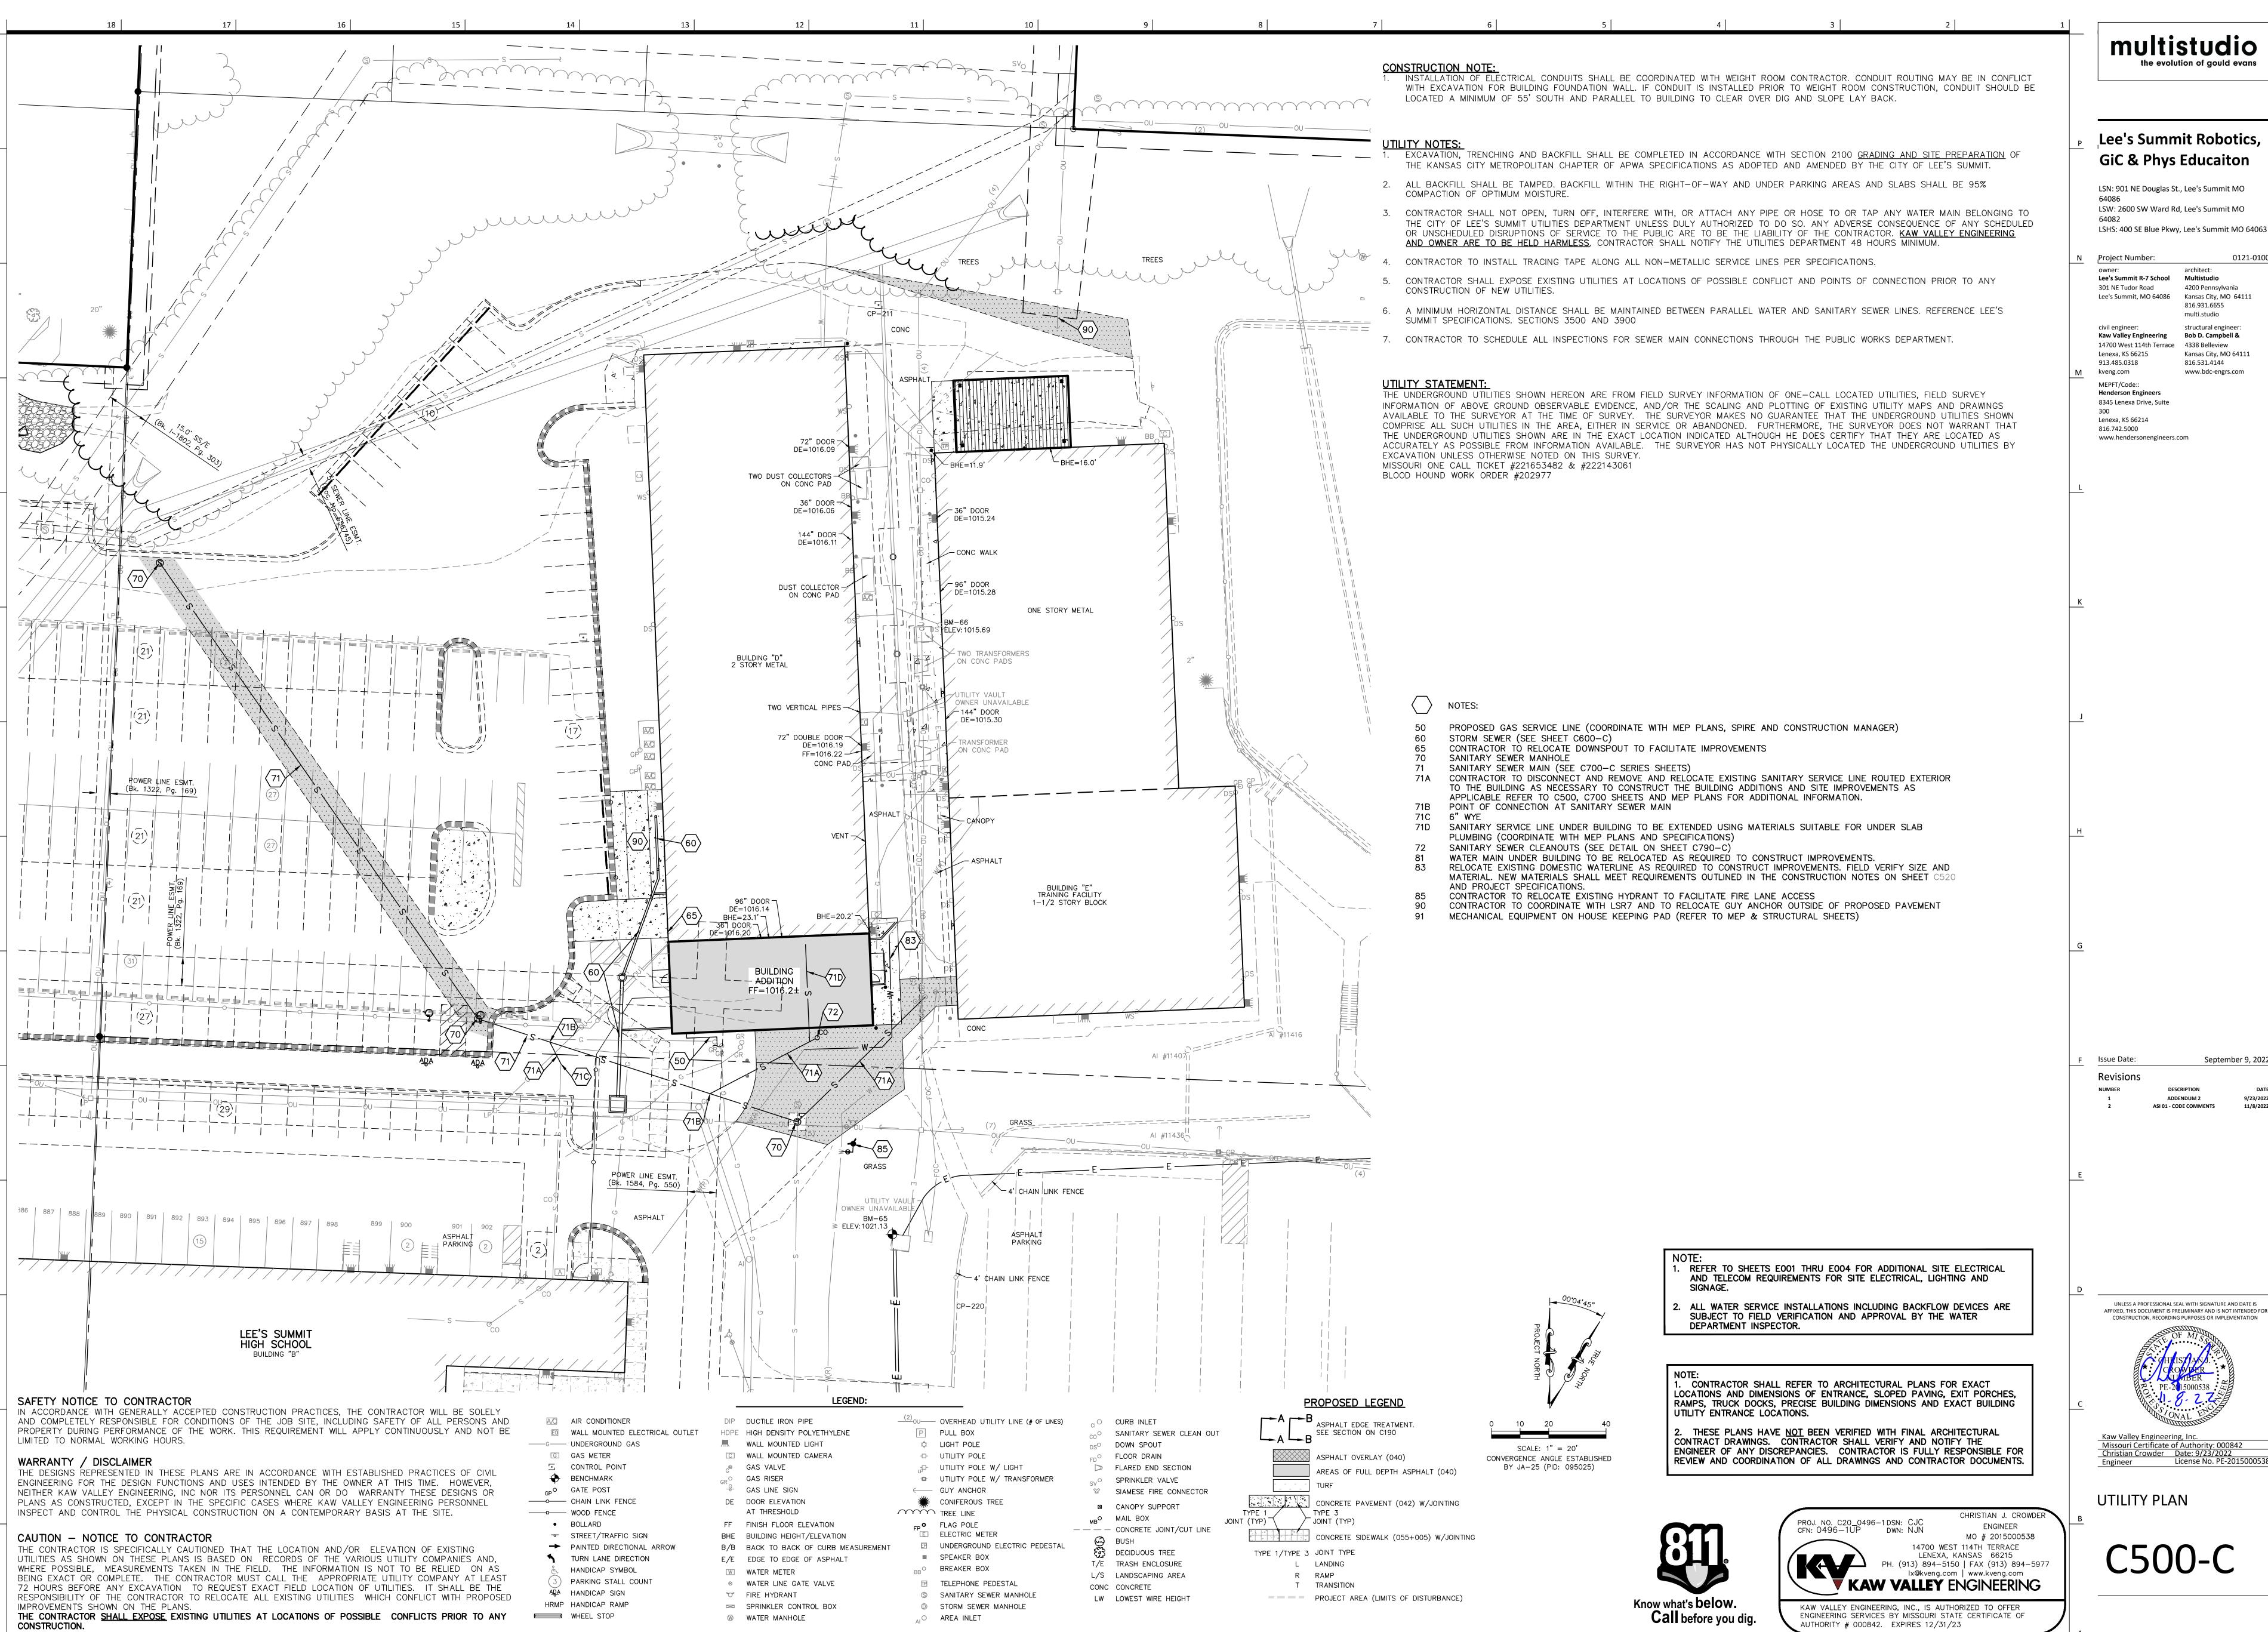

17

PRINT DATE/TIME:

11/8/2022 3:22 PM

15

14

16 [|]

13

12

11 |

10

Lee's Summit Robotics, **GiC & Phys Educaiton**

LSN: 901 NE Douglas St., Lee's Summit MO LSW: 2600 SW Ward Rd, Lee's Summit MO

Project Number: Lee's Summit R-7 School 301 NE Tudor Road 4200 Pennsylvania Lee's Summit, MO 64086 Kansas City, MO 64111

816.931.6655

multi.studio structural engineer Kaw Valley Engineering Bob D. Campbell & 14700 West 114th Terrace Lenexa, KS 66215 Kansas City, MO 6411 913.485.0318 816.531.4144 www.bdc-engrs.com

kveng.com MEPFT/Code:: **Henderson Engineers** 8345 Lenexa Drive, Suite Lenexa, KS 66214

www.hendersonengineers.com

ADDENDUM 2


September 9, 2022

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED. THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

Kaw Valley Engineering, Inc. Missouri Certificate of Authority: 000842
Christian Crowder Date: 9/23/2022
Engineer License No. PE-2015000538

DONAL ELE

UTILITY PLAN

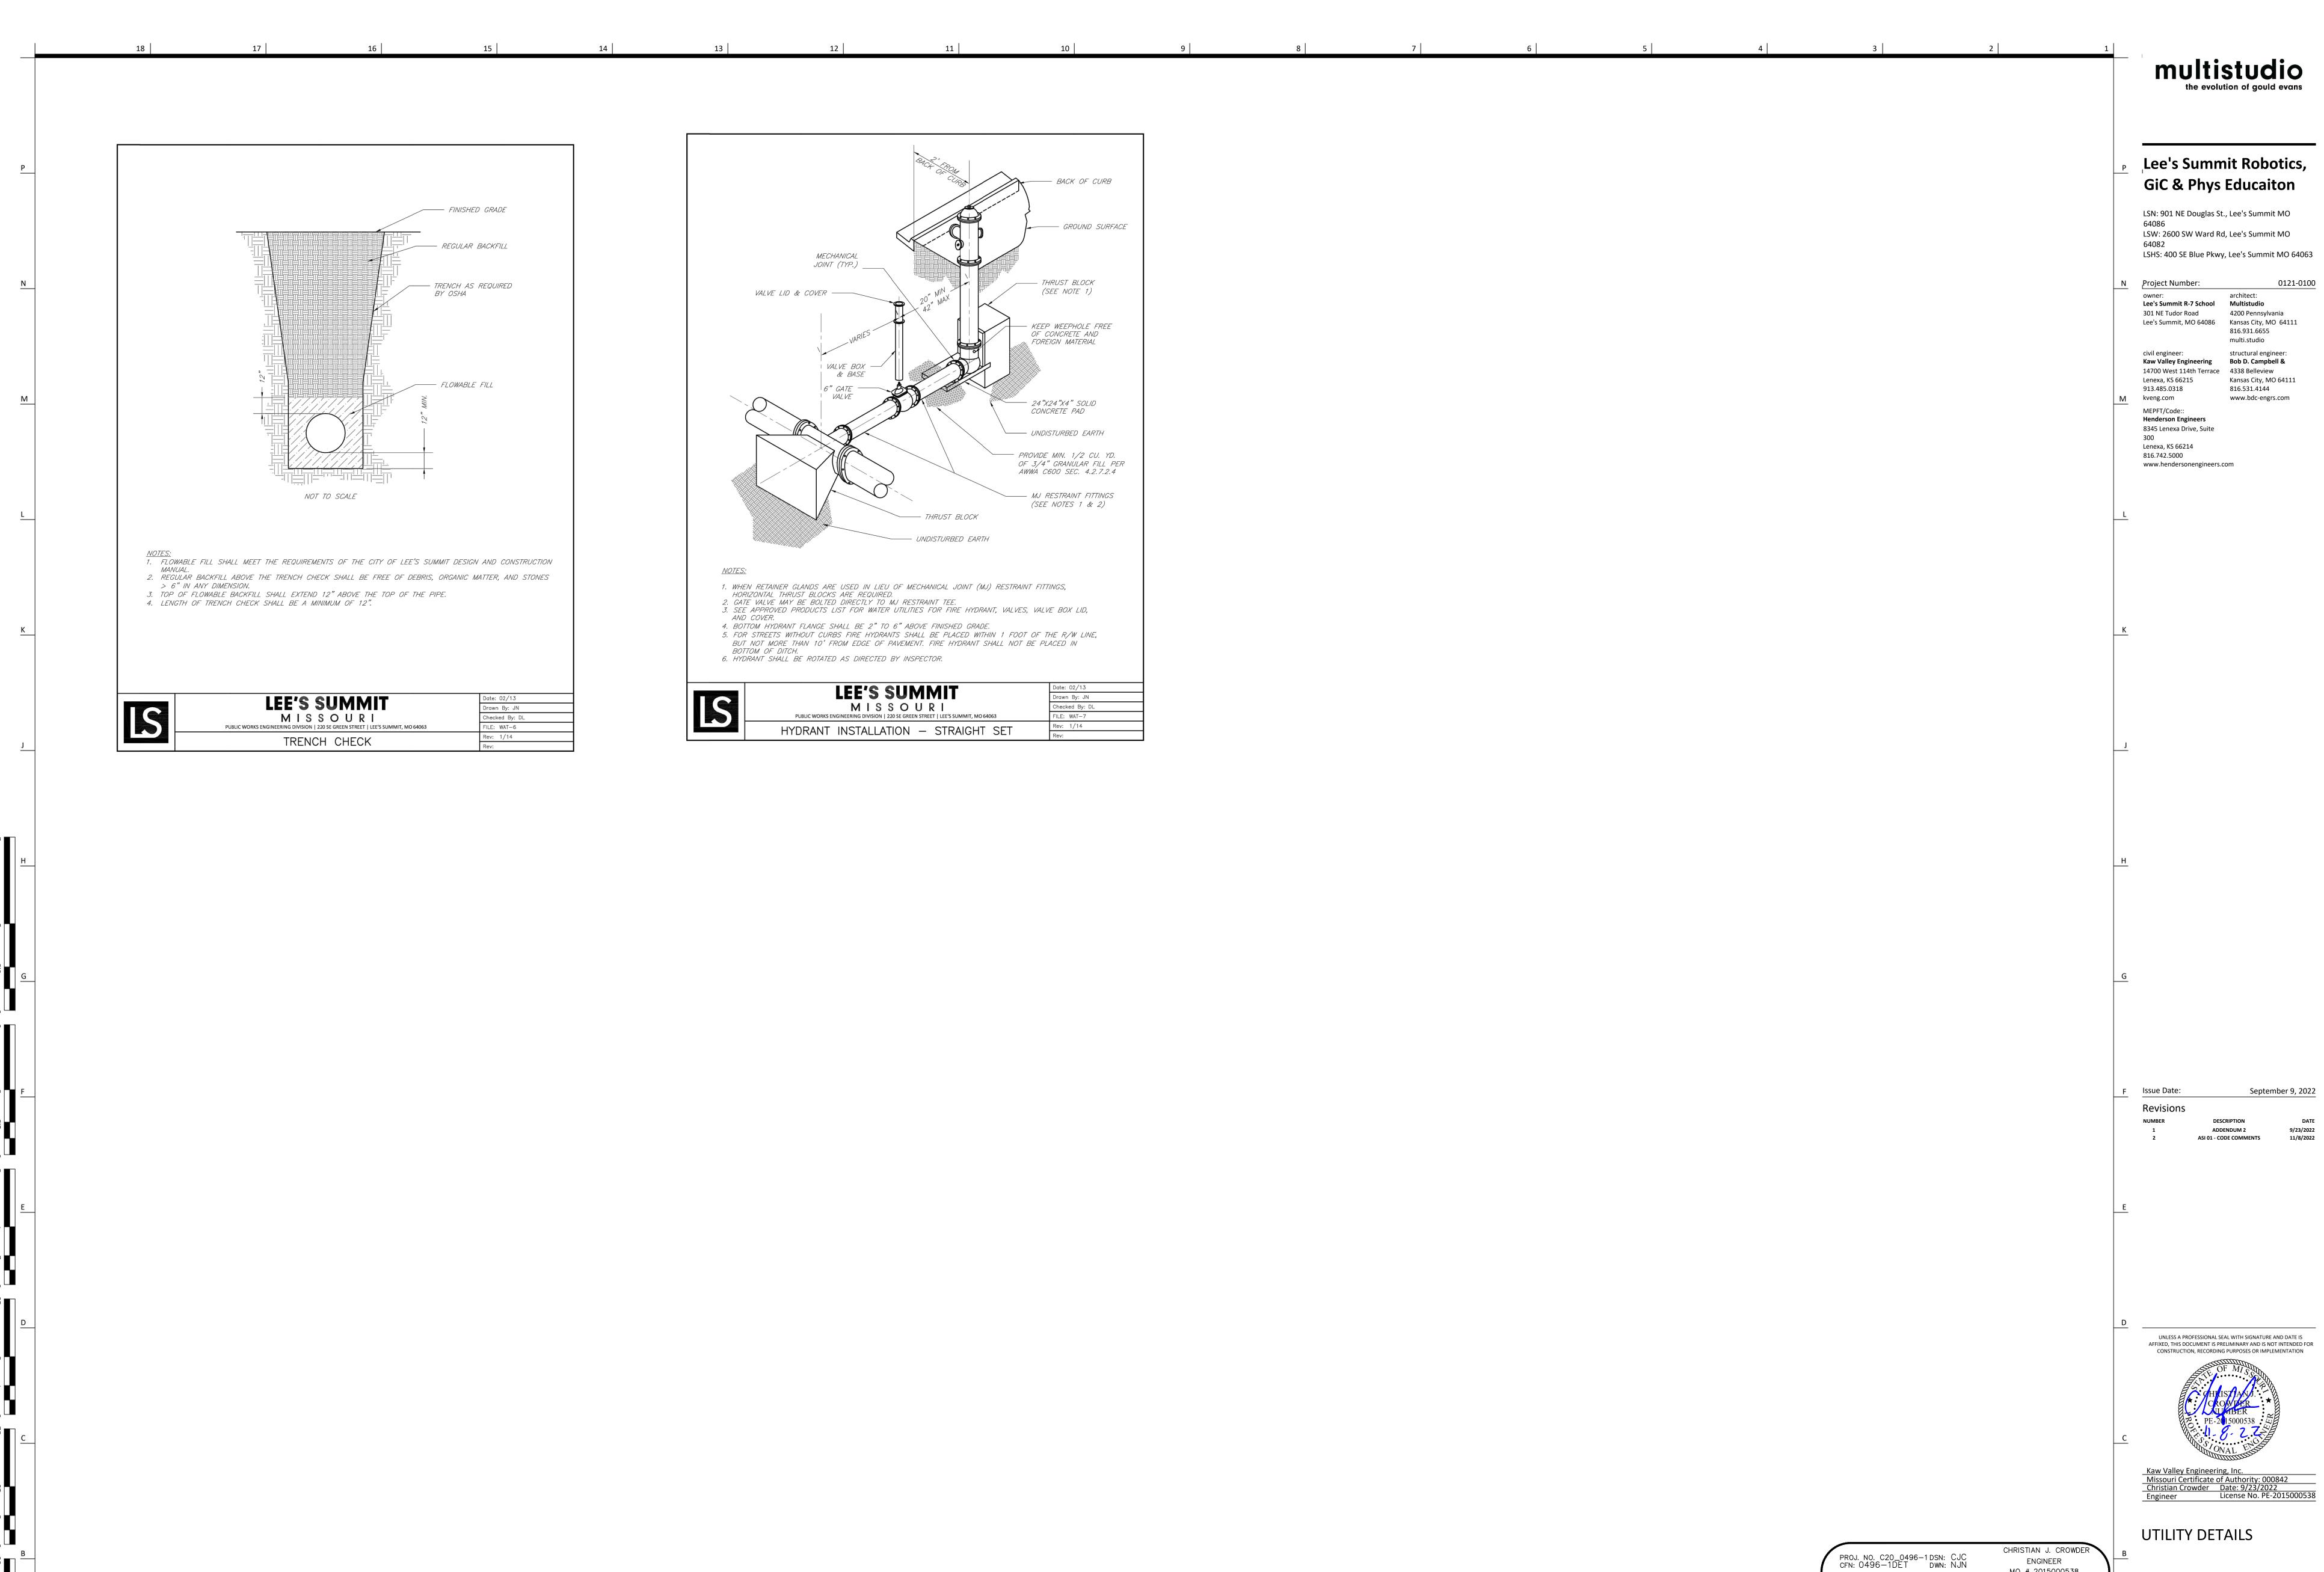

| 18 | PRINT DATE/TIME: 11/8/2022 3:22 PM


9/23/2022

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

C590-C

ENGINEER MO # 2015000538

KAW VALLEY ENGINEERING, INC., IS AUTHORIZED TO OFFER ENGINEERING SERVICES BY MISSOURI STATE CERTIFICATE OF AUTHORITY # 000842. EXPIRES 12/31/23

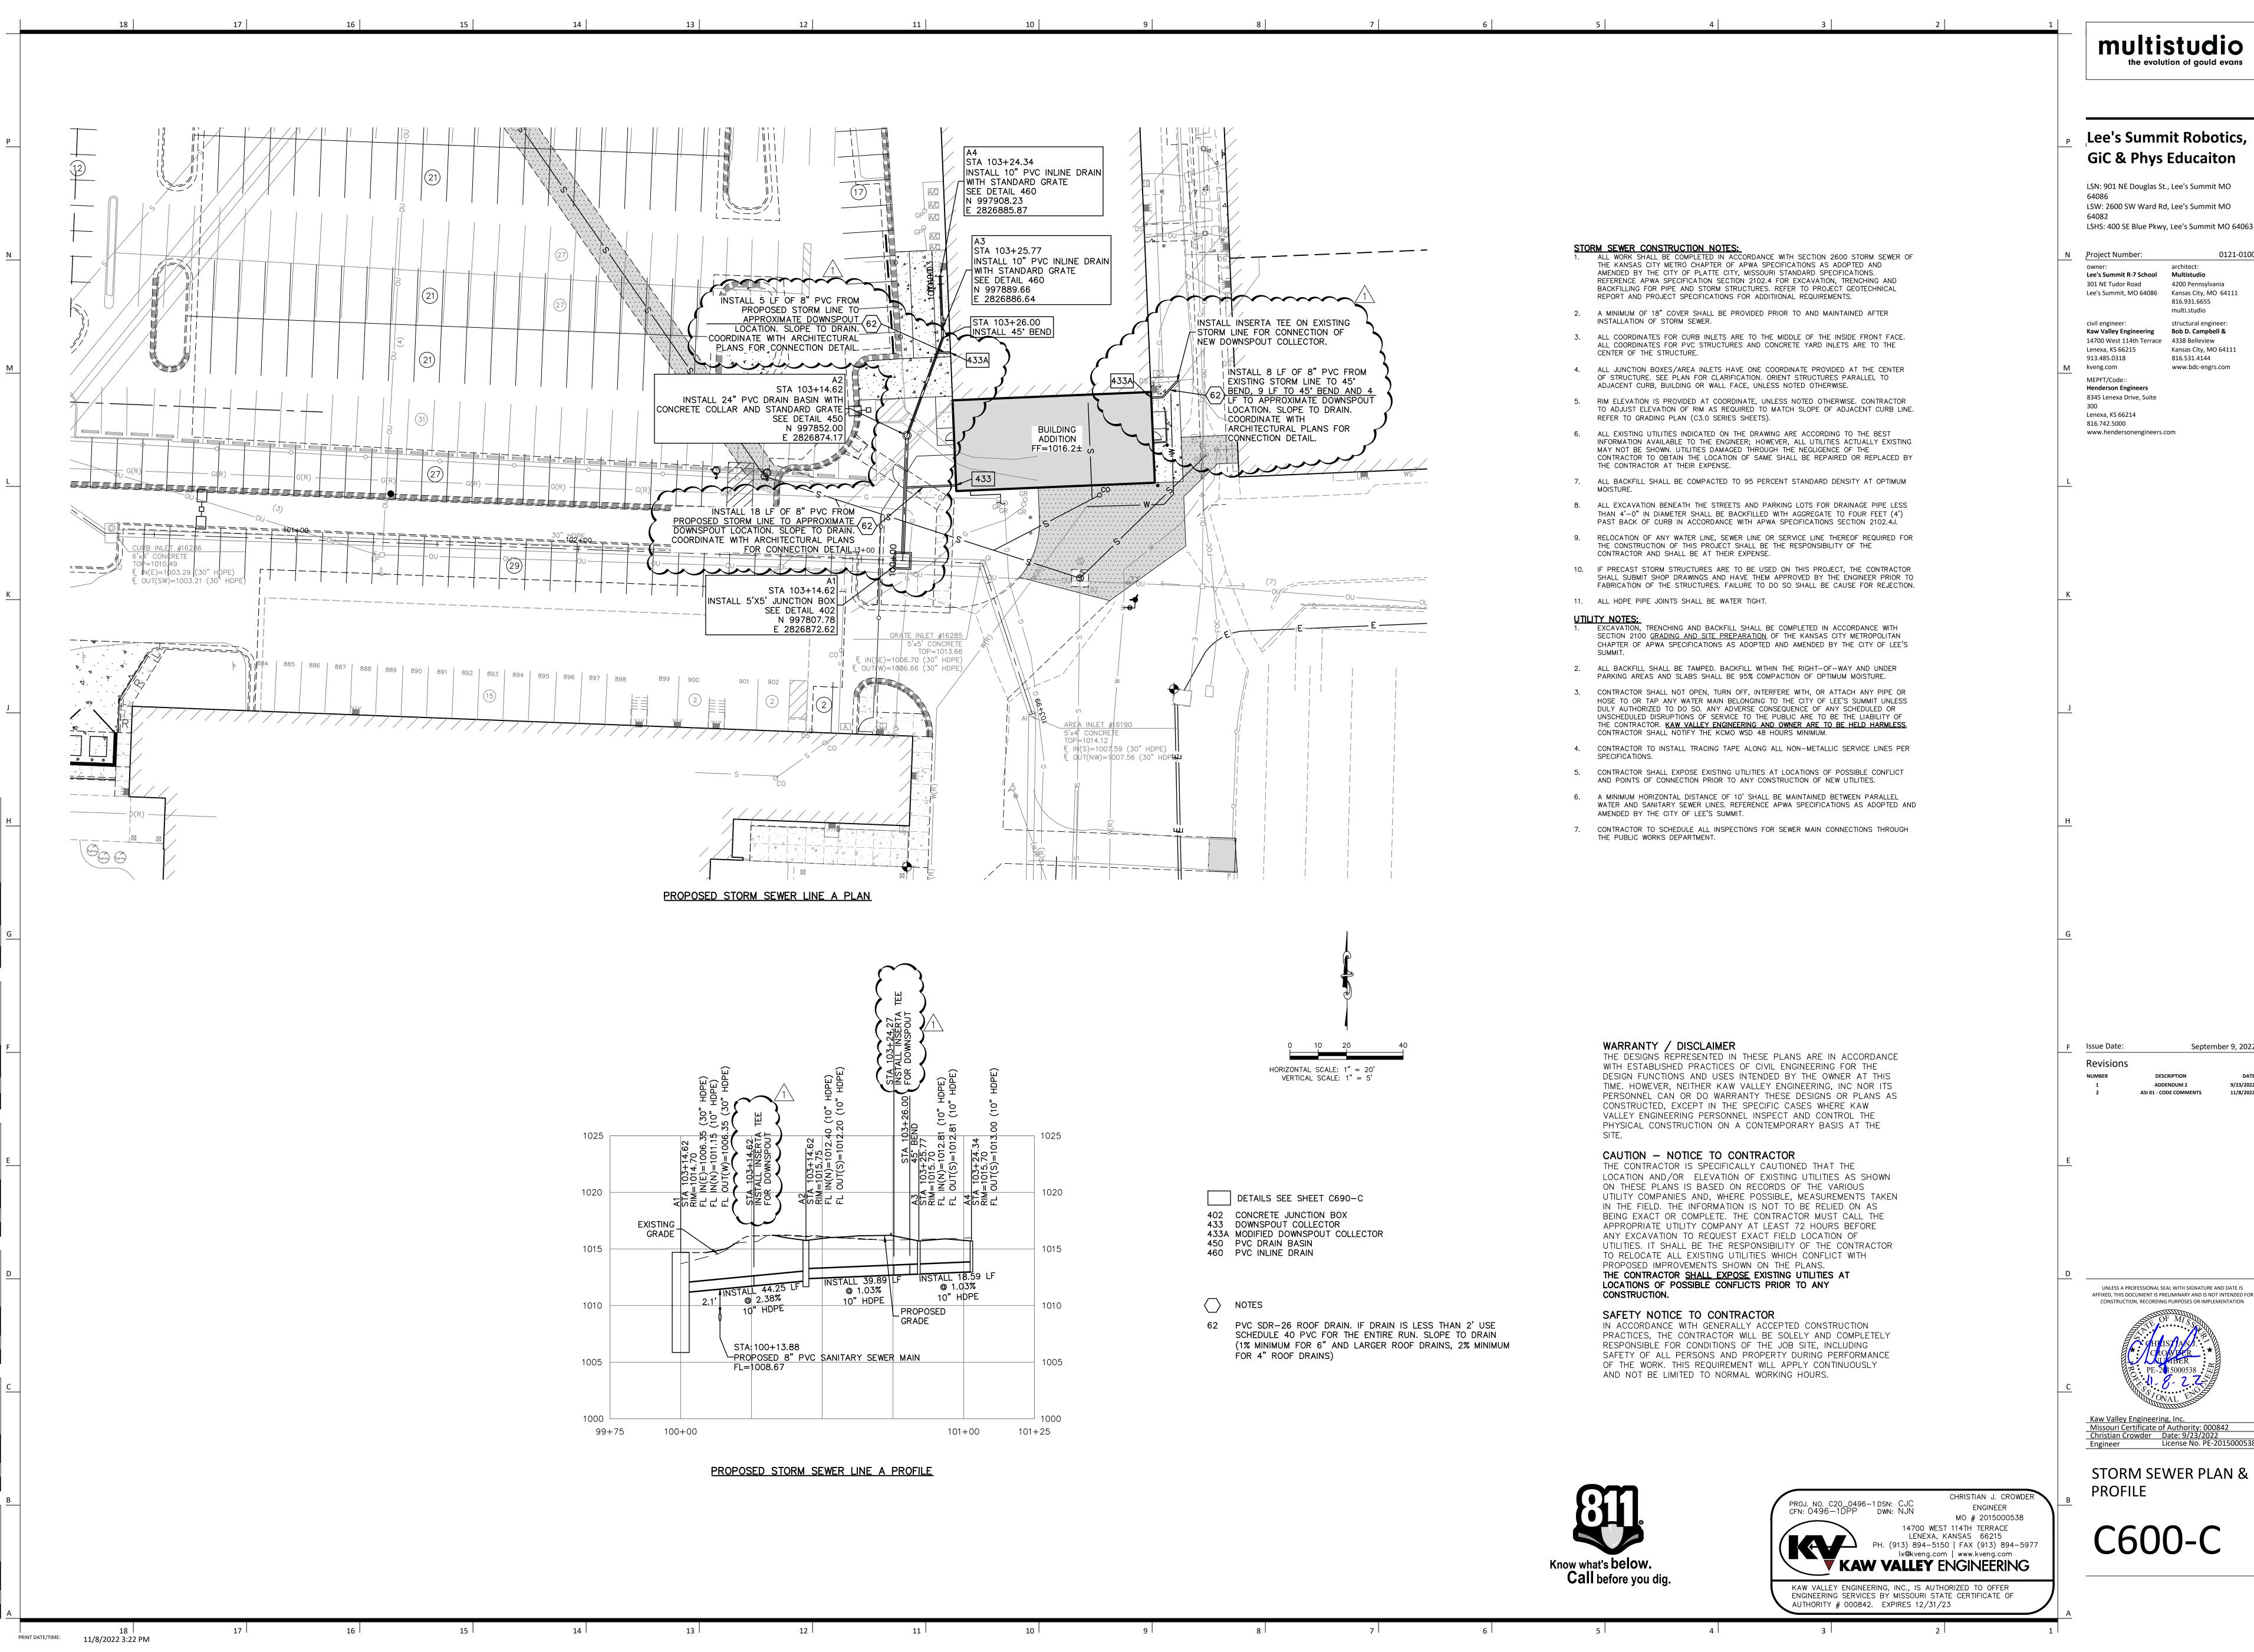

the evolution of gould evans

Lee's Summit Robotics, **GiC & Phys Educaiton**

> LSN: 901 NE Douglas St., Lee's Summit MO LSW: 2600 SW Ward Rd, Lee's Summit MO

Project Number: Lee's Summit R-7 School Multistudio 4200 Pennsylvania 301 NE Tudor Road Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655

multi.studio structural engineer Kaw Valley Engineering Bob D. Campbell & 14700 West 114th Terrace 4338 Belleview Lenexa, KS 66215 Kansas City, MO 64111 816.531.4144 www.bdc-engrs.com

MEPFT/Code:: **Henderson Engineers** 8345 Lenexa Drive, Suite

816.742.5000 www.hendersonengineers.com

Issue Date: September 9, 2022 Revisions

ADDENDUM 2 9/23/2022 ASI 01 - CODE COMMENTS


UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



Kaw Valley Engineering, Inc. Missouri Certificate of Authority: 000842
Christian Crowder Date: 9/23/2022
Engineer License No. PE-2015000538

STORM SEWER PLAN & **PROFILE**

C600-C

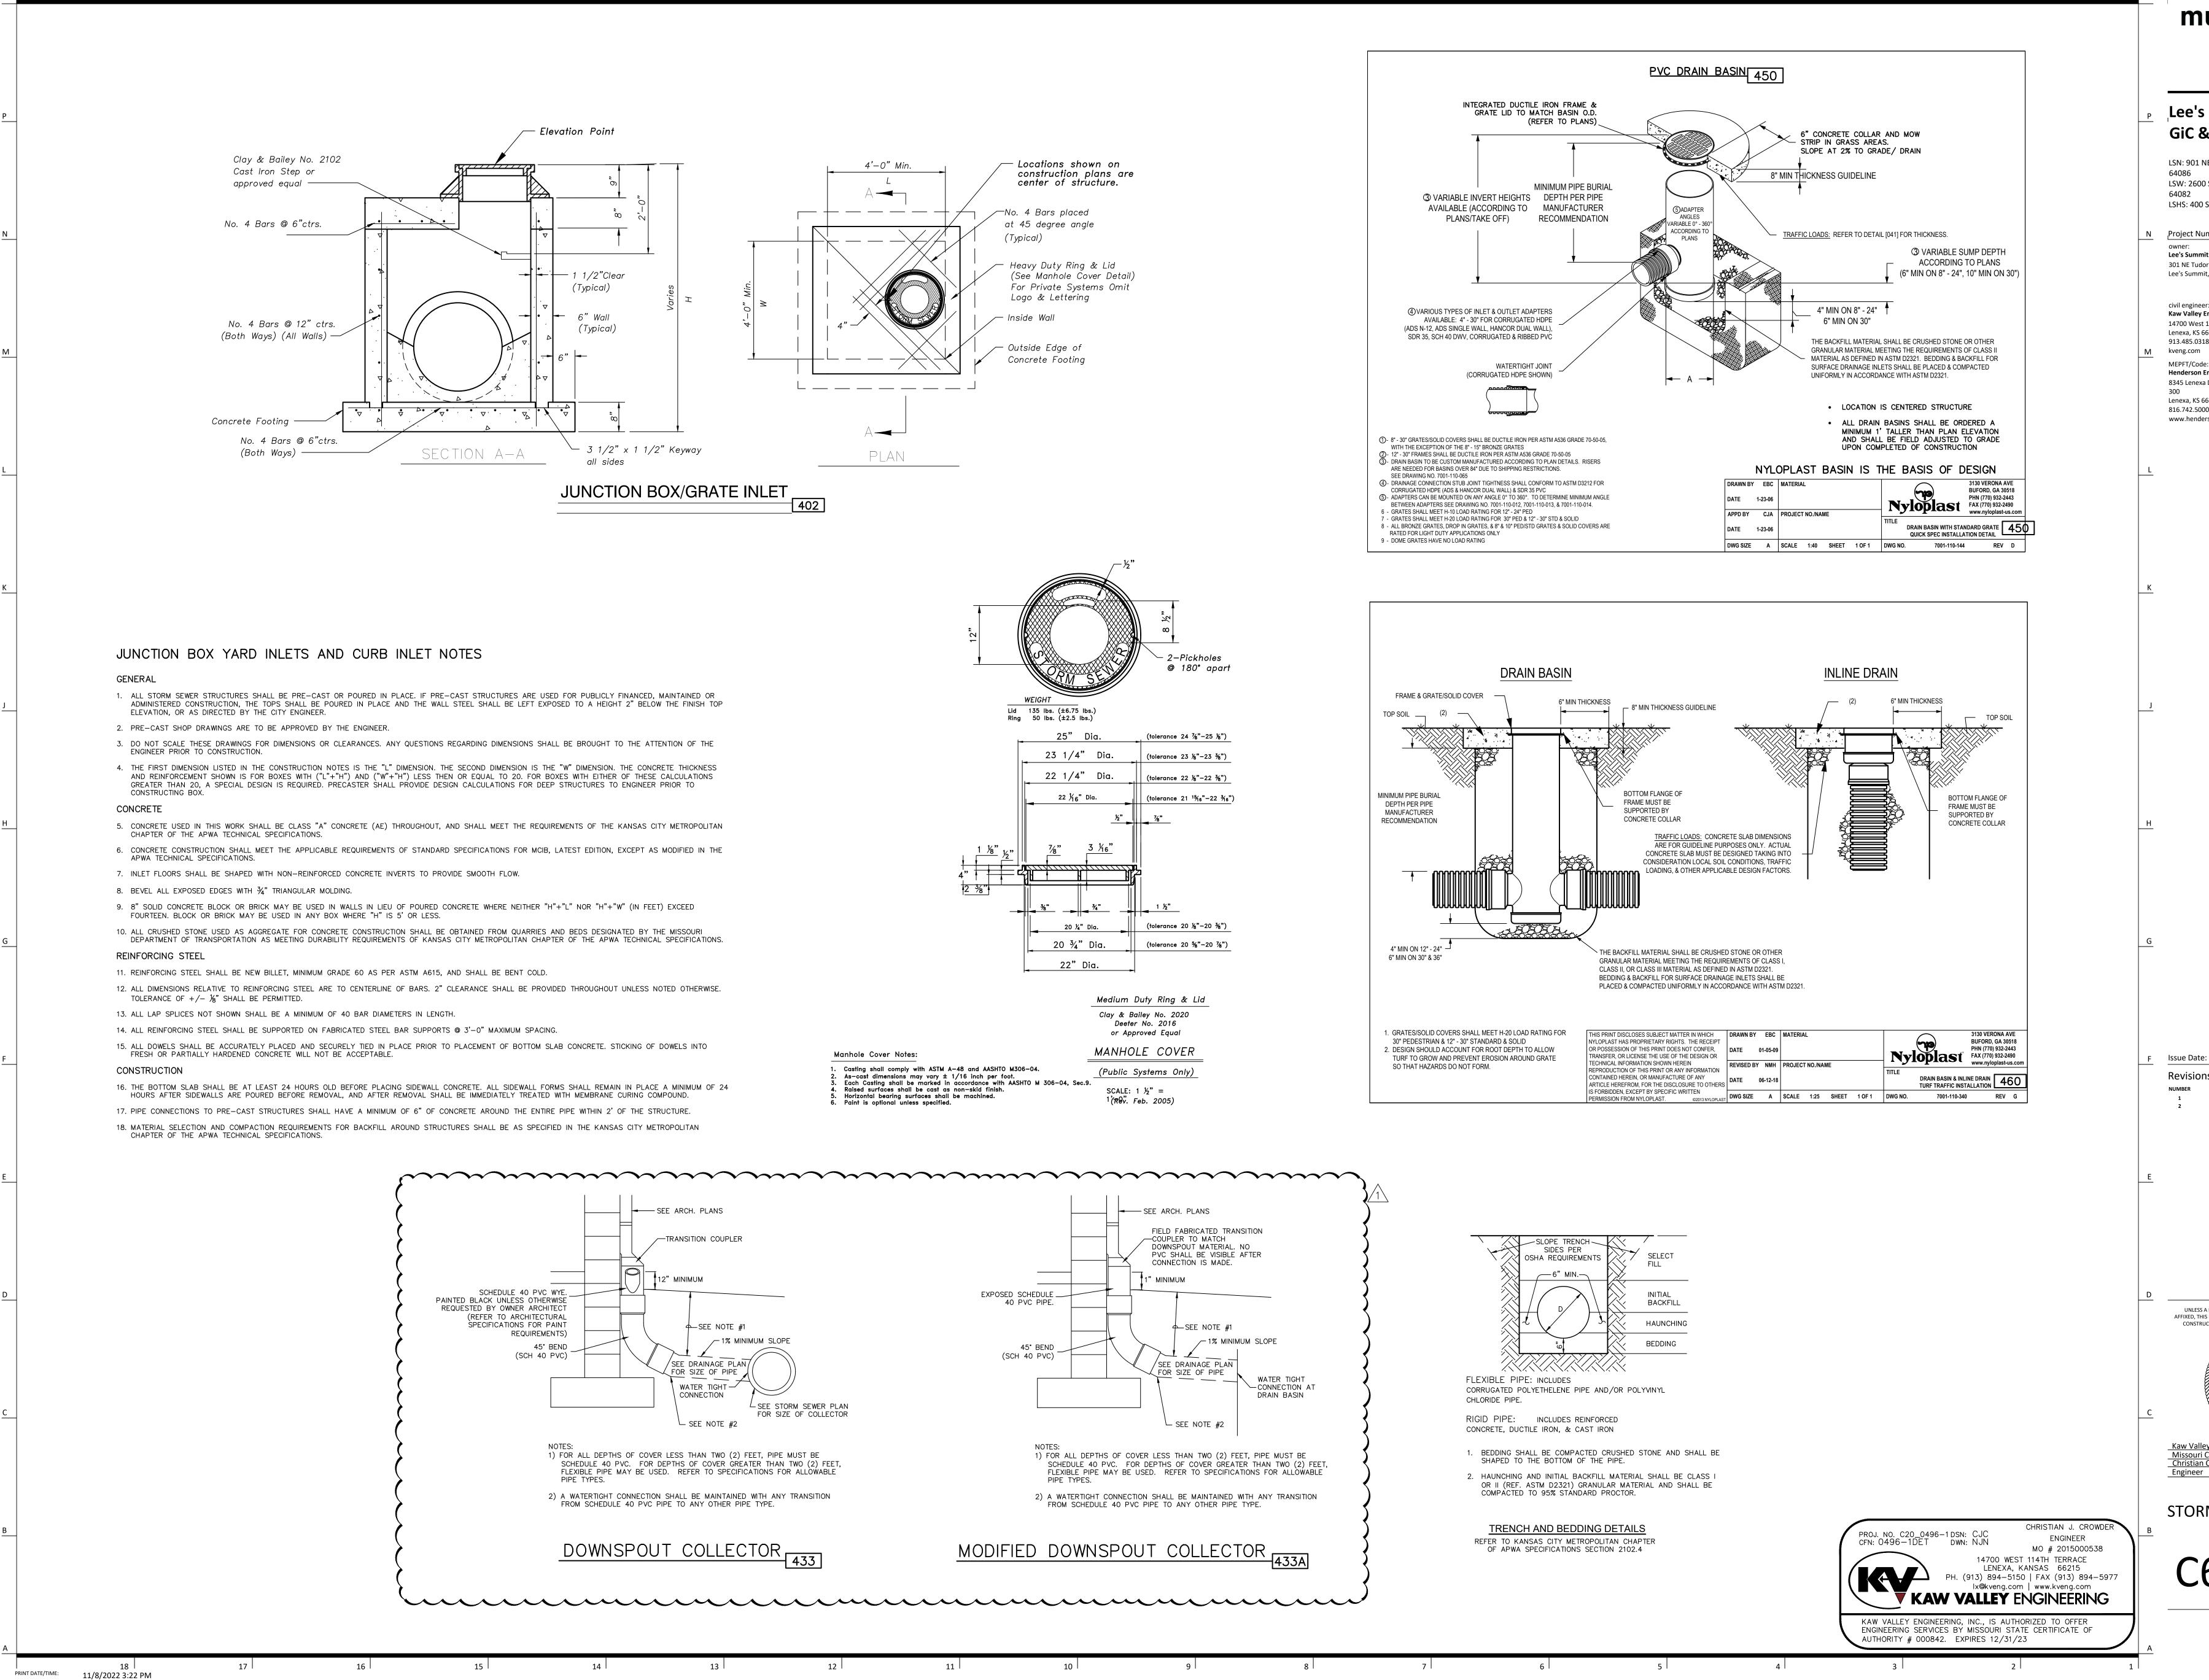

multistudio

Lee's Summit Robotics,
GiC & Phys Educaiton

LSN: 901 NE Douglas St., Lee's Summit MO 64086 LSW: 2600 SW Ward Rd, Lee's Summit MO 64082

Comparison of the Comparison o

Lee's Summit R-7 School
301 NE Tudor Road
Lee's Summit, MO 64086

Civil engineer:
Kaw Valley Engineering
14700 West 114th Terrace

Multistudio
4200 Pennsylvania
Kansas City, MO 64111
816.931.6655
multi.studio

structural engineer:
Bob D. Campbell &
4338 Belleview

Kaw Valley Engineering
14700 West 114th Terrace
Lenexa, KS 66215
913.485.0318
kveng.com
MEPFT/Code::
Henderson Engineers

Bob D. Campbell &
4338 Belleview
Kansas City, MO 64111
816.531.4144
www.bdc-engrs.com

kveng.com www.bdc-eng
MEPFT/Code::
Henderson Engineers
8345 Lenexa Drive, Suite
300
Lenexa, KS 66214

300 Lenexa, KS 66214 816.742.5000 www.hendersonengineers.com

Revisions

NUMBER DESCRIPTION DATE

1 ADDENDUM 2 9/23/2022
2 ASI 01 - CODE COMMENTS 11/8/2022

September 9, 2022

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INT

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

OF MISSIONAL

PE-2015000538

Kaw Valley Engineering, Inc.


Missouri Certificate of Authority: 000842


Christian Crowder Date: 9/23/2022


Engineer License No. PE-2015000538

STORM SEWER DETAILS

C690-C

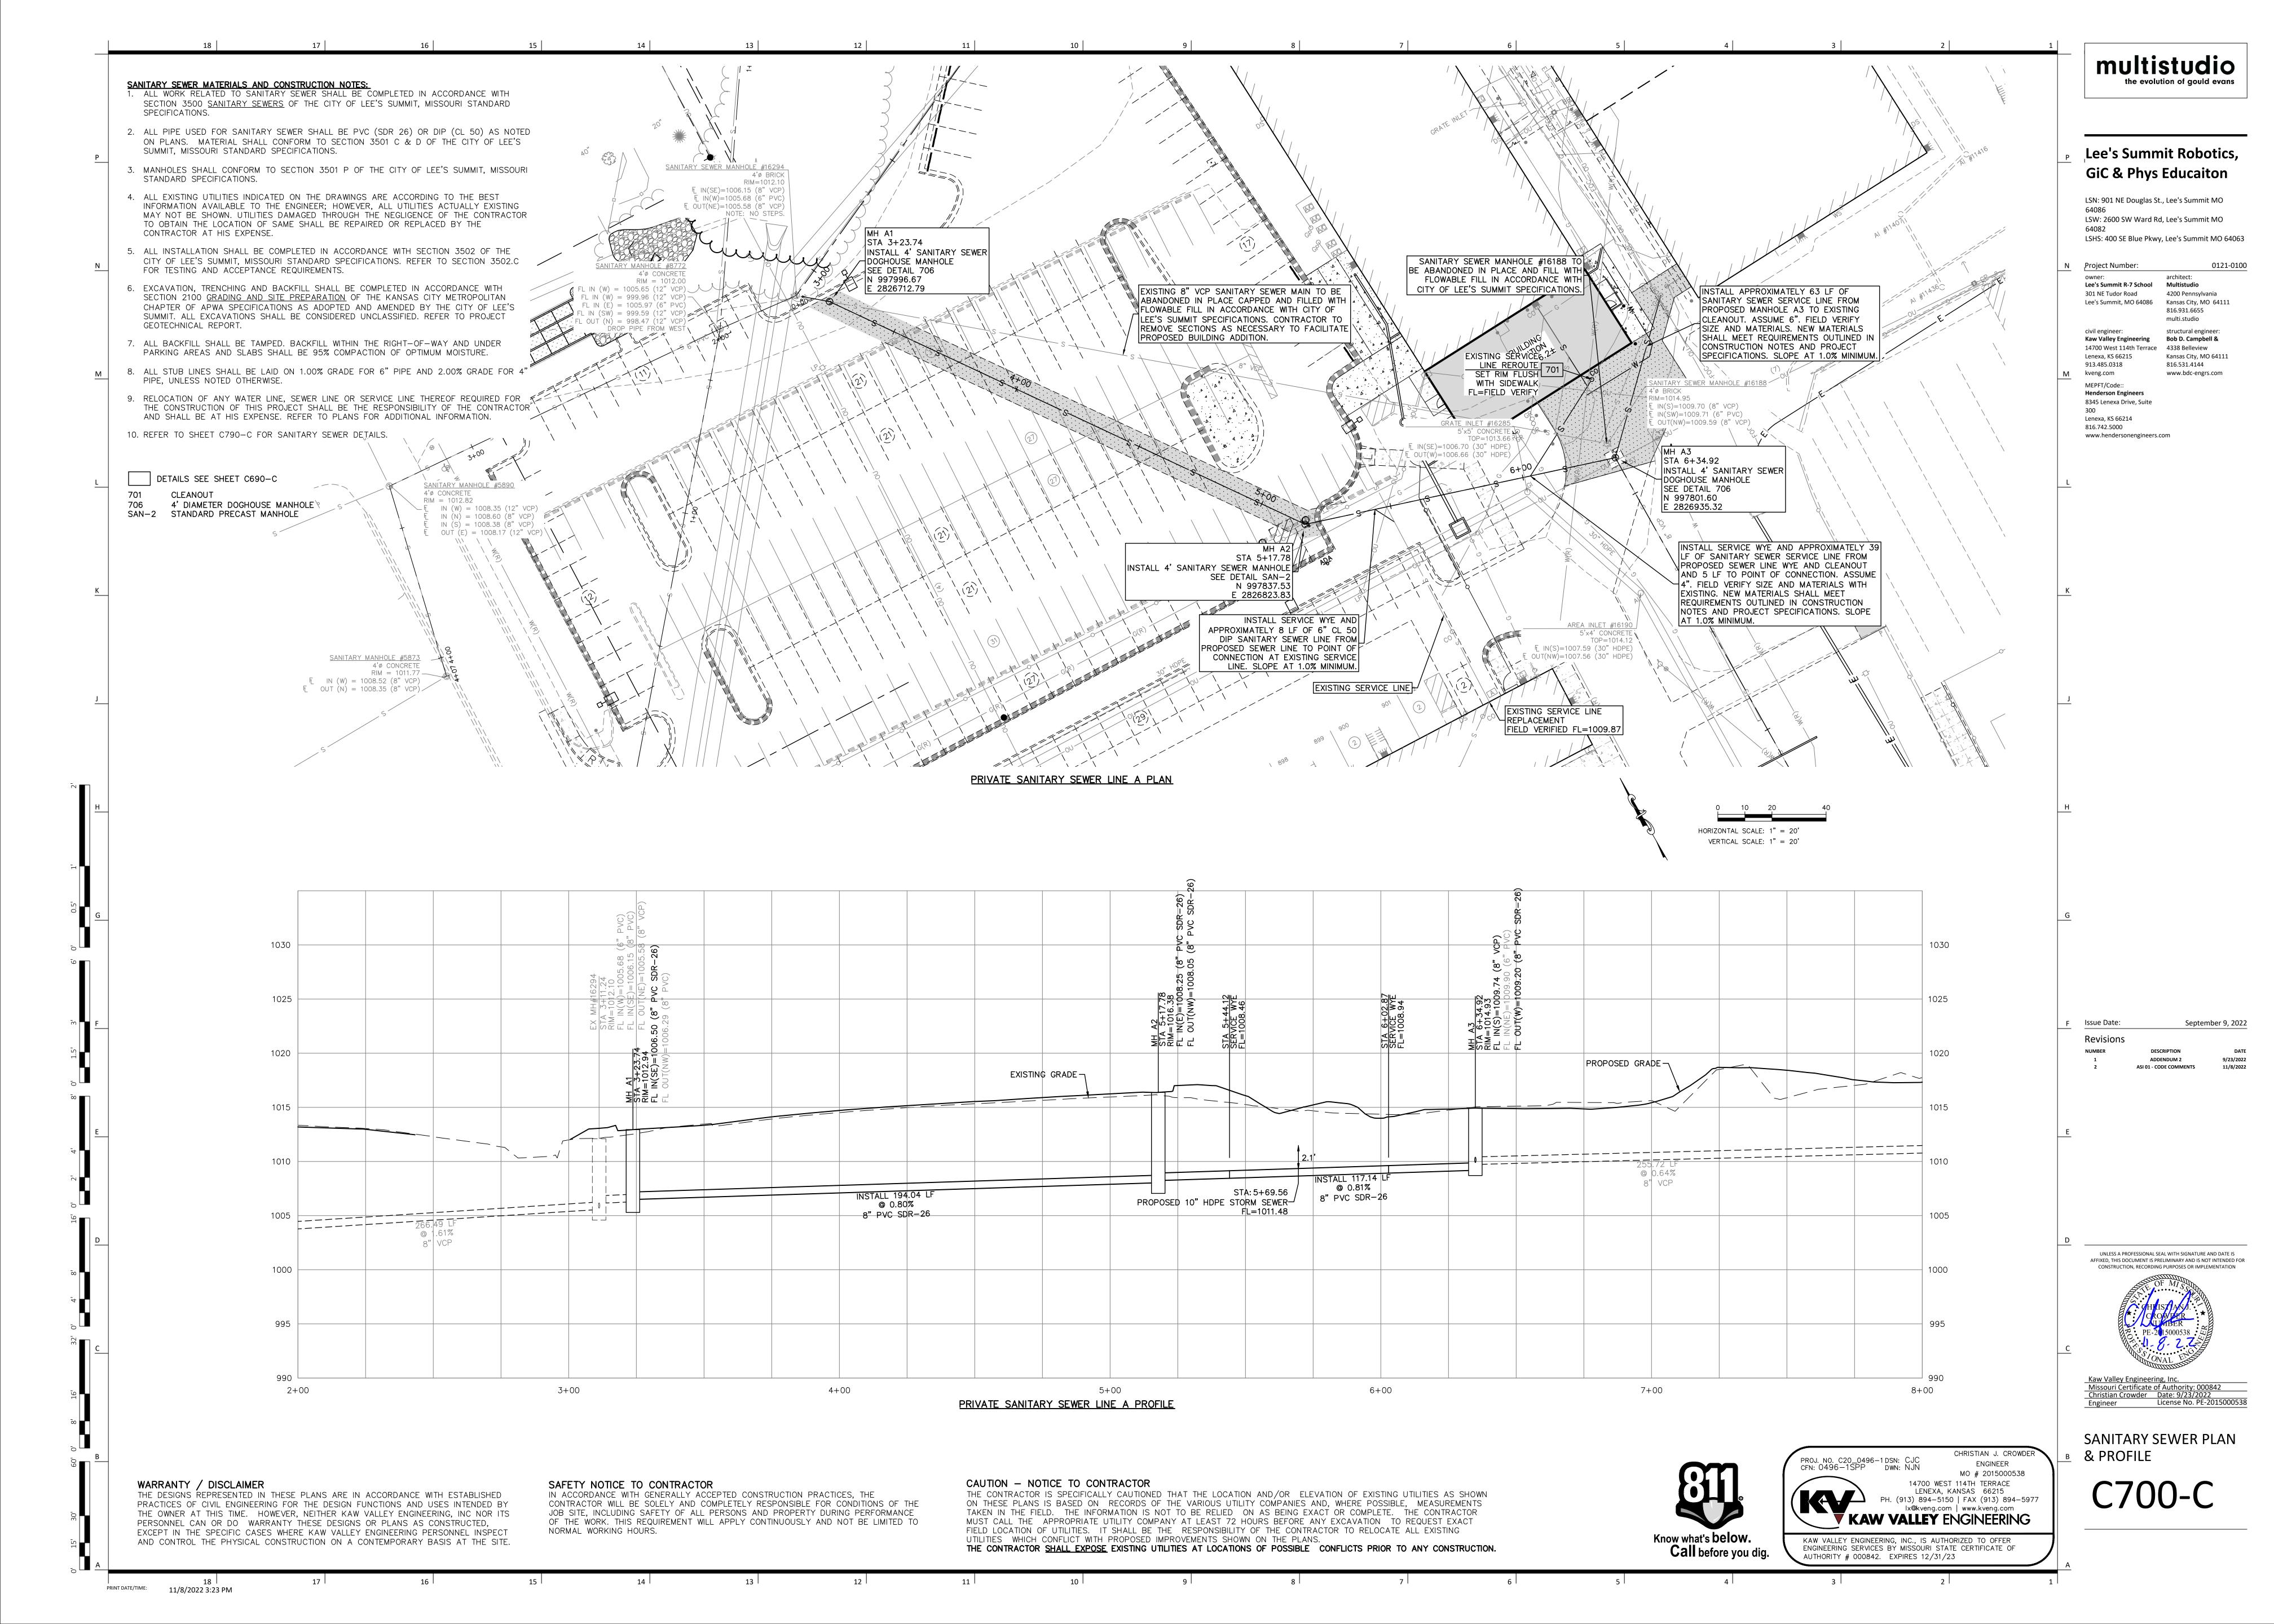



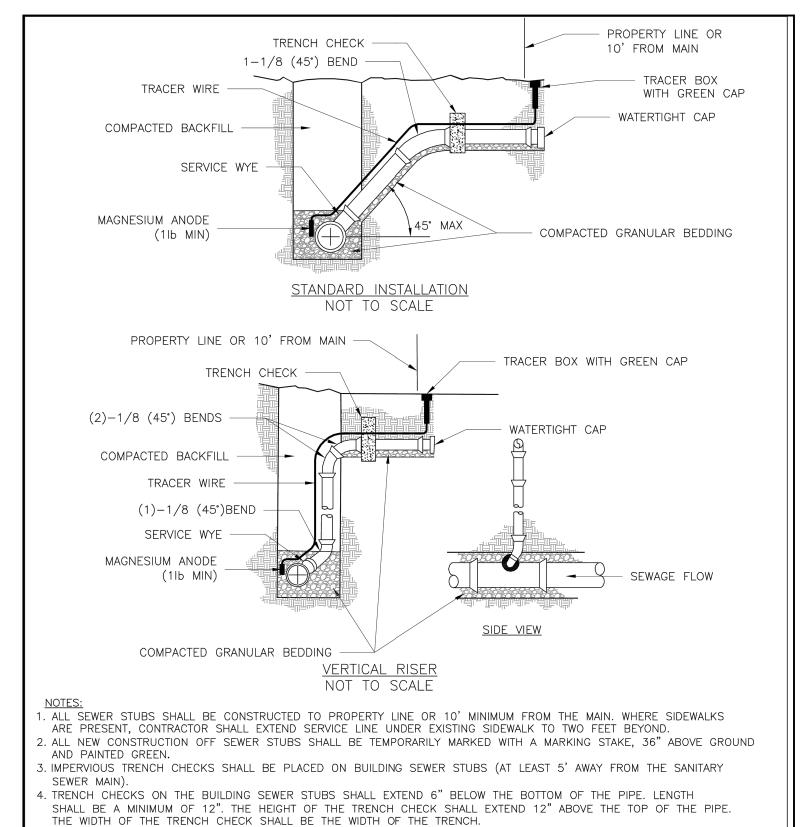

6. #12 GAUGE GREEN INSULATED COPPER TRACER WIRE SHALL BE INSTALLED. TRACER WIRE TERMINAL BOXES SHALL BE INSTALLED DIRECTLY ABOVE THE SEWER SERVICE OR AS DETERMINED BY THE ENGINEER.

LEE'S SUMMIT

BUILDING SEWER STUB AND RISER

SLOPE TRENCH SIDES PER

FLEXIBLE PIPE: INCLUDES

CHLORIDE PIPE.

OSHA REQUIREMENTS

CORRUGATED POLYETHELENE PIPE AND/OR POLYVINYL

RIGID PIPE: INCLUDES REINFORCED CONCRETE, DUCTILE IRON, & CAST IRON

SHAPED TO THE BOTTOM OF THE PIPE.

TRENCH AND BEDDING DETAILS

REFER TO KANSAS CITY METROPOLITAN CHAPTER OF APWA SPECIFICATIONS SECTION 2102.4

BACKFILL

HAUNCHING

BEDDING

MISSOURI

7. FOR SERVICES, TRACER WIRE SHALL RUN FROM THE WYE AND TERMINATE IN A FLUSH MOUNTED TRACER BOX WITH A GREEN


9. THE TRACER WIRE SHALL REMAIN CONTINUOUS TO THE GREATEST EXTENT POSSIBLE. SPLICES IN THE TRACER WIRE SHOULD BE MADE WITH SPLIT BOLT CONNECTORS. WIRE NUTS SHALL NOT BE USED. A WATER-PROOF CONNECTION IS NECESSARY TO


SAN-1

5. SEE SPECIFICATION SECTION 2100 FOR SEWER MAIN BEDDING AND BACKFILL.

8. TRACER WIRE BOX SHALL BE INSTALLED WITHIN 1.0' OF PROPERTY LINE.

CAST IRON LOCKABLE TOP. WIRE SHALL BE TAPED OR TIED TO THE PIPE AT 5' INTERVALS.

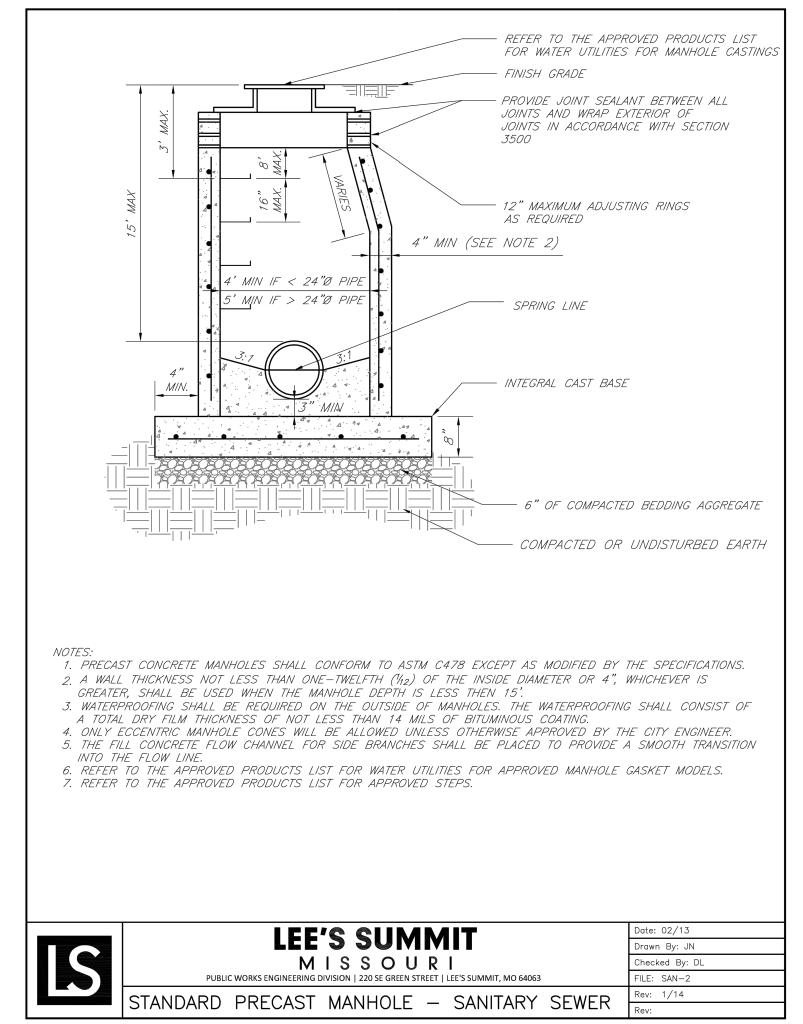


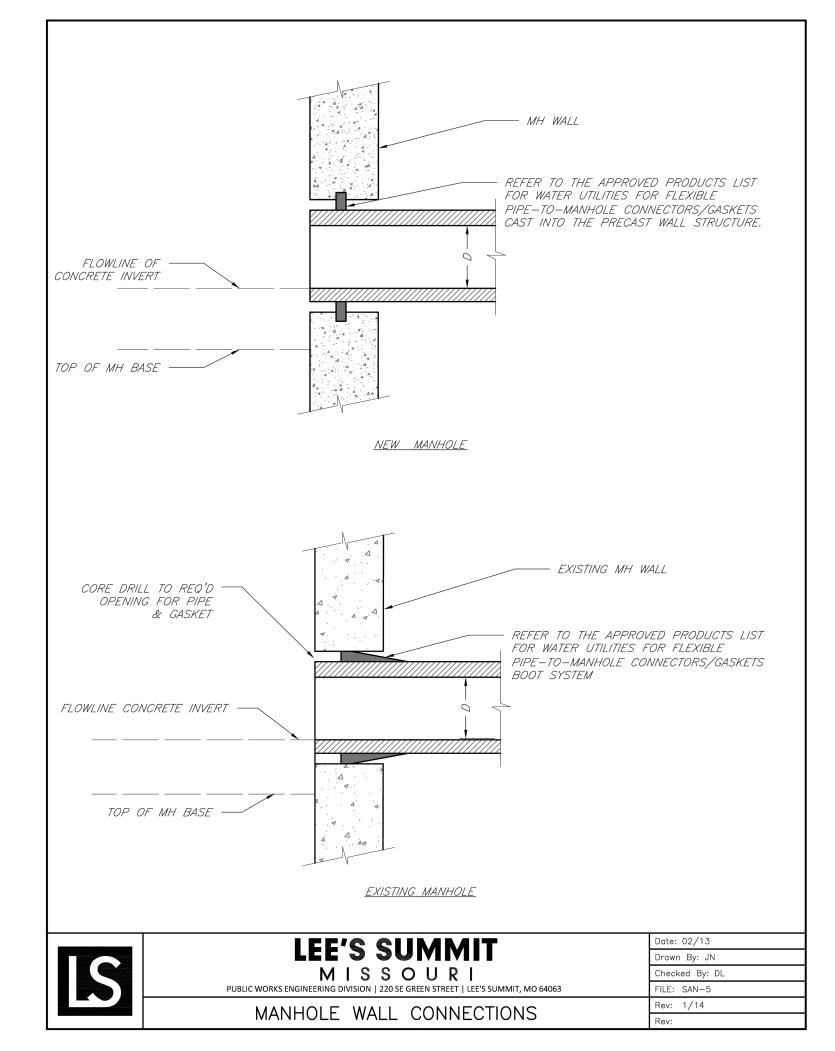



1'-4" Min.


3'-0" Max.

12" Poured-in-place

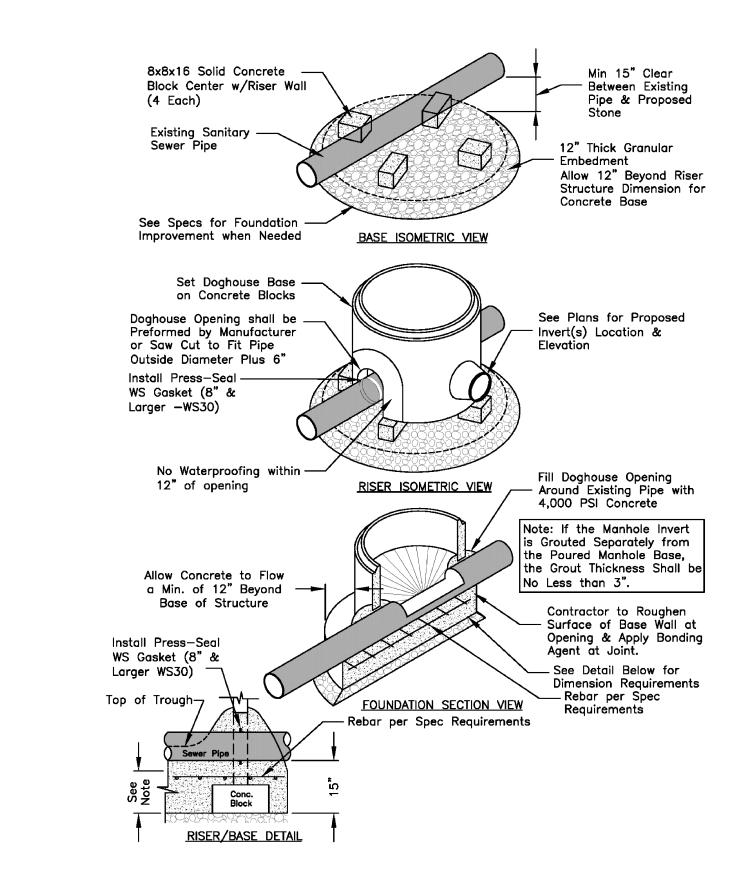

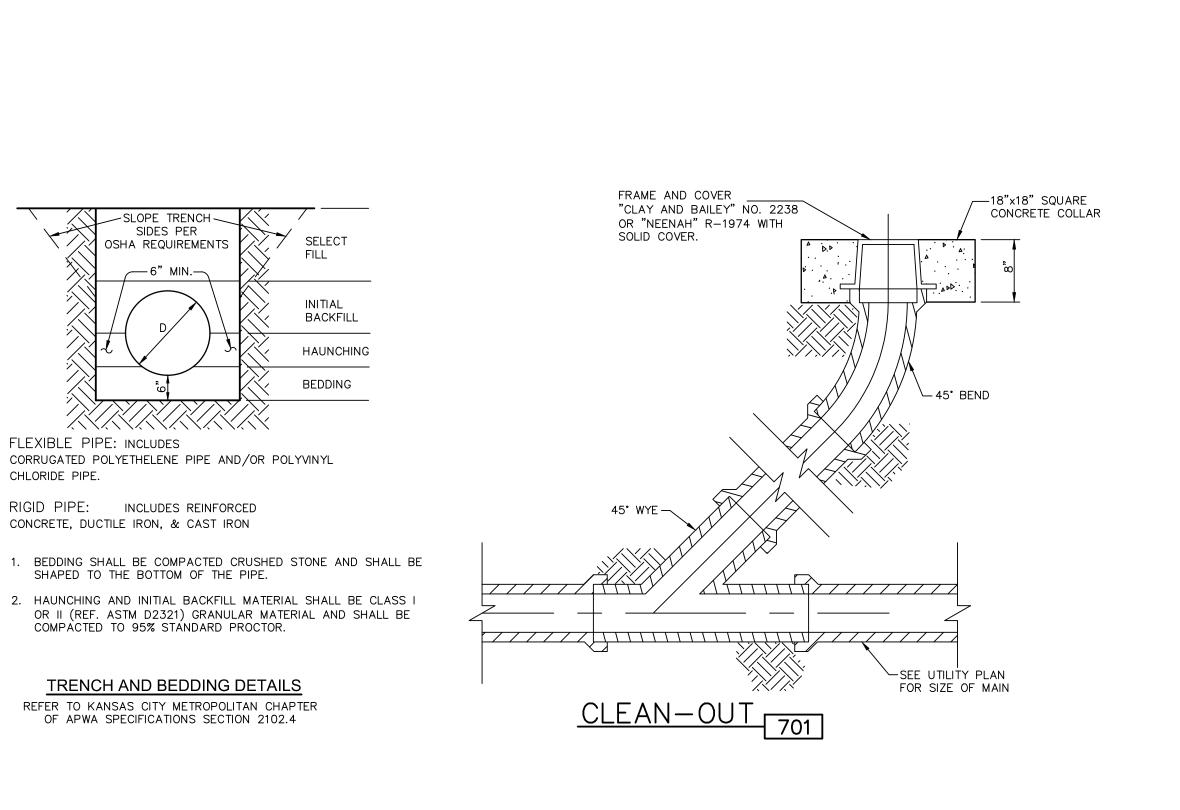

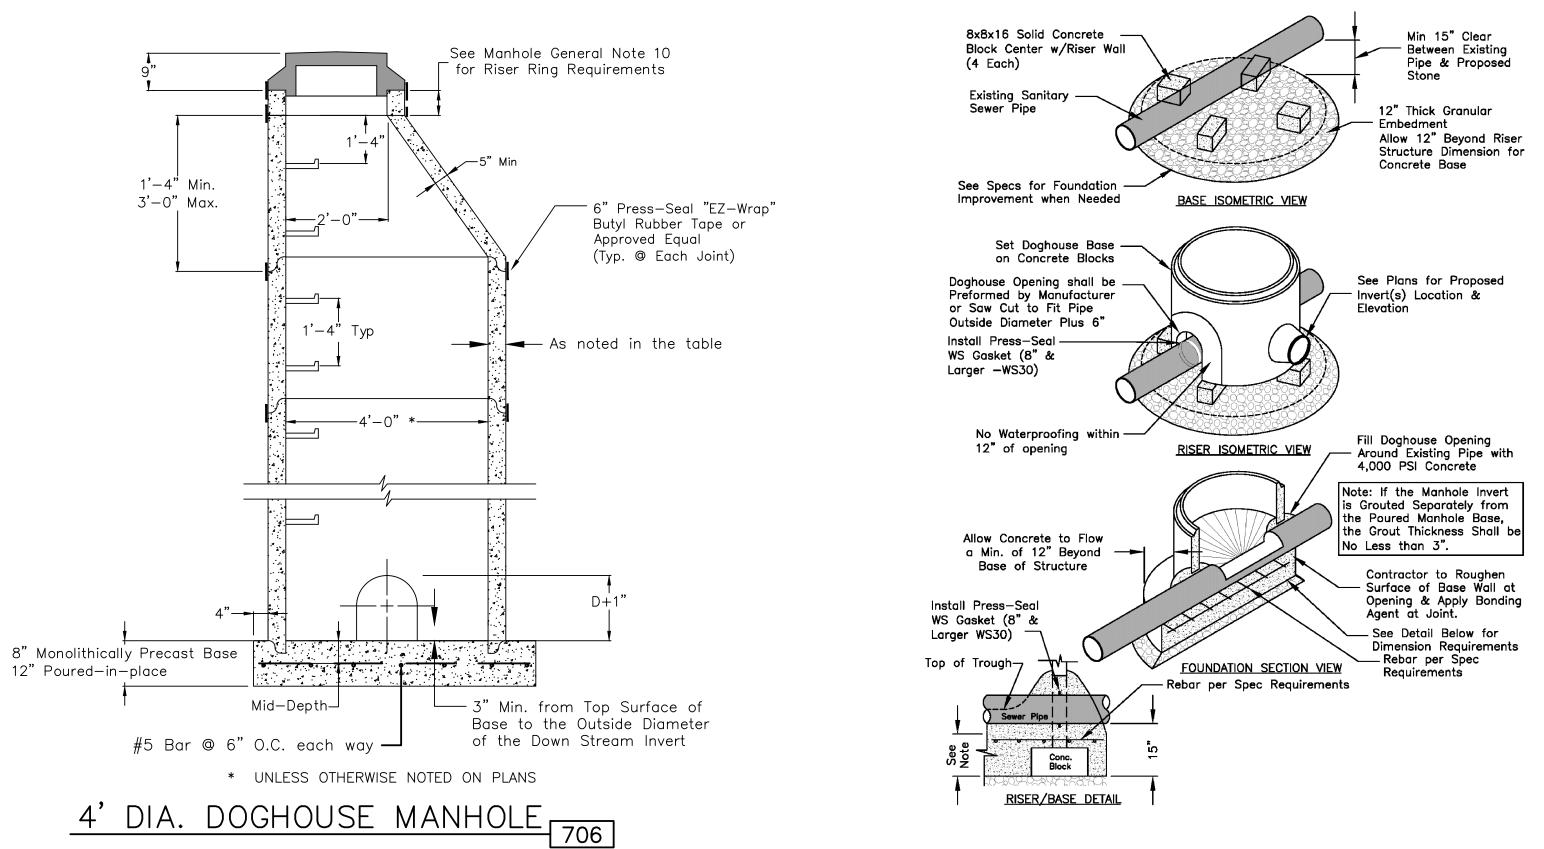

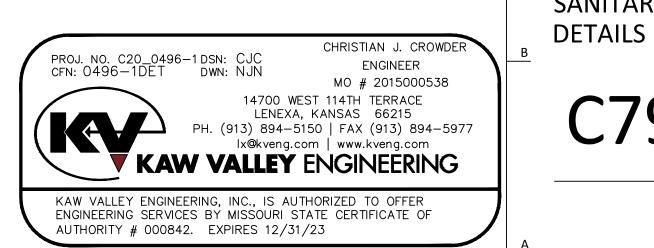

Lee's Summit Robotics, **GiC & Phys Educaiton**

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

LSN: 901 NE Douglas St., Lee's Summit MO LSW: 2600 SW Ward Rd, Lee's Summit MO

Project Number: Lee's Summit R-7 School Multistudio 301 NE Tudor Road 4200 Pennsylvania Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655 multi.studio structural engineer Kaw Valley Engineering Bob D. Campbell & 14700 West 114th Terrace 4338 Belleview Lenexa, KS 66215 Kansas City, MO 64111 913.485.0318 816.531.4144 www.bdc-engrs.com kveng.com MEPFT/Code:: **Henderson Engineers** 8345 Lenexa Drive, Suite

Lenexa, KS 66214 816.742.5000

www.hendersonengineers.com


Issue Date: September 9, 2022 Revisions ADDENDUM 2 9/23/2022 ASI 01 - CODE COMMENTS

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION Kaw Valley Engineering, Inc.

Missouri Certificate of Authority: 000842
Christian Crowder Date: 9/23/2022
Engineer License No. PE-2015000538 **SANITARY SEWER**

C790-C

PRINT DATE/TIME: 11/8/2022 4:45 PM

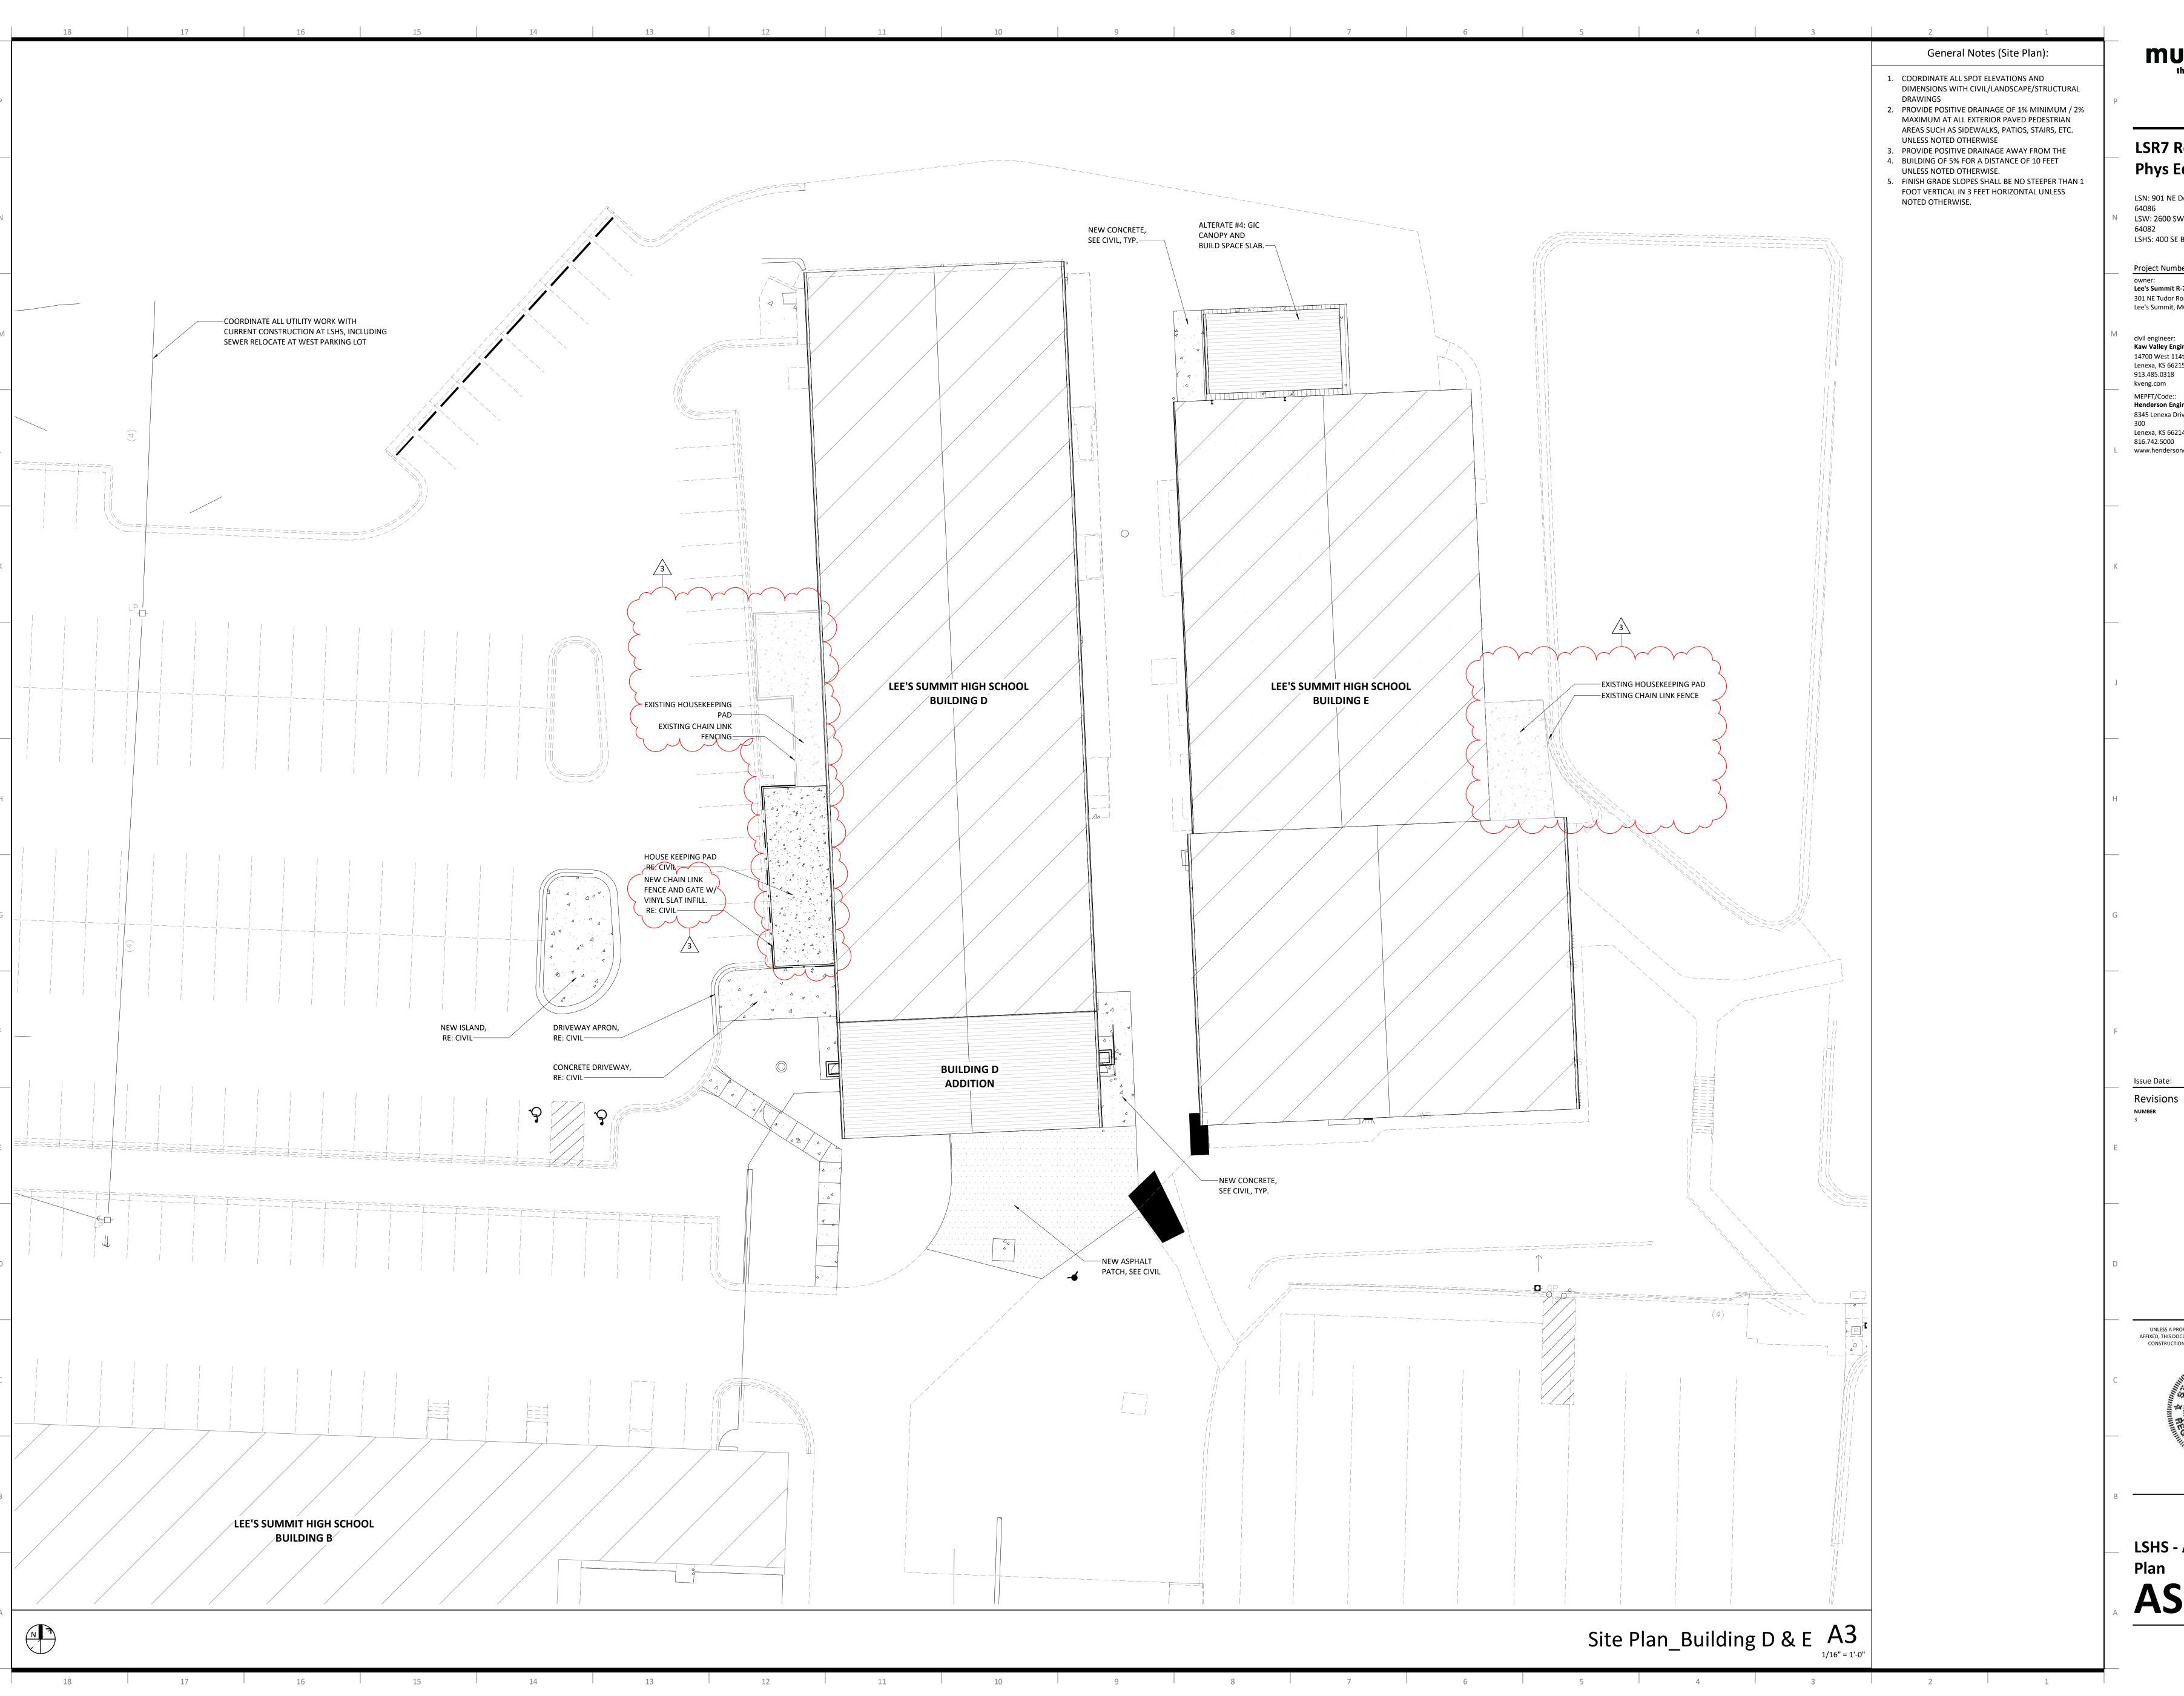

multistudio the evolution of gould evans

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086 LSW: 2600 SW Ward Rd, Lee's Summit MO 64082

Project Number: 0121-0100

owner: architect:

Lee's Summit R-7 School

301 NE Tudor Road
Lee's Summit, MO 64086

Kansas City, MO 64111
816.931.6655
multi.studio

civil engineer: structural engineer:

Kaw Valley Engineering
14700 West 114th Terrace
Lenexa, KS 66215
913.485.0318
kveng.com

MEPFT/Code::
Handerson Engineer:

Structural engineer:

Bob D. Campbell &
4338 Belleview
Kansas City, MO 64111
816.531.4144
www.bdc-engrs.com

MEPFT/Code::
Henderson Engineers
8345 Lenexa Drive, Suite
300
Lenexa, KS 66214

8345 Lenexa Drive, Suite 300 Lenexa, KS 66214 816.742.5000 www.hendersonengineers.com

Positions

Example 2 Date: September 9, 2022

Positions

Example 2 Description Date

ASi01 - Code Comments 11/09/2022

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



LSHS - Architectural Site Plan AS100-C

GENERAL NOTES - STRUCTURAL

1. General Information

- A. The contractor shall verify dimensions and conditions before construction and notify the engineer of any discrepancies, inconsistencies, or difficulties affecting the work before proceeding.
- B. The contractor shall coordinate all disciplines, verifying size and location of all openings, whether shown on structural drawings or not, as called for on architectural, mechanical, or electrical drawings. In the case of work in an existing building the contractor shall scan existing structure to locate all rebar in the area of the new core/opening using ground penetrating radar and notify the engineer of record for review prior to coring/cutting. Conflicts, inconsistencies, or other difficulties affecting structural work shall be called to the architect or engineer's attention for direction before proceeding.
- C. All design and construction work for this project shall conform to the requirements of the following governing design codes: 1. International Building Code (IBC 2018) as amended by the city of
- Lee Summit, MO 2. Minimum Design Loads for Buildings and Other Structures (ASCE7-16) 3. Specification for Structural Steel Buildings (AISC 360-16) Member Design Basis is Allowable Stress Design (ASD)
- Connection Design Basis is Allowable Stress Design (ASD) 4. Structural Welding Code (AWS D1.4-2017) 5. Building Code Requirements for Structural Concrete (ACI 318-14) 6. Building Code Requirements for Masonry Structures (TMS 402-2016)
- 7. North American Specification for the Design of Cold-Formed Steel Structural Members (AISI S100-16) D. These drawings are for this specific project and no other use is authorized.

2. Structural Load Design Criteria

- A. Roof Live = 30 psf; Roof Dead = 25psf B. Snow: Pg = 20psf, Pf =14psf, Is = 1.0, Ce = 1.0, Ct = 1.0, Drift per ASCE/SEI 7 C. Lateral Loads:
- 1.) Wind: V = 109 mph, Exposure C Occupancy [Risk] Category II, lw=1.0 GCpi=+/-0.18 Design wind pressures to be used for the design of exterior component and cladding materials on the designated zones of wall and roof surfaces shall be per section 30.7 and Table 30.7-2 of ASCE/SEI 7. Tabulated pressures shall be multiplied by effective area reduction factors, exposure adjustment factors, and topographic factors where applicable
- 2.) Seismic: Ss = 0.101, S1 = 0.069 Occupancy [Risk] Category II, le=1.0, Site Classification D; Sds = 0.108; Sd1 = 0.110
- Seismic Design Category B Basic Seismic Force-resisting System: Steel system not specifically detailed for seismic resistance Equivalent Lateral Force Procedure
- R = 3; V = 0.036W; Omega = 3; Cd= 3 D. This project is designed to resist the most critical effects resulting from the load combinations of section 1605.3 of the International Building Code.

3. Concrete

- A. All concrete for foundations (walls, grade beams, footings and piers) shall develop minimum ultimate compressive design strength of 3500 psi in 28 days, but not less than 500 pounds of cement shall be used per cubic yard of concrete regardless of strengths obtained, not over 6 gallons of water per 100 pounds of cement and not over 4 inches of slump.
- B. All concrete for interior flatwork (without floor covering) shall develop minimum ultimate compressive design strength of 4000 psi in 28 days, but not less than 525 pounds of cement shall be used per cubic yard of concrete regardless of strengths obtained, not over 5.75 gallons of water per 100 pounds of cement and not over 4 inches of slump. Concrete mix shop drawing shall contain testing data proving concrete design mix shrinkage is less than 0.034% at 28 days when tested
- according to ASTM C157 (air drying method only). C. All concrete for interior flatwork (with floor covering) shall develop minimum ultimate compressive design strength of 4000 psi in 28 days, but not less than 540 pounds of cement shall be used per cubic yard of concrete regardless of strengths obtained, not over 5.40 gallons of water per 100 pounds of cement and not over 4 inches of slump. Concrete mix shop drawing shall contain testing data proving
- concrete design mix shrinkage is less than 0.034% at 28 days when tested according to ASTM C157 (air drying method only). D. All concrete for exterior flatwork shall have a minimum design compressive strength of 4500 psi in 28 days, with not less than 560 pounds of cement per cubic yard of concrete, not over 5 gallons of water per 100 pounds of cement, with 6% +/- 1% air entrainment, and a maximum of 4 inches of slump.
- E. The preceding minimum mix requirements may have water-reducing admixtures conforming to ASTM C494 added to the mix at manufacturer's dosage rates for improved workability.
- F. The preceding minimum mix requirements may have up to 15% maximum of the cement content replaced with an approved ASTM C618 Class C fly ash, provided the total minimum cementitious content is not reduced.
- G. Combined aggregate (coarse plus fine) for all concrete shall be well graded from coarsest to finest with no more than 18 percent and not less than 8 percent retained on an individual sieve, except that less than 8 percent may be retained on coarsest sieve and on No. 50 and finer sieves. Submit this gradation report with the concrete mix design shop drawings. H. All interior concrete slabs on grade shall be placed over 15 mil, Class A Vapor Barrier per ASTM E1745 with less than 0.01 perms, tested after mandatory conditioning. All joints shall be lapped and sealed per manufacturer's recommendations. All penetrations, as well as damaged vapor barrier material shall also be sealed per manufacturer's recommendation prior to concrete placement. Install barrier per manufacturer recommended details at all discontinuous edges (at interior columns, exterior edge of slab, etc.) to ensure terms of warranty are followed. The vapor barrier shall be placed over freedraining granular material as prescribed by the project soils report.
- I. All concrete is reinforced concrete unless specifically called out as unreinforced. Reinforce all concrete not otherwise shown with same steel as in similar sections or areas. Any details not shown shall be detailed per ACI 315 and meet requirements of ACI 318, current editions. J. Control joints in dirt formed slab to be as shown on plans. Where not shown, limit
- controlled areas to not more than 144 square feet, or 12 feet on any side. Slab panel side ratio shall not exceed 1 1/2 to 1. K. Contractor shall verify that all concrete inserts, reinforcing and embedded items
- are correctly located and rigidly secured prior to concrete placement. L. Construction joints in beams, slabs, and grade beams shall occur at midspan (middle third) unless noted otherwise. Provide 2 x 4 horizontal keys at construction joints for shear transfer.
- M. No aluminum items shall be embedded in any concrete.

4. Reinforcing Steel

- A. All reinforcing steel shall conform to the requirements of ASTM A615 or A706 grade 60 steel. Welded plain wire fabric shall be supplied in sheets and conform
- to the requirements of ASTM A185. B. Clear coverage of concrete over reinforcing steel shall be as follows:
- Concrete placed against earth: 3" Formed concrete against earth: 2"
- Slabs: 4. Beams or Columns: 1-1/2" Other
- All coverage shall be nominal bar diameter minimum. C. All dowels shall be the same size and spacing as adjoining main bars (splice lap 48
- bar diameters or 24" minimum unless noted otherwise). D. At corners of all walls, beams, and grade beams supply corner bars (minimum 2'-0" in each direction or 48 bar diameters) in outside face of wall, matching size and spacing of horizontal bars. Where there are no vertical bars in outside face of wall,
- supply 3 #4 vertical support bars for corner bars. E. Bars marked continuous and all vertical steel shall be lapped 48 bar diameters (2'-0" minimum) at splices and embedments, unless shown otherwise. Splice top bars near midspan and splice bottom bars over supports, unless noted otherwise. F. At all holes in concrete walls and slabs, add 2 - #5 bars (opening dimension plus 96
- diameters long) at each of four sides and add 2 #5 x 5'-0" diagonally at each of four corners of hole. Openings in 8" thick walls are reinforced similar, but with 1 - # 5 instead of 2 - #5, respectively. G. Unless otherwise covered on architectural plans or specifications, vertical control joints in concrete wall shall be spaced at a maximum of 20'-0" on center and
- coordinated with the architect. Every other horizontal wall reinforcing bar shall be discontinuous at control joints except heavy top and bottom bars unless noted otherwise. Provide base seal waterstop style number 772 (by Greenstreak Inc. or approved equal) on dirt face side of wall at all walls below grade. H. Accessories shall be as specified in latest edition of the ACI Detailing Handbook

and the concrete Reinforcing Steel Institute Design Handbook. Maximum

- accessory spacing shall be 4'-0" on center, and all accessories on exposed surfaces are to have plastic coated feet. I. All slabs and stairs not shown otherwise shall be 6" thick with #4 bars at 12" on center each way. All exterior porches and stoops not otherwise detailed may be constructed in any standard manner, solid or hollow, but must be reinforced with #4 bars at 12" on center each way minimum. Porches shall be doweled to adjacent walls or grade beams with #4 bars at 12" on center, hooked or embedded 48 diameters into both members. Slope porches 1/8" per foot for drainage unless
- noted otherwise. J. Allow 2 ton of reinforcing bars #4 or larger to be used as directed in the field for special conditions by the engineer of record (labor for placing same to be included).

5. Structural Steel

- A. All structural steel beams and columns shall be ASTM A992, grade 50 steel and all miscellaneous steel shall be ASTM A36 grade steel (except at moment connections where plates shall be ASTM A572, grade 50). Hollow Structural Sections (HSS) shall be ASTM A500, grade C. Fabrication and erection shall be in accordance with AISC 303-05 "Code of Standard Practice for Steel Buildings and Bridges" in the 13th Edition of the AISC Steel Construction Manual. B. All welding shall conform to the recommendations of the AWS.
- All exterior steel and connections, and brick relief angles shall be hot-dip galvanized. D. All bolts not otherwise specified shall be 3/4" diameter high strength (ASTM A325-N). All bolts shall be fully pretensioned. All beam connections shall be designed per the AISC Manual of Steel Construction "Framed Beam Connections" for the indicated reactions or at least 0.4 x beam total shear capacity, Vn/Omega, shown in the maximum total uniform load tables, whichever is greater; and, shall account for eccentricity when the bolt line is more than 2" from the center of the support. All connections must be two bolt minimum. Additional connection elements may not be specifically shown in the conceptual details in this set but may be required by the final connection design, such as stiffener plates, doubler plates, supplement/reinforcing plates or other connection material. Connection design and shop drawing preparation shall be completed under the direct supervision of a professional engineer licensed in the state the project is located and shop drawings and connection calculations shall
- bear his/her seal. E. All anchor bolts shall be 3/4" diameter, ASTM F1554, Grade 36 unless noted otherwise. Washers of minimum size and thickness for the given anchor diameter in Table 14-2 of the AISC Steel Construction Manual shall be provided at every column anchor bolt. Washers shall have a standard size hole for the anchor bolt. At braced frames washers shall be welded all around to the column base plate with 3/16" fillet weld.
- F. All openings in steel beam roof to have L6x4x5/16 (LLV) frame set between beams. Support mechanical equipment with L6x4x3/8 (LLV) frame laid between beams

G. Design and installation of steel decking shall comply with the recommendations of the

Steel Deck Institute (SDI). All decking shall be galvanized unless noted otherwise. H. Allow 2.0 tons structural steel to be used as directed in field for special conditions by the engineer of record. Cost for shop drawings, fabrication, delivery, detailing, and erection to be included. 50% of structural steel allowance shall be bid as miscellaneous galvanized angle and plate.

6. Post Installed Anchors

- A. Post-installed anchors shall be used only where specified on the drawings unless approved in writing by the engineer of record. See drawings for anchor diameter, spacing and embedment. Performance values of the anchors shall be obtained for specified products using appropriate design procedures and/or standards as required by the governing building code. Anchors installed in concrete shall have an ICC-ES Evaluation Service Report. Special inspection is required for all post installed anchors. The contractor shall coordinate an on-site meeting with the post installed anchor manufacturer field representative to educate the construction team on the anchor installation guidelines and requirements.
- B. Mechanical anchors used in cracked and uncracked concrete shall have been tested and qualified for use in accordance with ACI 355.2 and ICC-ES AC193. All anchors shall be installed per the anchor manufacturer's written instructions. C. Adhesive anchors used in cracked and uncracked concrete shall have been tested and gualified for use in accordance with ICC-ES AC308. All anchors shall be installed
- per the anchor manufacturer's written instructions. D. Mechanical anchors used in solid grouted masonry shall have been tested and qualified for use in accordance with ICC-ES AC01. All anchors shall be installed per
- the anchor manufacturer's written instructions. E. Adhesive anchors used in solid grouted masonry shall have been tested and qualified for use in accordance with ICC-ES AC58. All anchors shall be installed per the anchor manufacturer's written instructions.
- F. Anchors used in hollow concrete masonry shall have been tested and qualified in accordance with ICC-ES AC106 or ICC-ES AC58 as appropriate. All anchors shall be installed per the anchor manufacturer's written instructions with appropriate screen

7. Foundations

- Lee's Summit High School: A. The soil investigation was prepared by Cook, Flatt & Strobel Engineers, P.A., the report
- number is 22-5546 and the telephone number is 913-627-9040. B. Spread footings and grade beams are designed to bear on engineered fill
- or undisturbed soil capable of safely sustaining 1,500 psf. C. Contractor shall provide for dewatering at excavations from either surface water or
- D. All foundation excavations shall be inspected by a qualified soil engineer, approved by
- the architect and/or structural engineer, prior to placement of steel or concrete. This inspection shall be at the owner's expense. E. All concrete in the structural portion retaining the backfill shall have attained its design
- strength prior to being backfilled. F. Moisture content in soils beneath building locations should not be allowed to change after footing excavations and after grading for slabs on grade are completed. If subgrade materials become desiccated or softened by water or other conditions, recompact materials to the density and water content specified for engineered fill. Do not place

8. Concrete Masonry Units

concrete on frozen ground.

- A. Concrete block used in exterior walls or load bearing walls shall meet the requirements of ASTM C90 and have a minimum net compressive strength of 2650 psi and laid up using type N mortar such that f'm equals 2000 psi. Mortar shall be volume proportion based cement lime mortar. Proportioning shall be completed by box measure. Any block in contact with earth shall be normal weight units, laid using type "S" mortar and
- B. The contractor shall provide adequate temporary bracing for all masonry walls during construction. C. All concrete block shall have 9 gage (or larger) horizontal joint reinforcing (ladder
- or truss) per architectural drawings and specifications (16" maximum vertical spacing). D. Cavity wall construction shall be reinforced as designed for specific concrete block used. The horizontal joint reinforcing shall be of the ladder or truss style per specification and continuous between brick and block, as prescribed by the
- architectural drawings. E. Concrete block shall be reinforced as follows in 6", 8", 10", and 12" walls: . Vertical reinforcing shall be a minimum of 1 - #4 bar in 6" and 8" walls and 2 - #4 bars in 10" and 12" walls at 4'-0" on center, at each corner, at each door and window jamb, each side of control joints and in the end void of each length of wall. Lap splices for masonry vertical reinforcing shall be 48 bar diameters, 24"
- 2. Horizontal reinforcing: A. Horizontal joint reinforcing as noted above. B. Continuous horizontal bars shall be included per section or detail in bond beam or optional running bond beam where noted. Where bond beams are continuous at corners of walls, supply corner bars matching size of horizontal bars (minimum 2'-0" or 40 bar diameters in each direction).
- F. Grout, where noted above, shall have a minimum design ultimate compressive strength of 2500 psi at 28 day test and 3/8" maximum aggregate size. G. Non-load bearing concrete block walls shall be isolated from adjacent structural elements with vertical 3/8" control joints and at the top of the wall with 1" air space or
- compressible material and support per architectural detail. H. Unless otherwise covered on architectural plans or specifications, vertical control joints in masonry construction shall be 3/8" wide, full height of wall. Joints shall be spaced at a maximum of 24'-0" on center and coordinated with the architect. All horizontal joint reinforcing shall be discontinuous at control joints in masonry. All bond beam horizontal reinforcing shall be continuous through control joints.
- I. Lintels over all openings up to 8'-0" wide in new and existing masonry walls not otherwise covered shall be one 6x3 1/2x5/16 angle for each 4" width of masonry. All exterior lintels to be galvanized.
- J. Walls shall be anchored top and bottom by dowels matching wall vertical reinforcing(unless noted otherwise) from floor slab bottom and bracing angles at the top, per details on the drawings.

Light Gage Metal Structural Framing

- A. All load bearing, light gage structural studs, track, and bridging shall be of the
- type, size, gage, and spacing as shown on the plans, minimum. B. All materials shall be 33,000 psi minimum yield, except studs of 16 gage or
- heavier shall have a minimum yield of 50,000 psi. C. All properties, fabrication, and erection shall be in accordance with latest editions of the AISI "Specifications for the Design of Cold-Formed Structural Members." D. All framing components shall be cut squarely or at an angle to fit squarely
- against abutting members. Splicing of axially loaded members is not permitted. Members shall be held firmly in place until properly fastened. Attachments of similar components shall be by welding, screw attachment, or bolting. Wire tving of components is not permitted
- E. Tracks shall be securely anchored to floor and overhead members. Special anchorage requirements required for wind bracing shall be as shown on the plans. F. Prior to fabrication and/or erection, the contractor shall submit shop drawings complete with detail of erection, fabrication, attachments, anchorages, lintels, etc., for review by the architect/engineer.

10. Deferred Submittal and Shop Drawing

- A. Bob D. Campbell and Company, Inc. will review the General Contractor's (GC) shop drawings and related submittals (as indicated below) with respect to the ability of the detailed work, when complete, to be a properly functioning integral element of the overall structural system designed by Bob D. Campbell and Company, Inc.
- B. Deferred submittals shall be submitted to the architect of record for review who shall forward to the building official for review and approval. Design calculations for deferred sub mittals shall be submitted at the same time as the shop drawings for review. Design calculations shall be prepared and sealed by a Professional Engineer licensed in the state of the project. The deferred submittal items shall not be installed until the deferred submittal documents have been approved by the building official.
- C. Prior to submittal of a shop drawing or any related material to Bob D. Campbell and Company, Inc., the GC shall: 1. Review each submission for conformance with the means, methods, techniques, sequences and operations of construction and safety precautions and programs incidental thereto, all of which are the sole responsibility of the GC. Review and approve each submission.
- Stamp each submission as approved. D. Bob D. Campbell and Company, Inc. shall assume that no submission comprises a
- variation unless the GC advises Bob D. Campbell and Company, Inc. with written documentation. E. Bob D. Campbell and Company, Inc. shall review shop drawings and related
- materials with comments provided that each submission has met the above requirements. Bob D. Campbell and Company, Inc. shall return without comment unrequired material or submissions without GC approval stamp.
- F. Shop drawings and related material (if any) required are indicated below. Should Bob D. Campbell and Company, Inc. require more than ten (10) working days to perform the review, Bob D. Campbell and Company, Inc. shall so notify the GC. 1. Concrete mix designs and material certificates including admixtures and
- compounds applied to the concrete after placement. Reinforcing steel shop drawings including erection drawings and bending details. Bar list will not be reviewed for correct quantities.
- 3. Elevations of all reinforced concrete masonry walls at a scale no smaller than 3/8" = 1'-0" showing all required reinforcing. 4. Grout mix designs (for CMU).

structural drawings for Bob D. Campbell and Company, Inc. review.

- . Construction and control joint plans and/or elevations. Structural steel shop drawings including erection drawings and piece details. Include joist, decking and connector submittals. Include miscellaneous framing specified on the structural drawings, but do not submit framing specified on non-
- Deferred Submittal: Exterior curtain wall 8. Deferred Submittal: Structural steel connection design calculations submitted concurrently with structural steel shop drawings.
- Miscellaneous anchors shown on the structural drawings 10. Deferred Submittal: Light gage framing design calculations and detailed erection and fabrication drawings.

11. Statement of Structural Special Inspections

- A. The structural design for this project is based on completion of special inspections during construction in accordance with section 1704 of the International Building Code. The owner shall employ one or more qualified special inspectors to provide
- the required special inspections. B. The special inspector shall furnish inspection reports to the building official, owner, architect and structural engineer, and any other designated person.
- C. All discrepancies shall be brought to the immediate attention of the contractor for correction, then, if uncorrected, to the proper design authority, building official and structural engineer.
- D. The special inspector shall submit a final signed report stating that the work requiring special inspection was, to the best of the inspector's knowledge, in conformance with the approved plans and specifications and the applicable workmanship provisions of the building code. . The following inspections and tests are required with the frequency (continuous or periodic) as defined within the referenced section or standard listed below. The
- General Contractor shall provide notification to the inspector when items requiring inspection are ready to be inspected and provide access for those inspections. 1. Shop Fabrication – structural steel and steel bar joist per Section 1704.2.5 unless AISC certified shop
- 2. Steel Construction per Section 1705.2 and the quality assurance requirements of AISC 341 Chapter J (as referenced by AISC 360)
- 3. Cold-Formed Steel Deck per Section 1705.2.2 and the quality assurance requirements of SDI QA/QC.
- 4. Concrete Construction per Section 1705.3 and Table 1705.3 a. Reinforcing Steel Placement
- b. Cast in Place Anchors
- c. Post Installed Anchors d. Design Mix Verification e. Concrete Sampling and Testing
- f. Concrete Placement g. Concrete Curing
- requirements of TMS 602 Level 2 6. Verification of Soils per Table 1705.6

12. Copyright and Disclaimer

A. All drawings in the structural set (S-series drawings) are the copyrighted work of Bob D. Campbell and company, Inc. These drawings may not be photographed, traced, or copies in any manner without the written permission of Bob D. Campbell and Company, Inc. Exception: Original drawings may be printed for distribution to the owner, architect, and general contractor for coordination, bidding, and construction. Subcontractors may not reproduce these drawings for any purpose

5. Masonry Construction per Section 1705.4 and the quality assurance

or in any manner. B. I, Wayne E. Davis, P.E., registered engineer and a representative of Bob D. Campbell and Company, Inc., do hereby accept professional responsibility as required by the professional registration laws of this state for the structural design drawings consisting of S-series drawings. I hereby disclaim responsibility for all other drawings in the construction document package, they being the responsibility of other design professionals whose seals and signed statements may appear elsewhere in the construction document package.

STRUCTURAL ABBREVIATIONS

@	AI	GA	GAGE	RAD	RADIUS
@ &	AND	GALV	GALVANIZE(D)	RD-#	ROOF DECK TYPE
Ø	ROUND, DIAMETER	GEN	GENERAL	REF	REFERENCE
ADTL	ADDITIONAL	GR	GRADE	REINF	REINFORCEMENT
AFF	ABOVE FINISHED FLOOR	HORIZ	HORIZONTAL	REQD	REQUIRED
ALT	ALTERNATE	HSS	HOLLOW STRUCTURAL SECTION	REV	REVISION
ARCH	ARCHITECTURAL	IF	INSIDE FACE	RLL	ROOF LIVE LOAD
BLDG	BUILDING	INFO	INFORMATION	RTU	ROOF TOP UNIT
B/	BOTTOM OF	INT	INTERIOR	SC	SLIP CRITICAL
BM	BEAM	JST	JOIST	SCHED	SCHEDULE(D)
BOTT	BOTTOM	JT	JOINT	SECT	SECTION
BRG		K		SHT	SHEET
	BEARING		KIPS (1000 LBS)		
C	CAMBER	KSF	KIPS PER SQUARE FOOT	SIM	SIMILAR
CD-#	CONCRETE DECK TYPE	KSI	KIPS PER SQUARE INCH	SJ	SAW JOINT
CJ	CONSTRUCTION/CONTROL JOINT	LBS,#	POUNDS	SL	SNOW LOAD
CJP	COMPLETE JOINT PENETRATION	Ld	DEVELOPMENT LENGTH	SOG	SLAB-ON-GRADE
CL	CENTERLINE	LL	LIVE LOAD	SOG-#	SLAB-ON-GRADE TYPE
CMU	CONCRETE MASONRY UNIT	LLH	LONG LEG HORIZONTAL	SPCG	SPACING
COL	COLUMN	LLV	LONG LEG VERTICAL	SPEC	SPECIFICATION
CONC	CONCRETE	LONG	LONGITUDINAL	SPRT	SUPPORT
CONN	CONNECTION	LSLT	LONG-SLOTTED HOLE TRANSVERSE	SQ	SQUARE
CONT	CONTINUOUS	LTWT	LIGHTWEIGHT	SS	STAINLESS STEEL
COORD	COORDINATE	M	MOMENT FORCE	SSLT	SHORT-SLOTTED HOLE TRANSVERSE
COV, CVR	COVER	MAX	MAXIMUM	STD	STANDARD
DBL	DOUBLE	MECH	MECHANICAL	STIFF	STIFFENER
DET	DETAIL	MFGR	MANUFACTURER	STIR	STIRRUP
DIA	DIAMETER	MIN	MINIMUM	STL	STEEL
DIM	DIMENSION	MISC	MISCELLANEOUS	STRUCT	STRUCTURE, STRUCTURAL
DL	DEAD LOAD	MSRY	MASONRY	T/	TOP OF
DWG	DRAWING	MTL	METAL	THRU	THROUGH
EA	EACH	NF	NEAR FACE	TOS	TOP OF STEEL, TOP OF SLAB
EF	EACH FACE	NS	NEAR SIDE	TRANS	TRANSVERSE
EJ	EXPANSION JOINT	NTS	NOT TO SCALE	TYP	TYPICAL
EL, ELEV	ELEVATION	NW	NORMAL WEIGHT	UNO	UNLESS NOTED OTHERWISE
EMBED	EMBEDMENT, EMBEDDED	OC	ON CENTER	V	SHEAR FORCE
ENGR	ENGINEER	OF	OUTSIDE FACE	VERT	VERTICAL
		OPNG		W/	WITH
EOD	EDGE OF DECK		OPENING		
EOR	ENGINEER OF RECORD	OPP	OPPOSITE	W/0	WITHOUT
EOS	EDGE OF SLAB	OVS	OVERSIZED HOLE	WF	WIDE FLANGE
EQ	EQUAL	Р	AXIAL FORCE	WL	WIND LOAD
EQUIP	EQUIPMENT	PAF	POWDER ACTUATED FASTENER	WP	WORK POINT
EW	EACH WAY	PC	PRECAST	WWF	WELDED WIRE FABRIC
EXP	EXPANSION	PCF	POUNDS PER CUBIC FOOT		
EXT	EXTERIOR	PEMB	PRE-ENGINEERED METAL BUILDING		
EXTG, EXIST	EXISTING	PERP	PERPENDICULAR		
FD-#	FLOOR DECK TYPE	PL	PLATE		
FD-# FDN	FOUNDATION	PLF	POUNDS PER LINEAR FOOT		
FF	FAR FACE	PJP	PARTIAL JOINT PENETRATION		
FIN	FINISH	PSF	POUNDS PER SQUARE FOOT		
FLR	FLOOR	PSI	POUNDS PER SQUARE INCH		
FS	FAR SIDE	QTY	QUANTITY		
FTG	FOOTING				
FV	FIELD VERIFY				

LEGEND:

RAD RADIUS

→		SPAN DIRECTION OF DECK
BP-1		BEARING PLATE 3/8"x8"x8" WITH (2) 1/2"Ø x 6" STUDS GROUT (3) COURSES BELOW PLATE SOLID (3) COURSES WIDE.
BP-2		BEARING PLATE 3/8"x7 1/2"x7 1/2" WITH (2) 1/2"Ø x 6" STUDS GROUT (3) COURSES BELOW PLATE SOLID (3) COURSES WIDE.
RD-1		3", 20ga GALVANIZED TYPE N ROOF DECK (3 SPAN CONTINUOUS) ATTACH TO STRUCTURE TO DEVELOP 325plf DIAPHRAGM SHEAR (ASD LOAD).
3.0		FOOTING MARK - SEE SCHEDULE ON SHEET S101-B.
HS HS	S8x8x5/	16COLUMN SIZE
		LATE MARK OFF COLIFFIER ON OUFFET

BASE PLATE MARK - SEE SCHEDULE ON SHEET W14x22 _____ STEEL BEAM SIZE

EACH END

T 117'-6" TOP OF BEAM ELEVATION ELEVATION

> Issue Date: September 9, 2022 Revisions

LSR7 Robotics, GiC &

LSN: 901 NE Douglas St., Lee's Summit MO

LSW: 2600 SW Ward Rd, Lee's Summit MO

Lee's Summit R-7 School Multistudio

14700 West 114th Terrace 4338 Belleview

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Lee's Summit, MO 64086 Kansas City, MO 64111

4200 Pennsylvania

structural engineer:

Kansas City, MO 64111

www.bdc-engrs.com

Bob D. Campbell &

816.931.6655

multi.studio

816.531.4144

Phys Education

Project Number:

301 NE Tudor Road

Kaw Valley Engineering

Lenexa, KS 66215

Henderson Engineers

Lenexa, KS 66214

816.742.5000

8345 Lenexa Drive, Suite

www.hendersonengineers.com

913.485.0318


MEPFT/Code::

kveng.com


UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS

AFFIXED. THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR

CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



GENERAL NOTES

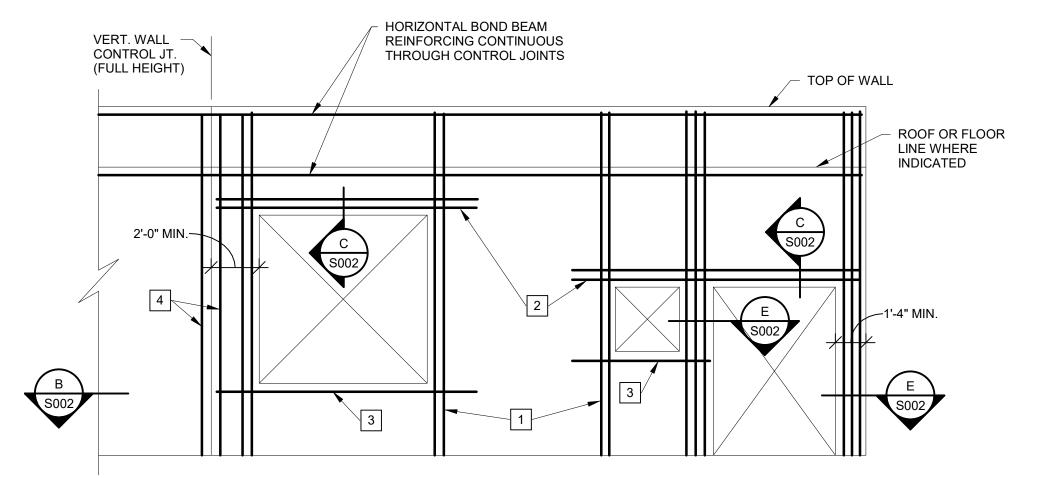


TYPICAL CMU WALL REINFORCING AT OPENINGS

- FULL HEIGHT VERTICAL BARS AS JAMB REINFORCING IN FIRST 2 CELLS ADJACENT TO OPENING. REINFORCE EACH CELL WITH SIZE & QUANTITY OF BAR TO MATCH WALL REINFORCING (1 BAR TYPICAL IN 8" WALLS AND 2 BARS TYPICAL IN 12" WALLS).
- 2 LINTEL REINFORCING PER SECTION C. EXTEND 2'-0" PAST EDGE OF OPENING ON EACH SIDE (TYPICAL). 2-#5 CONTINUOUS HORIZONTAL BARS AS SILL REINFORCING IN 8" COURSE BELOW OPENING (U.N.O.). EXTEND 2'-0" PAST EDGE OF OPENING ON EACH SIDE (TYPICAL).
- FULL HEIGHT VERTICAL BARS PER MASONRY VERTICAL REINFORCING SCHEDULE LOCATED IN END CELL AT EACH SIDE OF VERTICAL WALL CONTROL JOINTS.
- GENERAL CRITERIA: (SECTION A CONTINUED):
- 1. VERTICAL REINFORCING BARS SHALL BE DOWELED TO FOUNDATION WITH A DOWEL OF MATCHING SIZE
- AND SPACING. 2. CONTRACTOR SHALL COORDINATE AND VERIFY OPENINGS IN MASONRY WALLS. OPENINGS SHALL BE DETAILED ON REINFORCING STEEL SHOP DRAWING ELEVATIONS. 3. VERTICAL CONTROL JOINTS IN MASONRY WALLS SHALL BE 3/8" WIDE, FULL HEIGHT OF WALL. JOINTS SHALL
- BE SPACED AT A MAXIMUM OF 24'-0" ON CENTER AND NOT LESS THAN 2'-0" FROM THE EDGE OF ANY OPENING. ALL HORIZONTAL JOINT REINFORCING SHALL BE DISCONTINUOUS AT CONTROL JOINTS. ALL BOND BEAM HORIZONTAL REINFORCING SHALL BE CONTINUOUS THROUGH CONTROL JOINTS. CONTRACTOR SHALL COORDINATE AND VERIFY ALL CONTROL JOINT LOCATIONS.

LOCATION	VERTICAL REINF. (IN GROUTED CELLS)	SPACING						
ALL 8" WALLS (U.N.O.)	1- #5	32"oc						
ALL 12" WALLS (U.N.O.)	2- #5	16"oc						
NOTES: 1. IN ADDITION TO SPACING SHOWN IN SCHEDULE, VERTICAL REINFORCING SHALL BE PROVIDED IN GROUTED CELLS AT THE FOLLOWING LOCATIONS A.) IN THE FIRST 2 CELLS ADJACENT TO EACH OPENING B.) IN THE END CELLS ON EACH SIDE OF VERTICAL CONTROL JOINTS C.) IN THE END CELLS OF EACH LENGTH OF WALL D.) AT EACH CORNER OF WALLS								
	ALL 8" WALLS (U.N.O.) ALL 12" WALLS (U.N.O.) SPACING SHOWN IN SCHEL GROUTED CELLS AT THE IT IS CELLS ON EACH SIDE OF V	ALL 8" WALLS (U.N.O.) ALL 12" WALLS (U.N.O.) 3-#5 CPACING SHOWN IN SCHEDULE, VERTICAL REINFORMUTED CELLS AT THE FOLLOWING LOCATION 2 CELLS ADJACENT TO EACH OPENING CELLS ON EACH SIDE OF VERTICAL CONTROL JOINE CELLS ON EACH SIDE OF VERTICAL CONTROL						

A CMU WALL ELEVATION

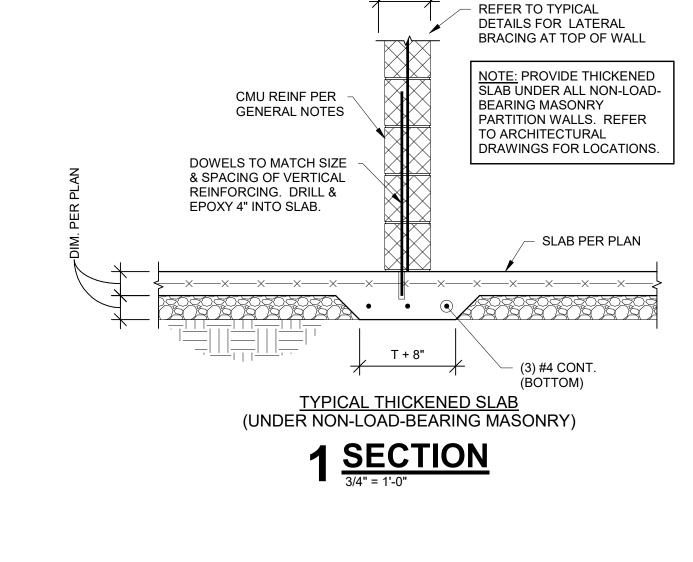

NOTE: REINFORCING

SHALL BE PLACED IN

TO GROUTING.

MORTAR CMU

ADJACENT TO

GROUTED

VOIDS (TYP.)

1 BAR DIAMETER

NOTE: VERTICAL REINFORCING

SHALL BE +/-1/4"

FROM LOCATIONS

ALL MORTAR PROJECTIONS

SHALL BE LESS THAN 1/2"

BEYOND INSIDE FACE OF

INTO GROUTED VOIDS

PLACEMENT

NOTED.

MASONRY.

CLEAR GROUT

COVER

WEBS

POSITIONEERS PRIOR

2 5/8" +/--

3" +/-

NOTE: ALL MASONRY VOIDS AND BOND BEAMS TO

MORTAR DROPPINGS PRIOR TO GROUTING. ANY

MASONRY w/ DROPPINGS OR DEBRIS OBSERVED IN

TYPICAL REBAR POSITIONING DETAIL

B <u>SECTION</u>

BE GROUTED SHALL BE FREE OF DEBRIS AND

VOIDS SHALL BE REJECTED.

2 5/16" +/--

ADJUSTMENTS TO DIMENSIONS TO PROVIDE

ACCEPTABLE, BUT ALL ADJUSTMENTS SHALL

CONSTRUCTION AND SHALL NOT EXCEED 1/4".

12" CMU WALL

8" CMU WALL

GROUT VOID (TYP.).

FOR 12" CMU WALL

MAXIMUM OF 32" o.c.

WIRE (MIN.) & HOT DIP

LAPPING BAR LOCATION

SINGLE BAR REINFORCING

FOR NEXT LIFT (TYP.)

FOR 8" CMU WALL

GALVANIZED.

RECONSOLIDATE GROUT w/

DOUBLE BAR REINFORCING

MECHANICAL VIBRATOR (TYP.)

REBAR POSITIONERS SHALL BE

PROVIDED TO SUPPORT BOTH

ENDS OF EACH BAR AND AT A

POSITIONER SHALL BE 9 GA.


CONSOLIDATE &

DEFINED CLEAR GROUT COVER ARE

-2 5/16" +/-

→ CMU WALL CENTERLINE

BE APPROVED BY ENGINEER PRIOR TO

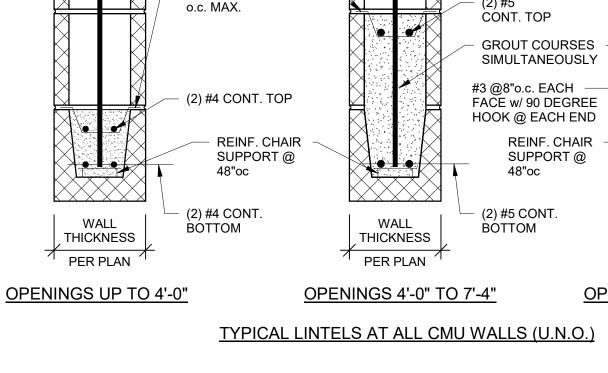

TYPICAL MASONRY REINFORCING NOTE:

ALL INTERIOR & EXTERIOR MASONRY WALLS SHOWN ON ARCHITECTURAL

BOND BEAMS (2 - #5 BOTTOM) AT BOTTOM COURSE, TOP COURSE, JOIST

INDICATED ON DRAWINGS. THESE WALLS ARE TO BE ANCHORED TOP AND

2'-6" MINIMUM). FILL BLOCK CELLS AND BOND BEAMS WITH 2,500psi GROUT.

RE: DETAILS "A" THROUGH "E" ON THIS SHEET.

REBAR POSITIONER

OR SUPPORT @ 48"

BOTTOM TO THE FOUNDATION, FLOOR, OR ROOF PER TYPICAL DETAILS. THE

VERTICAL REINFORCING IS CONTINUOUS (IN 6'-6" MAXIMUM LENGTHS, LAPPED

REBAR POSITIONER

2-#6 CONT

(TOP)


OR SUPPORT @ 48"

o.c. MAX.

BEARING ELEVATION AND AT 8'-0" MAXIMUM O.C. AND VERTICALLY AS

AND STRUCTURAL DRAWINGS ARE TO BE REINFORCED HORIZONTALLY WITH

C SECTION

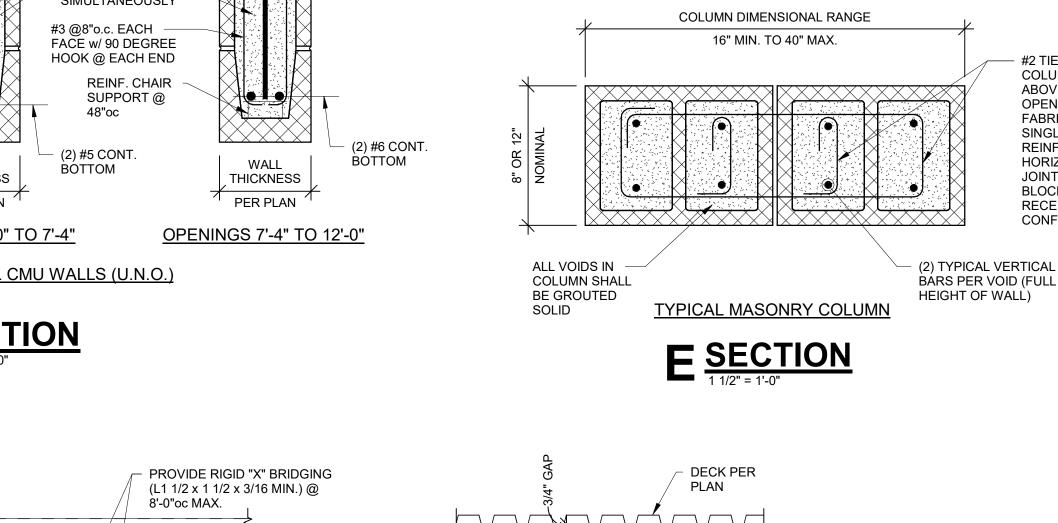

"KNOCKOUT" (K.O.) or TROUGH BOND BEAM BLOCK (TYPICAL UNIT EXCEPT @

DOOR OPENINGS; SOLID BOTTOM BOND

STOP (RE: SPECS.) UNDER K.O. BOND

BE REINFORCED AND GROUTED.

SLOTS

BEAM SHALL BE USED). PROVIDE GROUT

BEAMS OVER CELLS WHICH ARE NOT TO

#2 TIES @8"oc THROUGH

ABOVE AND BELOW

SINGLE LAYER OF TIE

HORIZONTAL MORTAR

JOINT. CUT WEBS OF

RECEIVE TIES WHERE

CONFLICTS OCCUR.

BLOCK AS REQUIRED TO

COLUMN HEIGHT PLUS 2'-0"

FABRICATED TO MAINTAIN A

OPENING. TIES SHALL BE

REINFORCING WITHIN THE

TOP BOND BEAM

(REINFORCING NOT

— SAW CUT OR

SPECIAL BLOCK

TYPICAL BOND BEAM DETAIL AT CORNER OF CMU WALL

DETAIL

OUTPUT

OR K.O. BLOCK

SHOWN FOR


CLARITY)

PROVIDE CORNER


CONTINUOUS BOND

BEAM REINFORCING

BARS TO MATCH

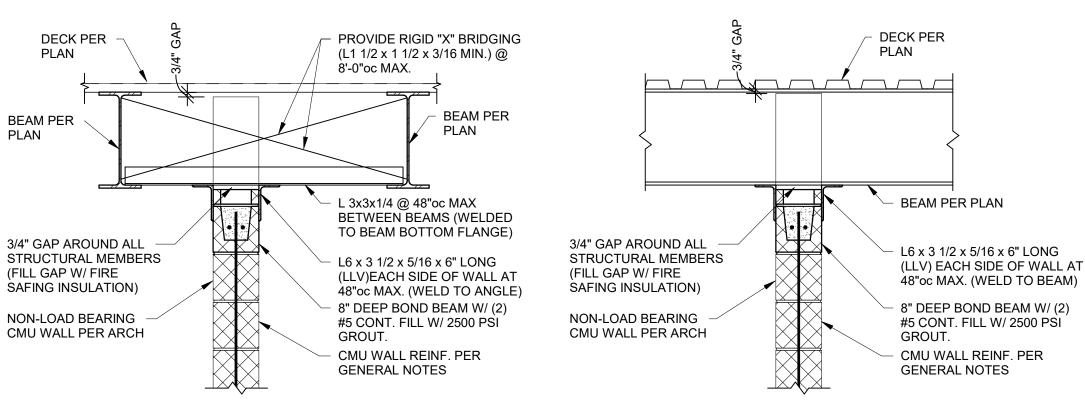


WALL PARALLEL TO BEAM WALL PERPENDICULAR TO BEAM TYPICAL BRACING DETAILS FOR NON-LOAD-BEARING CMU WALLS THAT EXTEND TO DECK (REFER TO ARCHITECTURAL DRAWINGS FOR LOCATION)

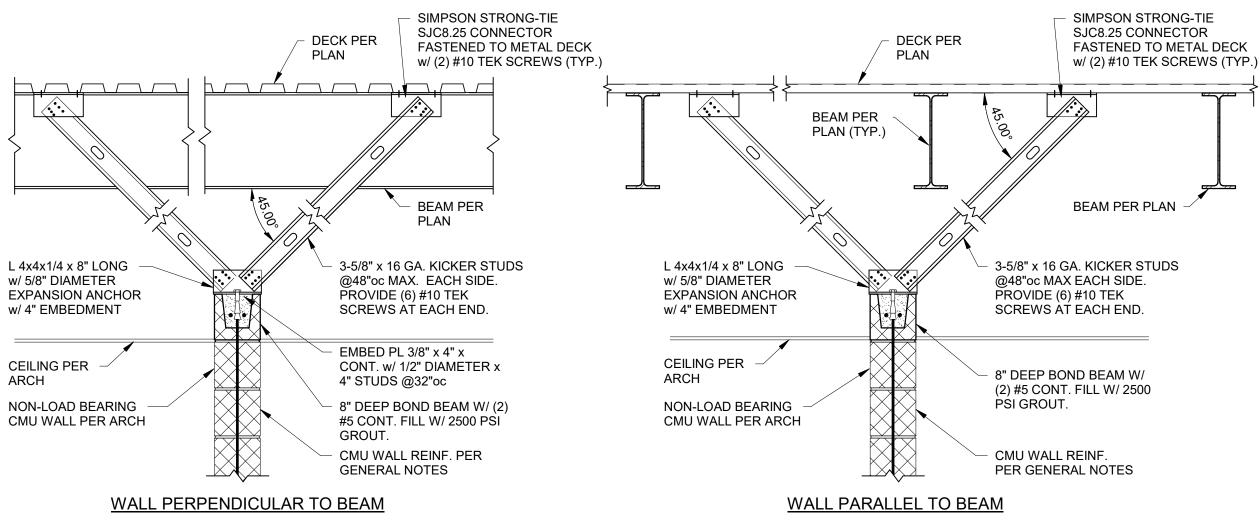


TYPICAL BRACING DETAILS FOR NON-LOAD-BEARING CMU WALLS THAT DO NOT EXTEND TO DECK (REFER TO ARCHITECTURAL DRAWINGS FOR LOCATION)

3 SECTION

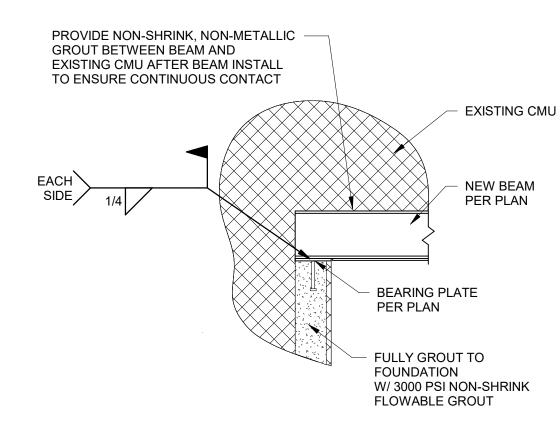

TYPICAL STEEL BEAM LINTEL BEARING ON EXISTING CMU WALL

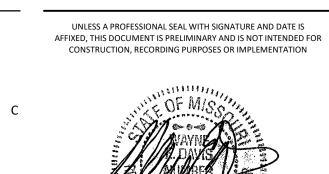

CMU DETAILS

September 9, 2022

Issue Date:

Revisions

LSR7 Robotics, GiC &

LSN: 901 NE Douglas St., Lee's Summit MO

LSW: 2600 SW Ward Rd, Lee's Summit MO

Lee's Summit R-7 School Multistudio

14700 West 114th Terrace 4338 Belleview

Lee's Summit, MO 64086 Kansas City, MO 64111

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

4200 Pennsylvania

structural engineer:

Kansas City, MO 64111

www.bdc-engrs.com

Bob D. Campbell &

816.531.4144

816.931.6655

multi.studio

Phys Education

64082

Project Number:

301 NE Tudor Road

Kaw Valley Engineering

Lenexa, KS 66215

Henderson Engineers

Lenexa, KS 66214

816.742.5000


8345 Lenexa Drive, Suite


www.hendersonengineers.com

913.485.0318

kveng.com

MEPFT/Code::



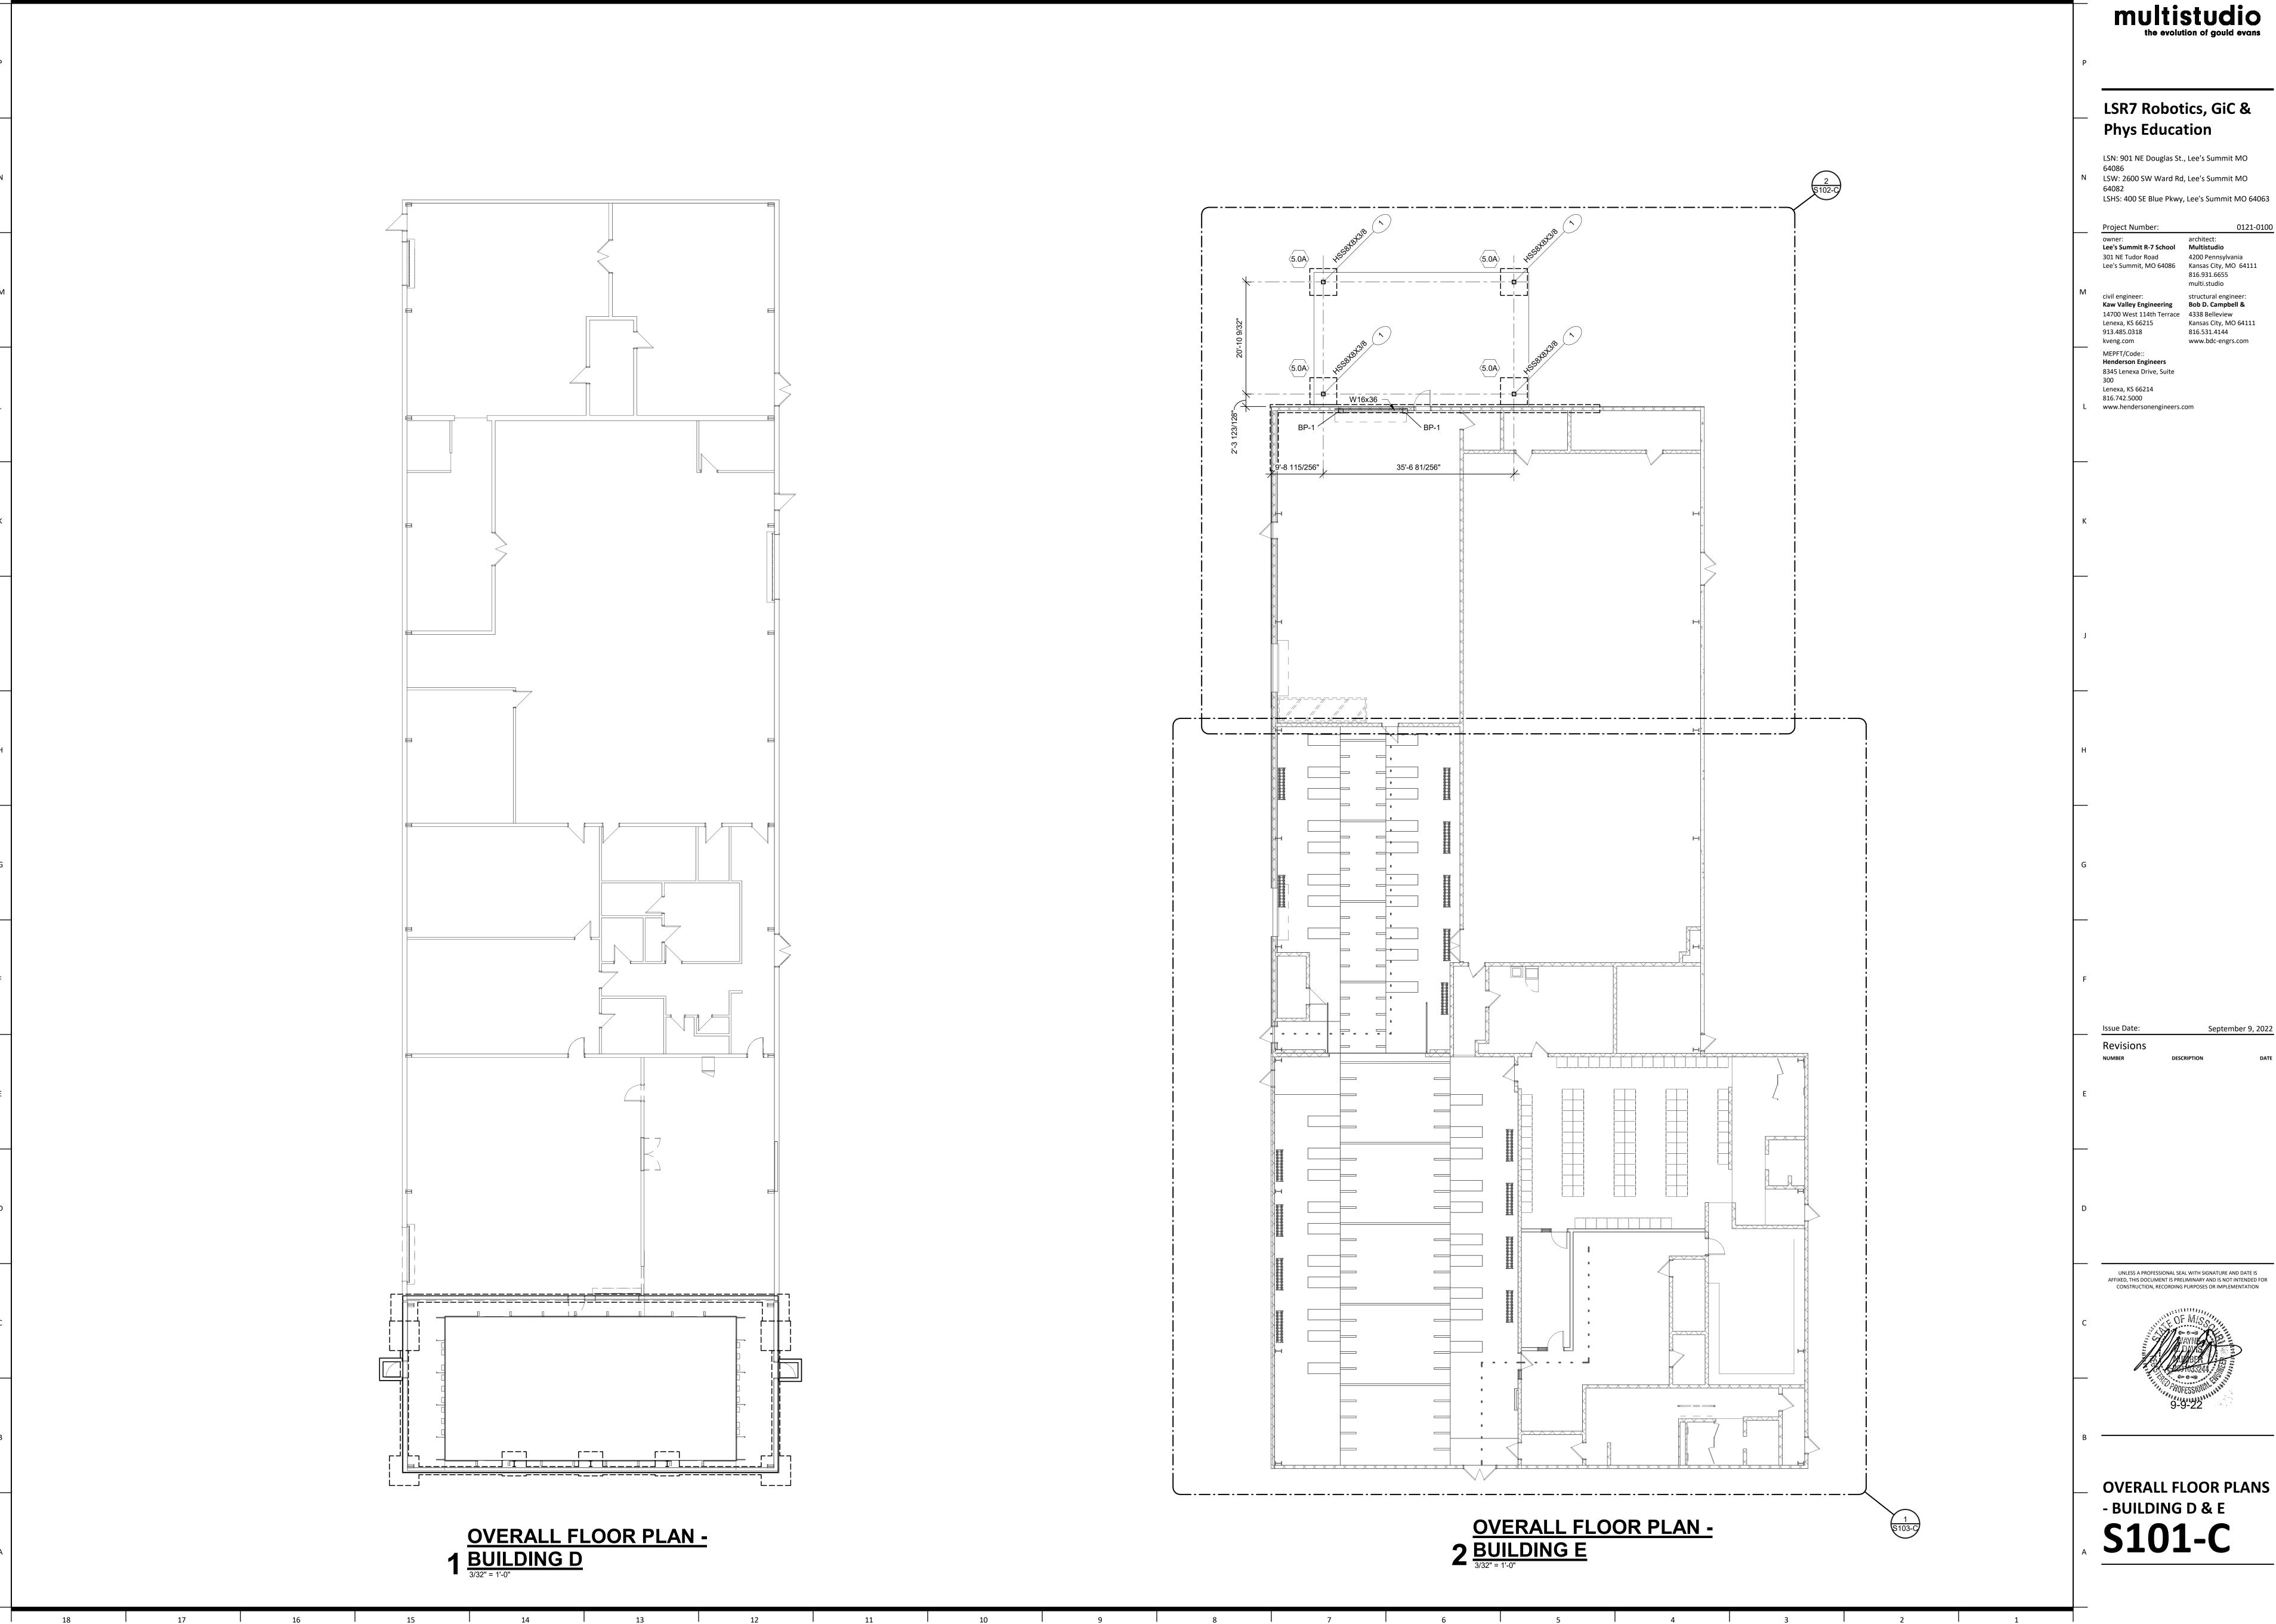

LSR7 Robotics, GiC &

LSN: 901 NE Douglas St., Lee's Summit MO LSW: 2600 SW Ward Rd, Lee's Summit MO


Lee's Summit R-7 School Multistudio 4200 Pennsylvania Lee's Summit, MO 64086 Kansas City, MO 64111

structural engineer: Kaw Valley Engineering Bob D. Campbell & 14700 West 114th Terrace 4338 Belleview Kansas City, MO 64111 816.531.4144 www.bdc-engrs.com

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS



OVERALL FLOOR PLANS - BUILDING D & E

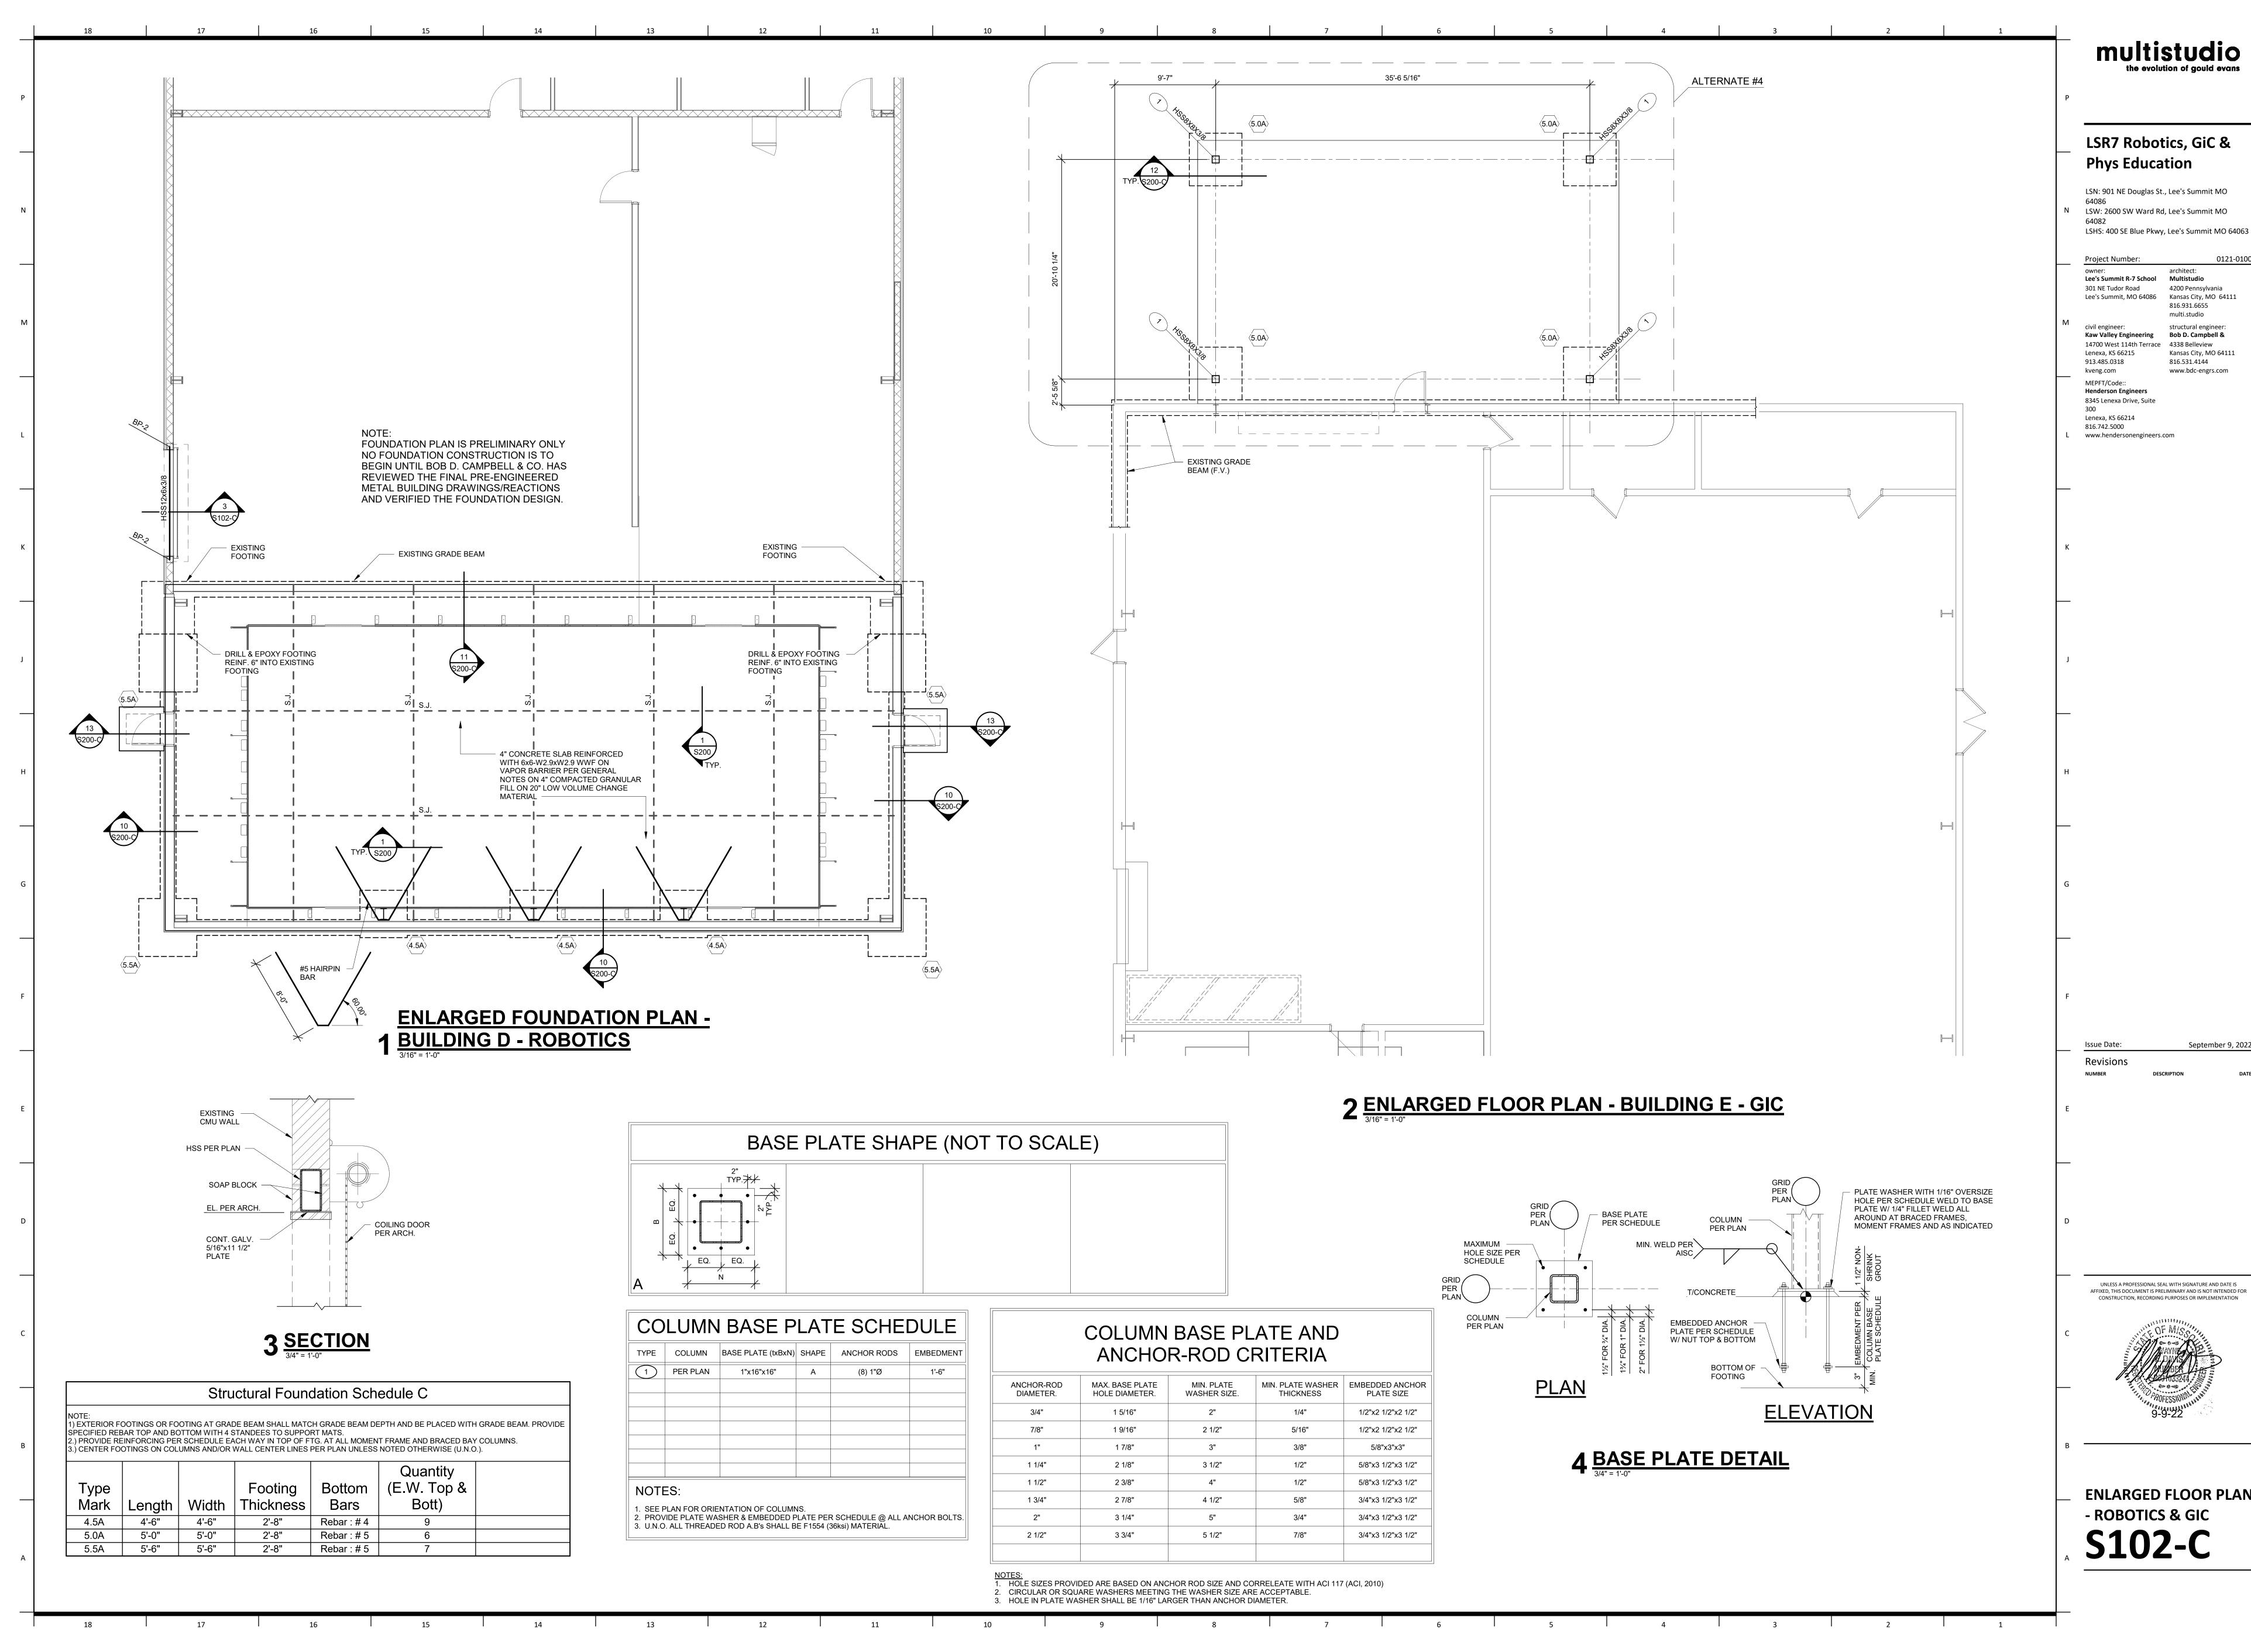

LSR7 Robotics, GiC & **Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO LSW: 2600 SW Ward Rd, Lee's Summit MO

Project Number: 301 NE Tudor Road

Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655 structural engineer: Kaw Valley Engineering Bob D. Campbell & 14700 West 114th Terrace 4338 Belleview

Lenexa, KS 66215 Kansas City, MO 6411 913.485.0318 www.bdc-engrs.com kveng.com

MEPFT/Code:: **Henderson Engineers** 8345 Lenexa Drive, Suite

Lenexa, KS 66214

816.742.5000 www.hendersonengineers.com

AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR




ENLARGED FLOOR PLAN - ROBOTICS & GIC



Kansas City, MO 64111


UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS



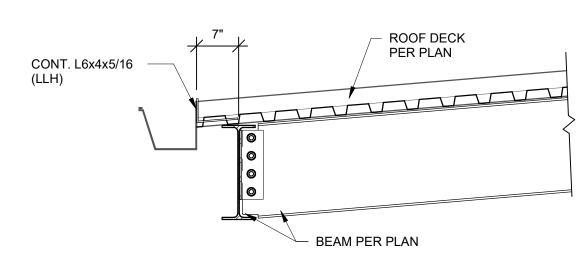


2 **SECTION**3/4" = 1'-0"


(ALTERNATE #4)

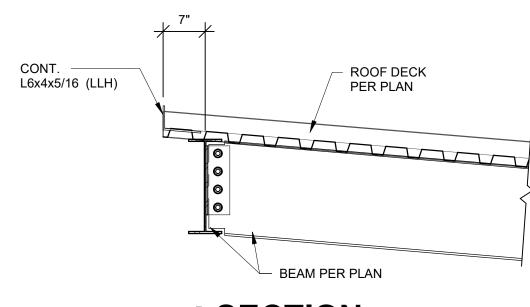

(ALTERNATE #4)

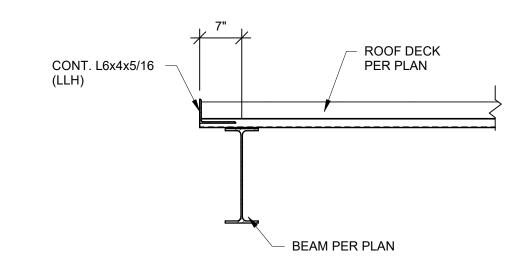


3 **SECTION**3/4" = 1'-0" (ALTERNATE #4)

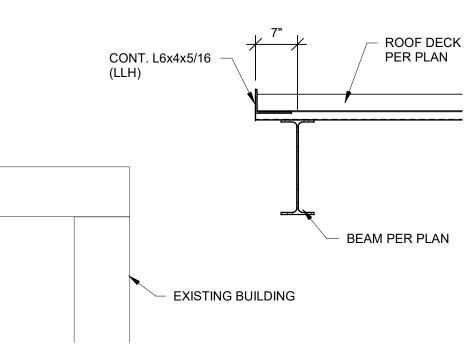

5 **SECTION**3/4" = 1'-0"



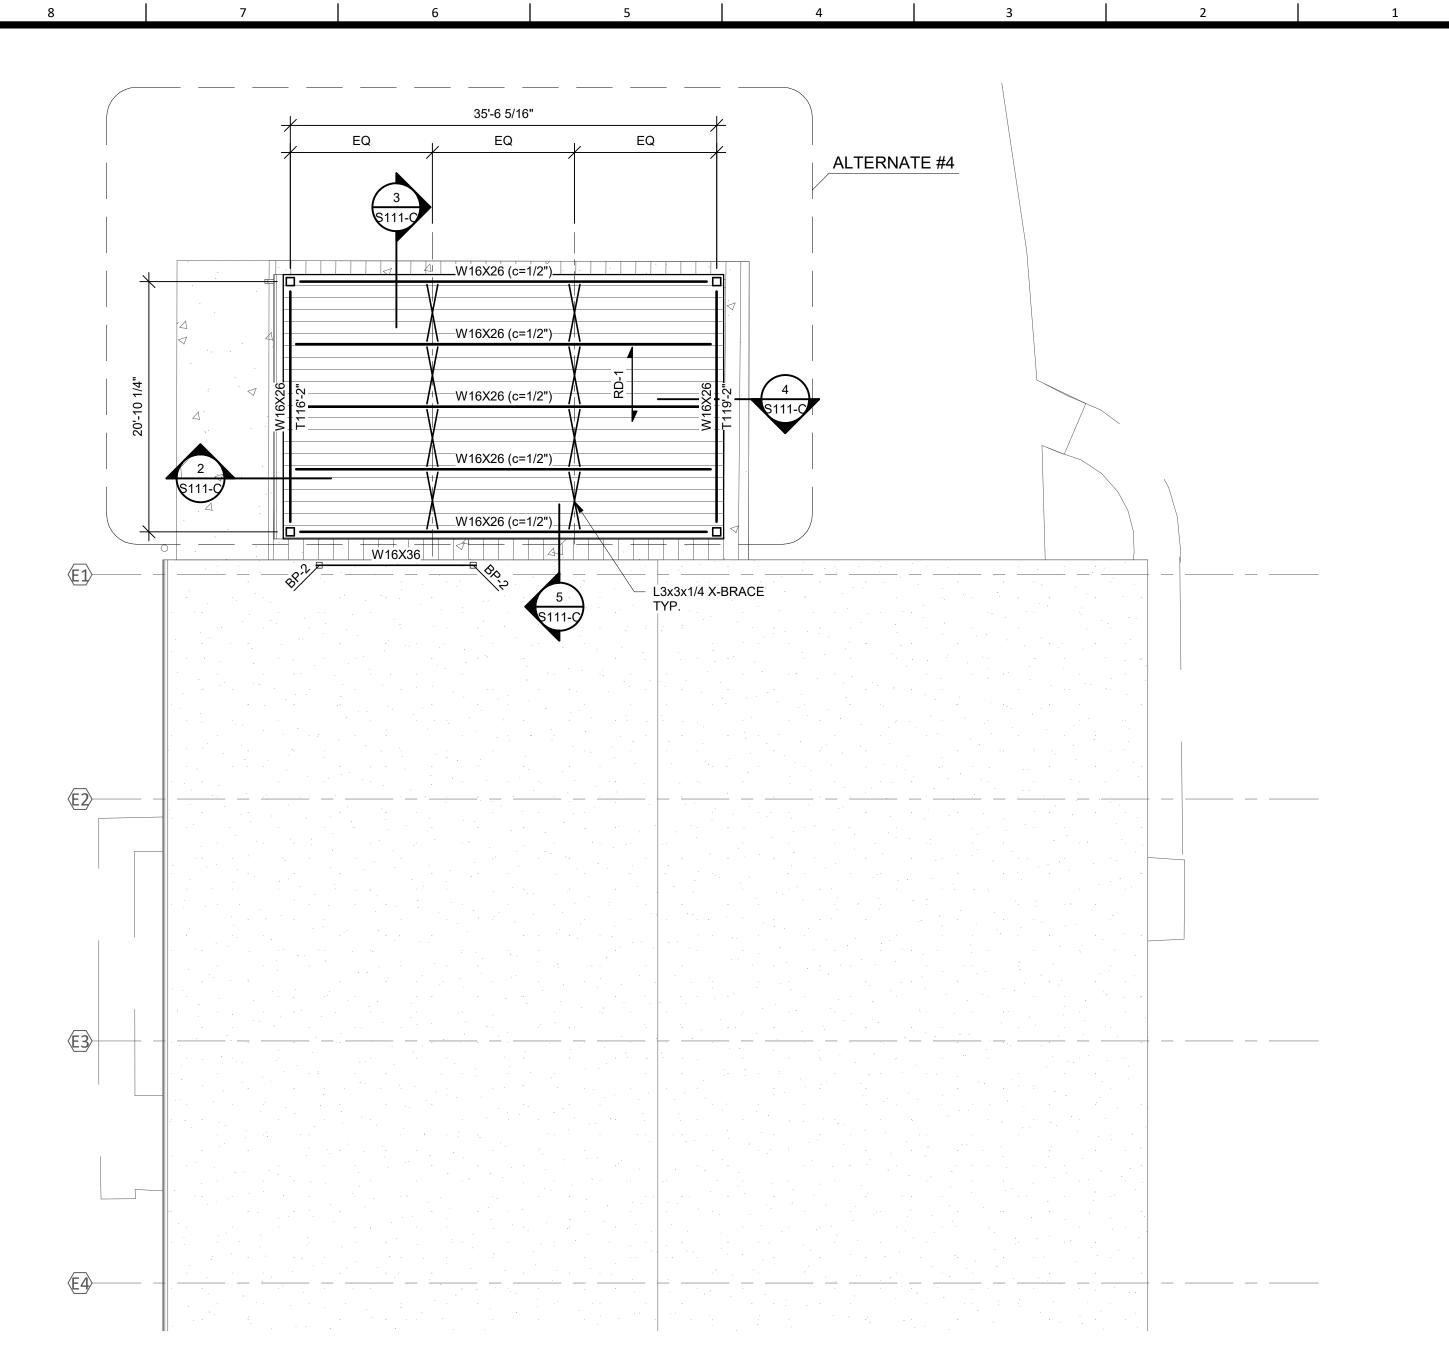

1 ROOF FRAMING PLAN

1/8" = 1'-0"

LSR7 Robotics, GiC & **Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO N LSW: 2600 SW Ward Rd, Lee's Summit MO 64082

Project Number: Lee's Summit R-7 School Multistudio 301 NE Tudor Road 4200 Pennsylvania Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655


LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

multi.studio civil engineer: structural engineer:
Kaw Valley Engineering Bob D. Campbell & 14700 West 114th Terrace 4338 Belleview Lenexa, KS 66215 Kansas City, MO 64111 816.531.4144 913.485.0318 kveng.com www.bdc-engrs.com


MEPFT/Code:: **Henderson Engineers** 8345 Lenexa Drive, Suite Lenexa, KS 66214 816.742.5000 www.hendersonengineers.com

Issue Date: September 9, 2022

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



ROOF FRAMING PLAN

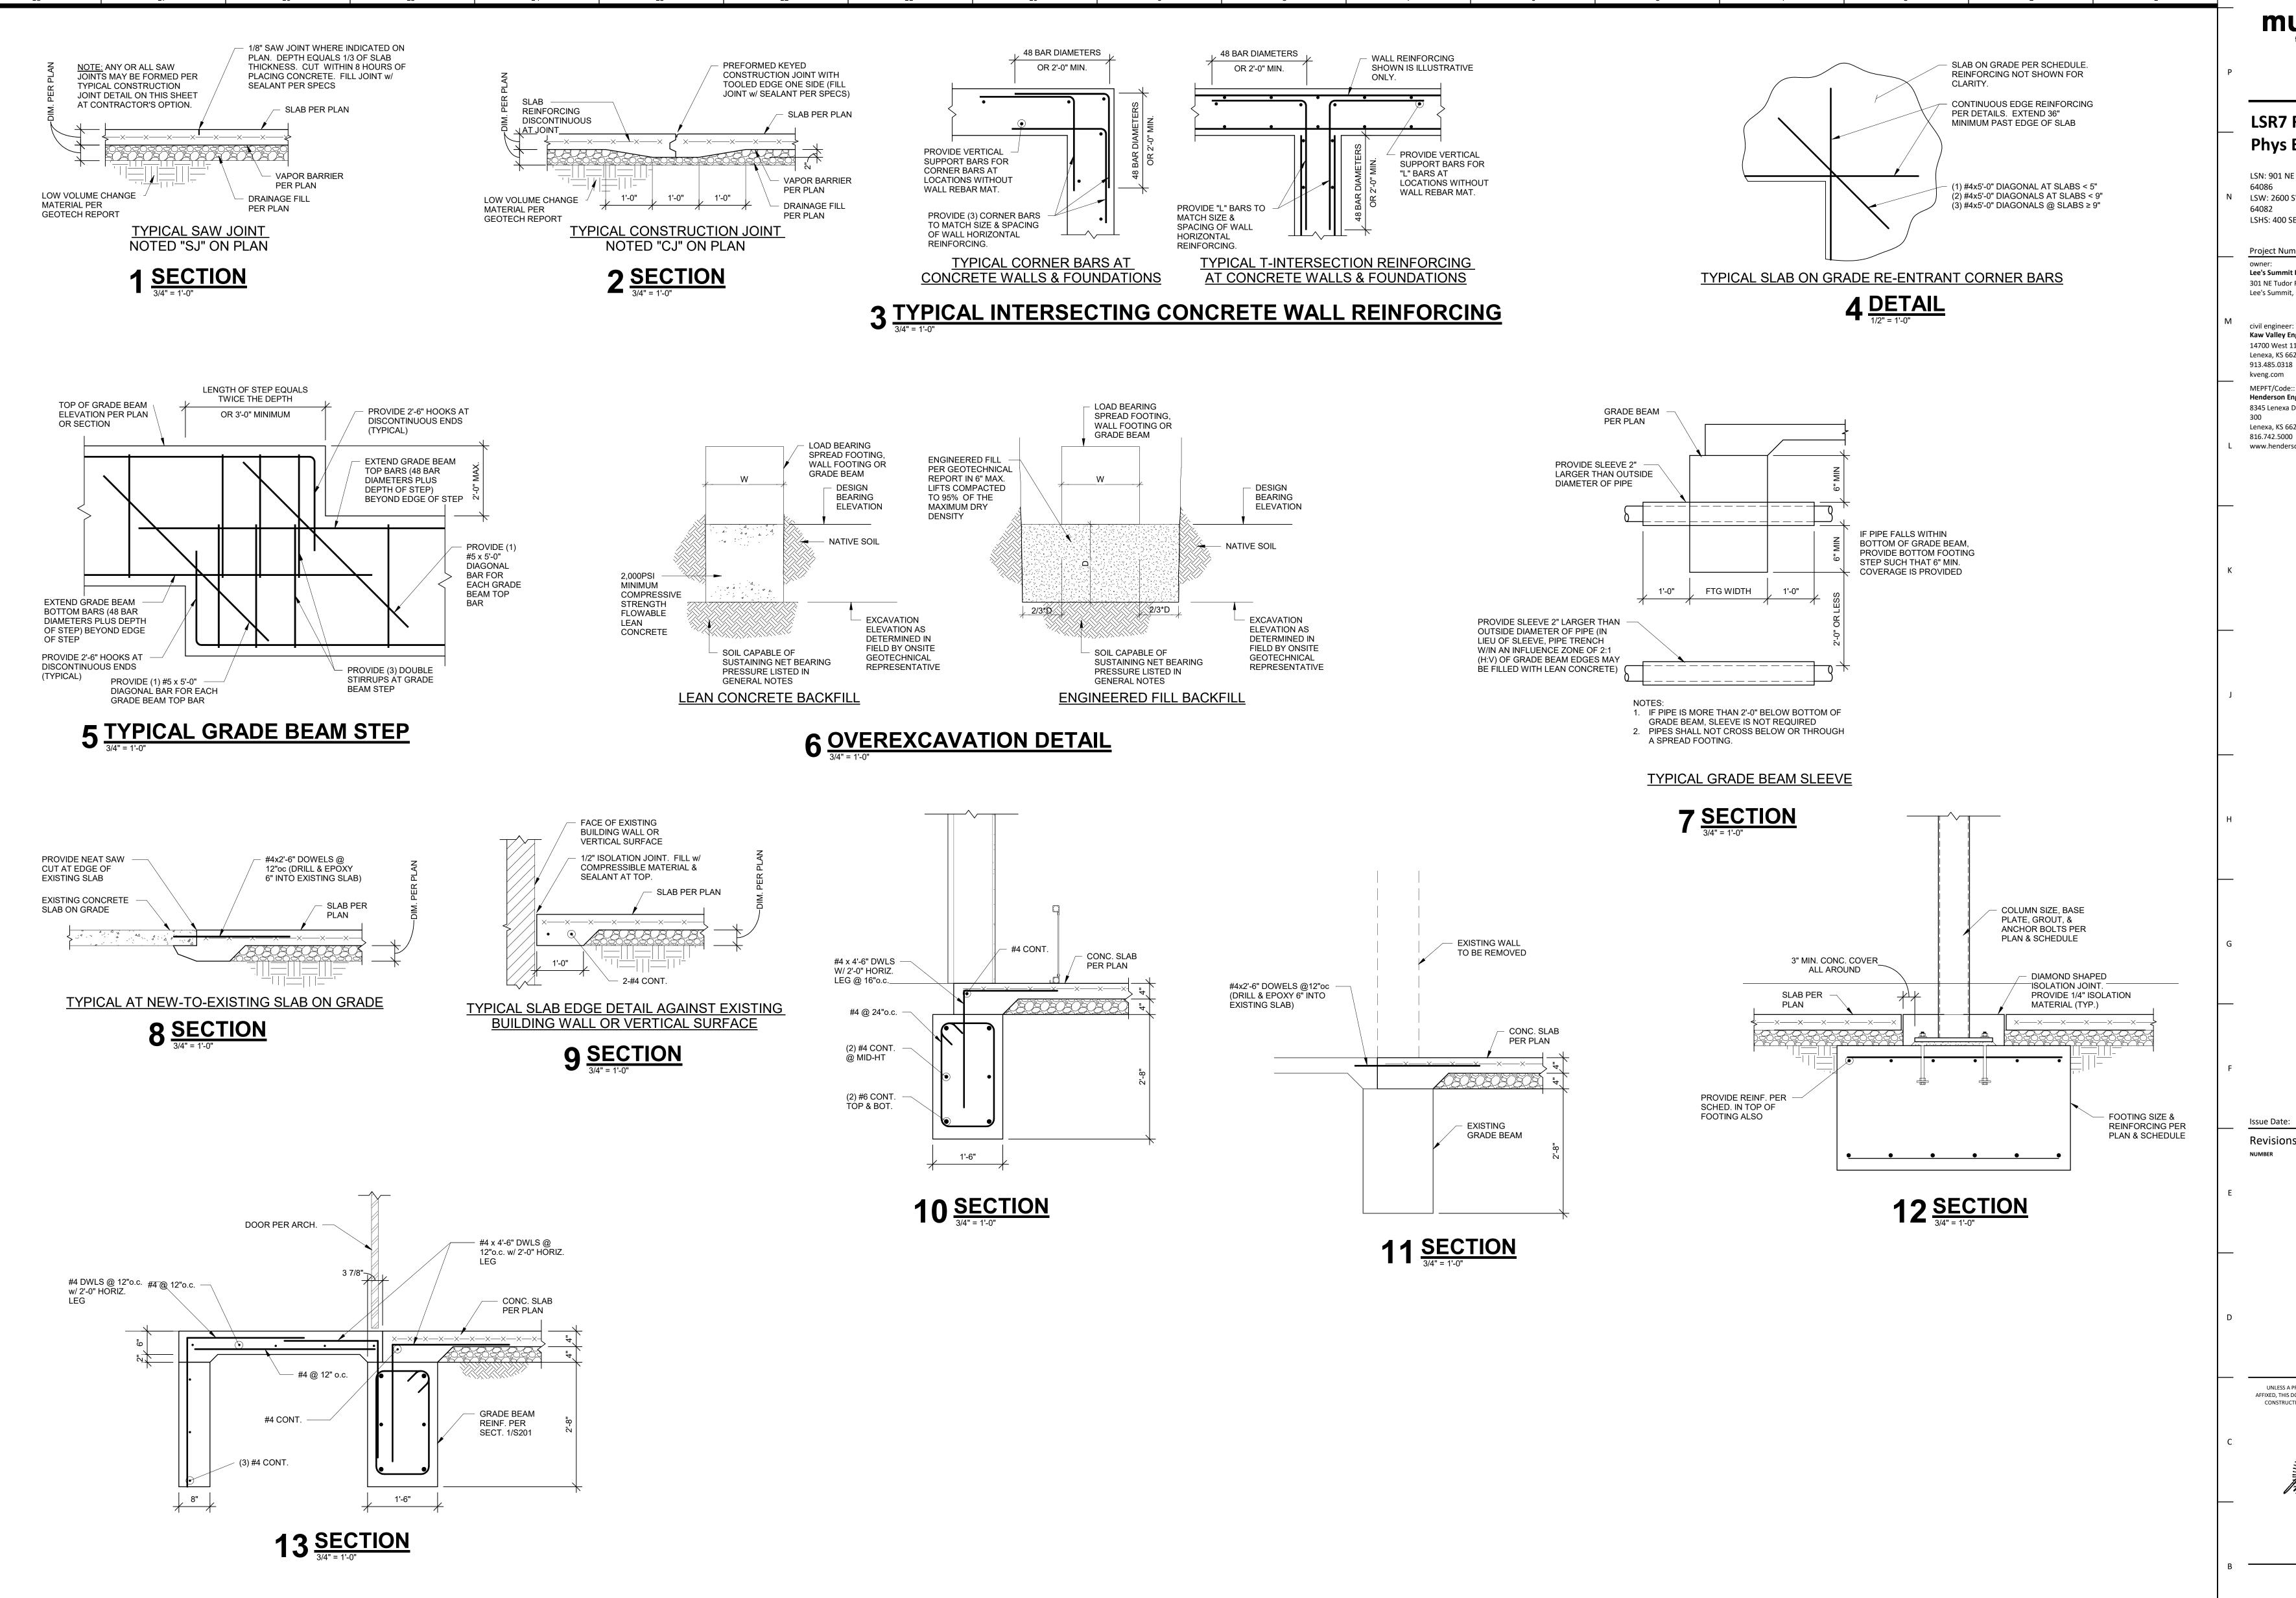

LSR7 Robotics, GiC & **Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO LSW: 2600 SW Ward Rd, Lee's Summit MO

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063 Project Number:

Lee's Summit R-7 School Multistudio 301 NE Tudor Road 4200 Pennsylvania Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655 multi.studio

structural engineer: Bob D. Campbell & Kaw Valley Engineering 14700 West 114th Terrace 4338 Belleview Lenexa, KS 66215 Kansas City, MO 64111 913.485.0318 816.531.4144 www.bdc-engrs.com

MEPFT/Code::


Henderson Engineers 8345 Lenexa Drive, Suite Lenexa, KS 66214 816.742.5000 www.hendersonengineers.com

September 9, 2022

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



FOUNDATION SECTIONS S200-C

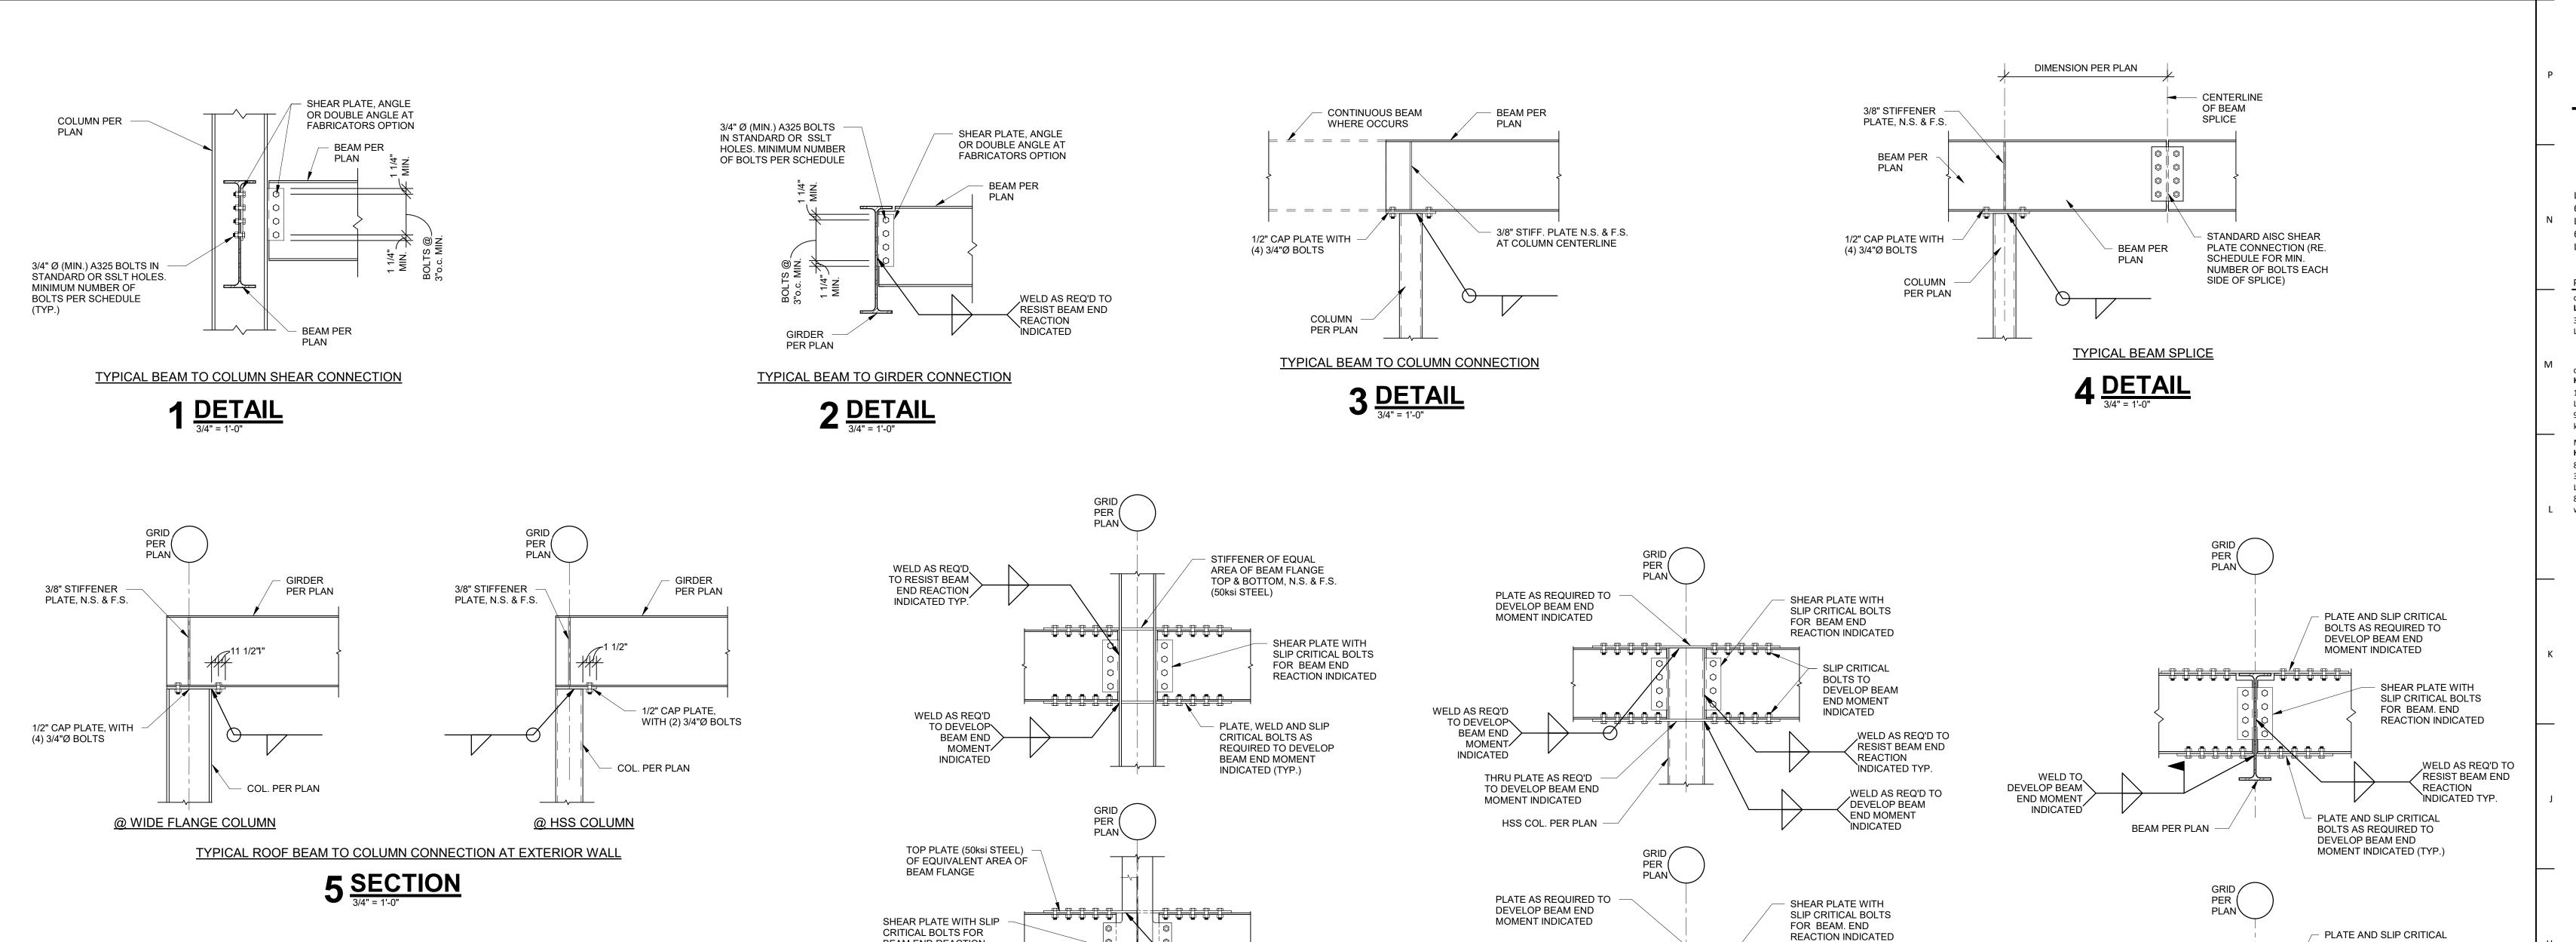

WELD AS REQ'D

WELD AS REQ'D TO

RESIST BEAM END

INDICATED TYP.

REACTION

TO DEVELOP\

BEAM END

INDICATED

MOMENT/

THRU PLATE AS REQ'D

TO DEVELOP BEAM END

HSS COL.

PER PLAN

TYPICAL BEAM TO HSS COLUMN MOMENT CONNECTIONS

MOMENT INDICATED

BEAM END REACTION

WELD AS REQ'D

TO DEVELOP\

BEAM END

INDICATED

MOMENT/

PLATE AND SLIP CRITICAL

MOMENT INDICATED (TYP.)

TYP. BEAM TO WIDE FLANGE COL. MOMENT CONNECTIONS NOTE: FLANGE PLATES MAY BE FULL PENETRATION

WELDED TO COLUMN AT CONTRACTORS OPTION

18 | 17 | 16 | 15 | 14 | 13 | 12 | 11 | 10 | 9 | 8 | 7 | 16 | 5 | 4 | 1 3 | 2

6 **SECTION**

BOLTS AS REQUIRED TO

DEVELOP BEAM END

INDICATED

BEAM SHEAR CONNECTION SCHEDULE

SLIP CRITICAL

DEVELOP BEAM

WELD AS REQ'D TO

WELD AS REQ'D TO

RESIST BEAM END

INDICATED TYP.

DEVELOP BEAM

NOMENT
 NOMENT

END MOMENT

BOLTS TO

INDICATED

OOMINEO HOM OOHEDOLE									
BEAM SIZE	MINIMUM ROWS OF BOLTS	END REACTION (kips)(U.N.O.)							
W8,C8	2	16							
W10,C10	2	16							
W12,C12	2	16							
W14	3	24							
W16, C15	3	24							
W18	4	32							
W21	5	40							
W24	5	40							
W27	6	48							
W30	7	56							
W33	8	64							
W36	8	64							

STEEL CONNECTION NOTES:

BEAM PER PLAN

PLATE AND SLIP CRITICAL

BOLTS AS REQUIRED TO

INDICATED

DEVELOP BEAM END MOMENT

- 1. REFER TO GENERAL NOTES ON SHEET S001.
- CONNECTIONS SHOWN IN THESE DETAILS ARE MINIMUM REQUIREMENTS.
- . FABRICATOR SHALL BE RESPONSIBLE FOR THE ENGINEERING, DESIGNING, AND DETAILING OF EACH CONNECTION FOR LOADS SHOWN ON THE DRAWINGS IN ACCORDANCE WITH THE SPECIFICATIONS AND THE STRUCTURAL GENERAL NOTES.

TYP. BEAM TO BEAM MOMENT CONNECTIONS

BOLTS AS REQUIRED TO

SHEAR PLATE WITH

FOR BEAM. END

REACTION

INDICATED TYP.

SLIP CRITICAL BOLTS

REACTION INDICATED

WELD AS REQ'D TO RESIST BEAM END

DEVELOP BEAM END MOMENT INDICATED

- I. SUGGESTED CONNECTION DETAILS ARE SHOWN. FINAL CONNECTION CONFIGURATION AND DESIGN SHALL BE COMPLETED BY THE CONNECTION ENGINEER. CONNECTION DESIGN SHALL INCLUDE COLUMN OR BEAM CONTINUITY PLATES, WEB STIFFENERS, AND/OR DOUBLER PLATES AS REQUIRED FOR THE FORCES INDICATED.
- 5. FABRICATOR MAY OPT TO USE OTHER AISC APPROVED CONNECTIONS IN LIEU OF THESE SHOWN HEREIN TO MEET END REACTION REQUIREMENTS (i.e. DOUBLE ANGLE CONNECTION). 6. CONNECTION DETAILING SHALL COMPLY WITH THE STANDARD
- DETAILS SHOWN IN THE LATEST EDITION OF THE AISC MANUAL OF STEEL CONSTRUCTION.
- 7. ALL BOLTS SHALL BE 3/4" Ø ASTM A325 MINIMUM.
- 8. ALL BOLTS SHALL BE SPACED AT 3"o.c. MINIMUM. 9. ALL BOLTS SHALL HAVE HEAVY HEX NUTS.
- 10. ALL BOLTS SHALL BE FULLY PRE-TENSIONED. 11. BOLT SPACING AND EDGE DISTANCES SHALL BE ADJUSTED PER AISC MANUAL FOR BOLTS LARGER THAN 3/4" DIAMETER. 12. CLIP ANGLES MAY BE SHOP WELDED TO BEAM WEB PER AISC.
- 13. FOR BEAMS WITH AXIAL LOADS PER DRAWINGS, BOLTS AND CONNECTIONS SHALL BE SLIP-CRITICAL PER AISC GUIDELINES. INCREASE NUMBER OF BOLTS AND/OR PROVIDE EXTENDED SHEAR PLATE CONNECTION W/ AN ADDITIONAL COLUMN OF BOLTS TO
- ACCOMODATE COMBINED FORCES. 14. PROVIDE ASTM A490 BOLTS IF REQUIRED TO MEET END REACTION LOAD REQUIREMENTS.
- 15. REFER TO ELEVATIONS ON SHEET S FOR BRACE FORCES. REFER TO PLANS FOR ADDITIONAL BEAM AXIAL FORCES. BRACE AND BEAM FORCES INDICATED ARE UNFACTORED (ASD) LOADS AND SHALL BE CONSIDERED CONCURRENT W/ BEAM SHEAR
- SCHEDULE. 16. COORDINATE BRACED FRAME CONNECTION W/ ARCHITECTURAL
- WALLS AS REQUIRED TO AVOID CONFLICT OR EXPOSURE OUTSIDE OF WALL OR FINISH. 17. ALL END REACTIONS INDICATED ARE UNFACTORED (ASD) LOADS.

DESIGN FORCES LISTED IN THE BEAM SHEAR CONNECTION

LSR7 Robotics, GiC & **Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO LSW: 2600 SW Ward Rd, Lee's Summit MO

04002	
LSHS: 400 SE Blue Pkwy	, Lee's Summit MO 640
Project Number:	0121-0
owner:	architect:
Lee's Summit R-7 School	Multistudio
301 NE Tudor Road	4200 Pennsylvania

Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655 multi.studio structural engineer: Kaw Valley Engineering Bob D. Campbell &

14700 West 114th Terrace 4338 Belleview Lenexa, KS 66215 Kansas City, MO 64111 913.485.0318 816.531.4144 www.bdc-engrs.com kveng.com MEPFT/Code:: **Henderson Engineers**

8345 Lenexa Drive, Suite Lenexa, KS 66214 816.742.5000 www.hendersonengineers.com

Issue Date: September 9, 2022 Revisions

> UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



FRAMING SECTIONS



LSR7 Robotics, GiC & **Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO LSW: 2600 SW Ward Rd, Lee's Summit MO

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063 Proiect Number:

structural engineer:

Lee's Summit R-7 School Multistudio 301 NE Tudor Road 4200 Pennsylvania Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655 multi.studio

Kaw Valley Engineering Bob D. Campbell & 14700 West 114th Terrace 4338 Belleview Lenexa, KS 66215 Kansas City, MO 64111 913.485.0318 816.531.4144 www.bdc-engrs.com kveng.com MEPFT/Code:: **Henderson Engineers**

8345 Lenexa Drive, Suite 8. CONTRACTOR IS RESPONSIBLE FOR CONSTRUCTION OF TEMPORARY DUST AND NOISE PROOF PARTITION Lenexa, KS 66214 BETWEEN CONSTRUCTION AREA AND ADJACENT 816.742.5000 www.hendersonengineers.com 9. NOTIFY THE BUILDING OWNER OF ANY MATERIALS,

ITEMS TO THE BUILDING OWNER IN GOOD CONDITION. 10. ALL DEMOLITION MATERIALS NOT CLAIMED BY THE OWNER, OR TO BE REUSES ARE TO BE DISPOSED OF OFF SITE AS PER LOCAL REGULATIONS AT THE

FIXTURES, ETC. THAT ARE TO BE REMOVED THAT ARE DEEMED SALVAGEABLE TURN OVER ANY REQUESTED

General Notes (Demolition):

THIS DEMOLITION PLAN OUTLINES THE SCOPE OF THE WORK INVOLVED FOR THE DEMOLITION PHASE

OF THIS PROJECT. CONTRACTOR SHALL ALSO REFER

NEW ADDITION FOR ADDITIONAL INFORMATION.

OBTAINED FROM DOCUMENTS AND INFORMATION

SUPPLIED TO THE ARCHITECT, THE CONTRACTOR IS

TO VERIFY EXACT LOCATIONS, SIZES, ELEVATIONS,

ETC. AND REPORT ANY DISCREPANCIES TO THE

ENCOUNTERED STOP WORK IMMEDIATELY AND

NOTIFY OWNER. DO NOT RESUME WORK UNTIL

BY THE OWNER AS NECESSARY PRIOR TO THE

ALL FURNITURE WILL BE REMOVED OR RELOCATED

SHALL COORDINATE WITH OWNER AS REQUIRED.

INDICATED ON THE DRAWINGS. SHOULD ANY

TO REMAIN ON SITE, THE CONTRACTOR SHALL

ALL EXISTING UTILITIES PRIOR TO DEMOLITION

. CONTRACTOR SHALL PROTECT ALL EXISTING

ALL OTHER ADJACENT FACILITIES.

PROPERTIES AS NECESSARY

AND SOILING DURING DEMOLITION. REMOVE

REMOVE EXISTING CONSTRUCTION TO THE EXTENT

DAMAGE OCCUR TO ANY EXISTING CONSTRUCTION

CONTRACTOR IS TO VERIFY THE EXACT LOCATION OF

CONSTRUCTION NOTED TO REMAIN FROM DAMAGE

DEBRIS REGULARLY AS NECESSARY TO ELIMINATED

INTERFERENCE WITH ROADS, STREET, WALKS, AND

DEMOLITION WORK OF THIS PROJECT. CONTRACTOR

IF SUSPECTED HAZARDOUS MATERIALS ARE

ARCHITECT

DIRECTED BY THE OWNER.

REPAIR THE DAMAGE.

ACTIVITIES.

. EXISTING CONDITIONS INFORMATION WAS

TO THE DRAWINGS FOR THE CONSTRUCTION OF THE

CONTRACTOR'S EXPENSE. 11. THE CONTRACTOR SHALL REMOVE ALL TRASH AND DEBRIS FROM THE SITE ON A DAILY BASIS. 12. MAINTAIN THE INTEGRITY OF ALL EXISTING RATED

WALLS, FIRE SEAL ANY PENETRATIONS WITH U.L. APPROVED ASSEMBLY. 13. WHEN UNANTICIPATED MECHANICAL, ELECTRICAL, OR STRUCTURAL ELEMENTS THAT CONFLICT WITH THE INTENDED FUNCTION OR DESIGN ARE ENCOUNTERED, DETERMINE THE NATURE AND

EXTENT OF THE CONFLICT AND NOTIFY THE ARCHITECT IMMEDIATELY FOR RESOLUTION. 14. PROTECT EXISTING SITE IMPROVEMENTS AND LANDSCAPING TO REMAIN. INCLUDING BUT NOT LIMITED TO EXISTING TREES AND OTHER VEGETATION INDICATED TO REMAIN IN PLACE AGAINST UNNECESSARY CUTTING, BREAKING, OR SKINNING OF ROOTS, SKINNING OR BRUISING OF BARK, SMOTHERING OF TREES BY STOCKPILING

MATERIAL WITHIN DRIP LINES. 15. CONTRACTOR SHALL PROVIDE TRAFFIC HANDLING MEASURES AS NECESSARY TO PROTECT THE GENERAL PUBLIC AT ALL TIMES, AND AS REQUIRED

BY THE CITY.

CONSTRUCTION MATERIAL OR EXCAVATED

16. DO NOT INTERRUPT EXISTING UTILITIES, EXCEPT WHEN AUTHORIZED IN WRITING BY AUTHORITIES HAVING JURISDICTION. PROVIDE TEMPORARY SERVICES DURING INTERRUPTIONS TO EXISTING UTILITIES, AS ACCEPTABLE TO GOVERNING AUTHORITIES.

17. WHEN UTILITY SERVICES ARE REQUIRED TO BE REMOVED, RELOCATED, OR ABANDONED, PROVIDE BYPASS CONNECTIONS TO MAINTAIN CONTINUITY OF SERVICE BEFORE PROCEEDING WITH DEMOLITION.

18. CONTRACTOR SHALL BE RESPONSIBLE TO CONTACT ALL UTILITY COMPANIES INCLUDING BUT NOT LIMITED TO THE FOLLOWING: ELECTRIC, GAS, WATER, TELEPHONE, STORM SEWER, AND SANITARY SEWER FOR FIELD LOCATION OF ALL UNDERGROUND AND OVERHEAD UTILITY LINES. PRIOR TO COMMENCEMENT WITH ANY DEMOLITION WORK, CONTRACTOR SHALL IDENTIFY ALL ELECTRICAL CIRCUITS SERVICING THE AREA INVOLVED WITH THIS DEMOLITION. THOSE CIRCUITS SHALL THEN BE LOCKED OUT AND TAGGED OUT IF THEY DO NOT SERVICE ANY OF THE REMAINING BUILDING. THOSE CIRCUITS WHICH ARE IDENTIFIED TO SERVICE BOTH THE AREA TO BE DEMOLISHED AND THE REMAINING BUILDING SHALL BE SPLIT SO AS TO KILL ALL ELECTRICAL POWER TO THE AREA TO BE

DEMOLISHED WHILE MAINTAINING POWER TO THE REMAINDER OF THE BUILDING. 19. CONTRACTOR TO PATCH/REPAIR ALL HOLES IN WALLS, FLOORS, &/ OR CEILINGS, AS REQUIRED. PAINT TO MATCH ADJACENT WALL/CEILING.

20. CONTRACTOR TO RE-LOCATE UTILITIES & EQUIPMENT AS REQUIRED TO ACCOMMODATE NEW HVAC, ELECTRICAL & PLUMBING REQUIREMENTS FOR NEW RENOVATION WORK.

21. REFER TO DEMOLITION PLUMBING PLANS FOR EXTENT OF CONCRETE SLAB TO BE REMOVED AND REPLACED FOR UNDER FLOOR PIPING INSTALLATION. 22. FILL ALL EXISTING FLOOR AND WALL PENETRATIONS RESULTING FROM PIPING AND CONDUIT REMOVAL

FLOOR OR WALL FINISH. 23. EXISTING WALLS (OR PORTIONS OF WALLS) TO BE REMOVED SHALL BE CUT FLUSH WHERE INTERSECTING WITH WALLS TO REMAIN. REMAINING WALLS TO BE PATCHED AND FINISHED

WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL

24. NEW OPENING TO BE CUT IN EXISTING WALLS SHALL BE SAW-CUT AT LOCATIONS INDICATED TO THE HEIGHT AND WIDTH INDICATED. NEW LINTELS SHALL BE INSTALLED TO SUPPORT EXISTING WALL CONSTRUCTION ABOVE AS INDICATED ON THE DRAWINGS, OR IF NOT INDICATED, AS REQUIRED FOR NEW WALL CONSTRUCTION PER STRUCTURAL

DRAWINGS. 25. WHERE EXISTING INTERIOR WALLS ARE REPLACED OR REMOVED, REMOVE MEP SYSTEMS BACK TO PANEL OR MECHANICAL ROOM OR FARTHEST POSSIBLE POINT WITHOUT DISTURBING EXISTING CONSTRUCTION, REMOVE EXISTING MECHANICAL

EQUIPMENT, RELOCATE POWER PER MEP DRAWINGS 26. REFER TO MEP DRAWINGS FOR DEMOLITION OF MEP SYSTEMS TO IDENTIFY WORK REQUIRED BY THIS CONTRACTOR WHICH MAY AFFECT DEMOLITION AND/OR REPAIRS OF ARCHITECTURAL ELEMENTS. COORDINATE WITH RELATED SUBS THE EXTENT OF

ALL DEMOLITION WORK. 27. PATCH FLOORS, WALLS CEILINGS WHICH REMAIN AT LOCATIONS WHERE PIPES, CONDUITS, ETC. ARE REMOVED AS REQUIRED TO MATCH EXISTING

CONDITIONS OR FOR NEW FINISHES. 28. PROTECT ALL EXISTING HORIZONTAL BLINDS TO

REMAIN UNLESS NOTED OTHERWISE. 29. WHERE EXISTING FINISH FLOOR IS REMOVED,


PREPARE SURFACE TO RECEIVE NEW FLOORING 30. REMOVE ANY EXISTING VINYL MATERIALS IN ACCORDANCE WITH EPA STANDARDS, NOTIFY ARCHITECT & OWNER OF ANY ADDITIONAL ASBESTOS CONTAINING MATERIALS DISCOVERED BEFORE PROCEEDING WITH WORK, PROTECT INTERIOR CONSTRUCTION TO REMAIN DURING DEMOLITION AND CONSTRUCTION.

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

September 9, 2022

Issue Date:

Demolition Plan -Building D

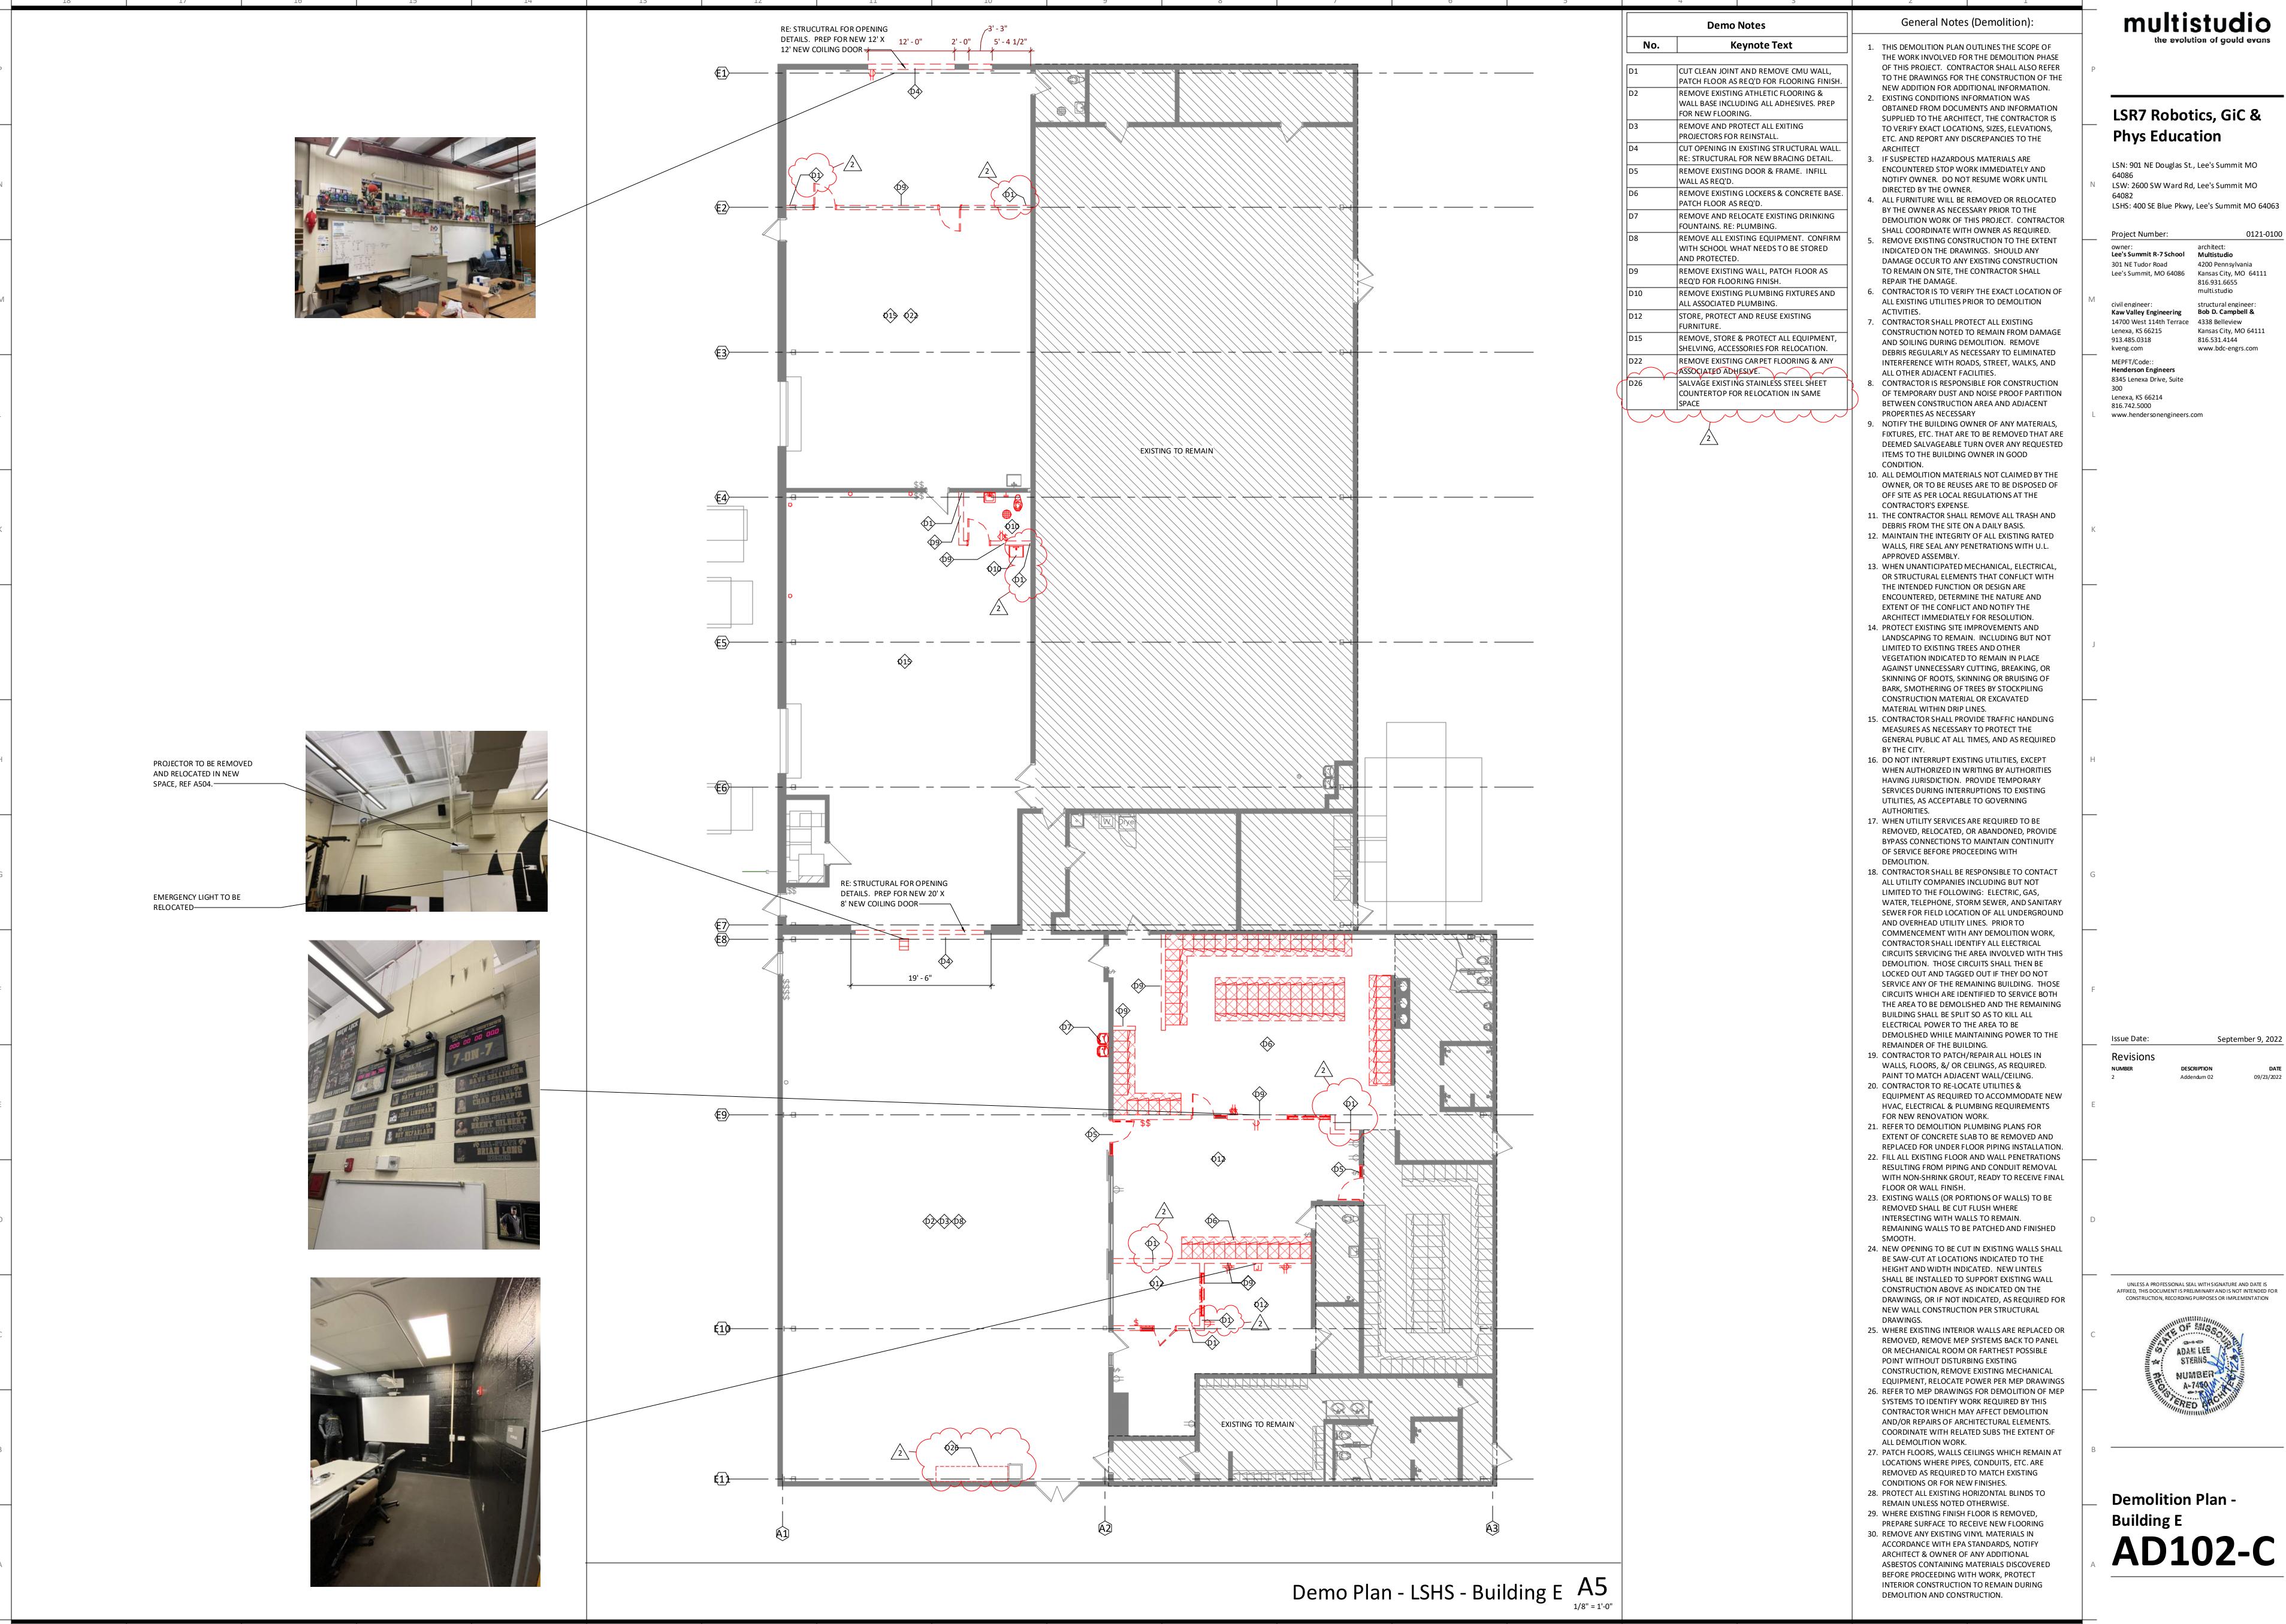

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION. RECORDING PURPOSES OR IMPLEMENTATION

	18	17		16	15	14		13	12	11	10	9	8 7 6 5 4
						Abbreviations					Graphic	Symbols	Materials Graphics
	A		D		Н		P		T		01 GENERAL		
Р	@	AT	D	DEEP, DEPTH	НВ	HOSE BIBB	PA	PUBLIC ADDRESS	T	TREAD	UI GENERAL	NEW WALL	02 SITE CONSTRUCTION
	A/C A/C UNIT	AIR CONDITION(ING) (ED) AIR CONDITIONING UNIT	DBL DEG	DOUBLE DEGREE	HC HCP	HANDICAP, HOLLOW CORE HANDICAPPED	PAR PART	PARALLEL PARTIAL	T & B T & G	TOP AND BOTTOM TONGUE AND GROOVE		NEW WALE	EARTH (existing)
	AB ABBVR	ANCHOR BOLT	DEMO DEPT	DEMOLITION DEPARTMENT	HD HDW	HEAVY DUTY HARDWARE	PAT PC	PATTERN PLUMBING CONTRACTOR	TB TECH	THROUGH BOLT, TOWEL BAR TECHNICAL, TECHNOLOGY			EARTH (backfill)
	ACC	ACCESSIBLE AIR COOLED CONDENSING UNIT	DET	DETAIL DRINKING FOUNTAIN	HDWD	HARDWOOD	PERF PERIM	PERFORATED	TEL	TELEPHONE TEMPORARY, TEMPERATURE		REMOVED EXISTING WALL	DRAINAGE FILL
	ACCU ACI	AMERICAN CONCRETE	DF DH	DOUBLE HUNG	HM HO	HOLLOW METAL HOLD OPEN	PERIIVI	PERIMETER PLATE, PROPERTY LINE	TEMP TERR	TERRAZZO		EXISTING WALL	03 CONCRETE
	ACOUS	INSTITUTE ACOUSTICAL INSULATION	DIA or Ø DIFF	DIAMETER DIFFERENCE	HORIZ HR	HORIZON HOUR	PL GL PLAM	PLATE GLASS PLASTIC LAMINATE	THERM THK	THERMAL THICKNESS	1 SIM	BUILDING SECTION	CAST-IN-PLACE CONCRETE
N	INSUL ACOUS PNI	IL ACOUSTICAL PANEL	DIM DIR	DIMENSION DIRECTION	HSS HT	HOLLOW STRUCTURAL SECTION HEIGHT	PLAS PLBG	PLASTER, PLASTIC PLUMBING	THRU TK BD	THROUGH TACK BOARD	A101		PRECAST CONCRETE
	ACST	ACOUSTIC	DISP	DISPENSER	HVAC	HEATING, VENTILATING AND	PLYWD	PLYWOOD	TMPD	TEMPERED	1 SIM	WALL SECTION	04 MASONRY
	ACT ADA	ACOUSTICAL CEILING TILE AMERICANS WITH DISABILITIES	DIST DIV	DISTANCE DIVIDE, DIVISION	HW	AIR CONDITIONING HOT WATER	PNL POL	PANEL POLISHED	TMPD GI	L TEMPERED GLASS TOP OF CONCRETE	A101		BRICK
	ADDL	ACT ADDITIONAL	DL DMPF	DEAD LOAD DAMPPROOFING	HYD	HYDRANT	POLY PORC	POLYETHYLENE (PLASTIC) PORCELAIN	TOF	TOP OF FOOTING, TOP OF FLOOR, TOP OF FRAME	SIM	DETAIL SECTION	CONCRETE MASONRY UNITS
	ADDM ADH	ADDENDUM ADHESIVE	DMPR	DAMPER		INCIDE DIAMETER	PORT	PORTABLE	TOM	TOP OF MASONRY	A101	2-17.11-0-10.11	GLASS BLOCK
	ADJ	ADJUSTABLE, ADJACENT	DN DO	DOWN DITTO	ID IN	INSIDE DIAMETER INCHES	POS PR	POSITIVE PAIR	TOPO TOS	TOPOGRAPHY TOP OF STEEL	SIM	DETAIL DEFENSE	STONE
M	AE AFF	ARCHITECT/ ENGINEER ABOVE FINISHED FLOOR	DOC	DOCUMENT	INCAND INCL	INCANDESCENT INCLUDE	PRCST	PRECAST	TPD TV	TOILET PAPER DISPENSER TELEVISION	A101	DETAIL REFERENCE	
	AGGR	AGGREGATE AUTHORITIY HAVING	DOZ DR	DOZEN DOOR	INFO	INFORMATION	PREFAB PREFIN	PREFABRICATED PREFINISHED	TYP	TYPICAL			
	AHJ	JURISDICTION	DS DSGN	DOWNSPOUT DESIGN	INSUL INT	INSULATION INTERIOR	PRELIM PRKG	PRELIMINARY PARKING	U				[변화] GROUT
	AHU AISC	AIR HANDLING UNIT AMERICAN INSTITUTE OF STEEL	DT	DRAIN TILE	INTERM	INTERMEDIATE	PROJ	PROJECT	U UC	HEAT TRANSFER COEFFICIENT UNDERCUT	A1/A101	EXTERIOR ELEVATION TAG	05 METALS V//////
	ALT	CONSTRUCTION ALTERNATE	DW DWG	DISH WASHER DRAWING	J		PROP PSF	PROPERTY POUNDS PER SQUARE FOOT	UGND	UNDERGROUND	1 (Ref)		ALUMINUM The state of the stat
	ALUM	ALUMINUM	E		JAN JAN CLO	JANITOR JANITOR CLOSET	PSI PT	POUNDS PER SQUARE INCH POST TENSIONED	UH UL	UNIT HEATER UNDERWRITERS LABORATORIES			////// STEEL
L	ANOD APC	ANNODIZED ACOUSTICAL PANEL CEILING	E	EAST	JNT IR	JOINT JUNIOR	PTD	PAPER TOWER DISPENSER	UNFIN UNO	UNFINISH(ED) UNLESS NOTED OTHERWISE	(Ref) A101 (Ref)	INTERIOR ELEVATION TAG	06 WOODS AND PLASTICS
	ARCH ASL	ARCHITECT(URAL) ABOVE STRUCTURAL LEVEL	EC	EACH ELECTRICAL CONTRACTOR	JR JST	JOIST	PTN PVC	PARTITION POLYVINYL CHLORIDE (PLASTIC)	UTIL	UTILITY	1		CONTINUOUS WOOD
	AWT	ACOUSTICAL WALL TREATMENT	EF EIFS	EACH FACE EXTERIOR INSULATION AND	К		PWR	POWER	UV	UNIT VENTILATOR	(Ref)		INTERMITTENT WOOD
	В			FINISH SYSTEM	KD 	KNOCK DOWN	Q	OLIADOV TIL T	V	VOLT		BREAK LINE	FINISH WOOD
	B BD B/B	BASE BOARD BACK-TO-BACK	EJ EL	EXPANSION JOINT ELEVATION	KIP KIT	1000 POUNDS KITCHEN	QT QTR	QUARRY TILE QUARTER	V VAR	VOLT VARIES, VARIATION	Room name	ROOM TAG	HARDBOARD
K	BAT	BATTEN	ELEC ELEM	ELECTRIC(AL) ELEMENTARY	KO KPL	KNOCK OUT KICK PLATE	QTY	QUANTITY	VB VCT	VINYL BASE VINYL COMPOSITE TILE	##.#	INTERIOR PARTITION TYPE	MEDIUM DENSITY FIBER BOARD
I\	BD BDRM	BOARD BEDROOM	ELEV	ELEVATOR	· -		R	200	VENT	VENTILATION	******	SYMBOL	L (MDF)
	BITUM BLDG	BITUMINOUS BUILDING	ENAM ENCL	ENAMEL ENCLOSURE	L L	LITER, ANGLE	R	RISER, RADIUS, HEAT RESISTANCE	VERT VEST	VERTICAL VESTIBULE	Туре	WINDOW TYPE SYMBOL	
	BLKG	BLOCKING	ENGR ENVIR	ENGINEER ENVIRONMENT	LAB LAM	LABORATORY LAMINATE(D)	RA RAD	RETURN AIR RADIATOR	VIF VOC	VERIFY IN FIELD VOLATILE ORGANIC		BENCHMARK/SPOT ELEV.	COUR SURFACE MATERIAL
	BM BOT	BENCHMARK, BEAM BOTTOM	EOS	EDGE OF SLAB	LAV	LAVATORY	RB	RUBBER BASE, RESILIENT BASE		COMPOUND	T	SYMBOL COLUMN LINE/GRID	SOLID SURFACE MATERIAL
	BRG	BEARING BRONZE	EP EPDM	ELECTRIC PANEL ETHYLENE PROPYLENE DIENE	LBL LBS	LABEL POUND	RC RCP	ROOFING CONTRACTOR REFLECTED CEILING PLAN	VOL VR	VOLUME VAPOR RETARDER	XX	INDICATOR	07 THERMAL & MOISTURE PROTECTION
J	BRZ BSMT	BASEMENT	EPS	MONOMER EXPANDED POLYSTYRENE	LD I F	LOAD LINEAR FEET	RD REC	ROOF DRAIN RECESSED	VUH VWC	VERTICAL UNIT HEATER VERTICAL WALL COVERING	<u>/#-#\</u>	REVISION INDICATOR	BATT INSULATION
	BTWN BUR	BETWEEN BUILT-UP ROOFING	EQ	BOARD EQUAL	LH	LATENT HEAT, LEFT HAND	REC RM	RECREATION ROOM	147		(101A)	DOOR TAG	LOOSE FILL INSULATION
	BW	BOTH WAYS	EQUIP	EQUIPMENT	LIB LIN	LIBRARY LINEAR	REF REG	REFRIGERATOR REGISTER, REGULATION	W	WATT, WEST	ELEVATION LEVEL NAME	FLOOR LEVEL SYMBOL	RIGID INSULATION
	C		EQUIV ETC	EQUIVALENT ET CETERA	LKR LKR RM	LOCKER LOCKER ROOM	REINF REQD	REINFORCE REQUIRED	W/ W/O	WITH WITHOUT	1t	CEILING HEIGHT SYMBOL	08 GLAZING
	CAB CB	CABINET CARRIAGE BOLT, CATCH BASIN	ETR EW	EXISTING TO REMAIN EACH WAY	LL	LIVE LOAD	RESIL	RESILIENT	W/W	WALL TO WALL WOOD BASE	1'-0"A.F.F. PLAN NORTH	NORTH ARROWS	GLASS GLASS
	CCTV CD	CLOSED-CIRCUIT TELEVISION CONSTRUCTION DOCUMENTS,	EWC	ELECTRIC WATER COOLER	LLH LLV	LONG LEG HORIZONTAL LONG LEG VERTICAL	REV RFG	REVISION ROOFING	WB WC	WALL COVERING, WATER	N		09 FINISHES
Н		CONTRACT DOCUMENTS	EWH EXC	ELECTRIC WATER HEATER EXCAVATE	LT LTG	LINOLEUM TILE, LIGHT LIGHTING	RFI RFP	REQUEST FOR INFORMATION REQUEST FOR PROPOSAL	WD	CLOSET WOOD	N T		LATH AND PLASTER
	CEM CERT	CEMENT CERTIFY, CERTIFICATE,	EXH EXIST	EXHAUST EXISTING			RH	RIGHT HAND, ROOF HATCH	WDW WF	WINDOW WIDE FLANGE	TRUE NORTH		GYPSUM BOARD
	CF/CI	CERTIFICATION CONRACTOR FURNISHED/	EXP	EXPAND, EXPANSION	M MACH	MATCHLINE	RM RO	ROOM ROUGH OPENING	WH	WATER HEATER, WALL HUNG	1 1/2"		
	CF/OI	CONTRACTOR INSTALLED CONTRACTOR FURNISHED/	EXT	EXTERIOR	MACH RN MAHOG	M MACHINE ROOM MAHOGANY	ROW RTF	RIGHT OF WAY RUBBER TILE FLOOR	WI WM	WROUGHT IRON WIRE MESH	* * * * * * * * * * * * * * * * * * *	DIMENSION	
	-	OWNER INSTALLED CORNER GUARD	F F/F	FACE-TO-FACE	MAINT	MAINTENANCE	RTU	ROOF TOP UNIT	WP	WATER PROOFING, WEATHERPROOF			
	CG CH	COAT HOOK	FA	FIRE ALARM	MATL MAX	MATERIAL MAXIMUM	RV RW	ROOF VENT RESCUE WINDOW	WR	WATER REPELENT, WEATHER RESISTANT	ALIGN	ALIGN TWO WALLS OR OBJECTS	
G	CHBD CHEM	CHALK BOARD CHEMICAL	FAAP	FIRA ALARM ANNUNCIATOR PANEL	MB or MI BD	KR MARKERBOARD	RWB	RUBBER WALL BASE	WSCT	WAINSCOT			
	CI CIP	CAST IRON CAST-IN-PLACE	FACP FCU	FIRE ALARM CONTROL PANEL FAN COIL UNIT	MC MDF	MECHANICAL CONTRACTOR MEDIUM DENSITY FIBERBAORD	S	SOUTH	WT WWF	WEIGHT WELDED WIRE FABRIC			
	CJ	CONTROL JOINT, CONSTRUCTION JOINT	FD FE	FLOOR DRAIN FIRE EXTINGUISHER	MDO	MEDIUM DENSITY OVERLAY	SAB	SOUND ATTENUATION BATTS	WWM	WELDED WIRE MESH			
	CL	CENTER LINE	FEC	FIRE EXTINGUISHER CABINET	ME MECH	MATCH EXISTING MECHANICAL	SAN SC	SANITARY SOLID CORE, SHADING	X	DV			
	CLG CLO	CEILING CLOSET	FIN FIXT	FINISH FIXTURE	MECH RM MFR	MECHANICAL ROOM MANUFACTURER	SCHED	COEFFICIENT SCHEDULE		ВУ			
F	CLR CLRM	CLEAR CLASSROOM	FLOUR FLR	FLOURESCENT FLOOR	MIN MISC	MINIMUM MISCELLANEOUS	SD SECT	SOAP DISPENSER SECTION	Y Y	YD			
	CMU	CONCRETE MASONRY UNIT	FNDN FO	FOUNDATION FINISHED OPENING	MM	MILIMETER	SF	SQUARE FOOT, SAFETY FACTOR					
	CNR CNTR	CORNER COUNTER	FRJS	FIRE RESISTIVE JOINT SYSTEM	MO MOD BIT	MASONRY OPENING MODIFIED BITUMEN	SGT SHR	STRUCTURAL GLAZED TILE SHOWER					
	COL CONC	COLUMN CONCRETE	FRP	FIBERGLASS REINFORCED PLASTIC	MTD MTL	MOUNTED METAL, MATERIAL	SHT SIM	SHEET SIMILAR					
	CONF	CONFERENCE	FRTW	FIRE RETARDANT TREATED WOOD	MULL	MULLION	SND	SANITARY NAPKIN DISPENSER					
		CONNECT(ION) CONSTRUCTION	FT FTG	FOOT, FEET FOOTING	N		SOG SPC	SLAB ON GRADE SUSPENDED SPLASTER CEILING					
Е	CONT CONTR	CONTINUOUS CONTRCT(OR)	FURN	FURNITURE	N NA	NORTH NOT APPLICABLE	SPEC SPKR	SPECIFICATION(S) SPEAKER					
		CORDINATE, COORDINATION	FW FWC	FIRE WALL FABRIC WALL COVERING	NIC	NOT IN CONTRACT	SQ	SQUARE					
	CORR CPT	CORRIDOR CARPET	G		NO or # NOM	NUMBER NOMINAL	SST STC	STAINLESS STEEL SOUND TRANSMISSION CLASS					
	CSK CSWK	COUNTERSINK CASEWORK	GA GAL	GALLON	NORM NTS	NORMAL NOT TO SCALE	STD STOR	STANDARD STORAGE					
	СТ	CERAMIC TILE	GAL GALV	GALLON GALVANIZED	-		STRM	STOREROOM					
1	CTR CTRL	CENTER CONTROL	GALV ST GB		O O/A	OVERALL	STRUCT SUB	STRUCTURAL UBSTITUTE					
D	CU CUH	CUBIC CABINET UNIT HEATER	GC	GENERAL CONTRACTOR	0/0 0C	OUT TO OUT ON CENTER	SUB FL SUSP	SUBFLOOR SUSPENDED					
	CUST	CUSTODIAL COLD WATER, CASEMENT	GEN GFCI	GENERAL, GENERATOR GROUND FAULT CIRCUIT	OD	OUTSIDE DIAMETER OWNER FURNISHED/ OWNER		SUSPENDED CEILING					
		WINDOW	GFRC	INTERRUPTER GLASS FIBER RINFORCED	OF/ OI	INSTALLED	SV SWBD	SAFETY VALVE, SHEET VINYL SWITCHBOARD					
			GFRG	CONCRETE GLASS FIBER REINFORCED	OF/CI	OWNER FURNISEHD/ CONTRACTOR INSTALLED	SY SYM	SQUARE YARD SYMBOL					
				GYPSUM	OFF OH	OFFICE OVERHANG	SYS	SYSTEM					
С			GL GL BLK	GLASS, GROUND LEVEL GLASS BLOCK	OH DR	OVERHEAD DOOR							
			GLU LAN GLZ	M GLUED LAMINATED BEAM GLAZING	OPH OPNG	OPPOSITE HAND OPENING							
			GWT	GLAZED WALL TILE	OPP OPT	OPPOSITE OPTIONAL, OPTIMUM							
			GYM GYP	GYMNASIUM GYPSUM	J. 1	<u></u> , o							
			GYP BD GYP PLA										
			JIF PLA	S. SOMI ESTER									
В													
Α													

General Architectural Drawing Notes: multistudio

LSR7 Robotics, GiC &

Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086 LSW: 2600 SW Ward Rd, Lee's Summit MO 64082 LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100
owner: architect:
Lee's Summit R-7 School
301 NE Tudor Road
Lee's Summit, MO 64086 Kansas City, MO 64111
816.931.6655

multi.studio

civil engineer:
Kaw Valley Engineering
14700 West 114th Terrace
Lenexa, KS 66215
913.485.0318
kveng.com

MEPFT/Code::
Henderson Engineers
8345 Lenexa Drive, Suite

Lenexa, KS 66214 816.742.5000

www.hendersonengineers.com

General Materials & Equipment Notes:

VERIFY DIMENSIONS AND EXISTING CONDITIONS
 BEFORE COMMENCING WORK. REPORT
 DISCREPANCIES TO THE ARCHITECT PRIOR TO

REFERENCED FROM STRUCTURAL GRID, FACE OF CONCRETE, FACE OF MASONRY, OR FACE OF

FINISHED SURFACE, UNLESS NOTED OTHERWISE.

3. REFLECTED CEILING PLAN DIMENSIONS ARE

REFERENCED FROM FINISHED SURFACES UNLESS NOTED OTHERWISE. CEILING HEIGHTS ARE DIMENSIONED FROM FLOOR TO FINISHED CEILING

PARTITIONS, AND OTHER FIXTURES AND EQUIPMENT ARE DIMENSIONED FROM FINISHED SURFACES

5. DIMENSIONS NOTED AS "FIELD VERIFY" SHALL BE CHECKED AT THE SITE BY THE CONTRACTOR AND

6. DIMENSIONS NOTED AS "CLEAR" REQUIRE SPECIFIC

COORDINATION BETWEEN DISCIPLINES AND/OR

7. DRAWINGS NOTED AT "N.T.S." ARE NOT TO SCALE.

8. DO NOT SCALE DRAWING. WRITTEN DIMENSIONS

9. NOTES OR DIMENSIONS LABELED "TYPICAL" SHALL

APPLY TO SITUATIONS THAT ARE THE SAME OR

TAKE PRECEDENCE. IF CLARIFICATION IS REQUIRED IN ORDER TO DETERMINE THE INTENT OF THE

CONTRACT DOCUMENTS, CONTACT THE ARCHITECT.

REVIEWED WITH THE ARCHITECT BEFORE INCORPORATING INTO THE WORK.

PROCEEDING WITH AFFECTED WORK.

2. BUILDING FLOOR PLAN DIMENSIONS ARE

4. CASEWORK, PLUMBING FIXTURES, TOILET

UNLESS NOTED OTHERWISE.

MANUFACTURERS.

HEIGHT.

- PROVIDE GALVANIC PROTECTION BETWEEN DISSIMILAR METALS.
- INSTALL PIPING AND CONDUIT TIGHT TO WALLS, COLUMNS AND ROOF DECK.
 SEAL ALL PIPE OR CONDUIT PENETRATIONS WITH
- SEAL ALL PIPE OR CONDUIT PENETRATIONS WITH APPROPRIATE SEALANT. PROVIDE FIRE SEALANT AT RATED PARTITIONS.
- PLYWOOD AND WOOD BLOCKING SHALL BE FIRE RESISTANT.

THE STRUCTURAL ENGINEER.


5. DO NOT CUT OR DRILL ANY STRUCTURAL MEMBER,
OTHER THAN DESCRIBED ON THE STRUCTURAL
DRAWINGS, WITHOUT WRITTEN APPROVAL FROM

September 9, 2022

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION




Graphic Symbols,
Abbreviations, and
General Information
A \cap 1 _ C

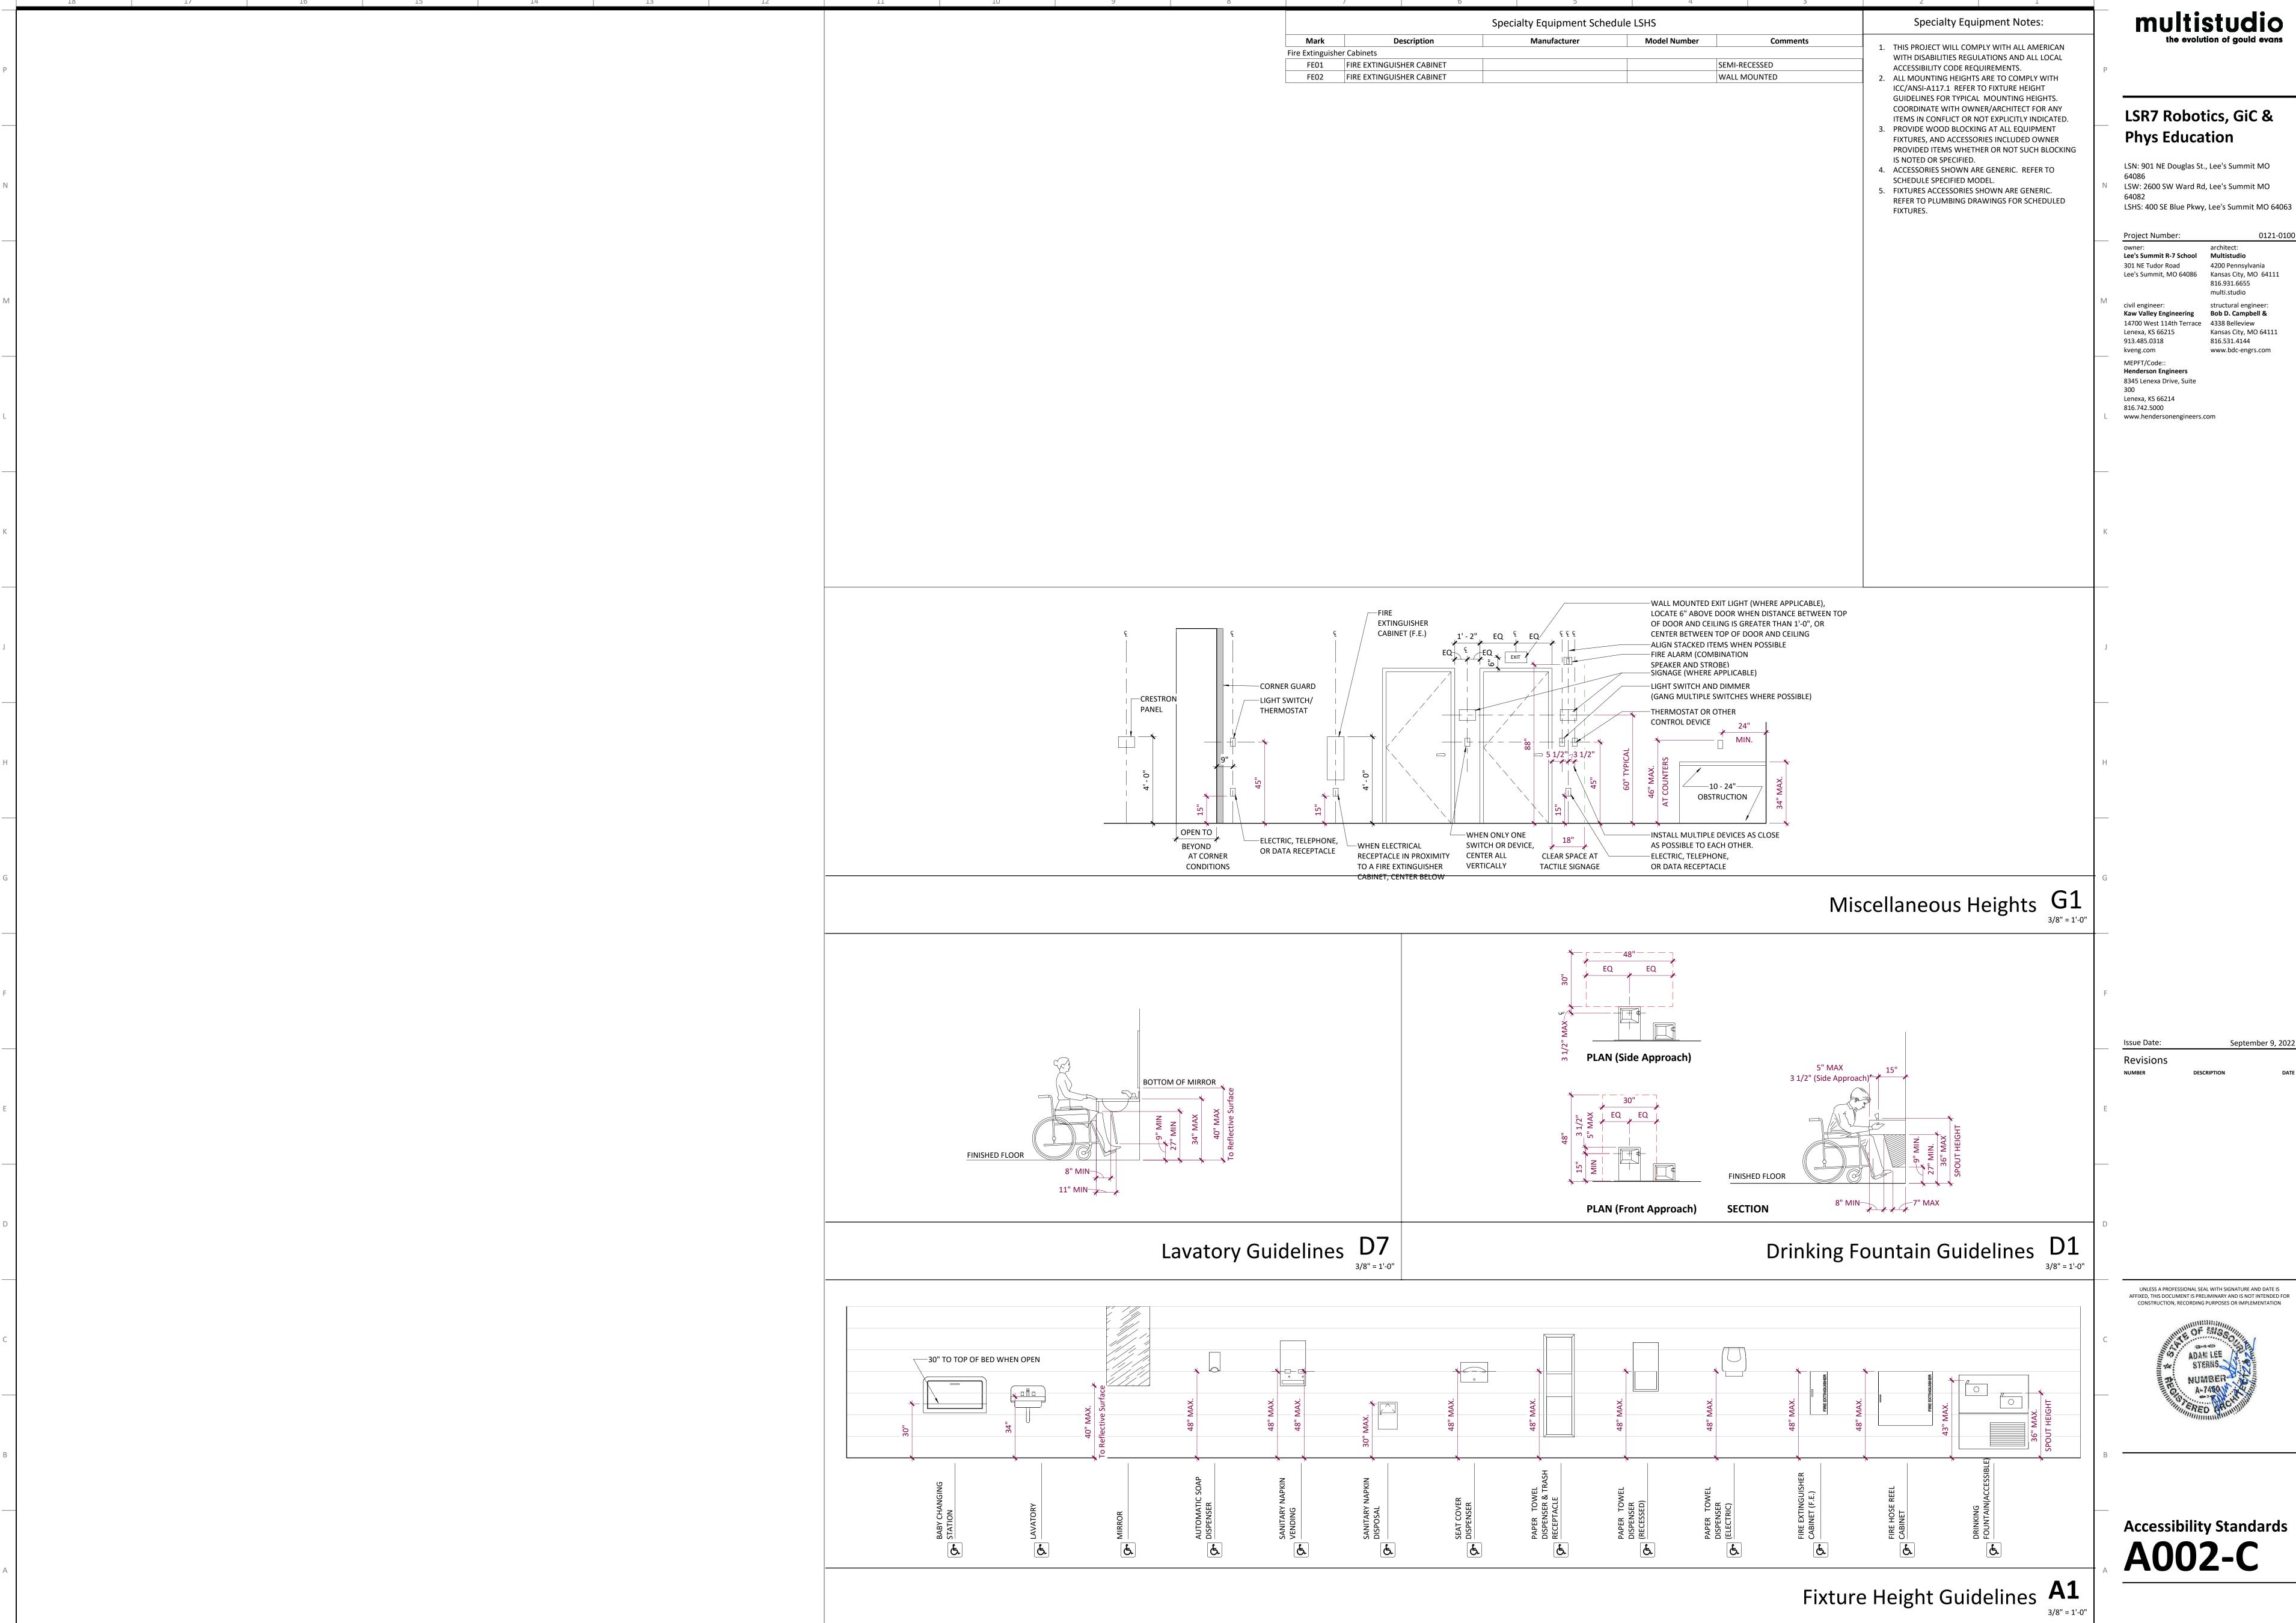

September 9, 2022

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR

Accessibility Standards

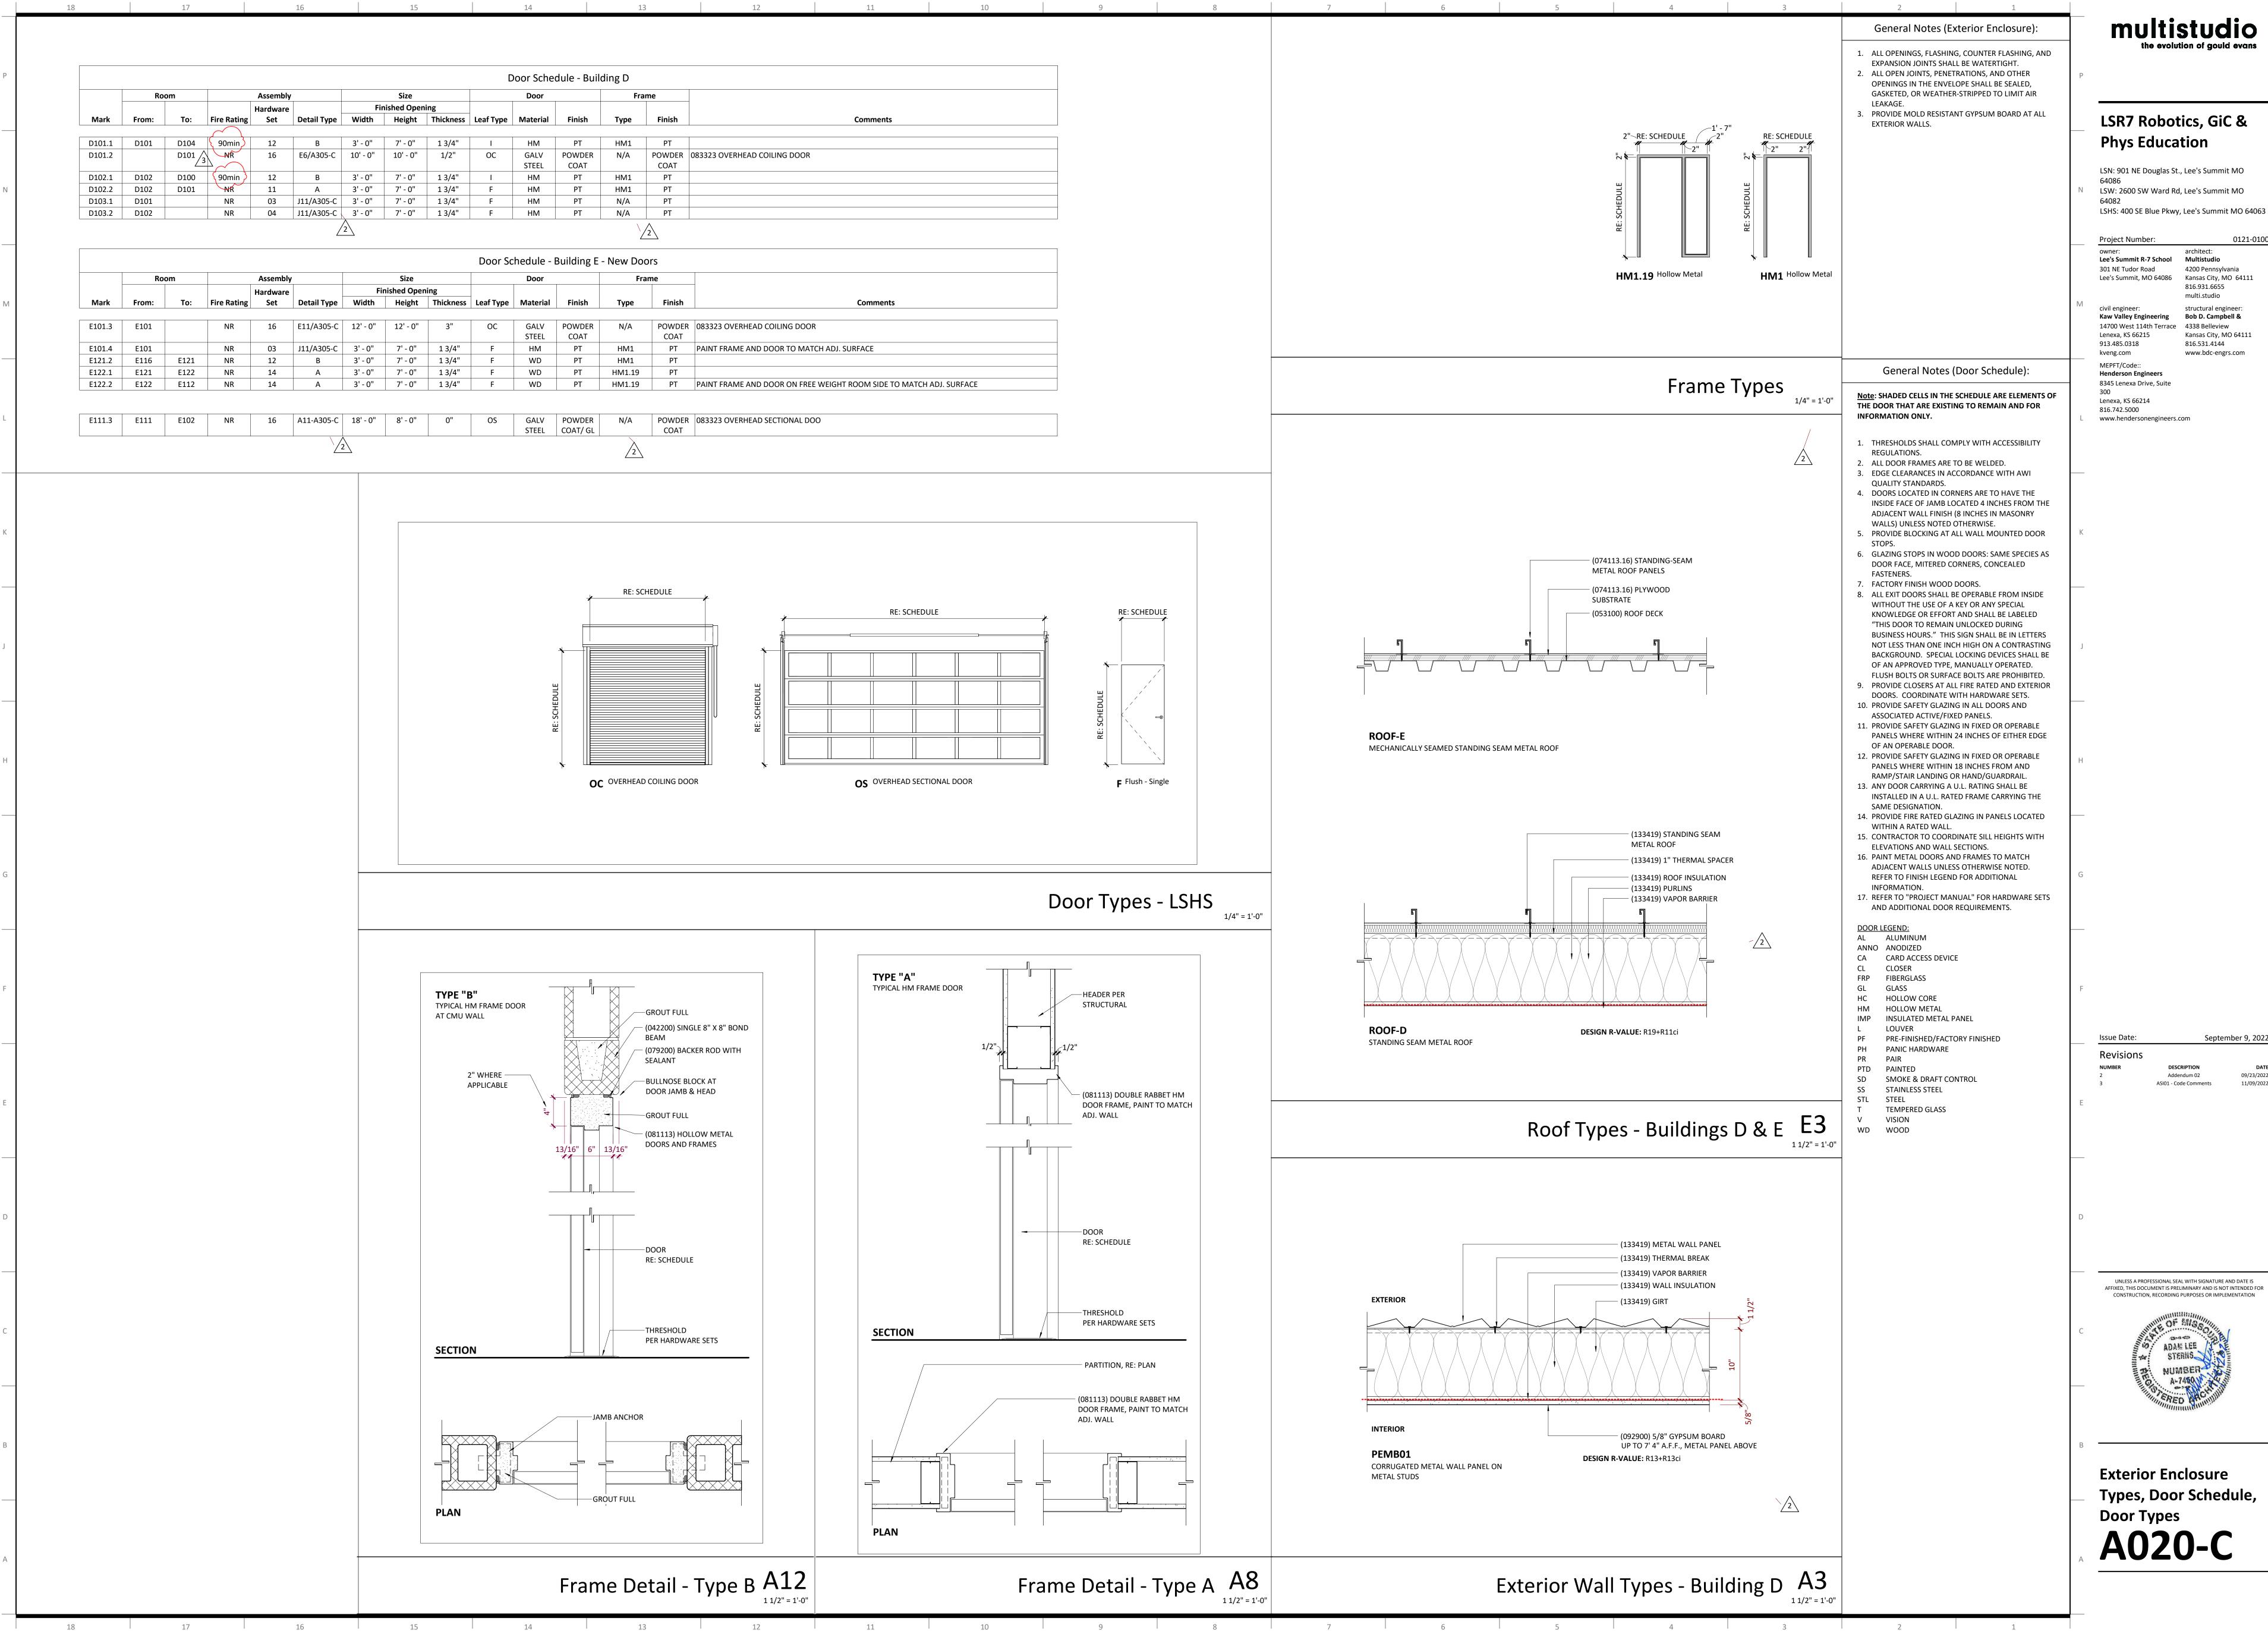

LSR7 Robotics, GiC & **Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO LSW: 2600 SW Ward Rd, Lee's Summit MO

Project Number: Lee's Summit R-7 School Multistudio 301 NE Tudor Road 4200 Pennsylvania

816.931.6655 multi.studio structural engineer: Kaw Valley Engineering Bob D. Campbell & 14700 West 114th Terrace 4338 Belleview Lenexa, KS 66215 Kansas City, MO 64111 913.485.0318 816.531.4144 www.bdc-engrs.com

kveng.com MEPFT/Code:: **Henderson Engineers** 8345 Lenexa Drive, Suite Lenexa, KS 66214

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

Addendum 02

ASI01 - Code Comments




September 9, 2022

09/23/2022

11/09/2022

Exterior Enclosure Types, Door Schedule, **Door Types** A020-C

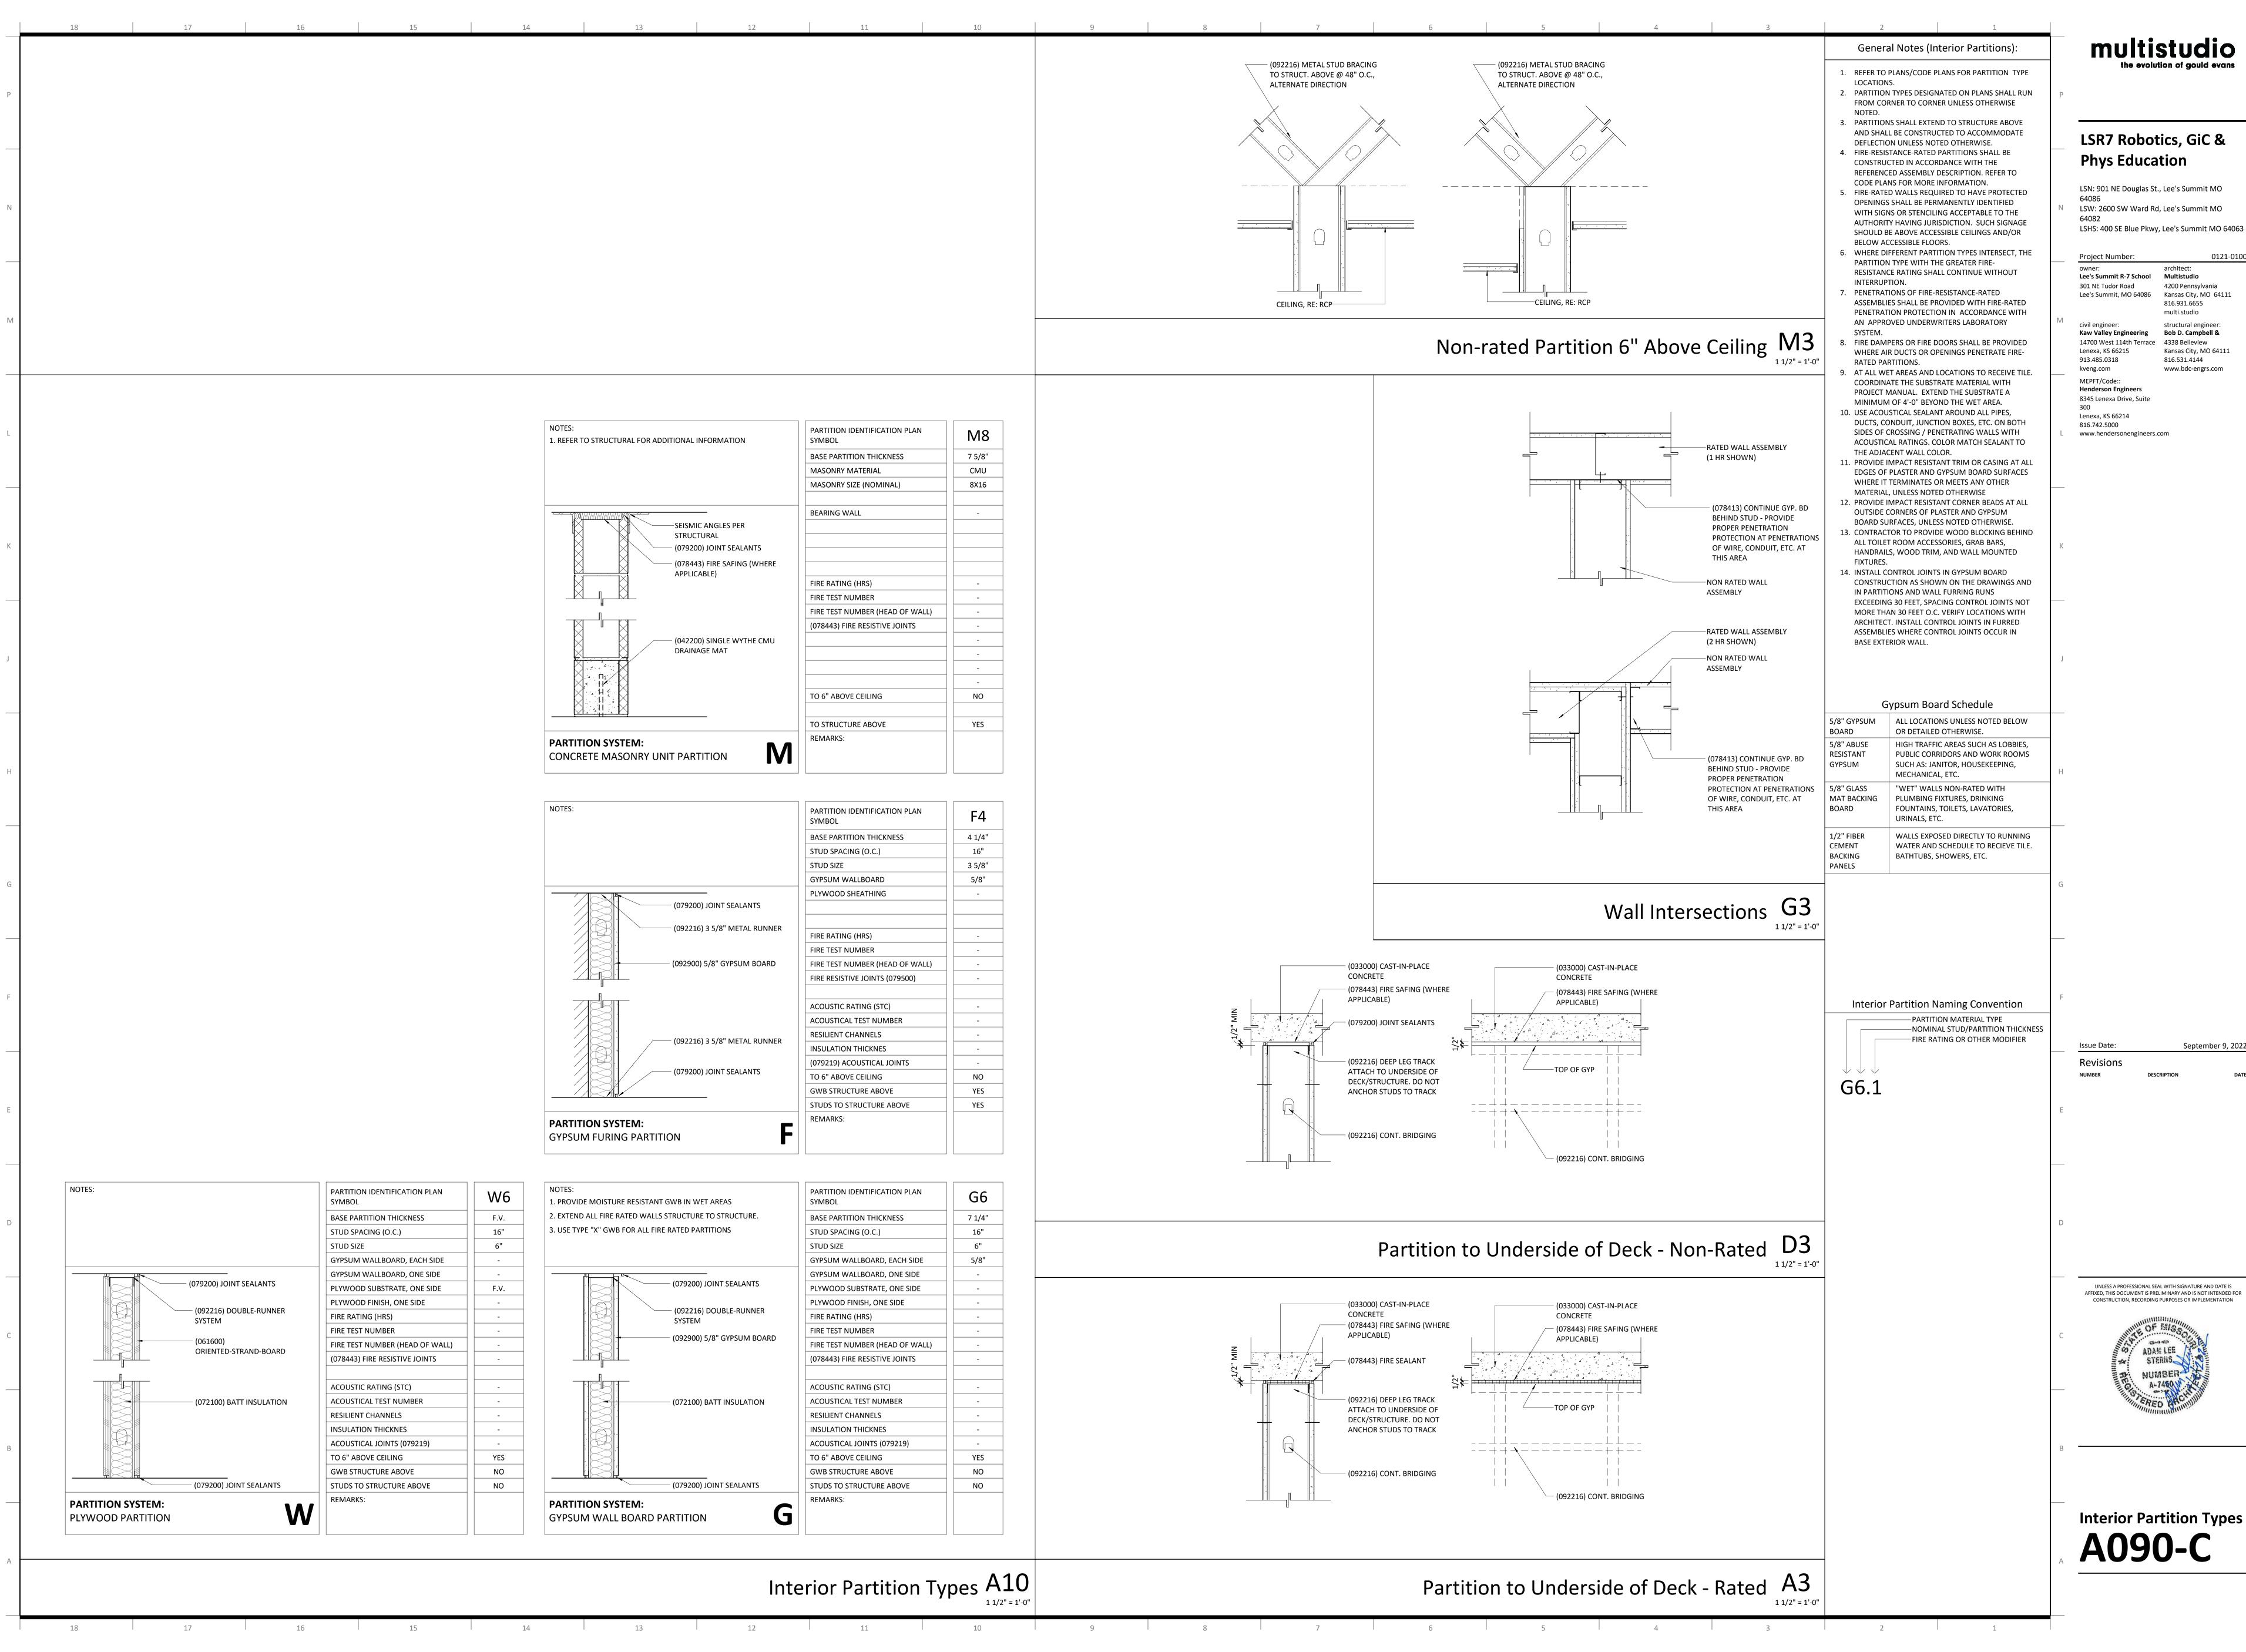

LSR7 Robotics, GiC & **Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO LSW: 2600 SW Ward Rd, Lee's Summit MO

Proiect Number: Lee's Summit R-7 School Multistudio 4200 Pennsylvania

Kansas City, MO 64111

www.bdc-engrs.com

816.531.4144

Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655 multi.studio structural engineer: Kaw Valley Engineering Bob D. Campbell & 14700 West 114th Terrace 4338 Belleview

Issue Date: September 9, 2022

> UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



Interior Partition Types A090-C



multistudio

LSR7 Robotics, GiC &

Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086 LSW: 2600 SW Ward Rd, Lee's Summit MO

64082 LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Project Number: 0121-0100
owner: architect:
Lee's Summit R-7 School
301 NE Tudor Road 4200 Pennsylvania
Lee's Summit, MO 64086 Kansas City, MO 64111

816.931.6655
multi.studio

civil engineer: structural engineer:

Kaw Valley Engineering
14700 West 114th Terrace
Lenexa, KS 66215

Ransas City, Mo 64111

913.485.0318 816.531.4144 www.bdc-engrs.com

MEPFT/Code::
Henderson Engineers
8345 Lenexa Drive, Suite
300


8345 Lenexa Drive, Suite 300 Lenexa, KS 66214 816.742.5000 www.hendersonengineers.com


UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS
AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR
CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION

September 9, 2022




Overall Floor Plans Building D & E
A 101-C

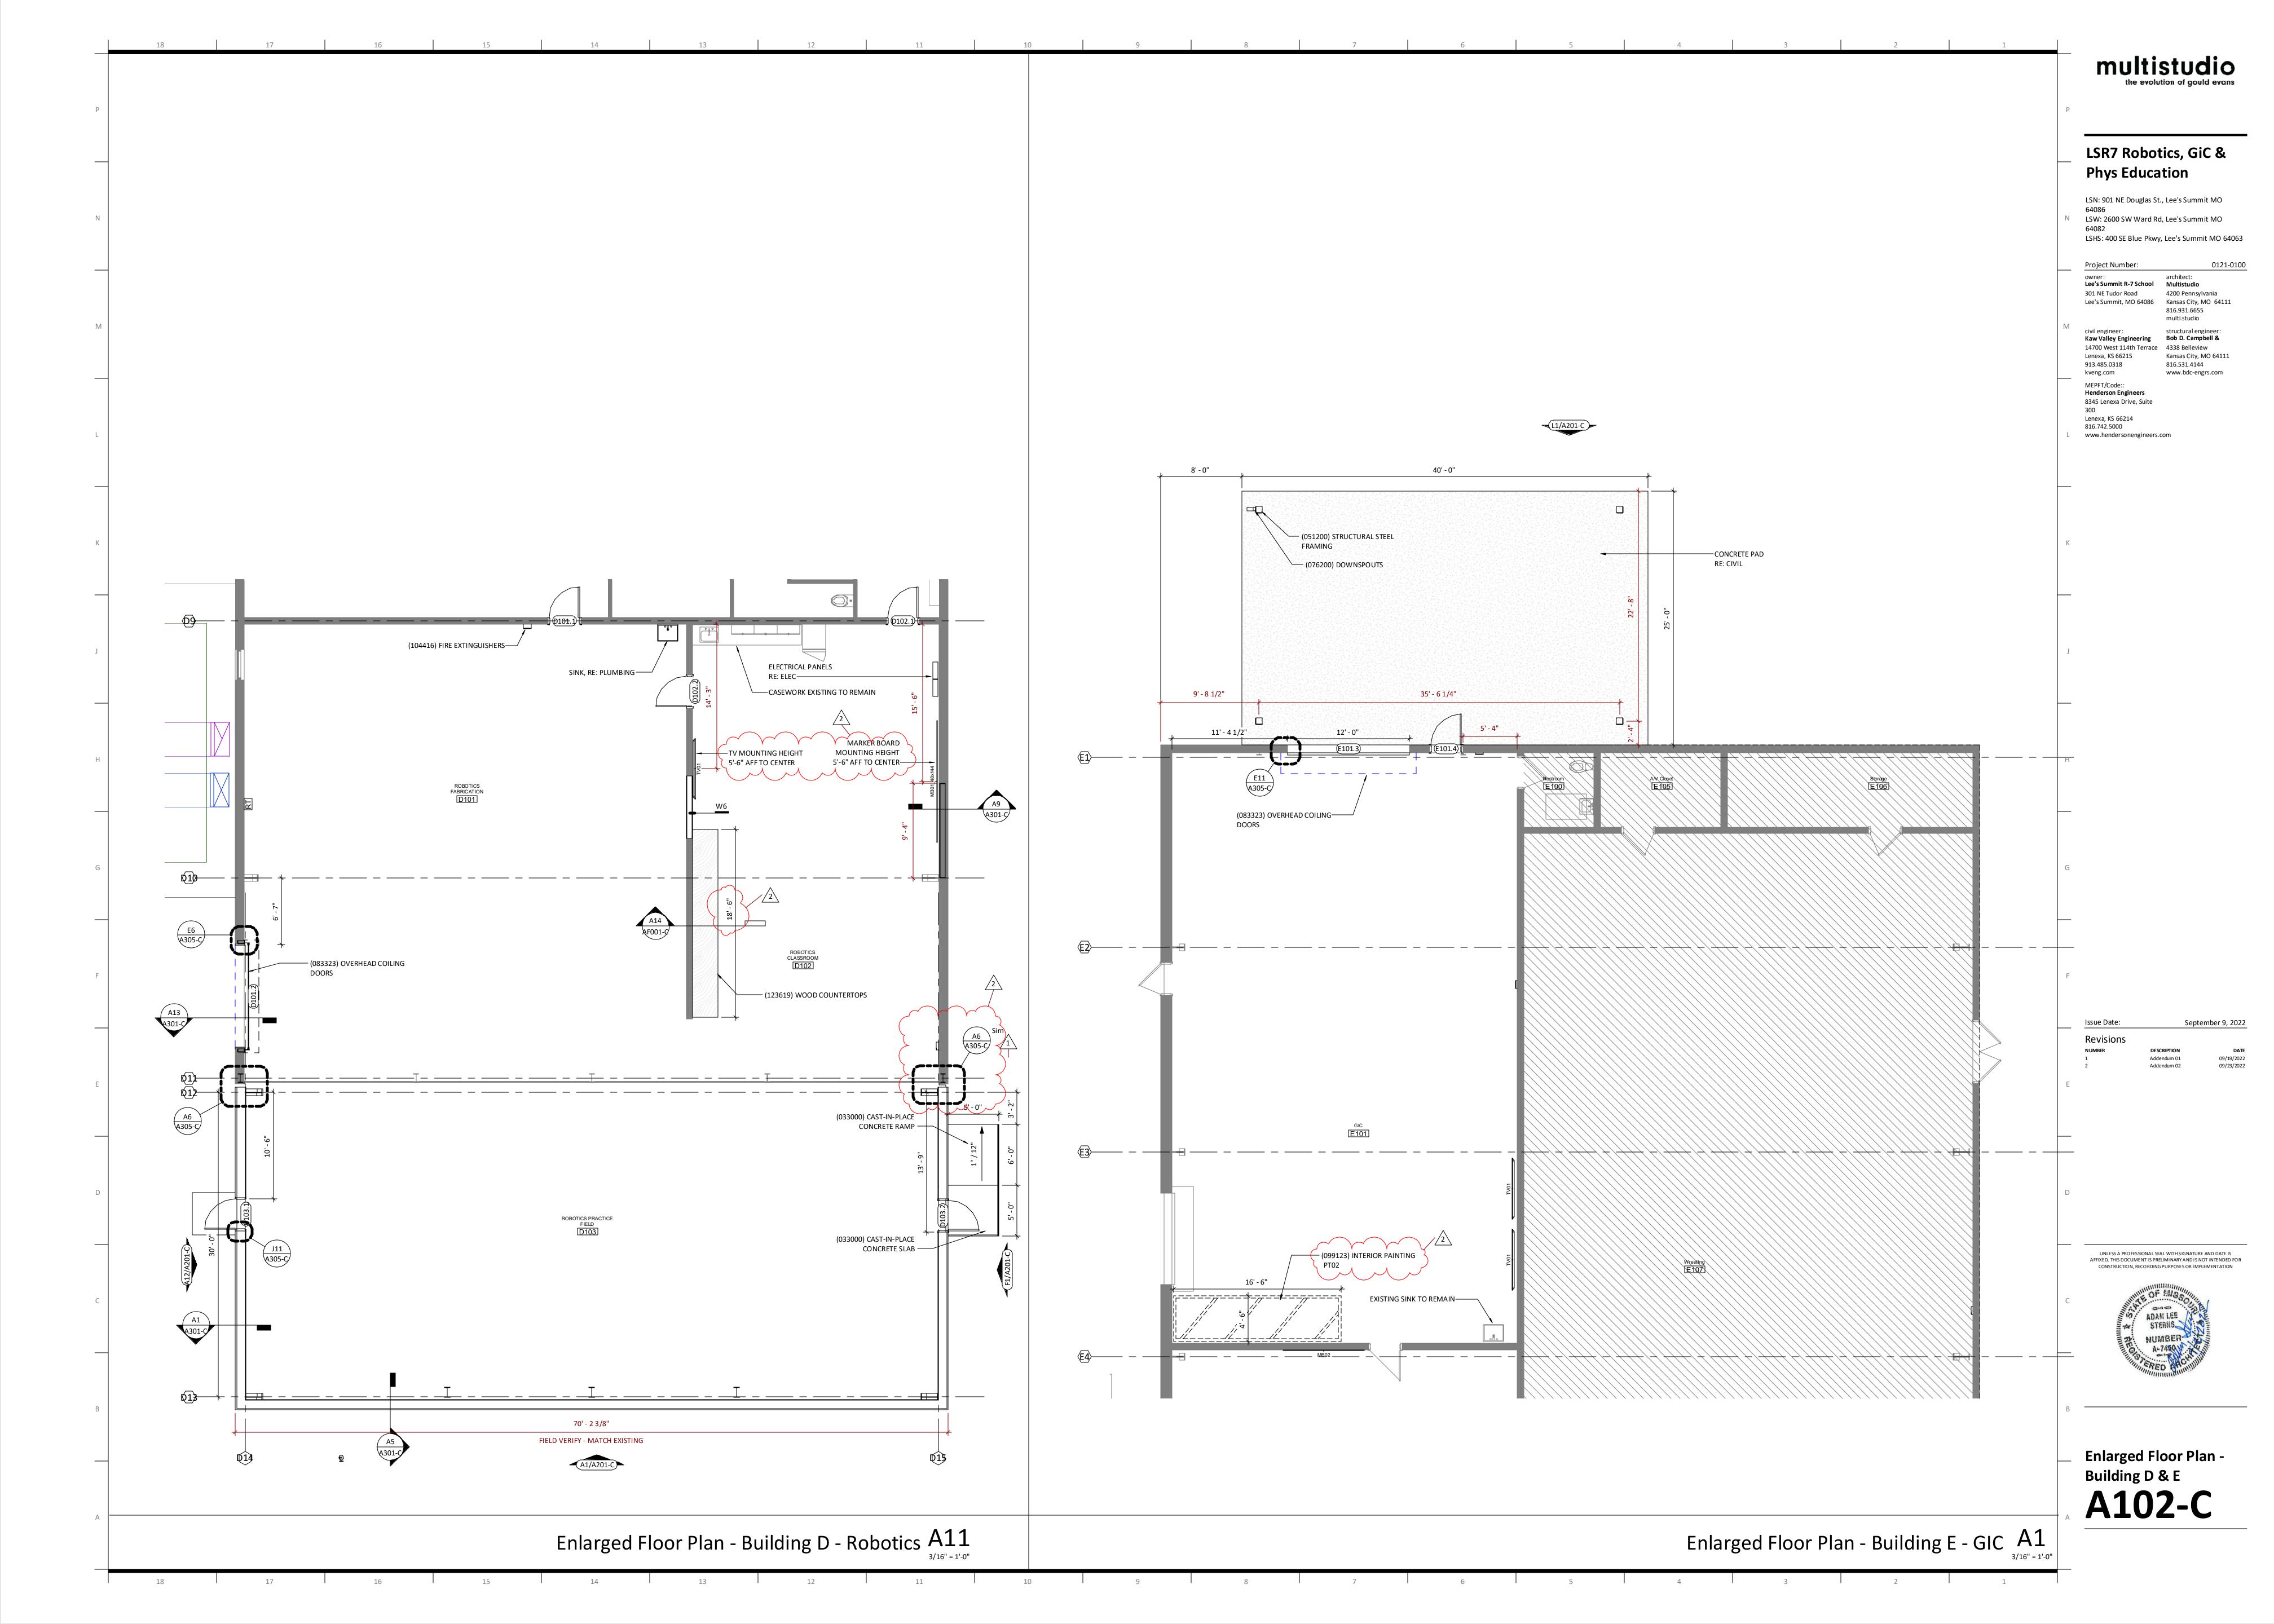

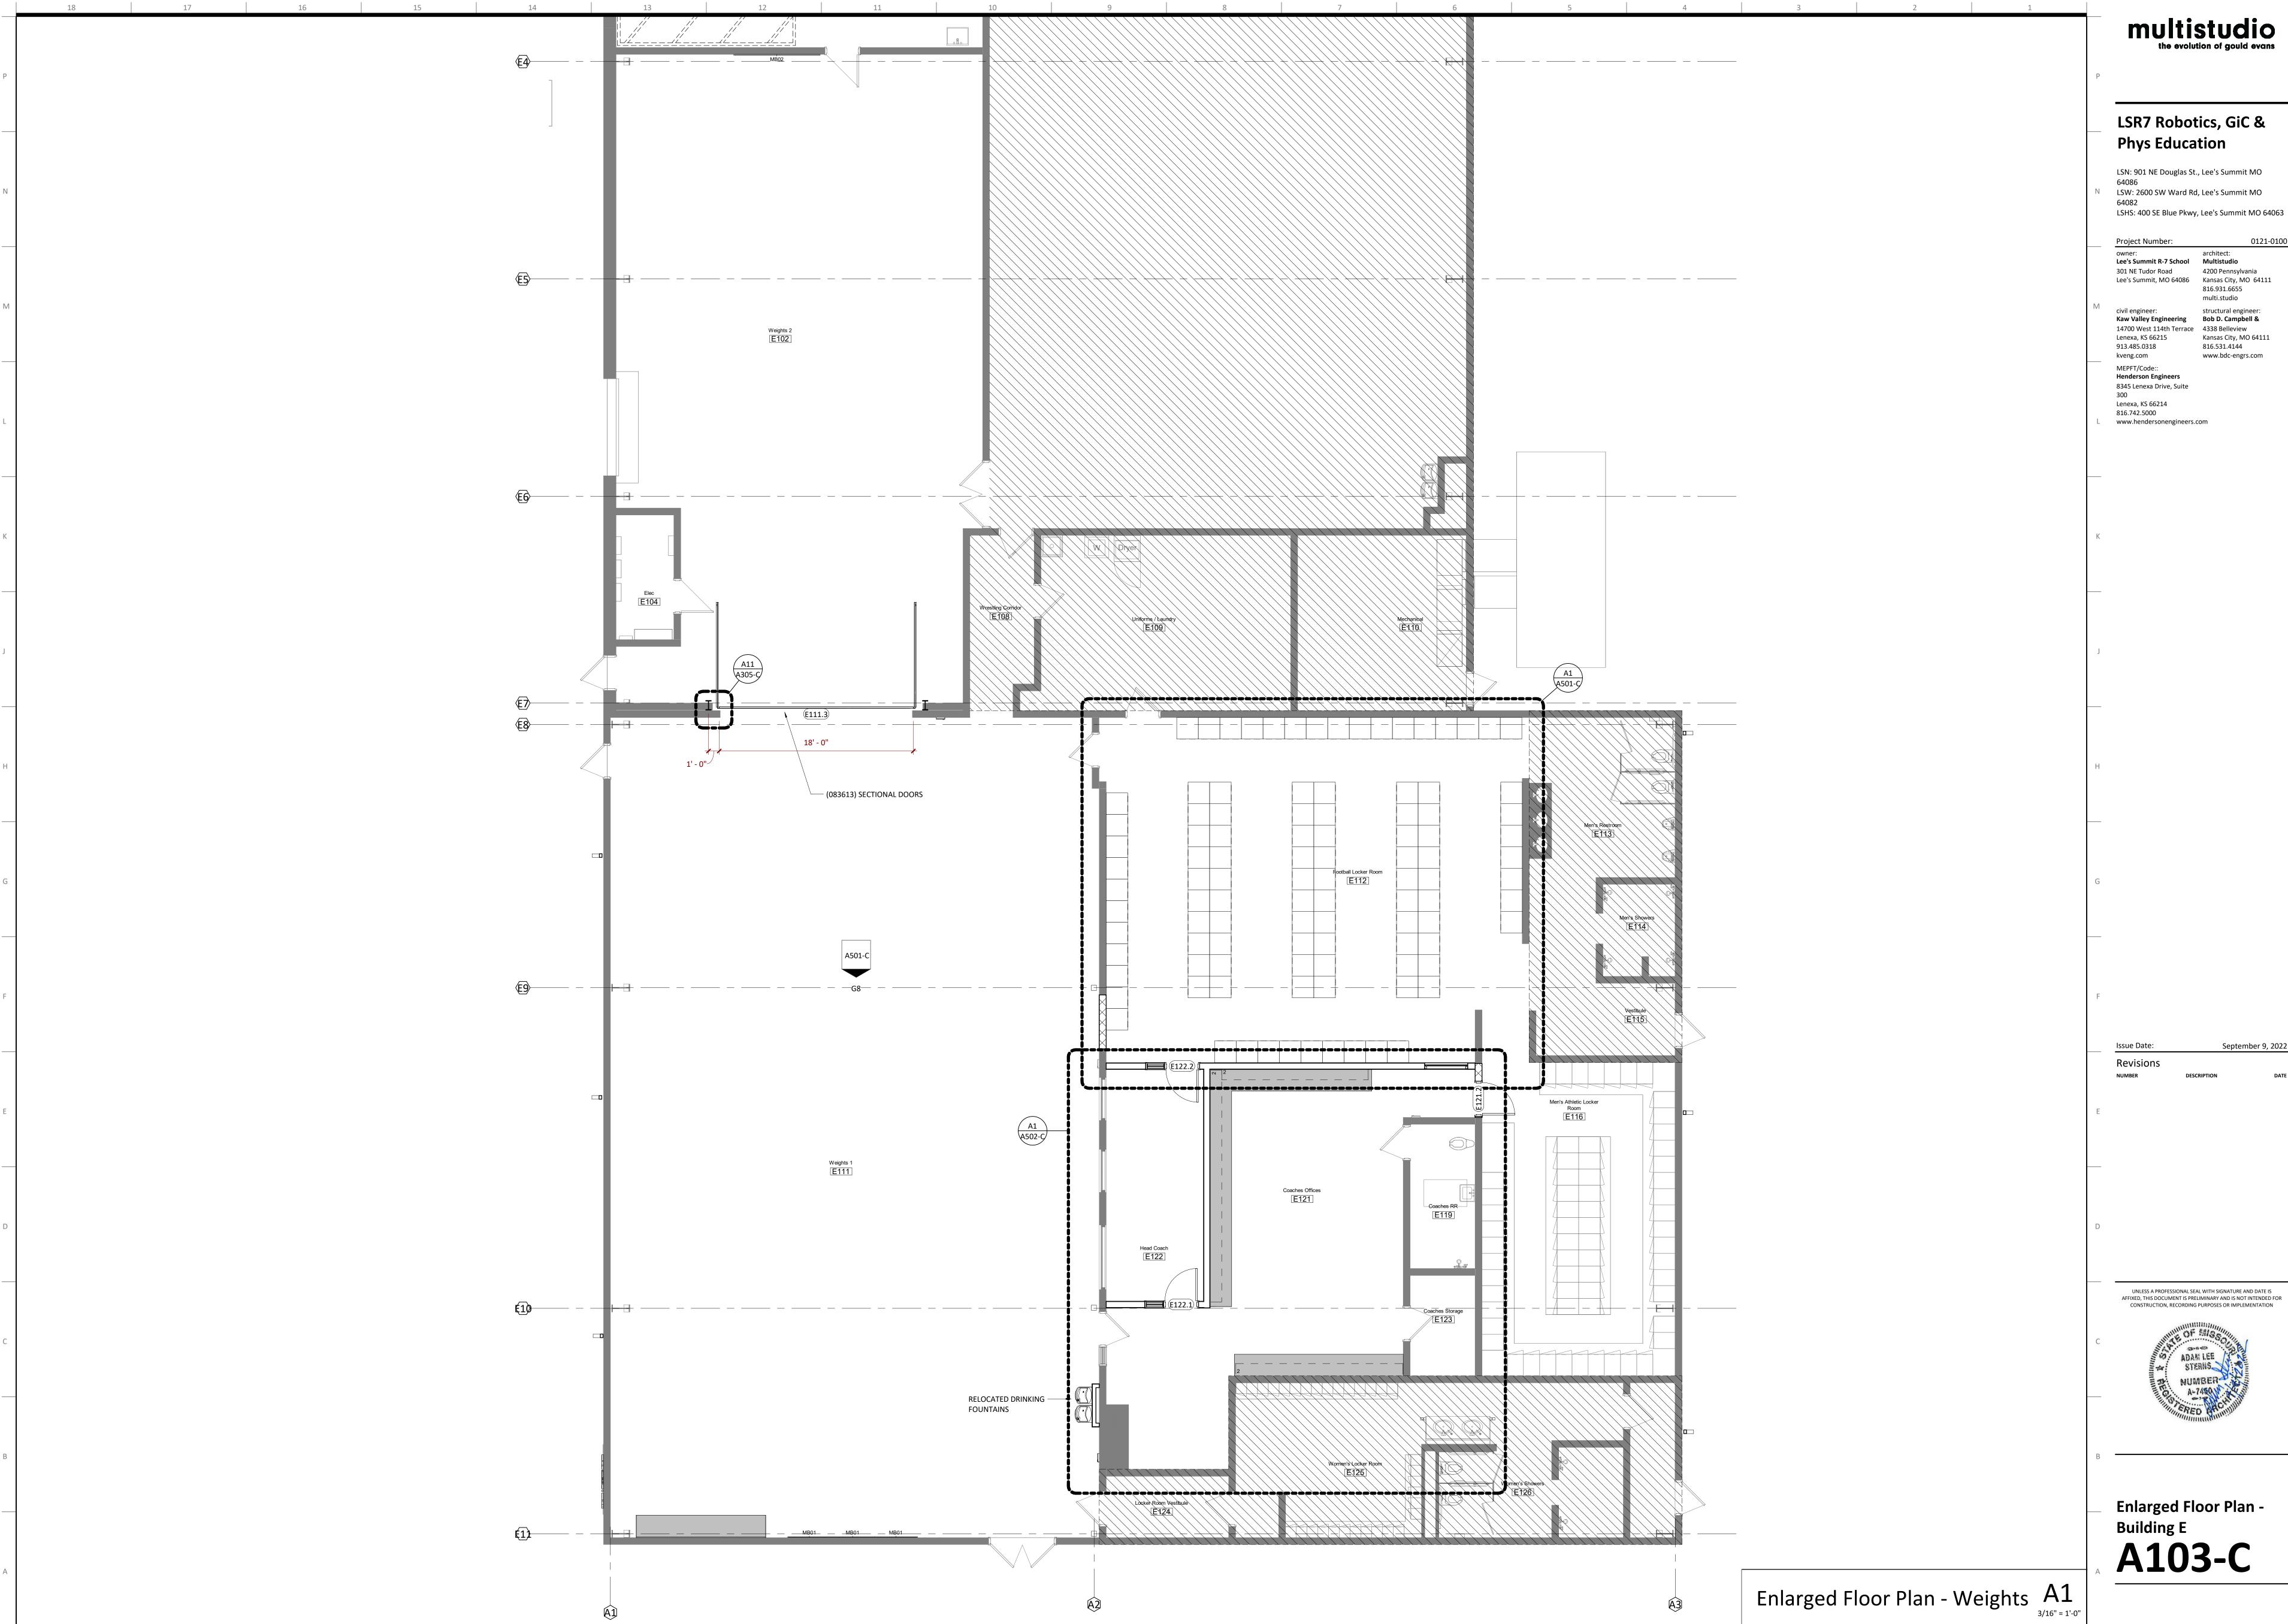


September 9, 2022

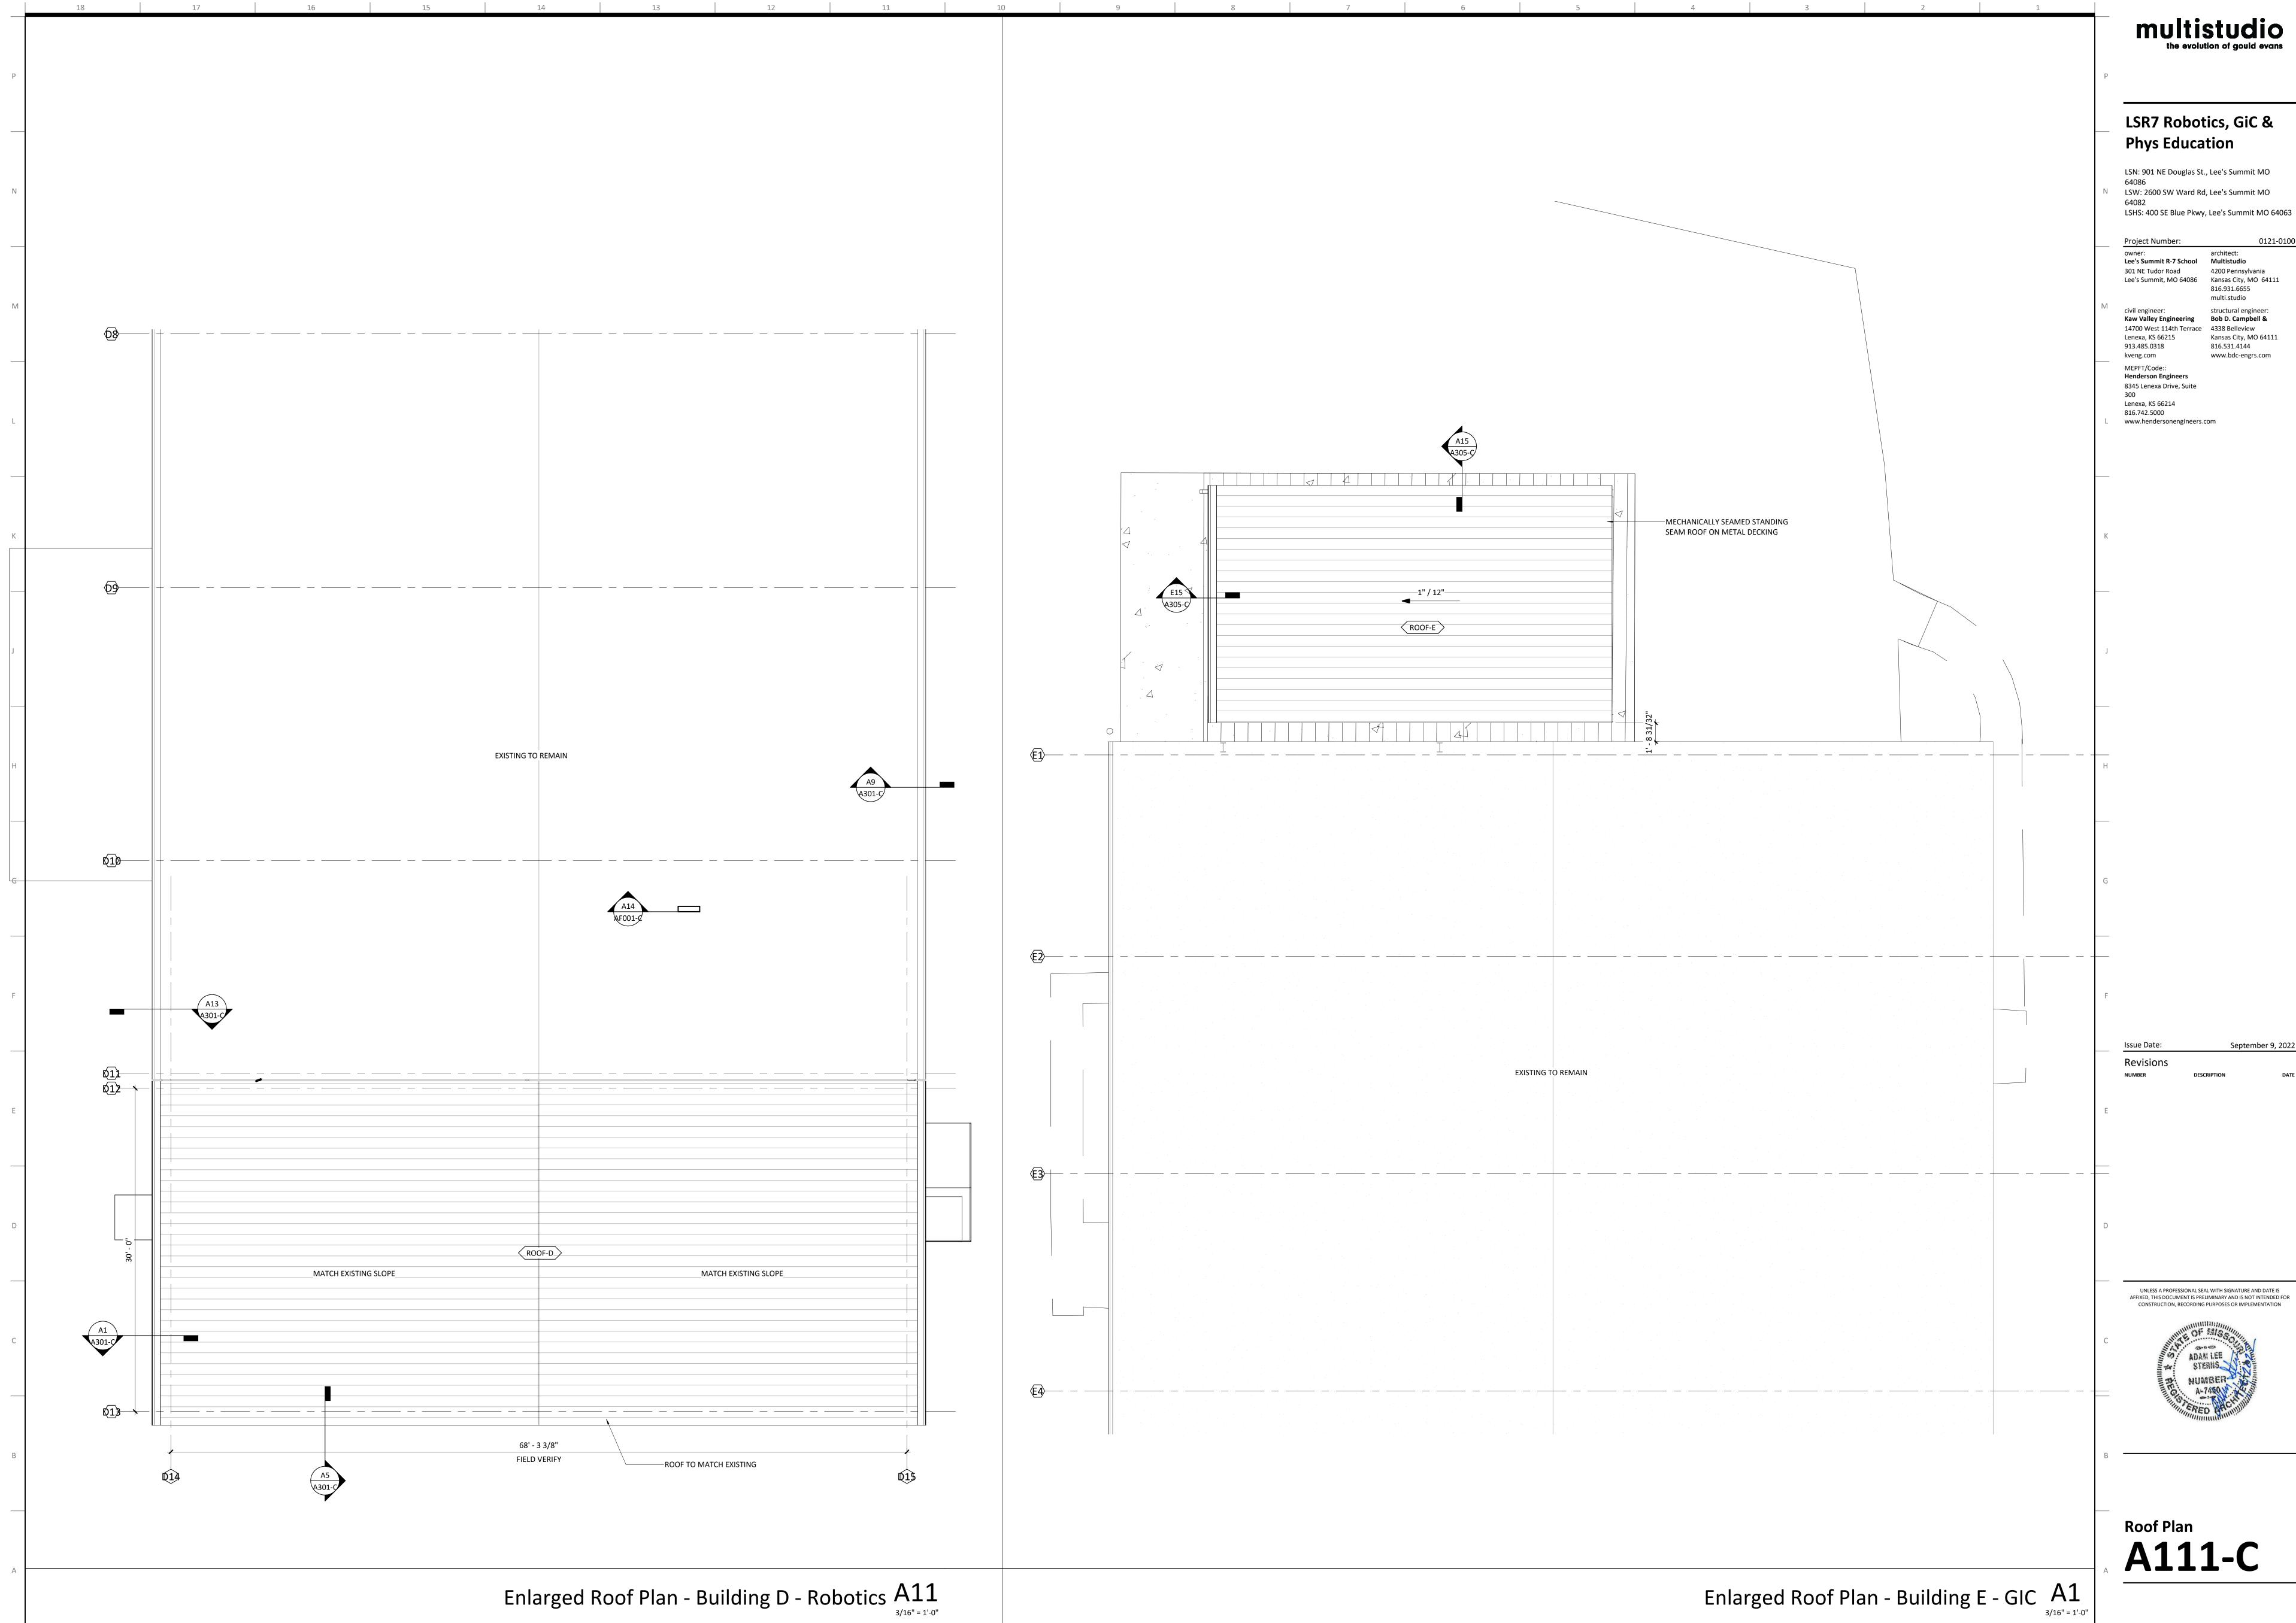


Kansas City, MO 64111

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR



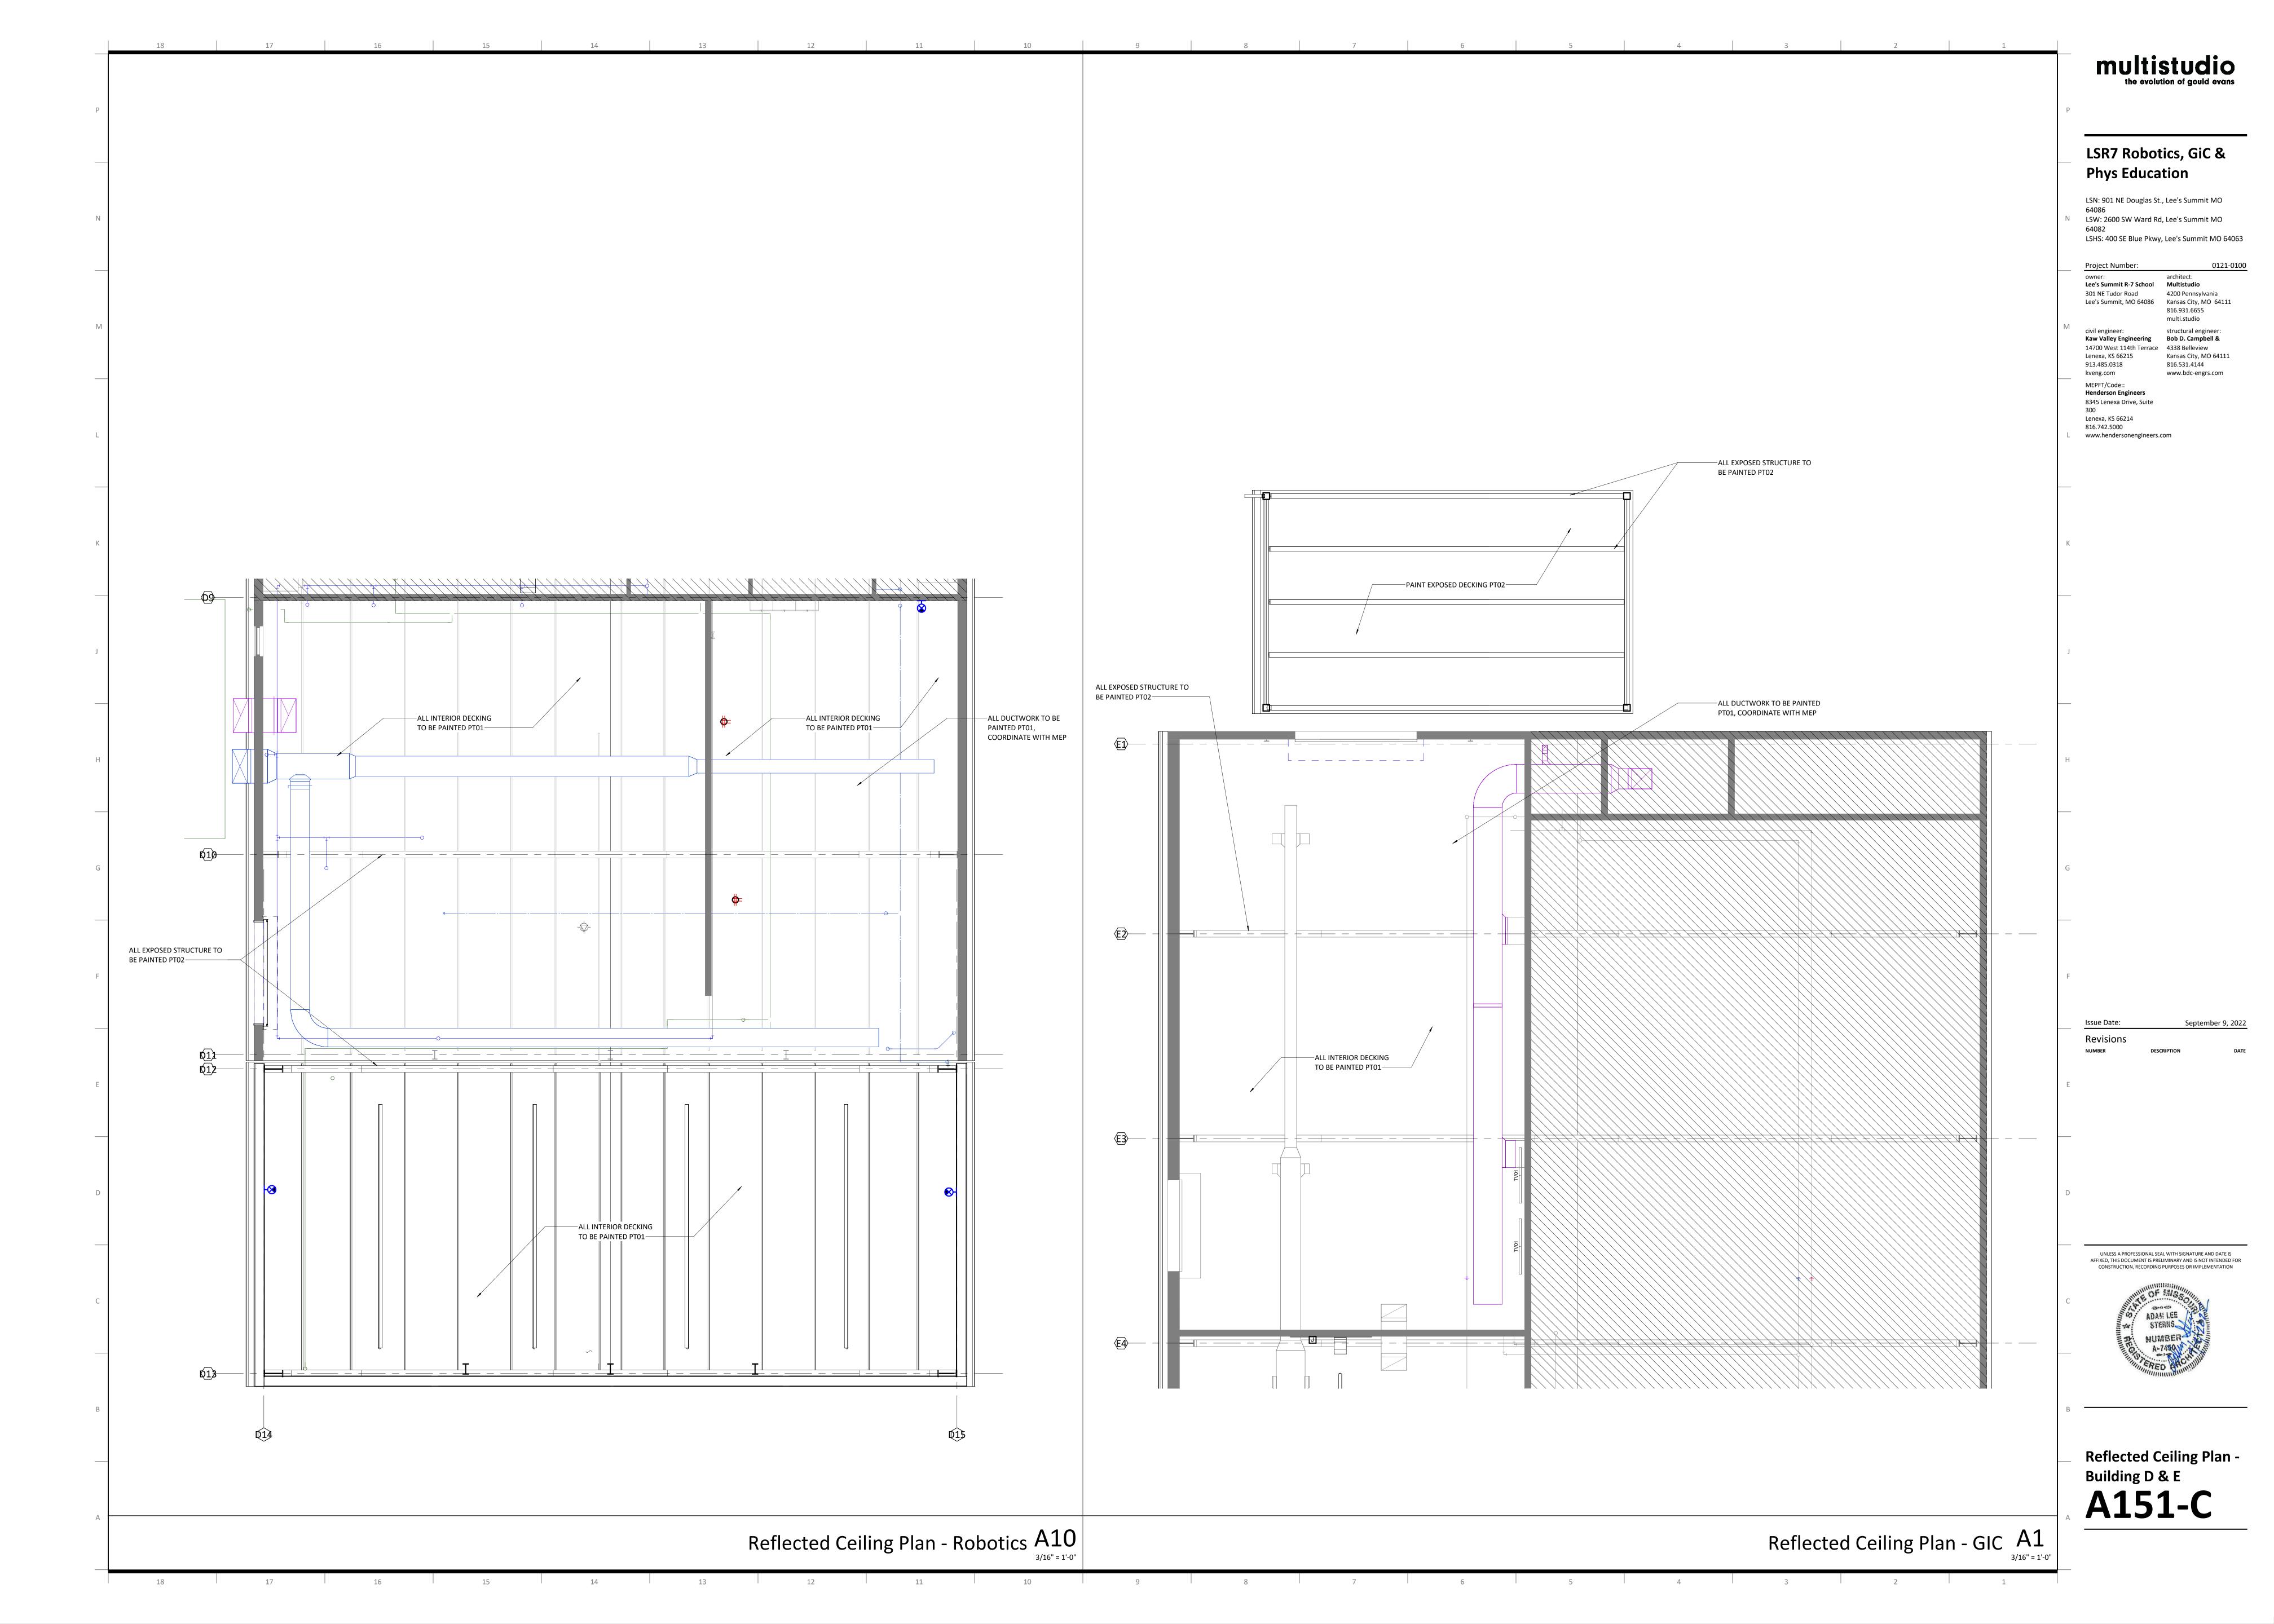

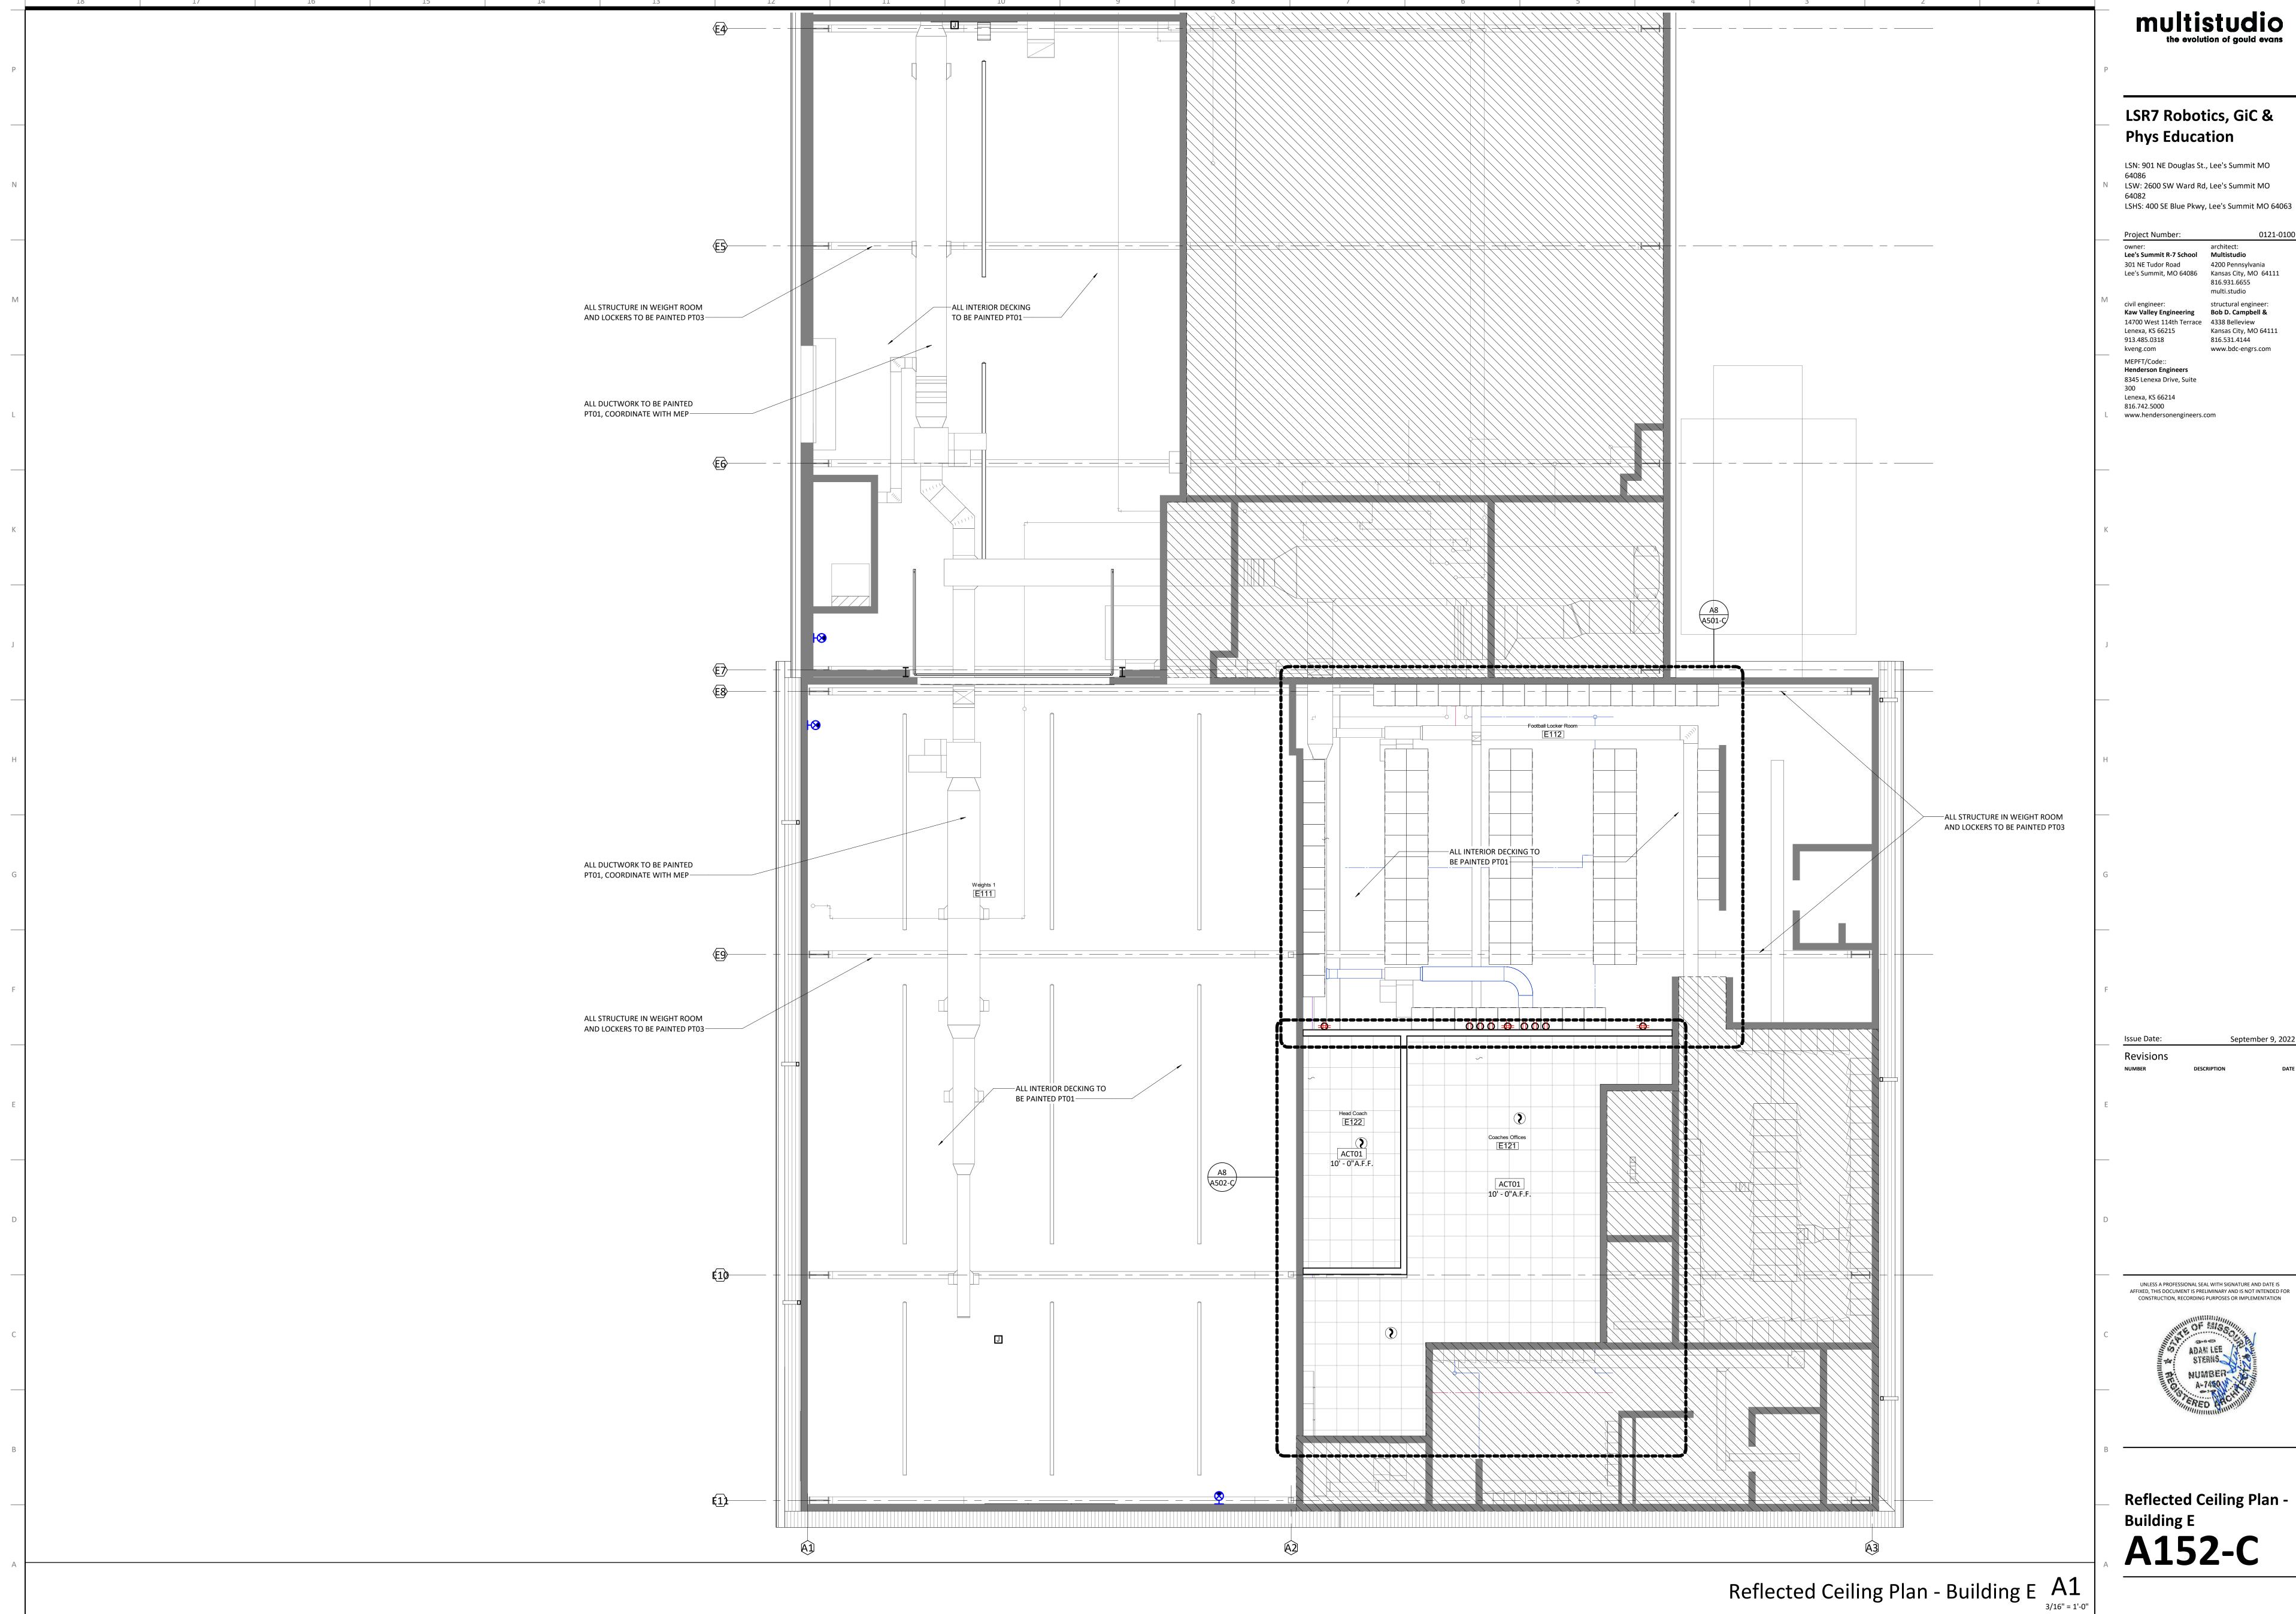


Lee's Summit, MO 64086 Kansas City, MO 64111

September 9, 2022

AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



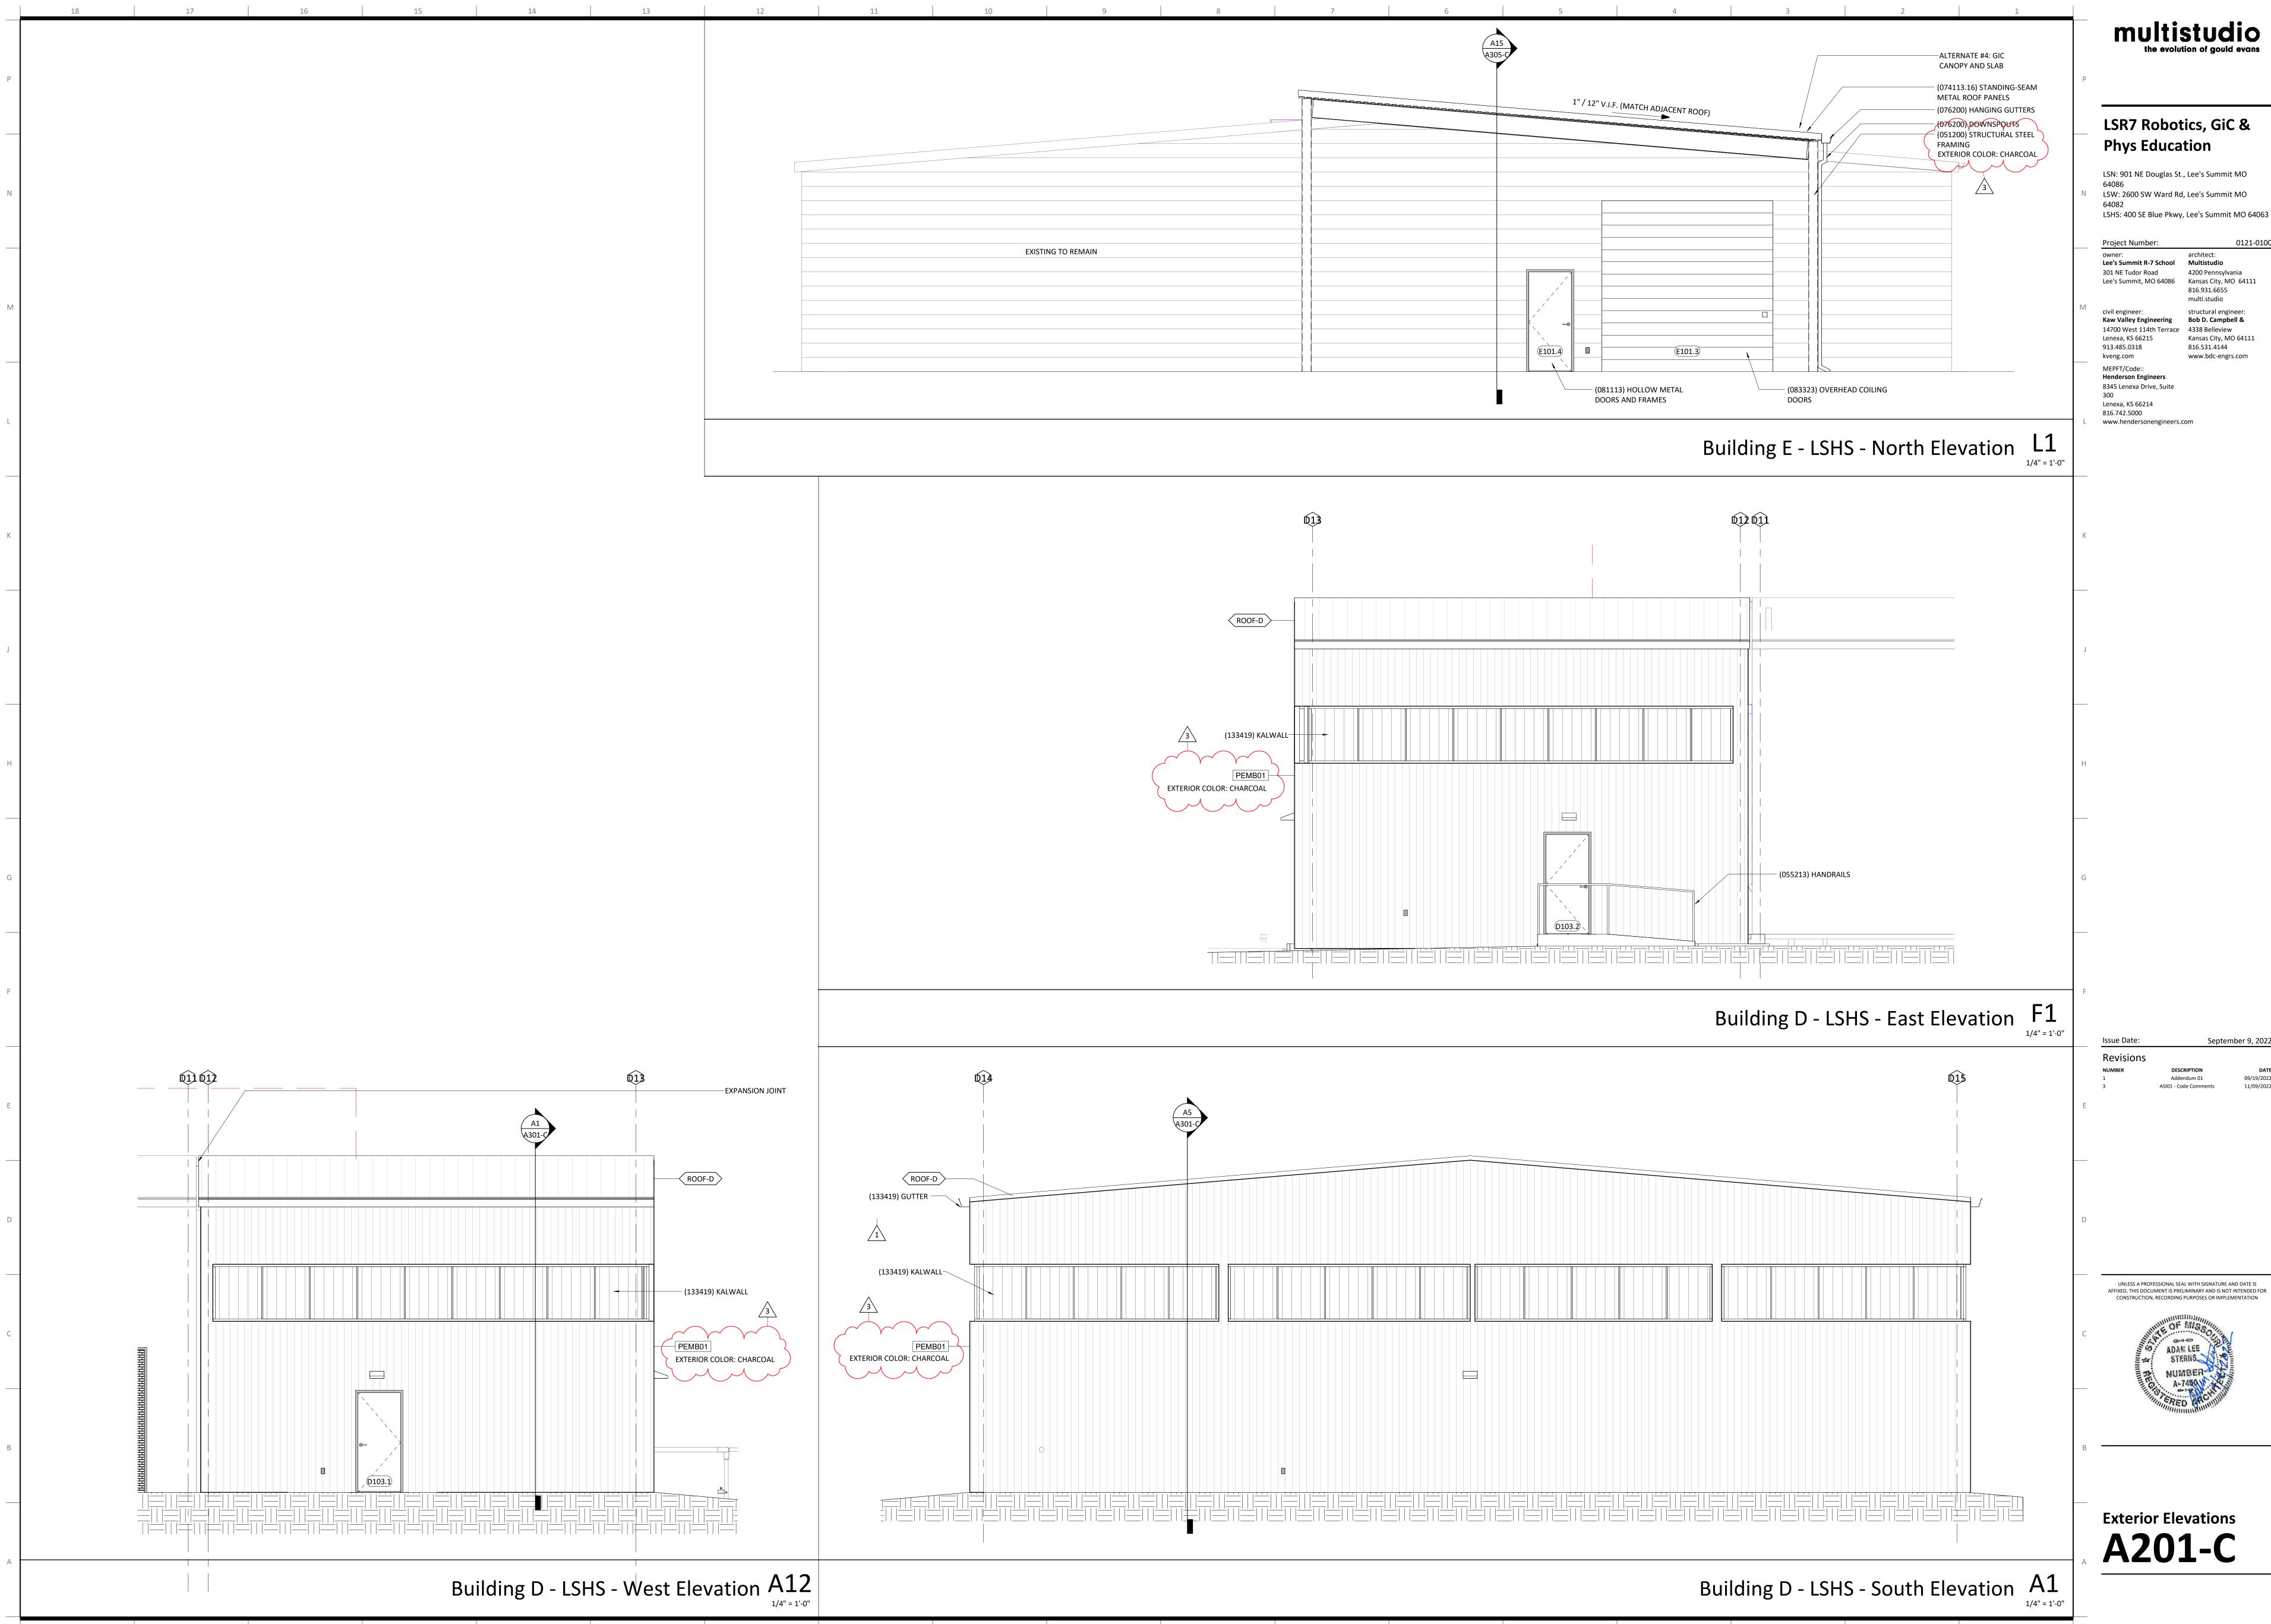


4200 Pennsylvania Lee's Summit, MO 64086 Kansas City, MO 64111 structural engineer:


Kansas City, MO 64111 www.bdc-engrs.com


September 9, 2022 09/19/2022 11/09/2022


UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION




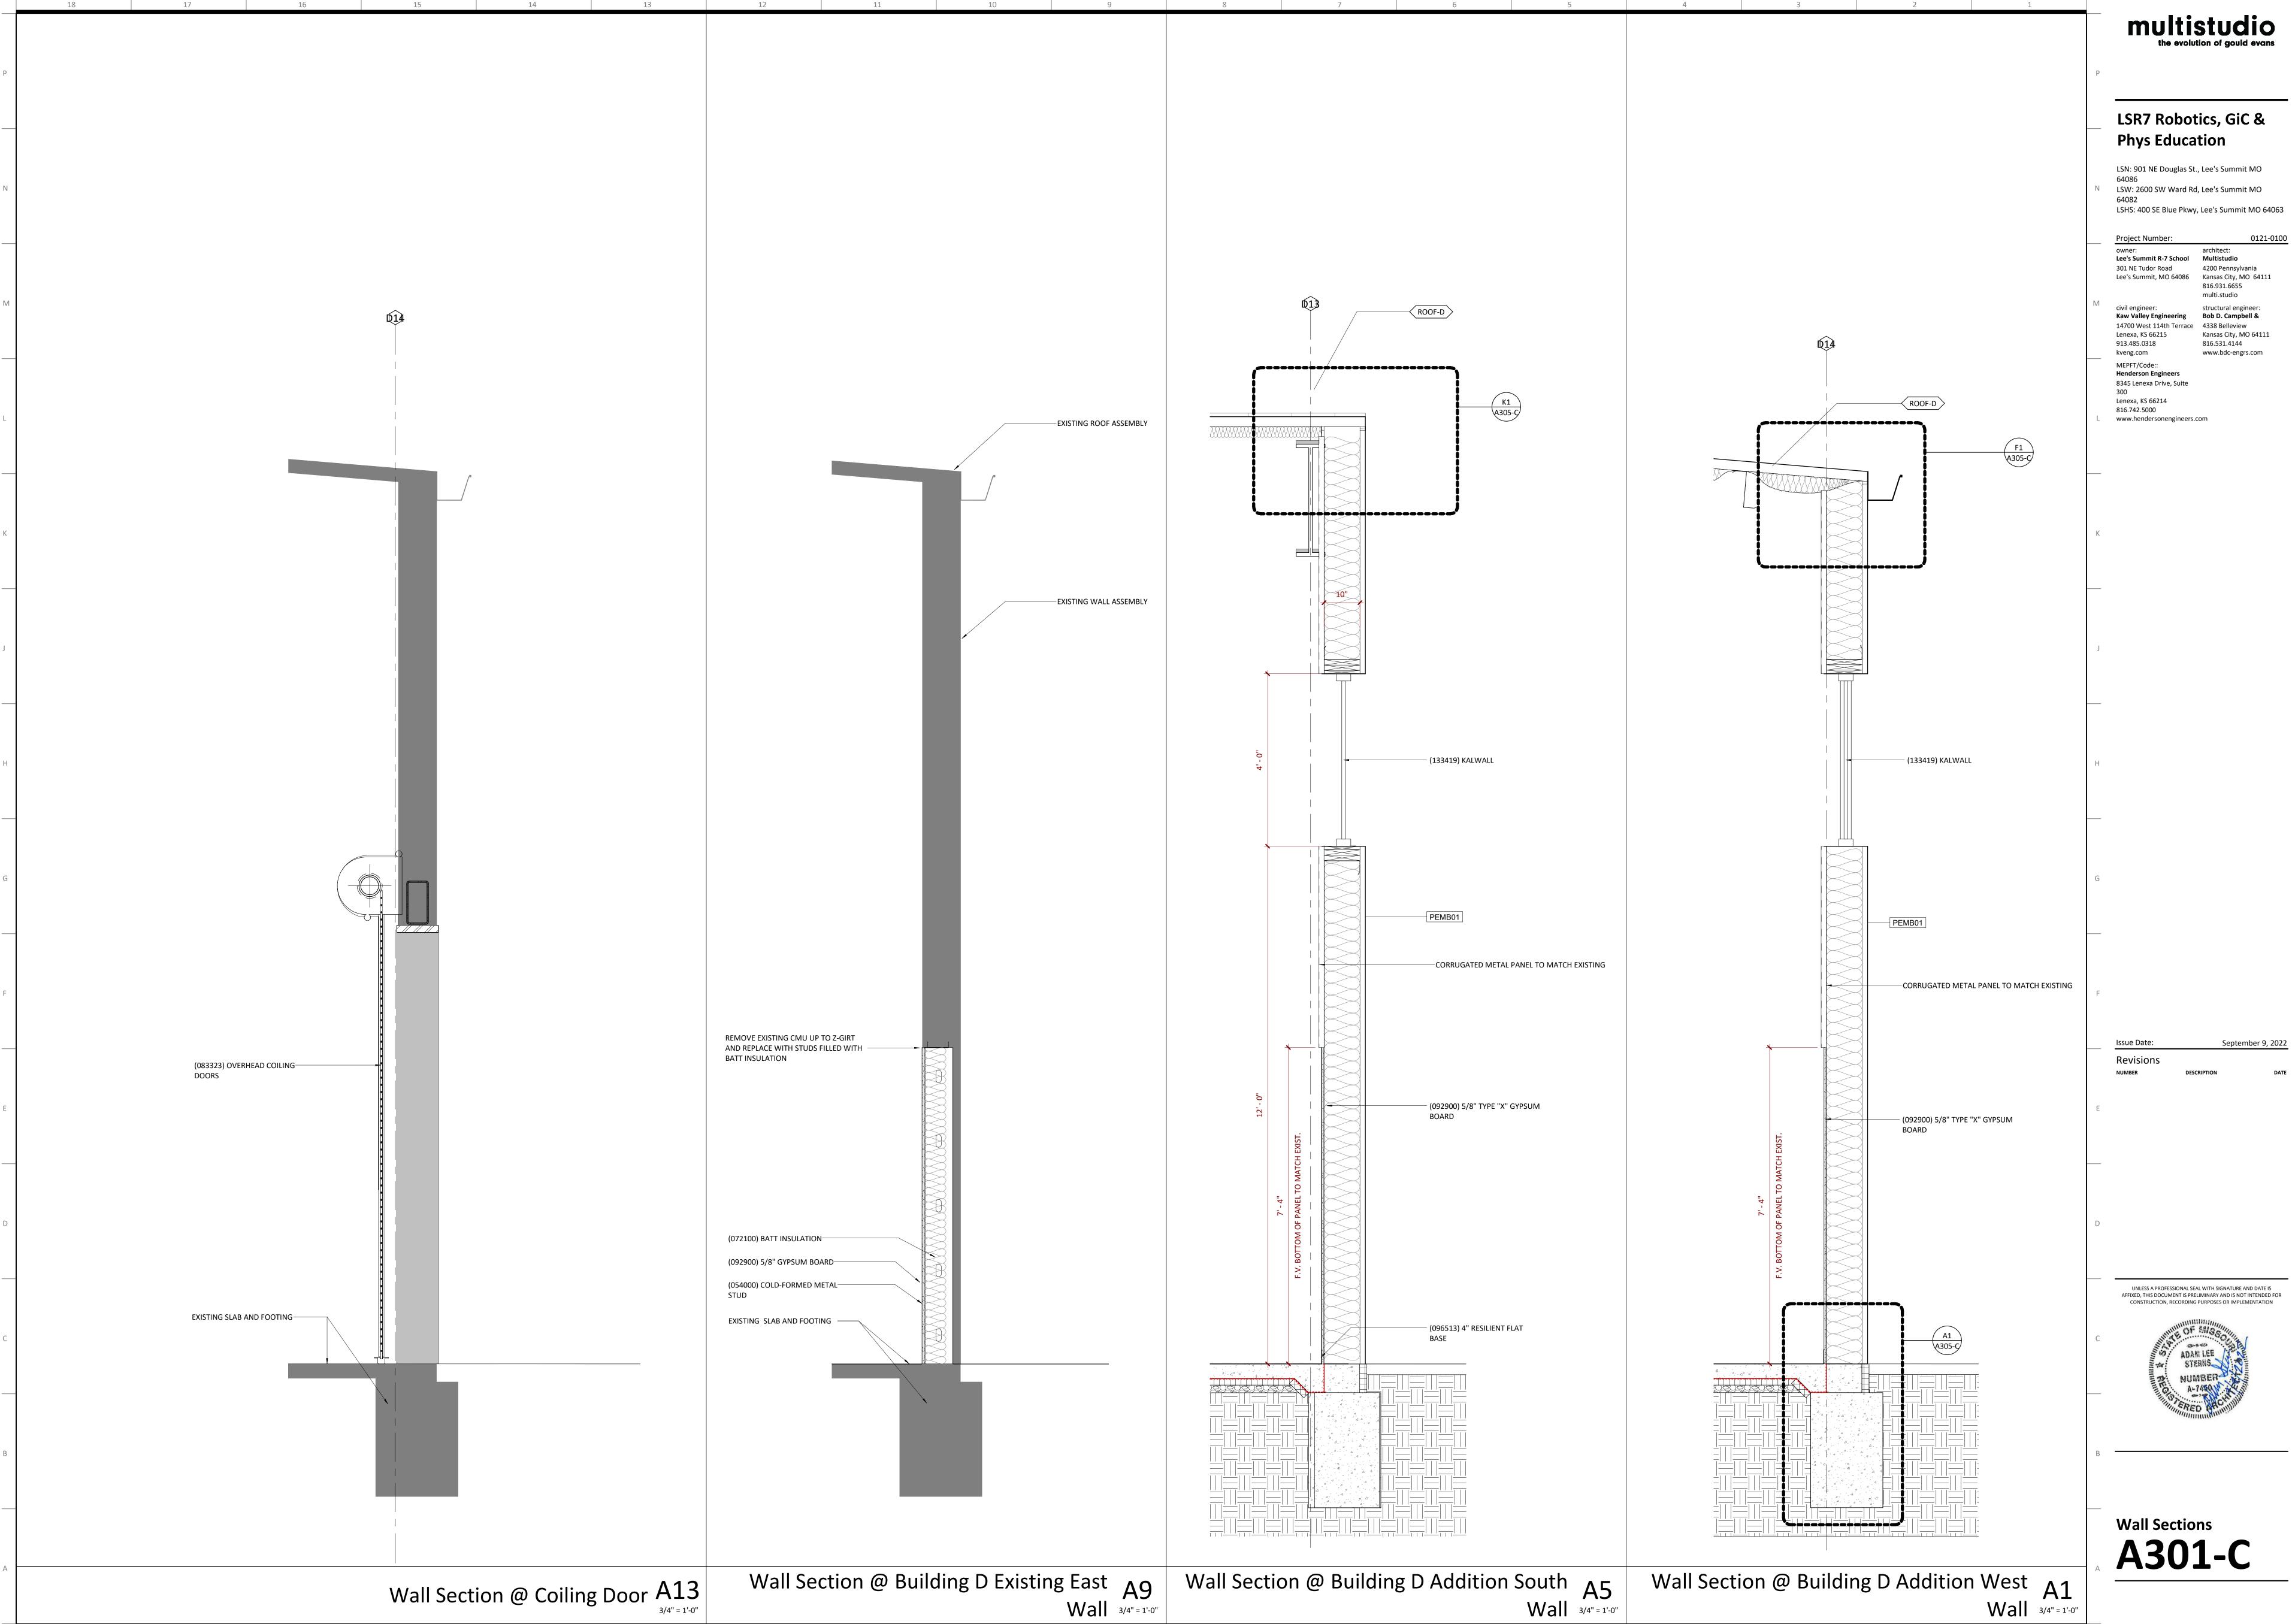

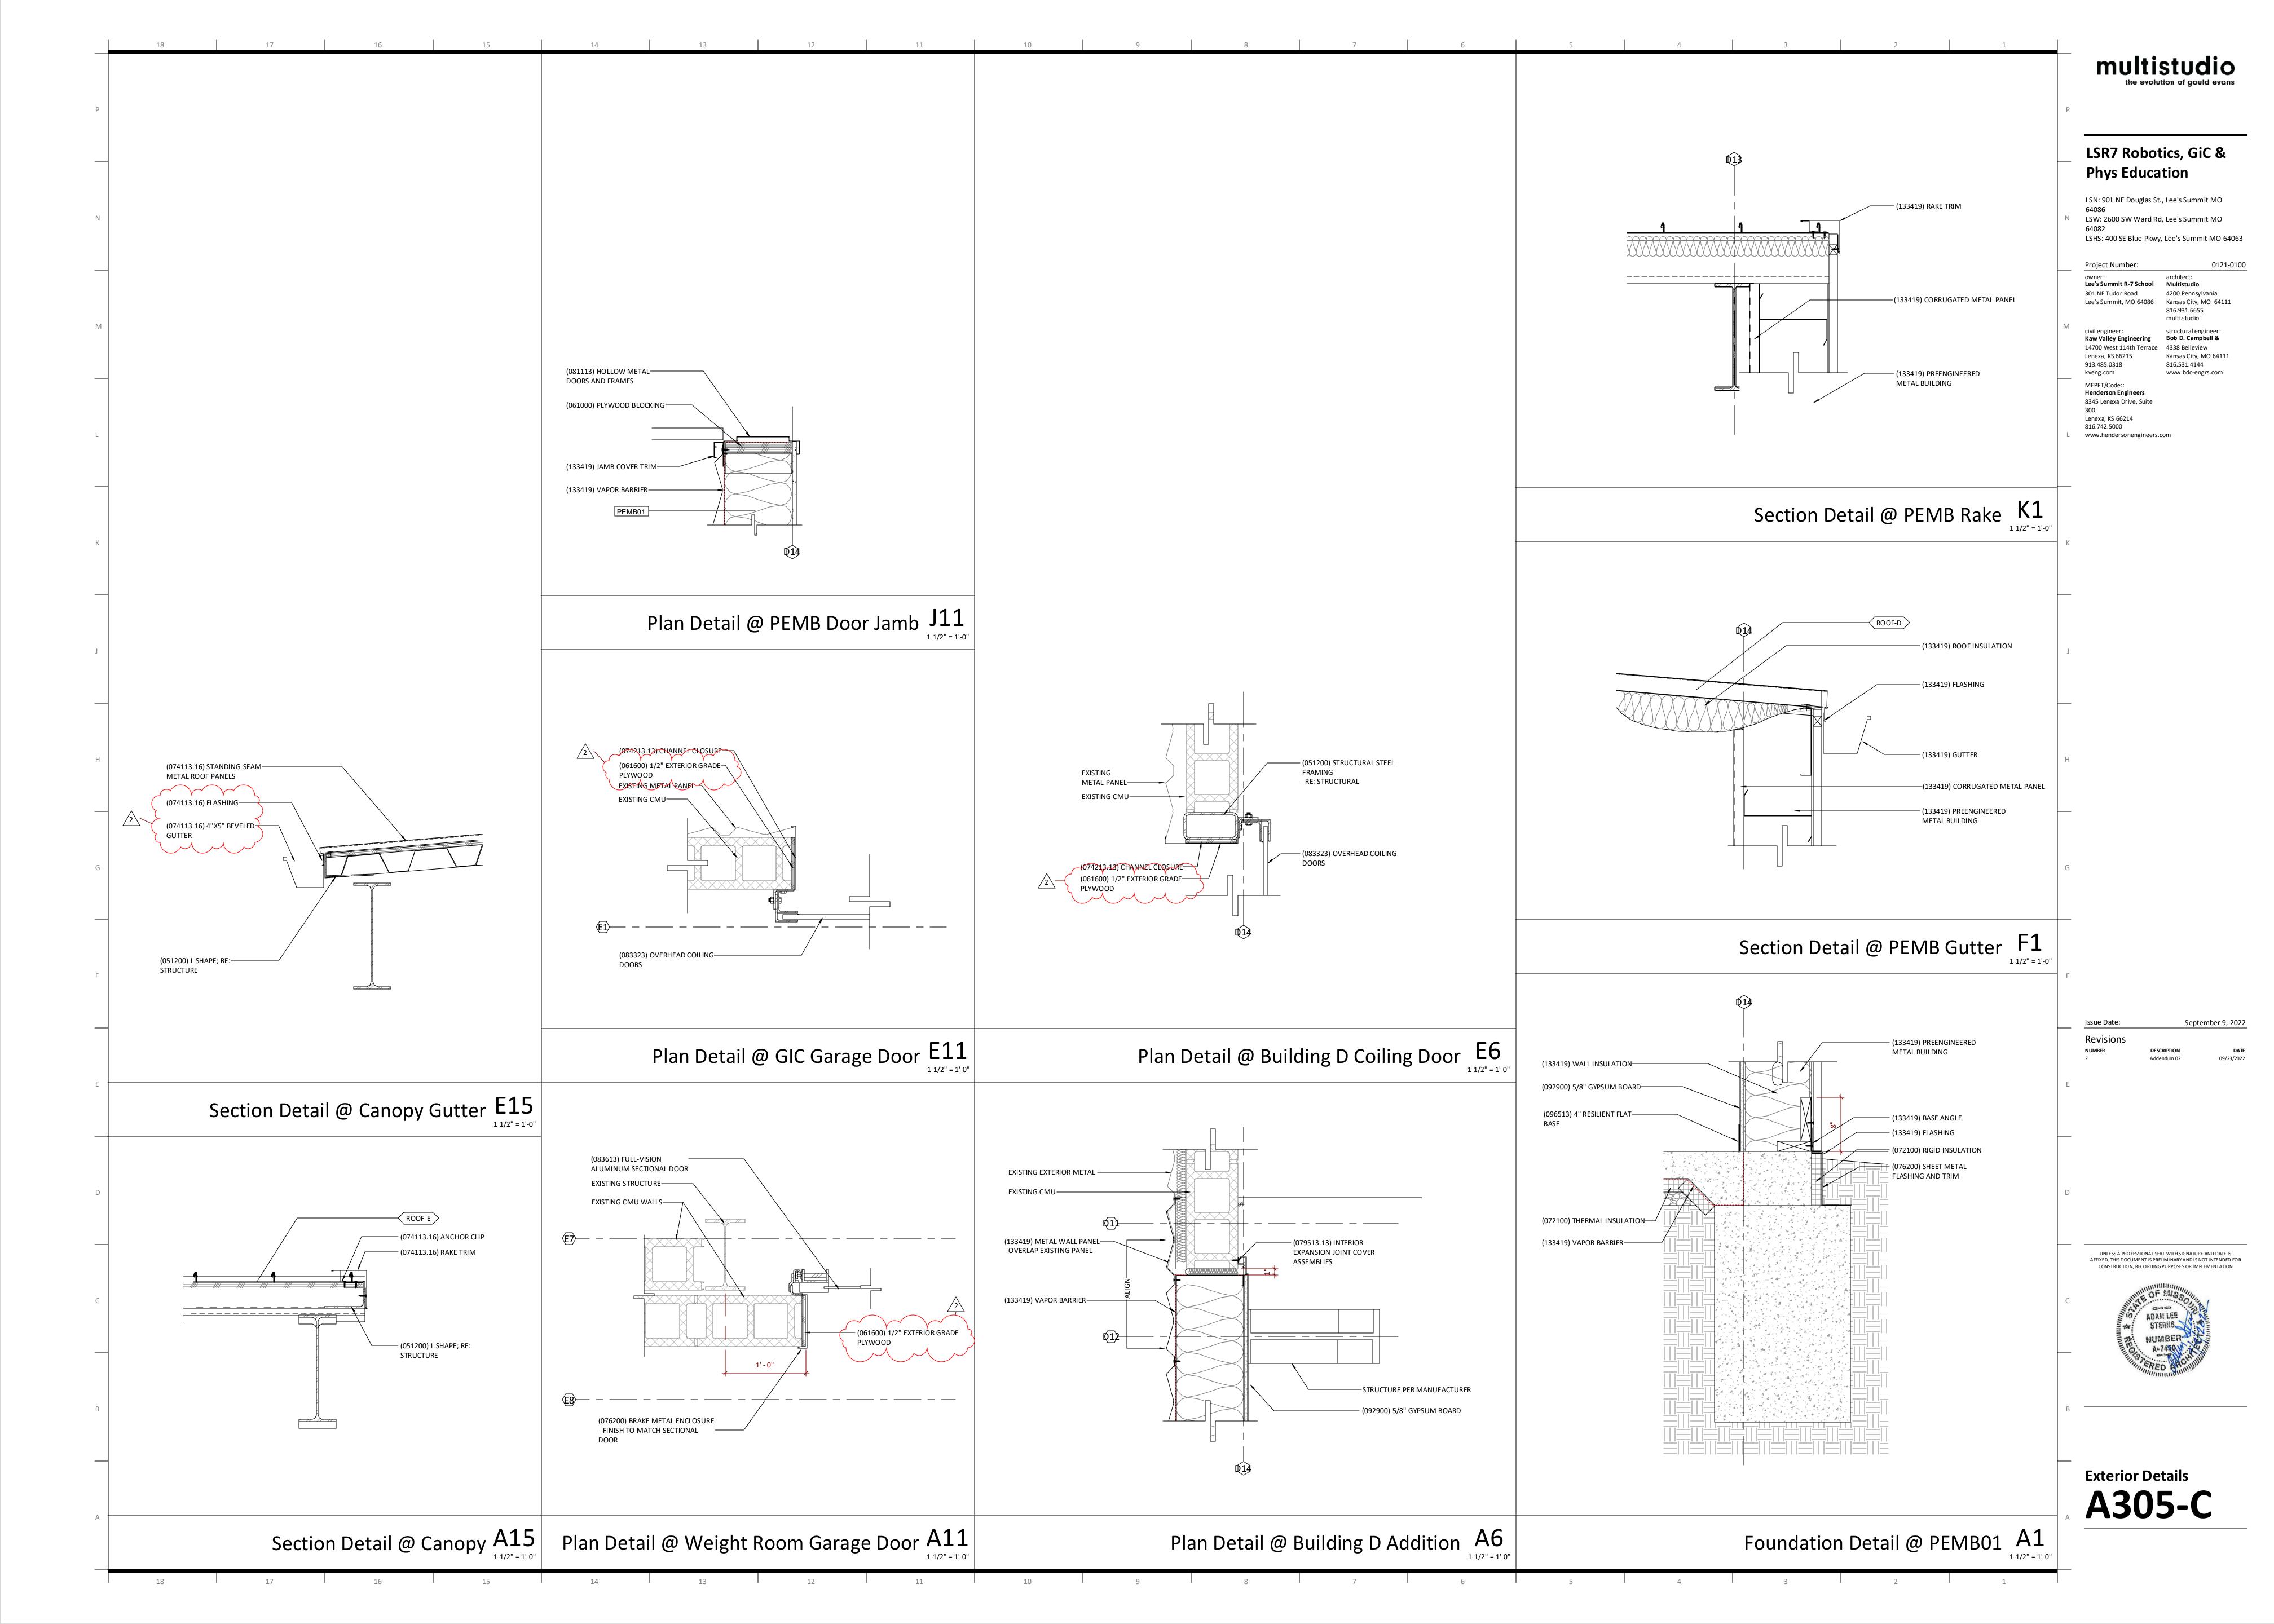

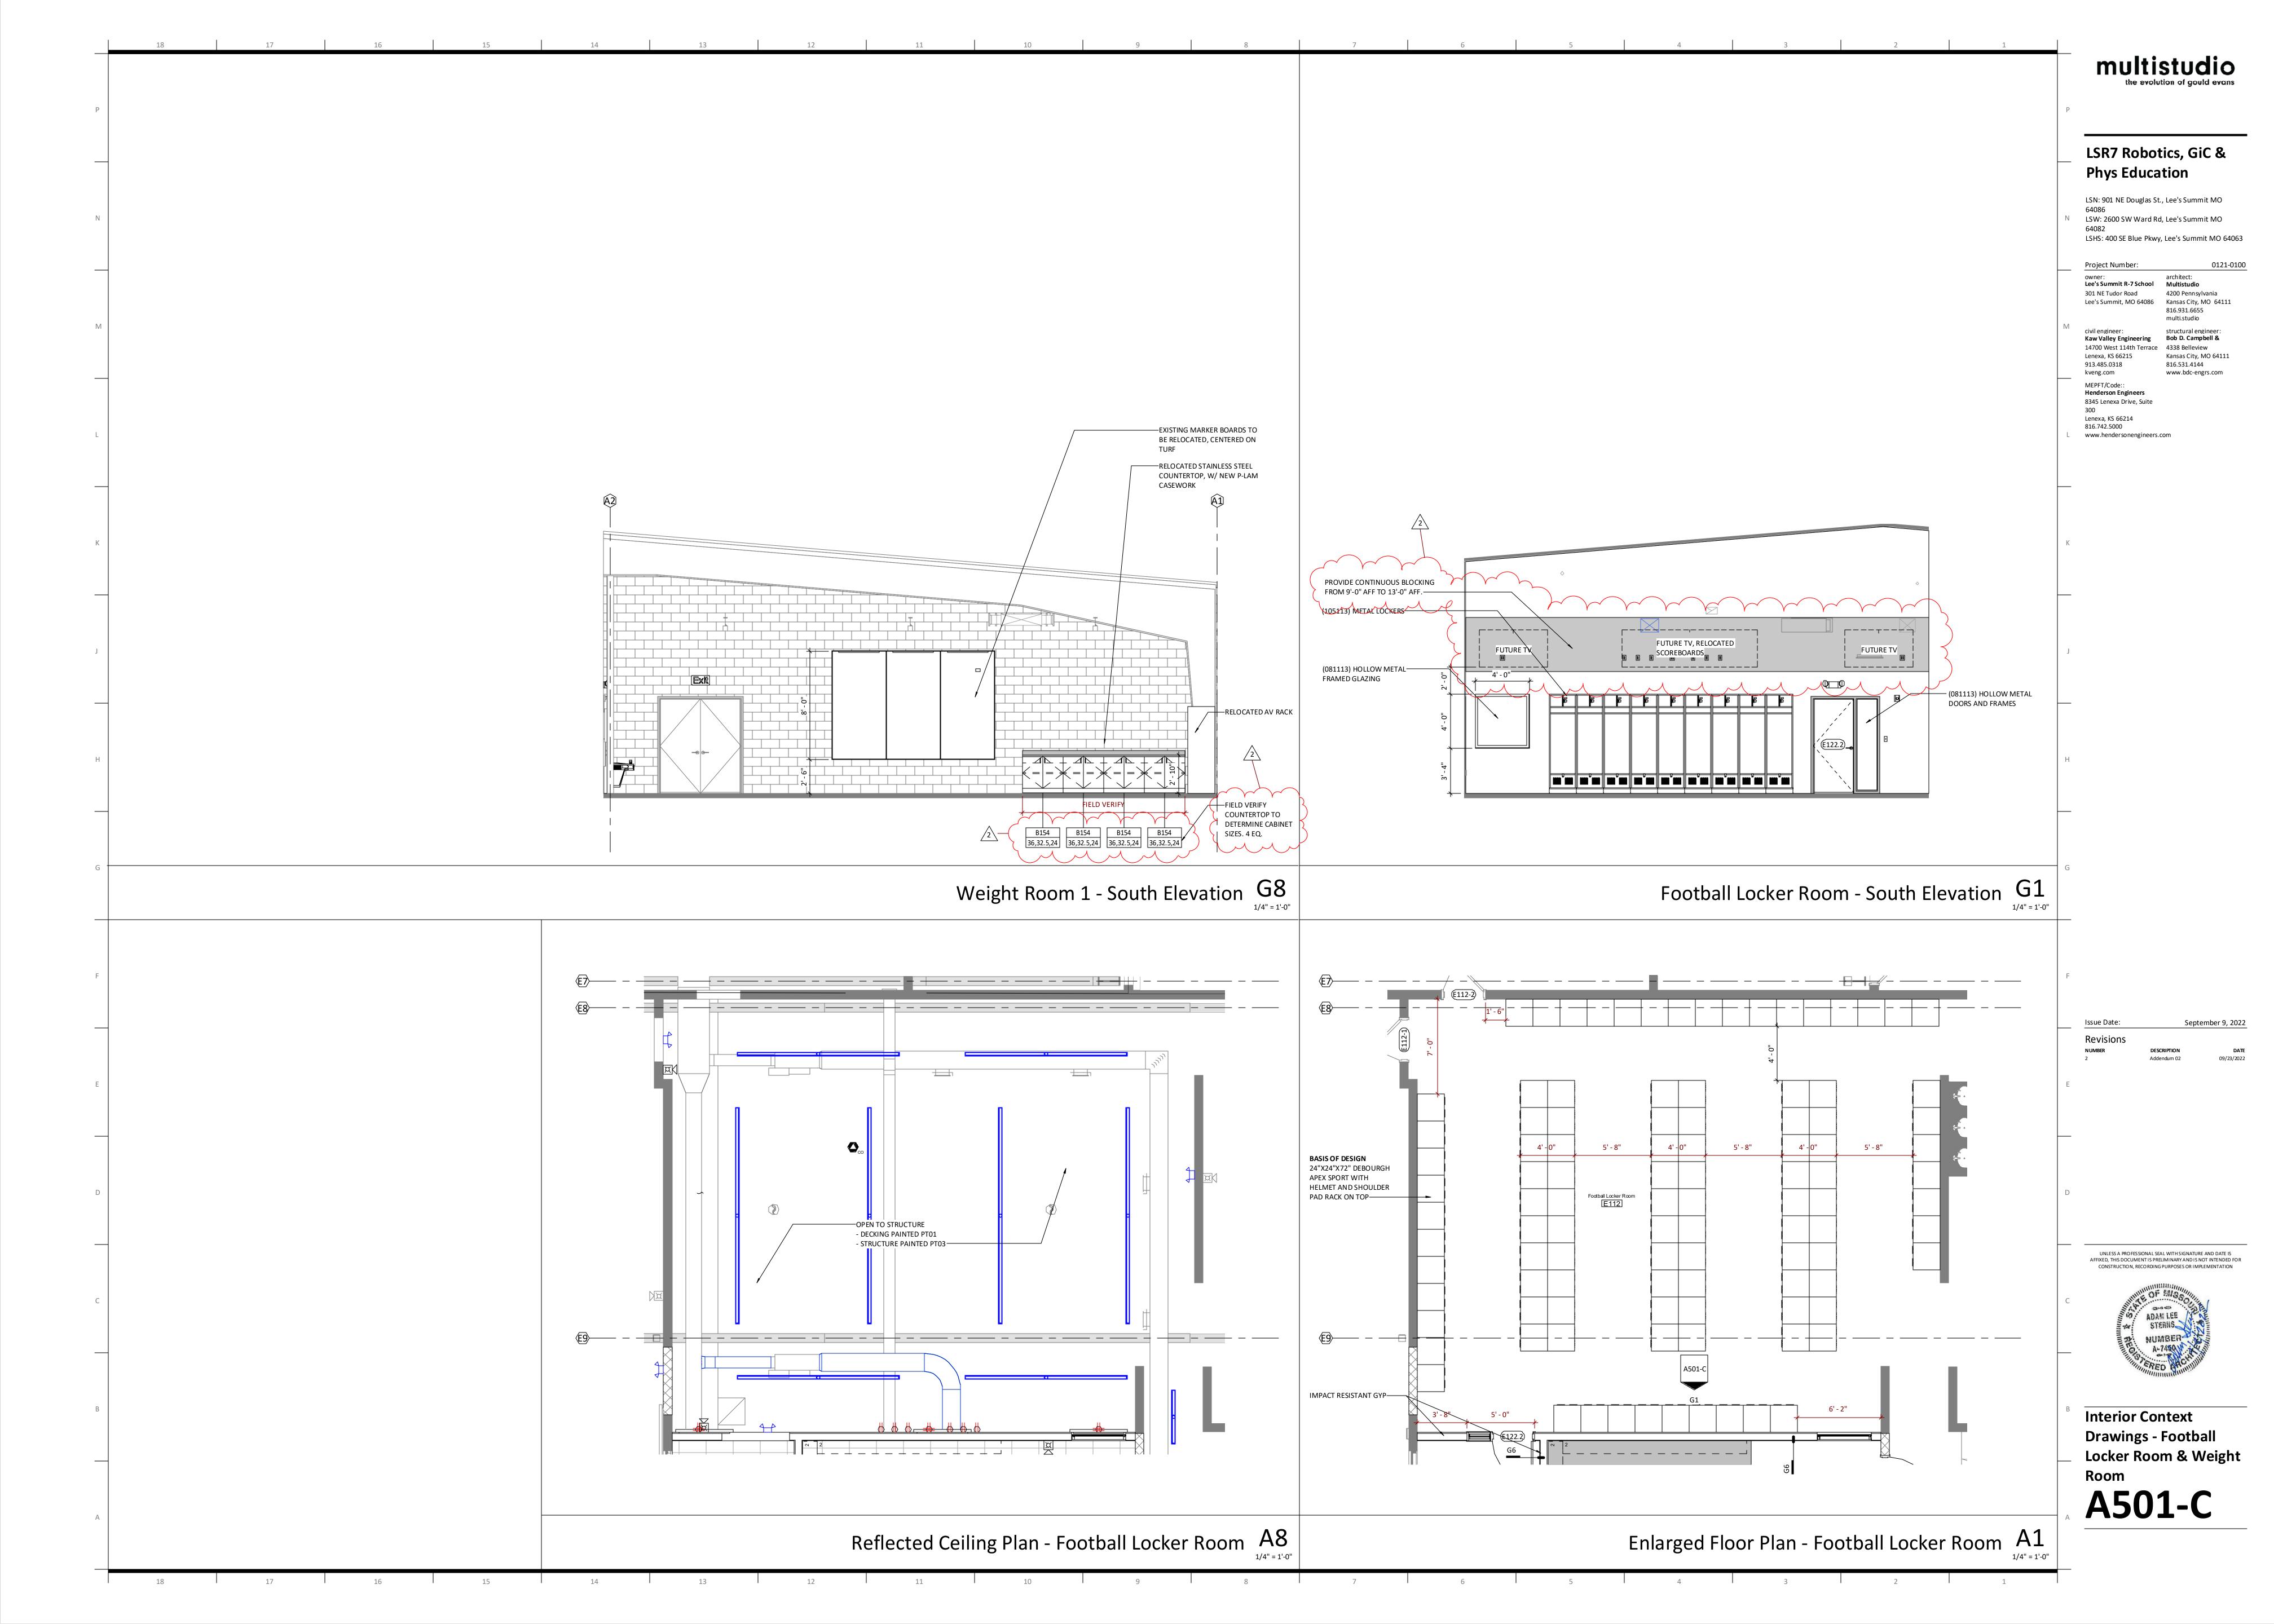

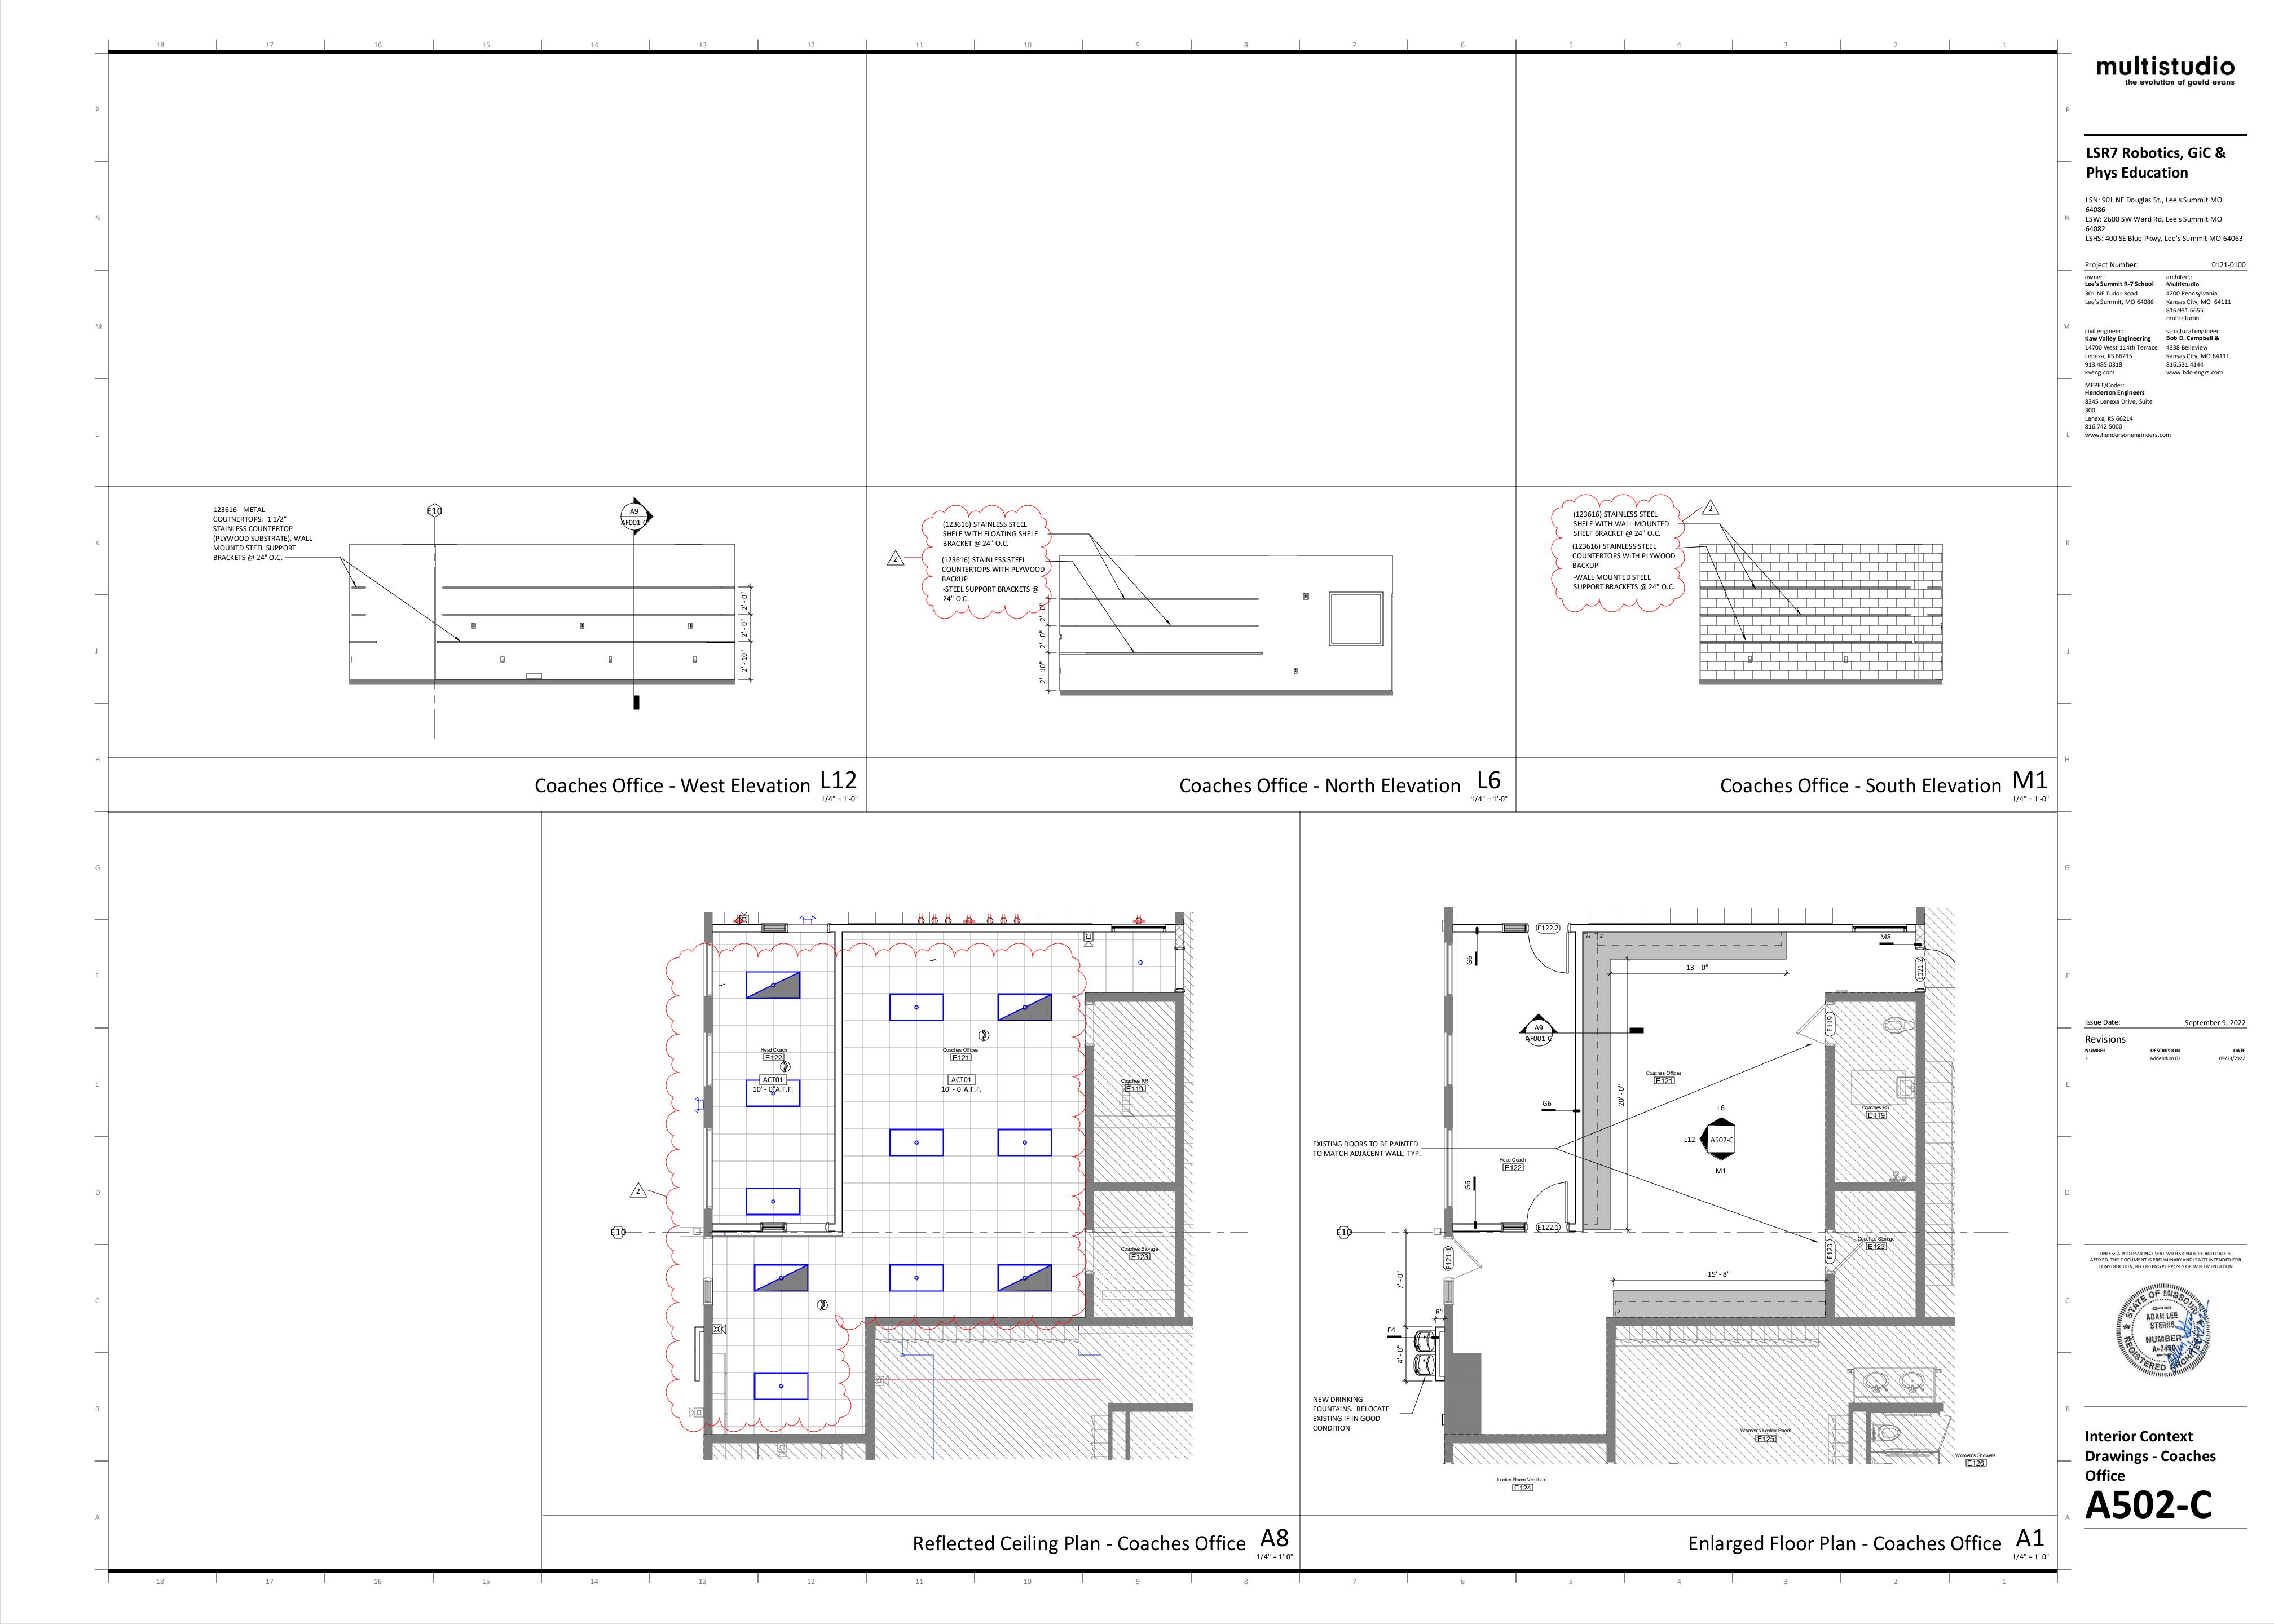

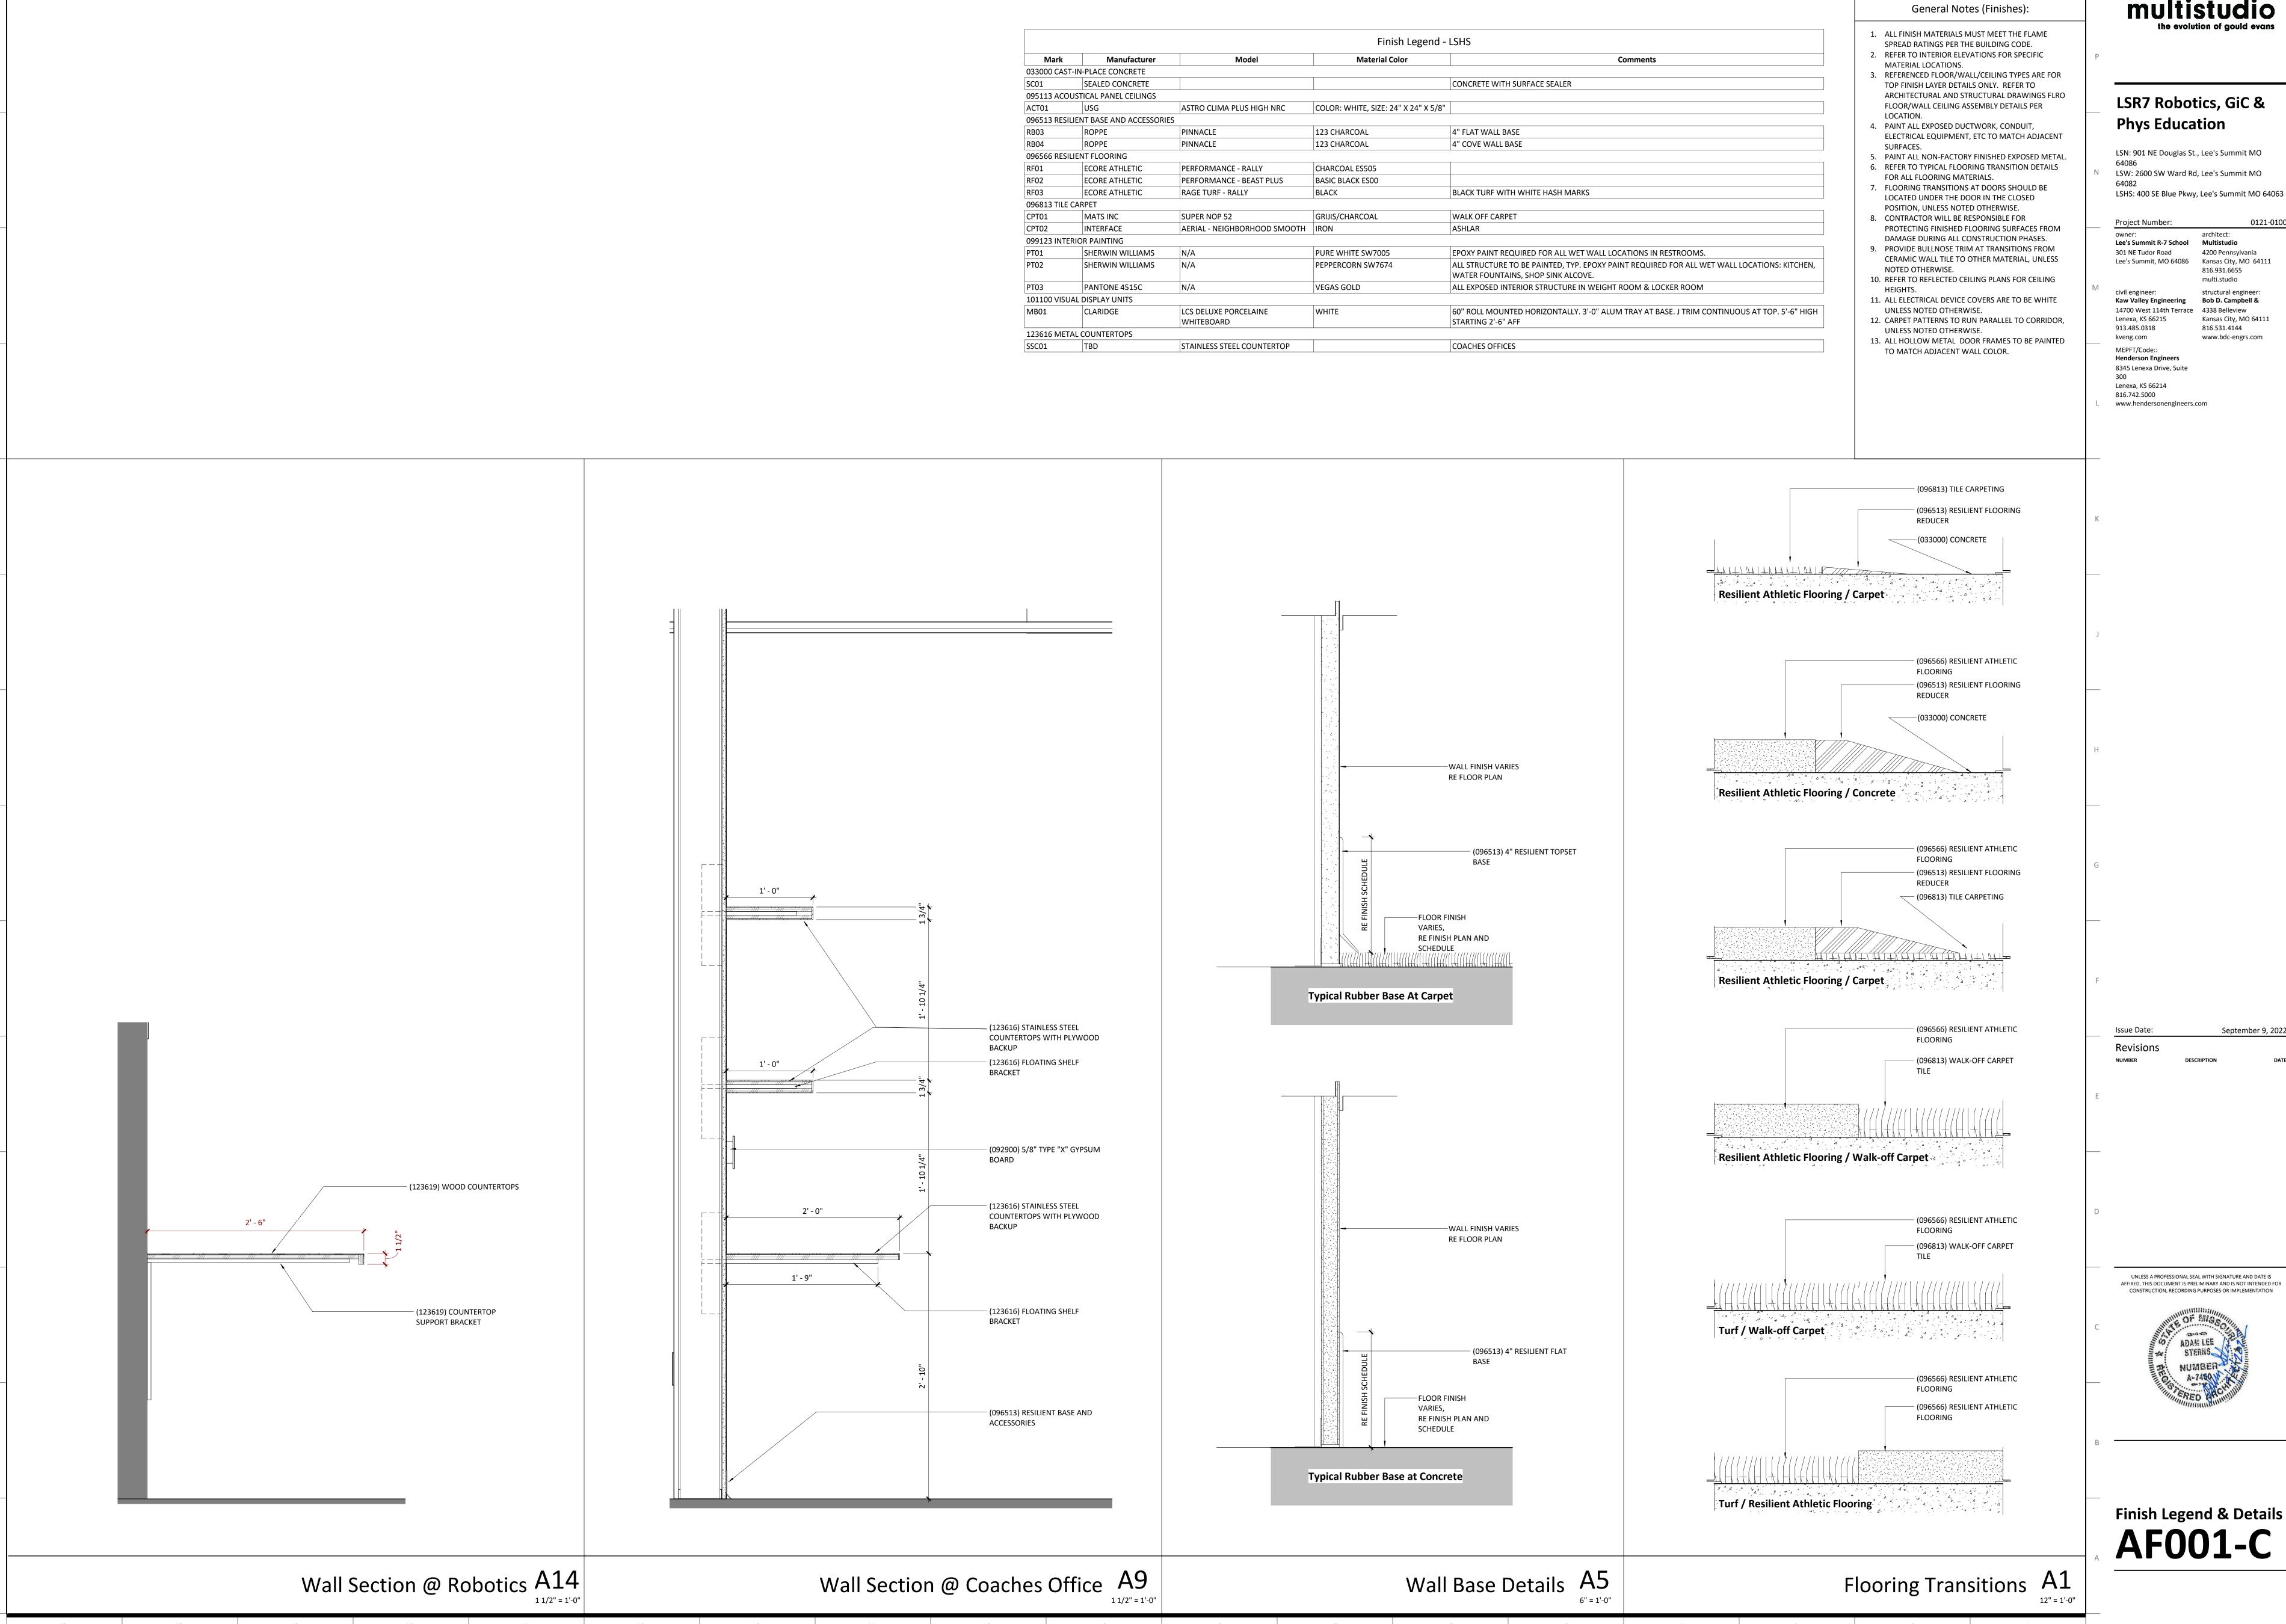

LSR7 Robotics, GiC & **Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO LSW: 2600 SW Ward Rd, Lee's Summit MO

Project Number: Lee's Summit R-7 School Multistudio

4200 Pennsylvania Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655 multi.studio structural engineer: Kaw Valley Engineering Bob D. Campbell & 14700 West 114th Terrace 4338 Belleview

Lenexa, KS 66215 Kansas City, MO 64111 913.485.0318 816.531.4144 www.bdc-engrs.com kveng.com MEPFT/Code:: **Henderson Engineers**


8345 Lenexa Drive, Suite Lenexa, KS 66214 816.742.5000 www.hendersonengineers.com

Issue Date: September 9, 2022

> UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



Finish Legend & Details **AF001-C**

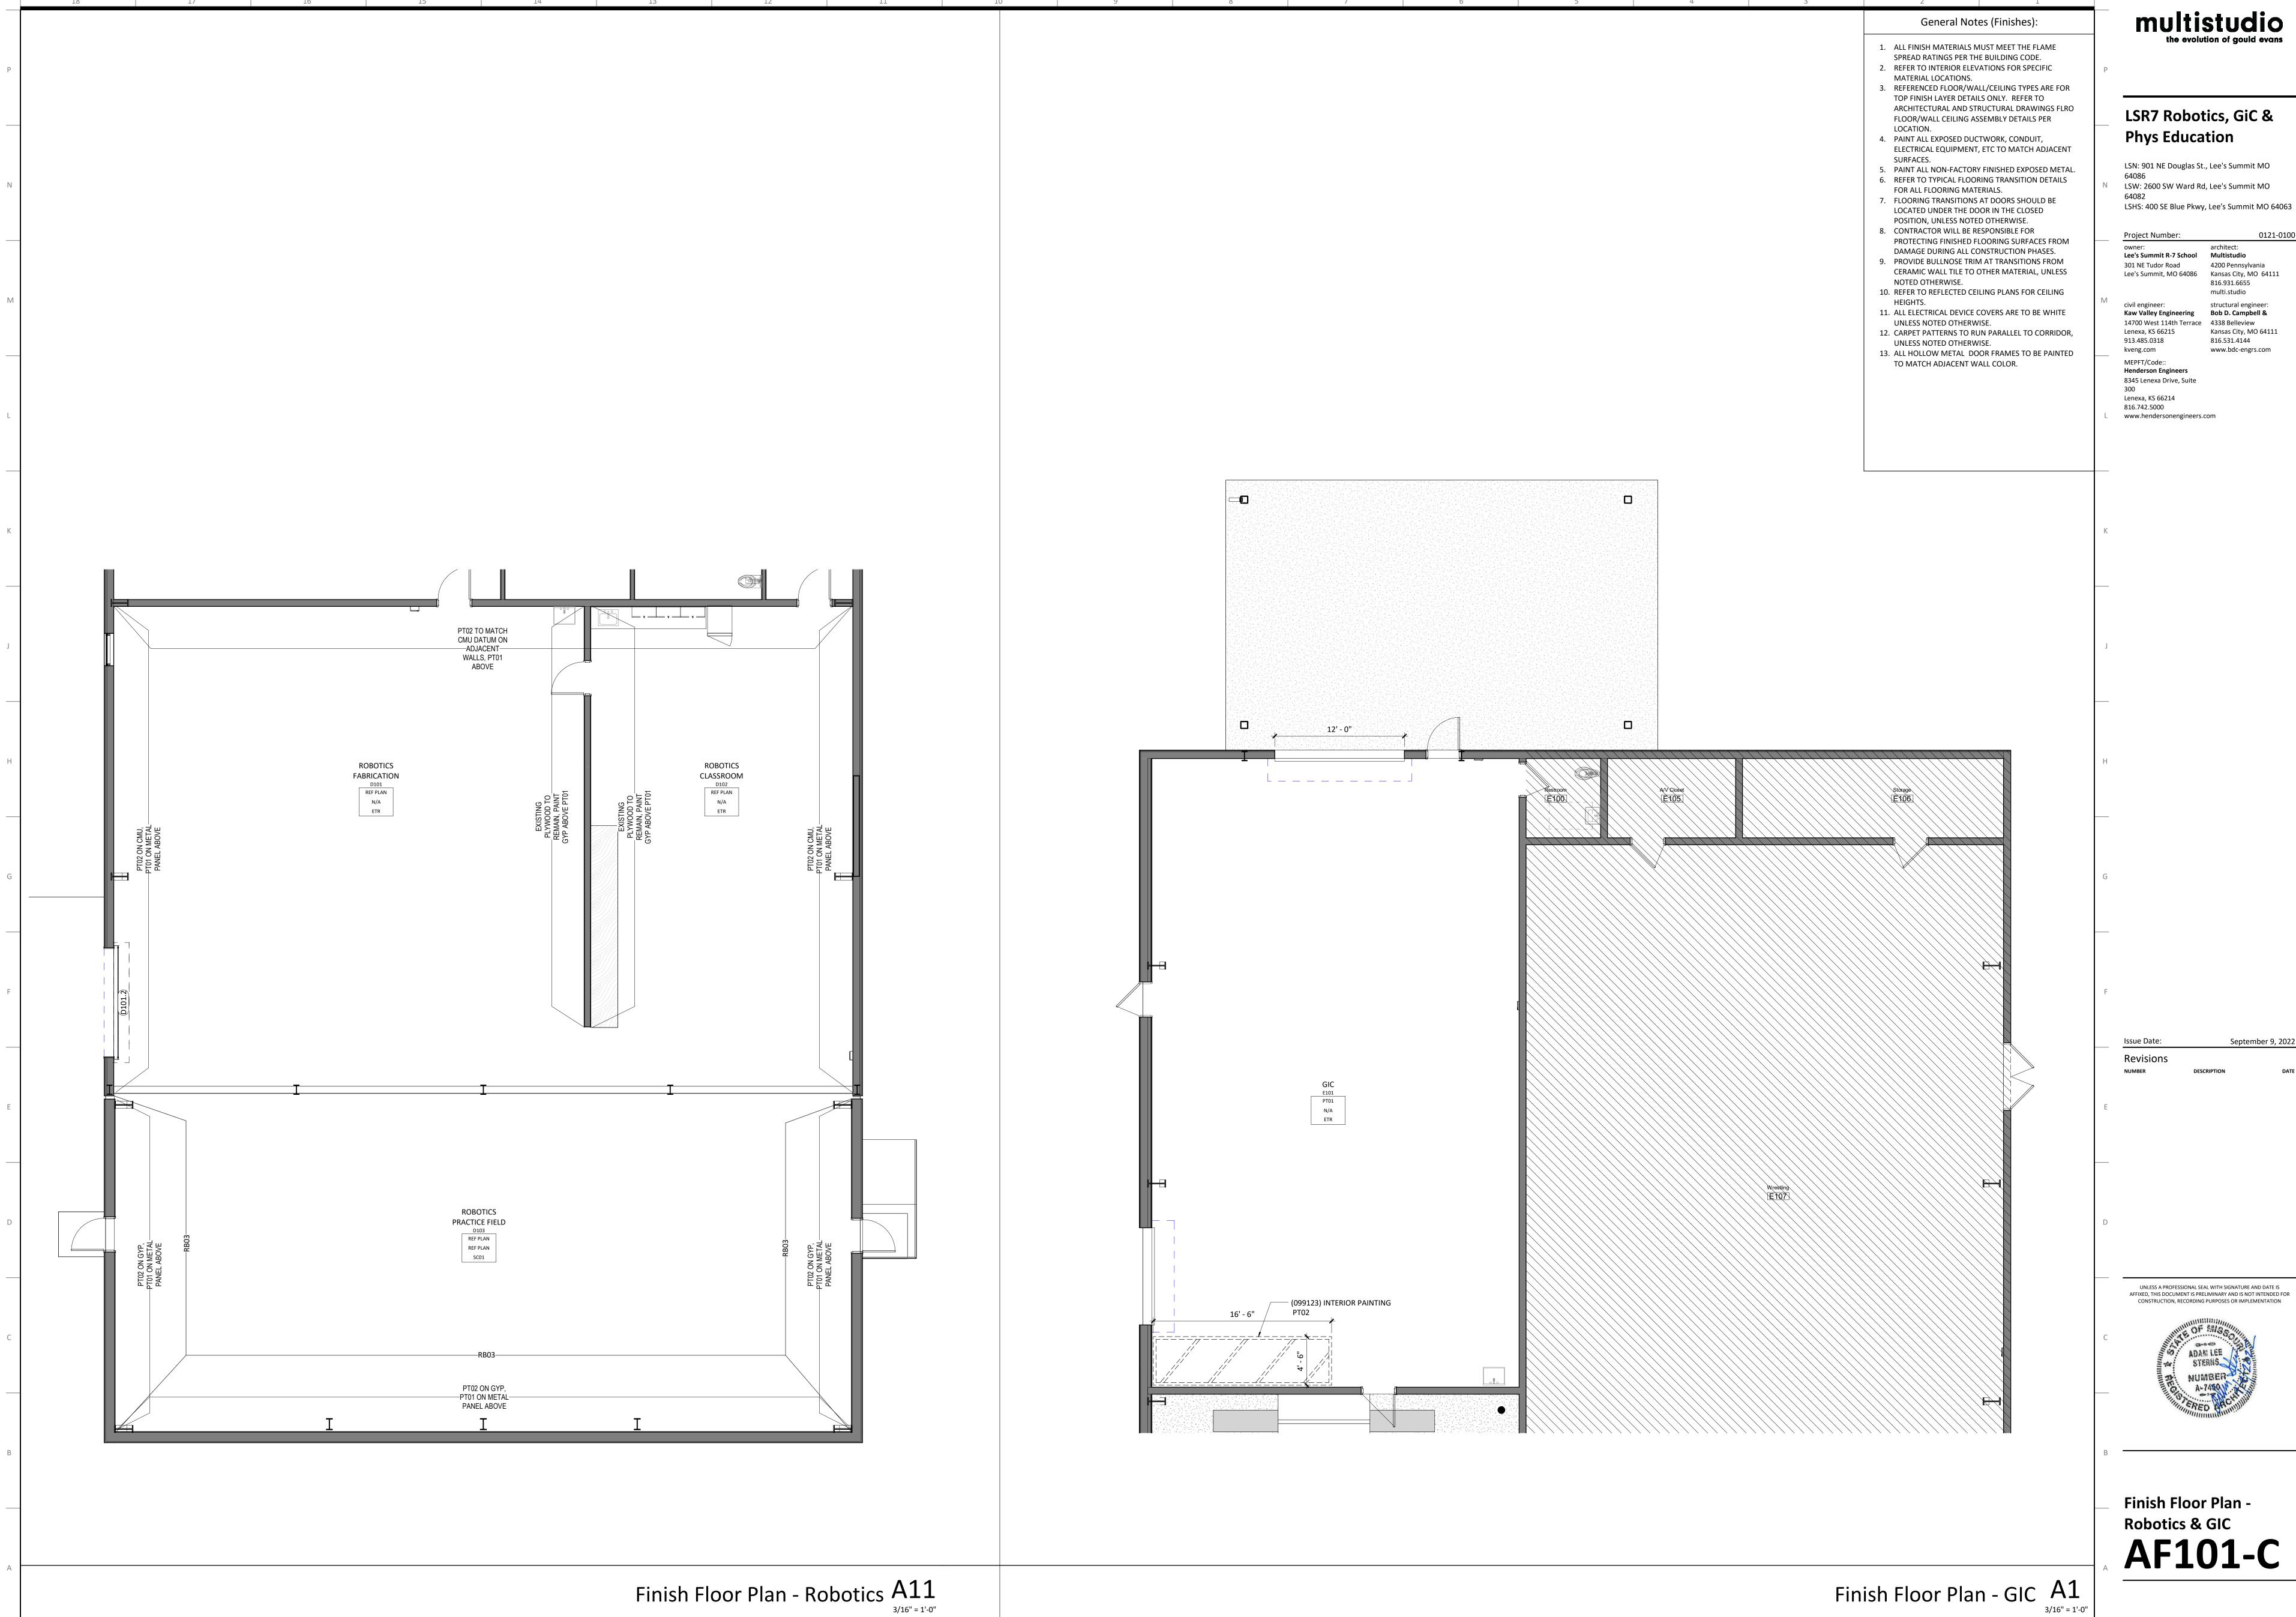


LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063


4200 Pennsylvania

structural engineer: Kansas City, MO 64111

September 9, 2022

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS



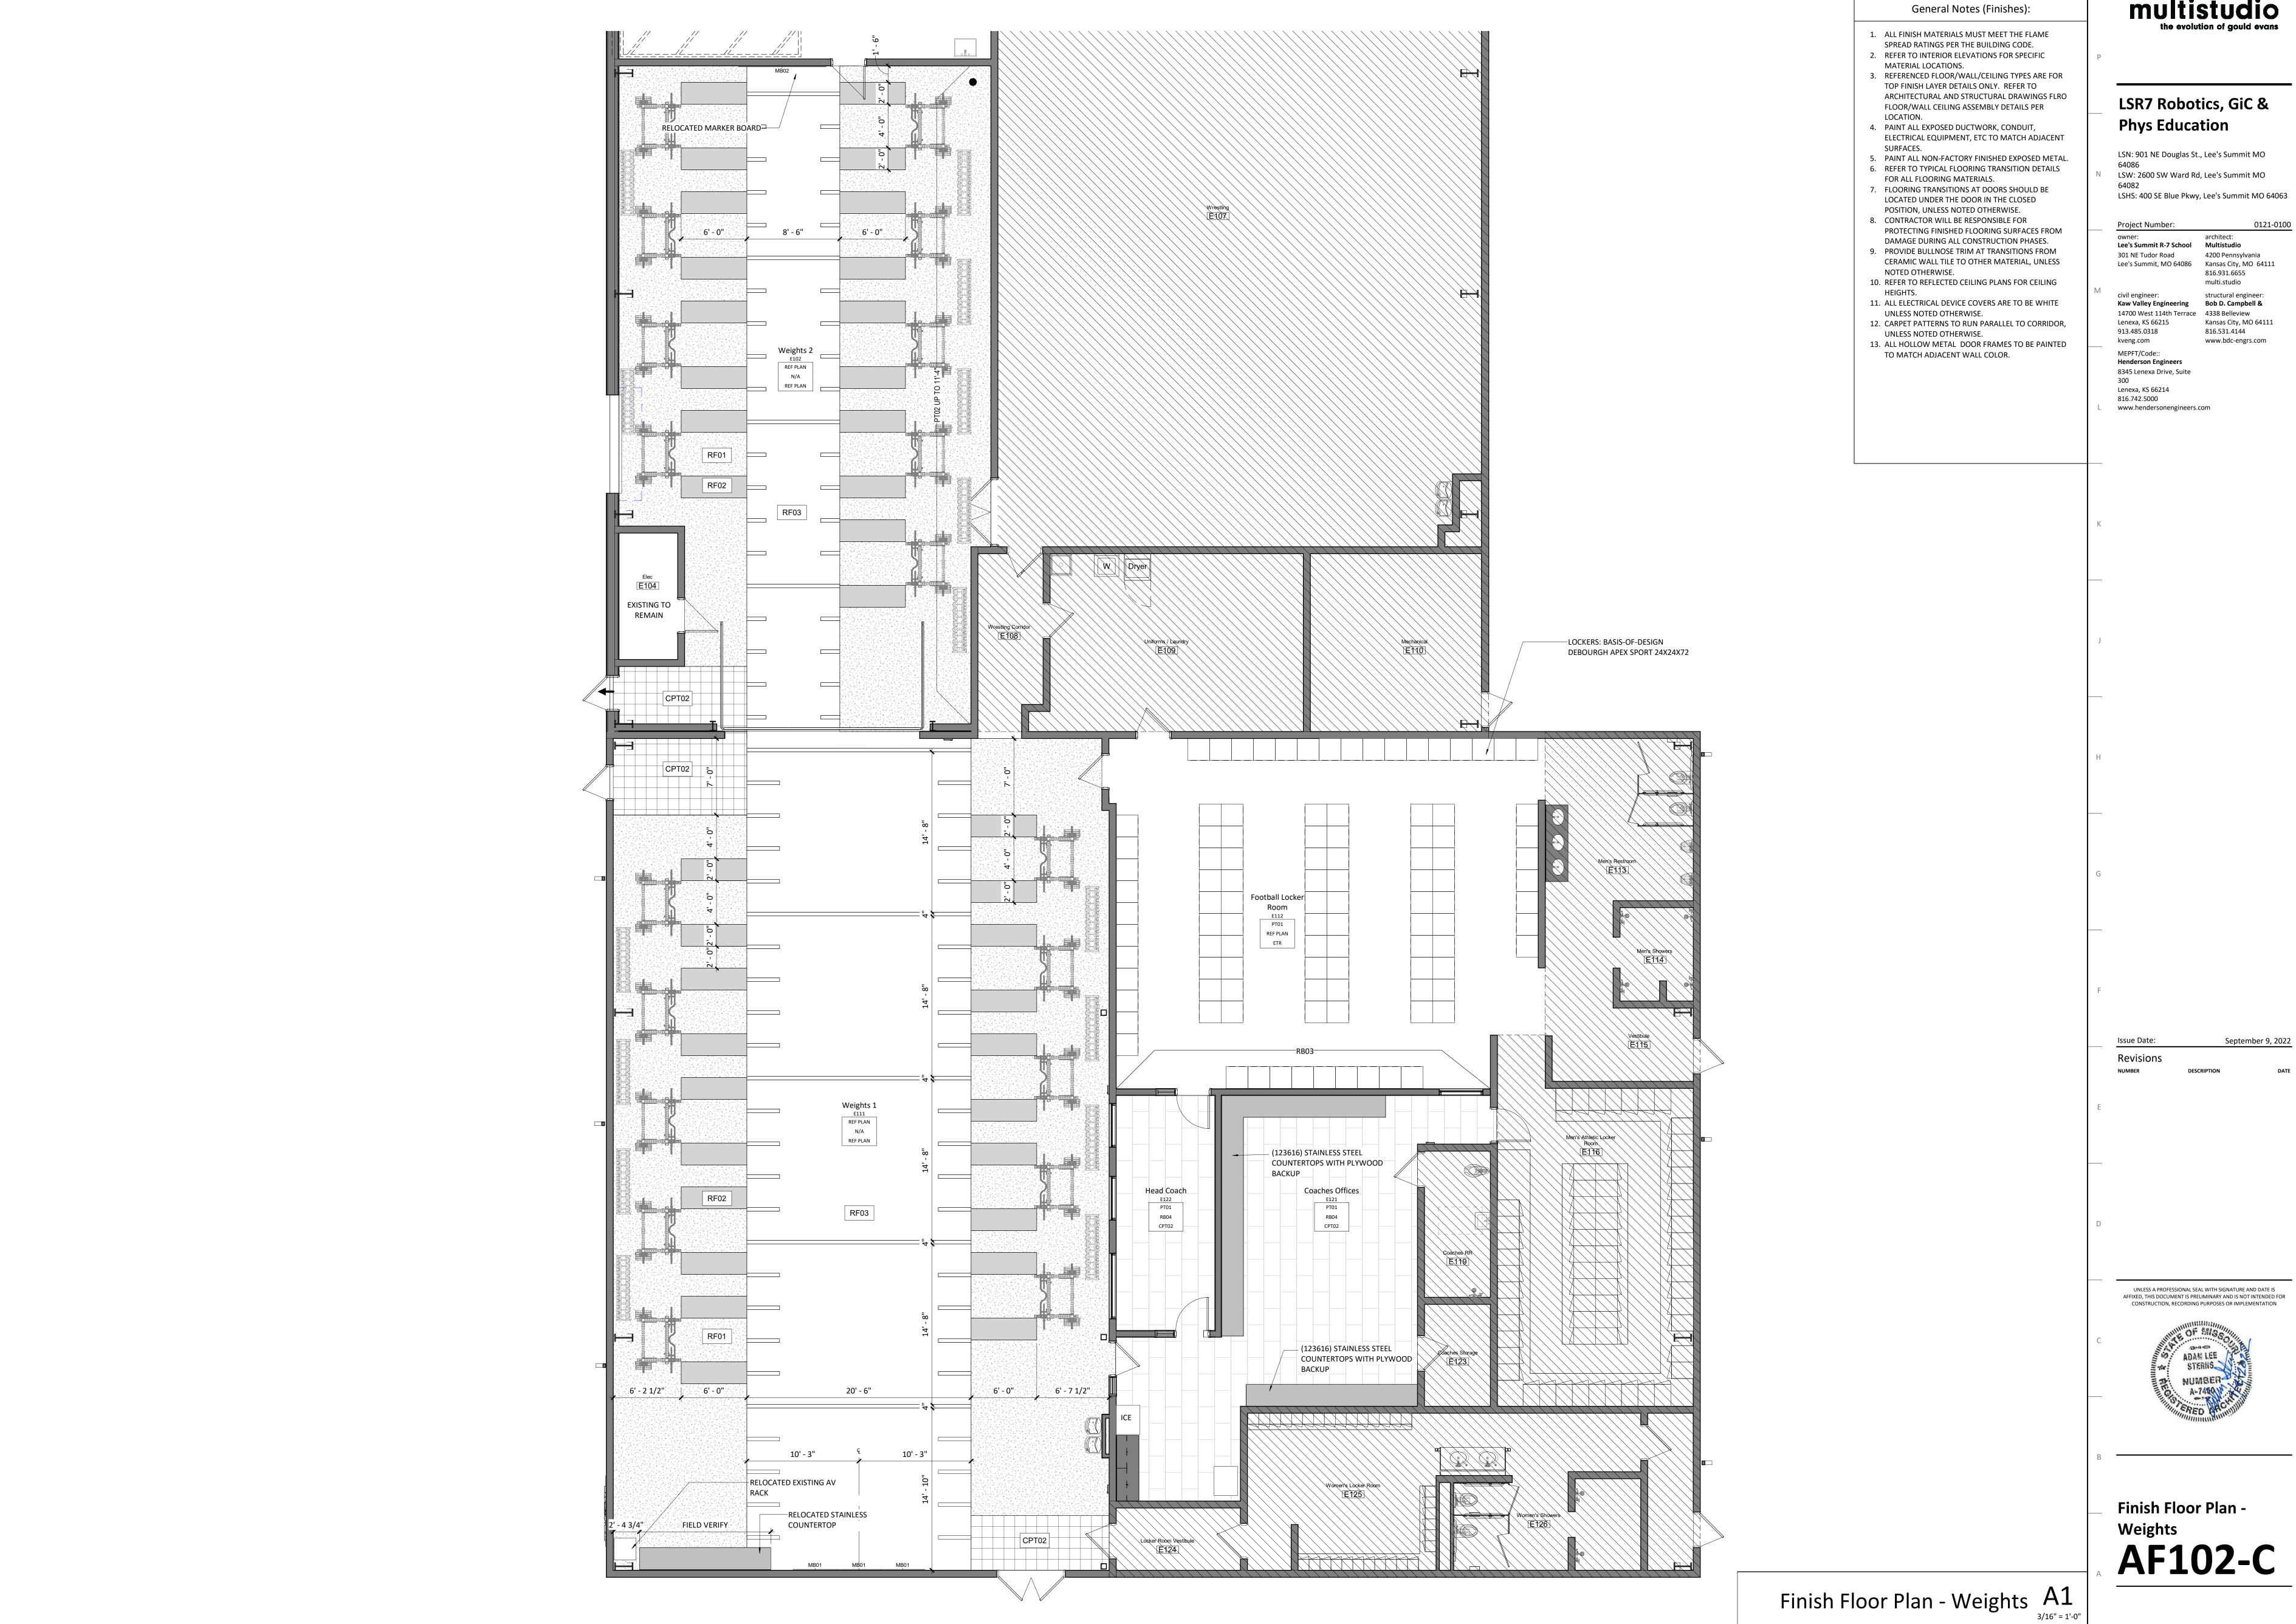

LSR7 Robotics, GiC &

LSN: 901 NE Douglas St., Lee's Summit MO LSW: 2600 SW Ward Rd, Lee's Summit MO

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

4200 Pennsylvania


816.931.6655 multi.studio structural engineer: Kaw Valley Engineering Bob D. Campbell &

Kansas City, MO 64111 816.531.4144 www.bdc-engrs.com

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS AFFIXED, THIS DOCUMENT IS PRELIMINARY AND IS NOT INTENDED FOR CONSTRUCTION, RECORDING PURPOSES OR IMPLEMENTATION



Finish Floor Plan -**AF102-C**

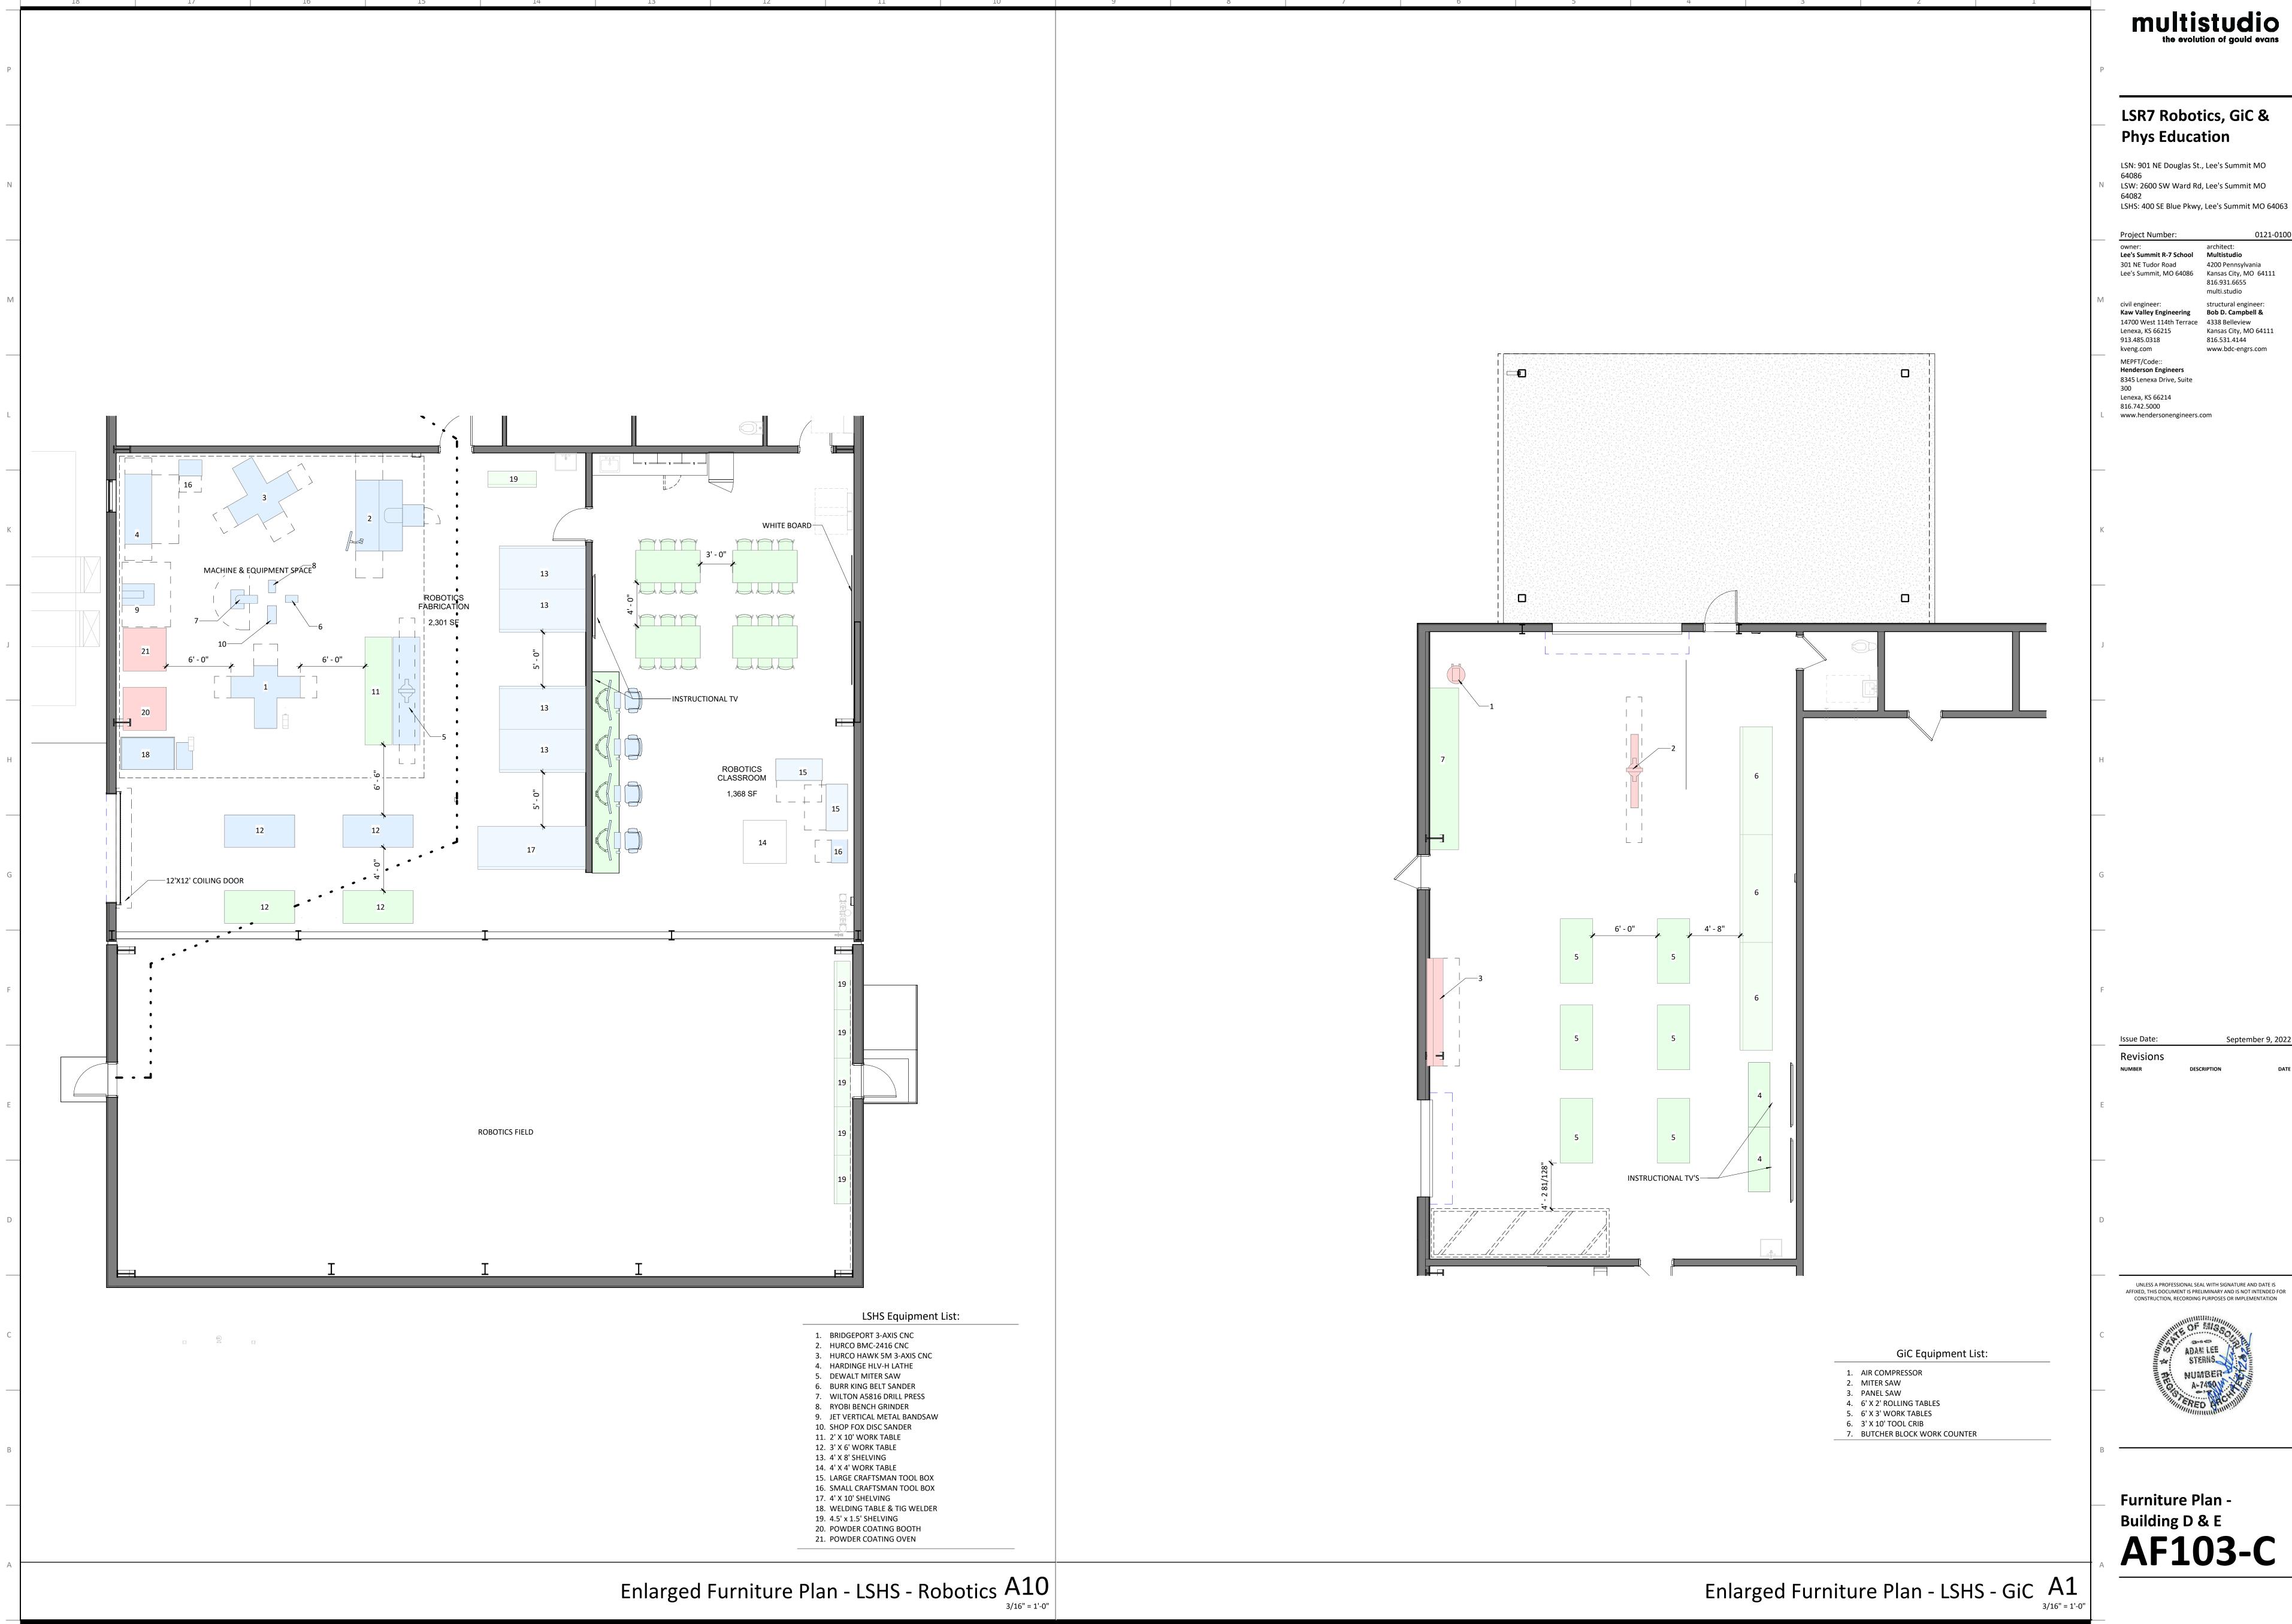

LSW: 2600 SW Ward Rd, Lee's Summit MO

structural engineer: Kansas City, MO 64111

September 9, 2022

UNLESS A PROFESSIONAL SEAL WITH SIGNATURE AND DATE IS





XNÓT ÎN SCÒPE (

3/4" CA (ETR) 3/4" CA (ETR)

CLASSROOM

ROBOTICS

CLASSROOM

ROBOTICS

FABRICATION

-----1 1/2" CW (ETR)--

COORDINATE WITH
CIVIL DRAWINGS
FOR SITE UTILITY
DEMOLITION

PLUMBING DEMOLITION PLAN NOTES:

CEILING AND CAP.

UNDER NEW WORK.

IN NEW WORK.

AREA BOUNDARY AND CAP.

CONNECTION UNDER NEW WORK.

REGULATOR FOR NEW WORK.

PD6 REMOVE EXISTING WATER SERVICE ENTRY.

MATCH EXISTING WHERE REQUIRED.

PD7 REMOVE EXISTING COMPRESSED AIR PIPING AND ASSOCIATED ACCESSORIES. RETAIN PRESSURE

PD1 REMOVE EXISTING PLUMBING FIXTURES IN THIS AREA AS

PD2 REMOVE EXISTING PLUMBING FIXTURE AS WELL AS PIPING (WASTE, VENT, HOT AND COLD WATER) TO BELOW FINISHED FLOOR AND TO ACTIVE MAINS ABOVE CEILING AND CAP.

PD3 DEMO ABANDONED GAS PIPING TO THE CONSTRUCTION

PD4 DEMO ACTIVE GAS PIPING TO APPROXIMATELY 15 FEET SOUTH OF NEW ADDITION AND CAP FOR FUTURE

PD5 RETAIN EXISTING GAS PRESSURE REGULATOR SET FOR USE

PD8 REMOVE EXISTING PLUMBING PIPING (SANITARY AND GAS) TO BELOW FINISHED FLOOR AND TO ACTIVE MAINS ABOVE

PD9 EXISTING PLUMBING FIXTURE SHALL REMAIN. PROTECT

PD10 REMOVE EXISTING PLUMBING FIXTURE AND CAP PIPING

RECONNECTION UNDER NEW WORK.

PD11 REMOVE EXISTING COMPRESSED AIR PIPING. REMOVE AIR

COMPRESSOR TANK AND COMPRESSED AIR DRYER AND

PD13 CAP AND ABANDON EXISTING VENT THROUGH ROOF WITH

NEW PIPE CAPS ABOVE AND BELOW ROOF. PD14 REMOVE EXISTING WALL HYDRANT AS WELL AS PIPING

CEILING AND CAP. REPAIR REMAINING SURFACES TO

FROM DAMAGE DURING DEMOLITION AND RENOVATION.

(SANITARY, VENT, HOT AND COLD WATER) AT WALL FOR

SLABS REQUIRED FOR PREP OF INSTALLATION OF FIXTURE

(COLD WATER) TO ACTIVE MAIN ABOVE CEILING AND CAP.

KEEP EXISTING PLUMBING FIXTURE FOR INSTALLATION

WELL AS PIPING (WASTE, VENT, HOT AND COLD WATER) TO BELOW FINISHED FLOOR AND TO ACTIVE MAINS ABOVE

LSR7 Robotics, GiC & **Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO N LSW: 2600 SW Ward Rd, Lee's Summit MO 64082

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100

Lee's Summit R-7 School Multistudio 301 NE Tudor Road 4200 Pennsylvania Lee's Summit, MO 64086 Kansas City, MO 64111

816.931.6655


multi.studio structural engineer: Kaw Valley Engineering Bob D. Campbell & Company, Inc. 14700 West 114th Terrace 4338 Belleview Lenexa, KS 66215 Kansas City, MO 64111 913.485.0318 816.531.4144 kveng.com www.bdc-engrs.com

MEPFT/Code:: **Henderson Engineers** 8345 Lenexa Drive, Suite

Lenexa, KS 66214 816.742.5000 www.hendersonengineers.com

8345 LENEXA DRIVE, SUITE 300 LENEXA, KS 66214 TEL 913.742.5000 FAX 913.742.5001

September 9, 2022



LSHS - PLUMBING DEMOLITION PLAN -LEVEL 1 - BUILDING D &

PD101-C

GENERAL DEMOLITION NOTES:

- 1. PRIOR TO SUBMITTING BID, VISIT THE JOB SITE AND BECOME FULLY ACQUAINTED WITH THE EXISTING CONDITIONS OF THE PROJECT. REVIEW THE GENERAL NOTES, SPECIFICATIONS AND OTHER DRAWINGS FOR ADDITIONAL REQUIREMENTS WHICH MAY NOT BE SPECIFICALLY CALLED OUT IN THIS PORTION OF THE CONSTRUCTION DOCUMENTS. NOTIFY ARCHITECT OF CONFLICTS OR DISCREPANCIES PRIOR TO SUBMISSION OF BID.
- 2. EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND SITE VISITS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. FIELD VERIFY EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. COORDINATE NEW WORK AND DEMOLITION WITH OTHER DISCIPLINES AND EXISTING CONDITIONS PRIOR TO CONSTRUCTION.
- 3. OWNER RETAINS RIGHTS OF SALVAGE FOR EQUIPMENT AND FIXTURES TO BE REMOVED. COORDINATE WITH THE OWNER THE EQUIPMENT AND FIXTURES TO BE SALVAGED AND THE LOCATION FOR STORAGE. AVOID DAMAGE TO EQUIPMENT, FIXTURES AND DEVICES DURING DEMOLITION WORK AND DURING TRANSPORT TO OWNER'S DESIGNATED STORAGE LOCATION.
- 4. REMOVE ITEMS SHOWN HEAVY LINED AND/OR CROSSHATCHED AND/OR NOTED TO BE REMOVED.

CAUSED DURING WORK AT NO EXTRA COST TO THE OWNER.

- 5. AVOID DAMAGING EXISTING SURFACES AND EQUIPMENT TO REMAIN FOR NEW INSTALLATION. REPAIR ANY DAMAGE
- 6. SEAL ALL PENETRATIONS THROUGH FLOORS, WALLS, CEILINGS AND ROOFS WHERE PLUMBING COMPONENTS ARE REMOVED AND WHERE THE EXISTING PENETRATION IS NOT USED FOR THE NEW INSTALLATION. REPAIR SURFACES TO MATCH ADJACENT AREAS.
- 7. INSTALL PERMANENT CAPS WHERE PIPING IS REMOVED AND THE EXISTING TAPS ARE NOT USED FOR THE NEW INSTALLATION. INSTALL TEMPORARY CAPS WHERE PIPING IS REMOVED AND THE EXISTING TAPS WILL BE USED FOR THE NEW INSTALLATION TO PROTECT THE INTERIOR SURFACES UNTIL NEW PIPING IS INSTALLED.
- 8. REMOVE PIPE HANGERS, PIPE SUPPORTS AND EQUIPMENT SUPPORTS WHERE PIPING OR EQUIPMENT IS REMOVED AND THE EXISTING HANGERS AND SUPPORTS ARE NOT USED FOR THE NEW INSTALLATION.
- 9. VERIFY THAT EXISTING EQUIPMENT TO REMAIN IS OPERATING PROPERLY. NOTIFY THE ARCHITECT OF ANY DAMAGED AND/OR MALFUNCTIONING COMPONENTS.
- 10. WHERE SHUTDOWN OF EXISTING ACTIVE PIPING SYSTEMS IS REQUIRED DURING DEMOLITION PHASE OF WORK IN PREPARATION FOR NEW TIE-IN PHASE OF WORK, COORDINATE WITH THE OWNER AND MINIMIZE DOWNTIME. VERIFY EXISTING SYSTEMS, EQUIPMENT, AND COMPONENTS WILL BE PROVIDED WITH BACKUP SERVICE WHERE REQUIRED. NOTIFY OWNER A MINIMUM OF SEVEN (7) DAYS PRIOR TO INTERRUPTION OF SERVICE.

GENERAL NOTES:

- PROVIDE A CONSTRUCTION RECORD SET OF "AS-BUILT" DOCUMENTS TO THE ARCHITECT REFLECTING ANY VARIANCES OF INSTALLED PIPING LOCATIONS OR EQUIPMENT CONTRARY TO THE CONSTRUCTION DOCUMENTS, REFER TO SPECIFICATIONS.
- 2. DRAWINGS ARE DIAGRAMMATIC ONLY AND REPRESENT THE GENERAL SCOPE OF THE WORK. REVIEW THE GENERAL NOTES, SPECIFICATIONS AND PLANS FOR ADDITIONAL REQUIREMENTS THAT MAY NOT BE SPECIFICALLY CALLED OUT IN THIS PORTION OF THE CONSTRUCTION DOCUMENTS. NOTIFY THE ARCHITECT OF ANY CONFLICTS OR DISCREPANCIES PRIOR TO SUBMISSION OF BID.
- 3. PROVIDE TO THE ARCHITECT A COPY OF INSPECTION REPORTS AND APPROVAL CERTIFICATES FROM LOCAL AND STATE INSPECTIONS, REFER TO SPECIFICATIONS.
- 4. INSTALLATION SHALL COMPLY WITH LEGALLY CONSTITUTED CODES AND THE REQUIREMENTS OF AUTHORITIES HAVING JURISDICTION.
- 5. PLANS AND SPECIFICATIONS GOVERN WHERE THEY EXCEED CODE REQUIREMENTS.
- 6. VERIFY LOCATION AND DEPTH OF UTILITIES AT POINTS OF CONNECTION BEFORE START OF PIPING INSTALLATION.
- 7. REFER TO ARCHITECTURAL PLANS FOR EXACT LOCATION AND
- MOUNTING HEIGHTS OF PLUMBING FIXTURES.

 8. DO NOT SCALE FLOOR PLANS FOR EXACT HORIZONTAL
- LOCATION OF PIPE ROUTING.

 9. INSTALL CONCEALED PIPING TIGHT TO THE STRUCTURE AND
- INSTALL CONCEALED PIPING TIGHT TO THE STRUCTURE AND AS HIGH AS POSSIBLE.

10. VALVES SHALL BE LINE SIZE UNLESS OTHERWISE NOTED.

- 11. INSTALL EXPOSED PIPING, WHERE NECESSARY, IN FINISHED AREAS TIGHT TO THE STRUCTURE, WALL OR CEILING AND AS HIGH AS POSSIBLE. INSTALL PIPING PARALLEL AND / OR PERPENDICULAR TO WALLS.
- 12. INSTALL VALVES AND APPURTENANCES A MAXIMUM OF 24"
 ABOVE CEILING IN ACCESSIBLE LOCATION WITHIN 24" OF
 ACCESS DOORS OR ACCESSIBLE CEILING TILES. PROVIDE PIPE
 AND FITTINGS TO INSTALL VALVES AND APPURTENANCES AT
 REQUIRED HEIGHT AND WITHIN 24" OF ACCESS DOORS OR
 ACCESSIBLE CEILING TILES.
- 13. INSTALL NO PLASTIC PIPE OF ANY KIND ABOVE SLAB INSIDE THE BUILDING. INSTALL NO PLASTIC PIPE IN THE CEILING RETURN AIR PLENUM.
- 14. COORDINATE ALL WORK WITH OTHER TRADES AND CONTRACTORS.
- 15. COORDINATE PIPING INSTALLATION WITH STRUCTURAL GRADE BEAMS, FOOTINGS, COLUMN PIERS, ETC. SLEEVE PIPING THROUGH GRADE BEAMS, FOOTING, ETC. WHERE REQUIRED AND AS NOTED ON PLANS. COORDINATE SLEEVE INSTALLATIONS WITH THE ARCHITECT, STRUCTURAL ENGINEER, STRUCTURAL CONTRACTOR AND GENERAL CONTRACTOR BEFORE CONCRETE IS INSTALLED.
- 16. CLEAN FAUCET AERATORS AND PIPE STRAINERS PRIOR TO TURNING BUILDING OVER TO THE OWNER.
- 17. PROVIDE TRAP PRIMERS WHERE REQUIRED BY LOCAL AUTHORITIES.
- 18. COORDINATE PIPE ROUTING AWAY FROM ELECTRICAL PANELS.
 DO NOT INSTALL PIPING OVER ELECTRICAL PANELS.
- 19. PAINT ALL EXPOSED GAS AND WATER PIPING USING RUST INHIBITOR PAINT. PAINT AND COLOR SHALL BE COORDINATED WITH THE ARCHITECT AND / OR OWNER.
- 20. COORDINATE ALL ROOF PENETRATIONS WITH OTHER TRADES.
 MAINTAIN 10' MINIMUM CLEARANCE FROM ALL AIR INTAKES.
 MAINTAIN 2' CLEARANCE FROM ALL OTHER EQUIPMENT.
- 21. INSULATE PIPING ROUTED IN EXTERIOR BUILDING WALLS WITH MINIMUM 2" BATT INSULATION TO PREVENT FREEZING.
- 22. PROVIDE "HEAVY-DUTY" NO-HUB COUPLINGS ON SANITARY PIPING 4" AND LARGER. SEE DIVISION 22 SPECIFICATION SECTION "SANITARY DRAINAGE AND VENT AND PIPING SPECIALTIES" FOR MORE INFORMATION.
- 23. PROVIDE "HEAVY-DUTY" NO-HUB COUPLINGS ON STORM PIPING, INCLUDING CONNECTIONS TO ROOF DRAINS. SEE DIVISION 22 SPECIFICATION SECTION "STORM DRAINAGE PIPING AND SPECIALTIES" FOR MORE INFORMATION.
- 24. PROVIDE TRANSITION ADAPTER COUPLINGS FOR CONNECTION OF PVC DWV TO CAST IRON AT SLAB ON GRADE. SEE DIVISION

22 SPECIFICATION FOR MORE INFORMATION.

- 25. PROVIDE TRANSITION ADAPTER COUPLINGS FOR CONNECTION OF PVC DWV TO CAST IRON SANITARY, WASTE AND VENT PIPE AT SLAB ON GRADE. SEE DIVISION 22 SPECIFICATION SECTION "SANITARY DRAINAGE AND VENT PIPING AND SPECIALTIES" FOR MORE INFORMATION.
- 26. PROVIDE TRANSITION ADAPTER COUPLINGS FOR CONNECTION OF PVC DWV TO CAST IRON STORM PIPE AT SLAB ON GRADE. SEE DIVISION 22 SPECIFICATION SECTION "STORM DRAINAGE PIPING AND SPECIALTIES" FOR MORE INFORMATION.
- 27. FLOW CONTROL VALVES SHALL BE SIZE 1/2" AND SET AT 0.5
- 28. WATER HAMMER ARRESTORS SHALL BE SIZE "A" UNLESS NOTED OTHERWISE.

GPM UNLESS NOTED OTHERWISE.

- 29. PROVIDE VERTICAL LIFT SPRING LOADED CHECK VALVES IN HOT AND COLD WATER SUPPLIES FOR MOP SINK FAUCETS DOWNSTREAM OF SHUTOFF VALVES.
- 30. PROVIDE WALL PIPES AT PIPING PENETRATIONS OF ELEVATED WATERPROOF FLOOR SLABS, REFER TO SPECIFICATIONS.
- 31. VERIFY EXISTING EQUIPMENT, INCLUDING ACCESSORIES, IS NOT DAMAGED AND IS IN GOOD WORKING ORDER. REPORT
- ANY DEFICIENCIES TO THE ARCHITECT.

 32. PROVIDE SIZE AND LENGTH OF HOT WATER FIXTURE SUPPLY PIPE FROM CIRCULATED HOT WATER BRANCH OR MAIN TO TERMINATION OF HOT WATER FIXTURE SUPPLY PIPE AT EACH FIXTURE PER 2015 INTERNATIONAL ENERGY CONSERVATION CODE, TABLE C404.3.1. FOR ½" HOT WATER FIXTURE SUPPLY PIPE SIZE TO INDIVIDUAL LAVATORIES, PROVIDE MAXIMUM LENGTH OF TWO FEET. FOR ½" HOT WATER FIXTURE SUPPLY PIPE SIZE TO INDIVIDUAL SINKS, PROVIDE MAXIMUM LENGTH OF 43 FEET. FOR 3/4" HOT WATER FIXTURE SUPPLY PIPE SIZE

TO INDIVIDUAL SINKS, PROVIDE MAXIMUM LENGTH OF 21 FEET.

MH

MANHOLE

PLUMBING SYMBOLS THIS IS A MASTER LEGEND AND NOT ALL SYMBOLS OR ABBREVIATIONS ARE USED. V2.02 STANDARD MOUNTING HEIGHTS PIPING SYMBOLS PIPING LINETYPES OXYGEN OUTLET HOSE BIBB (CENTERLINE) 36" NITROUS OXIDE OUTLET ICE MAKER OUTLET BOX (CENTER OF BOX) MEDICAL AIR OUTLET **─** JANITOR'S SINK FAUCET FITTINGS (CENTERLINE) 42" NITROGEN OUTLET NON FREEZE WALL HYDRANT (AFG TO CENTERLINE) 18" MEDICAL VACUUM INLET WASHING MACHINE OUTLET BOX (RIM) 42" FLOOR SINK (FS), SIZE & TYPE TRAP PRIMER LINE (T) FLOOR DRAIN (FD), SIZE & TYPE SOIL PIPING - ABOVE FLOOR (S) ROOF DRAIN (RD), SIZE & TYPE WASTE PIPING - ABOVE FLOOR (W) ──────── BALL VALVE CONTROL VALVE — W— WASTE PIPING - BELOW FLOOR (W) → SHUTOFF VALVE GREASE WASTE - ABOVE FLOOR (GW) — — GW — — GREASE WASTE - BELOW FLOOR (GW) — CHECK VALVE BALANCING VALVE WITH PRESSURE PORTS ——Ö WATER METER STRAINER STORM DRAIN - ABOVE FLOOR (ST) STRAINER WITH BLOWOFF — — ·ST· — — STORM DRAIN - BELOW FLOOR (ST) RELIEF/SAFETY VALVE OST—OST—OVERFLOW STORM DRAIN - ABOVE FLOOR (OST) SOLENOID VALVE — VBG — VENT BELOW GRADE (VBG) PRESSURE REDUCING VALVE — WBF — VENT BELOW FLOOR (VBF) GAS PRESSURE REGULATOR INDIRECT DRAIN (ID) THERMOSTATIC MIXING VALVE PA PIPE ANCHOR CD——— CONDENSATE DRAIN (CD) EXPANSION JOINT ACD——— AUXILIARY CONDENSATE DRAIN (ACD) ■ BACKFLOW PREVENTER SPD——SPD——SUMP OR SEWAGE PUMP DISCHARGE (SPD) PRESSURE GAUGE ———G——— NATURAL GAS (G) THERMOMETER — — -G- — NATURAL GAS ON ROOF (G) INSTALL PLUMBING FIXTURES AT THE MOUNTING HEIGHTS SHOWN ABOVE UNO IN THE ARCHITECTURAL DRAWINGS OR ELSEWHERE IN THE — UNION ———MPG——— MEDIUM PRESSURE NATURAL GAS (MPG) CONSTRUCTION DOCUMENTS, FINAL APPROVAL OF LOCATIONS BY ARCHITECT. MOUNTING HEIGHTS LISTED ABOVE, OR ELSEWHERE IN THE — MPG — MEDIUM PRESSURE NATURAL GAS ON ROOF (MPG) FLANGE CONNECTION CONSTRUCTION DOCUMENTS, ARE AFF, UNO. ALL DEVICES SHALL BE INSTALLED IN COMPLIANCE WITH CURRENT ADA AND LOCAL HOSE BIBB (HB) NPW——NPW—— NON-POTABLE WATER (NPW) REQUIREMENTS. NON-FREEZING WALL HYDRANT (NW) ———LPG——— LIQUEFIED PETROLEUM GAS (LPG) ANNOTATION MANUAL / AUTOMATIC AIR VENT OR VACUUM RELIEF -----WS------ WATER SERVICE (WS) PLUMBING PLAN NOTE CALLOUT ———DFP——— FIRE PROTECTION SPRINKLER DRY (DFP) PRESSURE / VACUUM SWITCH FP——FP——FIRE PROTECTION SPRINKLER WET (FP) PLUMBING EQUIPMENT DESIGNATION. (CONTRACTOR CLEANOUT FURNISHED AND INSTALLED). REFER TO PLUMBING FIXTURE ———DSP——— FIRE PROTECTION STANDPIPE DRY (DSP) OR EQUIPMENT SCHEDULES ———WSP——— FIRE PROTECTION STANDPIPE WET (WSP) WALL CLEANOUT (WCO) EQUIPMENT DESIGNATION (OWNER FURNISHED, ———PD——— CONDENSATE PUMP DISCHARGE (PD) CONTRACTOR INSTALLED) FLOOR CLEANOUT (FCO) VENT PIPING (V) EXTERIOR CLEANOUT (ECO) MECHANICAL EQUIPMENT DESIGNATION (CONTRACTOR ACID WASTE - ABOVE FLOOR (AW) FURNISHED AND INSTALLED UNLESS NOTED OTHERWISE) ELBOW UP — — AW — — ACID WASTE - BELOW FLOOR (AW) **ELBOW DOWN** CONNECTION POINT OF NEW WORK TO EXISTING ACID VENT (AV) TEE UP ———GWS——— GRAY WATER (GWS) DETAIL REFERENCE UPPER NUMBER INDICATES DETAIL TEE DOWN NUMBER LOWER NUMBER INDICATES SHEET NUMBER ELBOW UP WITH SHUT-OFF VALVE (SOV) -----MA------ MEDICAL AIR (MA) SECTION CUT DESIGNATION ELBOW DOWN WITH SHUT-OFF VALVE (SOV) -----MV------ MEDICAL VACUUM (VE) TEE UP WITH SHUT-OFF VALVE (SOV) DEDICATED EQUIPMENT ACCESS TILE HE—HE—HELIUM (HE) TEE DOWN WITH SHUT OFF VALVE (SOV) INSTRUMENT AIR (IA) ACCESS PANEL WATER HAMMER ARRESTER (WHA) WITH PDI SIZES, INSTRUMENT VACUUM (IV) (A, B, C, D, & E) ABBREVIATIONS RECIRCULATION PUMP N2—N2—NITROGEN (N2) N2O NITROUS OXIDE (N20) AMERICANS WITH MINIMUM N/C NORMALLY CLOSED DISABILITIES ACT O2—OXYGEN (O2) ABOVE FINISHED FLOOR NORMALLY OPEN —————— GAS COCK ABOVE FINISHED GRADE NOT IN CONTRACT OVERFLOW ROOF DRAIN EVAC/WAGD (EV) ORD −−−−− TRAP PRIMER AIR HANDLING UNIT PLUMBING DRAINAGE ACCESS PANEL PDI TRAP PRIMER WITH DISTRIBUTION UNIT ———CO2——— CARBON DIOXIDE (CO2) BAS BUILDING AUTOMATION INSTITUTE PHASE SYSTEM BELOW FINISHED FLOOR PRV PRESSURE REDUCING BELOW FINISHED GRADE PVC POLYVINYL CHLORIDE ——VE—— MEDICAL VACUUM EXHAUST (VE) BOP BOTTOM OF PIPE BOTTOM OF STRUCTURE RCP REINFORCED CONCRETE ———DA——— DENTAL AIR (DA) BTU BRITISH THERMAL UNIT ROOF DRAIN CONDENSATE PUMP ———DV——— DENTAL VACUUM (DV) RPM REVOLUTIONS PER CPVC CHLORINATED POLYVINYL CHLORIDE ROOFTOP UNIT FILTERED WATER (FW1) COPPER SQUARE FEET DUCTILE IRON FILTERED WATER W/ SCALE INHIBITOR (FW2) DOWN SS DFU DRAINAGE FIXTURE UNIT STAINLESS STEEL RO—RO—RO—REVERSE OSMOSIS (RO) SANITARY SEWER, SOIL DOWNSPOUT EXISTING REVERSE OSMOSIS REMINERALIZATION (ROR) TDH TOTAL DYNAMIC HEAD EMS ENERGY MANAGEMENT TFA TO FLOOR ABOVE SYSTEM EXISTING TO REMAIN TFB TO FLOOR BELOW LINETYPE LEGEND TYP ELECTRIC WATER COOLER TYPICAL UL UNDERWRITERS FLOOR DRAIN THROUGHOUT THE DRAWINGS DIFFERENT LINETYPES ARE USED IN FROM FLOOR ABOVE LABORATORIES, INC. UNO COMBINATION WITH THE SYMBOLS TO INDICATE THE STATUS OF ITEMS AS FROM FLOOR BELOW UNLESS NOTED EXISTING, TO BE DEMOLISHED, TO BE INCLUDED AS PART OF NEW WORK FINISHED FLOOR OTHERWISE UPS UNINTERRUPTIBLE AND/OR ITEMS WHICH ARE ANTICIPATED TO BE PROVIDED IN THE FUTURE. FLOW LINE THE STATUS OF ITEMS USING THESE LINETYPES ARE RELATIVE TO THE POWER SUPPLY FULL LOAD AMPS VITRIFIED CLAY PIPE VIEW IN WHICH THEY APPEAR. PHASING SHOWN IN DRAWINGS IS NOT FLOOR INTENDED TO FULLY DESCRIBE ALL NECESSARY CONSTRUCTION PHASING. GALLONS PER MINUTE VARIABLE FREQUENCY VFD GPM WHICH IS DETERMINED BY THE CONTRACTOR AS PART OF THEIR HEAD, HUB DRAIN VENT STACK RESPONSIBILITIES. ANY SUCH PHASES DESCRIBED IN THE CONSTRUCTION CALL OUTS VTR VENT THROUGH ROOF INVERT ELEVATION DOCUMENTS ARE GENERAL AND ONLY INTENDED TO INDICATE A BROAD ORDER FOR THE SAKE OF DESCRIBING THE PROJECT. THE FOLLOWING IN WC INCHES OF WATER COLUMN LINETYPES MAY BE USED ON ANY DEVICE, EQUIPMENT, NOTE, LINE, SHAPE, JUNCTION BOX W/O WITHOUT ENLARGED PLAN CALLOUT J-BOX JUNCTION BOX WC WATER COLUMN KILOWATT WASTE STACK WSFU WATER SUPPLY FIXTURE MAU MAKE-UP AIR UNIT MAX MAXIMUM EXISTING -WVS WASTE VENT STACK MBH 1000 BTU PER HOUR NOT IN SCOPE

DEMOLISH— — — —

FUTURE -----



LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086 N LSW: 2600 SW Ward Rd, Lee's Summit MO 64082

owner:
Lee's Summit R-7 School
301 NE Tudor Road
Lee's Summit, MO 64086

Kansas City, MO 64111
816.931.6655

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

multi.studio

civil engineer: structural engineer:

Kaw Valley Engineering Bob D. Campbell & Company, Inc.

14700 West 114th Terrace
Lenexa, KS 66215 Kansas City, MO 64111

913.485.0318 816.531.4144
kveng.com www.bdc-engrs.com


kveng.com www.

MEPFT/Code::
Henderson Engineers
8345 Lenexa Drive, Suite
300
Lenexa, KS 66214
816.742.5000
www.hendersonengineers.com

HENDERSON
ENGINEERS
8345 LENEXA DRIVE, SUITE 300
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001
WWW.HENDERSONENGINEERS.COM
2150005255
MO. CORPORATE NO: E-556D


EXPIRES 12/31/2022

Revisions
NUMBER DESCRIPTION DATE



LICENSE # PE-2020016283

LSHS - PLUMBING
LEGEND AND GENERAL
NOTES
DOOGLO

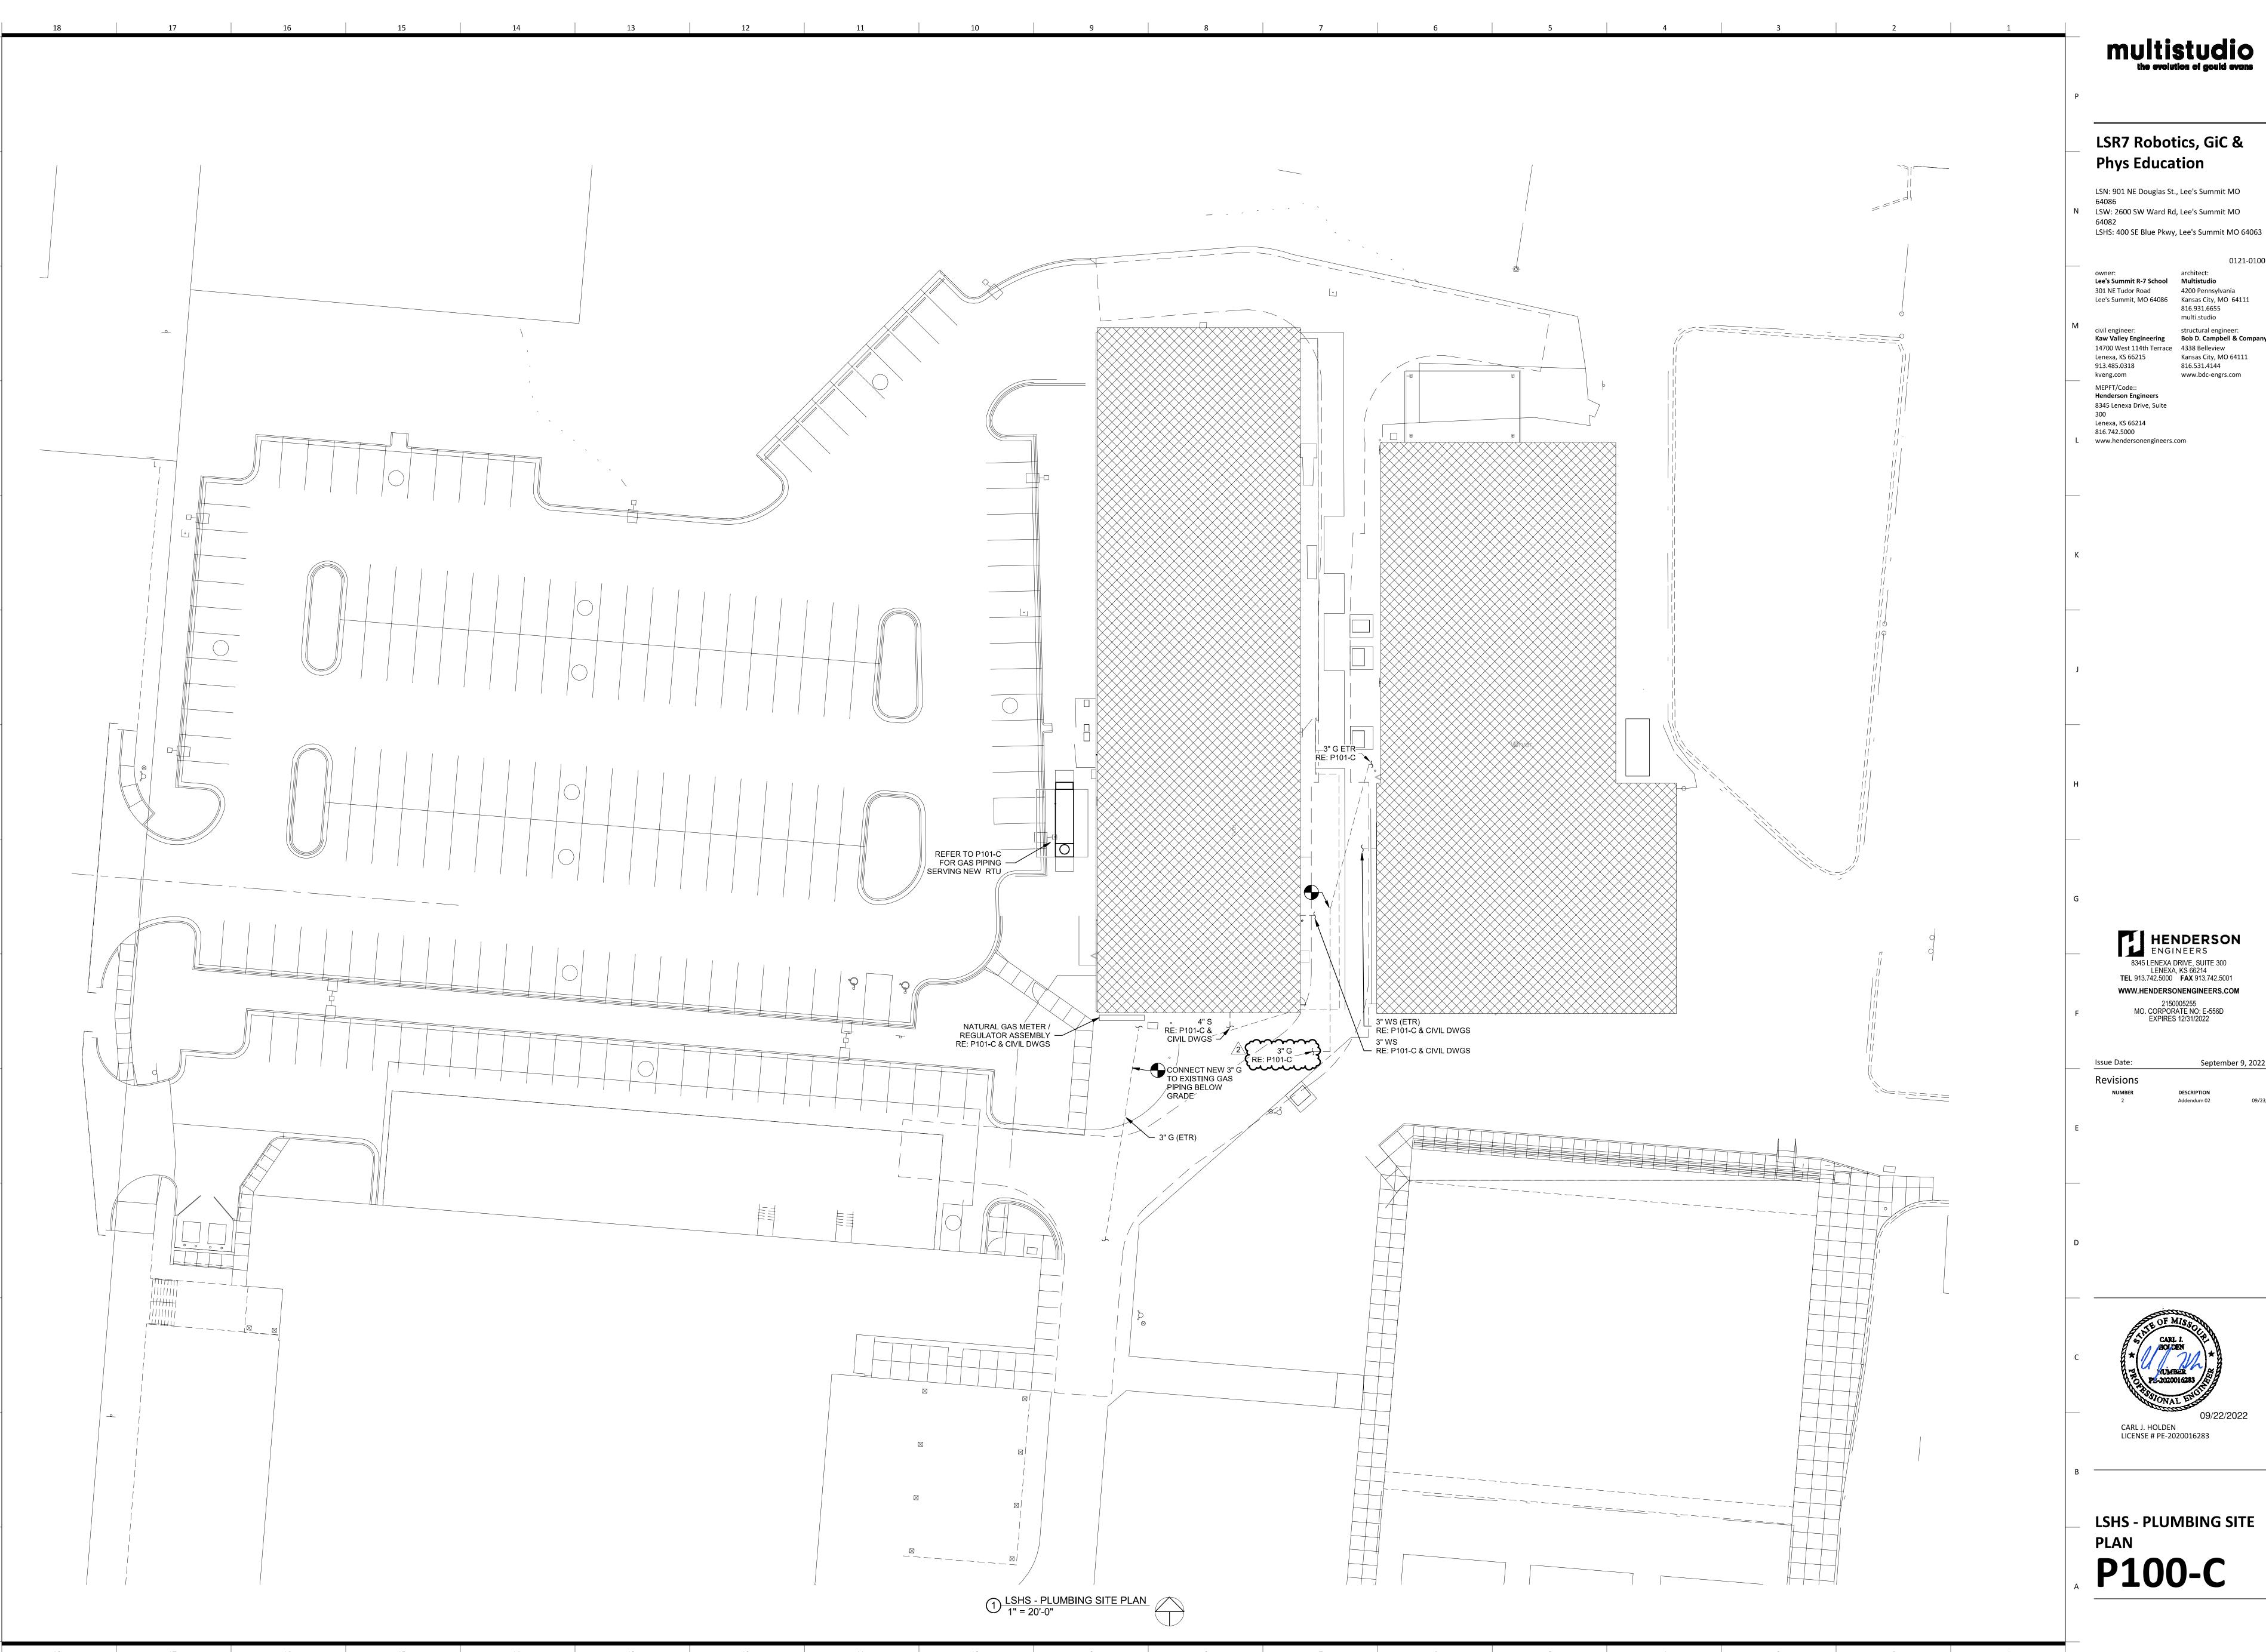

LSR7 Robotics, GiC & **Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO N LSW: 2600 SW Ward Rd, Lee's Summit MO

> 301 NE Tudor Road 4200 Pennsylvania

Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655 multi.studio


civil engineer: structural engineer:
Kaw Valley Engineering Bob D. Campbell & Company, Inc. 14700 West 114th Terrace 4338 Belleview Kansas City, MO 64111 Lenexa, KS 66215 913.485.0318 816.531.4144 www.bdc-engrs.com

kveng.com MEPFT/Code:: Henderson Engineers 8345 Lenexa Drive, Suite Lenexa, KS 66214


816.742.5000 www.hendersonengineers.com

HENDERSON
ENGINEERS

8345 LENEXA DRIVE, SUITE 300
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001



LSHS - PLUMBING SITE PLAN P100-C

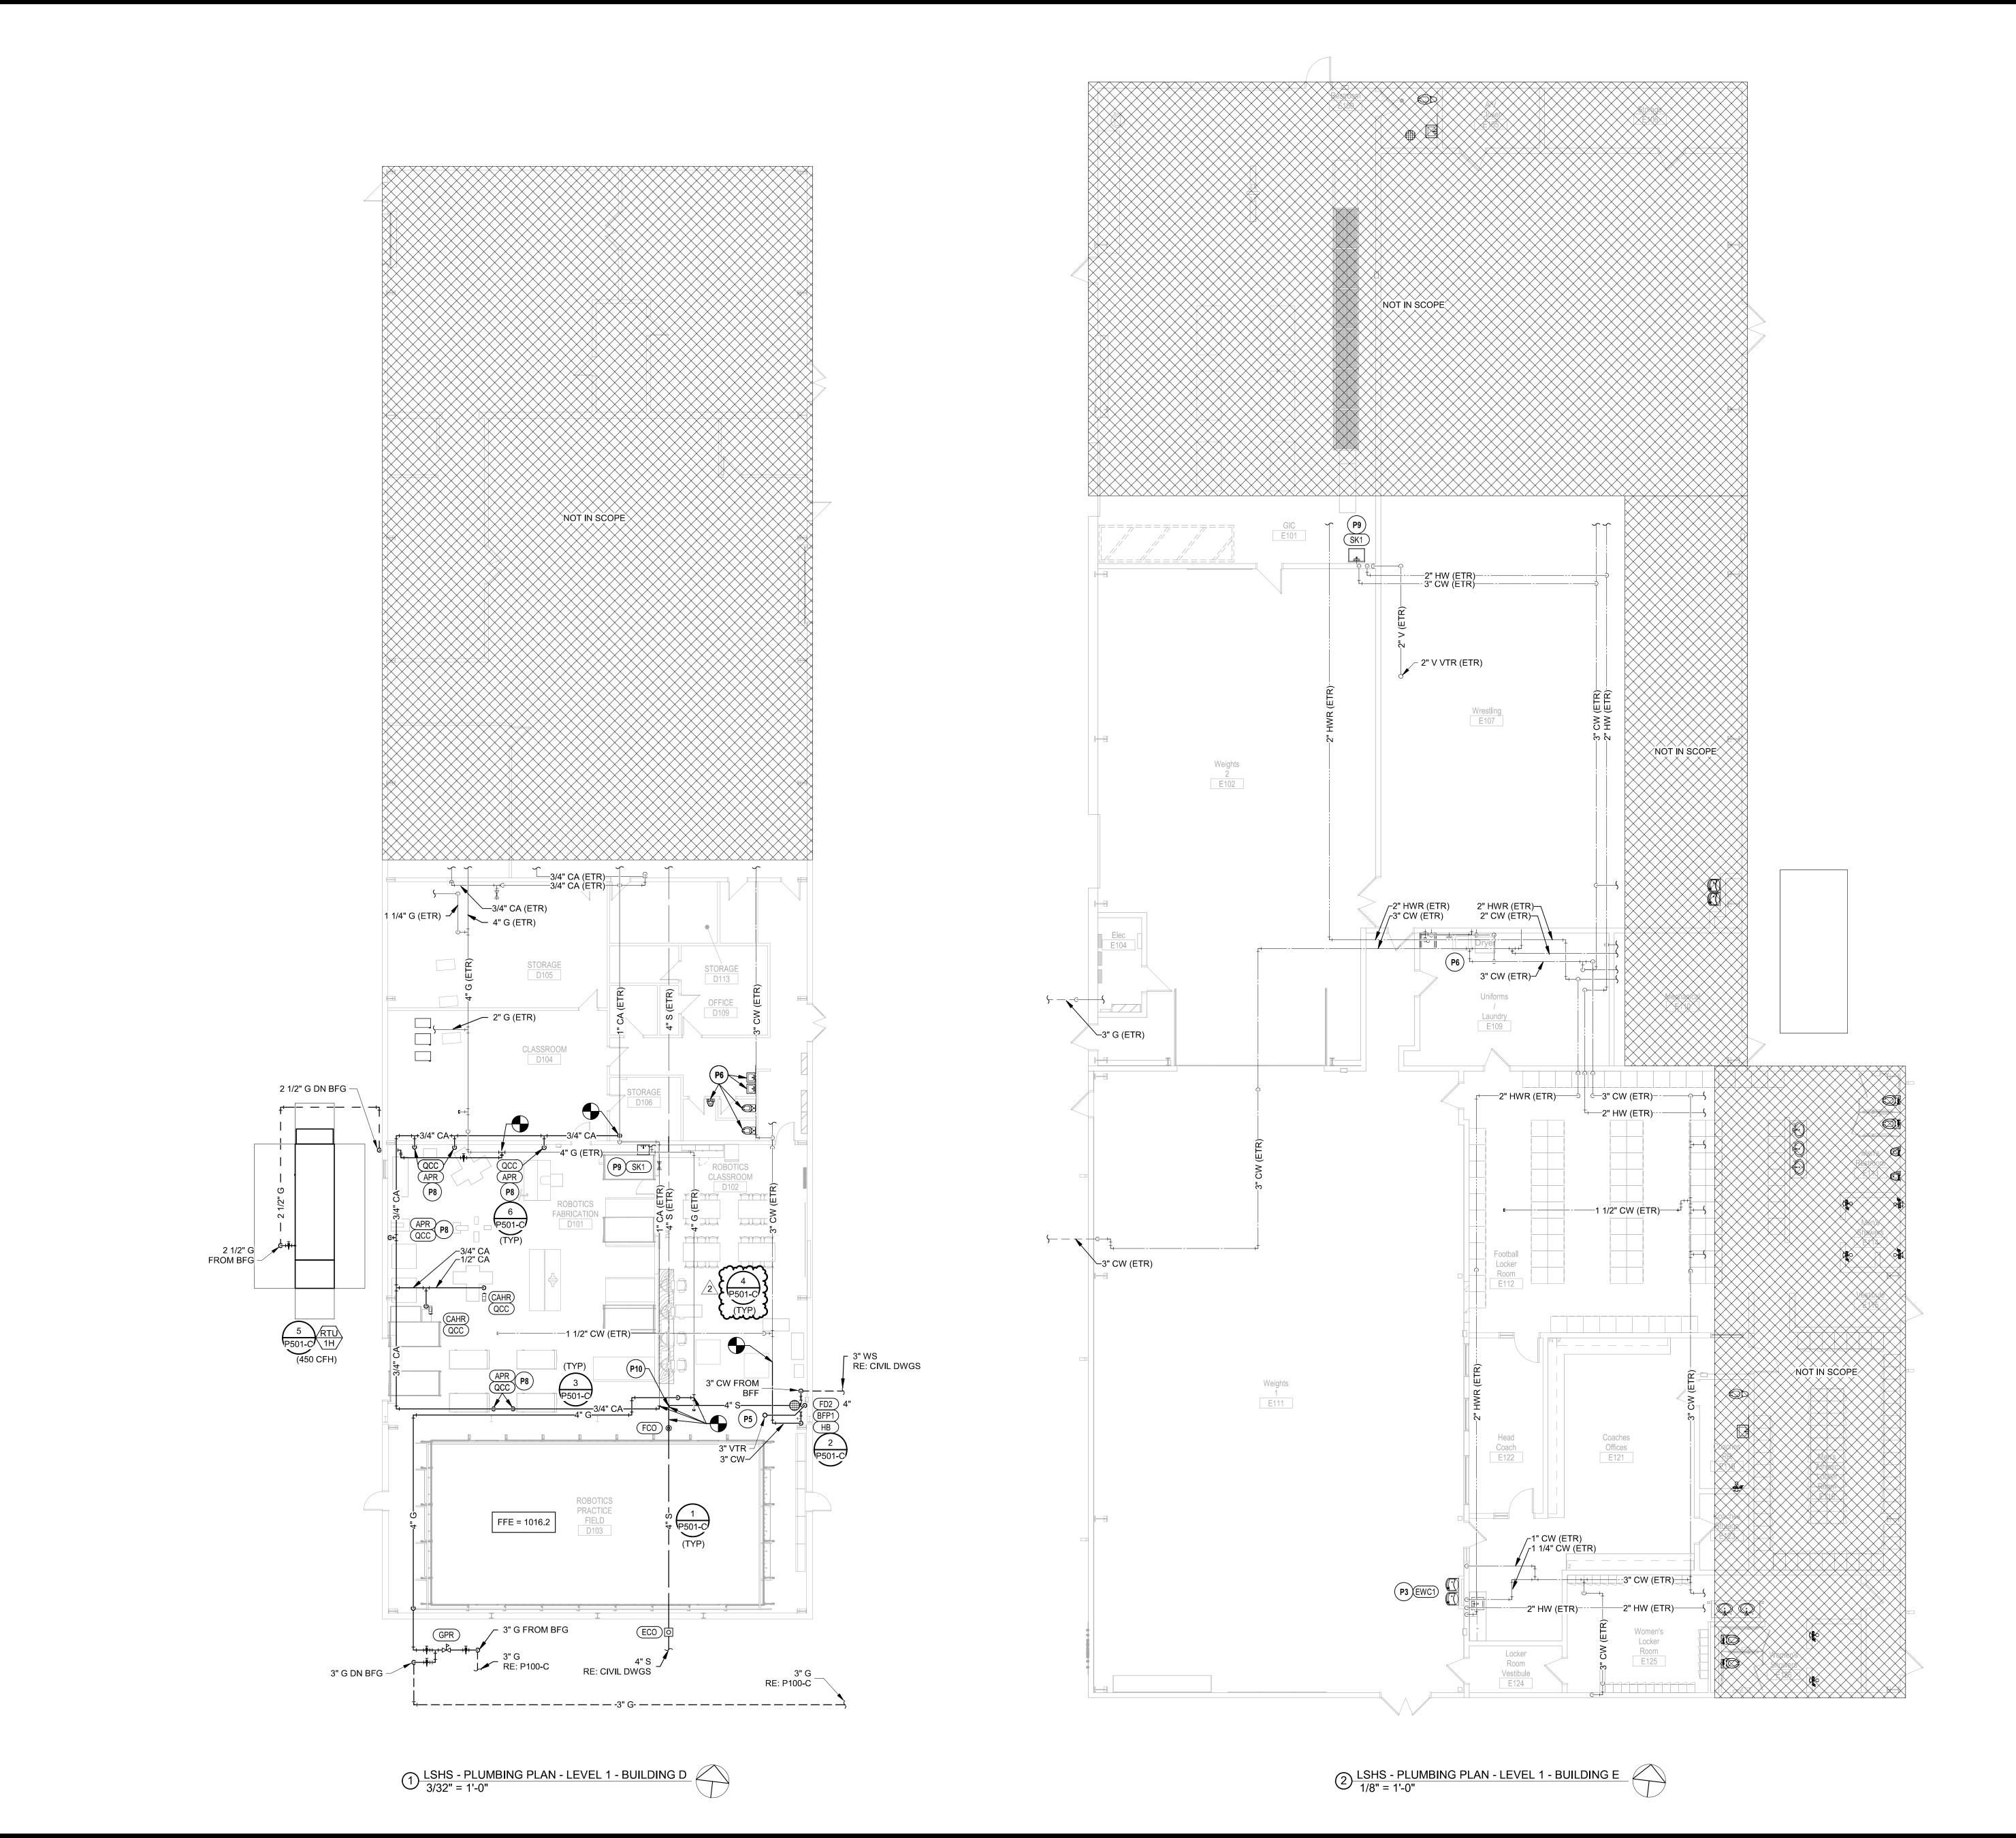

O PLUMBING PLAN NOTES:

- P3 CONNECT RELOCATED PLUMBING FIXTURE TO EXISTING PLUMBING PIPING (WASTE, VENT, AND COLD/HOT WATER) IN THIS AREA. PROVIDE ADDITIONAL PIPING AND INSULATION TO MATCH EXISTING AS REQUIRED. REPAIR AND MATCH FINAL FINISH PER ARCHITECTURAL INSTRUCTIONS.
- P5 CUT AND PATCH EXISTING CONCRETE FLOOR SLAB FOR INSTALLATION OF NEW UNDERGROUND PLUMBING PIPE. REPAIR AND MATCH FINAL FINISH PER ARCHITECTURAL INSTRUCTIONS.

EXISTING AS REQUIRED

- P6 EXISTING PLUMBING FIXTURE SHALL REMAIN. PROTECT FROM DAMAGE DURING DEMOLITION AND RENOVATION.

 P8 1/2" C4 DROP WITH SHUTGE VALVE DROP TO 4" 4FF
- P8 1/2" CA DROP WITH SHUTOFF VALVE. DROP TO 4' AFF
 P9 CONNECT NEW PLUMBING FIXTURE TO EXISTING PLUMBING
 SERVICE PIPING (WASTE, VENT, AND COLD/HOT WATER).
 PROVIDE ADDITIONAL PIPING AND INSULATION TO MATCH
- P10 CONNECT NEW SANITARY PIPING TO EXISTING SANITARY PIPING IN THIS VICINITY. FIELD VERIFY THE EXACT LOCATION, SIZE AND INVERT ELEVATION OF PIPING PRIOR TO START OF INSTALLATION.

multistudio

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086 LSW: 2600 SW Ward Rd, Lee's Summit MO

64082 LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

owner: architect:
Lee's Summit R-7 School Multistudio

301 NE Tudor Road 4200 Pennsylvania
Lee's Summit, MO 64086 Kansas City, MO 64111
816.931.6655
multi.studio

civil engineer: structural engineer:

Kaw Valley Engineering
14700 West 114th Terrace
Lenexa, KS 66215
913.485.0318
kveng.com

structural engineer:

Bob D. Campbell & Company, Inc.

4338 Belleview
Kansas City, MO 64111
816.531.4144
www.bdc-engrs.com

MEPFT/Code::
Henderson Engineers
8345 Lenexa Drive, Suite
300
Lenexa, KS 66214

www.hendersonengineers.com

816.742.5000


HENDERSON
ENGINEERS

8345 LENEXA DRIVE, SUITE 300
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001

WWW.HENDERSONENGINEERS.COM

2150005255
MO. CORPORATE NO: E-556D

Revisions
NUMBER
DESCRIPTION
Addendum 02
DESCRIPTION
DATE
2
Addendum 02
09/23/2022



LSHS - PLUMBING PLAN
- LEVEL 1 - BUILDING D
& E
P101-C

NACI DEN

PLUMBING FIXTURE CONNECTION SCHEDULE

		•••••		
FIXTURE	COLD WATER	HOT WATER	WASTE	VENT
WATER CLOSET (FV)	1-1/4" (NOTE 1)		4"	2"
URINAL	3/4" (NOTE 2)		2"	2"
LAVATORY	1/2"	1/2"	2"	1-1/2"
ELECTRIC WATER COOLER	1/2"		2"	1-1/2"
JANITOR'S SINK	1/2"	1/2"	3"	2"
FLOOR DRAIN			2"	2"
SINK	1/2"	1/2"	2"	1-1/2"

PIPE SIZES SHOWN ARE MINIMUM. AND ARE FOR INDIVIUAL SERVICE PIPE SIZES

(NOTE 1) PROVIDE 1-1/4" CW TO FLUSH VALVE, REDUCE TO 1" PRIOR TO CONNECTING TO FLUSH VALVE INLET AT INSIDE OF WALL (NOTE 2) PROVIDE 1" CW TO FLUSH VALV..

GAS PRESSURE REGULATOR SCHEDULE FOR 2 PSI SYSTEMS MANUFACTURER OUTLET PRESSURE SIZE (INCHES) RATE (CFH) (INCHES WATER COLUMN) PIETRO-FIORENTINI 31057/F 12,993 A, B, D, E, F, G, H & I

- A. C = SELF CONTAINED "DIRECT ACTING" DIAPHRAGM TYPE WITH INTERNAL VENT LIMITER
- B. DROOP = 1" WATER COLUMN MAXIMUM

C. DROOP = 2" WATER COLUMN MAXIMUM

- D. 65# ALUMINUM BODY, SCREWED CONNECTIONS AND OVERPRESSURE PROTECTION TO 25 PSI MAXIMUM FLOW RATE SCHEDULED, MATCH BODY SIZE AND MAXIMUM FLOW RATE TO EQUIPMENT FLOW RATE. REFER TO EQUIPMENT SHOP DRAWINGS FOR EXACT LOADS.
- F. LISTED TO MEET ANSI Z21.80 / CSA 6.22 WITH CSA LISTING STAMP ON REGULATOR BODY G. GAS PRESSURE REGULATOR INLET PRESSURE = OPERATING PRESSURE - DESIGN FRICTION LOSS
- H. 2 PSI MAXIMUM INLET PRESSURE AND 1 PSI MINIMUM INLET PRESSURE PROVIDE EXTERNAL VENT LIMITER (WHERE APPROVED BY LOCAL AUTHORITIES) FOR INDOOR INSTALLATION AND INSTALL PER SPECIFICATIONS. INSTALL OUTDOORS PER SPECIFICATIONS.


DITIMBING FIXTURE SCHEDULE I SHS

	PLU	JMBING FIXTURE SCHEDULE - LSHS
1	PLUMBING PLAN MARK	DESCRIPTION
	APR	AIR PRESSURE REGULATOR: WILKERSON #R-8, ALUMINUM BODY, BRASSVALVE STEM, NITRILE DIAPHRAGM AND SEALS, OUTLET PRESSURE GAGE, 3/8" FNPT CONNECTIONS AND MAXIMUM FLOW OF 68 SCFM WITH PRESSURE ADJUSTMENT RANGE OF 0 -125 PSIG.
	BFP1	REDUCED PRESSURE ZONE BACKFLOW PREVENTER: WATTS # 957-NRS, MEETING ASSE 1013, 304 STAINLESS STEEL BODY AND SLEEVE, QUARTER TURN TEST COCKS, RESILIENT SEATED NON-RISING STEM GATE VALVES AND WATTS #77F-DI-FDA EPOXY COATED CAST IRON STRAINER AND # 957AG AIR GAP FITTING.
-	CAHR	COMPRESSED AIR HOSE REEL: COXREELS EZ-P-LP430 RETRACTABLE HOSE REEL, WITH SPRING LOADED "EZ-COIL REWIND SAFETY SYSTEM" WITH LOW RETRACTION SPEED, BRASS BEARING AND 30 FEET OF 1/2" LOW PRESSURE AIR HOSE WITH A MAXIMUM PRESSURE RATING OF 180 PSIG. PROVIDE WITH 4-WAY ROLLER BRACKET #4RB, PROVIDE WITH MOUNTING BRACKET KIT FOR MOUNTING SINGLE HOSE REEL # 15723 EZ-UP BRACKET, PROVIDE WITH # 5155-1.5 3/4" X 24" INCH LOW PRESSURE HOSE FOR CONNECTION FROM THE COMPRESSED AIR LINE TO THE HOSE REEL INLET. PROVIDE WITH QUICK DISCONNECT (QCC) DESCRIBED ELSE WHERE IN THIS PLUMBING FIXTURE SCHEDULE.
	ECO ECO	DISCONNECT (QCC) DESCRIBED ELSE WHERE IN THIS PLUMBING FIXTURE SCHEDULE. EXTERIOR CLEANOUT: EXTERIOR CLEANOUT: JAY R. SMITH # 4261L SERIES DUCO CAST IRON DOUBLE FLANGED HOUSING WITH HEAVY DUTY SECURED SCORIATED CAST IRON COVER WITH LIFTING DEVICE AND CLEANOUT BODY WITH ABS PLASTIC PLUG WITH GASKET SEAL AND PUSH-ON JOINT. REFER TO SPECIFICATIONS FOR INSTALLATION.CLEANOUT COVERS SHALL HAVE EITHER "SANITARY" OR "STORM" CAST INTO THE COVER TO IDENTIFY SYSTEM SERVED.
-	EWC1	ELECTRIC WATER COOLER (ADA ACCESSIBLE): RELOCATED FIXTURE. TRIM: McGUIRE # LF2165CC LEAD FREE BRASS COMPRESSION ANGLE STOP VALVE WITH RISER AND ESCUTCHEON, McGUIRE # B8912CF 1-1/2" 17 GAUGE CAST CHROME PLATED BRASS ADJUSTABLE P-TRAP AND WASTE ARM WITH CLEANOUT PLUG AND ESCUTCHEON, AND SUITABLE CARRIER WITH STANCHIONS TO FLOOR. ELECTRICAL REQUIREMENTS: 120-VOLT, 4 FULL LOAD AMPS.
	FCO FCO	FLOOR CLEANOUT: JAY R. SMITH, CAST IRON BODY, FLASHING FLANGE WITH CLAMPING COLLAR, ABS PLUG, AND ADJUSTABLE, ROUND, SECURED, NICKEL BRONZE, TOP. # 4031L (-F-C), SCORIATED TOP FOR EXPOSED, FLUSH WITH FINISHED FLOOR, APPLICATION(S), # 4031L (-F-C-Y), STAINLESS STEEL MARKER FOR INSTALLATION IN CARPETED FLOOR AREA(S), # 4151 (-F-C), 1/8" RECESS FOR INSTALLATION IN TILED FLOOR AREA(S), # 4191 (-F-C), 1/2" RECESS FOR INSTALLATION IN TERRAZZO AND SIMILAR POURED FLOOR AREA(S). REFER TO SPECIFICATIONS FOR INSTALLATION. CLEANOUT COVERS SHALL HAVE EITHER "SANITARY" OR "STORM" CAST INTO THE COVER TO IDENTIFY SYSTEM SERVED.
	FD2	FLOOR DRAIN: JAY R .SMITH # 2005L (-A), CAST IRON BODY AND CLAMPING COLLAR, ADJUSTABLE 8" ROUND NICKEL BRONZE STRAINER. PROVIDE TRAP PRIMER PORT IF TRAP PRIMER IS PROVIDED ON THE DRAWINGS. USE PUSH-ON JOINT OF OUTLET SIZE AS SHOWN ON PLANS.


HOSE BIBB: PRIER PRODUCTS # C-258CP.75, POLISHED CHROME PLATED BRASS 3/4" MALE INLET, 3/4" THREADED HOSE CONNECTION, LOOSE KEY HANDLE, AND ASSE 1011 INTEGRAL VACUUM BREAKER. QUICK CONNECT COUPLER: GRACO #110198 COUPLER WITH 3/8" FNPT END. GRACO #110199 COUPLER WITH 1/2" FNPT END. VERIFY WITH OWNER THE TYPE OF COUPLER NECESSARY TO MATCH TOOL AND EQUIPMENT CONNECTION NEEDS FOR NEW AND RELOCATED EQUIPMENT SINK: ELKAY # WNSF-8124, ONE 24" x 24" x 14" DEEP COMPARTMENT, 8" HIGH BACKSPLASH, 14 GAUGE TYPE 304 STAINLESS STEEL, AND 16 GAUGE STAINLESS STEEL ADJUSTABLE LEGS. FAUCET: CHICAGO FAUCET #445-206578AB 3 3/8" BACK MOUNT FAUCET WITH 3" – 3 3/8" ADJUSTABLE


"R" ARMS WITH INTEGRAL SHUT OFF, VANDAL RESISTANT # 369 LEVER HANDLES, L9 SWING SPOUT, # E1 FULL FLOW OUTLET, QUARTER TURN CERAMIC CARTRIDGES TRIM: ELKAY # LK24RT GRID STRAINER WITH LEVER HANDLE AND 1-1/2" TAILPIECE, AND 1-1/2" HARD

COPPER TYPE "DWV" FABRICATED INDIRECT WASTE LINE ROUTED TO FLOOR SINK.

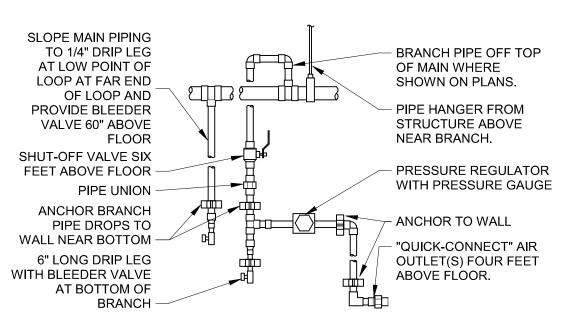


REFER TO SPECIFICATIONS FOR FURTHER INFORMATION ABOUT PIPE, FITTINGS, AND DEVICES. PIPING ARRANGEMENT SHOWN IS SCHEMATIC: ADJUST TO SUIT CONDITIONS. REFER TO FLOOR PLANS FOR LOCATION OF OUTLETS, DRIP LEGS, AND AIR MAIN PIPE SIZES.

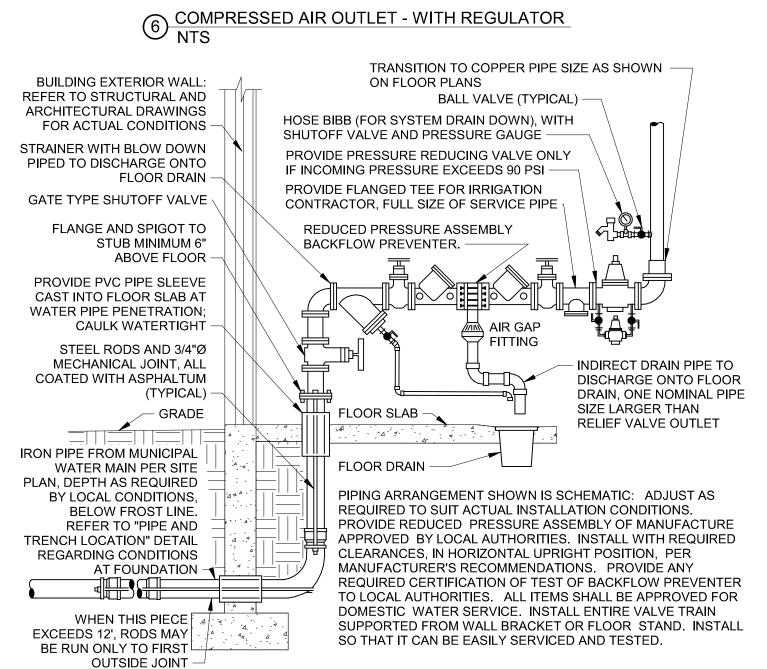

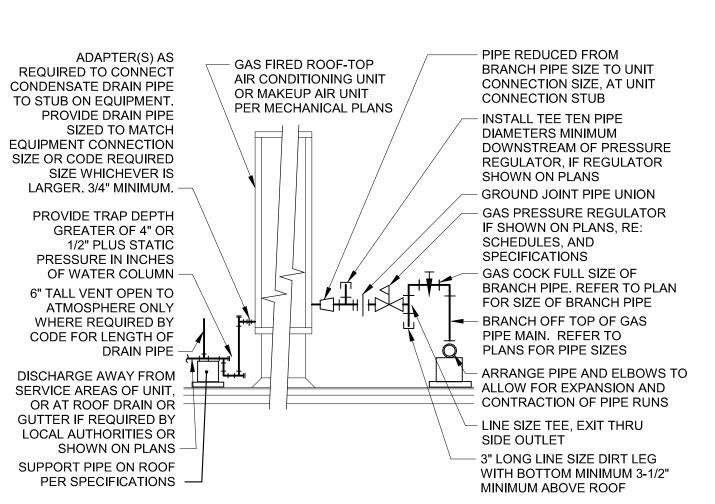

ARRANGEMENT SHOWN IS SCHEMATIC. ADJUST TO SUIT FIELD CONDITIONS. PROVIDE CONNECTIONS SHOWN IN EQUIPMENT MANUFACTURER'S INSTALLATION INSTRUCTIONS. VERIFY CONNECTION LOCATIONS BEFORE INSTALLING PIPE RUNS. REFER TO SPECIFICATIONS FOR PIPE AND FITTING MATERIALS AND INSTALLATION. PROVIDE DIELECTRIC UNION IF CONNECTING DISSIMILAR METALS. FOR PIPE SIZE(S) REFER TO FLOOR PLANS, OR CODE REQUIREMENTS FOR HVAC UNIT TONNAGE. PROVIDE GAS COCK, UNION AND DIRT LEG SAME SIZE AS BRANCH PIPE. SLOPE CONDENSATE PIPE AS MUCH AS POSSIBLE TOWARD DISCHARGE, 2% MINIMUM. PROVIDE CLEANOUTS IN ENDS AND TURNS OF PIPE PER LOCAL CODE REQUIREMENTS: ADAPTER WITH THREADED CLEANOUT PLUG. PROVIDE MINIMUM 6" CLEARANCE TO ROOF UNDER PIPES.

5 CONNECTIONS TO ROOF-TOP UNIT NTS

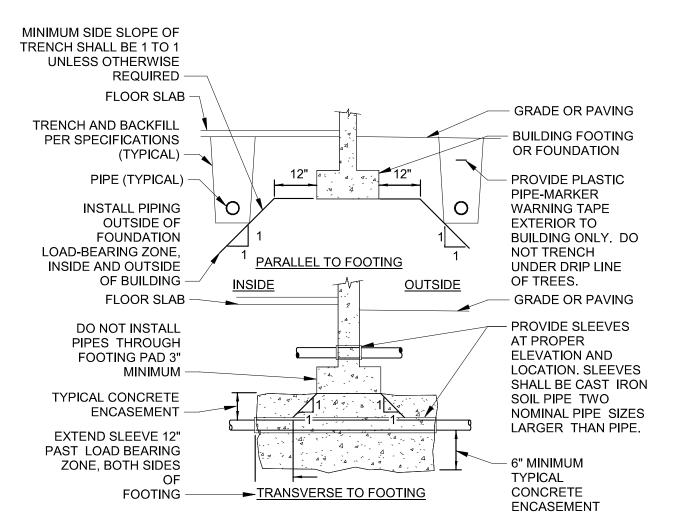

VERIFY EXCAVATION CONDITIONS (SOIL/ROCK) WITH GEOTECHNICAL REPORT AND/OR SITE INVESTIGATIONS. REFER TO SPECIFICATIONS FOR OTHER CONDITIONS. DO NOT INSTALL PIPES UNDER INTERIOR BUILDING SPREAD FOOTINGS OR PILE CAPS. COORDINATE WITH AFFECTED CONTRACTORS PRIOR TO THE START OF WORK.

1) PIPE AND TRENCH LOCATION NTS

LSR7 Robotics, GiC &

LSN: 901 NE Douglas St., Lee's Summit MO

LSW: 2600 SW Ward Rd, Lee's Summit MO

Lee's Summit R-7 School Multistudio

14700 West 114th Terrace 4338 Belleview

301 NE Tudor Road

Kaw Valley Engineering

Lenexa, KS 66215

Henderson Engineers 8345 Lenexa Drive, Suite

Lenexa, KS 66214

www.hendersonengineers.com

816.742.5000

913.485.0318

MEPFT/Code::

kveng.com

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Lee's Summit, MO 64086 Kansas City, MO 64111

4200 Pennsylvania

structural engineer:

Kansas City, MO 6411

Bob D. Campbell & Company, Inc.

816.931.6655

multi.studio

816.531.4144 www.bdc-engrs.com


0121-0100

Phys Education


HENDERSON 8345 LENEXA DRIVE, SUITE 300 LENEXA, KS 66214 **TEL** 913.742.5000 **FAX** 913.742.5001 WWW.HENDERSONENGINEERS.COM MO. CORPORATE NO: E-556D

Issue Date: September 9, 2022 Revisions

EXPIRES 12/31/2022




LSHS - PLUMBING **SCHEDULES & DETAILS**

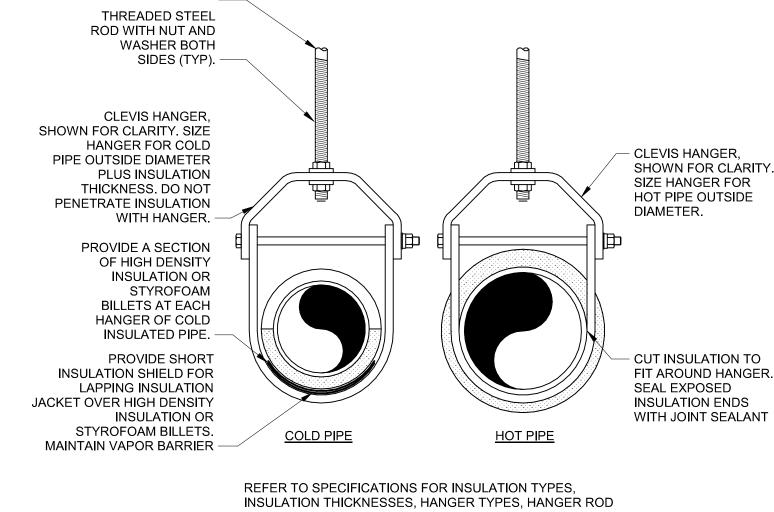

SECURE PIPE HANGER


TO STRUCTURE (TYP)

CONNECTIONS TO STRUCTURE AND HANGER SPACING.

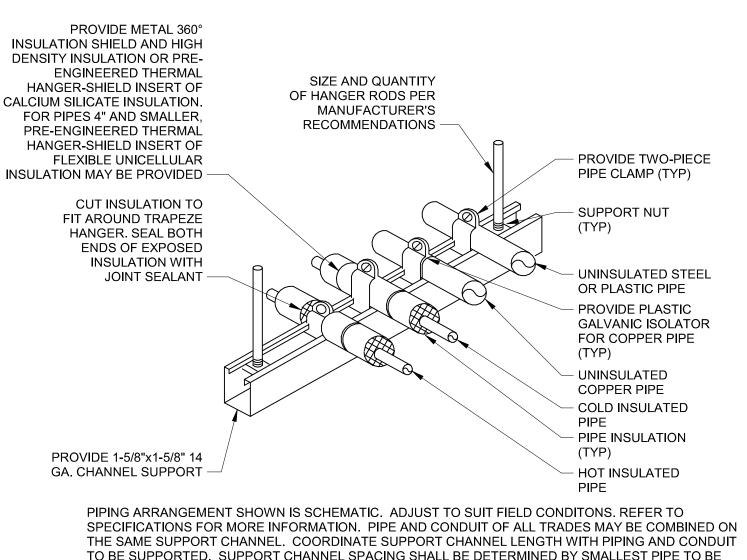

TO BE SUPPORTED. SUPPORT CHANNEL SPACING SHALL BE DETERMINED BY SMALLEST PIPE TO BE SUPPORTED. CHANNEL SUPPORT MAY BE USED AS A WALL BRACKET, ATTACH TO WALL WITH ANCHOR BOLTS PER SPECIFICATIONS. FOR HORIZONTAL INSULATED PIPING, ATTACH CLAMPS AS INDICATED ABOVE, FOR VERTICAL INSULATED PIPING, ATTACH CLAMPS TO THE PIPE AND SEAL INSULATION AT BOTH CLAMP ENDS.

2 IRON PIPE DOMESTIC WATER SERVICE ENTRY NTS

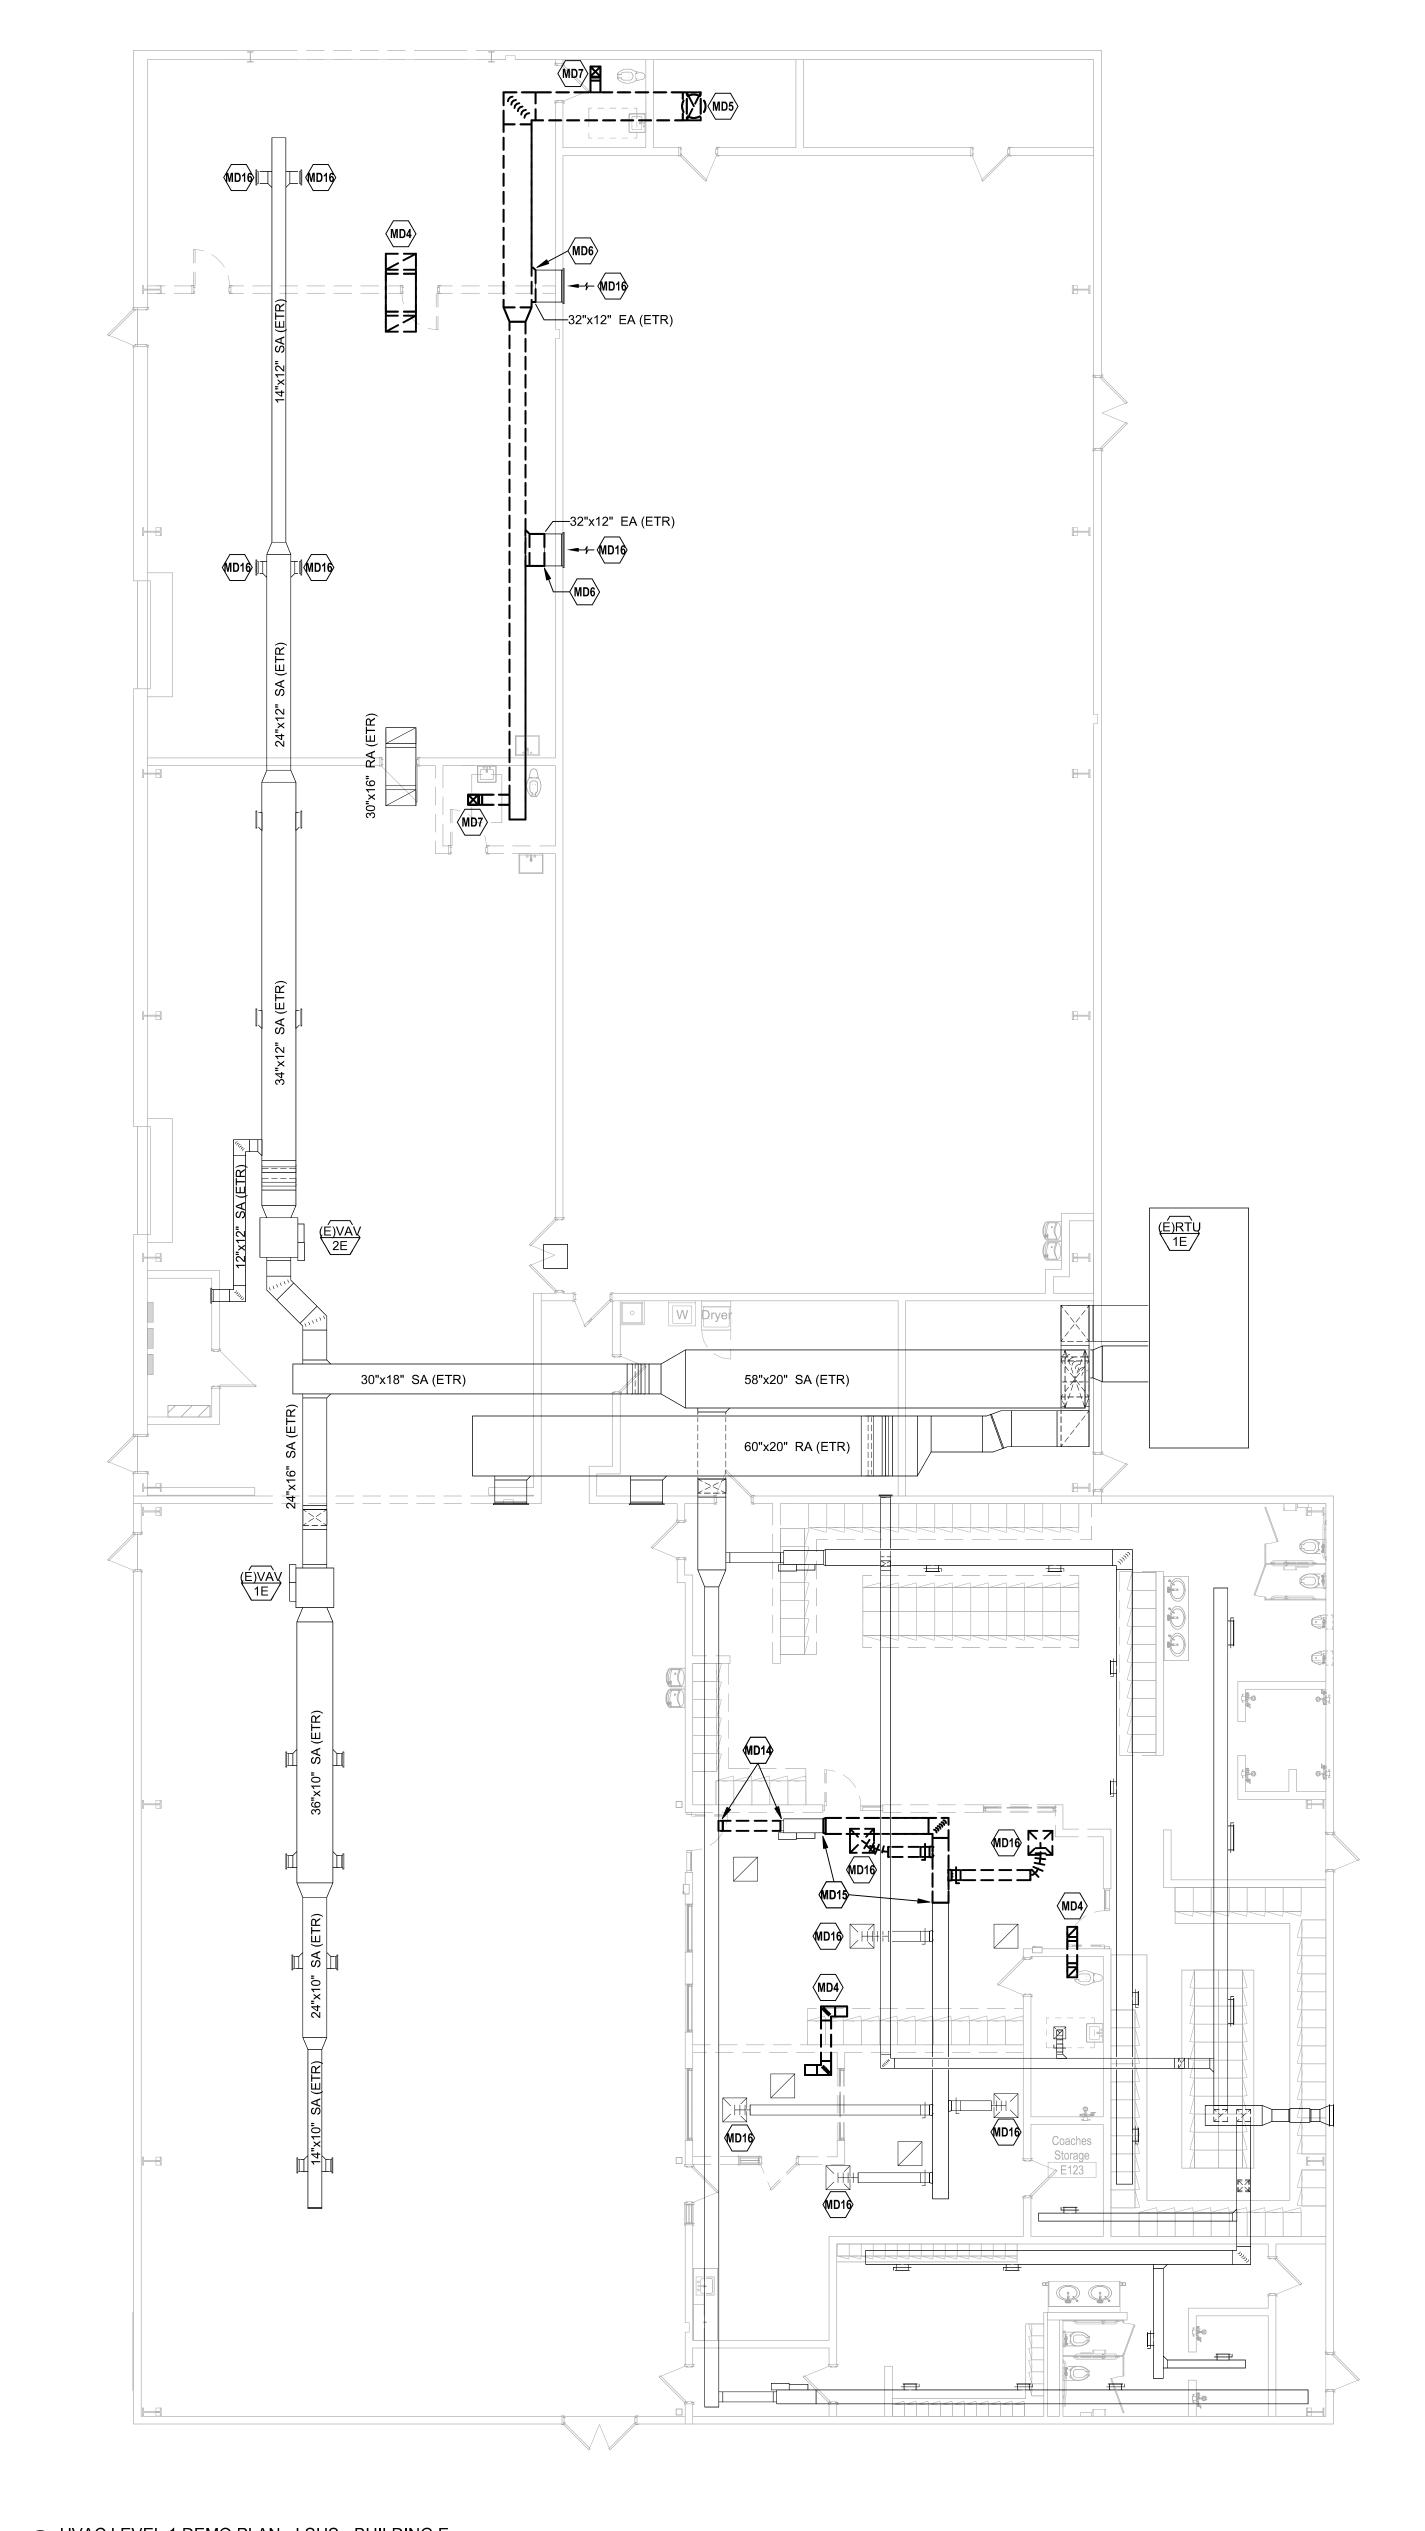

MECHANICAL DEMOLITION PLAN NOTES:

MD1 DEMOLISH DUCT AND SUPPLY DIFFUSER(S) BACK TO MAIN. PROVIDE PERMANENT INSULATED SHEET METAL CAP OVER

DUCT OPENING.
MD4 DEMOLISH TRANSFER DUCT.

MD5 DEMOLISH EXHAUST FAN AND ASSOCIATED DUCTWORK, GRILLES, AND CONTROLS. PROVIDE TEMPORARY TAP OVER

ROOF FOR RE-USE OF PENETRATION IN NEW WORK.

MD6 DEMOLISH EXHAUST TAP TO POINT SHOWN. PROVIDE

TEMPORARY CAP OVER OPENING FOR RE-USE OF DUCT AND GRILLE IN NEW WORK.

MD7 DEMOLISH EXHAUST GRILLE AND ASSOCIATED DUCTWORK.

MD8 DEMOLISH ABANDONED IN PLACE CONDENSING UNIT.

MD9 DEMOLISH EVAPORATOR COIL, FURNACE, ASSOCIATED CONDENSING UNIT, CONTROL DEVICES, AND PIPING. PROVIDE PERMANENT SHEET METAL CAP OVER PIPE/WALL EXTERIOR PENETRATIONS. SEAL PENETRATIONS AIR/WATER

MD10 DEMOLISH ALL DUCTWORK AND SUPPLY GRILLES SERVED BY EVAP COIL AND FURNACE.

MD11 DEMOLISH RELIEF LOUVER AND ASSOCIATED
DUCTWORK/GRILLE. INFILL WALL OPENING TO MAINTAIN
REQUIRED WALL RATING CALLED OUT IN NEW WORK.
COORDINATE WITH ARCHITECTURAL PLANS FOR

RECONSTRUCTION MATERIALS AND WALL RATINGS (TYP.).

MD12 INFILL WALL OPENINGS CREATED BY DEMOLITION. INFILL TO MAINTAIN REQUIRED WALL RATING CALLED OUT IN NEW WORK. COORDINATE WITH ARCHITECTURAL PLANS FOR

RECONSTRUCTION MATERIALS AND WALL RATINGS (TYP.).

MD13 DEMOLISH RETURN DUCT BACK TO POINT SHOWN. LEAVE DUCT OPEN TO SPACE AND PROVIDE BIRDSCREEN OVER

OPENING TO PROTECT FROM DEBRIS.

MD14 DEMOLISH VAV INLET DUCT AND PROVIDE TEMPORARY CAP
OVER DUCT AND BOX INLET FOR RECONNECTION IN NEW

MD15 DEMOLISH DUCTWORK SHOWN. PROVIDE TEMPORARY CAP OVER DUCT AND BOX OUTLET FOR RECONNECTION IN NEW

MD16 PRE-TEST EXISTING DIFFUSERS/GRILLES IN ROOM NOTED TO DETERMINE EXISTING AIRFLOW.

multistudio

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086 N LSW: 2600 SW Ward Rd, Lee's Summit MO 64082

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

owner: architect:

Lee's Summit R-7 School

301 NE Tudor Road 4200 Pennsylvania
Lee's Summit, MO 64086 Kansas City, MO 64111

816.931.6655

0121-0100

multi.studio

civil engineer: structural engineer:

Kaw Valley Engineering Bob D. Campbell & Company, Inc.

14700 West 114th Terrace Lenexa, KS 66215 Kansas City, MO 64111

14700 West 114th Terrace
Lenexa, KS 66215
913.485.0318
kveng.com

MEPFT/Code::
Henderson Engineers

Henderson Engineers
8345 Lenexa Drive, Suite
300
Lenexa, KS 66214
816.742.5000

www.hendersonengineers.com


HENDERSON
ENGINEERS

8345 LENEXA DRIVE, SUITE 300
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001

WWW.HENDERSONENGINEERS.COM

2150005255
MO. CORPORATE NO: E-556D

Revisions
NUMBER DESCRIPTION DATE



CARL J. HOLDEN LICENSE # PE-2020016283


LSHS - HVAC
DEMOLITION PLAN LEVEL 1 - BUILDING D &

MD101-C

1 HVAC LEVEL 1 DEMO PLAN - LSHS - BUILDING D 3/32" = 1'-0"

EXISTING PAD

2 HVAC LEVEL 1 DEMO PLAN - LSHS - BUILDING E 1/8" = 1'-0"

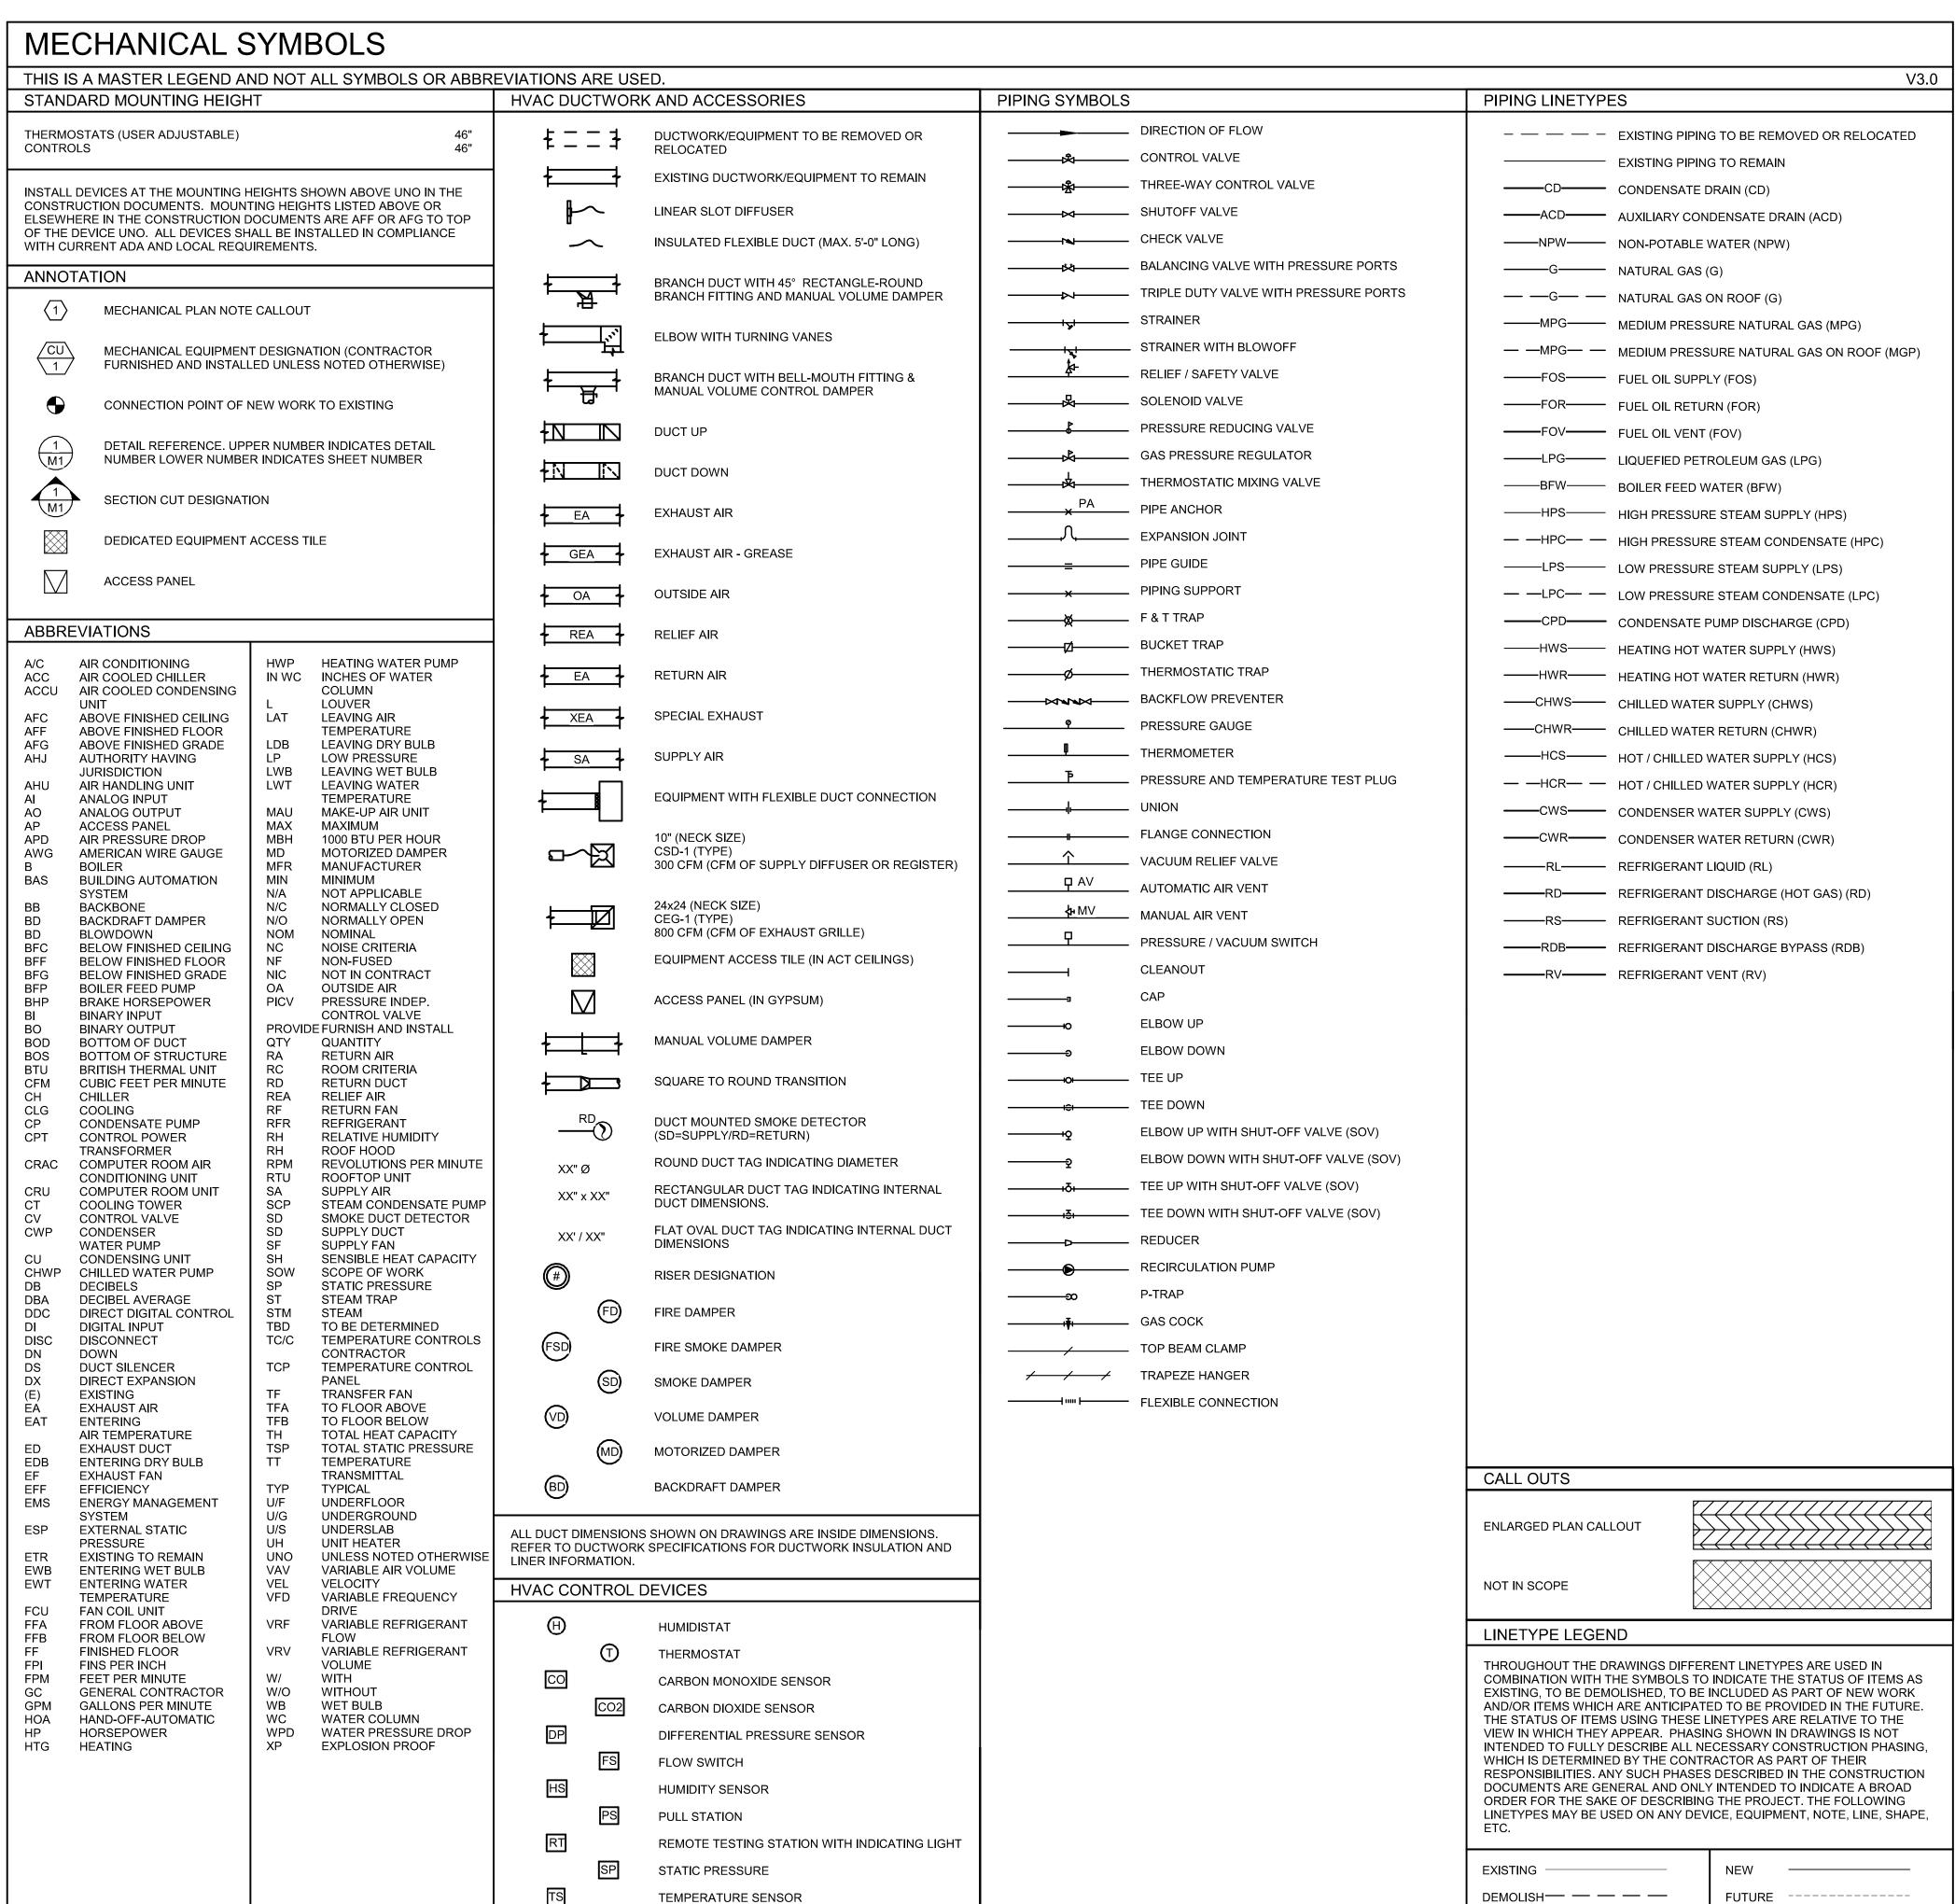

GENERAL DEMOLITION NOTES:

- 1. COORDINATE ALL DEMOLITION WITH WHAT IS SHOWN ON ARCHITECTURAL PLANS. NOTIFY ARCHITECT OF ANY DISCREPANCIES.
- PRIOR TO SUBMITTING BID, VISIT THE JOB SITE AND BECOME FULLY ACQUAINTED WITH THE EXISTING CONDITIONS OF THE PROJECT. REVIEW GENERAL NOTES, SPECIFICATIONS AND OTHER DRAWINGS FOR ADDITIONAL REQUIREMENTS THAT MAY NOT BE SPECIFICALLY CALLED OUT IN THIS PORTION OF THE CONSTRUCTION DOCUMENTS. NOTIFY ARCHITECT, ENGINEER OR OWNER, AS DEFINED IN BID DOCUMENTS, OF CONFLICTS OR DISCREPANCIES PRIOR TO SUBMISSION OF BID.
- OWNER RETAINS RIGHTS OF SALVAGE FOR EQUIPMENT AND FIXTURES TO BE REMOVED. COORDINATE WITH OWNER THE EQUIPMENT AND FIXTURES TO BE SALVAGED AND THE LOCATION FOR STORAGE. AVOID DAMAGE TO SALVAGED EQUIPMENT, FIXTURES AND DEVICES DURING DEMOLITION WORK AND DURING TRANSPORT TO OWNER'S DESIGNATED STORAGE
- 4. REMOVE ITEMS SHOWN HEAVY-LINED DASHED, AND/OR NOTED TO BE
- AVOID DAMAGING EXISTING SURFACES AND EQUIPMENT TO REMAIN FOR NEW INSTALLATION. REPAIR DAMAGE CAUSED DURING WORK AT NO EXTRA COST TO THE OWNER.
- 6. SEAL PENETRATIONS THROUGH FLOORS, WALLS, CEILINGS AND ROOFS WHERE MECHANICAL COMPONENTS ARE REMOVED AND WHERE THE EXISTING PENETRATION IS NOT USED FOR THE NEW INSTALLATION. REPAIR DAMAGED SURFACES TO MATCH ADJACENT AREAS OR AS INDICATED ON THE ARCHITECTURAL DRAWINGS.
- REMOVE HANGERS AND SUPPORTS WHERE DUCTWORK, PIPING AND/OR EQUIPMENT ARE REMOVED AND THE EXISTING HANGERS AND SUPPORTS ARE NOT USED FOR THE NEW INSTALLATION.
- 8. INSTALL PERMANENT CAPS WHERE DUCTWORK AND PIPING IS REMOVED AND THE EXISTING TAPS ARE NOT USED FOR THE NEW INSTALLATION. WHERE DUCTWORK AND PIPING ARE REMOVED AND THE EXISTING TAPS WILL BE USED FOR THE NEW INSTALLATION, INSTALL TEMPORARY CAPS TO PROTECT THE INTERIOR SURFACES UNTIL NEW DUCTWORK AND PIPING
- INSPECT EXISTING EQUIPMENT TO REMAIN TO VERIFY THAT EQUIPMENT IS OPERATING PROPERLY. NOTIFY OWNER OF DAMAGED AND/OR MALFUNCTIONING COMPONENTS.
- 10. WHERE SHUTDOWN OF EXISTING SYSTEMS IS REQUIRED DURING DEMOLITION, COORDINATE SHUTDOWN TIME AND DURATION WITH OWNER TO MINIMIZE DOWNTIME. NOTIFY OWNER SEVEN (7) DAYS PRIOR TO INTERRUPTION OF SERVICE.
- 11. CEASE WORK AND IMMEDIATELY NOTIFY THE OWNER SHOULD ANY HAZARDOUS MATERIALS BE ENCOUNTERED DURING THE PERFORMANCE OF THE WORK.
- 12. REMOVAL, RECOVERY, RECYCLING, AND DISPOSAL OF REFRIGERANT, CONTAINED IN ANY EQUIPMENT TO BE REMOVED, SHALL BE PERFORMED IN STRICT ACCORDANCE WITH CURRENT EPA GUIDELINES.

13 12 11 10 9 8 7 6 5 4 3

GENERAL NEW NOTES:

- 1. PRIOR TO SUBMITTING BID, VISIT THE JOB SITE AND BECOME FULLY ACQUAINTED WITH THE EXISTING CONDITIONS OF THE PROJECT. REVIEW THE GENERAL NOTES, SPECIFICATIONS AND OTHER DRAWINGS FOR ADDITIONAL REQUIREMENTS WHICH MAY NOT BE SPECIFICALLY CALLED OUT IN THIS PORTION OF THE CONSTRUCTION DOCUMENTS. NOTIFY ARCHITECT, ENGINEER AND/OR OWNER OF CONFLICTS OR DISCREPANCIES PRIOR TO SUBMISSION OF BID.
- 2. EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND SITE VISITS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. FIELD VERIFY EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. COORDINATE NEW WORK AND DEMOLITION WITH OTHER DISCIPLINES AND EXISTING CONDITIONS PRIOR TO CONSTRUCTION.
- 3. COORDINATE THE INSTALLATION OF THE MECHANICAL SYSTEMS WITH OTHER TRADES TO ENSURE A NEAT AND ORDERLY INSTALLATION. INSTALL DUCTWORK AND PIPING AS TIGHT TO STRUCTURE AS POSSIBLE. COORDINATE WITH OTHER TRADES TO AVOID CONFLICTS. COORDINATE INSTALLATION OF DUCTWORK AND PIPING TO AVOID CONFLICTS WITH ELECTRICAL PANELS, LIGHTING FIXTURES, ETC. ANY MODIFICATIONS REQUIRED DUE TO LACK OF COORDINATION WILL BE THE RESPONSIBILITY OF THE CONTRACTOR AT NO EXTRA COST TO THE OWNER.
- 4. WHERE SHUTDOWN OF EXISTING SYSTEMS IS REQUIRED DURING NEW WORK, COORDINATE SHUTDOWN TIME AND DURATION WITH THE OWNER TO MINIMIZE DOWNTIME. NOTIFY OWNER SEVEN (7) DAYS PRIOR TO INTERRUPTION OF SERVICE.
- 5. DURING INSTALLATION OF NEW WORK, AVOID DAMAGING EXISTING SURFACES AND EQUIPMENT TO REMAIN. REPAIR DAMAGE CAUSED DURING CONSTRUCTION AT NO EXTRA COST TO THE OWNER.
- 6. PROVIDE TEMPORARY BARRIERS TO CONTAIN DUST AND DEBRIS RESULTING FROM THE PERFORMANCE OF THE WORK TO THE AREA WHERE WORK IS BEING PERFORMED.
- 7. ALL MECHANICAL EQUIPMENT SHOWN ON THE MECHANICAL PLANS SHALL BE PROVIDED BY DIVISION 23 UNLESS OTHERWISE NOTED.
- 8. NEW MECHANICAL EQUIPMENT, DUCTWORK AND PIPING ARE SHOWN AT APPROXIMATE LOCATIONS. FIELD MEASURE FINAL DUCTWORK AND PIPING LOCATIONS PRIOR TO FABRICATION AND MAKE ADJUSTMENTS AS REQUIRED TO FIT THE DUCTWORK AND PIPING WITHIN THE AVAILABLE SPACE. VERIFY THAT FINAL EQUIPMENT LOCATIONS MEET MANUFACTURER'S RECOMMENDATIONS REGARDING SERVICE CLEARANCE AND PROPER AIRFLOW CLEARANCE AROUND EQUIPMENT.
- 9. REFER TO ARCHITECTURAL DRAWINGS FOR RELATED CONSTRUCTION DETAILS AS APPLICABLE TO THE HVAC SYSTEM. VERIFY CHASES AND PENETRATIONS SHOWN ON ARCHITECTURAL DRAWINGS THAT ARE INTENDED FOR DUCTWORK AND PIPING MEET REQUIREMENTS.
- 10. COORDINATE LOCATION OF ROOF MOUNTED HVAC EQUIPMENT AND ROOF PENETRATIONS WITH THE ARCHITECTURAL AND STRUCTURAL DRAWINGS.
- 11. INDOOR AIR QUALITY MEASURES: PROTECT INSIDE OF (INSTALLED AND DELIVERED) DUCTWORK AND HVAC UNITS FROM EXPOSURE TO DUST, DIRT, PAINT AND MOISTURE. REPLACE INSULATION THAT HAS BECOME WET AT ANY TIME DURING CONSTRUCTION, DRYING THE INSULATION IS NOT ACCEPTABLE. SEAL ANY TEARS OR JOINTS OF INTERNAL FIBERGLASS INSULATION. REMOVE DEBRIS FROM CEILING/RETURN AIR PLENUM INCLUDING DUST. VACUUM CLEAN ANY DUCTWORK CONNECTED TO HVAC UNITS THAT WERE OPERATED DURING THE CONSTRUCTION PERIOD AFTER NEW FILTERS ARE INSTALLED AND PRIOR TO TURNING SYSTEM OVER TO THE OWNER. THE INTERNAL SURFACES AND ASSOCIATED COILS OF ANY HVAC UNITS THAT WERE OPERATED SHALL ALSO BE CLEANED.
- 12. INSTALL DUCTWORK AND PIPING PARALLEL TO BUILDING COLUMN LINES UNLESS OTHERWISE SHOWN OR NOTED.
- 13. OVERHEAD HANGERS AND SUPPORTS FOR EQUIPMENT, DUCTWORK AND PIPING SHALL BE FASTENED TO BUILDING JOISTS OR BEAMS. DO NOT ATTACH HANGERS AND SUPPORTS TO THE ABOVE FLOOR SLAB OR ROOF EXCEPT WHERE CONCRETE INSERTS IN CONCRETE SLABS ARE ALLOWED BY THE SPECIFICATIONS.
- 14. COORDINATE LOCATION OF EQUIPMENT SUPPORTS WITH LOCATION OF EQUIPMENT ACCESS PANELS/DOORS TO ENABLE SERVICE OF EQUIPMENT AND/OR FILTER REPLACEMENT
- 15. SEAL PENETRATIONS THROUGH THE BUILDING COMPONENTS IN ACCORDANCE WITH THE CONTRACT SPECIFICATIONS. FIREPROOF PENETRATIONS THROUGH FIRE RATED COMPONENTS IN ACCORDANCE WITH U.L. REQUIREMENTS.
- 16. COORDINATE THE EXACT MOUNTING SIZE AND FRAME TYPE OF DIFFUSERS, REGISTERS AND GRILLES WITH THE SUPPLIER TO MEET THE CEILING, WALL AND DUCT INSTALLATION REQUIREMENTS.
- 17. ADJUST LOCATION OF CEILING DIFFUSERS, REGISTERS AND GRILLES AS REQUIRED TO ACCOMMODATE FINAL CEILING GRID AND LIGHTING LOCATIONS.
- 18. PAINT PORTIONS OF DUCTWORK AND INSULATION THAT ARE EXPOSED TO VIEW BY THE INSTALLATION OF DIFFUSERS, REGISTERS, AND GRILLES IN CEILINGS OR WALLS FLAT BLACK. PORTIONS INCLUDE BOTH THE INTERIOR OF UNLINED DUCTWORK AND THE EXTERIOR OF DUCTWORK AND INSULATION.
- 19. DUCTWORK CROSSING FIRE RATED WALLS OR OTHER FIRE RATED ASSEMBLIES SHALL BE MINIMUM 26 GAUGE SHEET METAL.
- 20. PROVIDE FIRE OR FIRE/SMOKE DAMPERS, AS APPLICABLE, IN DUCTWORK AT CEILINGS AND WALLS AT LOCATIONS SHOWN ON THE PLANS. FIRE AND FIRE/SMOKE DAMPERS SHALL CONFORM TO NFPA AS APPLICABLE. COORDINATE SLEEVE LENGTH WITH REQUIREMENTS OF INSTALLED LOCATION.
- 21. PROVIDE WALL OR DUCT ACCESS PANELS OR DOORS FOR ACCESS TO FIRE AND FIRE/SMOKE DAMPERS. ACCESS PANEL OR DOOR SHALL BE MINIMUM SIZE OF 10" BY 10" AND SHALL BE INSTALLED WITHIN 12" OF DAMPER. PROVIDE A REMOVABLE DUCT SECTION WHERE DUCT SIZE IS TOO SMALL FOR A 10" BY 10" ACCESS DOOR.
- 22. LOCATE AND SET THERMOSTATS AND HUMIDISTATS AT LOCATIONS SHOWN ON PLANS. VERIFY EXACT LOCATIONS WITH ARCHITECT PRIOR TO INSTALLATION. INSTALL DEVICES WITH TOP OF DEVICE AT MAXIMUM 48" AFF TO MEET ADA REQUIREMENTS UNLESS NOTED OTHERWISE ON PLANS. PROVIDE INSULATED BACKING FOR THERMOSTATS MOUNTED ON EXTERIOR BUILDING WALLS. INSTALL WIRING IN CONDUIT PROVIDED BY DIVISION 26. AT A MINIMUM, PROVIDE CONDUIT IN THE WALL FROM THE JUNCTION BOX TO 6" ABOVE THE CEILING.
- 23. COORDINATE THE LOCATION AND ELEVATION OF WALL-MOUNTED DEVICES WITH PRESENTATION BOARDS, DISPLAY CABINETS, SHELVES OR OTHER COMPONENTS SHOWN ON THE ARCHITECTURAL DRAWINGS THAT ARE TO BE INSTALLED UNDER OTHER DIVISIONS. CONTRACTOR WILL NOT BE REIMBURSED FOR RELOCATION OF WALL-MOUNTED DEVICES CAUSED BY A LACK OF COORDINATION.
- 24. PROVIDE A MANUAL BALANCING DAMPER IN EACH DUCT TAKEOFF FROM SUPPLY, RETURN, OUTDOOR AND EXHAUST AIR DUCTS.
- 25. PROVIDE A PREFABRICATED 45 DEGREE, HIGH EFFICIENCY, RECTANGULAR/ROUND BRANCH DUCT TAKEOFF FITTING FOR BRANCH DUCT CONNECTIONS AND TAKE-OFFS TO INDIVIDUAL DIFFUSERS, REGISTERS AND GRILLES. PROVIDE WITH INTEGRAL MANUAL BALANCING DAMPER AND LOCKING QUADRANT WHERE INDICATED ON DIANS
- 26. BRANCH DUCTWORK TO AIR OUTLETS SHALL BE SAME SIZE AS OUTLET NECK SIZE UNLESS OTHERWISE NOTED.
- 27. REFER TO SPECIFICATIONS FOR DUCTWORK AND PIPING INSULATION REQUIREMENTS. DUCT SIZES ON MECHANICAL PLANS INDICATE CLEAR INSIDE AIRFLOW DIMENSIONS, INCREASE SHEET METAL SIZES ACCORDINGLY TO ACCOUNT FOR THICKNESS OF DUCT LINER.
- 28. FLEXIBLE DUCTWORK SHALL NOT EXCEED 5'-0" IN LENGTH AND SHALL BE INSTALLED AND SUPPORTED TO AVOID SHARP BENDS AND SAGGING. REFER TO SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.
- 29. PROVIDE EQUIPMENT VENTS AND FLUES PER EQUIPMENT MANUFACTURERS RECOMMENDATIONS AND EQUIPMENT SPECIFICATIONS. KEEP PENETRATIONS THROUGH ROOF A MINIMUM OF 10'-0" FROM HVAC EQUIPMENT FRESH AIR INLETS AND 2'-0" FROM ROOF PARAPETS.
- 30. PROVIDE WALL MOUNTED LOUVERS AND DAMPERS WITH SUITABLE MOUNTING FRAME TO MATCH WALL CONSTRUCTION. COORDINATE WITH ARCHITECTURAL
- 31. PROVIDE A NEW SET OF AIR FILTERS IN UNITS PRIOR TO TESTING, ADJUSTING AND BALANCING AND BEFORE TURNING SYSTEM(S) OVER TO OWNER.
- 32. FIELD VERIFY THAT THE EXISTING EQUIPMENT INCLUDING ACCESSORIES BEING REUSED FOR THIS PROJECT IS NOT DAMAGED AND IS IN GOOD WORKING ORDER. REPORT ANY DEFICIENCIES TO THE OWNER OR ARCHITECT. SUBMIT TO THE OWNER AND ARCHITECT A WRITTEN REPORT DESCRIBING TESTS PERFORMED TO VERIFY OPERATION AND RESULTS OF THE TESTS.
- 33. CLEAN EXISTING EQUIPMENT AND EQUIPMENT COMPONENTS BEING REUSED FOR THIS PROJECT. PROVIDE NEW FILTERS FOR EXISTING AIR HANDLING EQUIPMENT PRIOR TO STARTUP OF EQUIPMENT. NEW FILTERS SHALL BE COMPATIBLE WITH THE EXISTING EQUIPMENT AND EQUAL IN PERFORMANCE TO THE EXISTING FILTERS AT NEW CONDITION UNLESS OTHERWISE NOTED. CLEAN STRAINERS IN PIPING SYSTEMS PRIOR TO STARTING PUMPS.
- 34. CLEAN THE EXTERIOR OF EXISTING COILS TO BE REUSED FOR THIS PROJECT. VACUUM BRUSH THE COIL IN THE DIRECTION OF THE FINS AND CLEAN THE COILS WITH COIL CLEANING FLUID. COMB ANY FINS BENT TO PROVIDE A STRAIGHT SURFACE FOR AIRFLOW.
- 35. LUBRICATE EXISTING EQUIPMENT BEING REUSED FOR THIS PROJECT IN ACCORDANCE WITH MANUFACTURER'S WRITTEN INSTRUCTIONS. OBTAIN INSTRUCTIONS FROM MANUFACTURER IF THEY ARE NOT AVAILABLE AT THE SITE.
- 36. FULLY CHARGE EXISTING REFRIGERANT SYSTEMS BEING REUSED FOR THIS PROJECT IN ACCORDANCE WITH MANUFACTURER'S WRITTEN INSTRUCTIONS. CHARGE SYSTEMS WITH NEW REFRIGERANT MATCHING EXISTING.

multistudio

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086 N LSW: 2600 SW Ward Rd, Lee's Summit MO 64082

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

owner: architect:

Lee's Summit R-7 School

301 NE Tudor Road
Lee's Summit, MO 64086

Kansas City, MO 64111

816.931.6655
multi.studio

civil engineer: structural engineer:

Kaw Valley Engineering Bob D. Campbell & Company, Inc.

14700 West 114th Terrace
Lenexa, KS 66215 Kansas City, MO 64111

913.485.0318 816.531.4144

Lenexa, KS 66215 Kansas City, MO 64111
913.485.0318 816.531.4144
kveng.com www.bdc-engrs.com

MEPFT/Code::
Henderson Engineers
8345 Lenexa Drive, Suite
300
Lenexa, KS 66214
816.742.5000

www.hendersonengineers.com


HENDERSON
ENGINEERS

8345 LENEXA DRIVE, SUITE 300
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001

WWW.HENDERSONENGINEERS.COM


2150005255
MO. CORPORATE NO: E-556D
EXPIRES 12/31/2022

Revisions
NUMBER DESCRIPTION DATE



LSHS - MECHANICAL
GENERAL NOTES AND
LEGEND

\[\lambda \cdot \cdot

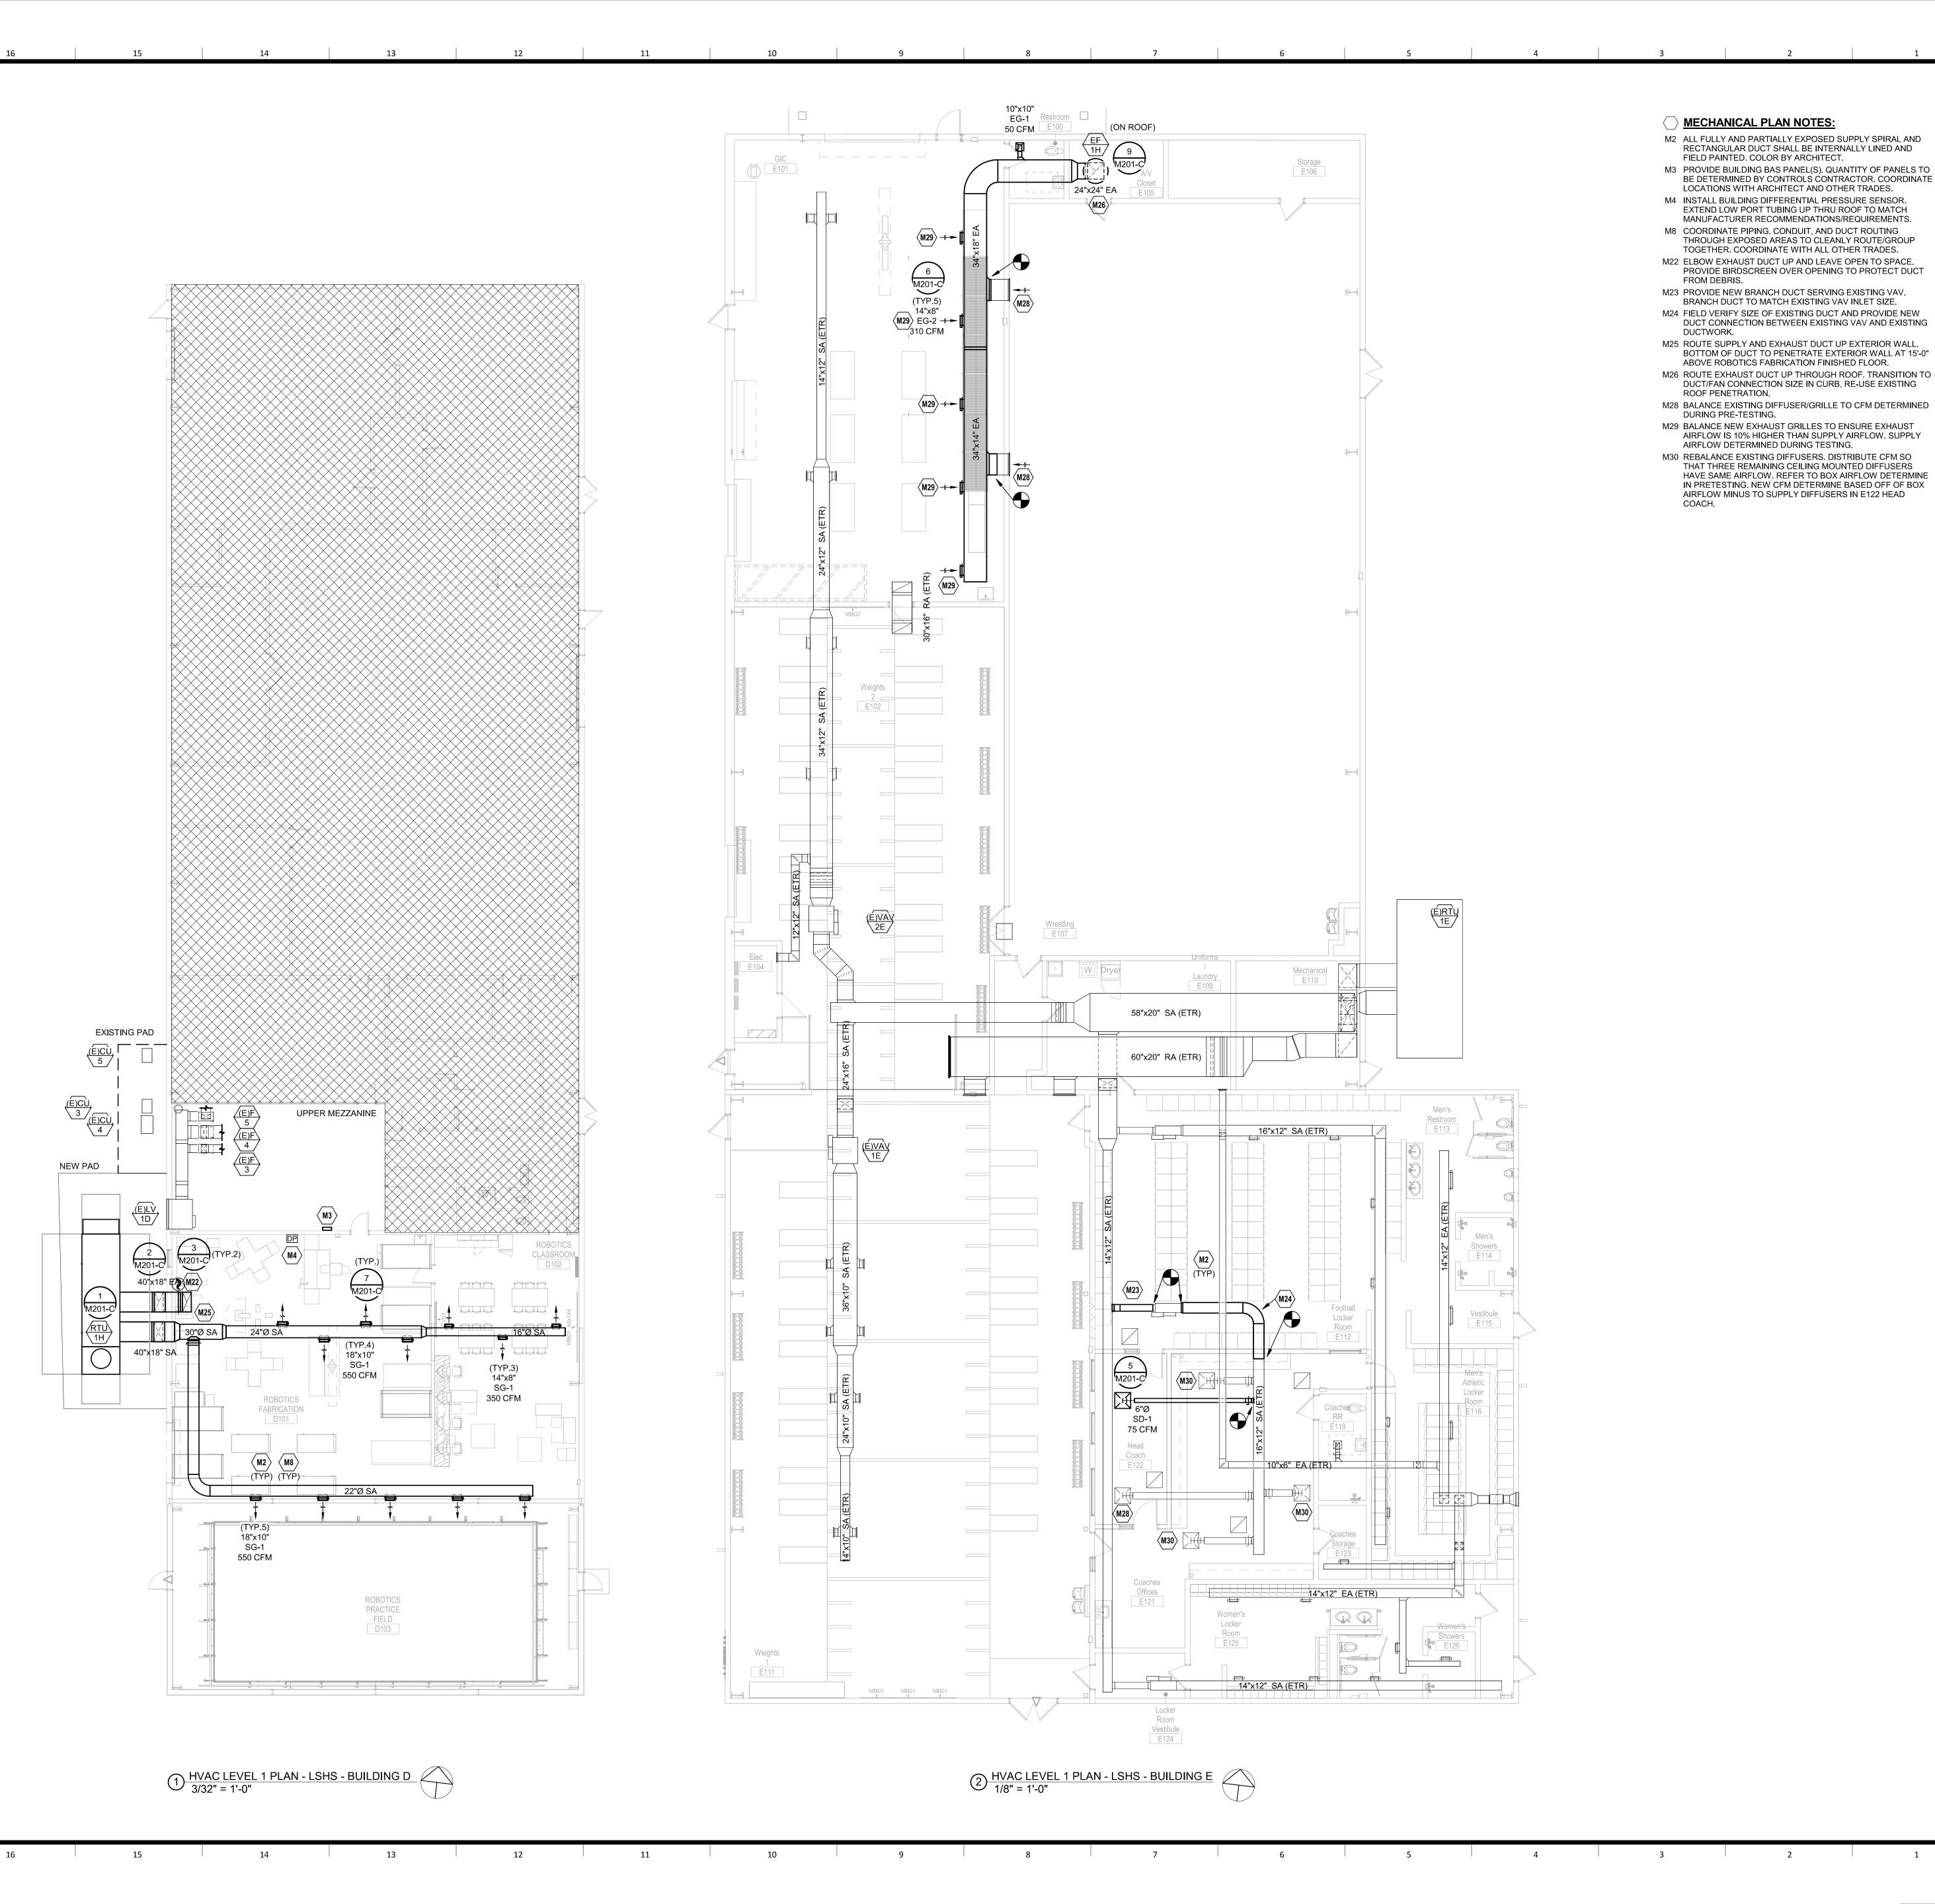

LSR7 Robotics, GiC & **Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO N LSW: 2600 SW Ward Rd, Lee's Summit MO 64082

> LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063 0121-0100

> > structural engineer:

Kansas City, MO 64111

www.bdc-engrs.com

816.531.4144

Lee's Summit R-7 School Multistudio 301 NE Tudor Road 4200 Pennsylvania Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655 multi.studio

Kaw Valley Engineering Bob D. Campbell & Company, Inc. M28 BALANCE EXISTING DIFFUSER/GRILLE TO CFM DETERMINED 14700 West 114th Terrace 4338 Belleview Lenexa, KS 66215 913.485.0318

AIRFLOW IS 10% HIGHER THAN SUPPLY AIRFLOW. SUPPLY kveng.com AIRFLOW DETERMINED DURING TESTING. M30 REBALANCE EXISTING DIFFUSERS. DISTRIBUTE CFM SO THAT THREE REMAINING CEILING MOUNTED DIFFUSERS HAVE SAME AIRFLOW. REFER TO BOX AIRFLOW DETERMINE

MEPFT/Code:: **Henderson Engineers** 8345 Lenexa Drive, Suite Lenexa, KS 66214 816.742.5000

www.hendersonengineers.com

8345 LENEXA DRIVE, SUITE 300 LENEXA, KS 66214 TEL 913.742.5000 FAX 913.742.5001


September 9, 2022



LSHS - HVAC PLAN -


LEVEL 1 - BUILDING D &

M101-C

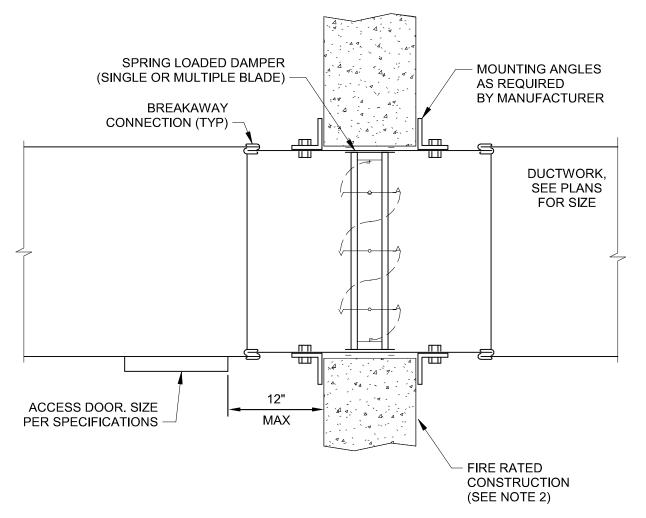


- INSTALL DAMPER PER MANUFACTURER'S INSTRUCTIONS/RECOMMENDATIONS. . MAKE PENETRATION OPENING 1/8" PER FOOT LARGER THAN DAMPER DIMENSIONS WITH 1/4" MINIMUM REQUIRED, MAXIMUM 1". 3. INSTALL ACCESS DOOR (WHEN REQUIRED) IN AN ACCESSIBLE LOCATION FOR MAINTENANCE
- IN ACCORDANCE WITH NFPA REQUIREMENTS. 4. FRAME OUT OPENINGS FOR MULTIPLE SECTION INSTALLATIONS OR PROVIDE FALSE MULLIONS TO SUPPORT MULTIPLE SECTION INSTALLATIONS PER MANUFACTURER'S RECOMMENDATIONS.

4 FIRE DAMPER IN WALL DETAIL NTS

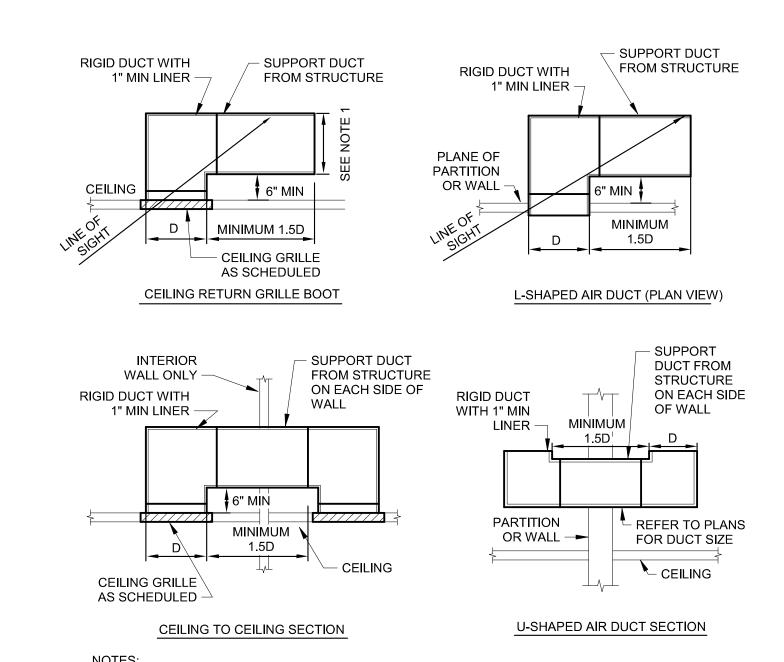

1. REFER TO FLOOR PLAN FOR OUTLET DEPTH. WHEN NO DEPTH IS SHOWN, MINIMUM DEPTH SHALL

BE AS REQUIRED TO LIMIT AIR VELOCITY TO 500 FPM WITH A MINIMUM SIZE OF 0.5D.

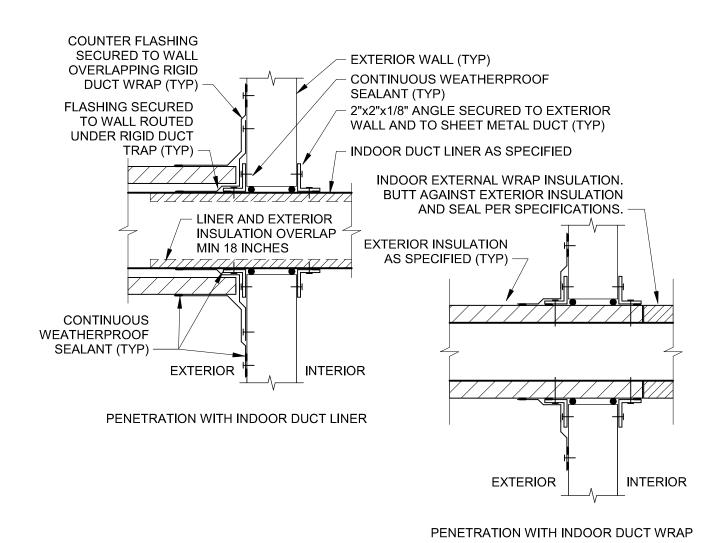

1. COORDINATE SIZE AND LOCATION OF DUCT WITH STRUCTURAL ENGINEER AND ARCHITECTURAL

ROUND SUPPLY DUCT

- SUPPLY GRILLE OR

TODUCT COLLAR.

FOR NECK SIZE

DIFFUSER SECURED

REFER TO DRAWINGS

- OVERSIZE DUCT

REGISTER FLANGE.

REFER TO DWG.'S FOR

REGISTER NECK SIZE.

COLLAR TO FIT

SIDE VIEW

END VIEW

SADDLE TYPE DUCT

INVERTED DUCT

COLLAR -

ROUND SUPPLY DUCT -


SADDLE TYPE DUCT

7 REGISTER MOUNTING TO ROUND DUCT DETAIL NTS


WITH NEOPRENE


GASKET (TYPICAL) -

WITH NEOPRENE GASKET -

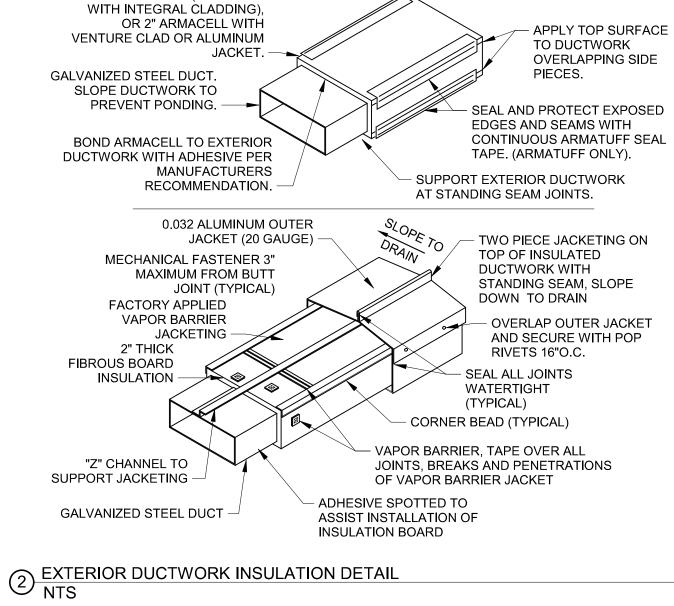


2" ARMATUFF (ARMACELL

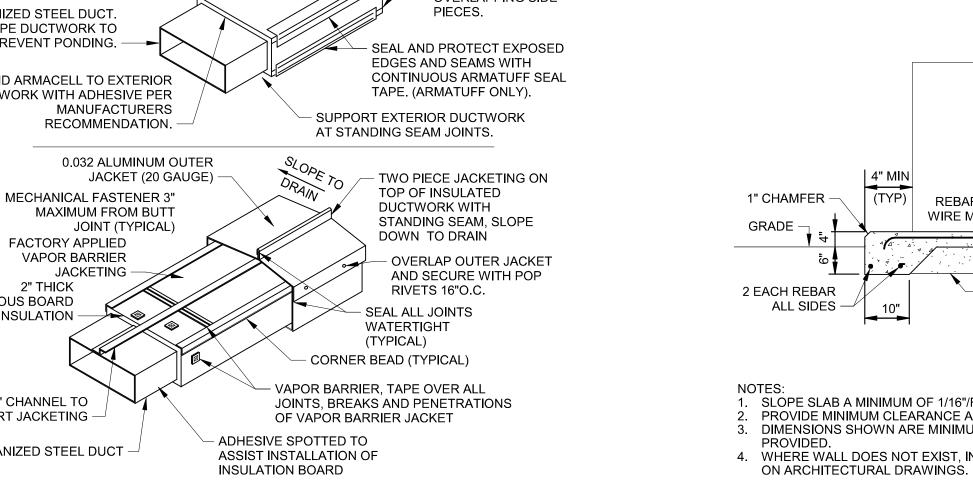

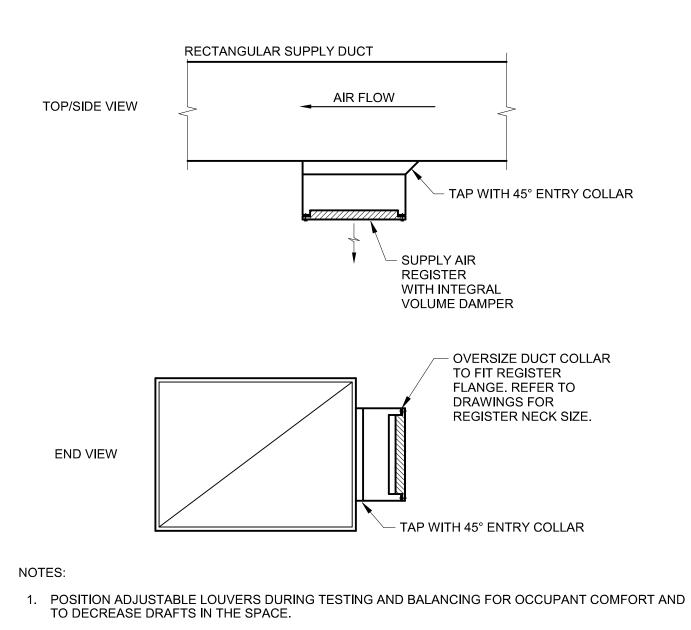




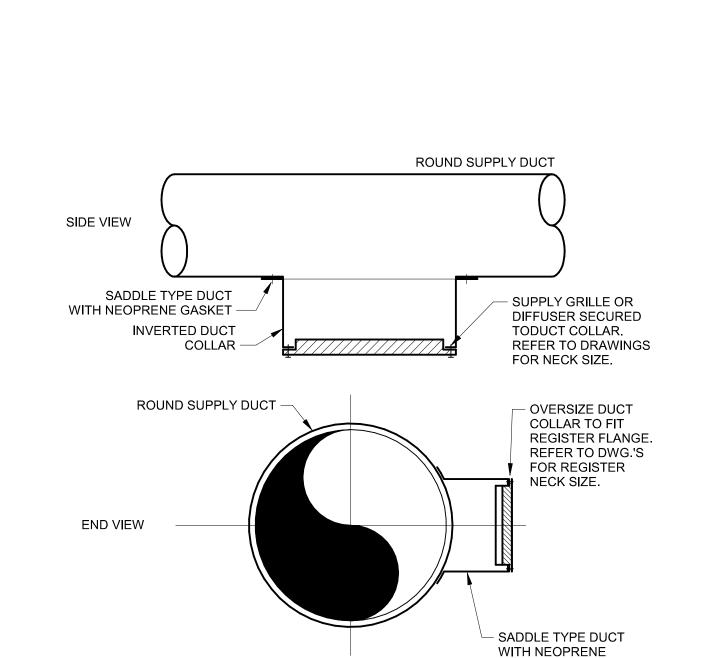


10 REGISTER MOUNTING TO ROUND DUCT DETAIL - NO ANGLE NTS

GASKET (TYPICAL)

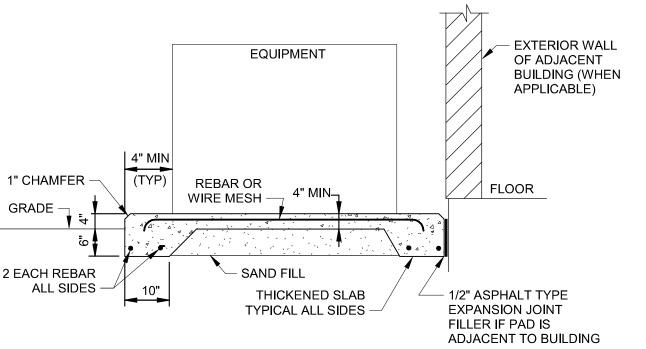


1. SLOPE SLAB A MINIMUM OF 1/16"/FOOT IN ONE DIRECTION (AWAY FROM BUILDING) FOR DRAINAGE. PROVIDE MINIMUM CLEARANCE AROUND EQUIPMENT, ALL SIDES, PER MANUFACTURER. DIMENSIONS SHOWN ARE MINIMUM ACCEPTABLE; REVISE AS REQUIRED FOR EQUIPMENT BEING 4. WHERE WALL DOES NOT EXIST, INSTALL EQUIPMENT IN CENTER OF PAD AND ENCLOSE AS SHOWN

1 EXTERIOR EQUIPMENT PAD DETAIL NTS

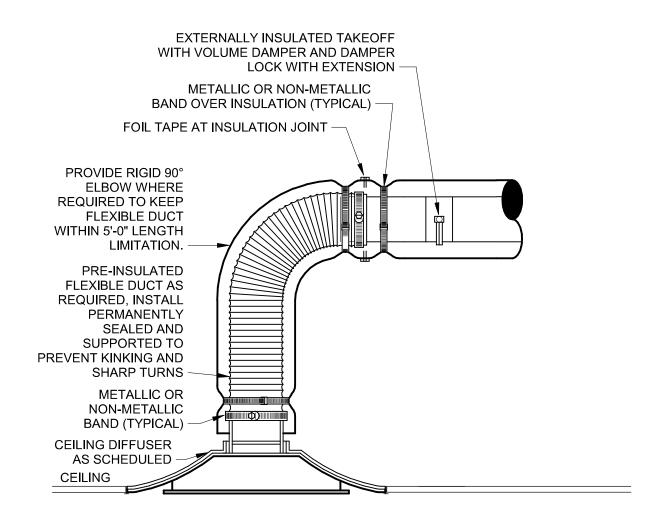

 FLEXIBLE DUCT LENGTH MAY NOT EXCEED 5'-0". EXTEND RIGID DUCT AS REQUIRED. 2. REFER TO SPECIFICATIONS FOR FLEXIBLE DUCTWORK INSTALLATION REQUIREMENTS.

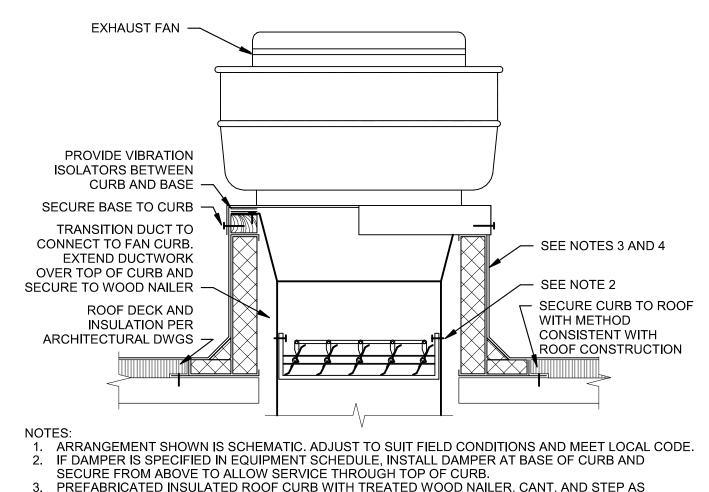

PREFABRICATED INSULATED ROOF CURB WITH TREATED WOOD NAILER, CANT, AND STEP AS REQUIRED TO ACCOMMODATE ROOF INSULATION. FRAME AND SECURE CURB TO ROOF WITH METHOD CONSISTENT WITH ROOF CONSTRUCTION. ROOF CURB SHALL BEAR ON ROOF STRUCTURE. REFER TO ARCHITECTURAL DRAWINGS AND CURB MANUFACTURER'S DETAILS FOR MORE INFORMATION.

4. FOR SLOPED ROOFS, PROVIDE CURB WITH DIMENSIONS CAPABLE OF COMPENSATING ROOF SLOPE TO ENSURE FAN IS INSTALLED LEVEL. HIGH WIND STRAPPING: PROVIDE STAINLESS STEEL STRAPS OF LENGTH, WIDTH, THICKNESS, AND SPACING SUFFICIENT TO SECURE FAN TO CURB TO WITHSTAND WIND SPEED REQUIREMENTS PER

LSR7 Robotics, GiC & **Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO LSW: 2600 SW Ward Rd, Lee's Summit MO 64082

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063 0121-0100

Lee's Summit R-7 School Multistudio 301 NE Tudor Road 4200 Pennsylvania Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655 multi.studio


structural engineer: Kaw Valley Engineering Bob D. Campbell & Company, Inc. 14700 West 114th Terrace 4338 Belleview Lenexa, KS 66215 Kansas City, MO 64111 913.485.0318 816.531.4144 www.bdc-engrs.com kveng.com

MEPFT/Code:: **Henderson Engineers** 8345 Lenexa Drive, Suite Lenexa, KS 66214

816.742.5000 www.hendersonengineers.com

> 8345 LENEXA DRIVE, SUITE 300 LENEXA, KS 66214 **TEL** 913.742.5000 **FAX** 913.742.5001 WWW.HENDERSONENGINEERS.COM MO. CORPORATE NO: E-556D EXPIRES 12/31/2022

Issue Date: September 9, 2022 Revisions



LSHS - MECHANICAL DETAILS

ROOFTOP UNIT W/ STATIC CORE ENERGY RECOVERY WHEEL SCHEDULE (DX COOLING, NATURAL GAS HEATING) - LSHS SUPPLY FAN NATURAL GAS HEAT EXCHANGER ELECTRICAL MAX PLATE OAT EXAUST EAT WHEEL SA LAT EXHAUST LAT | WHEEL SA LAT LAT NOM (°F | MIN OUT | INPUT | MIN | EAT | LAT | MIN NO | MAX VEL | O/A | MIN. MIN NO | MIN EFF | MAX VEL | CAP. | EAT | (°F | OAT | ESP NOM ECM PRESSURE NOMINAL UNIT TYPE | TYPE | CFM (N) (IN) | (IN) (N) BHP | HP | (Y/N) | CFM | (IN) | BHP | HP | (Y/N) | DROP (IN) | (°F DB) | (°F D NOTES MARK MANUFACTURER MODEL TONS

MODEL NUMBERS AND NOMINAL TONS LISTED SHALL NOT BE CONSIDERED COMPLETE AND MATERIAL SHALL NOT BE ORDERED BY MANUFACTURER, MODEL NUMBERS, OR NOMINAL TONS ONLY. REVIEW THE COMPLETE DESCRIPTION, NOTES AND SPECIFICATIONS TO DETERMINE THE EXACT MATERIAL AND ACCESSORIES TO BE ORDERED. THE MANUFACTURERS LISTED ARE THE BASIS FOR THE DESIGN.

B,D,E,F,G,J

A,B,C,F

0.08

0.08

REFER TO SHEET M402-C FOR CUSTOM ROOFTOP UNIT CONTROL DRAWING, POINTS LIST, AND SEQUENCE. EQUIPMENT SIZED FOR 100°F AMBIENT TEMPERATURE.

PROVIDE 2" MERV 13, EFFICIENT PLEATED THROWAWAY AIR FILTERS.

DIV. 26 TO PROVIDE FUSED DISCONNECT. STARTERS FOR ALL MOTORS SHALL BE FURNISHED INTEGRAL WITH UNIT.

PROVIDE SINGLE POINT POWER CONNECTION. COORDINATE SIZE OF CONDUCTOR TERMINATION LUGS WITH CONDUCTOR SIZES SHOWN ON ELECTRICAL DRAWINGS.

PROVIDE 125 VAC, 20 AMP DUPLEX CONVENIENCE RECEPTACLE MOUNTED TO UNIT READY FOR FIELD WIRING WITH A COVER UL LISTED FOR WET AND DAMPER LOCATIONS WHEN IN USE. SPECIFIED FAN ESP ACCOUNTS FOR DUCT LOSSES EXTERNAL TO UNIT.

SPECIFIED FAN TSP INCLUDES EXTERNAL DUCT AND INTERNAL FILTER, COIL, AND CASING LOSSES. FILTER LOSS IS AT A MAXIMUM OF 400 FPM FACE VELOCITY. PROVIDE MOTOR HORSEPOWER TO OVERCOME INTERNAL UNIT STATIC PRESSURE DROP PLUS SPECIFIED EXTERNAL STATIC PRESSURE DROP. NOMINAL MOTOR HP SHALL BE NO LARGER THAN THE FIRST AVAILABLE NOMINAL MOTOR SIZE

GREATER THAN THE REQUIRED BHP.

PROVIDE INSULATED HORIZONTAL DISCHARGE CURB MOUNTED ON GRADE. SCHEDULED WEIGHT IS THE MAXIMUM ALLOWABLE OPERATING WEIGHT OF THE EQUIPMENT AND CURB.

COOLING COIL LAT IS LEAVING AIR TEMPERATURE OF COIL. PROVIDE GUARDS TO PROTECT CONDENSER COIL FROM HAIL OR OTHER DAMAGE.

PROVIDE UNIT WITH INTERNAL VIBRATION ISOLATION.

PROVIDE HEATER TO MEET OR EXCEED SCHEDULED MINIMUM MBH OUTPUT. NOMINAL INPUT IS BASED ON LISTED MANUFACTURER'S STANDARD PRODUCT. COORDINATE EQUIPMENT GAS LOAD WITH PLUMBING CONTRACTOR IF DIFFERENT FROM THAT SCHEDULED. MEET MINIMUM EFFICIENCY SCHEDULED.

SELECT EQUIPMENT FOR ELEVATION OF 1000 FEET ABOVE SEA LEVEL. PROVIDE UNIT WITH FULLY MODULATING HOT GAS REHEAT.

PROVIDE UNIT WITH STATIC CORE ENERGY RECOVERY DEVICE. DAIKIN IS BASIS OF DESIGN. ACCEPTABLE MANUFACTURERS ARE VALENT AND AAON. REFER TO UNIT MAX DIMENSIONS IN SCHEDULE.

						. / 🗤	1 001				, i i C	,				
													ELECTRICAL			
	SERVICE					ESP		NOM	FAN	DRIVE	VFD			STARTER		
MARK	DESCRIPTION	MANUFACTURER	MOUNTING	MODEL	CFM	(IN)	BHP	HP	RPM	(BELT/DIRECT)	(Y/N)	V/PH	DISC TYPE	TYPE	WEIGHT (LBS)	NOTES
EF 1H	GIC EXHAUST	GREENHECK	ROOF	CUE-161-VG	4800	0.5	1.9	2.00	1725	DIRECT	Yes	208/1	NF	EC	125	A-E

MODEL NUMBERS SHALL NOT BE CONSIDERED COMPLETE AND MATERIAL SHALL NOT BE ORDERED BY MANUFACTURER AND MODEL NUMBERS ONLY. REVIEW THE COMPLETE DESCRIPTION, NOTES AND SPECIFICATIONS TO DETERMINE THE EXACT MATERIAL AND ACCESSORIES TO BE ORDERED. THE MANUFACTURERS LISTED ARE THE BASIS FOR THE DESIGN.

FLANGED

LAY-IN

REFER TO PLANS

24"x24"

PROVIDE INSULATED ROOF CURB WITH MINIMUM HEIGHT REQUIRED TO MAINTAIN BOTTOM OF EQUIPMENT A MINIMUM OF 16 INCHES ABOVE FINISHED ROOF SURFACE.

PLAQUE

COORDINATE WITH ROOF INSULATION THICKNESS AND ROOF TAPER AT INSTALLED LOCATION. PROVIDE BIRDSCREEN AND GRAVITY BACKDRAFT DAMPER.

PROVIDE FACTORY MOUNTED DISCONNECT SWITCH.

RETURN

SUPPLY

PROVIDE WITH MANUFACTURER'S ELECTRONICALLY COMMUTATED (EC) MOTOR. NOMINAL MOTOR HP SHALL BE NO LARGER THAN THE FIRST AVAILABLE NOMINAL MOTOR SIZE GREATER THAN THE BHP.

		GF	RILLE,	REGIST	ER A	ND DIFFUS	SER SC	HEDULE - L	SHS)	
MARK	MANUFACTURER	SERVICE	MODEL	CONSTRUCTION TYPE	FACE TYPE	MOUNTING LOCATION	BORDER TYPE	FACE SIZE (IN)	MAX NC	MAX PRESS DROP (IN W.C.)	NOTES
EG-1	PRICE	EXHAUST	80	ALUMINUM	EGG CRATE	CEILING	LAY-IN	12"x12"	20	0.08	C,F,H
EG-2	PRICE	EXHUAST	600	ALUMINUM	LOUVERED	DUCT	FLANGED	REFER TO PLANS	20	0.00	B,D,E,G,J

SIDEWALL

CEILING

PRICE SUPPLY 500 STEEL LOUVERED DUCT FLANGED REFER TO PLANS 20 0.08 B,D,E,G,JMODEL NUMBERS SHALL NOT BE CONSIDERED COMPLETE AND MATERIAL SHALL NOT BE ORDERED BY MANUFACTURER AND MODEL NUMBERS ONLY. REVIEW THE COMPLETE DESCRIPTION, NOTES AND SPECIFICATIONS TO DETERMINE THE EXACT MATERIAL AND ACCESSORIES TO BE ORDERED. THE MANUFACTURERS LISTED ARE THE BASIS FOR THE DESIGN.

NOTES:

SD-1

PRICE

4-WAY THROW PATTERN UNLESS OTHERWISE INDICATED BY FLOW ARROWS ON DRAWINGS. [PROVIDE ONE SPARE LOOSE BLANK-OFF DEFLECTOR PER DIFFUSER FOR USE DURING BALANCING AS REQUIRED.] NECK SIZE SHOWN ON DRAWINGS. PROVIDE BRANCH DUCT TO MATCH NECK SIZE UNLESS OTHERWISE SHOWN ON DRAWINGS.

BAKED ENAMEL FINISH, WHITE TO MATCH CEILING COLOR. FRONT BLADES PARALLEL TO LONG DIMENSION.

DOUBLE DEFLECTION BARS SHALL BE ADJUSTABLE. FRAME TYPE TO MATCH CEILING/WALL CONSTRUCTION, COORDINATE WITH ARCHITECTURAL REFLECTED CEILING/WALL PLAN.

ALUMINUM

STEEL

PAINT ALL INTERIOR SURFACES SLOTS, GRILLES AND PLENUMS FLAT BLACK. PROVIDE WITH RAPID MOUNT FRAMING OPTION FOR LAY-IN TYPE DIFFUSERS INSTALLED IN A HARD CEILING.

ASPD

PROVIDE GRILLE PRIMED FOR FIELD PAINTING.

LSR7 Robotics, GiC & **Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO LSW: 2600 SW Ward Rd, Lee's Summit MO 64082

ROOFTOP UNIT SIZE - LSHS

PLAN MARK UNIT LENGTH (FT-IN) UNIT WIDTH (FT-IN) UNIT HEIGHT (FT-IN) SIZE NOTES

18'-3"

UNIT WIDTH AND LENGTH INCLUDE CLEARANCE REQUIREMENTS.

HEIGHT INCLUDES HORIZONTAL DISCHARGE CURB HEIGHT.

9'-3"

35'-3"

NOTES:

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063 0121-0100


Lee's Summit R-7 School Multistudio 301 NE Tudor Road 4200 Pennsylvania Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655 multi.studio

structural engineer: Kaw Valley Engineering Bob D. Campbell & Company, Inc. 14700 West 114th Terrace 4338 Belleview Lenexa, KS 66215 Kansas City, MO 64111 913.485.0318 816.531.4144 www.bdc-engrs.com kveng.com

MEPFT/Code:: **Henderson Engineers** 8345 Lenexa Drive, Suite Lenexa, KS 66214 816.742.5000 www.hendersonengineers.com


> 8345 LENEXA DRIVE, SUITE 300 LENEXA, KS 66214 TEL 913.742.5000 FAX 913.742.5001 WWW.HENDERSONENGINEERS.COM MO. CORPORATE NO: E-556D EXPIRES 12/31/2022


Issue Date: September 9, 2022 Revisions Addendum 01




CARL J. HOLDEN 09/15/2022 LICENSE # PE-2020016283


LSHS - MECHANICAL SCHEDULES

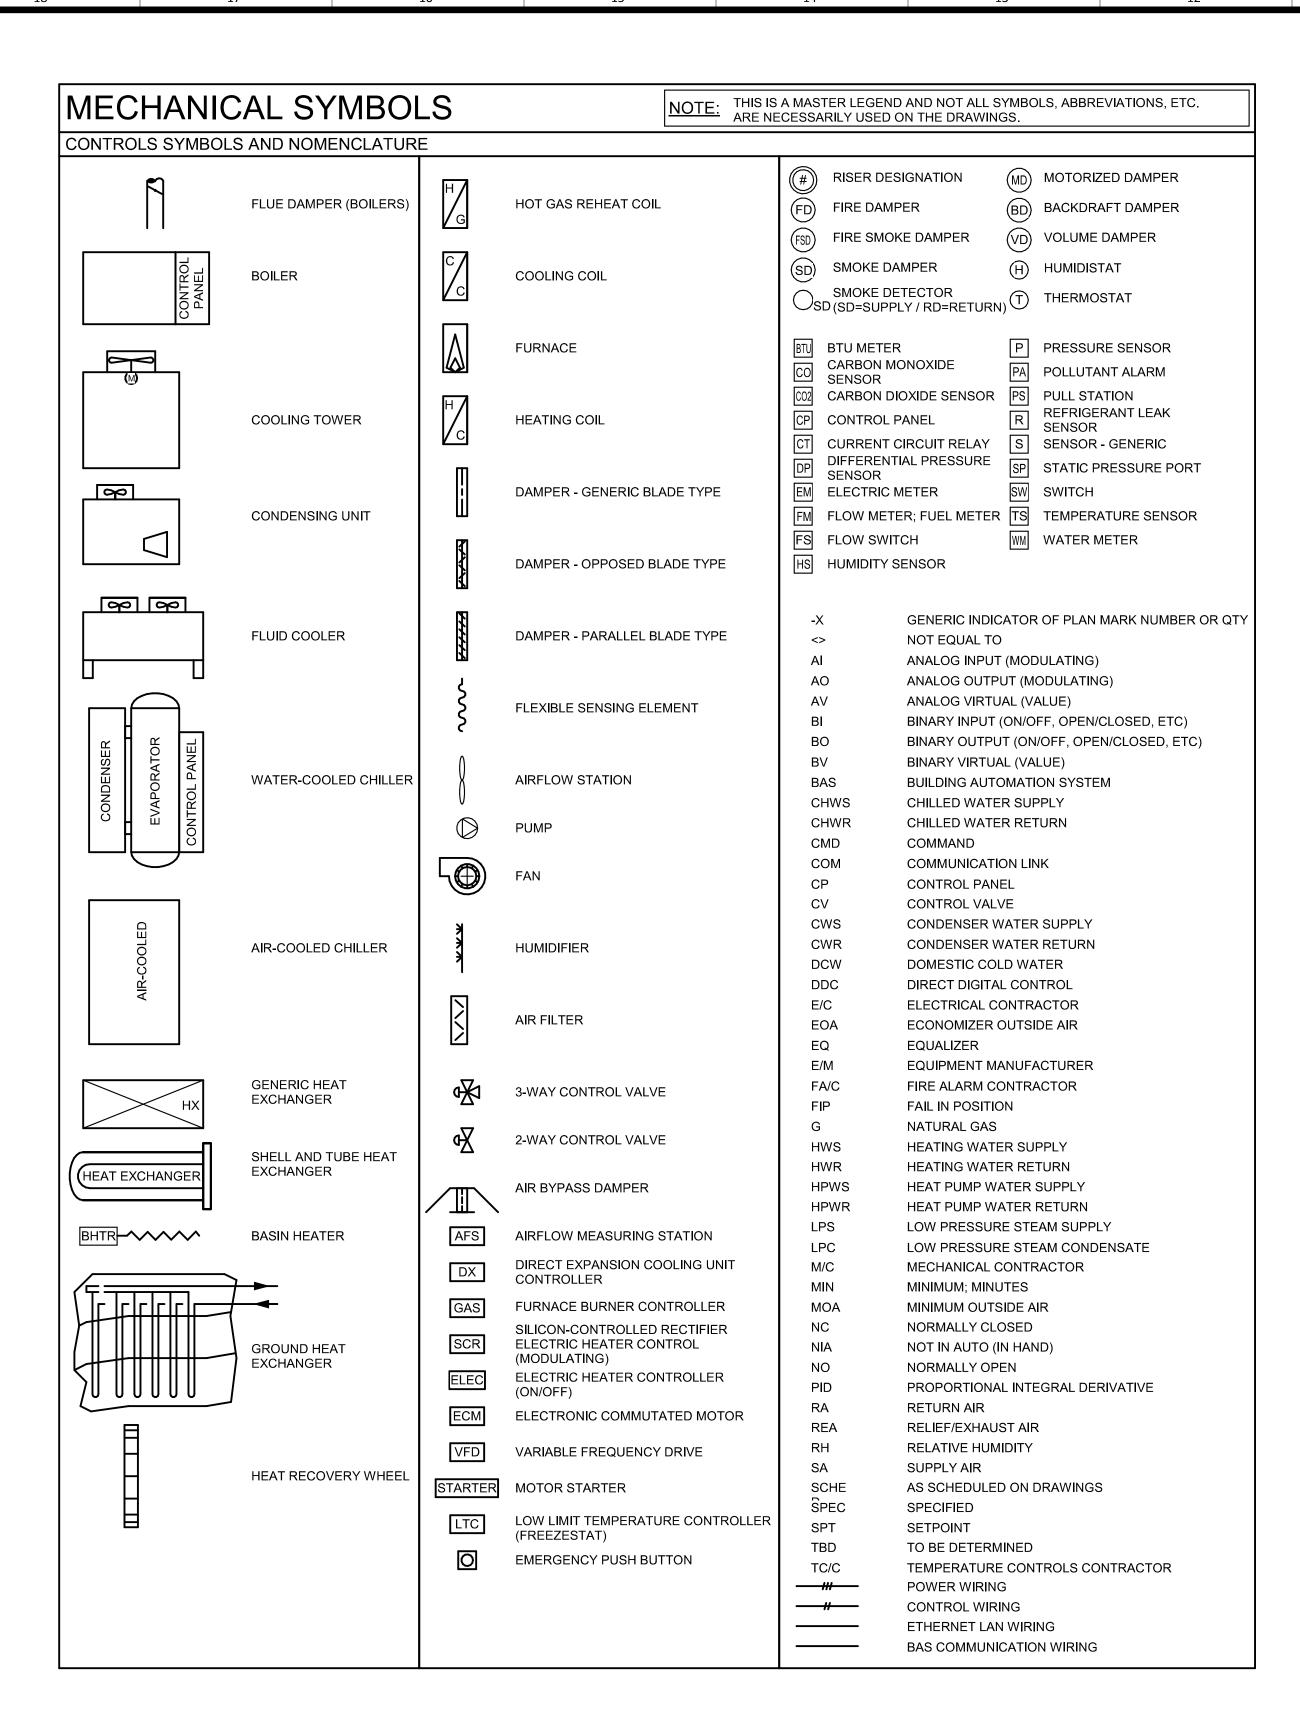


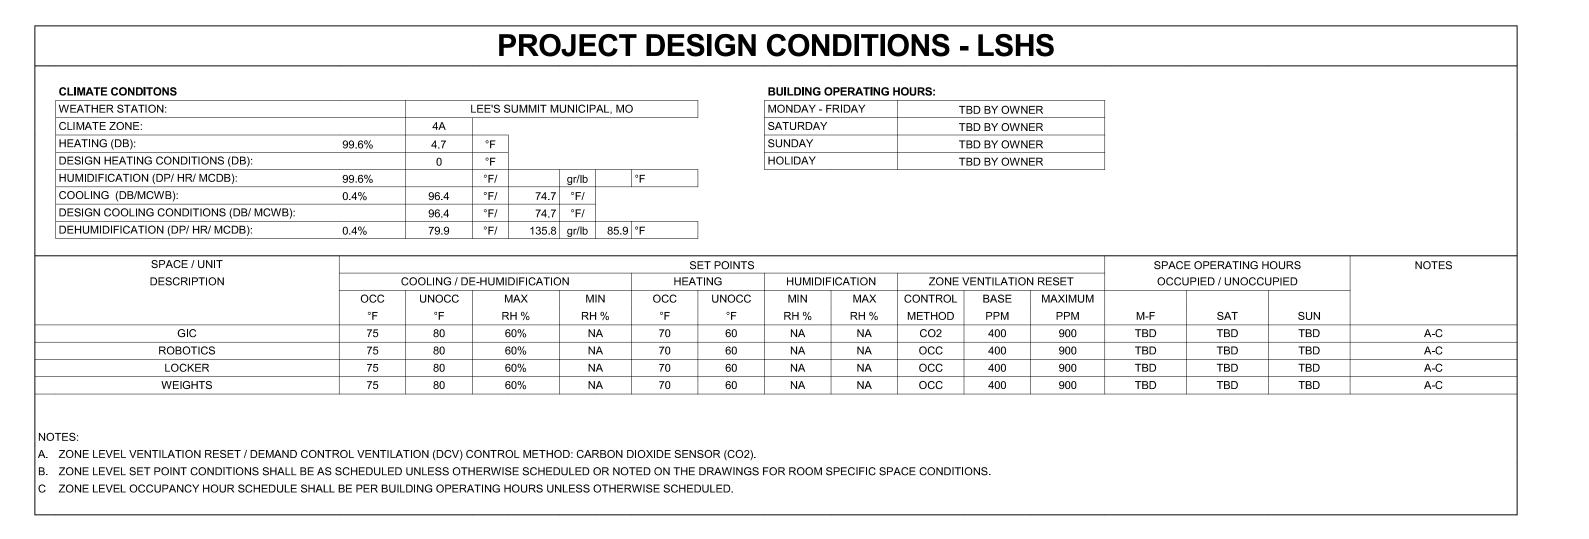

POINT ID	DESCRIPTION	POINT	UNITS	ACCURACY	TRENDING	ENERGY	STATUS	ALARM	NOTES
		TYPE			INTERVAL	DASHBOARD	ALARM	RANGE	
						DISPLAY			
ILDING SENSORS									
BDP	BUILDING DIFFERENTIAL PRESSURE	Al	IN. W.G.	SPEC	15 MIN.	X	X	-0.15 > BDP > +0.20	A, B
OACO2	OUTSIDE AIR CARBON DIOXIDE LEVEL	Al	PPM	SPEC	15 MIN.				
OAT	OUTSIDE AIR DRY BULB TEMPERATURE	Al	°F	SPEC	15 MIN.	X			
OAH	OUTSIDE AIR RELATIVE HUMIDITY	Al	%	SPEC	15 MIN.	X			





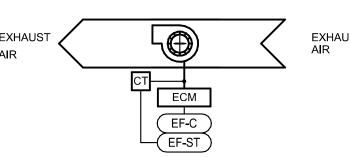


ALARM


RANGE

EF-C=ON, EF-ST=OFF

NOTES







SEQUENCE OF OPERATIONS MISCELLANEOUS EQUIPMENT

This sequence of operations is organized into the following main categories: safeties, overrides and interlocks, and component control loops

either enable or disable the various modes of operation. If a mode of operation is not listed within a component control loop section then that mode of operation has no direct influence on the operation of the component. The control setpoint reset section describes the logic and reference variables that will be used to reset control setpoints to a new value within its reset range. The safeties and interlocks section outlines the hardwired interlocks that will be required to meet life safety requirements. Safeties and interlocks take precedence over all other control strategies outlined in this document. The control responses of each component for the various modes of operation are described in the component control

Ioop sections.

The sequence of operations, the points list and control diagrams shall be used to provide a complete description of the control philosophy for the controlled equipment. Individual setpoint values, reset ranges, and alarm action levels are listed in the points list. Components and control sensor locations are graphically depicted on the control diagram.

EXHAUST FANS (EF-XX)

OPERATING MODES
OCCUPIED MODE:

The units shall be in occupied mode per the project design conditions schedule shown on the control drawings.

UNOCCUPIED MODE:

The units shall be in unoccupied mode for all periods not included in the occupied hours of operation.

COMPONENT CONTROL LOOPS

FAN CONTROL - CONSTANT VOLUME BMS SCHEDULED

When in Occupied Mode:
The fan shall be ON.

When in Unoccupied Mode: The fan shall be OFF. POINT ID DESCRIPTION POINT DEFAULT FAIL STATUS TYPE SETPOINT POSITION ALARM

EXHAUST FANS (EF-1H)

EF-C EXHAUST FAN COMMAND (START/STOP) BO SEF-ST EXHAUST FAN STATUS (CT) BI X

A. POINTS APPLY TO MULTIPLE UNITS. SEE CONTROL DIAGRAMS FOR NUMBER OF UNITS.

C. ALARM TO SIGNAL AFTER 30 SECOND TIME DELAY (ADJ.)
D. ALARM TO SIGNAL AFTER 10 MINUTE TIME DELAY (ADJ.)

multistudio

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086 N LSW: 2600 SW Ward Rd, Lee's Summit MO 64082

owner: architect:
Lee's Summit R-7 School Multistudio

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

301 NE Tudor Road
Lee's Summit, MO 64086
Kansas City, MO 64111
816.931.6655
multi.studio

civil engineer:
Kaw Valley Engineering
14700 West 114th Terrace
4338 Belleview

Lenexa, KS 66215 Kansas City, MO 64111
913.485.0318 816.531.4144
kveng.com www.bdc-engrs.com

MEPFT/Code::
Henderson Engineers
8345 Lenexa Drive, Suite

Henderson Engineers
8345 Lenexa Drive, Suite
300
Lenexa, KS 66214
816.742.5000
www.hendersonengineers.com


HENDERSON
ENGINEERS

8345 LENEXA DRIVE, SUITE 300
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001

WWW.HENDERSONENGINEERS.COM


2150005255
MO. CORPORATE NO: E-556D
EXPIRES 12/31/2022

Revisions
NUMBER DESCRIPTION DATE



LSHS - MECHANICAL CONTROLS

NAACA

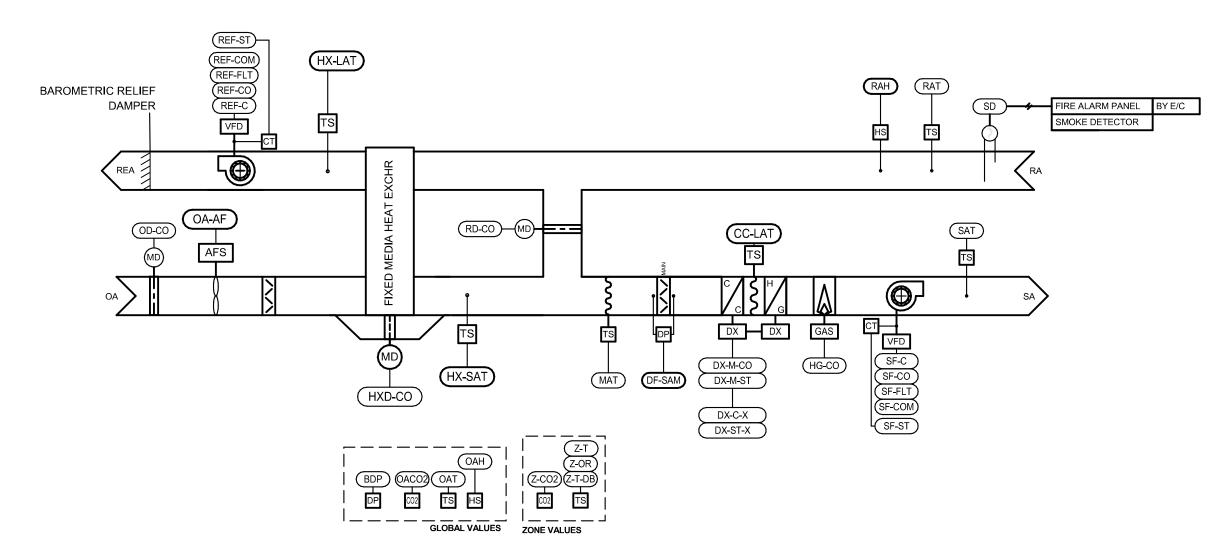

ROBOTICS - 100% OA SZ-VAV RTU (RTU-1H -LSHS)

_		LIST - RC	1					
POINT ID	DESCRIPTION	POINT TYPE	DEFAULT SET POINT	SET POINT RESET RANGE	FAIL POSITION	STATUS ALARM	ALARM RANGE	NOTES
GLOBAL VALUES		71112	OLITOINI	TEGETTOTIOE	TOOM	ALAIKIVI	TVIVOL	
BDP	BUILDING DIFFERENTIAL PRESSURE	AV						А
OAT	OUTSIDE AIR TEMPERATURE	AV						A
OAH	OUTSIDE AIR HUMIDITY	AV						A
OACO2	OUTSIDE AIR CO2 LEVEL	AV						A
AIR SENSING	OUTGIDE AIN GOZ EEVEE							
SAT	SUPPLY AIR TEMPERATURE	Al	55 F CLG; 90 F HTG	52 - 65 F CLG		Х	50 F > SAT > 100 F	D
RAT	RETURN AIR TEMPERATURE	Al	331 CLG, 901 111G	32 - 03 1 CLG		^	301 - 3A1 - 1001	
			50 DOT	20 55 DOT		V	45DU - DALL-CEDII	
RAH	RETURN AIR HUMIDITY	Al	50 PCT	30-55 PCT		X	15RH > RAH >65RH	D
MAT	MIXED AIR TEMPERATURE	Al	55 F	52 - 65 F CLG				D
CC-LAT	COOLING COIL LEAVING AIR TEMPERATURE	Al	SCHED			X	50 F > CC-LAT > 100 F	D
OA-AF	OUTSIDE AIR AIRFLOW QUANTITY ABSOL. MIN./ MIN.(CFM)	Al	SCHED			X	MOA-AF < SCHED - 15%	D
ZONE LEVEL SENSORS		-						
Z-T	ZONE TEMPERATURE	Al	SCHED					C, D
Z-OR	MANUAL OCCUPANCY OVERRIDE	BI	2 HOURS					D
Z-T-DB	ZONE TEMPERATURE	BV	5 F	-'2.5 F < Z-T < +2.5 F				D
Z-CO2	ZONE CO2	Al	SCHED				Z-CO2 > SPT	C, D
SUPPLY FAN								
SF-COM	SUPPLY FAN VFD COMMUNICATION	COM						
SF-C	SUPPLY FAN COMMAND (START/STOP)	ВО						
SF-CO	SUPPLY FAN CONTROL OUTPUT - SPEED (PERCENT)	AO		SCHED				
SF-ST	SUPPLY FAN STATUS	BI				X	SF-ST <> SF-C	
SF-FLT	SUPPLY FAN VFD FAULT	BI				X	COMMON ALARM	
RELIEF-EXHAUST FAN			I	I				
REF-COM	RELIEF-EXHAUSTFAN VFD COMMUNICATION	COM						
REF-C	RELIEF-EXHAUST FAN COMMAND (START/STOP)	ВО		201155				
REF-CO	RELIEF-EXHAUST FAN CONTROL OUTPUT - SPEED (PERCENT)	AO		SCHED.		V	REF-ST <> REF-C	
REF-ST REF-FLT	RELIEF-EXHAUST FAN STATUS RELIEF-EXHAUST FAN VFD FAULT	BI BI				X	COMMON ALARM	
RETURN AIR DAMPER (M		Ы				^	COMMON ALARM	
RD-CO	RETURN AIR DAMPER CONTROL OUTPUT	AO			NO			
OUTSIDE AIR DAMPER (M		AO			110			
OD-CO	OUTSIDE AIR DAMPER CONTROL OUTPUT	AO			NC			
FILTERS	COTOBETAIN BANK EN CONTINUE CONTINUE	710			110			
DF-SAM	DIRTY FILTER INDICATION (SA MAIN FILTER)	ВІ	SCHED.			Х	ON ACTIVATION	D
	ULATING AND BINARY STAGES							
DX-M-CO	DX MODULATING COMPRESSOR CONTROL OUTPUT	AO						J
DX-M-ST	DX MODULATING COMPRESSOR STATUS	Al				X	DX-M-ST <> DX-M-CO	J
DX-C-X	DX COMPRESSOR STAGE "X" COMMAND	ВО						J
DX-ST-X	DX COMPRESSOR STAGE "X" STATUS	BI				Х	DX-ST-X <> DX-C-X	J
HEATING COIL - GAS FUR	RNACE MODULATING	,	1	ı				
HG-CO	GAS FURNACE HEAT MODULATION CONTROL OUTPUT	AO						
HEAT EXCHANGER - TEM	PERATURE SENSING							
HX-LAT	LEAVING AIR TEMPERATURE	Al						
HX-SAT	SUPPLY AIR TEMPERATURE	Al				Х	HX-SAT< 35 F	
HEAT EXCHANGER - FIXE								
	(NO ADDITIONAL CONTROL)							
HEAT EXCHANGER - BYP								
HXD-CO	BYPASS DAMPER CONTROL OUTPUT	AO			NC			
FIRE ALARM/SMOKE DET	ECTORS							

ALL POINTS SHOWN SHALL BE PROVIDED BY BAS CONTRACTOR UNLESS NOTED OTHERWISE

DISPLAY VALUE WITH AHU GRAPHIC AT BAS FRONT-END. REFERENCE GLOBAL BUILDING MONITORING SCHEDULE FOR CONTROL POINT. REFERENCE PROJECT DESIGN CONDITIONS SCHEDULE FOR SETPOINT.

POINT SHALL BE ADJUSTABLE.

COORDINATE NUMBER OF STAGES FOR CONTROL WITH EQUIPMENT FURNISHED.

DEVICE AND RELAY FROM FIRE ALARM SYSTEM PROVIDED BY DIVISION 28. DISPLAY DETECTOR RELAY STATUS (NORMAL/ALARM) AT BAS FRONT END.

14 13

SEQUENCE OF OPERATIONS SINGLE ZONE VARIABLE AIR VOLUME ROOFTOP UNIT (RTU-1H)

This sequence of operations is organized into the following main categories: operating modes; control setpoint resets; safeties, overrides and interlocks; and component control loops. The operating modes describe the criteria that either enable or disable the various modes of operation. If a mode of operation is not listed within a component control loop section then that mode of operation has no direct influence on the operation of the component. The control setpoint reset section describes the logic and reference variables that will be used to reset control setpoints to a new value within its reset range. The safeties, overrides, and interlocks section outlines the hardwired interlocks that are required to meet life safety requirements. Safeties and interlocks take precedence over all other control strategies outlined in this document. The control responses of each component for the various modes of operation are described in the component control loop sections. Setpoints shall be adjustable (adj.) as noted.

The sequence of operations, the points list and control diagrams shall be used to provide a complete description of the control philosophy for the controlled equipment. Individual setpoint values, reset ranges, and alarm action levels are listed in the points list. Components and control sensor locations are graphically depicted on the control diagram. The controls contractor shall be responsible for coordinating any necessary time delay setpoints to establish stable system operation.

GENERAL DESCRIPTION

The rooftop unit described by this sequence of operations consist of a 100% OA DX/Gas RTU with modulating supply fan, modulating powered exhaust, and static core energy recovery device. The RTU shall be provided with refrigeration only and control to its own internal safeties and time delays. Controls shown in the diagram, points list, and described in the sequence are intended to be performed by controllers, sensors, and programming to achieve the specified sequence of operations indicated.

OPERATING MODES

OCCUPIED MODE:

The unit shall be in occupied mode per the Project Design Conditions Schedule shown on the control drawings.

UNOCCUPIED MODE:

The unit shall be in unoccupied mode for all periods not included in the occupied hours of operation. Overrides of unoccupied schedule are defined at the zone level control.

OCCUPIED STANDBY MODE:

The unit shall be in occupied standby mode when the associated zone is scheduled to be occupied and an occupant sensor indicates zero population within the zone subject to a 5-minute (adj.) delay. The unit shall exit occupied standby mode when occupancy is detected.

COOLING MODE:

The unit shall be in cooling mode when the outside air temperature (OAT) rises above the outside air cooling enable setpoint (OAT-C)

HEATING MODE:

The unit shall be in heating mode when the outside air temperature (OAT) falls below the outside air heating enable setpoint (OAT-H)

VENTILATION ONLY MODE:

The unit shall be in ventilation only mode when the outdoor air temperature is between the outdoor air cooling enable (OAT-C) and outdoor air heating enable (OAT-H) setpoints.

DEHUMIDIFICATION MODE: The unit shall be in dehumidification mode when the outside air dewpoint (OADP) is greater than the setpoint. The unit shall exit dehumidification mode when the outside air dewpoint (OADP) is

ENERGY RECOVERY COOLING MODE- TEMPERATURE ENABLED:

Dehumidification mode shall take priority over other modes.

less than its setpoint minus the outside air dewpoint deadband (OADP-DB).

The unit shall be in energy recovery cooling mode when the outside air temperature (OAT) is greater than the return air temperature (RAT).

ENERGY RECOVERY HEATING MODE-TEMPERATURE ENABLED: The unit shall be in energy recovery heating mode when:

The outside air temperature (OAT) is lower than the return air temperature (RAT) and the outside air temperature (OAT) is colder than the supply air temperature (SAT) setpoint).

ENERGY RECOVERY FROST PREVENTION MODE- TEMPERATURE ENABLED: The unit shall be in energy recovery frost prevention mode when the heat exchanger exhaust leaving air temperature (HX-LAT) falls below setpoint.

The unit shall be in energy recovery frost prevention mode when the outside air temperature (OAT) is below 30 degrees F (adj).

CONTROL SETPOINT RESETS

SUPPLY AIR TEMPERATURE RESET - DIRECT OUTSIDE AIR RESET: The supply air temperature (SAT) setpoint shall linearly reset within the range as listed in the "setpoint reset range" column of the points list based on the outside air temperature (OAT) according to the following schedule:

OAT-C setpoint minimum value of the SAT setpoint range OAT-H setpoint maximum value of the SAT setpoint range

VENTILATION RESET (CO2):

The outside airflow CFM (OA-AF) setpoint shall be reset between the minimum and maximum values subject to the associated zone level CO2 value as scheduled in the Project Design Conditions Schedule.

The airflow setpoint shall be at its maximum value when the associated zone CO2 sensor

detects levels at or above the maximum CO2 range.

The airflow setpoint shall be at its minimum value when the associated zone CO2 sensor

detects levels at or below the minimum CO2 range. The airflow setpoint shall vary between its minimum and maximum setpoint range linearly

as the associated zone CO2 sensor varies between is minimum and maximum value.

SAFETIES, OVERRIDES AND INTERLOCKS

SMOKE DETECTOR INTERLOCK:

The unit shall be disabled via hard wired interlock on activation of a system smoke detector. Display smoke detector relay status (normal or alarm) at the BAS front end.

COMPONENT CONTROL LOOPS

SUPPLY FAN CONTROL- SINGLE ZONE VARIABLE VOLUME:

When the HOA switch is in hand position, the variable speed supply fan shall operate at a speed set manually by the operator at the user interface of the drive.

When the HOA switch is in off position, the fan shall be off. When the HOA switch is in auto position, the variable speed supply fan shall operate subject to

the unit enable signal, and unit operating modes.

When in Occupied Mode: The fan shall energize and slowly ramp to the initial minimum fan speed determined during

system startup. Minimum fan speed shall be established during balancing.

The fan VFD shall modulate to maintain the design outside airflow CFM (OA-AF) as measured by the outside airflow sensor.

When in Occupied Standby Mode:

The fan shall be OFF. When in Unoccupied Mode:

The fan shall be OFF. On an override signal from the zone level, the fan shall operate as

12 11 10 9 8 7 6 5 4 3 2 1

in occupied mode until the override is removed.

When in Pre-Occupancy Purge Mode: The fan shall operate as in occupied mode. RELIEF - EXHAUST FAN (REF) - BUILDING PRESSURE SENSOR CONTROL

When in Occupied Mode: The fan shall be ON. When the building differential pressure (BDP) exceeds setpoint, the fan shall energize and slowly ramp to the initial minimum fan speed determined during

system startup. The fan VFD speed shall vary to maintain the building differential pressure (BDP) setpoint. When in Unoccupied Mode:

The fan shall be OFF. When in Pre-Occupancy Purge Mode: The fan shall operate as in occupied mode.

OUTSIDE AIR DAMPER (OA)

When in Occupied Mode: The damper shall be open.

When in Unoccupied Mode: The damper shall close after the supply fan is off and a time delay.

When in Pre-Occupancy Purge Mode: The damper shall be open.

FILTER MONITORING

When in All Modes: The controller shall monitor the differential pressure across each filter bank and shall provide a signal when the setpoint is exceeded.

ENERGY RECOVERY BYPASS DAMPERS

The supply and exhaust bypass dampers shall be linked together on a common actuator.

When in Occupied Mode: The dampers shall be open unless unit is in one of the following modes.

When in Ventilation Mode The dampers shall be open. This takes priority over other energy recovery modes listed

When in Energy Recovery Cooling Mode: The dampers shall be closed.

When in Energy Recovery Heating Mode:

The dampers shall be closed. The dampers shall modulate to maintain the heat exchanger leaving air temperature (HX-

SAT) setpoint. When in Energy Recovery Frost Prevention Mode:

Capacity modulation: The energy recovery bypass dampers shall modulate to maintain the

heat exchanger exhaust leaving air temperature (HX-LAT) setpoint. When in Unoccupied Mode:

The dampers shall be open.

On an override signal from the zone level the dampers shall operate as in occupied mode until the override is removed.

HEATING COIL- GAS MODULATED

When in Occupied Mode: When in Ventilation Only Mode:

The coil shall be OFF.

When in Cooling Mode:

The coil shall be OFF.

When in Heating Mode: The controller shall modulate the heating to maintain the supply air temperature setpoint

When in Dehumidification Mode:

The coil shall be OFF. When in Unoccupied Mode:

The coil shall be OFF. On an override signal from the zone level the coil shall operate as in occupied mode until

the override is removed.

COOLING COIL DX STAGED + VARIABLE CONTROL (MULTIPLE COMPRESSORS) When in Occupied Mode:

When in Ventilation Only Mode:

The compressors shall be OFF.

When in Cooling Mode: The variable compressor shall modulate in coordination with the constant speed

compressors (subject to the manufacturer's standard safeties) to maintain the supply air temperature setpoint (SAT).

When in Heating Mode: The compressors shall be OFF.

When in Dehumidification Mode:

The variable compressor shall modulate in coordination with the constant speed compressors (subject to the manufacturer's standard safeties) to maintain the cooling coil

leaving air temperature (CC-LAT). The variable compressor represents the primary stage of cooling and shall vary continuously between minimum capacity and 100% capacity to maintain the supply air set

point temperature. When the supply air temperature setpoint cannot be maintained and the variable compressor is at 100%, then the constant speed compressor shall be energized and the variable compressor shall return to minimum speed and modulate to

maintain the supply air setpoint. Units with subsequent stages of cooling shall follow a similar loading and unloading logic.

When in Unoccupied Mode: The compressors shall be OFF.

On an override signal from the zone level the compressors shall operate as in occupied mode until override is removed.

REHEAT COIL- DX HOT GAS REHEAT

When in Occupied Mode: When in Ventilation Only Mode:

The coil shall be OFF

When in Cooling Mode The coil shall be OFF.

When in Heating Mode: The coil shall be OFF.


the supply air temperature setpoint (SAT).

When in Dehumidification Mode: The manufacturer onboard controller shall control the hot gas reheat coil valve to maintain

When in Unoccupied Mode:

the override is removed.

The coil shall be OFF. On an override signal from the zone level the coil shall operate as in occupied mode until



HENDERSON

8345 LENEXA DRIVE, SUITE 300 LENEXA, KS 66214

TEL 913.742.5000 **FAX** 913.742.5001

WWW.HENDERSONENGINEERS.COM

MO. CORPORATE NO: E-556D

September 9, 2022

Issue Date:

Revisions

LSR7 Robotics, GiC &

LSN: 901 NE Douglas St., Lee's Summit MO

LSW: 2600 SW Ward Rd, Lee's Summit MO

Lee's Summit R-7 School Multistudio

14700 West 114th Terrace 4338 Belleview

301 NE Tudor Road

civil engineer:

913.485.0318

MEPFT/Code::

kveng.com

Lenexa, KS 66215

Henderson Engineers

Lenexa, KS 66214

816.742.5000

8345 Lenexa Drive, Suite

www.hendersonengineers.com

Kaw Valley Engineering

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Lee's Summit, MO 64086 Kansas City, MO 64111

4200 Pennsylvania

structural engineer:

Kansas City, MO 64111

www.bdc-engrs.com

Bob D. Campbell & Company, Inc.

816.931.6655


multi.studio

816.531.4144

0121-0100

Phys Education

LSHS - MECHANICAL CONTROLS

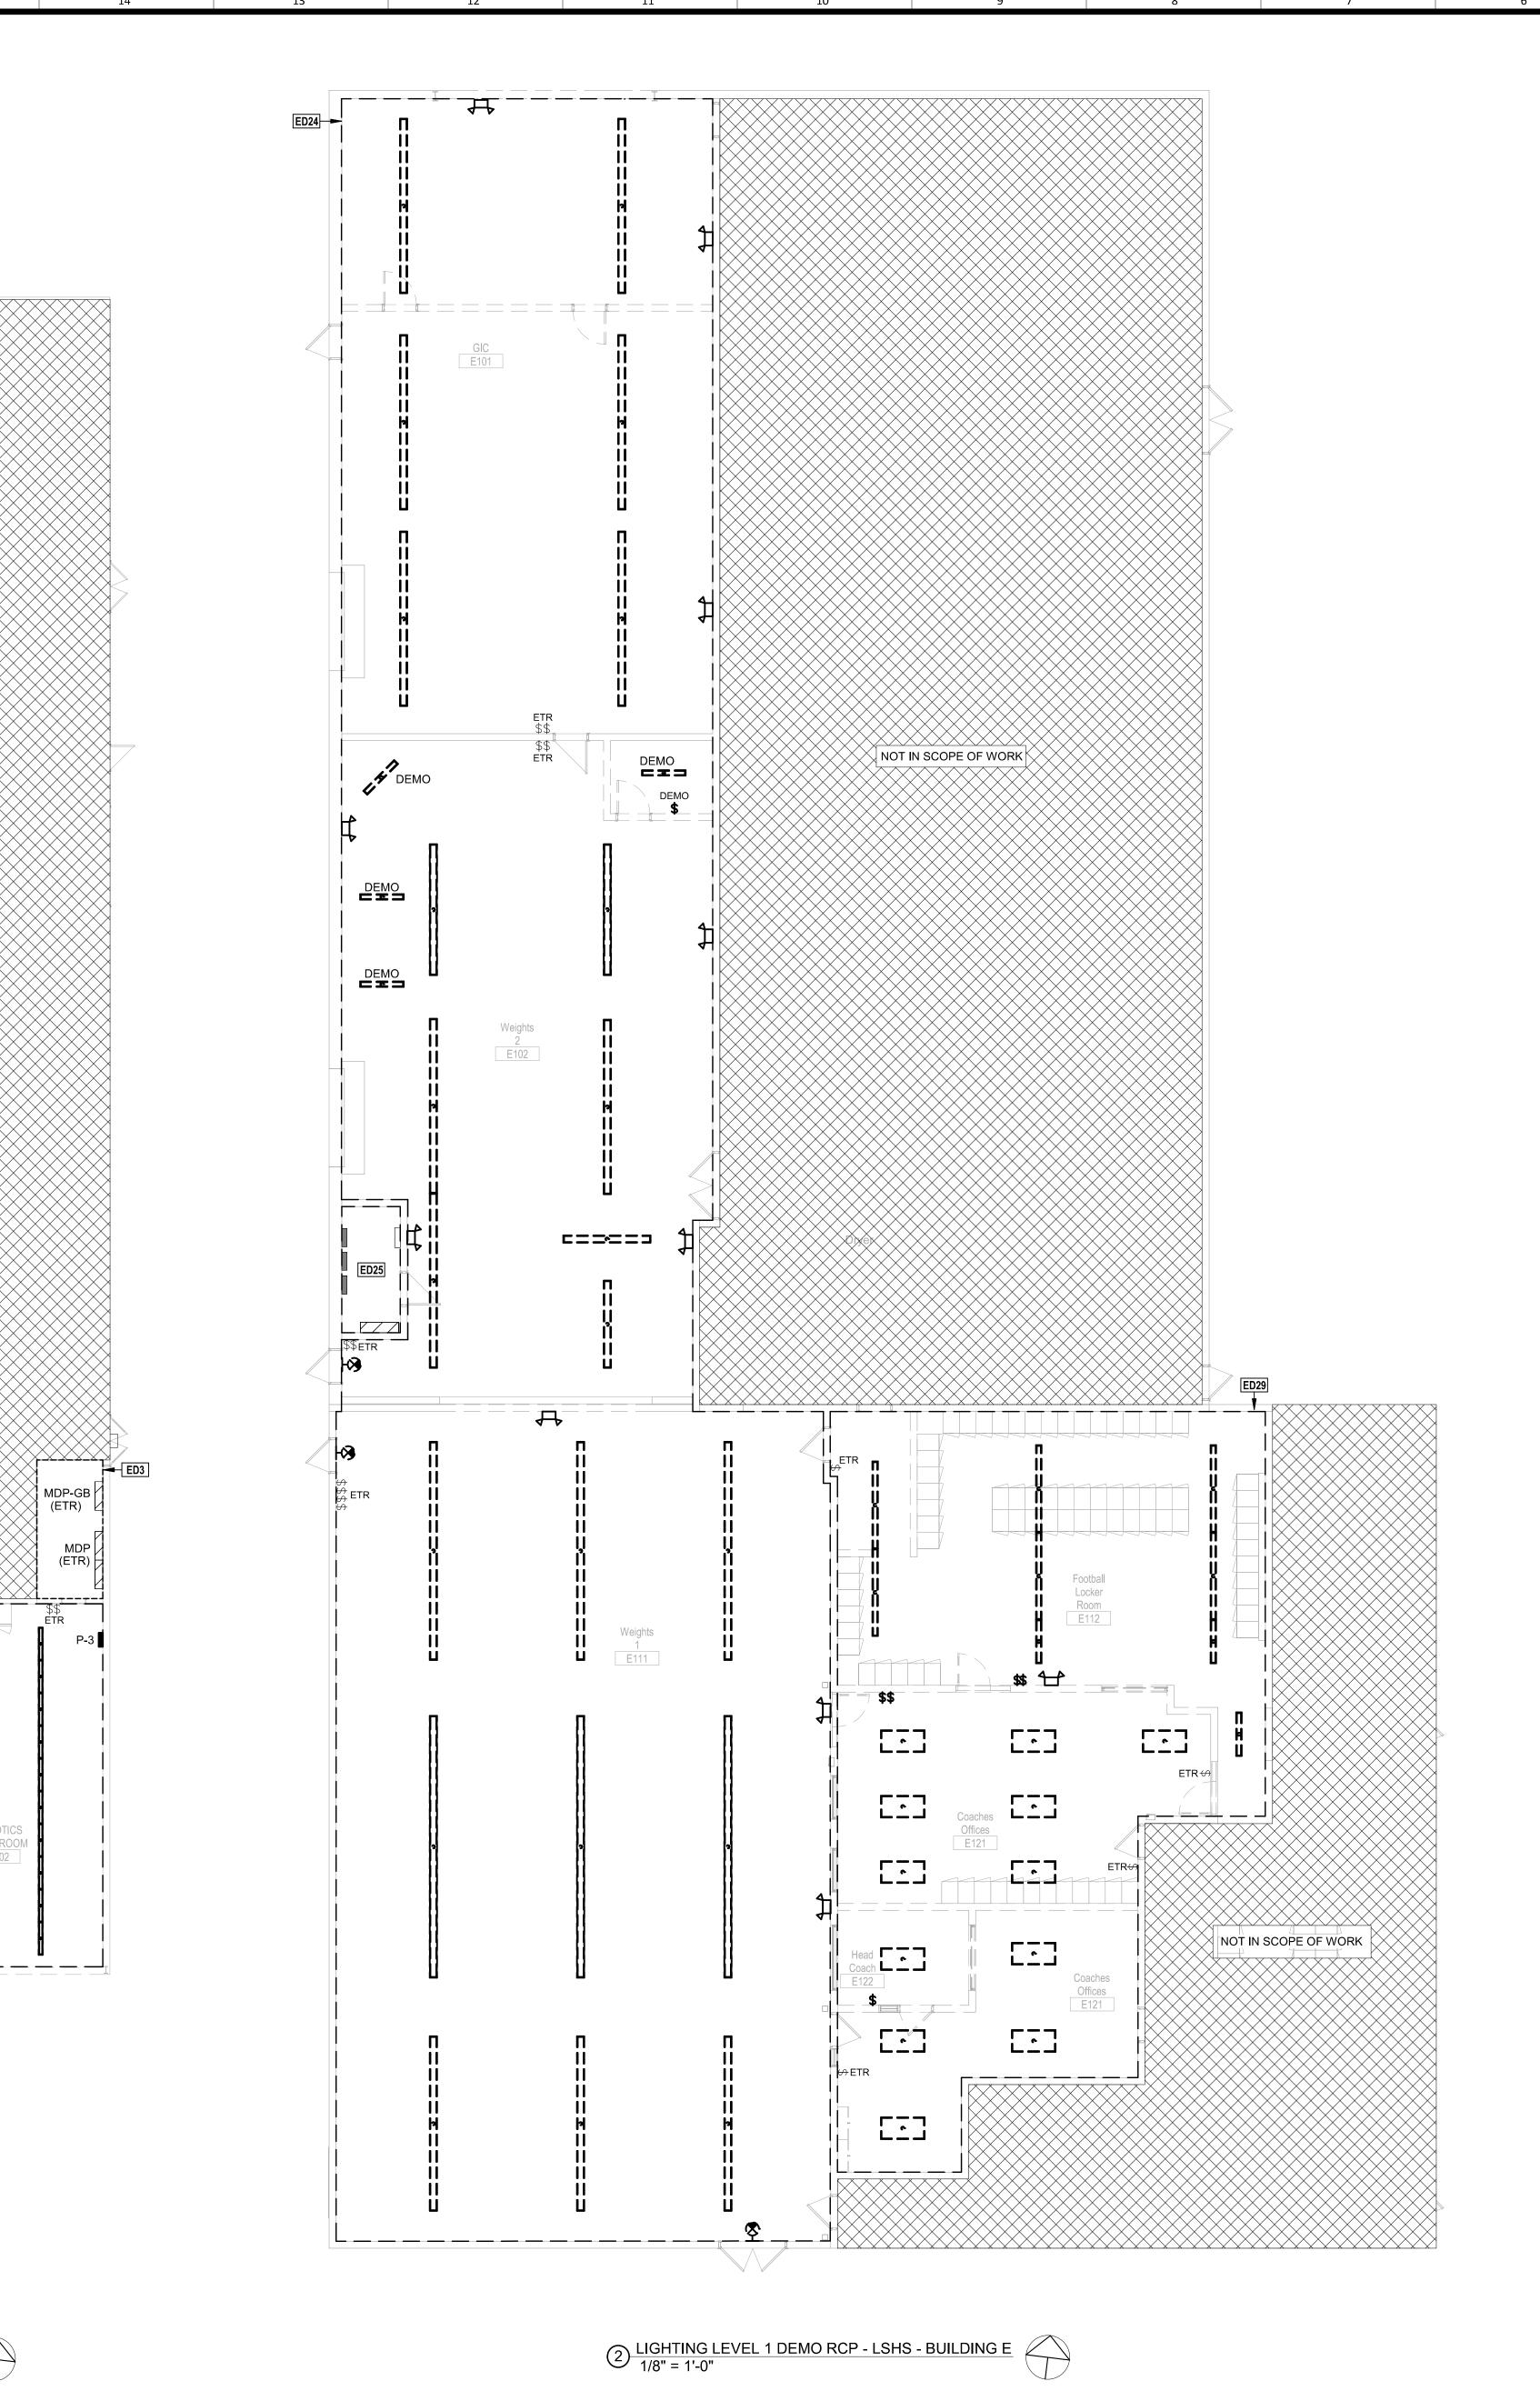

NOT IN SCOPE OF WORK

FABRICATION

- ELECTRICAL DEMOLITION PLAN NOTES:
- ED3 MAIN SERVICE ENTRANCE LOCATION IS ON MEZZANINE
- LEVEL ABOVE. EQUIPMENT IS ETR.

 ED18 RELOCATE WALL PACK TO SOUTH SIDE OF NEW ROBOTICS
 FIELD ADDITION. RE: 1/E101-C FOR ADDITIONAL
 INFORMATION.
- ED24 BASE BID: REMOVE FIXTURES AND LIGHTING CONTROLS MARKED AS "DEMO". ALL OTHER LIGHT FIXTURES AND CONTROLS ARE TO EXISTING TO REMAIN WITHIN DASHED REGION.

 ADD ALTERNATE #3: DEMOLISH ALL LIGHTING IN AREA SHOWN BOLD AND DASHED UNLESS NOTED OTHERWISE. REMOVE ALL EXISTING LIGHT FIXTURES, RACEWAY, CIRCUITRY, AND RELATED ACCESSORIES NOT BEING REUSED BACK TO SOURCE PANELBOARD OR NEAREST
- CONSTRUCTION DRAWINGS.

 ED25 DEMO FIXTURE AND SUPPORTS. REMOVE CIRCUITRY BACK
 TO JUNCTION BOX

ARE EXISTING TO REMAIN. MAINTAIN ALL EXISTING

CIRCUITRY FOR REUSE WHERE NOTED ON NEW

- TO JUNCTION BOX.

 ED27 BASE BID: REMOVE FIXTURES AND LIGHTING CONTROLS

 MARKED AS "DEMO". ALL OTHER LIGHT FIXTURES AND

 CONTROLS ARE EXISTING TO REMAIN WITHIN DASHED
- MARKED AS "DEMO". ALL OTHER LIGHT FIXTURES AND CONTROLS ARE EXISTING TO REMAIN WITHIN DASHED REGION.
 ADD ALTERNATE #2: REMOVE ALL LIGHT FIXTURES AND SUPPORTS. REMOVE CIRCUITRY BACK TO JUNCTION BOX

REMAINING DEVICE/LIGHT FIXTURE. LIGHTING CONTROLS

FOR RE-USE. LIGHTING CONTROLS ARE EXISTING TO REMAIN, UNLESS NOTED OTHERWISE. REFER TO NEW CONSTRUCTION DRAWINGS FOR ADDITIONAL INFORMATION.

ED29 DEMOLISH ALL LIGHTING AND CONTROLS IN AREA SHOWN BOLD AND DASHED UNLESS NOTED OTHERWISE. REMOVE ALL EXISTING LIGHT FIXTURES, RACEWAY, CIRCUITRY, AND RELATED ACCESSORIES NOT BEING REUSED BACK TO SOURCE PANELBOARD OR NEAREST REMAINING DEVICE/LIGHT FIXTURE. MAINTAIN ALL EXISTING CIRCUITRY AND CONTROLS FOR REUSE WHERE NOTED ON NEW

CONSTRUCTION DRAWINGS.

- **ELECTRICAL DEMOLITION GENERAL NOTES:**
- 1. REFERENCE ARCHITECTURAL DRAWINGS FOR FULL EXTENT OF DEMOLITION WORK AND PHASING. NOTIFY ARCHITECT, ENGINEER AND OWNER, AS APPLICABLE, OF ANY CONFLICTS OR DISCREPANCIES BETWEEN DRAWINGS AND JOB SITE CONDITIONS PRIOR TO SUBMITTING BID.
- 2. COORDINATE DEMOLITION AND REMOVAL OF EXISTING LIGHTING SYSTEMS WITH ARCHITECTURAL PHASING DRAWING AND OWNER TO ALLOW NECESSARY SYSTEMS TO REMAIN OPERATIONAL DURING CONSTRUCTION. (NOTE: NOT ALL EXISTING/DEMOLISHED EQUIPMENT, LIGHT FIXTURES, DEVICES OR RACEWAYS WILL BE SHOWN ON THE DRAWINGS). COORDINATE ELECTRICAL REQUIREMENTS FOR REMODELED/RENOVATED SPACES WITH THE OWNER.
- 3. AVOID DAMAGING FACILITIES, INCLUDING EQUIPMENT, LIGHT FIXTURES AND DEVICES THAT ARE EXISTING TO REMAIN, NEW OR REUSED. REPAIR ALL DAMAGE CAUSED DURING WORK AT NO EXTRA COST TO THE OWNER.
- 4. DISPOSE OF ALL ELECTRICAL EQUIPMENT, LIGHT FIXTURES, AND DEVICES SHOWN TO BE REMOVED, UNLESS NOTED OTHERWISE. COORDINATE WITH THE OWNER THE ITEMS TO BE SALVAGED, AND THE LOCATION FOR STORAGE. AVOID DAMAGING SALVAGED ITEMS DURING DEMOLITION WORK AND DURING TRANSPORT TO OWNER'S DESIGNATED STORAGE LOCATION.
- 5. WHERE ALTERATION OF ELECTRICAL EQUIPMENT, LIGHT FIXTURES, RACEWAYS OR WIRING DEVICES AFFECTS EXISTING SURFACES/FINISHES: REPAIR/PAINT AFFECTED SURFACE TO MATCH EXISTING ADJACENT SURFACE IN ACCORDANCE WITH OWNER REQUIREMENTS. MAINTAIN FIRE RATING OF ALL FLOORS/WALLS/CEILINGS THAT ARE RATED.
- 6. WHERE DEMOLITION WORK INTERRUPTS ELECTRICAL CONTINUITY OF CIRCUITS THAT ARE TO REMAIN IN USE, PROVIDE NECESSARY DEVICES AND RELATED CIRCUITRY TO MAINTAIN ELECTRICAL CONTINUITY IN ACCORDANCE WITH OWNER REQUIREMENTS. RECIRCUIT REUSED ELECTRICAL EQUIPMENT, LIGHT FIXTURES AND WIRING DEVICES PREVIOUSLY POWERED FROM DEMOLISHED EQUIPMENT TO NEW OR TEMPORARY EQUIPMENT AS NEEDED.
- 7. COORDINATE DISCONNECTION OF POWER TO EQUIPMENT BEING DEMOLISHED/REMOVED/RELOCATED WITH OTHER TRADES PRIOR TO START OF WORK. ALL ELECTRICAL EQUIPMENT, LIGHT FIXTURES, RACEWAYS, WIRING DEVICES AND RELATED CIRCUITRY NOT BEING REUSED SHALL BE REMOVED IN ALL ACCESSIBLE AREAS AND IN FLOORS/WALLS/CEILINGS THAT ARE TO BE REMOVED, UNLESS NOTED OTHERWISE. AS ALLOWED BY OWNER, UNUSED ELECTRICAL EQUIPMENT, RACEWAYS AND RELATED CIRCUITRY THAT ARE INACCESSIBLE MAY BE ABANDONED IN PLACE AND SHALL BE PERMANENTLY DISCONNECTED FROM ALL POWER SOURCES, INSULATED FROM CONTACT WITH OTHER LIVE ELECTRICAL WIRING/DEVICES, AND IDENTIFIED AT THE TERMINATIONS AS NO LONGER BEING IN SERVICE.
- 8. LOW VOLTAGE CABLES/WIRING NOT BEING REUSED SHALL BE REMOVED UNLESS IDENTIFIED FOR FUTURE USE. COORDINATE REQUIREMENTS WITH OWNER. CARE SHOULD BE TAKEN DURING THE REMOVAL PROCESS TO PROTECT THE EXISTING REUSED CABLES/WIRING FROM DAMAGE.

MUITISTUC

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086 N LSW: 2600 SW Ward Rd, Lee's Summit MO

64082 LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100

architect:
t R-7 School Multistudio

Lee's Summit R-7 School
301 NE Tudor Road
Lee's Summit, MO 64086
Lee's Summit, MO 64086
Kansas City, MO 64111
816.931.6655

multi.studio

civil engineer: structural engineer:

Kaw Valley Engineering Bob D. Campbell & Company, Inc.

14700 West 114th Terrace 4338 Belleview

Lenexa, KS 66215 Kansas City, MO 64111

Lenexa, KS 66215 Kansas City, MO 64111
913.485.0318 816.531.4144
kveng.com www.bdc-engrs.com

MEPFT/Code::
Henderson Engineers
8345 Leneva Drive Suite

Henderson Engineers
8345 Lenexa Drive, Suite
300
Lenexa, KS 66214
816.742.5000

Lenexa, KS 66214 816.742.5000 www.hendersonengineers.com


ENGINEERS

8345 LENEXA DRIVE, SUITE 300
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001

WWW.HENDERSONENGINEERS.COM


2150005255
MO. CORPORATE NO: E-556D
EXPIRES 12/31/2022

Revisions
NUMBER DESCRIPTION DATE



LSHS - LIGHTING
DEMOLITION RCP LEVEL 1 - BUILDING D &
E

ED101-C

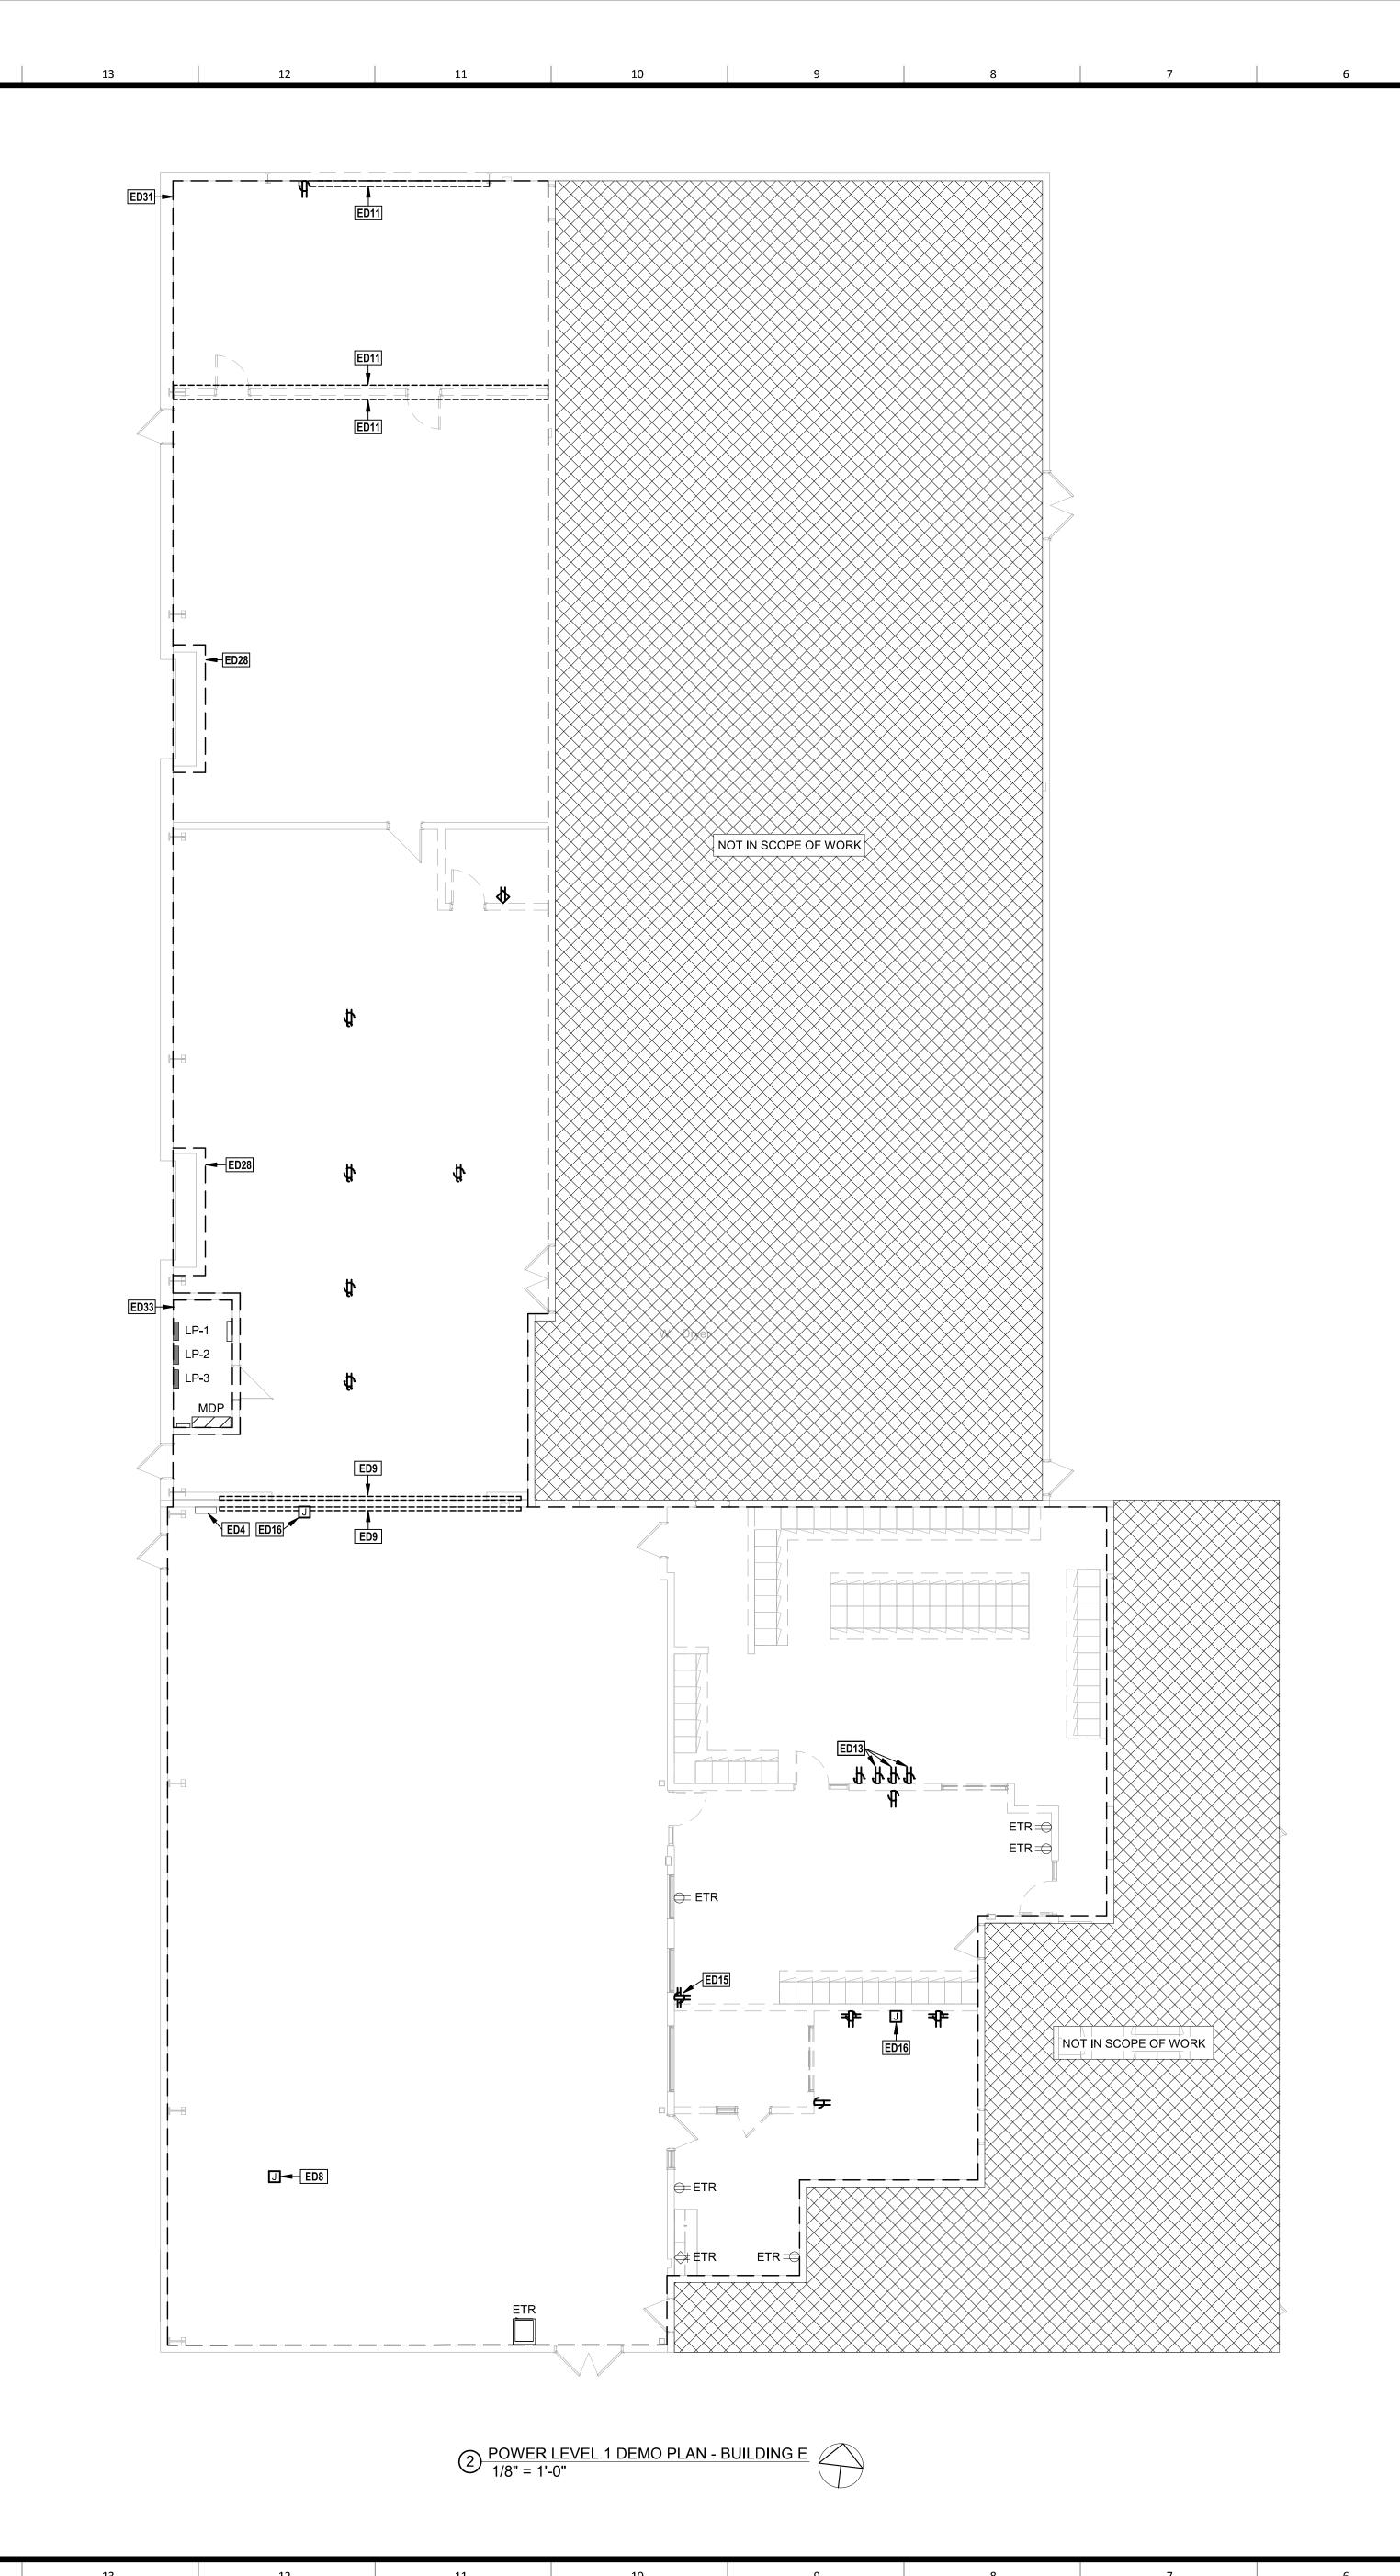

NOT IN SCOPE OF WORK

ELECTRICAL DEMOLITION PLAN NOTES:

- ED3 MAIN SERVICE ENTRANCE LOCATION IS ON MEZZANINE LEVEL ABOVE. EQUIPMENT IS ETR.
- LEVEL ABOVE. EQUIPMENT IS ETR.

 ED4 EXISTING WIREWAY MOUNTED AT APPROXIMATELY 10' AFF.
 PROTECT EXISTING WIREWAY AND ALL CONDUIT
- TERMINATIONS ENTERING AND LEAVING WIREWAY.

 ED8 RELOCATE EXISTING PENDANT MOUNTED PROJECTOR AND REVISE AND EXTEND RELATED CIRCUITRY. EXISTING RACEWAY, CIRCUITRY, AND RELATED ACCESSORIES MAY BE REUSED IF IN GOOD CONDITION AND NEW DESIGN CRITERIA CAN BE MET, OTHERWISE REPLACE, RE: NEW
- CONSTRUCTION DRAWINGS FOR ADDITIONAL INFORMATION.

 ED9 PROTECT EXISTING EXPOSED CONDUIT WITHIN DASHED REGION DURING CONSTRUCTION OF NEW GARAGE DOOR. RELOCATE ALL EXPOSED CONDUIT SURFACE MOUNTED TO PORTION OF WALL GETTING DEMOLISHED TIGHT TO DECK. REMOVE ALL RECEPTACLES WITHIN PORTION OF WALL GETTING DEMOLISHED. REMOVE CONDUIT AND CIRCUITRY BACK TO SOURCE.
- ED11 DEMOLISH ALL ELECTRICAL DEVICES LOCATED ON WALL OR PORTION OF WALL TO BE REMOVED UNLESS NOTED OTHERWISE. REMOVE EXISTING ELECTRICAL DEVICES, RACEWAY, CIRCUITRY, AND RELATED ACCESSORIES NOT BEING REUSED BACK TO SOURCE PANELBOARD OR NEAREST REMAINING DEVICE. NOT ALL EXISTING TO REMAIN RECEPTACLES ARE SHOWN.
- ED13 RELOCATE EXISTING RECEPTACLES SERVING GAME CLOCKS AND REVISE AND EXTEND RELATED CIRCUITRY. EXISTING RACEWAY, CIRCUITRY, AND RELATED ACCESSORIES MAY BE REUSED IF IN GOOD CONDITION AND NEW DESIGN CRITERIA CAN BE MET, OTHERWISE REPLACE. RE: NEW CONSTRUCTION DRAWINGS FOR ADDITIONAL INFORMATION.
- ED15 RELOCATE EXISTING RECEPTACLE SERVING WALL RACK AND REVISE AND EXTEND RELATED CIRCUITRY. EXISTING RACEWAY, CIRCUITRY, AND RELATED ACCESSORIES MAY BE REUSED IF IN GOOD CONDITION AND NEW DESIGN CRITERIA CAN BE MET, OTHERWISE REPLACE. RE: NEW CONSTRUCTION DRAWINGS FOR ADDITIONAL INFORMATION.
- ED16 RELOCATE EXISTING WALL MOUNTED PROJECTOR AND REVISE AND EXTEND RELATED CIRCUITRY. EXISTING RACEWAY, CIRCUITRY, AND RELATED ACCESSORIES MAY BE REUSED IF IN GOOD CONDITION AND NEW DESIGN CRITERIA CAN BE MET, OTHERWISE REPLACE. RE: NEW CONSTRUCTION DRAWINGS FOR ADDITIONAL INFORMATION.

DASHED UNLESS NOTED OTHERWISE. REMOVE EXISTING ELECTRICAL DEVICES, RACEWAY, CIRCUITRY, AND RELATED

- ED22 REMOVE PANEL. DISCONNECT ALL EXISTING BRANCH
 CIRCUITRY LOADS AND MAINTAIN CONDITION FOR
 RECONNECTION TO NEW PANEL.
 ED28 EXISTING ROLLING DOOR TO REMAIN.
 ED31 DEMOLISH ALL RECEPTACLES IN AREA SHOWN BOLD AND
- ACCESSORIES NOT BEING REUSED BACK TO SOURCE PANELBOARD OR NEAREST REMAINING DEVICE.

 ED32 ALL RECEPTACLES WITHIN DASHED REGION ARE EXISTING
- ED33 NO DEMOLITION WORK IN THIS AREA. ALL EQUIPMENT IS EXISTING TO REMAIN.

multistudio

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086 N LSW: 2600 SW Ward Rd, Lee's Summit MO

0121-0100

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

owner: architect:

Lee's Summit R-7 School

301 NE Tudor Road 4200 Pennsylvania
Lee's Summit, MO 64086 Kansas City, MO 64111

816.931.6655
multi.studio

civil engineer: structural engineer:

Kaw Valley Engineering Bob D. Campbell & Company, Inc.

14700 West 114th Terrace 4338 Belleview

 14700 West 114th Terrace
 4338 Belleview

 Lenexa, KS 66215
 Kansas City, MO 64111

 913.485.0318
 816.531.4144

 kveng.com
 www.bdc-engrs.com

 MEPFT/Code::

 Handaran Engineers

kveng.com www.bdc-engrs.co

MEPFT/Code::
Henderson Engineers
8345 Lenexa Drive, Suite
300
Lenexa, KS 66214

816.742.5000

www.hendersonengineers.com

HENDERSON
ENGINEERS

8345 LENEXA DRIVE, SUITE 300
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001

WWW.HENDERSONENGINEERS.COM


2150005255
MO. CORPORATE NO: E-556D

Revisions
NUMBER DESCRIPTION DATE



LSHS - POWER
DEMOLITION PLAN LEVEL 1 - BUILDING D &
E

ED201-C

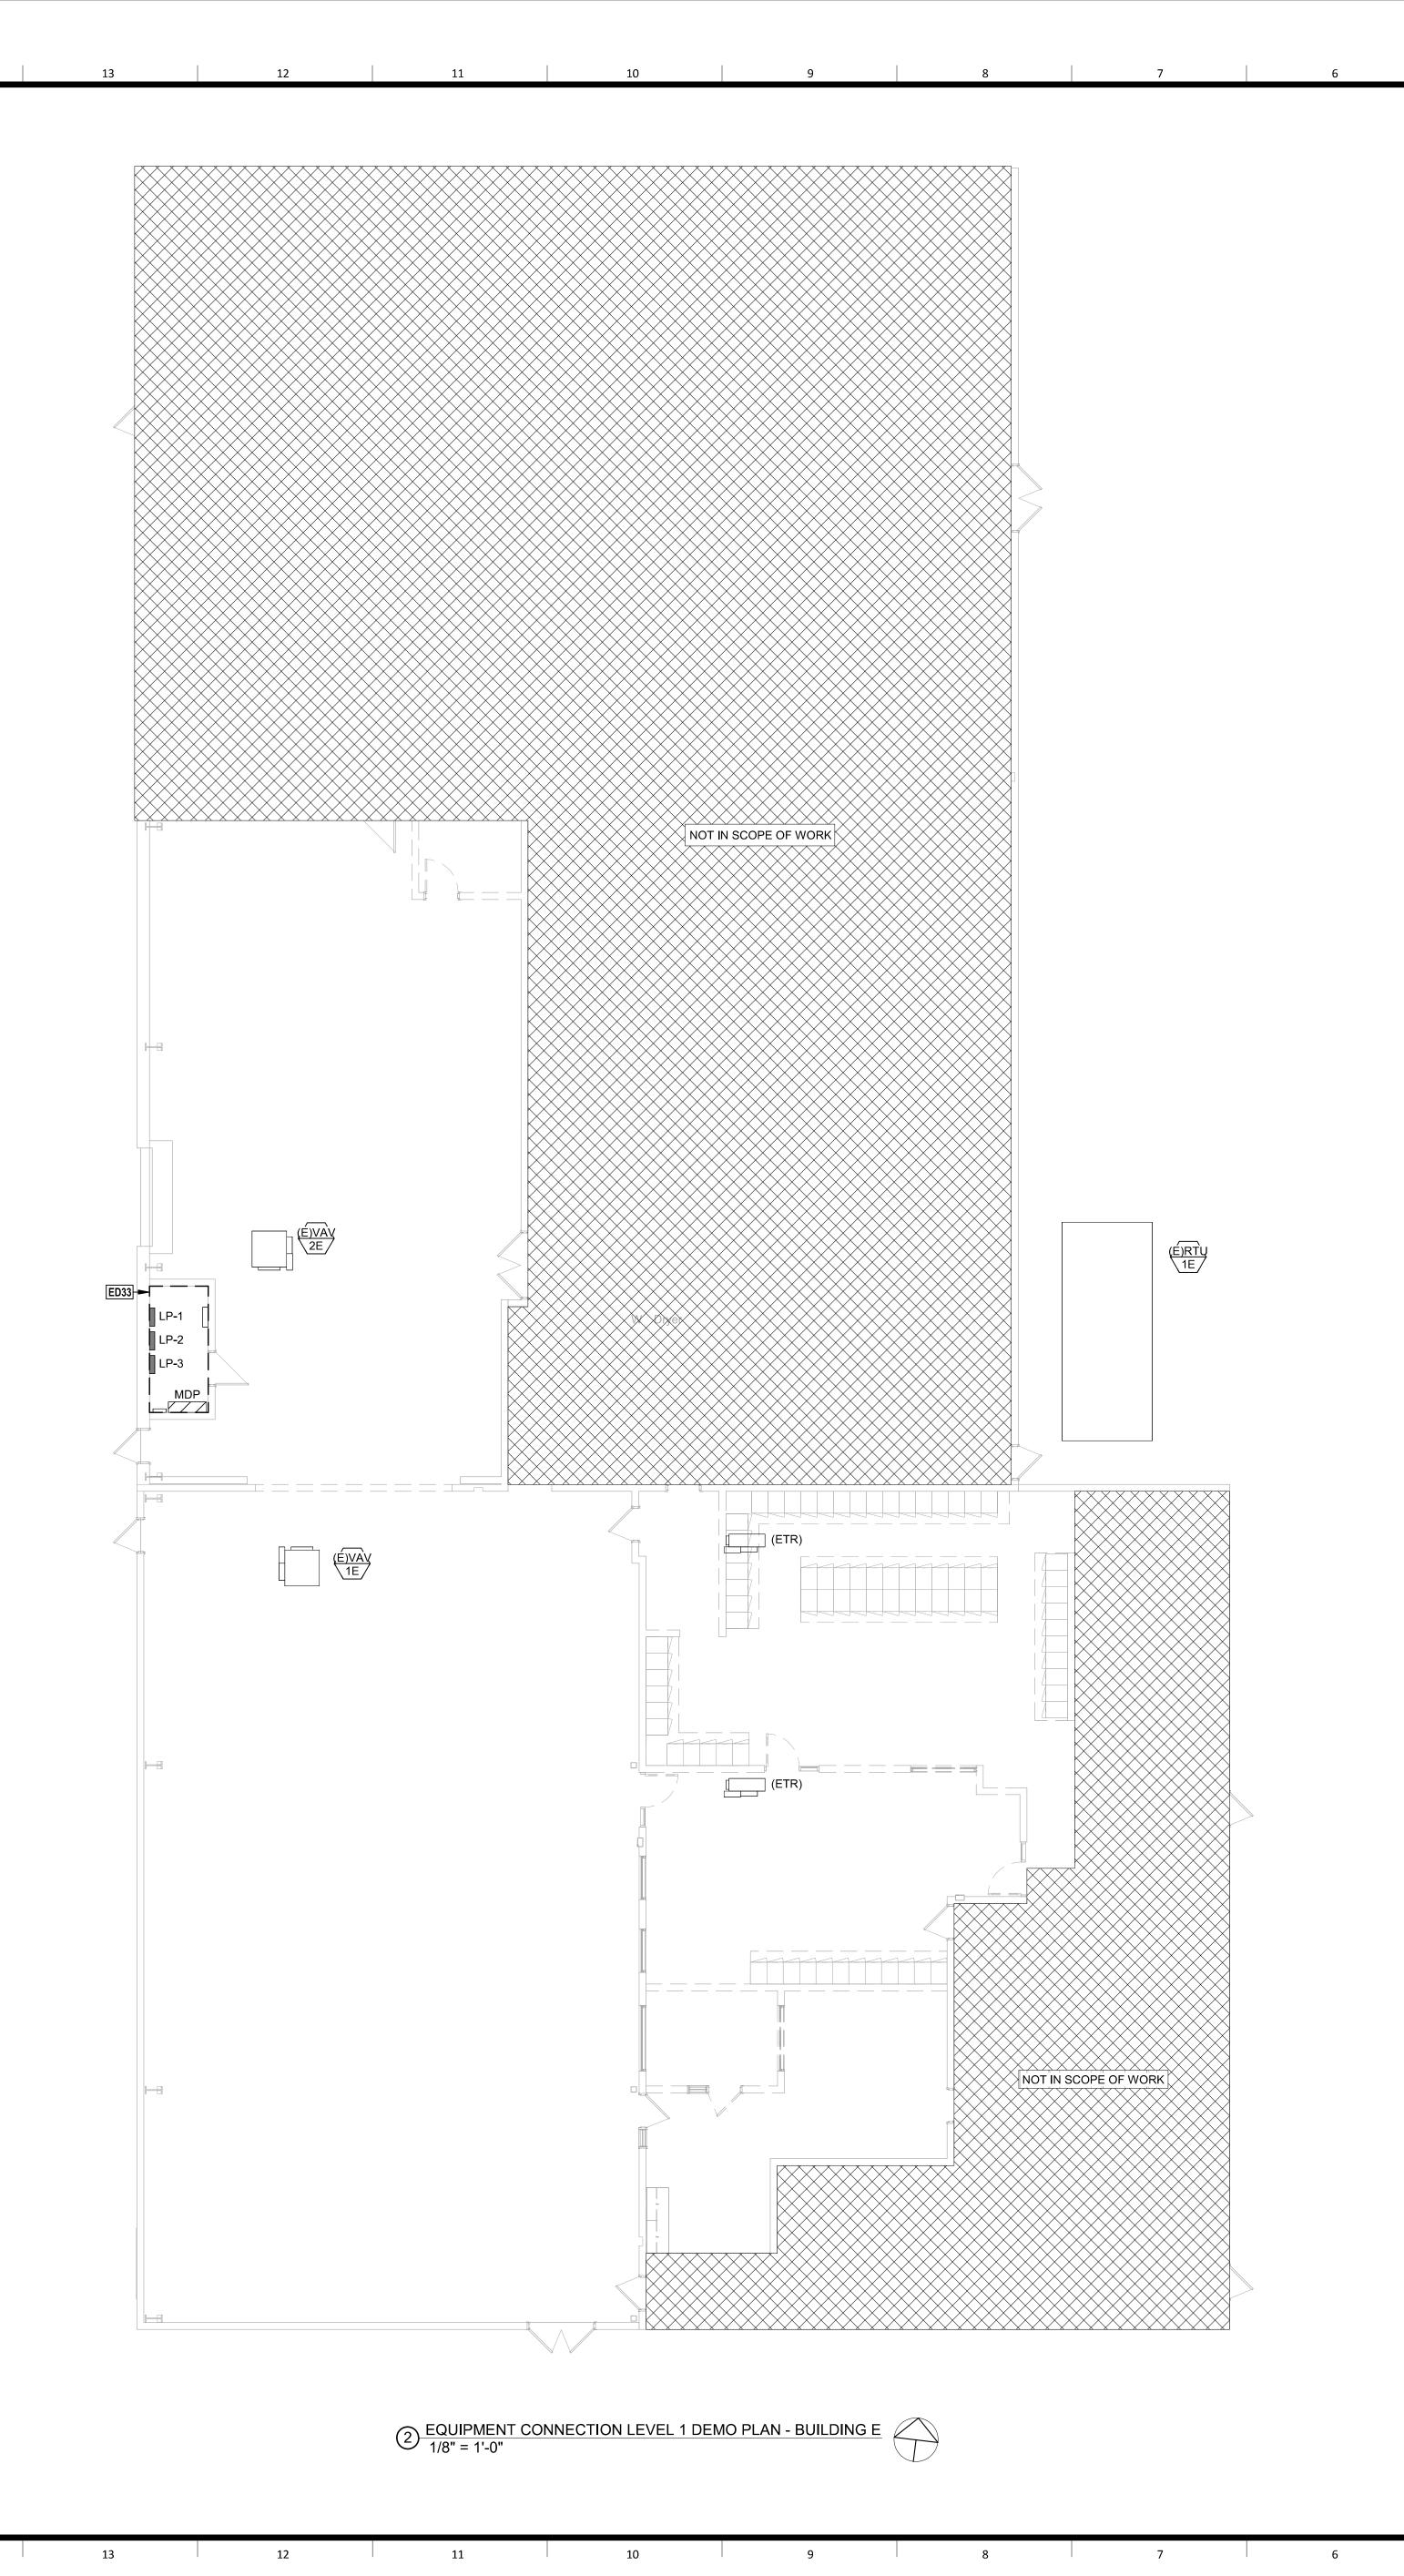

 \searrow NOT IN SCOPE OF WORK \cline{igle}

1 EQUIPMENT CONNECTION LEVEL 1 DEMO PLAN - BUILDING D
3/32" = 1'-0"

ED20

EXISTING
EXTERIOR
WIREWAY

RE: ONE-LINE DIAGRAM

LSR7 Robotics, GiC & **Phys Education**

ELECTRICAL DEMOLITION PLAN NOTES:

SALVAGE LOCATION WITH OWNER.

ED2 EXISTING EQUIPMENT TO BE REMOVED. REMOVE EXISTING RACEWAY, CIRCUITRY, AND RELATED ACCESSORIES NOT BEING REUSED BACK TO SOURCE. REFER TO NEW

ED20 REMOVE SPARE DISCONNECT AND SALVAGE. COORDINATE

ED33 NO DEMOLITION WORK IN THIS AREA. ALL EQUIPMENT IS EXISTING TO REMAIN.

CONSTRUCTION DRAWINGS FOR ADDITIONAL INFORMATION.

LSN: 901 NE Douglas St., Lee's Summit MO N LSW: 2600 SW Ward Rd, Lee's Summit MO 64082

> LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063 0121-0100

Lee's Summit R-7 School Multistudio 301 NE Tudor Road 4200 Pennsylvania Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655 multi.studio

structural engineer: Kaw Valley Engineering Bob D. Campbell & Company, Inc. 14700 West 114th Terrace 4338 Belleview Lenexa, KS 66215 Kansas City, MO 64111 913.485.0318 816.531.4144 www.bdc-engrs.com kveng.com MEPFT/Code::

Henderson Engineers 8345 Lenexa Drive, Suite Lenexa, KS 66214 816.742.5000 www.hendersonengineers.com


8345 LENEXA DRIVE, SUITE 300 LENEXA, KS 66214 TEL 913.742.5000 FAX 913.742.5001



DOUGLAS M. EVERHART LICENSE # PE-2019007648

LSHS - EQUIPMENT CONNECTION **DEMOLITION PLAN -**LEVEL 1 - BUILDING D &

ED301-C

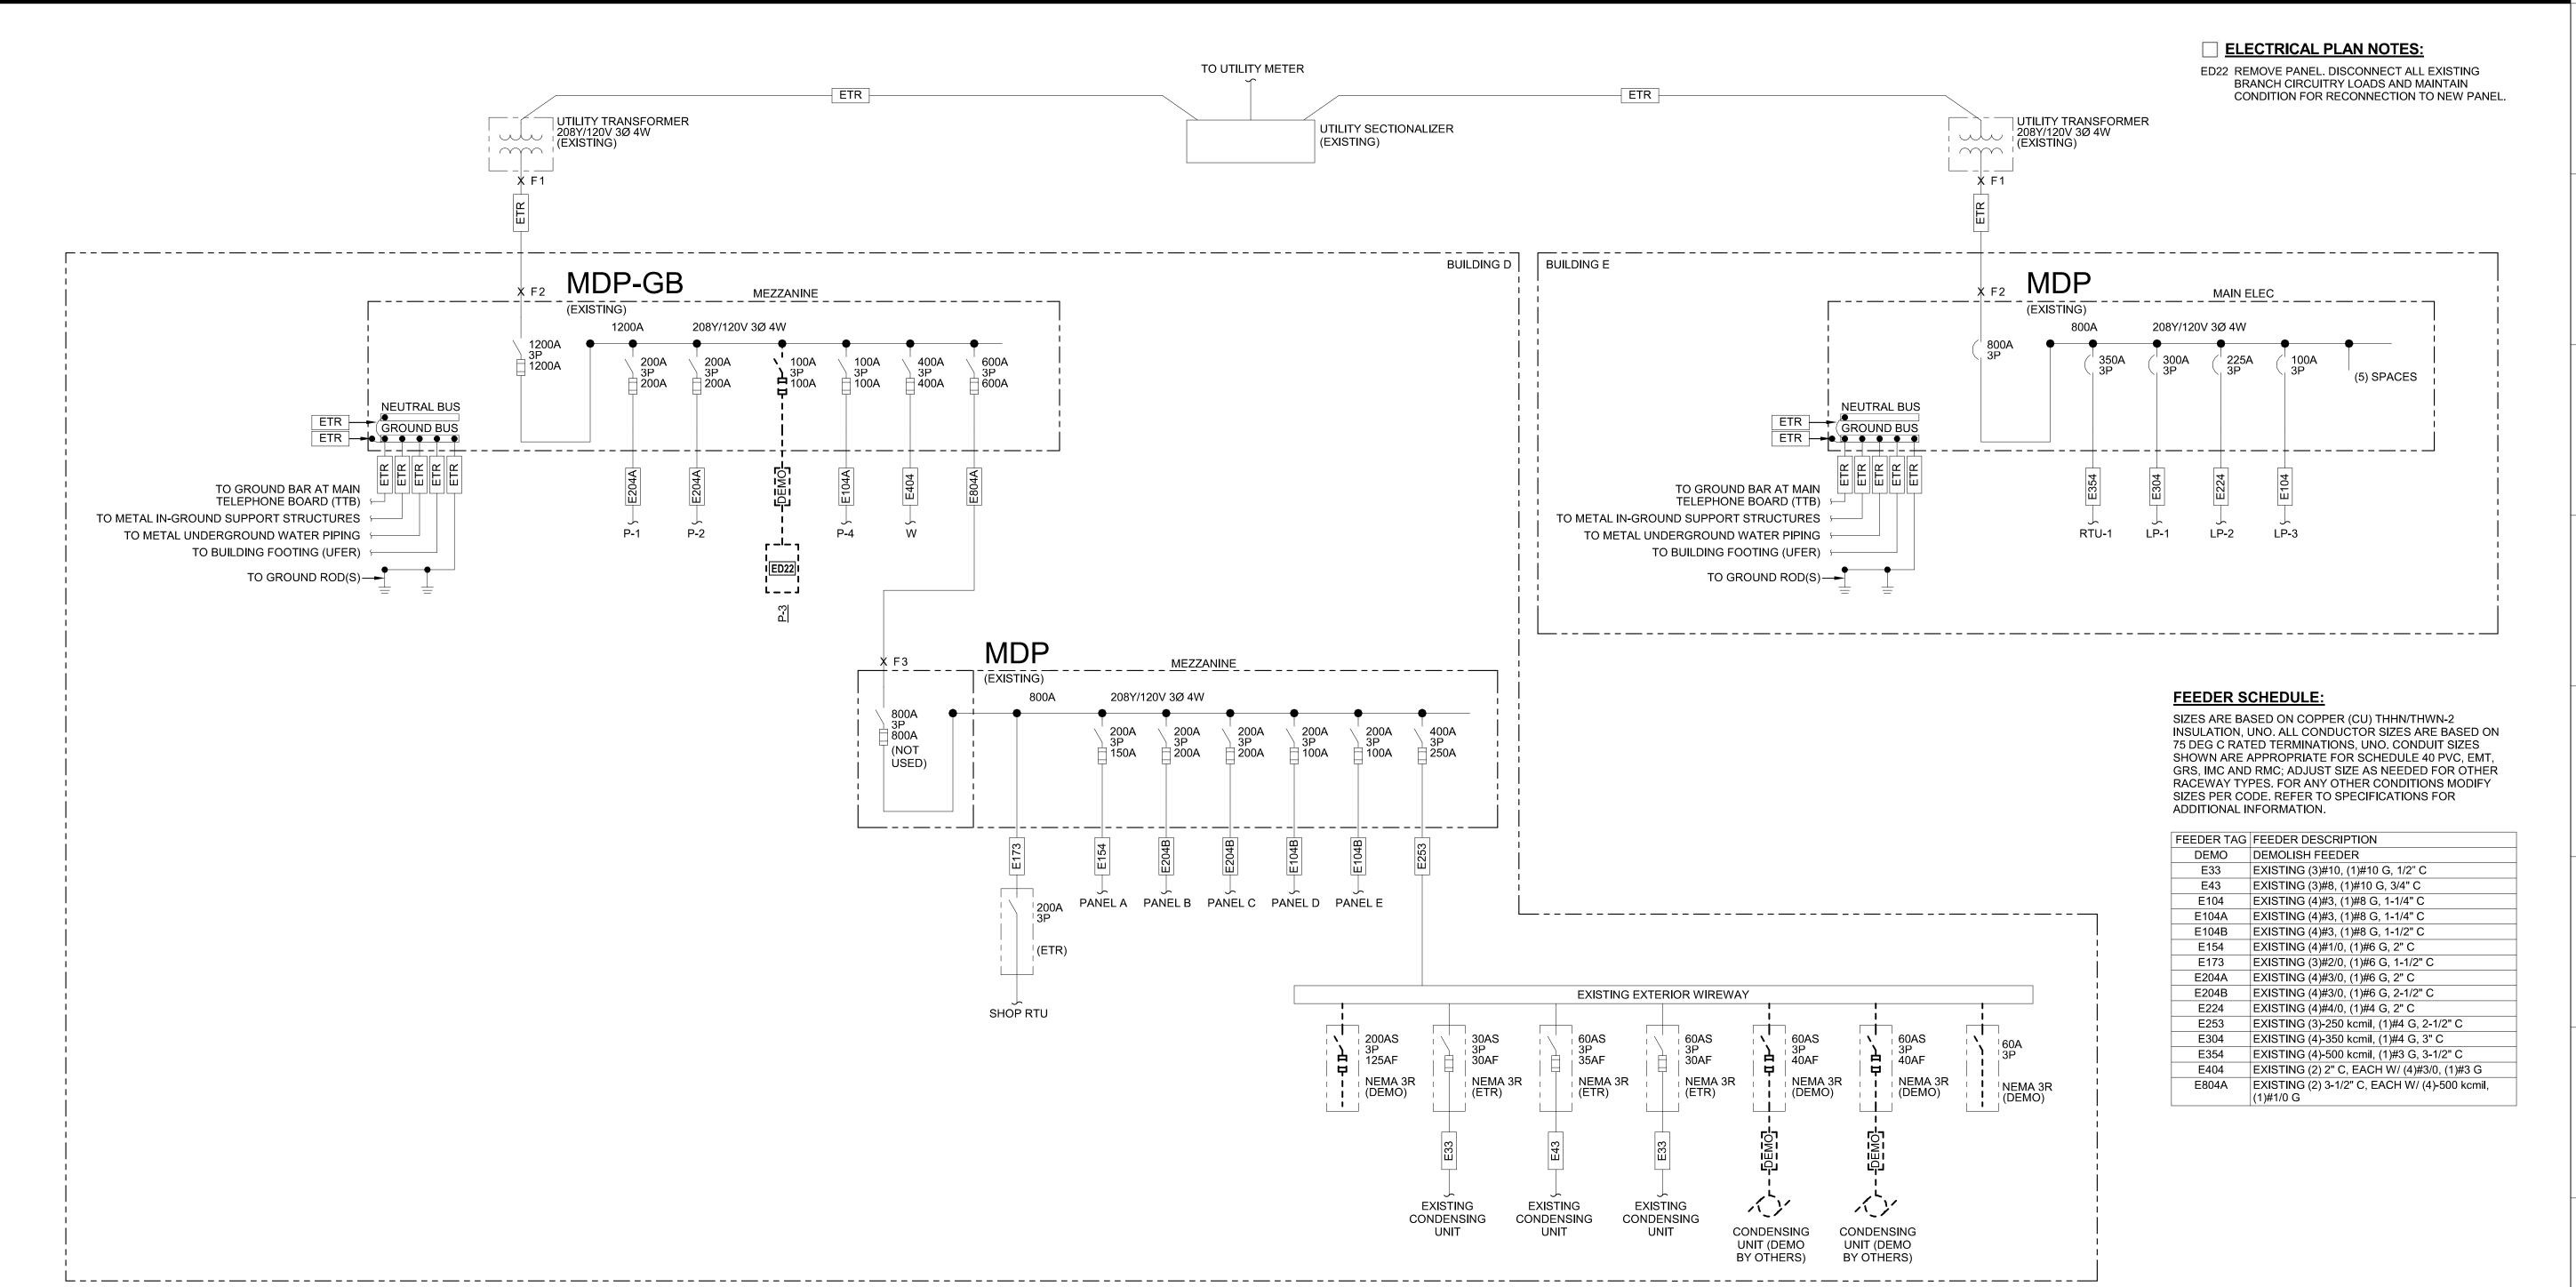

multistudio
the evolution of gould evons

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086 N LSW: 2600 SW Ward Rd, Lee's Summit MO 64082

Lee's Summit R-7 School Multistudio

0121-0100 architect:

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

301 NE Tudor Road
Lee's Summit, MO 64086
Kansas City, MO 64111
816.931.6655
multi.studio

civil engineer:
Kaw Valley Engineering
Structural engineer:
Bob D. Campbell & Company, Inc.

14700 West 114th Terrace 4338 Belleview
Lenexa, KS 66215 Kansas City, MO 64111
913.485.0318 816.531.4144
kveng.com www.bdc-engrs.com
MEPFT/Code::
Henderson Engineers

8345 Lenexa Drive, Suite 300 Lenexa, KS 66214 816.742.5000 www.hendersonengineers.com


HENDERSON
ENGINEERS

8345 LENEXA DRIVE, SUITE 300
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001


WWW.HENDERSONENGINEERS.COM

2150005255
MO. CORPORATE NO: E-556D
EXPIRES 12/31/2022

Revisions
NUMBER DESCRIPTION DATE



LSHS - ELECTRICAL
ONE-LINE DIAGRAM DEMO
ED800-C

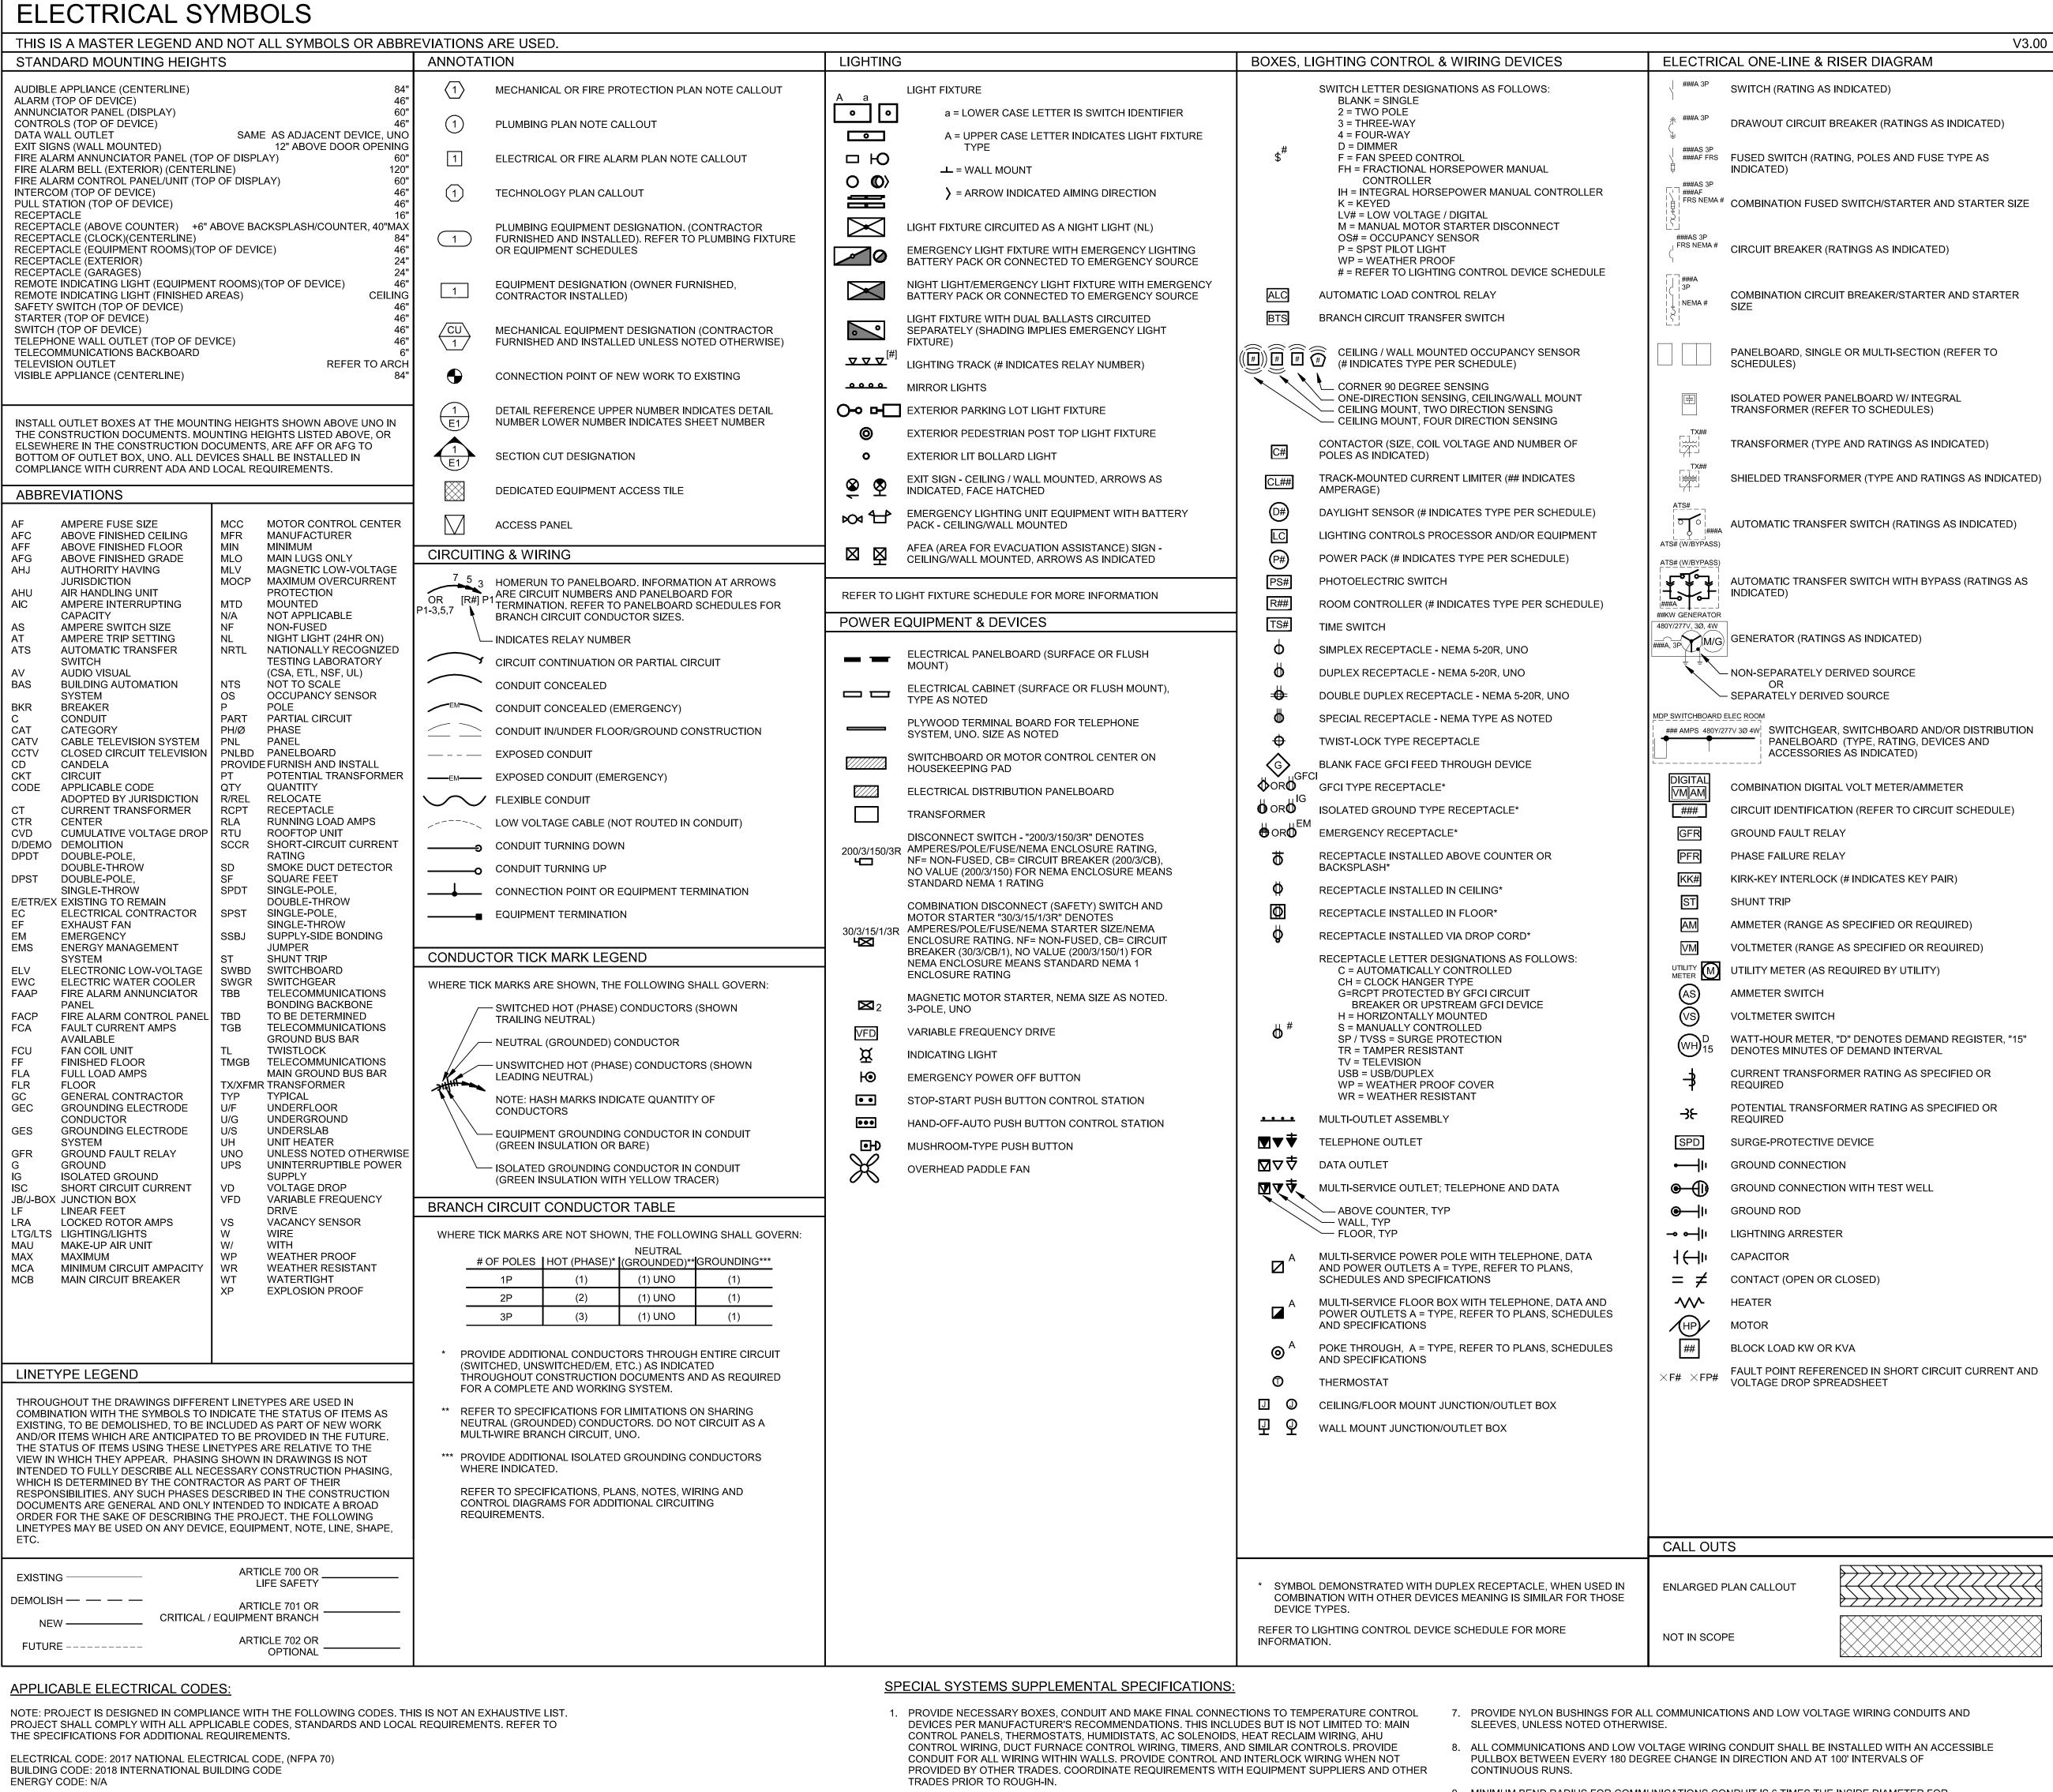

NOTE: PROJECT IS DESIGNED IN COMPLIANCE WITH THE FOLLOWING CODES. THIS IS NOT AN EXHAUSTIVE LIST PROJECT SHALL COMPLY WITH ALL APPLICABLE CODES, STANDARDS AND LOCAL REQUIREMENTS. REFER TO

14 13

ELECTRICAL CODE: 2017 NATIONAL ELECTRICAL CODE, (NFPA 70)

BUILDING CODE: 2018 INTERNATIONAL BUILDING CODE

- 2. PROVIDE LINE VOLTAGE WIRING AND MAKE FINAL CONNECTIONS TO ALL DUCT-MOUNTED SMOKE DETECTORS, FIRE/SMOKE AND SMOKE DAMPERS WHERE APPLICABLE. COORDINATE REQUIREMENTS WITH OTHER TRADES PRIOR TO INSTALLATION.
- 3. DEVICES MOUNTED ON ACOUSTICAL TILE CEILINGS SHALL BE CENTERED ON THE TILE, UNO.
- 4. PROVIDE BOX AND 3/4" CONDUIT FROM EACH THERMOSTAT LOCATION TO MECHANICAL EQUIPMENT. (FLUSH MOUNT BOX WHEREVER PRACTICABLE). COORDINATE LOCATION OF ALL THERMOSTAT BOXES WITH MECHANICAL/CONTROLS CONTRACTOR AND OWNER PRIOR TO ROUGH-IN.
- PROVIDE BOXES AND CONDUITS FOR THE FIRE PROTECTION SYSTEM LOW VOLTAGE WIRING AS REQUIRED. THIS INCLUDES EXPOSED WIRING LESS THAN 96" AFF. AT A MINIMUM, PROVIDE 3/4" CONDUIT, UNLESS NOTED OTHERWISE. COORDINATE REQUIREMENTS AND LOCATIONS WITH SYSTEM INSTALLER AND FIRE ALARM SPECIFICATIONS.
- 6. AT A MINIMUM, PROVIDE EXTRA DEEP, DOUBLE GANG COMMUNICATION OUTLET BOXES, (FLUSH MOUNTED WHEREVER PRACTICABLE), WITH SINGLE-GANG PLASTER RING AND 1" CONDUIT STUBBED-UP CONCEALED TO ACCESSIBLE CEILING SPACE, UNLESS NOTED OTHERWISE. PROVIDE SURFACE MOUNTED DATA BOXES WITHIN CABINETRY, AND SELECT OTHER LOCATIONS AS INDICATED ON THE DRAWINGS. COORDINATE TELEPHONE/DATA BOX AND CONDUIT LOCATIONS AND SIZES WITH OWNER AND OTHER TRADES PRIOR TO ROUGH-IN.
- 9. MINIMUM BEND RADIUS FOR COMMUNICATIONS CONDUIT IS 6 TIMES THE INSIDE DIAMETER FOR CONDUITS 2" IN DIAMETER AND SMALLER AND 10 TIMES THE INSIDE DIAMETER FOR CONDUITS GREATER THAN 2" IN DIAMETER, UNLESS NOTED OTHERWISE.
- 10. ALL LOW VOLTAGE CLASS 2 OR 3 WIRING NOT IN CONDUIT SHALL BE PLENUM RATED WHERE
- 11. LOW VOLTAGE CABLE SHEATH LABELS AND RELATED MANUFACTURER INFO SHALL REMAIN APPARENT IN ALL EXPOSED APPLICATIONS, PROTECT ALL EXPOSED CABLING FROM PAINTING AND OVERSPRAY (INCLUDES CABLE NOT ROUTED IN CONDUIT AND THAT IS IN CABLE TRAY).
- APPLICABLE.

EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND SITE VISITS AND MAY NOT REFLECT ACTUAL "AS-BUILT" CONDITIONS, VERIFY EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BID. COORDINATE NEW AND DEMOLITION WORK WITH ALL OTHER TRADES AND EXISTING CONDITIONS.

ELECTRICAL SUPPLEMENTAL SPECIFICATIONS

- NOTIFY ARCHITECT, ENGINEER AND OWNER, AS APPLICABLE, IF ANY DANGEROUS CONDITIONS EXIST ON JOB SITE BEFORE ANY DEMOLITION OR REMODEL WORK BEGINS.
- 3. FOR AREAS AND EQUIPMENT WITHIN THE SCOPE OF THIS REMODEL: EXISTING ELECTRICAL EQUIPMENT AND CIRCUITRY MAY BE REUSED IF IN GOOD CONDITION AND NEW DESIGN REQUIREMENTS CAN BE MET;
- 4. FOR AREAS AND EQUIPMENT WITHIN THE SCOPE OF THIS REMODEL: REPAIR OR REPLACE ANY EXISTING DAMAGED OR RECALLED ELECTRICAL EQUIPMENT, LIGHT FIXTURES, WIRING DEVICES AND RELATED CIRCUITRY AND RESTORE ALL ELECTRICAL SYSTEMS TO PROPER WORKING ORDER. THE FINAL ELECTRICAL INSTALLATION SHALL BE FREE FROM ELECTRICAL DEFECTS TO THE SATISFACTION OF THE AHJ, OWNER,
- ARCHITECT AND ENGINEER. 5. PRIOR TO SUBMITTING BID, VISIT THE JOB SITE AND BECOME FULLY ACQUAINTED WITH THE EXISTING CONDITIONS, AS APPLICABLE, REVIEW THE OWNER CRITERIA, GENERAL NOTES, OTHER TRADE DRAWINGS AND SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS THAT MAY NOT BE CALLED OUT IN THIS PORTION OF THE CONSTRUCTION DOCUMENTS. NOTIFY ARCHITECT AND ENGINEER OF ANY CONFLICTS OR DISCREPANCIES PRIOR TO SUBMITTING BID.
- 6. ALL WORK SHALL CONFORM TO ALL LOCAL CODES AND ORDINANCES AS WELL AS APPLICABLE INDUSTRY STANDARDS. ALL EQUIPMENT SHALL BEAR LABELS FOR THE USE INTENDED BY AN AHJ ACCEPTED NATIONALLY RECOGNIZED TESTING LABORATORY (NRTL), SUCH AS UL OR ETL. THE FINAL ELECTRICAL INSTALLATION OF THE FACILITY OCCUPIED BY OWNER SHALL BE FREE FROM ELECTRICAL DEFECTS TO THE SATISFACTION OF THE AHJ, OWNER, ARCHITECT AND ENGINEER.
- 7. COORDINATE FINAL LOCATION AND INSTALLATION REQUIREMENTS OF ALL LIGHT FIXTURES. ELECTRICAL EQUIPMENT AND ELECTRICAL DEVICES WITH ARCHITECTURAL DRAWINGS, EXISTING CONDITIONS AND OTHER TRADES PRIOR TO ROUGH-IN, PROVIDE ALL NECESSARY DEVICES, CORDS, PLUGS, DISCONNECTS AND FINAL CONNECTIONS TO ELECTRICAL EQUIPMENT FOR PROPER OPERATION IN ACCORDANCE WITH CODE, OWNER AND MANUFACTURER REQUIREMENTS.
- 8. ELECTRICAL DRAWINGS ARE DIAGRAMMATIC/SCHEMATIC IN NATURE AND REPRESENT THE GENERAL SCOPE OF WORK IT IS NOT WITHIN THE SCOPE OF THE FLECTRICAL DRAWINGS TO SHOW ALL NECESSARY RACEWAY ROUTING, BENDS, OFFSETS, PULL BOXES AND OBSTRUCTIONS. CONTRACTOR SHALL COORDINATE THE FINAL LOCATION OF EQUIPMENT AND WIRING DEVICES WITH OTHER TRADES PRIOR TO INSTALLATION AND INSTALL ALL WORK TO CONFORM TO THE OWNER REQUIREMENTS.
- 9. ALL CONDUCTOR AND CONDUIT LENGTHS SHOWN IN THESE DESIGN DOCUMENTS ARE INTENDED SOLELY FOR USE IN THE DESIGN CALCULATIONS BY THE DESIGN PROFESSIONAL, UNLESS NOTED OTHERWISE. LENGTHS SHOWN SHALL NOT BE USED TO ASSIST IN THE BIDDING TAKEOFF PROCESS. THE CONTRACTOR IS SOLELY RESPONSIBLE FOR THE MATERIAL QUANTITIES REQUIRED TO BID AND CONSTRUCT THE
- 10. PROVIDE PROPER FIRE PROOFING AND SEALANT FOR PENETRATIONS THROUGH FIRE RATED ASSEMBLIES. THE FIRE STOPPING METHOD, MATERIAL AND ITS APPLICATION SHALL BE NRTL LISTED, CODE COMPLIANT AND APPROVED BY AHJ.
- 11. WHEN CONCRETE TRENCHING/CORING IS REQUIRED, THE METHODS, DEPTHS, AND LOCATIONS SHALL BE PRE-APPROVED BY ARCHITECT AND STRUCTURAL ENGINEER PRIOR TO THE START OF WORK. X-RAY SLAB AS NECESSARY TO AVOID DAMAGING ANY UNDER-SLAB UTILITIES OR STRUCTURE, SLAB REPLACEMENT SHALL BE INSTALLED WITH DOWELLING AND REINFORCED CONCRETE AS DIRECTED BY THE STRUCTURAL ENGINEER, WHERE SLAB ON GRADE IS SAW-CUT AND REMOVED FOR TRENCHING THE CONTRACTOR SHALL INSTALL MOISTURE BARRIER PER LANDLORD'S REQUIREMENTS. PROVIDE 3/4" MINIMUM CONDUITS ROUTED THROUGH SLAB AND STUBBED UP INTO DEVICES. FOR SLAB ON DECK, THE FLOOR SHALL BE SLEEVED AND EQUIPPED WITH THE APPROPRIATE LISTED ASSEMBLY. PROVIDE 3/4" MINIMUM CONDUITS ROUTED BELOW SLAB, TIGHT TO STRUCTURE, AND STUBBED UP INTO DEVICES.
- 12. ALL APPLICABLE SWITCHES, RECEPTACLES, OUTLETS, AND CONTROLS SHALL BE PLACED AT HEIGHTS THAT ARE IN ACCORDANCE WITH ADA ACCESSIBILITY GUIDELINES.
- 13. COORDINATE FLOOR MOUNTED BOX, RECEPTACLE, AND COVER PLATE TYPES WITH ARCHITECT AND
- OWNER PRIOR TO ORDER. 14. WIRING DEVICES ADJACENT TO EACH OTHER SHALL BE INSTALLED UNDER A SINGLE COVER PLATE, UNO.
- 15. WIRING DEVICES SHOWN BACK-TO-BACK ON A COMMON WALL SHALL BE OFFSET A MINIMUM OF 12" HORIZONTALLY TO REDUCE SOUND TRANSMISSION BETWEEN ROOMS. UNO.
- 16. ALL WP OUTLET BOX HOODS SHALL BE "EXTRA-DUTY" AND "WHILE-IN-USE COVER" TYPE. OUTLET BOX HOODS SHALL BE LOW PROFILE WHEREVER PRACTICABLE, UNLESS NOTED OTHERWISE. THE USE OF LARGE BUBBLE COVERS SHALL BE AVOIDED ON THE EXTERIOR OF THE BUILDING OR BEHIND EQUIPMENT IN
- ORDER TO PREVENT DAMAGE TO THE COVER AND TO ALLOW THE EQUIPMENT TO BE LOCATED CLOSE TO 17. ALL 120V RECEPTACLES 50A OR LESS, 208V AND 240V RECEPTACLES 100A OR LESS, SHALL BE GFCI PROTECTED IN LOCATIONS REQUIRED BY CODE; THIS INCLUDES EXTERIOR LOCATIONS AND RECEPTACLES
- WITHIN 6 FEET OF A SINK. GFCI RECEPTACLES SHALL BE READILY ACCESSIBLE AND SHALL NOT BE LOCATED BEHIND STATIONARY EQUIPMENT. GFCI PROTECTION MAY BE VIA A GFCI CIRCUIT BREAKER OR GFCI RECEPTACLE, UNLESS NOTED OTHERWISE. WHERE NECESSARY, GFCI PROTECTION MAY BE ACHIEVED VIA A BLANK FACE GFCI DEVICE LOCATED IN A READILY ACCESSIBLE LOCATION NEAR RECEPTACLE BEING PROTECTED. FOR DOWNSTREAM WIRING DEVICES LOCATED ON THE SAME BRANCH CIRCUIT, THE GFCI PROTECTION MAY BE PROVIDED FOR BY A SINGLE UPSTREAM DEVICE IF ALL PROTECTED DEVICES ARE LABELED PER CODE.
- 18. PROVIDE TAMPER-RESISTANT (TR) TYPE RECEPTACLES AT ALL CODE REQUIRED LOCATIONS AND AT LOCATIONS WHERE RECEPTACLES ARE MOUNTED LESS THAN 5'-6" AFF AND ARE EASILY ACCESSIBLE BY
- 19. FLEXIBLE CONDUIT IS ONLY PERMITTED WHERE SPECIFICALLY ALLOWED IN THE CONSTRUCTION DOCUMENTS, WHERE CONCEALED FROM VIEW OR EXPOSED FINAL CONNECTIONS TO LIGHT FIXTURES AND EQUIPMENT IN LENGTHS OF 6'-0" OR LESS.
- 20. ALL EMPTY CONDUIT/RACEWAY SHALL BE INSTALLED WITH PULL STRINGS. TERMINATE CONDUIT STUB-UP WITH A NYLON BUSHING.
- 21. EXPOSED CONDUIT/RACEWAY SHALL BE PAINTED TO MATCH ADJACENT SURFACE, UNLESS NOTED OTHERWISE. COORDINATE REQUIREMENTS WITH ARCHITECT AND OWNER PRIOR TO INSTALLATION.
- 22. CONDUITS/RACEWAYS SHALL BE CONCEALED FROM VIEW WHEREVER PRACTICABLE, UNLESS NOTED OTHERWISE. DO NOT ROUTE CONDUITS ACROSS SKYLIGHTS, ACCESS PANELS, HATCHED TILES, HVAC DIFFUSERS, OR EQUIPMENT WORKING CLEARANCE SPACE. ROUTE ALL EXPOSED NON-FLEXIBLE CONDUITS TIGHT TO STRUCTURE, PARALLEL TO BUILDING LINES AND IN STRUT OR CABLE/PIPE TRAY WHERE PRACTICABLE. INSTALL CONDUITS PLUMB/ LEVEL WHERE EXPOSED TO VIEW. COORDINATE RACEWAY ROUTING AND INSTALLATION WITH OTHER TRADES PRIOR TO ROUGH-IN.
- 23. PROVIDE LABEL AT EACH RECEPTACLE COVER PLATE WITH THE RESPECTIVE "PNLBD-CKT#" DESIGNATION. COORDINATE LABEL REQUIREMENTS WITH THE OWNER PRIOR TO INSTALLATION. REFER TO THE SPECIFICATIONS FOR MORE INFORMATION.
- 24. MULTIWIRE BRANCH CIRCUITS ARE NOT ALLOWED, UNLESS NOTED OTHERWISE.
- 25. PROVIDE INSULATED EQUIPMENT GROUNDING CONDUCTOR FOR ALL CIRCUITS, UNLESS NOTED
- 26. THE EMERGENCY LIGHTING SYSTEM HAS BEEN DESIGNED TO PROVIDE AN INITIAL FLOOR ILLUMINANCE LEVEL OF 1 FC AVERAGE, 0.1 FC MINIMUM AND NO MORE THAN A 40:1 MAX/MIN RATIO ALONG THE
- 27. ALL REMOTELY LOCATED LIGHT FIXTURE POWER SUPPLIES SHALL BE LOCATED IN AN ACCESSIBLE LOCATION WITH PROPER VENTILATION IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS. CONCEAL DEVICES AND RELATED WIRING FROM CUSTOMER/PUBLIC VIEW. PROVIDE ENCLOSURE IF REQUIRED. COORDINATE LOCATION AND ENCLOSURE TYPE WITH ARCHITECT AND OWNER PRIOR TO
- 28. REFER TO THE ARCHITECTURAL DRAWINGS FOR LIGHT FIXTURE LOCATIONS, MOUNTING HEIGHTS, TRACK LENGTHS AND ADDITIONAL MOUNTING INFORMATION. CONTRACTOR SHALL BE RESPONSIBLE FOR INSURING THAT COORDINATION AND CONFLICT ISSUES ARE RESOLVED PRIOR TO INSTALLATION OF LIGHT FIXTURES. CONTACT ARCHITECT/ENGINEER IMMEDIATELY IF THERE ARE DISCREPANCIES.
- 9. THROUGH WIRING OF RECESSED LIGHT FIXTURES, IN SUSPENDED CEILINGS, IS NOT PERMITTED. CONNECT EACH LIGHT FIXTURE BY A WHIP TO A JUNCTION BOX. PROVIDE CABLE WHIPS OF SUFFICIENT LENGTHS TO ALLOW FOR RELOCATING EACH LIGHT FIXTURE WITHIN A 5'-0" RADIUS OF ITS INDICATED LOCATION. CABLE WHIPS SHALL NOT EXCEED 6'-0" OF UNSUPPORTED LENGTHS.
- 30. ALL EMERGENCY LIGHTS AND EXIT SIGNS WITH INTEGRAL BATTERY BACK-UP SHALL BE CONNECTED TO A SEPARATE UNSWITCHED CONDUCTOR BYPASSING ALL OTHER CONTROLS AND CONTACTORS, UNLESS NOTED OTHERWISE. EXIT SIGNS SHALL NOT BE SWITCHED. REFER TO MANUFACTURER'S WRITTEN INSTRUCTIONS FOR PROPER INSTALLATION AND TESTING. ALLOW BATTERY TO CHARGE FOR A MINIMUM OF 48 HOURS BEFORE LIGHT LEVEL TESTING. IN ORDER TO PREVENT BATTERY DAMAGE, DO NOT TURN OFF POWER FOR EXTENDED PERIODS OF TIME AFTER EMERGENCY LIGHT HAS BEEN POWERED.
- 31. PROVIDE A NEUTRAL CONDUCTOR TO ALL WALL MOUNTED LINE VOLTAGE LIGHT SWITCHES, UNLESS NOTED OTHERWISE. IF NEUTRAL TERMINATION IS NOT REQUIRED FOR THE DEVICE THEN CAP CONDUCTOR AND TAG AS "NEUTRAL FOR FUTURE USE".
- 32. COORDINATE ALL OCCUPANCY/VACANCY SENSOR SETTINGS WITH OWNER AND ADJUST AS NECESSARY
- 33. DO NOT INSTALL OCCUPANCY/VACANCY SENSORS WITHIN 48" OF AIR DIFFUSER OR SIMILAR OBSTRUCTION THAT MAY ADVERSLY AFFECT THE SENSOR PERFORMANCE. COORDINATE FINAL SENSOR LOCATIONS WITH OTHER TRADES AND INSTALL IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.

LSR7 Robotics, GiC & **Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO LSW: 2600 SW Ward Rd, Lee's Summit MO

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100 Lee's Summit R-7 School Multistudio 301 NE Tudor Road 4200 Pennsylvania

Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655 multi.studio structural engineer: Bob D. Campbell & Company, Inc. Kaw Valley Engineering 14700 West 114th Terrace 4338 Belleview Lenexa, KS 66215 Kansas City, MO 6413

913.485.0318 816.531.4144 www.bdc-engrs.com kveng.com MEPFT/Code::

Henderson Engineers 8345 Lenexa Drive, Suite Lenexa, KS 66214 816.742.5000 www.hendersonengineers.com

8345 LENEXA DRIVE, SUITE 300 LENEXA, KS 66214 **TEL** 913.742.5000 **FAX** 913.742.5001 WWW.HENDERSONENGINEERS.COM MO. CORPORATE NO: E-556D EXPIRES 12/31/2022

September 9, 2022

Issue Date:

Revisions

DOUGLAS M BURNHART 09/09/2022

DOUGLAS M. EVERHART

LICENSE # PE-2019007648

LSHS - ELECTRICAL **GENERAL NOTES AND LEGEND**

multistudio

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086 N LSW: 2600 SW Ward Rd, Lee's Summit MO 64082 LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

owner: architect:

Lee's Summit R-7 School
301 NE Tudor Road
Lee's Summit, MO 64086 Kansas City, MO 641

301 NE Tudor Road
Lee's Summit, MO 64086
Kansas City, MO 64111
816.931.6655
multi.studio
civil engineer:
Kaw Valley Engineering
Structural engineer:
Bob D. Campbell & Company, Inc.

14700 West 114th Terrace
Lenexa, KS 66215
913.485.0318
kveng.com

MEPFT/Code::
Henderson Engineers
8345 Lenexa Drive, Suite


MEPFI/Code::
Henderson Engineers
8345 Lenexa Drive, Suite
300
Lenexa, KS 66214
816.742.5000
www.hendersonengineers.com

HENDERSON
ENGINEERS


8345 LENEXA DRIVE, SUITE 300
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001

WWW.HENDERSONENGINEERS.COM
2150005255
MO. CORPORATE NO: E-556D
EXPIRES 12/31/2022

Revisions
NUMBER DESCRIPTION DATE



LSHS - ELECTRICAL SITE PLAN
E100-C

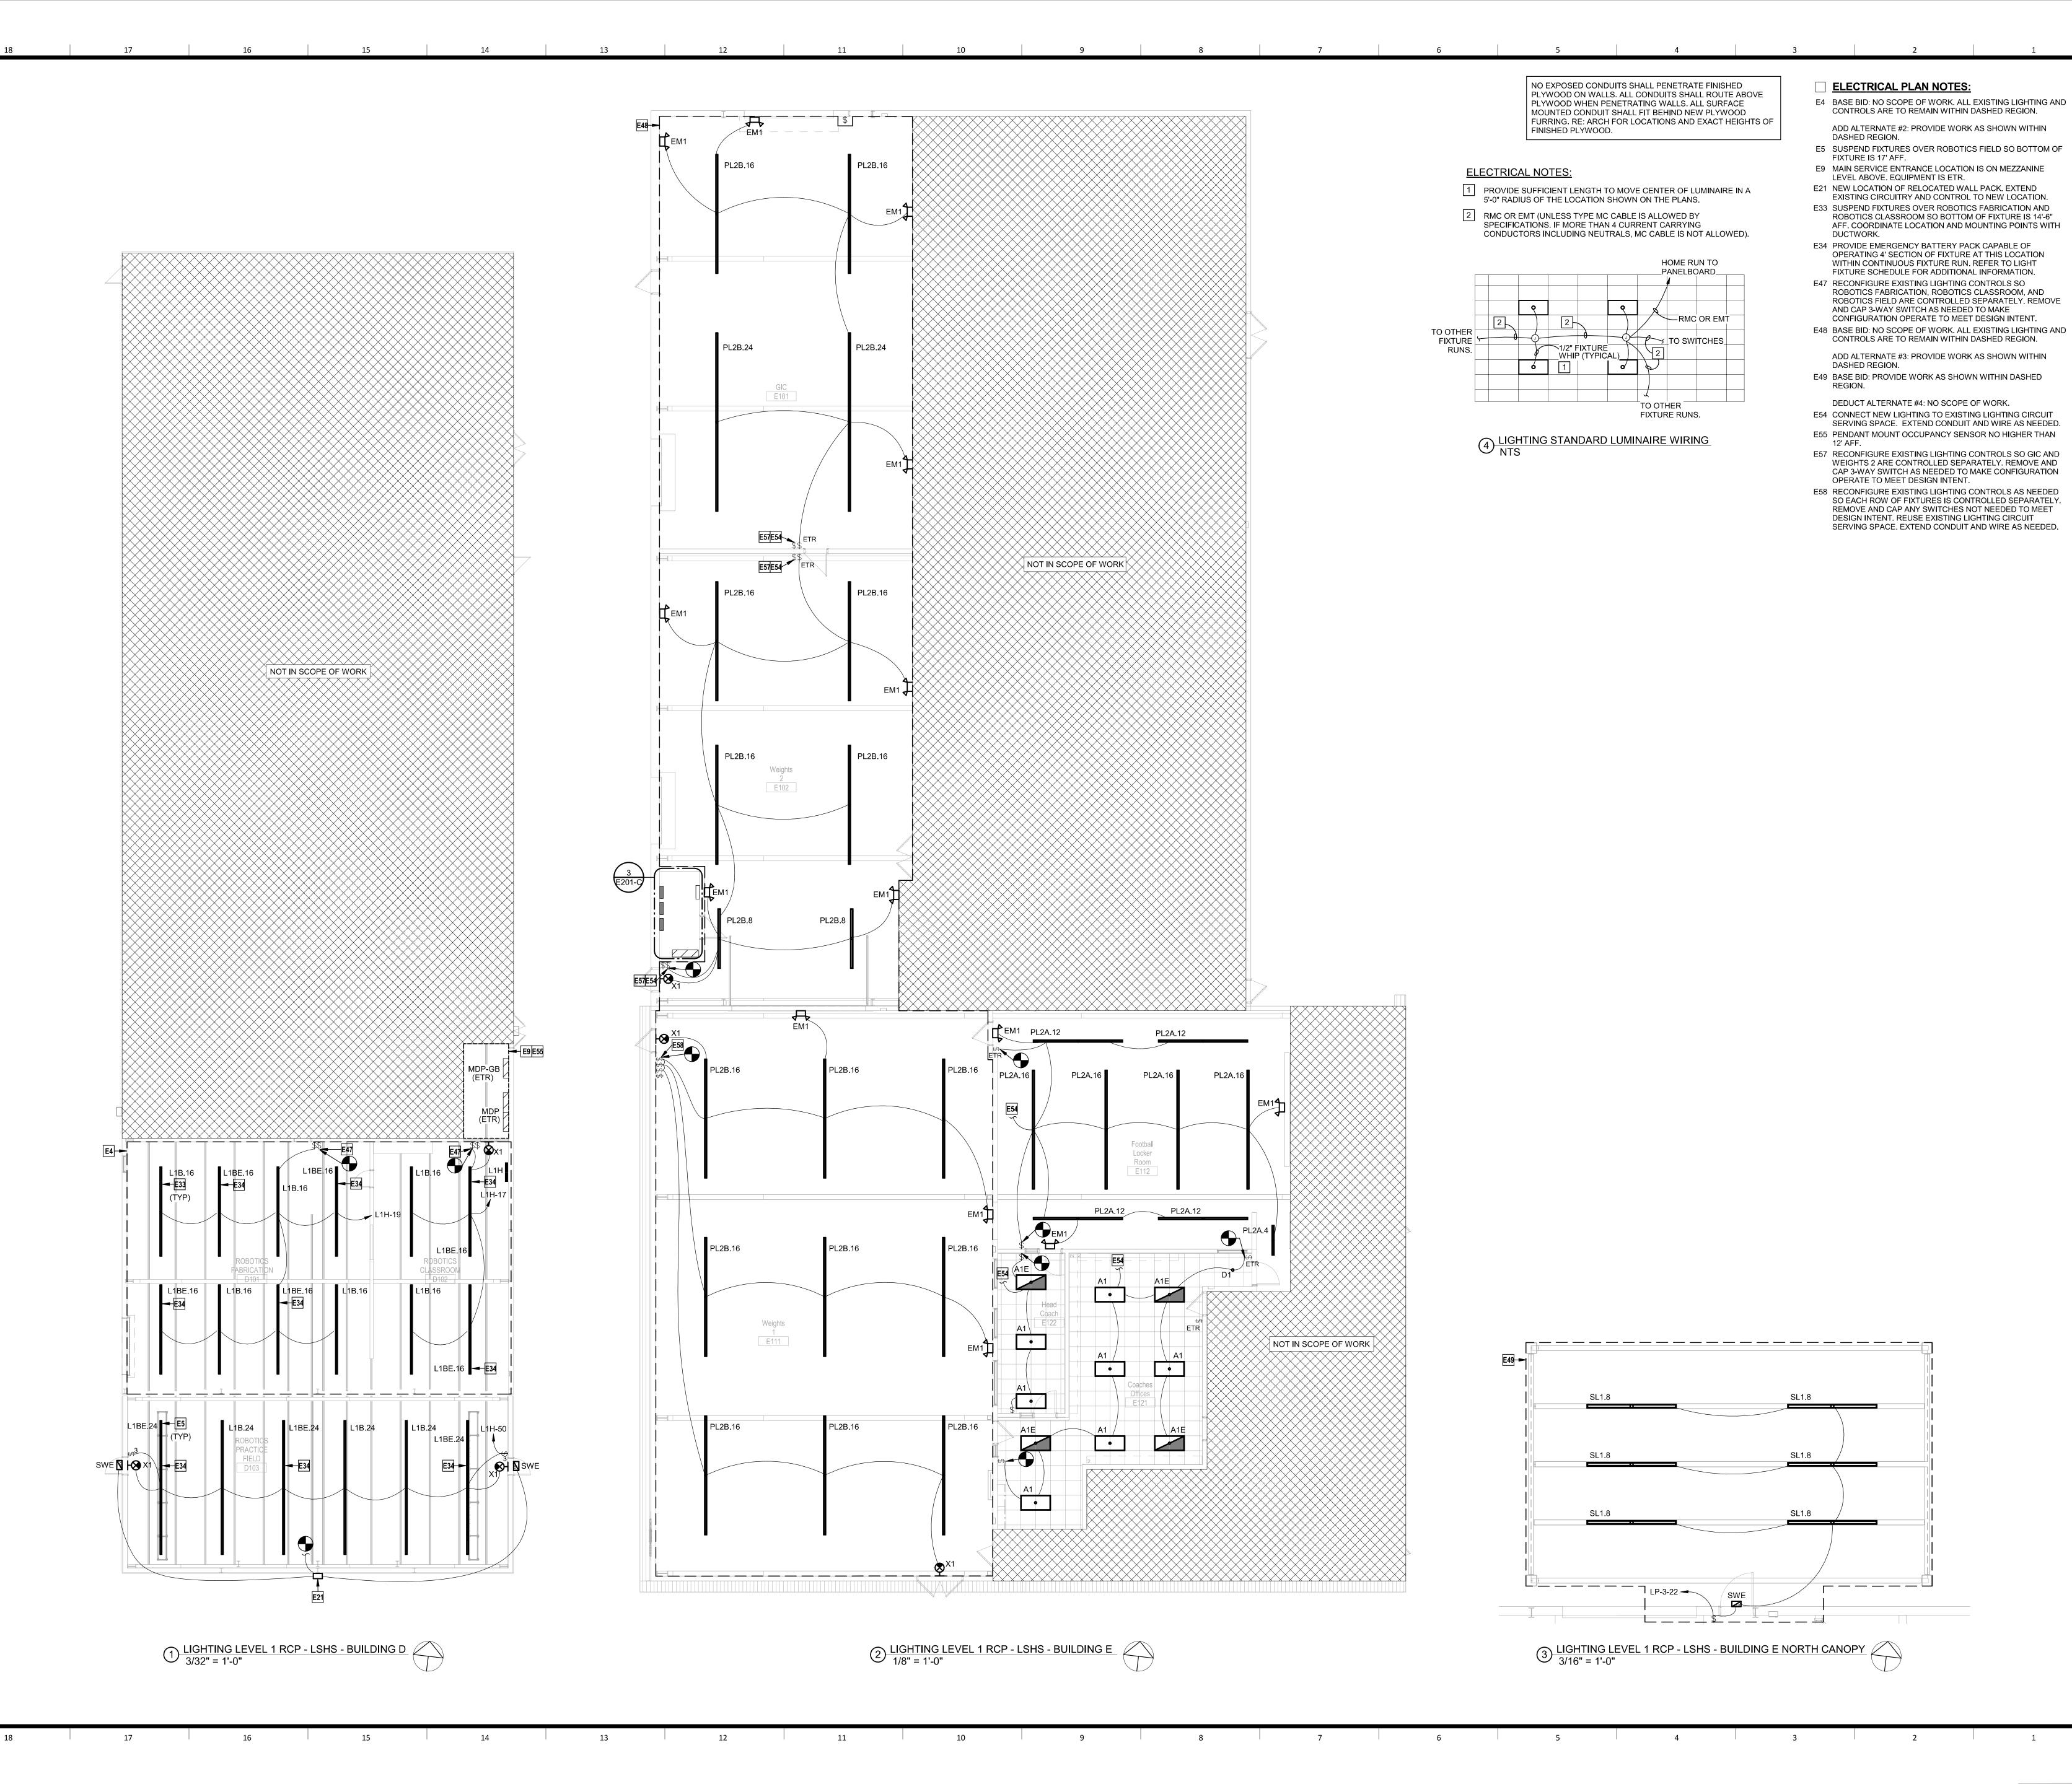

LSR7 Robotics, GiC & **Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO N LSW: 2600 SW Ward Rd, Lee's Summit MO

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Lee's Summit, MO 64086 Kansas City, MO 64111

0121-0100 Lee's Summit R-7 School Multistudio 301 NE Tudor Road 4200 Pennsylvania


816.931.6655 multi.studio structural engineer: Kaw Valley Engineering Bob D. Campbell & Company, Inc. 14700 West 114th Terrace 4338 Belleview Lenexa, KS 66215 Kansas City, MO 64111 816.531.4144

913.485.0318 www.bdc-engrs.com kveng.com MEPFT/Code::

Henderson Engineers 8345 Lenexa Drive, Suite

Lenexa, KS 66214 816.742.5000 www.hendersonengineers.com

8345 LENEXA DRIVE, SUITE 300 LENEXA, KS 66214 TEL 913.742.5000 FAX 913.742.5001



LSHS - LIGHTING RCP -LEVEL 1 - BUILDING D &

E101-C

LP-2-10 brace NOT IN SCOPE OF WORK braceLP-1-58 🔫 LP-1-57 NOT IN SCOPE OF WORK

NOT IN SCOPE OF WORK

PRACTICE

WP/WR**-**⇔

NO EXPOSED CONDUITS SHALL PENETRATE FINISHED PLYWOOD ON WALLS. ALL CONDUITS SHALL ROUTE ABOVE PLYWOOD WHEN PENETRATING WALLS. ALL SURFACE MOUNTED CONDUIT SHALL FIT BEHIND NEW PLYWOOD FURRING. RE: ARCH FOR LOCATIONS AND EXACT HEIGHTS OF FINISHED PLYWOOD.

VERIFY ALL EQUIPMENT PLUG TYPES AND ASSOCIATED RECEPTACLE NEMA RATINGS PRIOR TO ROUGH-IN.

ROBOTICS EQUIPMENT SCHEDULE

TAG	EQUIPMENT DESCRIPTION	VOLTAGE	PHASE	RECEPTACL TYPE
			•	
1B	BRIDGEPORT 3-AXIS CNC	208 V	3	15 - 20R
2B	HURCO BMC-2416 CNC	208 V	3	HARDWIRE
3B	HURCO HAWK 5M 3-AXIS CNC	208 V	3	15-30R
4B-1	HARDINGE LATHE (MAIN)	208 V	3	14 - 20R
4B-2	HARDINGE LATHE (CONTROLS)	120 V	1	5-20R
5B	DEWALT MITER SAW	120 V	1	5-20R
6B	BURR KING BELT SANDER	120 V	1	5 - 20R
7B	WILTON A5816 DRILL PRESS	120 V	1	5-20R
8B/10B	RYOBI BENCH GRINDER SHOP FOX DISC SANDER	120 V	1	RE: PLAN NOTE
9B	JET VERTICAL BANDSAW	208 V	3	14 - 20R
18B-1	TIG WELDER (MAIN)	208 V	1	6-50R
18B-2	TIG WELDER (MISC)	120 V	1	5 - 20R

	GIC EQUIPMEN	T SCHED	JLE	
TAG	EQUIPMENT DESCRIPTION	VOLTAGE	PHASE	RECEPTACL TYPE
1A	AIR COMPRESSOR	208 V	3	HARDWIRE
2A	MITER SAW	120 V	1	5-20R

120 V

PANEL SAW

ELECTRICAL PLAN NOTES:

- E7 REVISE AND EXTEND CIRCUITRY FOR RELOCATED SHORT THROW PROJECTOR. COORDINATE CONDUIT ROUTING WITH OWNER AND OTHER TRADES. EXISTING DEVICES AND RELATED CIRCUITRY MAY BE REUSED IF IN GOOD
- CONDITION, OTHERWISE REPLACE.

 E9 MAIN SERVICE ENTRANCE LOCATION IS ON MEZZANINE LEVEL ABOVE. EQUIPMENT IS ETR.
- E11 PROVIDE KH INDUSTRIES RTBB3L-WDD520-J12F
 RETRACTABLE CORD REEL OR APPROVED EQUIVALENT. 25'
 CORD LENGTH WITH #12/3 WIRES RATED FOR 20A AT 120V.
 (2) DUPLEX RECEPTACLES. NEMA 2 ENCLOSURE. SJOW
 BLACK CORD. 12 POSITION ADJUSTABLE GUIDE ARM WITH
 ADJUSTABLE RATCHED AND BALL STOP. 6' FEEDER CORD.
- E12 PROVIDE KH INDUSTRIES RTAN3LW-WCL520-J12F
 RETRACTABLE CORD REEL OR APPROVED EQUIVALENT. 25'
 CORD LENGTH WITH #12/3 WIRES RATED FOR 20A AT 120V.
 (1) TWISTLOCK L5-20R RECEPTACLE. NEMA 2 ENCLOSURE.
 SJOW BLACK CORD. 4-POSITION ADJUSTABLE ARM WITH (4)
 ROLLER GUIDES AND ADJUSTABLE BALL STOP. 6' FEEDER
 CORD. WHITE FINISH.
- E13 PROVIDE JUNCTION BOX AND HARDWIRE CONNECTION TO MOTORIZED ROLL-UP DOOR. COORDINATE ROUGH-IN AND CONTROL LOCATIONS WITH APPROVED MANUFACTURER PRIOR TO INSTALL.
- E17 REVISE AND EXTEND CIRCUITRY FOR RELOCATED PENDANT MOUNT PROJECTOR. COORDINATE CONDUIT ROUTING WITH OWNER AND OTHER TRADES. EXISTING DEVICES AND RELATED CIRCUITRY MAY BE REUSED IF IN GOOD CONDITION, OTHERWISE REPLACE.
- E24 REFER TO ARCHITECTURAL ELEVATIONS FOR RECEPTACLE MOUNTING HEIGHT(S) AT CAD STATIONS.
 E27 PROVIDE L5-20R TWISTLOCK RECEPTACLE ON DROP CORD.
 E28 PROVIDE JUNCTION BOX AND HARDWIRE CONNECTION TO MOTORIZED OVERHEAD GARAGE DOOR. COORDINATE ROUGH-IN AND CONTROL LOCATIONS WITH APPROVED
- E32 PROVIDE RECEPTACLE FOR NEW WALL MOUNTED IT RACK.
 COORDINATE FINAL LOCATION WITH TECHNOLOGY
 DRAWINGS PRIOR TO ROUGH-IN.


MANUFACTURER PRIOR TO INSTALL.

- E59 EXISTING ROLLING DOOR. PROTECT EXISTING CIRCUITRY AND CONTROL.E60 EXISTING WIREWAY MOUNTED AT APPROXIMATELY 10' AFF.
- PROTECT EXISTING WIREWAY AND ALL CONDUIT TERMINATIONS ENTERING AND LEAVING WIREWAY.

 E61 REVISE AND EXTEND CIRCUITRY FOR RELOCATED GAME CLOCKS. COORDINATE CONDUIT ROUTING WITH OWNER AND OTHER TRADES. EXISTING DEVICES AND RELATED CIRCUITRY MAY BE REUSED IF IN GOOD CONDITION,
- BREAKER WITH GFCI CIRCUIT BREAKER TO COMPLY WITH NEC 2017 210.8(B)(7).


 E62 ALL RECEPTACLES WITHIN DASHED REGION ARE EXISTING TO REMAIN.

OTHERWISE REPLACE. REPLACE EXISTING CIRCUIT

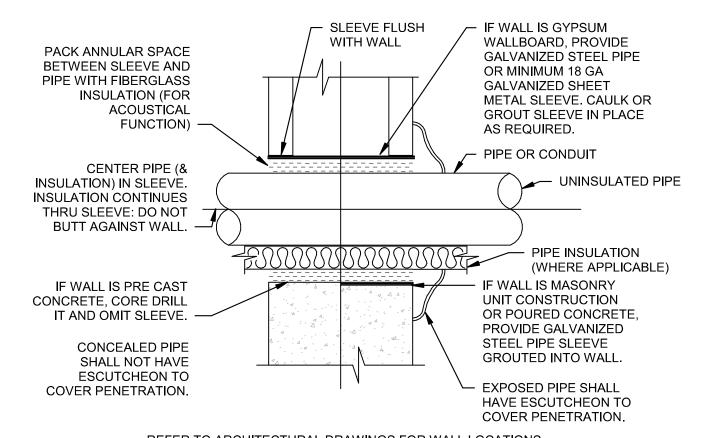

REFER TO ARCHITECTURAL DRAWINGS FOR WALL LOCATIONS.
REFER TO SPECIFICATIONS FOR ALTERNATIVE INSTALLATIONS.
COORDINATE REQUIREMENTS WITH GENERAL CONTRACTOR.

CONDUIT PENETRATION THRU NON-FIREWA

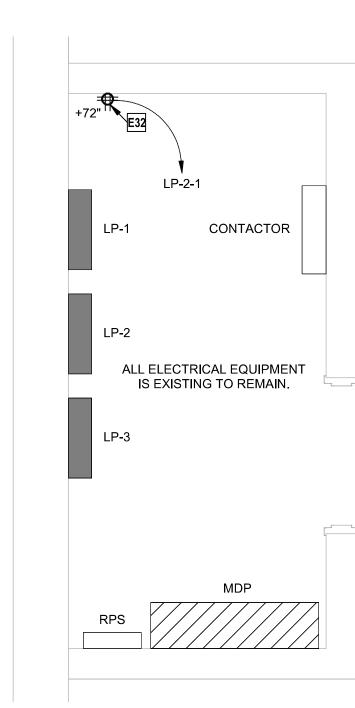

POWER LEVEL 1 PLAN - LSHS - BUILDING E - ELEC ROOM
1/2" = 1'-0"



LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086 LSW: 2600 SW Ward Rd, Lee's Summit MO

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063 0121-0100

wher: architect:

Lee's Summit R-7 School
301 NE Tudor Road
Lee's Summit, MO 64086

Kansas City, MO 64111
816.931.6655

multi.studio

civil engineer: structural engineer:

Kaw Valley Engineering Bob D. Campbell & Company, Inc.

14700 West 114th Terrace Lenexa, KS 66215 Kansas City, MO 64111

14700 West 114th Terrace
Lenexa, KS 66215
913.485.0318
kveng.com

MEPFT/Code::
Henderson Engineers

4338 Belleview
Kansas City, MO 64111
816.531.4144
www.bdc-engrs.com

Henderson Engineers
8345 Lenexa Drive, Suite
300
Lenexa, KS 66214
816.742.5000

www.hendersonengineers.com

DOUGLAS M. EVERHART LICENSE # PE-2019007648

8345 LENEXA DRIVE, SUITE 300 LENEXA, KS 66214 TEL 913.742.5000 FAX 913.742.5001

WWW.HENDERSONENGINEERS.COM


MO. CORPORATE NO: E-556D EXPIRES 12/31/2022

September 9, 2022

Issue Date:

LSHS - POWER PLAN -LEVEL 1 - BUILDING D &

E201-C

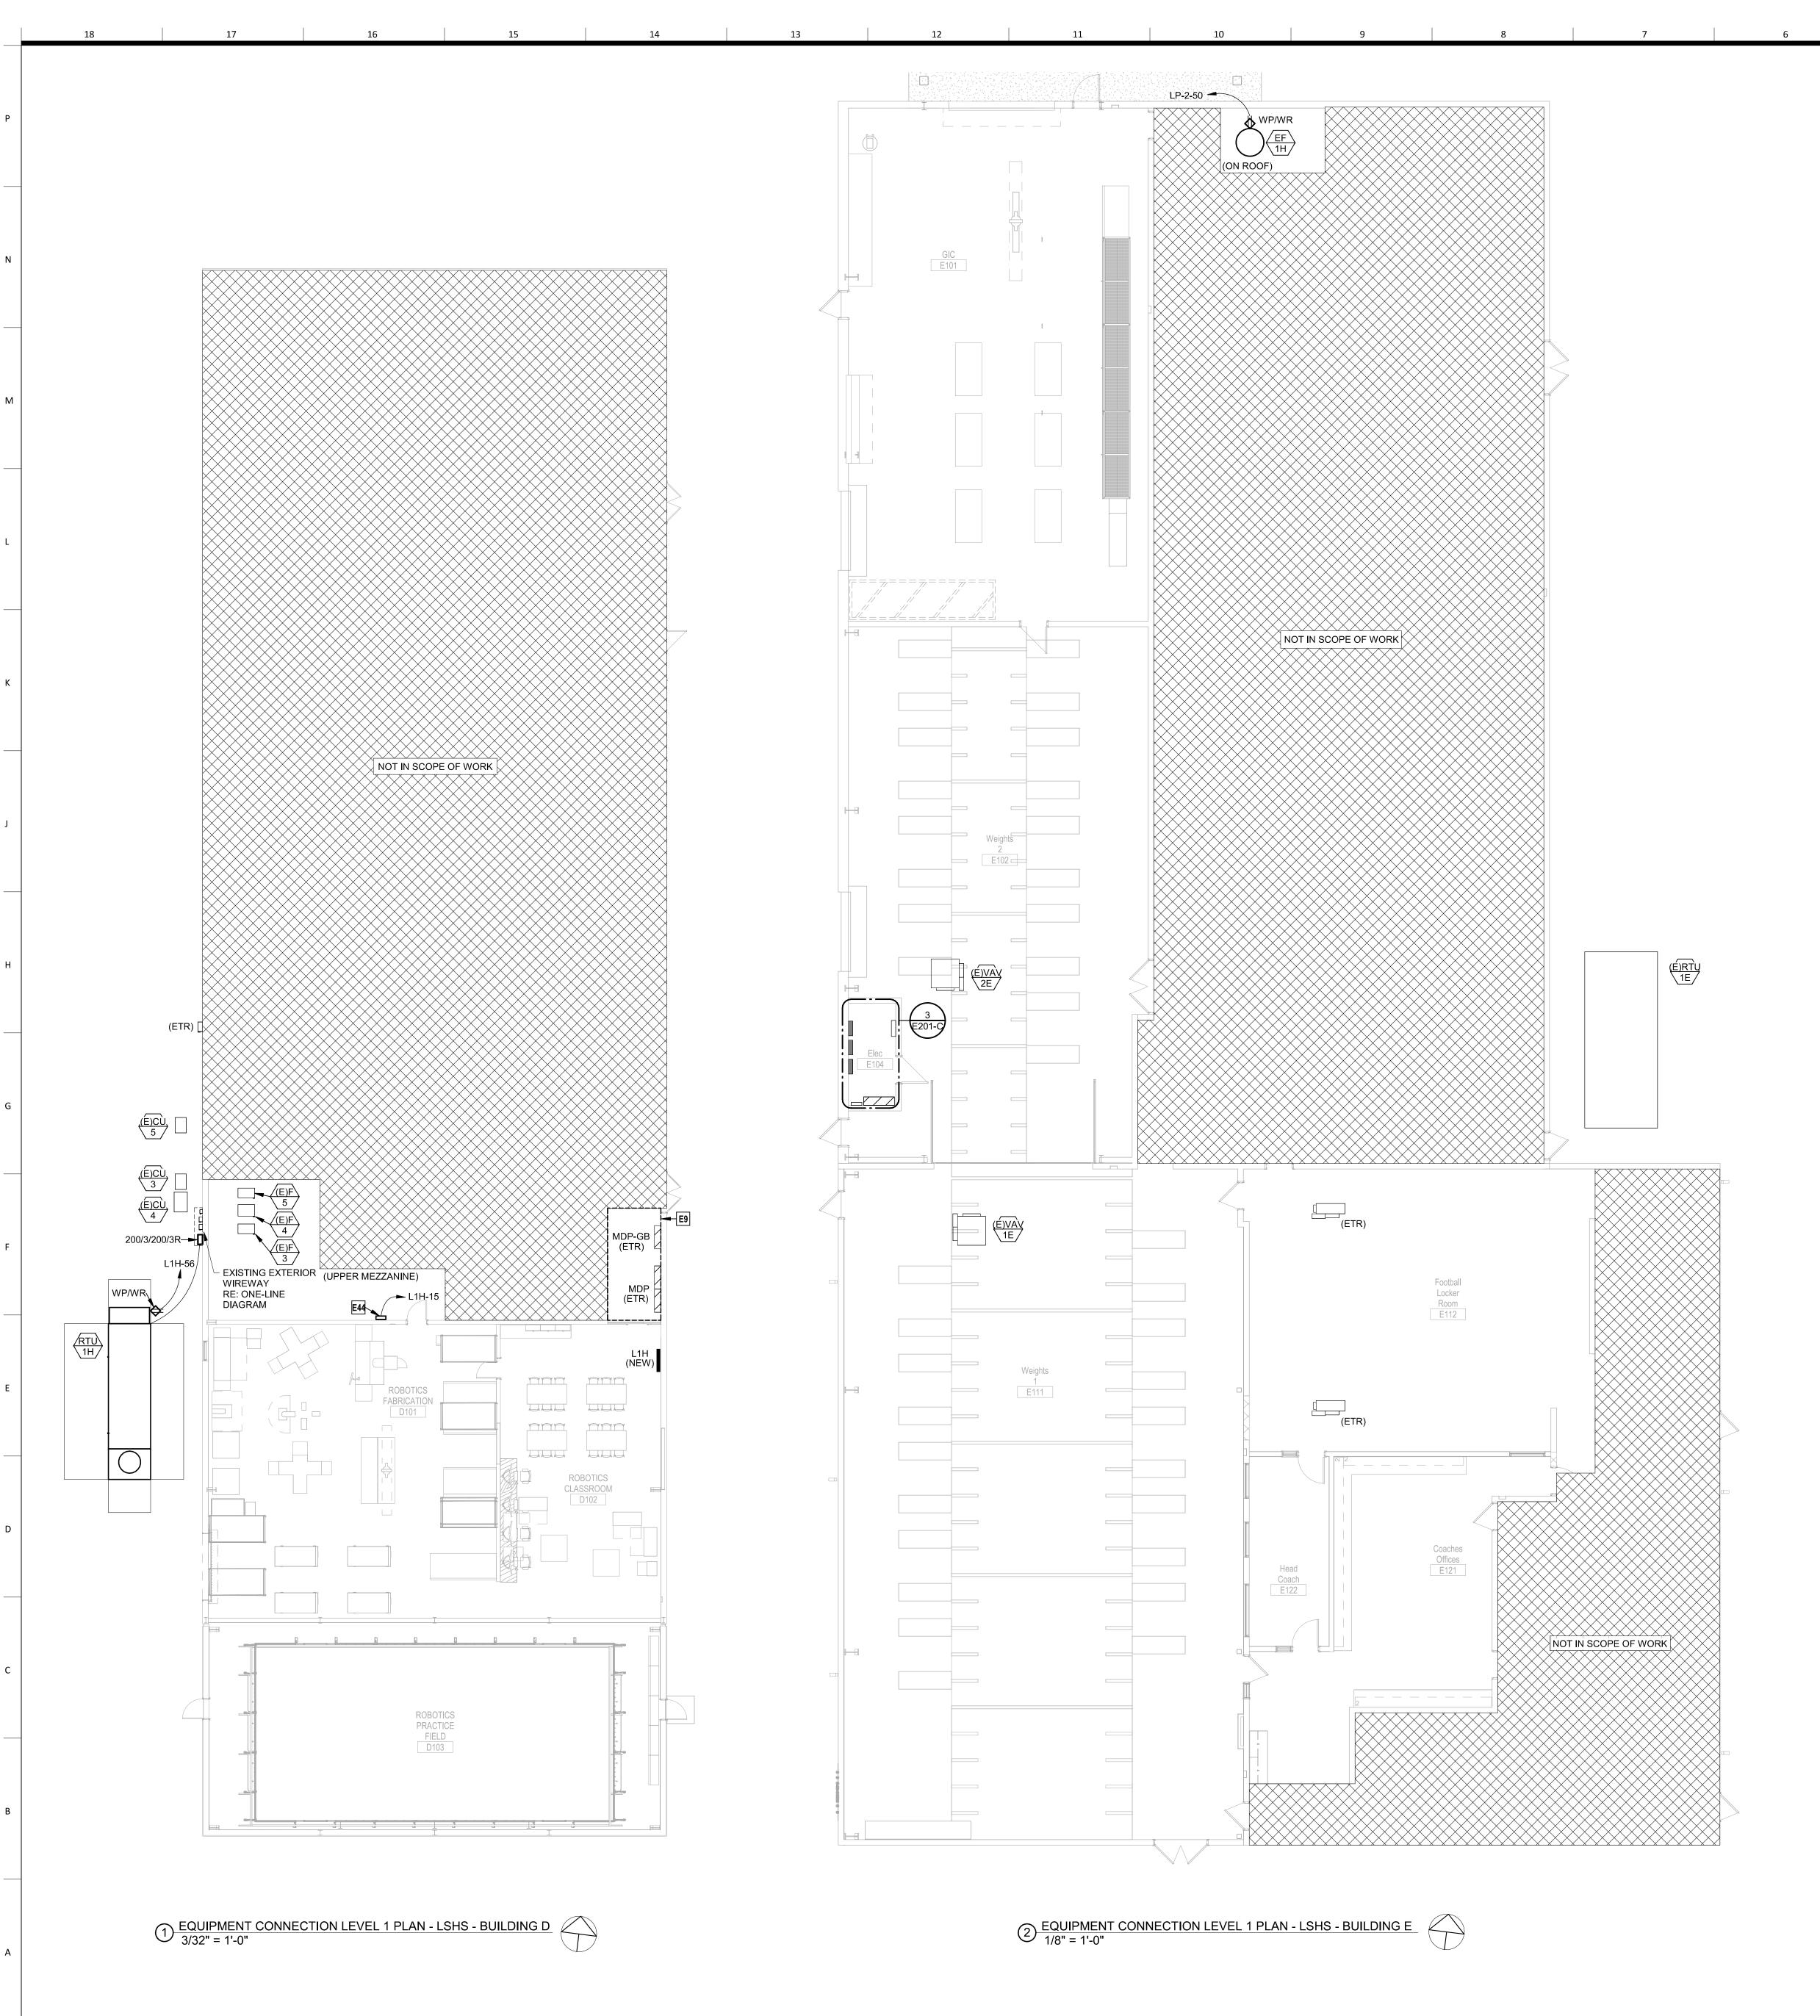

NO EXPOSED CONDUITS SHALL PENETRATE FINISHED PLYWOOD ON WALLS. ALL CONDUITS SHALL ROUTE ABOVE PLYWOOD WHEN PENETRATING WALLS. ALL SURFACE MOUNTED CONDUIT SHALL FIT BEHIND NEW PLYWOOD FURRING. RE: ARCH FOR LOCATIONS AND EXACT HEIGHTS OF FINISHED PLYWOOD.

ELECTRICAL PLAN NOTES:

- E9 MAIN SERVICE ENTRANCE LOCATION IS ON MEZZANINE
- LEVEL ABOVE. EQUIPMENT IS ETR. E44 PROVIDE CONNECTION TO BAS PANEL. COORDINATE FINAL LOCATION WITH MECHANICAL CONTRACTOR PRIOR TO

EQUIPMENT

CONNECTION SCHEDULE PANEL CIRCUIT NOTES

MDP 1,3,5 LP-2 57

EQUIPMENT CONNECTION GENERAL NOTES:

- COORDINATE FINAL LOCATIONS WITH MECHANICAL CONTRACTOR PRIOR TO ROUGH-IN.
- REFER TO MECHANICAL SCHEDULES FOR ADDITIONAL INFORMATION WITHIN SCOPE OF DIVISION 26. COORDINATE WITH MECHANICAL CONTRACTOR TO PROVIDE FINAL POWER REQUIREMENTS FOR ALL SUBMITTED EQUIPMENT THAT DIFFERS FROM BASIS-OF-DESIGN.

EQUIPMENT CONNECTION SCHEDULE NOTES:

- A. DISCONNECTING MEANS (FRACTIONAL HP SWITCH, FUSED DISCONNECT SWITCH, ETC.) AND/OR CONTROLLER (STARTER, VFD, ETC.) IS FACTORY MOUNTED OR PROVIDED BY DIVISION 23.
- B. PROVIDE FUSED DISCONNECT SWITCH SIZED PER EQUIPMENT MANUFACTURER'S SPECIFICATIONS AND THE NEC. REFER TO ELECTRICAL SYMBOLS LEGEND FOR NAMING DESIGNATIONS.
 - PROVIDE CONNECTION TO FACTORY PROVIDED 120V 20A GFCI RECEPTACLE.

LSR7 Robotics, GiC &

Phys Education LSN: 901 NE Douglas St., Lee's Summit MO

LSW: 2600 SW Ward Rd, Lee's Summit MO 64082 LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100

Lee's Summit R-7 School Multistudio 301 NE Tudor Road 4200 Pennsylvania Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655 multi.studio

structural engineer: Kaw Valley Engineering Bob D. Campbell & Company, Inc. 14700 West 114th Terrace 4338 Belleview Lenexa, KS 66215 Kansas City, MO 64111 913.485.0318 816.531.4144 kveng.com www.bdc-engrs.com

MEPFT/Code:: **Henderson Engineers** 8345 Lenexa Drive, Suite Lenexa, KS 66214 816.742.5000 www.hendersonengineers.com

8345 LENEXA DRIVE, SUITE 300 LENEXA, KS 66214 TEL 913.742.5000 FAX 913.742.5001



LSHS - EQUIPMENT CONNECTION PLAN -LEVEL 1 - BUILDING D &

E301-C

BUS A MAIN VOLT	NELBOARD: LP- MPS: 400A SIZE/TYPE: MLO S/PHASE: 208Y/120 V 3P/4V LIED BY: MDP	•	5)			FAULT (AIC RAT AIC RAT SERVES MOUNT LOCATI	FING: 10,000 S: BUILDIN FING: SURFAC	G E E						EQUIPMENT GR	OUND BUS
										1 1				LINE-SIDE LUGS: ME	CHANICAL
CKT	DESCRIPTION	I	OAD NOTES		BKR	PHASE	PHASE	PHA		P BKR		NOTES	LOAD	DESCRIPTION	CKT
NO.			YPE		AMP	Α	В	C	;		SIZE		TYPE		NO.
1	RCPT - WEIGHTS GENER		EX	EX	20	1 720 250		7		1 20	EX	EX		WATER COOLER - WEIGHTS	2
3	RCPT - MAIN LOCKER GE		EX EX	EX	20	<u>1 </u> 1	720 540	700	700	1 20	EX	EX EX		RCPT - WHIRLPOOL	4
5	RCPT - AUX LOCKER GE RCPT - CARDIO EQUIPMI		EX	EX	20	1 720 720		720	720	1 20	EX	EX		RCPT - TRAINER RCPT - TRAINER	6 8
9	RCPT - CARDIO EQUIPMI		EX	EX	20	1 720 720	720 720	7		1 20	EX	EX		RCPT - TRAINER	10
11	RCPT - COACHES OFFIC		EX	EX	20	<u>' </u>	120 120	540	500	1 20	EX	EX		EF-2	12
13	RCPT - COACHES OFFIC		EX	EX	20	1 540 250		0.0		1 20	EX	EX		WATER COOLER - WRESTLING	14
15	PROJECTOR - LOCKER		EX	EX	20	1	500 800	7		1 20	EX	EX		RCPT - WASHER	16
17	PROJECT/SMART BOARD		EX	EX	20	1		500	0	1 20	EX	EX		SPARE - ABV CLG IN COACH OFFICE	<u> </u>
19	PROJECTOR - WRESTLIN		EX	EX	20	1 500 1200				1 20	EX	EX		ICE MACHINE - TRAILER	20
21	SCOREBOARDS - WRES		EX	EX	20	1	500 250			1 20	EX	EX		PLASMA SCREEN - WRESTLING	22
23	RCPT - WRESTLING GEN		EX	EX	20	1	\neg	720	250	1 20	EX	EX		SPEAKERS - WRESTLING	24
25	CEILING FANS - WRESTL	ING	EX EX	EX	20	1 500 800	500 2000	٦		1 20	EX	EX		RCPT - WASHER	26
27 29	PROJECTOR SCREEN RCPT - AV CLOSET		EX	EX	20	<u>1 </u> 1	500 2200	500	2200	2 30	EX	EX		RCPT - DRYER	28 30
31	RCF1-AV CLOSE1		LA	+ -	20	6000 540		300	2200	1 20	EX	EX		RCPT - LAUNDRY ROOM/UNIFORMS	
33	VAV 1-1		EX	EX	70	3	6000 500	7		1 20	EX	EX		WH RECIRC PUMP	34
35	, ,,,,				'		0000 000	6000	500	1 20	EX	EX		BAS PANEL	36
37						6000 1500									38
39	VAV 1-2		EX	EX	70	3	6000 1500]		3 20	EX	EX		UH-1	40
41								6000	1500						42
43						6000 2000									44
45	VAV 1-3		EX	EX	70	3	6000 2000			3 25	EX	EX		VAV 1-5	46
47								6000	2000						48
49					0.5	2000 2000	0000	٦		0 05		>.		V/A\/ 4 O	50
51	VAV 1-4		EX	EX	25	3	2000 2000	2000	2000	3 25	EX	EX		VAV 1-6	52
53 55	EXHAUST FAN EF-1		EX	EX	20	1 250 1080		2000	2000	1 20	12	R,GF	R	RCPT - LCKR RM TVS	54 56
57	RCPT - HEAD COACH		R R	12	20	1 230 1000	540 900	7		1 20	12	R	R	RCPT - COACHES OFFICE	58
59	SPARE			12	20	<u>.</u> 1	010 000	0	250	1 20	12	N, GF	Z	RCPT - WEIGHTS EWC	60
61	EQUIPPED SPACE					1 0 0				1		,		EQUIPPED SPACE	62
63	EQUIPPED SPACE					1	0 0			1				EQUIPPED SPACE	64
65	EQUIPPED SPACE					1	_	0	0	1				EQUIPPED SPACE	66
67	EQUIPPED SPACE					1 0 0		7		1				EQUIPPED SPACE	68
69	EQUIPPED SPACE					1	0 0			1				EQUIPPED SPACE	70
71	EQUIPPED SPACE					1		0	0	1				EQUIPPED SPACE	72
			TOTAL	LOAD	(VA):	33570 VA	34890 VA	32900	0 VA						
			TOTAL	AMPS		281 A	292 A	274	1 A						
LOAD	TYPE	CONNECTED LOAD	DEMAND FACTOR		DEMA					T				PANELBOARD TOTALS	
FYIQT	ING LOAD (E)	98590 VA	100%	as	3590 VA										
	ING (C)	0 VA	0%		0 VA									TOTAL CONNECTED LOAD	101360 VA
	ING (H)	0 VA	100%		0 VA									TOTAL NEC LOAD	101360 VA
LIGH	TNG (L)	0 VA	125%		0 VA										
	PTACLES (R)	2520 VA	100%		520 VA									TOTAL CONNECTED CURRENT	281 A
	DRS (M)	0 VA	100%		0 VA									TOTAL NEC DEMAND CURRENT	281 A
	LEMENTAL HEAT (U)	0 VA	100%		0 VA										
	EQUIP (Z) IGERATION (F)	250 VA 0 VA	100% 100%		250 VA 0 VA	_									
	AGE (S)	0 VA	125%		0 VA 0 VA										
	IEN (K)	0 VA	100%		0 VA										
	EST MOTOR	0 VA	125%		0 VA										
LARG	•					—									
	V WINDOW (W)	0 VA	125%		0 VA										

PANELBOARD: LP-2 BUS AMPS: 225A MAIN SIZE/TYPE: MLO VOLTS/PHASE: 208Y/120 V 3P/4V SUPPLIED BY: MDP	•	G)					FAULT C AIC RATI AIC RATI SERVES MOUNTI LOCATIO	NG: : NG:	<10,000 FULLY R 10,000 BUILDING SURFAC Elec E104	G E E							EQUIPMENT GI LINE-SIDE LUGS: M	
CKT DESCRIPTION		LOAD	NOTES	WIDE	BKR I	2 0	IASE	PHA	A C F	DII	ASE		DIZD	WIDE	NOTES	LOAD		CKT
CKT DESCRIPTION NO.		TYPE			AMP		ASE A		40E 3		40E C			SIZE	NOTES	LOAD TYPE		NO.
1 RCPT - ELEC E104 DATA		Z	R	12	20		1080					1	20	12	R	R	RCPT - NEW WEIGHTS E	2
3 RCPT - NEW WEIGHTS W5 WEIGHTS GARAGE DOO		R Z	R R	12 12	20	<u>1 </u> 1		900	720	800	0	2		12	R	R	RCPT - NEW WEIGHTS N SPARE	6
7 SPARE				12		2 0	0]		800	0	- -	20		D		SPANE	8
9			D					0	720			1	20	12	R	R	CRD REEL - GIC TABLES 1	10
11 SPARE			D		20	2 0	5820	7		0	5820	$\frac{1}{3}$	70	4	N	M	GIC AIR COMPRESSOR	12 14
15						0	3020	0	5820				70	+	IN	IVI	GIC AIR COMPRESSOR	16
17 SPARE			D		20	3		٦		0	0							18
19 21						0	0	0	0			3	20		D		SPARE	20 22
23 SPARE			D		20	3		U	U	0	720	1	20	12	R	R	CRD REEL - GIC TABLES 2	24
25						0	720				I	1	20	12	R	R	CRD REEL - GIC TABLES 3	26
27 RCPT - GIC E WALL 29 RCPT - GIC NE WALL		R R	R R	12 12	20	<u>1 </u> 1		900	900	900	180	1	20 20	12 12	R R	R	RCPT - GIC SE WALL EXT RCPT - GIC CANOPY	28 30
31 SPARE		K		12	20	•	0			900	100	2		12		K	SPARE	32
33			D					0	0						D			34
35 GIC N GARAGE DOOR 37 RCPT - GIC ABV CTR W	1	Z	R, VD	10 12	20		0	7		1200	0	2	20		D		SPARE	36 38
37 RCPT - GIC ABV CTR W 7	l	R	R	12	20	1 360	U	0	0			2	20				SPARE	40
41 SPARE			D		20	3				0	0	-			D			42
43					00	0	0					1	00				EQUIPPED SPACE	44
45 SPARE 47			D		20	2		0	0	0	0	2	20		D		SPARE	46 48
49 EQUIPPED SPACE						1 0	180			J		1	20	12	R	R	EXT RCPT - EF-1H	50
51 RCPT - GIC ABV CTR W 2	2	R	R	12		1		540	0	1000		1			D		SPARE	52
53 RCPT - GIC PANEL SAW55 DROP RCPT - GIC MITER	ΡΩΝ	M M	R, VD R, VD	10 10	20		0]		1800	0	1			D D		SPARE SPARE	54 56
57 EF-1H	N OAVV	M	R,VD	10	20		0	1656	0			1			D		SPARE	58
59 SPARE			D		20	1		1		0	0	1	20		D		SPARE	60
61 SPARE 63 SPARE			D		20 20		0	0				1					EQUIPPED SPACE EQUIPPED SPACE	62 64
65 SPARE			D D		20	-		U	0	0	0	1					EQUIPPED SPACE	66
67 SPARE			D			1 0	0			<u>-</u>		1					EQUIPPED SPACE	68
69 EQUIPPED SPACE						1		0	0			1					EQUIPPED SPACE	70
71 EQUIPPED SPACE						1				0	0	1					EQUIPPED SPACE	72
			TOTAL I	OAD ((VA):	107	60 VA	1215	6 VA	1142	0 VA	4						
			TOTAL	AMPS:		9	0 A	102	2 A	96	6 A							
LOAD TYPE	CONNECTED LOAD		EMAND ACTOR	NEC	DEMAN	ID PANEL	BOARD N	OTES									PANELBOARD TOTALS	
EXISTING LOAD (E)	0 VA		100%		0 VA												TOTAL CONNECTED LOAD	34335 VA
COOLING (C)	0 VA		0%		0 VA													
HEATING (H) LIGHTING (L)	0 VA 0 VA		100% 125%		0 VA 0 VA												TOTAL NEC LOAD	38700 VA
RECEPTACLES (R)	8820 VA		100%	88	320 VA												TOTAL CONNECTED CURRENT	95 A
MOTORS (M)	5256 VA		100%		256 VA												TOTAL NEC DEMAND CURRENT	107 A
SUPPLEMENTAL HEAT (U) MISC EQUIP (Z)	0 VA 2800 VA		100% 100%		0 VA 800 VA													
REFRIGERATION (F)	0 VA		100%		0 VA													
SIGNAGE (S)	0 VA		125%		0 VA													
KITCHEN (K)	0 VA		100%		0 VA													
LARGEST MOTOR SHOW WINDOW (W)	17459 VA 0 VA		125% 125%		824 VA 0 VA													
TRACK LIGHTING	0 VA		100%		0 VA												I .	

BUS A MAIN VOLTS	NELBOARD: L1H AMPS: 400A SIZE/TYPE: MLO S/PHASE: 208Y/120 V 3P/4W	,						A A S M	IC RATE IC RATII ERVES: IOUNTIN	ED: NG: NG:	ROBOTIC SURFACI	ATED 6 MINIMUN S/CLASSF	И ROOM	200					EQUIPMENT GR	ROUND BL
SUPP	LIED BY: MDP-GB							L,	OCATIO	IN:	ROBOTIC	S CLASSF	ROOM DT	02					LINE-SIDE LUGS: ME	ECHANICA
CKT	DESCRIPTION		LOAD		WIRE		Р	PHASE	E		ASE B	PHA (BKR \		NOTES	LOAD	DESCRIPTION	CK
NO. 1 3	RCPT - HARDINGE LATHE	(MAIN)	TYPE M		SIZE		3 75	57	1900	757	1900		<u>, </u>	3	AMP 20	SIZE	V	TYPE	SHARED ROBOTICS	NO 2 4
5	RCPT - HARDINGE LATHE	(CTDLS)	Z		12	20	1 50	00	1500			757	1900	2	20				SHARED ROBOTICS	6 8
9					12		1 30	00	1300	481	1500						V			10
11 13	RCPT - JET VERTICAL BAN	NDSAW	M		12	20	3 48	81	1500			481	1500	2	20		V		FUME COLLECTOR	12
15	BAS PANEL		Z		12	20	1	01	1000	500	1500			2	20		V		LASER ENGRAVER	16
17 19	LTG - ROBOTICS CLASSRO	ООМ	L		12 12		1 1 15	552	1200			393	1500	1	20				MICROWAVE #1	2
21	RCPT - TIG WELDER MISC	•	R		12		1 13	002	1200	180	1200			1	20				MICROWAVE #1	2
23	RCPT - TIG WELDER MAIN		M		8		2		L	100	1200	4160	1200	1	20		V		MICROWAVE #3	2
25								160	800					1	20		V		REFRIGERATOR #1	2
27										829	800			1	20		V		REFRIGERATOR #2	2
29	DROP RCPT - 3 AXIS CNC		M		12	20	3					829	800	1	20		V		REFRIGERATOR #3	3
31								29	1080					1	20		V		SHARED ROBOTICS	3
33	DROP RCPT - WILTON DR	ILL PRESS	M		12	20			L	1320	1080	4.440	4000	1	20		V		RECEPTACLE FRONT HALL	3
35	CRD REEL - ROB AREA 1	0.000	Z		12		1	200	700			1440	1080	1	20	40	V	<u> </u>	RECEPTACLE FRONT HALL	3
37 39	DROP RCPT - DEW MITER	SAW	M		12	20	1 16	880	720	4972	720			1	20	12 12		R	RCPT - ROB CLSRM TWSTLCKS RCPT - CAD STATION CKT 1	3
41	HURCO BMC-2416 CNC		М		6	60	3		L	4912	120	4972	1080	1	20	12		R	RCPT - CAD STATION CKT 1	4
43	TIONGO BINO 2410 GIVO		101				-	972	720			4012	1000	1	20	12		R	RCPT - CAD STATION CKT 3	4
45								,,,_	720	2642	720			1	20	12		R	RCPT - ROB CLSRM E WALL	
47	RCPT - HURCO HAWK 3-A	XIS	М		10	30	3		L			2642	540	1	20	12		R	RCPT - S EXTERIOR	4
49								642	1756					1	20	10	VD	L	LTG - ROBOTICS FIELD	5
51	CRD REEL - ROB TABLES		R		12	20		•		720	1320			1	20	12		М	DROP RCPT - BURR BELT SANDER	5
53	CRD REEL - ROB TABLES		R		12							720	540	1		12		R	RCPT - N CLSRM TV	5
55	ROBOTICS COILING DOOF	₹	M		12	20		200	180	=					20	12		R	EXT RCPT - RTU-1H	Ę
57	RCPT - ROB FIELD S RCPT - ROB FIELD SE		R		12	20			L	720	0	000	0		20				SPARE SPARE	5
59 61	RCPT - ROB FIELD SE	ELD.	R R		12 12	20 20		60	0			900	0						SPARE	6
63	RCPT - ROB NORTH WALL		R		12	20		00	0	360	0				20				SPARE	6
65	RCPT - ROB EAST WALL	_	R		12	20			L	300	0	540	0		20				SPARE	- 6
67	CRD REEL - ROB CLSRM		R		12	20		20	0			010			20				SPARE	6
69	SPARE					20			-	0	0			1	20				SPARE	7
71	SPARE					20						0	0	1	20				SPARE	7
73	SPARE					20		0	0					1					SPARE	7
75	SPARE					20	1			0	0			1	20				SPARE	7
77	EQUIPPED SPACE						1					0	0	1					EQUIPPED SPACE	7
79	EQUIPPED SPACE							0	0					1					EQUIPPED SPACE	3
81	EQUIPPED SPACE						1		L	0	0			1					EQUIPPED SPACE	3
83	EQUIPPED SPACE						1					0	0	1					EQUIPPED SPACE	8
				TOTAL	LOAD (VA):		31207 \	/A	2421	9 VA	2797	2 VA							
				TOTAL	AMPS:			265 A	\	20:	2 A	238	3 A							
LOAD	TYPE	CONNECTE		EMAND ACTOR	NEC	DEMAN	ND PA	ANELBO	ARD NO	TES				_					PANELBOARD TOTALS	
EXIST	ING LOAD (E)	23940 VA		100%	239	940 VA													TOTAL COMMENTED LOAD	004003
COOL	ING (C)	0 VA		0%) VA													TOTAL CONNECTED LOAD	83400 \
	ING (H)	0 VA		100%) VA													TOTAL NEC LOAD	87834 ∖
	TNG (L)	3701 VA		125%		26 VA													TOTAL CONNECTED CURRENT	231 A
	PTACLES (R)	10440 VA		98%		220 VA														
	DRS (M)	27964 VA		100%		964 VA													TOTAL NEC DEMAND CURRENT	244 <i>F</i>
	LEMENTAL HEAT (U)	0 VA 2440 VA		100%		0 VA 40 VA														
	EQUIP (Z) IGERATION (F)	0 VA		100%		40 VA) VA	-													
	AGE (S)	0 VA 0 VA		125%) VA) VA														
	HEN (K)	0 VA 0 VA		100%) VA) VA	-													
	EST MOTOR	14915 VA		125%		3 V A 344 V A														
	V WINDOW (W)	0 VA		125%) VA														
	K LIGHTING	0 VA		100%) \/A														

PANELBOARD: LP-	3 (EXISTIN	G)							: <10,000	ATED							EQUIPMENT G	ROUND BUS
DUO AMBO, 400A						AIC RATED: FULLY RATED												
BUS AMPS: 100A		AIC RATING: 10,000																
MAIN SIZE/TYPE: MLO			SERVE	S:	BUILDING													
VOLTS/PHASE: 208Y/120 V 3P/4\			MOUNT	ING:	SURFAC													
SUPPLIED BY: MDP			LOCATI	ON:	Elec E104	ļ												
																	LINE-SIDE LUGS: M	ECHANICAL
KT DESCRIPTION O.		LOAD TYPE	NOTES	WIRE SIZE	BKR P AMP	PH	PHASE A		PHASE B		PHASE C		BKR AMP		NOTES	LOAD TYPE	DESCRIPTION	CKT NO.
1 LTG - WEIGHTS SOUTH			EX	EX	20 1	800	800					1	20	EX	EX		LTG - ROBOTICS #2	2
3 LTG - WEIGHTS MIDDLE			EX	EX	20 1			800	800			1	20	EX	EX		LTG - ROBOTICS 2 #1	4
5 LTG - WEIGHTS NORTH			EX	EX	20 1				-	800	800	1	20	EX	EX		LTG - WRESTLING	6
7 LTG - WRESTLING			EX	EX	20 1	800	800					1	20	EX	EX		LTG - WRESTLING	8
9 LTG - WRESTLING			EX	EX	20 1		-	800	200			1	20	EX	EX		LTG - LAUNDRY/MECHANICAL	10
11 LTG - TOILET, AV, STORA	AGE		EX	EX	20 1					200	300	1	20	EX	EX		LTG - OFFICE AND SUPPORT	12
13 LTG - MAIN LOCKER			EX	EX	20 1	300	800					1	20	EX	EX		LTG - MAIN LOCKER 2	14
15 LTG - AUX. LOCKER			EX	EX	20 1			300	300			1	20	EX	EX		LTG - BUILDING EXTERIOR	16
17 LTG - BUILDING EXTERIO)R		EX	EX	20 1			_		300	800	1	20	EX	EX		LTG - ROBOTICS 1 #2	18
19 CONTACTOR			EX	EX	20 1	500	800					1	20	EX	EX		IRRIGATION SYSTEM	20
21 SPARE			D		30 1			0	478			1	20	10	R, VD	L	EXT LTG - GIC CANOPY	22
23 SPARE			EX		20 1			_		0	0	1	20				SPARE	24
25			Б.		50 0	0	0					1	20				SPARE	26
27 SPARE			D		50 3			0	0			1	20				SPARE	28
29										0	0	1	20				SPARE	30
			TOTAL	LOAD (VA):	560	00 VA	36	78 VA	320	00 VA							
			TOTAL	AMPS:		4	7 A	3	31 A	2	7 A							
LOAD TYPE	CONNECTED LOAD		EMAND ACTOR	NEC	DEMAND	PANE	_BOARD N	OTES									PANELBOARD TOTALS	
EXISTING LOAD (E)	12000 VA		100%		000 VA												TOTAL CONNECTED LOAD	12478 VA
COOLING (C)	0 VA		0%) VA													
HEATING (H)	0 VA		100%) VA	_											TOTAL NEC LOAD	12598 VA
LIGHTING (L)	478 VA		125%		98 VA	_											TOTAL CONNECTED CURRENT	35 A
RECEPTACLES (R)	0 VA		0%		O VA	-												
MOTORS (M)	0 VA		100%) VA	-											TOTAL NEC DEMAND CURRENT	35 A
SUPPLEMENTAL HEAT (U) MISC EQUIP (Z)	0 VA 0 VA		100% 100%		O VA O VA	-												
REFRIGERATION (F)	0 VA		100%) VA) VA	-												
SIGNAGE (S)	0 VA		125%		O VA	\dashv												
KITCHEN (K)	0 VA		100%		O VA	\dashv												
LARGEST MOTOR	0 VA		125%		O VA	-												
SHOW WINDOW (W)	0 VA		125%		O VA	-												
TRACK LIGHTING	0 VA		100%) VA	\dashv												

TRACK LIGHTING

PANELBOARD LEGEND

- ABBREVIATIONS
- AF ARC FAULT CIRCUIT INTERRUPTER.
- C# CIRCUIT VIA CONTACTOR #.
 CL CIRCUIT VIA CURRENT LIMITING DEVICE. DISCONNECT CIRCUITRY FOR REMOVED LOAD, UPDATE CIRCUIT DIRECTORY TO
- SPARE AND TURN OFF.
- EX EXISTING.
- EM EMERGENCY LIGHTING HANDLE-ON CLAMP.
- FUTURE LOAD; NOTE AS SPARE AND TURN OFF. FA RED/HANDLE-ON CLAMP.
- GF GROUND-FAULT CIRCUIT INTERRUPTER TYPE CIRCUIT BREAKER (5 mA).

 GFEP GROUND FAULT EQUIPMENT PROTECTION BREAKER (30 mA). HT PROVIDE HANDLE-TIE FOR MULTI-WIRE BRANCH CIRCUIT PÉR CODE.
- IG ISOLATED GROUND CIRCUIT. L# LIGHTING CONTROL SCHEME NUMBER.
- LCK HANDLE PADLOCKABLE-OFF DEVICE.
 LO HANDLE-ON CLAMP.
- N PROVIDE NEW CIRCUIT BREAKER.
- OL REFER TO ELECTRICAL ONE-LINE/RISER DIAGRAM.
 PS POWER-SWITCHING CIRCUIT BREAKER.
- PSE EMERGENCY POWER-SWITCHING CIRCUIT BREAKER.
- R REUSE EXISTING CIRCUIT BREAKER FOR NEW/REVISED LOAD. RP CIRCUIT VIA RELAY PANEL.
- ST SHUNT TRIP CIRCUIT BREAKER. V CIRCUITS RECONNECTED FROM DEMOLISHED PANEL. VERIFY EXISTING LOAD
- AND UPDATE DIRECTORY, IF UNUSED, NOTE AS SPARE AND TURN OFF. VD BRANCH CIRCUITRY HAS BEEN UPSIZED TO REDUCE VOLTAGE DROP. ADJUST GROUND WIRE SIZE PER CODE. PROVIDE LUG ADAPTORS IF REQUIRED.

Z CORRECT/REPAIR EXISTING HAZARD TO MAKE CODE COMPLIANT INSTALLATION. NOT ALL ABBREVIATIONS ARE USED.

LSR7 Robotics, GiC & **Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO N LSW: 2600 SW Ward Rd, Lee's Summit MO 64082

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100 Lee's Summit R-7 School Multistudio 301 NE Tudor Road 4200 Pennsylvania Lee's Summit, MO 64086 Kansas City, MO 64111

816.931.6655 multi.studio structural engineer: Kaw Valley Engineering Bob D. Campbell & Company, Inc. 14700 West 114th Terrace 4338 Belleview

Lenexa, KS 66215 Kansas City, MO 64111 816.531.4144 913.485.0318 www.bdc-engrs.com kveng.com MEPFT/Code:: **Henderson Engineers**

8345 Lenexa Drive, Suite Lenexa, KS 66214 816.742.5000 www.hendersonengineers.com

> 8345 LENEXA DRIVE, SUITE 300 LENEXA, KS 66214 TEL 913.742.5000 FAX 913.742.5001 WWW.HENDERSONENGINEERS.COM MO. CORPORATE NO: E-556D EXPIRES 12/31/2022

Issue Date: September 9, 2022 Revisions



V1.01

LSHS - PANELBOARD **SCHEDULES**

			LIGH	[FI]	XTU	RE :	SCHEDU	JLE					
TYPE	MANUFACTURER	SERIES / MODEL	APPROVED ALTERNATES	TYPE	CRI	SOURC	LUMENS	DIMMING TYPE	VOLTAGE	INPUT WATTS	INPUT VA	DESCRIPTION	NOTES
A1	METALUX	24CZ2 SERIES 24CZ2-45-UNV-L935-CD-1-U	HEW LT SERIES LITHONIA BLT SERIES COLUMBIA LCAT SERIES DAY-BRITE CFI SERIES	LED	90	3500K	4500 LM	0-10V	120	35	39	2'X4' CENTER BASKET TROFFER WITH RIBBED FROSTED ACRYLIC LENS. SUITABLE FOR GRID CEILINGS. STANDARD WHITE FINISH.	NOTES
A1E	METALUX	24CZ2 SERIES 24CZ2-45-UNV-EL7W-L935-CD-1-U	REFER TO TYPE A1	LED	90	3500K	4500 LM	0-10V	120	35	39	SIMILAR TO TYPE A1 EXCEPT WITH 7W EMERGENCY BATTERY BACKUP.	
D1	H.E. WILLIAMS	4DR SERIES 4DR-TL-L10/935-DIM-UNV-OW-OF-CS-TD-N-F1	PORTFOLIO LD4C SERIES LITHONIA LDN4 SERIES INTENSE GRAVITY SERIES PRESCOLITE LTR-4RD SERIES	LED	90	3500K	1000 LM	0-10V	120	9	10	NOMINAL 4" DIAMETER DOWNLIGHT WITH WIDE DISTRIBUTION OPTICS. CLEAR SEMI-SPECULAR ANODIZED REFLECTOR FINISH. DIFFUSE POLYCARBONATE LENS MEDIA AT TOP OF OPEN REFLECTOR.	
EM1	H.E. WILLIAMS	EMER/LED SERIES EMER/LED-WHT-SDT-D	COLUMBIA CU2SQ SERIES LITHONIA EU2C SERIES CHLORIDE VLTU SERIES	LED	N/A	N/A	N/A	N/A	120	2	2	DUAL-HEAD EMERGENCY BUGEYE SUITABLE FOR WALL MOUNTING. 90 MINUTE RUNTIME. SELF-DIAGNOSTIC TEST. STANDARD WHITE FINISH.	
L1B.16	H.E. WILLIAMS	MX4 SERIES MX4D-16-L12/935-P-AC/D96-DIM-UNV	AXIS BEAM SERIES LUMENWERX VIA 4 SERIES ALW LIGHTPLANE SERIES METALUMEN RAIL SERIES PINNACLE EDGE SERIES	LED	90	3500K	1200 LM/FT	0-10V	120	176	194	NOMINAL 4" W X 4" H X 8' LONG FULLY EXTRUDED LINEAR WITH DIRECT OPTICS. PROUD, DIFFUSE ACRYLIC LENS WITH 5/16" DROP. 96" FIELD ADJUSTABLE AIRCRAFT CABLE. BLACK FINISH.	
L1B.24	H.E. WILLIAMS	MX4 SERIES MX4D-24-L12/935-P-AC/D96-DIM-UNV	REFER TO TYPE L1B.16	LED	90	3500K	1200 LM/FT	0-10V	120	264	291	SIMILAR TO L1B.16 EXCEPT 24' IN LENGTH.	
L1BE.16	H.E. WILLIAMS	MX4 SERIES MX4D-16-L12/935-P-AC/D96-EM/7W-DIM-UNV	REFER TO TYPE L1B.16	LED	90	3500K	1200 LM/FT	0-10V	120	176	194	SIMILAR TO TYPE L1B.16 EXCEPT WITH 7W EMERGENCY BATTERY BACKUP.	
L1BE.24	H.E. WILLIAMS	MX4 SERIES MX4D-24-L12/935-P-AC/D96-EM/7W-DIM-UNV	REFER TO TYPE L1B.16	LED	90	3500K	1200 LM/FT	0-10V	120	264	291	SIMILAR TO TYPE L1B.24 EXCEPT WITH 7W EMERGENCY BATTERY BACKUP.	
PL2A.4	STARTEK	BEAM DI SERIES BEAMDI-4-500-350-SD-BW-35K-90-PB-ACW10-U-1C	LUX EOS 4.0 SERIES FINELITE HP-4 SERIES ALW HBEAM 3.5 SERIES AXIS BEAM 4 SERIES	LED	90	3500K	500 LM/FT DOWN 350 LM/FT UP	0-10V	120	40	44	NOMINAL 3.5" W X 3.5" TALL X 4' LONG CONTINUOUS LINEAR CONSTRUCTED IN FULLY ALUMINUM HOUSING. DIRECT/INDIRECT DISTRIBUTION. SATIN ICE DIFFUSE FLUSH LENS FOR DIRECT OPTICS WITH BATWING DISTRIBUTION FOR INDIRECT OPTICS.10' FIELD CUTTABLE BLACK MOUNTING CORD. BLACK FINISH.	
PL2A.12	STARTEK	BEAM DI SERIES BEAMDI-S12-500-350-SD-BW-35K-90-PW-ACW10-U-1C	REFER TO TYPE PL2A.4	LED	90	3500K	500 LM/FT DOWN 350 LM/FT UP	0-10V	120	120	132	SIMILAR TO TYPE PL2A.4 EXCEPT 12' IN LENGTH.	
PL2A.16	STARTEK	BEAM DI SERIES BEAMDI-S16-500-350-SD-BW-35K-90-PW-ACW10-U-1C	REFER TO TYPE PL2A.4	LED	90	3500K	500 LM/FT DOWN 350 LM/FT UP	0-10V	120	160	176	SIMILAR TO TYPE PL2A.4 EXCEPT 16' IN LENGTH.	
PL2B.8	STARTEK	BEAM DI SERIES BEAMDI-S8-1000-350-SD-BW-35K-90-PW-ACW10-U-1C	REFER TO TYPE PL2A.4	LED	90	3500K	1000 LM/FT DOWN 350 LM/FT UP	0-10V	120	120	132	SIMILAR TO TYPE PL2A.4 EXCEPT 8' IN LENGTH AND WITH HIGHER LUMEN OUTPUT.	
PL2B.16	STARTEK	BEAM DI SERIES BEAMDI-S16-1000-350-SD-BW-35K-90-PW-ACW10-U-1C	REFER TO TYPE PL2A.4	LED	90	3500K	1000 LM/FT DOWN 350 LM/FT UP	0-10V	120	240	264	SIMILAR TO TYPE PL2B.8 EXCEPT 16' IN LENGTH.	
PL2B.24	STARTEK	BEAM DI SERIES BEAMDI-S24-1000-350-SD-BW-35K-90-PW-ACW10-U-1C	REFER TO TYPE PL2A.4	LED	90	3500K	1000 LM/FT DOWN 350 LM/FT UP	0-10V	120	360	396	SIMILAR TO TYPE PL2B.8 EXCEPT 24' IN LENGTH.	
SL1.8	STARTEK	BEAM D SERIES BEAMD-S8-500-SD-40K-80-PW-U-1C	HEW MX4D SERIES LUX EOS 4.0 SERIES AXIS WET BEAM 4 SERIES LUMENWERX VIA 4 SEAL SERIES ALW LITEPLANE 3.5 SERIES	LED	80	4000K	500 LM/FT	0-10V	120	64	71	NOMINAL 3.5" W X 3.5" TALL X 8' LONG CONTINUOUS LINEAR CONSTRUCTED IN FULLY EXTRUDED ALUMINUM. DIRECT DISTRIBUTION WITH SATIN ICE DIFFUSE LENS. END CONDUIT FEED FOR SURFACE MOUNT APPLICATIONS. BLACK FINISH.	
SWE	LITHONIA	WPX SERIES WPX2LED-40K-MVOLT-E14WC-DNAXD	-	LED	70	4000K	6000 LM	N/A	120	47	52	SIMILAR TO TYPE SW EXCEPT WITH 14W EMERGENCY BATTERY BACKUP.	1
X1	SURE-LITES	EUX SERIES EUX7RSD	LITHONIA COLUMBIA SIGNIFY	LED	N/A	N/A	N/A	N/A	<varies></varies>	5	5	UNIVERSALLY MOUNTED EDGE-LIT EXIT SIGN. RED LETTERING. SELF-DIAGNOSTICS.	

LIGHT FIXTURE SCHEDULE NOTES:

1. BASIS-OF-DESIGN FIXTURE IS SPECIFIED TO MATCH EXISTING FIXTURES FOR RE-USE. ANY SUBSTITUTIONS SHALL BE DIRECTED TO ENGINEER FOR APPROVAL.

LIGHT FIXTURE SCHEDULE SUPPLEMENTAL SPECIFICATIONS:

- 1. ANY PROPRIETARY, SOLE-SOURCED LIGHT FIXTURE LISTED IN THE LIGHT FIXTURE SCHEDULE SHALL BE UNIT PRICED ONLY. NO PACKAGING OR LOT PRICING OF THESE LIGHT FIXTURES SHALL BE ALLOWED. UNIT PRICES SHALL BE CLEARLY IDENTIFIED ON THE BID FORM.
- 2. LIGHTING CONTROLS PRICING, INCLUDING BUT NOT LIMITED TO THOSE REFERENCED IN ELECTRICAL SPECIFICATIONS, SHALL BE COMPLETELY SEPARATE OF ANY LIGHT FIXTURE PRICING. ANY LIGHTING CONTROLS PRICING THAT IS SUBMITTED WITH LIGHT FIXTURE PRICING (UNIT OR MINI-LOT) WILL BE IMMEDIATELY REJECTED IN ITS ENTIRETY.
- 3. CATALOG NUMBERS SHALL NOT BE CONSIDERED COMPLETE AND MATERIAL SHALL NOT BE ORDERED BY MANUFACTURER AND CATALOG NUMBERS ONLY. FIRST READ THE COMPLETE DESCRIPTION, NOTES AND SPECIFICATIONS IN CONJUNCTION WITH THE CATALOG NUMBER TO DETERMINE THE MATERIAL AND ACCESSORIES TO BE ORDERED. THE MANUFACTURERS LISTED ARE THE BASIS FOR THE DESIGN.
- 4. COORDINATE LIGHT FIXTURE MOUNTING HARDWARE AND TRIMS NEEDED TO SUIT CEILING CONDITIONS. LIGHT FIXTURES NEAR OR IN CONTACT WITH INSULATION SHALL COMPLY WITH CODE. MAINTAIN 3" MINIMUM WORKING CLEARANCE BETWEEN NON-IC RATED LIGHT FIXTURE HOUSINGS AND INSULATION ON ALL ADJACENT DUCTWORK, PIPING, WALLS, AND CEILINGS.
- 5. ALL LIGHT FIXTURES AND RELATED COMPONENTS SHALL BE PROVIDED BY THE CONTRACTOR, UNLESS NOTED OTHERWISE.
- 6. THE PARTY SUPPLYING THE LIGHT FIXTURES IS RESPONSIBLE FOR SUPPLYING THE PROPER QUANTITY OF LIGHT FIXTURES.



LSR7 Robotics, GiC & **Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO N LSW: 2600 SW Ward Rd, Lee's Summit MO

> Lenexa, KS 66214 816.742.5000

www.hendersonengineers.com

0121-0100 Lee's Summit R-7 School Multistudio 301 NE Tudor Road 4200 Pennsylvania


LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655 multi.studio structural engineer: Kaw Valley Engineering Bob D. Campbell & Company, Inc. 14700 West 114th Terrace 4338 Belleview Lenexa, KS 66215


Kansas City, MO 64111 913.485.0318 816.531.4144 www.bdc-engrs.com kveng.com MEPFT/Code:: **Henderson Engineers** 8345 Lenexa Drive, Suite

8345 LENEXA DRIVE, SUITE 300 LENEXA, KS 66214 TEL 913.742.5000 FAX 913.742.5001 WWW.HENDERSONENGINEERS.COM MO. CORPORATE NO: E-556D EXPIRES 12/31/2022

Issue Date: September 9, 2022 Revisions



LSHS - LIGHT FIXTURE SCHEDULE

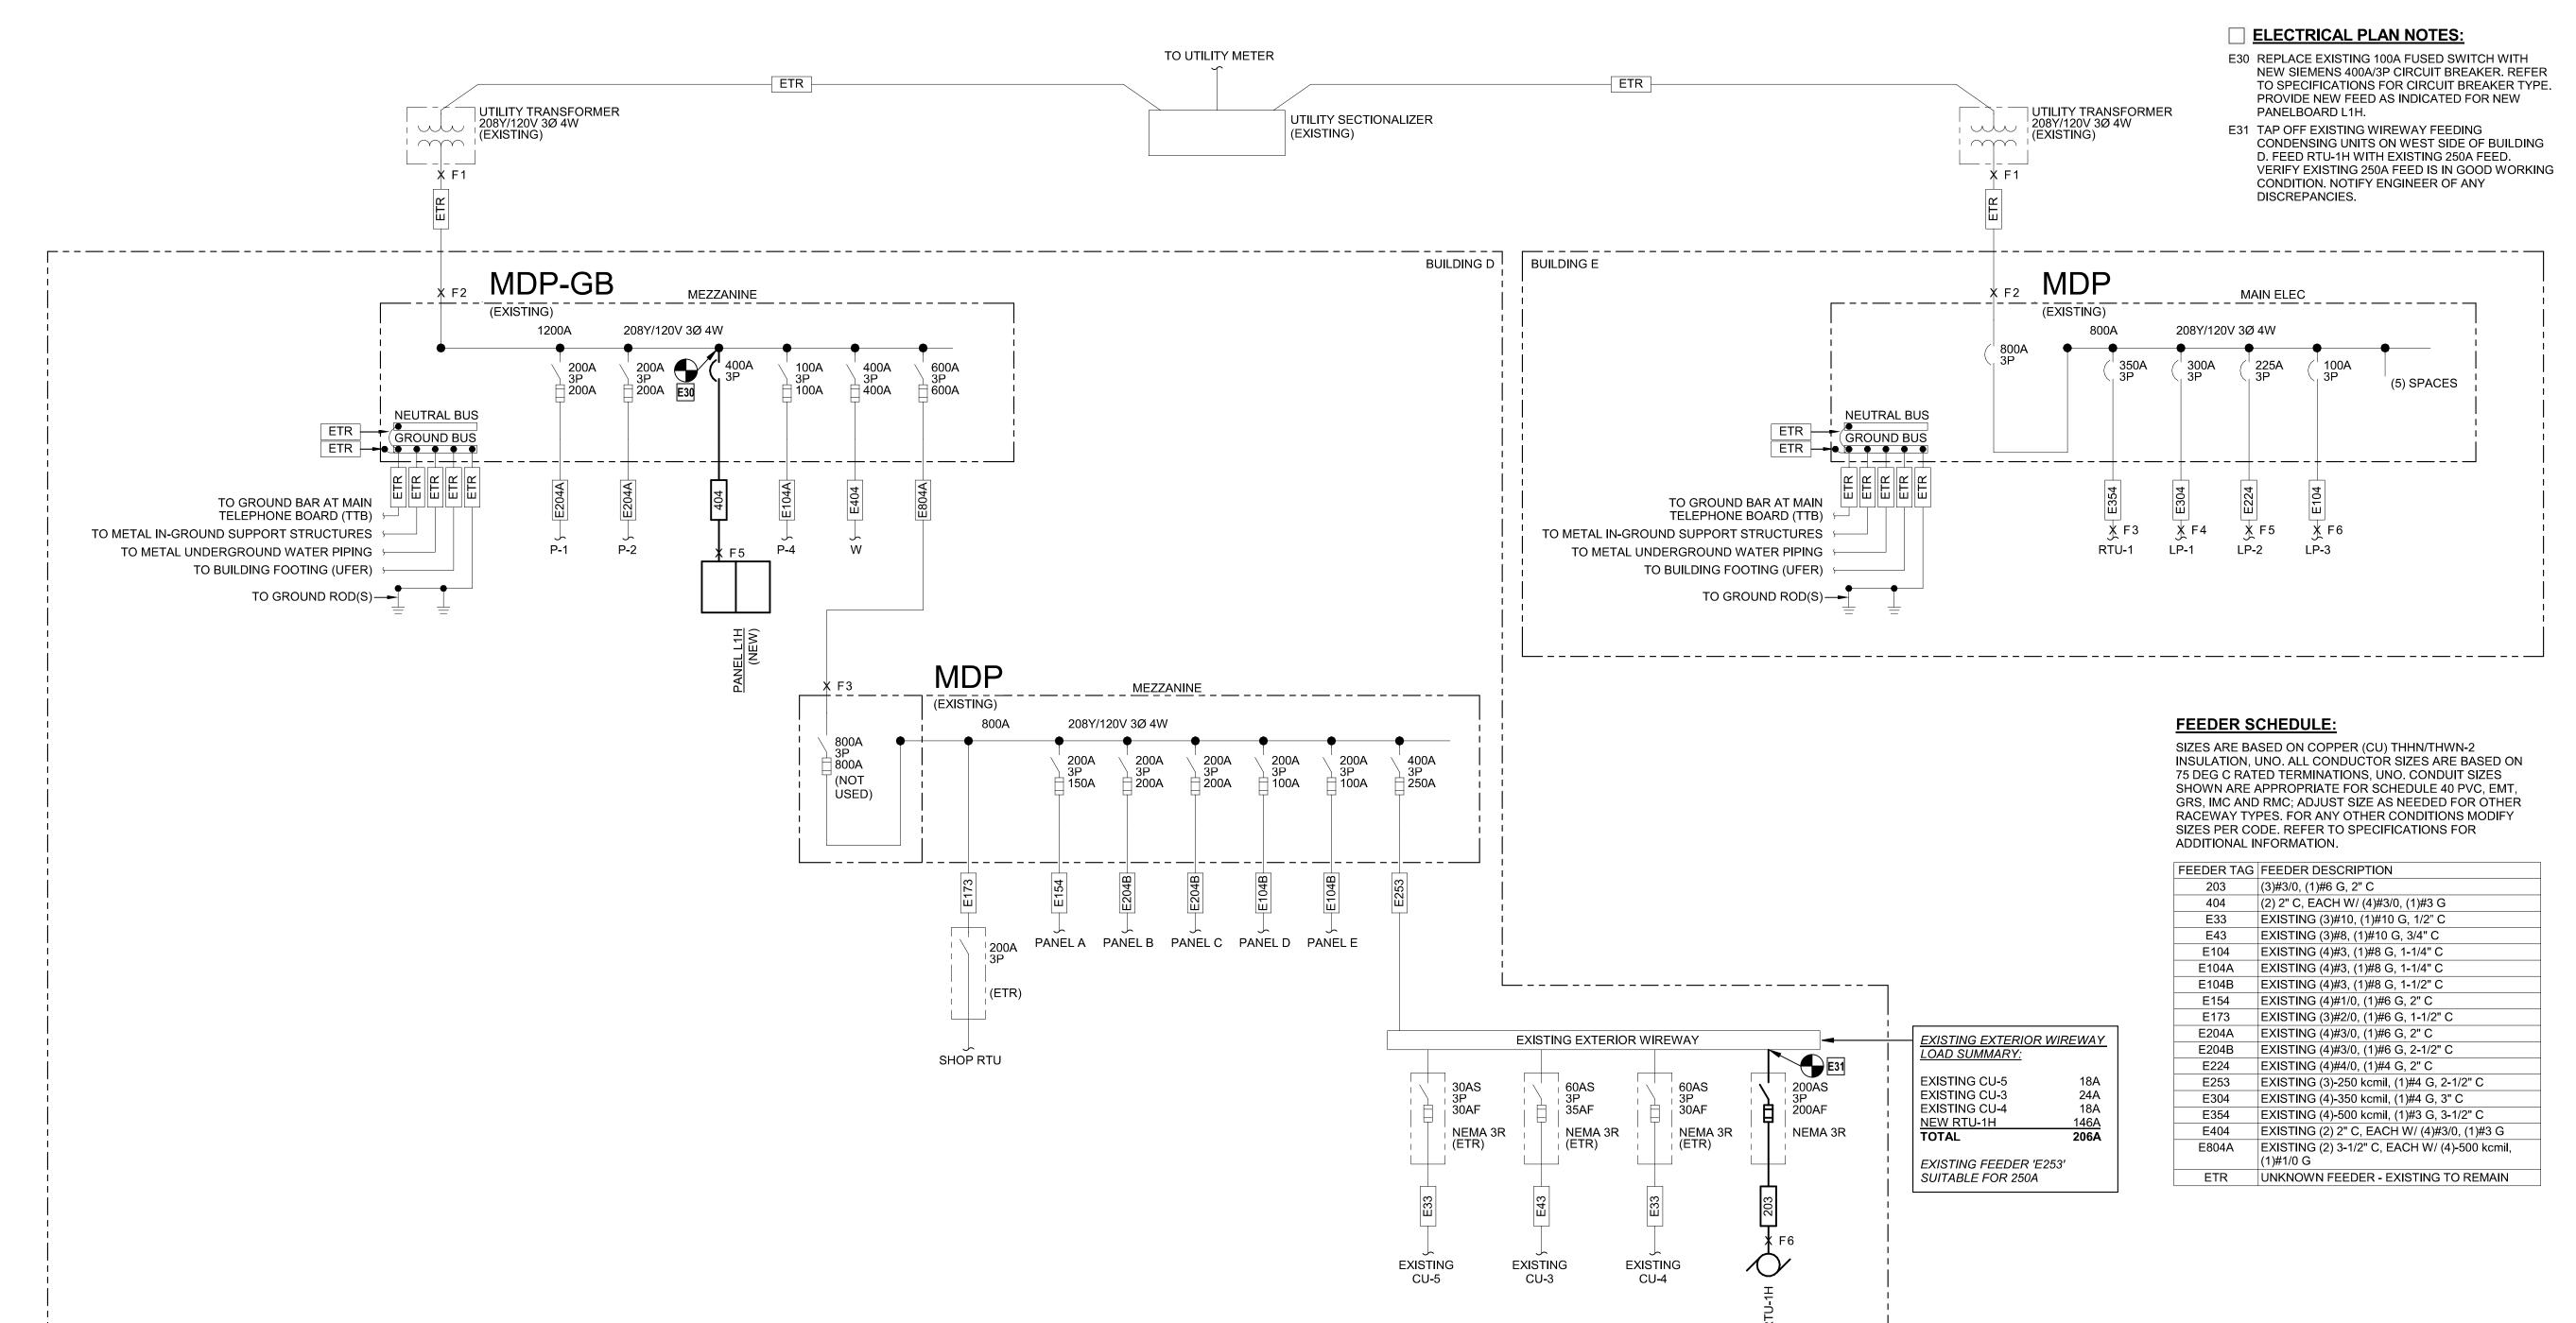

2 ELECTRICAL PARTIAL ONE-LINE DIAGRAM - LSHS BUILDINGS D&E NTS

ONE-LINE DIAGRAM GENERAL NOTES:

- 1. THE INFORMATION SHOWN IN THE SHORT-CIRCUIT AND VOLTAGE DROP CALCULATIONS SCHEDULE IS SHOWN FOR CALCULATION PURPOSES ONLY. CONTRACTOR SHALL NOT USE THE CONDUIT TYPES, CONDUCTOR TYPES, SIZES, QUANTITIES OR LENGTHS FOR TAKEOFFS OR BIDDING PURPOSES. CONTRACTOR SHALL NOTIFY ENGINEER OF ANY CONFLICTS BETWEEN THIS SCHEDULE AND OTHER PORTIONS OF THE CONSTRUCTION DOCUMENTS. CONTRACTOR SHALL NOTIFY ENGINEER OF AS-BUILT CONDITIONS THAT CONSTITUTE A CHANGE FROM WHAT IS SHOWN BELOW; THIS INCLUDES CONDUCTOR LENGTHS DIFFERING BY MORE THAN 10%.
- 2. REFER TO THE SHORT-CIRCUIT AND VOLTAGE DROP CALCULATIONS TABLE ON SHEET E801-C. AVAILABLE FAULT CURRENT INFORMATION IS LISTED UNDER THE "FAULT CURRENT" COLUMN. VOLTAGE DROP VALUES ARE LISTED UNDER THE "CUMULATIVE VOLTAGE DROP" COLUMN. THE AIC/SCCR RATING OF THE EQUIPMENT SHALL NOT BE LESS THAN THE AVAILABLE 3-PHASE SYMMETRICAL FAULT CURRENT. ALL SERIES RATED EQUIPMENT SHALL BE PROPERLY LISTED AND LABELED PER CODE.
- 3. CIRCUITRY SIZES ARE BASED ON COPPER (CU) THHN/THWN-2 INSULATION, UNLESS NOTED OTHERWISE. CONDUIT SIZES SHOWN ARE APPROPRIATE FOR SCHEDULE 40 PVC, EMT, GRS, IMC AND RMC; ADJUST SIZE AS NEEDED FOR OTHER RACEWAY TYPES. ALL CONDUCTOR SIZES ARE BASED ON 75 DEG C RATED TERMINATIONS, UNLESS NOTED OTHERWISE. FOR ANY OTHER CONDITIONS MODIFY SIZES PER CODE. REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- 4. INSTALL FEEDERS OVERHEAD AS HIGH AS PRACTICABLE AND ORTHOGONALLY ALONG BUILDING STRUCTURE, UNLESS NOTED OTHERWISE. COORDINATE FINAL ROUTING WITH OTHER TRADES.
- 5. PROVIDE A PERMANENT LABEL ON FRONT OF EQUIPMENT ENCLOSURE; REFER TO SPECIFICATIONS FOR LABEL REQUIREMENTS. LABEL SHALL READ AS FOLLOWS (INCLUDE RESPECTIVE NAMES IN BLANKS):

EXAMPLE: 208Y/120V, 60HZ

SERVICE EQUIPMENT LABEL:

800A SCCR = 65,000A

MAX AVAILABLE FAULT CURRENT = 58,815A CALCULATED: 01/01/2018

PANELBOARD/SWITCHBOARD LABEL:
LINE 1: PANELBOARD "_____" SUPPLIED BY UPSTREAM
LINE 2: PANELBOARD/SWITCHBOARD "_____"

LINE 3: LOCATED IN "_____"
LINE 4: PANELBOARD "_____" SUPPLIES DOWNSTREAM
LINE 5: PANELBOARD(S) "_____"

ELECTRICAL UTILITY CONTACT NOTE:

UTILITY COMPANY: EVERGY UTILITY CONTACT: PHILLIP INGRAM PHONE: 816-347-4339

PHONE: 816-347-4339 EMAIL: PHILLIP.INGRAM@EVERGY.COM

FAULT CURRENT GENERAL NOTE (UTILITY VALUE):

THE MAXIMUM AVAILABLE 3-PHASE SYMMETRICAL FAULT CURRENT VALUE AT THE UTILITY TRANSFORMER SECONDARY/POINT OF SERVICE COULD NOT BE DETERMINED AT THE TIME OF THIS SUBMITTAL. THE ESTIMATED WORST CASE VALUE OF 23,530A IS BASED ON AN INFINITE BUS CALCULATION AT THE UTILITY TRANSFORMER. CONTRACTOR SHALL VERIFY ACTUAL AVAILABLE FAULT CURRENT VALUE WITH UTILITY PRIOR TO BEGINNING CONSTRUCTION. NOTIFY ENGINEER IF ACTUAL VALUE EXCEEDS ESTIMATED CALCULATED VALUE. ESTIMATED DESIGN VALUE IS BASED ON THE FOLLOWING:

UTILITY TRANSFORMER SECONDARY VOLTAGE: 208V UTILITY TRANSFORMER SIZE: 225 KVA, 3PH 4W

OVERCURRENT PROTECTIVE DEVICE COORDINATION STUDY GENERAL NOTE:

CONTRACTOR SHALL PROVIDE AN OVERCURRENT PROTECTIVE DEVICE COORDINATION STUDY TO DETERMINE THE CORRECT SETTINGS FOR THE ADJUSTABLE TRIP CIRCUIT BREAKERS TO DOCUMENT ARC-FLASH HAZARDS. PROVIDE ALL NECESSARY AS-BUILT INFORMATION REQUIRED FOR COMPLETION OF THE STUDY TO THE ENGINEER DOING THE STUDY. PROVIDE SUBMITTALS INDICATED WITHIN THE SPECIFICATIONS TO OWNER AND ARCHITECT/ENGINEER TO CONFIRM STUDY HAS BEEN COMPLETED. CONTRACTOR SHALL INCLUDE THE COST FOR THIS WORK IN THEIR BID. REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION.

ONE-LINE DIAGRAM GENERAL NOTES:

- COORDINATE WORK WITH ARCHITECTURAL PHASING DRAWINGS TO PROPERLY STAGE TRANSITION TO PROVIDE POWER TO EXISTING, NEW AND TEMPORARY LOADS. MONITOR LOADS ON DISTRIBUTION SYSTEM TO MAKE SURE SHIFTING OF LOADS DOES NOT OVERLOAD ELECTRICAL EQUIPMENT.
- 2. PRIOR TO BEGINNING CONSTRUCTION, THE CONTRACTOR SHALL VERIFY THE EXISTING AIC/SCCR RATING OF EACH PANELBOARD/SWITCHBOARD. ALL NEW AND EXISTING OVER-CURRENT PROTECTION DEVICES (CIRCUIT BREAKERS AND FUSES) MUST HAVE AN AIC/SCCR RATING EXCEEDING THE AVAILABLE FAULT CURRENT AT THAT POINT IN THE SYSTEM. NOTIFY THE OWNER AND THE ENGINEER IF THE EXISTING EQUIPMENT DOES NOT COMPLY WITH THIS REQUIREMENT.
- 3. VERIFY THE INTEGRITY OF THE EXISTING GROUNDING ELECTRODE SYSTEM AND THAT THE NEUTRAL AND GROUND ARE PROPERLY BONDED TOGETHER AT THE POINT OF SERVICE ENTRANCE. NOTIFY THE LANDLORD, OWNER AND THE ENGINEER OF ANY EXISTING DEFICIENCIES.

ONE-LINE DIAGRAM SUPPLEMENTAL SPECIFICATIONS:

- GROUNDING ELECTRODE SYSTEM SHALL BE PER LOCAL REQUIREMENTS AND SHALL NOT BE LESS STRINGENT THAN THAT SPECIFIED IN THE CONSTRUCTION DOCUMENTS.
- 2. PROVIDE PROPERLY SIZED LUGS FOR ALL EQUIPMENT, CIRCUIT BREAKERS, AND OTHER ELECTRICAL DEVICES TO ACCOMMODATE INSTALLED CONDUCTORS. A LARGER FRAME, OVERSIZED LUGS OR NON-STANDARD PRODUCT MAY BE REQUIRED IN SOME INSTANCES. UTILIZE PIN ADAPTERS ONLY IF NECESSARY AND ONLY AS ALLOWED BY MANUFACTURER AND AHJ.
- 3. PROVIDE ANY AVAILABLE SPACE IN SWITCHBOARDS/PANELBOARDS WITH BUSSING.
- 4. PROVIDE TYPED FINAL CIRCUIT DIRECTORY FOR ALL PANELBOARDS TO REFLECT ACTUAL AS-BUILT CONDITIONS. COORDINATE FINAL ROOM NAMES, NUMBERS AND DESCRIPTIONS WITH OWNER PRIOR TO COMPLETION. CIRCUIT DESCRIPTIONS SHALL BE PER CODE AND SHALL BE DISTINGUISHABLE FROM ALL OTHERS.

multistudio

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086 N LSW: 2600 SW Ward Rd, Lee's Summit MO

64082 LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

owner: architect:
Lee's Summit R-7 School
301 NE Tudor Road 4200 Pennsylvania
Lee's Summit, MO 64086 Kansas City, MO 64111
816.931.6655

civil engineer: structural engineer:
Kaw Valley Engineering Bob D. Campbell & Company, Inc.
14700 West 114th Terrace Lenexa, KS 66215 Kansas City, MO 64111

Lenexa, KS 66215 Kansas City, MO 64111 913.485.0318 816.531.4144 kveng.com www.bdc-engrs.com MEPFT/Code:: Henderson Engineers

Henderson Engineers
8345 Lenexa Drive, Suite
300
Lenexa, KS 66214
816.742.5000
www.hendersonengineers.com

HENDERSON
ENGINEERS

8345 LENEXA DRIVE, SUITE 300
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001

WWW.HENDERSONENGINEERS.COM


2150005255
MO. CORPORATE NO: E-556D

EXPIRES 12/31/2022

Revisions
NUMBER DESCRIPTION DATE



LSHS - ELECTRICAL
ONE-LINE DIAGRAM
FRON-C

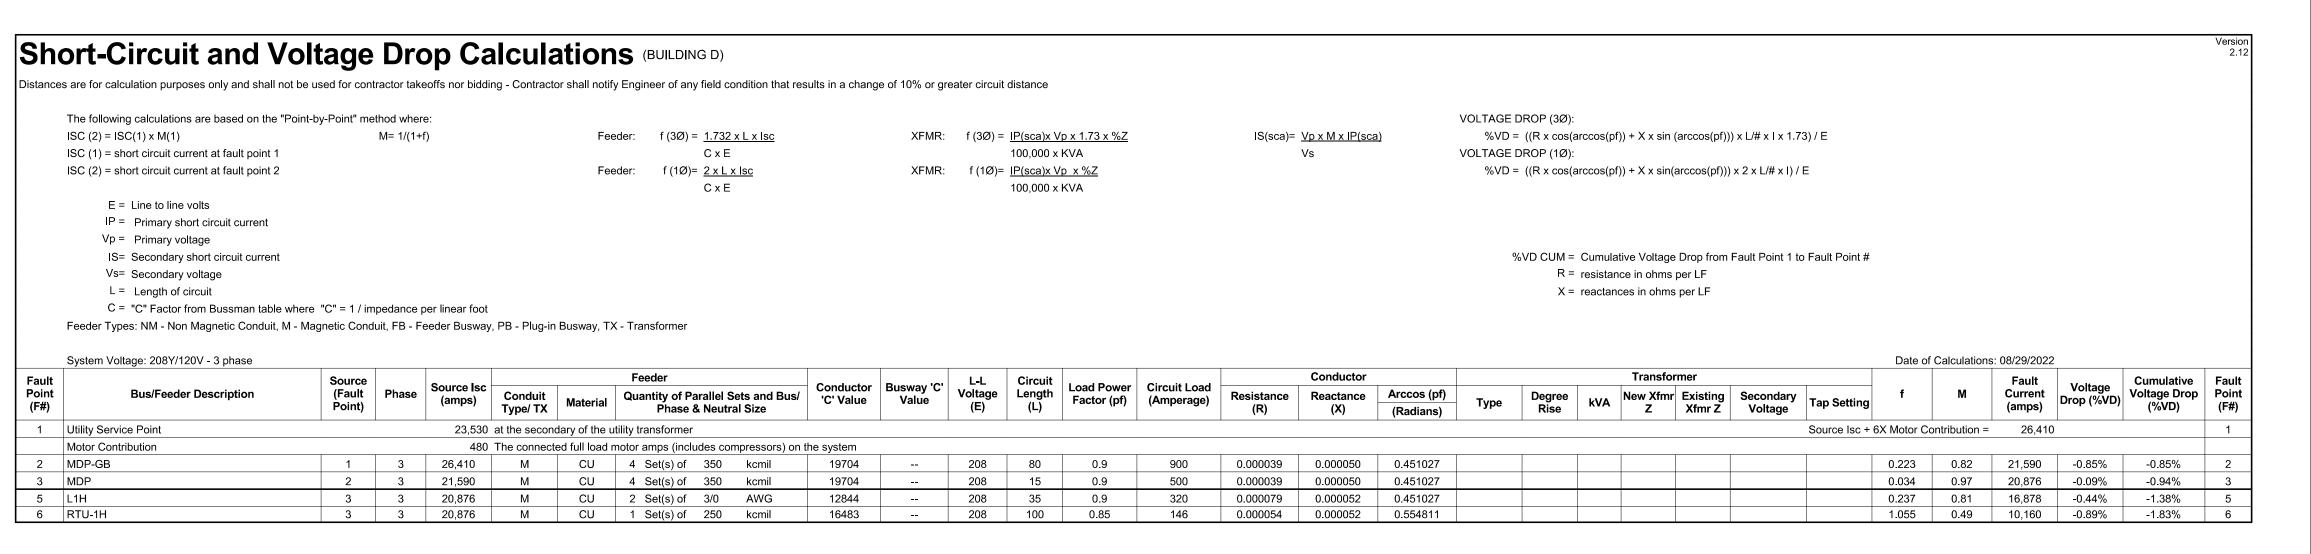

BUILDING LOAD SUMMARY (MDP	-GB)		(BUILD	
BUILDING OCCUPANCY TYPE: SCHOOL		SERVICE DI	ESCRIPTIO	
BUILDING SQUARE FOOTAGE: 14400		208Y	/120 V	
LOAD TYPE	CONNECTED LOAD KVA	DEMAND FACTOR	NEC DEI	
EXISTING PEAK UTILITY (@ 0.9 pf)	222.22	125%	277.	
COOLING (C)	0.00	0%	0.0	
HEATING (H)	0.00	100%	0.0	
LIGHTING (L) (PER NEC-220)	3.70	125%	4.6	
RECEPTACLES (R)	10.44	98%	10.2	
MOTORS (M)	27.96	100%	27.9	
SUPPLEMENTAL HEAT (U)	0.00	100%	0.0	
MISC EQUIP (Z)	2.44	100%	2.4	
REFRIGERATION (F)	0.00	100%	0.0	
SIGNAGE (S)	0.00	125%	0.0	
KITCHEN (K)	0.00	100%	0.0	
LARGEST MOTOR	14.92	125%	18.6	
SHOW WINDOW (W)	0.00	125%	0.0	
TRACK LIGHTING	0.00	100%	0.0	
EXISTING LOAD TO BE DELETED	55.00	100%	55.0	
ELEVATOR (V)	0.00	100%	0.0	
TOTAL LOAD	226.68	KVA	286.	
TOTAL AMPACITY	629.21	AMPS	795.	
SERVICE AMPACITY		AMPS	1200	
SPARE CAPACITY		AMPS	404.	

hort-Circuit and V	/oltage	e Dro	op Ca	alcula	ations	(BUILDING	E)																				Versic 2.1
ances are for calculation purposes only and shall n	_		-					results in a chang	ge of 10% or gre	eater circuit	t distance																
The following calculations are based on the "	"Point-by-Point" m	nethod whe	re:														VOLTAGE I	DROP (3Ø):									
$ISC(2) = ISC(1) \times M(1)$		M= 1/(1-	-f)		Feeder	r: f (3Ø) = <u>1</u>	.732 x L x Isc		XFMR:	f (3Ø) =	= <u>IP(sca)x Vp x</u>	x 1.73 x %Z		IS(sca)=	Vp x M x IP(sc	<u>a)</u>	%VD =	= ((R x cos(arccos(pf)) + X x sin (arccos(p	f))) x L/# x I	x 1.73) / E						
ISC (1) = short circuit current at fault point 1						C	CxE				100,000 x KV	/A			Vs		VOLTAGE I	DROP (1Ø):									
ISC (2) = short circuit current at fault point 2	!				Feede	`	x L x Isc C x E		XFMR:	f (1Ø)=	= <u>IP(sca)x Vp x</u> 100,000 x KV						%VD =	= ((R x cos(arccos(pf)) + X x sin(arccos(pr	())) x 2 x L/#	x I) / E						
E = Line to line volts											•																
IP = Primary short circuit current																											
Vp = Primary voltage																											
IS= Secondary short circuit current	t																o,	WND CLIM -	Cumulative Voltage Drop fro	m Foult Poi	4 4 Fault Daint 4	ı					
																	,	70 V D COIVI -	Cultivative voltage Drop ito	III Fault Foll	nt 1 to Fauit Point #	•					
Vs= Secondary voltage																	,		resistance in ohms per LF	III Fault Foli	nt i to Fauit Point #	•					
Vs= Secondary voltage L= Length of circuit																	,	R=	• •	III Fault Foi	nt i to Fauit Point #	•					
, ,		impedance	per linear foot														,	R=	resistance in ohms per LF	III Fault Fol	nt I to Fault Point #						
L = Length of circuit	e where "C" = 1 / i	•			Busway, TX - 1	Transformer											,	R=	resistance in ohms per LF	iii rault roii	nt I to Fauit Point #						
L = Length of circuit C = "C" Factor from Bussman table	e where "C" = 1 / i	•			Busway, TX - 1	Transformer											,	R=	resistance in ohms per LF	III Fault Foli	nt I to Fault Point #		Calculations	s: 08/22/2022	2		
L = Length of circuit C = "C" Factor from Bussman table Feeder Types: NM - Non Magnetic Conduit, N System Voltage: 208Y/120V - 3 phase	e where "C" = 1 / i M - Magnetic Cor	nduit, FB - F	Feeder Busway			Transformer Feeder			D 101	L-L	Circuit .		. "		Conductor		,	R=	resistance in ohms per LF	III Fault Foll	nt I to Fault Point #		Calculations			Cumulative	Fau
L = Length of circuit C = "C" Factor from Bussman table Feeder Types: NM - Non Magnetic Conduit, N System Voltage: 208Y/120V - 3 phase ult bint Bus/Feeder Description	e where "C" = 1 / i	Phase		, PB - Plug-in		Feeder Quantity of Para	llel Sets and Bu leutral Size	Conductor 'C' Value	Busway 'C' Value	L-L Voltage (E)			ircuit Load Amperage)	Resistance (R)	Conductor Reactance (X)	Arccos (pf) (Radians)	Туре	R=	resistance in ohms per LF reactances in ohms per LF	g Second	dary Ton Sotting	Date of	Calculations M	s: 08/22/2022 Fault Current (amps)	Voltage Drop (%VD)		Poir
L = Length of circuit C = "C" Factor from Bussman table Feeder Types: NM - Non Magnetic Conduit, N System Voltage: 208Y/120V - 3 phase	e where "C" = 1 / i M - Magnetic Cor Source (Fault	Phase	Source Isc (amps)	Conduit Type/ TX		Feeder Quantity of Para Phase & N	llel Sets and Bu leutral Size	Conductor 'C' Value	Busway 'C' Value	Voltage	Length L			Resistance (R)	Reactance	\ , ,		R = X =	resistance in ohms per LF reactances in ohms per LF Transformer New Xfmr Existin	g Second	dary ge Tap Setting	Date of	М	Fault Current	Voltage Drop (%VD)	Voltage Drop	
L = Length of circuit C = "C" Factor from Bussman table Feeder Types: NM - Non Magnetic Conduit, I System Voltage: 208Y/120V - 3 phase Bus/Feeder Description ##)	e where "C" = 1 / i M - Magnetic Cor Source (Fault	Phase	Source Isc (amps)	Conduit Type/ TX at the second	Material Q	Feeder Quantity of Para Phase & N y transformer	llel Sets and Bu leutral Size	s/ 'C' Value	Busway 'C' Value	Voltage	Length L			Resistance (R)	Reactance	\ , ,		R = X =	resistance in ohms per LF reactances in ohms per LF Transformer New Xfmr Existin	g Second	dary ge Tap Setting	Date of	М	Fault Current (amps)	Voltage Drop (%VD)	Voltage Drop	Poin
L = Length of circuit C = "C" Factor from Bussman table Feeder Types: NM - Non Magnetic Conduit, N System Voltage: 208Y/120V - 3 phase Bus/Feeder Description Utility Service Point	e where "C" = 1 / i M - Magnetic Cor Source (Fault	Phase	Source Isc (amps)	Conduit Type/ TX at the second	Material Q	Feeder Quantity of Para Phase & N y transformer or amps (include	leutral Size	s/ 'C' Value	Busway 'C' Value	Voltage	Length L			Resistance (R)	Reactance	\ , ,		R = X =	resistance in ohms per LF reactances in ohms per LF Transformer New Xfmr Existin	g Second	dary ge Tap Setting	Date of	М	Fault Current (amps)	Voltage Drop (%VD)	Voltage Drop	Poir
L = Length of circuit C = "C" Factor from Bussman table Feeder Types: NM - Non Magnetic Conduit, I System Voltage: 208Y/120V - 3 phase ult int # Bus/Feeder Description Utility Service Point Motor Contribution MDP RTU-1	e where "C" = 1 / i M - Magnetic Cor Source (Fault	Phase	Source Isc (amps)	Conduit Type/ TX at the second	Material Q dary of the utility ed full load mote	Feeder Quantity of Para Phase & N y transformer or amps (include 3 Set(s) of 3 1 Set(s) of 5	es compressors) of the second	on the system	Value	Voltage (E) 208 208	Length F	Factor (pf) (A	Amperage)	0.000045 0.000029	Reactance (X) 0.000051 0.000048	(Radians)		R = X =	resistance in ohms per LF reactances in ohms per LF Transformer New Xfmr Existin	g Second	dary ge Tap Setting	Date of f	M ntribution =	Fault Current (amps) 17,818 15,684 8,329	Voltage Drop (%VD)	Voltage Drop (%VD)	Poi
L = Length of circuit C = "C" Factor from Bussman table Feeder Types: NM - Non Magnetic Conduit, N System Voltage: 208Y/120V - 3 phase ult int Bus/Feeder Description Utility Service Point Motor Contribution MDP	e where "C" = 1 / i M - Magnetic Cor Source (Fault Point)	Phase	Source Isc (amps) 15,898 320 17,818	Conduit Type/ TX at the second	Material Q dary of the utility ed full load mote	Feeder Quantity of Para Phase & N y transformer or amps (include 3 Set(s) of 3 1 Set(s) of 5	es compressors)	on the system	Value	Voltage (E)	Length (L)	Factor (pf) (A	Amperage) 500	(R) 0.000045	Reactance (X) 0.000051	(Radians)		R = X =	resistance in ohms per LF reactances in ohms per LF Transformer New Xfmr Existin	g Second	dary ge Tap Setting	Date of f f 6X Motor Co	M ntribution =	Fault Current (amps) 17,818	Voltage Drop (%VD)	Voltage Drop (%VD)	Poi

BUILDING LOAD SUMMARY (MD	P)		(BUILDING E)			
BUILDING OCCUPANCY TYPE: SCHOOL		SERVICE D	ESCRIPTION:			
BUILDING SQUARE FOOTAGE: 14400		208Y/120 V				
LOAD TYPE	CONNECTED LOAD KVA	DEMAND FACTOR	NEC DEMAND KVA			
EXISTING PEAK UTILITY (@ 0.9 pf)	111.11	125%	138.89			
COOLING (C)	31.02	100%	31.02			
HEATING (H)	0.00	0%	0.00			
LIGHTING (L) (PER NEC-220)	0.48	125%	0.60			
RECEPTACLES (R)	11.34	94%	10.67			
MOTORS (M)	22.72	100%	22.72			
SUPPLEMENTAL HEAT (U)	0.00	100%	0.00			
MISC EQUIP (Z)	3.05	100%	3.05			
REFRIGERATION (F)	0.00	100%	0.00			
SIGNAGE (S)	0.00	125%	0.00			
KITCHEN (K)	0.00	100%	0.00			
LARGEST MOTOR	20.79	125%	25.98			
SHOW WINDOW (W)	0.00	125%	0.00			
TRACK LIGHTING	0.00	100%	0.00			
EXISTING LOAD TO BE DELETED	18.00	100%	18.00			
ELEVATOR (V)	0.00	100%	0.00			
TOTAL LOAD	182.50	KVA	214.92			
TOTAL AMPACITY	506.57	AMPS	596.57			
SERVICE AMPACITY		AMPS	800.00			
SPARE CAPACITY		AMPS	203.43			
*PER UTILITY COMPANY BILLING PEAK DEMAND OF:		100.00 KW				

multistudio

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086 N LSW: 2600 SW Ward Rd, Lee's Summit MO 64082

301 NE Tudor Road

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100
owner: architect:
Lee's Summit R-7 School Multistudio

4200 Pennsylvania

Lee's Summit, MO 64086

Kansas City, MO 64111
816.931.6655
multi.studio

civil engineer:

Kaw Valley Engineering
14700 West 114th Terrace
Lenexa, KS 66215

Kansas City, MO 64111
816.931.6655
multi.studio

structural engineer:
Bob D. Campbell & Company, Inc.
4338 Belleview
Kansas City, MO 64111

Lenexa, KS 66215
913.485.0318
kveng.com

MEPFT/Code::
Henderson Engineers
8345 Lenexa Drive, Suite
300
Lenexa, KS 66214
816.742.5000

www.hendersonengineers.com

HENDERSON
ENGINEERS

8345 LENEXA DRIVE, SUITE 300
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001

WWW.HENDERSONENGINEERS.COM

2150005255
MO. CORPORATE NO: E-556D
EXPIRES 12/31/2022

Revisions
NUMBER DESCRIPTION DATE



LSHS - ELECTRICAL CALCULATIONS **E801-C**

FIRE ALARM SCOPE NOTES:

- 1. FIRE ALARM SCOPE INCLUDES THE MODIFICATION OF THE EXISTING FIRE ALARM SYSTEM.
- 2. MODIFY EXISTING HORN/STROBE NOTIFICATION IN THE EXISTING BUILDINGS D & E FOR THE MODFIED BUILDING LAYOUT IN ACCORDANCE WITH NFPA 72 AND ANY LOCAL LAWS.

FIRE ALARM GENERAL NOTES:

- 1. PRIOR TO SUBMITTING BID, VISIT THE JOB SITE AND BECOME FULLY ACQUAINTED WITH THE EXISTING CONDITIONS OF THE PROJECT. REVIEW THE GENERAL NOTES, SPECIFICATIONS AND OTHER DRAWINGS FOR ADDITIONAL REQUIREMENTS WHICH MAY NOT BE SPECIFICALLY CALLED OUT IN THIS PORTION OF THE CONSTRUCTION DOCUMENTS. NOTIFY ARCHITECT, ENGINEER AND/OR OWNER OF CONFLICTS OR DISCREPANCIES PRIOR TO SUBMISSION OF BID.
- 2. SYSTEM DESIGN, INSTALLATION AND MATERIALS SHALL BE IN ACCORDANCE WITH APPLICABLE NFPA STANDARDS. SYSTEM SHALL ALSO MEET ALL APPLICABLE BUILDING CODES, FIRE CODES AND THE REQUIREMENTS OF THE AUTHORITY HAVING JURISDICTION AND INSURANCE CARRIER. VERIFY REQUIREMENTS PRIOR TO BID SUBMITTAL.
- 3. INFORMATION ON CONTRACT DOCUMENTS IS GENERAL INFORMATION AND FOR BID PURPOSES ONLY. CONTRACTOR SHALL BE FULLY RESPONSIBLE FOR THE FINAL SYSTEM DESIGN AND LAYOUT OF ALL COMPONENTS, COORDINATION WITH ALL OTHER TRADES, AND SYSTEM CALCULATIONS REQUIRED FOR APPROVAL BY THE AUTHORITY HAVING JURISDICTION, ENGINEER, AND OWNER'S INSURER.
- 4. THE CONTRACTOR SHALL FOLLOW THE ENGINEER OF RECORD'S SYSTEM DESIGN AND LAYOUT OF ALL COMPONENTS EXCEPT WHERE MODIFICATION TO THE DESIGN IS NECESSARY. MODIFICATIONS SHALL BE REFLECTED IN THE CONTRACTOR'S SHOP DRAWINGS AND CALCULATIONS.
- 5. DEVIATIONS FROM ENGINEER'S DESIGN WILL NOT BE CONSIDERED UNLESS A FORMALLY SUBMITTED RFI IS RECEIVED AND APPROVED.
- 6. THE CONTRACTOR SHALL PROVIDE ALL EQUIPMENT AND LABOR REQUIRED FOR A COMPLETE AND OPERATIONAL SYSTEM AS INDICATED IN THE DRAWINGS AND SPECIFICATIONS.
- 7. WHERE EXISTING SYSTEMS ARE PRESENT, CONTRACTOR SHALL MODIFY, RELOCATE AND/OR PROVIDE ADDITIONAL EQUIPMENT AS REQUIRED FOR SCOPE OF WORK AS REQUIRED FOR A COMPLETE AND OPERATIONAL SYSTEM. COORDINATE WITH WALLS, CEILINGS, LIGHTS, DIFFUSERS, STRUCTURE, OBSTRUCTIONS, ETC. IN AREAS AFFECTED BY SCOPE OF WORK. NEW EQUIPMENT SHALL BE COMPATIBLE WITH EXISTING SYSTEMS. CONTRACTOR SHALL REMOVE ALL ABANDONED EQUIPMENT, COORDINATE SYSTEM MODIFICATIONS TO MINIMIZE SYSTEM IMPAIRMENT, AND PROVIDE FIRE WATCH AND/OR INTERIM FIRE PROTECTION MEASURES WHERE REQUIRED BY THE AUTHORITY HAVING JURISDICTION, INSURANCE CARRIER OR OWNER.
- 8. PROVIDE ADDITIONAL MATERIALS AND LABOR REQUIRED DUE TO LACK OF COORDINATION OR TO MEET AUTHORITY HAVING JURISDICTION AND INSURANCE CARRIER REQUIREMENTS AT NO ADDITIONAL COST TO THE OWNER.
- 9. FORWARD COMPLETED CERTIFICATE OF COMPLETION AND CONTRACTOR MATERIAL TEST CERTIFICATES TO THE OWNER.
- 10. REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION.

- 1. COORDINATE ALL DEMOLITION WITH WHAT IS SHOWN ON ARCHITECTURAL PLANS. NOTIFY ARCHITECT OF ANY
- 2. COORDINATE NEW WORK AND DEMOLITION WITH OTHER DISCIPLINES AND EXISTING CONDITIONS PRIOR TO CONSTRUCTION.
- 3. PRIOR TO SUBMITTING BID, VISIT THE JOB SITE AND BECOME FULLY ACQUAINTED WITH THE EXISTING CONDITIONS OF THE PROJECT. REVIEW GENERAL NOTES, SPECIFICATIONS AND OTHER DRAWINGS FOR ADDITIONAL REQUIREMENTS THAT MAY NOT BE SPECIFICALLY CALLED OUT IN THIS PORTION OF THE CONSTRUCTION DOCUMENTS. NOTIFY ARCHITECT. ENGINEER OR OWNER, AS DEFINED IN BID DOCUMENTS. OF CONFLICTS OR DISCREPANCIES PRIOR TO SUBMISSION OF BID ADDITIONAL COMPENSATION WILL NOT BE PAID FOR LACK OF SUCH DETERMINATION, FAMILIARIZATION, AND/OR ALLOWANCE.
- 4. EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND SITE VISITS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. FIELD VERIFY EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. COORDINATE NEW WORK AND DEMOLITION WITH OTHER DISCIPLINES AND EXISTING CONDITIONS PRIOR TO CONSTRUCTION.
- OWNER RETAINS RIGHTS OF SALVAGE FOR EQUIPMENT AND OWNER'S DESIGNATED STORAGE LOCATION. PROPERLY
- 6. EQUIPMENT TO BE REMOVED SHALL BE KEPT FOR REINSTALLATION DURING THE CONSTRUCTION PHASE WHEN FOR NEW INSTALLATION. REPAIR ANY DAMAGE CAUSED DURING WORK AT NO EXTRA COST TO THE OWNER.
- AND ROOFS WHERE COMPONENTS ARE REMOVED AND WHERE THE EXISTING PENETRATION IS NOT USED FOR THE NEW INSTALLATION. REPAIR DAMAGED SURFACES TO MATCH ADJACENT AREAS OR AS INDICATED ON THE ARCHITECTURAL
- 8. PERFORM ALL WORK ACCORDING TO THE PHASING SCHEDUL FOR THIS PROJECT. PROVIDE ALL TEMPORARY DESIGN AND/OR CONFIGURATIONS THAT MEET APPLICABLE CODE REQUIREMENTS AS NECESSARY TO CONFORM TO THE REQUIRED CONSTRUCTION PHASING OF THE PROJECT.
- SCOPE OF THE PROJECT HAVE BEEN SHOWN, INFORMATION SHOWN AS EXISTING TO REMAIN IS NOT BEING MODIFIED AS A PART OF THIS PROJECT.
- SERVICE. THE CONTRACTOR SHALL PROPERLY NOTIFY THE BUILDING OWNER, LANDLORD, THE LEASER AND ADJACENT TENANTS AS APPLICABLE A MINIMUM OF 48 HOURS IN
- 11. REMOVE ALL UNUSED AND DEMOLISHED EQUIPMENT AND ASSOCIATED MATERIALS FROM SITE. ABANDONING UNUSED
- 13. INSPECT EXISTING EQUIPMENT TO REMAIN TO VERIFY THAT EQUIPMENT IS OPERATING PROPERLY. NOTIFY OWNER OF DAMAGED AND/OR MALFUNCTIONING COMPONENTS.
- EACH WORKDAY.

FIRE ALARM GENERAL DEMOLITION NOTES

- DISCREPANCIES.

- FIXTURES TO BE REMOVED. COORDINATE WITH THE OWNER THE EQUIPMENT AND FIXTURES TO BE SALVAGED AND THE LOCATION FOR STORAGE. AVOID DAMAGE TO EQUIPMENT DURING DEMOLITION WORK AND DURING TRANSPORT TO DISPOSE OF MATERIALS THAT ARE REMOVED AND ARE NOT REQUESTED TO BE SALVAGED BY THE OWNER.
- POSSIBLE AND/OR INDICATED ON THE DRAWINGS. AVOID DAMAGING EXISTING SURFACES AND EQUIPMENT TO REMAIN SEAL PENETRATIONS THROUGH FLOORS, WALLS, CEILINGS
- 9. ONLY THE PORTIONS OF THE BUILDING AFFECTED BY THE
- 10. ALL WORK SHALL BE PERFORMED SO AS TO NOT INTERRUPT ADVANCE BEFORE PROCEEDING WITH THIS WORK.
- PORTIONS WILL NOT BE ACCEPTABLE.
- 12. SYSTEM(S) NOT ASSOCIATED WITH THE DEMOLITION SHALL BE LEFT IN SERVICE AS APPLICABLE.
- 14. ALL SYSTEMS TO BE LEFT IN SERVICE PRIOR TO THE END OF

NOT IN SCOPE

EXISTING

DEMOLISH — — — —

LINETYPE LEGEND

THROUGHOUT THE DRAWINGS DIFFERENT LINETYPES ARE USED IN

COMBINATION WITH THE SYMBOLS TO INDICATE THE STATUS OF ITEMS AS

EXISTING. TO BE DEMOLISHED. TO BE INCLUDED AS PART OF NEW WORK

AND/OR ITEMS WHICH ARE ANTICIPATED TO BE PROVIDED IN THE FUTURE.

INTENDED TO FULLY DESCRIBE ALL NECESSARY CONSTRUCTION PHASING,

RESPONSIBILITIES, ANY SUCH PHASES DESCRIBED IN THE CONSTRUCTION DOCUMENTS ARE GENERAL AND ONLY INTENDED TO INDICATE A BROAD ORDER FOR THE SAKE OF DESCRIBING THE PROJECT. THE FOLLOWING LINETYPES MAY BE USED ON ANY DEVICE, EQUIPMENT, NOTE, LINE, SHAPE,

NEW

FUTURE -----

THE STATUS OF ITEMS USING THESE LINETYPES ARE RELATIVE TO THE

VIEW IN WHICH THEY APPEAR. PHASING SHOWN IN DRAWINGS IS NOT

WHICH IS DETERMINED BY THE CONTRACTOR AS PART OF THEIR

THIS IS A	MASTER LEGEND A	ND NOT	ALL SYMBOLS OR ABBF	REVIATIONS	S ARE USED.	V2.02
ABBREVI	ATIONS			FIRE ALA	ARM	
	ABOVE FINISHED FLOOR	NIC	NOT IN CONTRACT	FACP	FIRE ALARM CONTROL PANEL/UNIT	
CD	ABOVE FINISHED GRADE CANDELA DUCTILE IRON	OC PIV PROVID	ON CENTER POST INDICATOR VALVE E FURNISH AND INSTALL	FACP	RECESSED FIRE ALARM CONTROL PANEL/UNIT	
ESFR	EARLY SUPPRESSION FAST RESPONSE	PRV	PRESSURE REDUCING VALVE	FAAP	FIRE ALARM ANNUNCIATOR PANEL	
ETR	EXISTING TO REMAIN FIRE HOSE CABINET	RD REV	RETURN DUCT REVISION	FAAP	RECESSED FIRE ALARM ANNUNCIATOR PANEL	
FP	FIRE PROTECTION CONTRACTOR	SD SF	SUPPLY DUCT SQUARE FEET	AMP	AMPLIFIER PANEL	
GPM	GALLONS PER MINUTE JUNCTION BOX	TYP UNO	TYPICAL UNLESS NOTES OTHERWISE	RPS	REMOTE POWER SUPPLY	
	MAXIMUM MINIMUM	V W	VOLT(S) WATTS	RT	REMOTE TEST STATION WITH INDICATING LIGHT	
	NOT APPLICABLE	WP	WEATHERPROOF	RL	REMOTE INDICATING LIGHT	
ANNOTAT	ΓΙΟΝ			PS	PRESSURE SWITCH LOW/HIGH	
$\langle 1 \rangle$	FIRE PROTECTION PLAN	NOTE CALI	LOUT	FS	WATERFLOW ALARM SWITCH	
				VT	CONTROL VALVE TAMPER SWITCH	
lacktriangle	CONNECTION POINT OF N	NEW WORK	K TO EXISTING	DH	MAGNETIC DOOR HOLD OPEN DEVICE	
\bigcirc 1	DETAIL REFERENCE UPP	ER NUMBE	R INDICATES DETAIL	СМ	CONTROL MODULE	
F1	NUMBER LOWER NUMBE	R INDICATE	ES SHEET NUMBER	MM	MONITOR MODULE	
1 F1	SECTION CUT DESIGNATI	ION		K	FIRE DEPARTMENT KEY BOX	
				•	PULL STATION	
	DEDICATED EQUIPMENT	ACCESS TI	LE	▼「	FIREFIGHTER'S PHONE JACK	
\square	ACCESS PANEL			(b)	HEAT DETECTOR (E INDICATES ELEVATOR RECALI	L)
TANDARI	D MOUNTING HEIGHT	-S		0	SMOKE DETECTOR (E INDICATES ELEVATOR RECA	ALL)
DIANDAIL	J WOONTING TIEIGITI	<u> </u>		(1)	SINGLE STATION SMOKE DETECTOR	
	PLIANCE (TOP OF APPLIAN ANNUNCIATOR PANEL (TO		90" LAY) 60"	[]·))))	PROJECTED BEAM SMOKE DETECTOR	
FIRE ALARM	1 ANNONCIATOR PANEL (TO 1 BELL (EXTERIOR) (CENTEI 1 CONTROL PANEL/UNIT (TO	RLINE)	[′] 120"		DUCT MOUNTED SMOKE DETECTOR (SD=SUPPLY/	RD=RETURN
PULL STATION	ON (TOP OF DEVICE) PLIANCE (CENTERLINE)	DE OF DISE	48" 84"	Δ _{co}	CARBON MONOXIDE DETECTOR	
VISIBLE APP	PLIANCE (CENTERLINE)		04	æ	AREA OF REFUGE 2-WAY COMMUNICATION SYSTE	M
	VICES AT THE MOUNTING H			FÅ	WALL MOUNTED AUDIBLE NOTIFICATION APPLIANCE #W INDICATES WATTAGE (VOICE EVACUATION SYS	
ELSEWHER ALL DEVICE	E IN THE CONSTRUCTION [OOCUMENT		\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\	WALL MOUNTED VISIBLE NOTIFICATION APPLIANCE ## INDICATES CANDELA	E
CALL OU	TS			\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\\	WALL MOUNTED AUDIBLE/VISIBLE NOTIFICATION A ## INDICATES CANDELA #W INDICATES WATTAGE (VOICE EVACUATION SY	
ENLARGED	PLAN CALLOUT			F ^{#W}	CEILING MOUNTED AUDIBLE NOTIFICATION APPLIA #W INDICATES WATTAGE (VOICE EVACUATION SY	NCE
					CEILING MOUNTED VISIBLE NOTIFICATION APPLIAN	105

CEILING MOUNTED VISIBLE NOTIFICATION APPLIANCE

CEILING MOUNTED AUDIBLE/VISIBLE NOTIFICATION APPLIANCE

#W INDICATES WATTAGE (VOICE EVACUATION SYSTEMS ONLY)

INDICATES CANDELA

INDICATES CANDELA


END OF LINE RESISTOR

ABORT SWITCH

BELL

 $\qquad \qquad \square)$

1)

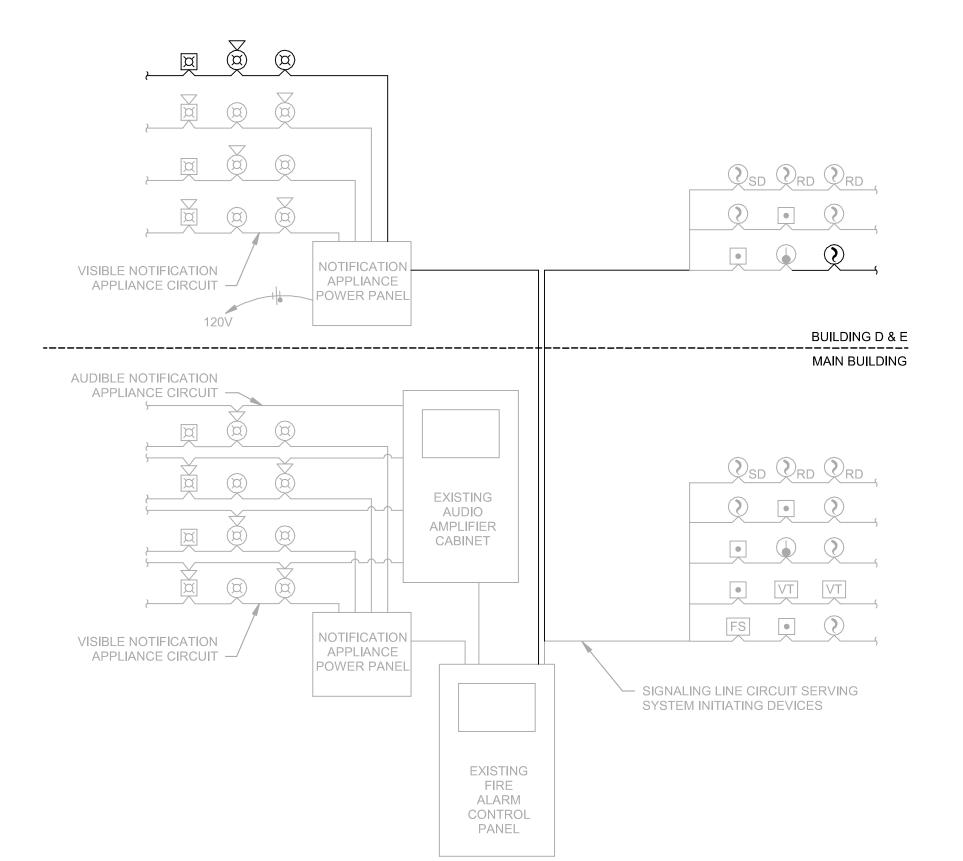

RISER DIAGRAM IS SCHEMATIC IN NATURE. NOT ALL DEVICES ARE SHOWN. REFER TO PLANS FOR EQUIPMENT QUANTITIES AND LOCATIONS. DUCT DETECTORS MAY HAVE INTEGRAL RELAYS FOR AIR HANDLING UNIT SHUT-DOWN AND FIRE/SMOKE DAMPER CONTROL. WIRING FOR THIS FUNCTION HAS NOT BEEN SHOWN. COORDINATE WITH MECHANICAL SYSTEM INSTALLER. REFER TO PLANS AND SPECIFICATIONS FOR ADDITIONAL INFORMATION.

LSR7 Robotics, GiC & **Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO N LSW: 2600 SW Ward Rd, Lee's Summit MO

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100

Lee's Summit R-7 School Multistudio 301 NE Tudor Road

816.931.6655 multi.studio structural engineer: Kaw Valley Engineering Bob D. Campbell & Company, Inc. 14700 West 114th Terrace 4338 Belleview Lenexa, KS 66215 Kansas City, MO 64111 913.485.0318 816.531.4144

Lee's Summit, MO 64086 Kansas City, MO 64111

4200 Pennsylvania


www.bdc-engrs.com kveng.com MEPFT/Code:: **Henderson Engineers** 8345 Lenexa Drive, Suite

Lenexa, KS 66214 816.742.5000 www.hendersonengineers.com

> HENDERSON 8345 LENEXA DRIVE, SUITE 300 LENEXA, KS 66214 TEL 913.742.5000 FAX 913.742.5001 WWW.HENDERSONENGINEERS.COM MO. CORPORATE NO: E-556D

EXPIRES 12/31/2022

Issue Date: September 9, 2022 Revisions



CHRISTOPHER J. CULP LICENSE # PE-2013037646

LSHS - FIRE ALARM **GENERAL NOTES AND**

09/08/2022

LEGEND



LSR7 Robotics, GiC & **Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO 64086 LSW: 2600 SW Ward Rd, Lee's Summit MO 64082 LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100

Lee's Summit R-7 School Multistudio 301 NE Tudor Road 4200 Pennsylvania Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655 multi.studio

structural engineer: Kaw Valley Engineering Bob D. Campbell & Company, Inc. 14700 West 114th Terrace 4338 Belleview Lenexa, KS 66215 Kansas City, MO 64111 913.485.0318 816.531.4144 www.bdc-engrs.com kveng.com MEPFT/Code::

Henderson Engineers 8345 Lenexa Drive, Suite Lenexa, KS 66214 816.742.5000 www.hendersonengineers.com

> HENDERSON ENGINEERS 8345 LENEXA DRIVE, SUITE 300 LENEXA, KS 66214 TEL 913.742.5000 FAX 913.742.5001

September 9, 2022



CHRISTOPHER J. CULP LICENSE # PE-2013037646

09/08/2022

LSHS - FIRE ALARM RCP

- LEVEL 1 - BUILDING D & E **FA101-C**

VOCATIONAL

WOOD SHOP D115

VOCATIONAL SHOP D118

VOCATIONAL SHOP D117


CLASSROOM D116

CLASSROOM D104

ROBOTICS FABRICATION D101

ROBOTICS PRACTICE

FIELD D103

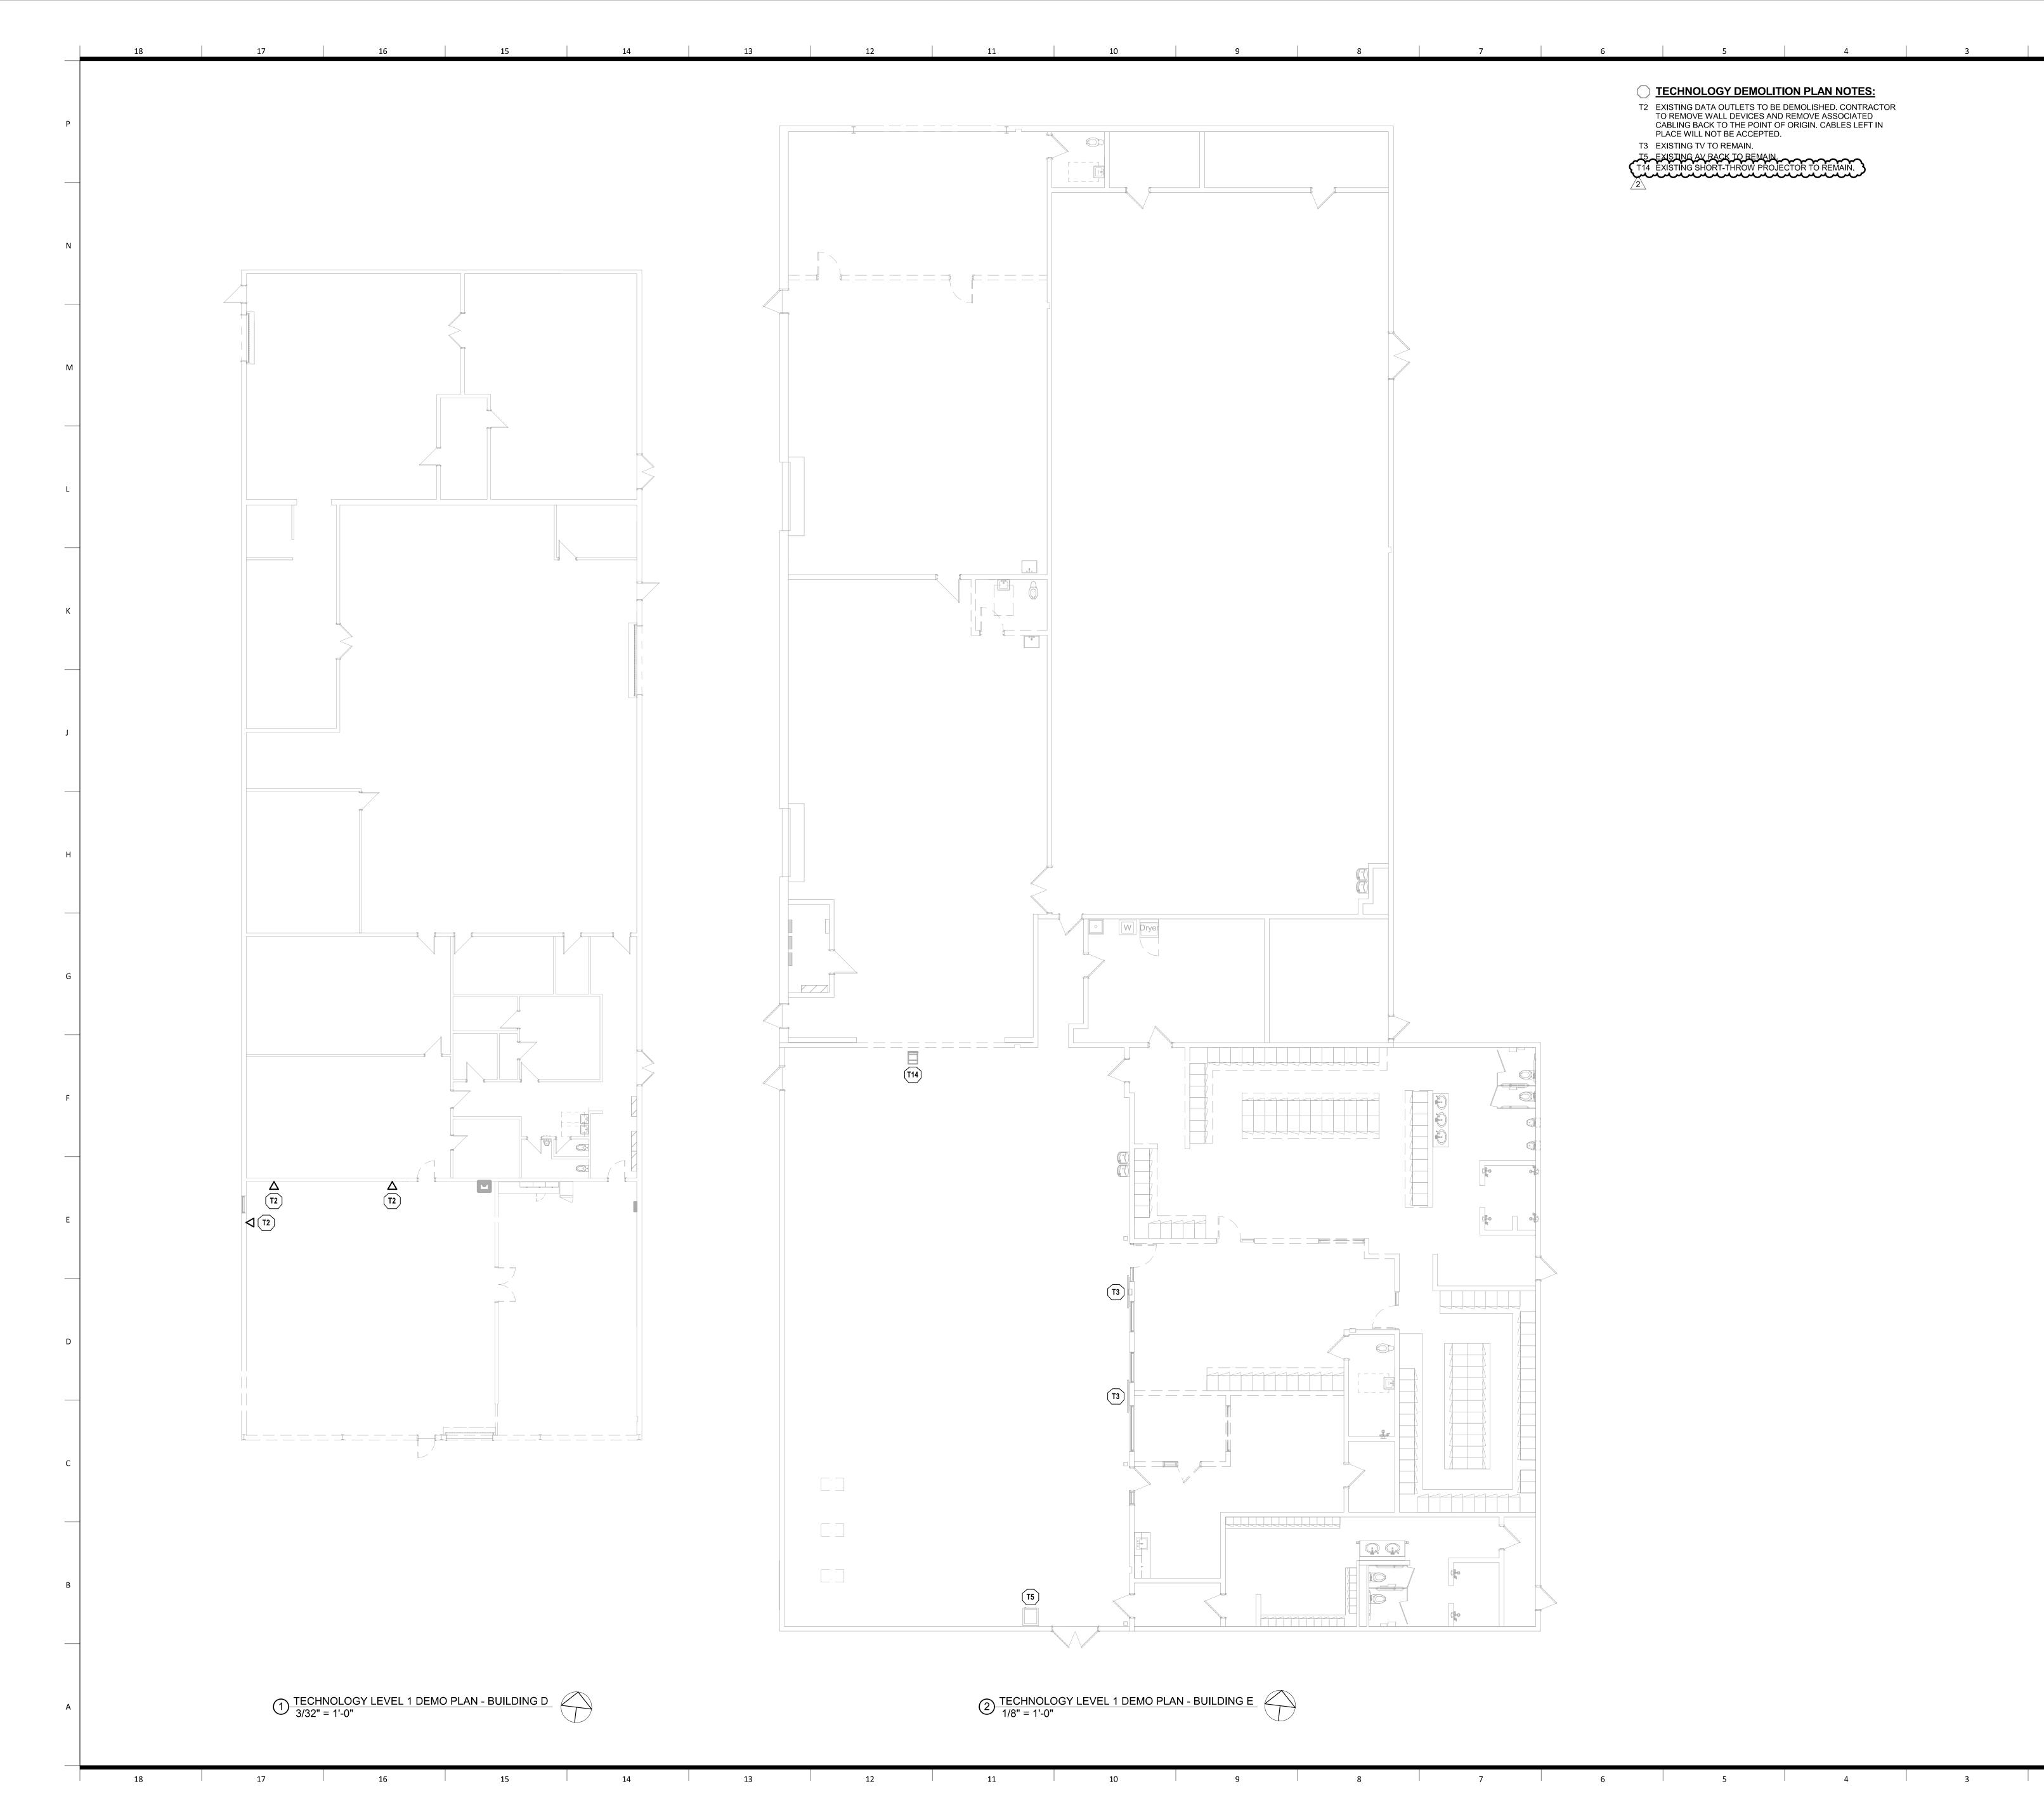

multistudio

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO
64086

N LSW: 2600 SW Ward Rd, Lee's Summit MO
64082
LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100
architect:
7 School Multistudio

owner: architect:

Lee's Summit R-7 School

301 NE Tudor Road 4200 Pennsylvania
Lee's Summit, MO 64086 Kansas City, MO 64111
816.931.6655
multi.studio

civil engineer: structural engineer:

Kaw Valley Engineering
14700 West 114th Terrace
Lenexa, KS 66215
913.485.0318

structural engineer:

Bob D. Campbell & Company, Inc.

4338 Belleview
Kansas City, MO 64111
816.531.4144

kveng.com www.bdc-engrs.com

MEPFT/Code::
Henderson Engineers
8345 Lenexa Drive, Suite
300
Lenexa, KS 66214

816.742.5000 www.hendersonengineers.com

HENDERSON
ENGINEERS

8345 LENEXA DRIVE, SUITE 300
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001

WWW.HENDERSONENGINEERS.COM

2150005255
MO COPPODATE NO: E 556D

Revisions

NUMBER

DESCRIPTION

Addendum 02


Addendum 02

DATE

2

Addendum 02

09/23/2022



LSHS - TECHNOLOGY
DEMOLITION PLAN LEVEL 1 - BUILDING D &

TND101-C

TELECOMMUN	ICATIONS SYME	BOLS										
THIS IS A MASTER LEGEND A	AND NOT ALL SYMBOLS OR ABBI HTS	REVIATIONS AR	RE USED.	TELECOMMUNICATIONS END-POINT DEVIC	CES					GENERAL NEW WORK N	DTES	V2.00
TELECOM BACKBOARD (BOTTOM OF LADDER RACK IN TELECOM ROOMS	(BOTTOM OF DEVICE) 90"	W"xH	WIRE MESH CABLE TRAY (W"=WIDTH, "H"=HEIGHT)	DEVICE SCHEDULE	CABLE(S)					DIVISIONS OF WORK. CC	NS AND REVIEW DRAWINGS OF A ORDINATE THIS WORK WITH ALL	
CABLE TRAY / CONDUIT AFC (BOTTO LIGHT FIXTURE IN TELECOM ROOMS TELEPHONE WALL OUTLET (CENTER	(BOTTOM OF DÉVICE) 108"(MIN)		VERTICAL CABLE TRAY	SYMBOL DESCRIPTION	A B C DETAIL 0 0 0 N/A					DIVISIONS OF WORK AND) ALL SUBCONTRACTORS. DRM TO THE APPLICABLE SPECIF	-ICATIONS
DATA WALL OUTLET TELEVISION OUTLET TMGB/TGB (CENTERLINE)	SAME AS ADJACENT DEVICE, UNO REFER TO ARCH DRAWINGS 84"	(#) D"	UNDERGROUND CONDUIT ("#"=QUANTITY, "D"=CONDUIT DIAMETER)	S RC PAGING SPEAKER, RECESSED CAN CEILING MOUNT	0 1 0 2/TN400-C					(DIVISION 26, DIVISION 27 PRE-ESTABLISHED STRU	, DIVISION 28, ETC.) AND THE CUSCTURED CABLING STANDARDS;	STOMER SHOULD
WALL CLOCK (CENTERLINE) INTERCOM (CENTERLINE)	84" 48"	(#) D"	── CONDUIT ("#"=QUANTITY, "D"=CONDUIT DIAMETER)	PAGING SPEAKER, PENDANT CEILING MOUNT AUDIO-VIDEO IP END-POINT DEVICES	0 1 0 2/TN400-C	<i>-</i>				TECHNOLOGY AND THE CONTRACTOR SHALL CO	HE SPECIFICATIONS RELATING T CLIENT'S PRE-ESTABLISHED STAI NTACT THE LOW VOLTAGE ENGI	NDARDS THE
USE THE DEFAULT MOUNTING HEIGH CONSTRUCTION DOCUMENTS. MOUN		#	CABLE SUPPORTS OR J-HOOKS CONDUIT SLEEVE	REFER TO TA-SERIES DRAWINGS FOR AV						CLARIFICATION THROUG 3. FULLY COORDINATE ALL	H THE RFI PROCESS. CABLE TRAY, FIRE STOP CONDU	JITS /
FINISHED FLOOR (AFF) OR ABOVE FINISHED FLOOR (AFF) OR ABOVE FINISHED SHALL BE	NISHED GRADE (AFG) TO BOTTOM OF E INSTALLED IN COMPLIANCE WITH	(#) D"	("#"=QUANTITY, "D"=CONDUIT DIAMETER)	SYMBOL DESCRIPTION	CABLE(S) DETAIL 1 0 2 6/TN400-C	2				COORDINATE CABLE TRA	ROUTING WITH STRUCTURAL EL AY AND CONDUIT INSTALLATIONS AL ENGINEER, STRUCTURAL CON	S WITH
CURRENT ADA AND LOCAL REQUIRE ABBREVIATIONS	MENIS.	PB L"XW"X	UL FIRESTOP SYSTEM ASSEMBLY H" PULL BOX	\vee	2 0 1 5/TN400-C					AND GENERAL CONTRAC CONCRETE SLAB OR UN	TOR PRIOR TO INSTALLATION. FOR SLAB (WHERE CONDUIT WO	ROUTING IN OULD BE ON
A AMPERES ADA AMERICANS WITH	LAN LOCAL AREA NETWORK LCC LIMITED COMBUSTIBLE CABLE	SC	("L"=LENGTH, "W"=WIDTH, "H"=HEIGHT) SPLICE	TELECOMMUNICATIONS RESPONSIBILITY	MATRIX	nish	Ins	fall		4. ALL TELECOMMUNICATION	JSE OF WET LOCATION RATED C. ONS CONTINUOUS PATHWAYS SH	HALL BE
DISABILITIES ACT AFC ABOVE FINISHED CEILING AFF ABOVE FINISHED FLOOR	LEC LOCAL EXCHANGE CARRIER LED LIGHT-EMITTING DIODE LF LINEAR FEET	RISER DIAGF			Tuil		1113	tan		CONDUITS, INSULATION	DMMUNICATIONS BONDING BACK BUSHINGS SHALL BE USED AT TH HEST AWAY FROM THE SERVING	HE END OF
AFG ABOVE FINISHED GRADE AHJ AUTHORITY HAVING JURISDICTION	MAN METROPOLITAN AREA NETWORK MATV MASTER ANTENNA			Description	Construction	Owner	Construction	Owner	Comments	SERVING TR. CONTRACT	.L BE USED AT THE END CLOSES [*] FOR TO REFER TO THE ANSI-STD NAL INFORMATION AS TO THE IN:)-J 607
ANSI AMERICAN NATIONAL STANDARDS INSTITUTE AP ACCESS POINT	TELEVISION MC MAIN CROSS-CONNECT MDF MAIN DISTRIBUTION FRAME		COPPER UTP CROSS CONNECT	Becompacin	Team		Team	Gu mer		OF THE TELECOMMUNIC	ATIONS BONDING BACKBONE.	
AV AUDIO-VIDEO AWG AMERICAN WIRE GAUGE	MFR MANUFACTURER MH MAINTENANCE HOLE	P	110-TYPE PROTECTOR BLOCK	General Communications						TELECOMMUNICATIONS STOPPED WITH THE APP	CABLING PATHWAYS SHALL BE F ROVED FIRE STOP SYSTEMS (F/S	FIRE S). ALL
BAS BUILDING AUTOMATION SYSTEM BBC BACKBONE BONDING	MM MULTIMODE MPOE MAIN POINT OF ENTRANCE MPOP MAIN POINT OF PRESENCE	PATCH PANE	EL PATCH PANEL	Grounding and Bonding Hangers and Supports	X		X			MANUFACTURER AND AS "FIRESTOPPING". FIRE S	ILL BE INSTALLED AS DIRECTED E S SPECIFIED IN DIVISION 07 07 84 TOP ASSEMBLY LOCATIONS ARE	100 -
CONDUCTOR BD BUILDING DISTRIBUTOR BDF BUILDING DISTRIBUTION	MTD MOUNTED N/A NOT APPLICABLE NEC NATIONAL ELECTRICAL CODE	SBB	SECONDARY BONDING BUSBAR (SBB)	Conduits and Backboxes Cable Trays	X		X			COORDINATED WITH CA TELECOMMUNICATIONS		
FRAME BFC BELOW FINISHED CEILING C CONDUIT	NFPA NATIONAL FIRE PROTECTION ASSOCIATION NIC NOT IN CONTRACT	PBB	PRIMARY BONDING BUSBAR (PBB)	Underground pathways for utility entrance and floor boxes Firestops, Conduit Sleeves, and Sleeve Seals	X		X			WALLS SHALL BE COORI	UIT LOCATIONS IN PRECAST CON DINATED WITH ARCHITECT, STRU PR TO ORDERING THE PRECAST N	JCTURAL
CAT CATEGORY CATV COMMUNITY ANTENNA TELEVISION	nm NANOMETER NRTL NATIONALLY RECOGNIZED TESTING LAB		 TELECOMMUNICATIONS BACKBONE CABLING (REFER TO RISER DIAGRAM FOR MORE INFORMATION) 	Structured Cabling Telecom Room Cabinets, Racks, Frames, and Enclosures	X		X			7. ROUTING OF CABLES SH	ALL BE CONCEALED. CABLES SH EXPOSED AREAS. MINIMIZE AMOU	HALL BE
CCTV CLOSED CIRCUIT TELEVISION	OC ON CENTER OSHA OCCUPATIONAL SAFETY AND	TELECOMMU	JNICATIONS ROOM LADDER RACK	Telecom Room Buildout (ex. backboard and ladder rack) Telecom Room Uninterruptible Power Supply (UPS) Telecom Room Power Strips	X	X	X	X		EXPOSED CONDUIT BY E POSSIBLE. EMBEDDED (MBEDDING CONDUIT IN SLAB WH CONDUITS AND PENETRATIONS O	HEN DF
CD CAMPUS DISTRIBUTOR CMP COMMUNICATIONS PLENUM JACKET	HEALTH ADMINISTRATION OSP OUTSIDE PLANT PBB PRIMARY BONDING BUSBAR			Optical Fiber Backbone Cable and Connectivity Copper Backbone Cable and Connectivity	X		X			WHEN CONDUITS CAN O ARCHITECT PRIOR TO S	OW DETAILS IN STRUCTURAL DE NLY BE INSTALLED EXPOSED, NO TART OF INSTALLATION OF COND	OTIFY OUITS.
CMR COMMUNICATIONS RISER JACKET DAS DISTRIBUTED ANTENNA	PBX PRIVATE BRANCH EXCHANGE POE POWER OVER ETHERNET PON PASSIVE OPTICAL NETWORK	PBB	PRIMARY BONDING BUSBAR (PBB) - WALL ELEVATION VIEW	Copper Horizontal Cable and Connectivity Data Communications	X		X			CEILINGS. CONDUITS FO	ED IN CONDUIT WHEN ABOVE HA R ELEVATOR PHONES AND FIRE / BE CONTINUOUS (HOMERUN) FR	ALARM
SYSTEM dB DECIBELS DEMO DEMOLITION	POTS PLAIN OLD TELEPHONE SERVICE PSTN PUBLIC SWITCHED	SBB	SECONDARY BONDING BUSBAR (SBB) - WALL ELEVATION VIEW	Router / Firewall Core Switch / Edge Switch		X		X X			ROOM TO THE APPLICABLE BOX A E AND PROVIDE CONDUITS TO M	
(E) EXISTING EC ELECTRICAL CONTRACTOR ECIA ELECTRONIC COMPONENTS	TELEPHONE NETWORK QTY QUANTITY RCDD REGISTERED	-B-B-	PBB/SBB - PLAN VIEW	Wireless Access Points Servers / Storage and Backup Laptops / Desktops / Copiers / Printers / Scanners		X		X X X		INFORMATION TECHNOL	ROOMS SHALL BE DEDICATED FO DGY USE (I.E. NO SHARED SPACE 'STEM, ETC.) NO SERVICES SHAL	E WITH A
INDUSTRY ASSOCIATION EMI ELECTROMAGNETIC INTERFERENCE	COMMUNICATIONS DISTRIBUTION DESIGNER RMC RIGID METAL CONDUIT		TELECOM BACKBOARD	Software Voice Communications		X		X		THROUGH THE SPACE U	NLESS DEDICATED TO THE SPAC , ELECTRICAL, FIRE, ETC.)	
EMS ENERGY MANAGEMENT SYSTEM EMT ELECTRICAL METALLIC	RU RACK UNIT SBB SECONDARY BONDING BUSBAR	0 0	TWO-POST EQUIPMENT RACK	VoIP Gateway / Analog handsets VoIP handset wall mount kit		X		X X				
TUBING ER EQUIPMENT ROOM	SCS STRUCTURED CABLING SYSTEM		FOUR-POST EQUIPMENT RACK	VoIP handsets VoIP Network licensing		X		X X				
ETR EXISTING TO REMAIN FAAP FIRE ALARM ANNUNCIATOR PANEL	SF SQUARE FEET SM SINGLEMODE SPECS SPECIFICATIONS			Audio-Video Communications Conduits and Backboxes for AV systems	X		X			GENERAL DEMOLITION N 1. PRIOR TO SUBMITTING B	OTES ID, VISIT THE JOB SITE AND BECC	OME FULLY
FACP FIRE ALARM CONTROL PANEL FD FLOOR DISTRIBUTOR	TBB TELECOMMUNICATIONS BONDING BACKBONE TBD TO BE DETERMINED		EQUIPMENT CABINET (REFER TO PLAN NOTES ON ENLARGED PLANS FOR MORE INFORMATION)	HDMI Classroom Cabling and Connectivity Refer to AV drawings for AV Scope Distributed & Monitoring Communications	X		X			INCLUDING PATHWAY LO	EXISTING CONDITIONS OF THE FA CATIONS AND ELEVATIONS. REV LL OTHER TRADE DRAWINGS FOR	/IEW THE
FMC FLEXIBLE METAL CONDUIT FS FIRE STOP SYSTEM FLR FLOOR	TIA TELECOMMUNICATIONS INDUSTRY ASSOCIATION TR TELECOMMUNICATIONS ROOM			K12 Classroom Analog Paging Wireless Clock Systems	X		X			PORTION OF THE CONST	NTS THAT MAY NOT BE CALLED (RUCTION DOCUMENTS, INCLUDII ORK DOCUMENTS. NOTIFY ARC	ING ALL
F/UTP SCREEN TWISTED PAIR (SHIELDED) GC GENERAL CONTRACTOR	TYP TYPICAL UNO UNLESS NOTED OTHERWISE UL UNDERWRITER			Electronic Safety and Security Conduits and Backboxes for Security systems	X		X				S SPECIFIED, OF ANY CONFLICTS	
GYP GYPSUM BOARD HC HORIZONTAL CROSS- CONNECT	LABORATORIES, INC. UPS UNINTERRUPTIBLE POWER SUPPLY	TELECOMMU	JNICATIONS OUTLETS	Refer to Security drawings for Security Scope						$^{-\!$	'ERE TAKEN FROM ORIGINAL DRA Y NOT REFLECT EXACT "AS-BUIL FY CONDITIONS PRIOR TO SUBM	.T"
HCM HORIZONTAL CABLE MANAGER HH HAND HOLE	U/UTP UNSHIELDED TWISTED PAIR V VOLT(S) VCM VERTICAL CABLE MANAGER	SYMBOL DE	CABLE(S) ESCRIPTION A B C DETAIL							FINAL BIDS. COORDINAT	E NEW WORK AND DEMOLITION V NG CONDITIONS PRIOR TO CONS	WITH OTHER
Hz HERTZ IMC INTERMEDIATE METAL CONDUIT	W WIRE WAN WIDE AREA NETWORK WAO WORK AREA OUTLET	▽ 2D DA	TA WALL OUTLET 2 0 0 3/TN400-0	С							NG SURFACES AND EQUIPMENT . REPAIR DAMAGE CAUSED DURII	
IP INTERNET PROTOCOL ISP INTERNET SERVICE PROVIDER	WAP WIRELESS ACCESS POINT WP WEATHER PROOF WR WEATHER RESISTANT	·	TA WALL OUTLET 4 0 0 3/TN400-0 TA WALL OUTLET 4 0 0 3/TN400-0							4. REMOVE ALL PATHWAYS	, CABLING AND ASSOCIATED DE\ BE REMOVED. ABANDONING UNI	
ISP INSIDE PLANT CABLE JB JUNCTION BOX J-BOX JUNCTION BOX	WT WATERTIGHT XP EXPLOSION-PROOF	Ψ 2B	TA CEILING OUTLET 2 0 0 4/TN400-0							PORTIONS WILL NOT BE	ACCEPTABLE.	
ANNOTATION		V W,2D TE	LEPHONE, VoIP WALL OUTLET 2 0 0 3/TN400-0							GENERAL DEMOLITION S THE SPACE INTENDED T	S AS REQUIRED TO ACCOMMODA COPE. ANY SYSTEMS PASSING T D REMAIN IN SERVICE SHALL BE	THROUGH
1 TECHNOLOGY PLAN CALLO	OUT										ATED AS REQUIRED TO MAINTAIN E GENERAL DEMOLITION AND NE	
1 EQUIPMENT DESIGNATION CONTRACTOR INSTALLED)										TO BE DEMOLISHED UND	RAL PLANS FOR SCOPE OF AREAS ER THIS PHASE OF CONSTRUCTI	TON. NOTE
CONNECTION POINT OF NE										SCOPE OF AREA IDENTIF	EPFT DEMOLITION WORK EXTEN IED DUE TO EXISTING SYSTEM D ENGINEER OF ANY CONFLICTS C	DESIGN.
	R NUMBER INDICATES DETAIL R INDICATES SHEET NUMBER										MEDIATE STORAGE, REMOVAL A	
SECTION CUT DESIGNATION	DN									(PATHWAYS, CABLE, TEF	MMUNICATIONS SCS COMPONEN MINATION COMPONENTS, ETC.) A OF EXISTING SPECIAL SYSTEMS	AND THE
DEDICATED EQUIPMENT A	CCESS TILE										R PRIOR TO IMPLEMENTATION THE LT OF THE DEMOLITION / RENOV.	
ACCESS PANEL											CATIONS CABLES AND COMPONI NSTRUCTION ZONE SHALL BE PR	_
LINETYPE LEGEND										AND REMAIN IN PLACE S ACCOMMODATING THE (O AS TO MAINTAIN SERVICE WHIL SENERAL DEMOLITION AND NEW IALL COORDINATE ALL SUCH EFF	LE ALSO SCOPE OF
	ERENT LINE-TYPES ARE USED IN O INDICATE THE STATUS OF ITEMS AS E INCLUDED AS PART OF THE NEW WORK									THE CLIENT PRIOR TO IN TO REMAIN IN PLACE TE	PLEMENTATION. DAMAGE TO EX ECOMMUNICATIONS CABLES AN BY THE CONTRACTOR SHALL BE	XISTING AND ND
AND/OR ITEMS WHICH ARE ANTICIPATHE STATUS OF ITEMS USING THESE	TED TO BE PROVIDED IN THE FUTURE. LINETYPES ARE RELATIVE TO THE VIEW									IN A TIMELY MANNER AN CLIENT AND AT NO ADDI	D TO THE WRITTEN SATISFACTIONAL COST TO THE CLIENT. COSUPPORTS FOR ANY EXISTING CA	ON OF THE ONTRACTOR
TO FULLY DESCRIBE ALL NECESSARY DETERMINED BY THE CONTRACTOR A										ARE NOT PROPERLY SUI		ISELO TIVO
OF DESCRIBING THE PROJECT. THE F	NDICATE A BROAD ORDER FOR THE SAKE FOLLOWING LINETYPES MAY BE USED ON											
ANY DEVICE, EQUIPMENT, NOTE, LINE EXISTING	E, SHAPE, ETC.									CALLOUTO		
DEMOLISH — — — —	FUTURE									CALL OUTS	}}}}	
CABLE TYPES A CATEGORY 6 CABLE										ENLARGED PLAN CALLOUT		
B PAGING SPEAKER CABLE										NOT IN SCOPE		
C HDMI CABLE											\times	

LSR7 Robotics, GiC & **Phys Education**

LSN: 901 NE Douglas St., Lee's Summit MO N LSW: 2600 SW Ward Rd, Lee's Summit MO 64082 LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

> Lee's Summit R-7 School Multistudio 301 NE Tudor Road 4200 Pennsylvania Lee's Summit, MO 64086 Kansas City, MO 64111 816.931.6655

0121-0100

civil engineer: structural engineer:
Kaw Valley Engineering Bob D. Campbell & Company, Inc. 14700 West 114th Terrace 4338 Belleview Lenexa, KS 66215 Kansas City, MO 64111 913.485.0318 816.531.4144 www.bdc-engrs.com

multi.studio

kveng.com MEPFT/Code:: **Henderson Engineers** 8345 Lenexa Drive, Suite Lenexa, KS 66214

www.hendersonengineers.com


816.742.5000

8345 LENEXA DRIVE, SUITE 300 LENEXA, KS 66214 TEL 913.742.5000 FAX 913.742.5001 WWW.HENDERSONENGINEERS.COM 2150005255 MO. CORPORATE NO: E-556D EXPIRES 12/31/2022

September 9, 2022

09/09/2022 DOUGLAS M. EVERHART LICENSE # PE-2019007648

LSHS - TECHNOLOGY GENERAL NOTES AND LEGEND TN000-C

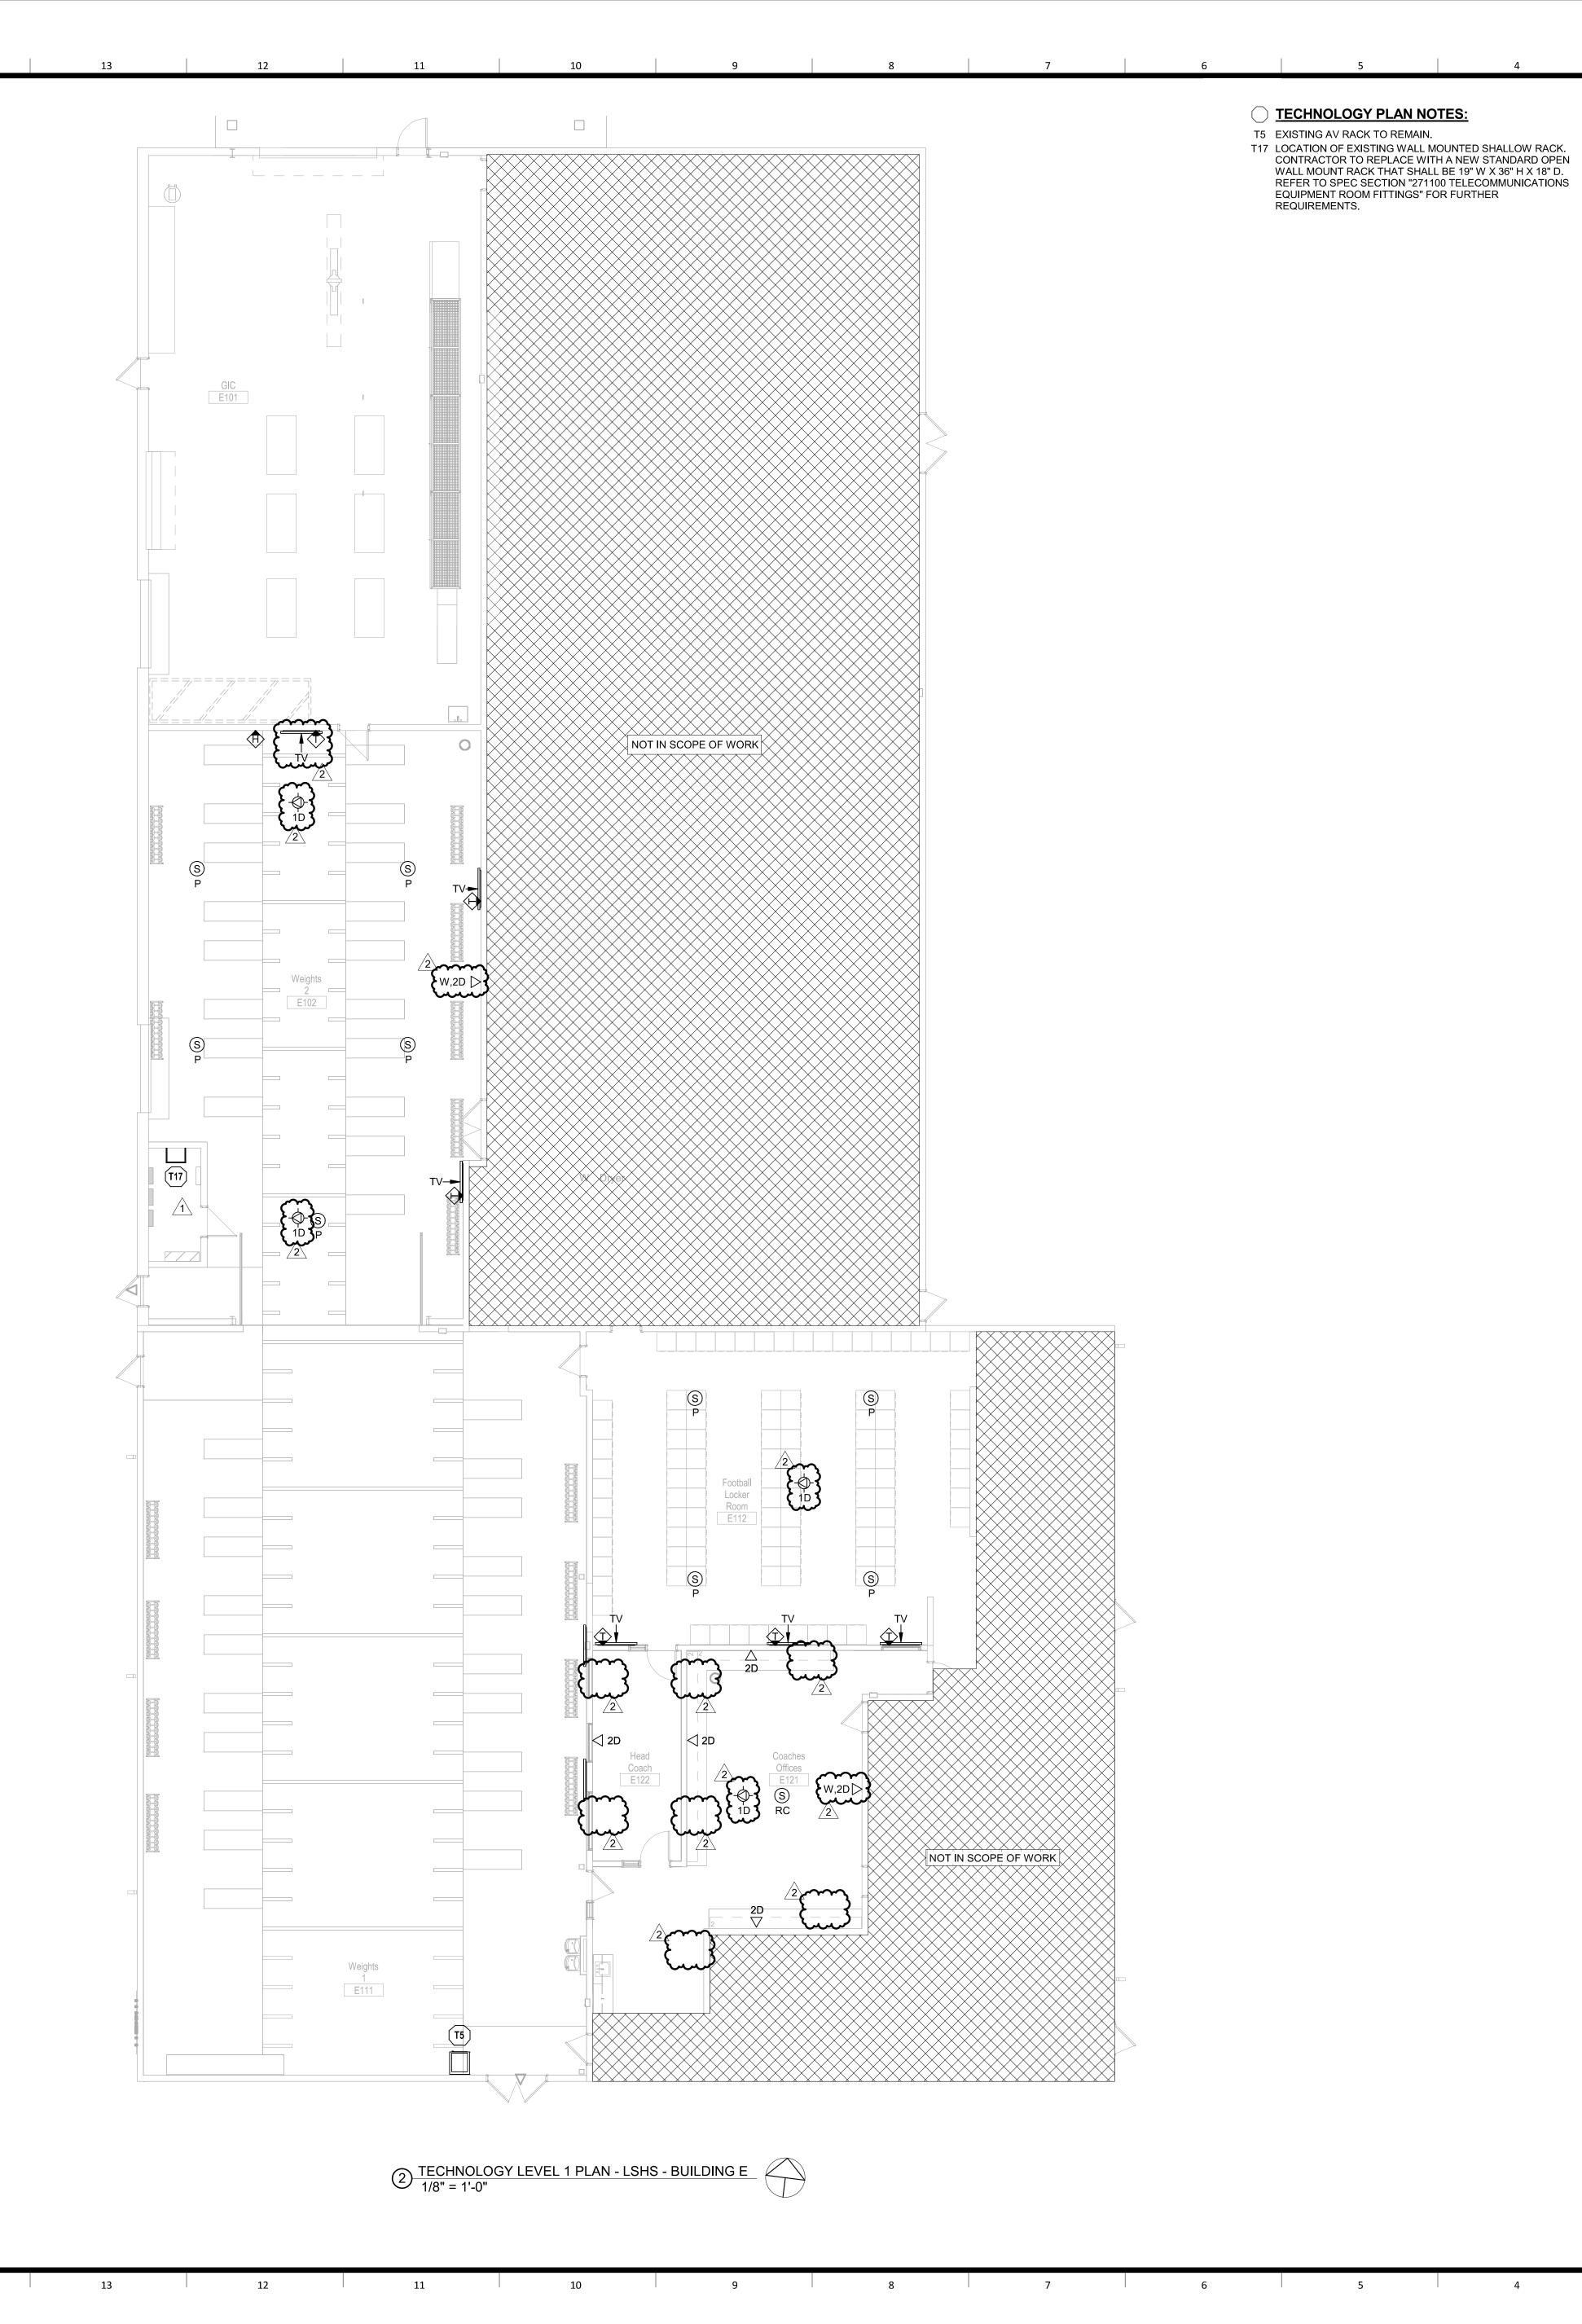

multistudio

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086 N LSW: 2600 SW Ward Rd, Lee's Summit MO

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

owner: architect:

Lee's Summit R-7 School

301 NE Tudor Road
Lee's Summit, MO 64086

Kansas City, MO 64111
816.931.6655

multi.studio

civil engineer: structural engineer:

Kaw Valley Engineering Bob D. Campbell & Company, Inc.

14700 West 114th Terrace 4338 Belleview
Lenexa, KS 66215 Kansas City, MO 64111

913.485.0318 816.531.4144

kveng.com www.bdc-engrs.com

MEPFT/Code::
Henderson Engineers

8345 Lenexa Drive, Suite
300

8345 Lenexa Drive, Suite 300 Lenexa, KS 66214 816.742.5000 www.hendersonengineers.com

HENDERSON
ENGINEERS

8345 LENEXA DRIVE, SUITE 300
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001

WWW.HENDERSONENGINEERS.COM

2150005255
MO. CORPORATE NO: E-556D

 Issue Date:
 September 9, 2022

 Revisions
 DESCRIPTION
 DATE

 1
 Addendum 01
 09/16/2022

 2
 Addendum 02
 09/23/2022




DOUGLAS M. EVERHART LICENSE # PE-2019007648


LSHS - TECHNOLOGY
PLAN - LEVEL 1 BUILDING D & E
TN101-C


1 TECHNOLOGY LEVEL 1 PLAN - LSHS - BUILDING D 3/32" = 1'-0"


ROBOTICS PRACTICE FIELD


NOT IN SCOPE OF WORK

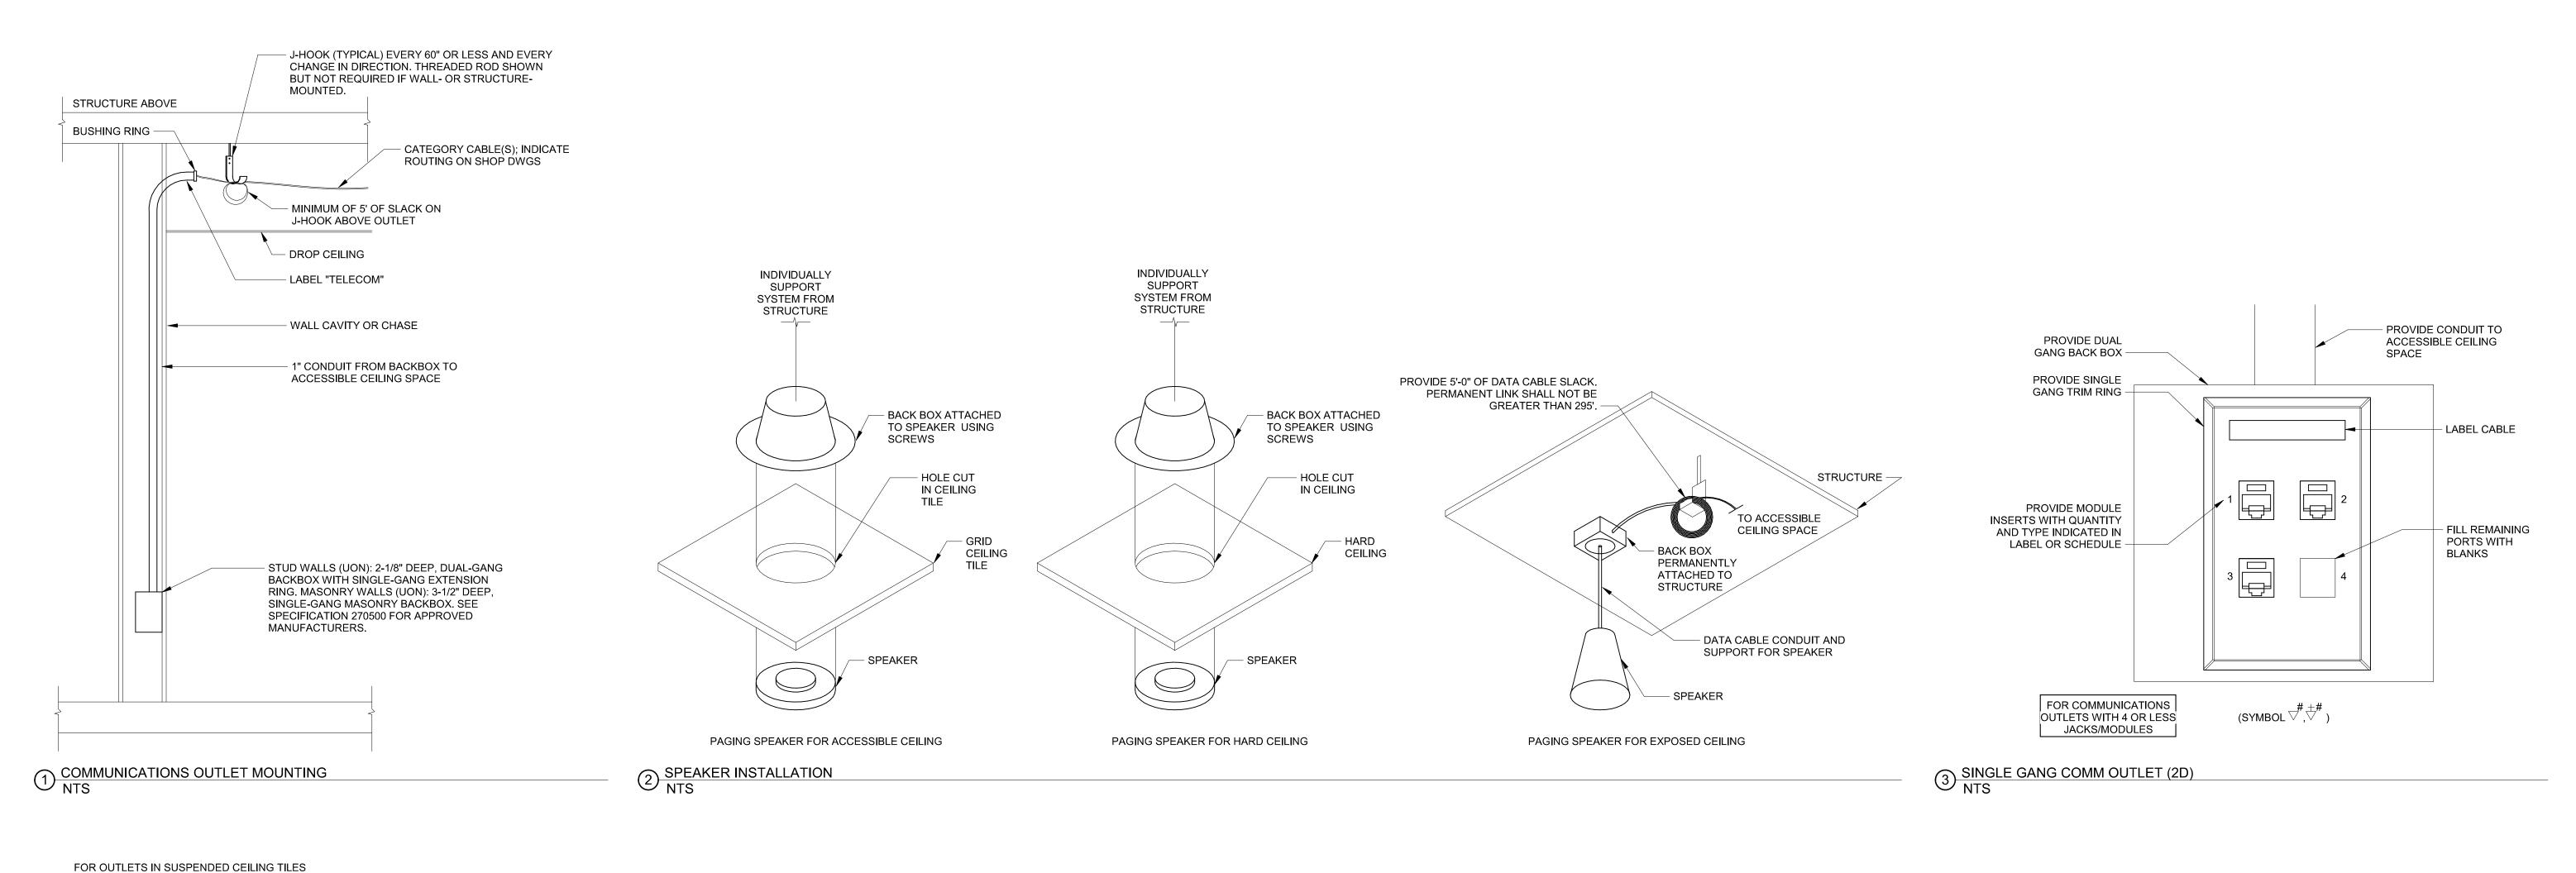

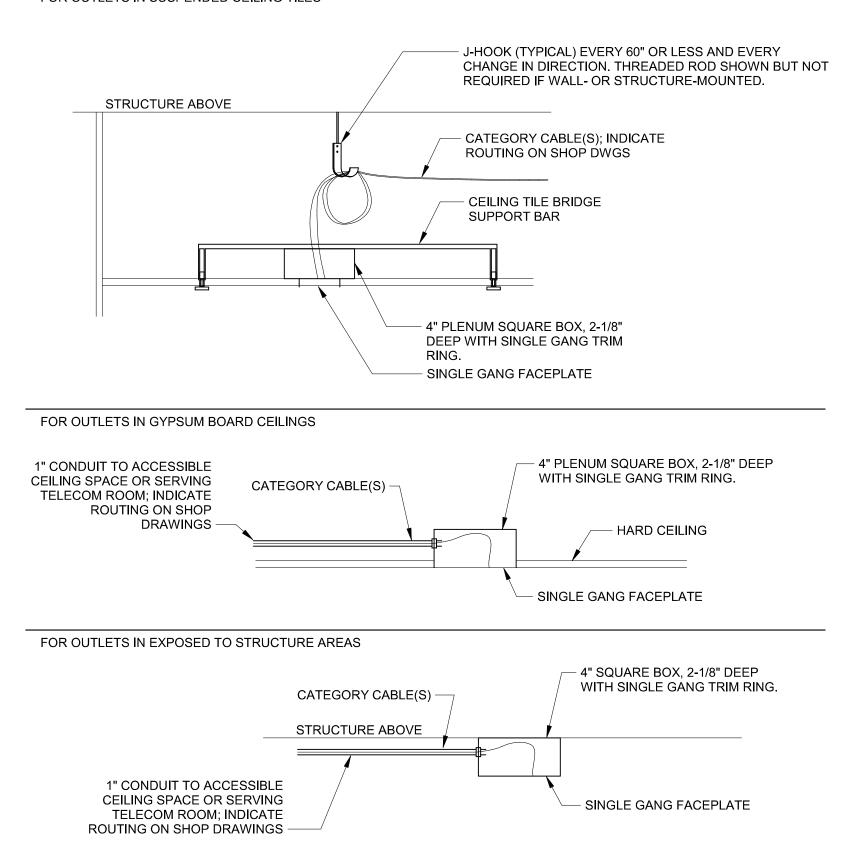

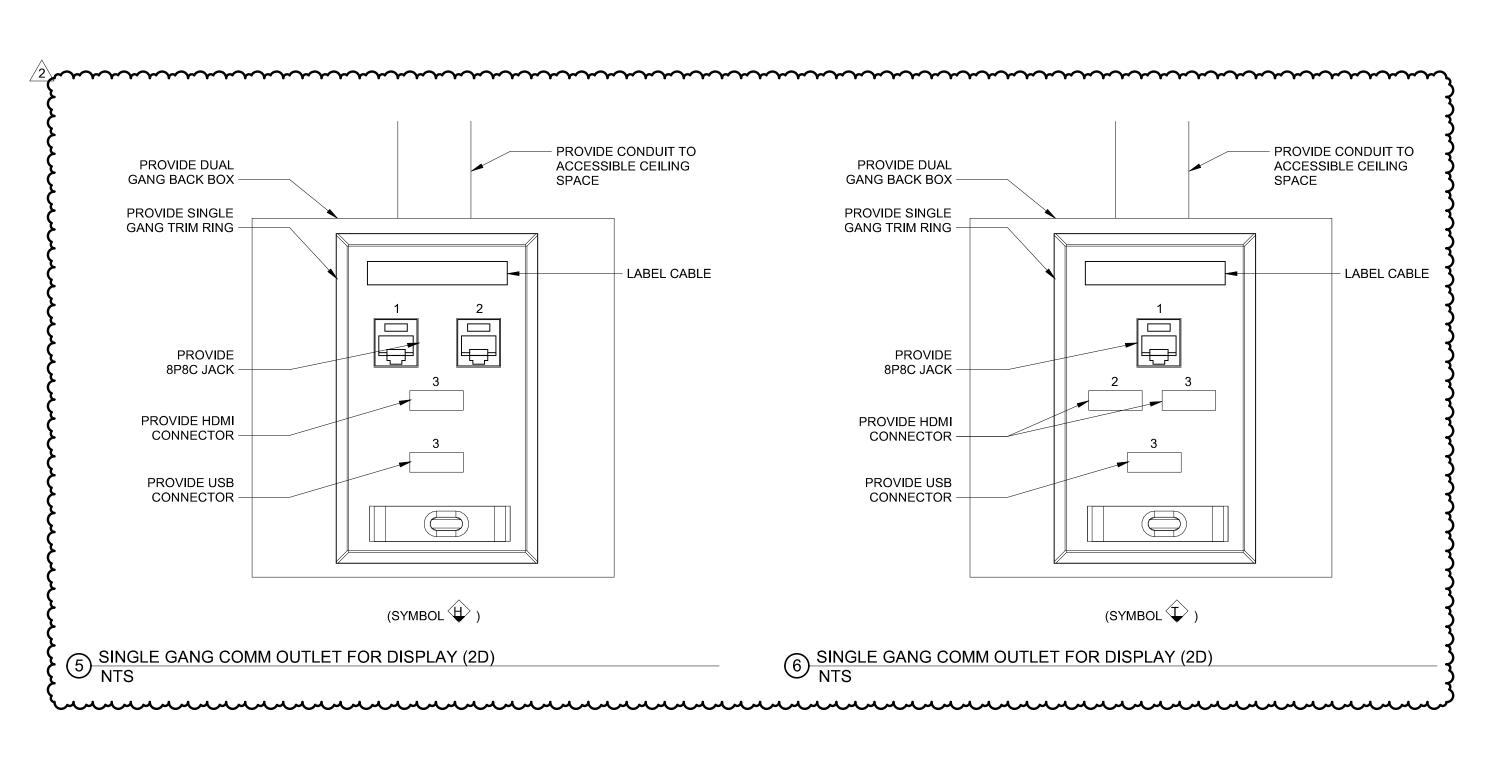

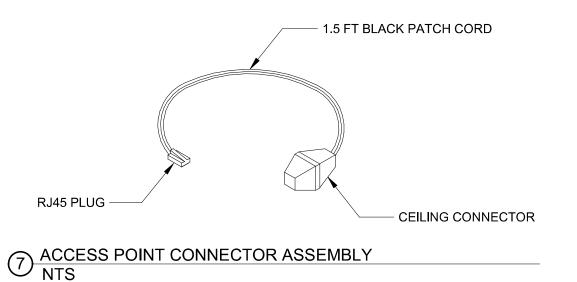

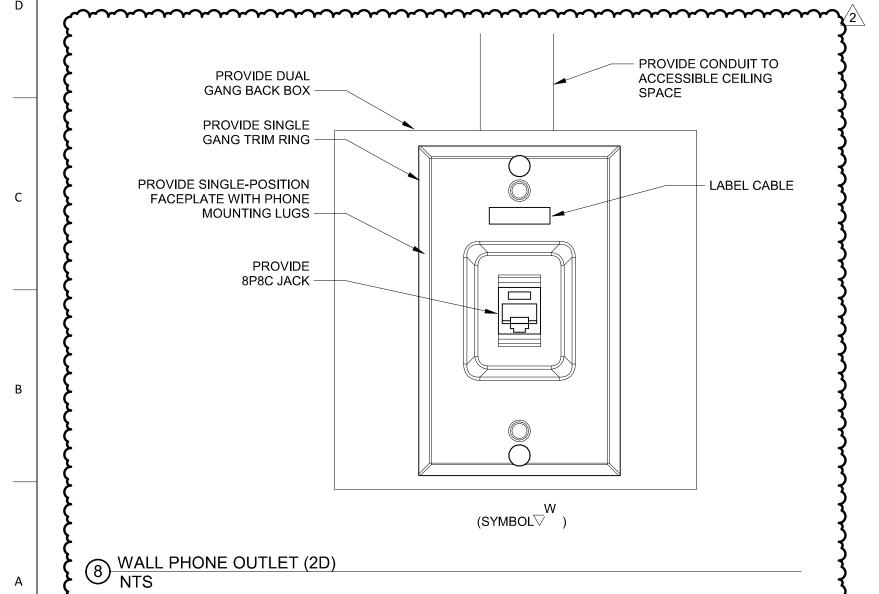

4 CEILING COMM OUTLET 2D NTS

multistudio

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086 N LSW: 2600 SW Ward Rd, Lee's Summit MO 64082

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

0121-0100

owner: architect:
Lee's Summit R-7 School Multistudio

4200 Pennsylvania

Lee's Summit, MO 64086

Kansas City, MO 64111
816.931.6655
multi.studio

civil engineer:

Kaw Valley Engineering
14700 West 114th Terrace

4338 Belleview

Lenexa, KS 66215 Kansas City, MO 64111
913.485.0318 816.531.4144
kveng.com www.bdc-engrs.com
MEPFT/Code::
Henderson Engineers
8345 Lenexa Drive, Suite

Henderson Engineers
8345 Lenexa Drive, Suite
300
Lenexa, KS 66214
816.742.5000
www.hendersonengineers.com

301 NE Tudor Road

HENDERSON
ENGINEERS

8345 LENEXA DRIVE, SUITE 300
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001

WWW.HENDERSONENGINEERS.COM


2150005255
MO. CORPORATE NO: E-556D
EXPIRES 12/31/2022

Revisions
NUMBER
DESCRIPTION
Addendum 02
DESCRIPTION
DATE
2
Addendum 02
09/23/2022



LSHS - TECHNOLOGY DETAILS

TN400-C

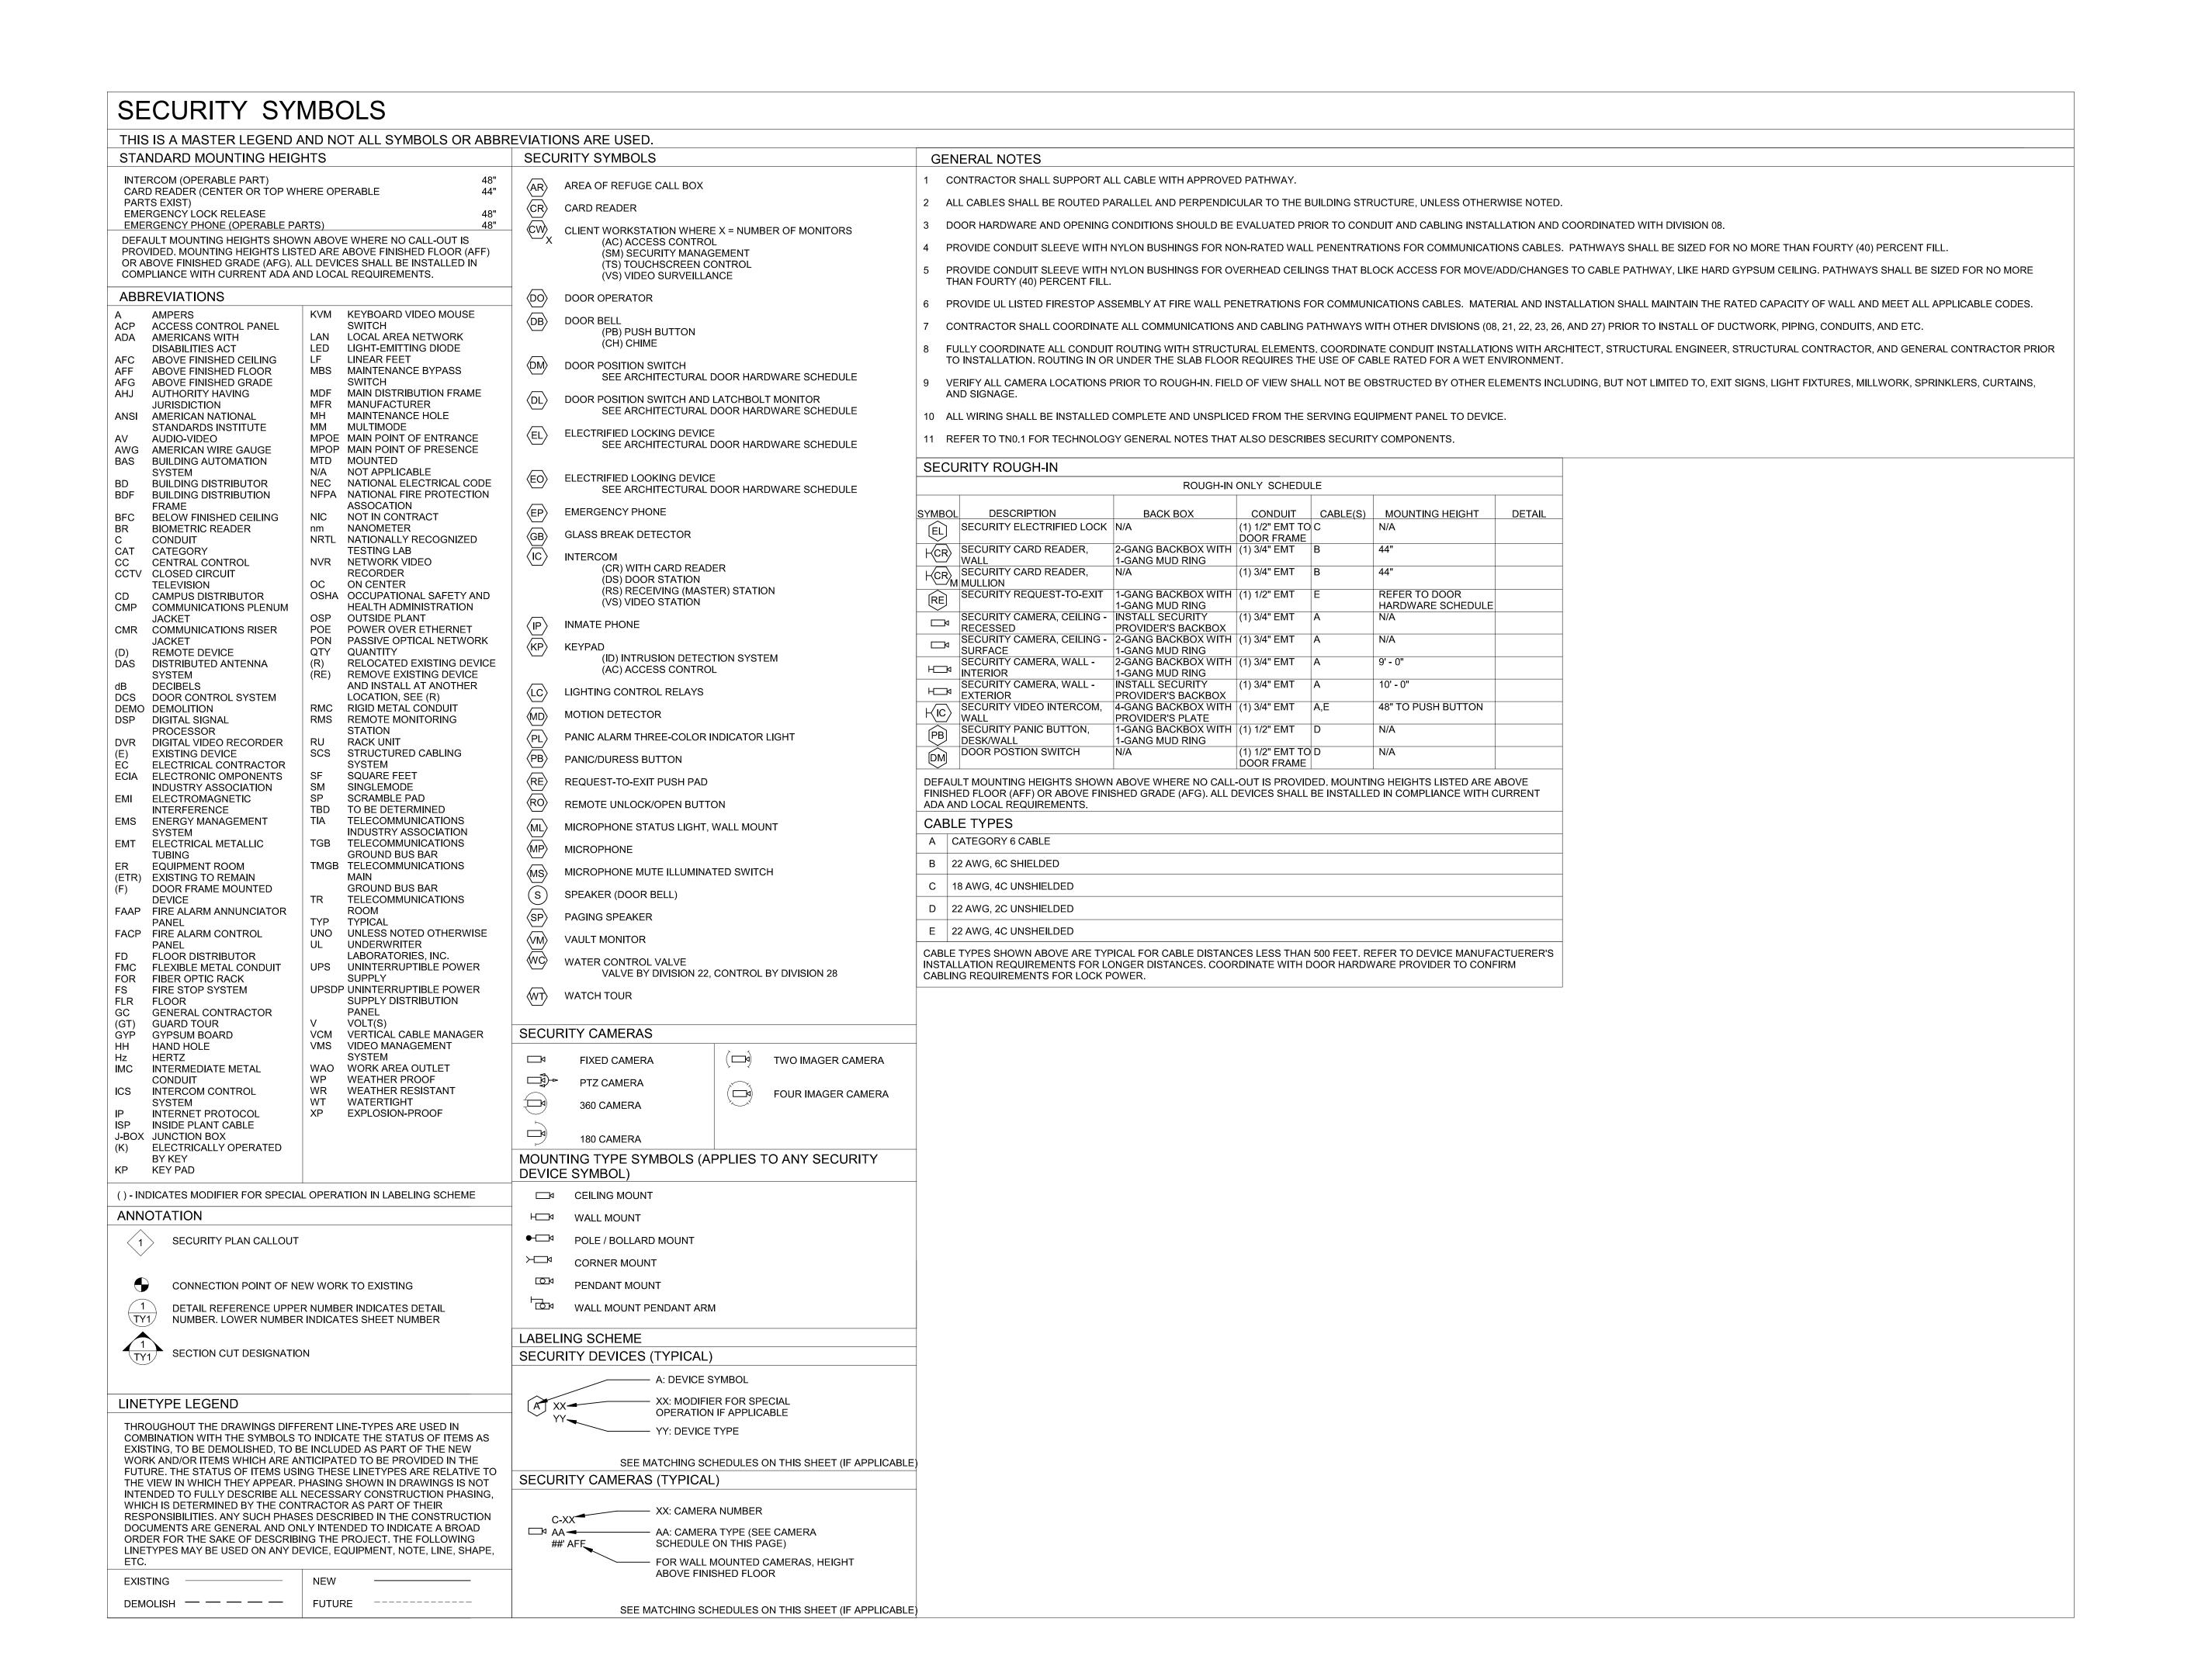

multistudio

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086 N LSW: 2600 SW Ward Rd, Lee's Summit MO 64082

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063
0121-0100

Lee's Summit R-7 School
301 NE Tudor Road
Lee's Summit, MO 64086
Lee's Summit, MO 64086
Kansas City, MO 64111
816.931.6655
multi.studio
civil engineer: structural engineer:

civil engineer:

Kaw Valley Engineering

14700 West 114th Terrace

Lenexa, KS 66215

913.485.0318

kveng.com

MEPFT/Code::

Kaw Valley Engineering

4338 Belleview

Kansas City, MO 64111

816.531.4144

www.bdc-engrs.com

MEPFI/Code::
Henderson Engineers
8345 Lenexa Drive, Suite
300
Lenexa, KS 66214
816.742.5000
www.hendersonengineers.com

HENDERSON
ENGINEERS

8345 LENEXA DRIVE, SUITE 300
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001

WWW.HENDERSONENGINEERS.COM

2150005255
MO. CORPORATE NO: E-556D
EXPIRES 12/31/2022

Revisions
NUMBER DESCRIPTION DATE



LSHS - SECURITY
GENERAL NOTES AND
LEGEND
TYOOO-C

VOCATIONAL

SHOP D121

VOCATIONAL

SHOP D118

VOCATIONAL SHOP D117

> CLASSROOM D116

> > STORAGE D105

CLASSROOM D104

ROBOTICS FABRICATION D101

> PRACTICE FIELD D103

VOCATIONAL

SHOP D122

WOOD SHOP D115

> STORAGE D113

STORAGE D114

> ROBOTICS CLASSROOM D102

SPRAY

BOOTH D119

multistudio

> SECURITY PLAN NOTES:

OWNER'S SECURITY VENDOR.

TY2 ALL SECURITY DEVICES SHOWN SHALL BE SERVED BY EXISTING PANELS NOT SHOWN ON PLAN. COORDINATE WITH

LSR7 Robotics, GiC &

Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO

N LSW: 2600 SW Ward Rd, Lee's Summit MO 64082 LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

owner: architect:

Lee's Summit R-7 School
301 NE Tudor Road
Lee's Summit, MO 64086 Kansas City, MO 64111
816.931.6655

multi.studio

civil engineer: structural engineer:

Kaw Valley Engineering Bob D. Campbell & Company, Inc.

14700 West 114th Terrace Lenexa, KS 66215 Kansas City, MO 64111

913.485.0318 816.531.4144

kveng.com www.bdc-engrs.com

MEPFT/Code::
Henderson Engineers
8345 Lenexa Drive, Suite
300
Lenexa, KS 66214
816.742.5000
www.hendersonengineers.com

HENDERSON
ENGINEERS

8345 LENEXA DRIVE, SUITE 300
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001

WWW.HENDERSONENGINEERS.COM


2150005255
MO. CORPORATE NO: E-556D
EXPIRES 12/31/2022


Revisions
NUMBER DESCRIPTION DATE





LSHS - SECURITY PLAN -LEVEL 1 - BUILDING D &


TY101-C

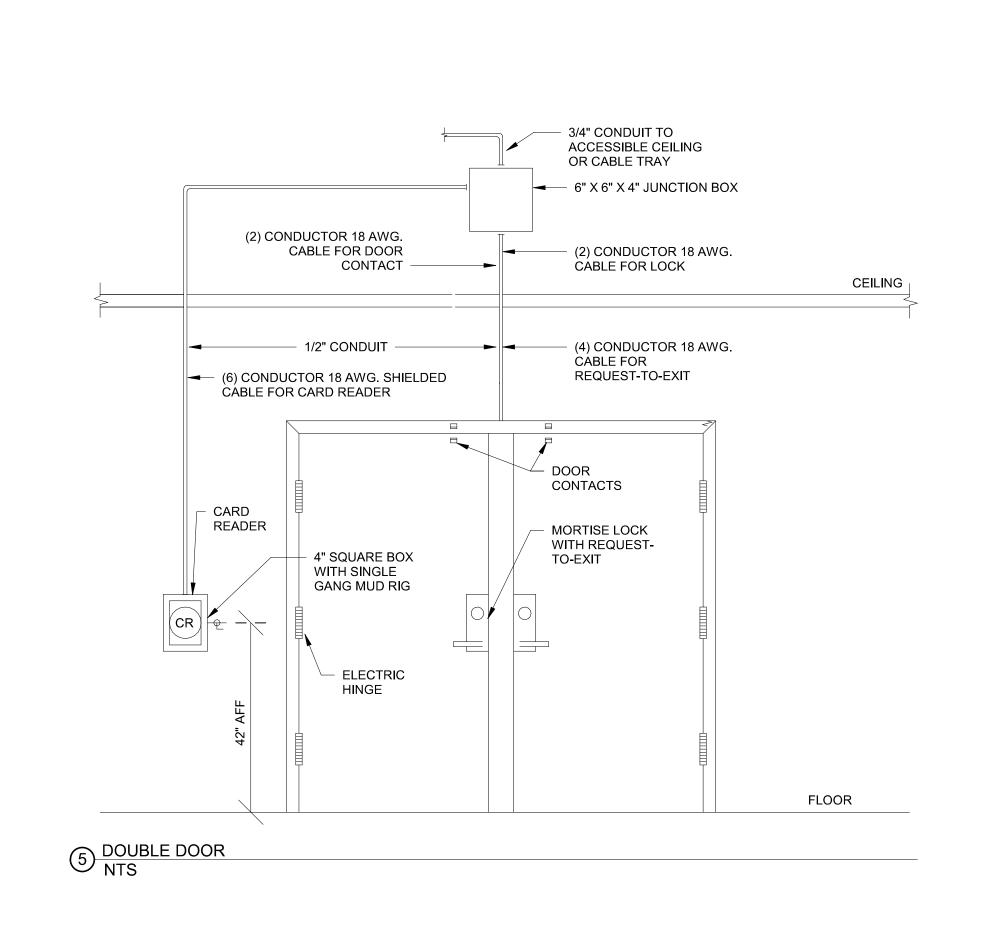

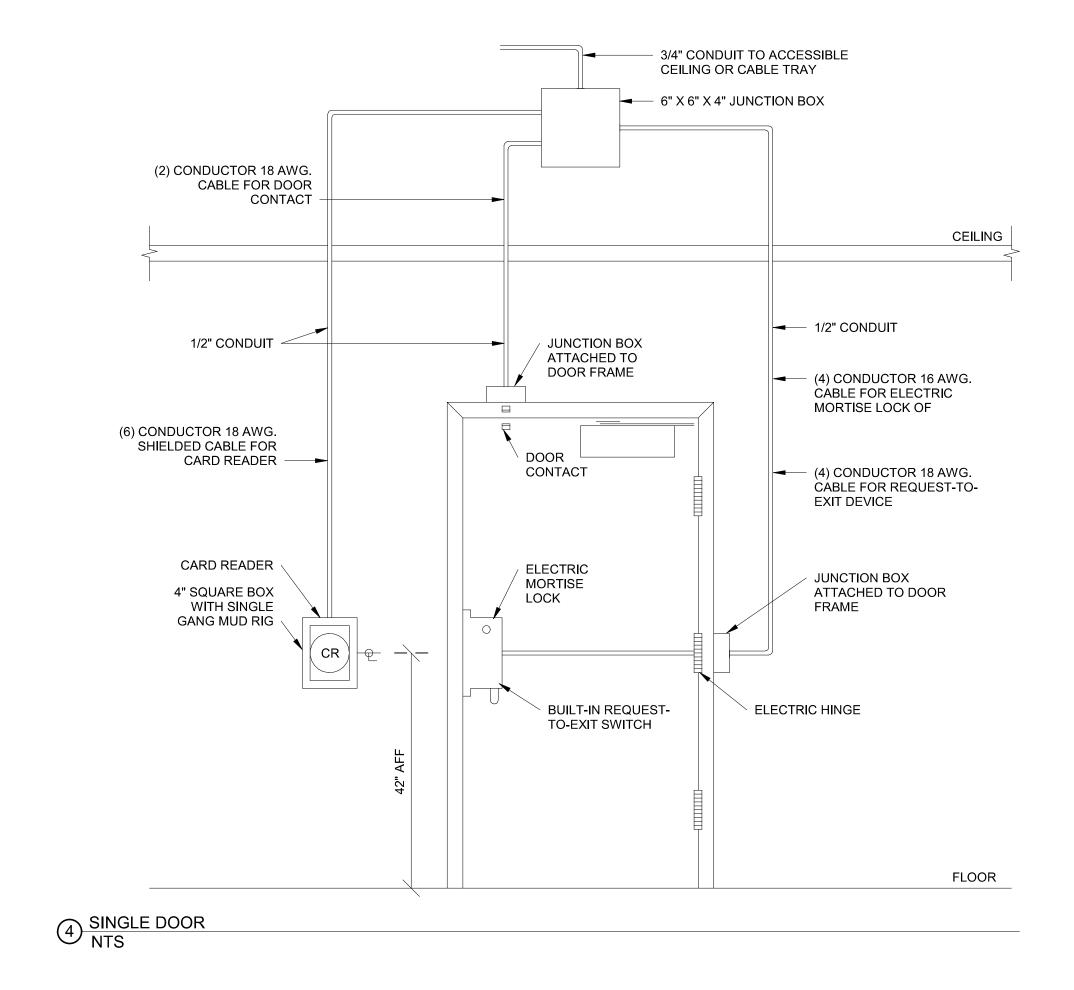

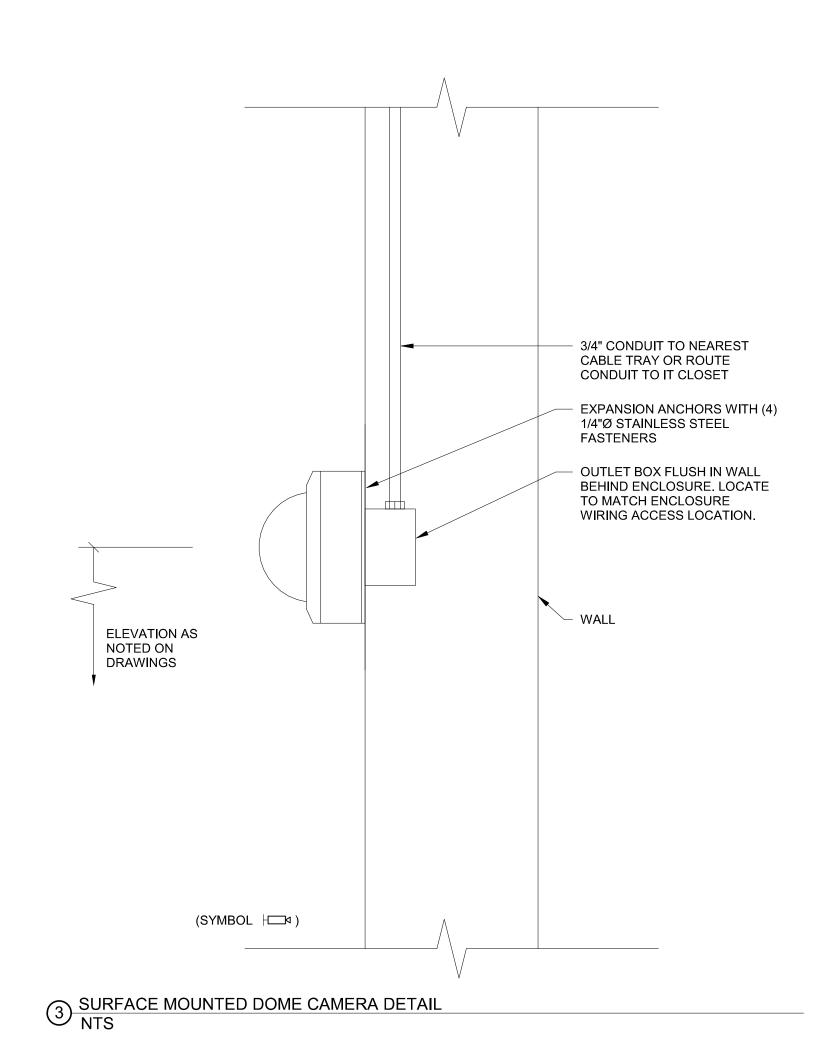

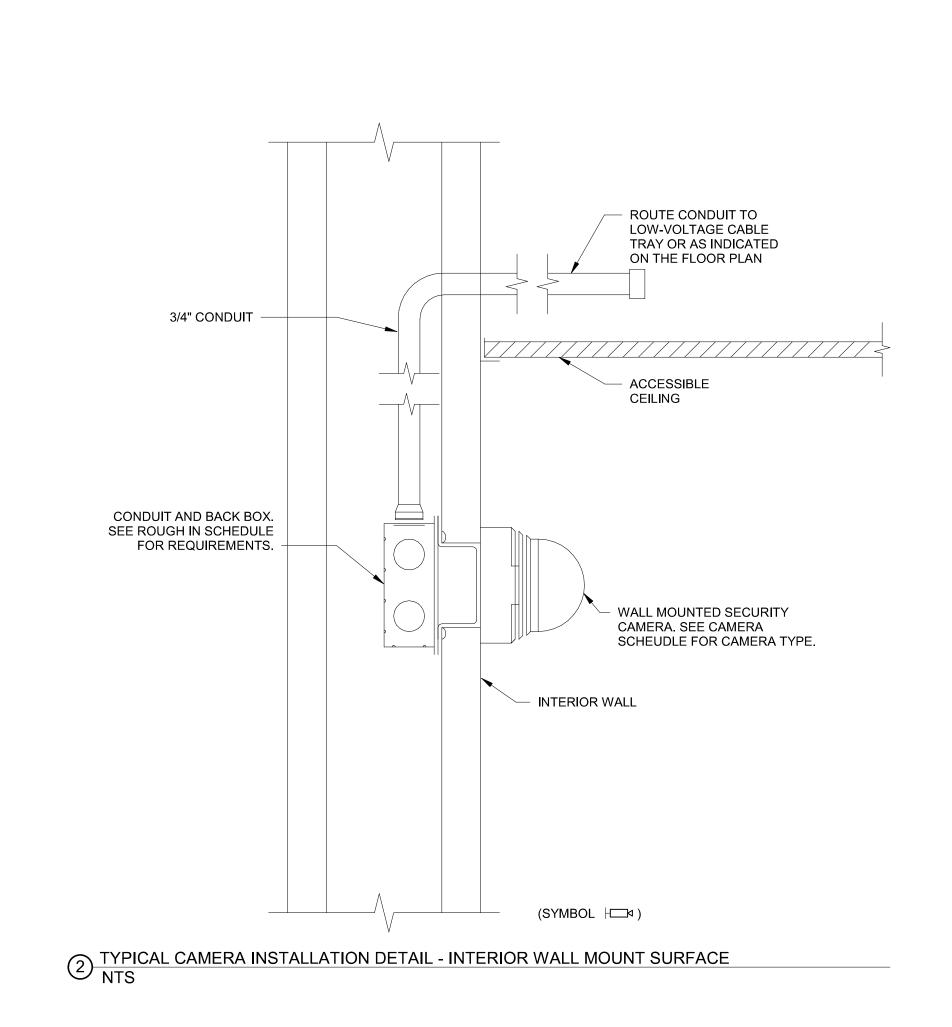

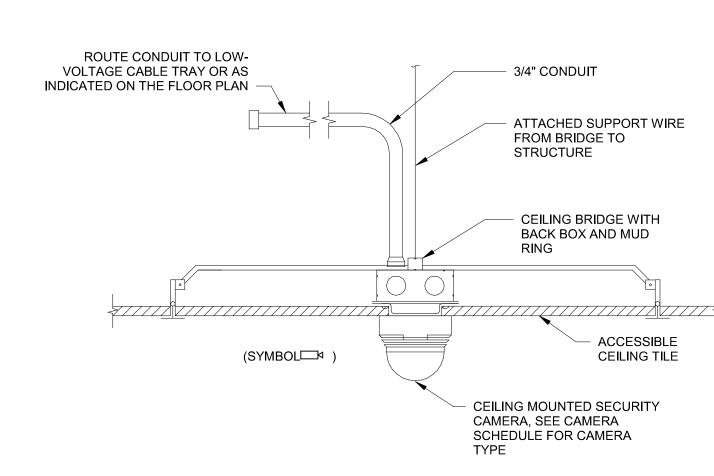

1 TYPICAL CAMERA INSTALLATION DETAIL - INTERIOR CEILING MOUNT SURFACE NTS

multistudio

LSR7 Robotics, GiC & Phys Education

LSN: 901 NE Douglas St., Lee's Summit MO 64086 N LSW: 2600 SW Ward Rd, Lee's Summit MO 64082

> 0121-0100 er: architect:

LSHS: 400 SE Blue Pkwy, Lee's Summit MO 64063

Lee's Summit R-7 School
301 NE Tudor Road
Lee's Summit, MO 64086

Kansas City, MO 64111
816.931.6655
multi.studio

civil engineer: structural engineer:

Kaw Valley Engineering
14700 West 114th Terrace
Lenexa, KS 66215
913.485.0318
kveng.com

ktructural engineer:

Bob D. Campbell & Company, Inc.

4338 Belleview
Kansas City, MO 64111
816.531.4144
www.bdc-engrs.com

kveng.com www.
MEPFT/Code::
Henderson Engineers
8345 Lenexa Drive, Suite
300
Lenexa, KS 66214
816.742.5000

816.742.5000 www.hendersonengineers.com

HENDERSON
ENGINEERS


8345 LENEXA DRIVE, SUITE 300
LENEXA, KS 66214
TEL 913.742.5000 FAX 913.742.5001

WWW.HENDERSONENGINEERS.COM

2150005255
MO. CORPORATE NO: E-556D
EXPIRES 12/31/2022

Issue Date: September 9, 2022

Revisions
NUMBER DESCRIPTION DATE



LSHS - SECURITY DETAILS

TY500-C