


Lumberman's Row With Fire Flow At Maximum Day Demand

	ID	Static Demand (gpm)	Static Pressure (psi)	Static Head (ft)	Fire-Flow Demand (gpm)	Residual Pressure (psi)
1	<input type="checkbox"/> 9303	0.00	100.45	1,176.82	1,750.00	74.82
2	<input type="checkbox"/> 9439	0.00	100.01	1,176.82	1,750.00	72.40
3	<input type="checkbox"/> 9440	0.00	98.71	1,176.82	1,750.00	66.61
4	<input type="checkbox"/> 9441	0.00	98.71	1,176.82	1,750.00	64.03
5	<input type="checkbox"/> 9442	9.10	97.85	1,176.82	1,750.00	59.06
6	<input type="checkbox"/> 9443	0.00	96.98	1,176.82	1,750.00	53.91



Lumberman's Row With No Fire Flow At Peak Hour Demand

		ID	Static Demand (gpm)	Static Pressure (psi)	Static Head (ft)	Fire-Flow Demand (gpm)	Residual Pressure (psi)
1	<input type="checkbox"/>	9303	0.00	70.00	1,106.54	0.00	70.00
2	<input type="checkbox"/>	9439	0.00	69.56	1,106.54	0.00	69.56
3	<input type="checkbox"/>	9440	0.00	68.26	1,106.54	0.00	68.26
4	<input type="checkbox"/>	9441	0.00	68.26	1,106.54	0.00	68.26
5	<input type="checkbox"/>	9442	18.20	67.39	1,106.53	0.00	67.39
6	<input type="checkbox"/>	9443	0.00	66.53	1,106.53	0.00	66.53

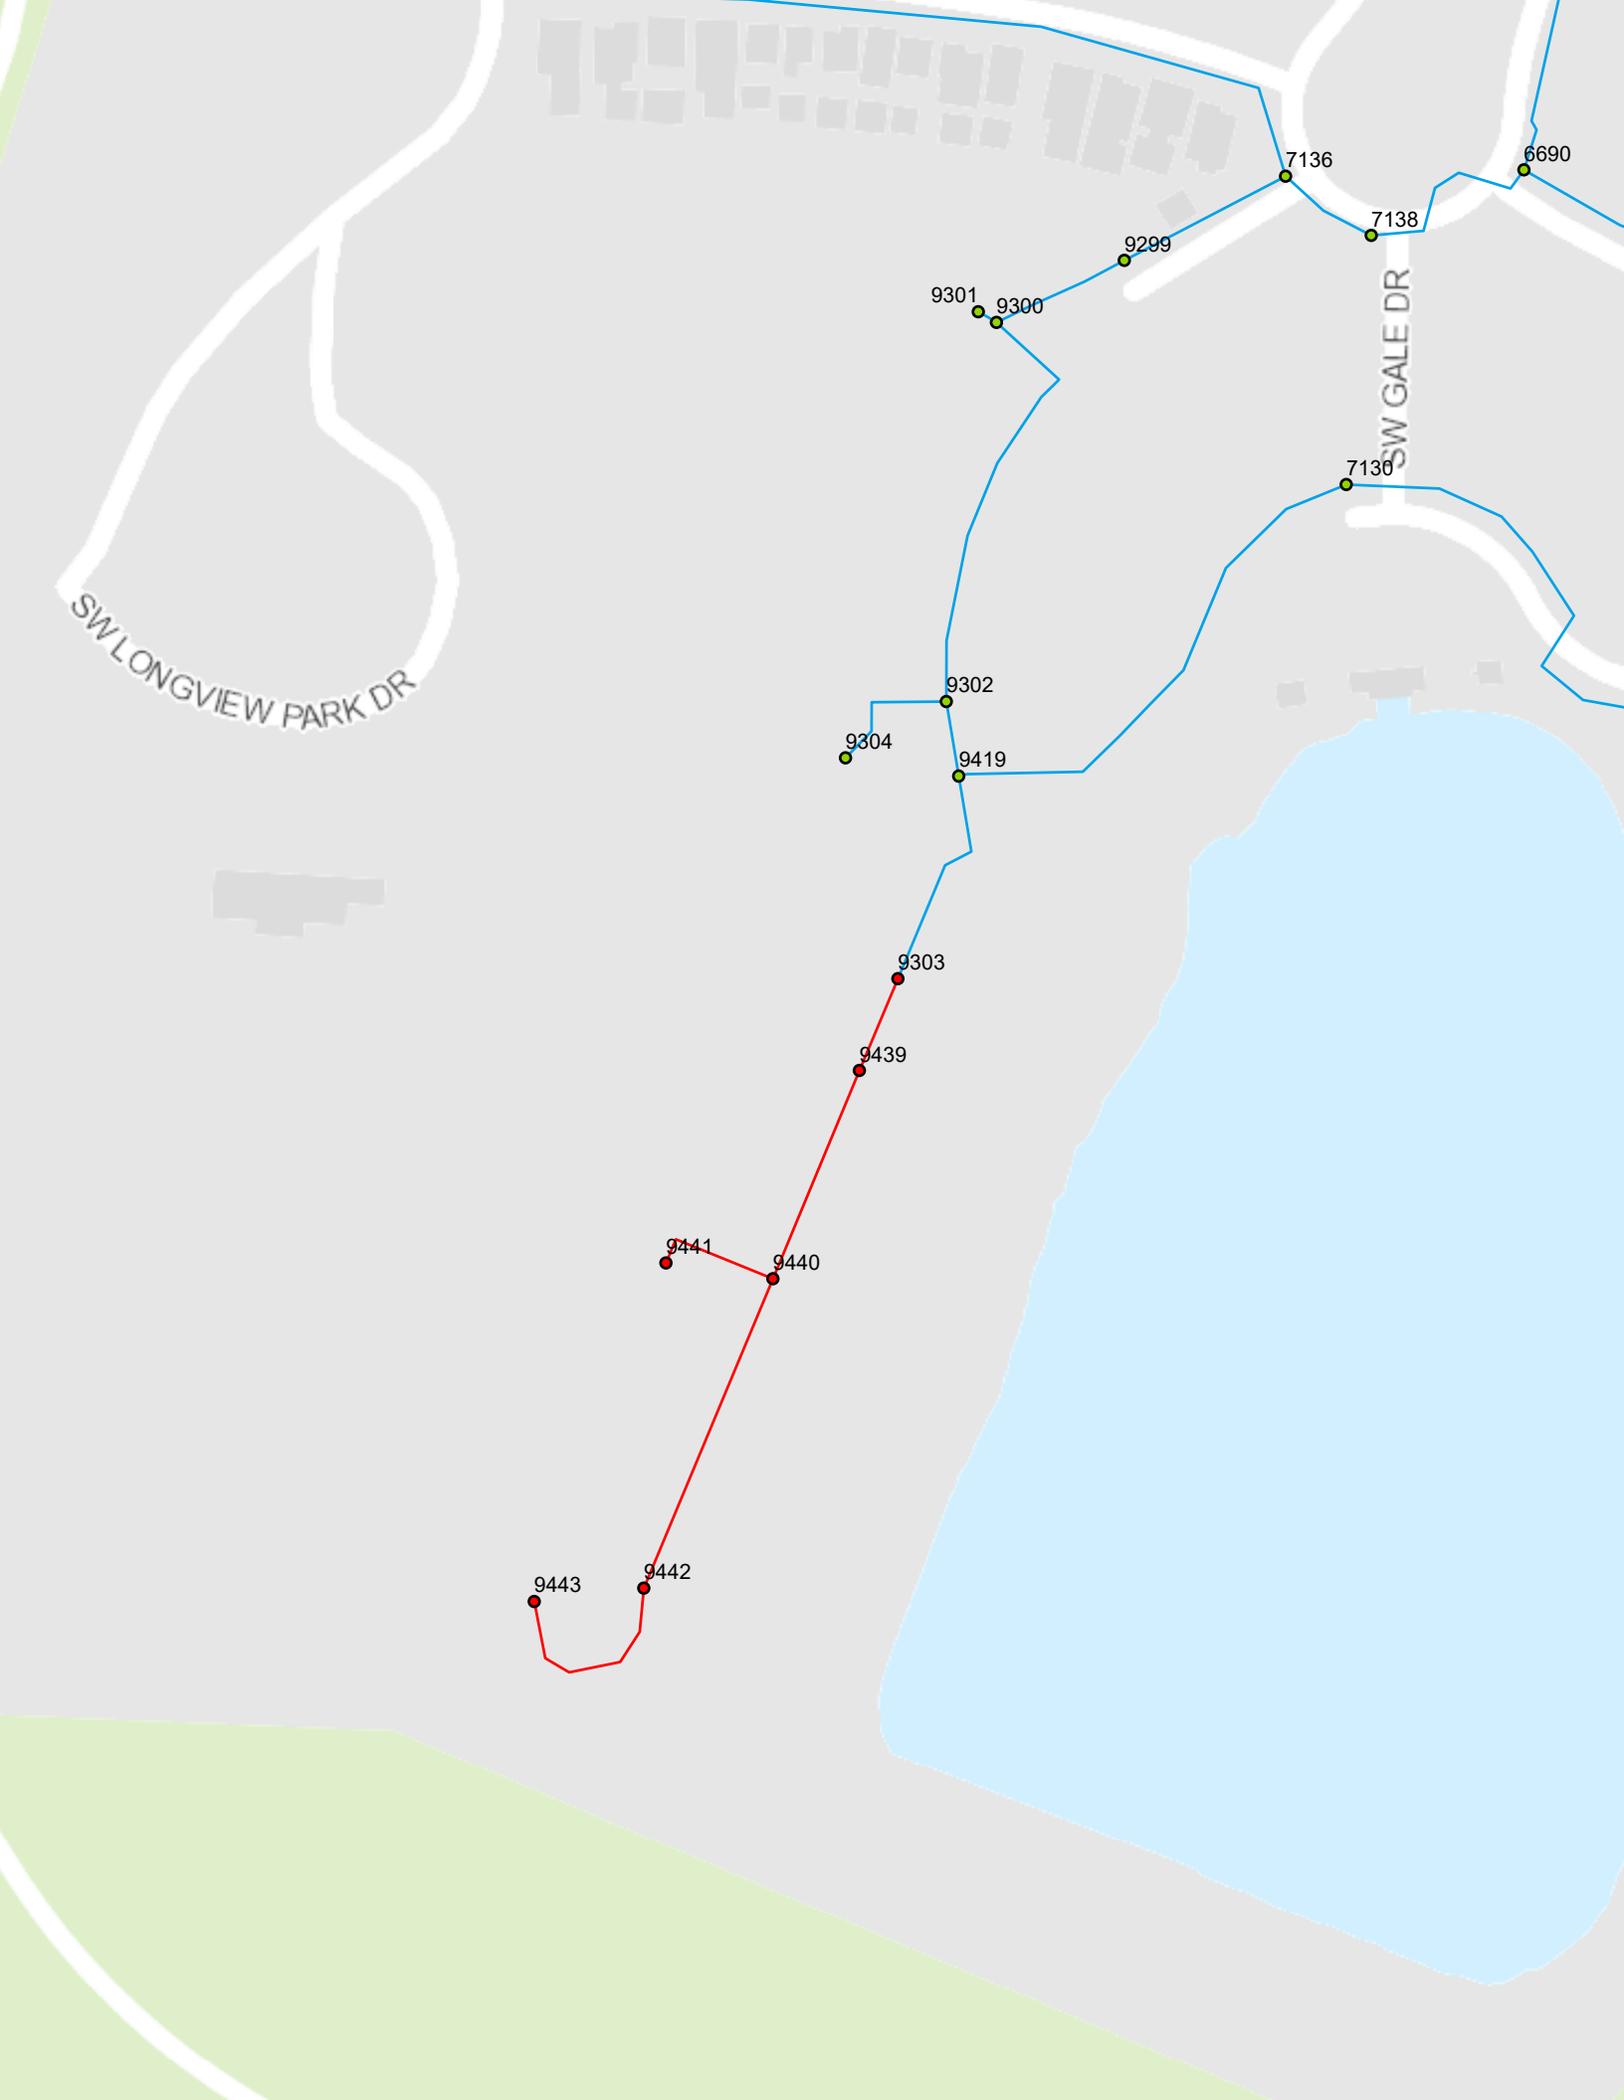

SW LONGVIEW PARK DR

SW GALE DR

9443

9442

9441

9440

9439

9303

9419

9304

9302

9301

9300

9299

7136

7138

6690

7130