



LEE'S SUMMIT
MISSOURI

DESIGN & CONSTRUCTION MANUAL
DESIGN CRITERIA MODIFICATION REQUEST

PROJECT NAME: Trilogy Apartments _____

ADDRESS: 800 NW Ward Rd _____

PERMIT NUMBER: PL2022436 _____

OWNER'S NAME: Northpoint Development _____

TO: Deputy Director of Public Works / City Engineer

In accordance with the City of Lee's Summit's Design and Construction Manual (DCM), I wish to apply for a modification to one or more provisions of the code as I feel that the spirit and intent of the DCM is observed and the public health, welfare and safety are assured. The following articulates my request for your review and action. (NOTE: Cite specific code sections, justification and all appropriate supporting documents.)

Northpoint Development is requesting a variance from the asphalt parking lot paving requirements for vehicle parking and drives (Sec 8.620.F.a.(1)), and fire lane and truck access (Sec. 8.620.F.1.b.(1)). The proposed asphalt pavement section would replace the provided pavement sections in the UDO with a single design for both parking and fire lane areas. A proposed pavement section consisting of 6" asphalt, 6" aggregate base, and 14" rock-subgrade mix was designed by CFS Engineers. The attached Addendum to the geotechnical report includes design calculations of the proposed pavement section, as well as analysis the pavement sections provided in the city's UDO. This document demonstrates that the proposed pavement section will meet or exceed the performance of the pavement sections provided in the UDO, and will serve as a suitable alternative.

SUBMITTED BY:

NAME: Neil Haas _____

ADDRESS: 3315 N Oak Trafficway _____

CITY, STATE, ZIP: Kansas City, MO, 64116 _____

Email: nhaas@northpointkc.com _____

() OWNER (x) OWNER'S AGENT

PHONE #: 816-888-7380

SIGNATURE: 

SUE PYLES, P.E.

DEVELOPMENT ENGINEERING MANAGER

SIGNATURE: _____ DATE: _____

() APPROVAL () DENIAL

JEFF THORN, P.E.

WATER UTILITIES ASSISTANT DIRECTOR OF ENGINEERING SERVICES

SIGNATURE: _____ DATE: _____

() APPROVED () DENIAL

GEORGE M. BINGER III, P.E.

DEPUTY DIRECTOR OF PUBLIC WORKS/CITY ENGINEER

SIGNATURE: _____ DATE: _____

() APPROVED () DENIAL

COMMENTS: _____

A COPY MUST BE ATTACHED TO THE APPROVED PLANS ON THE JOB SITE



Cook, Flatt & Strobel Engineers
1100 W. Cambridge Circle Drive, Suite 700
Kansas City, Kansas 66103
913.627.9040

June 29, 2023

Brian Benjamin
Northpoint Development
3315 N. Oak Trafficway
Kansas City, MO 64116

Re: Subsurface Exploration and Recommendations Addendum #1
Summit Square Phase III (Trilogy)
Lee's Summit, Missouri

Mr. Benjamin:

Cook, Flatt & Strobel (CFS) Engineers, P.A. performed geotechnical engineered services and submitted a geotechnical report (CFS #20-5674, report date September 22, 2022) for the Summit Square Phase III project. CFS understands that the client would like to use an alternative pavement section versus the standard sections provided in Article 12 of the City of Lee's Summit Unified Development Ordinance (UDO).

At the request of the client, CFS is providing a single alternative pavement section for both the heavy and light duty pavement sections required by Lee's Summit UDO. CFS utilized the Tensor Plus pavement program to calculate the design AASHTO equivalent single axle loads (ESALs) for the UDO pavement sections. The following table provides the standard layer coefficients for each pavement layer and subbase layer that were used to calculate the design ESALs. These coefficients are multiplied by the layer thickness and added together to calculate the structural number of the pavement section.


UDO Stabilized Subgrade Pavement Section

Layer	Description	Layer Coefficient
ACC1	Asphalt Surface	0.400
ACC2	Asphalt Base	0.350
ABC	MoDOT Type 5	0.120
SBC	Stabilized Base	0.080


UDO Geotextile Pavement Section

Layer	Description	Layer Coefficient
ACC1	Asphalt Surface	0.400
ACC2	Asphalt Base	0.350
ABC	MoDOT Type 5 with Tensor TX3	0.192


UDO Stabilized Subgrade Pavement
Light Duty
179,200 ESALs

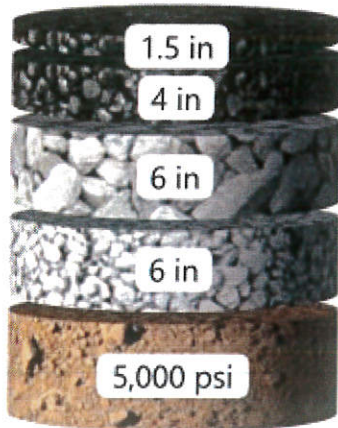


Heavy Duty
359,900 ESALs

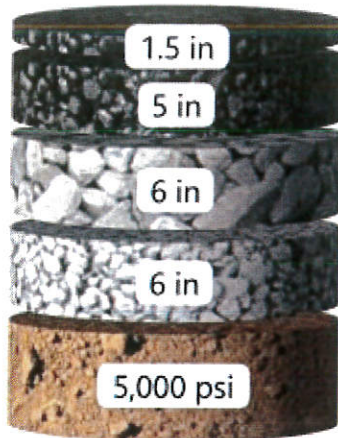

UDO Geosynthetic Pavement
Light Duty
162,100 ESALs

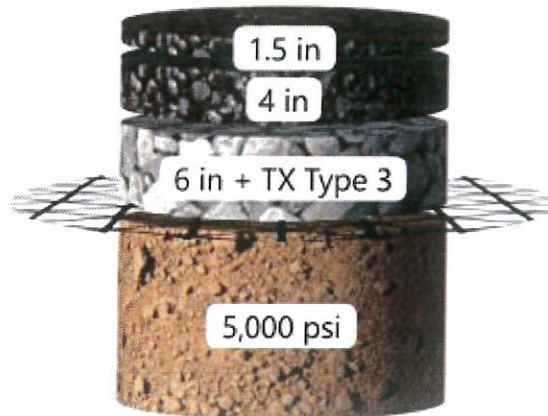

Heavy Duty
328,200 ESALs

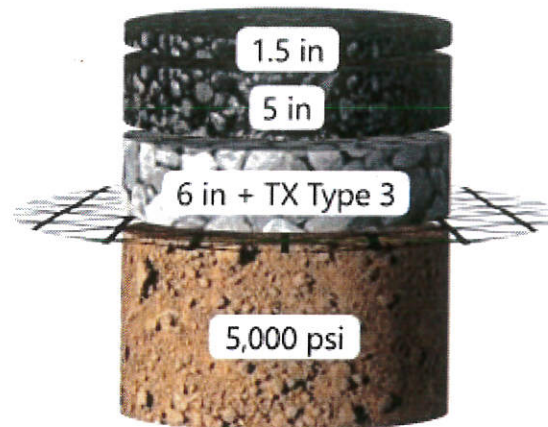

Based on the Tensar Plus analysis, the largest target design ESALs and structural number are 359,900 and 3.55, respectively.

NorthPoint has requested a single alternative pavement design for both the heavy and light duty sections. CFS has estimated the layer coefficient for the soil-gravel mixture to be 0.05. This coefficient has been conservatively estimated as less than half of MoDOT Type 5 (0.120) and less than a fly ash stabilized sub-grade layer coefficient (0.080). The following table shows the layer coefficients for the alternative pavement.




Cook, Flatt & Strobel Engineers
1100 W. Cambridge Circle Drive, Suite 700
Kansas City, Kansas 66103
913.627.9040

Alternative Pavement Section

Layer	Description	Layer Coefficient	Thickness (in)	Structural Number
ACC1	Asphalt Surface	0.400	2.0	0.80
ACC2	Asphalt Base	0.350	4.0	1.40
ABC	MoDOT Type 5	0.120	6.0	0.72
SBC	Rock Sub-Grade Mix	0.050	14.0	0.70
			Total	3.62

411,100 ESALs

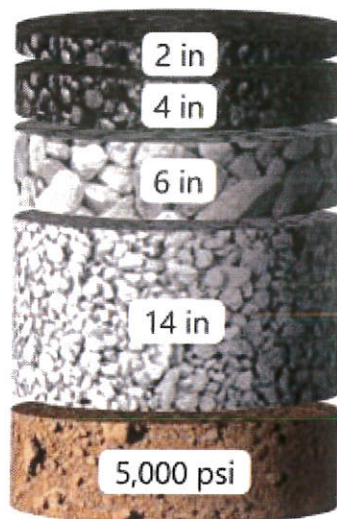

The recommended alternative section provides an estimated ESAL's and structural value of 411,100 and 3.62, respectively. This exceeds the larger heavy duty UDO estimated values.

Please contact CFS with any questions.

Respectfully,
Cook, Flatt & Strobel Engineers, P.A.


Adam M. McEachron, P.E.
Senior Engineer



One Vision. One Team. One Call.