


## OAD-6-CLE-DX-ASHP-ERV

Qty: 2 Tag(s): DOAS-1, DOAS-2

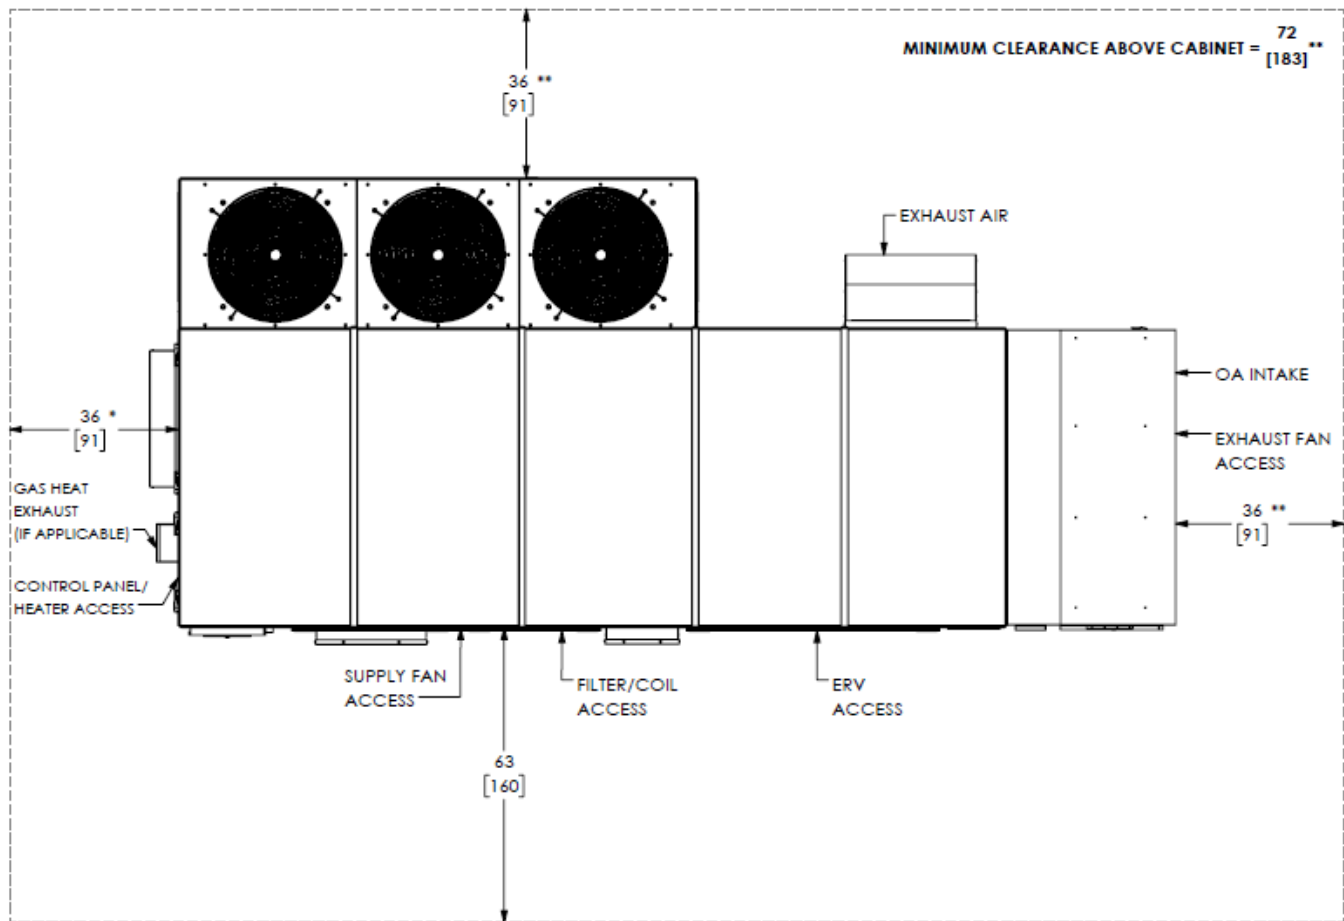

GENERAL NOTES:

A. DUAL DIMENSIONS IN. [CM.]

DIMENSIONS DISPLAYED ARE REQUIRED FOR BASIC UNIT SERVICEABILITY UNLESS OTHERWISE NOTED


\*MINIMUM REQUIRED CLEARANCE TO ENSURE UNIT PERFORMANCE FOR GAS HEAT OPTION

\*\*MINIMUM REQUIRED CLEARANCE TO ENSURE UNIT PERFORMANCE

REFER TO LOCAL BUILDING CODES TO ENSURE INSTALLATION MEETS ALL NECESSARY REQUIREMENTS




**OAD-6-RIG-DX-ASHP-ERV**

Qty: 2 Tag(s): DOAS-1, DOAS-2

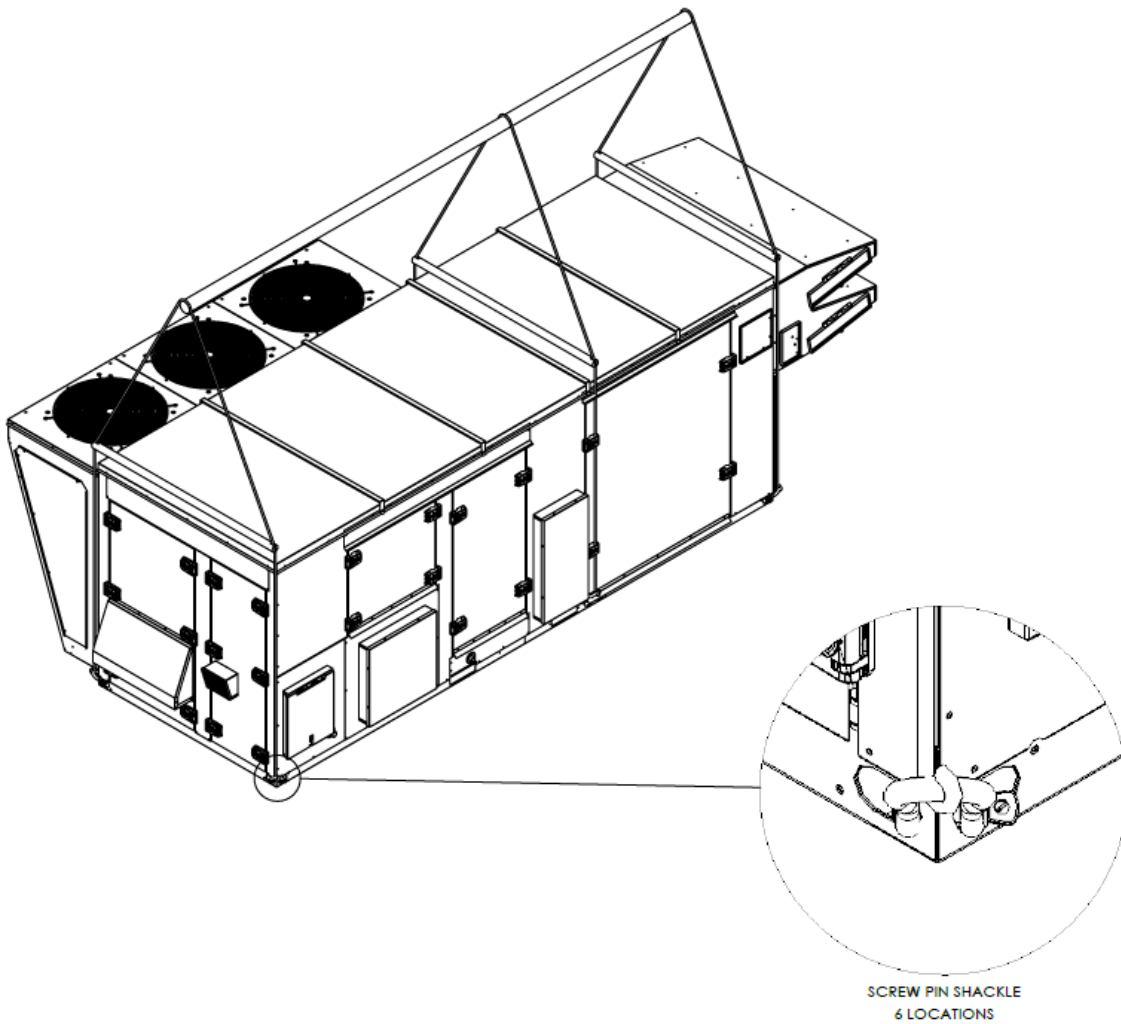

**OAD-6-UTL-DX-IDX-ASHP**

Qty: 2 Tag(s): DOAS-1, DOAS-2

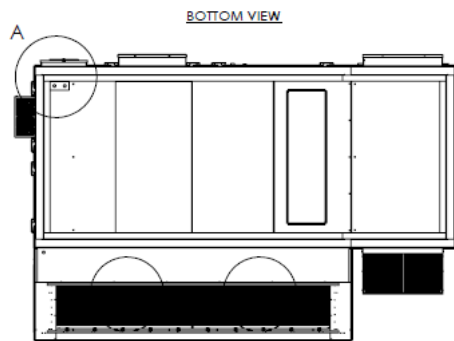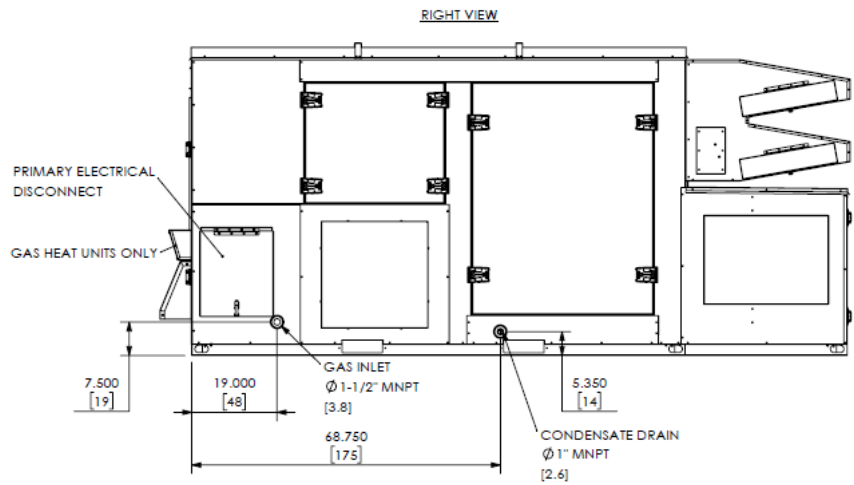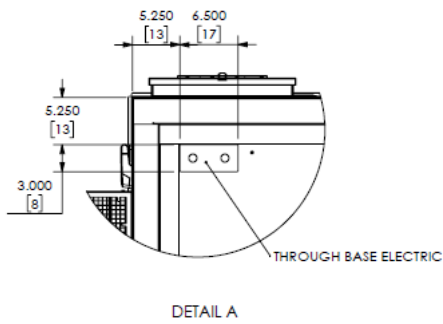

NOTES:  
1. DUAL DIMENSIONS: IN. [CM.]

