

March 11, 2024

City of Lee's Summit Development Services 220 SE Green Street Lee's Summit, MO 64063

RE: New Longview Lot 44

Storm Drainage Letter

Olsson Project Number: 023-07096

To Whom It May Concern:

This letter is intended as a stormwater study for the above referenced phase of New Longview. Please refer to the "New Longview Phase 2, Preliminary Stormwater Drainage Study", dated September 2, 2016, for additional information.

New Longview Lot 44 is a 6,021 square-foot building with associated parking and private drives. The building sites on Lot 44 of the New Longview Commercial District, Second Plat. The site is located on the NE corner of the Longview Boulevard and Fascination Drive intersection, which locates the project in the NW ¼ of Section 10, Township 47 N, Range 32 W, Lee's Summit, Jackson County, Missouri.

Stormwater runoff from the site will be directed into the proposed private storm sewer system by curb and gutter and directed to the existing storm sewer on the east side of the private drive.

The proposed site curve number and drainage areas for flow to the north and to the east are consistent with that in the Preliminary Stormwater Drainage Study and complies with the City of Lee's Summit requirements. We are requesting approval of this storm drainage letter.

Sincerely,

Stephen Saylor, PE

Olsson Project Engineer

NEW LONGVIEW PHASE 2

PRELIMINARY STORMWATER DRAINAGE STUDY

Submitted: September 2, 2016

Proposed Mixed Use Development located in: NW ¼ Section 10, Township 47N, Range 32W Lee's Summit, Jackson County, Missouri

Cedar Creek Watershed

Prepared For: BOX Real Estate Development 920 SW Ovation Drive Lee's Summit, MO 64081





1301 Burlington #100 North Kansas City, MO 64116 816.587.4320 816.587.1393 fax www.olssonassociates.com

Table of Contents


| <u>Section</u> 1.) General Information | Page No. 2 |
|--|-------------------|
| 1.) General information | 2 |
| 2.) Methodology | 3 |
| 3.) Existing Conditions Analysis | 3 |
| 4.) Proposed Conditions Analysis | 5 |
| 5.) Summary | 6 |
| 6.) Conclusions | 6 |
| 7.) Supporting Calculations: 7.1) Existing Conditions 7.2) Proposed Conditions | |
| 8.) Maps & Exhibits 8-1.1) Floodplain Map 8-1.2) Soils Map 8-3.1) Drainage Area Map | |



1.) General Information:

New Longview Phase 2 is proposed as a 5-lot mixed used development with apartments, townhomes, office, retail and restaurant buildings and a new theater. The project is at the southeast corner of the intersection of SW Fascination Drive and SW Longview Boulevard. This locates the project in the NW ¼ of Section 10, Township 47 N, Range 32 W, Lee's Summit, Jackson County, Missouri.

Stormwater runoff from New Longview Phase 2 is conveyed into two separate sub-watersheds, both of which flow to existing storm sewer systems that discharge to unnamed tributaries to Cedar Creek. This Preliminary Stormwater Drainage Study will evaluate the hydrologic impact generated by the construction of New Longview Phase 2.

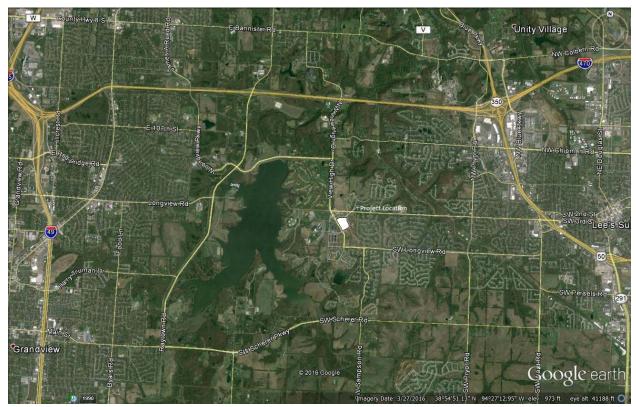

New Longview Phase 2 Vicinity Map

1.1) FEMA Floodplain Classification:

Zone X is the FEMA flood insurance rate zone that corresponds to "areas of 0.2% annual chance flood; areas of 1% annual chance flood with average depths of less than 1 foot or within drainage areas less than 1 square mile; and areas protected by levees from 1% annual chance flood."





1.2) Soil Classifications

Soil Maps published in the Soil Survey of Jackson County, Missouri, categorize soils on the Kessler Ridge property as:

| Map Unit | Name | Slopes |
|----------|-------------------------------------|----------|
| 10120 | Sharpsburg silt loam | 2% to 5% |
| 10128 | Sharpsburg-Urban land complex | 2% to 5% |
| 30080 | Greenton silty clay loam | 5% to 9% |
| 10181 | Udarents-Urban land-Sampsel complex | 5% to 9% |

2.) Methodology

This Preliminary Stormwater Drainage Study has been prepared to evaluate the hydrologic impact generated by development of New Longview Phase 2. The base data for the models prepared for this report has been obtained from site visits, available online maps and aerial imagery.

The following methods were used in this study to model Existing and Proposed Conditions for stormwater runoff:

• Haestad Methods, Inc. "PondPack" v8i

TR-55 Unit Hydrograph Method

- 2-year, 10-year and 100-year Return Frequency storms
- ARC II Soil Moisture conditions
- 24-Hour SCS Type II Rainfall Distribution
- SCS Runoff Curve Numbers per SCS TR-55 (Tables 2-2a 2-2c)
- SCS TR-55 Methods for determination of Time of Concentration and Travel Time. Where specific data pertaining to channel geometry is not available, "length & velocity" estimates for channel-flow Travel Time is utilized per Section 5600, Kansas City APWA Standard Specifications and Design Criteria.

The following approved drainage studies were referenced in preparation of this report:

- Letter to Lee's Summit for Storm Water Detention for proposed development of a parcel of land at Longview Boulevard and SW 3rd Street, New Longview – Lee's Summit, MO, September 27, 2006, which references the regional detention analyzed in the Winterset Valley and New Longview Storm Water Detention Report, prepared by Hamilton Sterrett, June 29, 2004
- A copy of the Winterset Valley and New Longview Storm Water Detention Report, has been requested from the City of Lee's Summit. An addendum to this study can be provided if necessary when that is available.
- Kessler Ridge at New Longview Macro and First Plat Micro Stormwater Drainage Study, prepared by Lutjen Inc., September 24, 2015

3.) Existing Conditions Analysis

This section of the Preliminary Stormwater Drainage Study has been prepared to evaluate the Existing Conditions related to stormwater runoff. Section 4 will evaluate the site under Proposed Conditions. The purpose of this report is to evaluate the Proposed Conditions stormwater discharge from the property and to ensure that there are no adverse conditions generated by the development. In order to quantify the effects of development of this project, the following areas have been used for both Existing and Proposed Conditions analyses.

The portion of New Longview Phase 2 which flows to the southeast contributes to **Subarea A5**, as defined in the Kessler Ridge at New Longview report. Total modeled area within Subarea A5 is





40.93 acres under Existing Conditions. Approximately 8.42 acres of New Longview Phase 2 lies within this watershed. The remainder of the watershed consists predominantly of offsite single-family residential area to the east and apartments to the west.

Previous development in this area constructed a detention basin into which this portion of New Longview Phase 2 will discharge. This basin was constructed with Kessler Ridge at New Longview, and is referred to in this study as **Basin A5** in conformance with the previously approved drainage study.

The portion of New Longview Phase 2 which flows to the north contributes to **Subarea B**, as defined in this report. Total area within Subarea B is 126.01 acres under Existing Conditions. Approximately 4.72 acres of New Longview Phase 2 lies within this watershed. The remainder of the watershed consists of offsite single family residential and commercial areas to the north.

According to the drainage letter for New Longview (referenced above), previous development in this area constructed a detention basin into which this portion of New Longview Phase 2 will discharge. This basin was constructed with Winterset Valley 1st Plat. The drainage areas in that report used a CN value of 93 for stormwater modeling.

The following tables summarize the results of the Existing Conditions analysis. The intent of this report is to evaluate the hydrologic impact created by construction of New Longview Phase 2. The Proposed Conditions discharge data will be compared to these Existing Conditions results. The Existing Conditions stormwater runoff model simulates the 2, 10 and 100-year design storm events. Refer to the Drainage Area Map (Exhibit 8-3.1) for subarea locations, Runoff Curve Numbers, and tributary acreage. Refer to Section 7.1 for output from the Existing Conditions model. The following tables contain input data and summarize the computed results from the PondPack model for New Longview Phase 2 Existing Conditions.

Table 3-1 New Longview Phase 2 Existing Conditions Subarea Data

| Subarea: | Area (ac.): | Composite CN | Tc (hr.) |
|------------|-------------|--------------|----------|
| Subarea A5 | 40.93 | 82 | 0.129 |

Table 3-2 New Longview Phase 2 Existing Conditions Runoff Data: Subarea Peak Discharge Rates

| - tames to a transfer and trans | | | | | | | |
|--|----------------------|-----------------------|------------------------|--|--|--|--|
| Subarea: | Q ₂ (cfs) | Q ₁₀ (cfs) | Q ₁₀₀ (cfs) | | | | |
| A5 | 96.77 | 180.81 | 315.43 | | | | |

The existing Basin A5 accepts runoff from all of Subarea A5, most of which is currently developed, except for a small area to the north of the basin, and the New Longview Phase 2 property. The basin currently provides detention in conformance with the approved Kessler Ridge at New Longview drainage study. Basin A5 was designed with the proposed New Longview Phase 2 property in mind, as well as the remaining undeveloped area within A5. The table below shows the basin in its existing state, with some areas remaining to be developed.

Table 3-4 Basin A5 Existing Conditions Detention Basin Data

| | Peak Q In (cfs) | T _P In (hr.) | Peak Q Out (cfs) | T _P Out (hr.) | V _R (ac-ft) | Peak W.S.E. | Max. Storage Volume (ac-ft) |
|----------|-----------------|----------------------------|---------------------|-----------------------------|---------------------------|----------------|--------------------------------|
| 2-Year | 96.77 | 11.96 | 3.71 | 14.51 | 5.608 | 960.03 | 3.631 |
| 10-Year | 180.11 | 11.95 | 52.73 | 12.15 | 10.443 | 960.83 | 4.779 |
| 100-Year | 315.43 | 11.95 | 101.94 | 12.14 | 18.469 | 962.77 | 8.044 |

The existing basin with Winterset Valley accepts runoff from all of Subarea B, most of which is currently developed, except for the New Longview Phase 2 property. The basin currently provides detention in conformance with the approved Winterset Valley and New Longview drainage study.





The basin was design using a CN of 93 for the contributing area. The analysis in Section 4 will show that the proposed CN for New Longview Phase 2 will not exceed the assumed drainage area.

4.) Proposed Conditions

The Proposed Conditions section of analysis assumes completion of New Longview Phase 2. As in the Existing Conditions section, this Proposed Conditions stormwater runoff model was created and run for the 2, 10 and 100-year design storm events. Refer to Section 7.2 for output from the Proposed Conditions model. The following tables contain input data and summarize the computed results from the PondPack model for Proposed Conditions. After the results of this Proposed Conditions model are presented, they will be compared to the Existing Conditions results. Any variation in computed discharge rates from Existing to Proposed Conditions will be a direct result of construction of New Longview Phase 2.

Table 4-1 New Longview Phase 2 Proposed Conditions Subarea Data

| Subarea: | Area (ac.): | Composite CN | T _C (hr.) |
|------------|-------------|--------------|----------------------|
| Subarea A5 | 83 | 40.92 | 0.129 |

Table 4-2 New Longview Phase 2 Proposed Conditions Runoff Data: Subarea Peak Discharge Rates

| Subarea: | Q ₂ (cfs) | Q ₁₀ (cfs) | Q ₁₀₀ (cfs) |
|------------|----------------------|-----------------------|------------------------|
| Subarea A5 | 114.85 | 202.05 | 337.61 |

Table 4-3 Basin A5 Proposed Conditions Detention Basin Data

| | Peak Q In | T _P In | Peak Q | T _P Out | V _R | Peak | Max. Storage |
|----------|-----------|-------------------|-----------|--------------------|-----------------------|--------|----------------|
| | (cfs) | (hr.) | Out (cfs) | (hr.) | (ac-ft) | W.S.E. | Volume (ac-ft) |
| 2-Year | 114.85 | 11.95 | 9.23 | 12.74 | 6.627 | 960.12 | 3.745 |
| 10-Year | 202.05 | 11.95 | 67.56 | 12.13 | 11.756 | 961.21 | 5.362 |
| 100-Year | 337.61 | 11.95 | 109.38 | 12.13 | 20.063 | 963.19 | 8.830 |

According to the approved Kessler Ridge First Plat drainage study, the approved peak flow rates from Subarea A5 are as shown in the table below, with a comparison to the proposed discharge after development of New Longview Phase 2.

Table 4-4 New Longview Phase 2 Subarea A5 Peak Discharge Comparison (Approved vs. Proposed)

| Table 4 4 New Longview I hade L Gubarea Ao I can bloomarge Companion (Approved to: I reposed) | | | | | | | |
|---|----------------------|-----------------------|------------------------|--|--|--|--|
| | Q ₂ (cfs) | Q ₁₀ (cfs) | Q ₁₀₀ (cfs) | | | | |
| Proposed | 114.85 | 202.05 | 337.61 | | | | |
| Approved: | 115.44 | 203.09 | 339.34 | | | | |
| Difference: | -0.59 | -1.04 | -1.73 | | | | |

Because we have not yet attained a copy of the approved drainage study showing the regional detention to the north, for Subarea B, this study will only include a Curve Number calculation comparison to the approved CN. Below is a calculation of the CN for New Longview Phase 2, within Subarea B.



September 2, 2016

Table 4-5 New Longview Phase 2 Curve Number Calculation (within Subarea B)

| _ | Land Use | Curve Number | Area |
|---------------------------------------|------------|--------------|------|
| New Longview Phase 2 within Subarea B | Impervious | 98 | 3.84 |
| | Pervious | 74 | 0.89 |
| | Total | 93 | 4.73 |

5.) Summary

This Preliminary Stormwater Drainage Study has been prepared to evaluate the hydrologic impact generated by development of New Longview Phase 2. The proposed project will drain to two existing offsite detention facilities.

Section 3 of this report determined the baseline conditions reflecting the Existing Conditions for the project site. Section 4 showed the site under developed conditions and demonstrated that flows to the existing detention facilities are within approved limits.

6.) Conclusions

New Longview Phase 2 is proposed as a 5-lot mixed used development with apartments, townhomes, office, retail and restaurant buildings and a new theater. This report has been prepared to evaluate the development to ensure that stormwater discharge from the site will remain within acceptable levels. Existing Basins constructed with Winterset 1st Plat and Kessler Ridge 1st Plat will provide detention for the site.

In conclusion all points of interest exhibit Proposed Conditions peak discharges for all events that are at or below the established limits.

It is therefore requested that Lee's Summit, Missouri approve this "New Longview Phase 2 Preliminary Stormwater Drainage Study." This study will be verified with final construction documents for the first phase of construction within New Longview Phase 2.



September 2, 2016

| Project Summary | |
|-----------------|-------------------------|
| Title | NEW LONGVIEW PHASE 2 |
| Engineer | MGD |
| Company | OLSSON ASSOCIATES |
| Date | 9/1/2016 |
| | |
| Notes | |

Table of Contents

Master Network Summary

2

Subsection: Master Network Summary

Catchments Summary

| Label | Scenario | Return Event (years) | Hydrograph Volume (ac-ft) | Time to Peak (hours) | Peak Flow (ft³/s) |
|--------|----------|----------------------------|---------------------------------|-------------------------|----------------------|
| SUB A5 | 2-Year | 2 | 5.608 | 11.960 | 96.77 |
| SUB A5 | 10-Year | 10 | 10.443 | 11.950 | 180.81 |
| SUB A5 | 100-Year | 100 | 18.469 | 11.950 | 315.43 |
| SUB A4 | 2-Year | 2 | 1.366 | 11.980 | 22.86 |
| SUB A4 | 10-Year | 10 | 2.482 | 11.980 | 41.22 |
| SUB A4 | 100-Year | 100 | 4.312 | 11.960 | 70.25 |
| SUB A2 | 2-Year | 2 | 9.847 | 12.040 | 146.26 |
| SUB A2 | 10-Year | 10 | 17.676 | 12.020 | 260.09 |
| SUB A2 | 100-Year | 100 | 30.429 | 12.020 | 439.72 |
| SUB A3 | 2-Year | 2 | 1.891 | 12.010 | 30.14 |
| SUB A3 | 10-Year | 10 | 3.436 | 12.000 | 54.38 |
| SUB A3 | 100-Year | 100 | 5.968 | 11.990 | 92.61 |
| SUB A1 | 2-Year | 2 | 0.821 | 12.050 | 11.57 |
| SUB A1 | 10-Year | 10 | 1.510 | 12.040 | 21.29 |
| SUB A1 | 100-Year | 100 | 2.646 | 12.040 | 36.80 |

Node Summary

| Label | Scenario | Return Event (years) | Hydrograph Volume (ac-ft) | Time to Peak (hours) | Peak Flow (ft³/s) |
|-------|----------|----------------------------|---------------------------------|-------------------------|----------------------|
| PT A4 | 2-Year | 2 | 6.788 | 11.980 | 23.91 |
| PT A4 | 10-Year | 10 | 12.731 | 12.070 | 76.61 |
| PT A4 | 100-Year | 100 | 22.585 | 12.020 | 158.70 |
| PT A3 | 2-Year | 2 | 8.679 | 12.010 | 54.05 |
| PT A3 | 10-Year | 10 | 16.167 | 12.070 | 120.73 |
| PT A3 | 100-Year | 100 | 28.552 | 12.020 | 247.45 |
| PT A2 | 2-Year | 2 | 18.525 | 12.040 | 200.10 |
| PT A2 | 10-Year | 10 | 33.842 | 12.070 | 357.57 |
| PT A2 | 100-Year | 100 | 58.981 | 12.040 | 681.81 |
| PT A1 | 2-Year | 2 | 19.345 | 12.060 | 211.64 |
| PT A1 | 10-Year | 10 | 35.351 | 12.060 | 378.16 |
| PT A1 | 100-Year | 100 | 61.626 | 12.060 | 718.25 |

| Labe | l Scenario | Return Event (years) | Hydrograph Volume (ac-ft) | Time to Peak (hours) | Peak Flow (ft³/s) | Maximum Water Surface Elevation (ft) | Maximum Pond Storage (ac-ft) |
|---------|------------|----------------------------|---------------------------------|-------------------------|----------------------|--|------------------------------------|
| BASIN A | 5 2-Year | 2 | 5.608 | 11.960 | 96.77 | (N/A) | (N/A) |

Subsection: Master Network Summary

| Label | Scenario | Return Event (years) | Hydrograph Volume (ac-ft) | Time to Peak (hours) | Peak Flow (ft³/s) | Maximum Water Surface Elevation (ft) | Maximum Pond Storage (ac-ft) |
|-------------------|----------|----------------------------|---------------------------------|-------------------------|----------------------|--|------------------------------------|
| BASIN A5 (OUT) | 2-Year | 2 | 5.421 | 14.510 | 3.71 | 960.03 | 3.631 |
| BASIN A5 (IN) | 10-Year | 10 | 10.443 | 11.950 | 180.81 | (N/A) | (N/A) |
| BASIN A5 (OUT) | 10-Year | 10 | 10.248 | 12.150 | 52.73 | 960.83 | 4.779 |
| BASIN A5 (IN) | 100-Year | 100 | 18.469 | 11.950 | 315.43 | (N/A) | (N/A) |
| BASIN A5 (OUT) | 100-Year | 100 | 18.273 | 12.140 | 101.94 | 962.77 | 8.044 |

Index

Μ

Master Network Summary...2, 3

| Project Summary | |
|-----------------|-------------------------|
| Title | NEW LONGVIEW PHASE 2 |
| Engineer | MGD |
| Company | OLSSON ASSOCIATES |
| Date | 9/1/2016 |
| | |
| Notes | |

Table of Contents

Master Network Summary

2

Subsection: Master Network Summary

Catchments Summary

| Label | Scenario | Return Event (years) | Hydrograph Volume (ac-ft) | Time to Peak (hours) | Peak Flow (ft³/s) |
|--------|----------|----------------------------|---------------------------------|-------------------------|----------------------|
| SUB A5 | 2-Year | 2 | 6.627 | 11.950 | 114.85 |
| SUB A5 | 10-Year | 10 | 11.756 | 11.950 | 202.05 |
| SUB A5 | 100-Year | 100 | 20.063 | 11.950 | 337.61 |
| SUB A4 | 2-Year | 2 | 1.366 | 11.980 | 22.86 |
| SUB A4 | 10-Year | 10 | 2.482 | 11.980 | 41.22 |
| SUB A4 | 100-Year | 100 | 4.312 | 11.960 | 70.25 |
| SUB A2 | 2-Year | 2 | 9.847 | 12.040 | 146.26 |
| SUB A2 | 10-Year | 10 | 17.676 | 12.020 | 260.09 |
| SUB A2 | 100-Year | 100 | 30.429 | 12.020 | 439.72 |
| SUB A3 | 2-Year | 2 | 1.891 | 12.010 | 30.14 |
| SUB A3 | 10-Year | 10 | 3.436 | 12.000 | 54.38 |
| SUB A3 | 100-Year | 100 | 5.968 | 11.990 | 92.61 |
| SUB A1 | 2-Year | 2 | 0.821 | 12.050 | 11.57 |
| SUB A1 | 10-Year | 10 | 1.510 | 12.040 | 21.29 |
| SUB A1 | 100-Year | 100 | 2.646 | 12.040 | 36.80 |

Node Summary

| Label | Scenario | Return Event (years) | Hydrograph Volume (ac-ft) | Time to Peak (hours) | Peak Flow (ft³/s) |
|-------|----------|----------------------------|---------------------------------|-------------------------|----------------------|
| PT A4 | 2-Year | 2 | 7.803 | 11.980 | 24.07 |
| PT A4 | 10-Year | 10 | 14.044 | 12.050 | 98.08 |
| PT A4 | 100-Year | 100 | 24.178 | 12.020 | 166.88 |
| PT A3 | 2-Year | 2 | 9.694 | 12.010 | 54.21 |
| PT A3 | 10-Year | 10 | 17.480 | 12.070 | 144.73 |
| PT A3 | 100-Year | 100 | 30.145 | 12.020 | 255.92 |
| PT A2 | 2-Year | 2 | 19.540 | 12.040 | 200.27 |
| PT A2 | 10-Year | 10 | 35.155 | 12.050 | 388.78 |
| PT A2 | 100-Year | 100 | 60.574 | 12.040 | 690.86 |
| PT A1 | 2-Year | 2 | 20.361 | 12.060 | 211.81 |
| PT A1 | 10-Year | 10 | 36.665 | 12.070 | 409.83 |
| PT A1 | 100-Year | 100 | 63.219 | 12.060 | 727.30 |

| Label | Scenario | Return Event (years) | Hydrograph Volume (ac-ft) | Time to Peak (hours) | Peak Flow (ft³/s) | Maximum Water Surface Elevation (ft) | Maximum Pond Storage (ac-ft) |
|------------------|----------|----------------------------|---------------------------------|-------------------------|----------------------|--|------------------------------------|
| BASIN A5 (IN) | 2-Year | 2 | 6.627 | 11.950 | 114.85 | (N/A) | (N/A) |

Subsection: Master Network Summary

| Label | Scenario | Return Event (years) | Hydrograph Volume (ac-ft) | Time to Peak (hours) | Peak Flow (ft³/s) | Maximum Water Surface Elevation (ft) | Maximum Pond Storage (ac-ft) |
|-------------------|----------|----------------------------|---------------------------------|-------------------------|----------------------|--|------------------------------------|
| BASIN A5 (OUT) | 2-Year | 2 | 6.437 | 12.740 | 9.23 | 960.12 | 3.745 |
| BASIN A5 (IN) | 10-Year | 10 | 11.756 | 11.950 | 202.05 | (N/A) | (N/A) |
| BASIN A5 (OUT) | 10-Year | 10 | 11.562 | 12.130 | 67.56 | 961.21 | 5.362 |
| BASIN A5 (IN) | 100-Year | 100 | 20.063 | 11.950 | 337.61 | (N/A) | (N/A) |
| BASIN A5 (OUT) | 100-Year | 100 | 19.866 | 12.130 | 109.38 | 963.19 | 8.830 |

Index

Μ

Master Network Summary...2, 3

