

HYDRAULIC REPORT

FOR

Public Improvements to Serve Wilshire Hills III

Lee's Summit, Missouri

PREPARED FOR:

WILSHIRE HILLS III L.P.

206 PEACH WAY

COLUMBIA, MO 54202

JUNE 22, 2023

REVISED: MARCH 29, 2024

PREPARED BY:


Engineering Surveys & Services

1113 FAY STREET

COLUMBIA, MO 65201

(573) 449-2646

JOB NUMBER: 15925

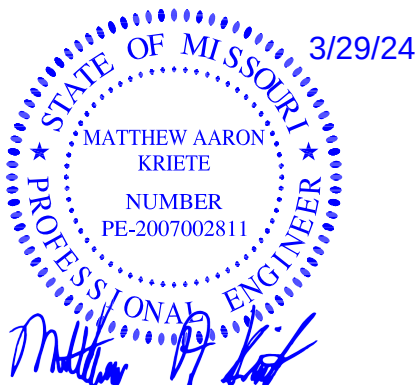

MISSOURI ENGINEERING CORPORATION NUMBER 2004005018

COLUMBIA ♦ JEFFERSON CITY ♦ SEDALIA



TABLE OF CONTENTS

TABLE OF CONTENTS.....	2
1 Introduction	1
2 Post Construction Stormwater Management.....	1
2.1 Analysis Goals	1
2.2 Flood Plain	2
2.3 Soils.....	2
2.4 Comprehensive Basin Analysis	2
2.5 Downstream Analysis	3
2.5.1 Existing Conditions.....	4
2.5.2 Proposed Conditions.....	5
2.5.3 Downstream Analysis.....	6
2.6 Final Design Summary	7
3 Storm Sewer Design	8
4 Erosion and Sediment Control and Design	8
5 Conclusion	9
APPENDIX	
Appendix A: Maps.....	A
Appendix B: Erosion and Sediment Control Calculations	B
Appendix C: Basin Analysis.....	C
C.1 Water Quality	D
C.2 Emergency Spillway.....	E
C.3 Comprehensive Basin Analysis.....	F
C.4 Downstream Basin Analysis	G
Appendix D: Storm Sewer Calculations.....	H
Appendix E: Drainage Area Map(s).....	I



1 INTRODUCTION

The project consists of the construction of a public road and associated utilities to connect existing Wilshire Drive to Strother Road in Lee's Summit, MO. The road and associated storm sewer and sanitary sewer extensions will provide service to Wilshire Hills Phase III on Lot 5 and additional future development. Soil disturbing activities will include clearing and grubbing, installing erosion and sediment controls, grading, installation of underground utilities, and preparation for final seeding, mulching, and landscaping. Public Improvements for the development include the extension of utilities including water, sewer, and electric. Storm sewers will be constructed along with the extension of Wilshire Hill Drive to Strother Road.

The purpose of this report is to demonstrate compliance with the city of Lee's Summit storm water requirements. The report specifically addresses the following.

1. Compliance with the APWA Comprehensive Control Strategy for Stormwater.
2. Stormwater quality for the proposed development.
3. Design of best management practices during construction.
4. Proposed storm sewer and channel design.
5. Impact of proposed and future development of storm water runoff from the site and the downstream watershed.

2 POST CONSTRUCTION STORMWATER MANAGEMENT

2.1 Analysis Goals

Design Standard(s):

- *Lee's Summit, Missouri Stormwater Discharge Control Regulations (Code of Ordinance Chapter 34 Article 3)*
- *APWA Section 5300*
- *APWA Section 5608.4*
- *MARC/APWA BMP Manual Chapter 6.*
- *LS Section 5600 – Storm Drainage Systems and Facilities (revised July 2020)*

The purpose of this analysis is to evaluate the hydrological impact of the development of Wilshire Hills Lot 5 and the future lot development. The base data has been collected from aerial imagery, historical data, and maps and analyzed based on the KC-APWA 5600 standards. The KC-APWA standards are summarized by the Comprehensive Control Strategy and met by Wilshire Hills Development. These requirements include stream protection, detention, water quality, and erosion control. The allowable runoff specified for detention facilities in Section 5608 is intended to manage maximum storm water release rates to minimize flooding while the water quality aspect of a basin addresses impacts on downstream erosion and the environment.



The Comprehensive Control Strategy provided the basis for design of the onsite shared detention basin. The discharge rates set forth by the APWA, shown in 2.5 are based on the area treated. The analysis also includes water quality, extended detention, and erosion and sediment control.

2.2 Flood Plain

The Federal Emergency Management Agency (FEMA) Flood Boundary and Floodway Map Community Panel Number 2909C0430G classifies all portions of Wilshire Hills as Zone X, area of minimal flood hazard. Portions immediately downstream of the Wilshire Hills property are classified as Zone A with a 1% annual chance of flooding along the creek. The referenced FEMA map is available in Appendix A.

2.3 Soils

Soil maps published by the Natural Resources Conservation Service (NRCS) Web Soil Survey were used to categorize soils located at Wilshire Hills as well as the watershed analysis area. The following table displays the map of soils on the property as well as their hydrological soil group. Appendix A contains the full soil map as well as the soil classifications.

Table 2: Wilshire Hills Soil Classifications

Soil Type	Hydrological Soil Group	Acres	Percent
Greenton-Urban land complex, 5-9 percent slopes	D	4.5	24.4%
Sibley silt loam, 2-5 percent slopes	C	0.2	0.9%
Greenton silty clay loam, 5 to 9 percent slopes	C/D	13.9	74.7%
Totals for Area of Interest		18.6	100%

Table 3 is a scaled representation of the soil classifications for the entirety of May Brook Creek Watershed.

Table 3: May Brook Creek Soil Classifications

Soil Type	Hydrological Soil Group	Acres	Percent
Greenton-Urban land complex, 5-9 percent slopes	D	277.9	56.7
Sibley-Urban land complex, 2-5 percent slopes	C	133.8	27.3
Other (less than 10%)	C/D	78.4	16.0
Totals for Area of Interest		490.2	100%

2.4 Comprehensive Basin Analysis

The detention basin was designed to match the Lee's Summit Comprehensive Basin requirements. Section 7B shown on page C2.20 in Appendix E shows the area west of the site which currently flows onto Wilshire Hills. The basin has been sized to allow this offsite pass through.

The detention basin follows the KC-APWA 5600 requirements that limit the allowable discharge based on the size of the site. The offsite passthrough was added to the allowed rate to maintain the flow requirements. The following calculations and table analyze the design of the APWA Detention Basin.



Total Allowed Basin Discharge = Maximum Site Rate (cfs) + Offsite Pass Through (cfs)
Provided Basin Discharge = Designed Basin Discharge (cfs) + Offsite Pass Through (cfs) + Onsite Bypass (cfs)

Table 5: Basin Discharge Rates

Design Storm	Rate (cfs) Allowable per Acre per APWA	Area Served (acres)	Maximum Site Rate (cfs)	Offsite Pass Through (cfs)	Total Allowed Basin Discharge (csf)	Provided Basin Discharge (cfs)	Basin Elevation
50% (2-yr)	0.5	19.0	9.50	8.05	17.55	16.25	917.14
20% (10-yr)	2.0	19.0	38.0	17.6	55.60	48.60	918.99
1% (100-yr)	3.0	19.0	57.0	32.34	89.34	89.20	921.00

The basin meets all Comprehensive Control Requirements for extended detention and the allowable flat rate discharge rates for the 2-, 10-, or 100-year storms. Additionally, the 2-yr, 10yr, and 100-yr storms have reduced the post developed peak discharge rate of May Brook Creek at Study Point 1 to less than the predeveloped rate.

The basin has been sized to match KC-APWA 5600 water quality requirements. Appendix C.1 contains calculations displaying the use of basin stage elevations to calculate the water quality volume required from the runoff calculation. Based on the designed basin stage elevations, the required water quality volume is 48,607 ft³. The water quality orifice was sized at 4.5 inches.

The water quality elevation was 915.5. The basin was designed to hold the water quality storm for the 40-hour detention period. This will include the first flush which helps filtrate out the majority of the sediment and trash accumulation.

An emergency spillway for the basin has been designed for the top of the earthen dam in the unlikely event the outfall structure should become completely blocked. Appendix C.1 includes weir calculations that indicate the 100-year flow through the spillway when the outfall control structure is completely blocked is fully contained in the spillway and will not overtop the dam while providing the necessary freeboard set by Lee's Summit Stormwater Report Requirements.

The 100-year level of rise in the basin is 919.48, approximated to 919.5 for construction purposes, and the top of the emergency spillway is 920.0. The clogged water surface elevation is 921.0. The top of dam is 921.5. The depth of the flow is 0.68 feet setting the top of the dam at 923.18 with over one foot of freeboard.

2.5 Downstream Analysis

To confirm that the development did not have an adverse effect on May Brook Stream, a downstream analysis was conducted. Stormwater models were created for the 2-, 10- and 100- year storm to



determine the effect on the development on May Brook Creek. Figure 1 shows the watershed, May Brook Creek, Wilshire Hills, and Study Point 1. The confluence pointsof the North end of Wilshire Hills and the upper 490.2-acre watershed.

This analysis includes 490.2 acres of the May Brook Creek watershed. The study point used was the end of the restored stream on the northern property line of Wilshire Hills. This point is approximately 3,000 ft upstream of Lakewood Lake East. The 19 acres of the Wilshire Hills development is approximately 4% of the watershed.

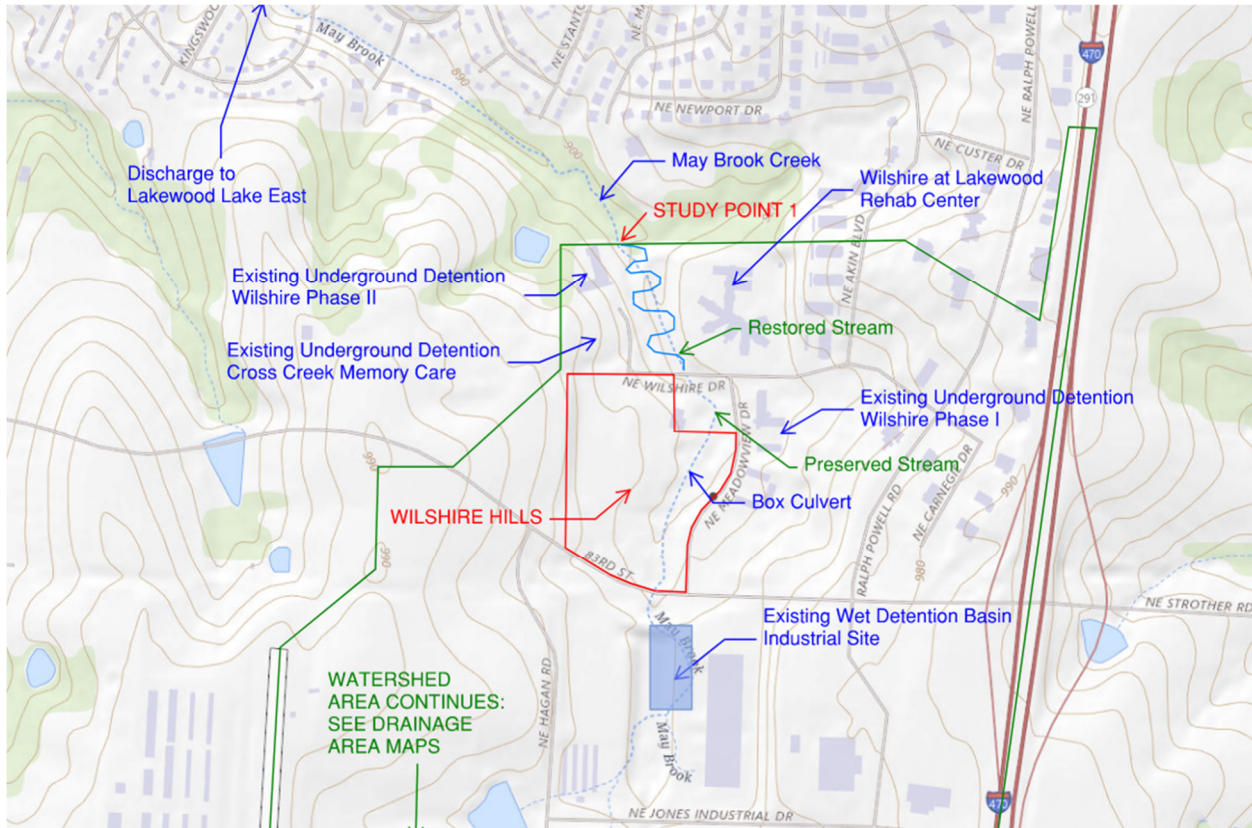


Figure 1: Location Map

2.5.1 EXISTING CONDITIONS

The Wilshire Hills development site analyzed with this study includes 19.0 contributing acres separated by NE Meadowview Drive to the east, Strother Road to the south, NE Wilshire Drive to the North, and industrial property to the west. The system was analyzed both locally as well as a part of a downstream analysis. To analyze the impact of the proposed Wilshire Hills Development, we first have to model the predeveloped assumptions of the site prior to the development of Wilshire Hills in 2006. The following describes the existing watershed, history of development, and methods used to develop the predevelopment model.

Due to downstream flooding and sedimentation issues, the study point of the downstream analysis, shown in Figure 1, is the edge of the Wilshire Hills development. The area contained upstream of this point includes 490.2 acres of May Brook Creek watershed.



The May Brook Creek watershed contains residential, commercial, and industrial development. The south side of the drainage area is composed of Lee's Summit Airport and a large industrial area. The airport mainly consists of concrete with a large amount of grass but has no detention. The industrial area is served by a large detention pond. This detention offsets the peak storm with the large volume of water contained before being released into the culvert under Strother Road. This detention pond is modeled as a reach in the hydraflow analysis.

Before 2006, May Brook Creek was an incised natural and manmade stream that bisected Wilshire Hills past an above ground detention pond at Lakewood Rehab Center. It discharged out of the detention basin into the existing stream approximately 3000 ft upstream of Lakewood Lake East.

The following table outlines the existing conditions for the May Brook Creek Watershed. See Appendix C for the full report. Appendix E has the pre drainage area map C2.19 that showcases each area and its associated curve number and time of concentration. These curve numbers were calculated using aerial images to measure impervious areas. The Time of concentrations were calculated using contours as well as street photos to analyze slope and water movement.

Table 1: May Brook Creek Watershed Pre-Development to Study Point 1

Section	Area (acres)	Curve Number	Time of Concentration (min)	Q 2-yr (cfs)	Q 10-yr (cfs)	Q 100-yr (cfs)
1	81.7	77	24.3	111.0	228.55	371.96
2	68.0	77	25.5	92.38	190.22	309.59
3	100.8	82	30.2	162.30	306.37	423.43
4	82.5	88	30.7	159.01	273.45	381.91
5	86.9	85	15.6	221.05	394.04	566.77
6	11.3	91	18.6	32.72	53.70	79.63
7	59.0	89	23.9	134.69	227.73	331.06
Total	490.02			660.85	1263.54	2145.77

2.5.2 PROPOSED CONDITIONS

Post 2006, Wilshire Hills Development has seen new development and changes to the existing conditions. May Brook Creek was enclosed into an 850-foot-long Box Culvert with a large energy dissipator at the outlet. The detention basin for Lakewood Rehab Center was removed and replaced with a restored meandering stream and floodplain.

In addition, Wilshire Hills Phase II and the Cross Creek Memory Care facilities were constructed with underground detention. The underground detention basins impact 8.07 acres and are not modeled in the study. Appendix E contains the Post Drainage Area Map on page C2.20 which outlines the improvements to the Wilshire Hills watershed since 2006.

Wilshire Hills Phase III and associated public improvements are the next phase in completing the development of Wilshire Hills. Public improvement to the site includes the extension of Wilshire Drive, looping the water main, mass grading, as well as sanitary and electric extensions to serve Willshire Hills Phase III.



Future development has been planned for with the extension of public utilities, construction of NE Wilshire Drive, and the detention basin being sized for future development. The current PDP plan calls for commercial and office development for the remaining lots. Impervious areas have been approximated for each area and can be found in Table 8 in Section 2.9 of this report. As development occurs, the constructed impervious will be subtracted from the total for the basin ensuring all 19 acres will be treated.

The basemap for the predeveloped watershed can be found in Appendix E page C2.19. The curve numbers were calculated using the aerial image as well as soil maps found in Appendix A and section 2.4 in this report. The times of concentration were calculated using the aerial image and contours. The calculations for both curve numbers and time of concentration can be found in Appendix E. The calculations are located in Appendix E. Table 4 includes the areas May Brook Creek Watershed was divided into as well as the associated curve number and time of concentration. The predevelopment flow rate is listed for the 2-, 10-, and 100-yr storm.

Table 4: May Brook Creek Watershed Post-Development to Study Point 1 (no detention)

Section	Area (acres)	Curve Number	Time of Concentration (min)	Q 2-yr (cfs)	Q 10-yr (cfs)	Q 100-yr (cfs)
1	81.7	77	24.3	111.0	228.55	403.79
2	68.0	77	25.3	92.38	190.22	336.08
3	100.8	82	30.2	162.30	306.37	512.72
4	82.5	88	30.7	159.01	273.45	431.92
5	86.9	85	15.6	221.05	394.04	636.00
6	11.3	91	18.6	32.72	53.70	82.47
7A	19.9	89	19.3	54.00	91.08	142.13
7B	7.5	65	20.5	5.01	14.26	29.71
7C	19.0	92	9.3	76.22	122.92	185.23
8	12.6	90	23.9	29.76	49.61	76.90
Total	490.2			943.45	1724.2	2836.95

2.5.3 DOWNSTREAM ANALYSIS

Due to the location within the watershed, and the known Lakewood Lake East sedimentation and flooding issues, the basin has been inserted into a downstream analysis. The detention basin meets the flat rate discharge requirements set by KC-APWA 5600. The following text and Appendices provide analysis and the supporting data for this analysis.

The 490.2 acres of May Brook Creek analyzed for the downstream analysis includes one large above ground detention basin and three below ground detention basins. When analyzing peak flows for the watershed, it is important to remember that the time of concentration for flow through the underground basins is negated to zero. The above ground detention in the industrial area south of Strother was included in the Hydraflow report as a reach. The following table details the sections, shown on page C2.20.



The detention basin was designed to match the flat rate discharge delays of the peak discharge rate from Wilshire Hills to closely match the peak rate time in the watershed as well as match water quality standards. Therefore, the basin discharges earlier, ahead of the watershed peak. This earlier discharge provides a lower 100-year discharge rate for the downstream analysis.

Table 7: Downstream Analysis at Study Point 1

	Pre-Developed	Post –Detention Basin
2-year Storm		
Time to Peak (min)	732	728
Peak Flow (cfs)	660.85	597.54
10-year Storm		
Time to Peak (min)	732	728
Peak Flow (cfs)	1263.54	1189.44
100-year Storm		
Team to Peak (min)	732	728
Peak Flow (cfs)	2145.77	2060.48

2.6 Final Design Summary

The designed detention basin reduces post development discharge to the level of the AWWA Comprehensive Control Strategy limit. The Comprehensive control strategy parameters and KC-APWA Section 5608.4 requirement of 40 hour extended detention for water quality have been met by the basin design. The basin has also been analyzed to ensure it has no adverse impact to the May Brook Creek Watershed at Study Point 1.

The following table provides the allowed impervious acreage for each site in the planned development. The current PDP plan shows future lot uses as commercial and office development. The designed amount of impervious as well as curve numbers will ensure future developments are treated by the water quality basin. As impervious area is developed, it will be subtracted from the overall total of the development.

Table 8: Allowed Impervious Area for Future Development in Wilshire Hills

Wilshire Hills	Total Area (acres)	Designed Imperious (acres)	Designed CN	Current Impervious (acres)	Remaining Impervious (acres)
Lot 5 (Wilshire Hills III + Bypass)	2.54	1.25	86	1.18	0.07
Northeast Area (includes Lot 6)	5.37	2.70	86	0.0	2.70
West Area	3.2	1.65	86	0.82	0.83
Southwest Area	1.6	1.12	91	0.2	0.92
Southeast Area	6.27	4.57	91	0.09	4.48
Total	19	11.29	89	2.29	9.0



3 STORM SEWER DESIGN

Design Standard(s):

- *Lee's Summit, Missouri Stormwater Discharge Control Regulations (Code of Ordinance Chapter 34 Article 3)*
- *APWA Section 5300*
- *LS Section 5600 – Storm Drainage Systems and Facilities (revised July 2020)*

All storm sewers for the road public improvement project will be public storm sewers. They have been designed to the 25-year storm but can handle the 100-year storm without impeding traffic. Appendix C includes HydraFlow storm sewer calculations. The calculations are based on the Storm Sewer Drainage Area Map in Appendix D. Pipes have been sized to convey the offsite bypass calculated for the detention analysis.

The outfall control structure for the water quality basin is covered by a large grade to prevent debris from entering the structure. The low flow orifice is outfitted with a perforated pipe to prevent clogging. The 10" pipe exits the structure at 90° before bending vertically. The pipe has a cap both on the top of its vertical bend as well as the entrance to the structure wall. The cap inside of the control structure has a 4.55" orifice drilled into it. This restricts the flow to the required water quality storm while providing protection from clogging.

4 EROSION AND SEDIMENT CONTROL AND DESIGN

Design Standard(s):

- *Missouri Department of Natural Resources (MDNR) Protecting Water Quality Field Guide, 2011*

The Civil Site Plans and project Storm Water Pollution and Prevention Plan (SWPPP) indicate erosion and sediment control Best Management Practices (BMPs) to be utilized throughout construction activities. The proposed water quality basin shall be used as a temporary sediment trap throughout construction. Appendix B includes erosion and sediment control storage calculations. The outfall control structure must be wrapped in filter fabric to an elevation of 919.0 according to these calculations.

Per the city of Lee's Summit, the water quality basin has been lined with an erosion control blanket to assist in bank stabilization while the grass is being established. The basin currently has swales to assist with drainage, the future development will include pipes from the surrounding development. The installation of this fabric in the first stage prepares the basin for future development as well as providing maximum protection.

The swales leading into the basin have temporary erosion control blankets to help protect earthwork while grass is being established. These blankets are not permanent, as are the nature of the swales. The swale was analyzed with only riprap and bare earth as well as vegetated and both were found to be stable. Bare earth was also calculated and resulted in being unstable. A temporary erosion blanket will provide the necessary stability to maintain the swale until vegetation establishes. The check dams and rip rap also provide excess protection and slow the water before entering the basin. The hydraulic results for each option have been included in Appendix B.



The restored portion of May Brook Creek, north of Meadowview Drive and South of Meadowview to the end of the box culvert falls within the requirements of the KC-APWA Section 5605.3 Stream Preservation and Buffer Zones. A stream buffer has been outlined from the Ordinary High-Water Mark and extended onto the site. Part of the platting process for this site development ensured that the stream buffer became a permanent boundary protecting this area from future development. This meander of stream as well as the restored portion north of Meadowview Drive benefit May Brook Creek with water quality enhancement as well as slowing peak flows to reduce the downstream impact. No impact to this stream buffer will occur during development.

5 CONCLUSION

This hydraulic analysis was completed to evaluate the impact generated by the public improvements and future site development for Wilshire Hills. The project includes 19 acres of development including both commercial and residential living. The detention basin meets the Lee's Summit Comprehensive Control Strategy for stormwater management. Therefore, the basin provides the required water quality and meets the runoff reduction standards based on site area. Additional analysis shows the site does not have an adverse impact on the May Brook Creek watershed.

Erosion and sediment control has been designed per requirements. The site meets storm water quality requirements for developments within the City of Lee's Summit and is designed for future development on the site. The storm sewers have been designed to convey the 25-year design storm.




APPENDIX A: MAPS

National Flood Hazard Layer FIRMette



94°22'20"W 38°58'29"N

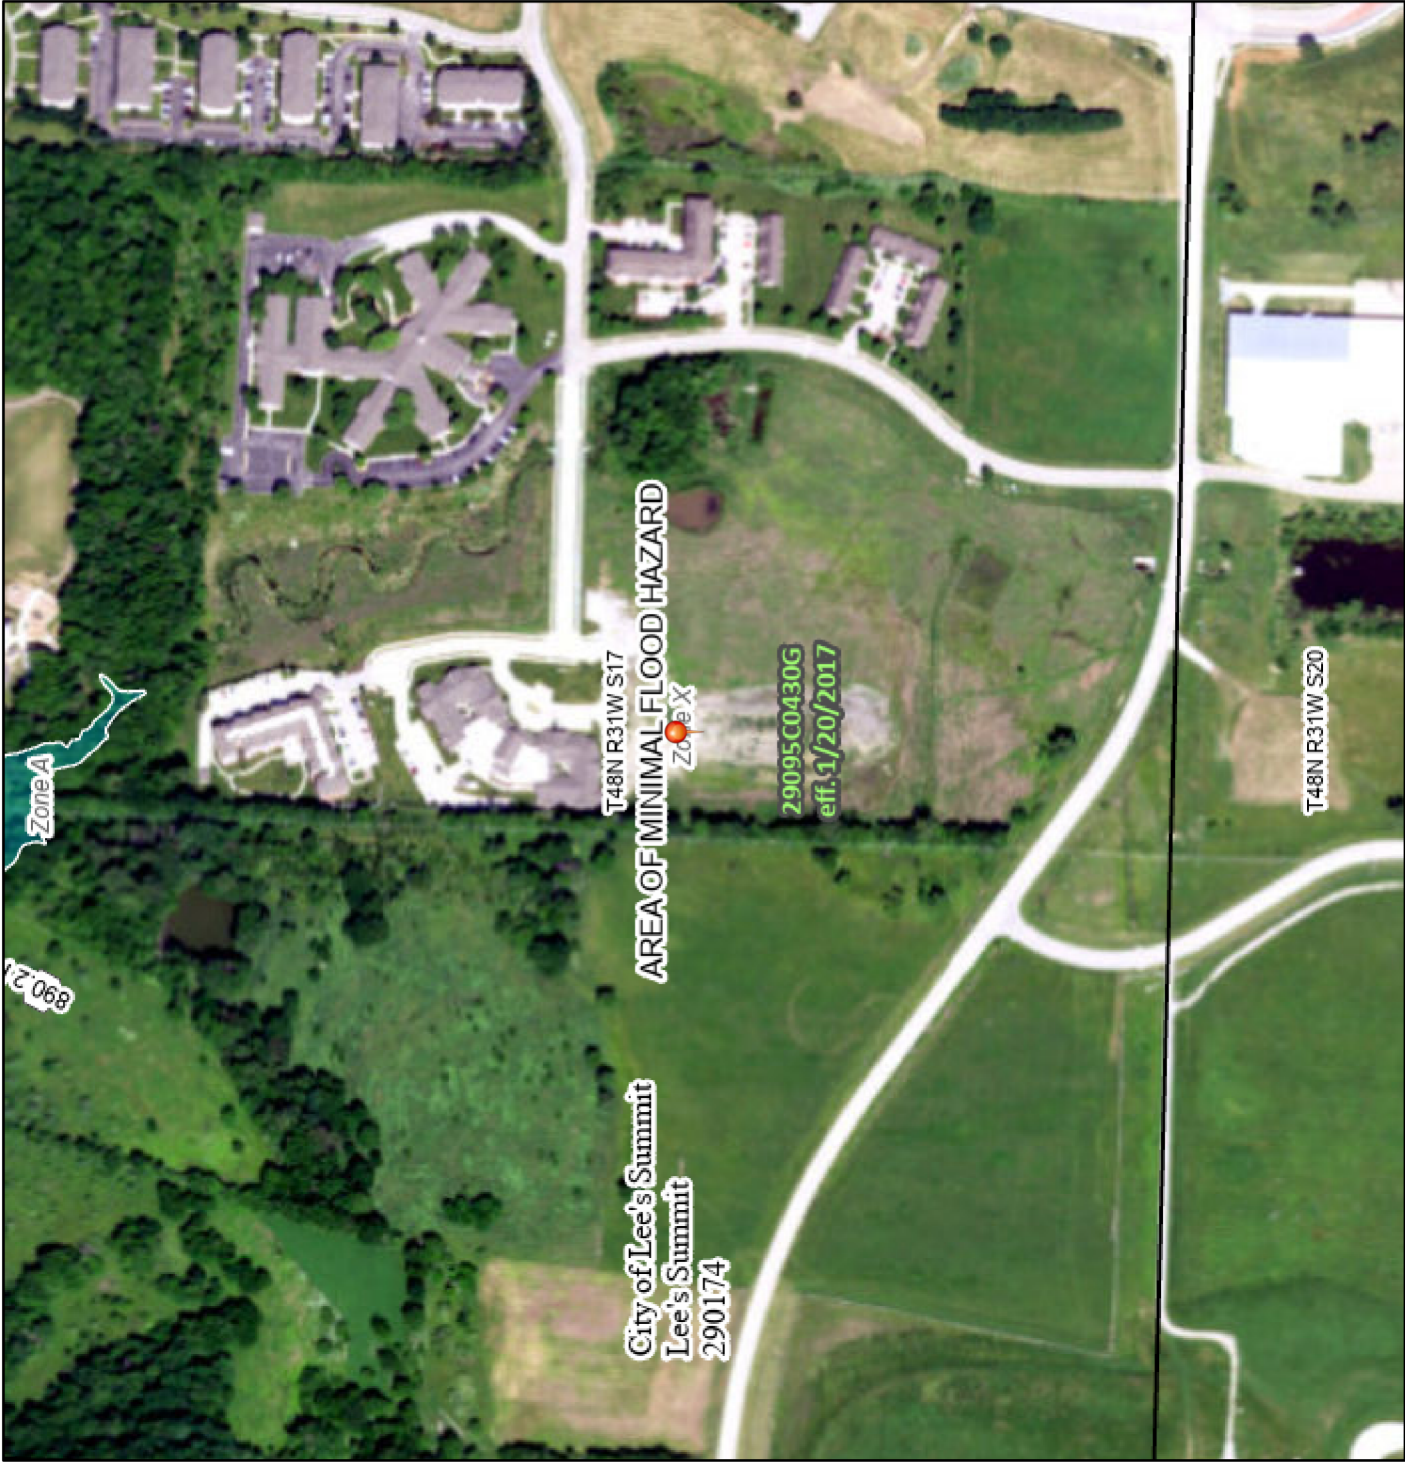

94°21'43"W 38°58'11"N

Basemap Imagery Source: USGS National Map 2023

Legend

SEE FIS REPORT FOR DETAILED LEGEND AND INDEX MAP FOR FIRM PANEL LAYOUT

SPECIAL FLOOD HAZARD AREAS

- Without Base Flood Elevation (BFE)
Zone A, V, A99
- With BFE or Depth Zone AE, AO, AH, VE, AR
- Regulatory Floodway

- 0.2% Annual Chance Flood Hazard, Areas of 1% annual chance flood with average depth less than one foot or with drainage areas of less than one square mile Zone X
- Future Conditions 1% Annual Chance Flood Hazard Zone X
- Area with Reduced Flood Risk due to Levee, See Notes, Zone X
- Area with Flood Risk due to Levee Zone D

OTHER AREAS

- NO SCREEN
- Area of Minimal Flood Hazard Zone X
- Effective LOMRs
- Area of Undetermined Flood Hazard Zone D

GENERAL STRUCTURES

- Channel, Culvert, or Storm Sewer
- Levee, Dike, or Floodwall

Cross Sections with 1% Annual Chance

- Water Surface Elevation
- Coastal Transect
- Base Flood Elevation Line (BFE)
- Limit of Study

OTHER FEATURES

- Jurisdiction Boundary
- Coastal Transect Baseline
- Profile Baseline
- Hydrographic Feature

MAP PANELS

- Digital Data Available
- No Digital Data Available
- Unmapped

Other

- Pin

Other

- North Arrow

Other

- Pin

Other

- Pin

Other

- Pin

Other

- Pin

Other

- Pin

Other

- Pin

Other

- Pin

Other

- Pin

Other

- Pin

Other

- Pin

Other

- Pin

Other

- Pin

Other

- Pin

Other

- Pin

Other

- Pin

Soil Map—Jackson County, Missouri



MAP LEGEND

Area of Interest (AOI)

 Area of Interest (AOI)

Soils

 Soil Map Unit Polygons

 Soil Map Unit Lines

 Soil Map Unit Points

Special Point Features



Blowout



Borrow Pit



Clay Spot



Closed Depression



Gravel Pit



Gravelly Spot



Landfill



Lava Flow



Marsh or swamp



Mine or Quarry



Miscellaneous Water



Perennial Water



Rock Outcrop



Saline Spot



Sandy Spot



Severely Eroded Spot



Sinkhole



Slide or Slip



Sodic Spot



Spoil Area



Stony Spot



Very Stony Spot



Wet Spot



Other



Special Line Features

Water Features



Streams and Canals

Transportation



Rails



Interstate Highways



US Routes



Major Roads



Local Roads

Background



Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service

Web Soil Survey URL:

Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Jackson County, Missouri

Survey Area Data: Version 25, Aug 22, 2023

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Aug 30, 2022—Sep 8, 2022

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.


Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
10024	Greenton-Urban land complex, 5 to 9 percent slopes	4.5	24.4%
10132	Sibley silt loam, 2 to 5 percent slopes	0.2	0.9%
30080	Greenton silty clay loam, 5 to 9 percent slopes	13.9	74.7%
Totals for Area of Interest		18.6	100.0%

Soil Map—Jackson County, Missouri
(Wilshire Hills Public Improvements)



Map Scale: 1:10,900 if printed on A portrait (8.5" x 11") sheet.



Map projection: Web Mercator Corner coordinates: WGS84 Edge tics: UTM Zone 15N WGS84



Natural Resources
Conservation Service

Web Soil Survey
National Cooperative Soil Survey

2/1/2024
Page 1 of 3

MAP LEGEND

Area of Interest (AOI)

 Area of Interest (AOI)

Soils

 Soil Map Unit Polygons

 Soil Map Unit Lines

 Soil Map Unit Points

Special Point Features



Blowout



Borrow Pit



Clay Spot



Closed Depression



Gravel Pit



Gravelly Spot



Landfill



Lava Flow



Marsh or swamp



Mine or Quarry



Miscellaneous Water



Perennial Water



Rock Outcrop



Saline Spot



Sandy Spot



Severely Eroded Spot



Sinkhole



Slide or Slip



Sodic Spot



Spoil Area



Stony Spot



Very Stony Spot



Wet Spot



Other



Special Line Features

Water Features



Streams and Canals

Transportation



Rails



Interstate Highways



US Routes



Major Roads



Local Roads

Background



Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service

Web Soil Survey URL:

Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Jackson County, Missouri

Survey Area Data: Version 25, Aug 22, 2023

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Aug 30, 2022—Sep 8, 2022

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
10024	Greenton-Urban land complex, 5 to 9 percent slopes	242.9	56.7%
10132	Sibley silt loam, 2 to 5 percent slopes	33.7	7.9%
10136	Sibley-Urban land complex, 2 to 5 percent slopes	117.1	27.3%
10143	Snead-Urban land complex, 9 to 30 percent slopes	2.8	0.6%
30080	Greenton silty clay loam, 5 to 9 percent slopes	32.1	7.5%
Totals for Area of Interest		428.6	100.0%

Approximate AOI used- actual watershed area = 490.2 acres
Acres/ Percent Scaled to remain similar

Jackson County, Missouri

10024—Greenton-Urban land complex, 5 to 9 percent slopes

Map Unit Setting

National map unit symbol: 2qky4

Elevation: 800 to 1,100 feet

Mean annual precipitation: 33 to 41 inches

Mean annual air temperature: 50 to 55 degrees F

Frost-free period: 177 to 220 days

Farmland classification: Not prime farmland

Map Unit Composition

Greenton and similar soils: 60 percent

Urban land: 40 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Greenton

Setting

Landform: Hillslopes

Landform position (two-dimensional): Shoulder

Landform position (three-dimensional): Side slope

Down-slope shape: Convex

Across-slope shape: Concave, convex

Parent material: Loess over residuum weathered from limestone and shale

Typical profile

A - 0 to 16 inches: silty clay loam

Bt1 - 16 to 26 inches: silty clay loam

2Bt2 - 26 to 80 inches: silty clay

Properties and qualities

Slope: 5 to 9 percent

Depth to restrictive feature: More than 80 inches

Drainage class: Somewhat poorly drained

Runoff class: Very high

Capacity of the most limiting layer to transmit water

(Ksat): Moderately low to moderately high (0.06 to 0.20 in/hr)

Depth to water table: About 12 to 30 inches

Frequency of flooding: None

Frequency of ponding: None

Maximum salinity: Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm)

Available water supply, 0 to 60 inches: Low (about 3.6 inches)

Interpretive groups

Land capability classification (irrigated): None specified

Land capability classification (nonirrigated): 3e

Hydrologic Soil Group: D

Ecological site: R109XY002MO - Loess Upland Prairie
Other vegetative classification: Grass/Prairie (Herbaceous
Vegetation)
Hydric soil rating: No

Description of Urban Land

Setting

Landform: Hills
Landform position (two-dimensional): Backslope
Across-slope shape: Concave, convex

Interpretive groups

Land capability classification (irrigated): None specified
Land capability classification (nonirrigated): 8
Hydric soil rating: No

Data Source Information

Soil Survey Area: Jackson County, Missouri
Survey Area Data: Version 25, Aug 22, 2023

Jackson County, Missouri

10136—Sibley-Urban land complex, 2 to 5 percent slopes

Map Unit Setting

National map unit symbol: 2ql0j

Elevation: 720 to 1,440 feet

Mean annual precipitation: 33 to 41 inches

Mean annual air temperature: 49 to 55 degrees F

Frost-free period: 155 to 220 days

Farmland classification: All areas are prime farmland

Map Unit Composition

Sibley and similar soils: 60 percent

Urban land: 35 percent

Minor components: 5 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Sibley

Setting

Landform: Interfluves

Landform position (two-dimensional): Summit

Landform position (three-dimensional): Interfluve

Down-slope shape: Convex

Across-slope shape: Convex

Parent material: Loess

Typical profile

A - 0 to 17 inches: silt loam

Bt - 17 to 65 inches: silty clay loam

C - 65 to 80 inches: silt loam

Properties and qualities

Slope: 2 to 5 percent

Depth to restrictive feature: More than 80 inches

Drainage class: Well drained

Runoff class: Medium

Capacity of the most limiting layer to transmit water

(Ksat): Moderately high (0.20 to 0.57 in/hr)

Depth to water table: More than 80 inches

Frequency of flooding: None

Frequency of ponding: None

Maximum salinity: Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm)

Available water supply, 0 to 60 inches: High (about 12.0 inches)

Interpretive groups

Land capability classification (irrigated): None specified

Land capability classification (nonirrigated): 2e

Hydrologic Soil Group: C

Ecological site: R107XB002MO - Deep Loess Upland Prairie
Other vegetative classification: Grass/Prairie (Herbaceous
Vegetation)
Hydric soil rating: No

Description of Urban Land

Setting

Landform: Interfluves
Landform position (two-dimensional): Summit
Landform position (three-dimensional): Interfluve
Across-slope shape: Convex

Interpretive groups

Land capability classification (irrigated): None specified
Land capability classification (nonirrigated): 8
Hydric soil rating: No

Minor Components

Macksburg

Percent of map unit: 5 percent
Landform: Ridges
Landform position (two-dimensional): Summit
Landform position (three-dimensional): Interfluve
Down-slope shape: Linear
Across-slope shape: Linear
Ecological site: R108XD860IA - Loess Upland Prairie
Hydric soil rating: No

Data Source Information

Soil Survey Area: Jackson County, Missouri
Survey Area Data: Version 25, Aug 22, 2023

Jackson County, Missouri

30080—Greenton silty clay loam, 5 to 9 percent slopes

Map Unit Setting

National map unit symbol: 2xjd9

Elevation: 640 to 1,120 feet

Mean annual precipitation: 35 to 41 inches

Mean annual air temperature: 50 to 57 degrees F

Frost-free period: 177 to 209 days

Farmland classification: Not prime farmland

Map Unit Composition

Greenton and similar soils: 90 percent

Minor components: 10 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Greenton

Setting

Landform: Hillslopes

Landform position (two-dimensional): Shoulder

Landform position (three-dimensional): Interfluve

Down-slope shape: Convex

Across-slope shape: Convex

Parent material: Loess over residuum weathered from limestone and shale

Typical profile

Ap - 0 to 12 inches: silty clay loam

Bt - 12 to 28 inches: silty clay

2Bt - 28 to 30 inches: silty clay

2C - 30 to 79 inches: silty clay

Properties and qualities

Slope: 5 to 9 percent

Depth to restrictive feature: More than 80 inches

Drainage class: Somewhat poorly drained

Runoff class: Very high

Capacity of the most limiting layer to transmit water

(Ksat): Moderately low to moderately high (0.06 to 0.20 in/hr)

Depth to water table: About 12 to 30 inches

Frequency of flooding: None

Frequency of ponding: None

Calcium carbonate, maximum content: 10 percent

Maximum salinity: Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm)

Available water supply, 0 to 60 inches: High (about 9.6 inches)

Interpretive groups

Land capability classification (irrigated): None specified

Land capability classification (nonirrigated): 3e
Hydrologic Soil Group: C/D
Ecological site: R109XY002MO - Loess Upland Prairie
Hydric soil rating: No

Minor Components

Sampsel

Percent of map unit: 10 percent
Landform: Hillslopes
Landform position (two-dimensional): Footslope
Landform position (three-dimensional): Side slope
Down-slope shape: Convex
Across-slope shape: Convex
Ecological site: R109XY002MO - Loess Upland Prairie
Hydric soil rating: Yes

Data Source Information

Soil Survey Area: Jackson County, Missouri
Survey Area Data: Version 25, Aug 22, 2023



APPENDIX B: EROSION AND SEDIMENT CONTROL CALCULATIONS



EROSION CONTROL CALCULATIONS

Temporary Sediment Trap

11.3 Acres disturbed to sediment basin

$11.3 \times 3,600 \text{ CF/Ac} = 40,680 \text{ CF sediment storage required}$

<u>ELEVATION</u>	<u>CONTOUR AREA(SF)</u>	<u>TOTAL STORAGE(CF)</u>
912	2360	0
913	13600	8370
914	15500	22900
915	17500	39400
916	19500	57900
917	21900	79600
918	23800	101500
919	26500	126700
920	30000	154900

40,680 CF of sediment storage is provided at an elevation of 915. The outfall structure must be wrapped with filter fabric below this elevation.



EROSION CONTROL CALCULATIONS

SILT FENCE - ratio less than $\frac{1}{4}$ ac/100 ft = 0.0025 ✓

1) EAST of NEW Wilshire Drive: STROTHER RD to FES 40

DISTURBED AREA: 0.58 Acres

SILT FENCE LENGTH: 288 Feet

RATIO: $0.58 / 288 = 0.0020$ ✓

2) NORTH of Basin outfall pipe (NE Meadowview Dr)

DISTURBED AREA: 0.28 Acres

SILT FENCE LENGTH: 305 feet

RATIO: $0.28 / 305 = 0.0009$ ✓

3) SOUTH of Basin outfall pipe (NE Manhattan Terrace)

DISTURBED AREA: 1.53 Acres

SILT FENCE LENGTH: 634 feet

RATIO: $1.53 / 634 = 0.0024$ ✓


INLET PROTECTION - Inlet design < $\frac{1}{2}$ acre disturbed area

CI 41 DISTURBED AREA = 0.14 ✓

CI 42 DISTURBED AREA = 0.13 ✓

SOI 6A DISTURBED AREA = 0.49 ✓


Discharge (cfs)	Peak Flow Period (hrs)	Velocity (fps)	Area (sq.ft)	Hydraulic Radius(ft)	Normal Depth (ft)
13.4	2.0	1.99	6.74	0.49	0.58

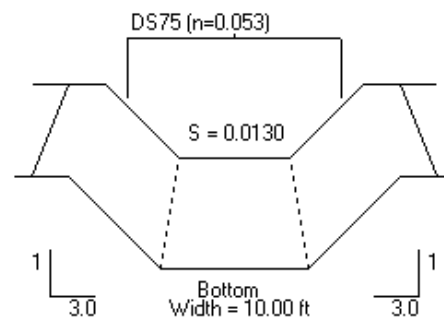

Not to Scale

[illegible]

Discharge (cfs)	Peak Flow Period (hrs)	Velocity (fps)	Area (sq.ft)	Hydraulic Radius(ft)	Normal Depth (ft)
13.4	2.0	1.30	10.27	0.68	0.82

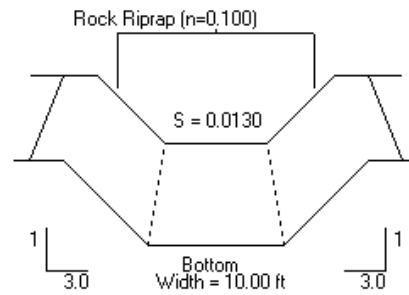

Not to Scale

[illegible]

Discharge (cfs)	13.4
Peak Flow Period (hrs)	2
Channel Slope (ft/ft)	0.013
Channel Bottom Width (ft)	10.00
Left Side Slope (Horiz. to 1)	3.0
Right Side Slope (Horiz. to 1)	3.0
Existing Channel Bend	☐ Yes ☒ No

COMPOSITE CHANNEL LINING? ☐ Yes ☒ No

Channel Liner

Matting Type	Unreinforced Vegetation
Vegetation Development Phase	
Vegetation Analysis	
Retardance Class (A-E)	E <2 in
Vegetation Type (Growth Habit)	Sod Former
Vegetation Density	4. Poor <50%
Soil Type	Clay Loam

Manning's 'n'

NORTH AMERICAN GREEN EROSION CONTROL MATERIALS DESIGN SOFTWARE VERSION 4.2
NORTH AMERICAN GREEN CHANNEL PROTECTION - ENGLISH/S.I.
USER SPECIFIED CHANNEL LINING BACK-UP COMPUTATIONS

PROJECT NAME: Wilshire Hills	PROJECT NO.: 15925
COMPUTED BY:	DATE: 10/12/2023
FROM STATION/REACH:	TO STATION/REACH:
DRAINAGE AREA:	DESIGN FREQUENCY:

INPUT PARAMETERS

Channel Discharge : 13.4 cfs (.38 m³/s)
Peak Flow Period : 2 hours
Channel Slope : 0.013 ft/ft (0.013 m/m)
Channel Bottom Width : 10.0 ft (3.05 m)
Left Side Slope : 3:1
Right Side Slope : 3:1

Channel Lining : Unreinforced Vegetation Sod <50%
 Permi. Shear(Tp) :2.16 psf (103.4 Pa)
 Phase = 1
 Class = E Vegetation
 Soil = Clay Loam
 Allowable Soil Shear(Ta):0.05 psf (2.39400003567338 Pa)

CALCULATIONS

Initial Depth Estimate = $0.16 * (13.4 / (0.013^{0.5}))^{0.375} = 0.96 \text{ ft } (.29 \text{ m})$
 Final Channel Depth (after 10 iterations) = $.25 \text{ ft } (0.08 \text{ m})$
 Flow Area = $(10.0 * 0.3) + (0.5 * 0.25^2 * (3.0 + 3.0)) = 2.7 \text{ sq.ft } (0.3 \text{ m}^2)$
 Wet Per. = $10.0 + (0.3 * ((3.0^2) + 1)^{.5} + ((3.0^2) + 1)^{.5}) = 11.6 \text{ ft } (3.5 \text{ m})$
 Hydraulic Radius = $(2.7 / 11.6) = 0.2 \text{ ft } (0.1 \text{ m})$
 Channel Velocity = $(1.486 / 0.013) * (0.2^{0.667}) * (0.013^{.5}) = 4.9 \text{ fps } (1.5 \text{ m/s})$

Channel Effective Manning's Roughness	= 0.013
Calculated Shear (Td) = 62.4 * 0.25 * 0.013	= 0.20 psf (9.8 Pa)
Safety Factor = (Tp/Td) = (2.16 /0.20)	= 10.57

Effective Stress on Soil (Te)= $0.2 \times (1 - 0.44) \times (0.0156 / 0.013)^2 = 0.16$ psf (7.9 Pa)
Safety Factor = (Ta/Te) = (0.05 / 0.165) = 0.30

W



APPENDIX C: BASIN ANALYSIS



C.1 WATER QUALITY



**Engineering Surveys
& Services**

DELIVERING YOUR VISION™

1113 Fay St
Columbia, MO 65201
www.ess-inc.com
573-449-2646

Channel Protection & Water Quality - Basin Elevations

Development Name: Wilshire Hills Phase III Public Improvements
Location: Lee's Summit, MO
Date: March 27, 2024
Project No: 15925

Basin Stage Elevations

<u>Elevation</u>	<u>Area (SF)</u>	<u>Storage (CF)</u>
911.7		
911.7	0	0
911.7	0	0
912		343
913		8,305
914		22,879
915		39,366
916		57,851
917		78,417

WQv = 48,607 CF (from calculation)

Elevation of WQv:

$$\frac{918 - 917}{56,048 - 41,292} = \frac{918 - X}{56,048 - 48,607}$$

X = WQv Elevation = 915.50



Water Quality Protection Volume Calculation (WQ_v)

Development Name: Wilshire Hills Phase III Public Improvements
Location: Lee's Summit, MO
Date: March 27, 2024
Project No: 15925

Runoff Calculation:

$$R_v = 0.05 + 0.009(I)$$

$$WQ_v = \frac{1.2 R_v A}{12}$$

I = percent of impervious cover (%)
WQ_v = water quality protection volume (acre-feet)
R_v = volumetric runoff
A = total drainage area (acres)

Runoff Calculation Inputs:

Total Drainage Area	19.00	Acres
% Impervious Area	60%	Acres
Riparian Buffer Area	0.00	Acres
Regulated Floodplain Area	0.00	Acres
Total Conservation Area	0.00	Acres
Reduced Drainage Area	19.00	Acres
R _v	0.59	
UnReduced WQ _v	1.116	ac-ft
Reduced WQ _v	1.116	ac-ft

Site area - ESA - Floodplain.

Reduced WQ_v 48,607 ft³



Water Quality - Orifice Sizing

Development Name: Wilshire Hills Phase III Public Improvements
Location: Lee's Summit, MO
Date: February 6, 2024
Project No: 15925

$H_{\max} = \text{WQv elevation} - \text{basin bottom elevation (or top of Volume Reduction elevation)}$

$H_{\max} = 3.80 \text{ (ft)}$

$Q_{\text{avg}} = \text{WQv} / (24 \text{ hr})(3,600 \text{ s/hr})$

$CP_v = 48,607 \text{ CF (from GA Review Tool Spreadsheet)}$

$Q_{\text{avg}} = 0.56 \text{ CFS}$

$Q_{\max} = Q_{\text{avg}} \times 2 = 1.13 \text{ CFS}$

$Q = CA(2gH)^{0.5}$ rearranging $A = Q/C(2gH)^{0.5}$

$C = \text{discharge coefficient} = 0.6$

$g = \text{acceleration due to gravity (ft/s)} = 32.2$

$A = \text{orifice area} = 0.11988 \text{ SF}$

$A = (\pi/4)d^2$ rearranging $d = (4A/\pi)^{0.5}$

$d = \text{orifice diameter} = 0.39 \text{ ft.}$

$d = \text{orifice diameter} =$	4.69	in.
---------------------------------	-------------	------------

**WQv Orifice Size > CPv Orifice Size
therefore orifice shall be the CPv Orifice Size**



C.2 EMERGENCY SPILLWAY

Weir Report

Wilshire Hills Water Quality Basin

Rectangular Weir


Crest = Broad
Bottom Length (ft) = 120.00
Total Depth (ft) = 2.10

Highlighted

Depth (ft) = 0.68
Q (cfs) = 174.65
Area (sqft) = 81.49
Velocity (ft/s) = 2.14
Top Width (ft) = 120.00

Calculations

Weir Coeff. Cw = 2.60
Compute by: Known Q
Known Q (cfs) = 174.65

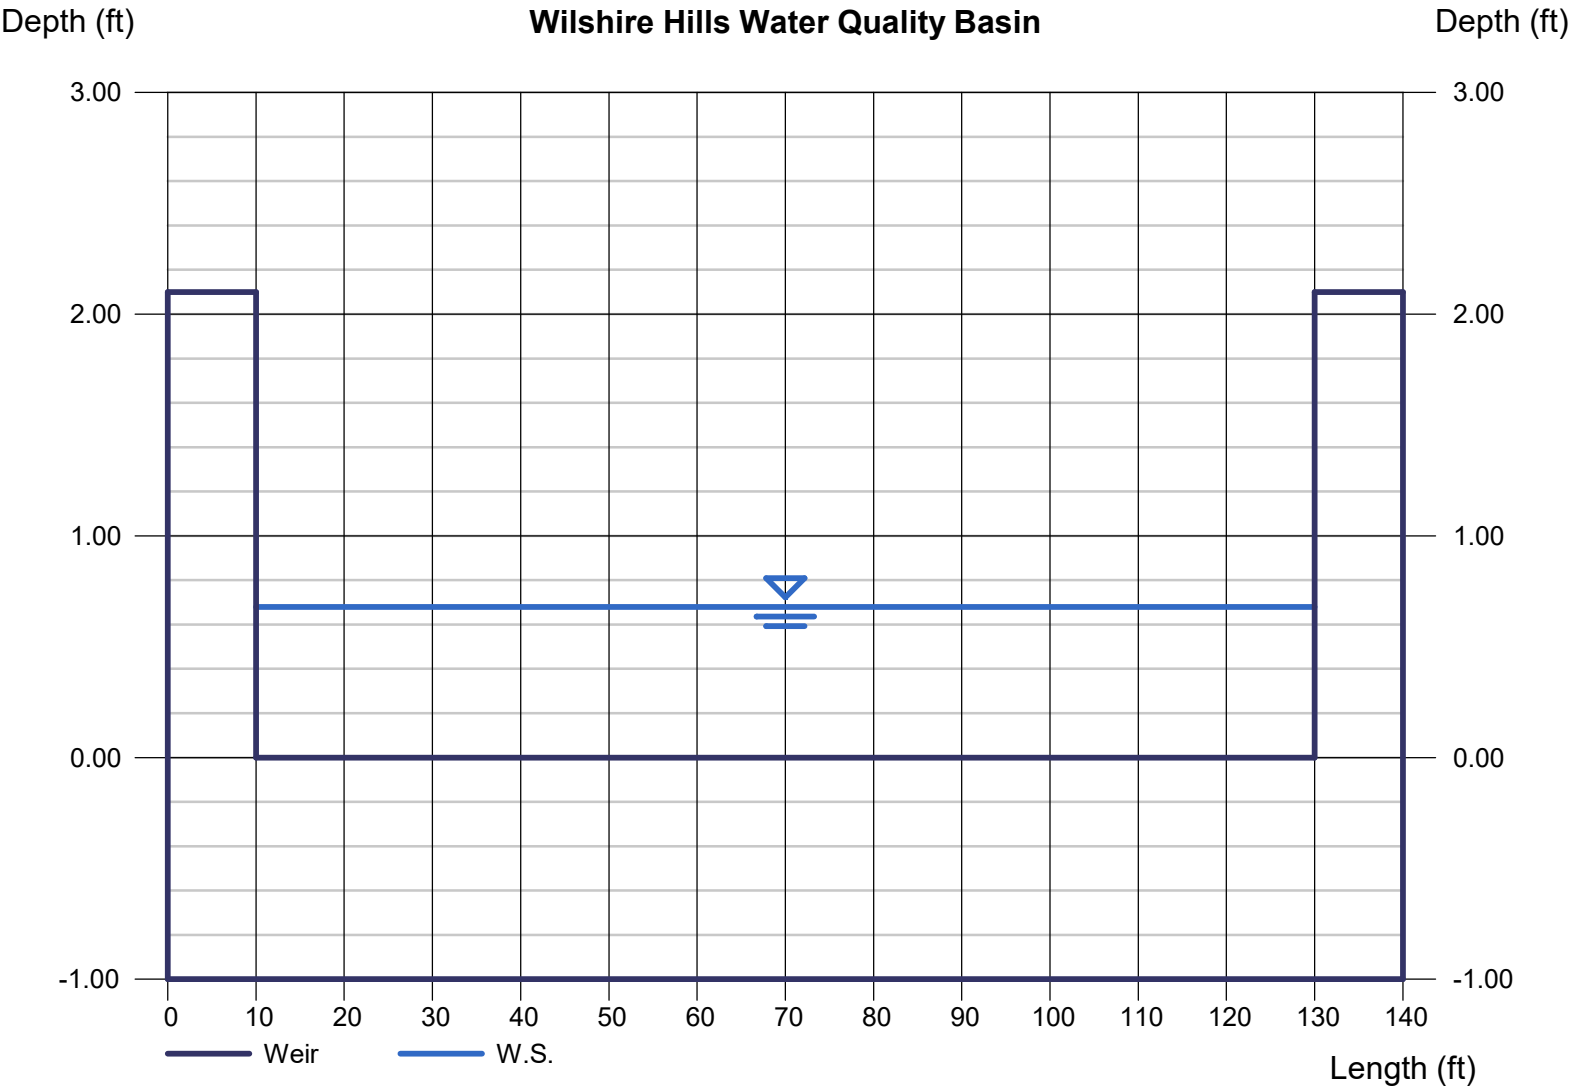



C.3 COMPREHENSIVE BASIN ANALYSIS

Hydraflow Table of Contents

I:\Geospatial\Projects\5925E-JES-Wilshire-Hills-3-Eng\Stormwater\Hydraflow\Comprehensive Analayis.gpw

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Thursday, 03 / 28 / 2024


Watershed Model Schematic.....	1
Hydrograph Return Period Recap.....	2
2 - Year	
Summary Report.....	3
Hydrograph Reports.....	4
Hydrograph No. 1, SCS Runoff, Bypass.....	4
TR-55 Tc Worksheet.....	5
Hydrograph No. 2, SCS Runoff, Northeast.....	6
TR-55 Tc Worksheet.....	7
Hydrograph No. 3, SCS Runoff, southeast.....	8
TR-55 Tc Worksheet.....	9
Hydrograph No. 4, SCS Runoff, Southwest.....	10
TR-55 Tc Worksheet.....	11
Hydrograph No. 5, SCS Runoff, West.....	12
TR-55 Tc Worksheet.....	13
Hydrograph No. 6, SCS Runoff, 7B (Offsite to Basin).....	14
TR-55 Tc Worksheet.....	15
Hydrograph No. 7, SCS Runoff, Lot 5 (Wilshire Phase III).....	16
TR-55 Tc Worksheet.....	17
Hydrograph No. 8, Combine, Onsite Water.....	18
Hydrograph No. 9, Reservoir, Water Quality Basin.....	19
Pond Report - Basin.....	20
10 - Year	
Summary Report.....	21
Hydrograph Reports.....	22
Hydrograph No. 1, SCS Runoff, Bypass.....	22
Hydrograph No. 2, SCS Runoff, Northeast.....	23
Hydrograph No. 3, SCS Runoff, southeast.....	24
Hydrograph No. 4, SCS Runoff, Southwest.....	25
Hydrograph No. 5, SCS Runoff, West.....	26
Hydrograph No. 6, SCS Runoff, 7B (Offsite to Basin).....	27
Hydrograph No. 7, SCS Runoff, Lot 5 (Wilshire Phase III).....	28
Hydrograph No. 8, Combine, Onsite Water.....	29
Hydrograph No. 9, Reservoir, Water Quality Basin.....	30
100 - Year	
Summary Report.....	31
Hydrograph Reports.....	32
Hydrograph No. 1, SCS Runoff, Bypass.....	32
Hydrograph No. 2, SCS Runoff, Northeast.....	33
Hydrograph No. 3, SCS Runoff, southeast.....	34
Hydrograph No. 4, SCS Runoff, Southwest.....	35
Hydrograph No. 5, SCS Runoff, West.....	36
Hydrograph No. 6, SCS Runoff, 7B (Offsite to Basin).....	37
Hydrograph No. 7, SCS Runoff, Lot 5 (Wilshire Phase III).....	38

Hydrograph No. 8, Combine, Onsite Water.....	39
Hydrograph No. 9, Reservoir, Water Quality Basin.....	40

IDF Report.....	41
------------------------	-----------

Watershed Model Schematic

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

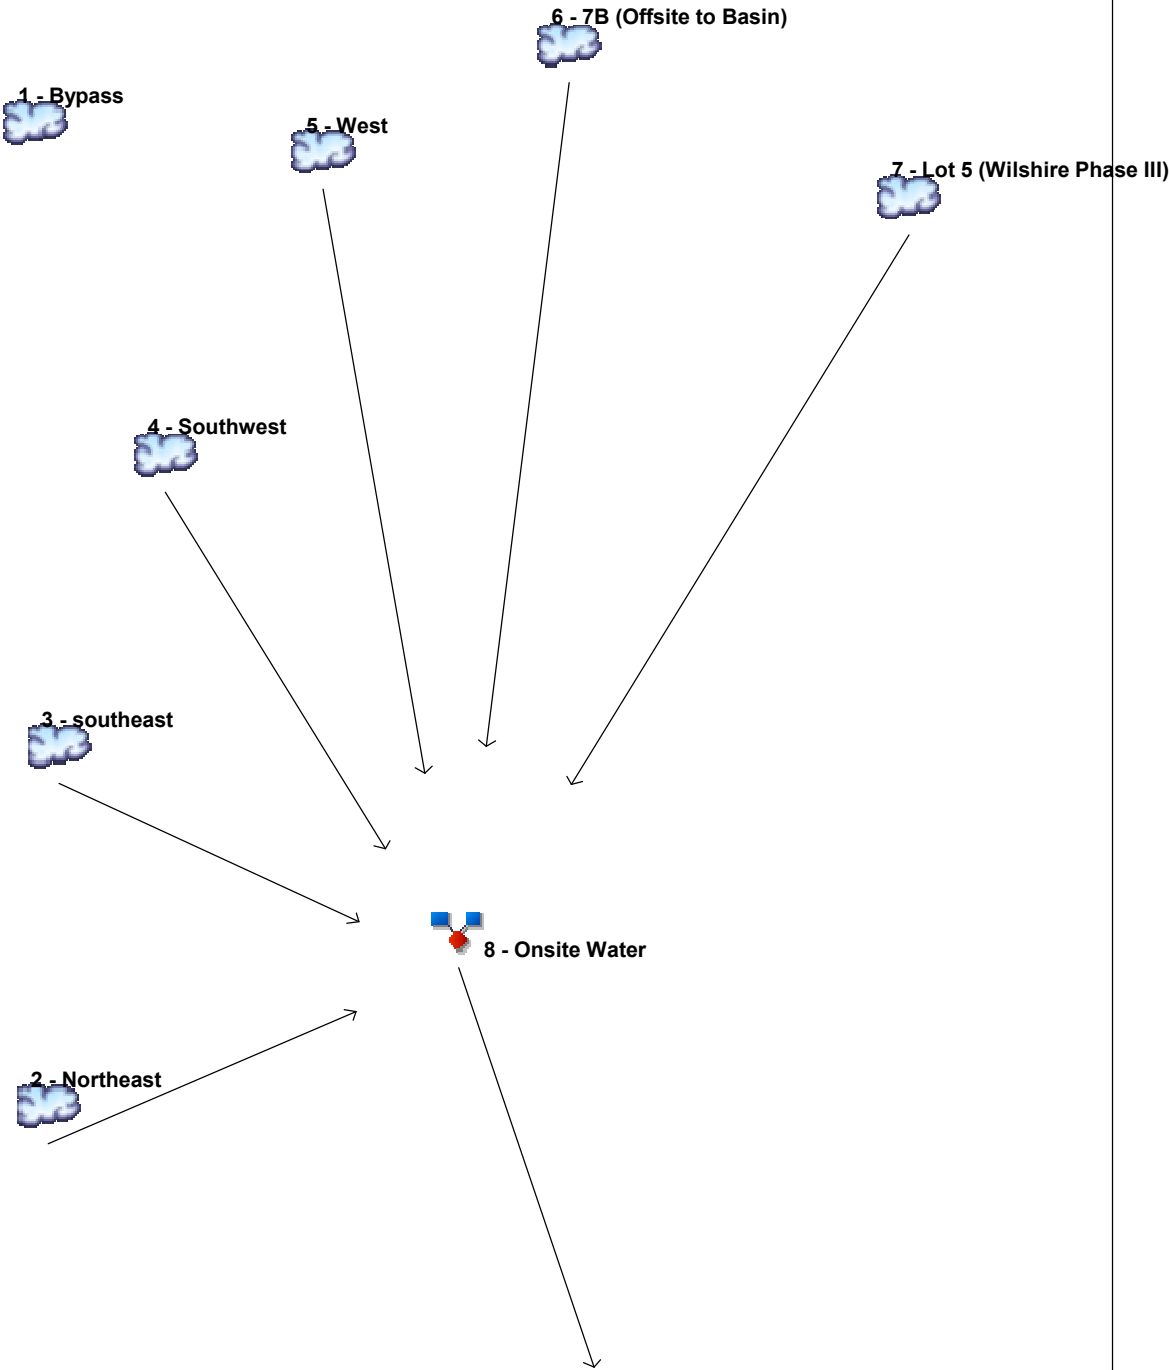

Legend

Hyd.	Origin	Description
1	SCS Runoff	Bypass
2	SCS Runoff	Northeast
3	SCS Runoff	southeast
4	SCS Runoff	Southwest
5	SCS Runoff	West
6	SCS Runoff	7B (Offsite to Basin)
7	SCS Runoff	Lot 5 (Wilshire Phase III)
8	Combine	Onsite Water
9	Reservoir	Water Quality Basin

Hydrograph Summary Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description
1	SCS Runoff	0.276	2	734	1,244	-----	-----	-----	Bypass
2	SCS Runoff	14.19	2	722	39,881	-----	-----	-----	Northeast
3	SCS Runoff	24.46	2	718	57,836	-----	-----	-----	southeast
4	SCS Runoff	6.241	2	718	14,759	-----	-----	-----	Southwest
5	SCS Runoff	9.666	2	720	25,136	-----	-----	-----	West
6	SCS Runoff	8.054	2	732	33,757	-----	-----	-----	7B (Offsite to Basin)
7	SCS Runoff	5.142	2	726	17,754	-----	-----	-----	Lot 5 (Wilshire Phase III)
8	Combine	62.25	2	720	189,123	2, 3, 4, 5, 6, 7	-----	-----	Onsite Water
9	Reservoir	16.23	2	742	189,109	8	917.14	81,770	Water Quality Basin


Hydrograph Report

Hyd. No. 1

Bypass

Hydrograph type	=	SCS Runoff	Peak discharge	=	0.276 cfs
Storm frequency	=	2 yrs	Time to peak	=	734 min
Time interval	=	2 min	Hyd. volume	=	1,244 cuft
Drainage area	=	0.260 ac	Curve number	=	75*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	30.70 min
Total precip.	=	3.50 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(0.010 x 98) + (0.240 x 74)] / 0.260

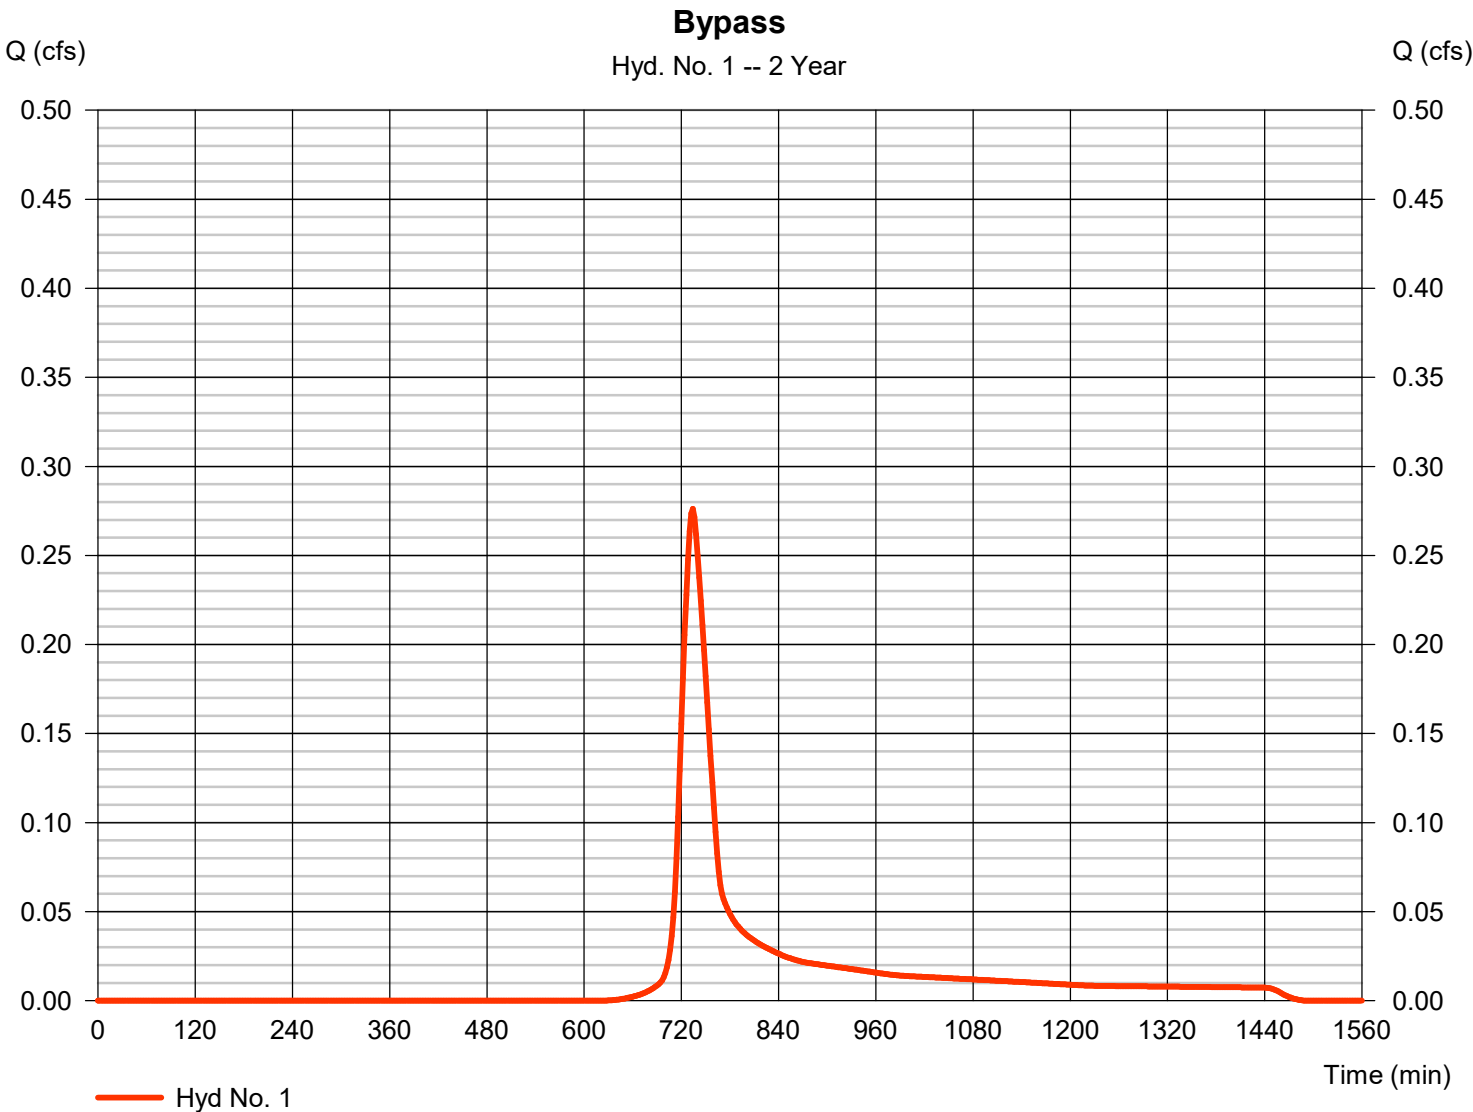

TR55 Tc Worksheet

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Hyd. No. 1

Bypass

<u>Description</u>	<u>A</u>	<u>B</u>	<u>C</u>	<u>Totals</u>
Sheet Flow				
Manning's n-value	= 0.240	0.011	0.011	
Flow length (ft)	= 100.0	0.0	0.0	
Two-year 24-hr precip. (in)	= 2.20	0.00	0.00	
Land slope (%)	= 1.00	0.00	0.00	
Travel Time (min)	= 22.71	+	0.00	+
			0.00	= 22.71
Shallow Concentrated Flow				
Flow length (ft)	= 900.00	0.00	0.00	
Watercourse slope (%)	= 1.50	0.00	0.00	
Surface description	= Unpaved	Paved	Paved	
Average velocity (ft/s)	=1.98	0.00	0.00	
Travel Time (min)	= 7.59	+	0.00	+
			0.00	= 7.59
Channel Flow				
X sectional flow area (sqft)	= 10.00	0.00	0.00	
Wetted perimeter (ft)	= 6.00	0.00	0.00	
Channel slope (%)	= 5.10	0.00	0.00	
Manning's n-value	= 0.015	0.015	0.015	
Velocity (ft/s)	=31.59	0.00	0.00	
Flow length (ft)	(\{0\})700.0	0.0	0.0	
Travel Time (min)	= 0.37	+	0.00	+
			0.00	= 0.37
Total Travel Time, Tc				30.70 min


Hydrograph Report

Hyd. No. 2

Northeast

Hydrograph type	=	SCS Runoff	Peak discharge	=	14.19 cfs
Storm frequency	=	2 yrs	Time to peak	=	722 min
Time interval	=	2 min	Hyd. volume	=	39,881 cuft
Drainage area	=	5.370 ac	Curve number	=	86*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	15.30 min
Total precip.	=	3.50 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(2.700 x 98) + (2.670 x 74)] / 5.370

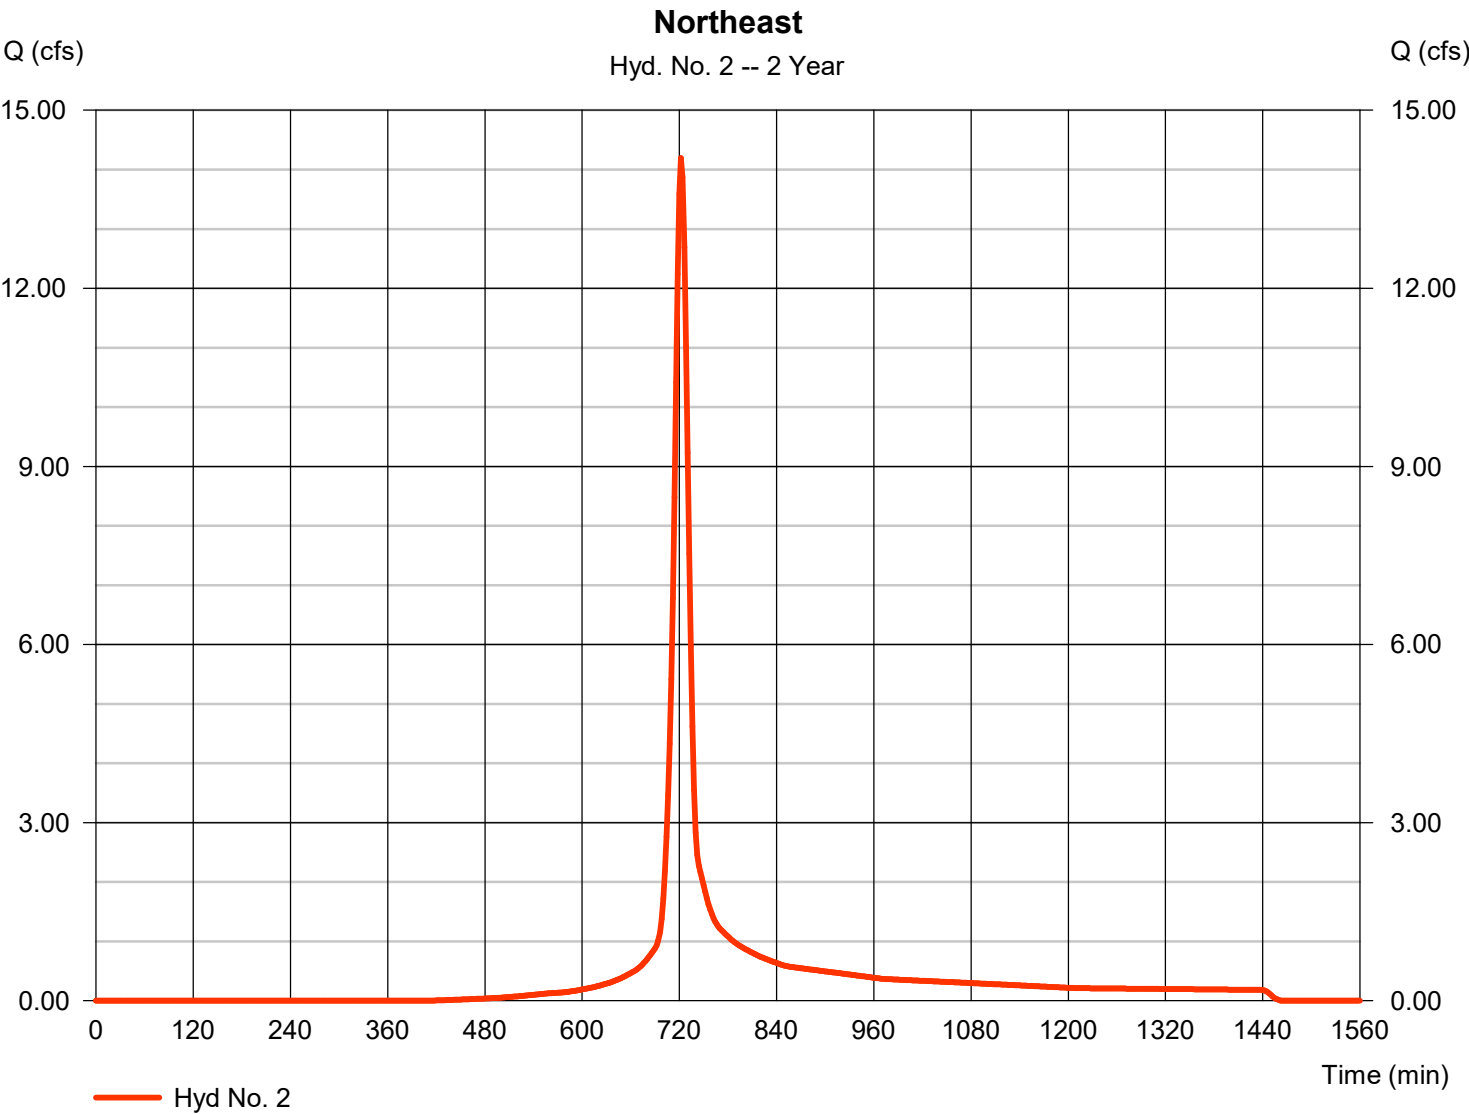

TR55 Tc Worksheet

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Hyd. No. 2

Northeast

<u>Description</u>	<u>A</u>	<u>B</u>	<u>C</u>	<u>Totals</u>
Sheet Flow				
Manning's n-value	= 0.240	0.011	0.011	
Flow length (ft)	= 100.0	0.0	0.0	
Two-year 24-hr precip. (in)	= 3.50	0.00	0.00	
Land slope (%)	= 2.00	0.00	0.00	
Travel Time (min)	= 13.64	+	0.00	+
			0.00	= 13.64
Shallow Concentrated Flow				
Flow length (ft)	= 150.00	0.00	0.00	
Watercourse slope (%)	= 2.00	0.00	0.00	
Surface description	= Unpaved	Paved	Paved	
Average velocity (ft/s)	=2.28	0.00	0.00	
Travel Time (min)	= 1.10	+	0.00	+
			0.00	= 1.10
Channel Flow				
X sectional flow area (sqft)	= 24.00	0.00	0.00	
Wetted perimeter (ft)	= 14.00	0.00	0.00	
Channel slope (%)	= 3.20	0.00	0.00	
Manning's n-value	= 0.050	0.015	0.025	
Velocity (ft/s)	=7.65	0.00	0.00	
Flow length (ft)	({})250.0	0.0	0.0	
Travel Time (min)	= 0.54	+	0.00	+
			0.00	= 0.54
Total Travel Time, Tc				15.30 min

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 3

southeast

Hydrograph type	= SCS Runoff	Peak discharge	= 24.46 cfs
Storm frequency	= 2 yrs	Time to peak	= 718 min
Time interval	= 2 min	Hyd. volume	= 57,836 cuft
Drainage area	= 6.270 ac	Curve number	= 91*
Basin Slope	= 0.0 %	Hydraulic length	= 0 ft
Tc method	= TR55	Time of conc. (Tc)	= 7.10 min
Total precip.	= 3.50 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

* Composite (Area/CN) = $[(4.570 \times 98) + (1.700 \times 74)] / 6.270$

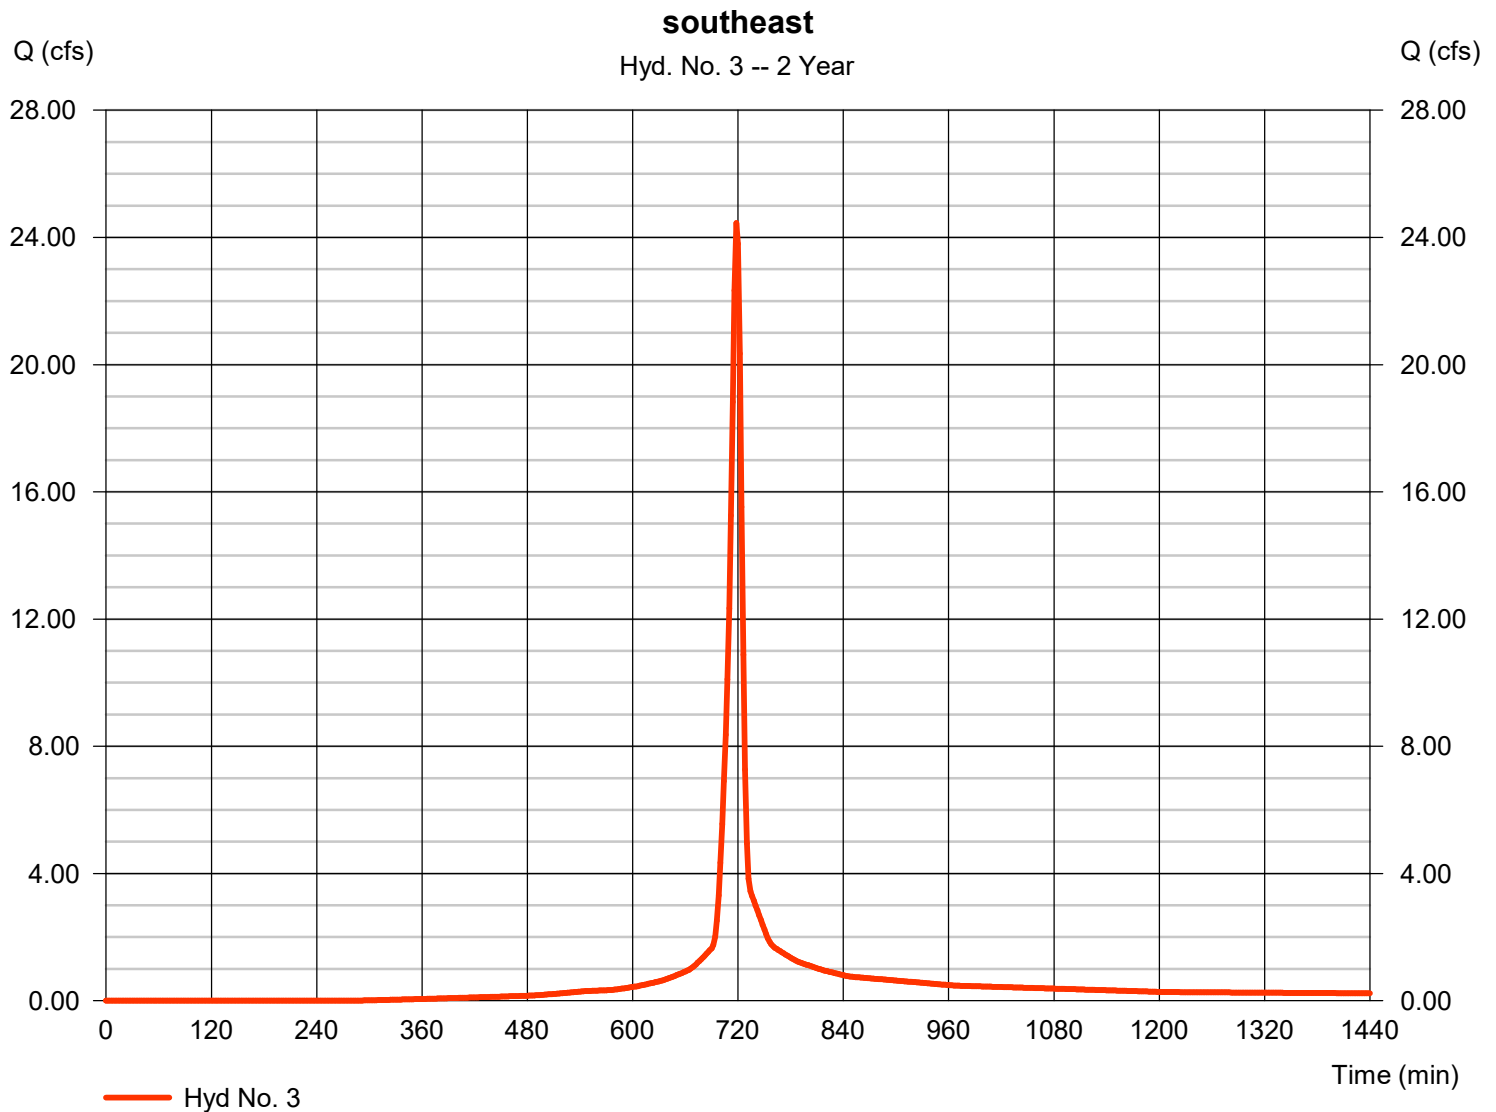

TR55 Tc Worksheet

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Hyd. No. 3

southeast

<u>Description</u>	<u>A</u>	<u>B</u>	<u>C</u>	<u>Totals</u>			
Sheet Flow							
Manning's n-value	= 0.240	0.011	0.011				
Flow length (ft)	= 25.0	0.0	0.0				
Two-year 24-hr precip. (in)	= 3.50	0.00	0.00				
Land slope (%)	= 2.00	0.00	0.00				
Travel Time (min)	= 4.50	+	0.00	+	0.00	=	4.50
Shallow Concentrated Flow							
Flow length (ft)	= 15.00	0.00	0.00				
Watercourse slope (%)	= 3.00	0.00	0.00				
Surface description	= Paved	Paved	Paved				
Average velocity (ft/s)	=3.52	0.00	0.00				
Travel Time (min)	= 0.07	+	0.00	+	0.00	=	0.07
Channel Flow							
X sectional flow area (sqft)	= 12.60	0.00	0.00				
Wetted perimeter (ft)	= 12.56	0.00	0.00				
Channel slope (%)	= 1.00	0.00	0.00				
Manning's n-value	= 0.030	0.015	0.015				
Velocity (ft/s)	=4.98	0.00	0.00				
Flow length (ft)	(0)}750.0	0.0	0.0				
Travel Time (min)	= 2.51	+	0.00	+	0.00	=	2.51
Total Travel Time, Tc				7.10 min			

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 4

Southwest

Hydrograph type	= SCS Runoff	Peak discharge	= 6.241 cfs
Storm frequency	= 2 yrs	Time to peak	= 718 min
Time interval	= 2 min	Hyd. volume	= 14,759 cuft
Drainage area	= 1.600 ac	Curve number	= 91*
Basin Slope	= 0.0 %	Hydraulic length	= 0 ft
Tc method	= TR55	Time of conc. (Tc)	= 6.60 min
Total precip.	= 3.50 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

* Composite (Area/CN) = [(1.120 x 98) + (0.480 x 74)] / 1.600

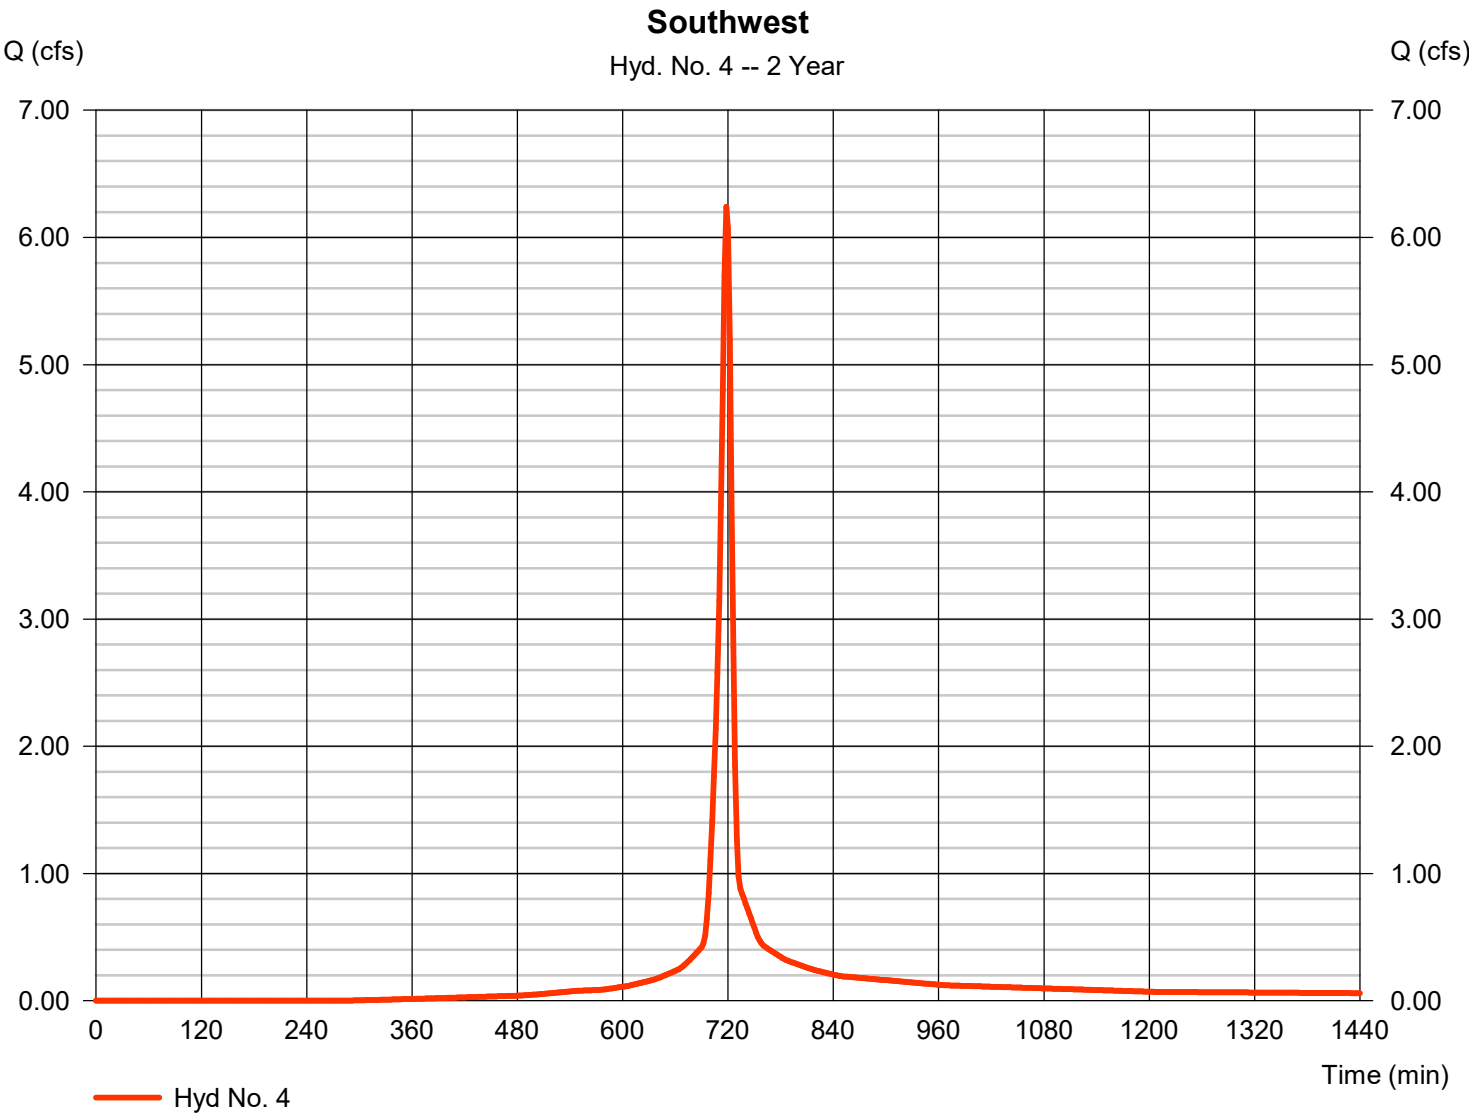

TR55 Tc Worksheet

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Hyd. No. 4

Southwest

<u>Description</u>	<u>A</u>	<u>B</u>	<u>C</u>	<u>Totals</u>			
Sheet Flow							
Manning's n-value	= 0.240	0.011	0.011				
Flow length (ft)	= 25.0	0.0	0.0				
Two-year 24-hr precip. (in)	= 3.50	0.00	0.00				
Land slope (%)	= 2.00	0.00	0.00				
Travel Time (min)	= 4.50	+	0.00	+	0.00	=	4.50
Shallow Concentrated Flow							
Flow length (ft)	= 75.00	0.00	0.00				
Watercourse slope (%)	= 3.00	0.00	0.00				
Surface description	= Paved	Paved	Paved				
Average velocity (ft/s)	=3.52	0.00	0.00				
Travel Time (min)	= 0.36	+	0.00	+	0.00	=	0.36
Channel Flow							
X sectional flow area (sqft)	= 3.14	0.00	0.00				
Wetted perimeter (ft)	= 6.30	0.00	0.00				
Channel slope (%)	= 1.50	0.00	0.00				
Manning's n-value	= 0.015	0.015	0.025				
Velocity (ft/s)	=7.63	0.00	0.00				
Flow length (ft)	(0}800.0	0.0	0.0				
Travel Time (min)	= 1.75	+	0.00	+	0.00	=	1.75
Total Travel Time, Tc				6.60 min			

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 5

West

Hydrograph type	=	SCS Runoff	Peak discharge	=	9.666 cfs
Storm frequency	=	2 yrs	Time to peak	=	720 min
Time interval	=	2 min	Hyd. volume	=	25,136 cuft
Drainage area	=	3.200 ac	Curve number	=	86*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	12.40 min
Total precip.	=	3.50 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(1.650 x 98) + (1.550 x 74)] / 3.200

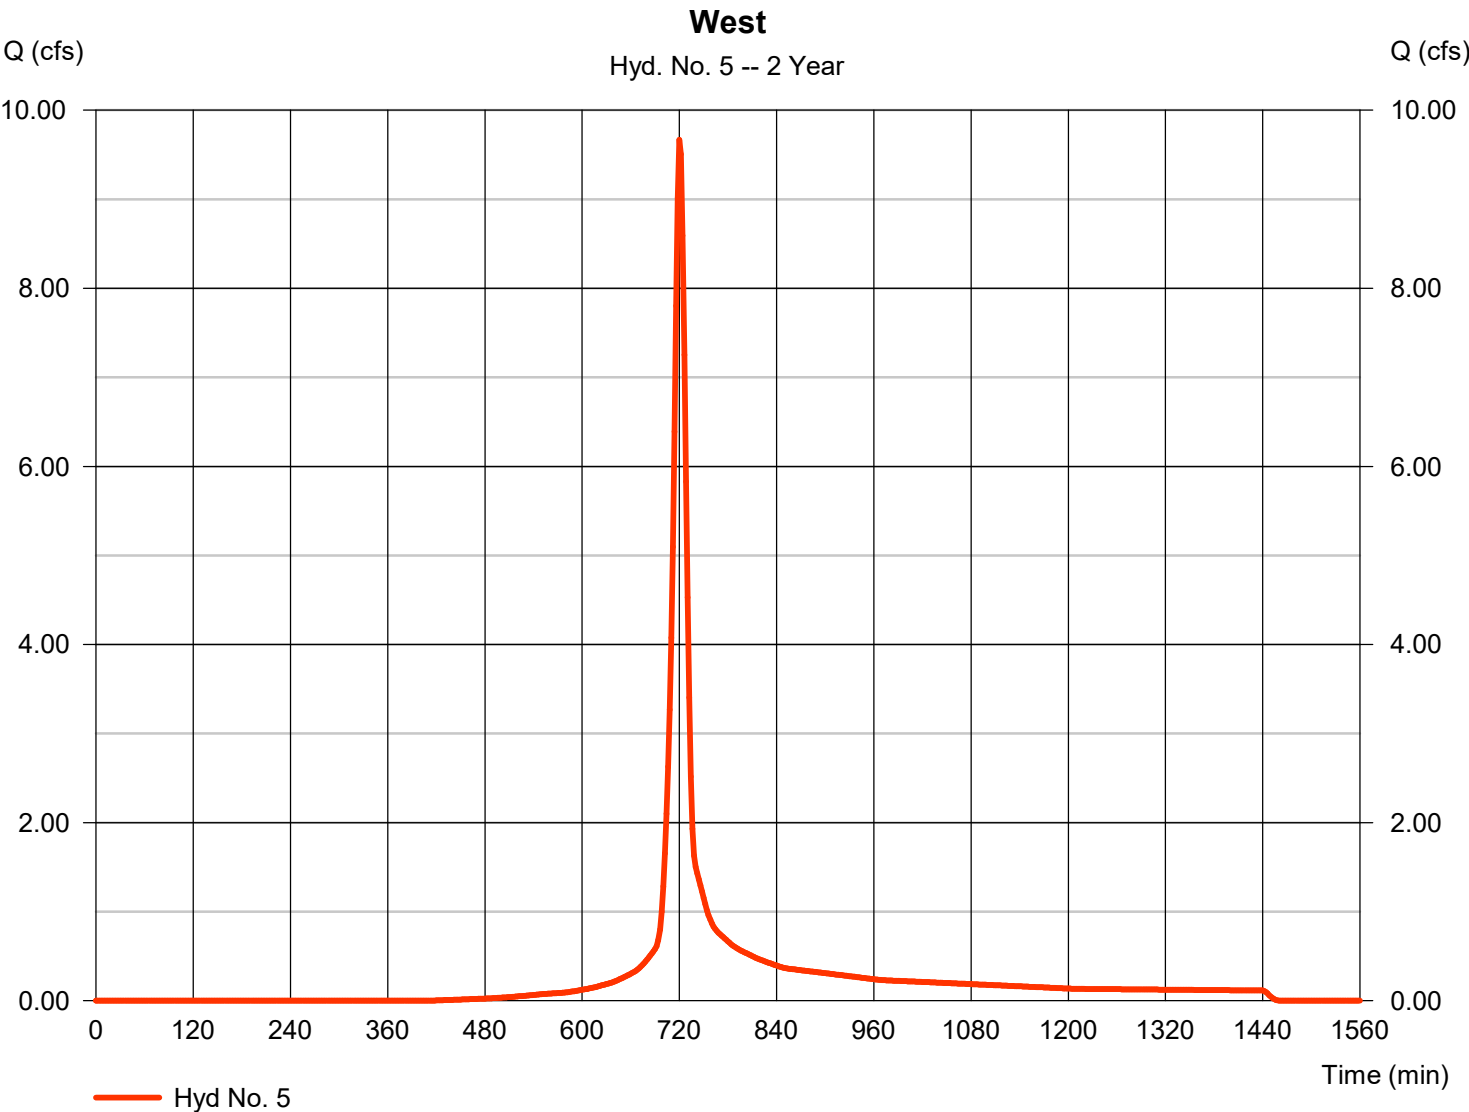

TR55 Tc Worksheet

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Hyd. No. 5

West

<u>Description</u>	<u>A</u>	<u>B</u>	<u>C</u>	<u>Totals</u>
Sheet Flow				
Manning's n-value	= 0.240	0.011	0.011	
Flow length (ft)	= 75.0	0.0	0.0	
Two-year 24-hr precip. (in)	= 3.50	0.00	0.00	
Land slope (%)	= 2.00	0.00	0.00	
Travel Time (min)	= 10.84	+	0.00	+
			0.00	= 10.84
Shallow Concentrated Flow				
Flow length (ft)	= 75.00	0.00	0.00	
Watercourse slope (%)	= 2.00	0.00	0.00	
Surface description	= Unpaved	Unpaved	Unpaved	
Average velocity (ft/s)	=2.28	0.00	0.00	
Travel Time (min)	= 0.55	+	0.00	+
			0.00	= 0.55
Channel Flow				
X sectional flow area (sqft)	= 1.52	4.21	0.00	
Wetted perimeter (ft)	= 3.32	5.54	0.00	
Channel slope (%)	= 2.00	1.00	0.00	
Manning's n-value	= 0.012	0.012	0.025	
Velocity (ft/s)	=10.39	10.33	0.00	
Flow length (ft)	({})383.0	225.0	0.0	
Travel Time (min)	= 0.61	+	0.36	+
			0.00	= 0.98
Total Travel Time, Tc				12.40 min


Hydrograph Report

Hyd. No. 6

7B (Offsite to Basin)

Hydrograph type	=	SCS Runoff	Peak discharge	=	8.054 cfs
Storm frequency	=	2 yrs	Time to peak	=	732 min
Time interval	=	2 min	Hyd. volume	=	33,757 cuft
Drainage area	=	7.500 ac	Curve number	=	74*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	28.30 min
Total precip.	=	3.50 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(7.500 x 74)] / 7.500

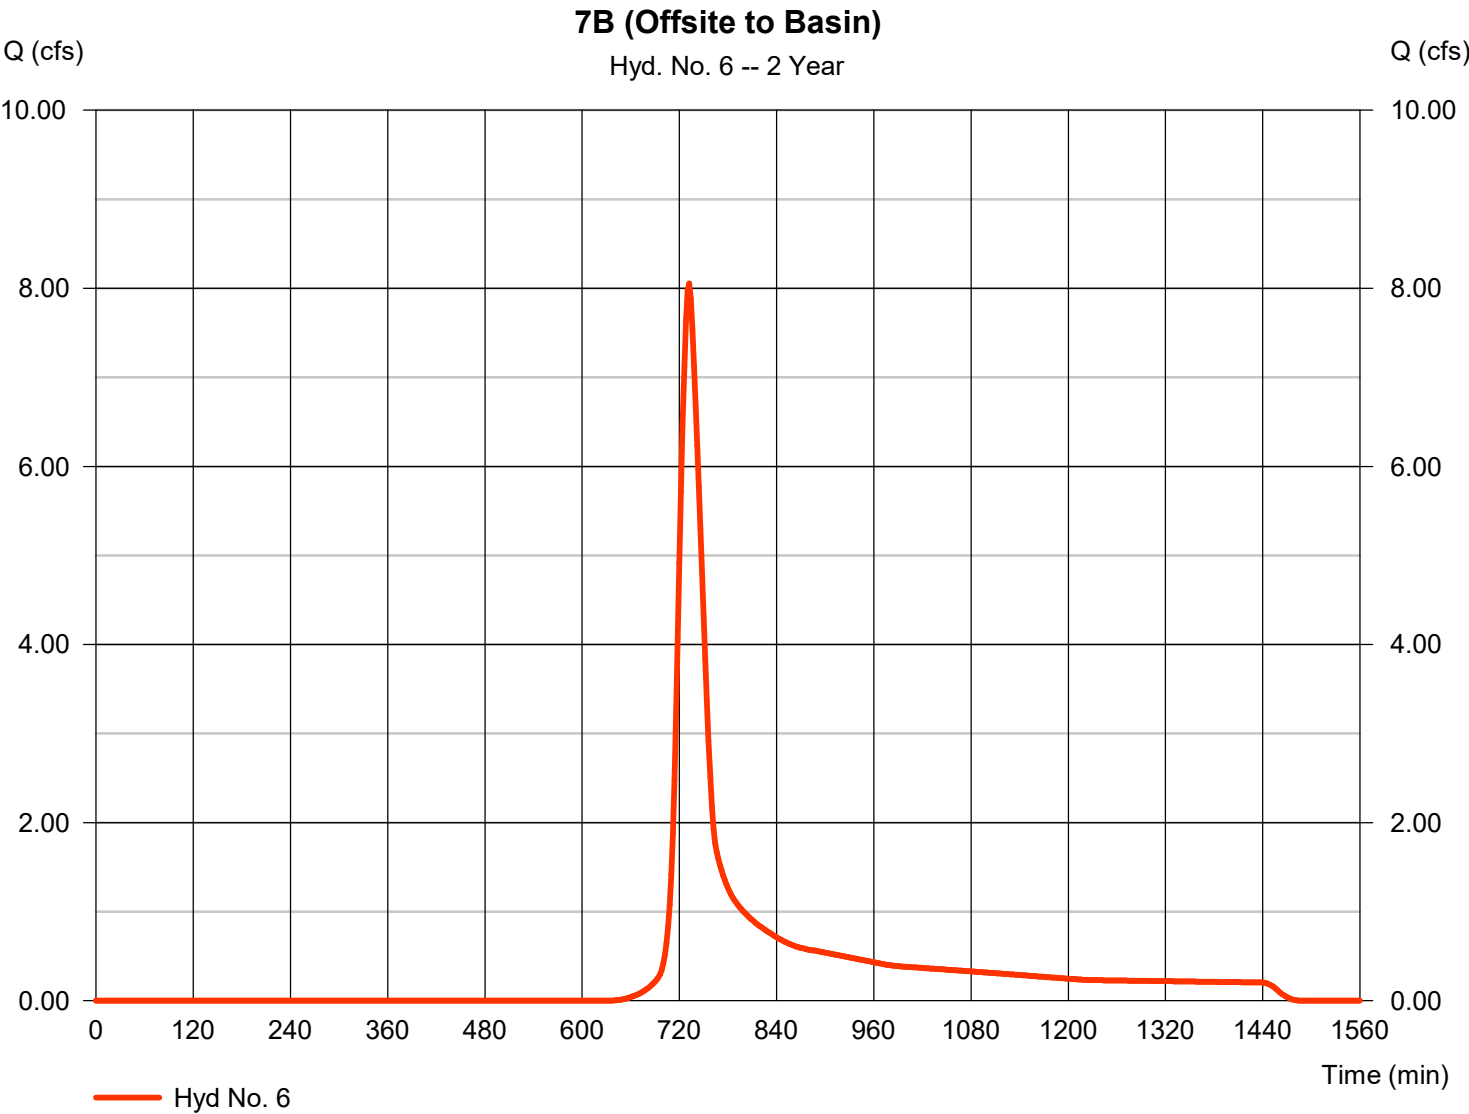

TR55 Tc Worksheet

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Hyd. No. 6

7B (Offsite to Basin)

<u>Description</u>	<u>A</u>	<u>B</u>	<u>C</u>	<u>Totals</u>			
Sheet Flow							
Manning's n-value	= 0.240	0.011	0.011				
Flow length (ft)	= 100.0	0.0	0.0				
Two-year 24-hr precip. (in)	= 3.10	0.00	0.00				
Land slope (%)	= 2.00	0.00	0.00				
Travel Time (min)	= 14.50	+	0.00	+	0.00	=	14.50
Shallow Concentrated Flow							
Flow length (ft)	= 850.00	0.00	0.00				
Watercourse slope (%)	= 2.00	5.00	1.00				
Surface description	= Unpaved	Unpaved	Unpaved				
Average velocity (ft/s)	=2.28	3.61	1.61				
Travel Time (min)	= 6.21	+	0.00	+	0.00	=	6.21
Channel Flow							
X sectional flow area (sqft)	= 2.00	5.00	0.00				
Wetted perimeter (ft)	= 12.00	31.00	0.00				
Channel slope (%)	= 0.50	2.00	0.00				
Manning's n-value	= 0.015	0.015	0.025				
Velocity (ft/s)	=2.11	4.14	0.00				
Flow length (ft)	({0})850.0	216.0	0.0				
Travel Time (min)	= 6.70	+	0.87	+	0.00	=	7.57
Total Travel Time, Tc				28.30 min			

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 7

Lot 5 (Wilshire Phase III)

Hydrograph type	=	SCS Runoff	Peak discharge	=	5.142 cfs
Storm frequency	=	2 yrs	Time to peak	=	726 min
Time interval	=	2 min	Hyd. volume	=	17,754 cuft
Drainage area	=	2.290 ac	Curve number	=	86*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	20.60 min
Total precip.	=	3.50 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(1.180 x 98) + (1.110 x 74)] / 2.290

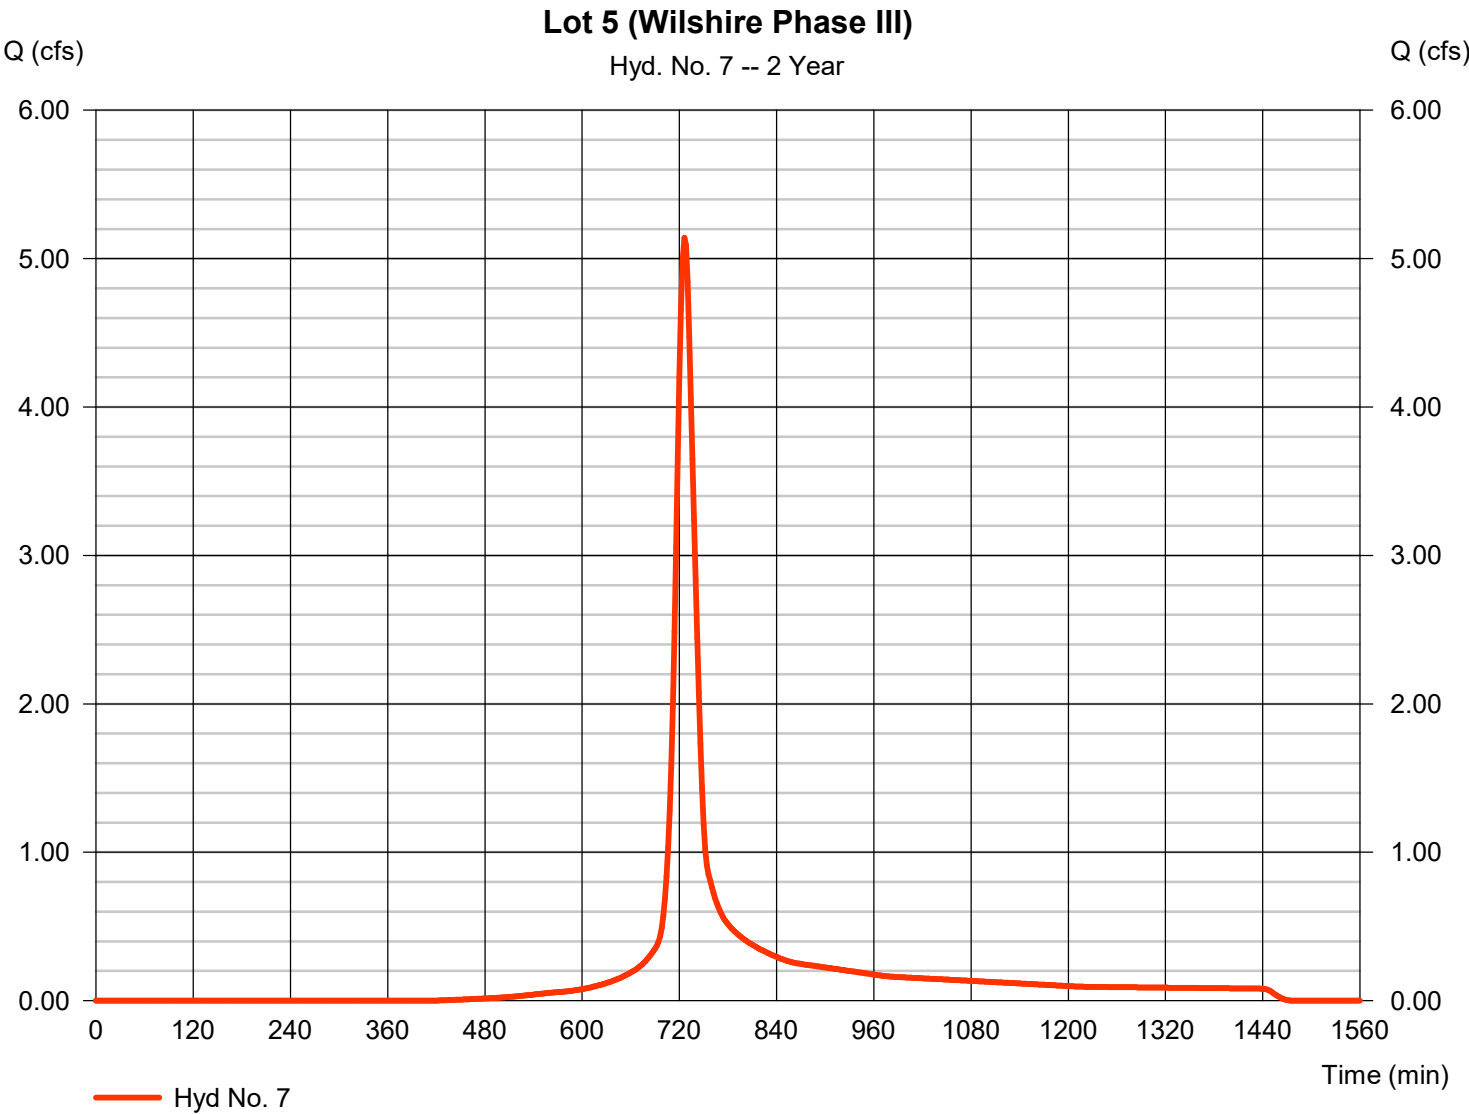

TR55 Tc Worksheet

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Hyd. No. 7

Lot 5 (Wilshire Phase III)

<u>Description</u>	<u>A</u>	<u>B</u>	<u>C</u>	<u>Totals</u>			
Sheet Flow							
Manning's n-value	= 0.240	0.011	0.011				
Flow length (ft)	= 100.0	0.0	0.0				
Two-year 24-hr precip. (in)	= 3.10	0.00	0.00				
Land slope (%)	= 1.50	0.00	0.00				
Travel Time (min)	= 16.27	+	0.00	+	0.00	=	16.27
Shallow Concentrated Flow							
Flow length (ft)	= 155.00	0.00	0.00				
Watercourse slope (%)	= 1.50	0.00	0.00				
Surface description	= Unpaved	Unpaved	Paved				
Average velocity (ft/s)	=1.98	0.00	0.00				
Travel Time (min)	= 1.31	+	0.00	+	0.00	=	1.31
Channel Flow							
X sectional flow area (sqft)	= 5.00	0.00	0.00				
Wetted perimeter (ft)	= 31.00	0.00	0.00				
Channel slope (%)	= 1.50	0.00	0.00				
Manning's n-value	= 0.015	0.015	0.015				
Velocity (ft/s)	=3.58	0.00	0.00				
Flow length (ft)	(0)650.0	0.0	0.0				
Travel Time (min)	= 3.02	+	0.00	+	0.00	=	3.02
Total Travel Time, Tc				20.60 min			

Onsite Water

Peak discharge = 62.25 cfs
Time to peak = 720 min
Hyd. volume = 189,123 cuft
Contrib. drain. area = 26.230 ac

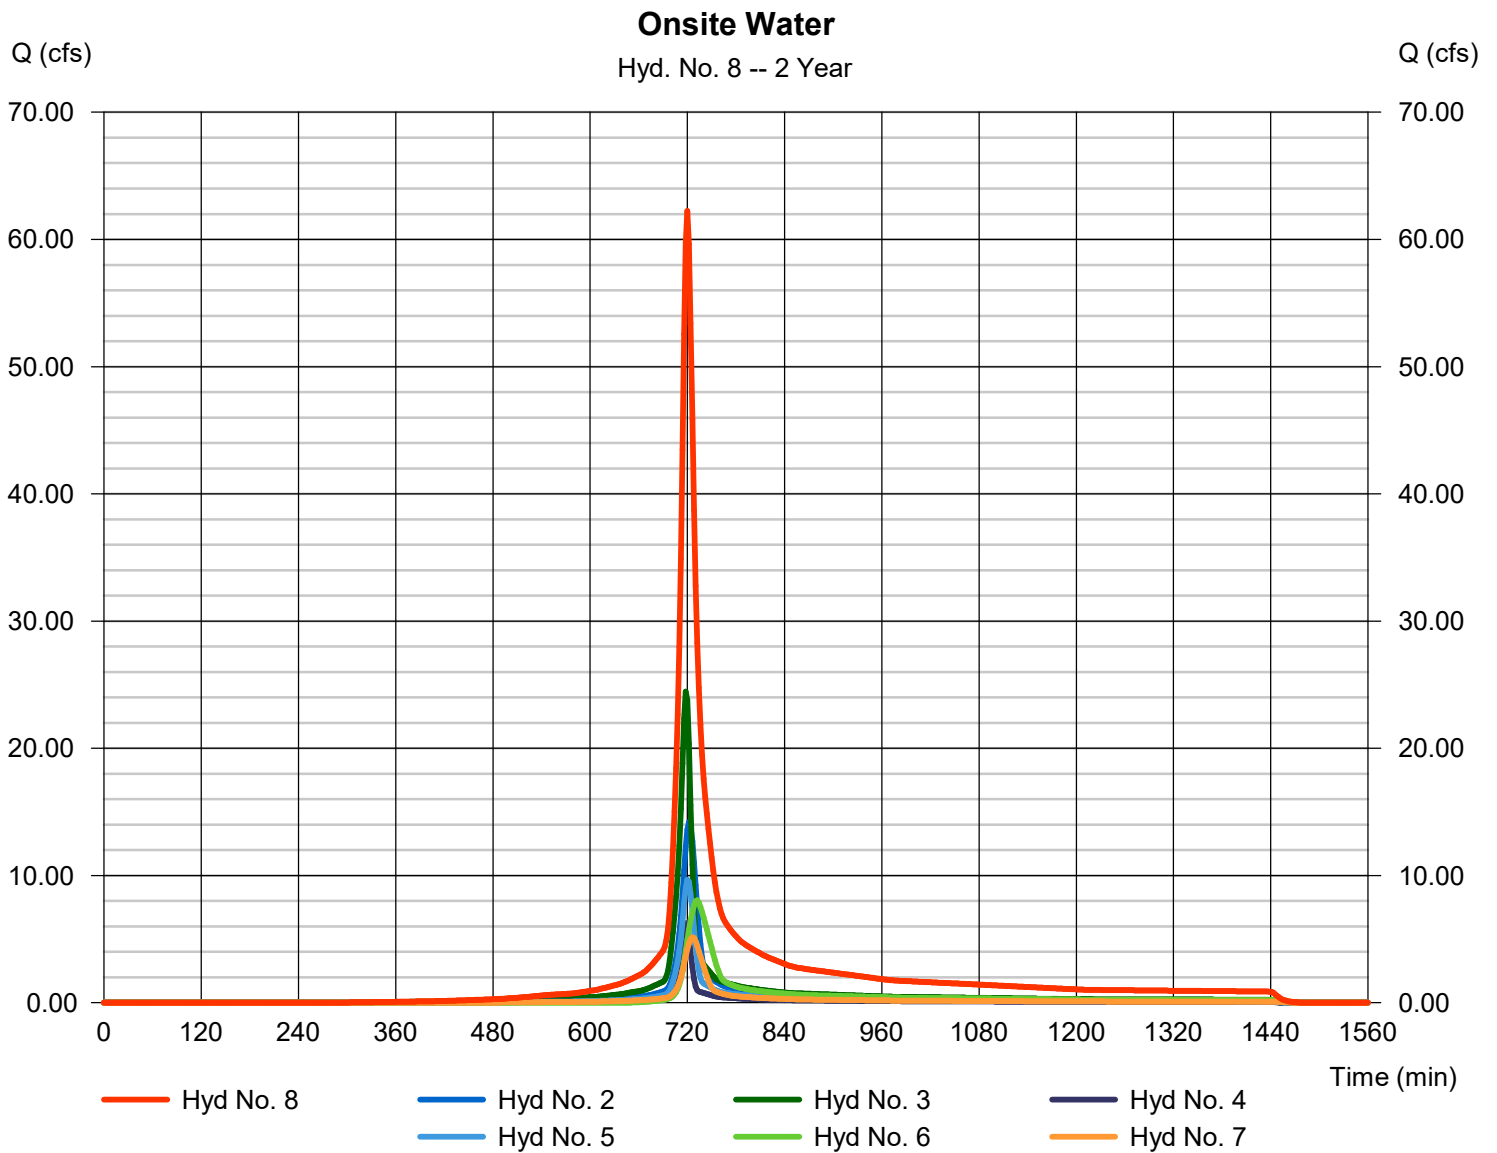


Hydrograph Report

Hyd. No. 9

Water Quality Basin

Hydrograph type	= Reservoir	Peak discharge	= 16.23 cfs
Storm frequency	= 2 yrs	Time to peak	= 742 min
Time interval	= 2 min	Hyd. volume	= 189,109 cuft
Inflow hyd. No.	= 8 - Onsite Water	Max. Elevation	= 917.14 ft
Reservoir name	= Basin	Max. Storage	= 81,770 cuft

Storage Indication method used.

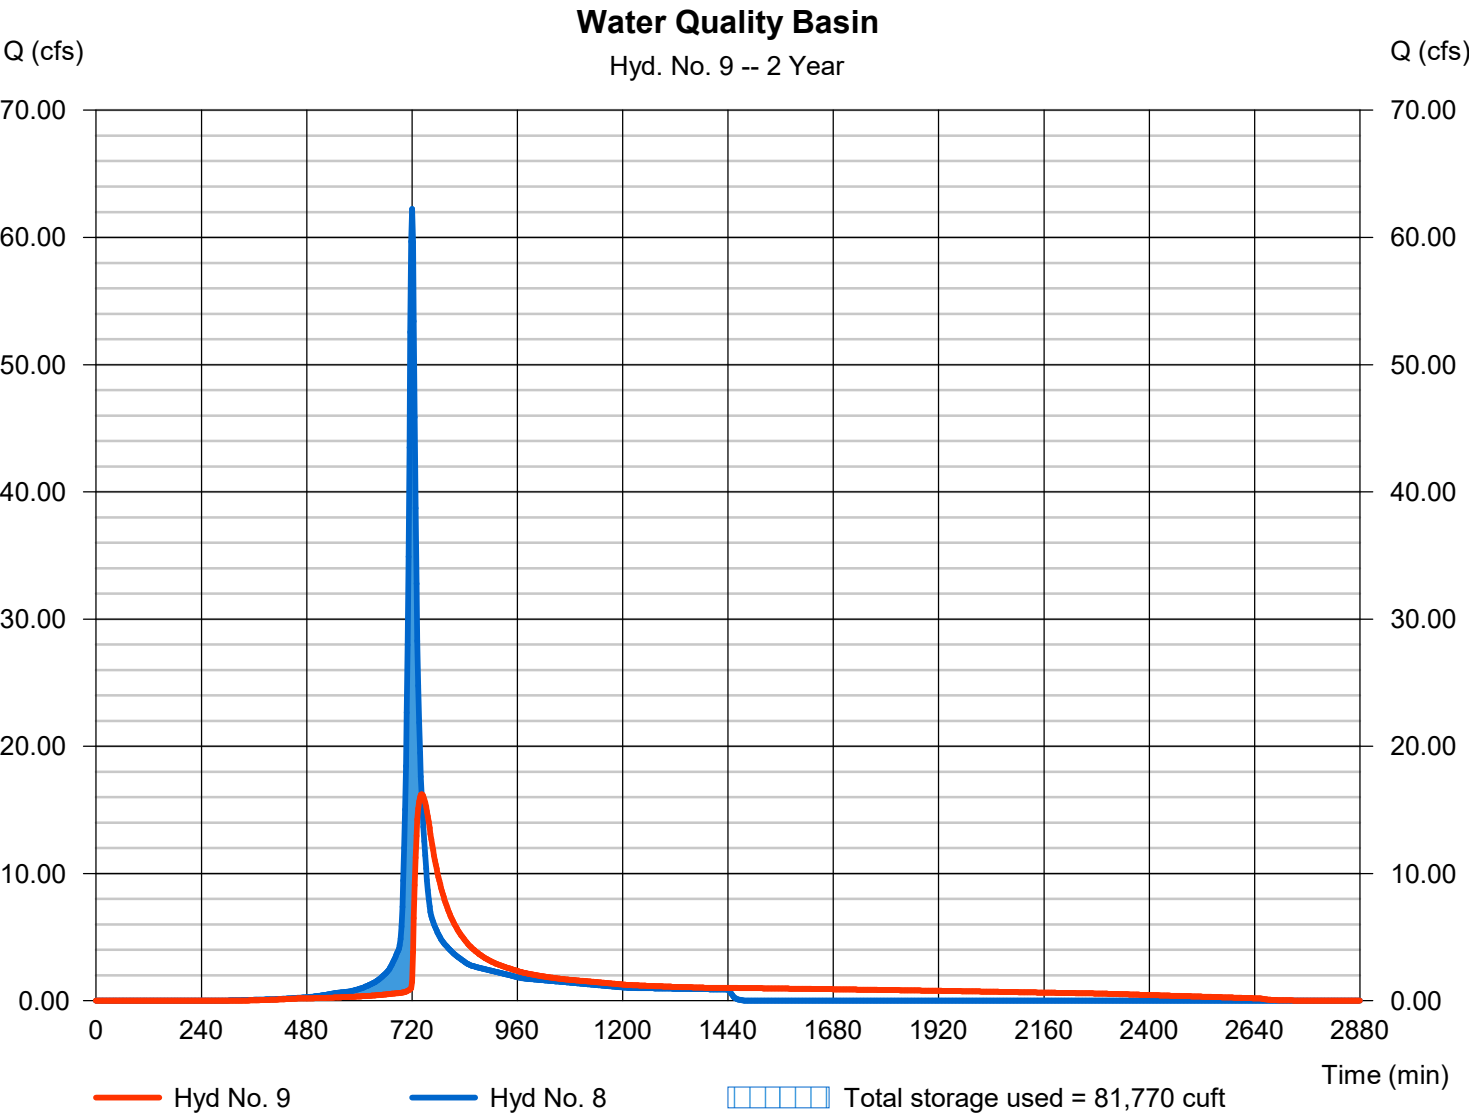

Pond No. 2 - Basin

Pond Data

Contours -User-defined contour areas. Average end area method used for volume calculation. Beginning Elevation = 911.70 ft

Stage / Storage Table

Stage (ft)	Elevation (ft)	Contour area (sqft)	Incr. Storage (cuft)	Total storage (cuft)
0.00	911.70	00	0	0
0.30	912.00	2,386	358	358
1.30	913.00	13,639	8,012	8,370
2.30	914.00	15,509	14,574	22,944
3.30	915.00	17,465	16,487	39,431
4.30	916.00	19,505	18,485	57,916
5.30	917.00	21,926	20,716	78,632
6.30	918.00	23,832	22,879	101,511
7.30	919.00	26,575	25,204	126,714
8.30	920.00	29,956	28,266	154,980
9.30	921.00	31,503	30,730	185,709
10.30	922.00	33,676	32,590	218,299


Culvert / Orifice Structures

	[A]	[B]	[C]	[PrfRsr]
Rise (in)	= 42.00	4.50	Inactive	0.00
Span (in)	= 42.00	4.50	0.00	0.00
No. Barrels	= 1	1	1	0
Invert El. (ft)	= 911.50	911.70	0.00	0.00
Length (ft)	= 47.30	0.00	0.00	0.00
Slope (%)	= 0.20	0.00	0.00	n/a
N-Value	= .013	.013	.013	n/a
Orifice Coeff.	= 0.60	0.60	0.60	0.60
Multi-Stage	= n/a	Yes	Yes	No

Weir Structures

	[A]	[B]	[C]	[D]
Crest Len (ft)	= 25.00	2.20	0.00	0.00
Crest El. (ft)	= 920.96	915.50	0.00	0.00
Weir Coeff.	= 3.33	3.33	3.33	3.33
Weir Type	= 1	Rect	---	---
Multi-Stage	= Yes	Yes	No	No
Exfil.(in/hr)	= 0.000 (by Wet area)			
TW Elev. (ft)	= 0.00			

Note: Culvert/Orifice outflows are analyzed under inlet (ic) and outlet (oc) control. Weir risers checked for orifice conditions (ic) and submergence (s).

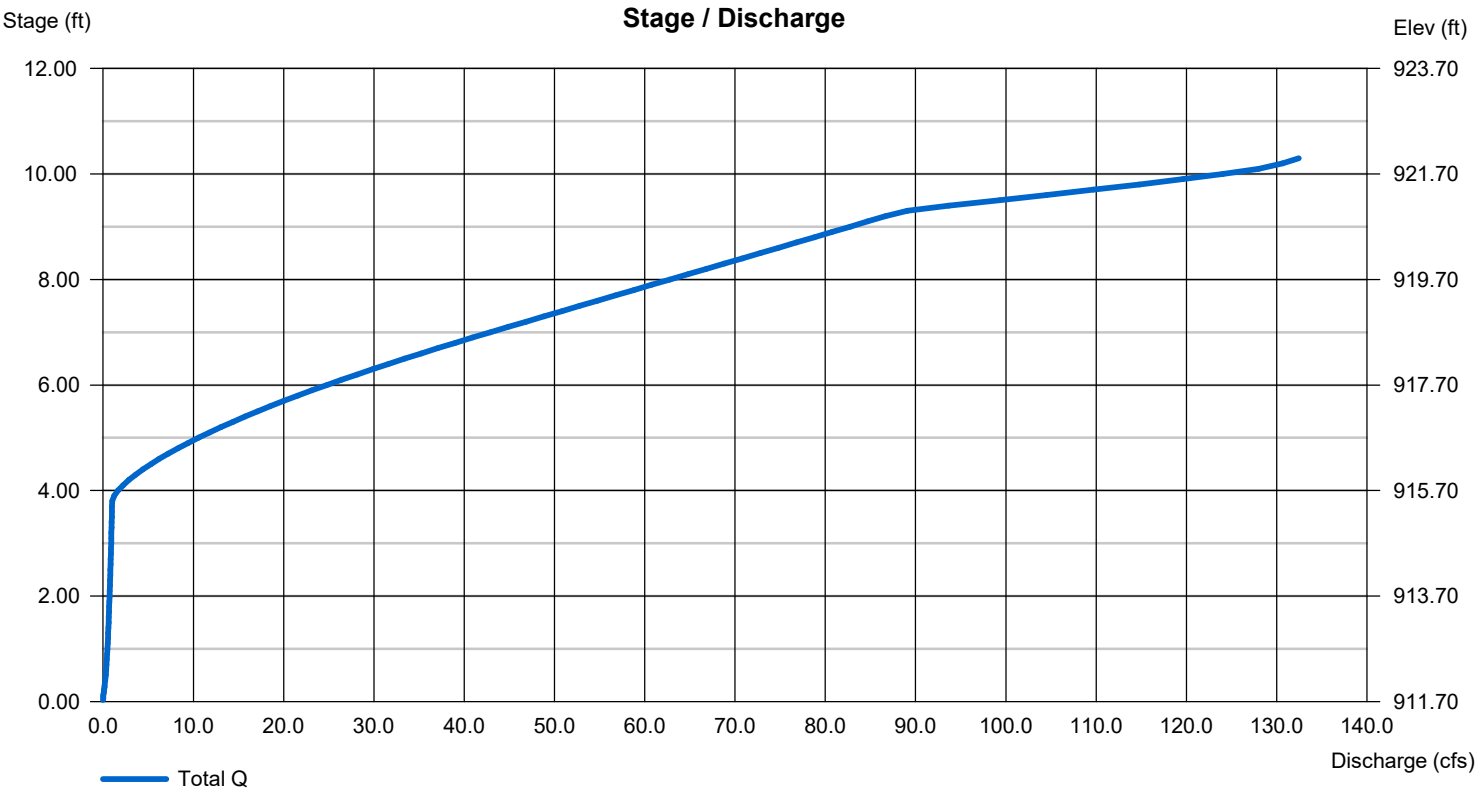

Hydrograph Summary Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description
1	SCS Runoff	0.592	2	734	2,575	-----	-----	-----	Bypass
2	SCS Runoff	24.92	2	722	71,232	-----	-----	-----	Northeast
3	SCS Runoff	39.93	2	718	97,271	-----	-----	-----	southeast
4	SCS Runoff	10.19	2	718	24,822	-----	-----	-----	Southwest
5	SCS Runoff	16.96	2	720	44,896	-----	-----	-----	West
6	SCS Runoff	17.60	2	730	70,943	-----	-----	-----	7B (Offsite to Basin)
7	SCS Runoff	9.081	2	726	31,711	-----	-----	-----	Lot 5 (Wilshire Phase III)
8	Combine	108.85	2	720	340,876	2, 3, 4, 5, 6, 7	-----	-----	Onsite Water
9	Reservoir	48.60	2	732	340,861	8	918.99	126,409	Water Quality Basin

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 1

Bypass

Hydrograph type	=	SCS Runoff	Peak discharge	=	0.592 cfs
Storm frequency	=	10 yrs	Time to peak	=	734 min
Time interval	=	2 min	Hyd. volume	=	2,575 cuft
Drainage area	=	0.260 ac	Curve number	=	75*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	30.70 min
Total precip.	=	5.30 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(0.010 x 98) + (0.240 x 74)] / 0.260

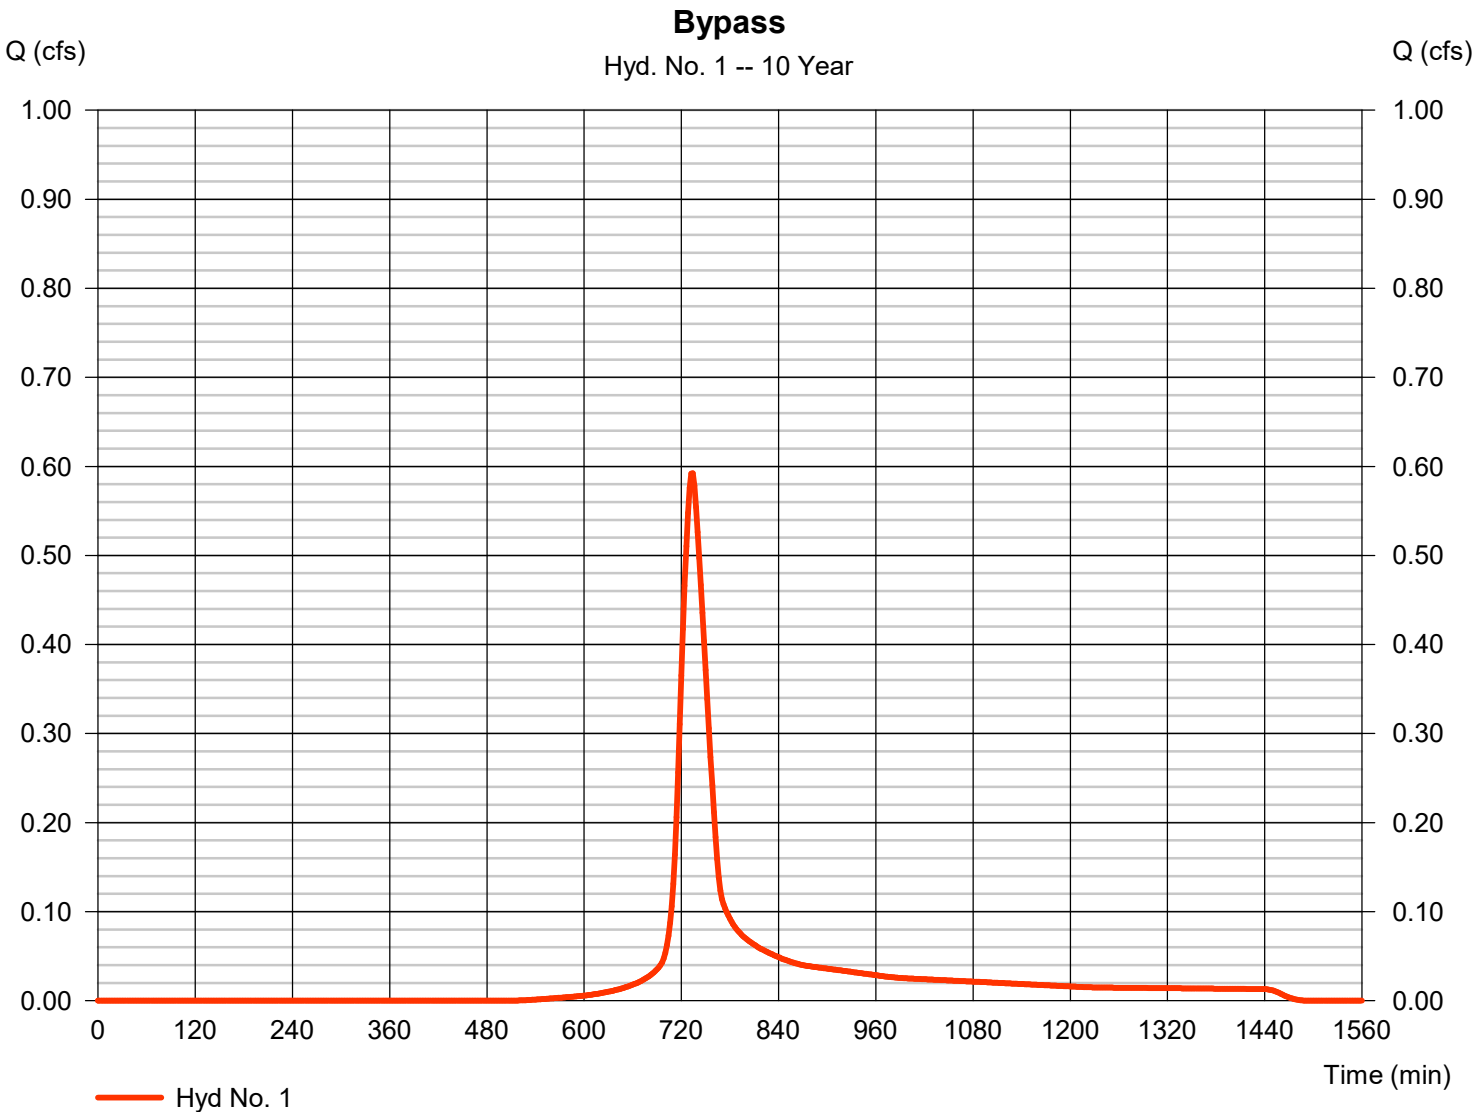

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 2

Northeast

Hydrograph type	=	SCS Runoff	Peak discharge	=	24.92 cfs
Storm frequency	=	10 yrs	Time to peak	=	722 min
Time interval	=	2 min	Hyd. volume	=	71,232 cuft
Drainage area	=	5.370 ac	Curve number	=	86*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	15.30 min
Total precip.	=	5.30 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(2.700 x 98) + (2.670 x 74)] / 5.370

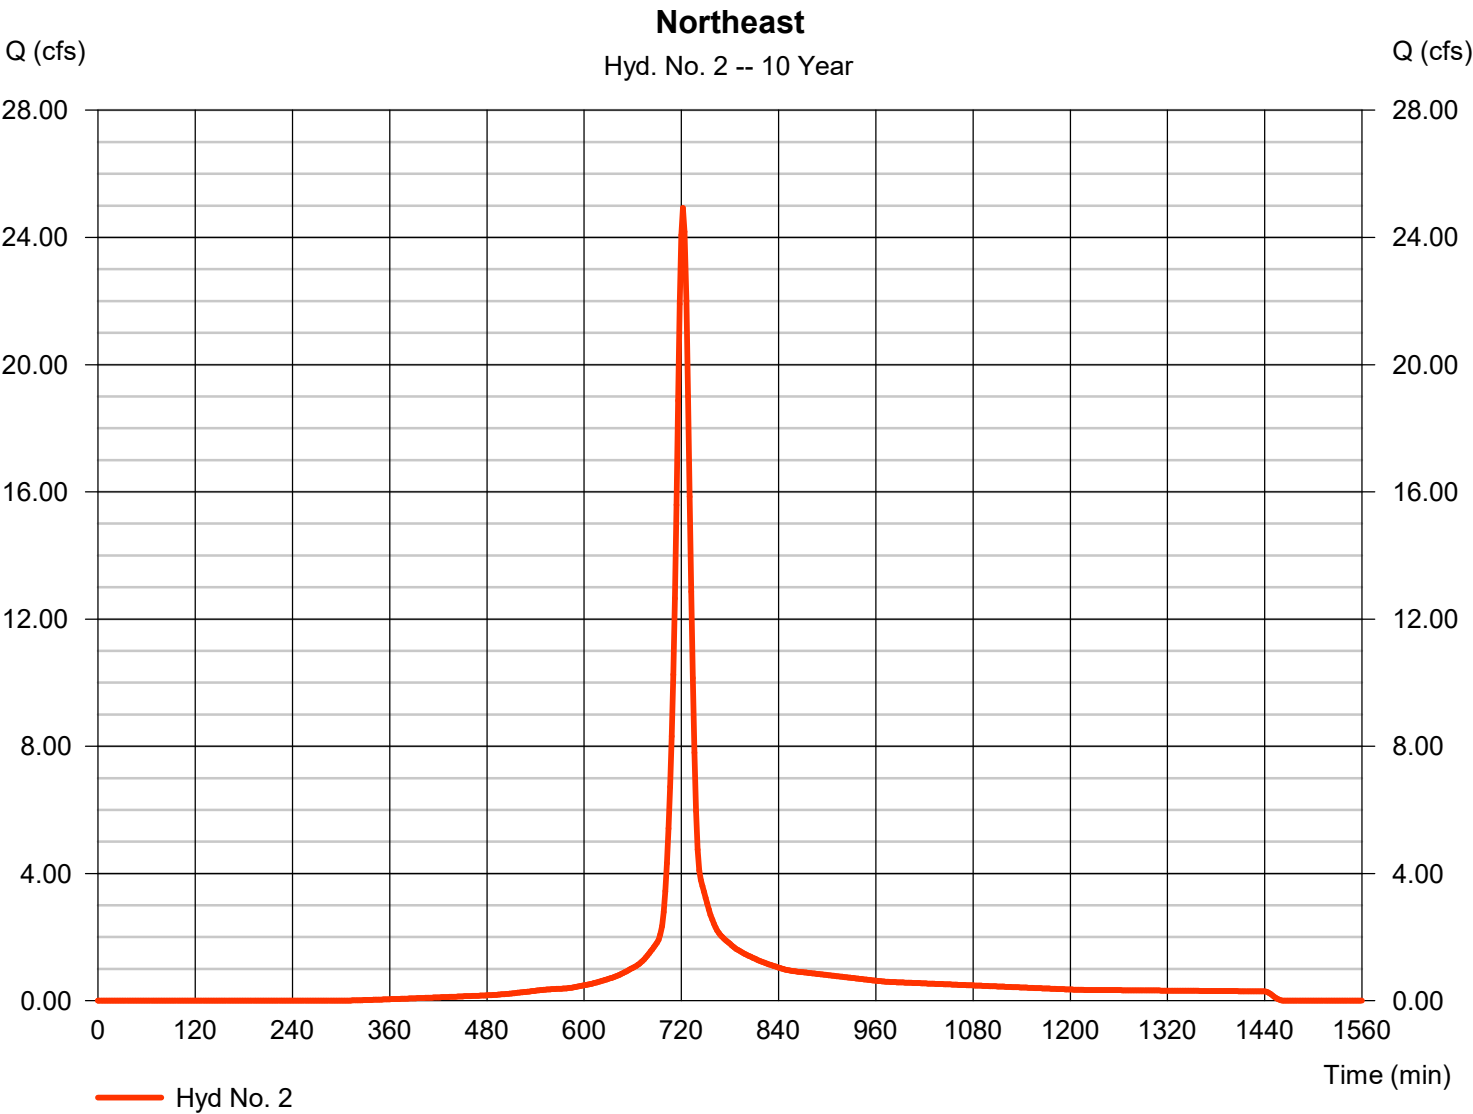

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 3

southeast

Hydrograph type	=	SCS Runoff	Peak discharge	=	39.93 cfs
Storm frequency	=	10 yrs	Time to peak	=	718 min
Time interval	=	2 min	Hyd. volume	=	97,271 cuft
Drainage area	=	6.270 ac	Curve number	=	91*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	7.10 min
Total precip.	=	5.30 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(4.570 x 98) + (1.700 x 74)] / 6.270

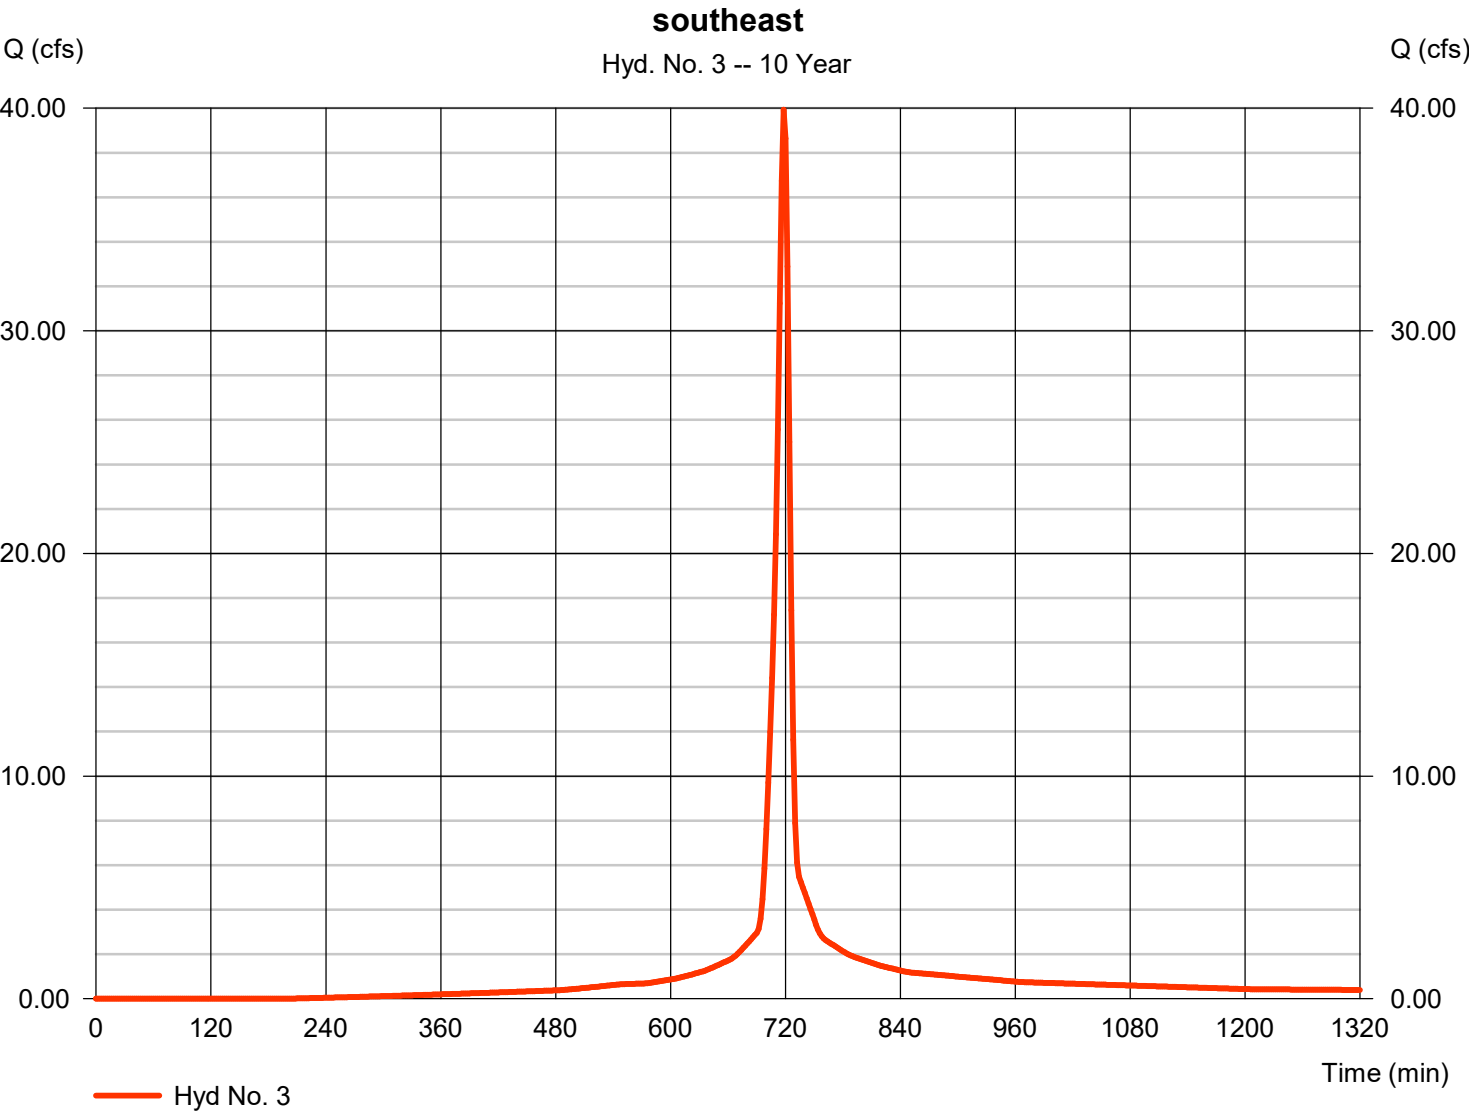


Hydrograph Report

Hyd. No. 4

Southwest

Hydrograph type	=	SCS Runoff	Peak discharge	=	10.19 cfs
Storm frequency	=	10 yrs	Time to peak	=	718 min
Time interval	=	2 min	Hyd. volume	=	24,822 cuft
Drainage area	=	1.600 ac	Curve number	=	91*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	6.60 min
Total precip.	=	5.30 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(1.120 x 98) + (0.480 x 74)] / 1.600

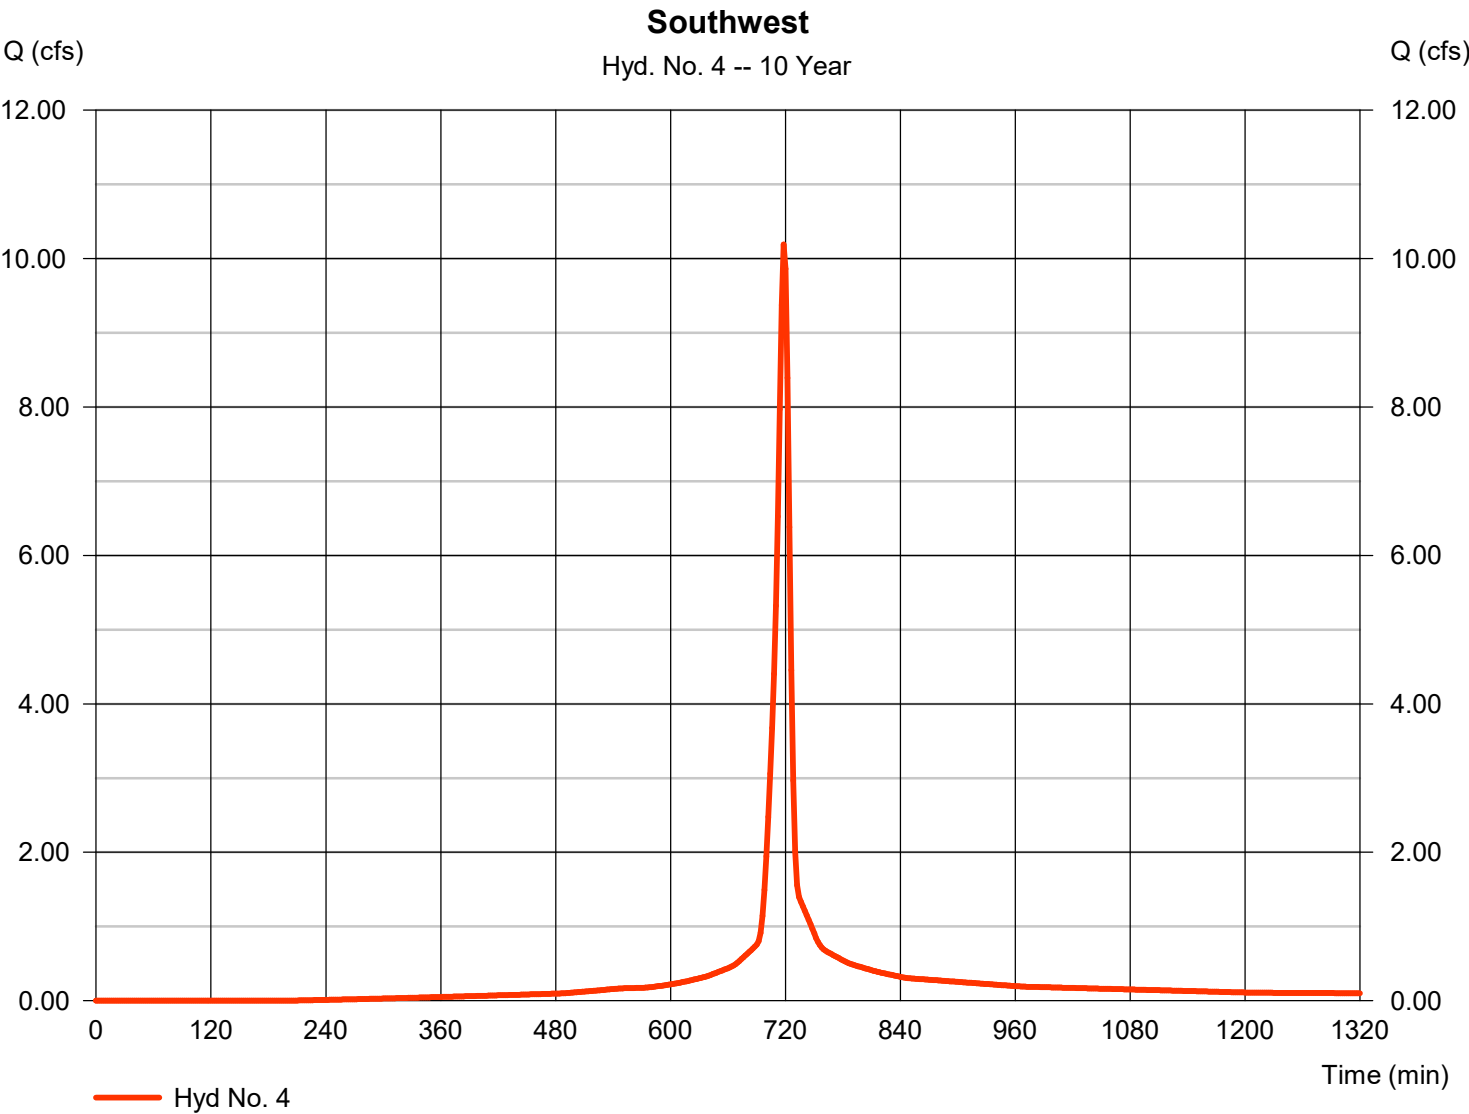

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 5

West

Hydrograph type	=	SCS Runoff	Peak discharge	=	16.96 cfs
Storm frequency	=	10 yrs	Time to peak	=	720 min
Time interval	=	2 min	Hyd. volume	=	44,896 cuft
Drainage area	=	3.200 ac	Curve number	=	86*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	12.40 min
Total precip.	=	5.30 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(1.650 x 98) + (1.550 x 74)] / 3.200

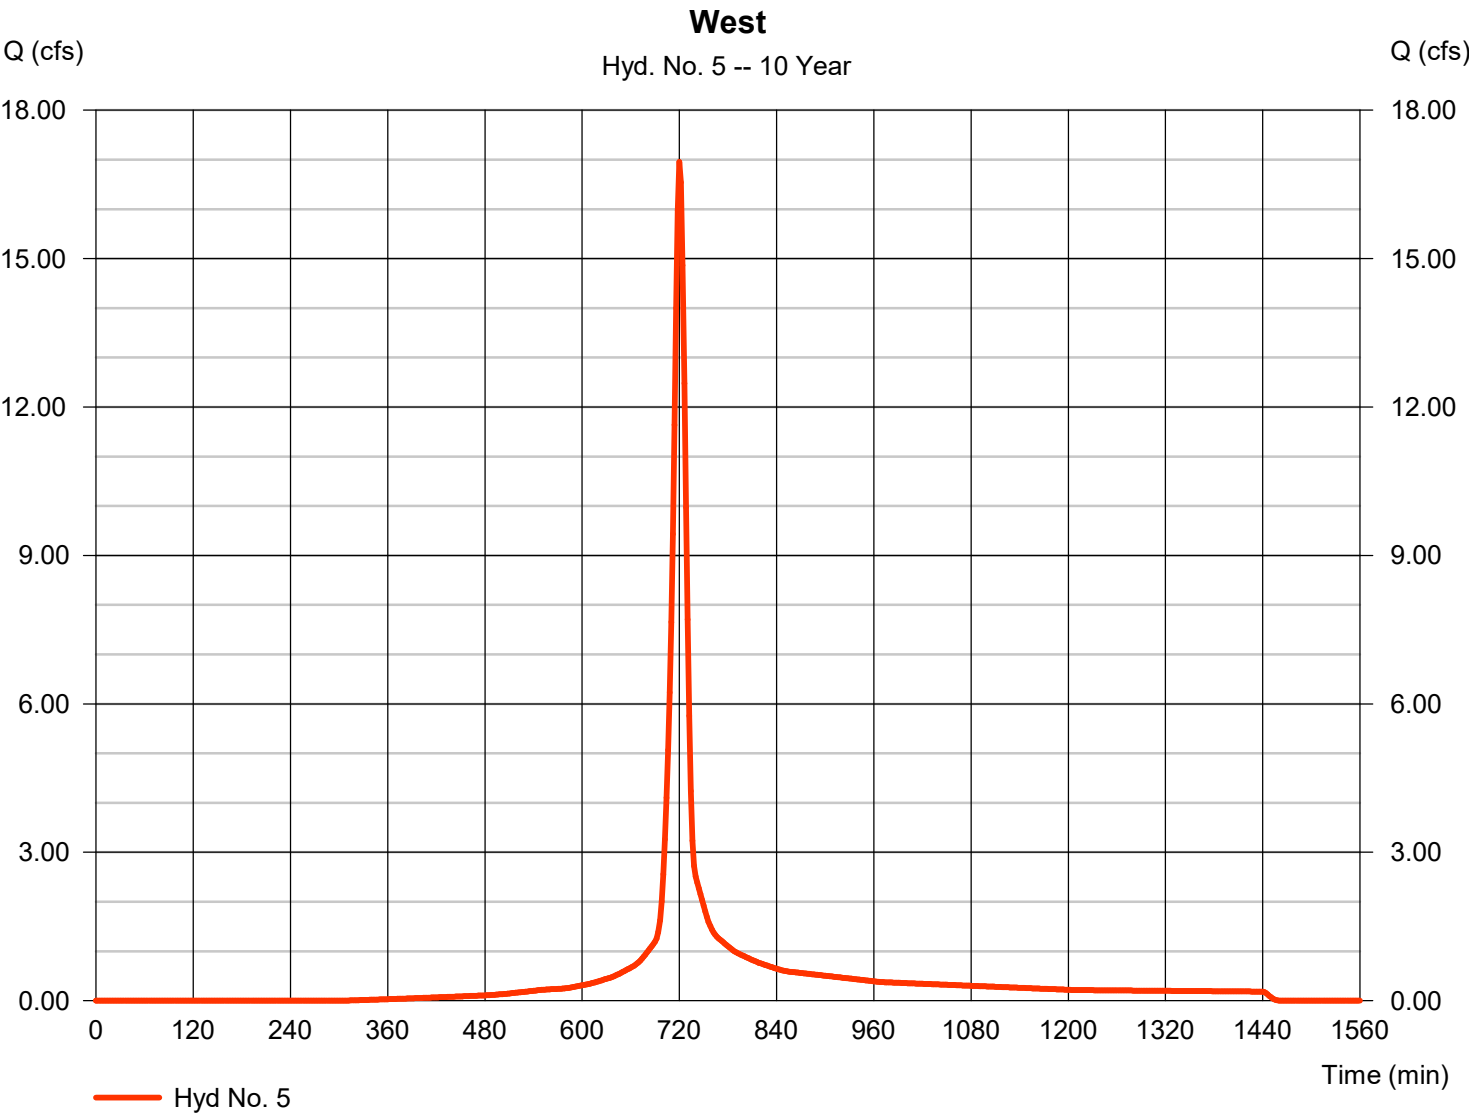

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 6

7B (Offsite to Basin)

Hydrograph type	= SCS Runoff	Peak discharge	= 17.60 cfs
Storm frequency	= 10 yrs	Time to peak	= 730 min
Time interval	= 2 min	Hyd. volume	= 70,943 cuft
Drainage area	= 7.500 ac	Curve number	= 74*
Basin Slope	= 0.0 %	Hydraulic length	= 0 ft
Tc method	= TR55	Time of conc. (Tc)	= 28.30 min
Total precip.	= 5.30 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

* Composite (Area/CN) = [(7.500 x 74)] / 7.500

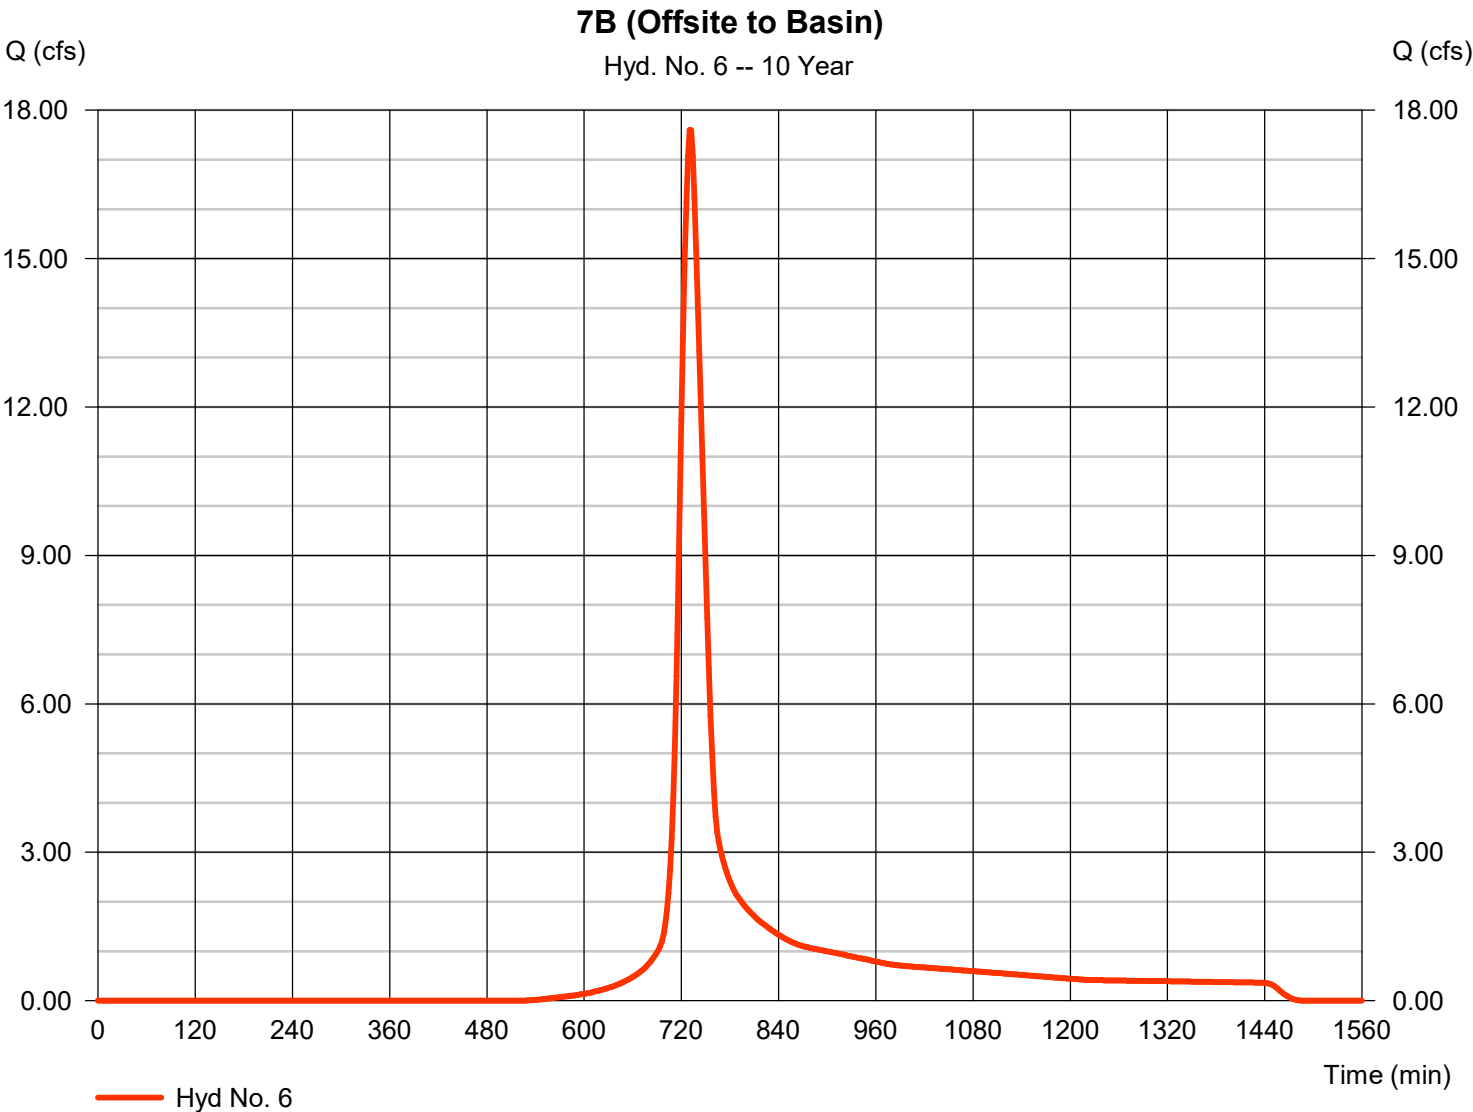


Hydrograph Report

Hyd. No. 7

Lot 5 (Wilshire Phase III)

Hydrograph type	=	SCS Runoff	Peak discharge	=	9.081 cfs
Storm frequency	=	10 yrs	Time to peak	=	726 min
Time interval	=	2 min	Hyd. volume	=	31,711 cuft
Drainage area	=	2.290 ac	Curve number	=	86*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	20.60 min
Total precip.	=	5.30 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(1.180 x 98) + (1.110 x 74)] / 2.290

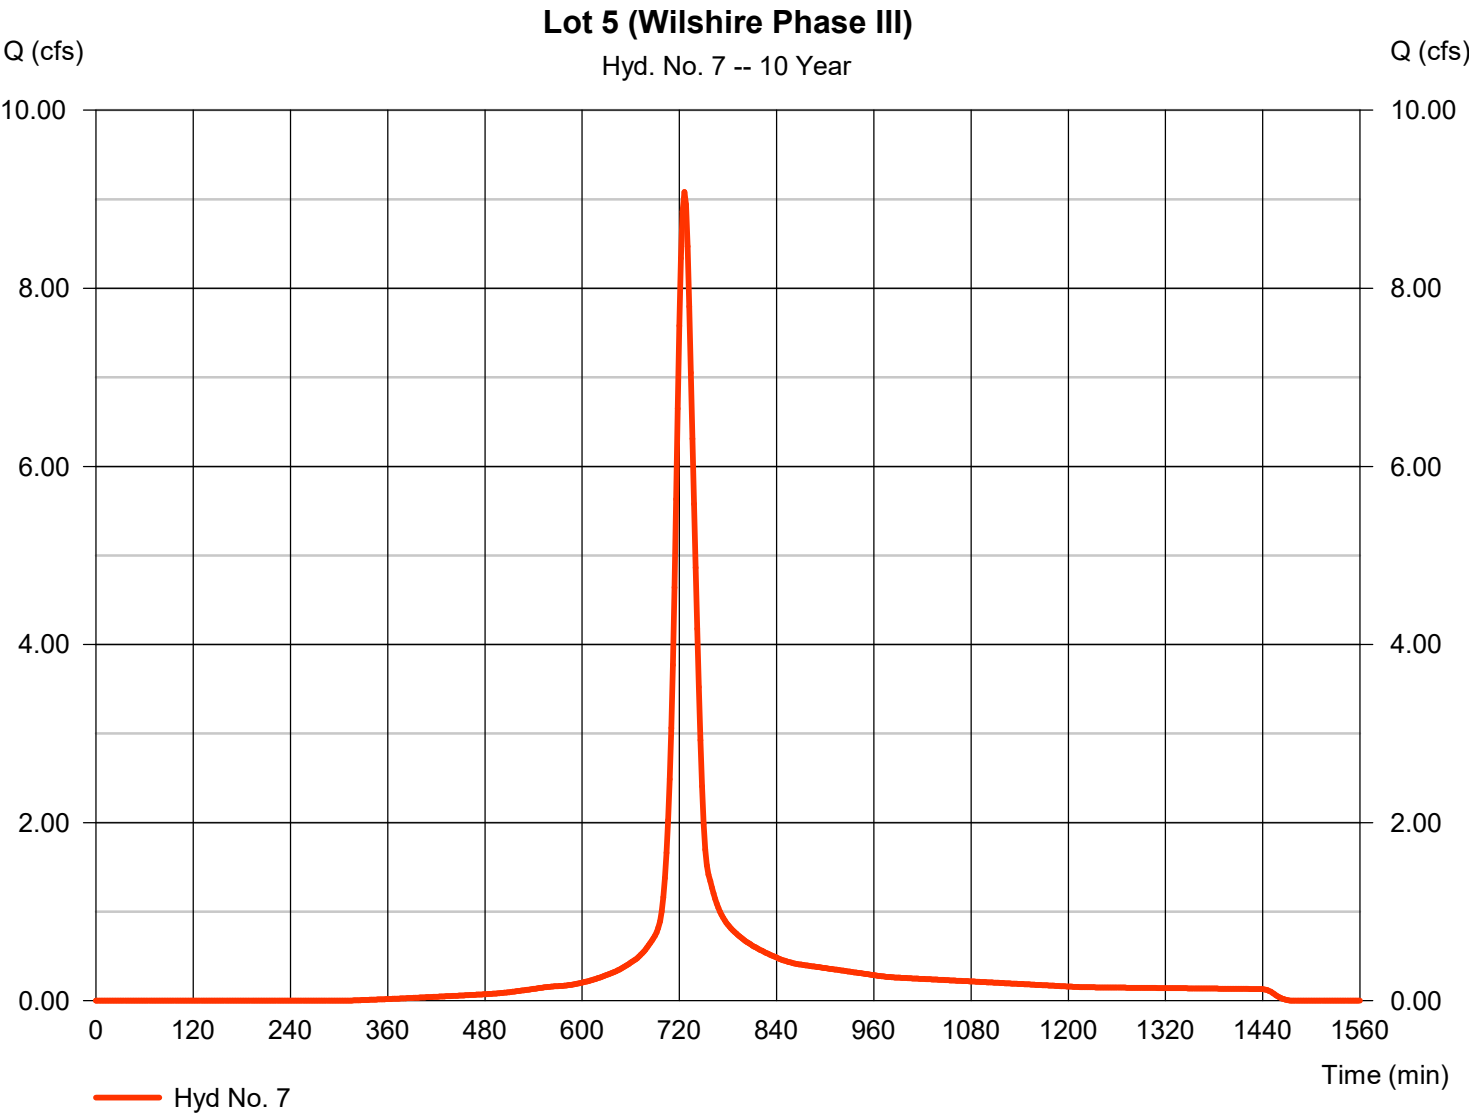

Hydrograph Report


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Thursday, 03 / 28 / 2024

Hyd. No. 8

Onsite Water

Hydrograph type	= Combine	Peak discharge	= 108.85 cfs
Storm frequency	= 10 yrs	Time to peak	= 720 min
Time interval	= 2 min	Hyd. volume	= 340,876 cuft
Inflow hyds.	= 2, 3, 4, 5, 6, 7	Contrib. drain. area	= 26.230 ac

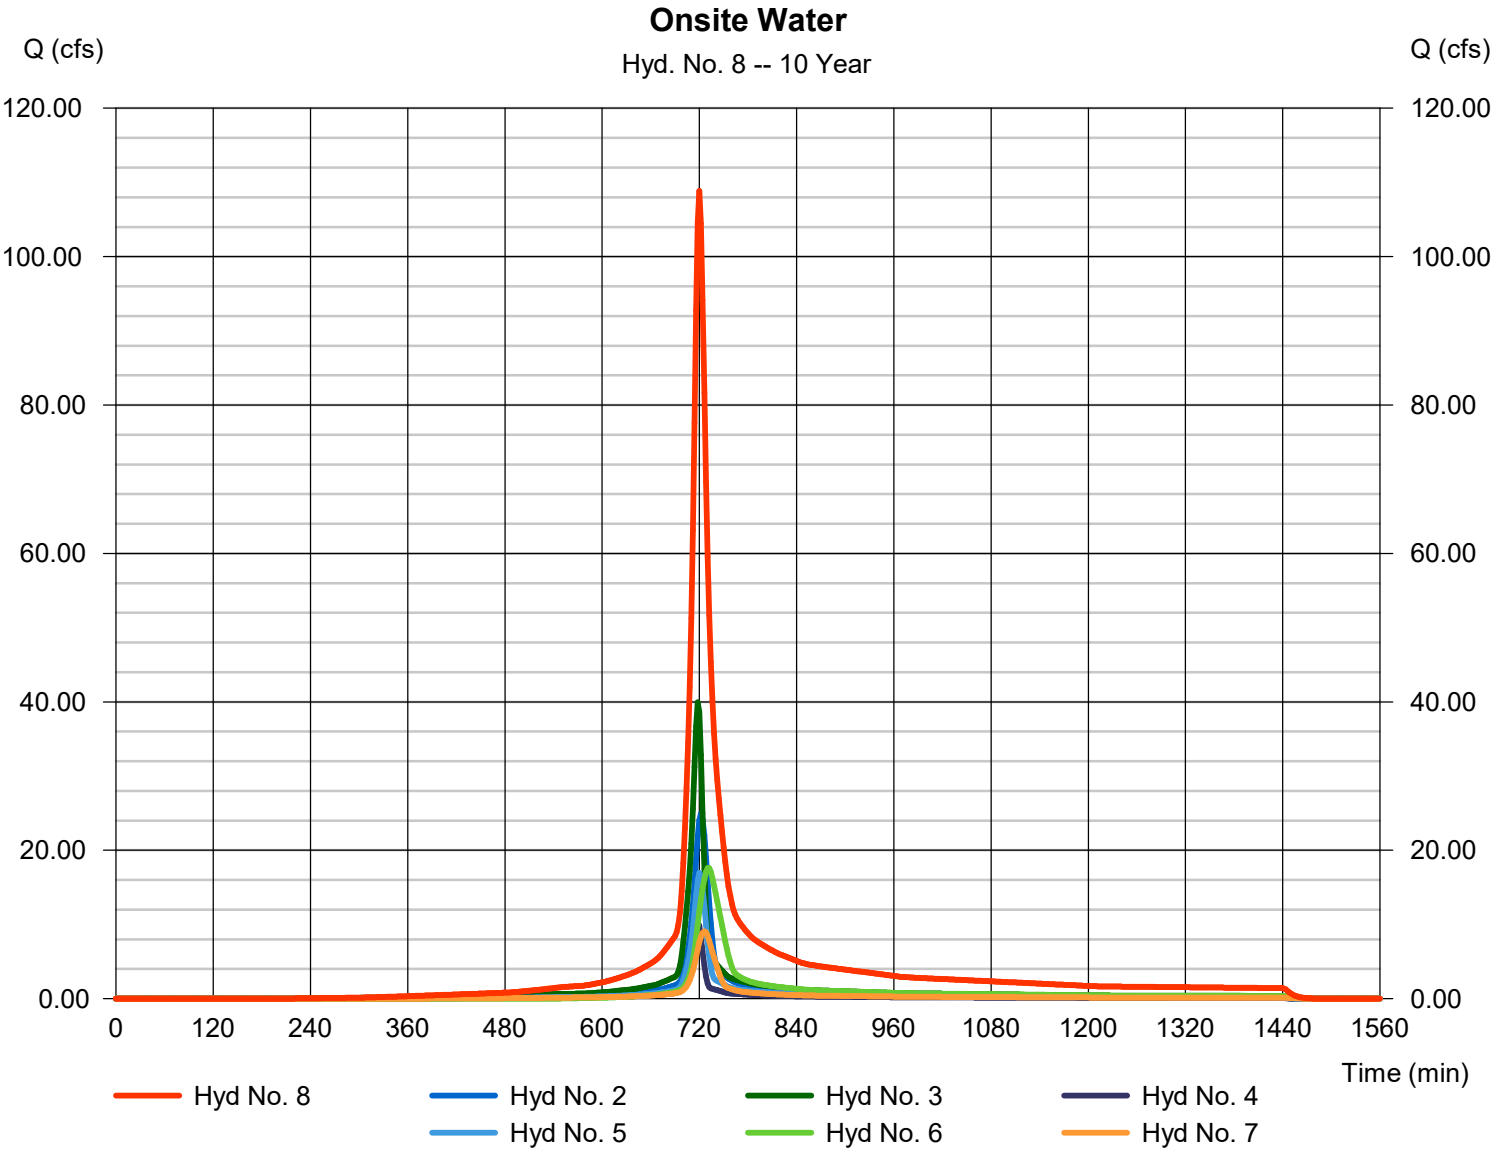

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 9

Water Quality Basin

Hydrograph type	= Reservoir	Peak discharge	= 48.60 cfs
Storm frequency	= 10 yrs	Time to peak	= 732 min
Time interval	= 2 min	Hyd. volume	= 340,861 cuft
Inflow hyd. No.	= 8 - Onsite Water	Max. Elevation	= 918.99 ft
Reservoir name	= Basin	Max. Storage	= 126,409 cuft

Storage Indication method used.

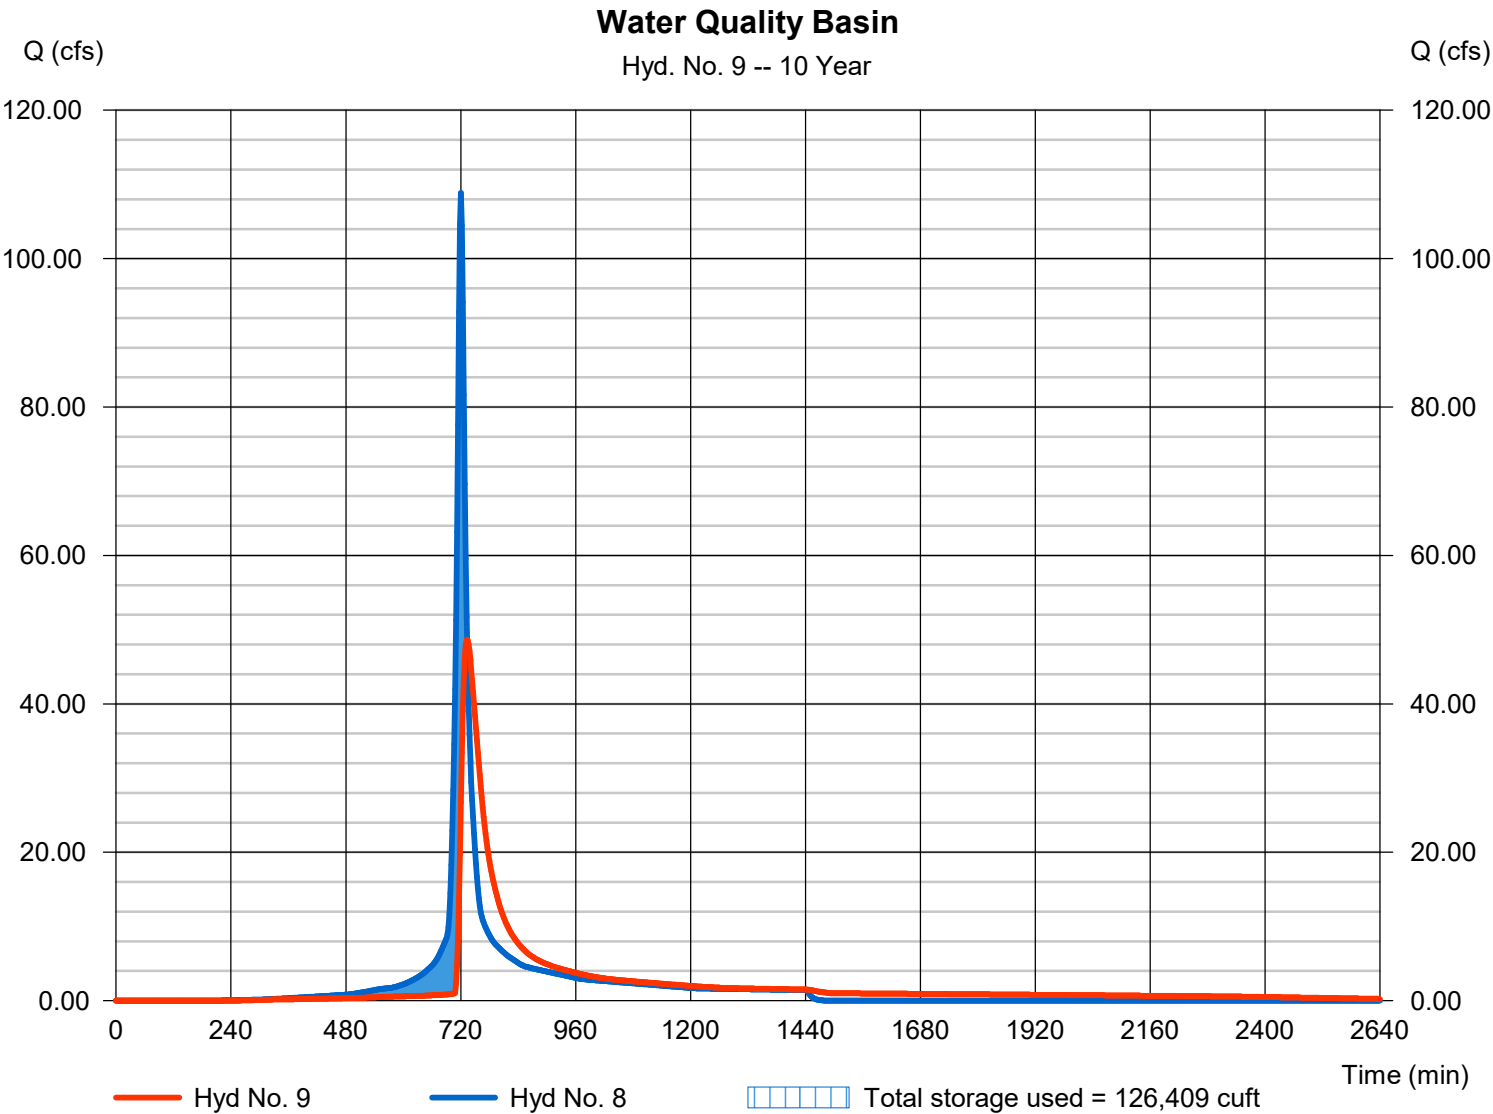

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 1

Bypass

Hydrograph type	=	SCS Runoff	Peak discharge	=	1.075 cfs
Storm frequency	=	100 yrs	Time to peak	=	732 min
Time interval	=	2 min	Hyd. volume	=	4,646 cuft
Drainage area	=	0.260 ac	Curve number	=	75*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	30.70 min
Total precip.	=	7.80 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(0.010 x 98) + (0.240 x 74)] / 0.260

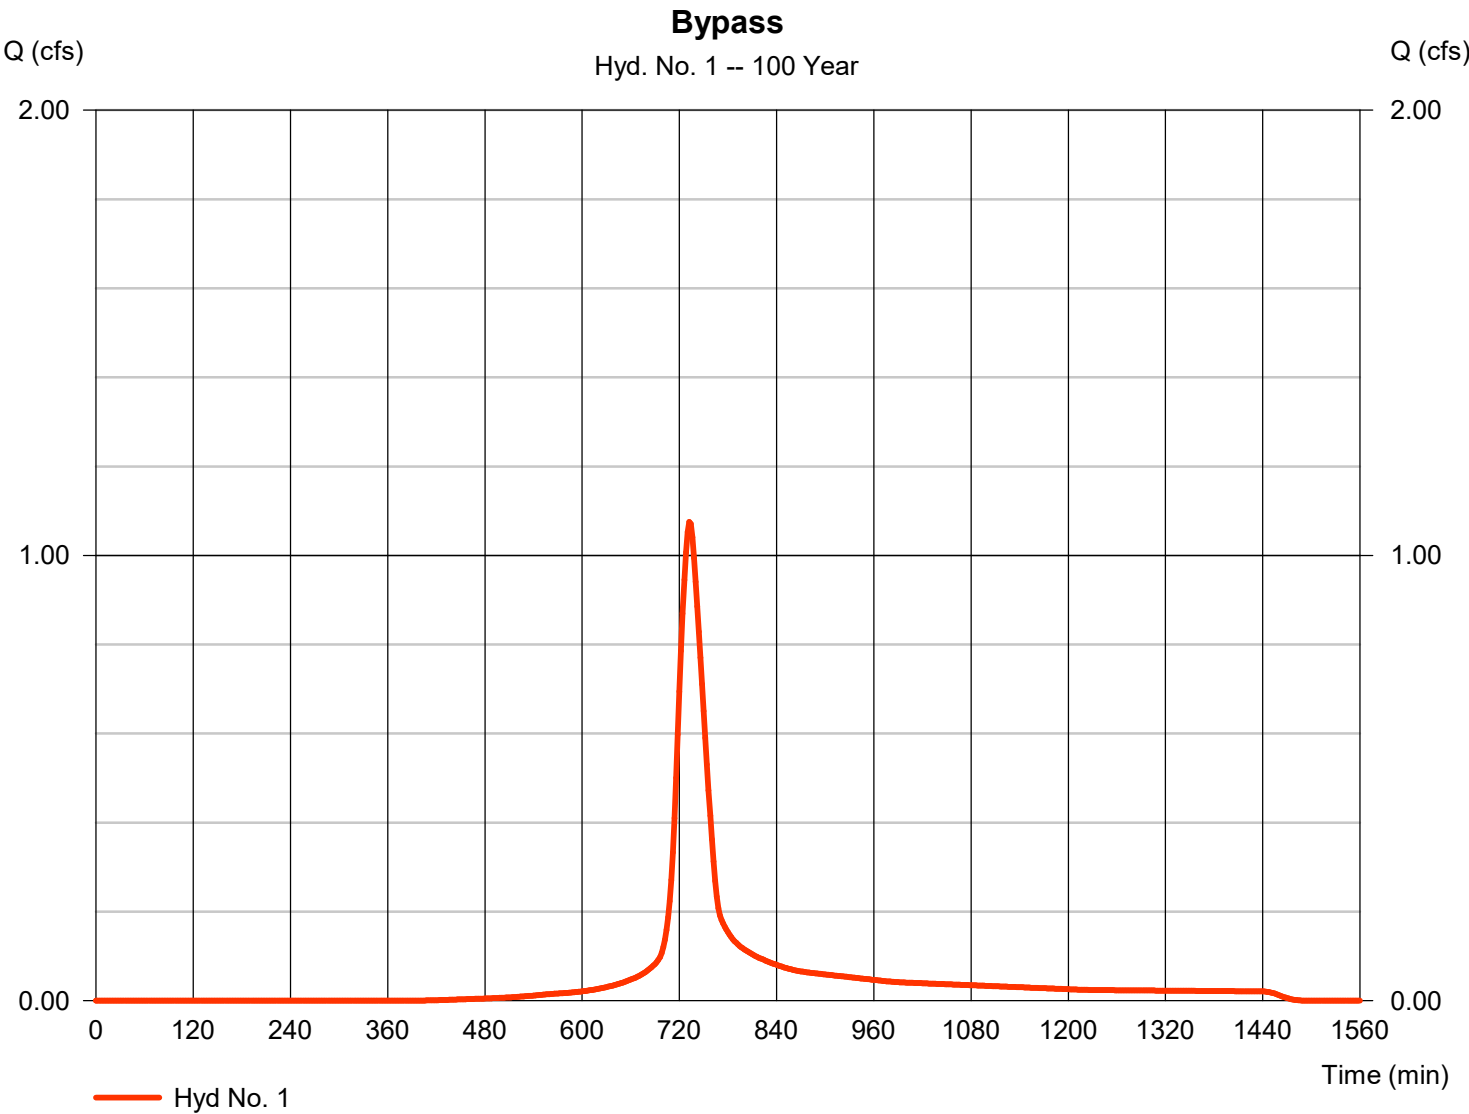


Hydrograph Report

Hyd. No. 2

Northeast

Hydrograph type	=	SCS Runoff	Peak discharge	=	39.85 cfs
Storm frequency	=	100 yrs	Time to peak	=	722 min
Time interval	=	2 min	Hyd. volume	=	116,651 cuft
Drainage area	=	5.370 ac	Curve number	=	86*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	15.30 min
Total precip.	=	7.80 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(2.700 x 98) + (2.670 x 74)] / 5.370

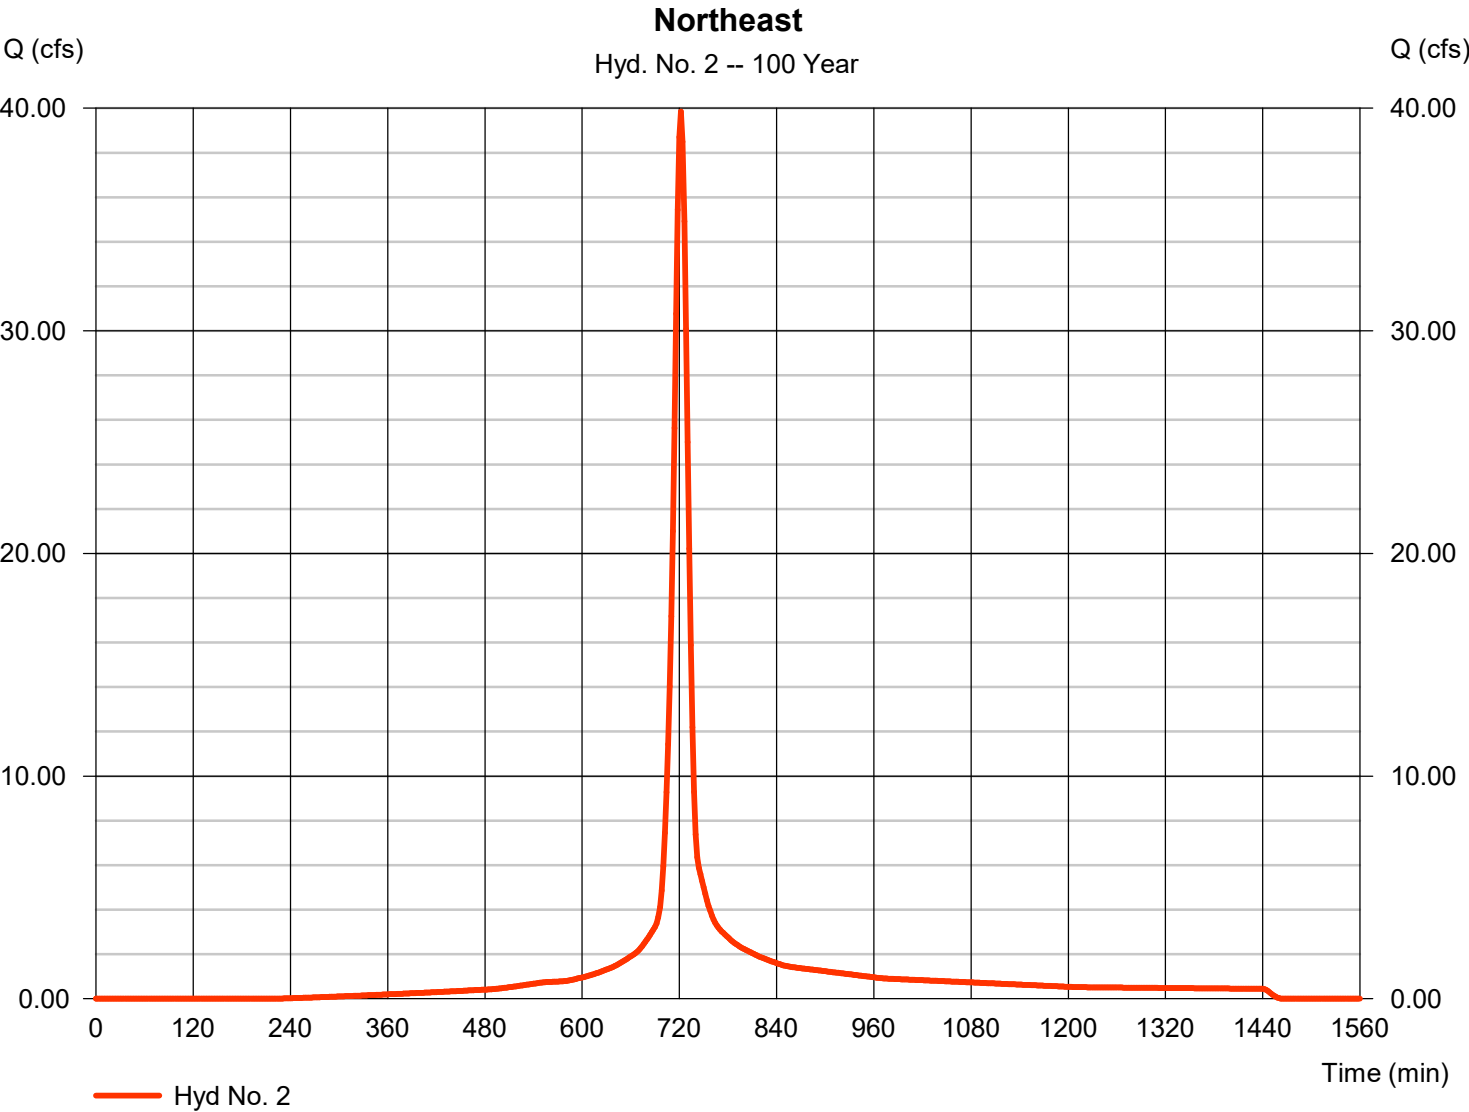


Hydrograph Report

Hyd. No. 3

southeast

Hydrograph type	= SCS Runoff	Peak discharge	= 61.12 cfs
Storm frequency	= 100 yrs	Time to peak	= 718 min
Time interval	= 2 min	Hyd. volume	= 153,108 cuft
Drainage area	= 6.270 ac	Curve number	= 91*
Basin Slope	= 0.0 %	Hydraulic length	= 0 ft
Tc method	= TR55	Time of conc. (Tc)	= 7.10 min
Total precip.	= 7.80 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

* Composite (Area/CN) = [(4.570 x 98) + (1.700 x 74)] / 6.270

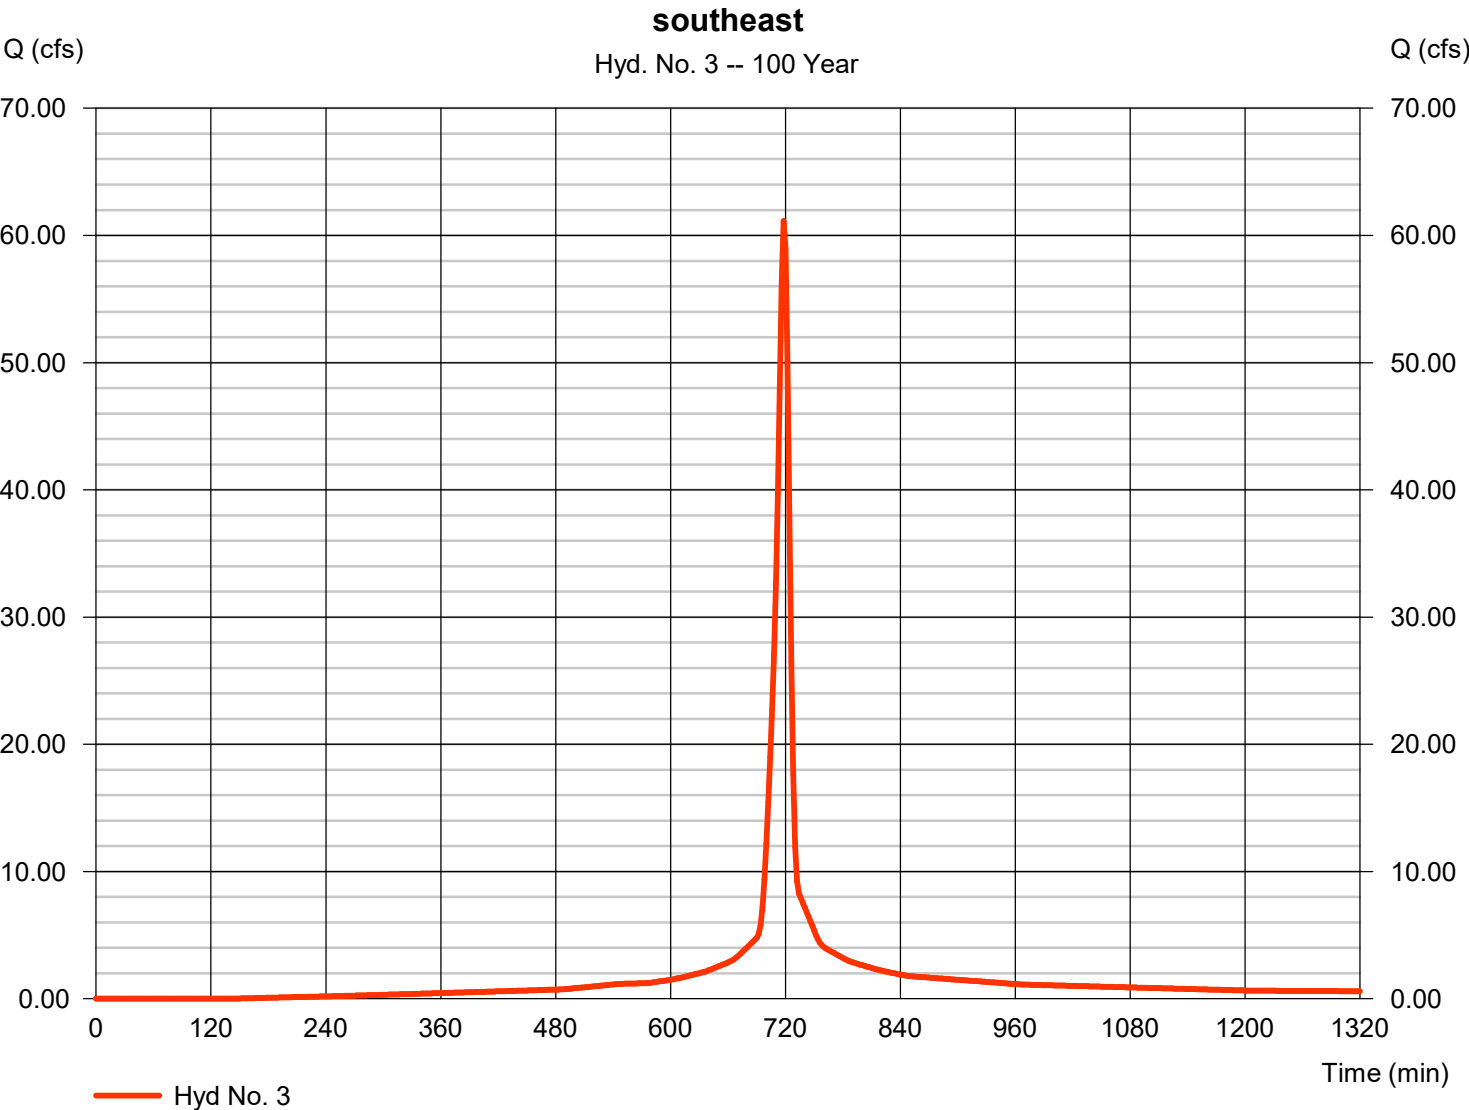


Hydrograph Report

Hyd. No. 4

Southwest

Hydrograph type	=	SCS Runoff	Peak discharge	=	15.60 cfs
Storm frequency	=	100 yrs	Time to peak	=	718 min
Time interval	=	2 min	Hyd. volume	=	39,071 cuft
Drainage area	=	1.600 ac	Curve number	=	91*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	6.60 min
Total precip.	=	7.80 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(1.120 x 98) + (0.480 x 74)] / 1.600

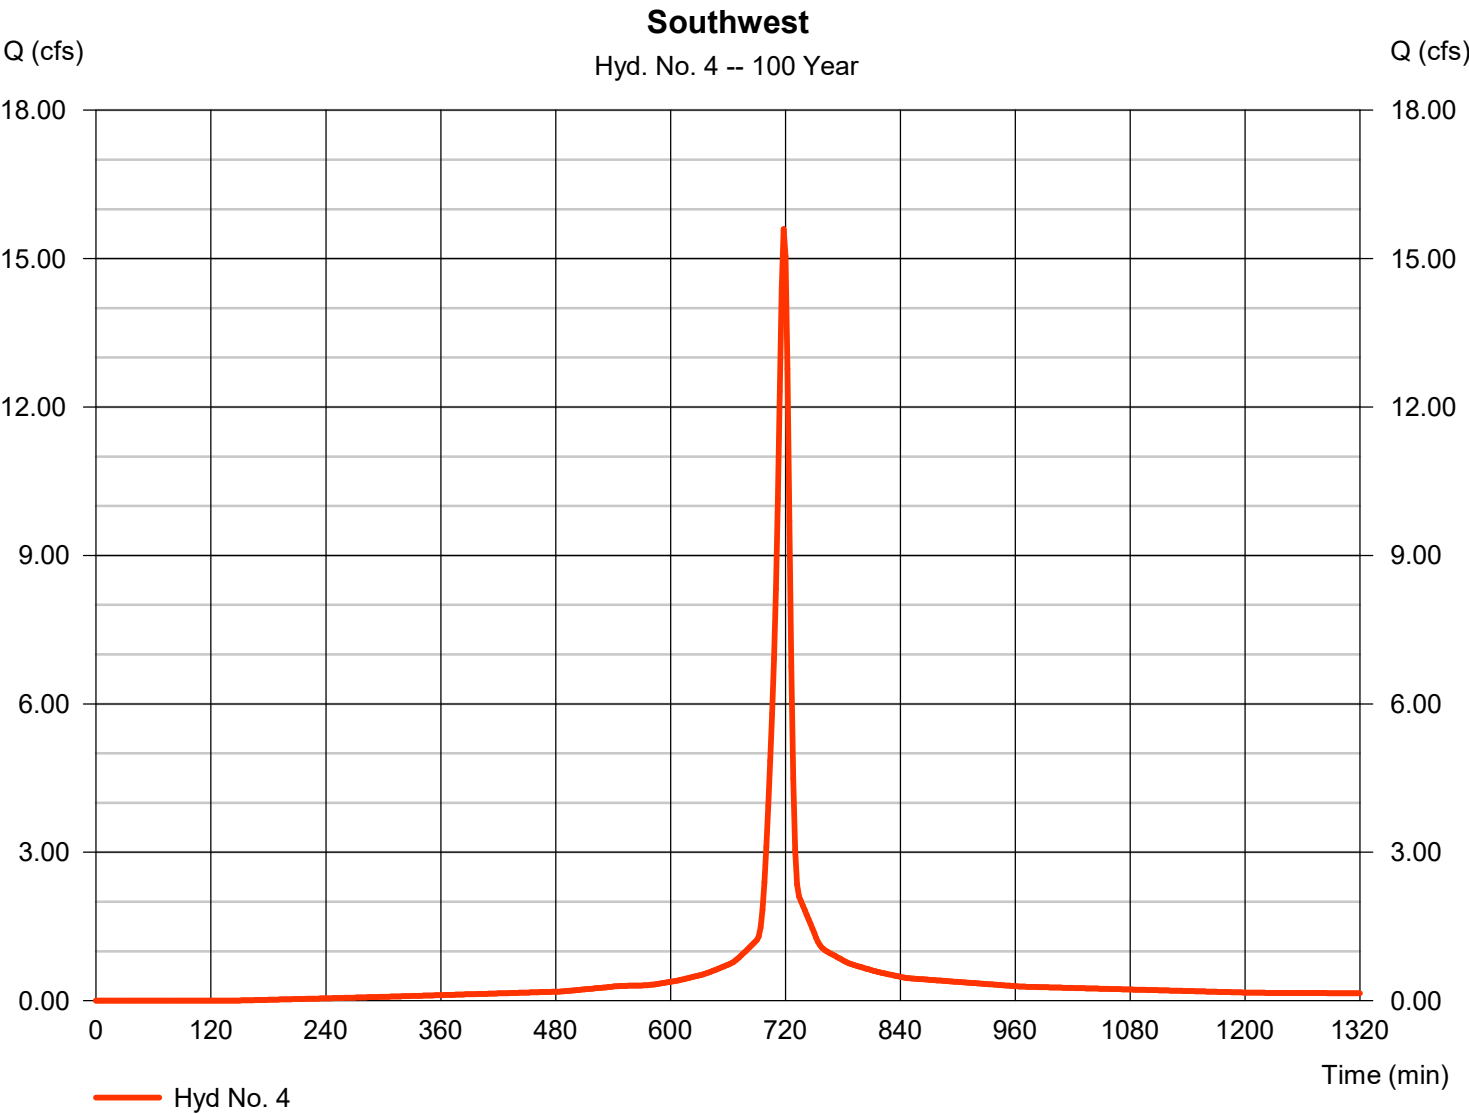

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 5

West

Hydrograph type	=	SCS Runoff	Peak discharge	=	27.10 cfs
Storm frequency	=	100 yrs	Time to peak	=	720 min
Time interval	=	2 min	Hyd. volume	=	73,523 cuft
Drainage area	=	3.200 ac	Curve number	=	86*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	12.40 min
Total precip.	=	7.80 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(1.650 x 98) + (1.550 x 74)] / 3.200

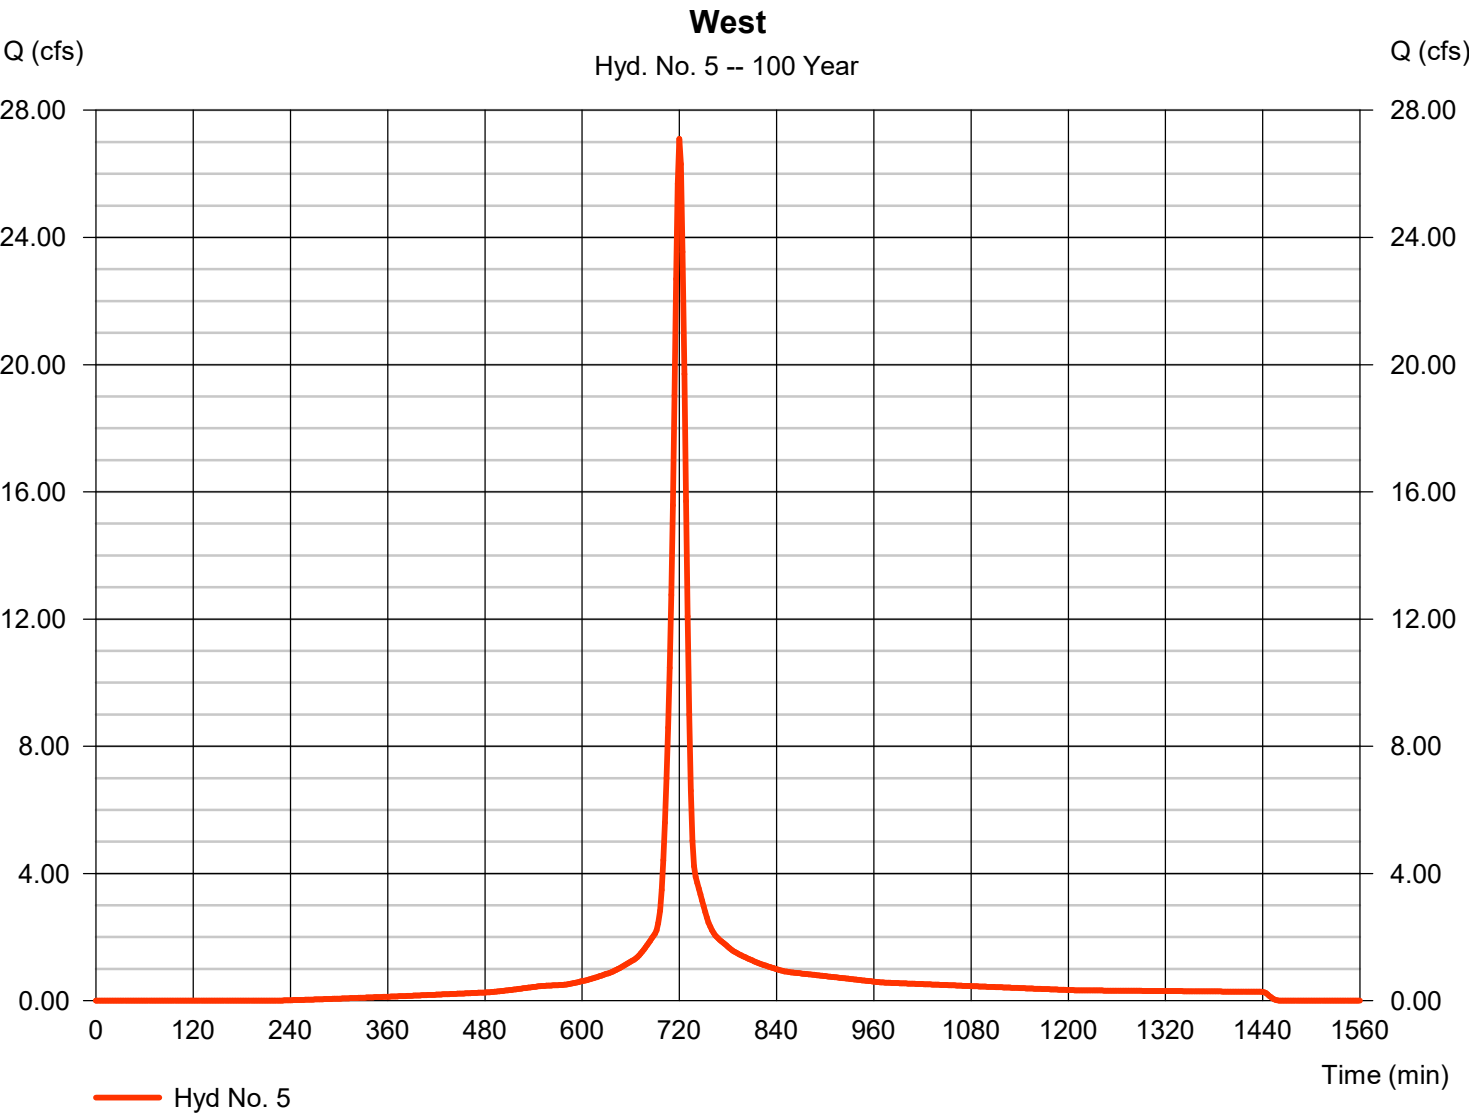


Hydrograph Report

Hyd. No. 6

7B (Offsite to Basin)

Hydrograph type	=	SCS Runoff	Peak discharge	=	32.34 cfs
Storm frequency	=	100 yrs	Time to peak	=	730 min
Time interval	=	2 min	Hyd. volume	=	129,243 cuft
Drainage area	=	7.500 ac	Curve number	=	74*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	28.30 min
Total precip.	=	7.80 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(7.500 x 74)] / 7.500

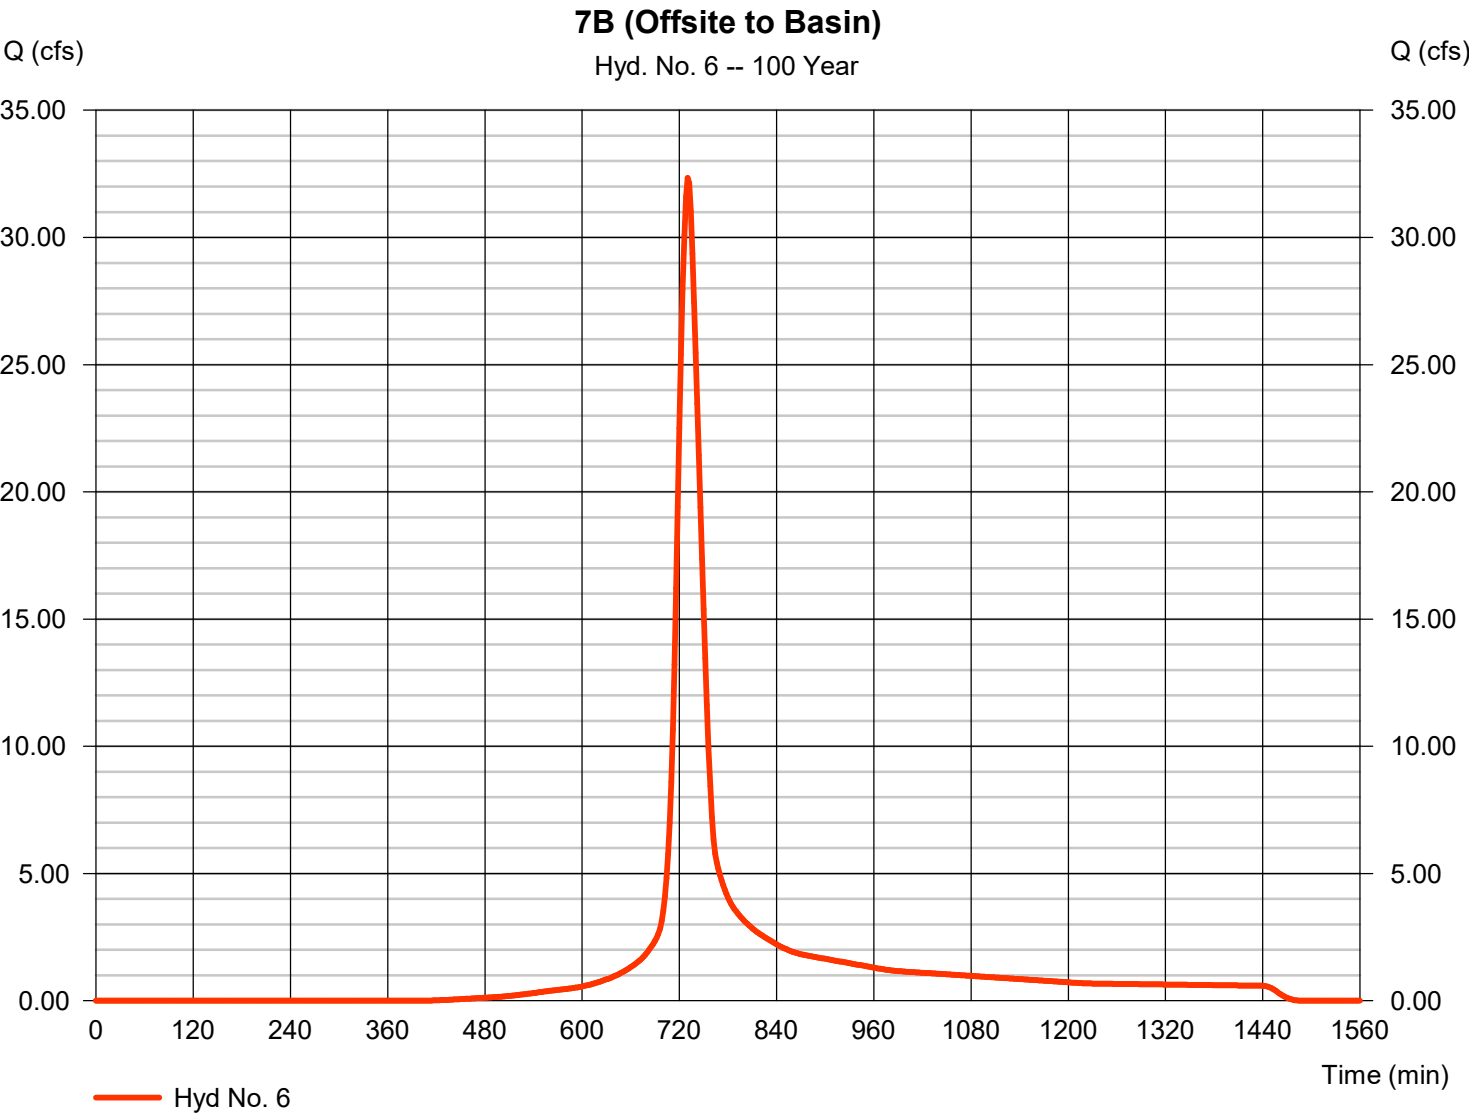


Hydrograph Report

Hyd. No. 7

Lot 5 (Wilshire Phase III)

Hydrograph type	=	SCS Runoff	Peak discharge	=	14.58 cfs
Storm frequency	=	100 yrs	Time to peak	=	726 min
Time interval	=	2 min	Hyd. volume	=	51,932 cuft
Drainage area	=	2.290 ac	Curve number	=	86*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	20.60 min
Total precip.	=	7.80 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(1.180 x 98) + (1.110 x 74)] / 2.290

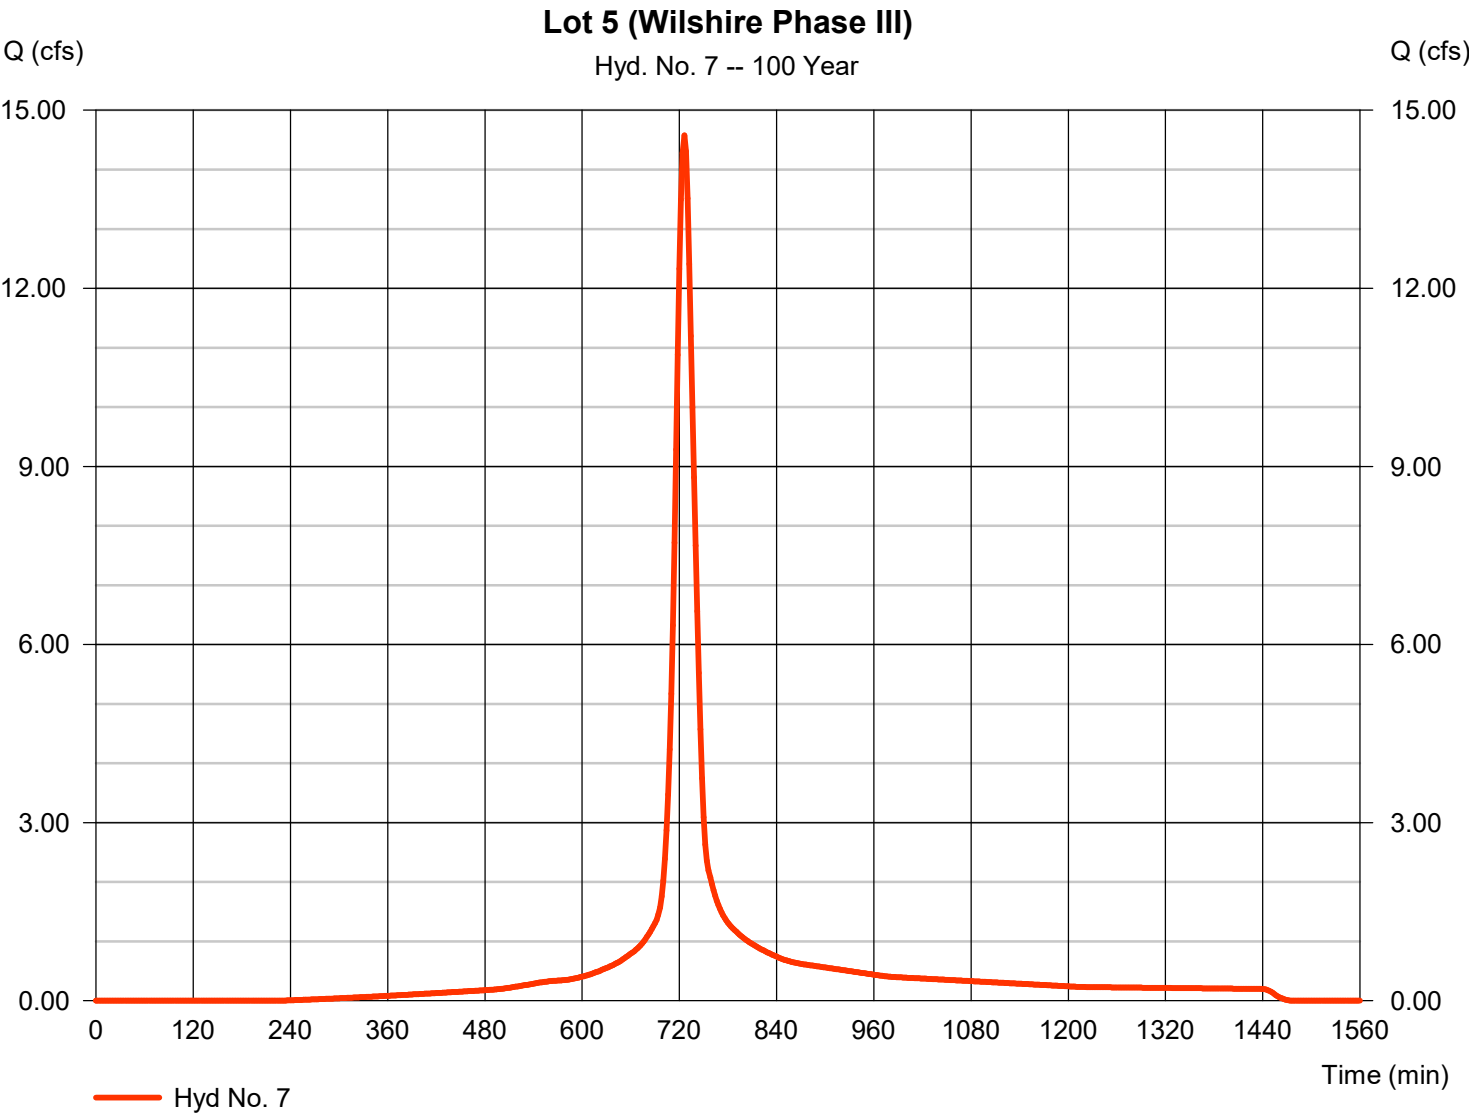


Hydrograph Report

Hyd. No. 8

Onsite Water

Hydrograph type	= Combine	Peak discharge	= 174.64 cfs
Storm frequency	= 100 yrs	Time to peak	= 720 min
Time interval	= 2 min	Hyd. volume	= 563,527 cuft
Inflow hyds.	= 2, 3, 4, 5, 6, 7	Contrib. drain. area	= 26.230 ac

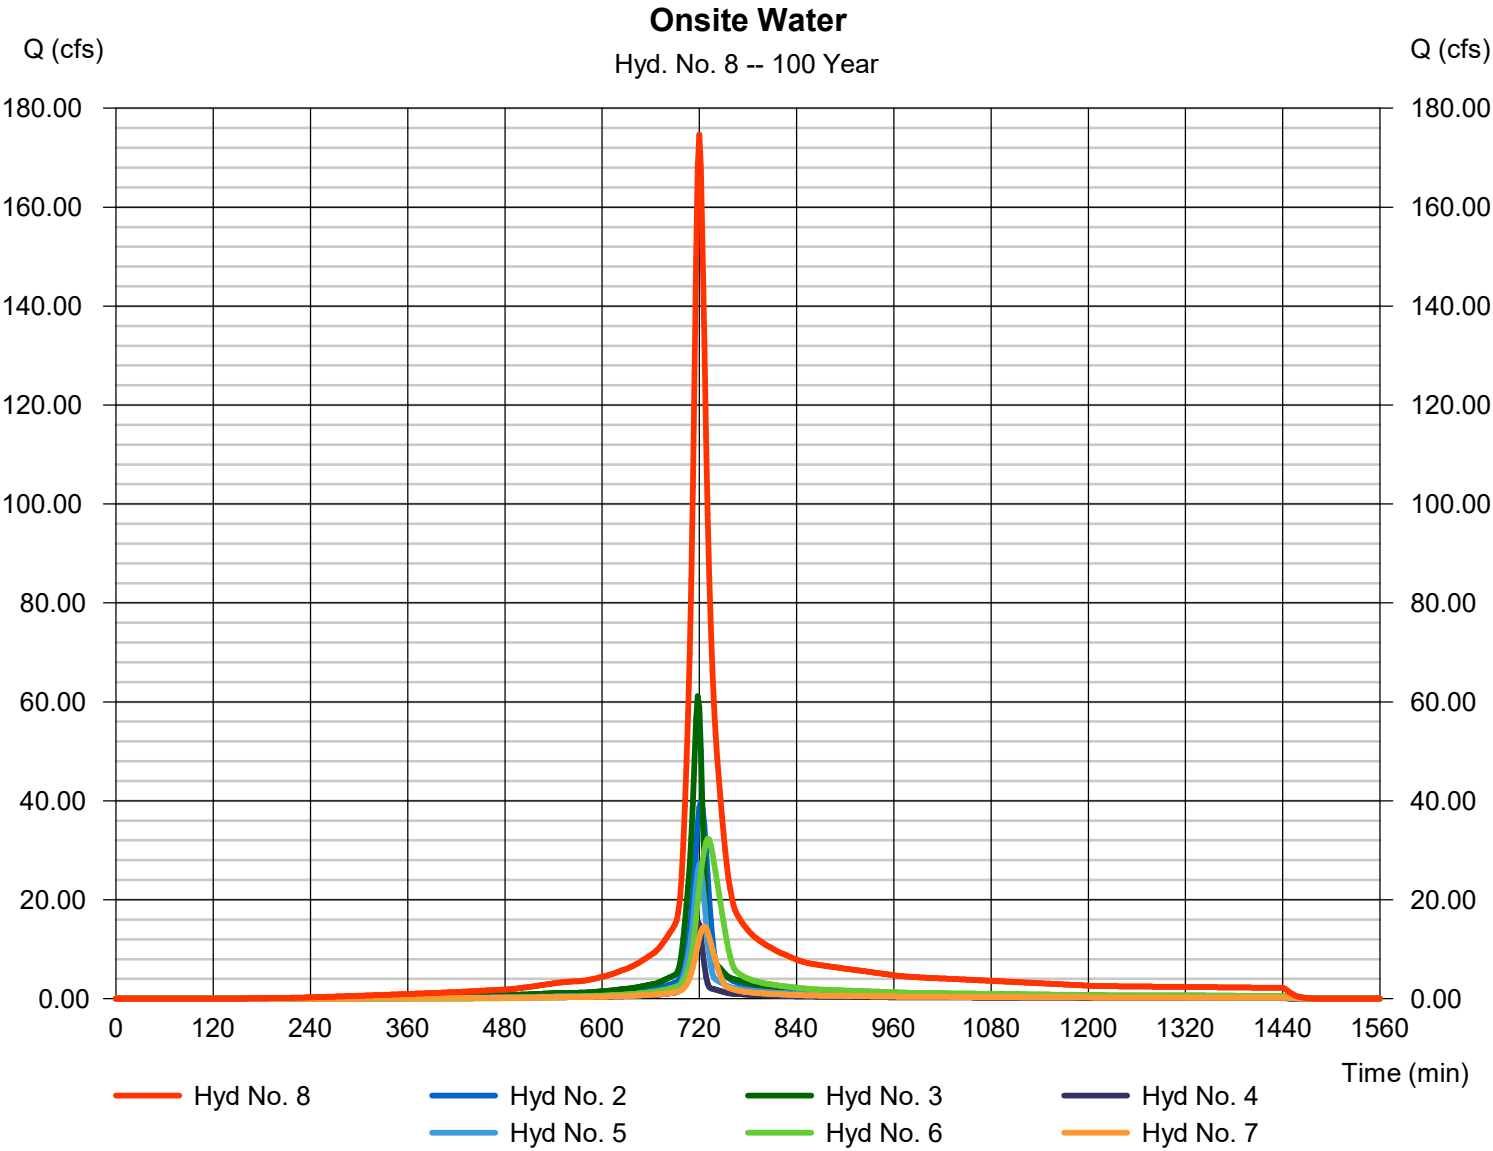

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 9

Water Quality Basin

Hydrograph type	= Reservoir	Peak discharge	= 89.20 cfs
Storm frequency	= 100 yrs	Time to peak	= 732 min
Time interval	= 2 min	Hyd. volume	= 563,512 cuft
Inflow hyd. No.	= 8 - Onsite Water	Max. Elevation	= 921.00 ft
Reservoir name	= Basin	Max. Storage	= 185,774 cuft

Storage Indication method used.

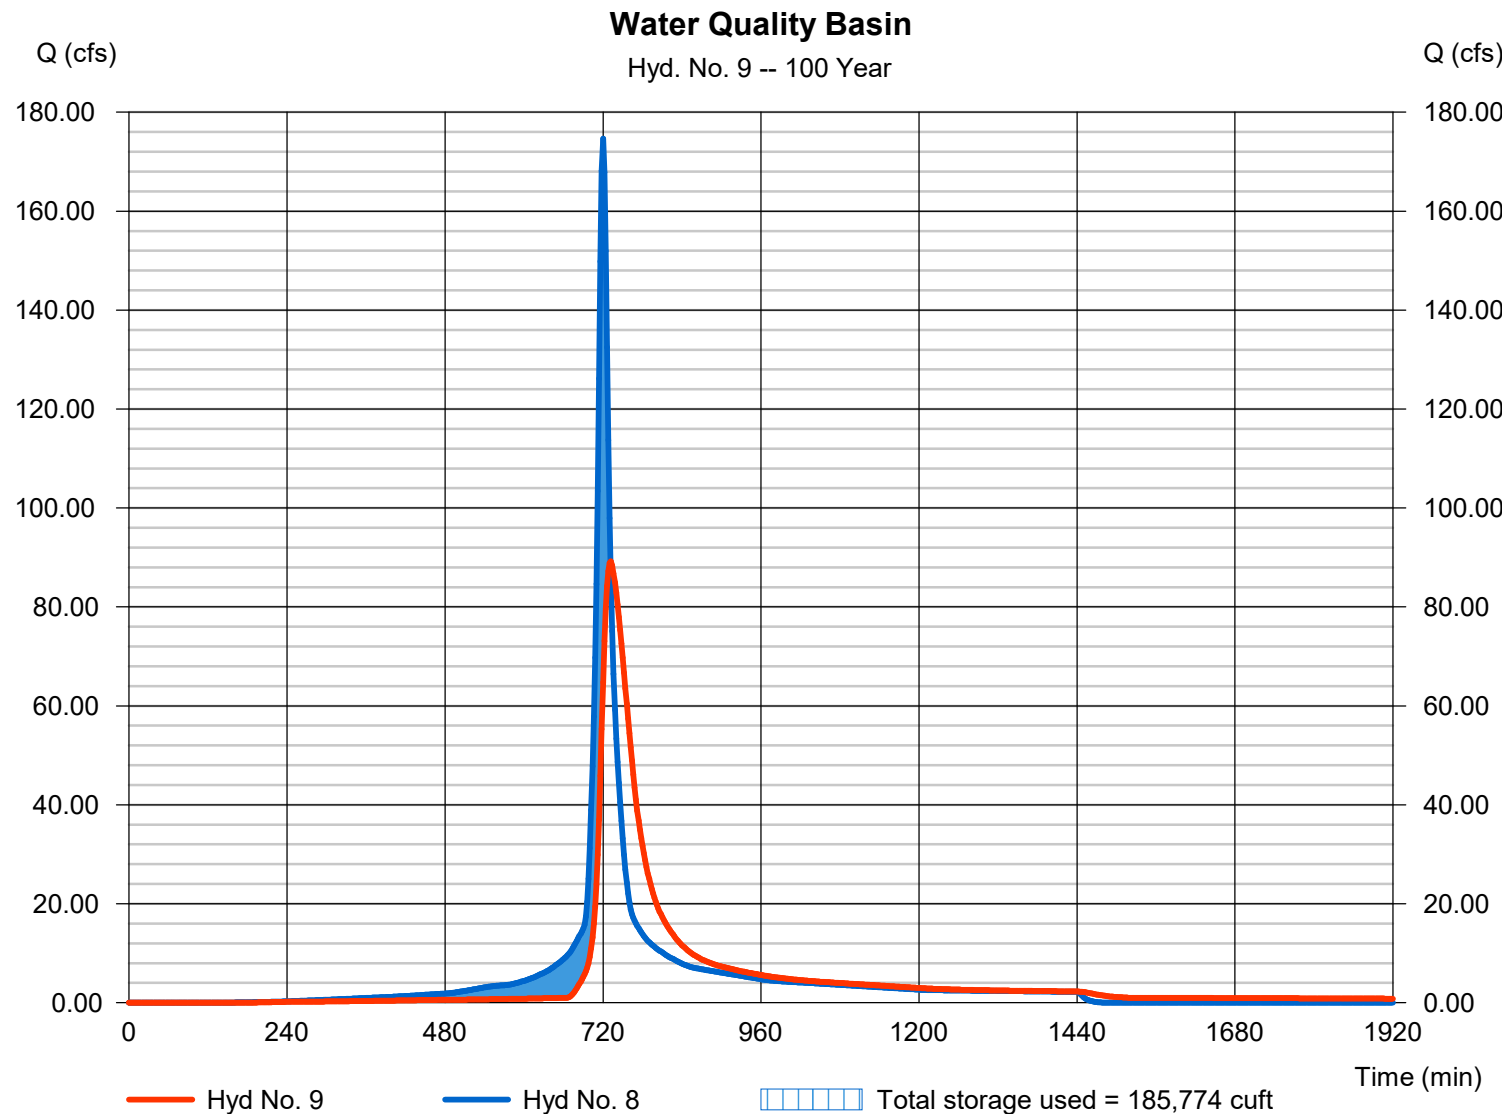



C.4 DOWNSTREAM BASIN ANALYSIS

Watershed Model Schematic..... 1

Hydrograph Return Period Recap..... 2

2 - Year

Summary Report..... 3

Hydrograph Reports..... 4

Hydrograph No. 1, SCS Runoff, Section 1..... 4

TR-55 Tc Worksheet..... 5

Hydrograph No. 2, SCS Runoff, Section 2..... 6

TR-55 Tc Worksheet..... 7

Hydrograph No. 3, SCS Runoff, Section 3..... 8

TR-55 Tc Worksheet..... 9

Hydrograph No. 4, SCS Runoff, Section 4..... 10

TR-55 Tc Worksheet..... 11

Hydrograph No. 5, SCS Runoff, Section 5..... 12

TR-55 Tc Worksheet..... 13

Hydrograph No. 6, SCS Runoff, Section 6..... 14

TR-55 Tc Worksheet..... 15

Hydrograph No. 7, SCS Runoff, Section 7/8-Pre..... 16

TR-55 Tc Worksheet..... 17

Hydrograph No. 8, Combine, Industrial Complex to Detention..... 18

Hydrograph No. 9, Reach, Industrial Above Ground Detention Pond..... 19

Hydrograph No. 10, Combine, Strother Road Culvert..... 20

Hydrograph No. 11, Reach, Wilshire Existing Stream..... 21

Hydrograph No. 12, Combine, OVERALL PRE..... 22

Hydrograph No. 13, SCS Runoff, Section 7A-Post..... 23

TR-55 Tc Worksheet..... 24

Hydrograph No. 14, SCS Runoff, Section 7B-Post (Wilshire Hills Bypass)..... 25

TR-55 Tc Worksheet..... 26

Hydrograph No. 15, SCS Runoff, Section 7C-Post (Wilshire Hills)..... 27

Hydrograph No. 16, Reach, Wilshire- Preserved stream..... 28

Hydrograph No. 17, Combine, Onsite Water..... 29

Hydrograph No. 18, Reservoir, Detention Basin..... 30

Pond Report - Detention Basin..... 31

Hydrograph No. 19, Combine, Post-Meadowview Culvert..... 32

Hydrograph No. 20, Reach, Post - Restored Stream..... 33

Hydrograph No. 21, SCS Runoff, Section 8 - Post..... 34

TR-55 Tc Worksheet..... 35

Hydrograph No. 22, Combine, OVERALL POST - DETENTION BASIN..... 36

10 - Year

Summary Report..... 37

Hydrograph Reports..... 38

Hydrograph No. 1, SCS Runoff, Section 1..... 38

Hydrograph No. 2, SCS Runoff, Section 2..... 39

Hydrograph No. 3, SCS Runoff, Section 3..... 40

Hydrograph No. 4, SCS Runoff, Section 4..... 41

Hydrograph No. 5, SCS Runoff, Section 5.....	42
Hydrograph No. 6, SCS Runoff, Section 6.....	43
Hydrograph No. 7, SCS Runoff, Section 7/8-Pre.....	44
Hydrograph No. 8, Combine, Industrial Complex to Detention.....	45
Hydrograph No. 9, Reach, Industrial Above Ground Detention Pond.....	46
Hydrograph No. 10, Combine, Strother Road Culvert.....	47
Hydrograph No. 11, Reach, Wilshire Existing Stream.....	48
Hydrograph No. 12, Combine, OVERALL PRE.....	49
Hydrograph No. 13, SCS Runoff, Section 7A-Post.....	50
Hydrograph No. 14, SCS Runoff, Section 7B-Post (Wilshire Hills Bypass).....	51
Hydrograph No. 15, SCS Runoff, Section 7C-Post (Wilshire Hills).....	52
Hydrograph No. 16, Reach, Wilshire- Preserved stream.....	53
Hydrograph No. 17, Combine, Onsite Water.....	54
Hydrograph No. 18, Reservoir, Detention Basin.....	55
Hydrograph No. 19, Combine, Post-Meadowview Culvert.....	56
Hydrograph No. 20, Reach, Post - Restored Stream.....	57
Hydrograph No. 21, SCS Runoff, Section 8 - Post.....	58
Hydrograph No. 22, Combine, OVERALL POST - DETENTION BASIN.....	59

100 - Year

Summary Report.....	60
----------------------------	-----------


Hydrograph Reports.....	61
--------------------------------	-----------

Hydrograph No. 1, SCS Runoff, Section 1.....	61
Hydrograph No. 2, SCS Runoff, Section 2.....	62
Hydrograph No. 3, SCS Runoff, Section 3.....	63
Hydrograph No. 4, SCS Runoff, Section 4.....	64
Hydrograph No. 5, SCS Runoff, Section 5.....	65
Hydrograph No. 6, SCS Runoff, Section 6.....	66
Hydrograph No. 7, SCS Runoff, Section 7/8-Pre.....	67
Hydrograph No. 8, Combine, Industrial Complex to Detention.....	68
Hydrograph No. 9, Reach, Industrial Above Ground Detention Pond.....	69
Hydrograph No. 10, Combine, Strother Road Culvert.....	70
Hydrograph No. 11, Reach, Wilshire Existing Stream.....	71
Hydrograph No. 12, Combine, OVERALL PRE.....	72
Hydrograph No. 13, SCS Runoff, Section 7A-Post.....	73
Hydrograph No. 14, SCS Runoff, Section 7B-Post (Wilshire Hills Bypass).....	74
Hydrograph No. 15, SCS Runoff, Section 7C-Post (Wilshire Hills).....	75
Hydrograph No. 16, Reach, Wilshire- Preserved stream.....	76
Hydrograph No. 17, Combine, Onsite Water.....	77
Hydrograph No. 18, Reservoir, Detention Basin.....	78
Hydrograph No. 19, Combine, Post-Meadowview Culvert.....	79
Hydrograph No. 20, Reach, Post - Restored Stream.....	80
Hydrograph No. 21, SCS Runoff, Section 8 - Post.....	81
Hydrograph No. 22, Combine, OVERALL POST - DETENTION BASIN.....	82

IDF Report.....	83
------------------------	-----------

Watershed Model Schematic

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

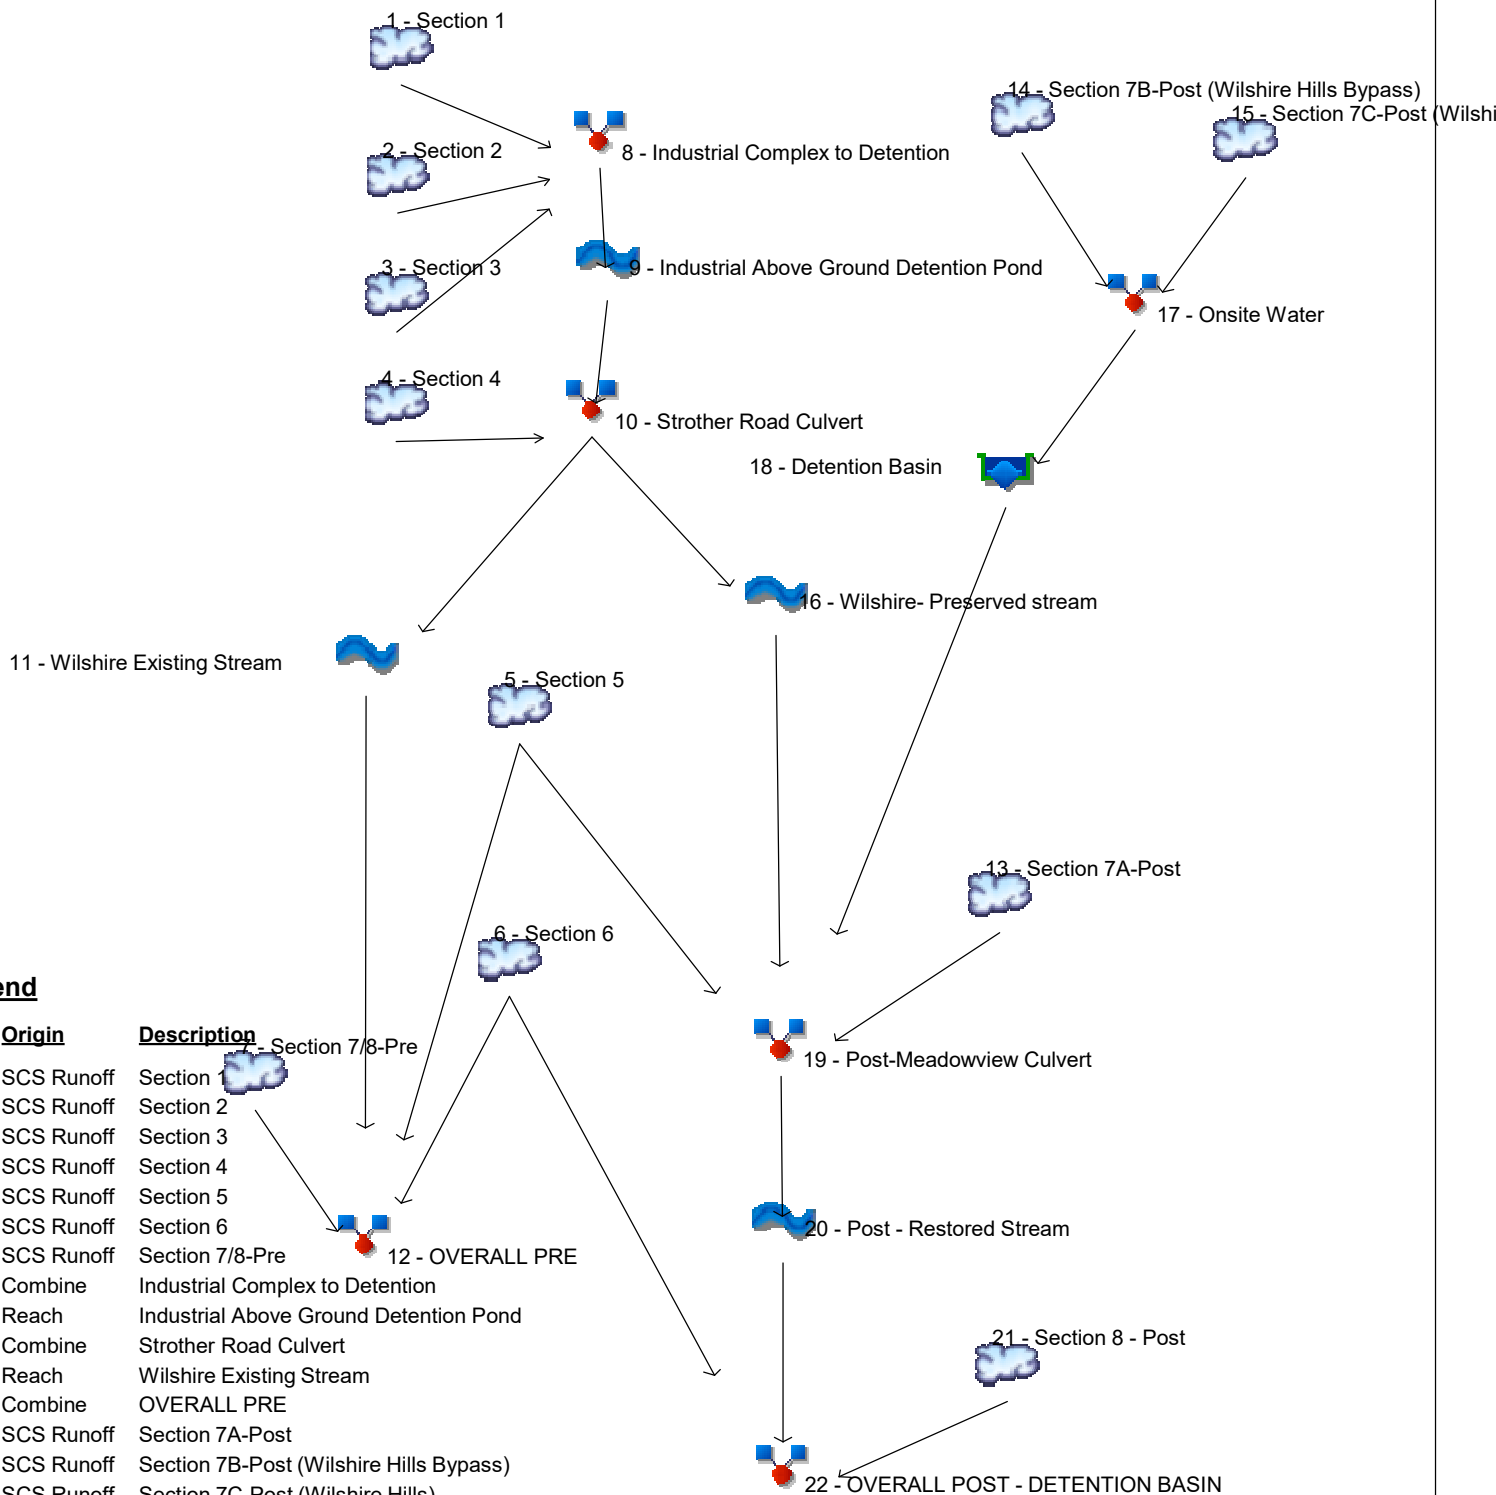

Legend

Hyd.	Origin	Description
1	SCS Runoff	Section 1
2	SCS Runoff	Section 2
3	SCS Runoff	Section 3
4	SCS Runoff	Section 4
5	SCS Runoff	Section 5
6	SCS Runoff	Section 6
7	SCS Runoff	Section 7/8-Pre
8	Combine	Industrial Complex to Detention
9	Reach	Industrial Above Ground Detention Pond
10	Combine	Strother Road Culvert
11	Reach	Wilshire Existing Stream
12	Combine	OVERALL PRE
13	SCS Runoff	Section 7A-Post
14	SCS Runoff	Section 7B-Post (Wilshire Hills Bypass)
15	SCS Runoff	Section 7C-Post (Wilshire Hills)
16	Reach	Wilshire- Preserved stream
17	Combine	Onsite Water
18	Reservoir	Detention Basin
19	Combine	Post-Meadowview Culvert
20	Reach	Post - Restored Stream
21	SCS Runoff	Section 8 - Post
22	Combine	OVERALL POST - DETENTION BASIN

Hydrograph Return Period Recap

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Hyd. No.	Hydrograph type (origin)	Inflow hyd(s)	Peak Outflow (cfs)								Hydrograph Description
			1-yr	2-yr	3-yr	5-yr	10-yr	25-yr	50-yr	100-yr	
1	SCS Runoff	-----	-----	111.00	-----	-----	228.55	-----	-----	403.79	Section 1
2	SCS Runoff	-----	-----	92.38	-----	-----	190.22	-----	-----	336.08	Section 2
3	SCS Runoff	-----	-----	162.30	-----	-----	306.37	-----	-----	512.72	Section 3
4	SCS Runoff	-----	-----	159.01	-----	-----	273.45	-----	-----	431.92	Section 4
5	SCS Runoff	-----	-----	221.05	-----	-----	394.04	-----	-----	636.00	Section 5
6	SCS Runoff	-----	-----	32.72	-----	-----	53.70	-----	-----	82.47	Section 6
7	SCS Runoff	-----	-----	134.69	-----	-----	227.73	-----	-----	355.97	Section 7/8-Pre
8	Combine	1, 2, 3,	-----	365.68	-----	-----	722.19	-----	-----	1243.39	Industrial Complex to Detention
9	Reach	8	-----	344.64	-----	-----	695.55	-----	-----	1211.21	Industrial Above Ground Detention Po
10	Combine	4, 9	-----	502.85	-----	-----	966.72	-----	-----	1643.13	Strother Road Culvert
11	Reach	10	-----	470.44	-----	-----	915.90	-----	-----	1570.20	Wilshire Existing Stream
12	Combine	5, 6, 7, 11	-----	660.85	-----	-----	1263.54	-----	-----	2145.77	OVERALL PRE
13	SCS Runoff	-----	-----	54.00	-----	-----	91.08	-----	-----	142.13	Section 7A-Post
14	SCS Runoff	-----	-----	4.168	-----	-----	12.03	-----	-----	25.16	Section 7B-Post (Wilshire Hills Bypas
15	SCS Runoff	-----	-----	46.96	-----	-----	79.37	-----	-----	124.02	Section 7C-Post (Wilshire Hills)
16	Reach	10	-----	478.83	-----	-----	933.75	-----	-----	1596.55	Wilshire- Preserved stream
17	Combine	14, 15,	-----	50.34	-----	-----	90.00	-----	-----	147.04	Onsite Water
18	Reservoir	17	-----	16.23	-----	-----	47.35	-----	-----	86.30	Detention Basin
19	Combine	5, 13, 16, 18	-----	579.40	-----	-----	1153.87	-----	-----	1992.98	Post-Meadowview Culvert
20	Reach	19	-----	564.63	-----	-----	1130.16	-----	-----	1958.22	Post - Restored Stream
21	SCS Runoff	-----	-----	29.76	-----	-----	49.61	-----	-----	76.90	Section 8 - Post
22	Combine	6, 20, 21	-----	597.54	-----	-----	1189.44	-----	-----	2060.48	OVERALL POST - DETENTION BASI
Proj. file: 15925 Downstream Analysis (3-28-2024).gpw										Thursday, 03 / 28 / 2024	

Hydrograph Summary Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description
1	SCS Runoff	111.00	2	730	417,615	-----	-----	-----	Section 1
2	SCS Runoff	92.38	2	730	347,587	-----	-----	-----	Section 2
3	SCS Runoff	162.30	2	730	652,264	-----	-----	-----	Section 3
4	SCS Runoff	159.01	2	732	687,904	-----	-----	-----	Section 4
5	SCS Runoff	221.05	2	722	620,159	-----	-----	-----	Section 5
6	SCS Runoff	32.72	2	724	104,234	-----	-----	-----	Section 6
7	SCS Runoff	134.69	2	728	496,946	-----	-----	-----	Section 7/8-Pre
8	Combine	365.68	2	730	1,417,466	1, 2, 3,	-----	-----	Industrial Complex to Detention
9	Reach	344.64	2	734	1,417,464	8	-----	-----	Industrial Above Ground Detention Po
10	Combine	502.85	2	734	2,105,367	4, 9	-----	-----	Strother Road Culvert
11	Reach	470.44	2	740	2,105,365	10	-----	-----	Wilshire Existing Stream
12	Combine	660.85	2	732	3,326,706	5, 6, 7, 11	-----	-----	OVERALL PRE
13	SCS Runoff	54.00	2	724	170,275	-----	-----	-----	Section 7A-Post
14	SCS Runoff	4.168	2	732	20,473	-----	-----	-----	Section 7B-Post (Wilshire Hills Bypas
15	SCS Runoff	46.96	2	726	163,125	-----	-----	-----	Section 7C-Post (Wilshire Hills)
16	Reach	478.83	2	740	2,105,365	10	-----	-----	Wilshire- Preserved stream
17	Combine	50.34	2	726	183,598	14, 15,	-----	-----	Onsite Water
18	Reservoir	16.23	2	748	183,584	17	917.14	81,774	Detention Basin
19	Combine	579.40	2	734	3,079,388	5, 13, 16, 18	-----	-----	Post-Meadowview Culvert
20	Reach	564.63	2	740	3,079,328	19	-----	-----	Post - Restored Stream
21	SCS Runoff	29.76	2	728	110,215	-----	-----	-----	Section 8 - Post
22	Combine	597.54	2	738	3,293,776	6, 20, 21	-----	-----	OVERALL POST - DETENTION BASI
15925 Downstream Analysis (3-28-2024).gpw					Return Period: 2 Year			Thursday, 03 / 28 / 2024	


Hydrograph Report

Hyd. No. 1

Section 1

Hydrograph type	=	SCS Runoff	Peak discharge	=	111.00 cfs
Storm frequency	=	2 yrs	Time to peak	=	730 min
Time interval	=	2 min	Hyd. volume	=	417,615 cuft
Drainage area	=	81.700 ac	Curve number	=	77*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	24.30 min
Total precip.	=	3.50 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(3.600 x 81) + (13.500 x 98) + (49.000 x 73) + (15.600 x 69)] / 81.700

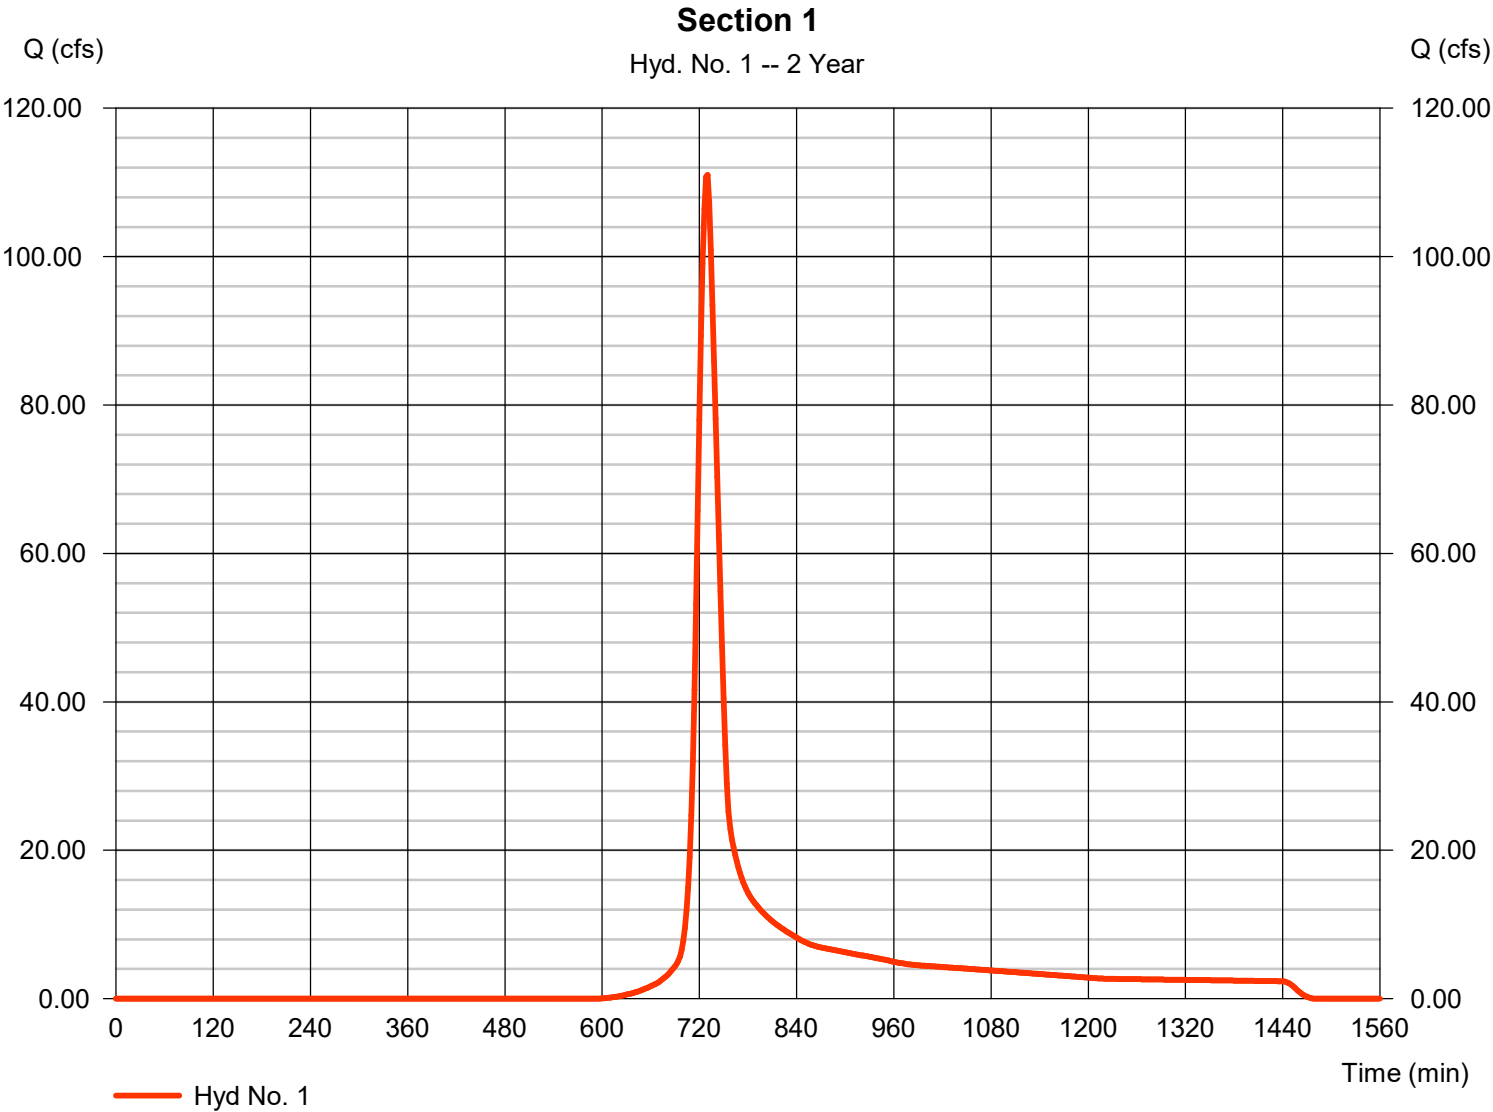

TR55 Tc Worksheet

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Hyd. No. 1

Section 1

<u>Description</u>	<u>A</u>	<u>B</u>	<u>C</u>	<u>Totals</u>
Sheet Flow				
Manning's n-value	= 0.240	0.011	0.011	
Flow length (ft)	= 100.0	0.0	0.0	
Two-year 24-hr precip. (in)	= 3.50	0.00	0.00	
Land slope (%)	= 2.80	0.00	0.00	
Travel Time (min)	= 11.93	+ 0.00	+ 0.00	= 11.93
Shallow Concentrated Flow				
Flow length (ft)	= 1100.00	0.00	0.00	
Watercourse slope (%)	= 2.80	0.00	0.00	
Surface description	= Unpaved	Paved	Paved	
Average velocity (ft/s)	=2.70	0.00	0.00	
Travel Time (min)	= 6.79	+ 0.00	+ 0.00	= 6.79
Channel Flow				
X sectional flow area (sqft)	= 24.00	3.14	0.00	
Wetted perimeter (ft)	= 14.00	6.30	0.00	
Channel slope (%)	= 2.00	1.00	0.00	
Manning's n-value	= 0.050	0.015	0.015	
Velocity (ft/s)	=6.05	6.23	0.00	
Flow length (ft)	({})1500.0	550.0	0.0	
Travel Time (min)	= 4.13	+ 1.47	+ 0.00	= 5.61
Total Travel Time, Tc				24.30 min


Hydrograph Report

Hyd. No. 2

Section 2

Hydrograph type	=	SCS Runoff	Peak discharge	=	92.38 cfs
Storm frequency	=	2 yrs	Time to peak	=	730 min
Time interval	=	2 min	Hyd. volume	=	347,587 cuft
Drainage area	=	68.000 ac	Curve number	=	77*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	25.30 min
Total precip.	=	3.50 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(8.000 x 98) + (0.500 x 77) + (30.800 x 79) + (28.700 x 69)] / 68.000

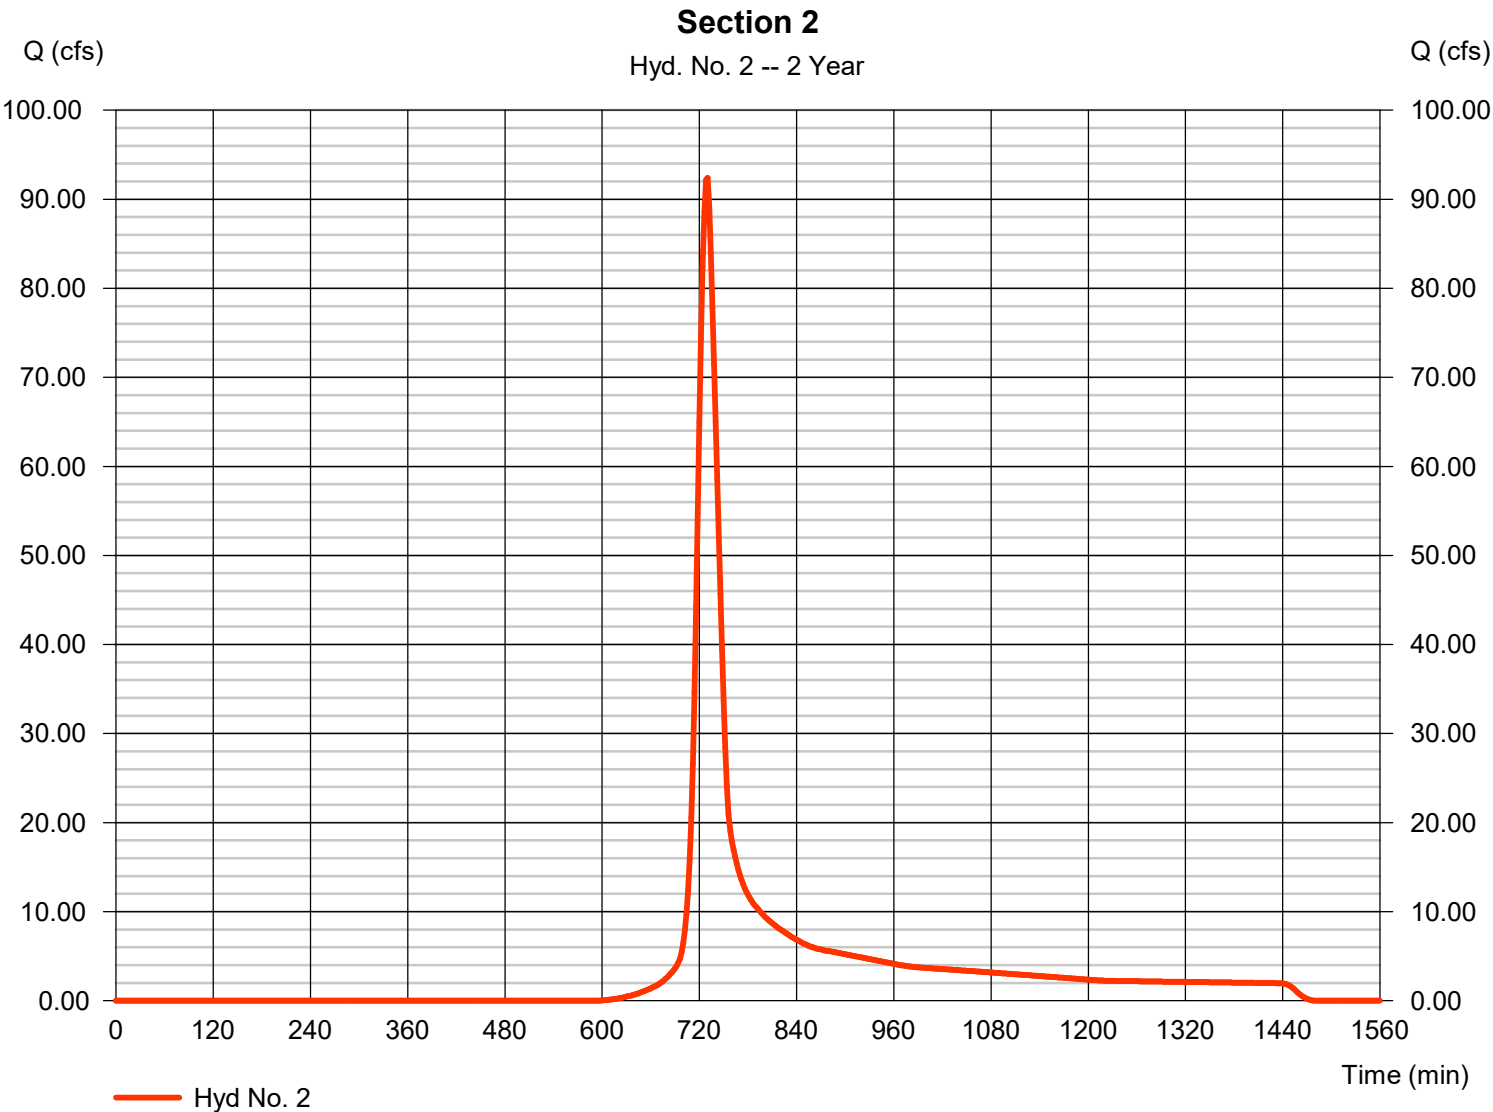

TR55 Tc Worksheet

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Hyd. No. 2

Section 2

<u>Description</u>	<u>A</u>	<u>B</u>	<u>C</u>	<u>Totals</u>
Sheet Flow				
Manning's n-value	= 0.240	0.011	0.011	
Flow length (ft)	= 100.0	0.0	0.0	
Two-year 24-hr precip. (in)	= 2.20	0.00	0.00	
Land slope (%)	= 2.20	0.00	0.00	
Travel Time (min)	= 16.57	+ 0.00	+ 0.00	= 16.57
Shallow Concentrated Flow				
Flow length (ft)	= 1000.00	0.00	0.00	
Watercourse slope (%)	= 2.20	0.00	0.00	
Surface description	= Unpaved	Paved	Paved	
Average velocity (ft/s)	=2.39	0.00	0.00	
Travel Time (min)	= 6.96	+ 0.00	+ 0.00	= 6.96
Channel Flow				
X sectional flow area (sqft)	= 24.00	50.00	0.00	
Wetted perimeter (ft)	= 14.00	20.00	0.00	
Channel slope (%)	= 3.00	2.50	0.00	
Manning's n-value	= 0.050	0.025	0.015	
Velocity (ft/s)	=7.41	17.41	0.00	
Flow length (ft)	({0})400.0	950.0	0.0	
Travel Time (min)	= 0.90	+ 0.91	+ 0.00	= 1.81
Total Travel Time, Tc				25.30 min


Hydrograph Report

Hyd. No. 3

Section 3

Hydrograph type	=	SCS Runoff	Peak discharge	=	162.30 cfs
Storm frequency	=	2 yrs	Time to peak	=	730 min
Time interval	=	2 min	Hyd. volume	=	652,264 cuft
Drainage area	=	100.800 ac	Curve number	=	82*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	30.20 min
Total precip.	=	3.50 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(18.200 x 98) + (3.000 x 77) + (79.600 x 79)] / 100.800

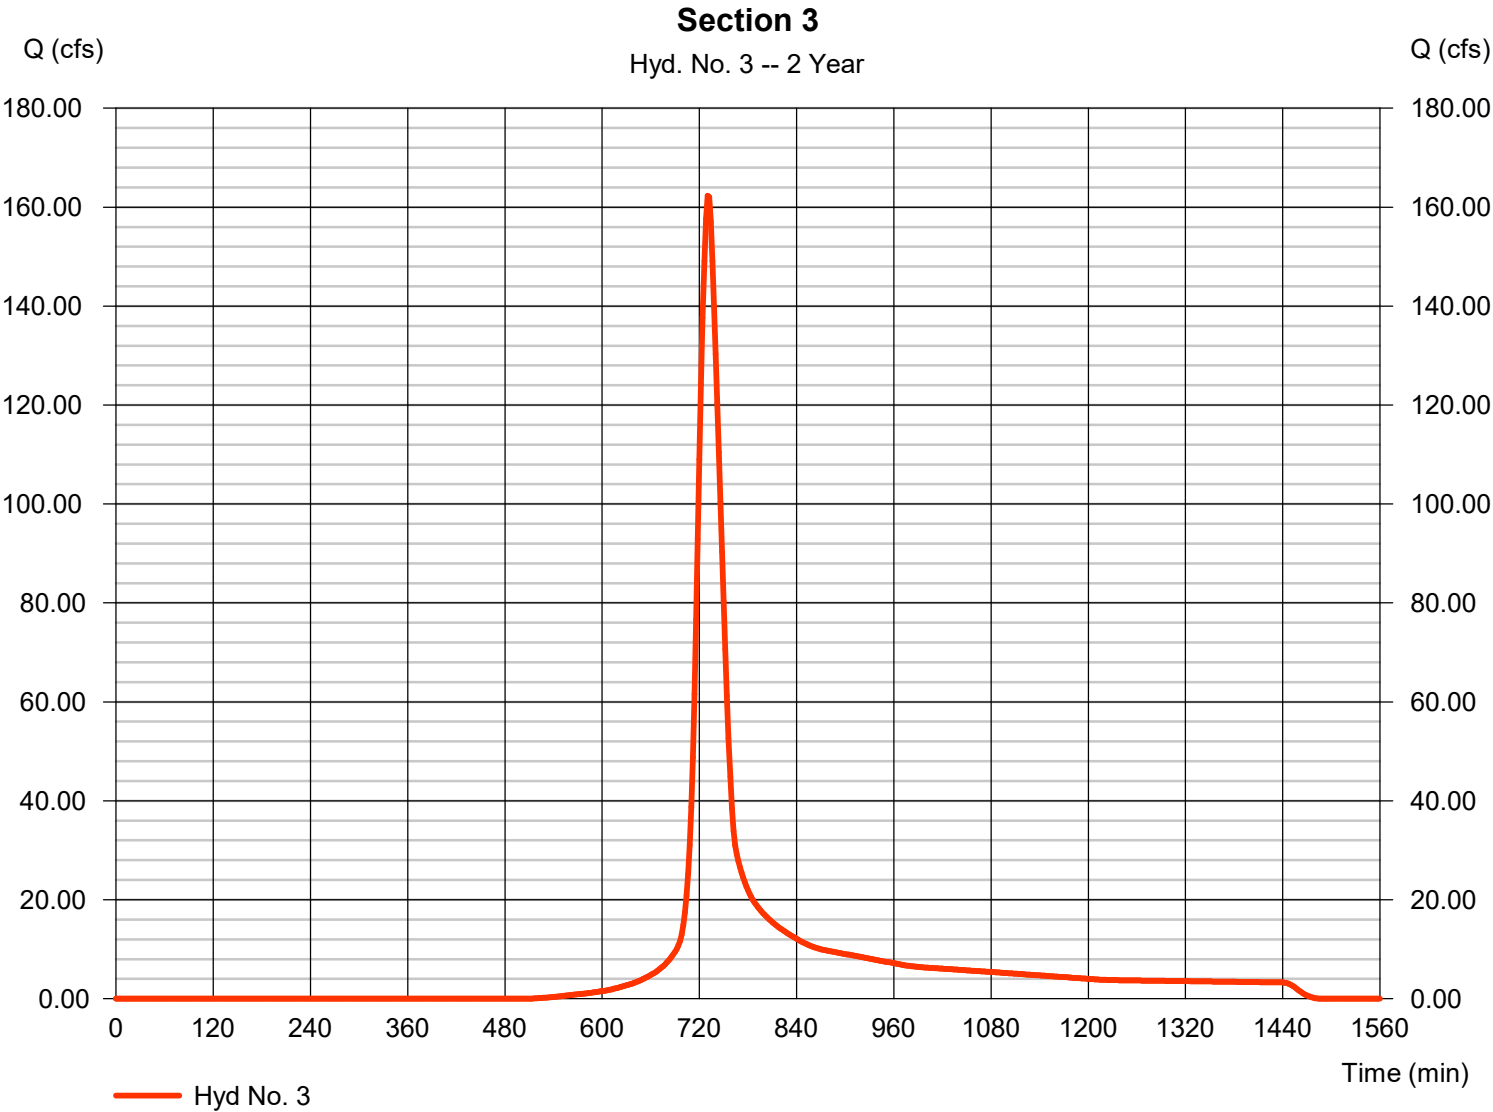

TR55 Tc Worksheet

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Hyd. No. 3

Section 3

<u>Description</u>	<u>A</u>	<u>B</u>	<u>C</u>	<u>Totals</u>
Sheet Flow				
Manning's n-value	= 0.240	0.011	0.011	
Flow length (ft)	= 100.0	0.0	0.0	
Two-year 24-hr precip. (in)	= 2.20	0.00	0.00	
Land slope (%)	= 1.00	0.00	0.00	
Travel Time (min)	= 22.71	+ 0.00	+ 0.00	= 22.71
Shallow Concentrated Flow				
Flow length (ft)	= 400.00	0.00	0.00	
Watercourse slope (%)	= 1.80	0.00	0.00	
Surface description	= Unpaved	Paved	Paved	
Average velocity (ft/s)	=2.16	0.00	0.00	
Travel Time (min)	= 3.08	+ 0.00	+ 0.00	= 3.08
Channel Flow				
X sectional flow area (sqft)	= 24.00	50.00	0.00	
Wetted perimeter (ft)	= 14.00	20.00	0.00	
Channel slope (%)	= 2.40	1.30	0.00	
Manning's n-value	= 0.050	0.025	0.015	
Velocity (ft/s)	=6.62	12.56	0.00	
Flow length (ft)	(0)850.0	1700.0	0.0	
Travel Time (min)	= 2.14	+ 2.26	+ 0.00	= 4.40
Total Travel Time, Tc				30.20 min


Hydrograph Report

Hyd. No. 4

Section 4

Hydrograph type	=	SCS Runoff	Peak discharge	=	159.01 cfs
Storm frequency	=	2 yrs	Time to peak	=	732 min
Time interval	=	2 min	Hyd. volume	=	687,904 cuft
Drainage area	=	82.500 ac	Curve number	=	88*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	30.70 min
Total precip.	=	3.50 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(49.680 x 98) + (32.820 x 74)] / 82.500

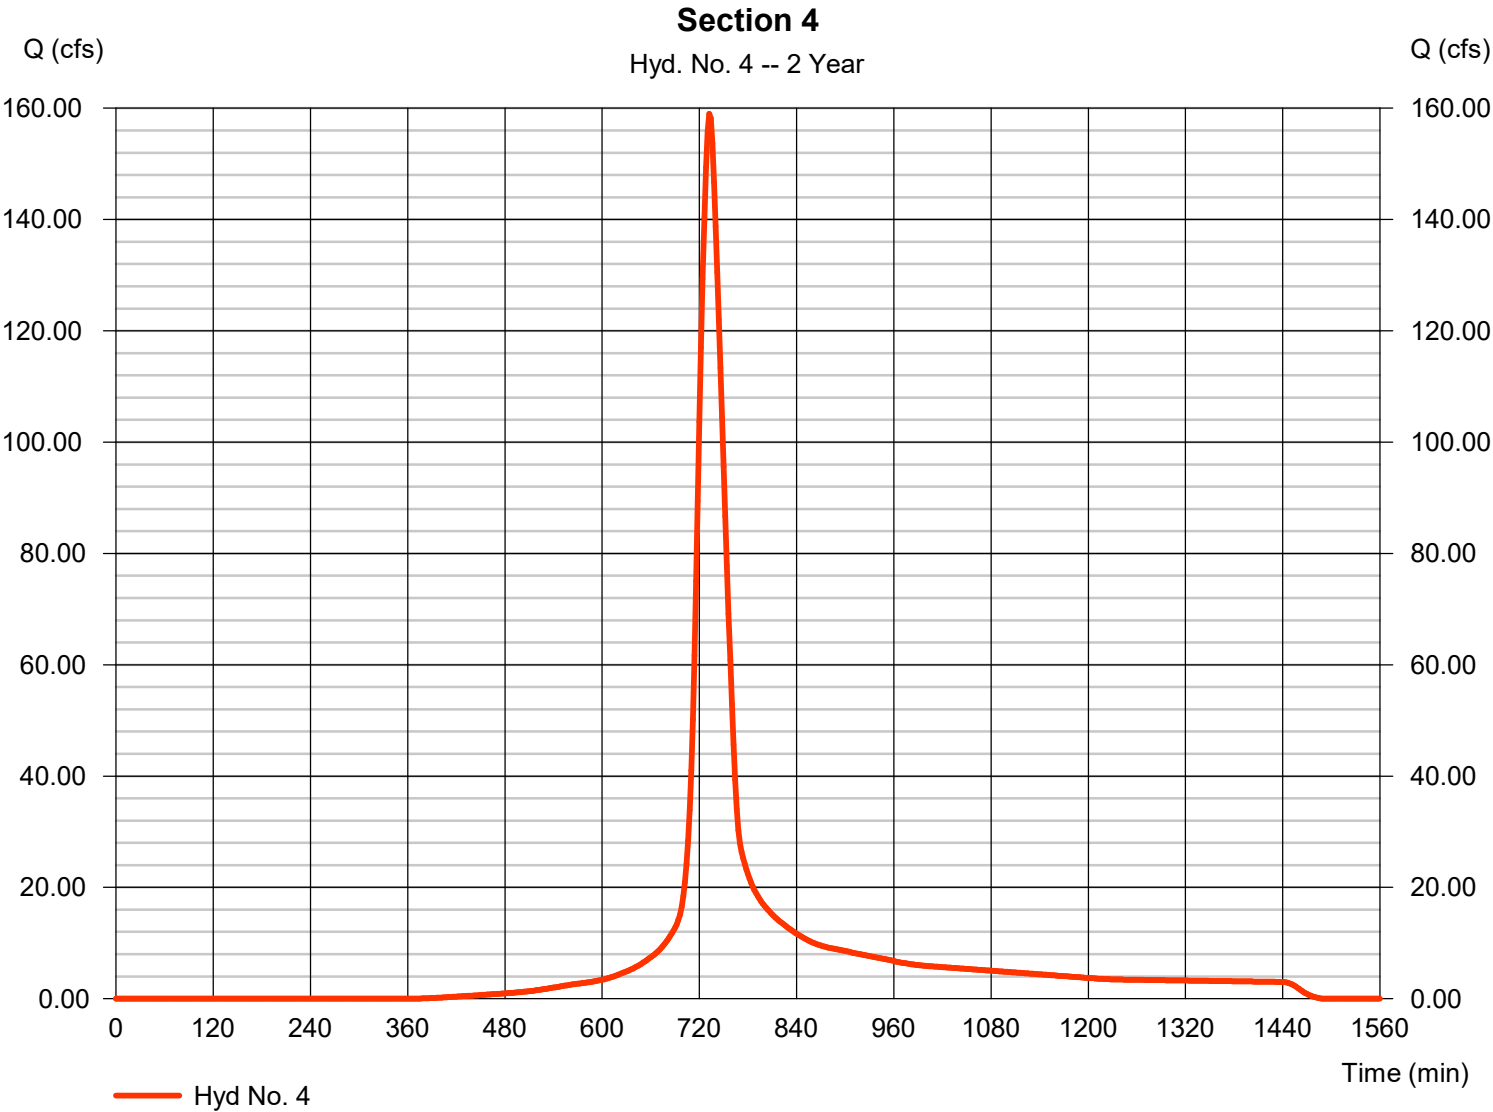

TR55 Tc Worksheet

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Hyd. No. 4

Section 4

<u>Description</u>	<u>A</u>	<u>B</u>	<u>C</u>	<u>Totals</u>
Sheet Flow				
Manning's n-value	= 0.240	0.011	0.011	
Flow length (ft)	= 100.0	0.0	0.0	
Two-year 24-hr precip. (in)	= 2.20	0.00	0.00	
Land slope (%)	= 1.00	0.00	0.00	
Travel Time (min)	= 22.71	+ 0.00	+ 0.00	= 22.71
Shallow Concentrated Flow				
Flow length (ft)	= 900.00	0.00	0.00	
Watercourse slope (%)	= 1.50	0.00	0.00	
Surface description	= Unpaved	Paved	Paved	
Average velocity (ft/s)	=1.98	0.00	0.00	
Travel Time (min)	= 7.59	+ 0.00	+ 0.00	= 7.59
Channel Flow				
X sectional flow area (sqft)	= 10.00	0.00	0.00	
Wetted perimeter (ft)	= 6.00	0.00	0.00	
Channel slope (%)	= 5.10	0.00	0.00	
Manning's n-value	= 0.015	0.015	0.015	
Velocity (ft/s)	=31.59	0.00	0.00	
Flow length (ft)	(\{0\})700.0	0.0	0.0	
Travel Time (min)	= 0.37	+ 0.00	+ 0.00	= 0.37
Total Travel Time, Tc				30.70 min


Hydrograph Report

Hyd. No. 5

Section 5

Hydrograph type	=	SCS Runoff	Peak discharge	=	221.05 cfs
Storm frequency	=	2 yrs	Time to peak	=	722 min
Time interval	=	2 min	Hyd. volume	=	620,159 cuft
Drainage area	=	86.900 ac	Curve number	=	85*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	15.60 min
Total precip.	=	3.50 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(40.000 x 98) + (46.900 x 74)] / 86.900

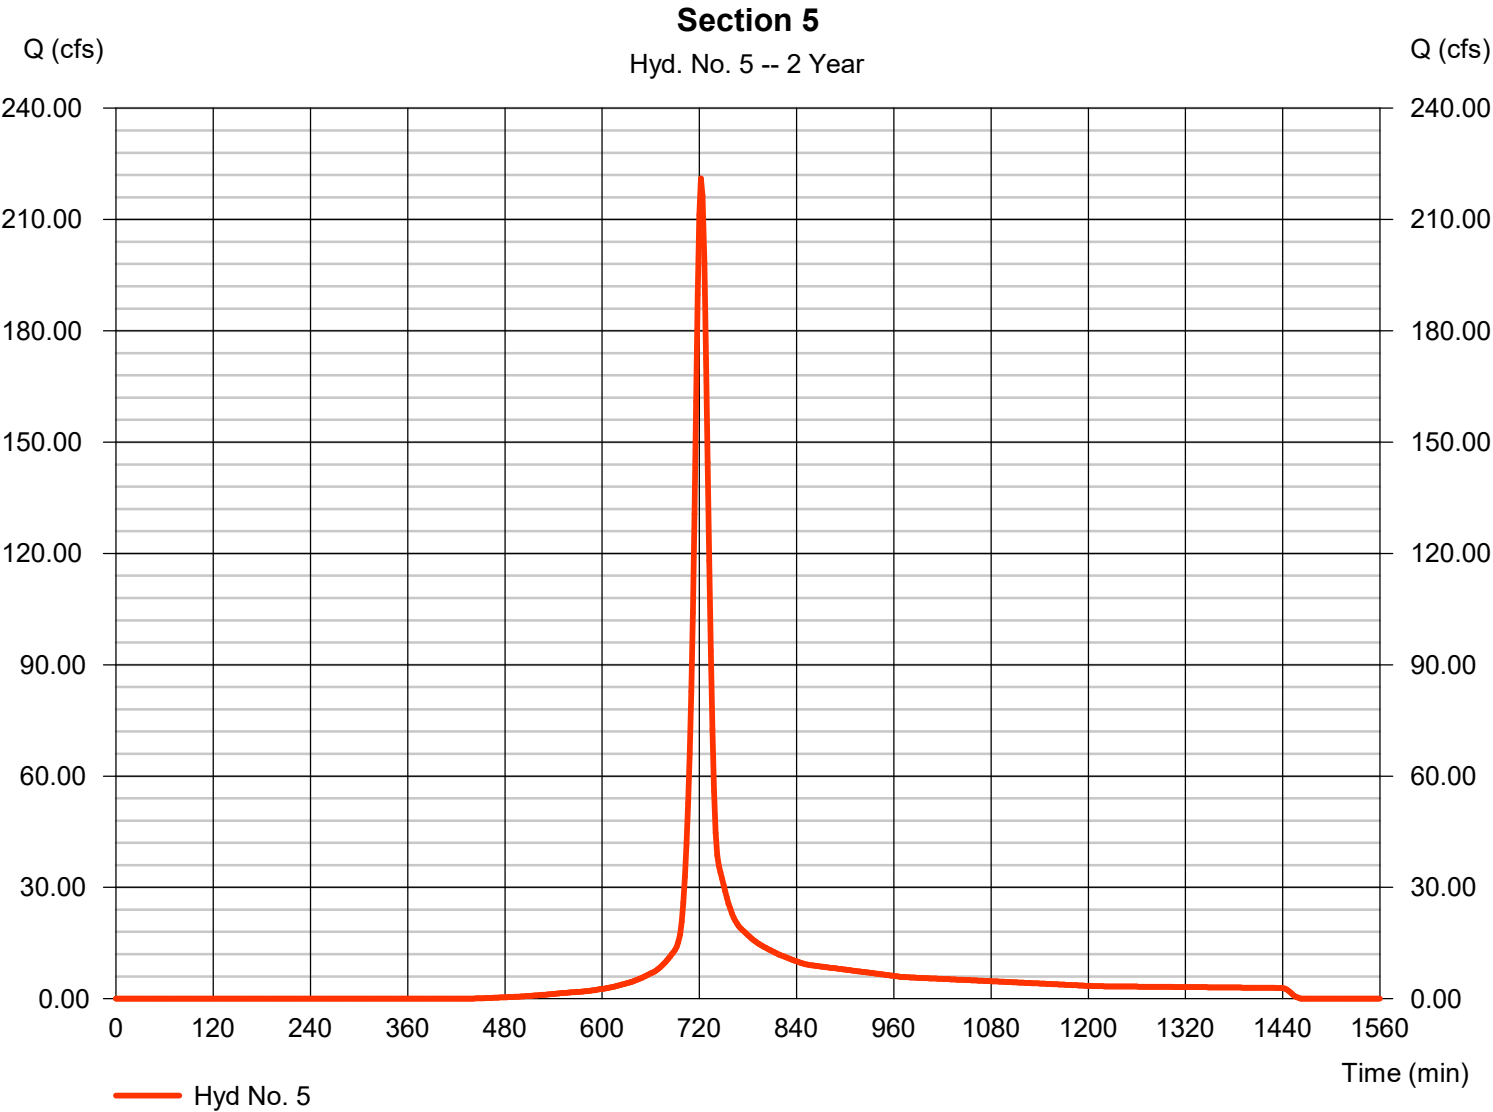

TR55 Tc Worksheet

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Hyd. No. 5

Section 5

<u>Description</u>	<u>A</u>	<u>B</u>	<u>C</u>	<u>Totals</u>
Sheet Flow				
Manning's n-value	= 0.024	0.011	0.011	
Flow length (ft)	= 100.0	0.0	0.0	
Two-year 24-hr precip. (in)	= 3.50	0.00	0.00	
Land slope (%)	= 1.00	0.00	0.00	
Travel Time (min)	= 2.85	+	0.00	+
			0.00	= 2.85
Shallow Concentrated Flow				
Flow length (ft)	= 1150.00	0.00	0.00	
Watercourse slope (%)	= 1.00	0.00	0.00	
Surface description	= Unpaved	Paved	Paved	
Average velocity (ft/s)	=1.61	0.00	0.00	
Travel Time (min)	= 11.88	+	0.00	+
			0.00	= 11.88
Channel Flow				
X sectional flow area (sqft)	= 24.00	50.00	0.00	
Wetted perimeter (ft)	= 14.00	20.00	0.00	
Channel slope (%)	= 3.20	2.50	0.00	
Manning's n-value	= 0.050	0.015	0.025	
Velocity (ft/s)	=7.65			
		29.02		
			0.00	
Flow length (ft)	(0)250.0	550.0	0.0	
Travel Time (min)	= 0.54	+	0.32	+
			0.00	= 0.86
Total Travel Time, Tc				15.60 min


Hydrograph Report

Hyd. No. 6

Section 6

Hydrograph type	=	SCS Runoff	Peak discharge	=	32.72 cfs
Storm frequency	=	2 yrs	Time to peak	=	724 min
Time interval	=	2 min	Hyd. volume	=	104,234 cuft
Drainage area	=	11.300 ac	Curve number	=	91*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	18.60 min
Total precip.	=	3.50 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(11.300 x 91)] / 11.300

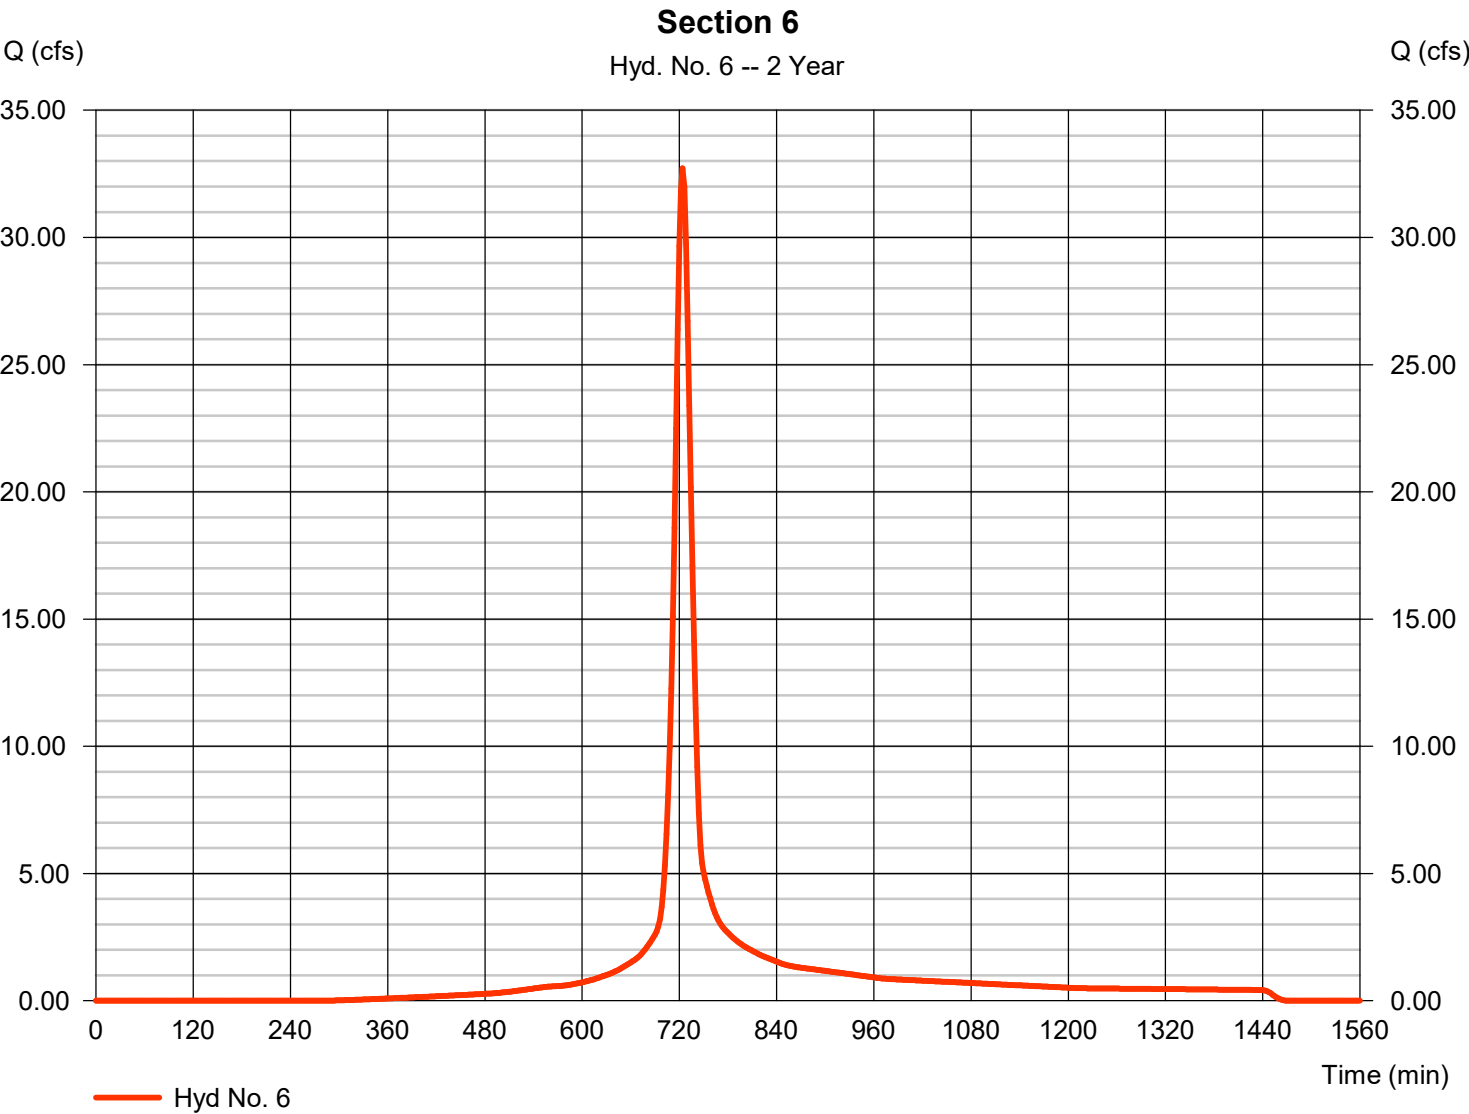

TR55 Tc Worksheet

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Hyd. No. 6

Section 6

<u>Description</u>	<u>A</u>	<u>B</u>	<u>C</u>	<u>Totals</u>
Sheet Flow				
Manning's n-value	= 0.240	0.011	0.011	
Flow length (ft)	= 100.0	0.0	0.0	
Two-year 24-hr precip. (in)	= 3.50	0.00	0.00	
Land slope (%)	= 2.00	0.00	0.00	
Travel Time (min)	= 13.64	+ 0.00	+ 0.00	= 13.64
Shallow Concentrated Flow				
Flow length (ft)	= 800.00	0.00	0.00	
Watercourse slope (%)	= 13.80	0.00	0.00	
Surface description	= Unpaved	Paved	Paved	
Average velocity (ft/s)	=5.99	0.00	0.00	
Travel Time (min)	= 2.22	+ 0.00	+ 0.00	= 2.22
Channel Flow				
X sectional flow area (sqft)	= 12.60	7.00	0.00	
Wetted perimeter (ft)	= 12.56	9.40	0.00	
Channel slope (%)	= 1.00	3.00	0.00	
Manning's n-value	= 0.030	0.015	0.015	
Velocity (ft/s)	=4.98	14.12	0.00	
Flow length (ft)	(700.0)	300.0	0.0	
Travel Time (min)	= 2.34	+ 0.35	+ 0.00	= 2.70
Total Travel Time, Tc				18.60 min


Hydrograph Report

Hyd. No. 7

Section 7/8-Pre

Hydrograph type	= SCS Runoff	Peak discharge	= 134.69 cfs
Storm frequency	= 2 yrs	Time to peak	= 728 min
Time interval	= 2 min	Hyd. volume	= 496,946 cuft
Drainage area	= 59.000 ac	Curve number	= 89*
Basin Slope	= 0.0 %	Hydraulic length	= 0 ft
Tc method	= TR55	Time of conc. (Tc)	= 25.20 min
Total precip.	= 3.50 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

* Composite (Area/CN) = [(59.000 x 79)] / 59.000

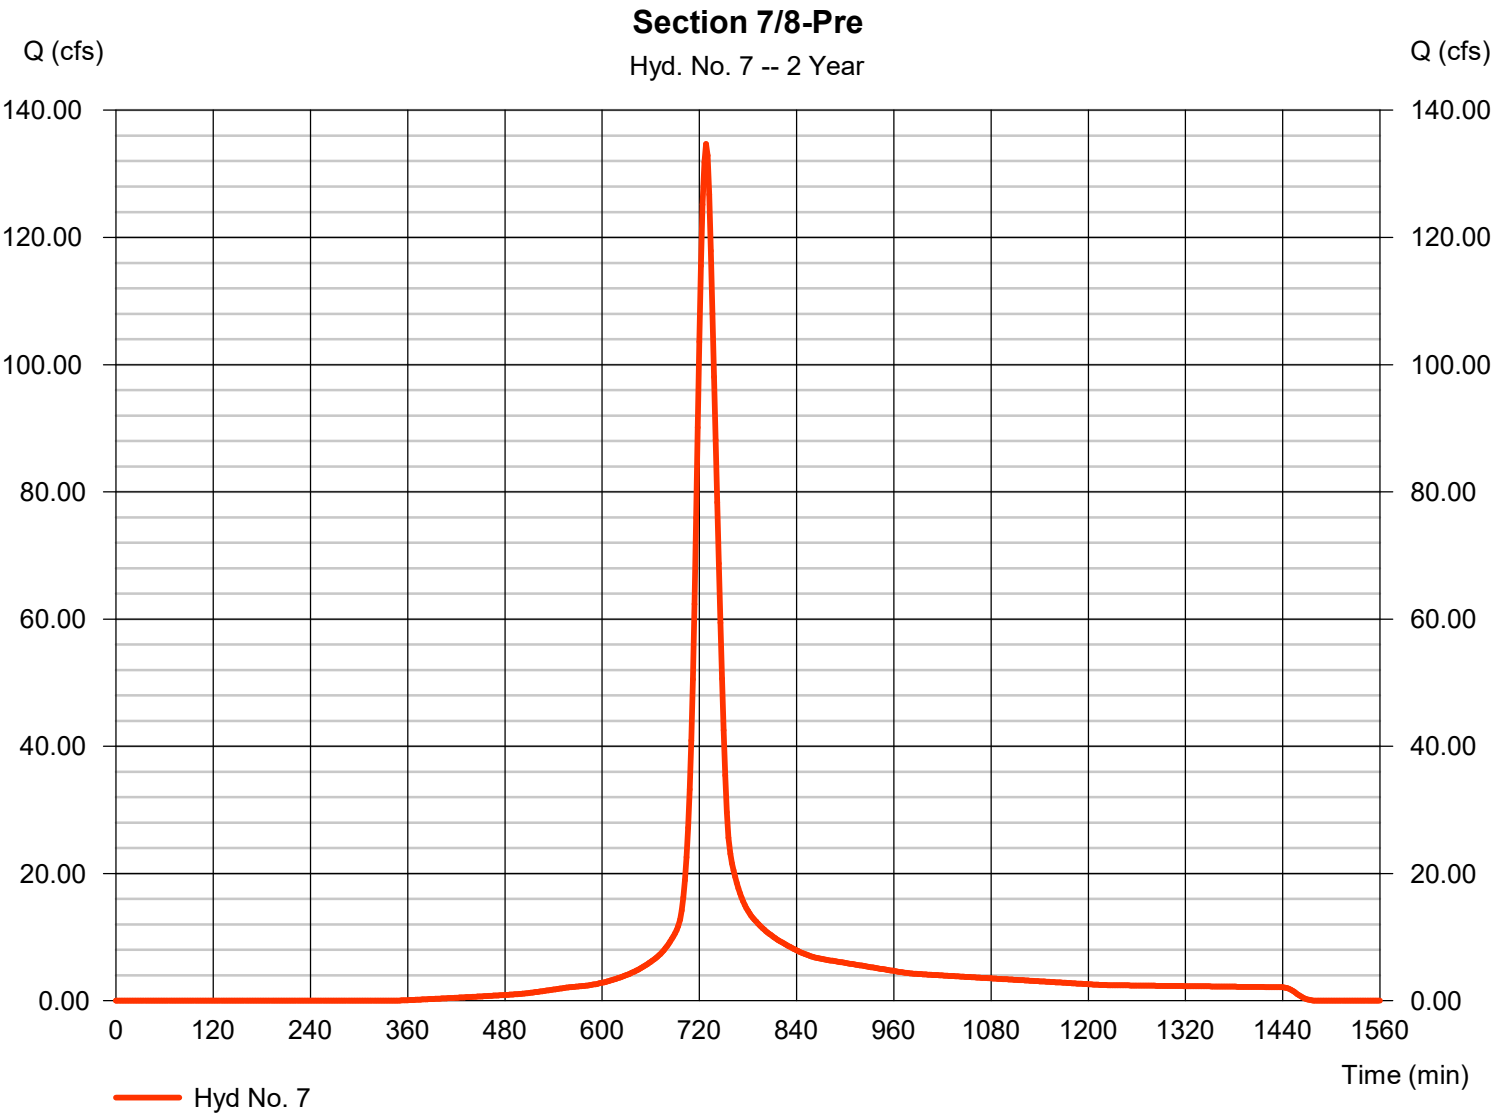

TR55 Tc Worksheet

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Hyd. No. 7

Section 7/8-Pre


<u>Description</u>	<u>A</u>	<u>B</u>	<u>C</u>	<u>Totals</u>
Sheet Flow				
Manning's n-value	= 0.240	0.011	0.011	
Flow length (ft)	= 100.0	0.0	0.0	
Two-year 24-hr precip. (in)	= 3.10	0.00	0.00	
Land slope (%)	= 1.00	0.00	0.00	
Travel Time (min)	= 19.13	+	0.00	+
			0.00	= 19.13
Shallow Concentrated Flow				
Flow length (ft)	= 1000.00	0.00	0.00	
Watercourse slope (%)	= 4.50	0.00	0.00	
Surface description	= Unpaved	Paved	Paved	
Average velocity (ft/s)	=3.42	0.00	0.00	
Travel Time (min)	= 4.87	+	0.00	+
			0.00	= 4.87
Channel Flow				
X sectional flow area (sqft)	= 3.14	0.00	0.00	
Wetted perimeter (ft)	= 6.30	0.00	0.00	
Channel slope (%)	= 1.50	0.00	0.00	
Manning's n-value	= 0.015	0.015	0.025	
Velocity (ft/s)	=7.63	0.00	0.00	
Flow length (ft)	({})550.0	0.0	0.0	
Travel Time (min)	= 1.20	+	0.00	+
			0.00	= 1.20
Total Travel Time, Tc				25.20 min

Hydrograph Report

Hyd. No. 8

Industrial Complex to Detention

Hydrograph type	= Combine	Peak discharge	= 365.68 cfs
Storm frequency	= 2 yrs	Time to peak	= 730 min
Time interval	= 2 min	Hyd. volume	= 1,417,466 cuft
Inflow hyds.	= 1, 2, 3	Contrib. drain. area	= 250.500 ac

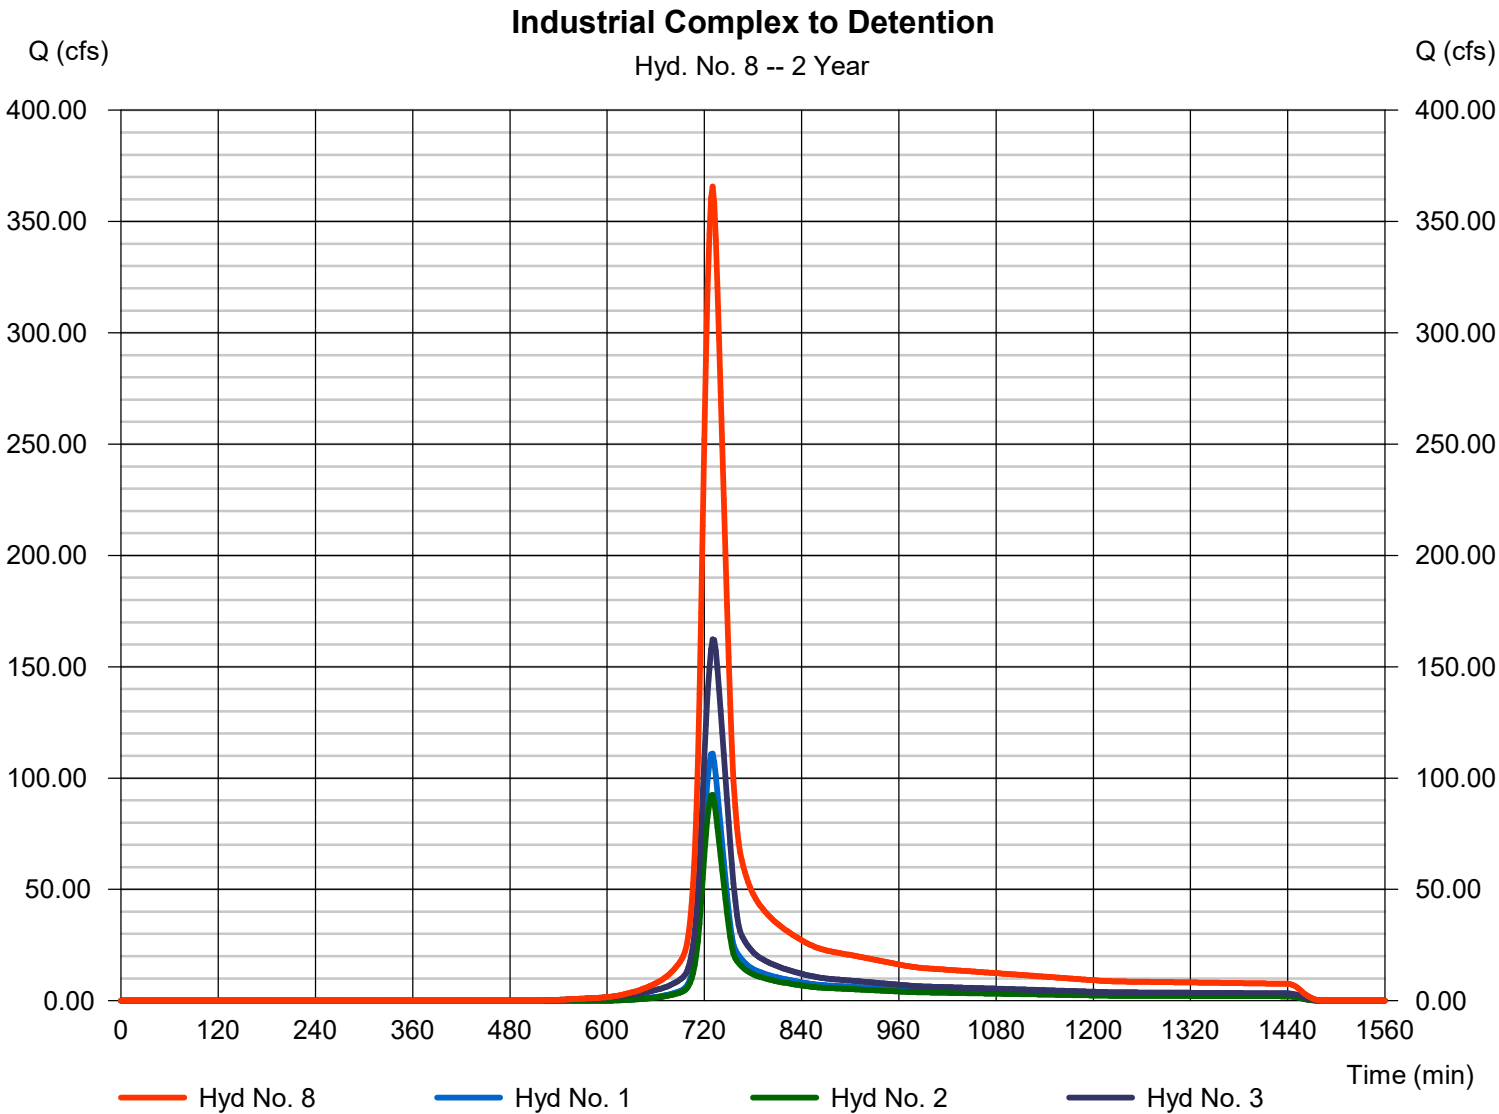

Hydrograph Report


Hyd. No. 9

Industrial Above Ground Detention Pond

Hydrograph type	= Reach	Peak discharge	= 344.64 cfs
Storm frequency	= 2 yrs	Time to peak	= 734 min
Time interval	= 2 min	Hyd. volume	= 1,417,464 cuft
Inflow hyd. No.	= 8 - Industrial Complex to Detention Pond	Section type	= Trapezoidal
Reach length	= 1000.0 ft	Channel slope	= 2.0 %
Manning's n	= 0.020	Bottom width	= 150.0 ft
Side slope	= 30.0:1	Max. depth	= 16.0 ft
Rating curve x	= 0.373	Rating curve m	= 1.407
Ave. velocity	= 2.73 ft/s	Routing coeff.	= 0.3748

Modified Att-Kin routing method used.

Industrial Above Ground Detention Pond

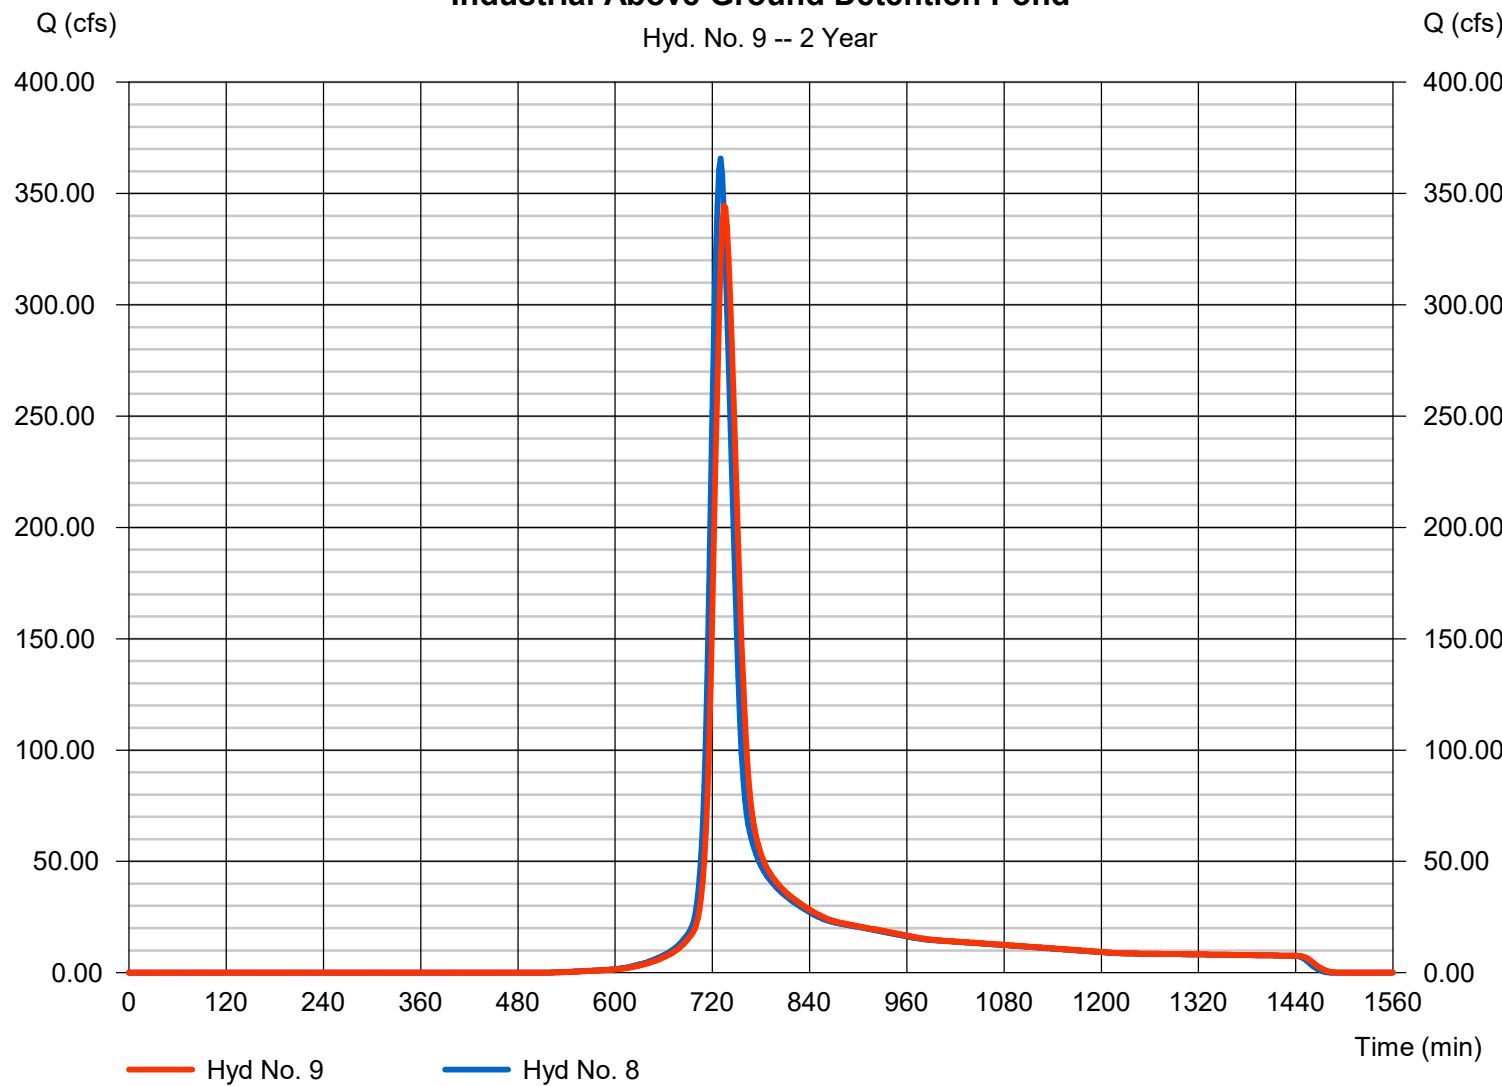

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Thursday, 03 / 28 / 2024


Hyd. No. 10

Strother Road Culvert

Hydrograph type	= Combine	Peak discharge	= 502.85 cfs
Storm frequency	= 2 yrs	Time to peak	= 734 min
Time interval	= 2 min	Hyd. volume	= 2,105,367 cuft
Inflow hyds.	= 4, 9	Contrib. drain. area	= 82.500 ac

Strother Road Culvert

Hyd. No. 10 -- 2 Year

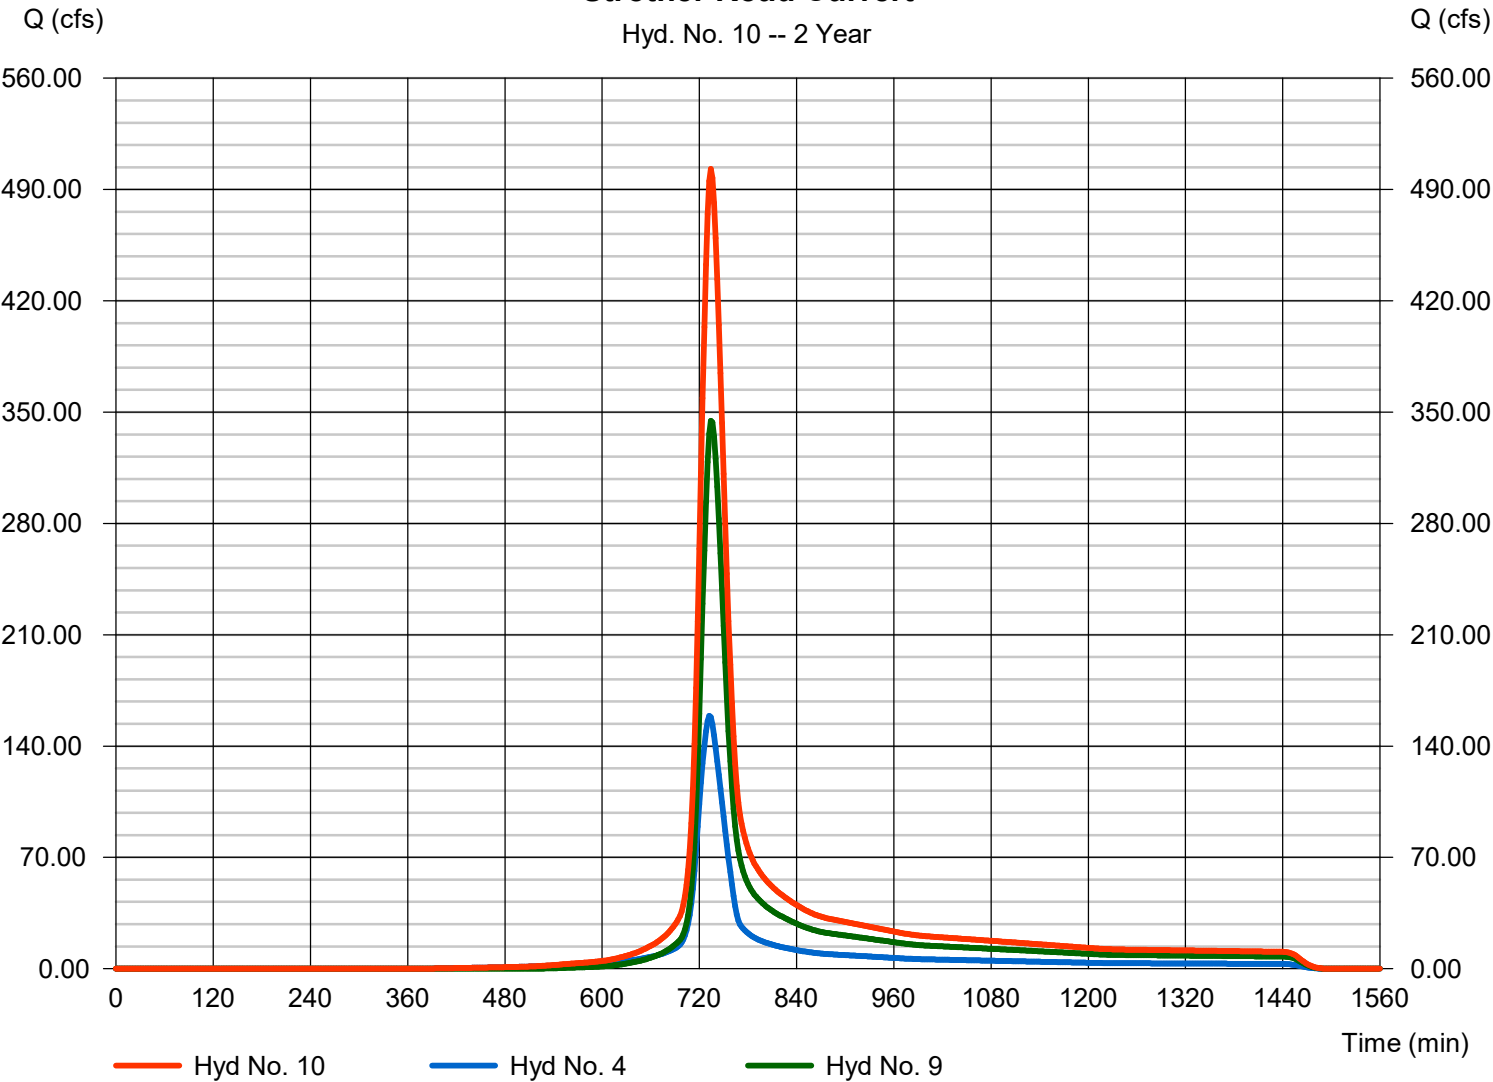

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 11

Wilshire Existing Stream

Hydrograph type	= Reach	Peak discharge	= 470.44 cfs
Storm frequency	= 2 yrs	Time to peak	= 740 min
Time interval	= 2 min	Hyd. volume	= 2,105,365 cuft
Inflow hyd. No.	= 10 - Strother Road Culvert	Section type	= Trapezoidal
Reach length	= 2200.0 ft	Channel slope	= 1.4 %
Manning's n	= 0.030	Bottom width	= 5.0 ft
Side slope	= 20.0:1	Max. depth	= 5.0 ft
Rating curve x	= 2.009	Rating curve m	= 1.231
Ave. velocity	= 5.66 ft/s	Routing coeff.	= 0.3193

Modified Att-Kin routing method used.

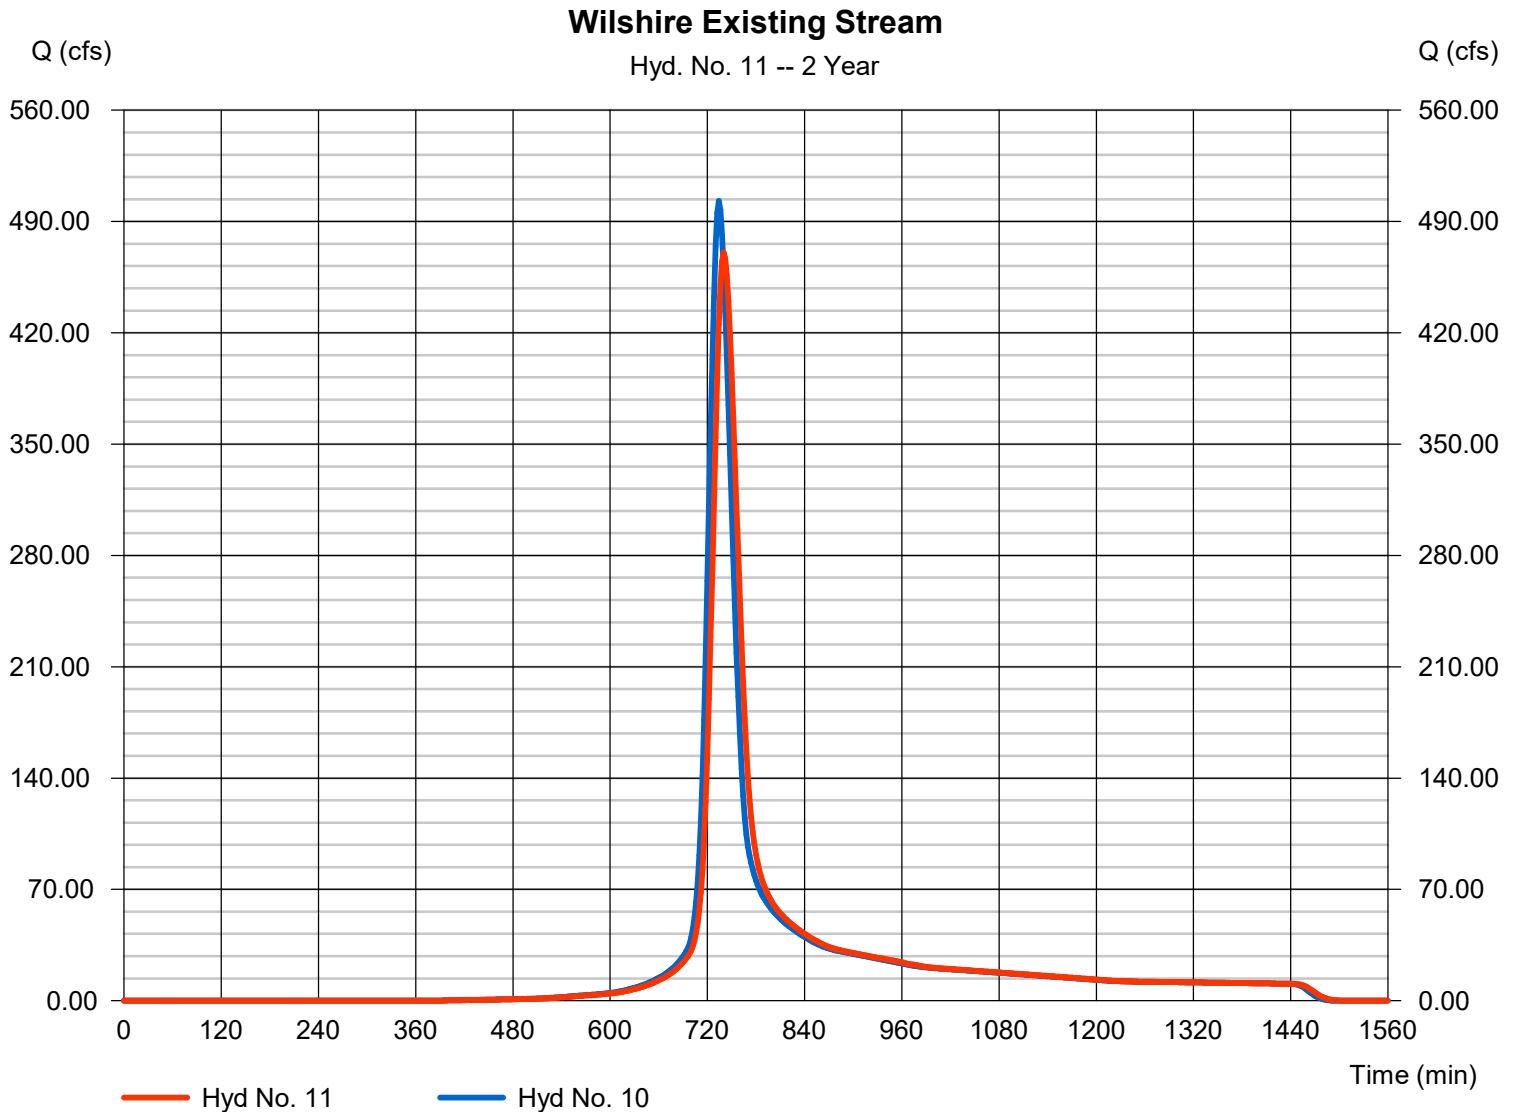

Hydrograph Report


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Thursday, 03 / 28 / 2024

Hyd. No. 12

OVERALL PRE

Hydrograph type	= Combine	Peak discharge	= 660.85 cfs
Storm frequency	= 2 yrs	Time to peak	= 732 min
Time interval	= 2 min	Hyd. volume	= 3,326,706 cuft
Inflow hyds.	= 5, 6, 7, 11	Contrib. drain. area	= 157.200 ac

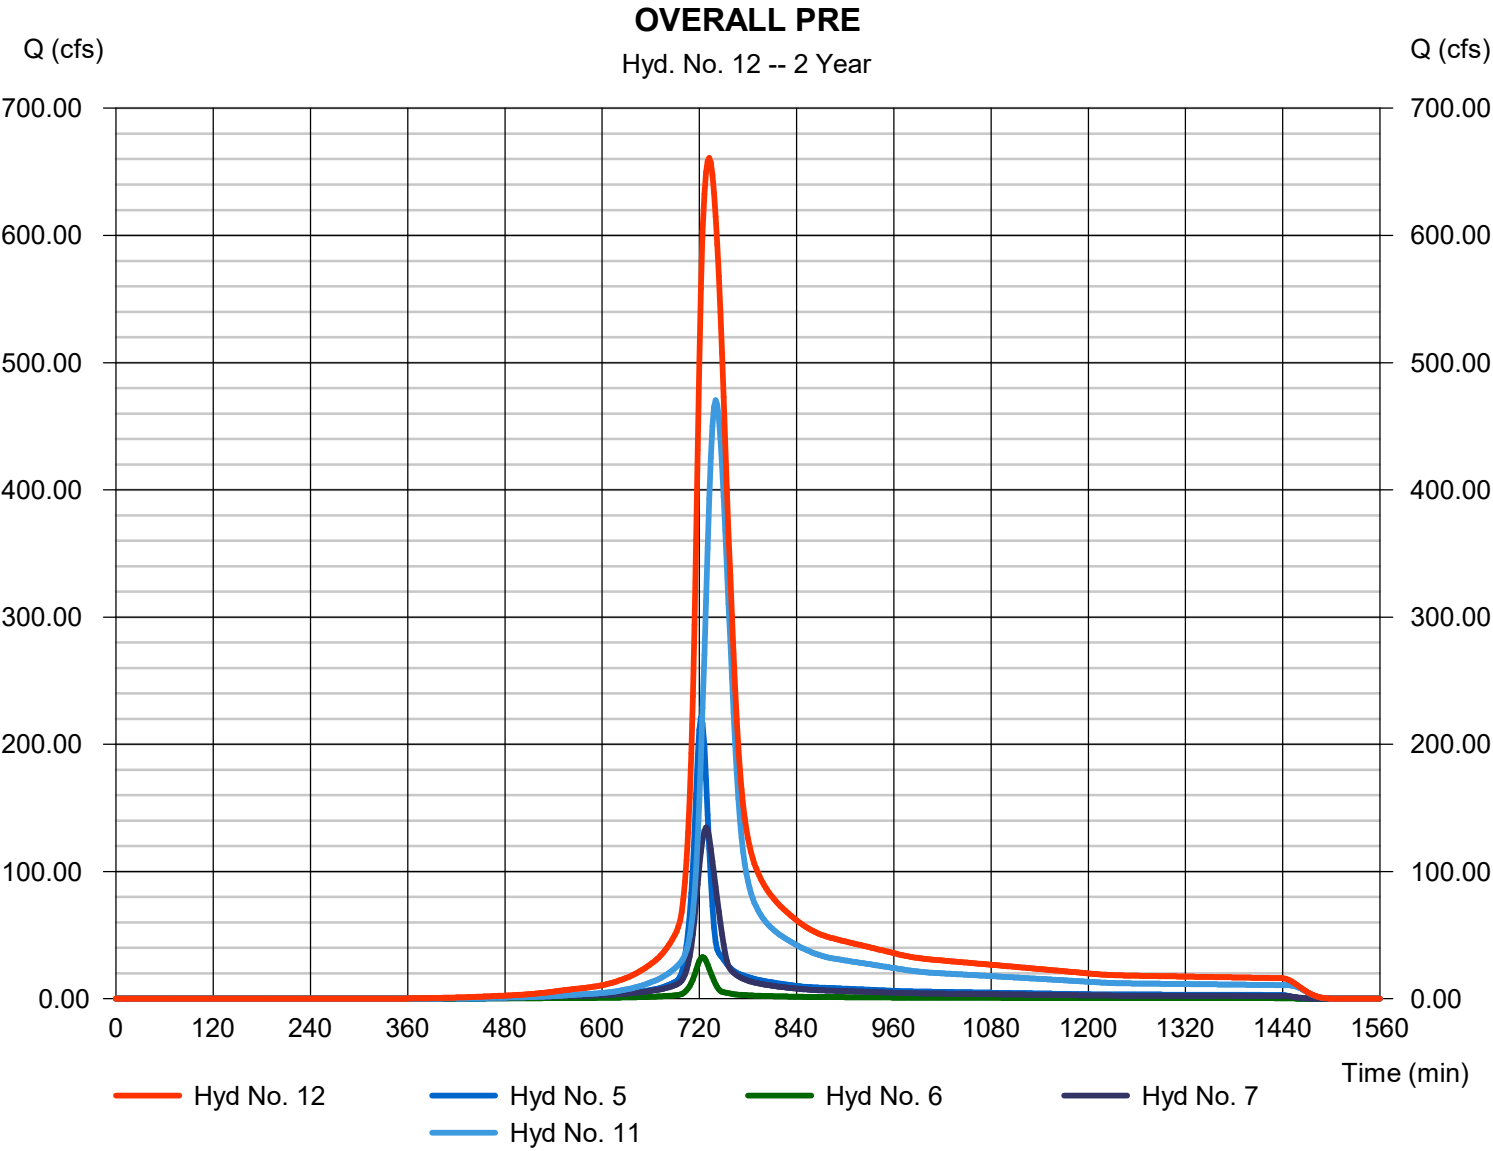


Hydrograph Report

Hyd. No. 13

Section 7A-Post

Hydrograph type	= SCS Runoff	Peak discharge	= 54.00 cfs
Storm frequency	= 2 yrs	Time to peak	= 724 min
Time interval	= 2 min	Hyd. volume	= 170,275 cuft
Drainage area	= 19.900 ac	Curve number	= 89*
Basin Slope	= 0.0 %	Hydraulic length	= 0 ft
Tc method	= TR55	Time of conc. (Tc)	= 19.30 min
Total precip.	= 3.50 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

* Composite (Area/CN) = [(19.900 x 89)] / 19.900

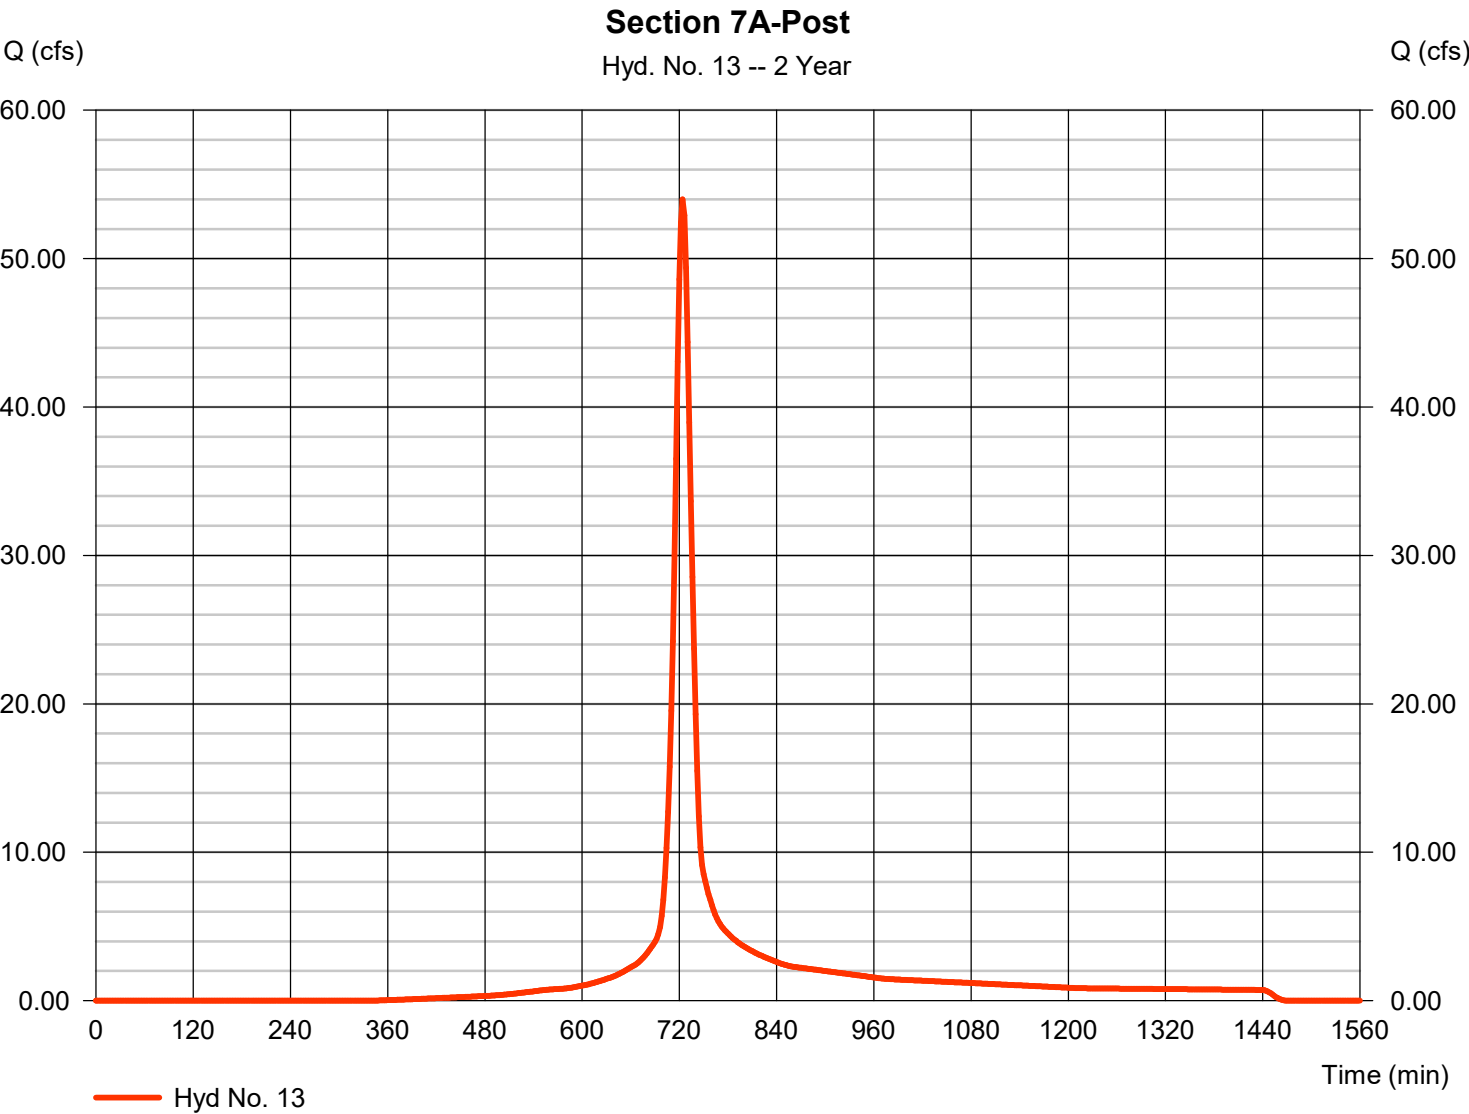

TR55 Tc Worksheet

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Hyd. No. 13

Section 7A-Post

<u>Description</u>	<u>A</u>	<u>B</u>	<u>C</u>	<u>Totals</u>
Sheet Flow				
Manning's n-value	= 0.240	0.011	0.011	
Flow length (ft)	= 100.0	0.0	0.0	
Two-year 24-hr precip. (in)	= 3.50	0.00	0.00	
Land slope (%)	= 2.00	0.00	0.00	
Travel Time (min)	= 13.64	+	0.00	+
			0.00	= 13.64
Shallow Concentrated Flow				
Flow length (ft)	= 662.00	0.00	0.00	
Watercourse slope (%)	= 2.00	0.00	0.00	
Surface description	= Paved	Unpaved	Unpaved	
Average velocity (ft/s)	=2.87	0.00	0.00	
Travel Time (min)	= 3.84	+	0.00	+
			0.00	= 3.84
Channel Flow				
X sectional flow area (sqft)	= 1.52	4.21	0.00	
Wetted perimeter (ft)	= 3.32	5.54	0.00	
Channel slope (%)	= 2.00	1.00	0.00	
Manning's n-value	= 0.012	0.012	0.025	
Velocity (ft/s)	=10.39	10.33	0.00	
Flow length (ft)	({})383.0	725.0	0.0	
Travel Time (min)	= 0.61	+	1.17	+
			0.00	= 1.78
Total Travel Time, Tc				19.30 min


Hydrograph Report

Hyd. No. 14

Section 7B-Post (Wilshire Hills Bypass)

Hydrograph type	=	SCS Runoff	Peak discharge	=	4.168 cfs
Storm frequency	=	2 yrs	Time to peak	=	732 min
Time interval	=	2 min	Hyd. volume	=	20,473 cuft
Drainage area	=	7.500 ac	Curve number	=	65*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	28.28 min
Total precip.	=	3.50 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(13.900 x 74)] / 7.500

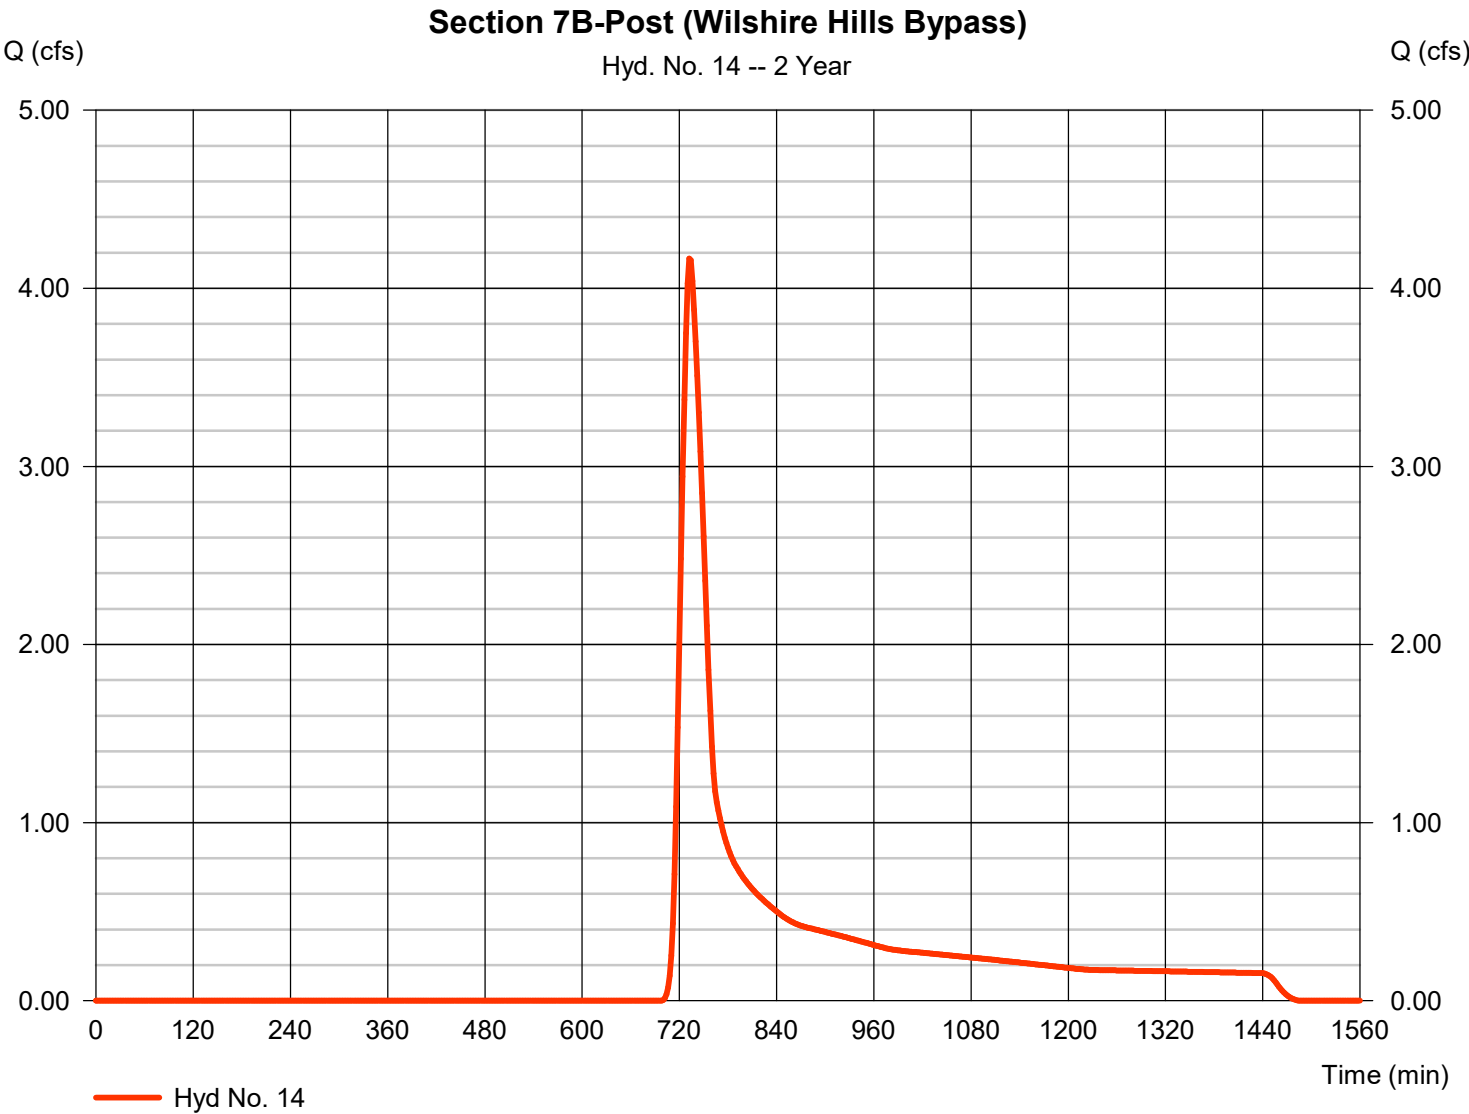

TR55 Tc Worksheet

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Hyd. No. 14

Section 7B-Post (Wilshire Hills Bypass)

<u>Description</u>	<u>A</u>	<u>B</u>	<u>C</u>	<u>Totals</u>			
Sheet Flow							
Manning's n-value	= 0.240	0.011	0.011				
Flow length (ft)	= 100.0	0.0	0.0				
Two-year 24-hr precip. (in)	= 3.10	0.00	0.00				
Land slope (%)	= 2.00	0.00	0.00				
Travel Time (min)	= 14.50	+	0.00	+	0.00	=	14.50
Shallow Concentrated Flow							
Flow length (ft)	= 850.00	0.00	0.00				
Watercourse slope (%)	= 2.00	5.00	1.00				
Surface description	= Unpaved	Unpaved	Unpaved				
Average velocity (ft/s)	=2.28	3.61	1.61				
Travel Time (min)	= 6.21	+	0.00	+	0.00	=	6.21
Channel Flow							
X sectional flow area (sqft)	= 2.00	5.00	0.00				
Wetted perimeter (ft)	= 12.00	31.00	0.00				
Channel slope (%)	= 0.50	2.00	0.00				
Manning's n-value	= 0.015	0.015	0.025				
Velocity (ft/s)	=2.11	4.14	0.00				
Flow length (ft)	(0)850.0	216.0	0.0				
Travel Time (min)	= 6.70	+	0.87	+	0.00	=	7.57
Total Travel Time, Tc				28.28 min			

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 15

Section 7C-Post (Wilshire Hills)

Hydrograph type	=	SCS Runoff	Peak discharge	=	46.96 cfs
Storm frequency	=	2 yrs	Time to peak	=	726 min
Time interval	=	2 min	Hyd. volume	=	163,125 cuft
Drainage area	=	18.730 ac	Curve number	=	89*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	User	Time of conc. (Tc)	=	20.60 min
Total precip.	=	3.50 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(18.730 x 89)] / 18.730

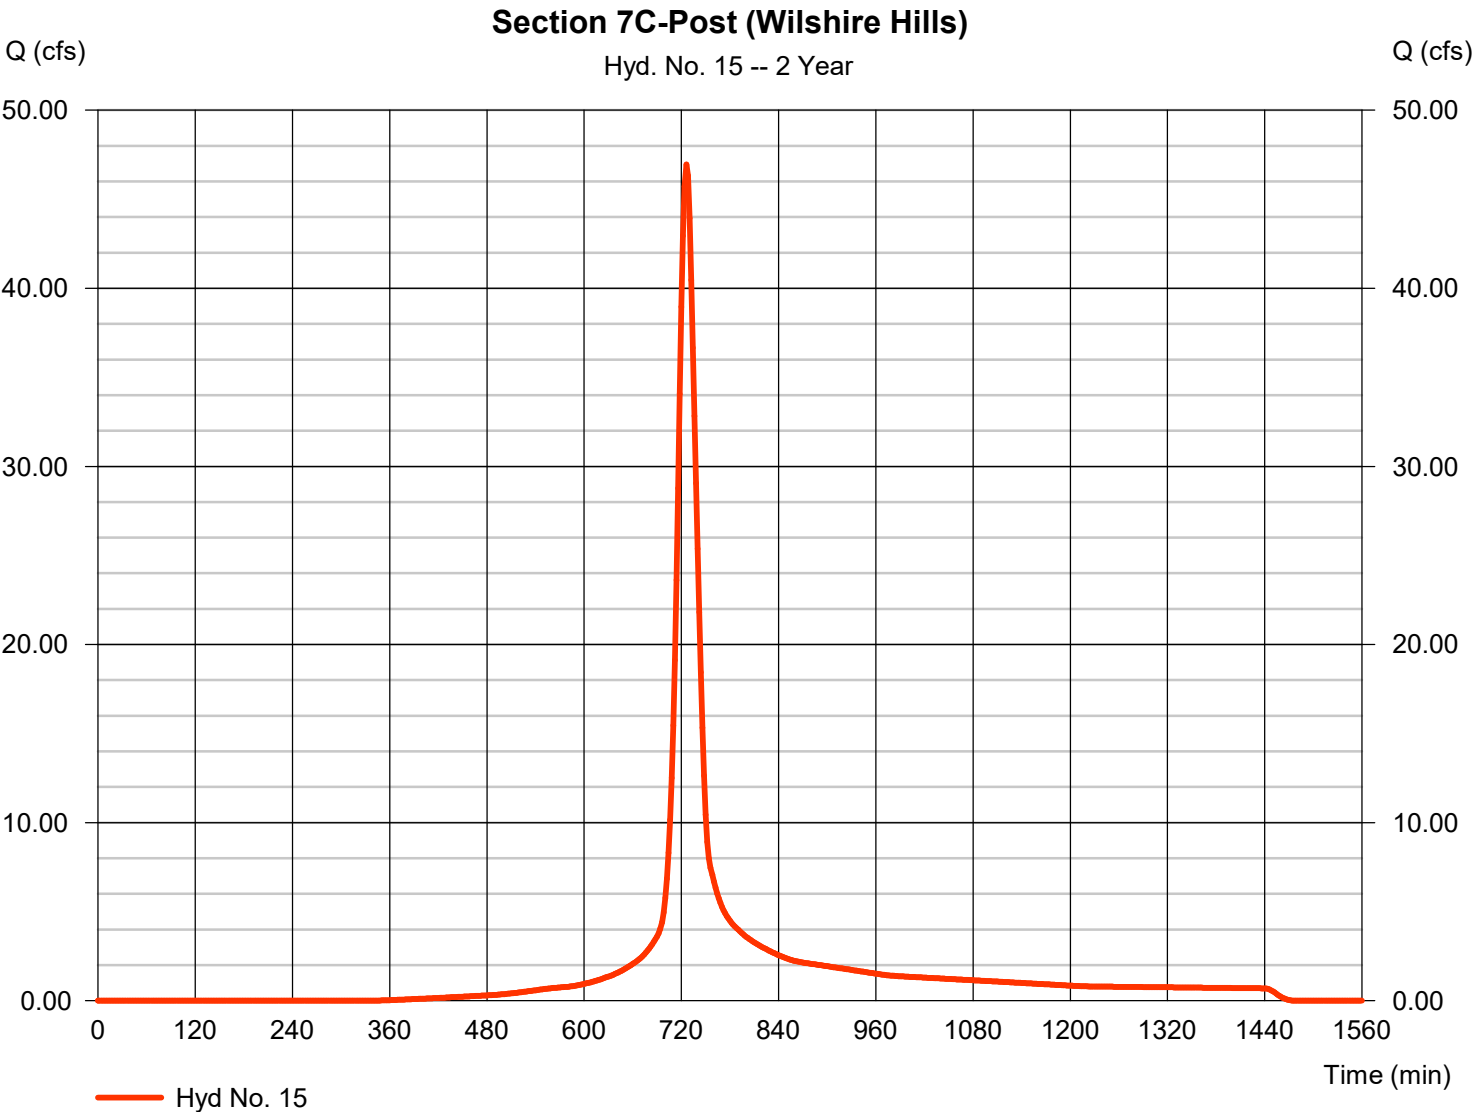

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 16

Wilshire- Preserved stream

Hydrograph type	= Reach	Peak discharge	= 478.83 cfs
Storm frequency	= 2 yrs	Time to peak	= 740 min
Time interval	= 2 min	Hyd. volume	= 2,105,365 cuft
Inflow hyd. No.	= 10 - Strother Road Culvert	Section type	= Trapezoidal
Reach length	= 500.0 ft	Channel slope	= 0.5 %
Manning's n	= 0.100	Bottom width	= 10.0 ft
Side slope	= 14.0:1	Max. depth	= 8.0 ft
Rating curve x	= 0.227	Rating curve m	= 1.318
Ave. velocity	= 1.46 ft/s	Routing coeff.	= 0.3749

Modified Att-Kin routing method used.

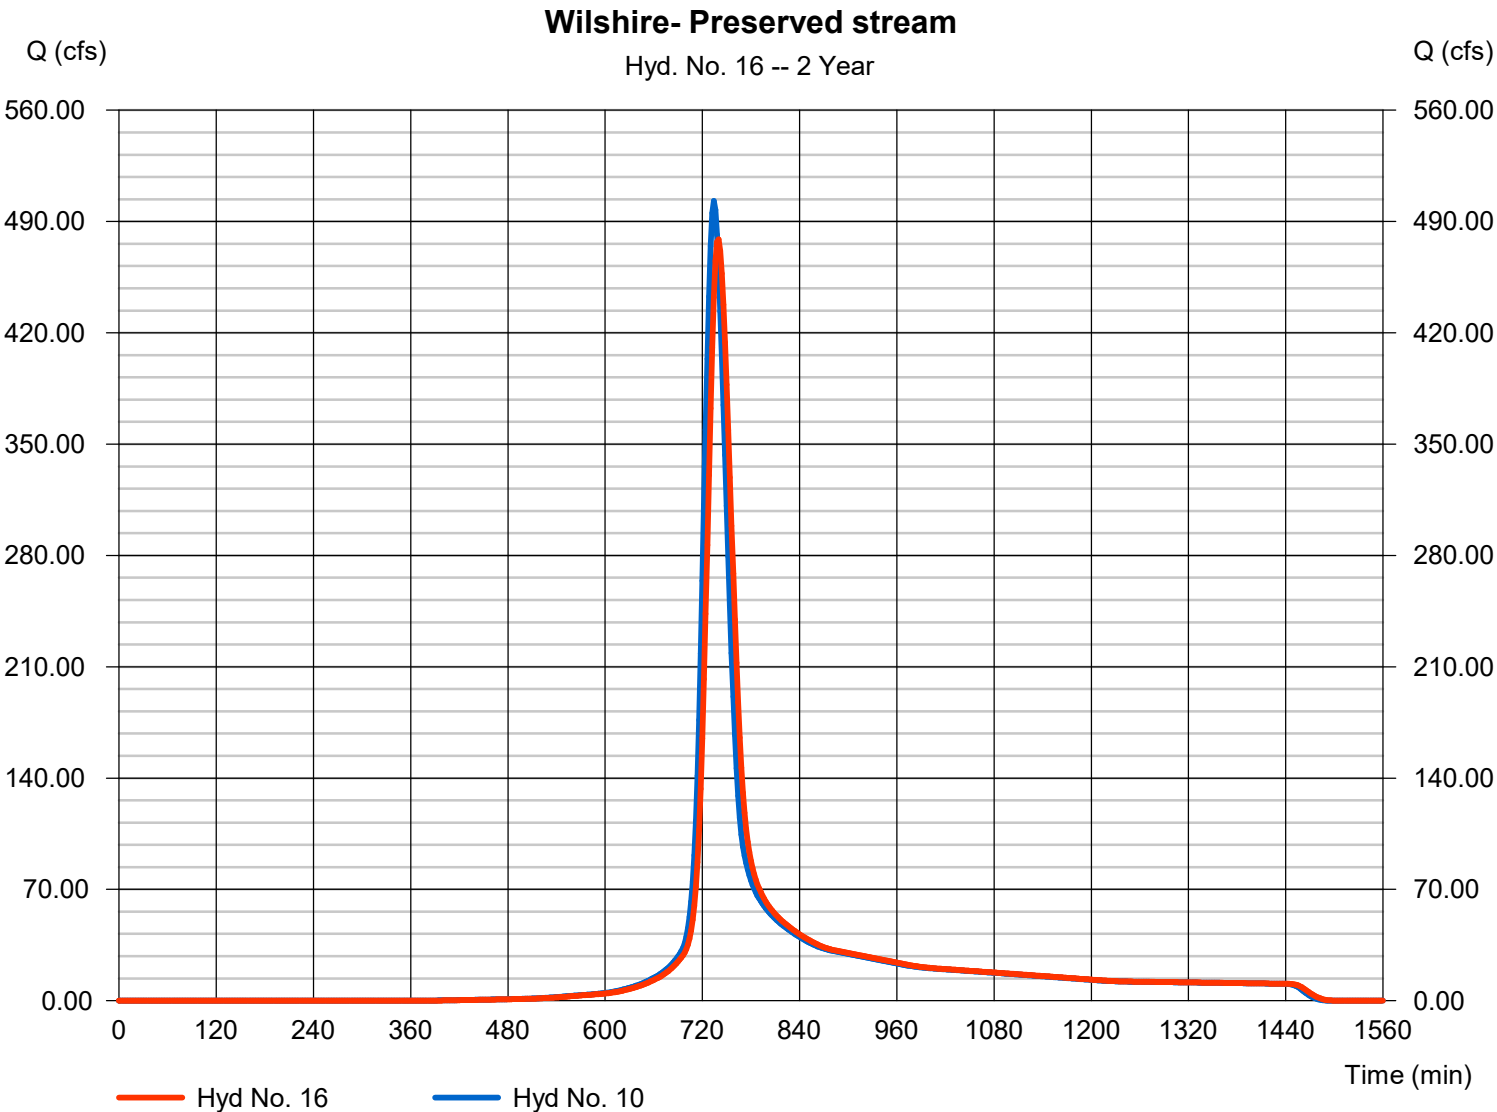


Hydrograph Report

Hyd. No. 17

Onsite Water

Hydrograph type	= Combine	Peak discharge	= 50.34 cfs
Storm frequency	= 2 yrs	Time to peak	= 726 min
Time interval	= 2 min	Hyd. volume	= 183,598 cuft
Inflow hyds.	= 14, 15	Contrib. drain. area	= 26.230 ac

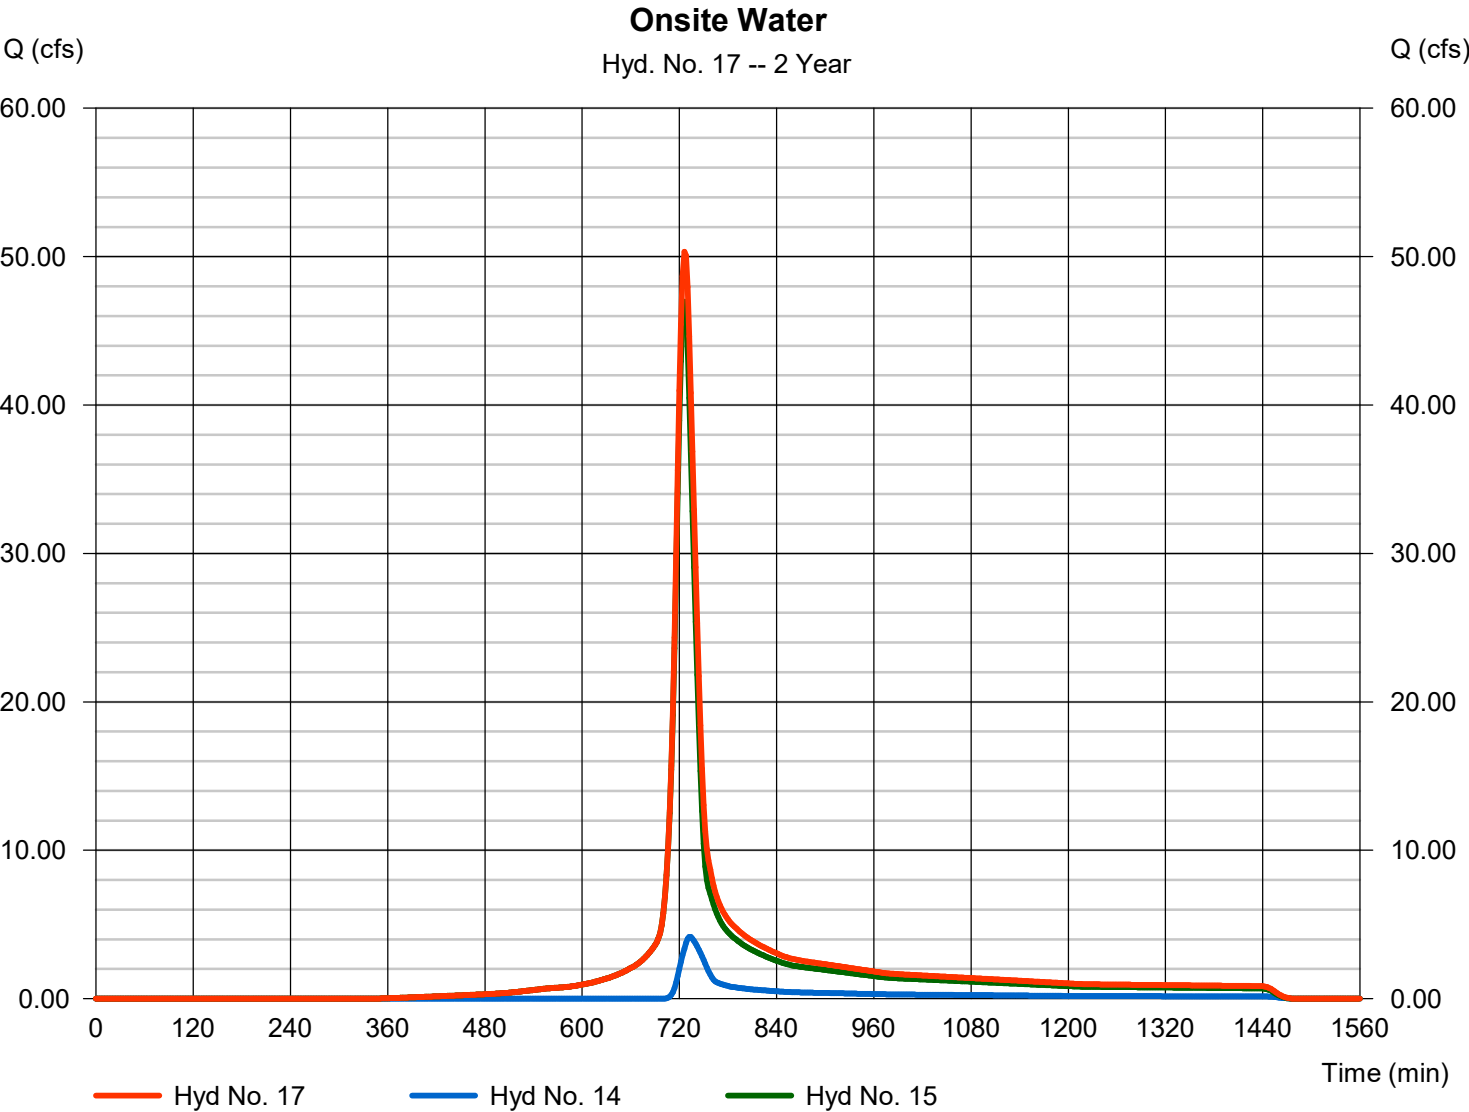

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 18

Detention Basin

Hydrograph type	= Reservoir	Peak discharge	= 16.23 cfs
Storm frequency	= 2 yrs	Time to peak	= 748 min
Time interval	= 2 min	Hyd. volume	= 183,584 cuft
Inflow hyd. No.	= 17 - Onsite Water	Max. Elevation	= 917.14 ft
Reservoir name	= Detention Basin	Max. Storage	= 81,774 cuft

Storage Indication method used.

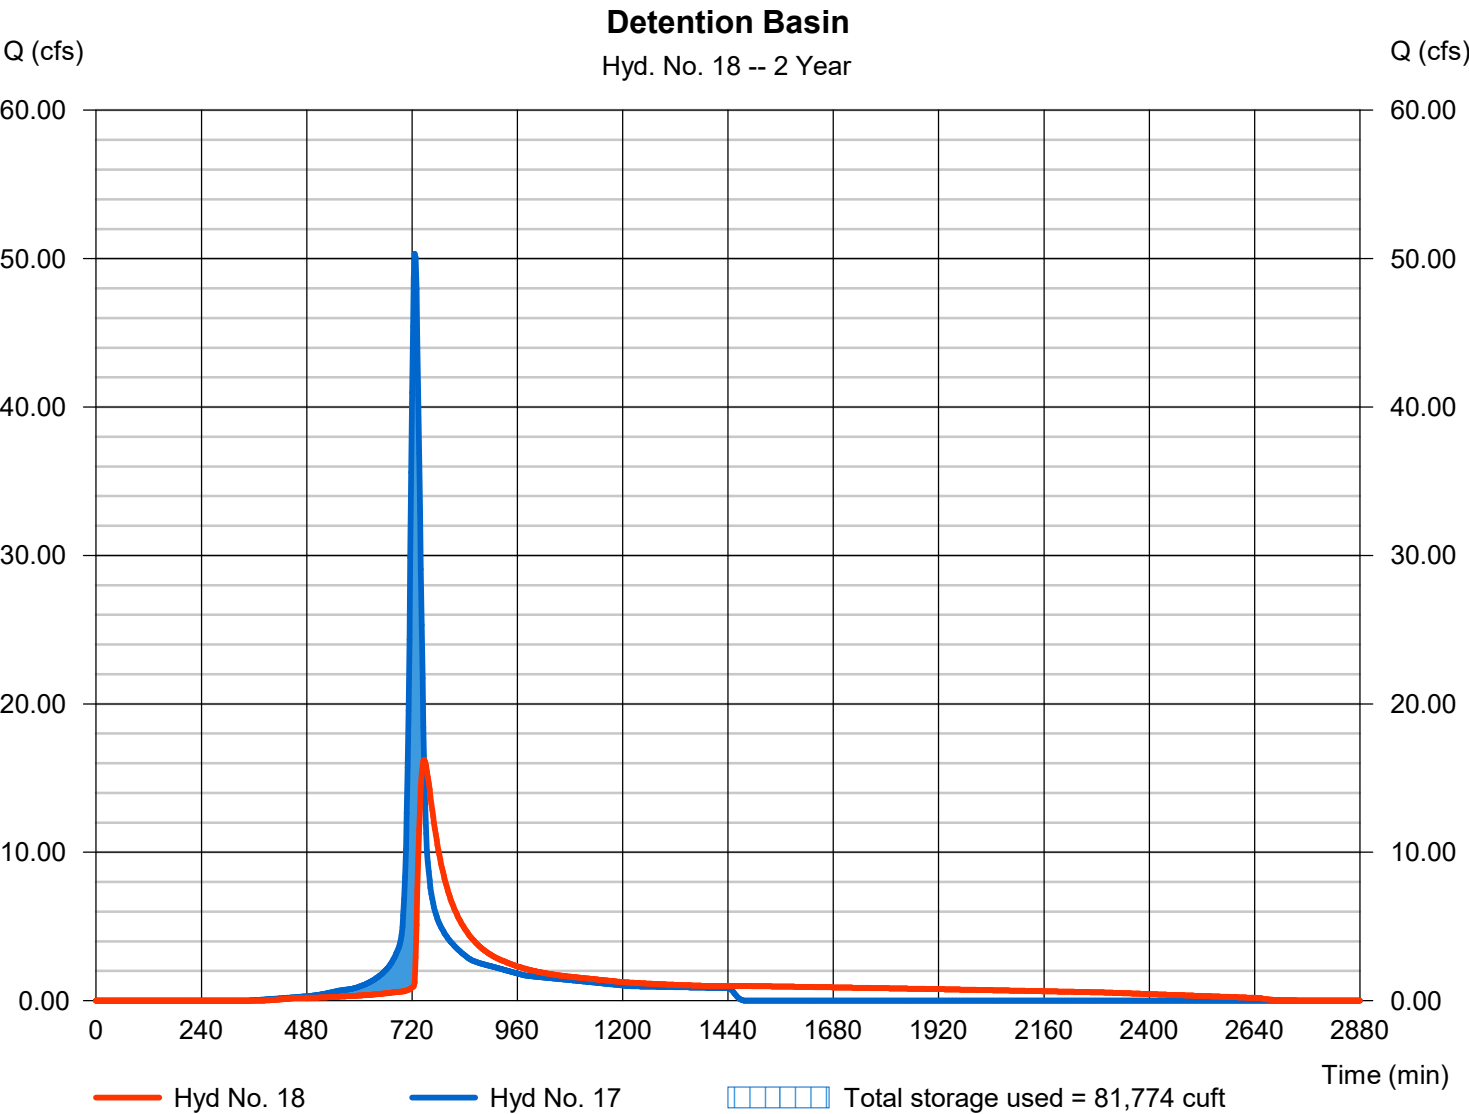

Pond No. 1 - Detention Basin

Pond Data

Contours -User-defined contour areas. Average end area method used for volume calculation. Beginning Elevation = 911.70 ft

Stage / Storage Table

Stage (ft)	Elevation (ft)	Contour area (sqft)	Incr. Storage (cuft)	Total storage (cuft)
0.00	911.70	00	0	0
0.30	912.00	2,386	358	358
1.30	913.00	13,639	8,013	8,370
2.30	914.00	15,509	14,574	22,944
3.30	915.00	17,465	16,487	39,431
4.30	916.00	19,505	18,485	57,916
5.30	917.00	21,926	20,716	78,632
6.30	918.00	23,832	22,879	101,511
7.30	919.00	26,575	25,204	126,714
8.30	920.00	29,956	28,265	154,980
9.30	921.00	31,503	30,730	185,709
10.30	922.00	33,676	32,590	218,299


Culvert / Orifice Structures

	[A]	[B]	[C]	[PrfRsr]
Rise (in)	= 42.00	4.50	Inactive	0.00
Span (in)	= 42.00	4.50	0.00	0.00
No. Barrels	= 1	1	0	0
Invert El. (ft)	= 911.50	911.70	0.00	0.00
Length (ft)	= 47.30	0.50	0.00	0.00
Slope (%)	= 0.20	0.00	0.00	n/a
N-Value	= .013	.013	.013	n/a
Orifice Coeff.	= 0.60	0.60	0.60	0.60
Multi-Stage	= n/a	Yes	No	No

Weir Structures

	[A]	[B]	[C]	[D]
Crest Len (ft)	= 25.00	2.20	0.00	0.00
Crest El. (ft)	= 920.96	915.50	0.00	0.00
Weir Coeff.	= 3.33	3.33	3.33	3.33
Weir Type	= 1	Rect	---	---
Multi-Stage	= Yes	Yes	No	No
Exfil.(in/hr)	= 0.000 (by Wet area)			
TW Elev. (ft)	= 0.00			

Note: Culvert/Orifice outflows are analyzed under inlet (ic) and outlet (oc) control. Weir risers checked for orifice conditions (ic) and submergence (s).

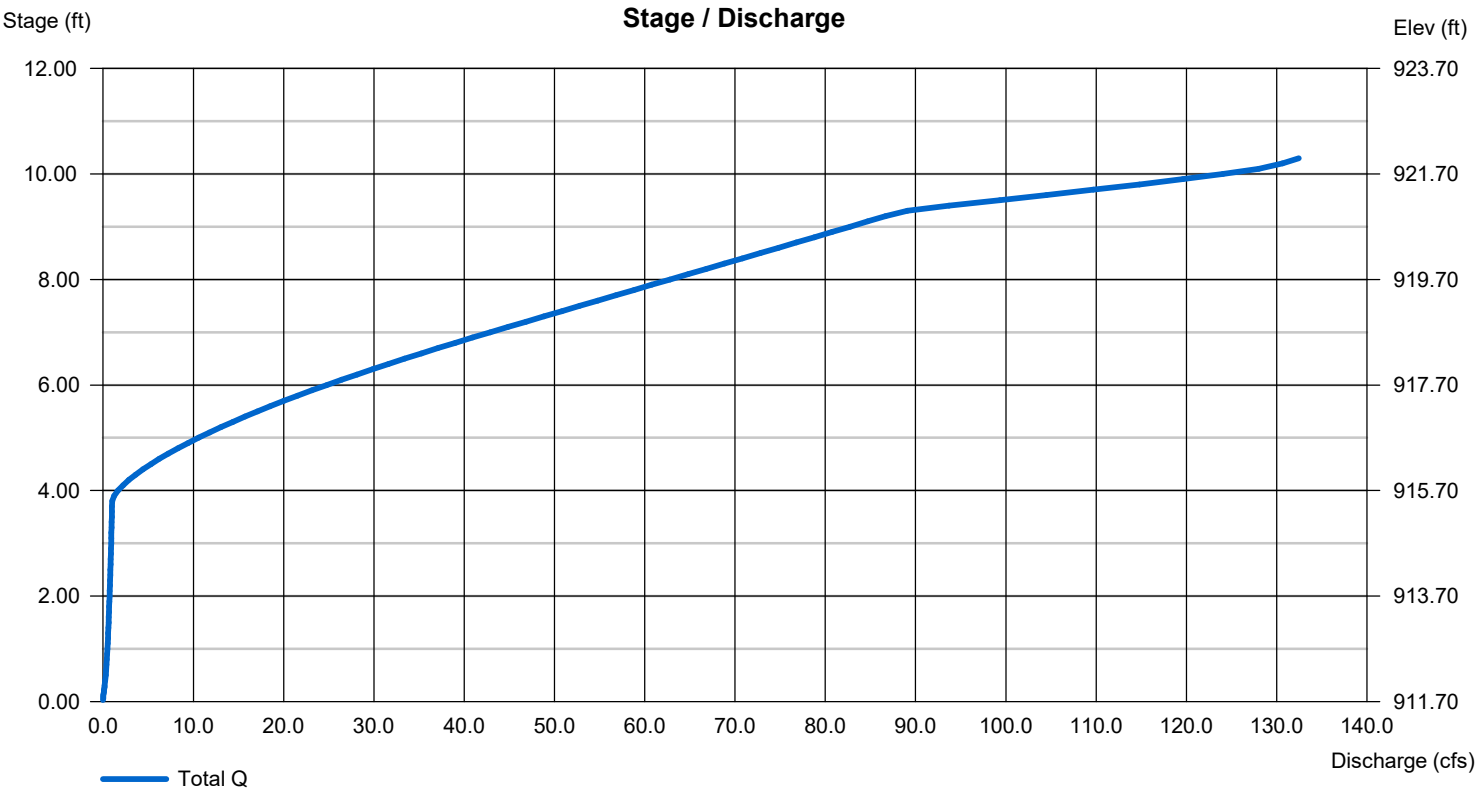

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Thursday, 03 / 28 / 2024


Hyd. No. 19

Post-Meadowview Culvert

Hydrograph type	= Combine	Peak discharge	= 579.40 cfs
Storm frequency	= 2 yrs	Time to peak	= 734 min
Time interval	= 2 min	Hyd. volume	= 3,079,388 cuft
Inflow hyds.	= 5, 13, 16, 18	Contrib. drain. area	= 106.800 ac

Post-Meadowview Culvert

Hyd. No. 19 -- 2 Year

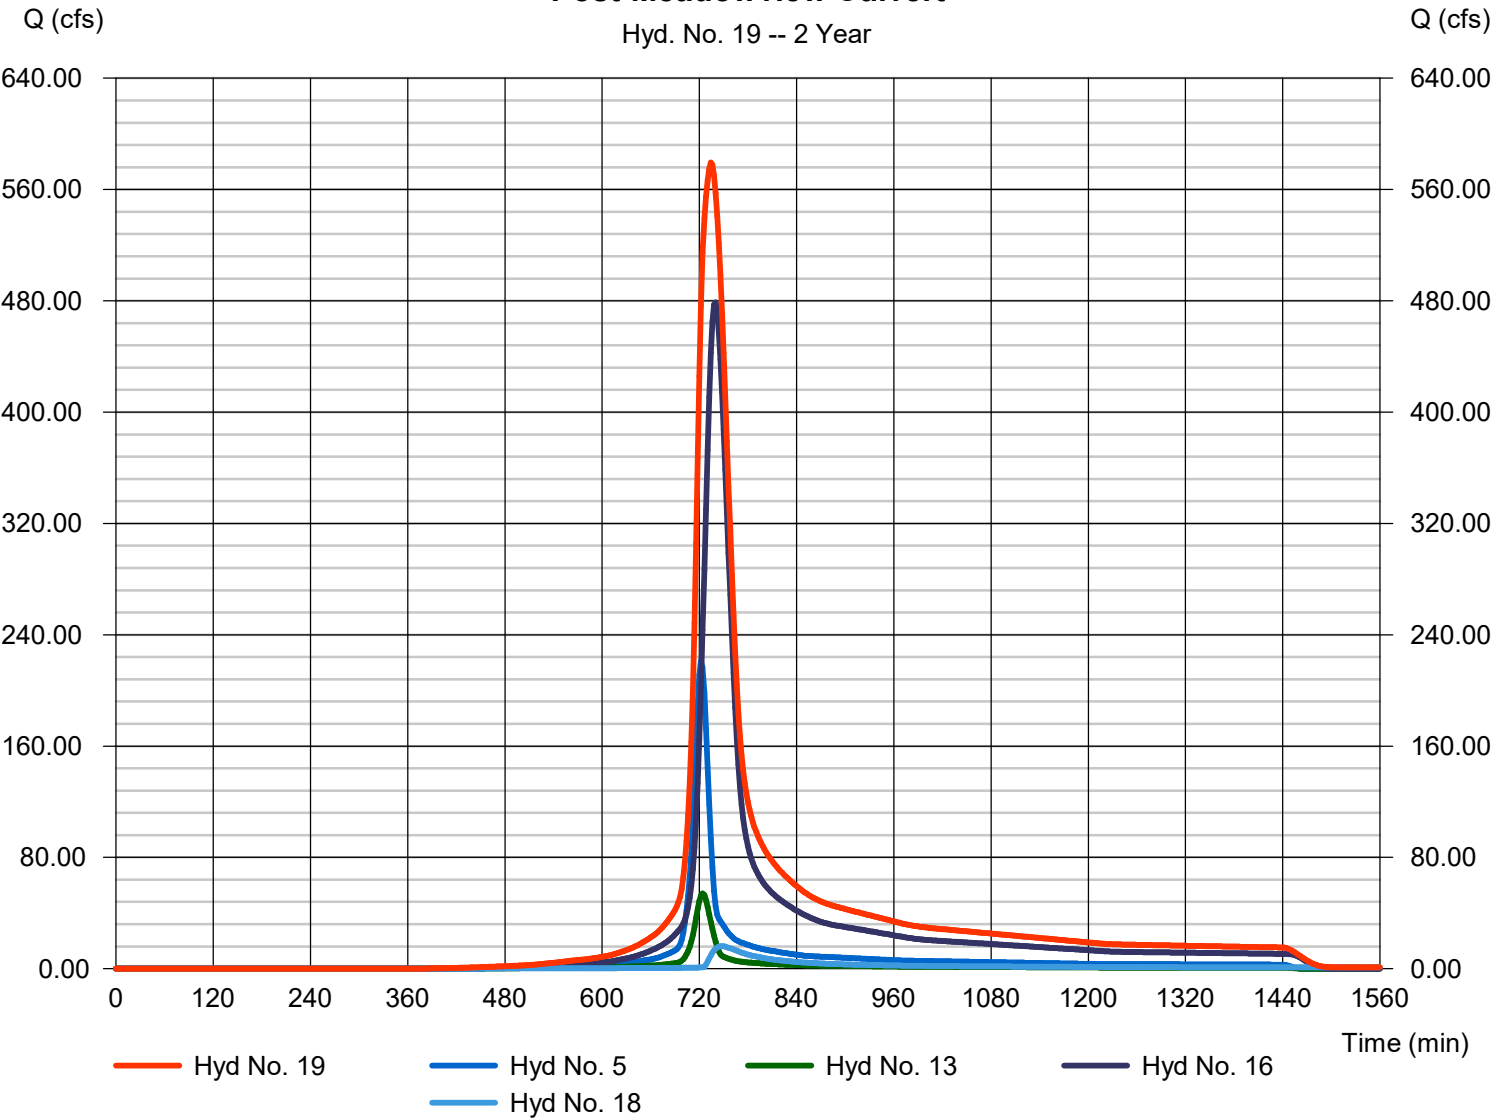

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Thursday, 03 / 28 / 2024

Hyd. No. 20


Post - Restored Stream

Hydrograph type	= Reach	Peak discharge	= 564.63 cfs
Storm frequency	= 2 yrs	Time to peak	= 740 min
Time interval	= 2 min	Hyd. volume	= 3,079,328 cuft
Inflow hyd. No.	= 19 - Post-Meadowview Culvert	Section type	= Trapezoidal
Reach length	= 1340.0 ft	Channel slope	= 0.8 %
Manning's n	= 0.030	Bottom width	= 20.0 ft
Side slope	= 10.0:1	Max. depth	= 4.0 ft
Rating curve x	= 0.595	Rating curve m	= 1.345
Ave. velocity	= 3.48 ft/s	Routing coeff.	= 0.3464

Modified Att-Kin routing method used.

Post - Restored Stream

Hyd. No. 20 -- 2 Year

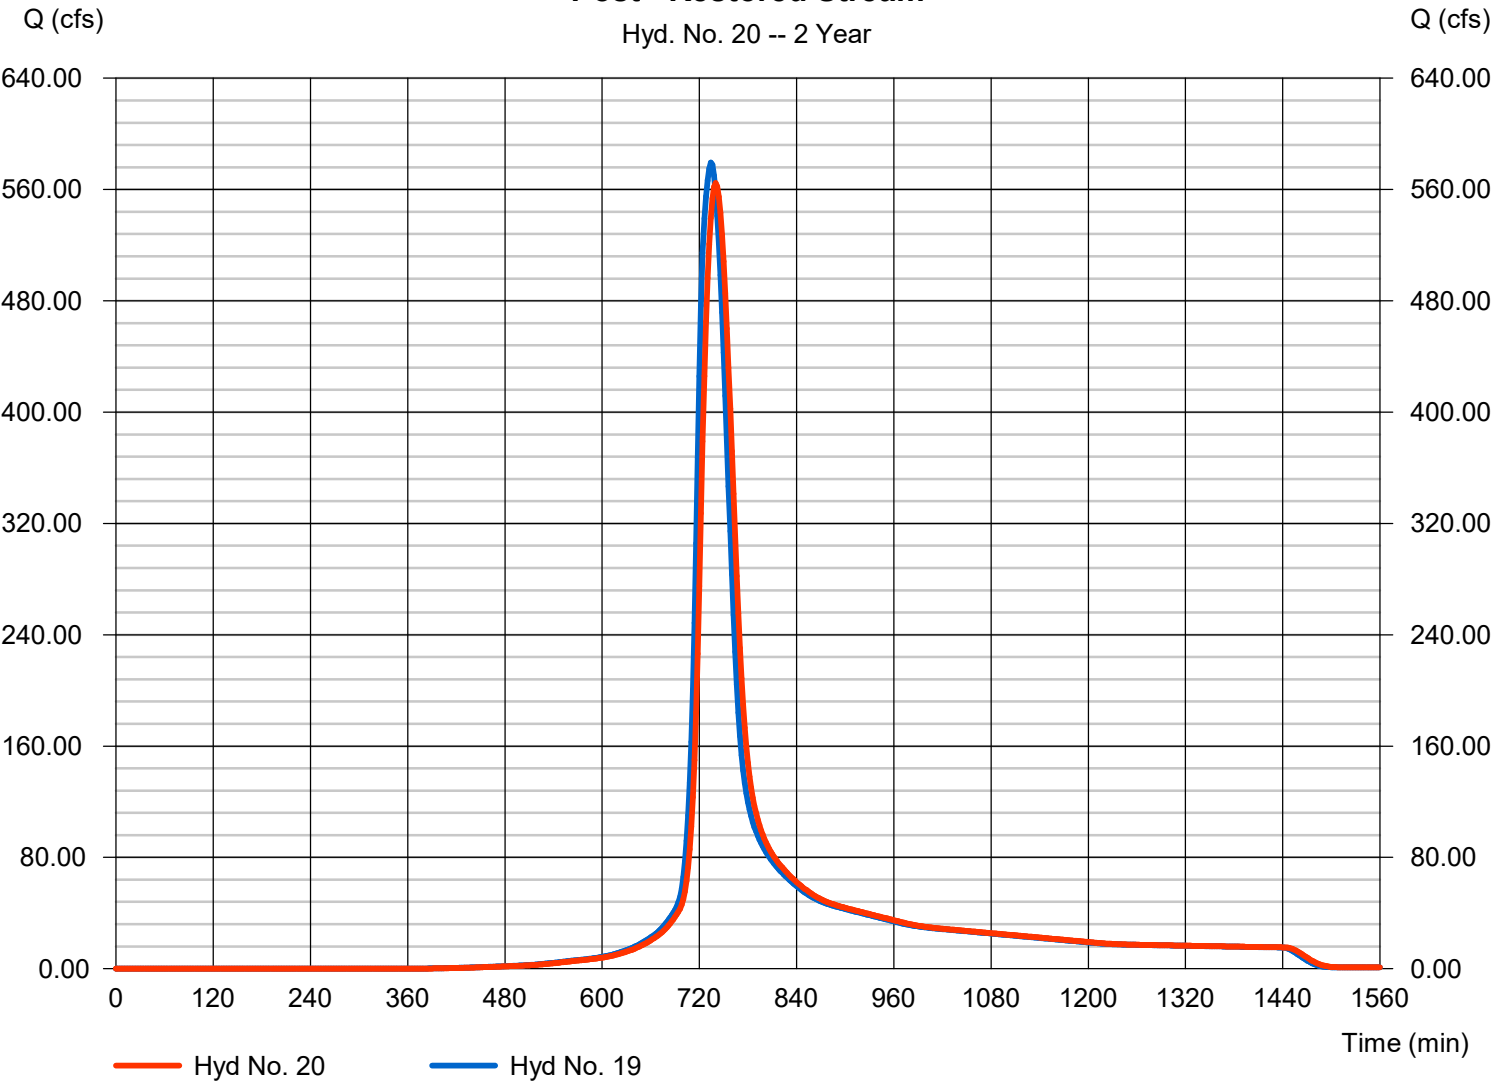


Hydrograph Report

Hyd. No. 21

Section 8 - Post

Hydrograph type	=	SCS Runoff	Peak discharge	=	29.76 cfs
Storm frequency	=	2 yrs	Time to peak	=	728 min
Time interval	=	2 min	Hyd. volume	=	110,215 cuft
Drainage area	=	12.600 ac	Curve number	=	90*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	23.90 min
Total precip.	=	3.50 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(12.600 x 90)] / 12.600

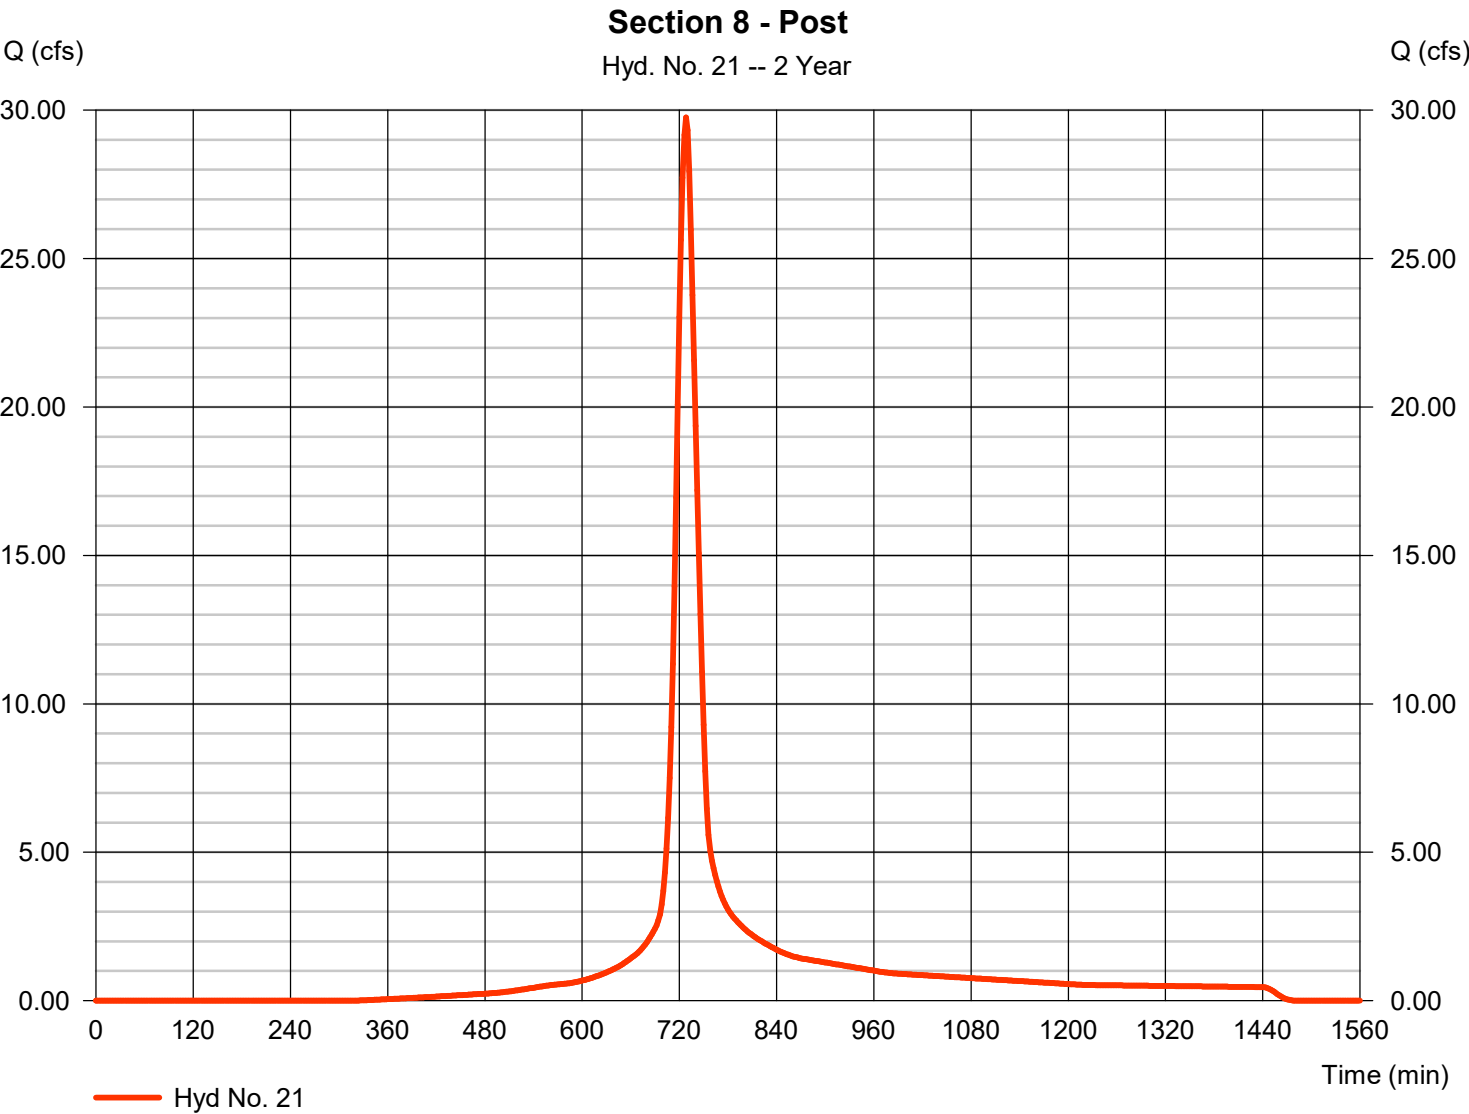

TR55 Tc Worksheet

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Hyd. No. 21

Section 8 - Post


<u>Description</u>	<u>A</u>	<u>B</u>	<u>C</u>	<u>Totals</u>
Sheet Flow				
Manning's n-value	= 0.240	0.011	0.011	
Flow length (ft)	= 100.0	0.0	0.0	
Two-year 24-hr precip. (in)	= 3.50	0.00	0.00	
Land slope (%)	= 1.00	0.00	0.00	
Travel Time (min)	= 18.00	+	0.00	+
			0.00	= 18.00
Shallow Concentrated Flow				
Flow length (ft)	= 1000.00	0.00	0.00	
Watercourse slope (%)	= 3.00	0.00	0.00	
Surface description	= Paved	Paved	Paved	
Average velocity (ft/s)	=3.52	0.00	0.00	
Travel Time (min)	= 4.73	+	0.00	+
			0.00	= 4.73
Channel Flow				
X sectional flow area (sqft)	= 3.14	0.00	0.00	
Wetted perimeter (ft)	= 6.30	0.00	0.00	
Channel slope (%)	= 1.50	0.00	0.00	
Manning's n-value	= 0.015	0.015	0.015	
Velocity (ft/s)	=7.63	0.00	0.00	
Flow length (ft)	(\{0\})550.0	0.0	0.0	
Travel Time (min)	= 1.20	+	0.00	+
			0.00	= 1.20
Total Travel Time, Tc				23.90 min

Hydrograph Report

Hyd. No. 22

OVERALL POST - DETENTION BASIN

Hydrograph type	= Combine	Peak discharge	= 597.54 cfs
Storm frequency	= 2 yrs	Time to peak	= 738 min
Time interval	= 2 min	Hyd. volume	= 3,293,776 cuft
Inflow hyds.	= 6, 20, 21	Contrib. drain. area	= 23.900 ac

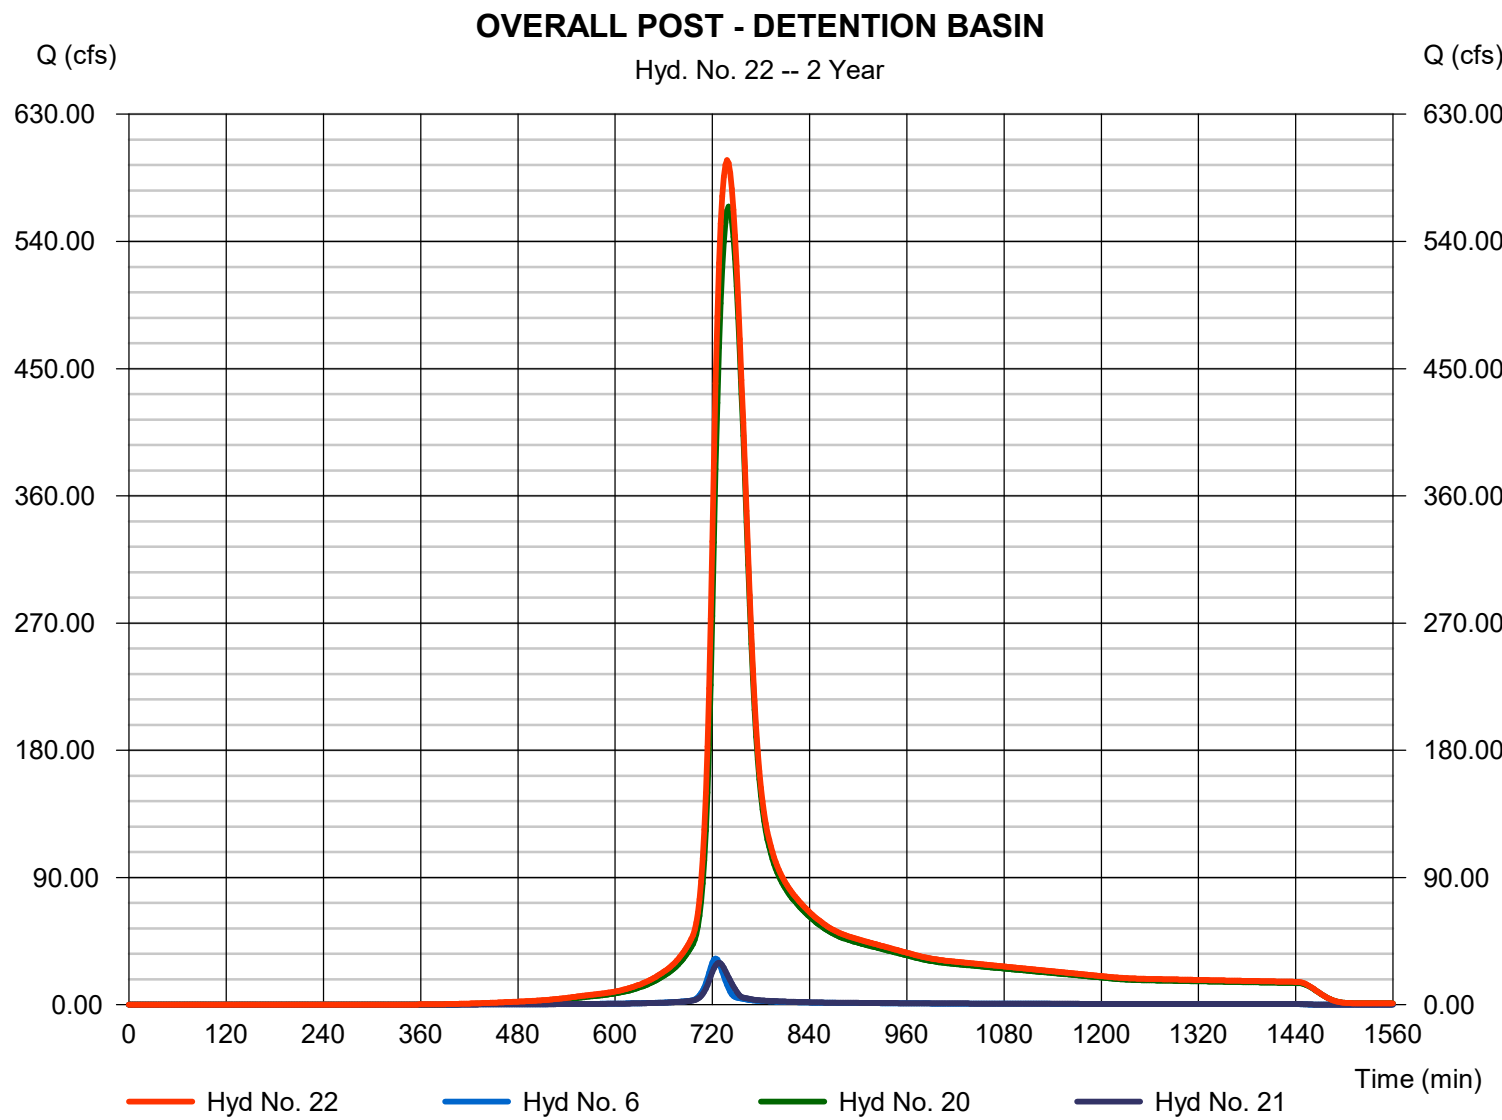

Hydrograph Summary Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description
1	SCS Runoff	228.55	2	728	839,577	-----	-----	-----	Section 1
2	SCS Runoff	190.22	2	728	698,792	-----	-----	-----	Section 2
3	SCS Runoff	306.37	2	730	1,225,319	-----	-----	-----	Section 3
4	SCS Runoff	273.45	2	732	1,199,107	-----	-----	-----	Section 4
5	SCS Runoff	394.04	2	722	1,121,472	-----	-----	-----	Section 5
6	SCS Runoff	53.70	2	724	175,306	-----	-----	-----	Section 6
7	SCS Runoff	227.73	2	728	855,894	-----	-----	-----	Section 7/8-Pre
8	Combine	722.19	2	730	2,763,687	1, 2, 3,	-----	-----	Industrial Complex to Detention
9	Reach	695.55	2	734	2,763,686	8	-----	-----	Industrial Above Ground Detention Po
10	Combine	966.72	2	734	3,962,792	4, 9	-----	-----	Strother Road Culvert
11	Reach	915.90	2	738	3,962,789	10	-----	-----	Wilshire Existing Stream
12	Combine	1263.54	2	732	6,115,463	5, 6, 7, 11	-----	-----	OVERALL PRE
13	SCS Runoff	91.08	2	724	293,265	-----	-----	-----	Section 7A-Post
14	SCS Runoff	12.03	2	732	50,537	-----	-----	-----	Section 7B-Post (Wilshire Hills Bypas
15	SCS Runoff	79.37	2	726	280,952	-----	-----	-----	Section 7C-Post (Wilshire Hills)
16	Reach	933.75	2	738	3,962,789	10	-----	-----	Wilshire- Preserved stream
17	Combine	90.00	2	726	331,488	14, 15,	-----	-----	Onsite Water
18	Reservoir	47.35	2	742	331,474	17	918.93	124,829	Detention Basin
19	Combine	1153.87	2	734	5,708,996	5, 13, 16, 18	-----	-----	Post-Meadowview Culvert
20	Reach	1130.16	2	738	5,708,940	19	-----	-----	Post - Restored Stream
21	SCS Runoff	49.61	2	728	187,574	-----	-----	-----	Section 8 - Post
22	Combine	1189.44	2	736	6,071,823	6, 20, 21	-----	-----	OVERALL POST - DETENTION BASI
15925 Downstream Analysis (3-28-2024).gpw					Return Period: 10 Year			Thursday, 03 / 28 / 2024	


Hydrograph Report

Hyd. No. 1

Section 1

Hydrograph type	=	SCS Runoff	Peak discharge	=	228.55 cfs
Storm frequency	=	10 yrs	Time to peak	=	728 min
Time interval	=	2 min	Hyd. volume	=	839,577 cuft
Drainage area	=	81.700 ac	Curve number	=	77*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	24.30 min
Total precip.	=	5.30 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(3.600 x 81) + (13.500 x 98) + (49.000 x 73) + (15.600 x 69)] / 81.700

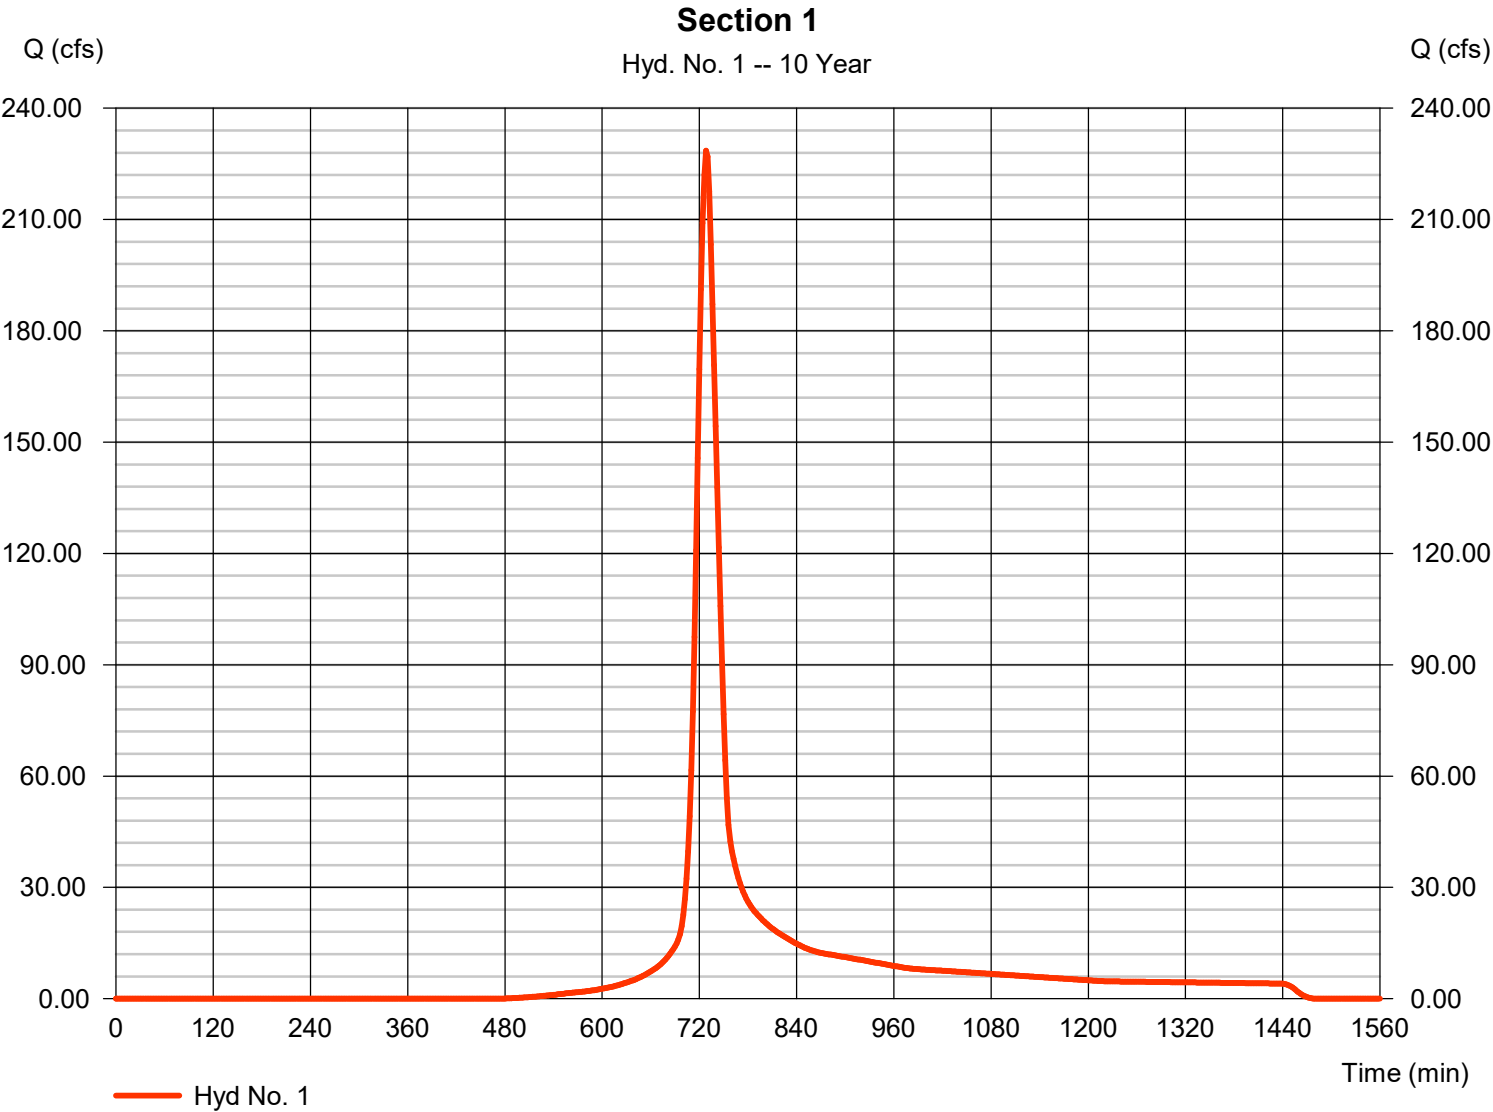


Hydrograph Report

Hyd. No. 2

Section 2

Hydrograph type	=	SCS Runoff	Peak discharge	=	190.22 cfs
Storm frequency	=	10 yrs	Time to peak	=	728 min
Time interval	=	2 min	Hyd. volume	=	698,792 cuft
Drainage area	=	68.000 ac	Curve number	=	77*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	25.30 min
Total precip.	=	5.30 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(8.000 x 98) + (0.500 x 77) + (30.800 x 79) + (28.700 x 69)] / 68.000

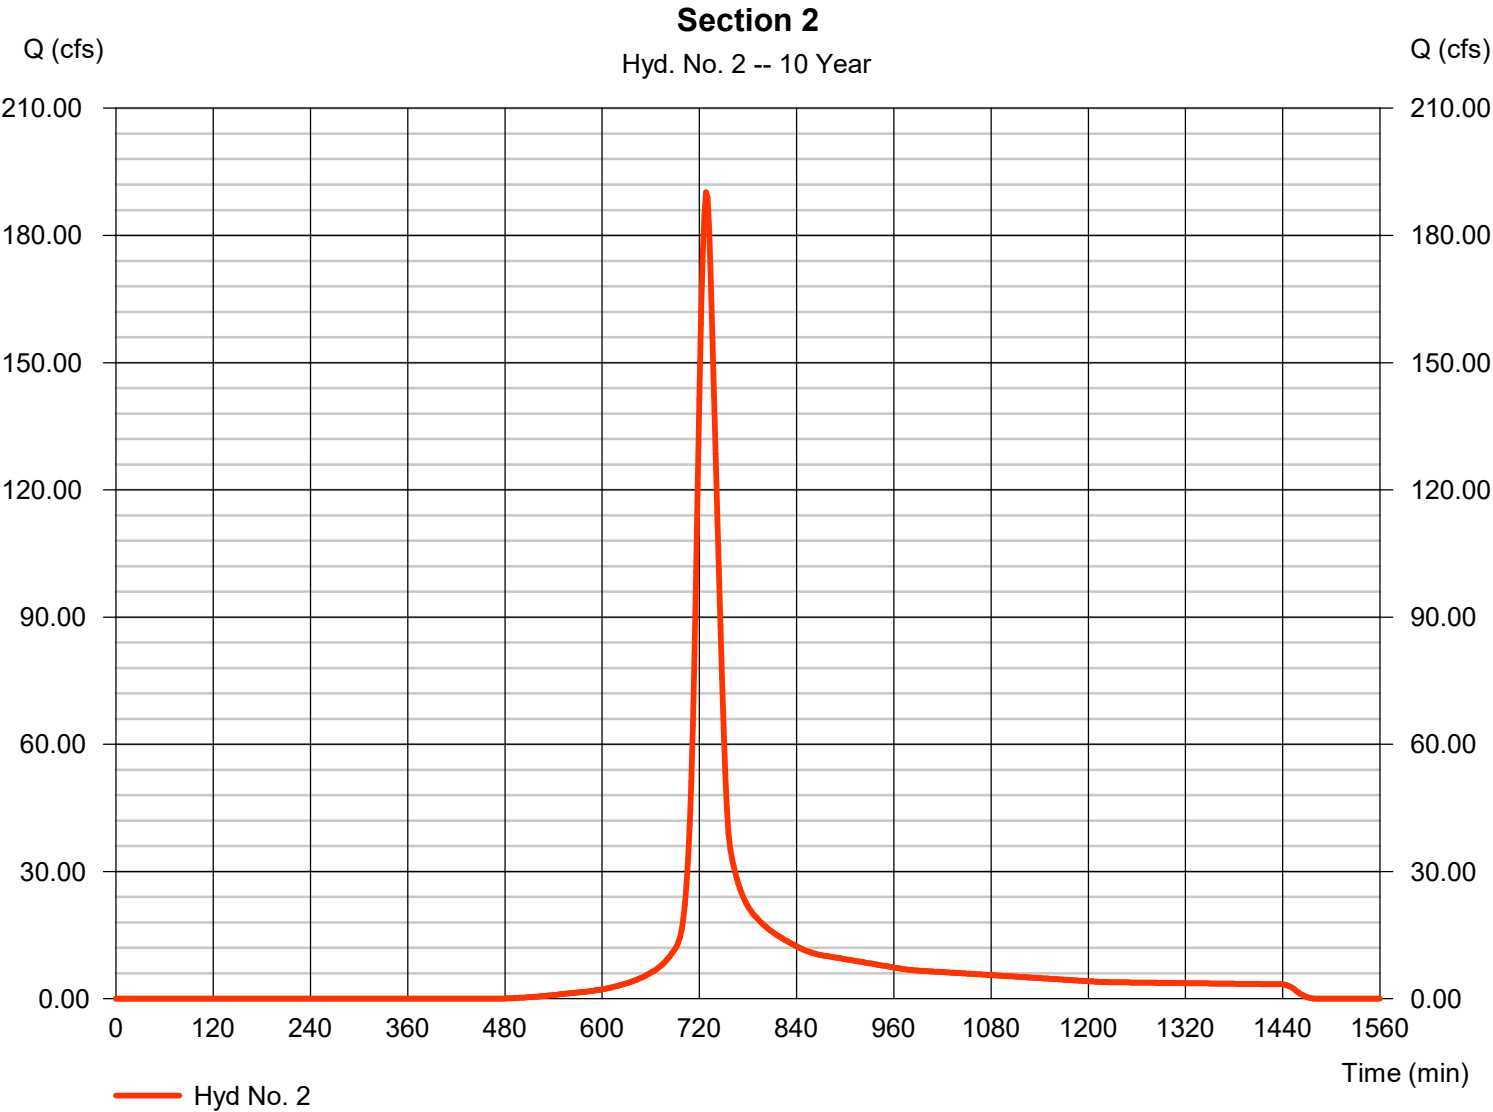


Hydrograph Report

Hyd. No. 3

Section 3

Hydrograph type	=	SCS Runoff	Peak discharge	=	306.37 cfs
Storm frequency	=	10 yrs	Time to peak	=	730 min
Time interval	=	2 min	Hyd. volume	=	1,225,319 cuft
Drainage area	=	100.800 ac	Curve number	=	82*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	30.20 min
Total precip.	=	5.30 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(18.200 x 98) + (3.000 x 77) + (79.600 x 79)] / 100.800

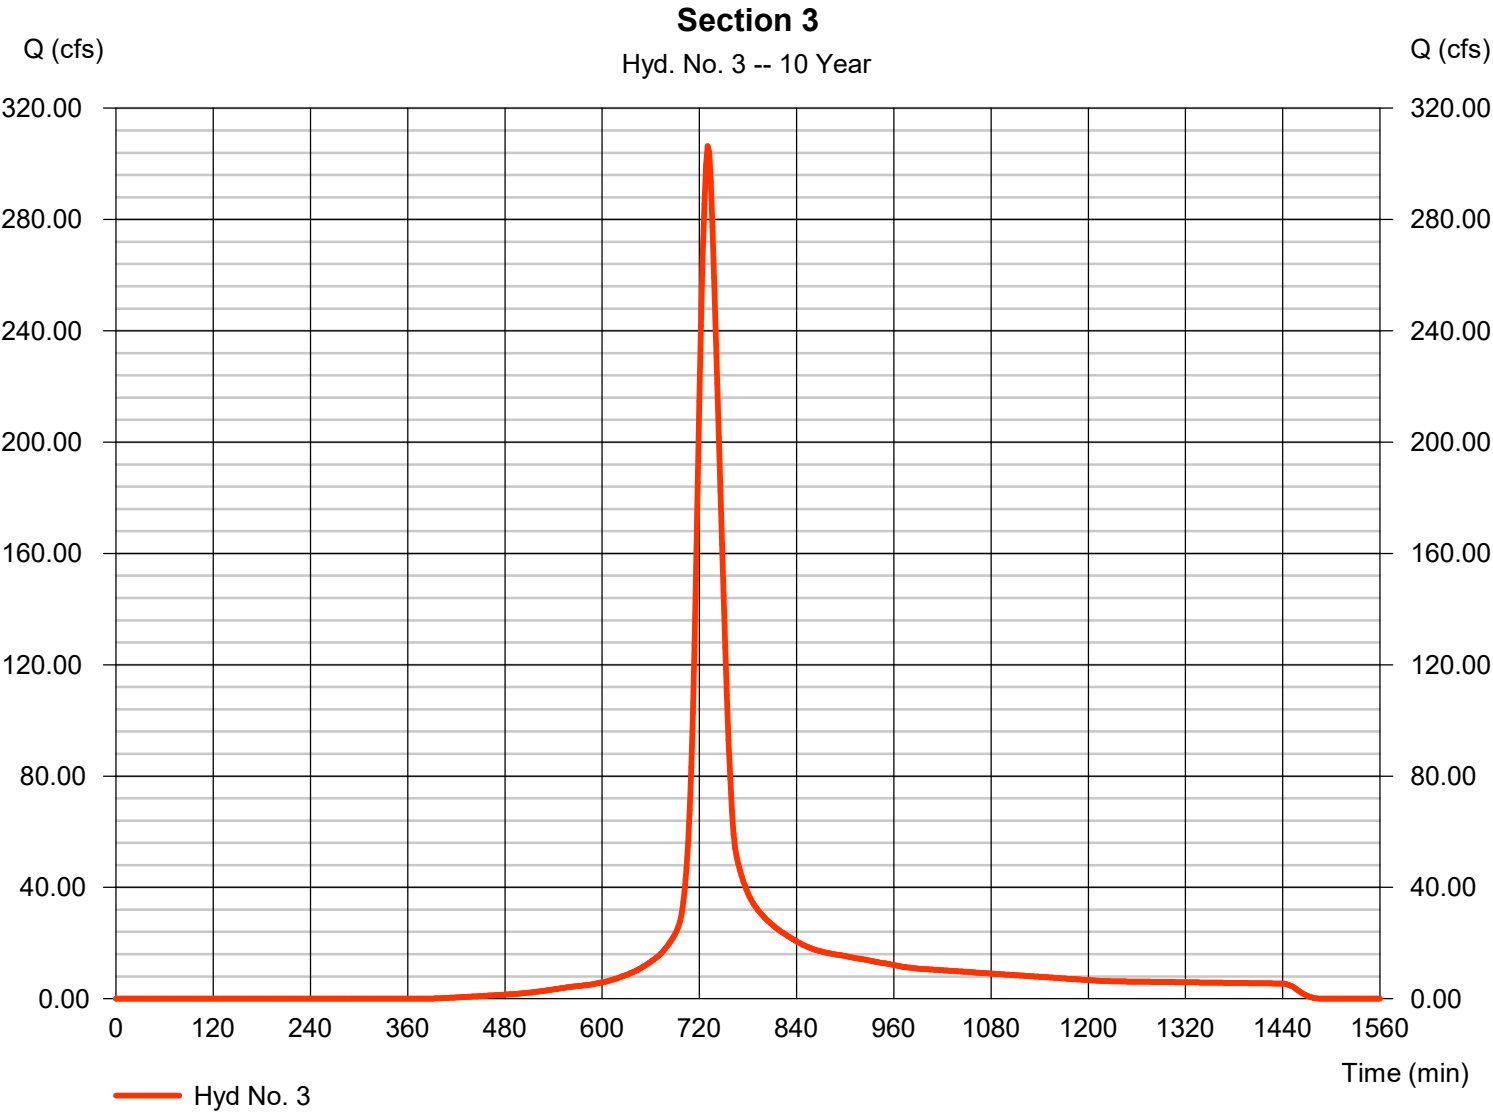

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 4

Section 4

Hydrograph type	= SCS Runoff	Peak discharge	= 273.45 cfs
Storm frequency	= 10 yrs	Time to peak	= 732 min
Time interval	= 2 min	Hyd. volume	= 1,199,107 cuft
Drainage area	= 82.500 ac	Curve number	= 88*
Basin Slope	= 0.0 %	Hydraulic length	= 0 ft
Tc method	= TR55	Time of conc. (Tc)	= 30.70 min
Total precip.	= 5.30 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

* Composite (Area/CN) = $[(49.680 \times 98) + (32.820 \times 74)] / 82.500$

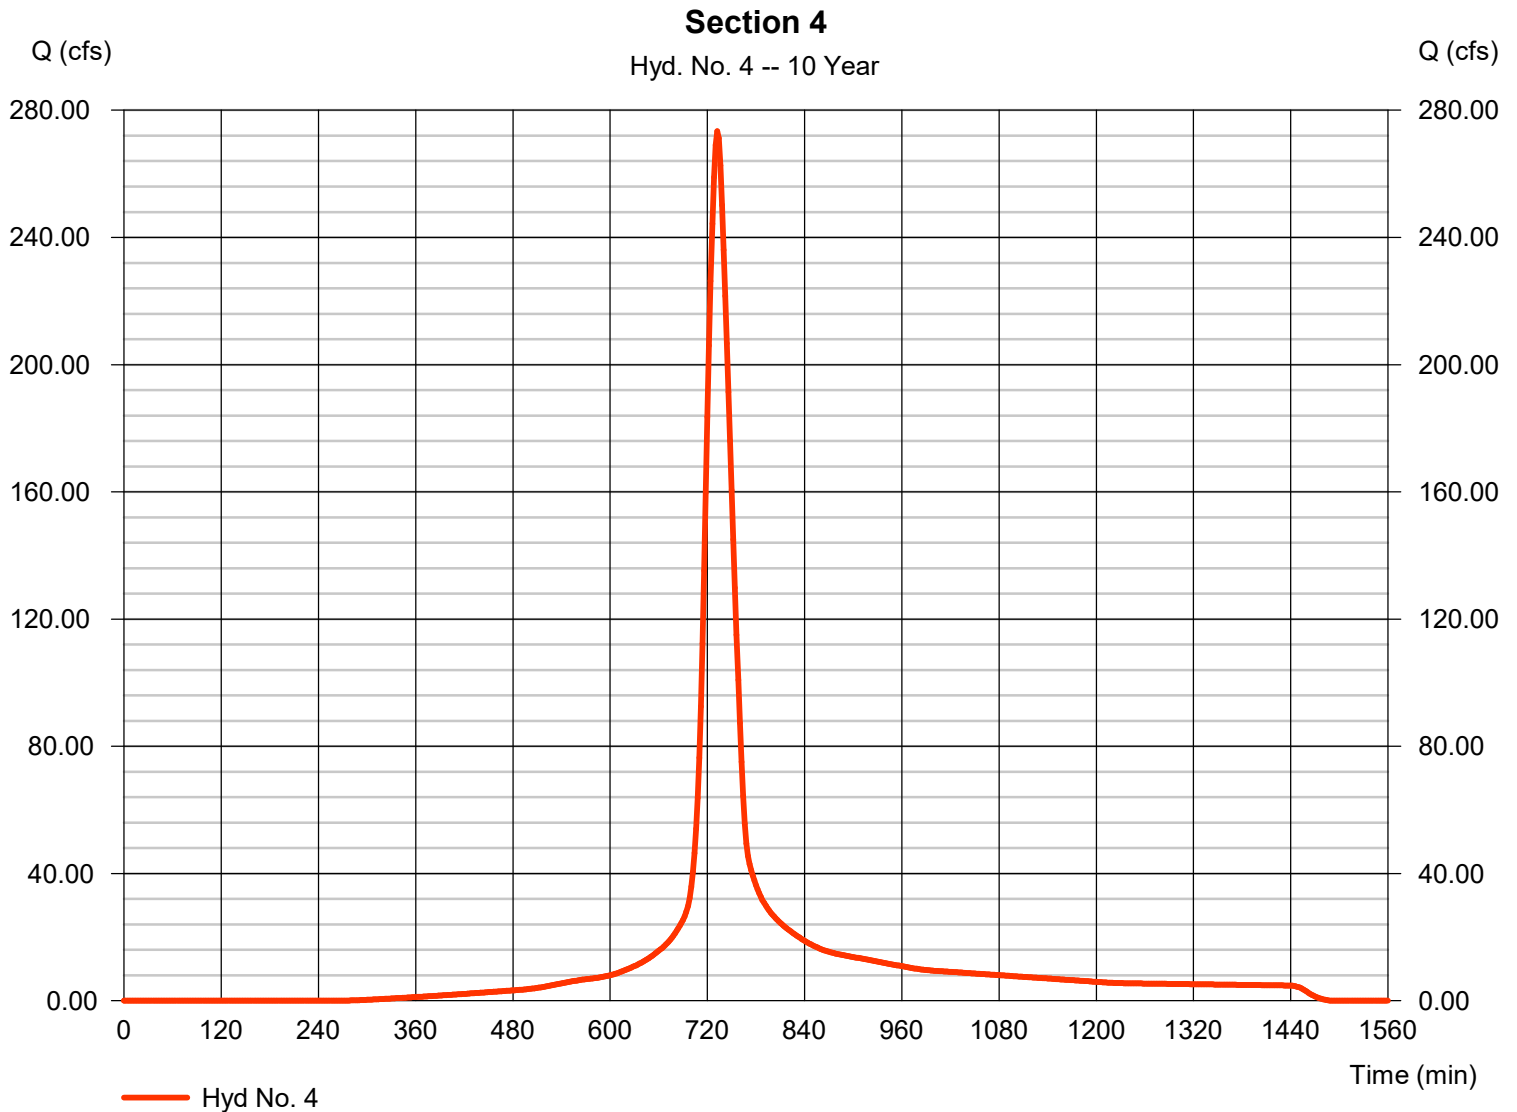


Hydrograph Report

Hyd. No. 5

Section 5

Hydrograph type	=	SCS Runoff	Peak discharge	=	394.04 cfs
Storm frequency	=	10 yrs	Time to peak	=	722 min
Time interval	=	2 min	Hyd. volume	=	1,121,472 cuft
Drainage area	=	86.900 ac	Curve number	=	85*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	15.60 min
Total precip.	=	5.30 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(40.000 x 98) + (46.900 x 74)] / 86.900

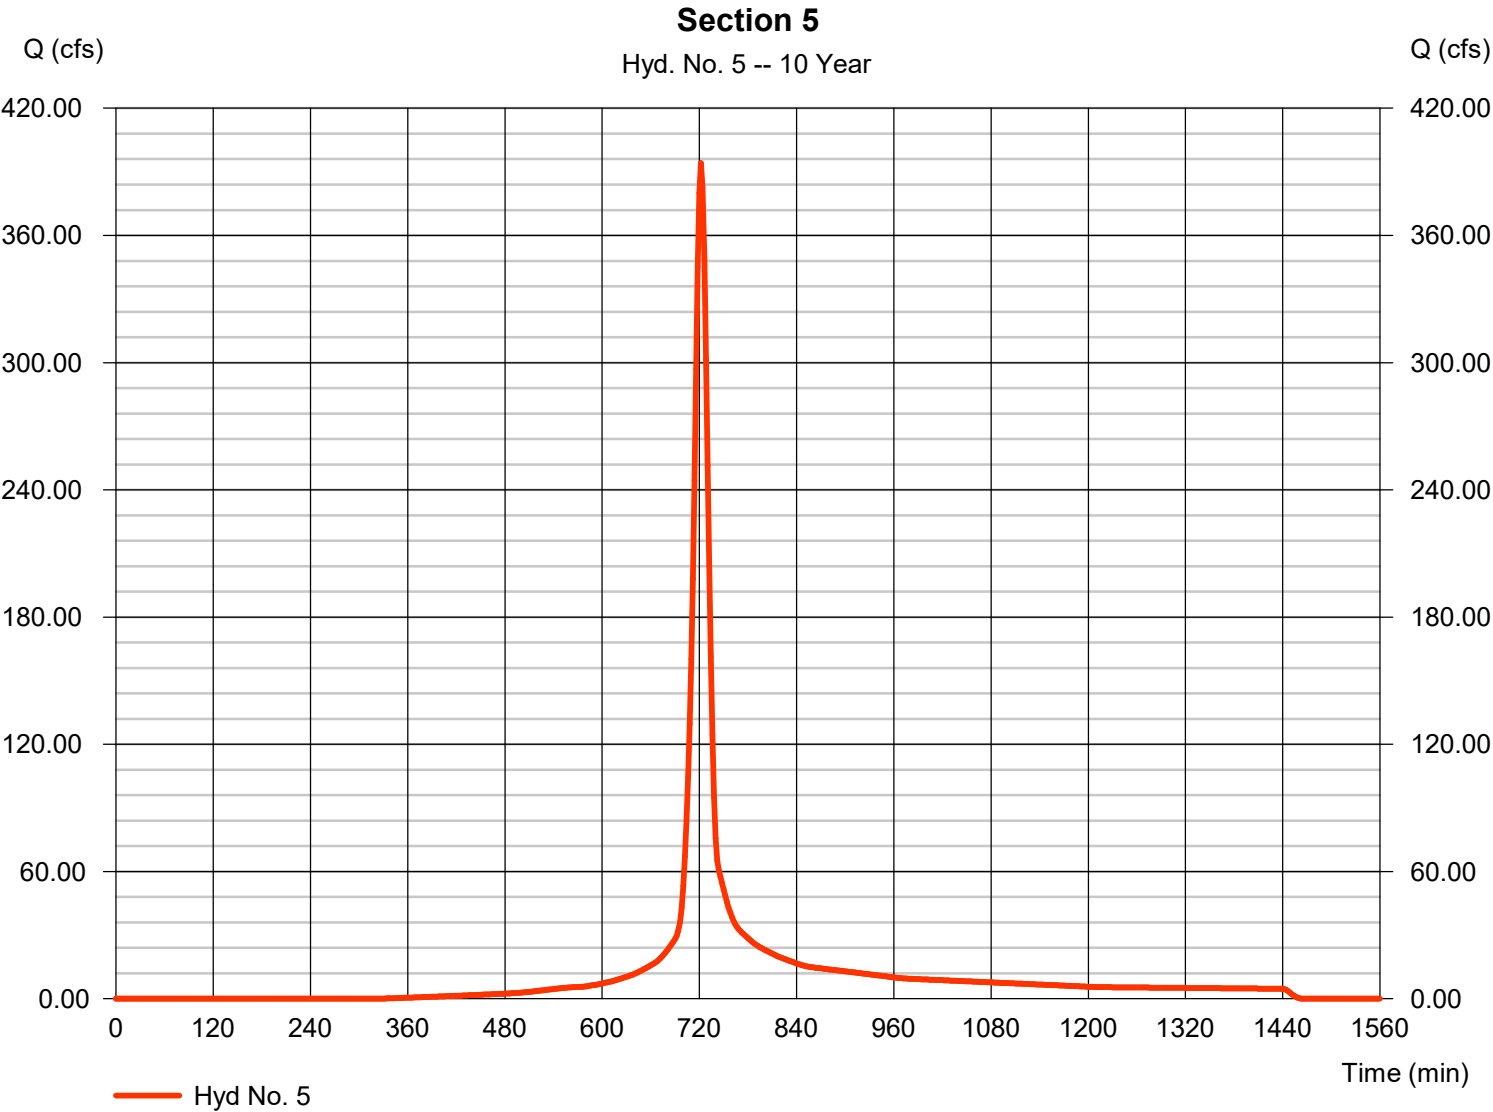


Hydrograph Report

Hyd. No. 6

Section 6

Hydrograph type	=	SCS Runoff	Peak discharge	=	53.70 cfs
Storm frequency	=	10 yrs	Time to peak	=	724 min
Time interval	=	2 min	Hyd. volume	=	175,306 cuft
Drainage area	=	11.300 ac	Curve number	=	91*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	18.60 min
Total precip.	=	5.30 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(11.300 x 91)] / 11.300

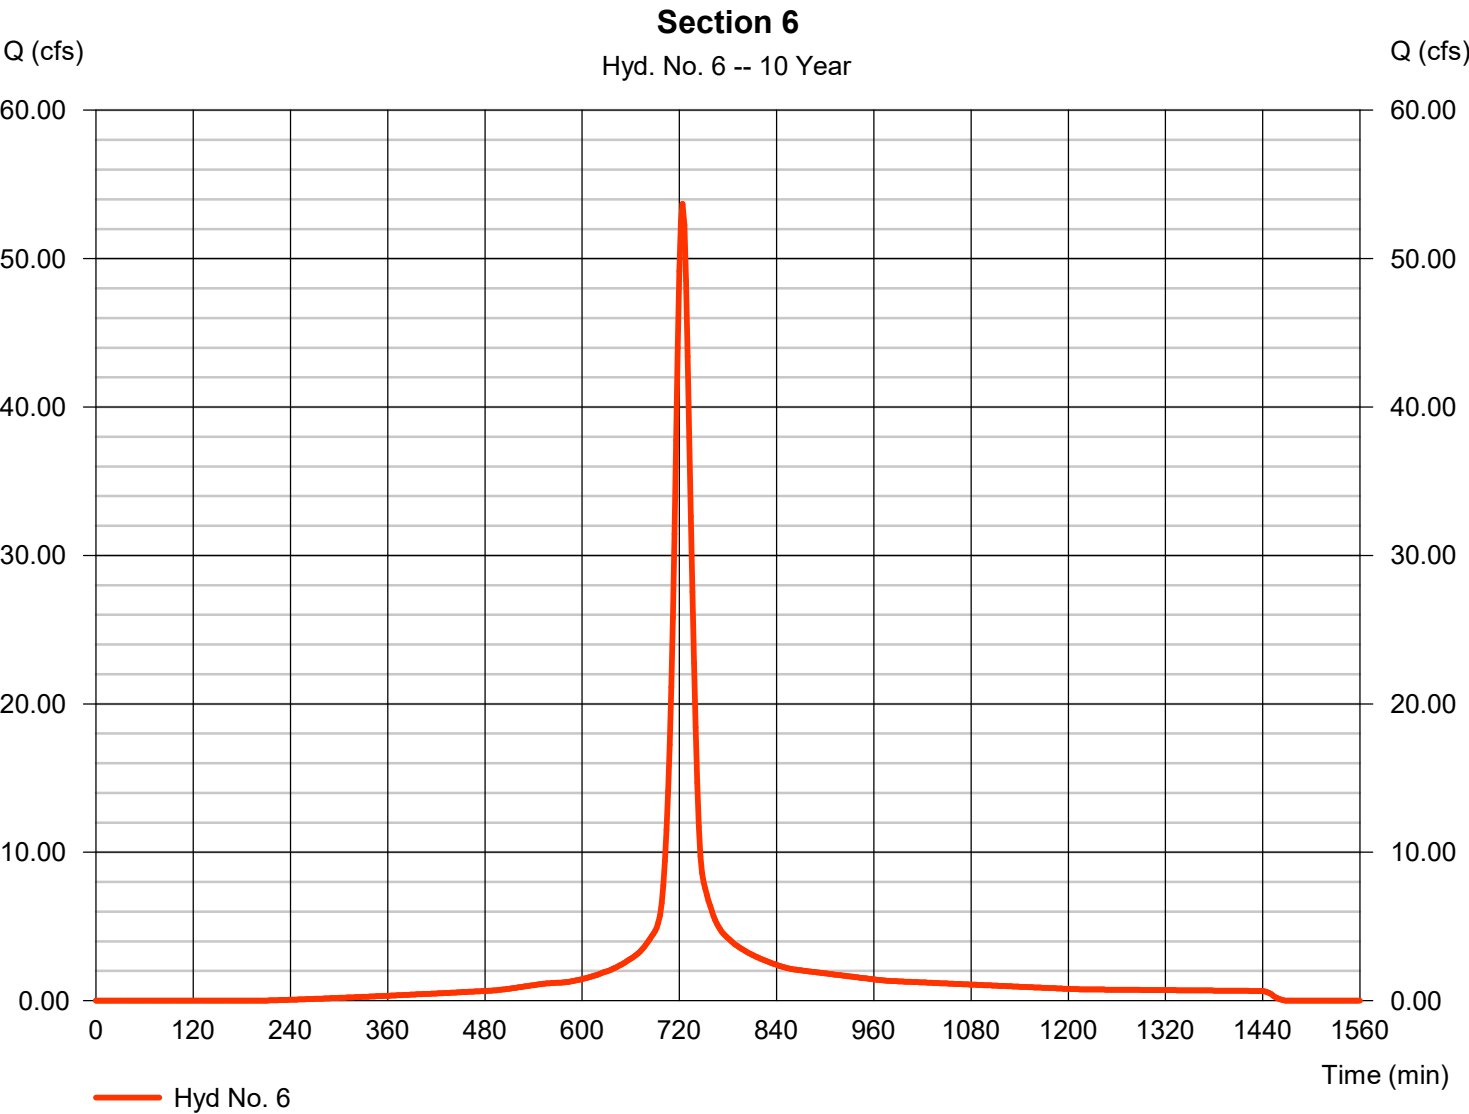


Hydrograph Report

Hyd. No. 7

Section 7/8-Pre

Hydrograph type	=	SCS Runoff	Peak discharge	=	227.73 cfs
Storm frequency	=	10 yrs	Time to peak	=	728 min
Time interval	=	2 min	Hyd. volume	=	855,894 cuft
Drainage area	=	59.000 ac	Curve number	=	89*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	25.20 min
Total precip.	=	5.30 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(59.000 x 79)] / 59.000

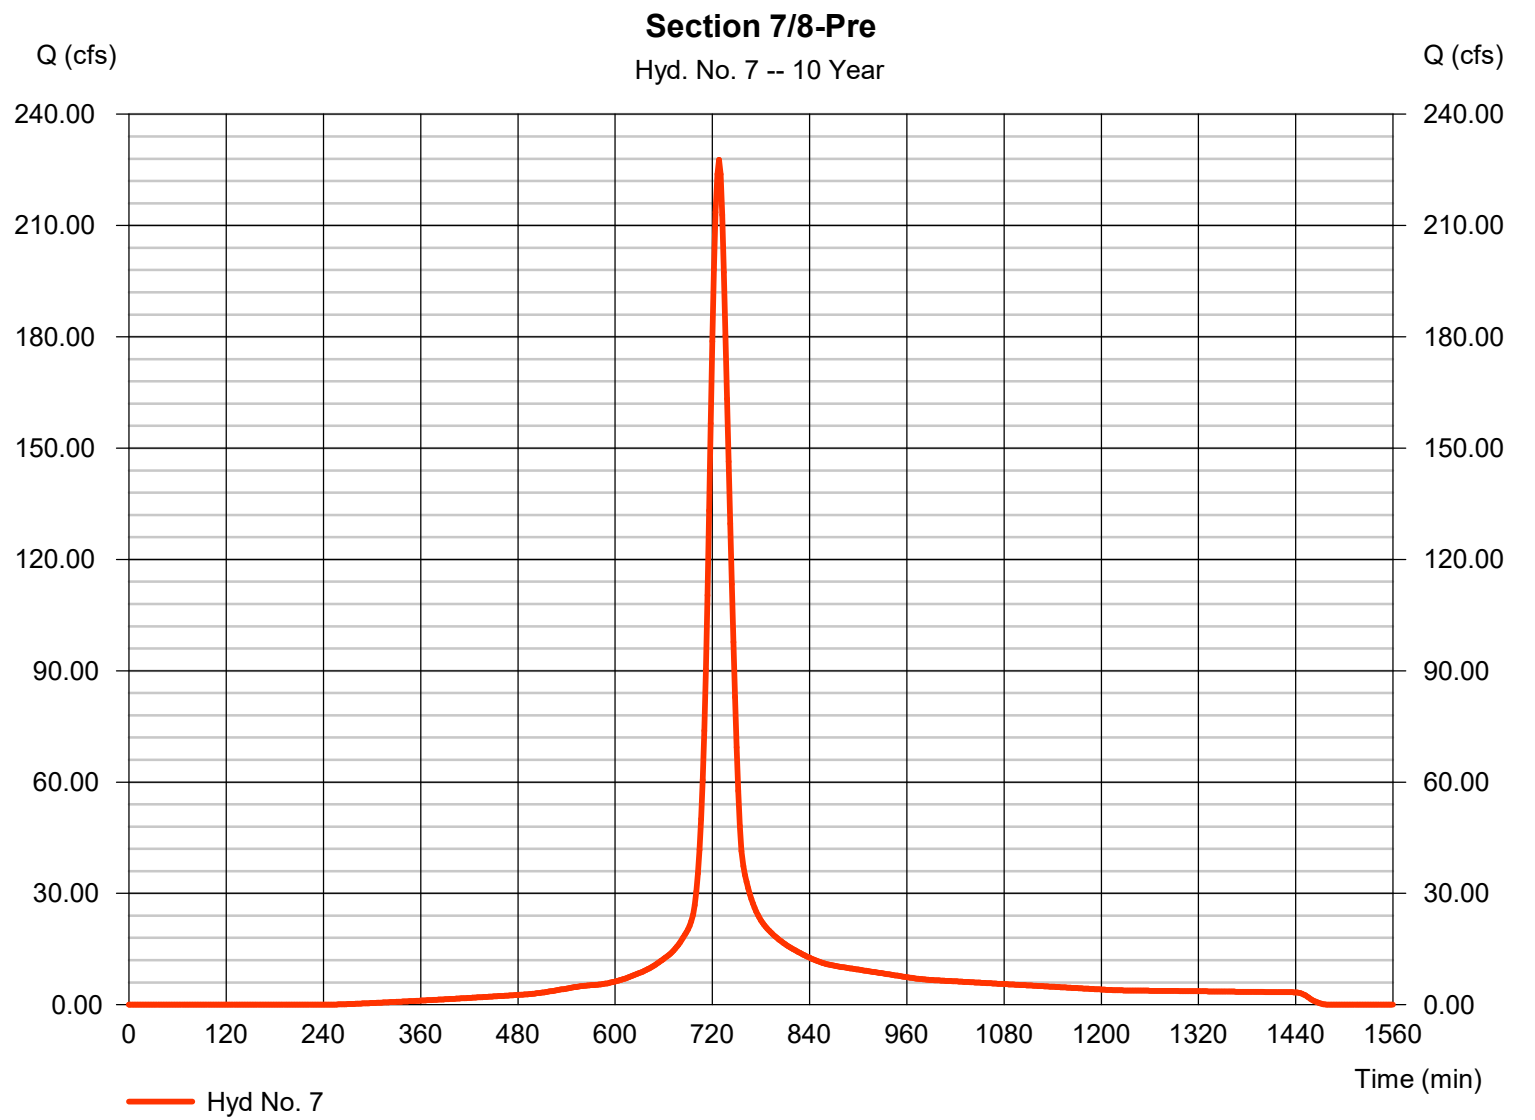


Hydrograph Report

Hyd. No. 8

Industrial Complex to Detention

Hydrograph type	= Combine	Peak discharge	= 722.19 cfs
Storm frequency	= 10 yrs	Time to peak	= 730 min
Time interval	= 2 min	Hyd. volume	= 2,763,687 cuft
Inflow hyds.	= 1, 2, 3	Contrib. drain. area	= 250.500 ac

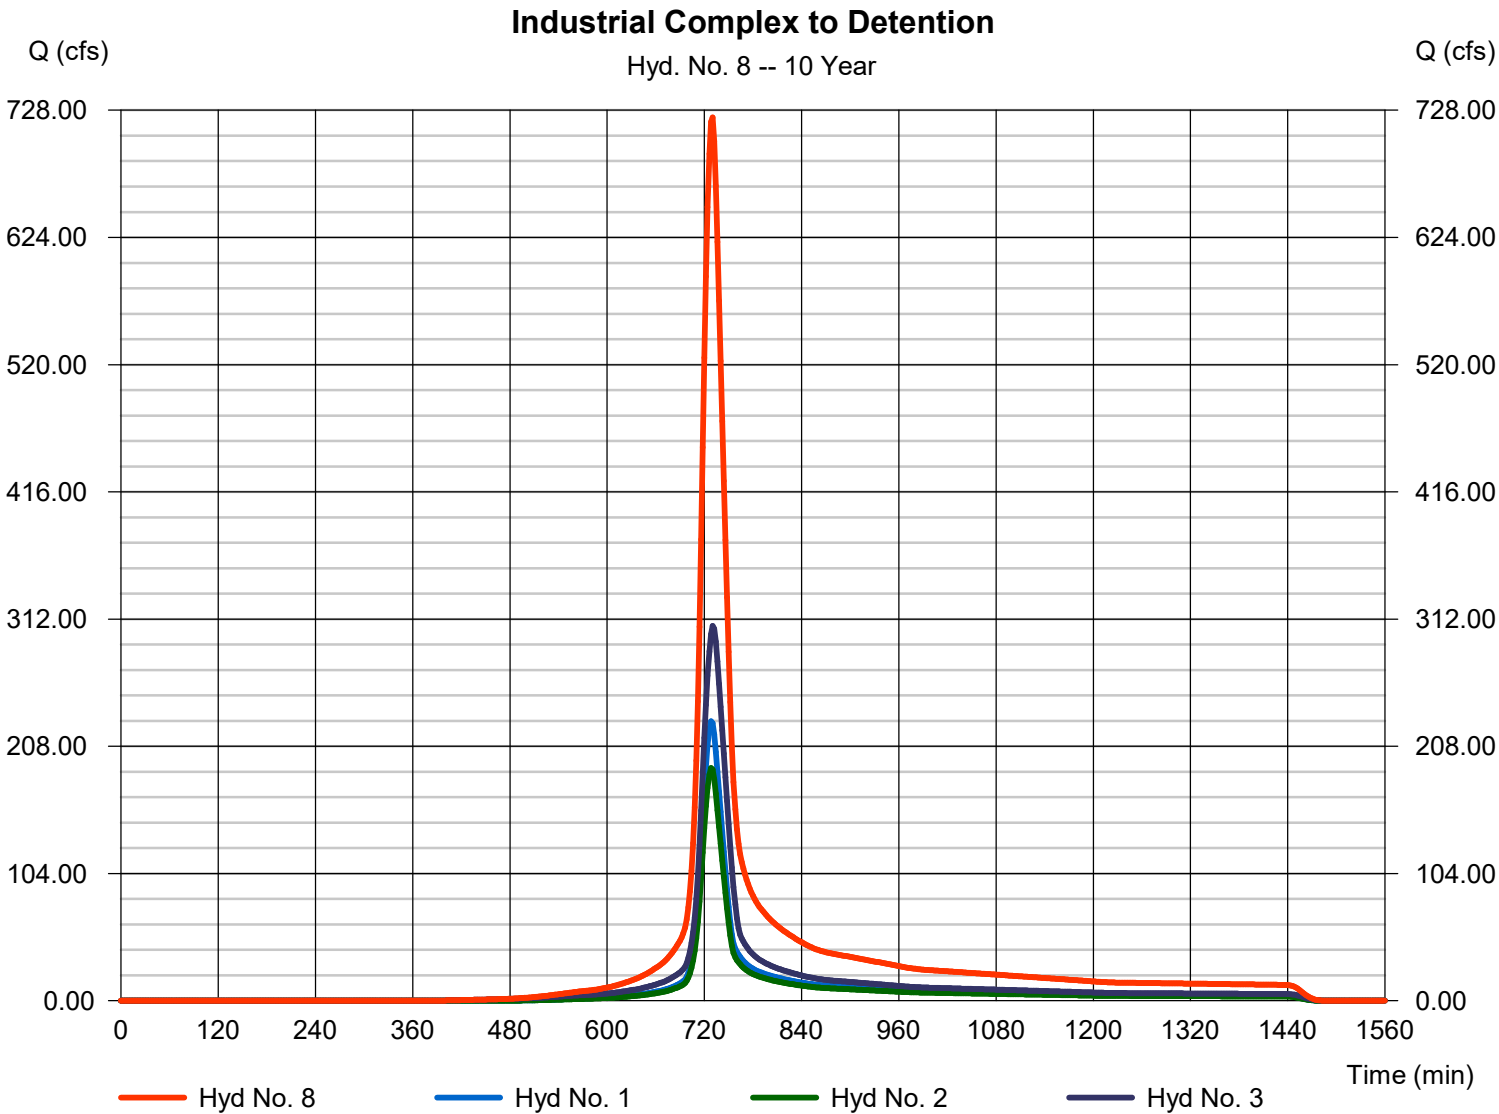

Hydrograph Report

Hyd. No. 9


Industrial Above Ground Detention Pond

Hydrograph type	= Reach	Peak discharge	= 695.55 cfs
Storm frequency	= 10 yrs	Time to peak	= 734 min
Time interval	= 2 min	Hyd. volume	= 2,763,686 cuft
Inflow hyd. No.	= 8 - Industrial Complex to Detention Pond	Section type	= Trapezoidal
Reach length	= 1000.0 ft	Channel slope	= 2.0 %
Manning's n	= 0.020	Bottom width	= 150.0 ft
Side slope	= 30.0:1	Max. depth	= 16.0 ft
Rating curve x	= 0.373	Rating curve m	= 1.407
Ave. velocity	= 3.33 ft/s	Routing coeff.	= 0.4384

Modified Att-Kin routing method used.

Industrial Above Ground Detention Pond

Hyd. No. 9 -- 10 Year

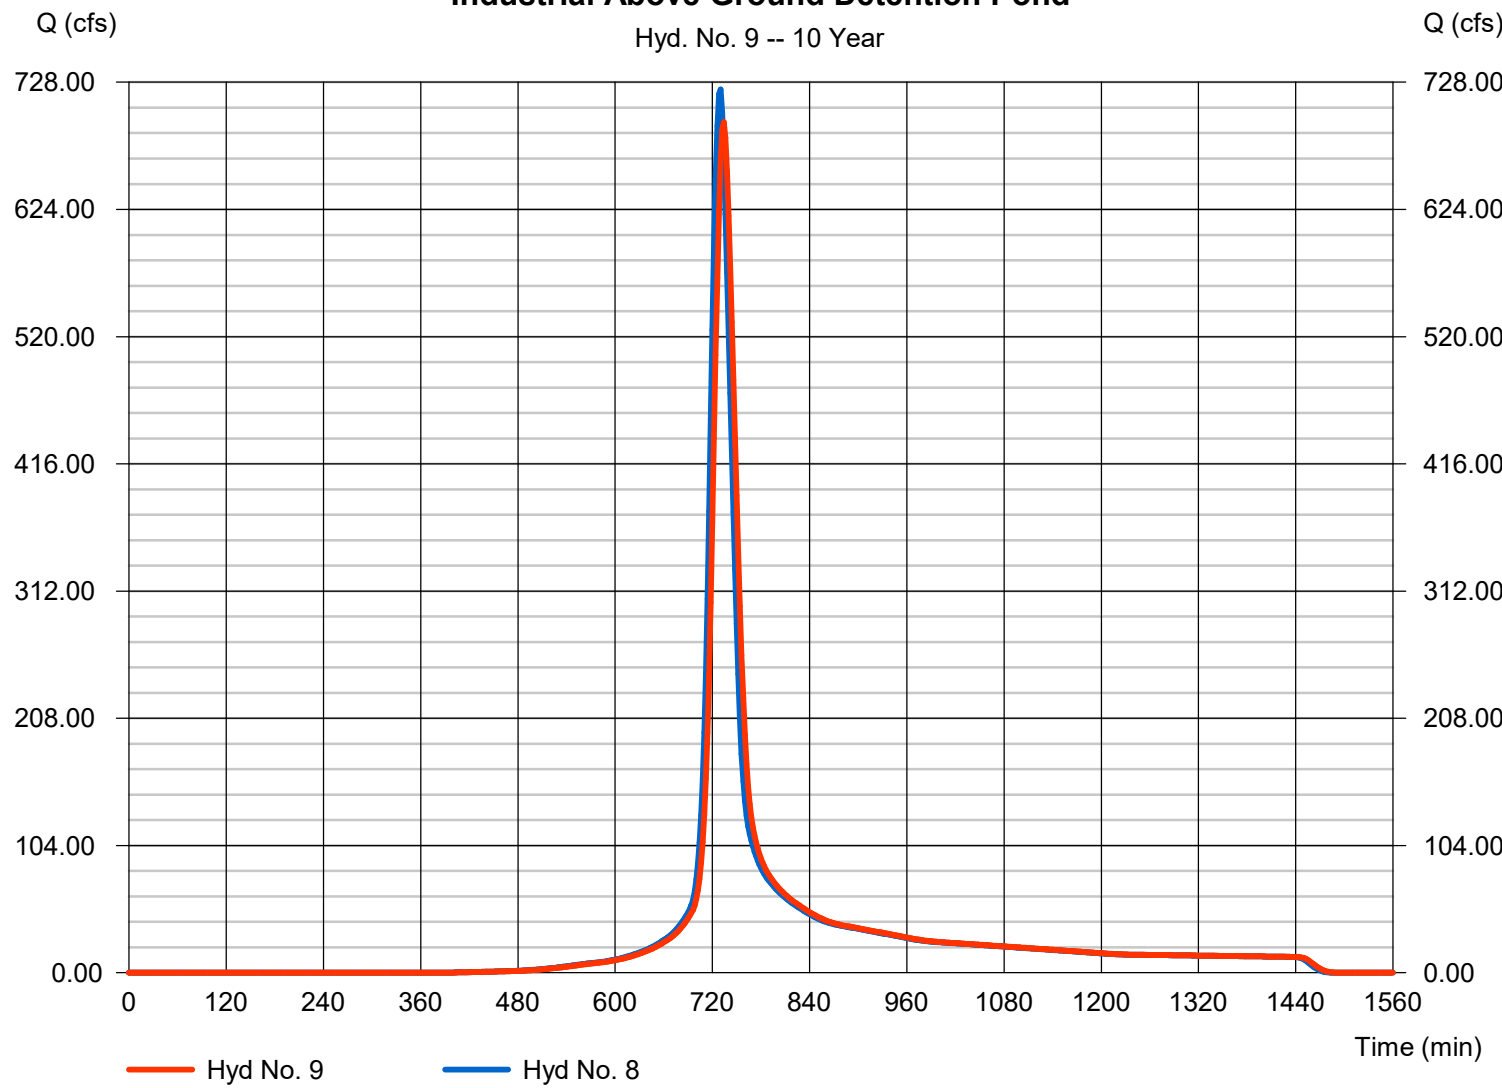

Hydrograph Report


Hyd. No. 10

Strother Road Culvert

Hydrograph type	= Combine	Peak discharge	= 966.72 cfs
Storm frequency	= 10 yrs	Time to peak	= 734 min
Time interval	= 2 min	Hyd. volume	= 3,962,792 cuft
Inflow hyds.	= 4, 9	Contrib. drain. area	= 82.500 ac

Strother Road Culvert

Hyd. No. 10 -- 10 Year

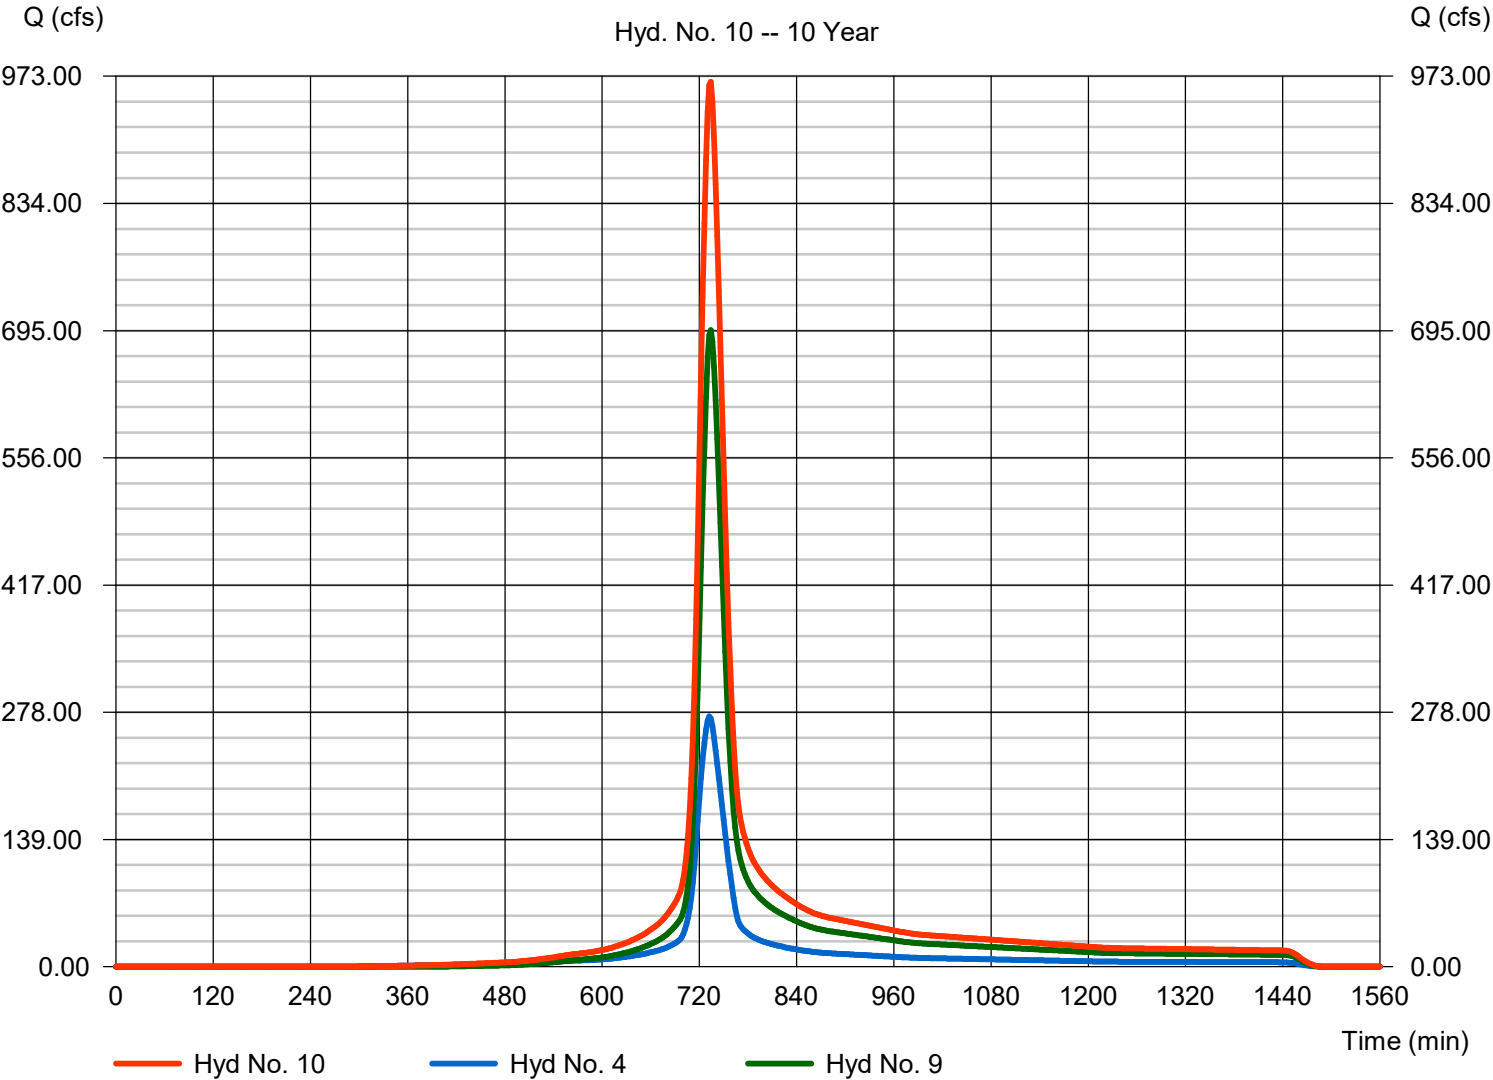


Hydrograph Report

Hyd. No. 11

Wilshire Existing Stream

Hydrograph type	= Reach	Peak discharge	= 915.90 cfs
Storm frequency	= 10 yrs	Time to peak	= 738 min
Time interval	= 2 min	Hyd. volume	= 3,962,789 cuft
Inflow hyd. No.	= 10 - Strother Road Culvert	Section type	= Trapezoidal
Reach length	= 2200.0 ft	Channel slope	= 1.4 %
Manning's n	= 0.030	Bottom width	= 5.0 ft
Side slope	= 20.0:1	Max. depth	= 5.0 ft
Rating curve x	= 2.009	Rating curve m	= 1.231
Ave. velocity	= 6.40 ft/s	Routing coeff.	= 0.3536

Modified Att-Kin routing method used.

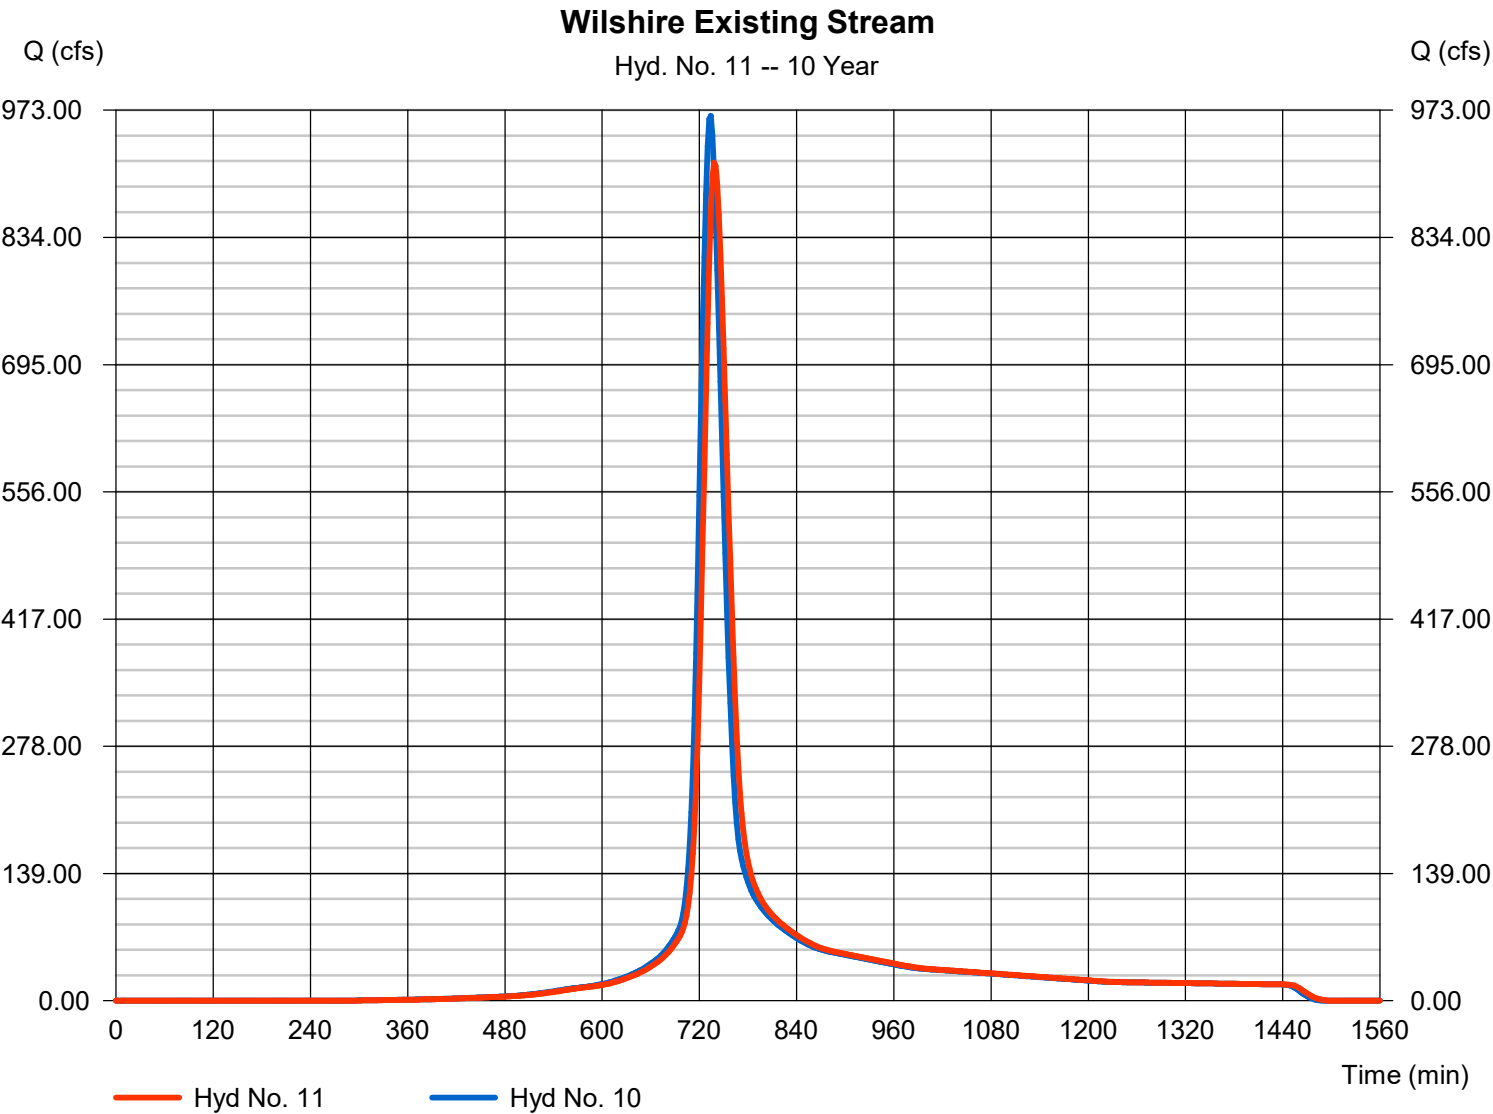


Hydrograph Report

Hyd. No. 12

OVERALL PRE

Hydrograph type	= Combine	Peak discharge	= 1263.54 cfs
Storm frequency	= 10 yrs	Time to peak	= 732 min
Time interval	= 2 min	Hyd. volume	= 6,115,463 cuft
Inflow hyds.	= 5, 6, 7, 11	Contrib. drain. area	= 157.200 ac

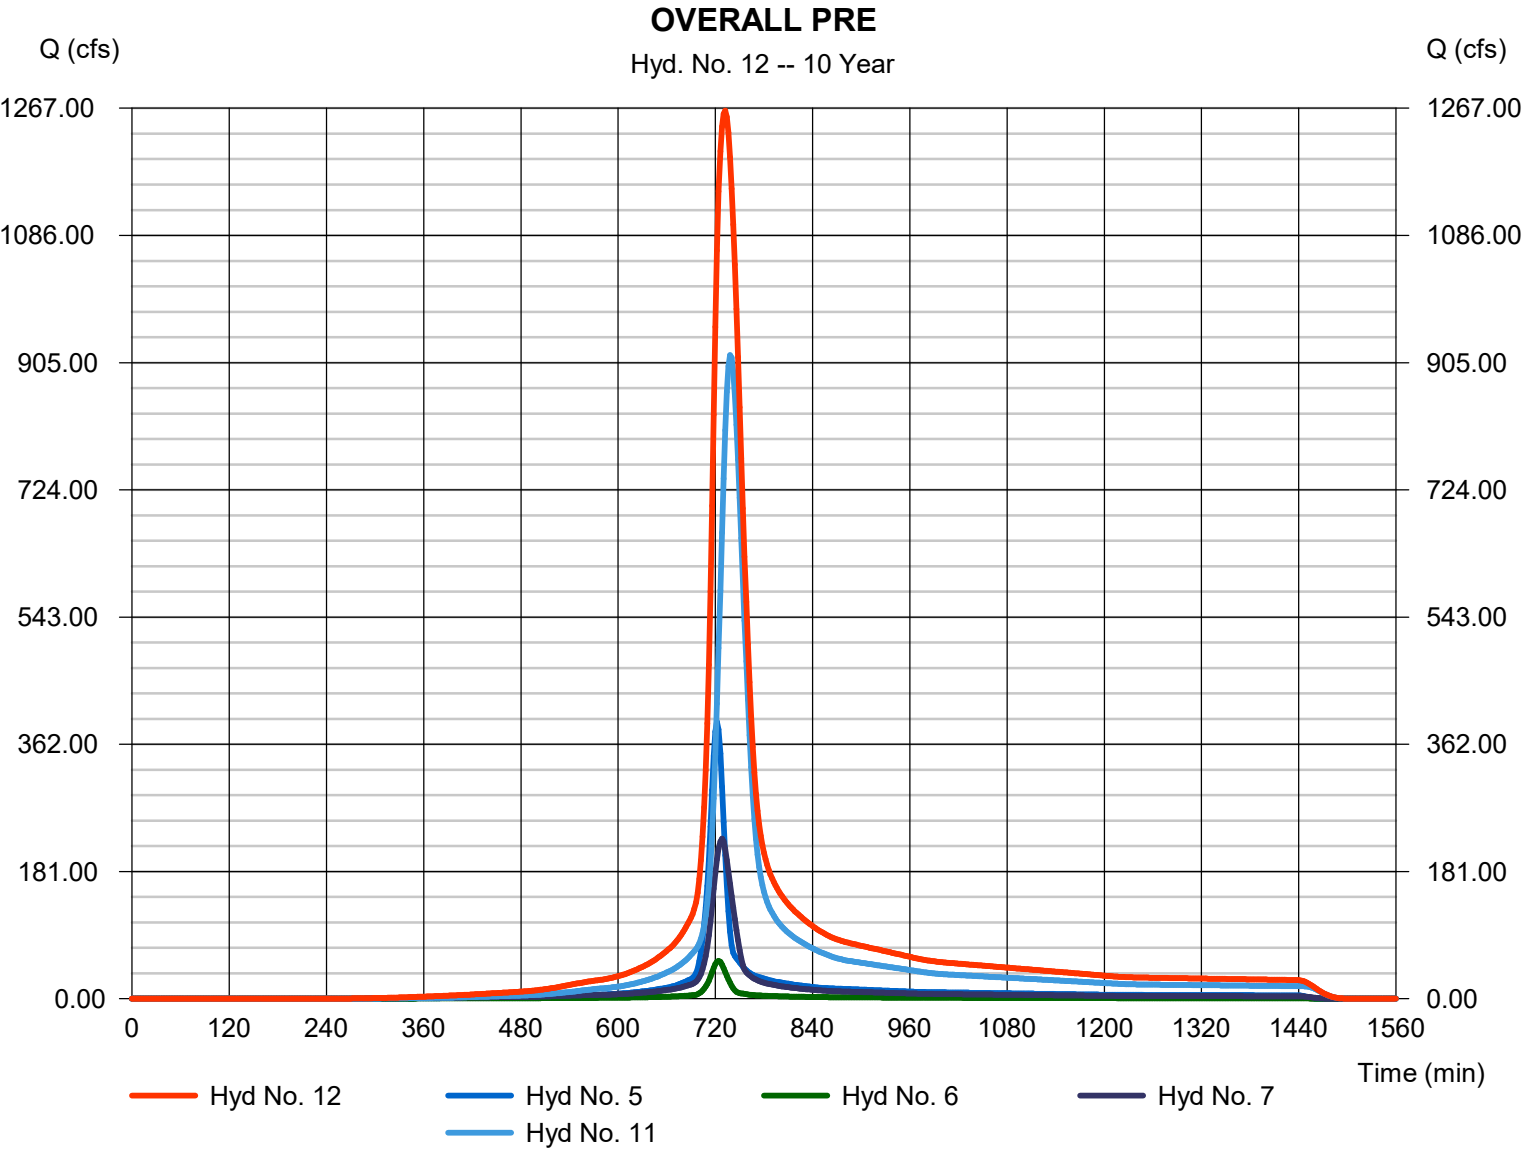

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 13

Section 7A-Post

Hydrograph type	= SCS Runoff	Peak discharge	= 91.08 cfs
Storm frequency	= 10 yrs	Time to peak	= 724 min
Time interval	= 2 min	Hyd. volume	= 293,265 cuft
Drainage area	= 19.900 ac	Curve number	= 89*
Basin Slope	= 0.0 %	Hydraulic length	= 0 ft
Tc method	= TR55	Time of conc. (Tc)	= 19.30 min
Total precip.	= 5.30 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

* Composite (Area/CN) = [(19.900 x 89)] / 19.900

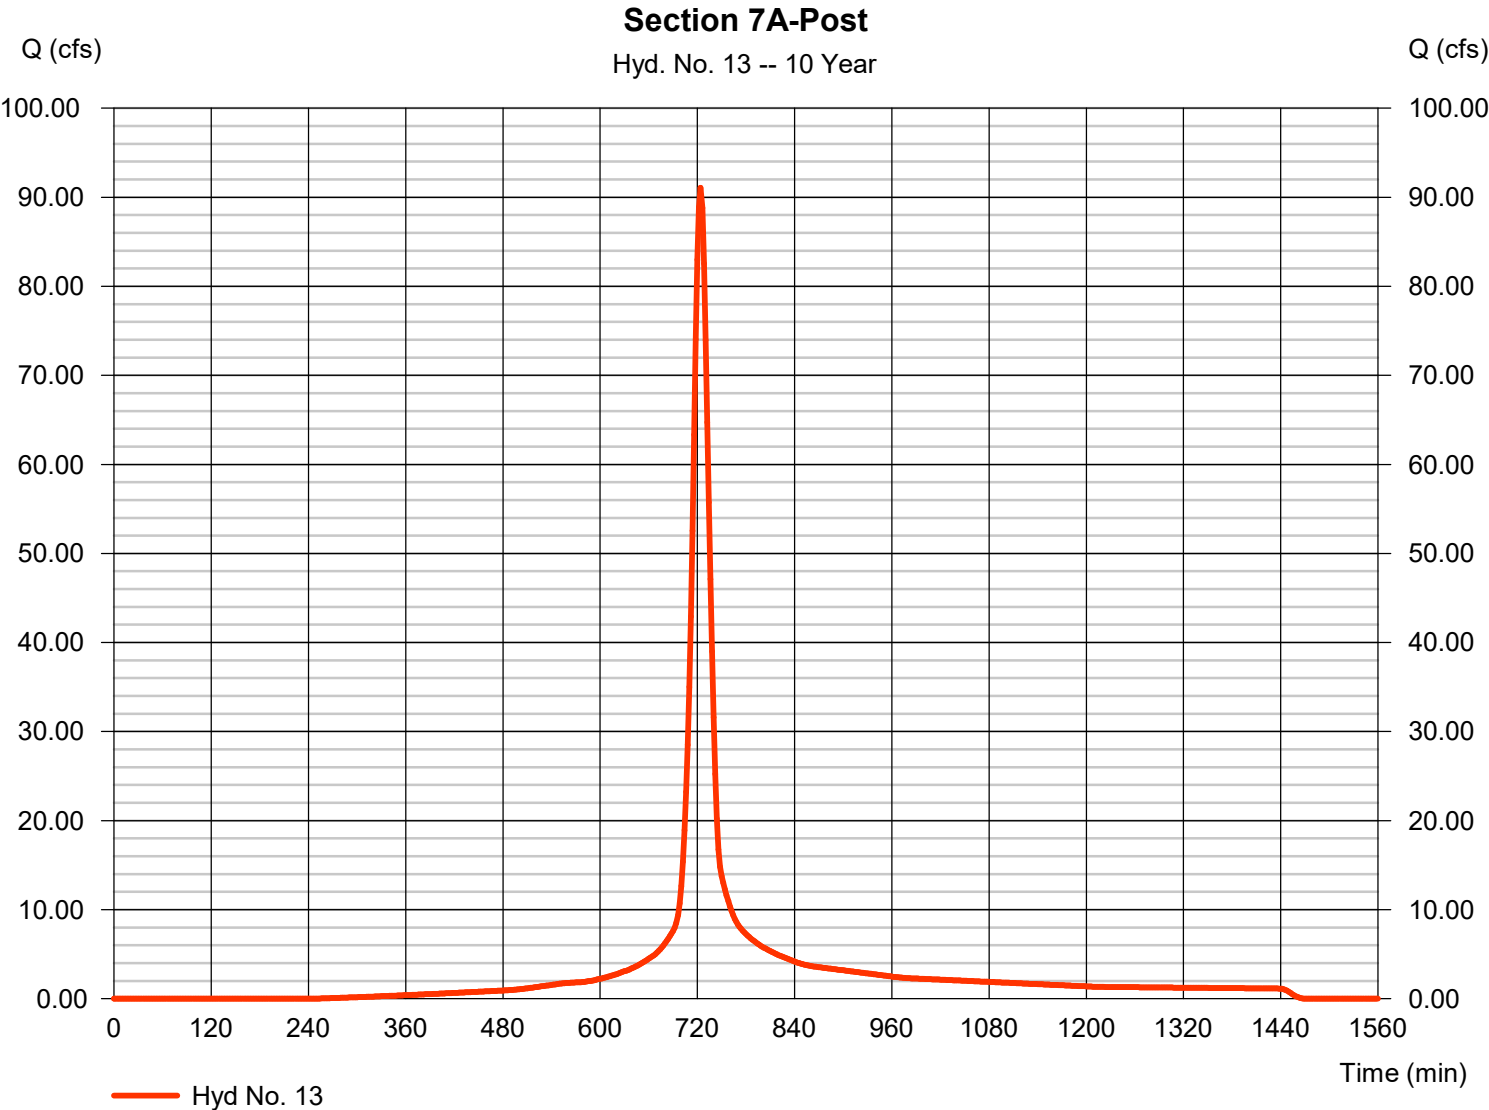


Hydrograph Report

Hyd. No. 14

Section 7B-Post (Wilshire Hills Bypass)

Hydrograph type	=	SCS Runoff	Peak discharge	=	12.03 cfs
Storm frequency	=	10 yrs	Time to peak	=	732 min
Time interval	=	2 min	Hyd. volume	=	50,537 cuft
Drainage area	=	7.500 ac	Curve number	=	65*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	28.28 min
Total precip.	=	5.30 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(13.900 x 74)] / 7.500

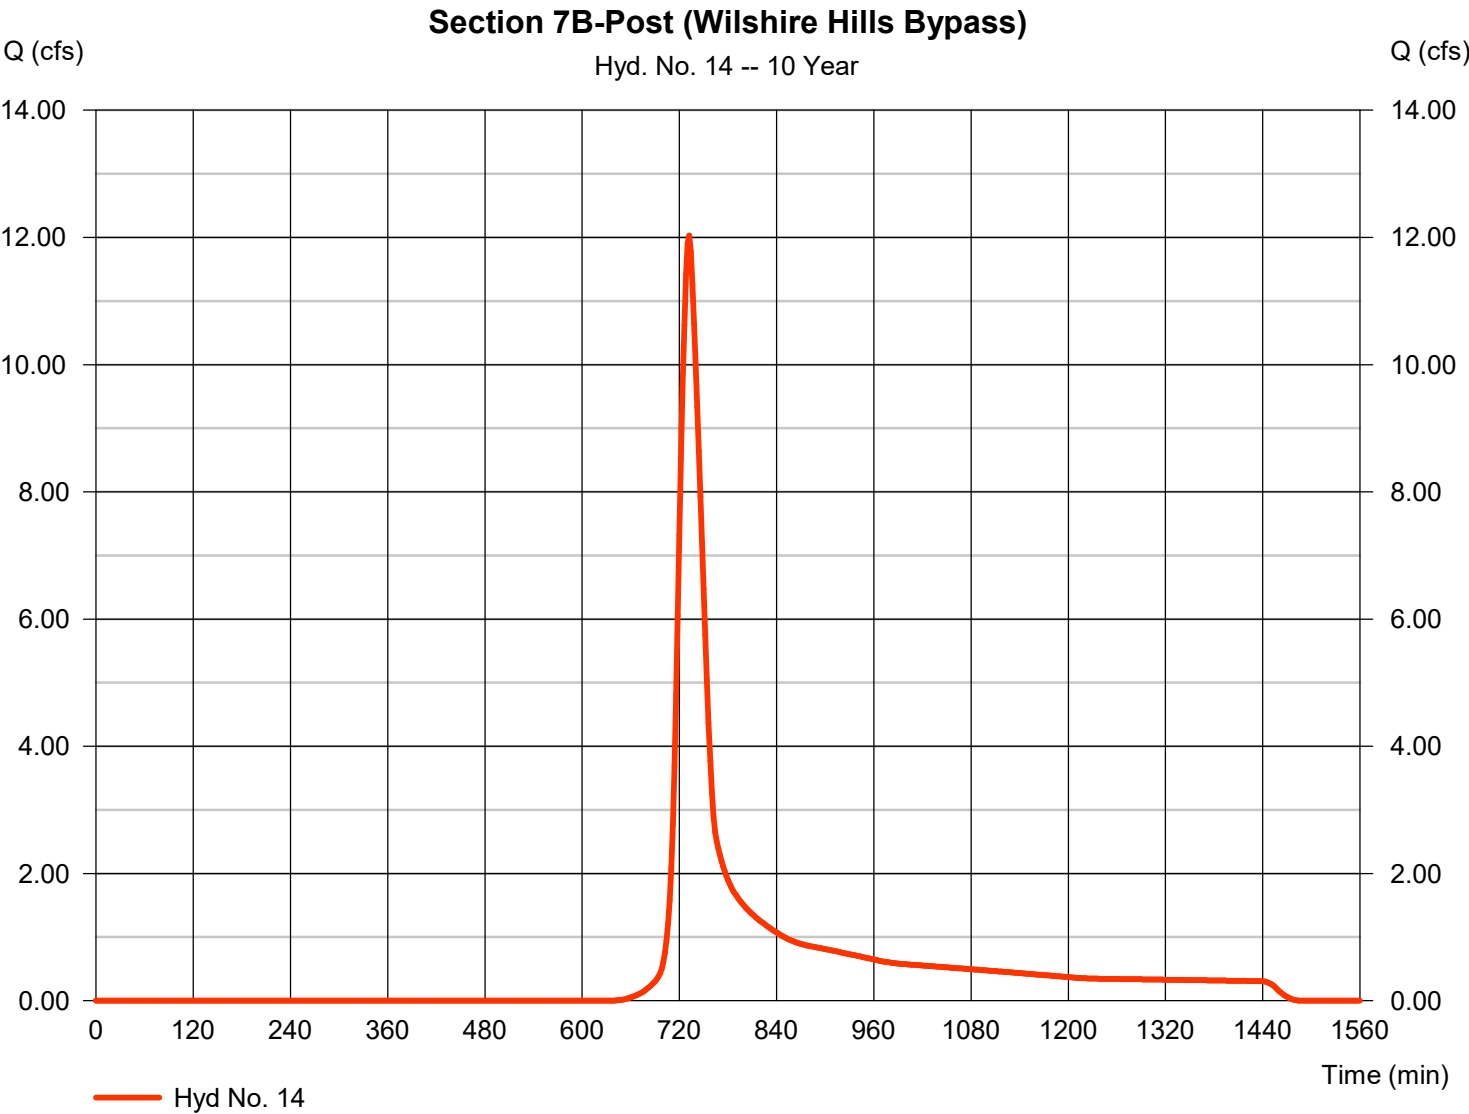


Hydrograph Report

Hyd. No. 15

Section 7C-Post (Wilshire Hills)

Hydrograph type	=	SCS Runoff	Peak discharge	=	79.37 cfs
Storm frequency	=	10 yrs	Time to peak	=	726 min
Time interval	=	2 min	Hyd. volume	=	280,952 cuft
Drainage area	=	18.730 ac	Curve number	=	89*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	User	Time of conc. (Tc)	=	20.60 min
Total precip.	=	5.30 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(18.730 x 89)] / 18.730

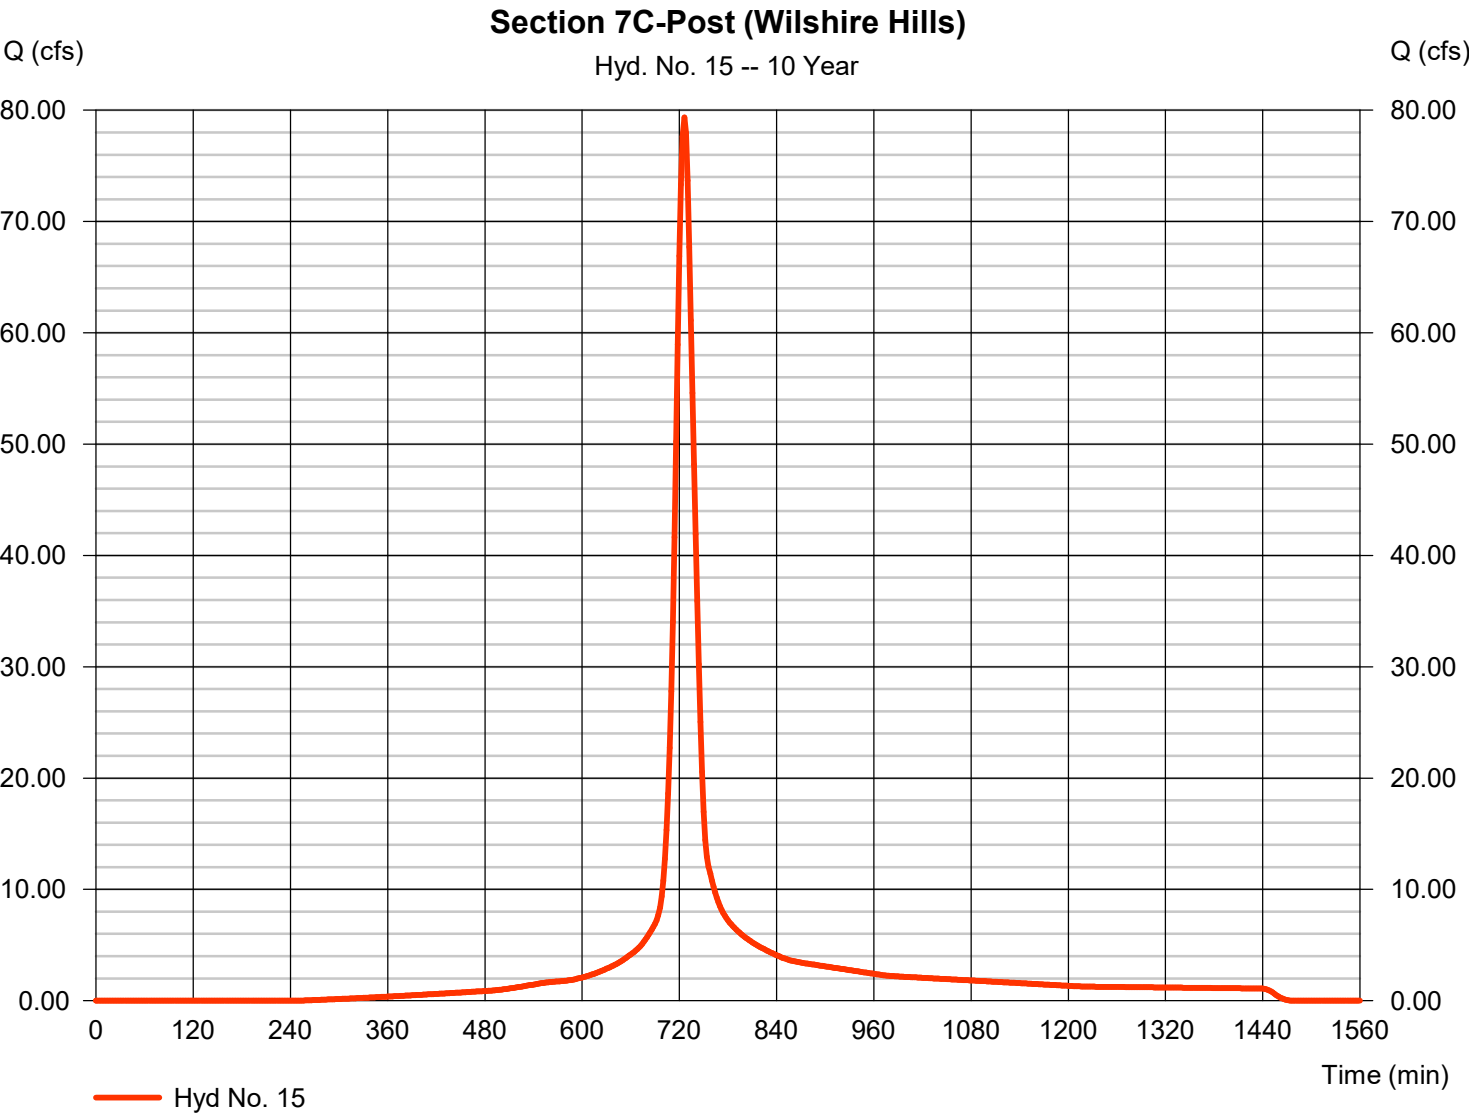

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Thursday, 03 / 28 / 2024

Hyd. No. 16


Wilshire- Preserved stream

Hydrograph type	= Reach	Peak discharge	= 933.75 cfs
Storm frequency	= 10 yrs	Time to peak	= 738 min
Time interval	= 2 min	Hyd. volume	= 3,962,789 cuft
Inflow hyd. No.	= 10 - Strother Road Culvert	Section type	= Trapezoidal
Reach length	= 500.0 ft	Channel slope	= 0.5 %
Manning's n	= 0.100	Bottom width	= 10.0 ft
Side slope	= 14.0:1	Max. depth	= 8.0 ft
Rating curve x	= 0.227	Rating curve m	= 1.318
Ave. velocity	= 1.71 ft/s	Routing coeff.	= 0.4254

Modified Att-Kin routing method used.

Wilshire- Preserved stream

Hyd. No. 16 -- 10 Year

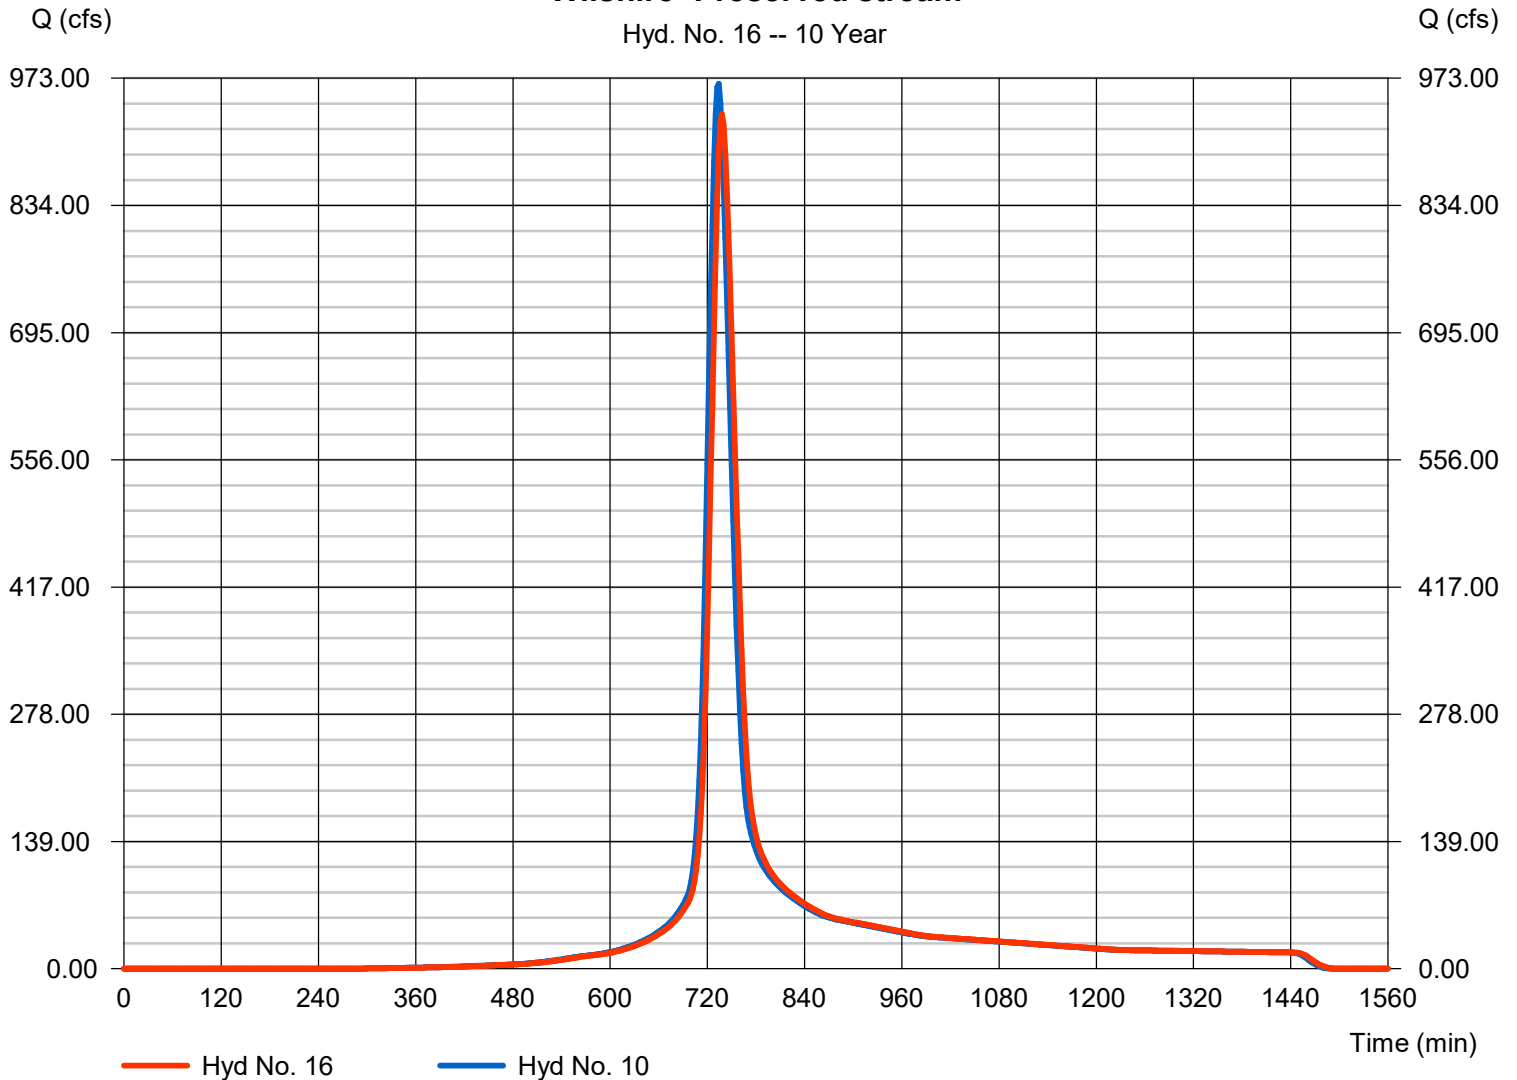

Hydrograph Report


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Thursday, 03 / 28 / 2024

Hyd. No. 17

Onsite Water

Hydrograph type	= Combine	Peak discharge	= 90.00 cfs
Storm frequency	= 10 yrs	Time to peak	= 726 min
Time interval	= 2 min	Hyd. volume	= 331,488 cuft
Inflow hyds.	= 14, 15	Contrib. drain. area	= 26.230 ac

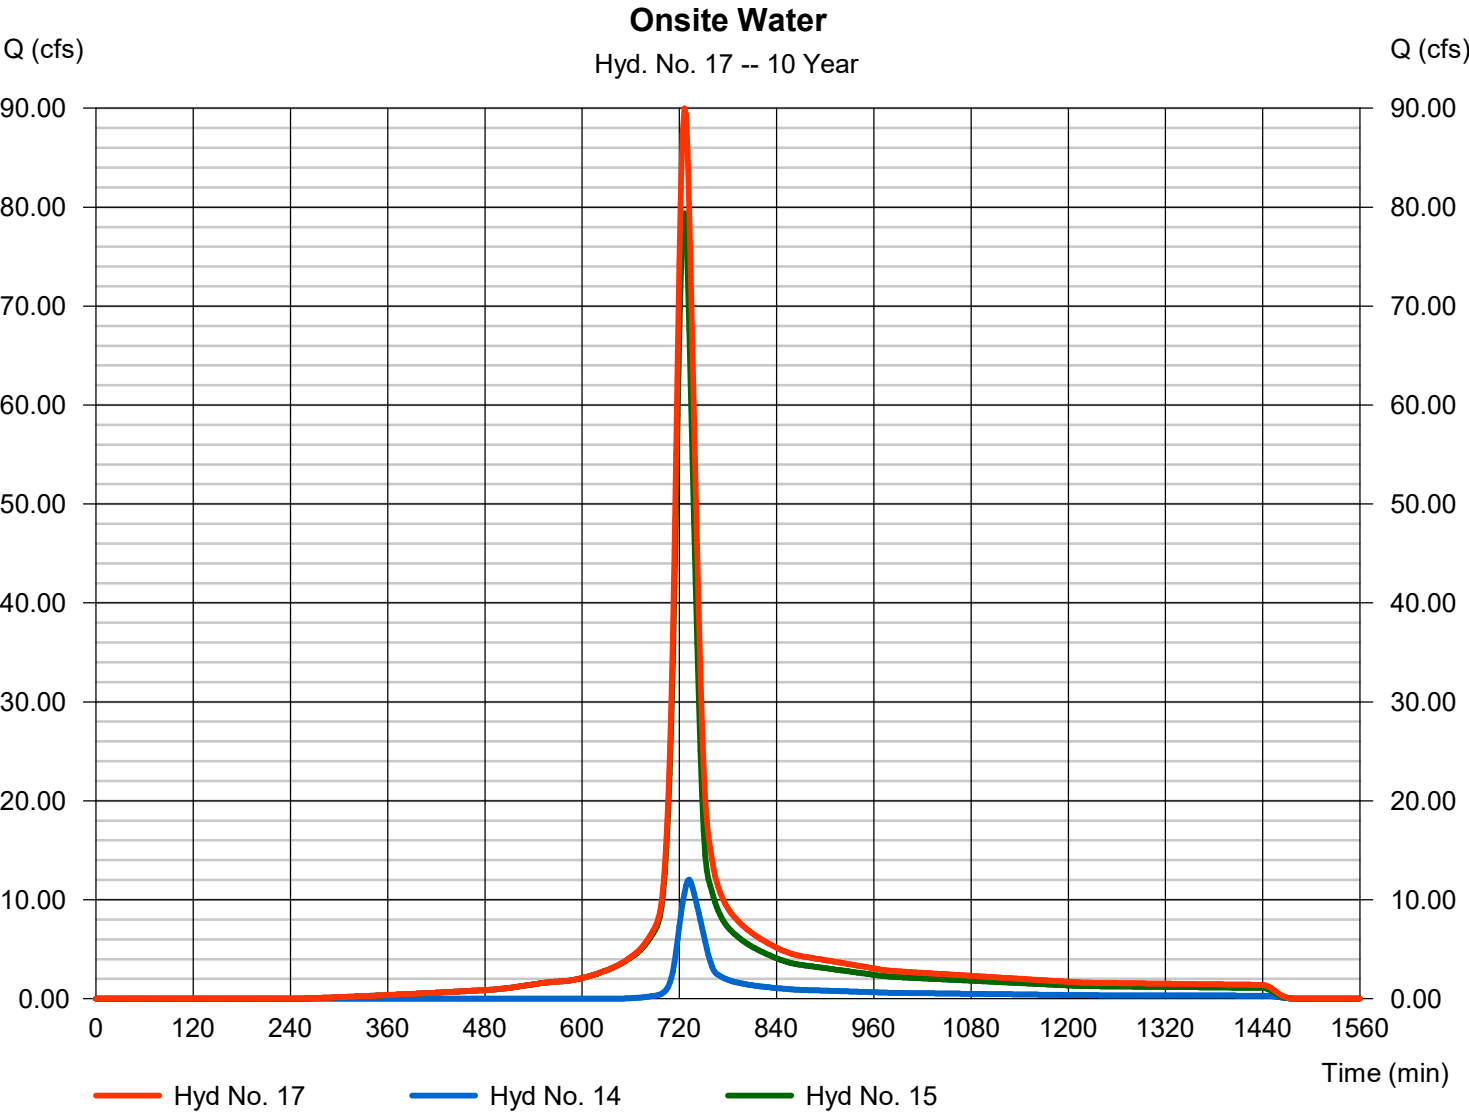


Hydrograph Report

Hyd. No. 18

Detention Basin

Hydrograph type	= Reservoir	Peak discharge	= 47.35 cfs
Storm frequency	= 10 yrs	Time to peak	= 742 min
Time interval	= 2 min	Hyd. volume	= 331,474 cuft
Inflow hyd. No.	= 17 - Onsite Water	Max. Elevation	= 918.93 ft
Reservoir name	= Detention Basin	Max. Storage	= 124,829 cuft

Storage Indication method used.

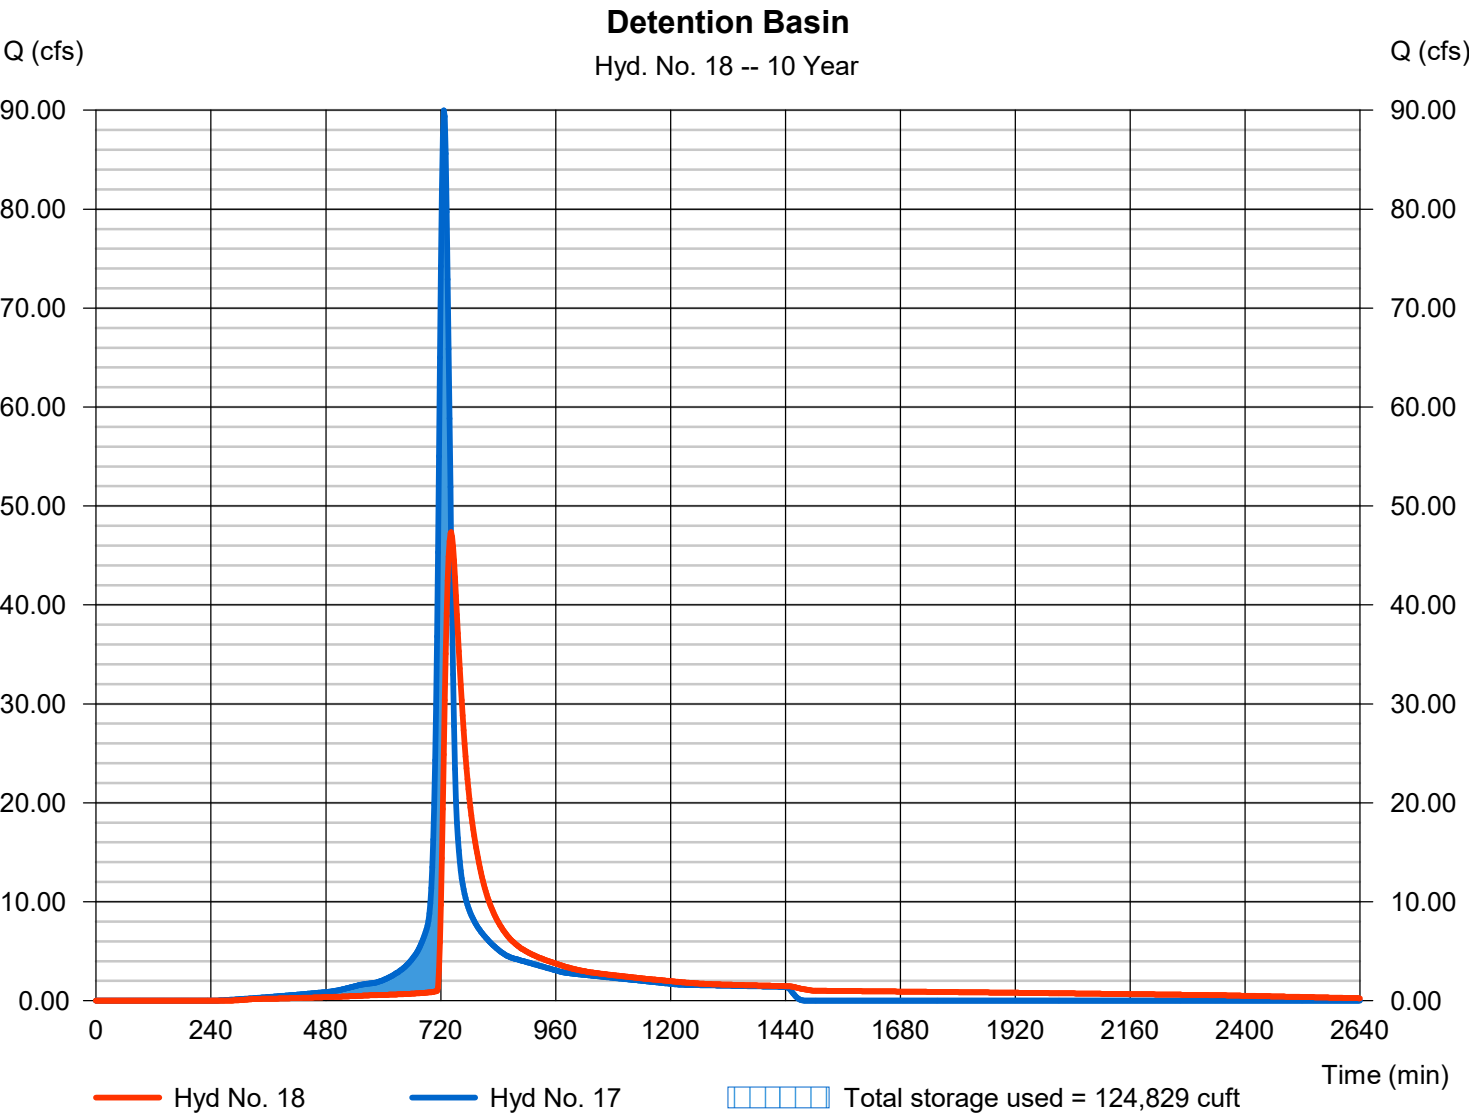

Hydrograph Report


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Thursday, 03 / 28 / 2024

Hyd. No. 19

Post-Meadowview Culvert

Hydrograph type	= Combine	Peak discharge	= 1153.87 cfs
Storm frequency	= 10 yrs	Time to peak	= 734 min
Time interval	= 2 min	Hyd. volume	= 5,708,996 cuft
Inflow hyds.	= 5, 13, 16, 18	Contrib. drain. area	= 106.800 ac

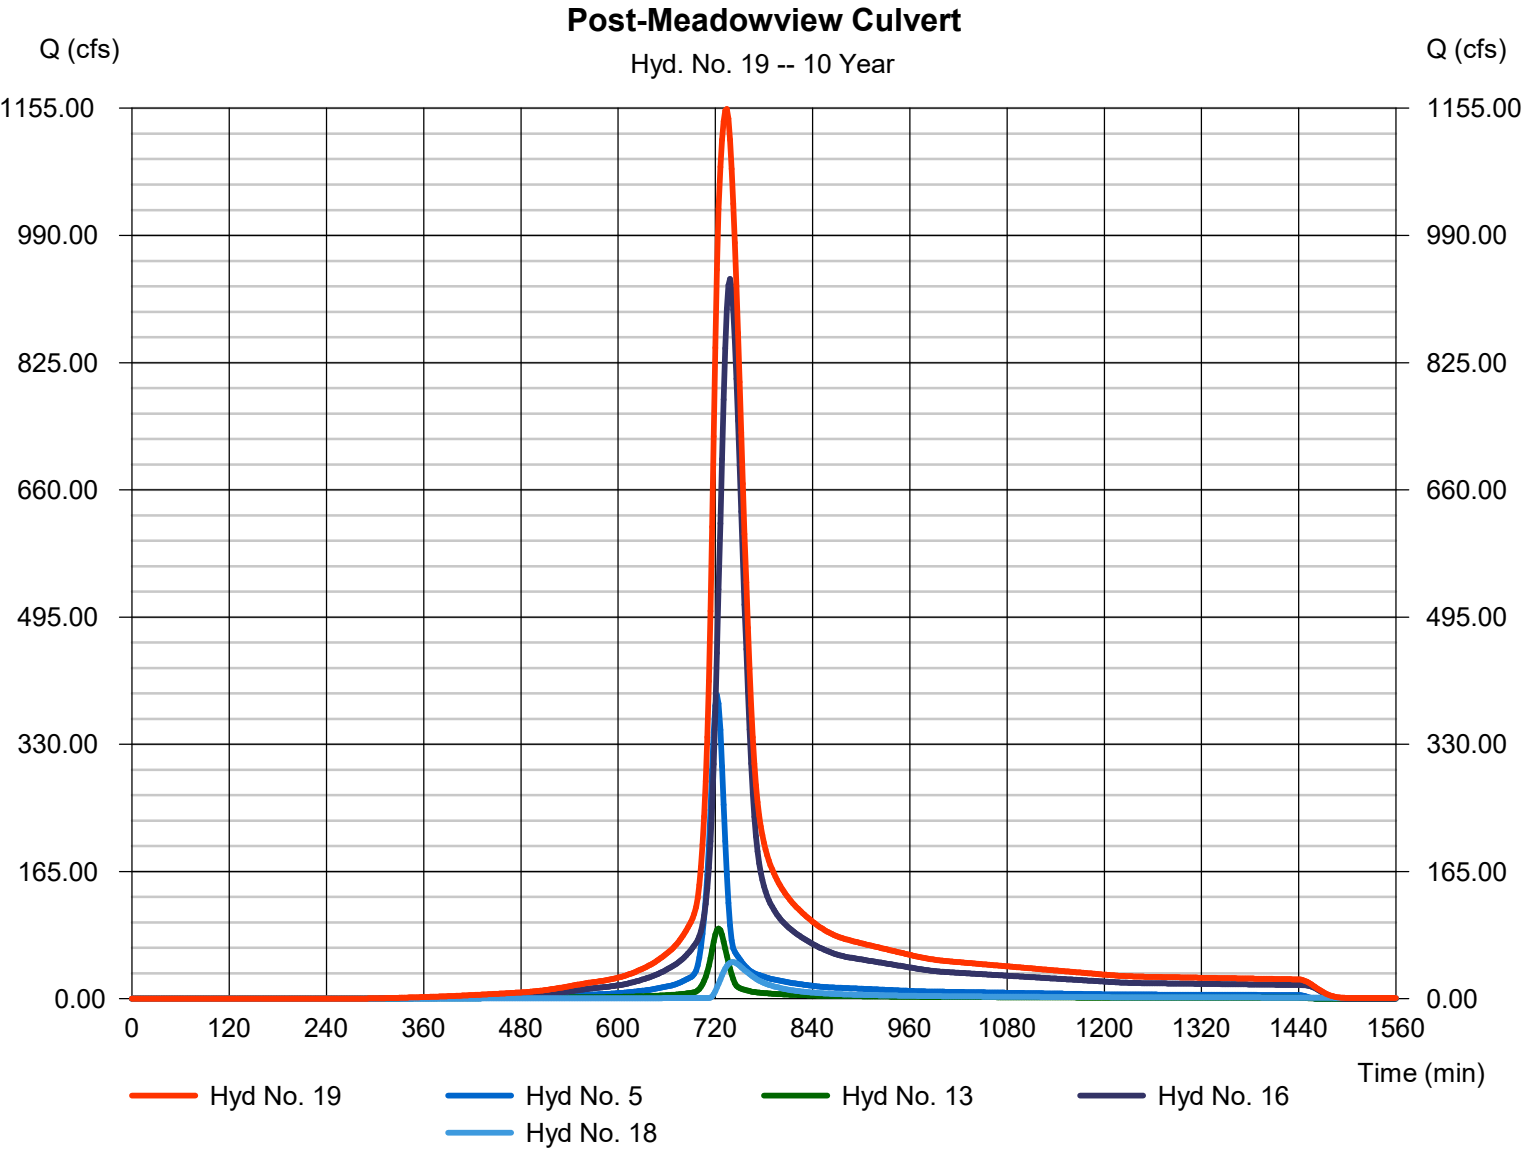


Hydrograph Report

Hyd. No. 20

Post - Restored Stream

Hydrograph type	= Reach	Peak discharge	= 1130.16 cfs
Storm frequency	= 10 yrs	Time to peak	= 738 min
Time interval	= 2 min	Hyd. volume	= 5,708,940 cuft
Inflow hyd. No.	= 19 - Post-Meadowview Culvert	Section type	= Trapezoidal
Reach length	= 1340.0 ft	Channel slope	= 0.8 %
Manning's n	= 0.030	Bottom width	= 20.0 ft
Side slope	= 10.0:1	Max. depth	= 4.0 ft
Rating curve x	= 0.595	Rating curve m	= 1.345
Ave. velocity	= 4.15 ft/s	Routing coeff.	= 0.4000

Modified Att-Kin routing method used.

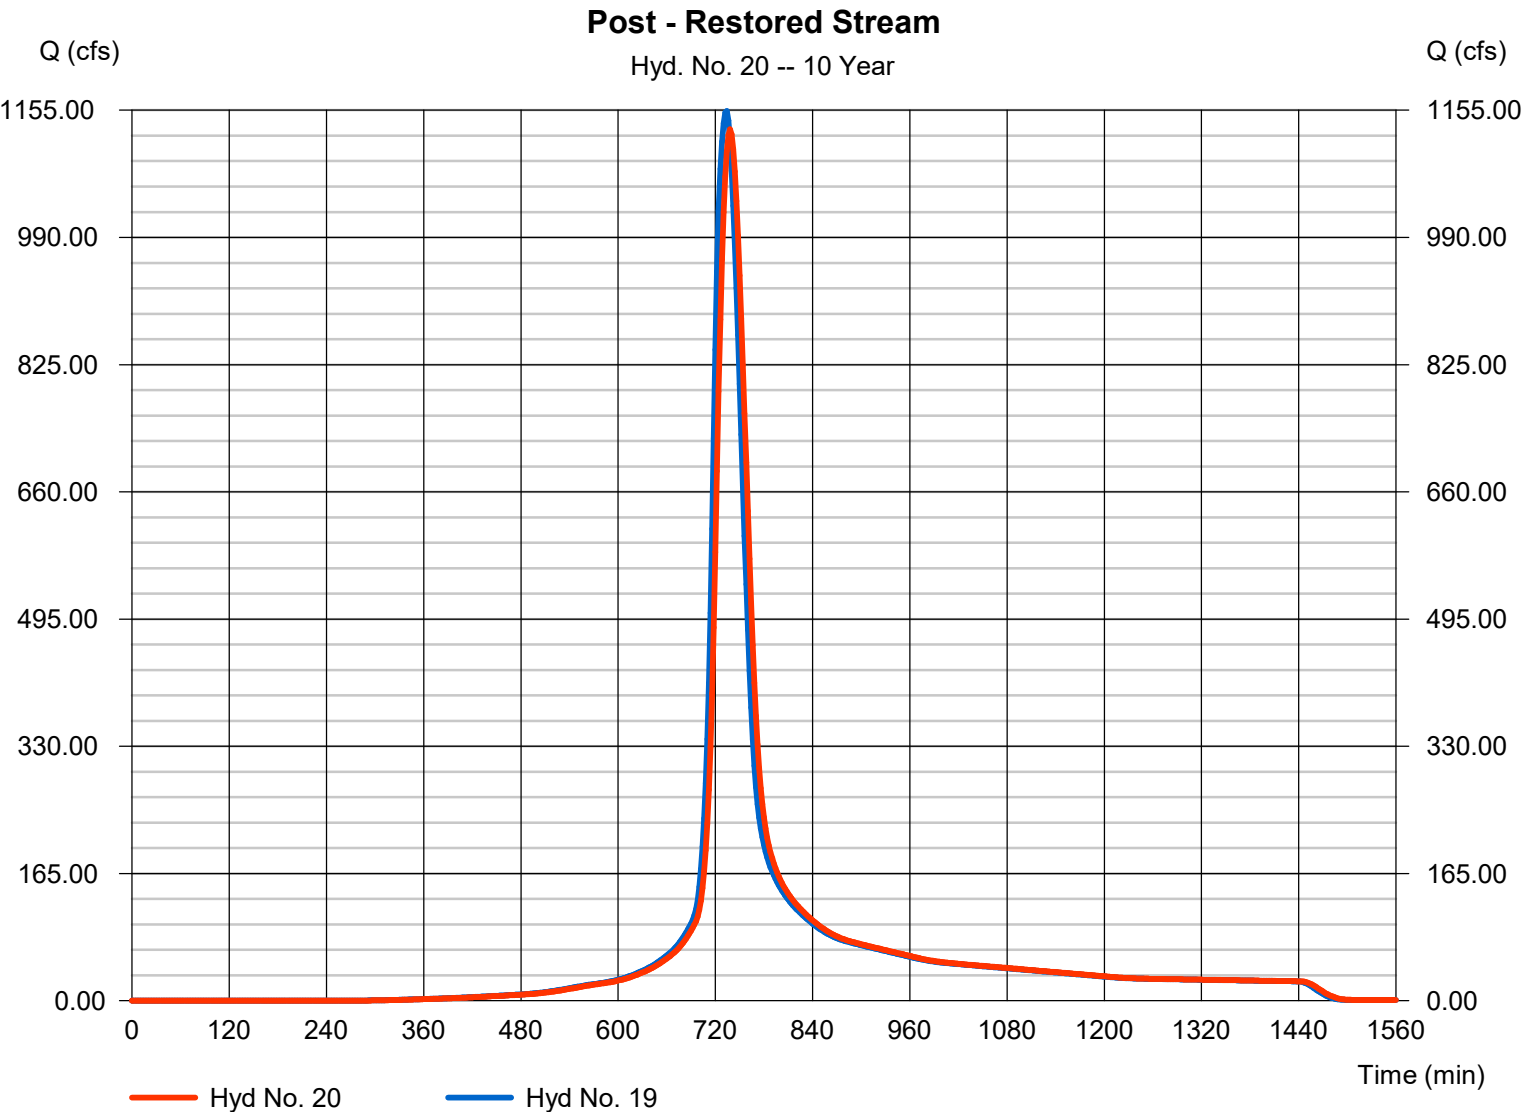


Hydrograph Report

Hyd. No. 21

Section 8 - Post

Hydrograph type	=	SCS Runoff	Peak discharge	=	49.61 cfs
Storm frequency	=	10 yrs	Time to peak	=	728 min
Time interval	=	2 min	Hyd. volume	=	187,574 cuft
Drainage area	=	12.600 ac	Curve number	=	90*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	23.90 min
Total precip.	=	5.30 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(12.600 x 90)] / 12.600

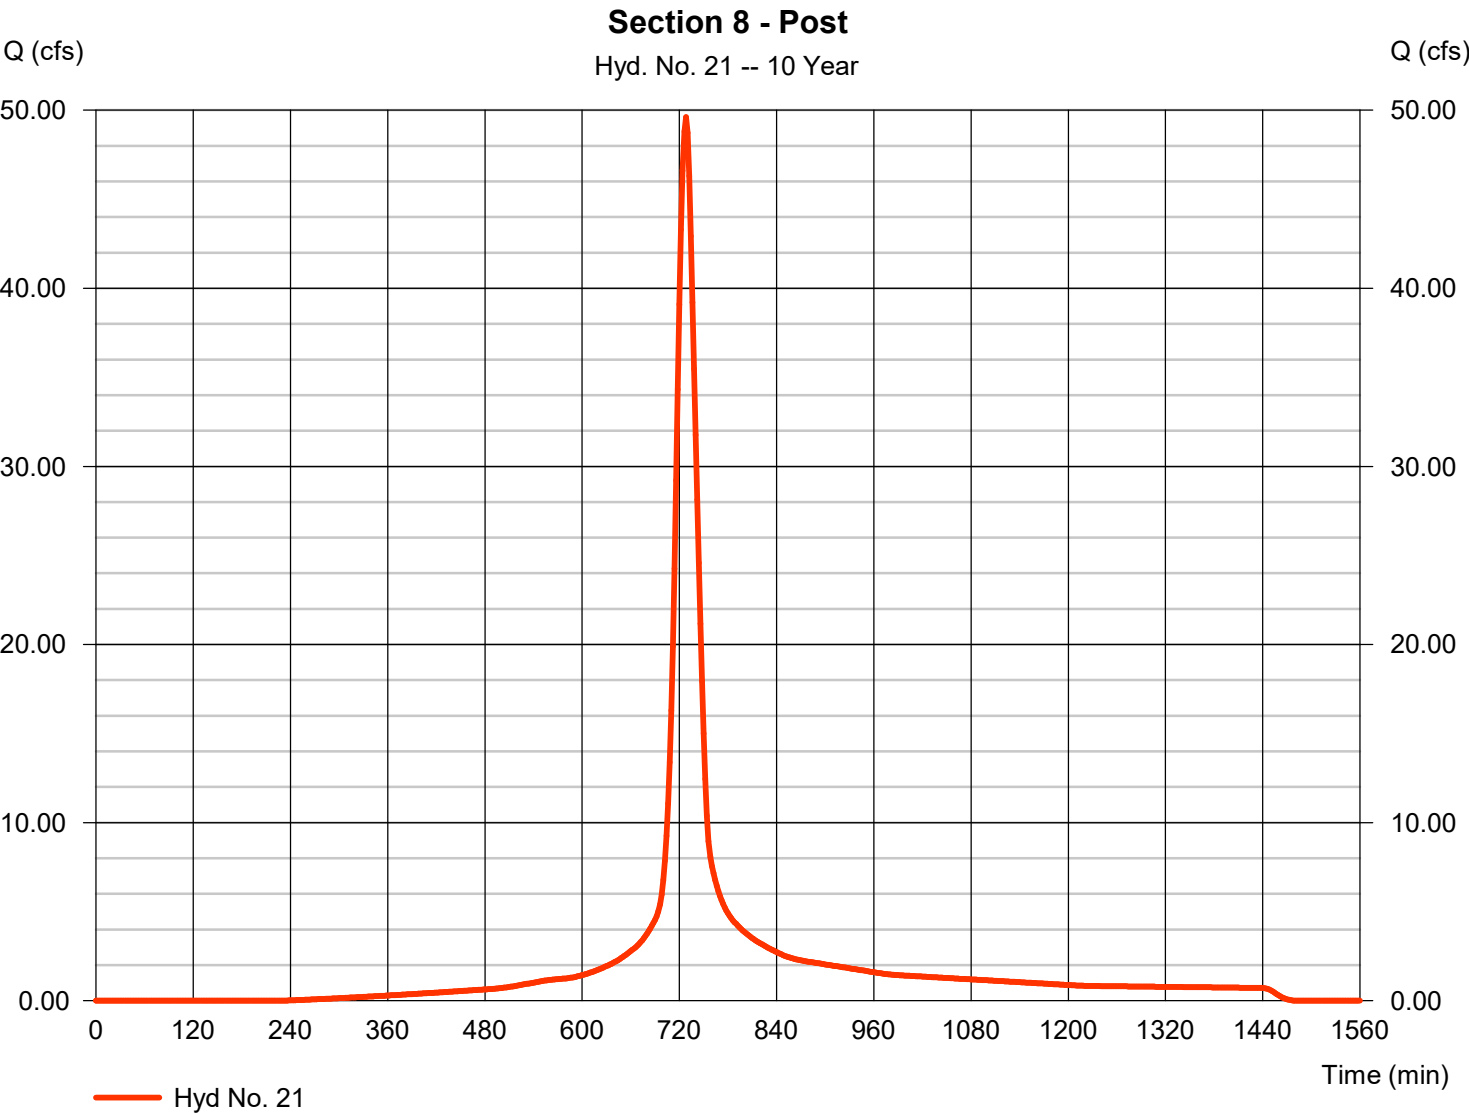

Hydrograph Report


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Thursday, 03 / 28 / 2024

Hyd. No. 22

OVERALL POST - DETENTION BASIN

Hydrograph type	= Combine	Peak discharge	= 1189.44 cfs
Storm frequency	= 10 yrs	Time to peak	= 736 min
Time interval	= 2 min	Hyd. volume	= 6,071,823 cuft
Inflow hyds.	= 6, 20, 21	Contrib. drain. area	= 23.900 ac

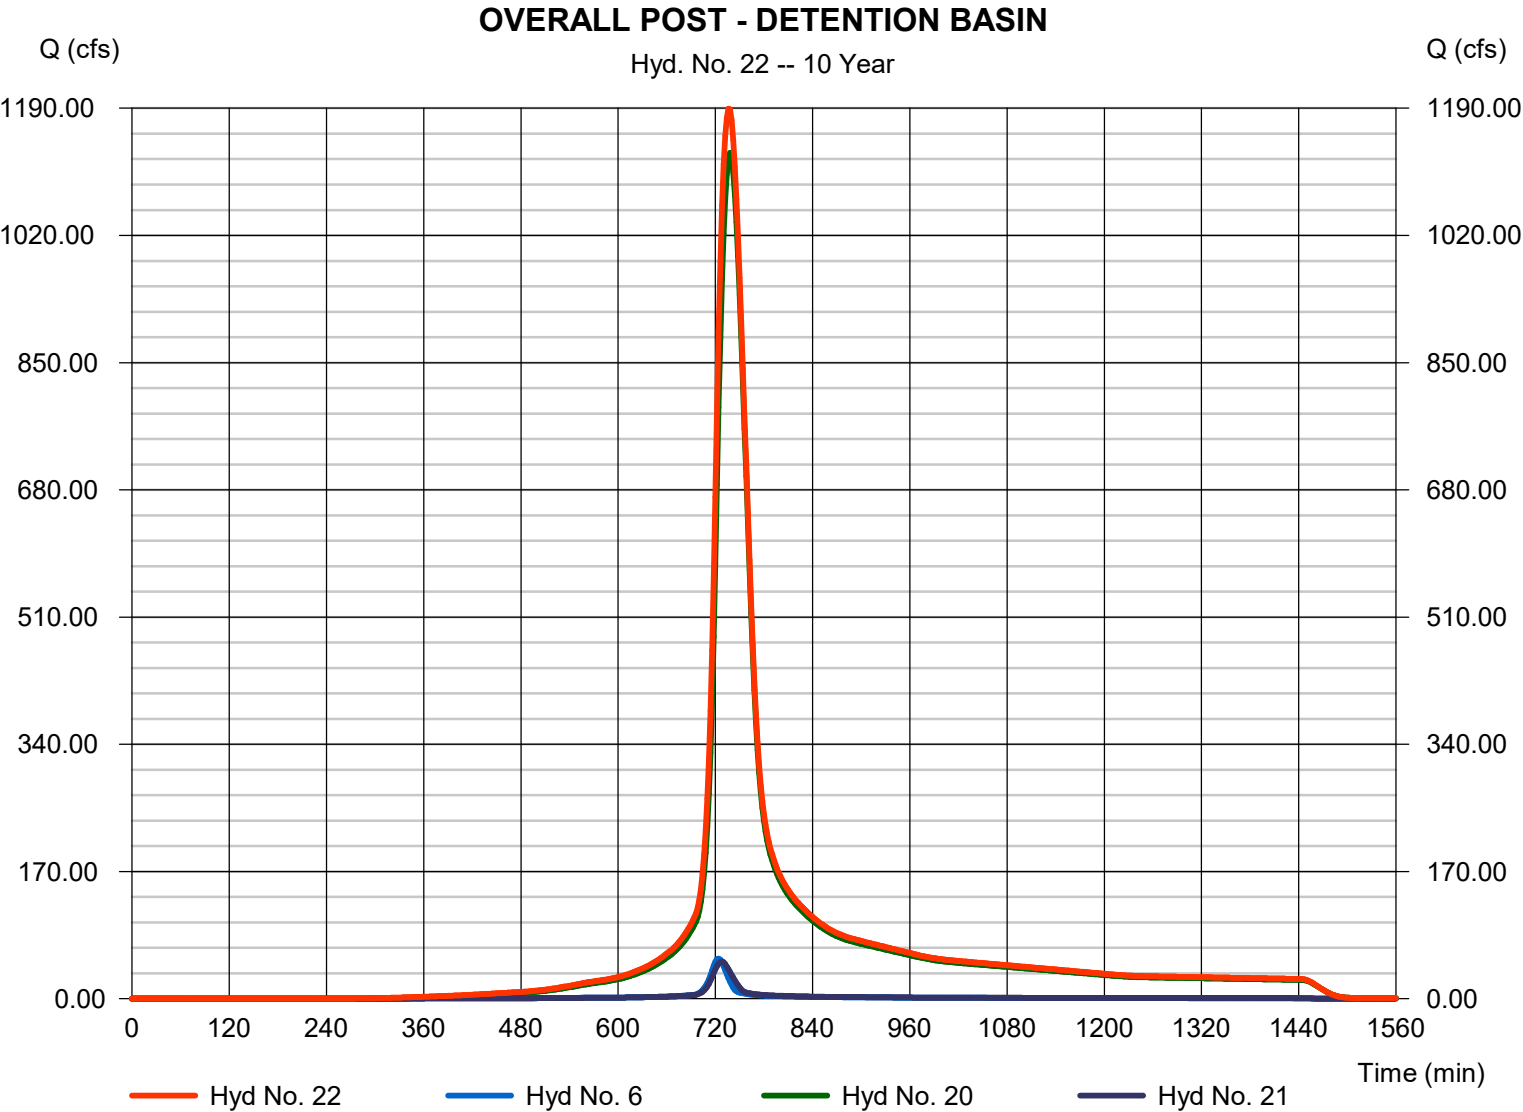

Hydrograph Summary Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Hyd. No.	Hydrograph type (origin)	Peak flow (cfs)	Time interval (min)	Time to Peak (min)	Hyd. volume (cuft)	Inflow hyd(s)	Maximum elevation (ft)	Total strge used (cuft)	Hydrograph Description
1	SCS Runoff	403.79	2	728	1,486,312	-----	-----	-----	Section 1
2	SCS Runoff	336.08	2	728	1,237,077	-----	-----	-----	Section 2
3	SCS Runoff	512.72	2	730	2,074,709	-----	-----	-----	Section 3
4	SCS Runoff	431.92	2	732	1,932,345	-----	-----	-----	Section 4
5	SCS Runoff	636.00	2	722	1,851,646	-----	-----	-----	Section 5
6	SCS Runoff	82.47	2	724	275,937	-----	-----	-----	Section 6
7	SCS Runoff	355.97	2	728	1,368,386	-----	-----	-----	Section 7/8-Pre
8	Combine	1243.39	2	728	4,798,103	1, 2, 3,	-----	-----	Industrial Complex to Detention
9	Reach	1211.21	2	732	4,798,098	8	-----	-----	Industrial Above Ground Detention Po
10	Combine	1643.13	2	732	6,730,445	4, 9	-----	-----	Strother Road Culvert
11	Reach	1570.20	2	738	6,730,444	10	-----	-----	Wilshire Existing Stream
12	Combine	2145.77	2	732	10,226,411	5, 6, 7, 11	-----	-----	OVERALL PRE
13	SCS Runoff	142.13	2	724	468,866	-----	-----	-----	Section 7A-Post
14	SCS Runoff	25.16	2	732	101,635	-----	-----	-----	Section 7B-Post (Wilshire Hills Bypas
15	SCS Runoff	124.02	2	726	449,180	-----	-----	-----	Section 7C-Post (Wilshire Hills)
16	Reach	1596.55	2	736	6,730,439	10	-----	-----	Wilshire- Preserved stream
17	Combine	147.04	2	726	550,815	14, 15,	-----	-----	Onsite Water
18	Reservoir	86.30	2	740	550,801	17	920.88	182,059	Detention Basin
19	Combine	1992.98	2	732	9,601,730	5, 13, 16, 18	-----	-----	Post-Meadowview Culvert
20	Reach	1958.22	2	736	9,601,693	19	-----	-----	Post - Restored Stream
21	SCS Runoff	76.90	2	728	297,548	-----	-----	-----	Section 8 - Post
22	Combine	2060.48	2	736	10,175,185	6, 20, 21	-----	-----	OVERALL POST - DETENTION BASI
15925 Downstream Analysis (3-28-2024).gpw					Return Period: 100 Year			Thursday, 03 / 28 / 2024	

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 1

Section 1

Hydrograph type	= SCS Runoff	Peak discharge	= 403.79 cfs
Storm frequency	= 100 yrs	Time to peak	= 728 min
Time interval	= 2 min	Hyd. volume	= 1,486,312 cuft
Drainage area	= 81.700 ac	Curve number	= 77*
Basin Slope	= 0.0 %	Hydraulic length	= 0 ft
Tc method	= TR55	Time of conc. (Tc)	= 24.30 min
Total precip.	= 7.80 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

* Composite (Area/CN) = $[(3.600 \times 81) + (13.500 \times 98) + (49.000 \times 73) + (15.600 \times 69)] / 81.700$

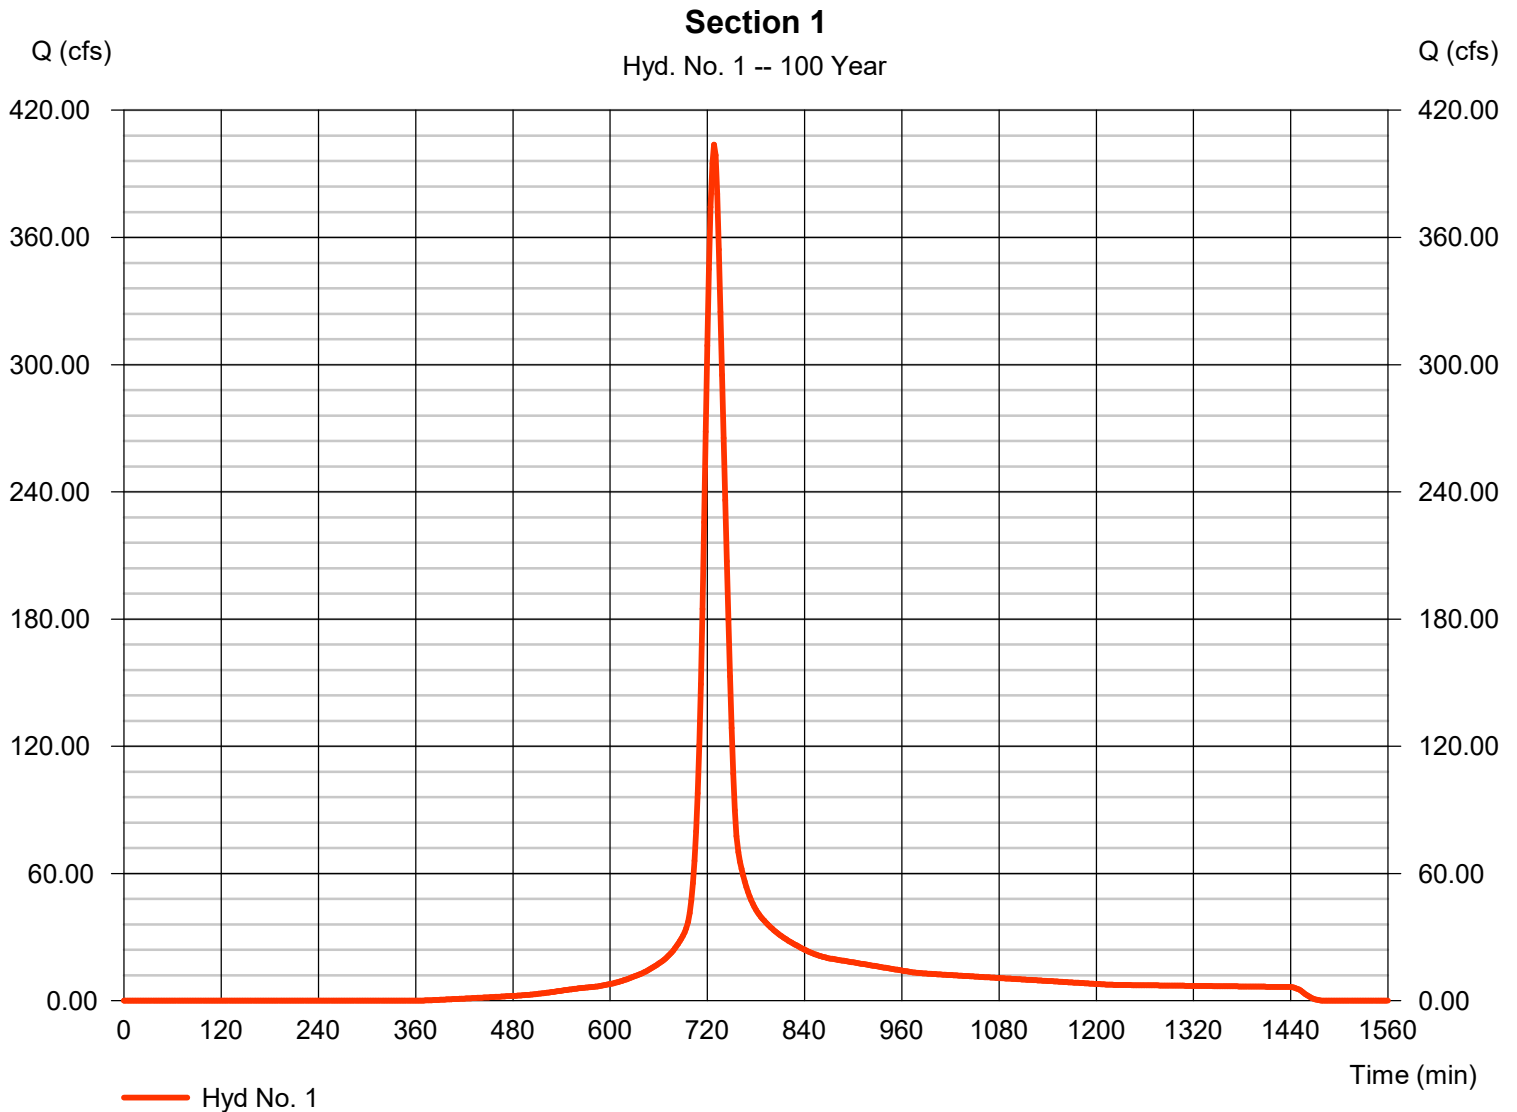


Hydrograph Report

Hyd. No. 2

Section 2

Hydrograph type	=	SCS Runoff	Peak discharge	=	336.08 cfs
Storm frequency	=	100 yrs	Time to peak	=	728 min
Time interval	=	2 min	Hyd. volume	=	1,237,077 cuft
Drainage area	=	68.000 ac	Curve number	=	77*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	25.30 min
Total precip.	=	7.80 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(8.000 x 98) + (0.500 x 77) + (30.800 x 79) + (28.700 x 69)] / 68.000

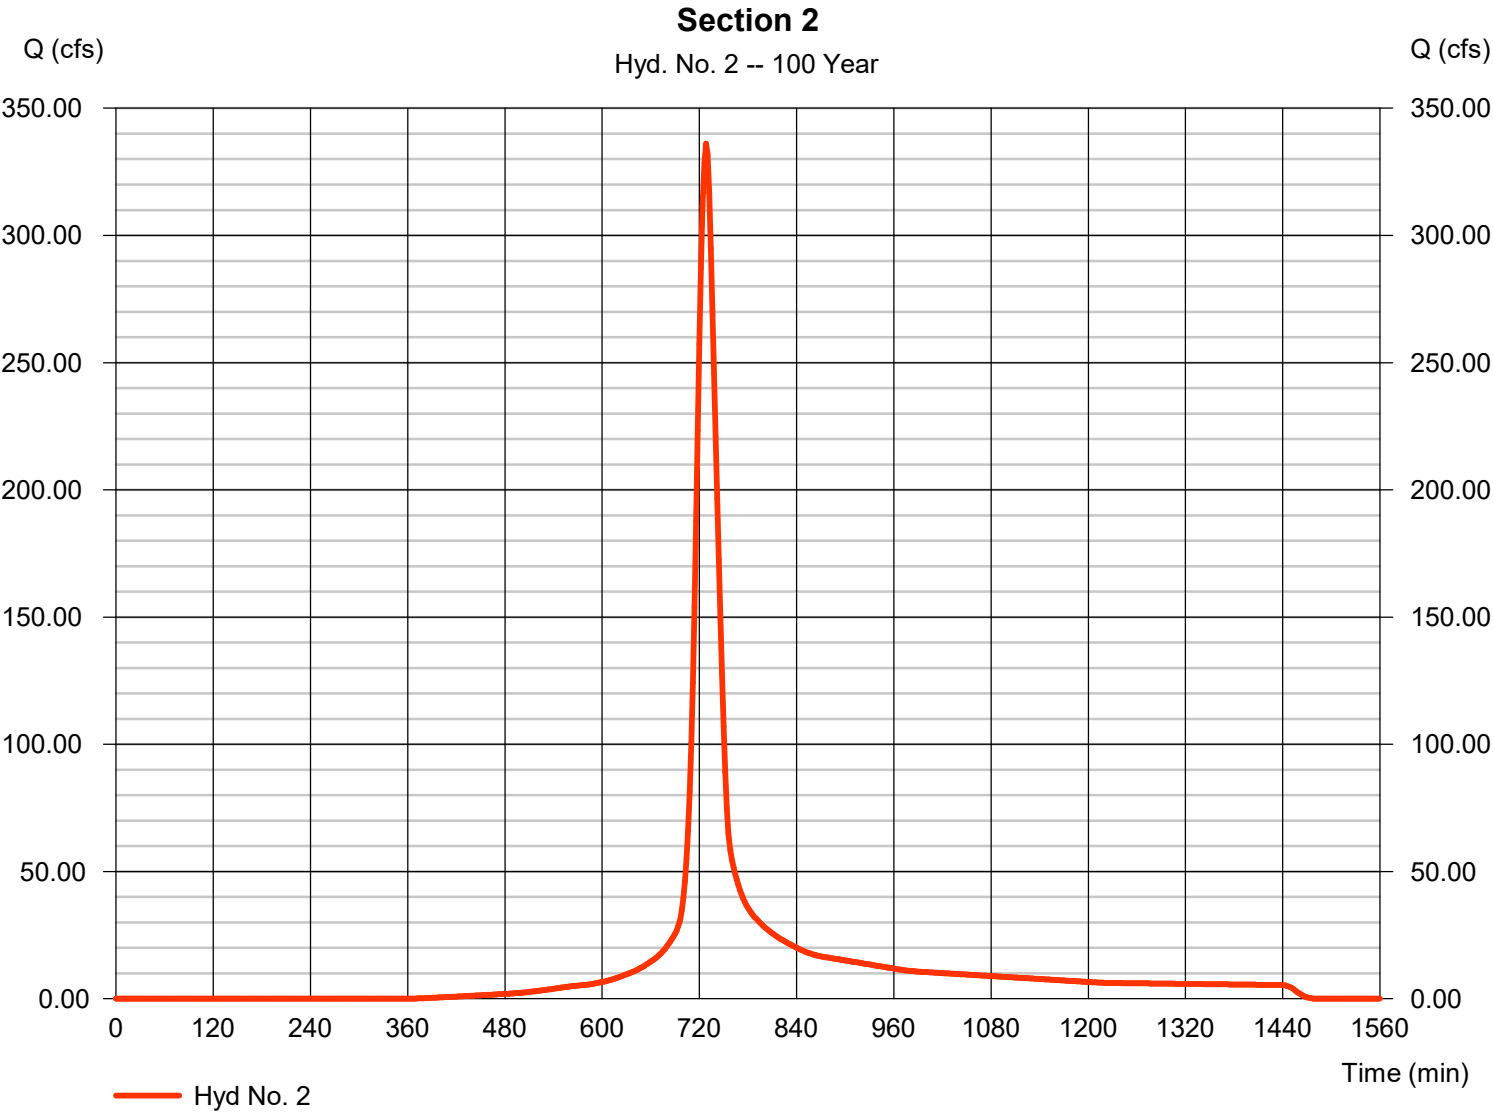

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 3

Section 3

Hydrograph type	=	SCS Runoff	Peak discharge	=	512.72 cfs
Storm frequency	=	100 yrs	Time to peak	=	730 min
Time interval	=	2 min	Hyd. volume	=	2,074,709 cuft
Drainage area	=	100.800 ac	Curve number	=	82*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	30.20 min
Total precip.	=	7.80 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(18.200 x 98) + (3.000 x 77) + (79.600 x 79)] / 100.800

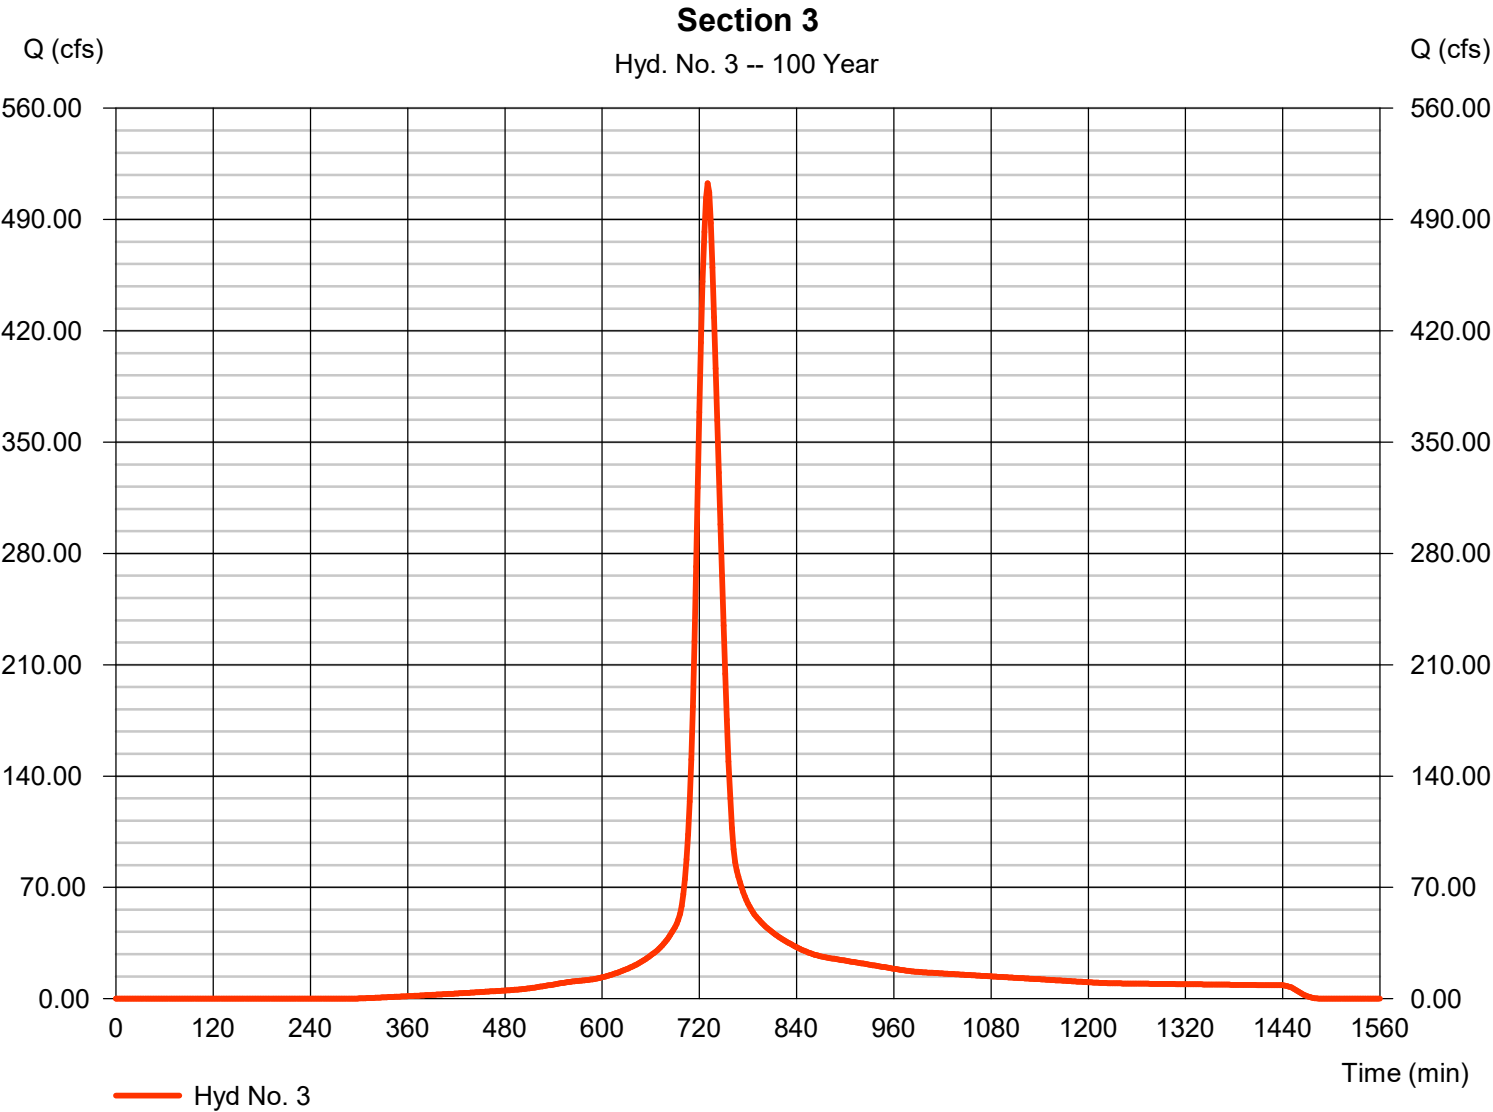


Hydrograph Report

Hyd. No. 4

Section 4

Hydrograph type	=	SCS Runoff	Peak discharge	=	431.92 cfs
Storm frequency	=	100 yrs	Time to peak	=	732 min
Time interval	=	2 min	Hyd. volume	=	1,932,345 cuft
Drainage area	=	82.500 ac	Curve number	=	88*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	30.70 min
Total precip.	=	7.80 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(49.680 x 98) + (32.820 x 74)] / 82.500

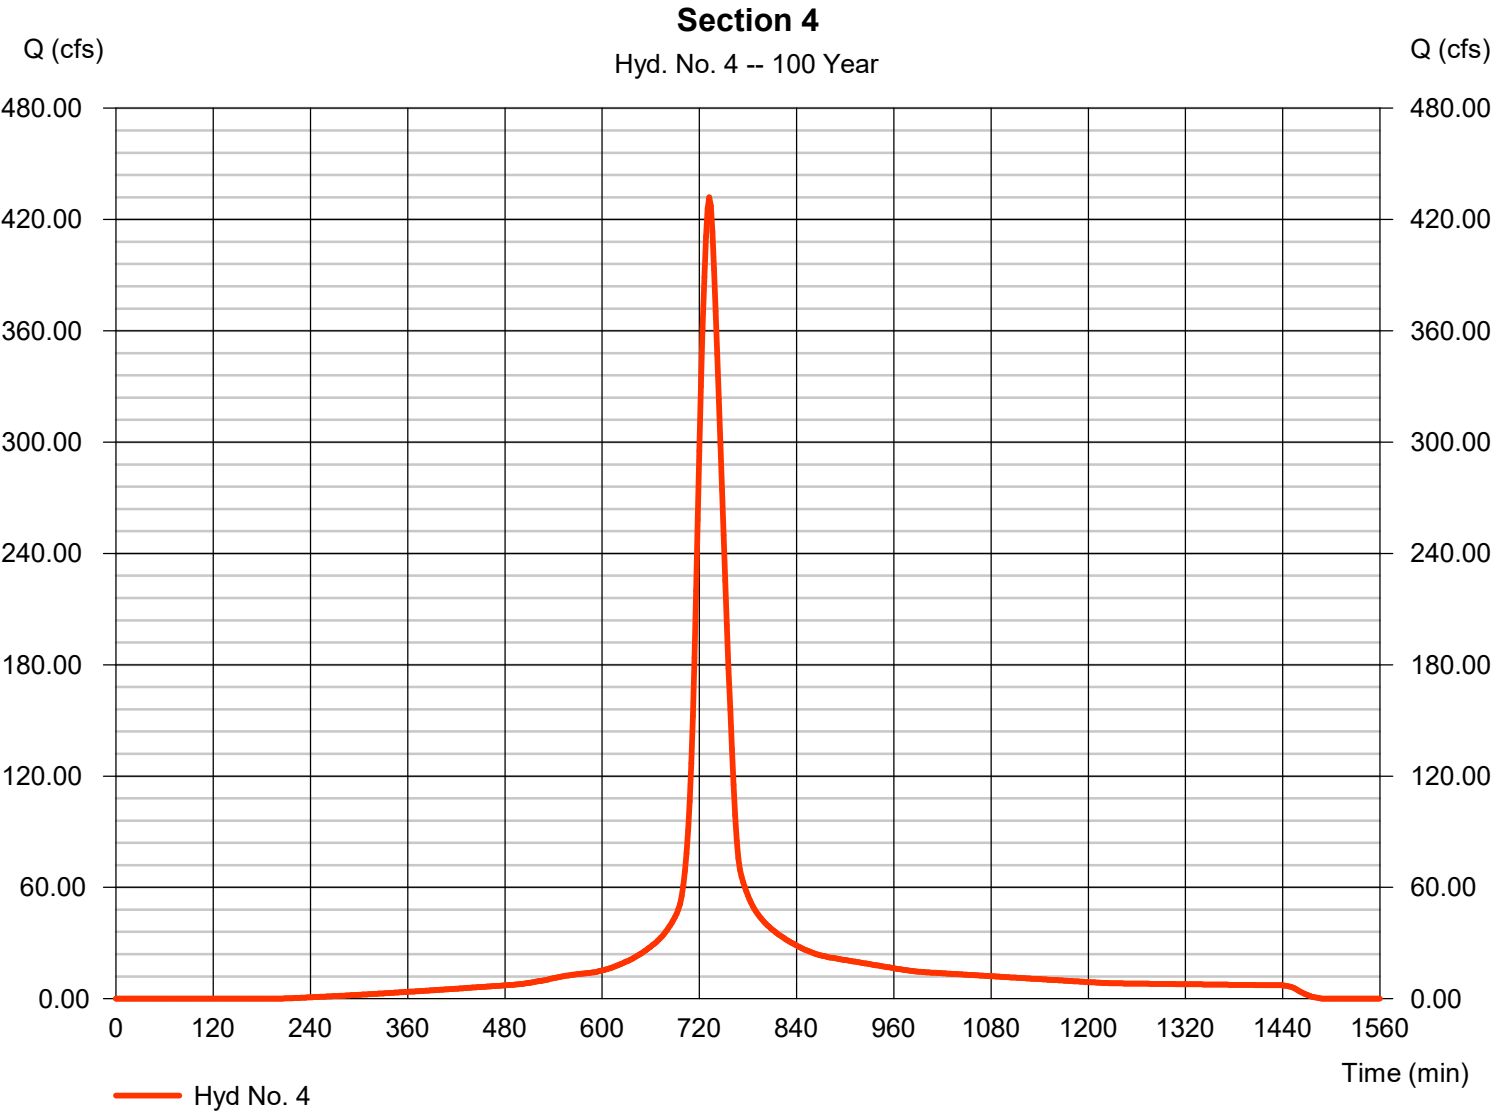


Hydrograph Report

Hyd. No. 5

Section 5

Hydrograph type	=	SCS Runoff	Peak discharge	=	636.00 cfs
Storm frequency	=	100 yrs	Time to peak	=	722 min
Time interval	=	2 min	Hyd. volume	=	1,851,646 cuft
Drainage area	=	86.900 ac	Curve number	=	85*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	15.60 min
Total precip.	=	7.80 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(40.000 x 98) + (46.900 x 74)] / 86.900

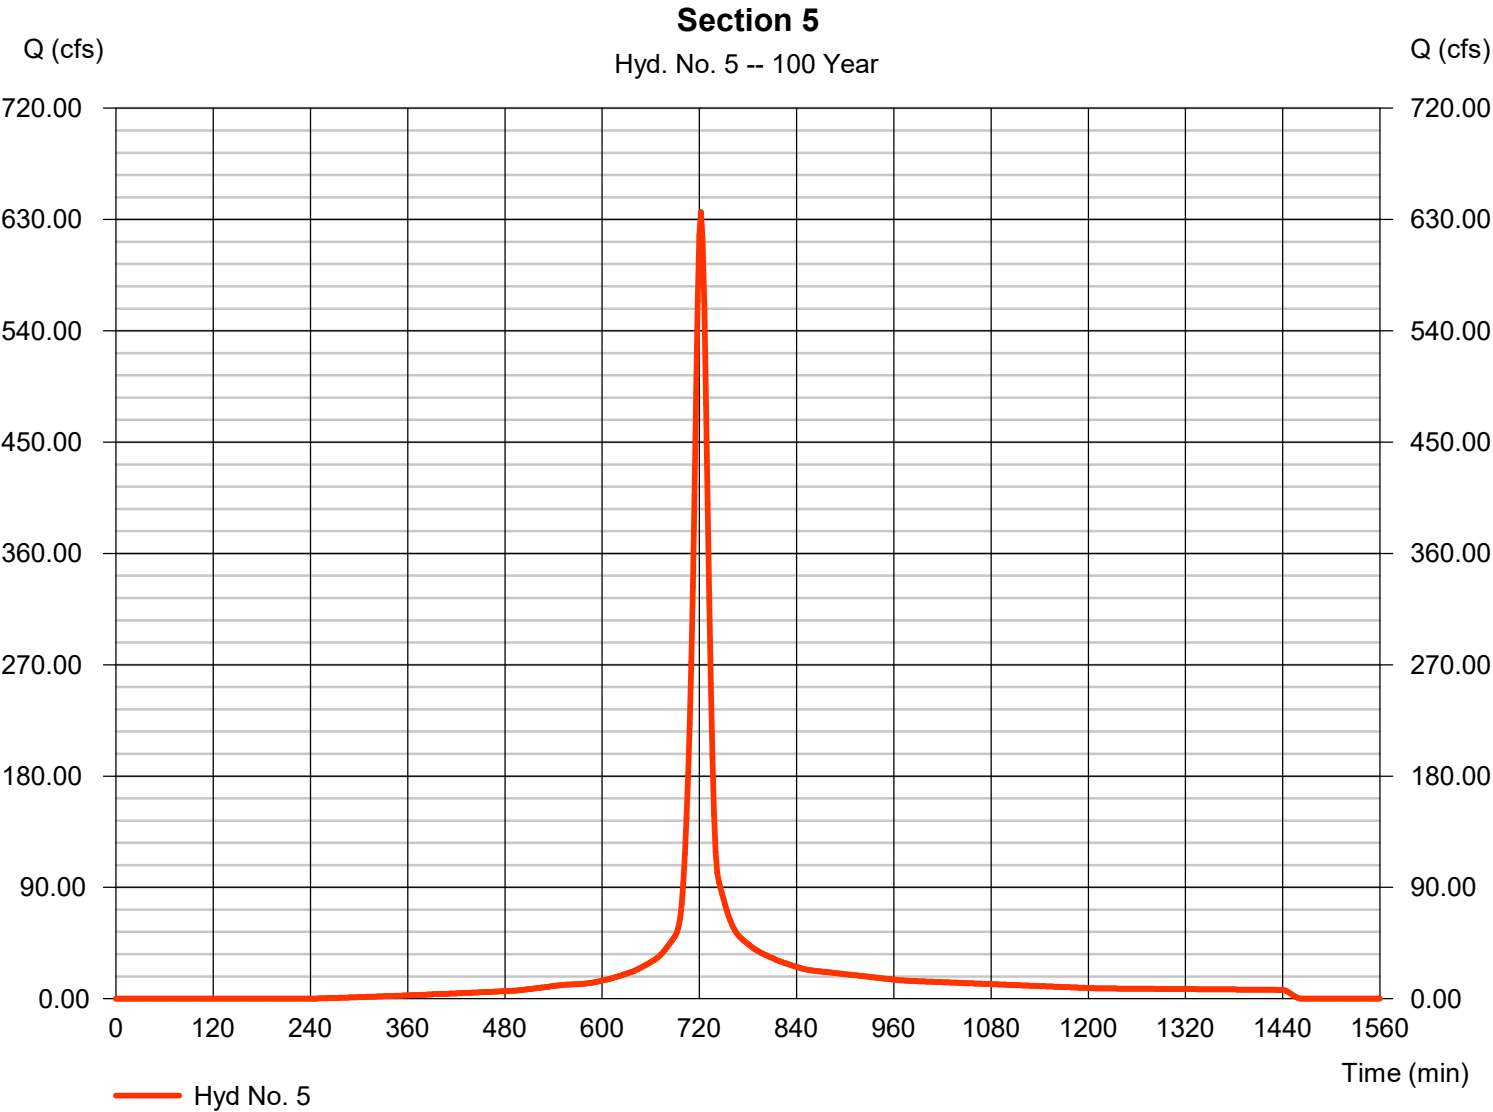

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 6

Section 6

Hydrograph type	=	SCS Runoff	Peak discharge	=	82.47 cfs
Storm frequency	=	100 yrs	Time to peak	=	724 min
Time interval	=	2 min	Hyd. volume	=	275,937 cuft
Drainage area	=	11.300 ac	Curve number	=	91*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	18.60 min
Total precip.	=	7.80 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(11.300 x 91)] / 11.300

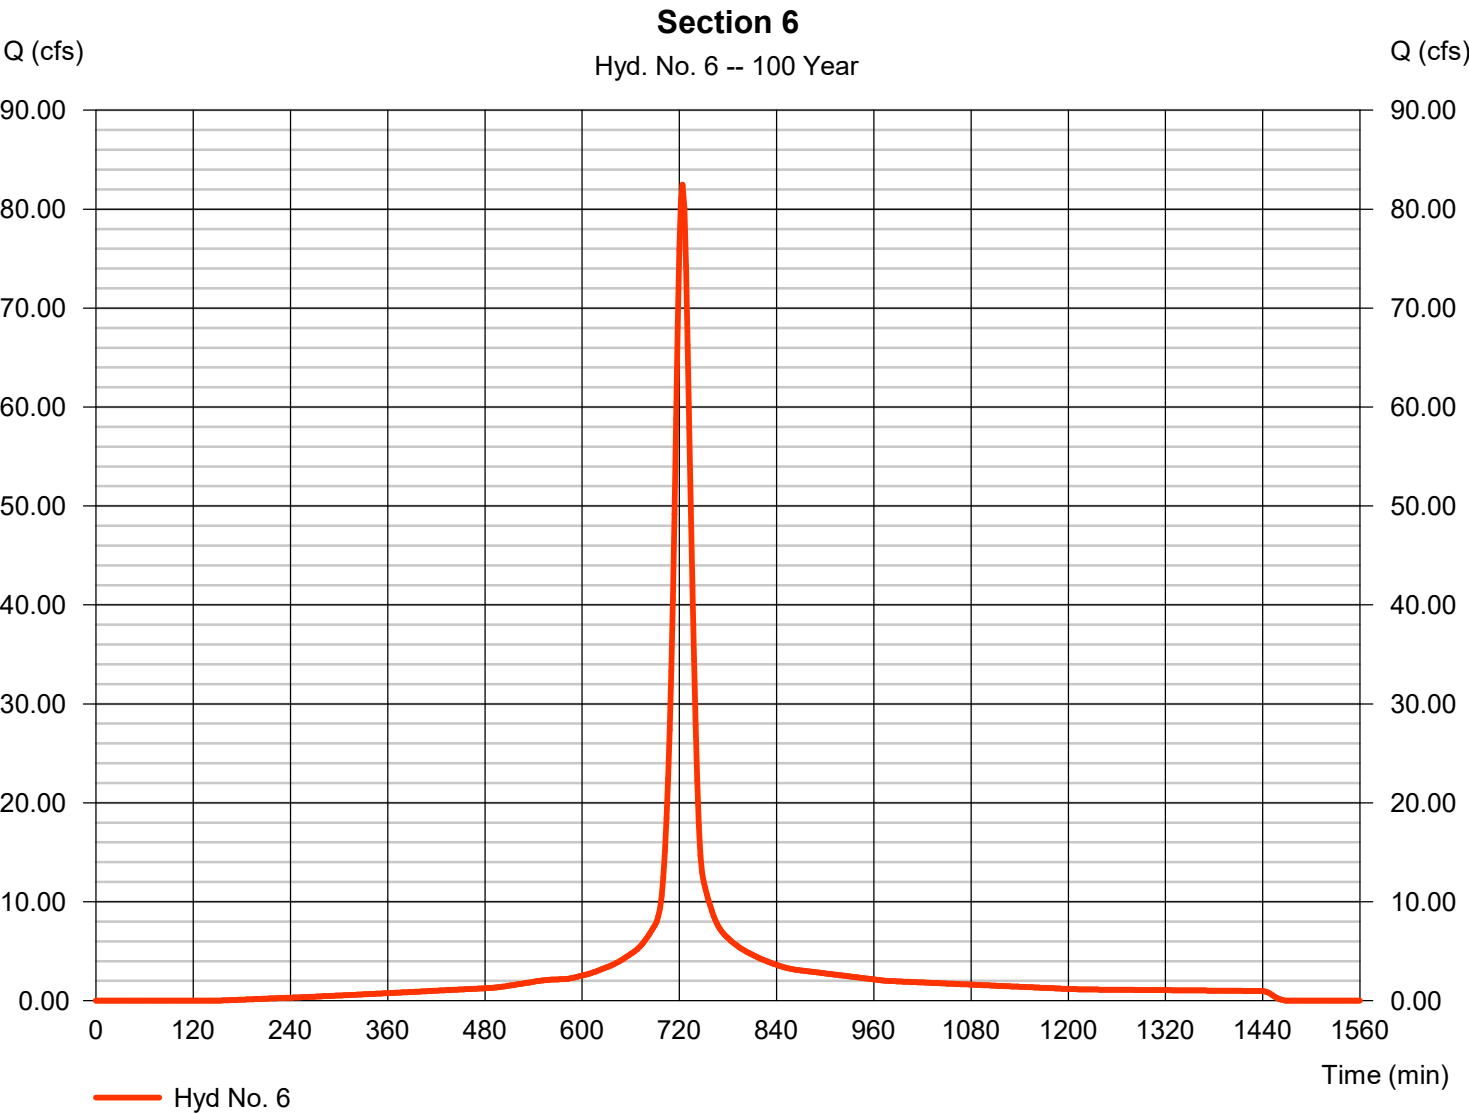

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 7

Section 7/8-Pre

Hydrograph type	= SCS Runoff	Peak discharge	= 355.97 cfs
Storm frequency	= 100 yrs	Time to peak	= 728 min
Time interval	= 2 min	Hyd. volume	= 1,368,386 cuft
Drainage area	= 59.000 ac	Curve number	= 89*
Basin Slope	= 0.0 %	Hydraulic length	= 0 ft
Tc method	= TR55	Time of conc. (Tc)	= 25.20 min
Total precip.	= 7.80 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

* Composite (Area/CN) = $[(59.000 \times 79)] / 59.000$

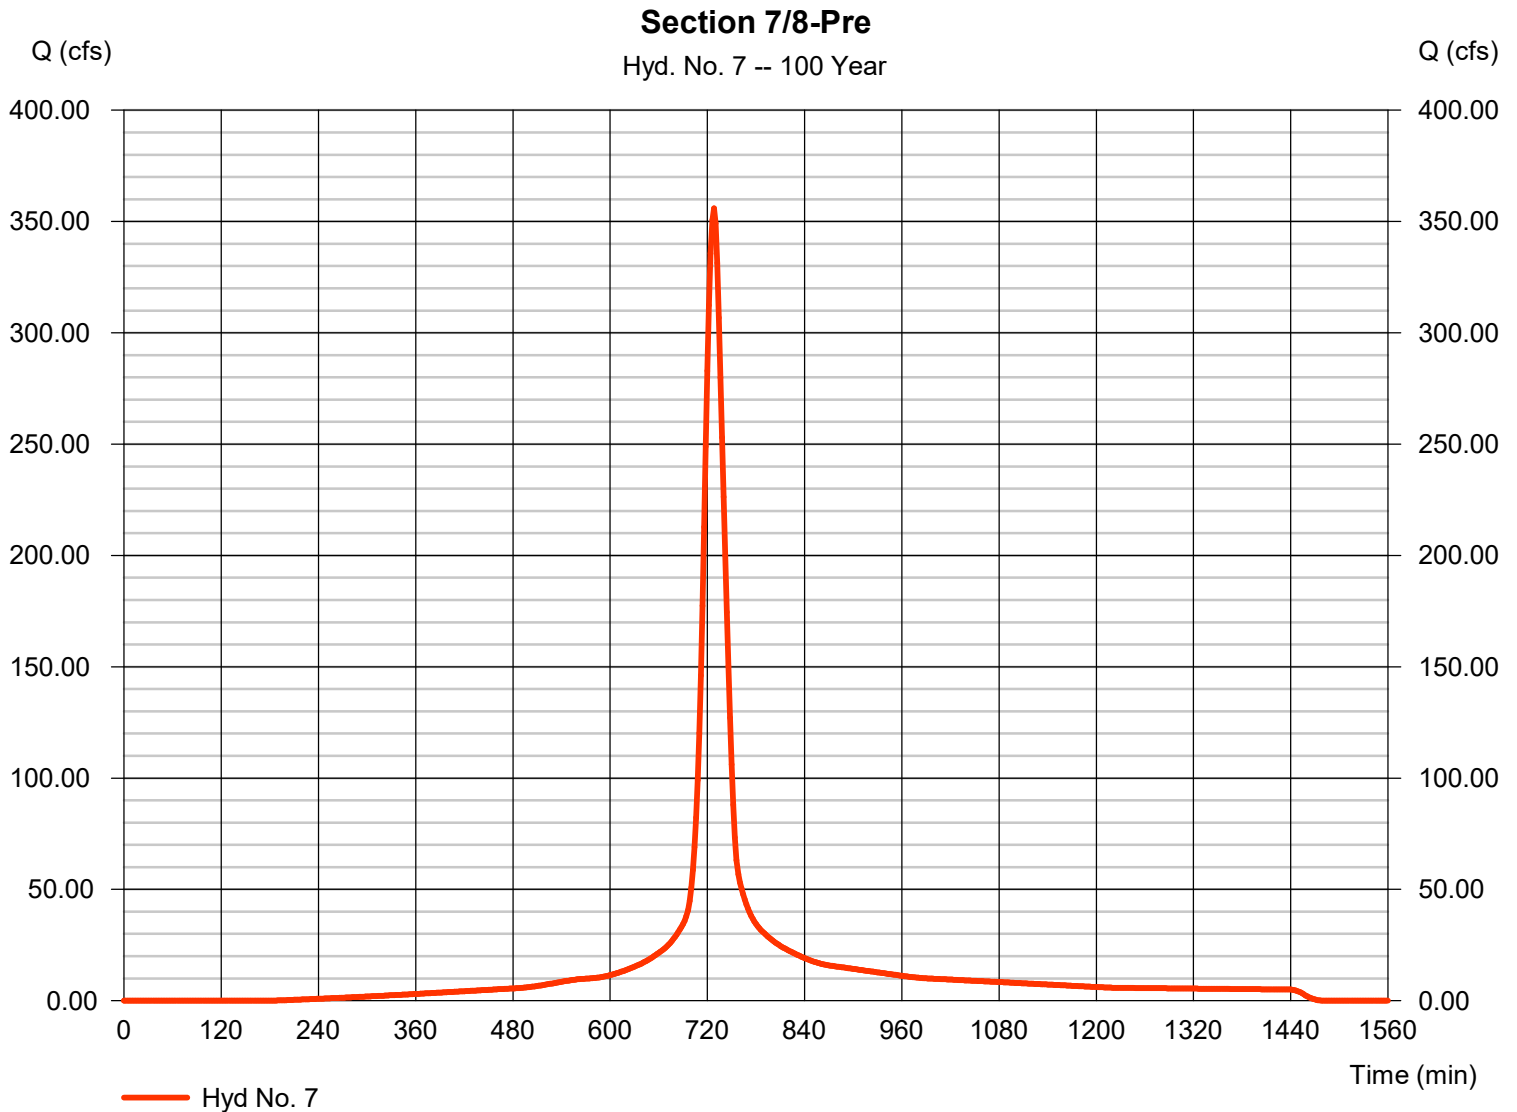


Hydrograph Report

Hyd. No. 8

Industrial Complex to Detention

Hydrograph type	= Combine	Peak discharge	= 1243.39 cfs
Storm frequency	= 100 yrs	Time to peak	= 728 min
Time interval	= 2 min	Hyd. volume	= 4,798,103 cuft
Inflow hyds.	= 1, 2, 3	Contrib. drain. area	= 250.500 ac

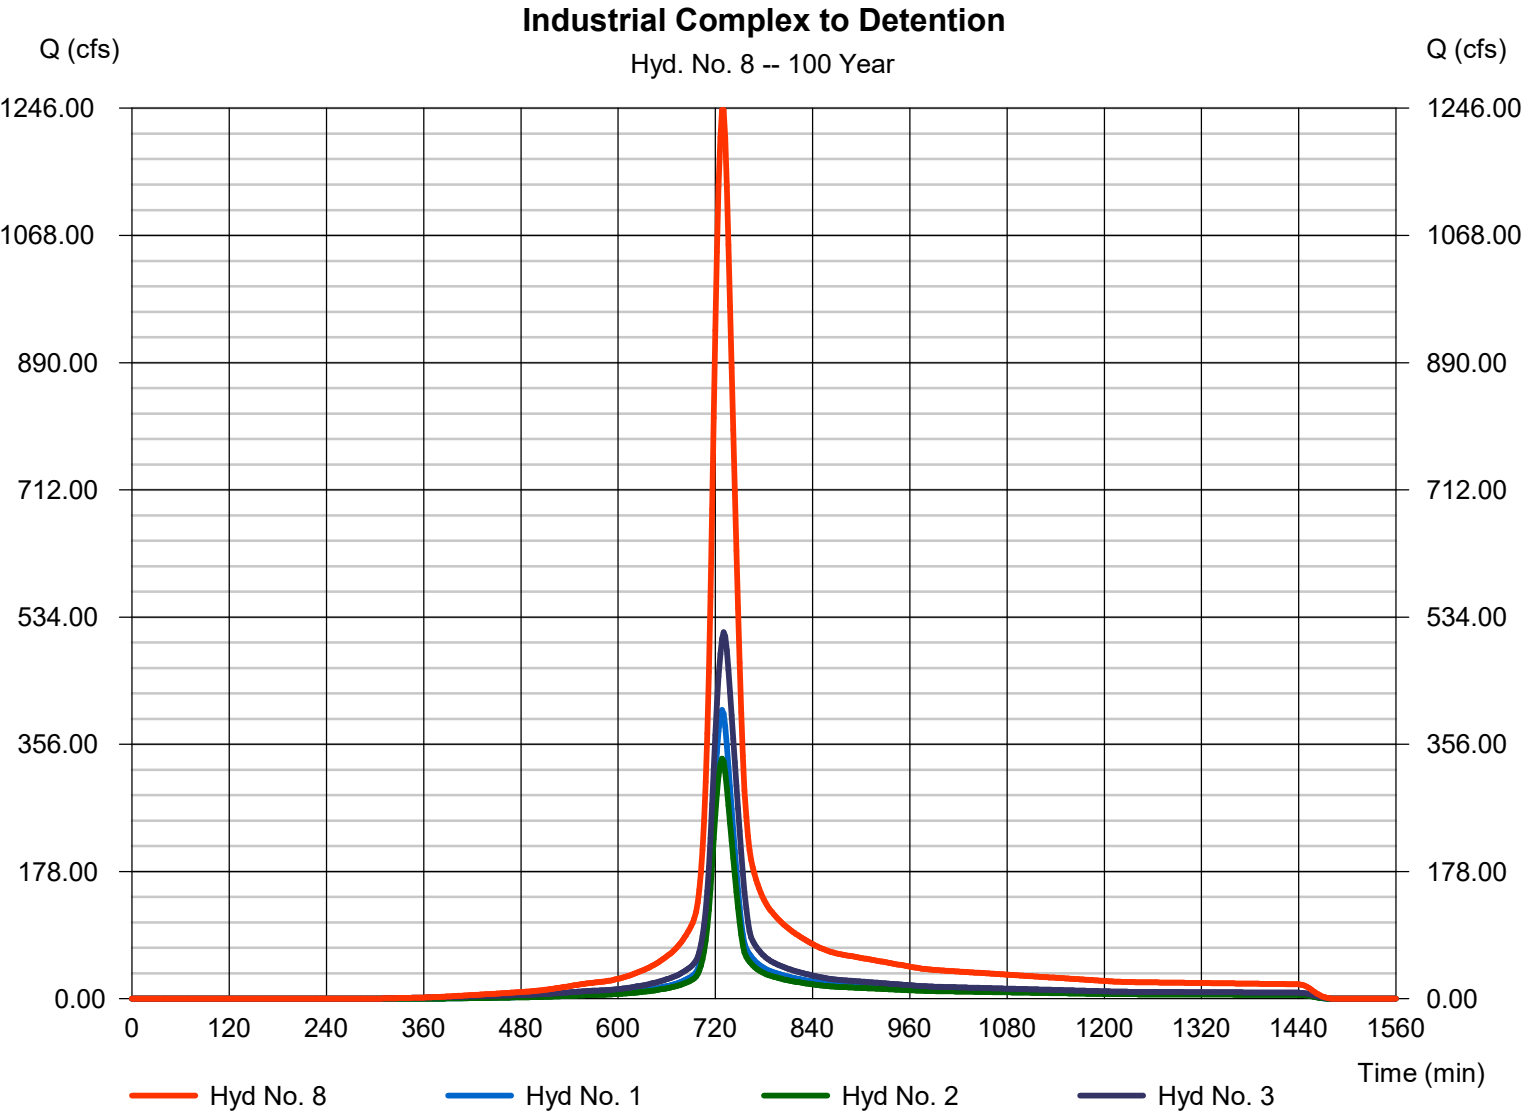


Hydrograph Report

Hyd. No. 9

Industrial Above Ground Detention Pond

Hydrograph type	= Reach	Peak discharge	= 1211.21 cfs
Storm frequency	= 100 yrs	Time to peak	= 732 min
Time interval	= 2 min	Hyd. volume	= 4,798,098 cuft
Inflow hyd. No.	= 8 - Industrial Complex to Detention Pond	Section type	= Trapezoidal
Reach length	= 1000.0 ft	Channel slope	= 2.0 %
Manning's n	= 0.020	Bottom width	= 150.0 ft
Side slope	= 30.0:1	Max. depth	= 16.0 ft
Rating curve x	= 0.373	Rating curve m	= 1.407
Ave. velocity	= 3.89 ft/s	Routing coeff.	= 0.4946

Modified Att-Kin routing method used.

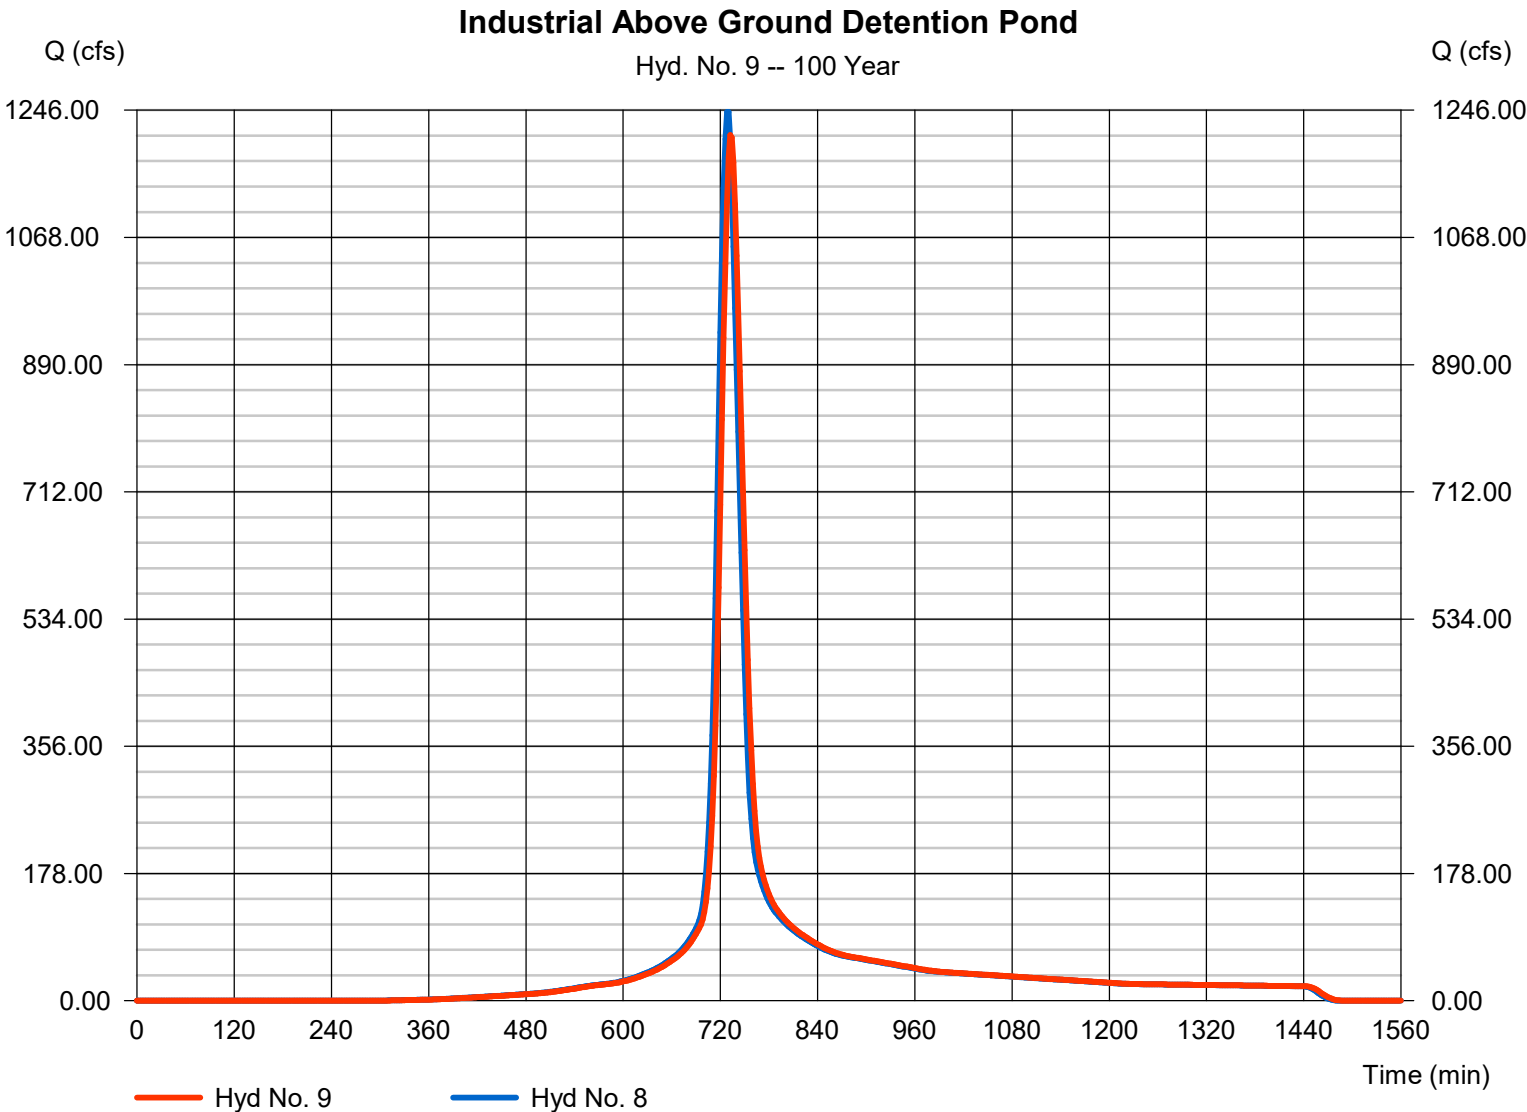

Hydrograph Report


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Thursday, 03 / 28 / 2024

Hyd. No. 10

Strother Road Culvert

Hydrograph type	= Combine	Peak discharge	= 1643.13 cfs
Storm frequency	= 100 yrs	Time to peak	= 732 min
Time interval	= 2 min	Hyd. volume	= 6,730,445 cuft
Inflow hyds.	= 4, 9	Contrib. drain. area	= 82.500 ac

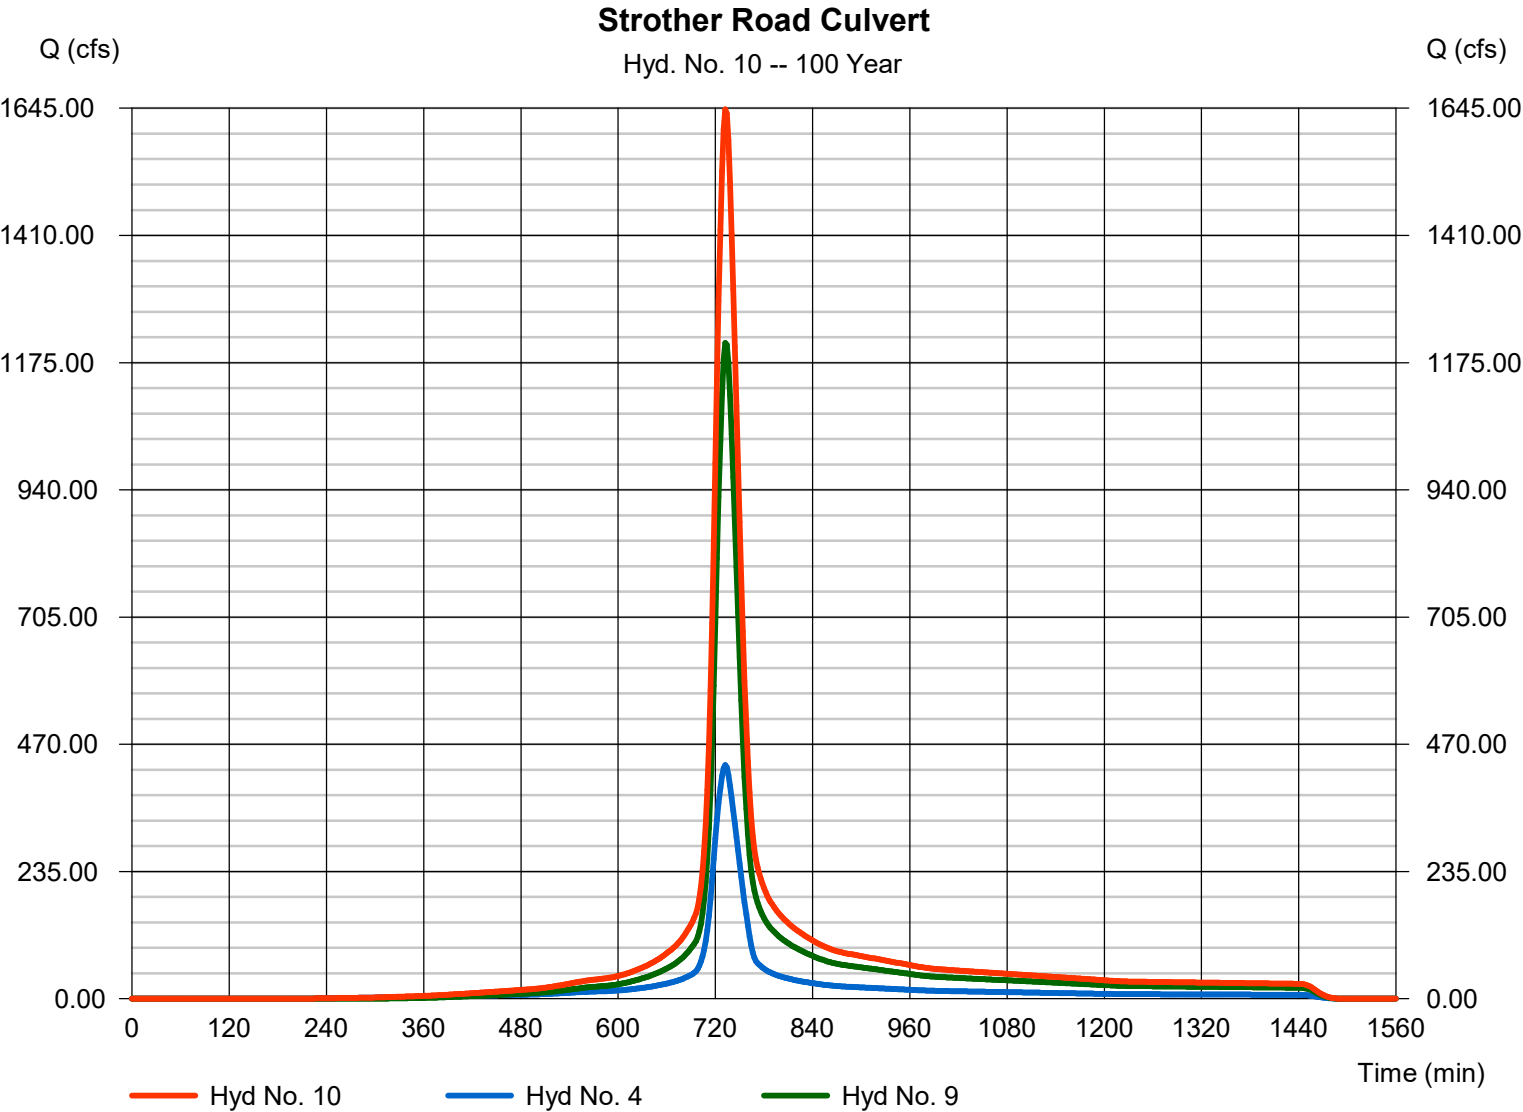

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 11

Wilshire Existing Stream

Hydrograph type	= Reach	Peak discharge	= 1570.20 cfs
Storm frequency	= 100 yrs	Time to peak	= 738 min
Time interval	= 2 min	Hyd. volume	= 6,730,444 cuft
Inflow hyd. No.	= 10 - Strother Road Culvert	Section type	= Trapezoidal
Reach length	= 2200.0 ft	Channel slope	= 1.4 %
Manning's n	= 0.030	Bottom width	= 5.0 ft
Side slope	= 20.0:1	Max. depth	= 5.0 ft
Rating curve x	= 2.009	Rating curve m	= 1.231
Ave. velocity	= 7.07 ft/s	Routing coeff.	= 0.3835

Modified Att-Kin routing method used.

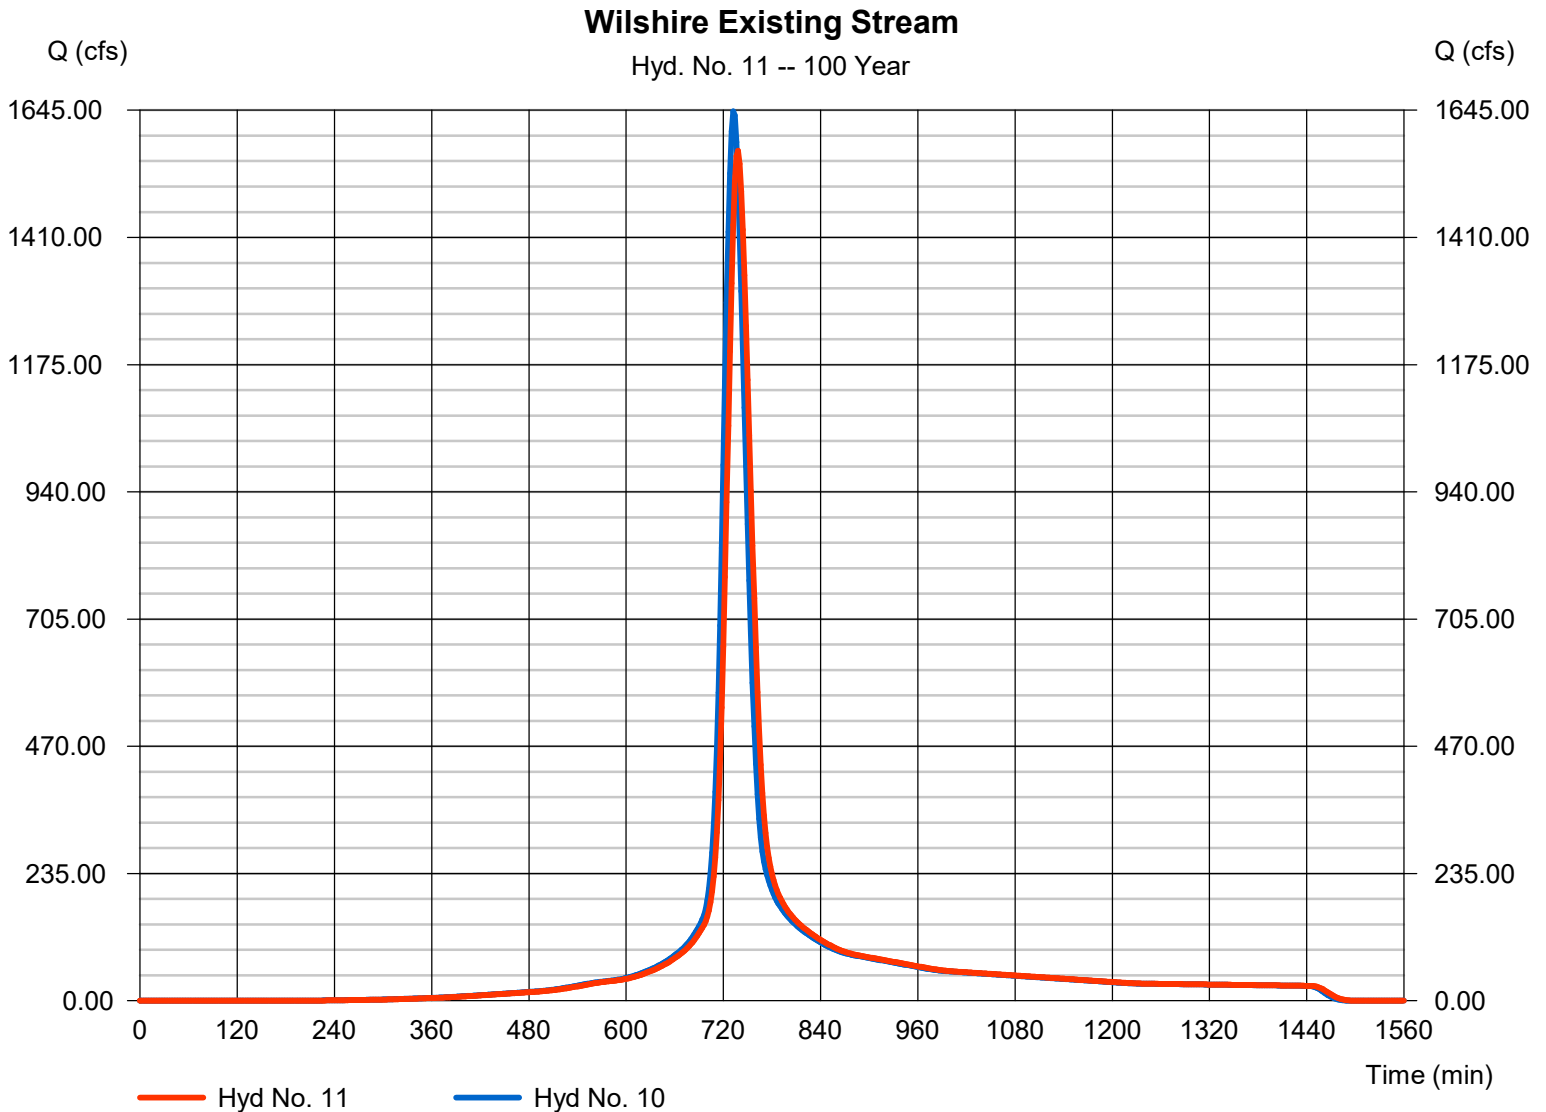


Hydrograph Report

Hyd. No. 12

OVERALL PRE

Hydrograph type	= Combine	Peak discharge	= 2145.77 cfs
Storm frequency	= 100 yrs	Time to peak	= 732 min
Time interval	= 2 min	Hyd. volume	= 10,226,411 cuft
Inflow hyds.	= 5, 6, 7, 11	Contrib. drain. area	= 157.200 ac

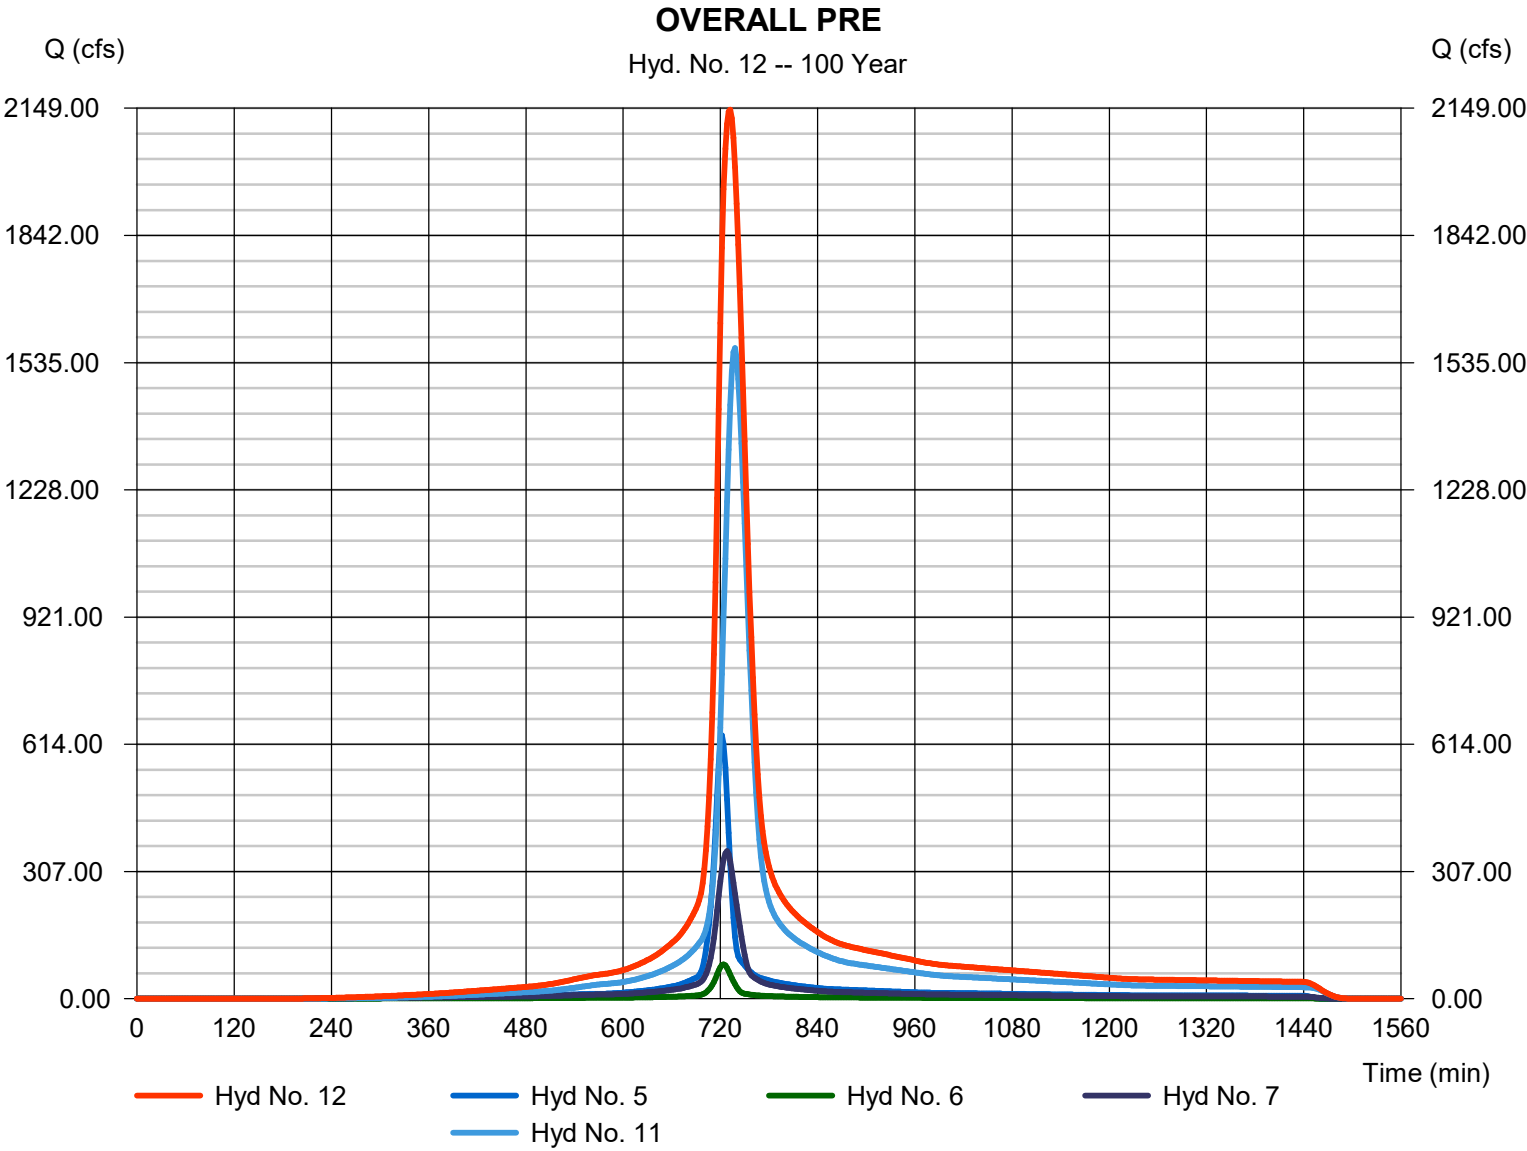


Hydrograph Report

Hyd. No. 13

Section 7A-Post

Hydrograph type	= SCS Runoff	Peak discharge	= 142.13 cfs
Storm frequency	= 100 yrs	Time to peak	= 724 min
Time interval	= 2 min	Hyd. volume	= 468,866 cuft
Drainage area	= 19.900 ac	Curve number	= 89*
Basin Slope	= 0.0 %	Hydraulic length	= 0 ft
Tc method	= TR55	Time of conc. (Tc)	= 19.30 min
Total precip.	= 7.80 in	Distribution	= Type II
Storm duration	= 24 hrs	Shape factor	= 484

* Composite (Area/CN) = [(19.900 x 89)] / 19.900

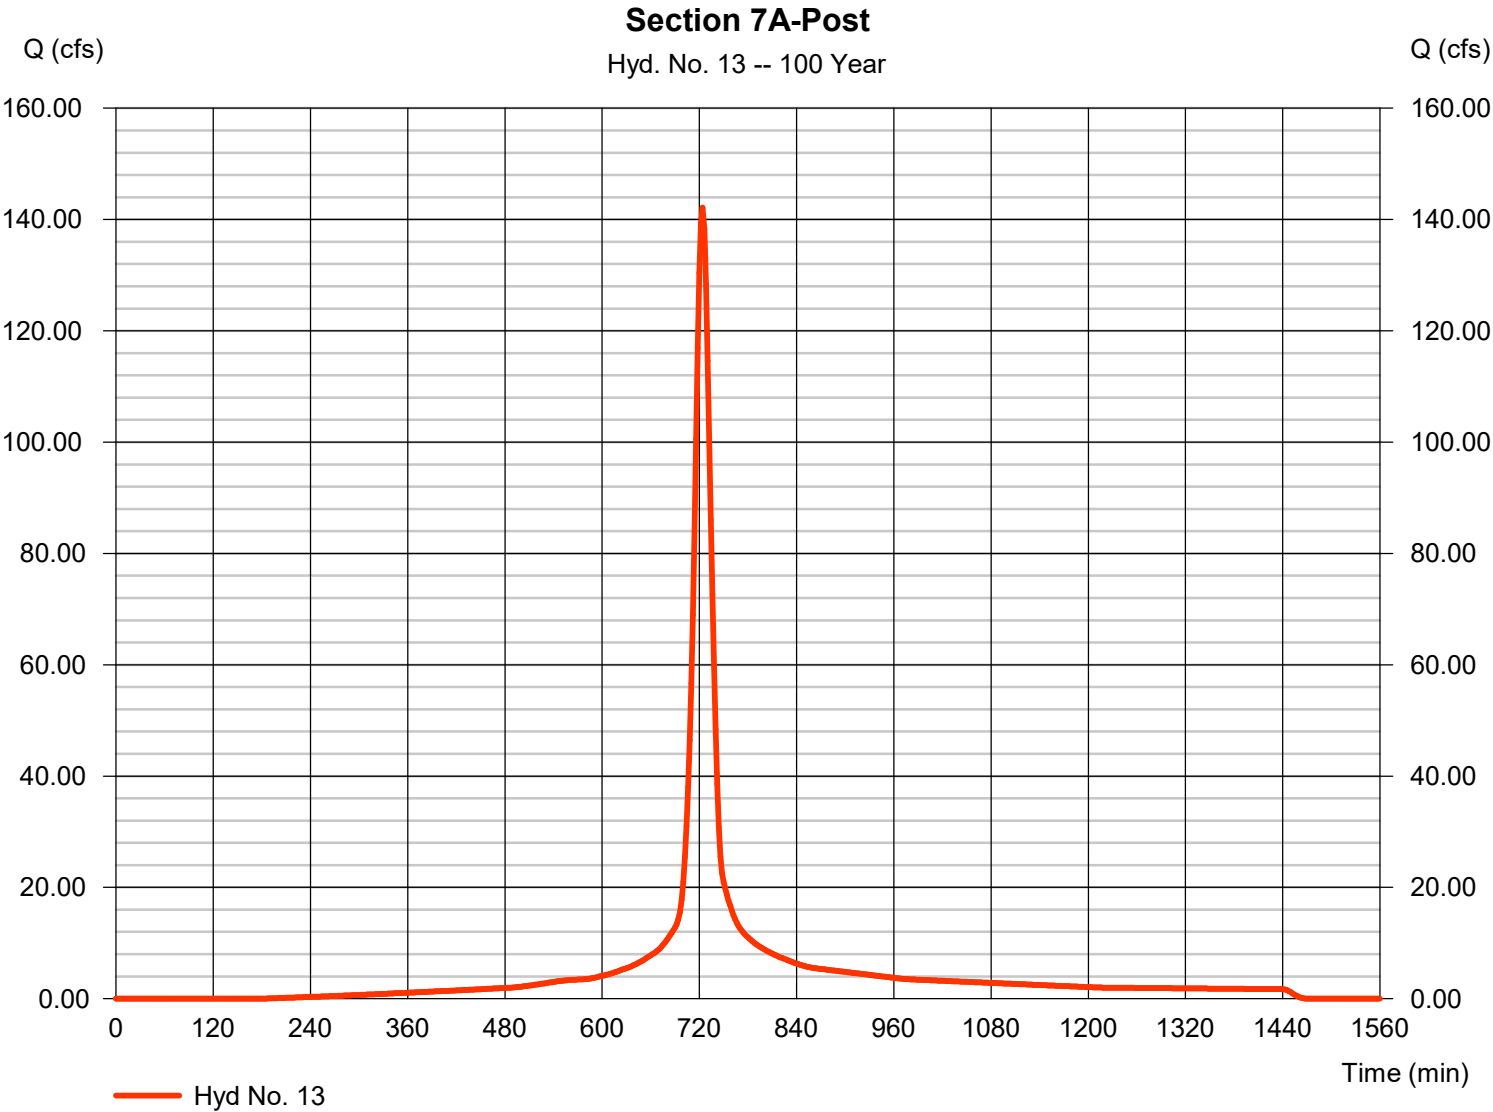

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 14

Section 7B-Post (Wilshire Hills Bypass)

Hydrograph type	=	SCS Runoff	Peak discharge	=	25.16 cfs
Storm frequency	=	100 yrs	Time to peak	=	732 min
Time interval	=	2 min	Hyd. volume	=	101,635 cuft
Drainage area	=	7.500 ac	Curve number	=	65*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	TR55	Time of conc. (Tc)	=	28.28 min
Total precip.	=	7.80 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(13.900 x 74)] / 7.500

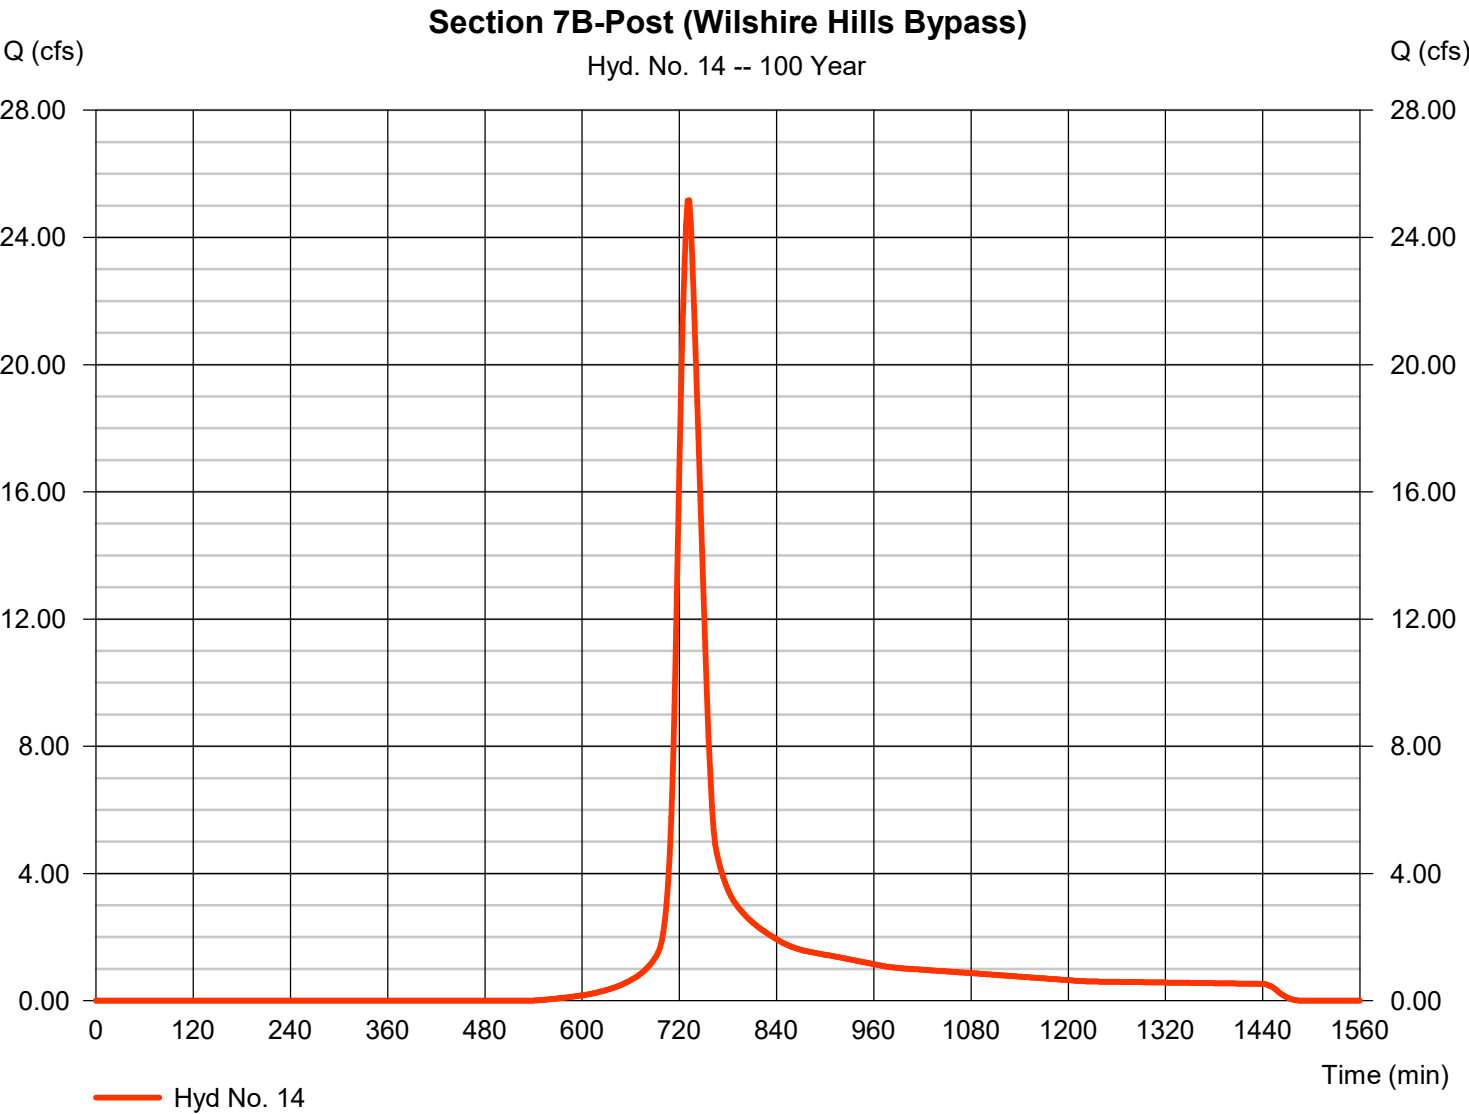


Hydrograph Report

Hyd. No. 15

Section 7C-Post (Wilshire Hills)

Hydrograph type	=	SCS Runoff	Peak discharge	=	124.02 cfs
Storm frequency	=	100 yrs	Time to peak	=	726 min
Time interval	=	2 min	Hyd. volume	=	449,180 cuft
Drainage area	=	18.730 ac	Curve number	=	89*
Basin Slope	=	0.0 %	Hydraulic length	=	0 ft
Tc method	=	User	Time of conc. (Tc)	=	20.60 min
Total precip.	=	7.80 in	Distribution	=	Type II
Storm duration	=	24 hrs	Shape factor	=	484

* Composite (Area/CN) = [(18.730 x 89)] / 18.730

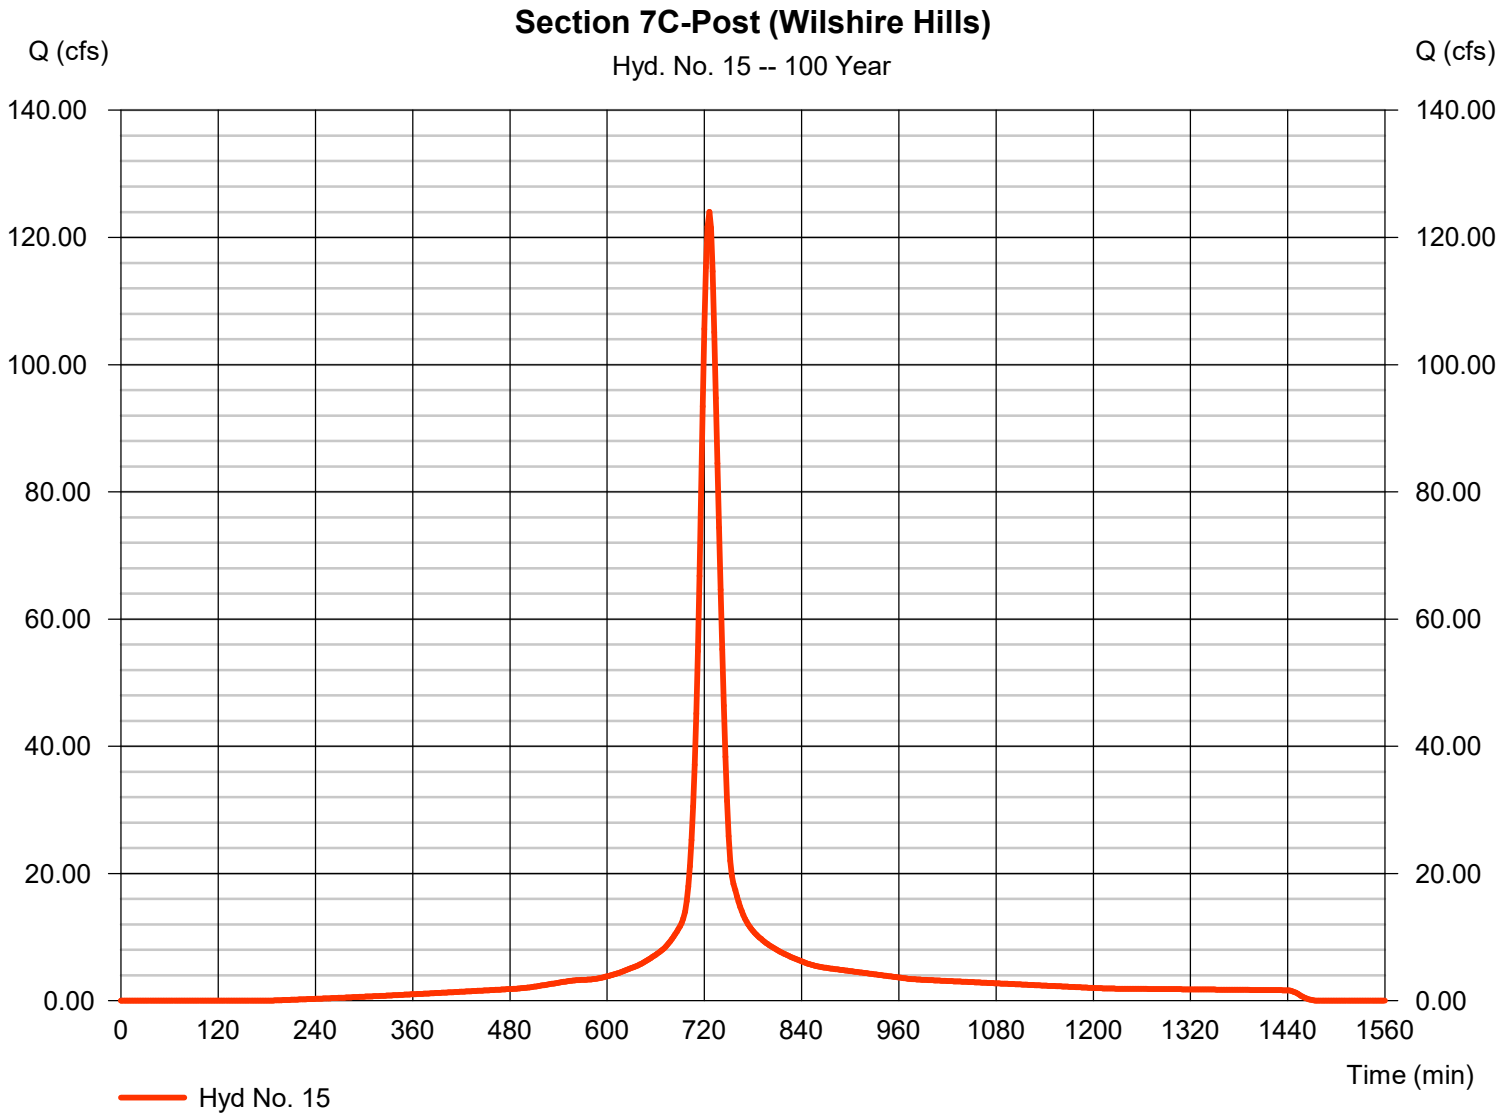


Hydrograph Report

Hyd. No. 16

Wilshire- Preserved stream

Hydrograph type	= Reach	Peak discharge	= 1596.55 cfs
Storm frequency	= 100 yrs	Time to peak	= 736 min
Time interval	= 2 min	Hyd. volume	= 6,730,439 cuft
Inflow hyd. No.	= 10 - Strother Road Culvert	Section type	= Trapezoidal
Reach length	= 500.0 ft	Channel slope	= 0.5 %
Manning's n	= 0.100	Bottom width	= 10.0 ft
Side slope	= 14.0:1	Max. depth	= 8.0 ft
Rating curve x	= 0.227	Rating curve m	= 1.318
Ave. velocity	= 1.94 ft/s	Routing coeff.	= 0.4698

Modified Att-Kin routing method used.

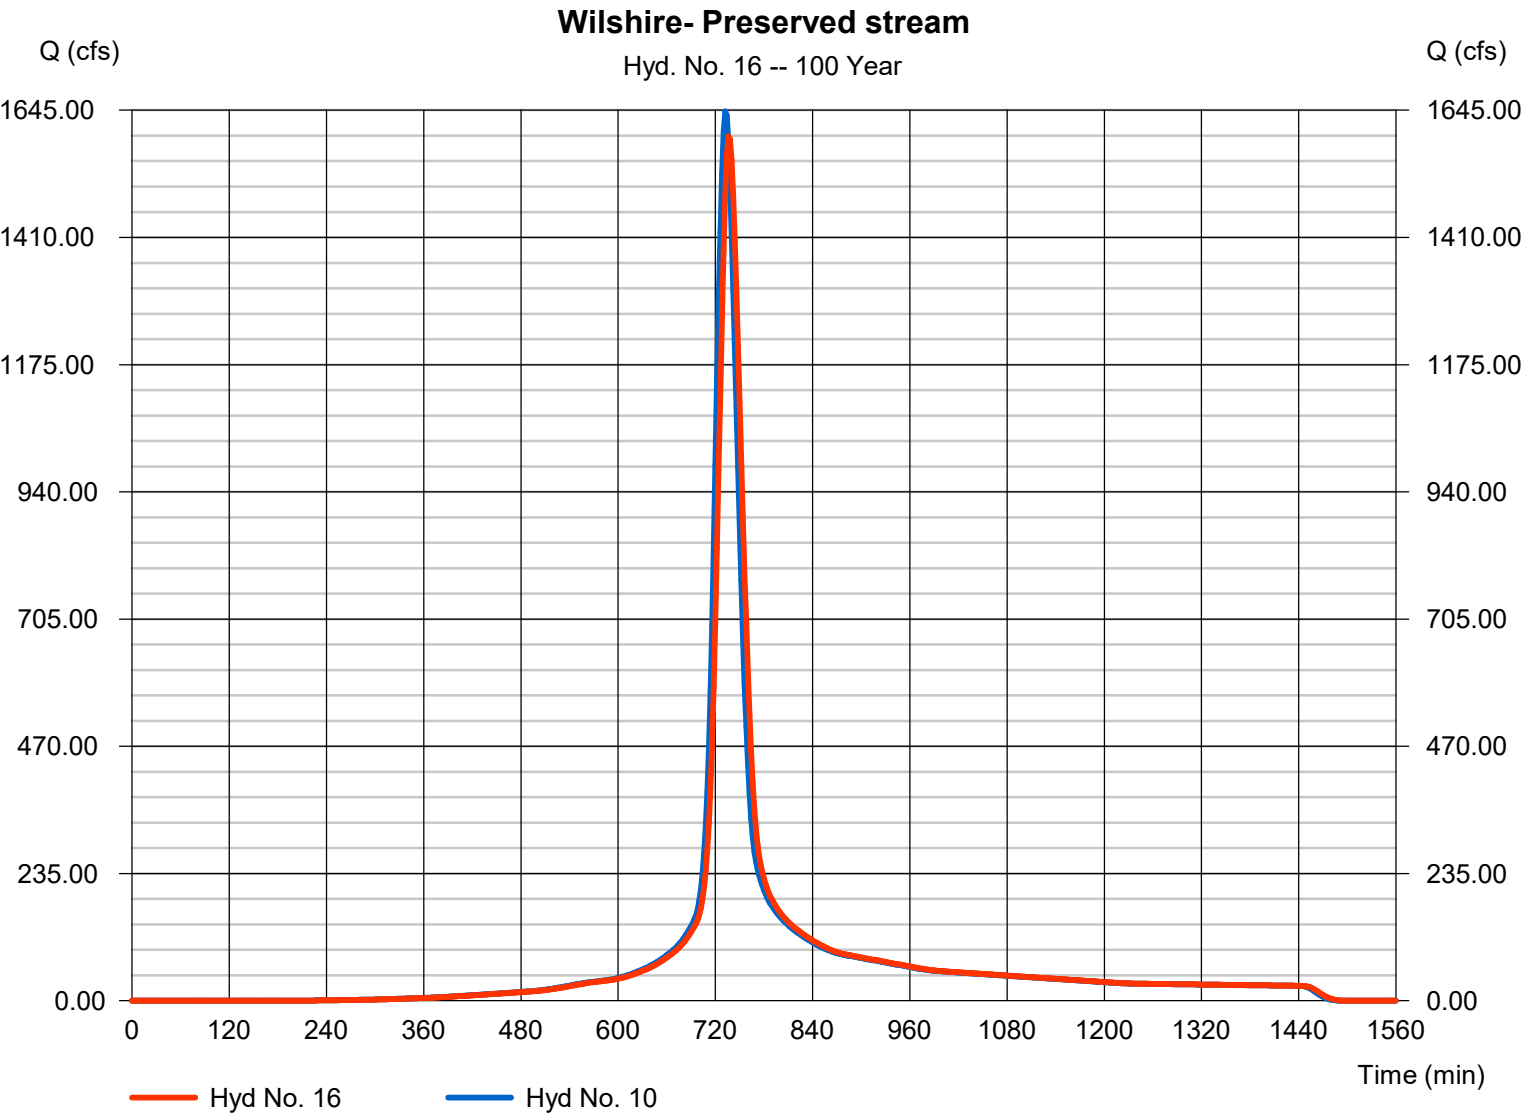

Hydrograph Report


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Thursday, 03 / 28 / 2024

Hyd. No. 17

Onsite Water

Hydrograph type	= Combine	Peak discharge	= 147.04 cfs
Storm frequency	= 100 yrs	Time to peak	= 726 min
Time interval	= 2 min	Hyd. volume	= 550,815 cuft
Inflow hyds.	= 14, 15	Contrib. drain. area	= 26.230 ac

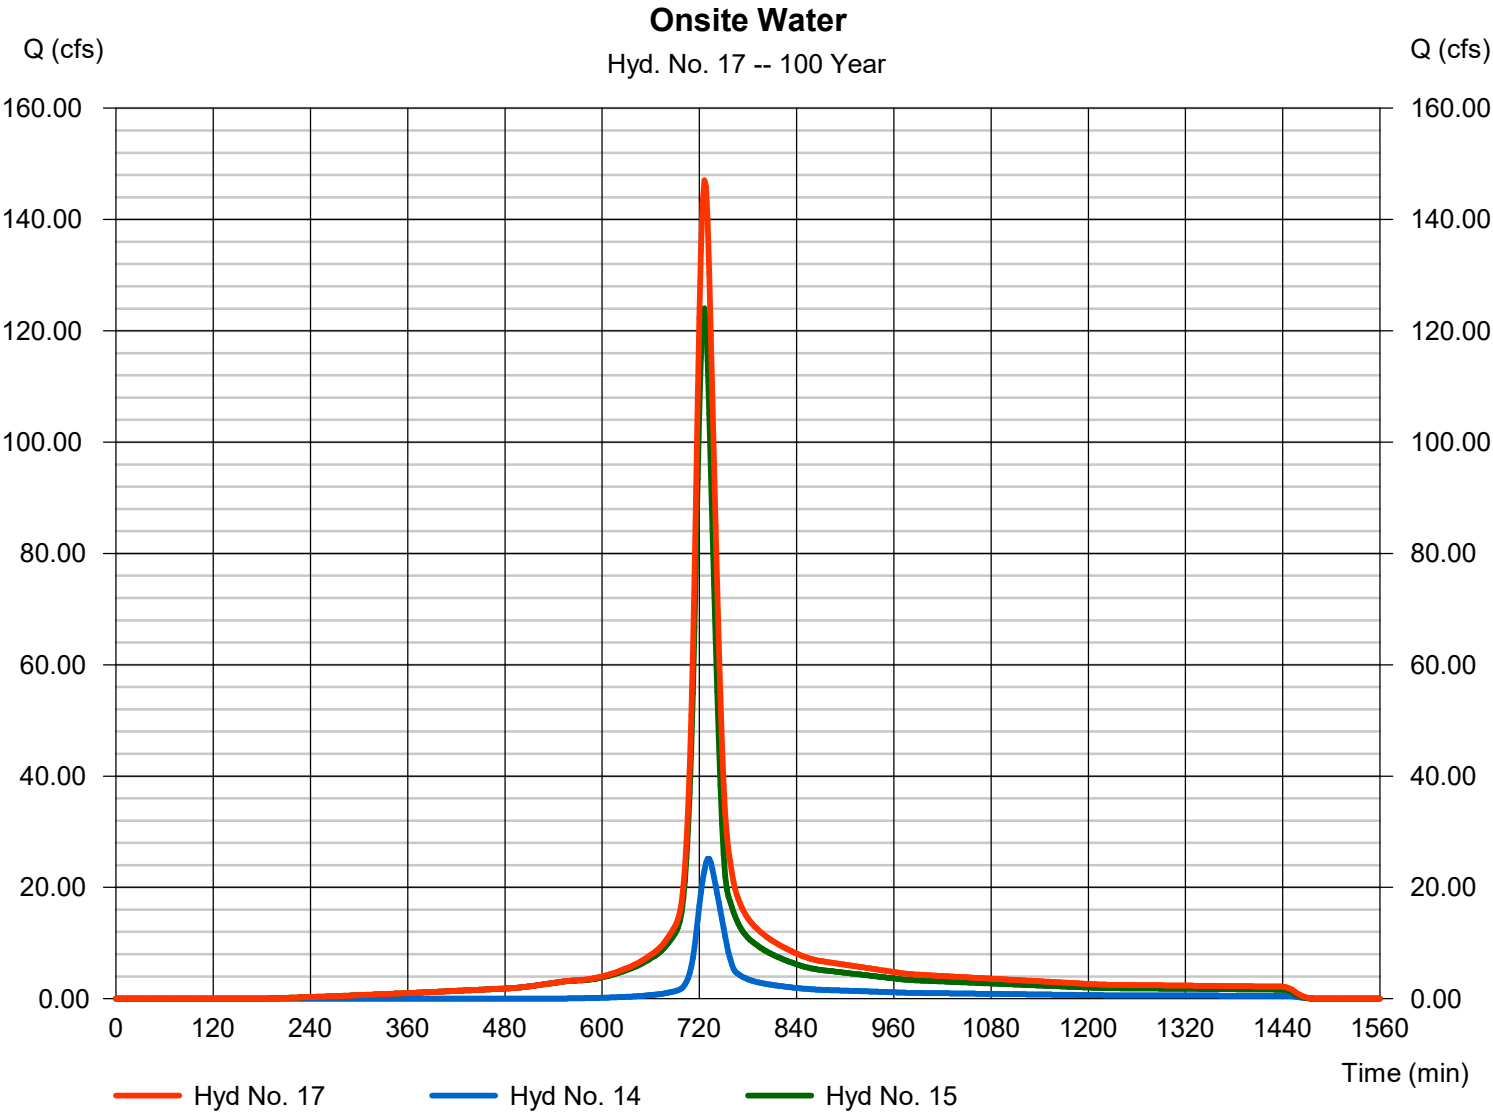

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 18

Detention Basin

Hydrograph type	= Reservoir	Peak discharge	= 86.30 cfs
Storm frequency	= 100 yrs	Time to peak	= 740 min
Time interval	= 2 min	Hyd. volume	= 550,801 cuft
Inflow hyd. No.	= 17 - Onsite Water	Max. Elevation	= 920.88 ft
Reservoir name	= Detention Basin	Max. Storage	= 182,059 cuft

Storage Indication method used.

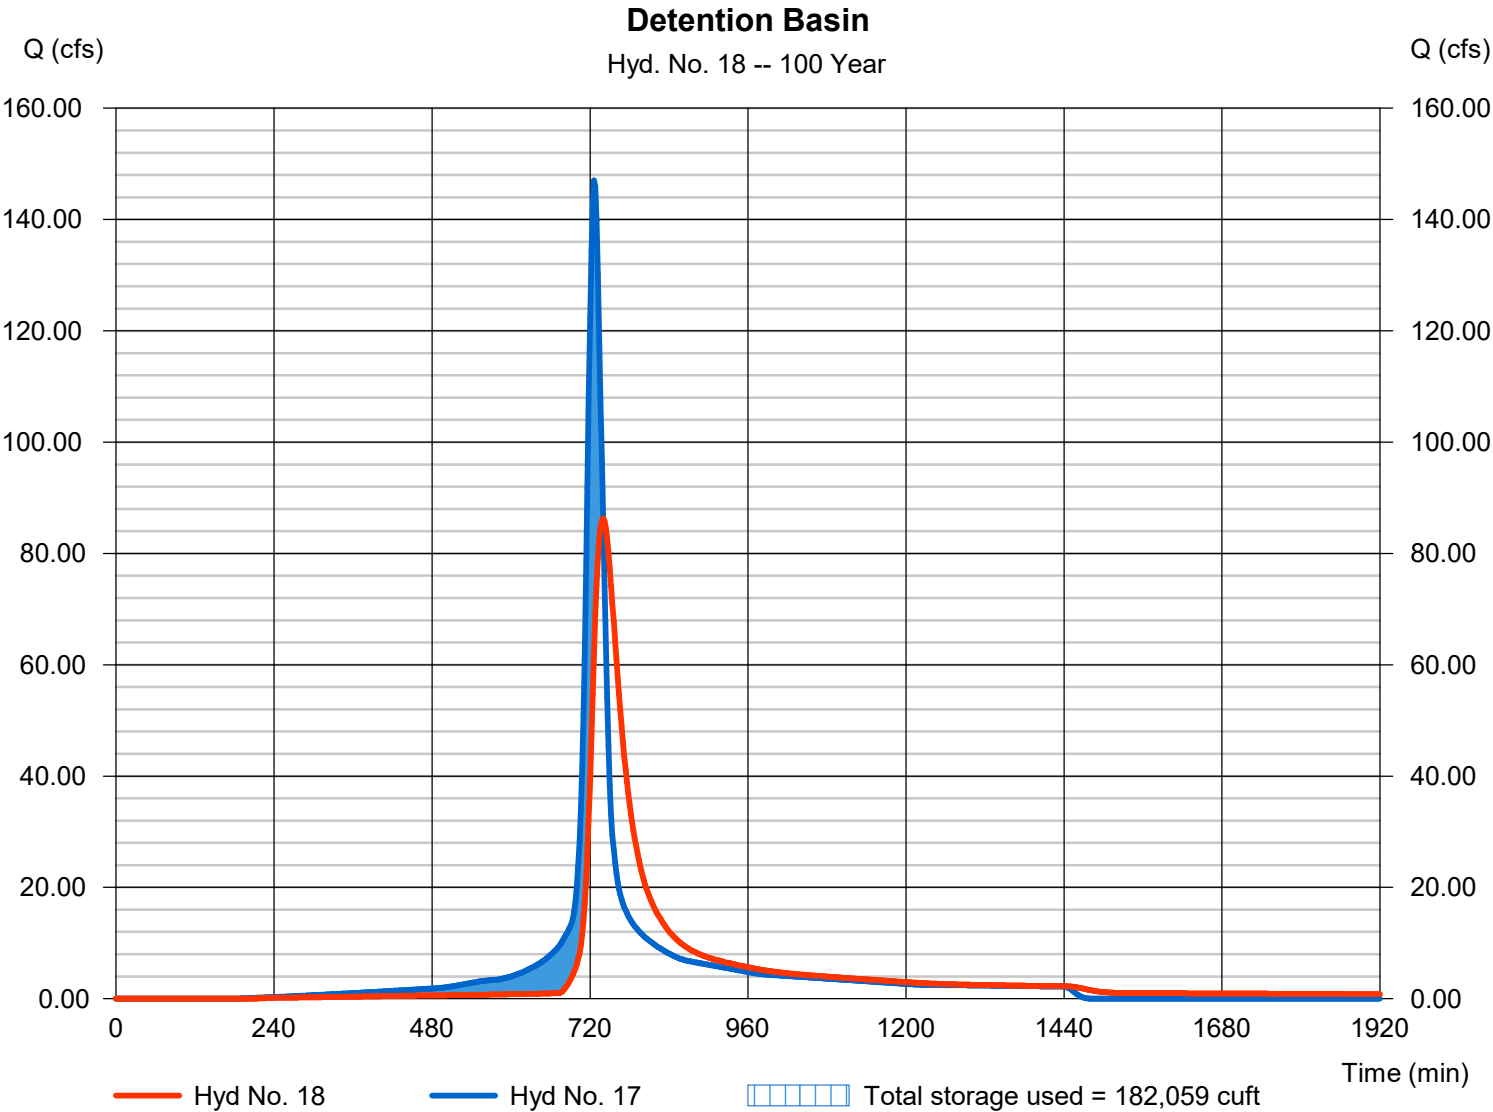


Hydrograph Report

Hyd. No. 19

Post-Meadowview Culvert

Hydrograph type	= Combine	Peak discharge	= 1992.98 cfs
Storm frequency	= 100 yrs	Time to peak	= 732 min
Time interval	= 2 min	Hyd. volume	= 9,601,730 cuft
Inflow hyds.	= 5, 13, 16, 18	Contrib. drain. area	= 106.800 ac

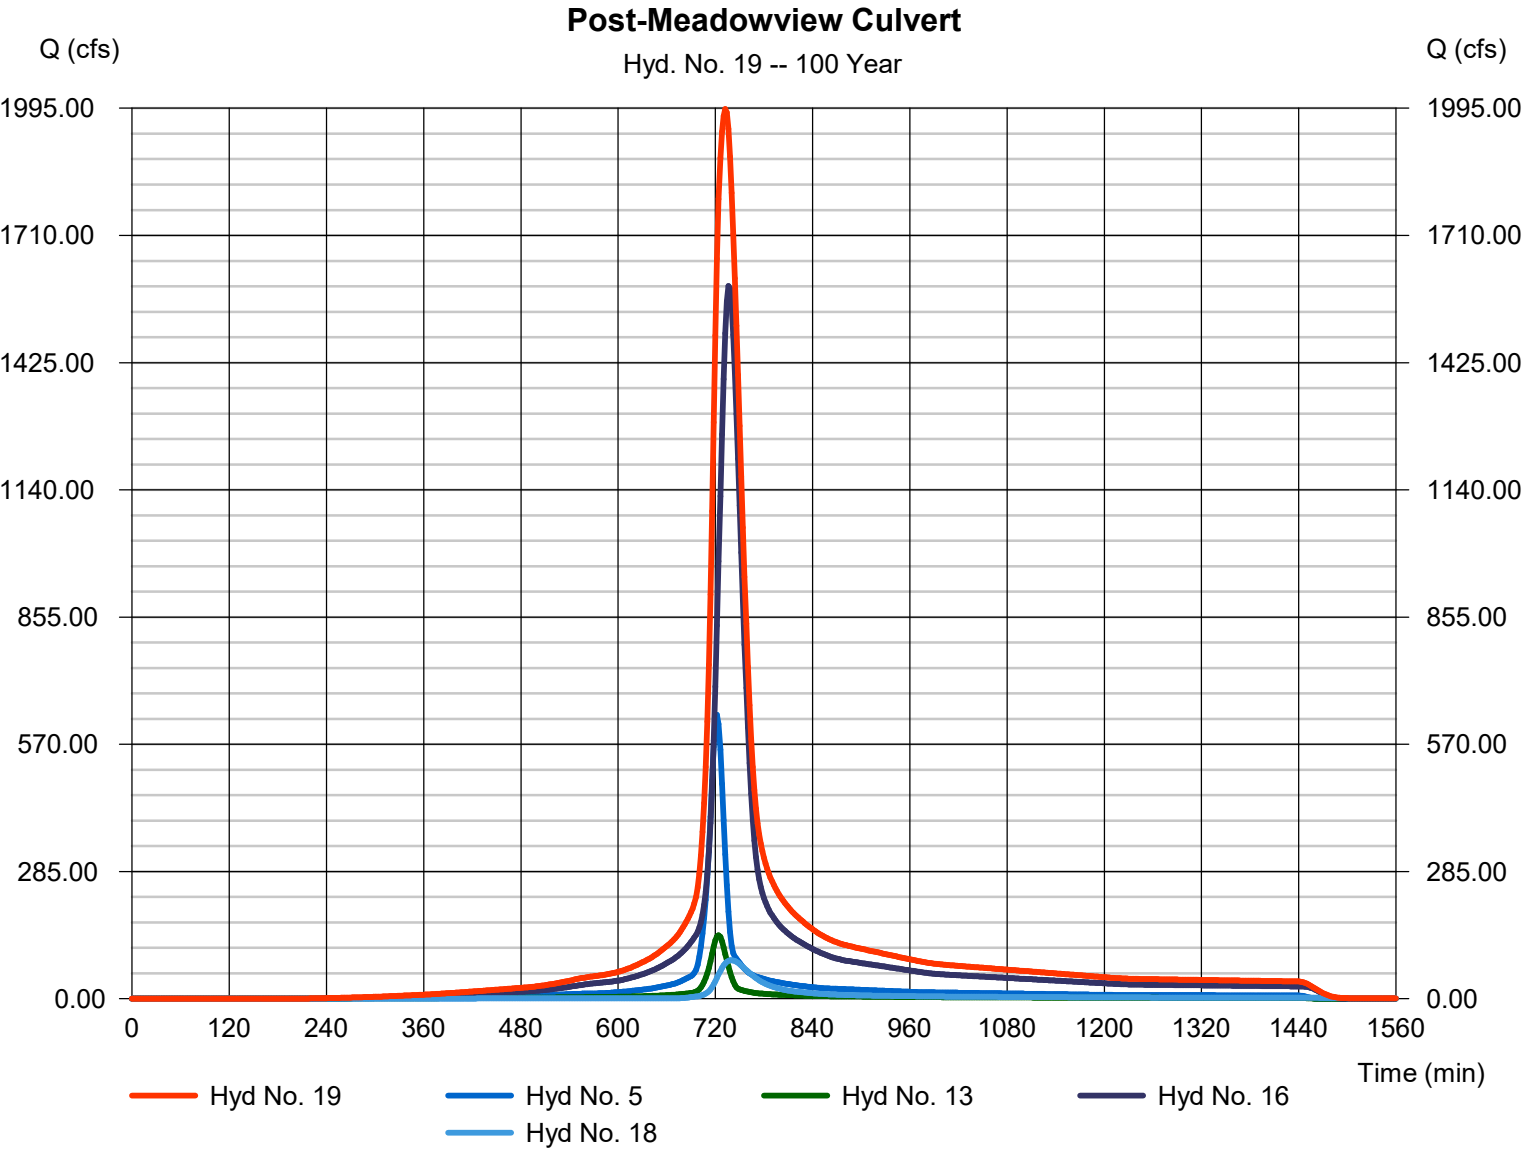

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023


Thursday, 03 / 28 / 2024

Hyd. No. 20

Post - Restored Stream

Hydrograph type	= Reach	Peak discharge	= 1958.22 cfs
Storm frequency	= 100 yrs	Time to peak	= 736 min
Time interval	= 2 min	Hyd. volume	= 9,601,693 cuft
Inflow hyd. No.	= 19 - Post-Meadowview Culvert	Section type	= Trapezoidal
Reach length	= 1340.0 ft	Channel slope	= 0.8 %
Manning's n	= 0.030	Bottom width	= 20.0 ft
Side slope	= 10.0:1	Max. depth	= 4.0 ft
Rating curve x	= 0.595	Rating curve m	= 1.345
Ave. velocity	= 4.78 ft/s	Routing coeff.	= 0.4467

Modified Att-Kin routing method used.

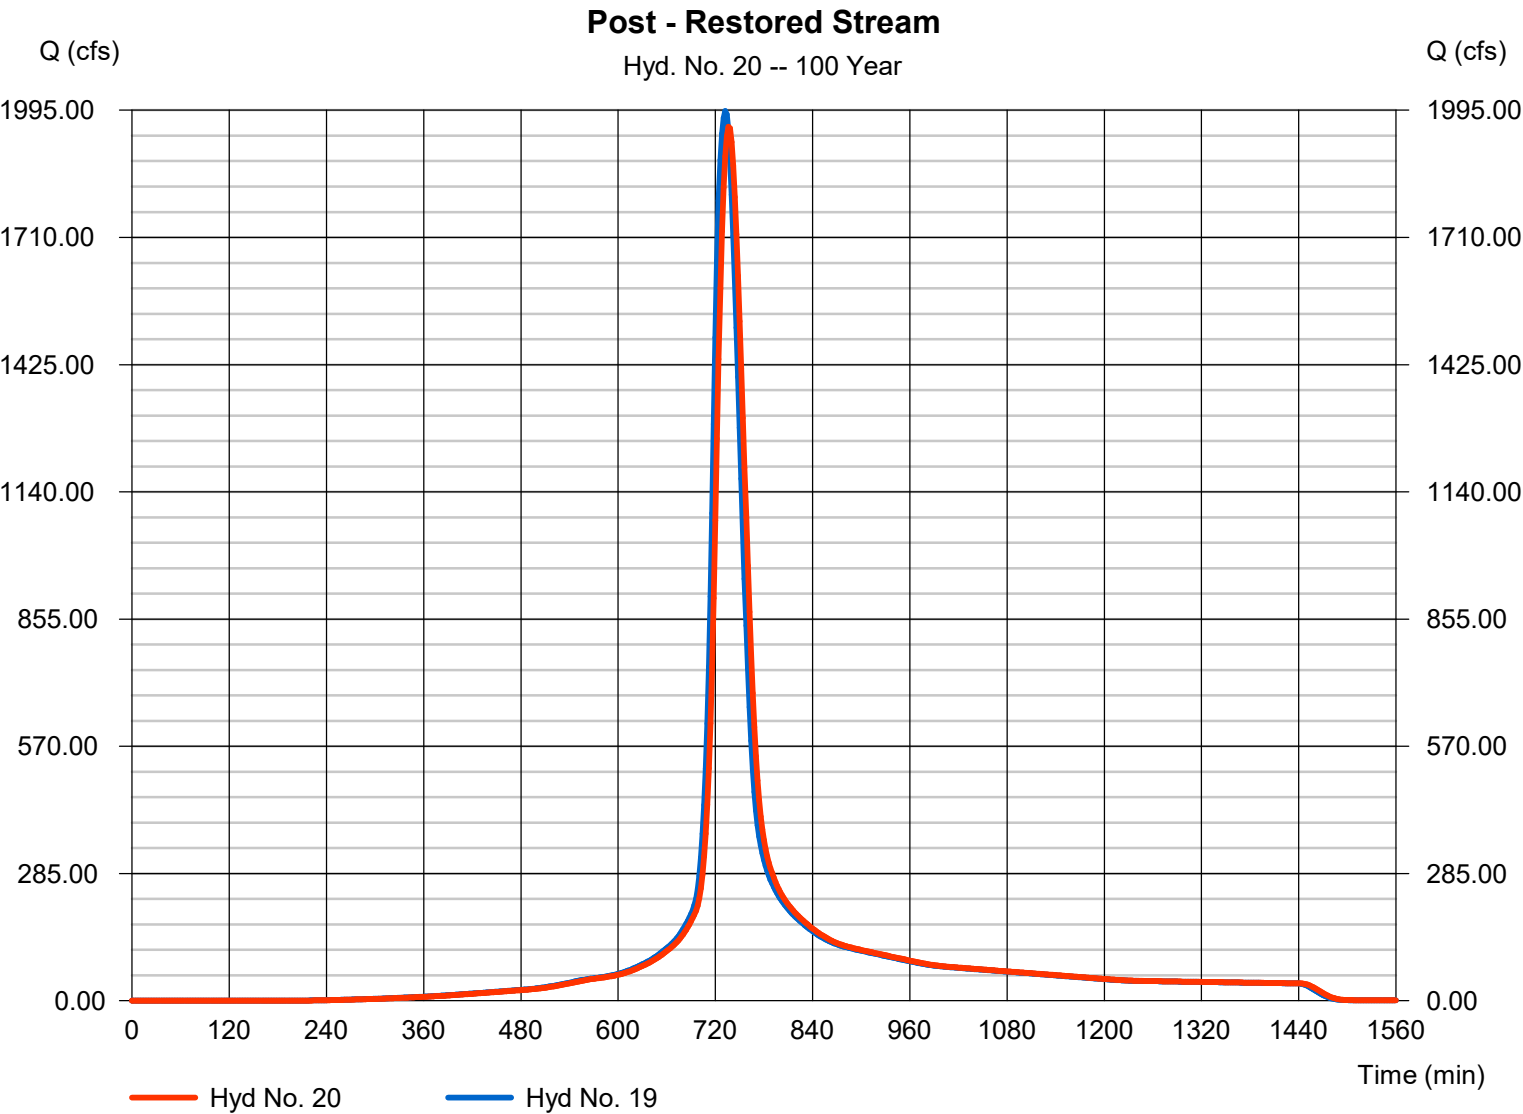

Hydrograph Report

Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Thursday, 03 / 28 / 2024

Hyd. No. 21

Section 8 - Post


Hydrograph type = SCS Runoff
 Storm frequency = 100 yrs
 Time interval = 2 min
 Drainage area = 12.600 ac
 Basin Slope = 0.0 %
 Tc method = TR55
 Total precip. = 7.80 in
 Storm duration = 24 hrs

Peak discharge = 76.90 cfs
 Time to peak = 728 min
 Hyd. volume = 297,548 cuft
 Curve number = 90*
 Hydraulic length = 0 ft
 Time of conc. (Tc) = 23.90 min
 Distribution = Type II
 Shape factor = 484

* Composite (Area/CN) = $[(12.600 \times 90)] / 12.600$

Section 8 - Post

Hyd. No. 21 -- 100 Year

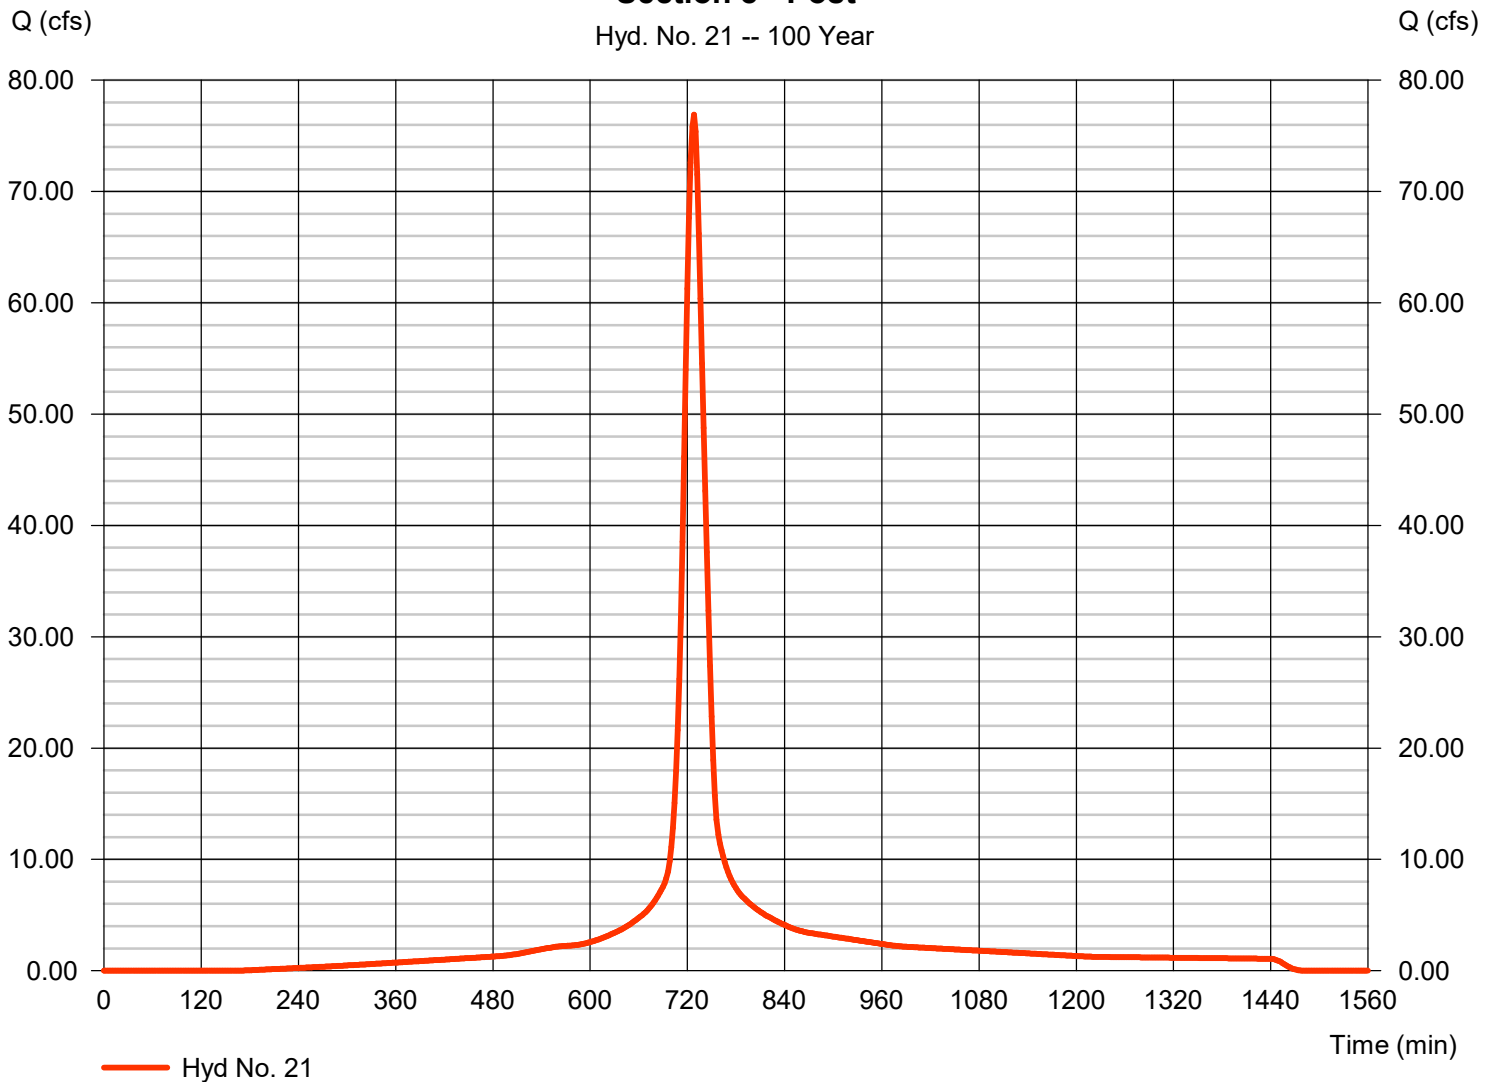

Hydrograph Report


Hydraflow Hydrographs Extension for Autodesk® Civil 3D® by Autodesk, Inc. v2023

Thursday, 03 / 28 / 2024

Hyd. No. 22

OVERALL POST - DETENTION BASIN

Hydrograph type	= Combine	Peak discharge	= 2060.48 cfs
Storm frequency	= 100 yrs	Time to peak	= 736 min
Time interval	= 2 min	Hyd. volume	= 10,175,185 cuft
Inflow hyds.	= 6, 20, 21	Contrib. drain. area	= 23.900 ac

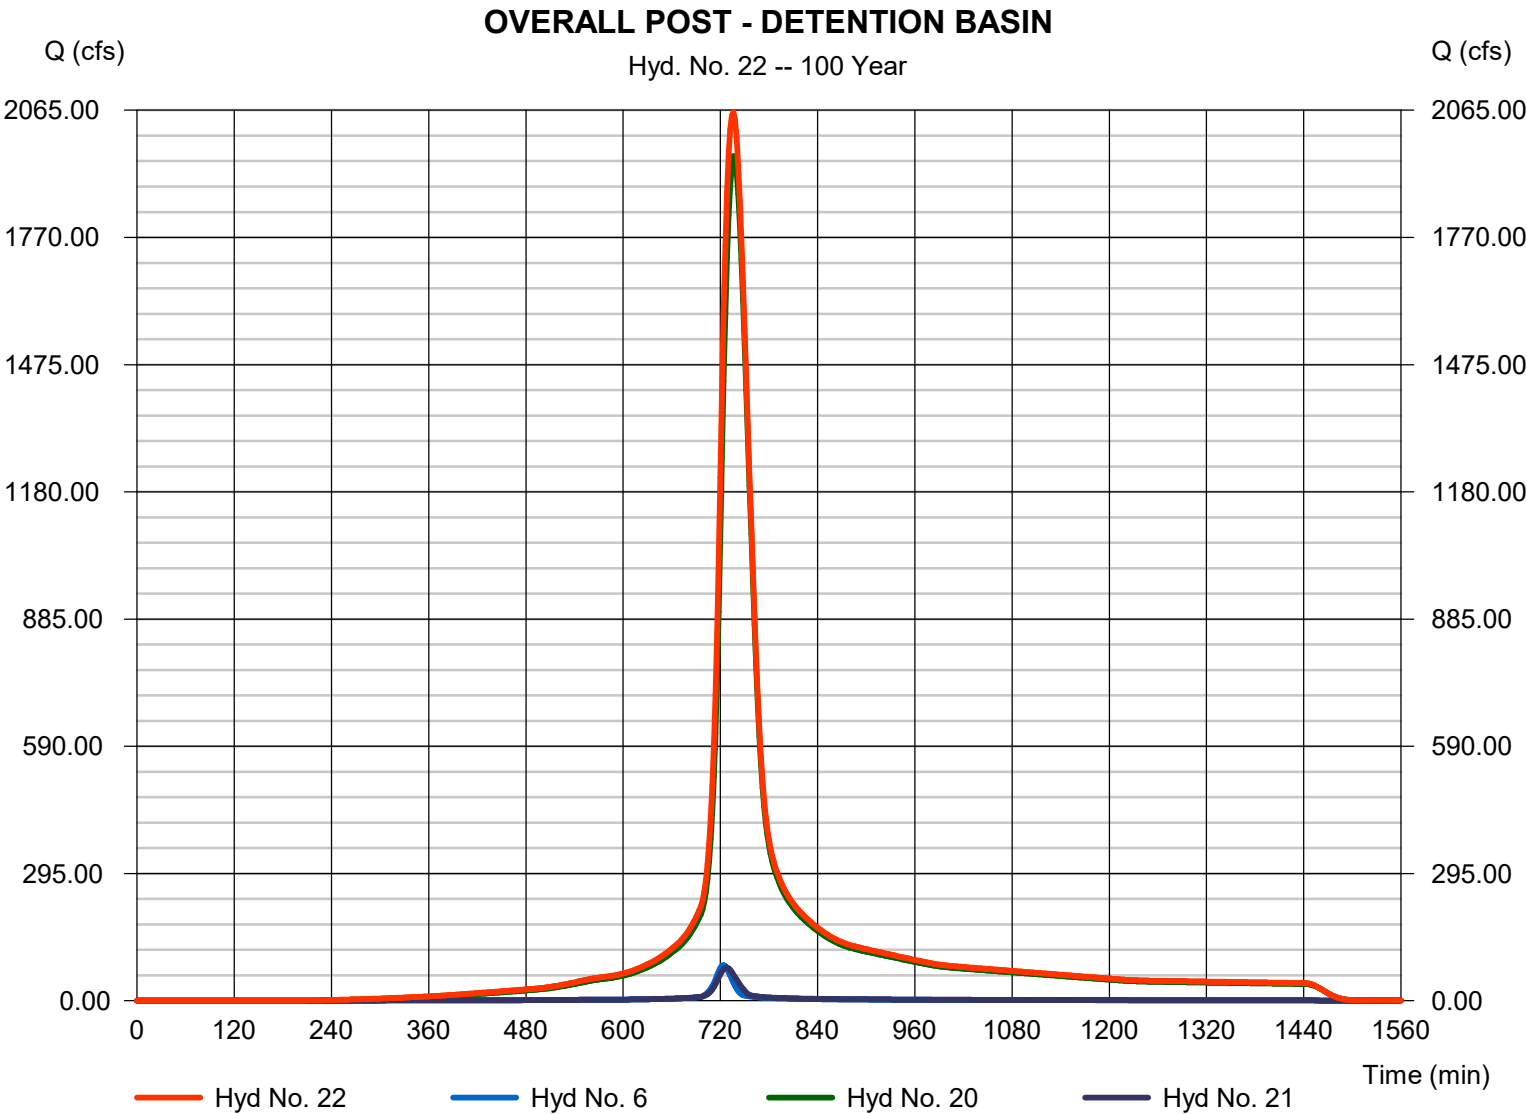

Return Period (Yrs)	Intensity-Duration-Frequency Equation Coefficients (FHA)			
	B	D	E	(N/A)
1	0.0000	0.0000	0.0000	-----
2	58.7310	12.5000	0.8339	-----
3	0.0000	0.0000	0.0000	-----
5	76.3517	14.4000	0.8324	-----
10	89.1197	15.3000	0.8331	-----
25	108.4324	16.3000	0.8361	-----
50	123.7045	16.9000	0.8383	-----
100	140.0626	17.5000	0.8416	-----

File name: Kansas City, MO Area.IDF

$$\text{Intensity} = B / (T_c + D)^E$$

Return Period (Yrs)	Intensity Values (in/hr)											
	5 min	10	15	20	25	30	35	40	45	50	55	60
1	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
2	5.40	4.38	3.70	3.22	2.86	2.58	2.35	2.16	2.00	1.87	1.75	1.65
3	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
5	6.47	5.34	4.58	4.02	3.59	3.25	2.97	2.74	2.55	2.38	2.24	2.11
10	7.26	6.04	5.20	4.58	4.10	3.72	3.41	3.15	2.93	2.74	2.58	2.43
25	8.40	7.05	6.09	5.38	4.83	4.39	4.03	3.73	3.47	3.25	3.06	2.89
50	9.31	7.83	6.79	6.01	5.40	4.91	4.51	4.18	3.89	3.65	3.44	3.25
100	10.19	8.61	7.48	6.63	5.97	5.44	5.00	4.63	4.31	4.04	3.81	3.60

Tc = time in minutes. Values may exceed 60.


Precip. file name: C:\MYFILES\Kansas City, MO Area.pcp

[illegible]



APPENDIX D: STORM SEWER CALCULATIONS

Hydraflow Storm Sewers Extension for Autodesk® Civil 3D® Plan

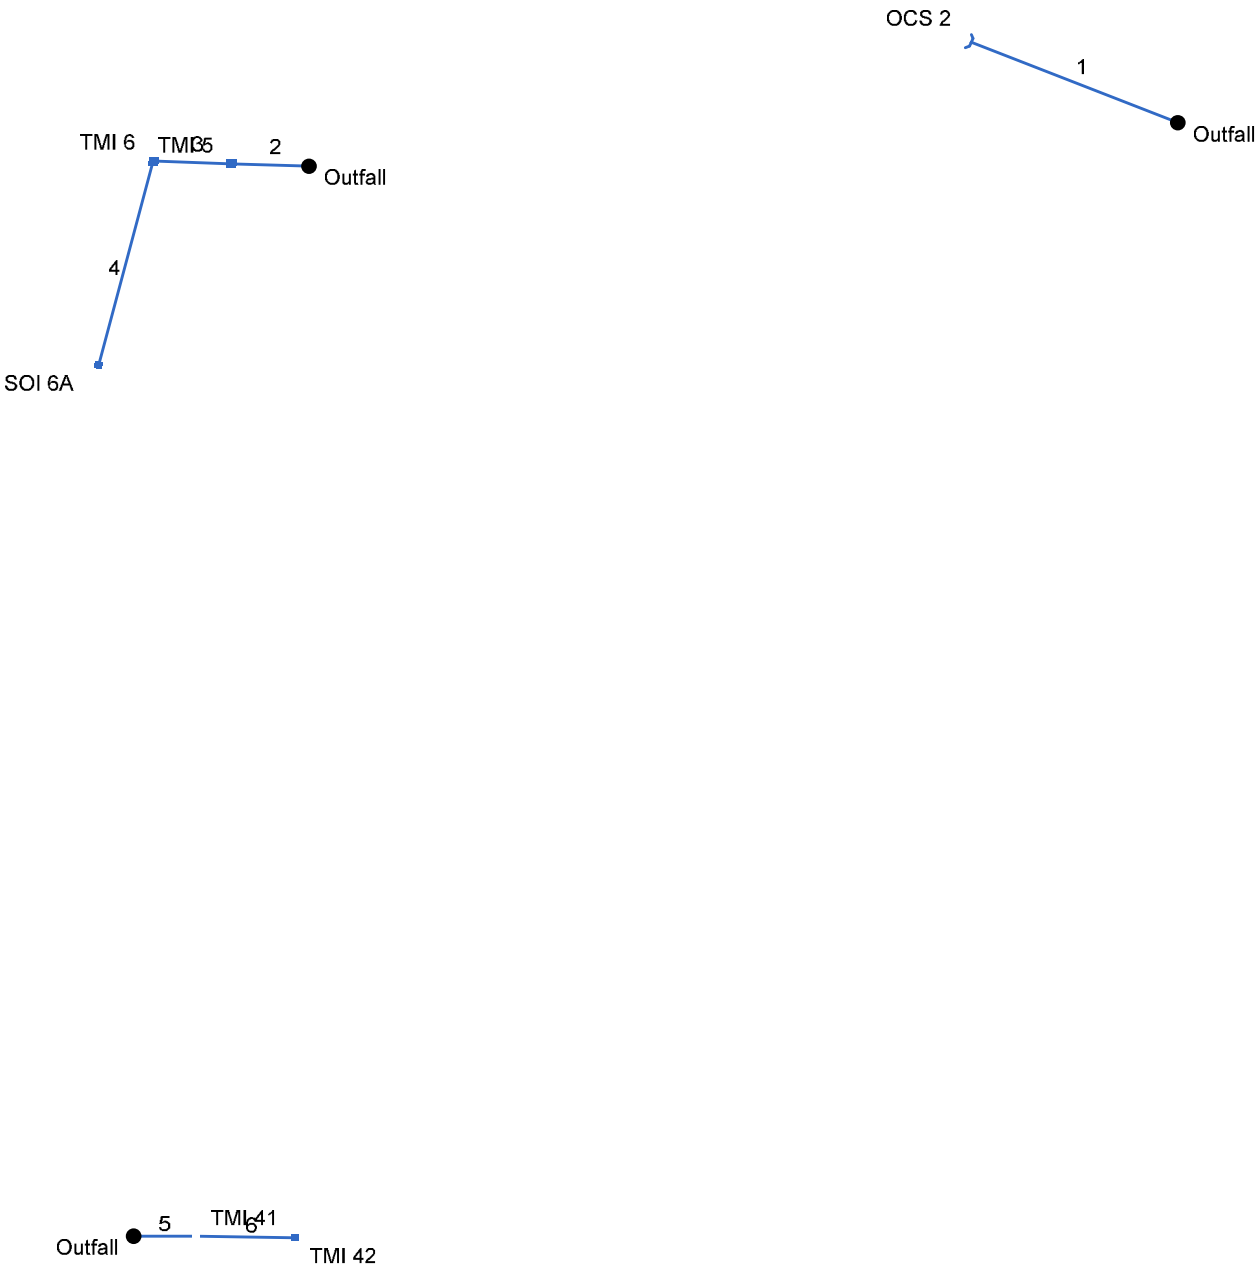

Project File: Storm Sewers-OFFSITE ONLY- 25 Year Storm.stm	Number of lines: 6	Date: 10/4/2023
--	--------------------	-----------------

Storm Sewer Summary Report

Line No.	Line ID	Flow rate (cfs)	Line Size (in)	Line shape	Line length (ft)	Invert EL Dn (ft)	Invert EL Up (ft)	Line Slope (%)	HGL Down (ft)	HGL Up (ft)	Minor loss (ft)	HGL Junct (ft)	Dns Line No.	Junction Type
1	EX WALL	16.63	60	Cir	95.300	910.75	911.15	0.420	912.32	912.27	n/a	912.27 j	End	OpenHeadwall
2	FES 4	33.34	36	Cir	33.145	922.47	922.64	0.513	924.74	924.51	0.40	924.51	End	Curb-Horiz
3	6	32.85	36	Cir	33.000	922.83	923.00	0.515	924.56	924.86	n/a	924.86	2	Curb-Horiz
4	6A	31.80	24	Cir	99.000	923.20	923.69	0.495	925.20*	926.87*	1.59	928.46	3	DropCurb
5	FES 40	1.24	24	Cir	26.463	928.76	929.03	1.020	929.08	929.41	0.07	929.41	End	Curb-Horiz
6	42	0.62	24	Cir	42.000	929.23	929.65	1.000	929.45	929.92	0.09	929.92	5	Curb-Horiz

Storm Sewer Tabulation

Station		Len	Drng Area		Rnoff coeff	Area x C		Tc		Rain (l)	Total flow	Cap full	Vel	Pipe		Invert Elev		HGL Elev		Grnd / Rim Elev		Line ID
Line	To Line		Incr	Total		Incr	Total	Inlet	Syst					Size	Slope	Dn	Up	Dn	Up	Dn	Up	
		(ft)	(ac)	(ac)	(C)			(min)	(min)	(in/hr)	(cfs)	(cfs)	(ft/s)	(in)	(%)	(ft)	(ft)	(ft)	(ft)	(ft)	(ft)	
1	End	95.300	0.00	0.00	0.00	0.00	0.00	5.0	5.0	0.0	16.63	182.8	4.10	60	0.42	910.75	911.15	912.32	912.27	0.00	920.00	EX WALL
2	End	33.145	0.16	10.59	0.64	0.10	6.97	5.0	25.2	4.8	33.34	51.75	6.50	36	0.51	922.47	922.64	924.74	924.51	0.00	928.10	FES 4
3	2	33.000	0.36	10.43	0.61	0.22	6.87	5.0	25.2	4.8	32.85	51.86	7.45	36	0.52	922.83	923.00	924.56	924.86	928.10	929.66	6
4	3	99.000	10.07	10.07	0.66	6.65	6.65	25.2	25.2	4.8	31.80	17.24	10.12	24	0.49	923.20	923.69	925.20	926.87	929.66	929.00	6A
5	End	26.463	0.13	0.26	0.58	0.08	0.15	5.0	5.0	8.2	1.24	24.75	3.39	24	1.02	928.76	929.03	929.08	929.41	0.00	934.65	FES 40
6	5	42.000	0.13	0.13	0.58	0.08	0.08	5.0	5.0	8.2	0.62	24.50	2.88	24	1.00	929.23	929.65	929.45	929.92	934.65	934.65	42
Project File: Storm Sewers-OFFSITE ONLY- 25 Year Storm.stm																Number of lines: 6				Run Date: 10/4/2023		
NOTES:Intensity = 102.61 / (Inlet time + 16.50) ^ 0.82; Return period =Yrs. 25 ; Pipe travel time suppressed. ; c = cir e = ellip b = box																						

Inlet Report

Line No	Inlet ID	Q = CIA (cfs)	Q carry (cfs)	Q capt (cfs)	Q Byp (cfs)	Junc Type	Curb Inlet		Grate Inlet			Gutter							Inlet			Byp Line No
							Ht (in)	L (ft)	Area (sqft)	L (ft)	W (ft)	So (ft/ft)	W (ft)	Sw (ft/ft)	Sx (ft/ft)	n	Depth (ft)	Spread (ft)	Depth (ft)	Spread (ft)	Depr (in)	
1	OCS 2	16.63*	0.00	16.63	0.00	Hdwl	0.0	0.00	0.00	0.00	0.00	Sag	2.00	0.020	0.020	0.013	0.00	0.00	0.00	0.00	0.0	Off
2	TMI 5	0.84	0.00	0.84	0.00	Curb	6.0	2.93	0.00	0.00	0.00	Sag	1.50	0.020	0.020	0.013	0.21	10.48	0.21	10.48	0.0	Off
3	TMI 6	1.81	0.00	1.81	0.00	Curb	6.0	2.93	0.00	0.00	0.00	Sag	1.50	0.020	0.020	0.013	0.35	17.43	0.35	17.43	0.0	Off
4	SOI 6A	31.80	0.00	31.80	0.00	DrCrb	12.0	5.00	0.00	0.00	0.00	Sag	0.00	0.020	0.020	0.013	1.90	95.06	1.90	95.06	0.0	Off
5	TMI 41	0.62	0.00	0.62	0.00	Curb	4.0	1.00	0.00	0.00	0.00	Sag	2.00	0.050	0.020	0.013	0.21	7.55	0.21	7.55	0.0	Off
6	TMI 42	0.62	0.00	0.62	0.00	Curb	6.0	4.00	0.00	0.00	0.00	Sag	2.00	0.050	0.020	0.013	0.17	5.40	0.17	5.40	0.0	Off

Project File: Storm Sewers-OFFSITE ONLY- 25 Year Storm.stm

Number of lines: 6

Run Date: 10/4/2023

NOTES: Inlet N-Values = 0.016; Intensity = 102.61 / (Inlet time + 16.50) ^ 0.82; Return period = 25 Yrs. ; * Indicates Known Q added. All curb inlets are Horiz throat.

Storm Sewer Inlet Time Tabulation

Line No.	Line ID	Tc Method	Sheet Flow					Shallow Concentrated Flow					Channel Flow							Total
			n-Value	flow Length (ft)	2-yr 24h P (in)	Land Slope (%)	Travel Time (min)	flow Length (ft)	Water Slope (%)	Surf Descr	Ave Vel (ft/s)	Travel Time (min)	X-sec Area (sqft)	Wetted Perim (ft)	Chan Slope (%)	n-Value	Vel	flow Length (ft)	Travel Time (min)	Travel Time (min)
1	EX WALL	User																		5.00
2	FES 4	User																		5.00
3	6	User																		5.00
4	6A	User																		25.20
5	FES 40	User																		5.00
6	42	User																		5.00
Project File: Storm Sewers-OFFSITE ONLY- 25 Year Storm.stn					Min. Tc used for intensity calculations = 5 min							Number of lines: 6				Date: 10/4/2023				

Hydraulic Grade Line Computations

Line	Size (in)	Q (cfs)	Downstream								Len (ft)	Upstream								Check		JL coeff (K)	Minor loss (ft)
			Invert elev (ft)	HGL elev (ft)	Depth (ft)	Area (sqft)	Vel (ft/s)	Vel head (ft)	EGL elev (ft)	Sf (%)		Invert elev (ft)	HGL elev (ft)	Depth (ft)	Area (sqft)	Vel (ft/s)	Vel head (ft)	EGL elev (ft)	Sf (%)	Ave Sf (%)	Enrgy loss (ft)		
1	60	16.63	910.75	912.32	1.57	3.29	3.15	0.40	912.72	0.000	95.300	911.15	912.27 j	1.12**	3.29	5.05	0.40	912.67	0.000	0.000	n/a	1.00	0.40
2	36	33.34	922.47	924.74	2.27	4.64	5.81	0.80	925.54	0.000	33.145	922.64	924.51	1.87**	4.64	7.18	0.80	925.32	0.000	0.000	n/a	0.50	0.40
3	36	32.85	922.83	924.56	1.73*	4.23	7.76	0.79	925.36	0.000	33.000	923.00	924.86	1.86**	4.60	7.14	0.79	925.65	0.000	0.000	n/a	1.48	n/a
4	24	31.80	923.20	925.20	2.00*	3.14	10.13	1.59	926.79	1.685	99.000	923.69	926.87	2.00	3.14	10.12	1.59	928.46	1.685	1.685	1.668	1.00	1.59
5	24	1.24	928.76	929.08	0.32	0.32	3.83	0.13	929.21	0.000	26.463	929.03	929.41	0.38**	0.42	2.94	0.13	929.55	0.000	0.000	n/a	0.50	0.07
6	24	0.62	929.23	929.45	0.22*	0.19	3.32	0.09	929.54	0.000	42.000	929.65	929.92	0.27**	0.25	2.45	0.09	930.01	0.000	0.000	n/a	1.00	0.09


Project File: Storm Sewers-OFFSITE ONLY- 25 Year Storm.stm

Number of lines: 6

Run Date: 10/4/2023

Notes: * Normal depth assumed; ** Critical depth.; j-Line contains hyd. jump ; c = cir e = ellip b = box

Hydraflow Storm Sewers Extension for Autodesk® Civil 3D® Plan

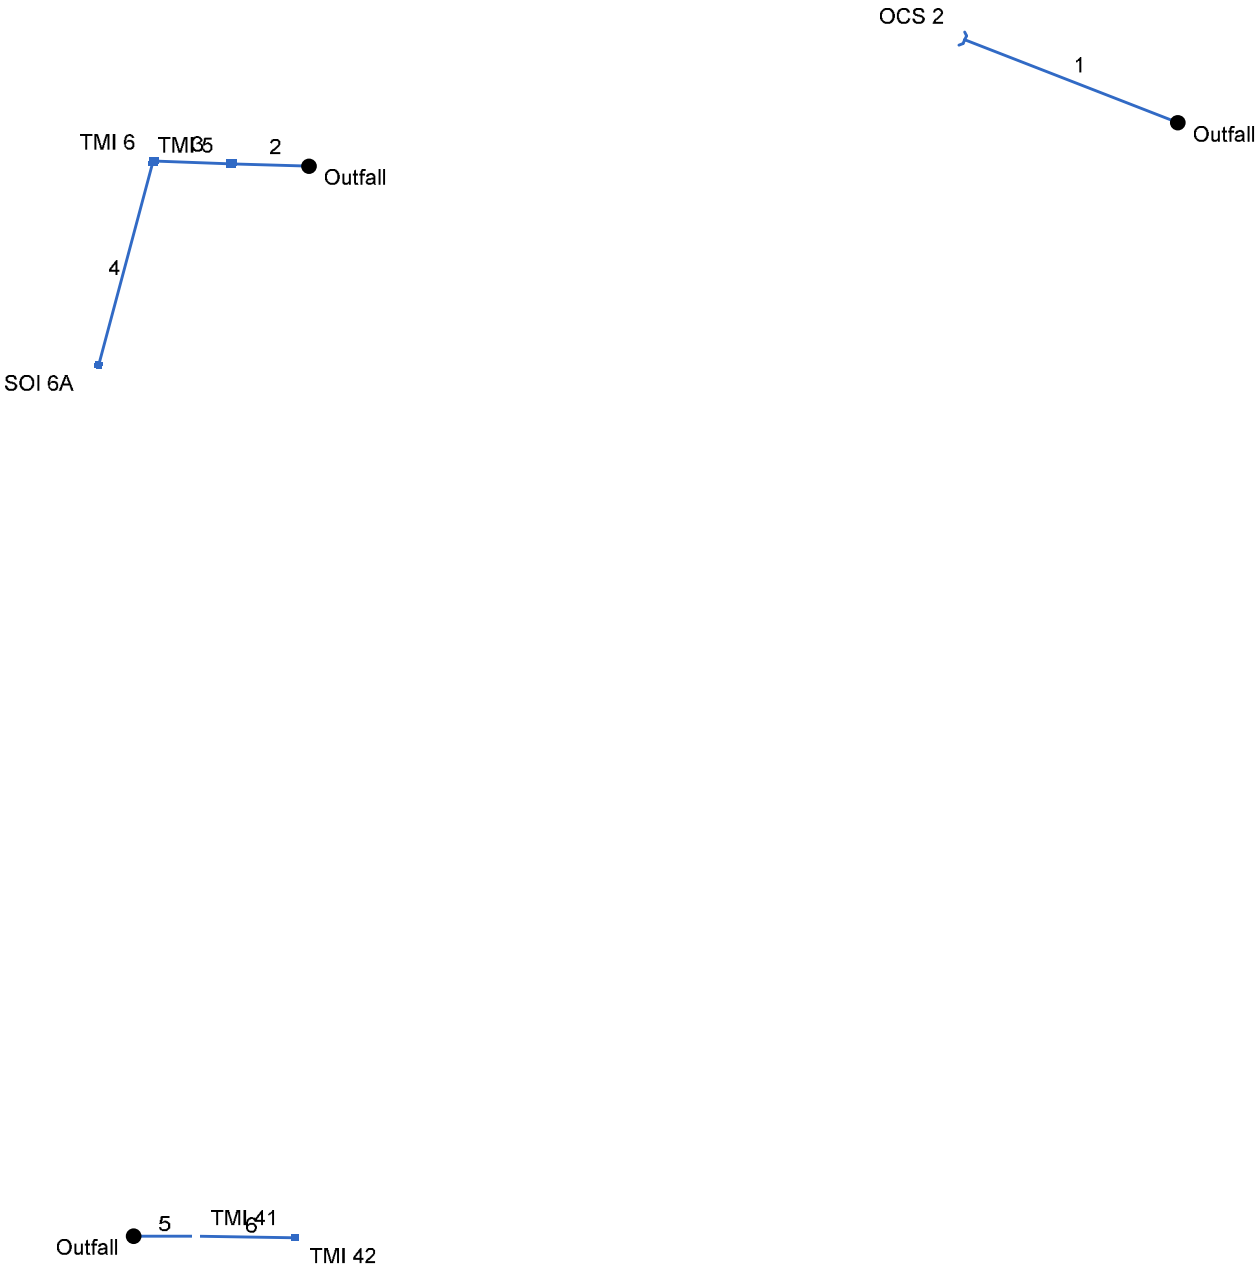

Project File: Storm Sewers-OFFSITE ONLY- 100 Year Storm.stm	Number of lines: 6	Date: 10/4/2023
---	--------------------	-----------------

Storm Sewer Summary Report

Line No.	Line ID	Flow rate (cfs)	Line Size (in)	Line shape	Line length (ft)	Invert EL Dn (ft)	Invert EL Up (ft)	Line Slope (%)	HGL Down (ft)	HGL Up (ft)	Minor loss (ft)	HGL Junct (ft)	Dns Line No.	Junction Type
1	EX WALL	42.41	60	Cir	98.333	910.75	911.15	0.407	912.40	912.97	n/a	912.97	End	OpenHeadwall
2	FES 4	40.58	36	Cir	33.145	922.47	922.64	0.513	924.74	924.71	n/a	924.71	End	Curb-Horiz
3	6	40.06	36	Cir	33.000	922.83	923.00	0.515	924.81	925.06	n/a	925.06	2	Curb-Horiz
4	6A	38.88	24	Cir	99.000	923.20	923.69	0.495	925.20*	927.69*	2.38	930.07	3	DropCurb
5	FES 40	1.34	24	Cir	26.463	928.76	929.03	1.020	929.08	929.43	0.07	929.43	End	Curb-Horiz
6	42	0.74	24	Cir	42.000	929.23	929.65	1.000	929.47	929.95	0.10	929.95	5	Curb-Horiz

Storm Sewer Tabulation

Station		Len	Drng Area		Rnoff coeff	Area x C		Tc		Rain (l)	Total flow	Cap full	Vel	Pipe		Invert Elev		HGL Elev		Grnd / Rim Elev		Line ID
Line	To Line		Incr	Total		Incr	Total	Inlet	Syst					Size	Slope	Dn	Up	Dn	Up	Dn	Up	
		(ft)	(ac)	(ac)	(C)			(min)	(min)	(in/hr)	(cfs)	(cfs)	(ft/s)	(in)	(%)	(ft)	(ft)	(ft)	(ft)	(ft)	(ft)	
1	End	98.333	0.00	0.00	0.00	0.00	0.00	5.0	5.0	0.0	42.41	180.0	7.03	60	0.41	910.75	911.15	912.40	912.97	0.00	920.00	EX WALL
2	End	33.145	0.16	10.59	0.64	0.10	6.97	5.0	25.4	5.8	40.58	51.75	7.43	36	0.51	922.47	922.64	924.74	924.71	0.00	928.10	FES 4
3	2	33.000	0.36	10.43	0.61	0.22	6.87	5.0	25.3	5.8	40.06	51.86	7.92	36	0.52	922.83	923.00	924.81	925.06	928.10	929.66	6
4	3	99.000	10.07	10.07	0.66	6.65	6.65	25.2	25.2	5.8	38.88	17.24	12.38	24	0.49	923.20	923.69	925.20	927.69	929.66	929.00	6A
5	End	26.463	0.13	0.26	0.58	0.08	0.15	5.0	8.0	8.9	1.34	24.75	3.57	24	1.02	928.76	929.03	929.08	929.43	0.00	934.65	FES 40
6	5	42.000	0.13	0.13	0.58	0.08	0.08	5.0	5.0	9.8	0.74	24.50	3.03	24	1.00	929.23	929.65	929.47	929.95	934.65	934.65	42
Project File: Storm Sewers-OFFSITE ONLY- 100 Year Storm.stm																Number of lines: 6				Run Date: 10/4/2023		
NOTES:Intensity = 127.16 / (Inlet time + 17.80) ^ 0.82; Return period =Yrs. 100 ; c = cir e = ellip b = box																						

Inlet Report

Line No	Inlet ID	Q = CIA (cfs)	Q carry (cfs)	Q capt (cfs)	Q Byp (cfs)	Junc Type	Curb Inlet		Grate Inlet			Gutter							Inlet			Byp Line No
							Ht (in)	L (ft)	Area (sqft)	L (ft)	W (ft)	So (ft/ft)	W (ft)	Sw (ft/ft)	Sx (ft/ft)	n	Depth (ft)	Spread (ft)	Depth (ft)	Spread (ft)	Depr (in)	
1	OCS 2	42.41*	0.00	42.41	0.00	Hdwl	0.0	0.00	0.00	0.00	0.00	Sag	0.00	0.000	0.000	0.013	0.00	0.00	0.00	0.00	0.0	Off
2	TMI 5	1.01	0.00	1.01	0.00	Curb	6.0	2.93	0.00	0.00	0.00	Sag	1.50	0.020	0.020	0.013	0.24	11.78	0.24	11.78	0.0	Off
3	TMI 6	2.16	0.00	2.16	0.00	Curb	6.0	2.93	0.00	0.00	0.00	Sag	1.50	0.020	0.020	0.013	0.39	19.60	0.39	19.60	0.0	Off
4	SOI 6A	38.88	0.00	38.88	0.00	DrCrb	12.0	5.00	0.00	0.00	0.00	Sag	0.00	0.020	0.020	0.013	2.59	129.69	2.59	129.69	0.0	Off
5	TMI 41	0.74	0.00	0.74	0.00	Curb	4.0	1.00	0.00	0.00	0.00	Sag	2.00	0.050	0.020	0.013	0.23	8.49	0.23	8.49	0.0	Off
6	TMI 42	0.74	0.00	0.74	0.00	Curb	6.0	4.00	0.00	0.00	0.00	Sag	2.00	0.050	0.020	0.013	0.18	6.07	0.18	6.07	0.0	Off

Project File: Storm Sewers-OFFSITE ONLY- 100 Year Storm.stm

Number of lines: 6

Run Date: 10/4/2023

NOTES: Inlet N-Values = 0.016; Intensity = 127.16 / (Inlet time + 17.80) ^ 0.82; Return period = 100 Yrs. ; * Indicates Known Q added. All curb inlets are Horiz throat.

Storm Sewer Inlet Time Tabulation


Line No.	Line ID	Tc Method	Sheet Flow					Shallow Concentrated Flow					Channel Flow							Total
			n-Value	flow Length (ft)	2-yr 24h P (in)	Land Slope (%)	Travel Time (min)	flow Length (ft)	Water Slope (%)	Surf Descr	Ave Vel (ft/s)	Travel Time (min)	X-sec Area (sqft)	Wetted Perim (ft)	Chan Slope (%)	n-Value	Vel	flow Length (ft)	Travel Time (min)	Travel Time (min)
1	EX WALL	User																		5.00
2	FES 4	User																		5.00
3	6	User																		5.00
4	6A	User																		25.20
5	FES 40	User																		5.00
6	42	User																		5.00
Project File: Storm Sewers-OFFSITE ONLY- 100 Year Storm.stm					Min. Tc used for intensity calculations = 5 min							Number of lines: 6				Date: 10/4/2023				

Hydraulic Grade Line Computations


Line	Size	Q	Downstream								Len	Upstream								Check		JL coeff	Minor loss
			Invert elev (ft)	HGL elev (ft)	Depth (ft)	Area (sqft)	Vel (ft/s)	Vel head (ft)	EGL elev (ft)	Sf (%)		Invert elev (ft)	HGL elev (ft)	Depth (ft)	Area (sqft)	Vel (ft/s)	Vel head (ft)	EGL elev (ft)	Sf (%)	Ave Sf (%)	Enrgy loss (ft)		
	(in)	(cfs)									(ft)											(K)	(ft)
1	60	42.41	910.75	912.40	1.65	5.66	7.49	0.67	913.07	0.000	98.333	911.15	912.97	1.82**	6.45	6.57	0.67	913.64	0.000	0.000	n/a	1.00	n/a
2	36	40.58	922.47	924.74	2.27	5.21	7.07	0.94	925.68	0.000	33.145	922.64	924.71	2.07**	5.21	7.79	0.94	925.66	0.000	0.000	n/a	0.50	n/a
3	36	40.06	922.83	924.81	1.98*	4.95	8.09	0.93	925.74	0.000	33.000	923.00	925.06	2.06**	5.17	7.75	0.93	925.99	0.000	0.000	n/a	1.48	n/a
4	24	38.88	923.20	925.20	2.00*	3.14	12.38	2.38	927.58	2.518	99.000	923.69	927.69	2.00	3.14	12.37	2.38	930.07	2.518	2.518	2.493	1.00	2.38
5	24	1.34	928.76	929.08	0.32	0.32	4.13	0.14	929.22	0.000	26.463	929.03	929.43	0.40**	0.45	3.00	0.14	929.57	0.000	0.000	n/a	0.50	0.07
6	24	0.74	929.23	929.47	0.24*	0.21	3.49	0.10	929.57	0.000	42.000	929.65	929.95	0.30**	0.29	2.56	0.10	930.05	0.000	0.000	n/a	1.00	0.10
Project File: Storm Sewers-OFFSITE ONLY- 100 Year Storm.stm														Number of lines: 6					Run Date: 10/4/2023				
Notes: * Normal depth assumed; ** Critical depth. ; c = cir e = ellip b = box																							


Storm Sewer Profile

Proj. file: STORM SEWERS 6-20-23.stm

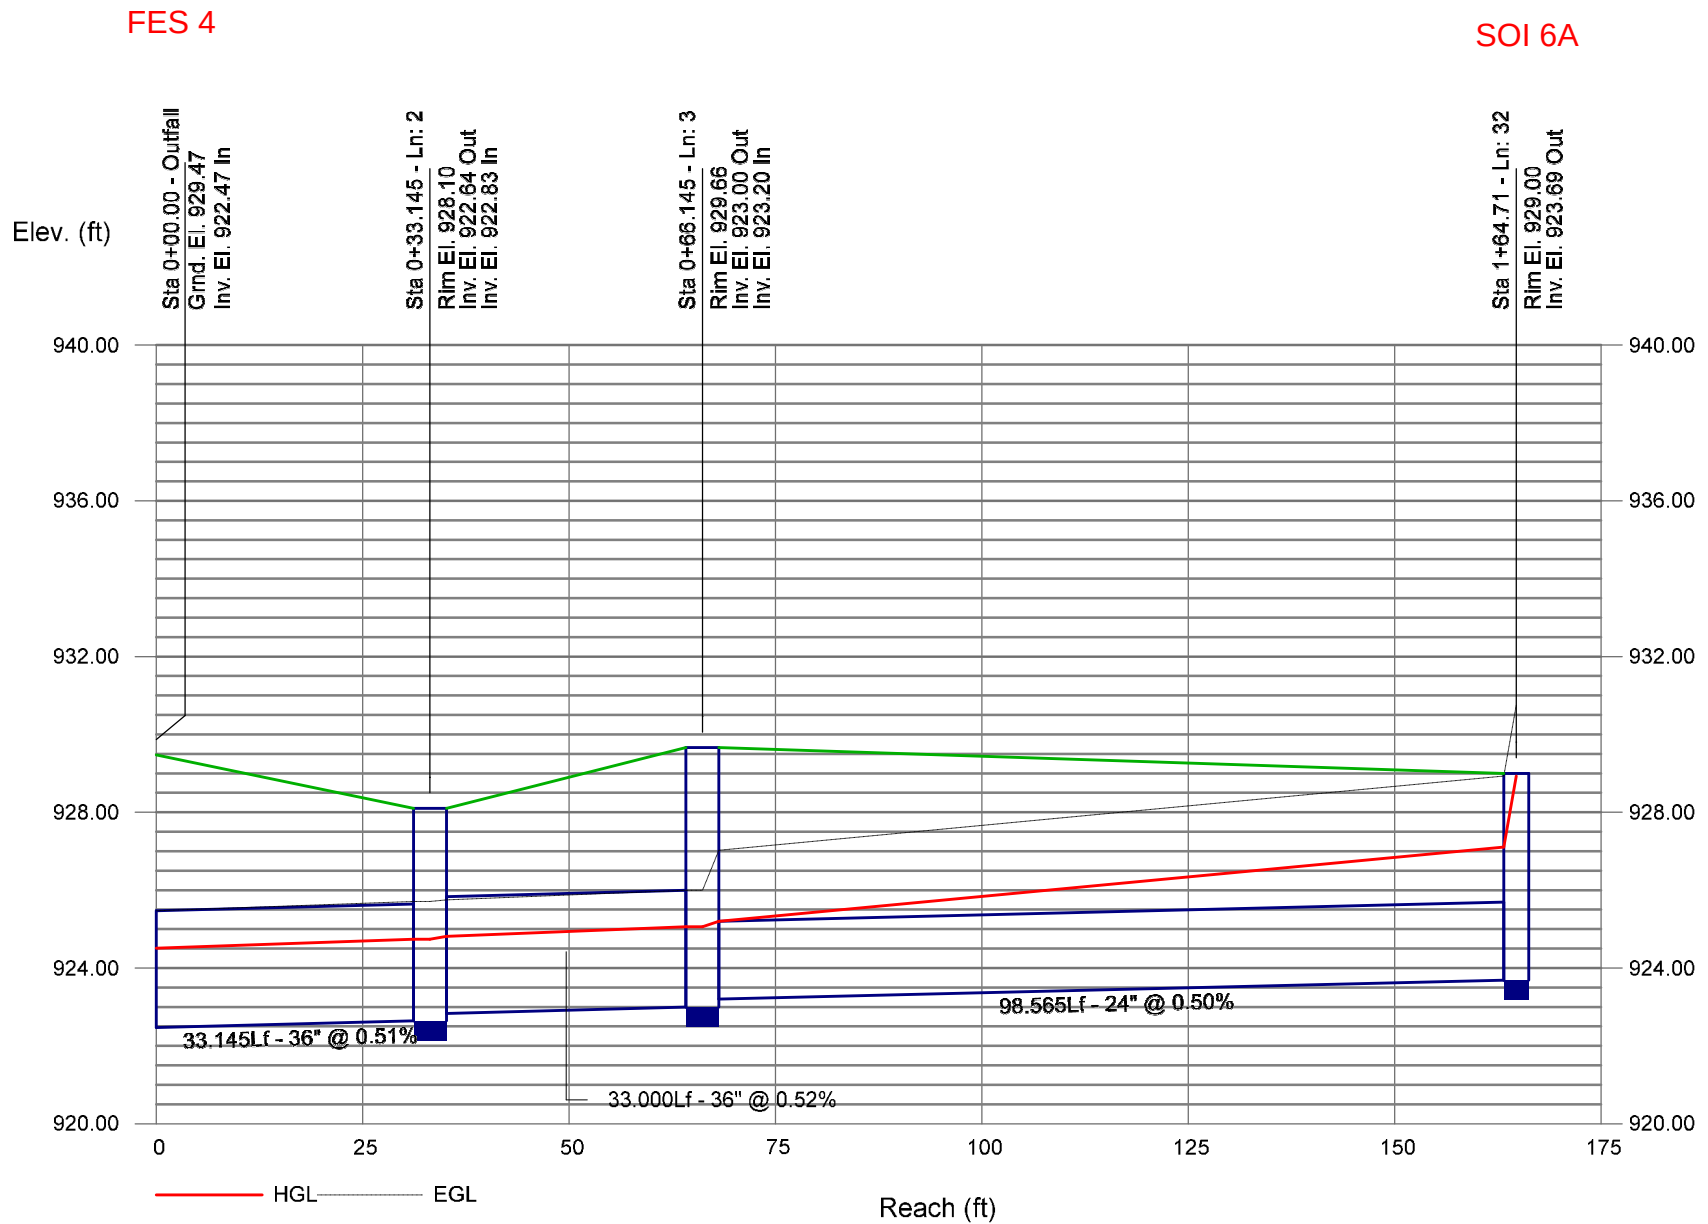



Storm Sewer Profile

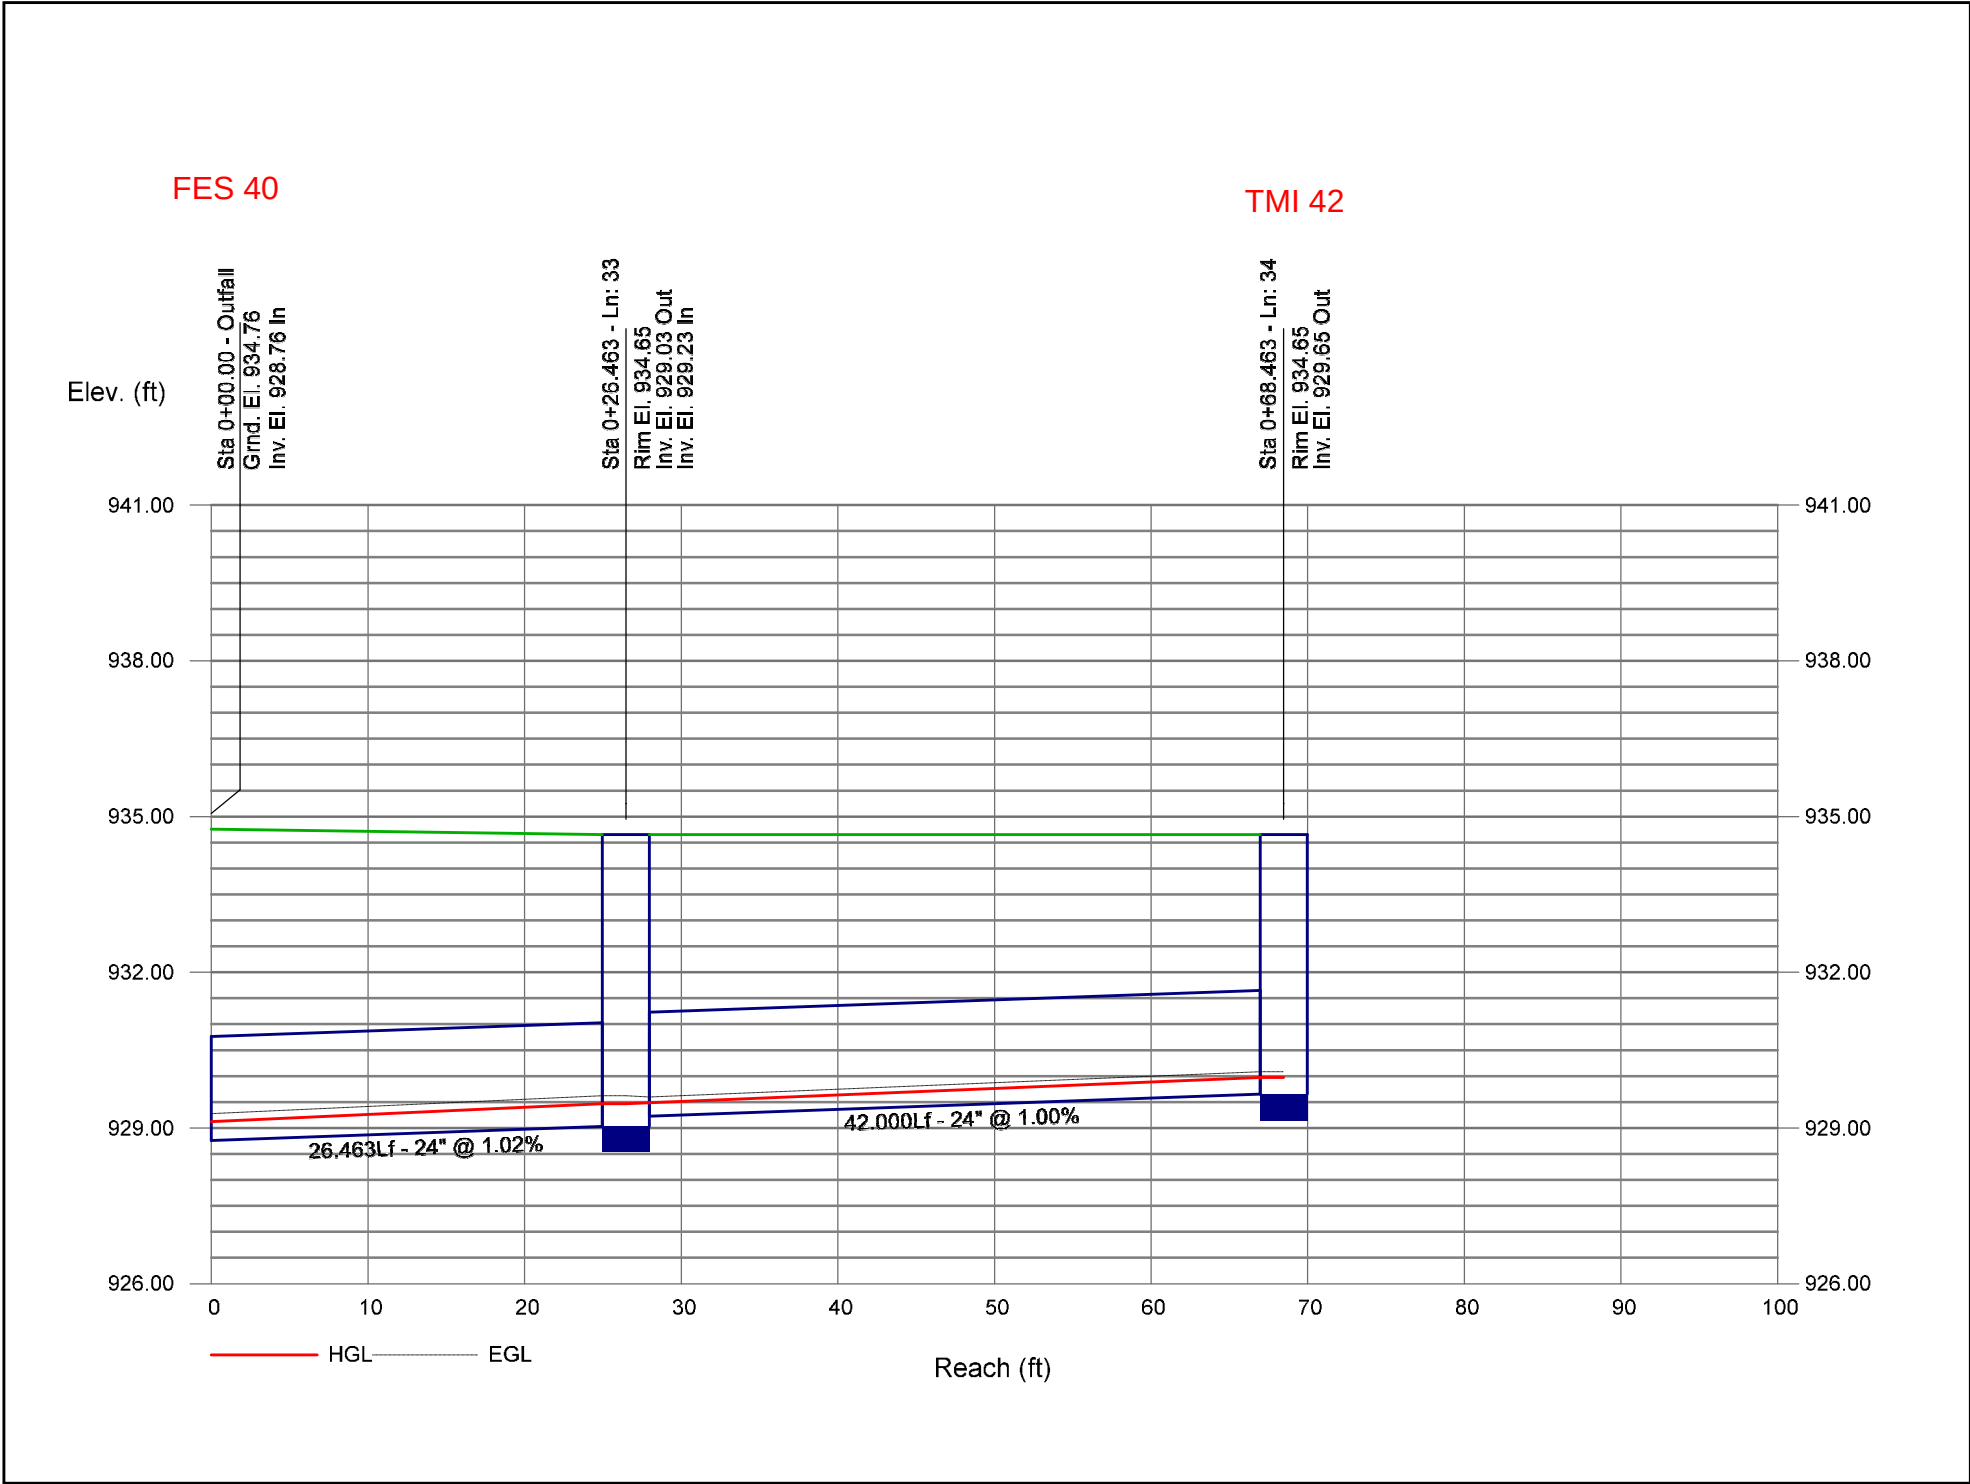

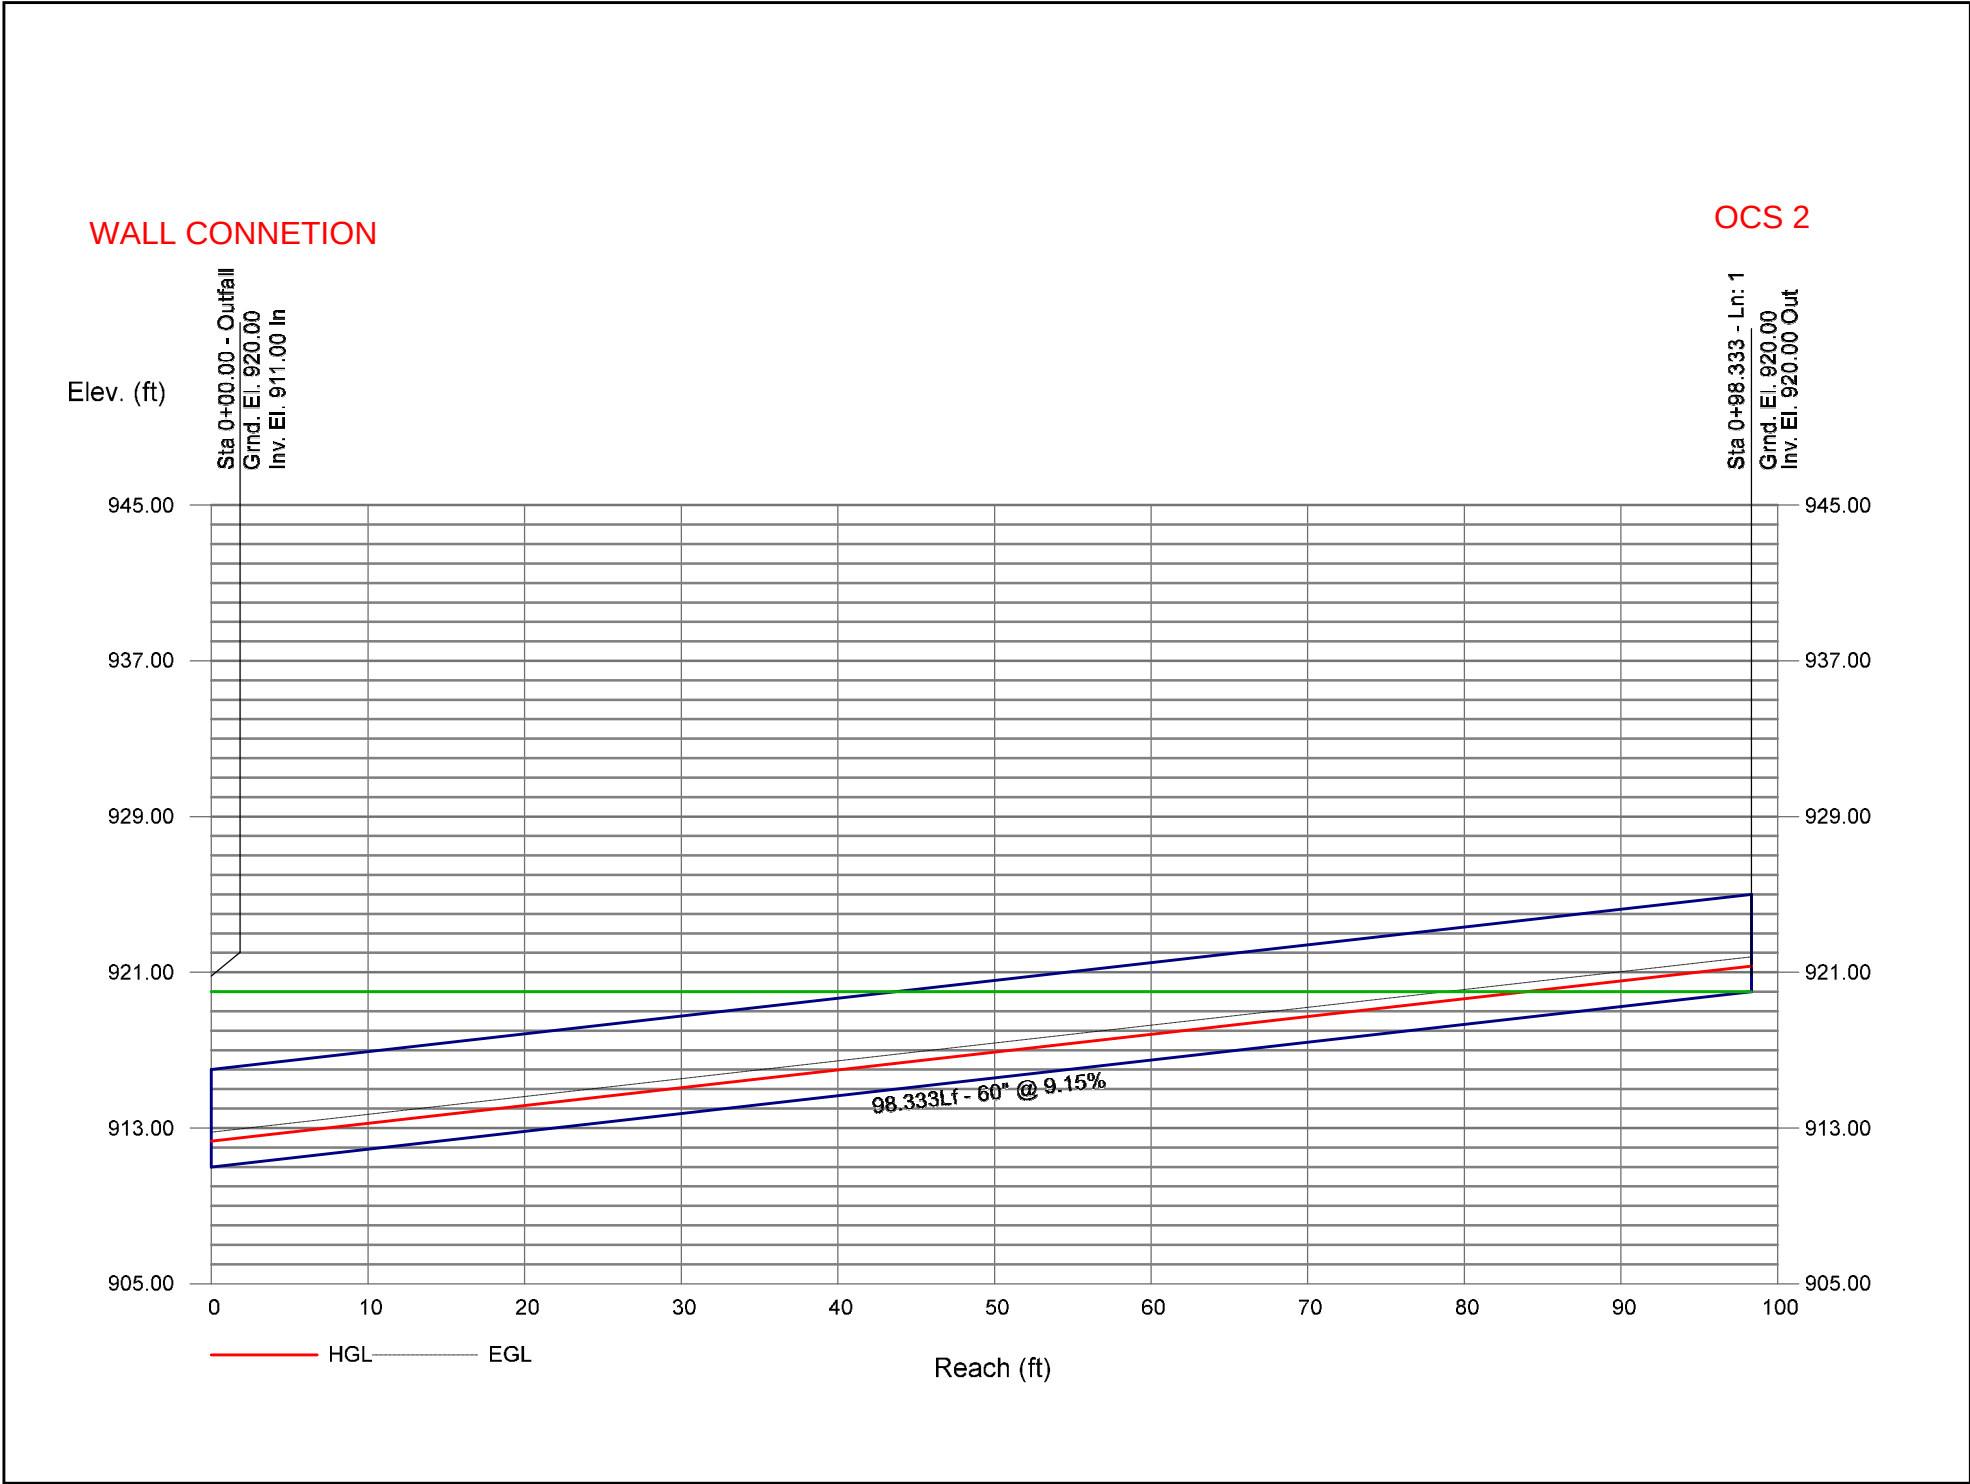




APPENDIX E: DRAINAGE AREA MAP(S)

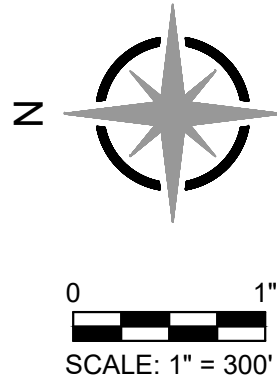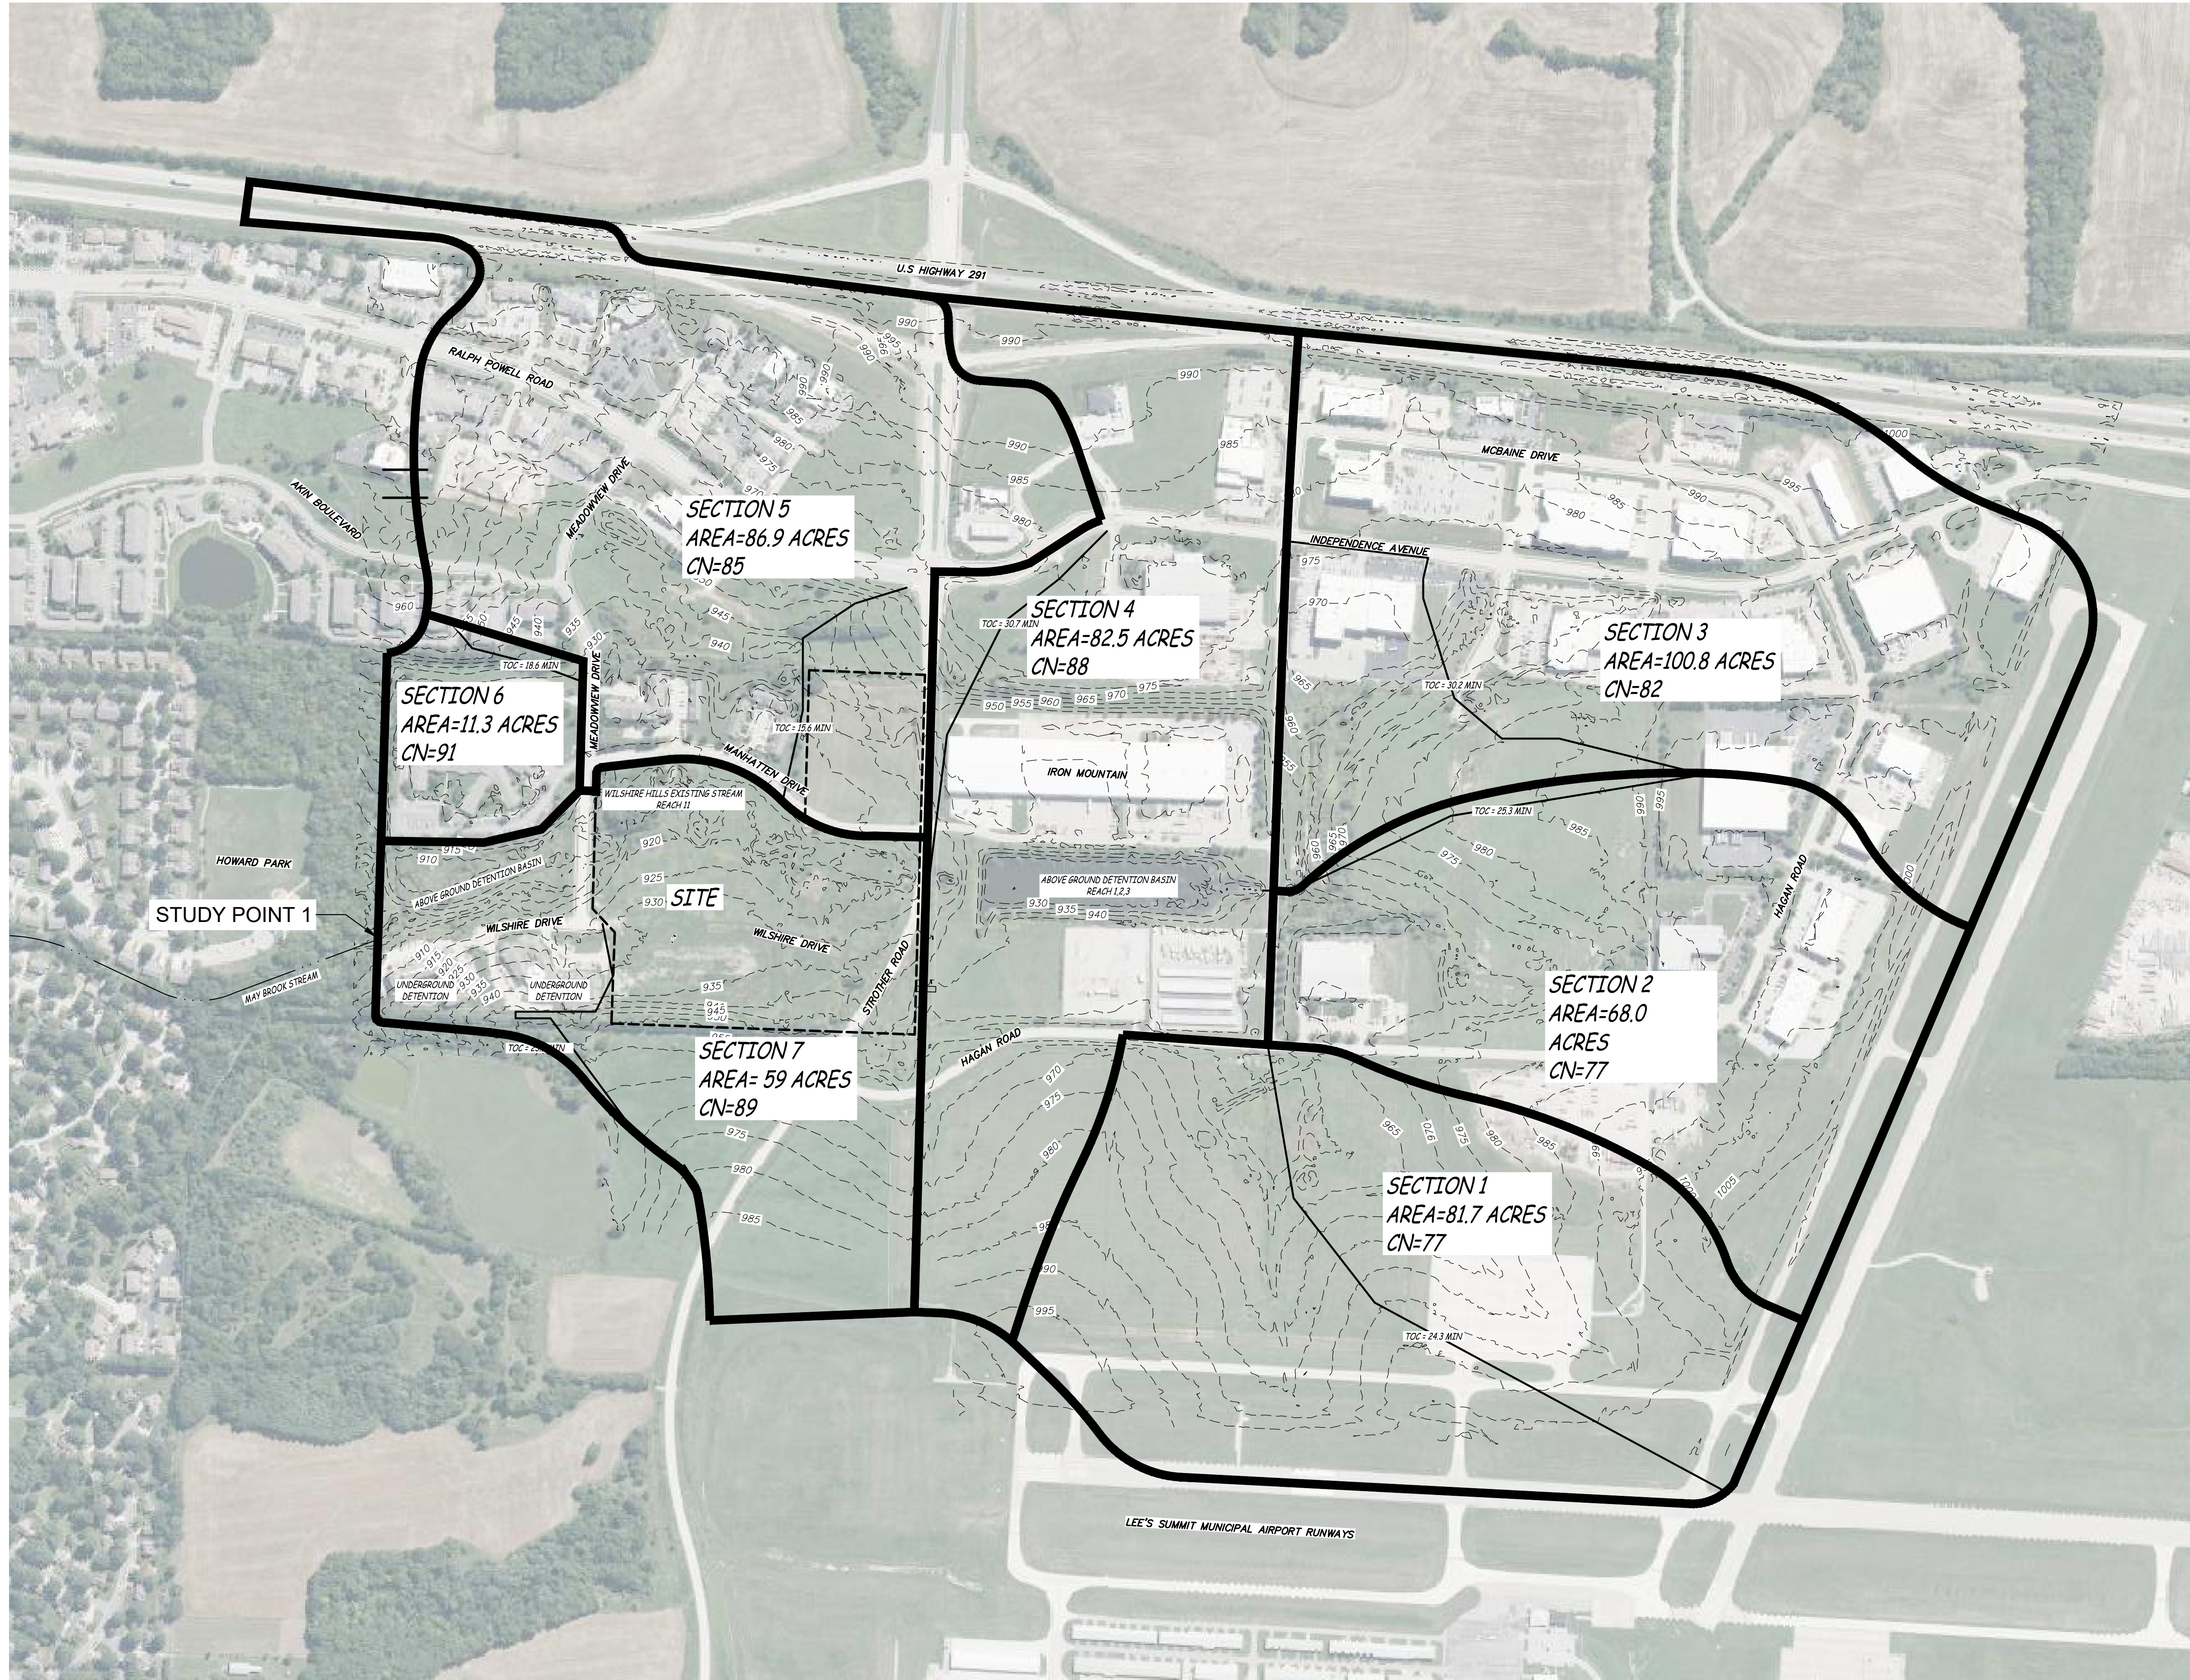

WILSHIRE HILLS PHASE III
STREET ADDRESS
LEE'S SUMMIT JACKSON COUNTY, MISSOURI

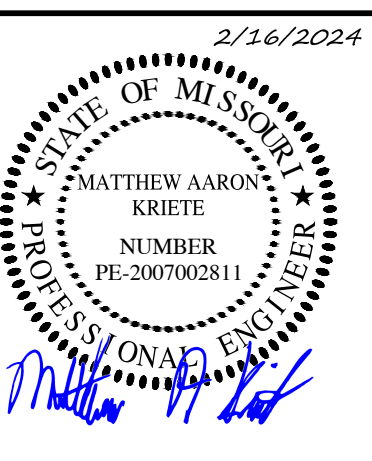

MATTHEW A. KRIETE
PROFESSIONAL ENGINEER
PE-2007002811

IF ORIGINAL SIGNATURE OR DIGITAL
AUTHENTICATION IS NOT PRESENT THIS
MEDIA SHOULD NOT BE CONSIDERED A
CERTIFIED DOCUMENT.

Date
NOVEMBER 28, 2023

Revised
(4) FEBRUARY 16, 2024


Design: ST Drawn: ST

PRE DOWNSTREAM
ANALYSIS MAP


Sheet
C2.18

ES&S PROJECT NO. 15925

CONSTRUCTION DOCUMENTS

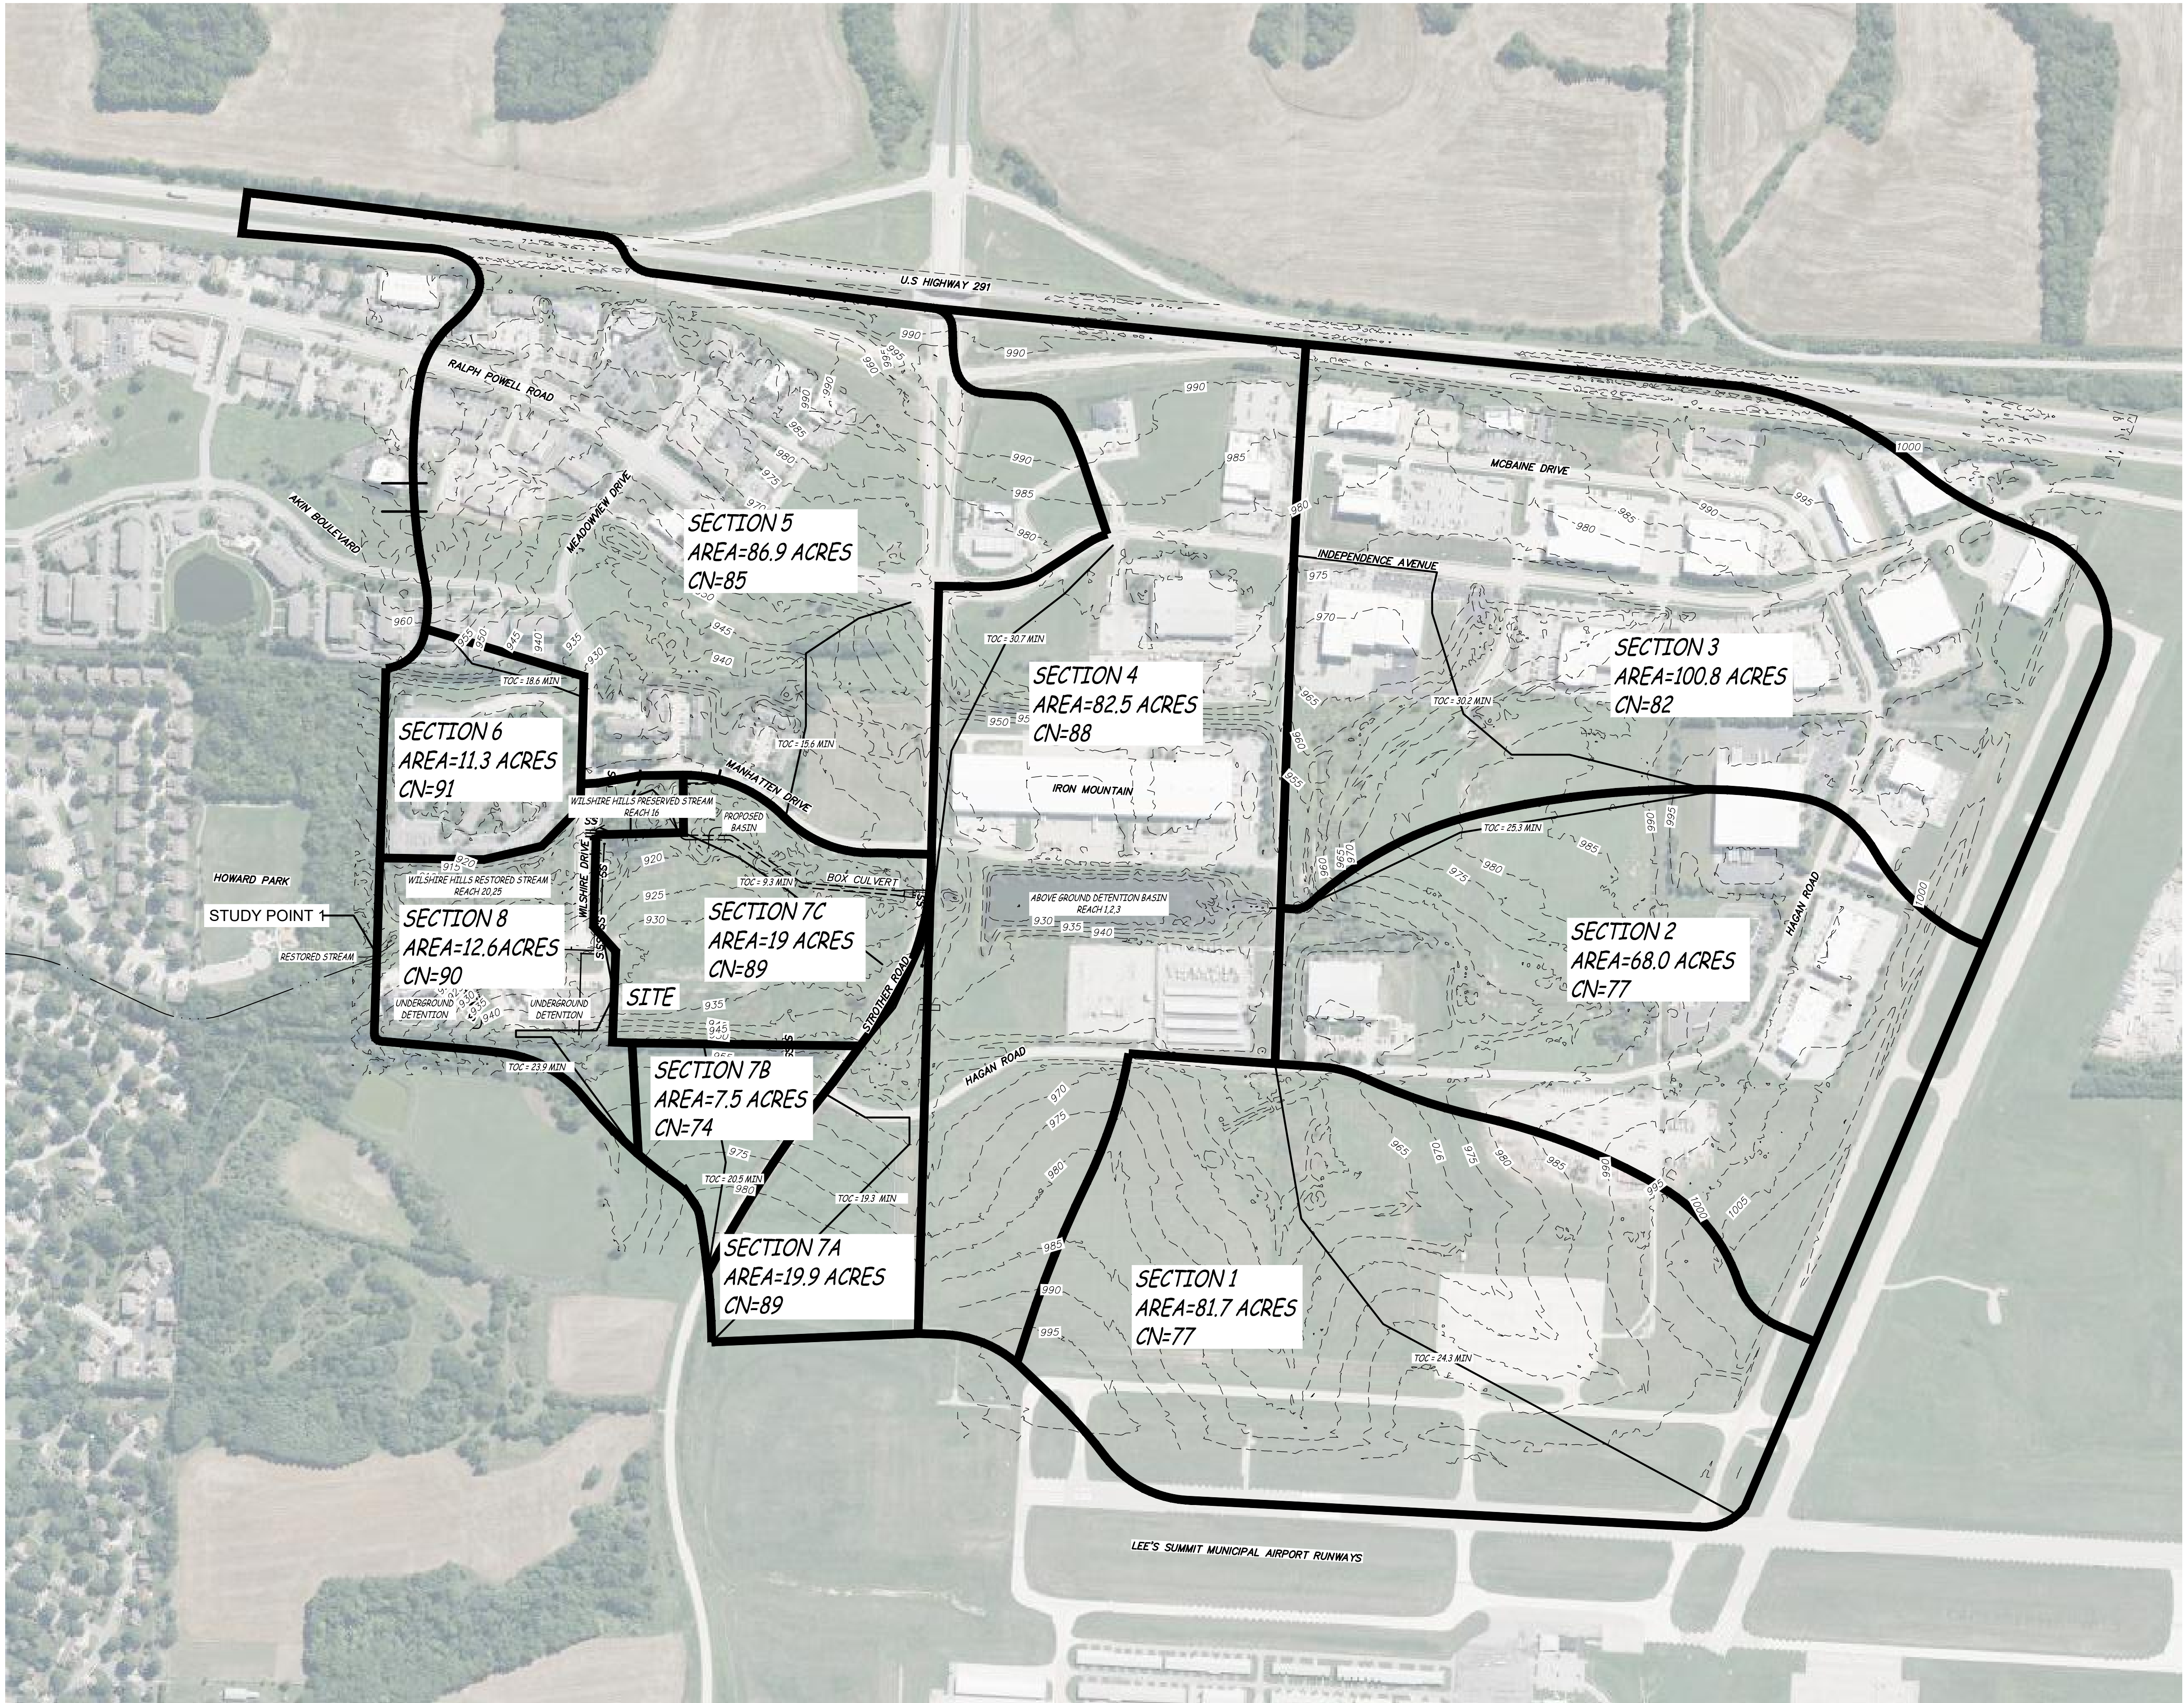

3000.0'± TO LAKEWOOD LAKE

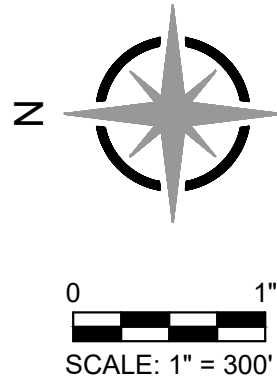

WILSHIRE HILLS PHASE III
STREET ADDRESS
LEE'S SUMMIT JACKSON COUNTY, MISSOURI



MATTHEW A. KRIETE
PROFESSIONAL ENGINEER
PE-2007002811

IF ORIGINAL SIGNATURE OR DIGITAL
AUTHENTICATION IS NOT PRESENT THIS
MEDIA SHOULD NOT BE CONSIDERED A
CERTIFIED DOCUMENT.

Date
NOVEMBER 28, 2023

Revised
(4) FEBRUARY 16, 2024

Design: ST Drawn: ST


POST DOWNSTREAM
ANALYSIS MAP

Sheet
C2.19

ES&S PROJECT NO. 15925


CONSTRUCTION DOCUMENTS

P:\GENERAL PROJECTS\15925E-WES-WILSHIRE-HILLS-3-ENG\CAD\15925 DAW.DWG 3/28/2024

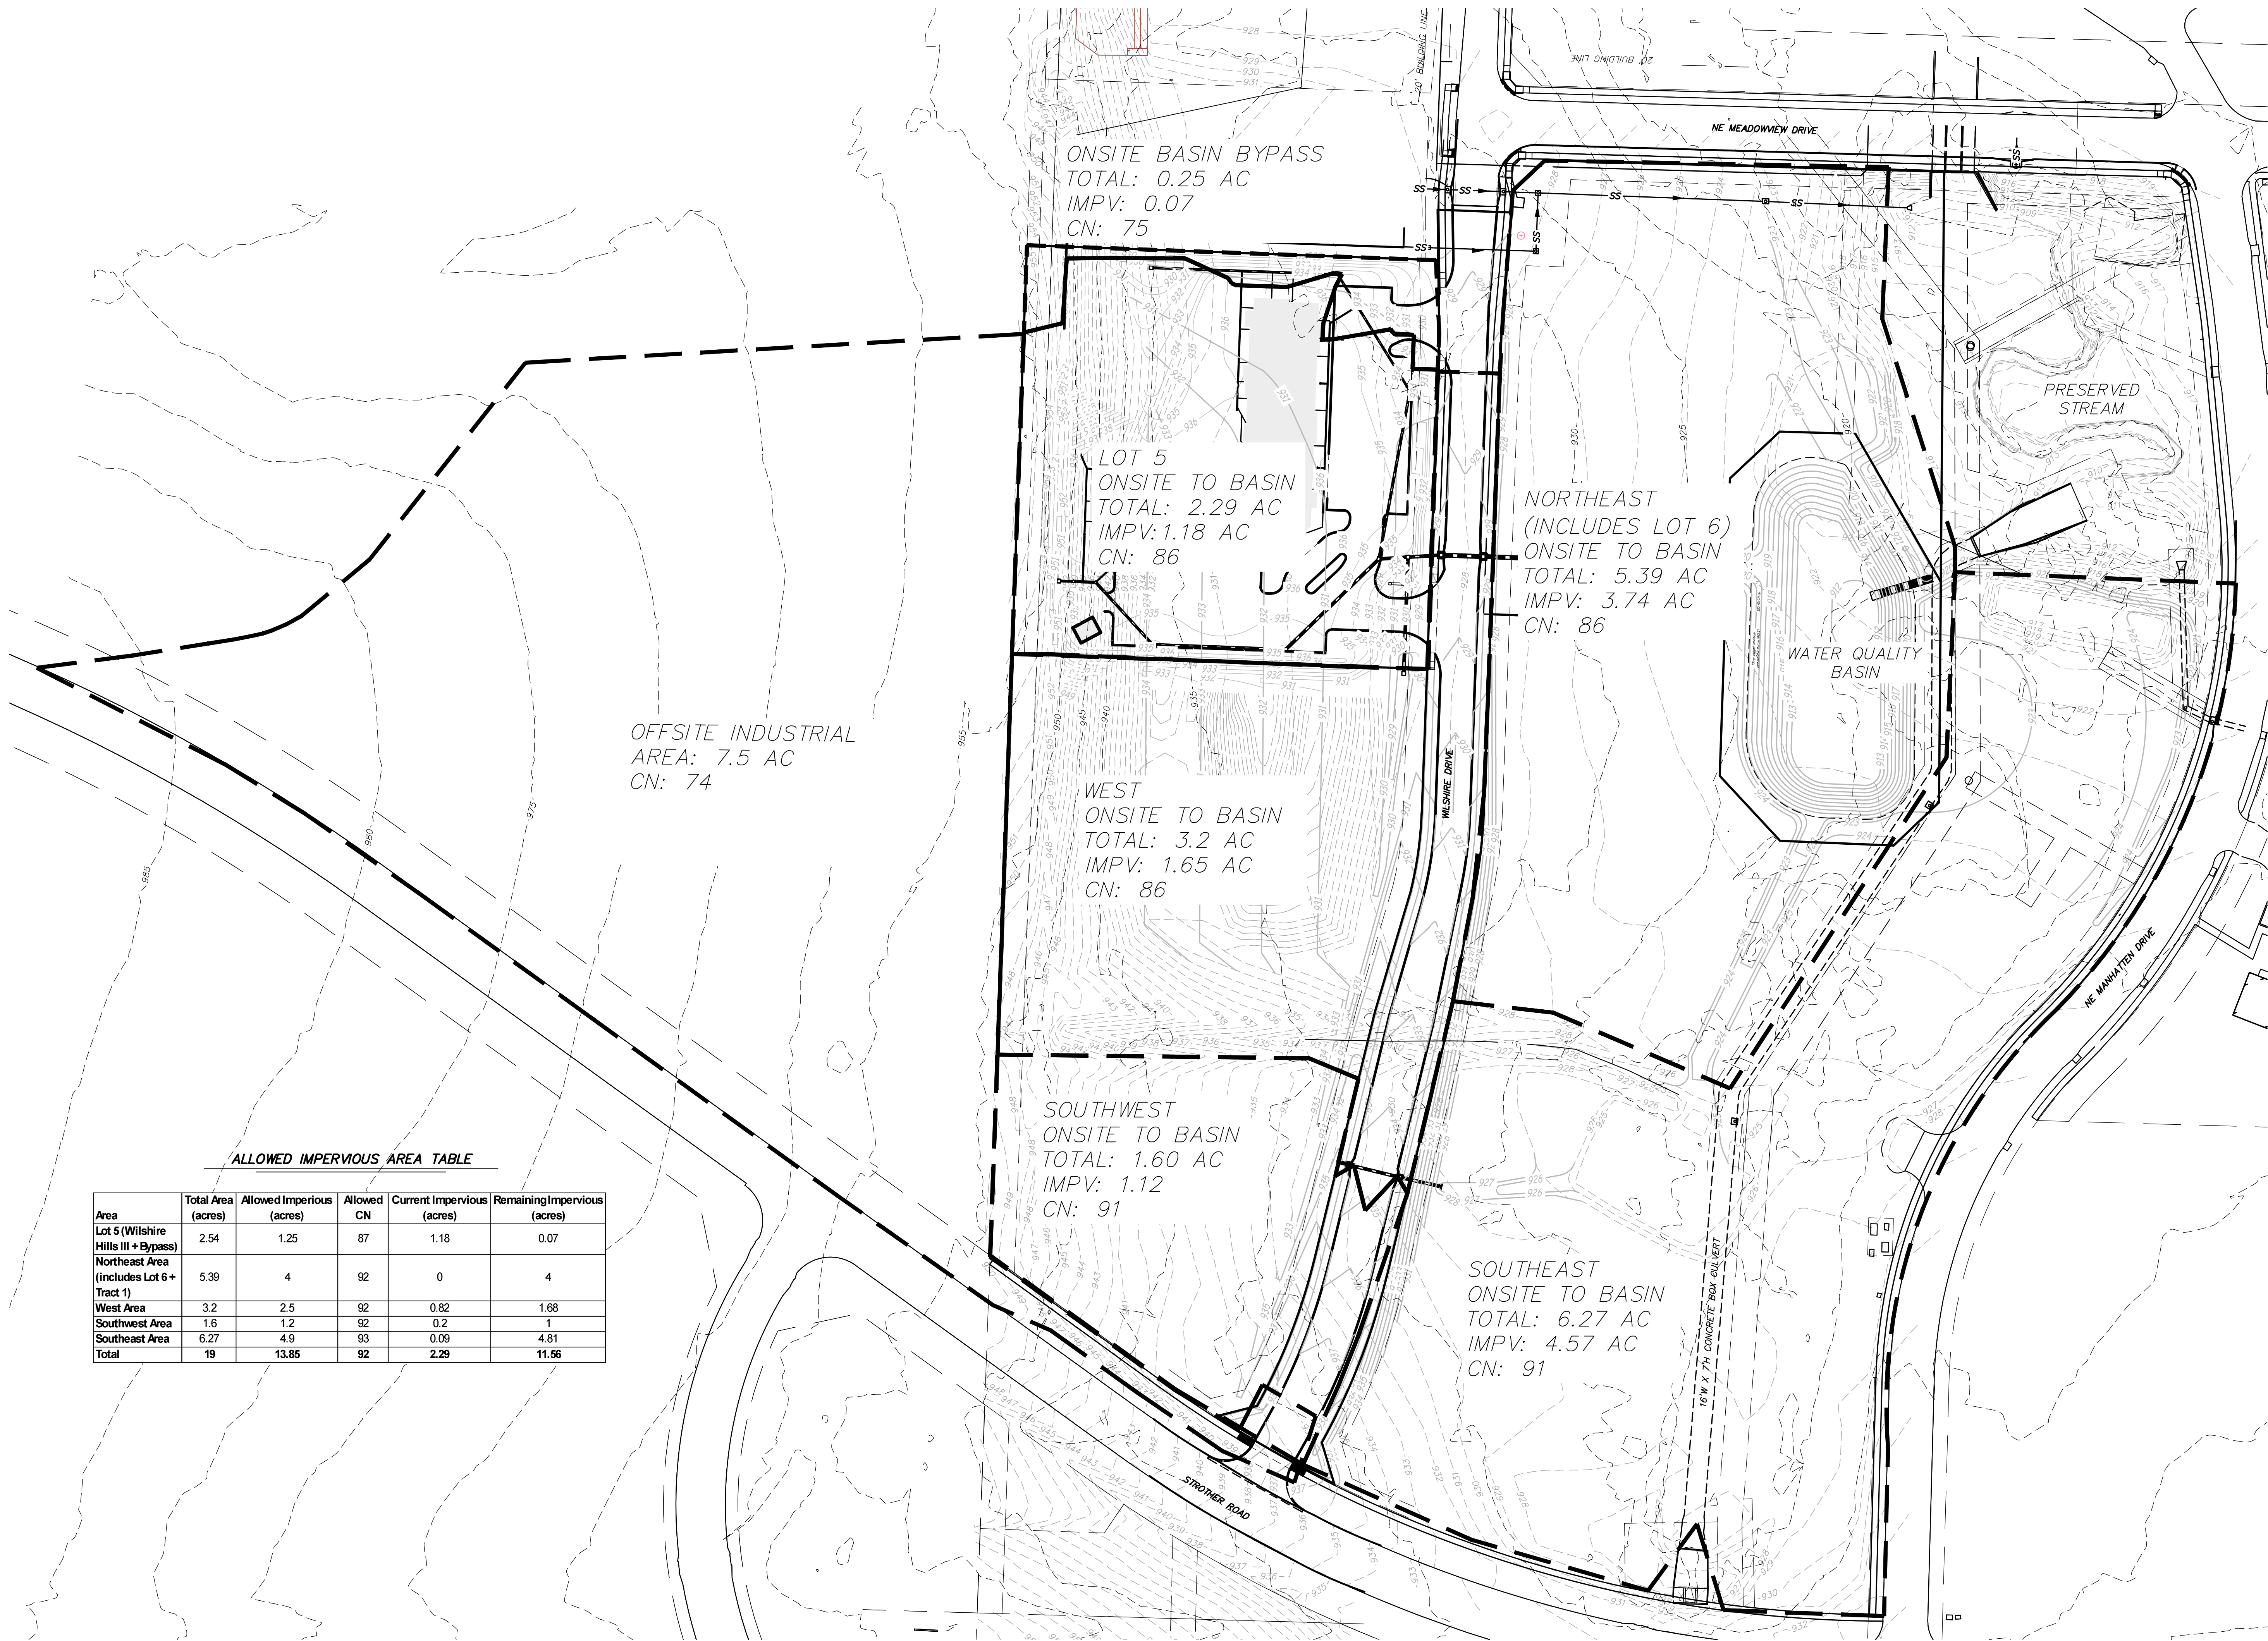

ALLOWED IMPERVIOUS AREA TABLE

Area	Total Area (acres)	Allowed Impervious (acres)	Allowed CN	Current Impervious (acres)	Remaining Impervious (acres)
Lot 5 (Wilshire Hills III + Bypass)	2.54	1.25	87	1.18	0.07
Northeast Area (includes Lot 6 + Tract 1)	5.39	4	92	0	4
West Area	3.2	2.5	92	0.82	1.68
Southwest Area	1.6	1.2	92	0.2	1
Southeast Area	6.27	4.9	93	0.09	4.81
Total	19	13.85	92	2.29	11.56

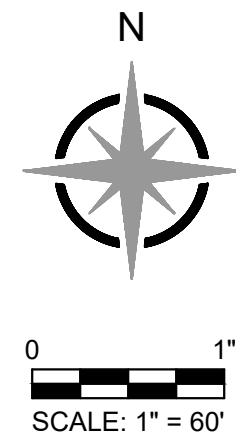

WILSHIRE HILLS PHASE III
3200 NE MANHATTAN DR
LEE'S SUMMIT JACKSON COUNTY, MISSOURI



MATTHEW A. KRIETE
PROFESSIONAL ENGINEER
PE-2007002811

IF ORIGINAL SIGNATURE OR DIGITAL
AUTHENTICATION IS NOT PRESENT THIS
MEDIA SHOULD NOT BE CONSIDERED A
CERTIFIED DOCUMENT.

Date
JUNE 30, 2023

Revised	
②	NOVEMBER 28, 2023
④	FEBRUARY 16, 2024
⑤	MARCH 27, 2024

Design: ST Drawn: ST



POST DEVELOPMENT
DRAINAGE AREA MAP

Sheet
C2.20

ES&S PROJECT NO. 15925


CONSTRUCTION DOCUMENTS

P:\GENERAL PROJECTS\15925E-ES-WILSHIRE-HILLS-3-ENG\CAD\15925 DAN.DWG 3/29/2024

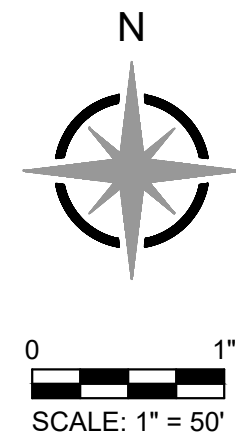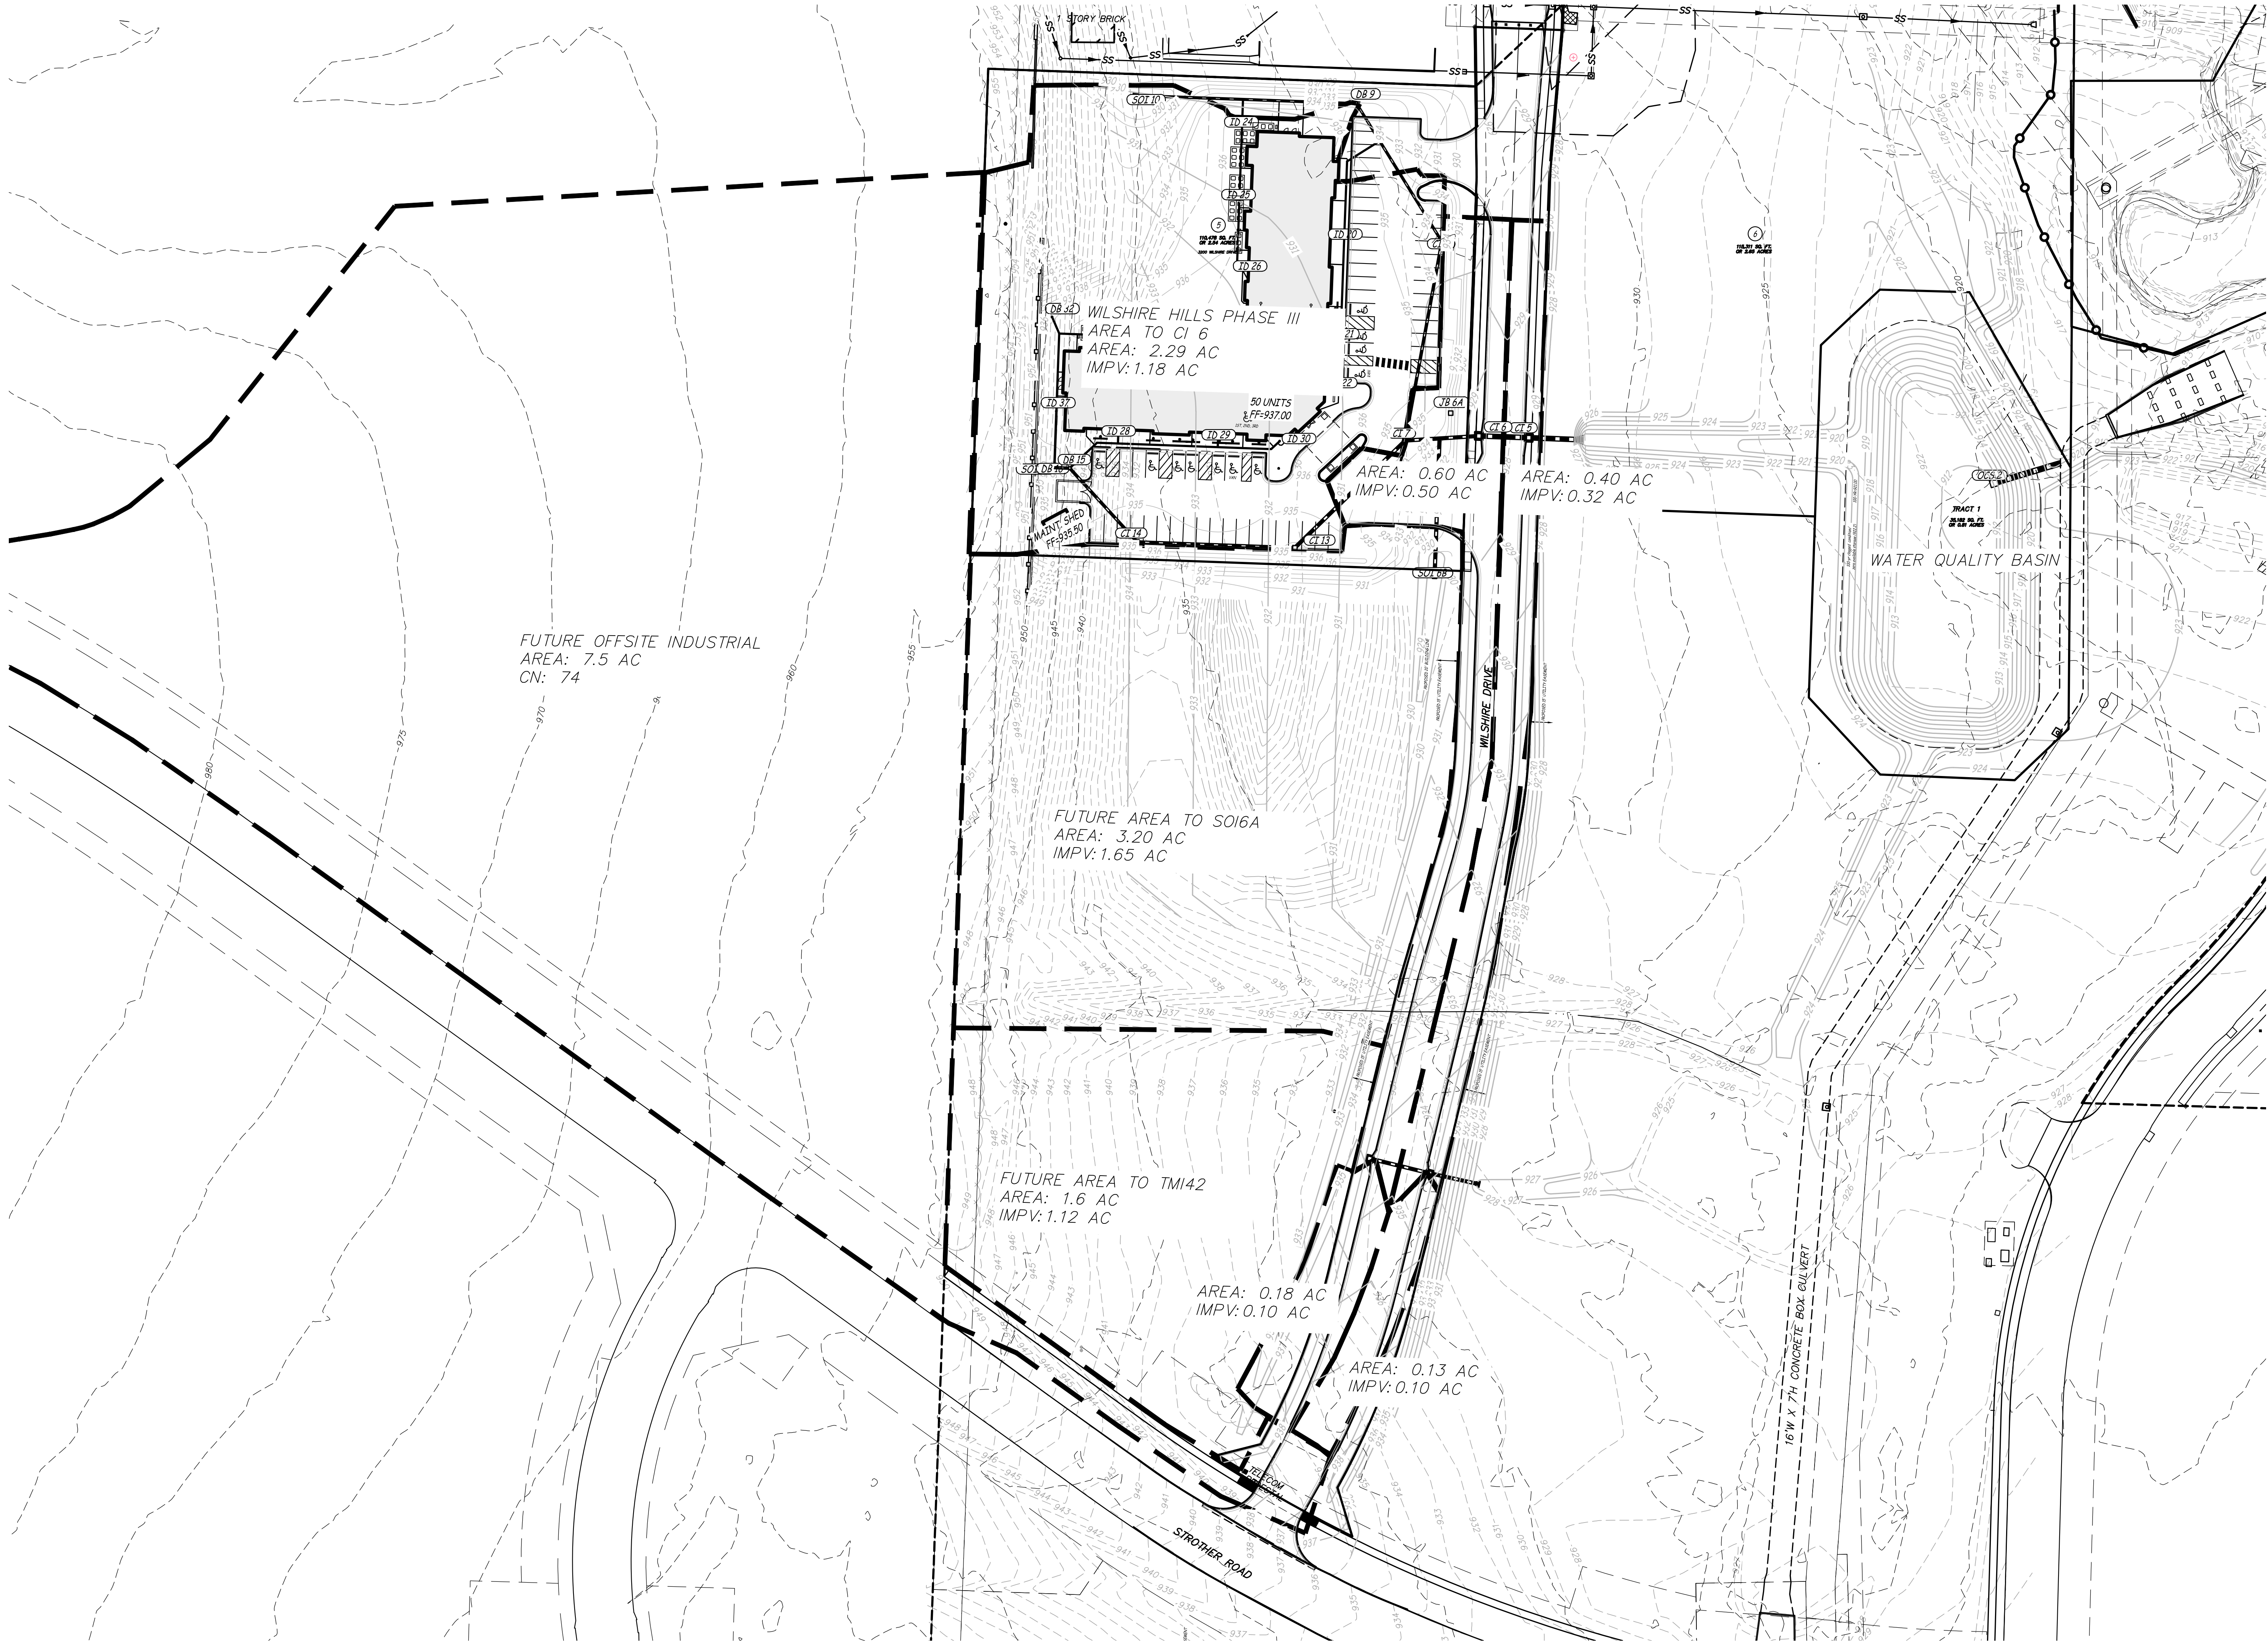

WILSHIRE HILLS PHASE III
3200 NE MANHATTAN DR
LEE'S SUMMIT JACKSON COUNTY, MISSOURI

3/27/2024

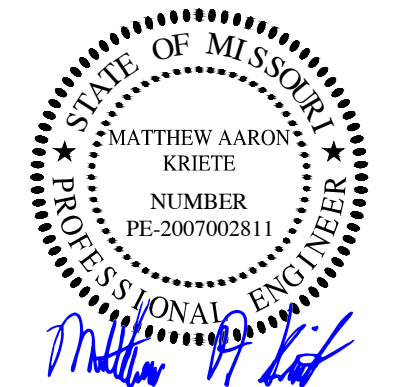

MATTHEW A. KRIETE
PROFESSIONAL ENGINEER
PE-200700281

IF ORIGINAL SIGNATURE OR DIGITAL
AUTHENTICATION IS NOT PRESENT THIS
MEDIA SHOULD NOT BE CONSIDERED A
CERTIFIED DOCUMENT

Date
JUNE 30, 2023

Revised
④ OCTOBER 12, 2023
④ FEBRUARY 16, 2024
④ MARCH 27, 2024

Design: ST Drawn: ST

STORM SEWER
DRAINAGE AREA MAP

Sheet
C2.21

CONSTRUCTION DOCUMENTS

ES&S PROJECT NO. 15925



Engineering Surveys & Services

DELIVERING YOUR VISION™

COLUMBIA ♦ JEFFERSON CITY ♦ SEDALIA