



#2001

610 NW CHIPMAN ROAD

LEE'S SUMMIT, MO 64086 PROPOSED LOT 3

PERMIT SET: 04/12/2024



#2001

610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3

PROTOTYPE VERSION 2.00



513 MAIN STREET #300
FORT WORTH TX 76102



PERMIT SET: 04/12/2024

CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DIMENSIONAL ERRORS. OMISSIONS OR DISCREPANCIES BEFORE BEGINNING OR FABRICATING ANY WORK. DO NOT SCALE DRAWINGS.

ISSUE DATE DESCRIPTION

PROJECT INFORMATION

PROJECT NO: 24-0087
ORIGINAL ISSUE: 04/12/2024
SCALE: AS NOTED
DRAWN BY: V. PEREZ
CHECKED BY: J. JEFFERY

SHEET TITLE

COVER SHEET

SHEET NUMBER


G001

SITE LOCATION MAP



PROJECT LOCATION

VICINITY MAP

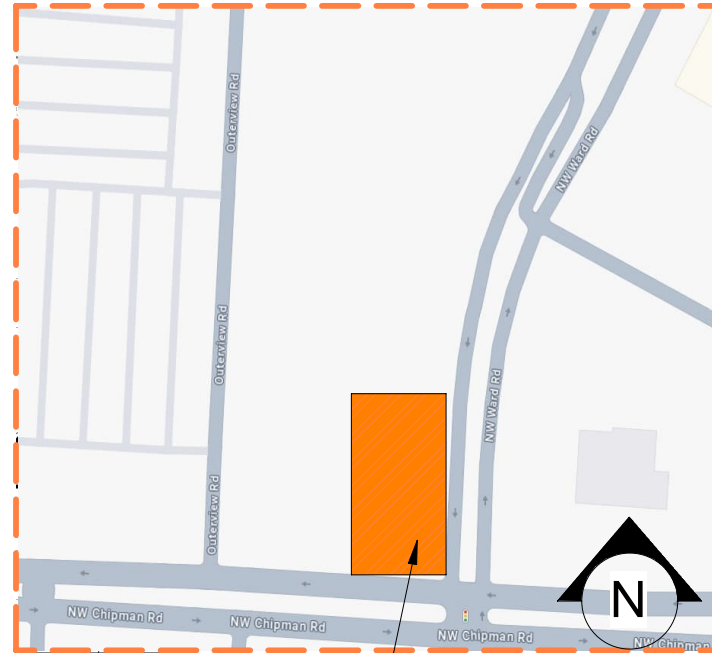

PROJECT LOCATION

SITE ANALYSIS & DATA

ZONING: C4
SITE AREA: .7 ACRES
MAX BUILDING HEIGHT: 20' - 2' FT
CONSTRUCTION TYPE: V-B
OCCUPANCY TYPE: BUSINESS 'B'
FIRE SPRINKLER: NOT REQUIRED
FIRE ALARM: NOT REQUIRED

BUILDING AREA: 1000 SQFT
AWNING AREA: 80 SQFT
DRIVE THRU CANOPY AREA: 60 SQFT
TOTAL COVERED AREA: 1140 SQFT

PROPOSED LOT COVERAGE: 30.7%

TOTAL PARKING: BUSINESS / RESTAURANT (14 SPACE/ 1000 SQFT*) = 14
*EXCLUDING COOLER & RESTROOMS

ACCESSIBLE SPACES: REQ: 1 SPACE 1 SPACES

NOTE: THERE IS NO OUTDOOR / INDOOR DINING AREA AVAILABLE AT THIS FACILITY

PROJECT DESCRIPTION

NEW CONSTRUCTION OF A DRIVE-THRU ONLY RESTAURANT (NO DINING SEATING)

BUILDING DATA

CALCULATED

OCCUPANT LOAD
BUSINESS AREAS (GROSS)
TOTAL OCCUPANT LOAD = (1000 SF / 150) = 6
*PER IBC 2018 1004.5 14

USABLE AREA
FOOD PREP AREA (NET) 530 SF
OFFICE (NET) 50 SF
TOTAL USABLE AREA = 580 SF

DEFERRED SUBMITTALS

- IRRIGATION
- SIGNAGE
- SPRINKLER

BID ALTERNATES

ROOF: 5" RIGID INSULATION ABOVE DECK WITH MEMBRANE.
ALTERNATE: SPRAY FOAM WITH BATT INSULATION BELOW DECK BETWEEN JOISTS.

BOTH VERSIONS SHOULD ACHIEVE THE SAME R-VALUE.

DECORATIVE SIGNAGE: DECORATIVE CUTLERY ON FACADE ARE TO BE BID SEPERATE. REF: A201.

CLEARANCE BARS: FOR DRIVE THRU AND MOBILE PICK-UP ARE TO BE BID SEPERATE. REF: AS004

APPLICABLE CODES

BUILDING CODE: 2018 International Building Code
PLUMBING CODE: 2018 International Plumbing Code
MECHANICAL CODE: 2018 International Mechanical Code
ELECTRICAL CODE: 2017 National Electric Code
ENERGY CODE: 2018 International Energy Code
FIRE CODE: 2018 International Fire Code
FUEL GAS CODE: 2018 International Fuel Gas Code
ACCESSIBILITY CODE: 2009 ICC/ANSI A117.1 Accessible and Usuable Buildings and Facilities

NOTE: ALL CODES WITH LOCAL AMENDMENTS AND SPECIAL INSPECTIONS
FLAME SPREAD CLASSIFICATION

PER IBC TABLE 805.13
INTERIOR WALL AND CEILING FINISH REQUIREMENTS BY OCCUPANCY

NON SPRINKLERED

GROUP	EXIT ENCLOSURE AND PASSAGE WAY	CORRIDORS	ROOMS AND ENCLOSED SPACES
B	N/A	N/A	C

PER IBC SECTION 803.1.2

CLASS A: FLAME SPREAD 0-25; SMOKE DEVELOPED 0-450
CLASS B: FLAME SPREAD 26-75; SMOKE DEVELOPED 0-450
CLASS C: FLAME SPREAD 76-200; SMOKE DEVELOPED 0-450

PROJECT DIRECTORY

OWNER	SALAD AND GO 5555 EAST VAN BUREN STREET, SUITE 215 PHOENIX, AZ 85008 CONTACT: ANDY HULSEY T: 410.371.1563 ANDY@SALADANDGO.COM
LANDLORD	AND GO CONCEPTS, LLC dba SALAD AND GO 5555 EAST VAN BUREN STREET, SUITE 215 PHOENIX, AZ 85008 CONTACT: ANDY HULSEY T: 410.371.1563 ANDY@SALADANDGO.COM
ARCHITECT	ARCHITECT ON RECORD STEVEN COX, ARCHITECT 513 MAIN STREET, STE 300 FORT WORTH, TX 76102 CONTACT: JOSEPH JEFFERY T: 817.820.0433
MECHANICAL	GEMINI ENGINEERING GROUP 101 NIGHTLINGER LN MILSAP, TX 76066 EOR: CLAYTON LUCAS T: 817.901.5191
ELECTRICAL	GEMINI ENGINEERING GROUP 101 NIGHTLINGER LN MILSAP, TX 76066 EOR: CLAYTON LUCAS T: 817.901.5191
STRUCTURAL	ELLISON GAGE & ASSOCIATES, PLLC 5068 W PLANO PARKWAY SUITE 200 PLANO, TX 75093 EOR: BRIAN KIRK ELLISON, PE, SE T: 972.354.8858
CIVIL	KIMLEY-HORN ANDREW GRIBBLE KIMLEY-HORN & ASSOCIATES, INC. 805 PENNSYLVANIA AVE, SUITE 150 KANSAS CITY, MO 64105 (816) 652-2333 ANDREW.GRIBBLE@KIMLEY-HORN.COM

DRAWING INDEX

SHEET	SHEET NAME	PERMIT					
			1	2	3	4	5
01 GENERAL							
G001	COVER SHEET	•					
G002	ACCESSIBILITY DETAILS	•					
G003	OCCUPANCY & LIFE SAFETY PLAN	•					
G004	SYMBOL, LEGENDS, & GENERAL NOTES	•					
G005	COMCHECK	•					
G006	RESPONSIBILITY MATRIX	•					

02 SITE							
AS001	ARCHITECTURAL SITE PLAN	•					
AS002	TRASH ENCLOSURE DETAILS	•					
AS003	SITE DETAILS	•					
AS004	SITE DETAILS	•					

04 ARCHITECTURAL							
A101	DIMENSION FLOOR PLANS	•					
A111	FLOOR PLANS	•					
A121	REFLECTED CEILING PLAN	•					
A131	ROOF PLAN	•					
A201	EXTERIOR ELEVATIONS	•					
A301	BUILDING SECTIONS	•					
A302	WALL SECTIONS	•					
A303	WALL SECTIONS	•					
A400	INTERIOR ELEVATIONS (WALL SHEATHING)	•					
A401	INTERIOR ELEVATIONS (KITCHEN)	•					
A402	INTERIOR ELEVATIONS (RESTROOM)	•					
A501	PLAN DETAILS	•					
A502	PLAN DETAILS	•					
A503	SECTION DETAILS	•					
A504	ROOF DETAILS	•					
A505	ROOF LADDER DETAILS	•					
A506	ELECTRIC PANEL DETAILS	•					
A611	INTERIOR PARTITION TYPES AND DETAILS	•					
A621	EXTERIOR PARTITION TYPES	•					
A631	DOOR SCHEDULE	•					
A641	WINDOW SCHEDULE	•					
A800	SPECIFICATIONS	•					
A801	SPECIFICATIONS	•					
A802	SPECIFICATIONS	•					
A803	SPECIFICATIONS	•					
A804	SPECIFICATIONS	•					
A805	SPECIFICATIONS	•					
A806	SPECIFICATIONS	•					
A807	SPECIFICATIONS	•					
A808	SPECIFICATIONS	•					
Q101	EQUIPMENT PLAN	•					

05 PLUMBING							
P101	PLUMBING LEGENDS AND NOTES	•					
P102	PLUMBING SCHEDULES	•					
P103	GREASE/SANITARY WASTE PLAN	•					
P104	DOMESTIC WATER PLAN	•					
P105	PLUMBING DETAILS	•					
P106	PLUMBING SPECIFICATIONS	•					

06 MECHANICAL							
M101	MECHANICAL LEGENDS AND NOTES	•					
M102	MECHANICAL SCHEDULES	•					
M103	MECHANICAL FLOOR PLANS	•					
M104	MECHANICAL DETAILS	•					
M105	MECHANICAL SPECIFICATIONS	•					
M106	MECHANICAL ENERGY FORMS	•					
M107	MECHANICAL ENERGY FORMS	•					

07 ELECTRICAL							
E101	ELECTRICAL LEGEND & NOTES	•					
E102	POWER FLOOR PLAN	•					
E103	LIGHTING FLOOR PLAN	•					
E104	LOW VOLTAGE PLAN	•					
E105	MECHANICAL POWER ROOF PLAN	•					
E106	ELECTRICAL SITE PLAN	•					
E107	PHOTOMETRIC PLAN	•					
E108	ELECTRICAL ELEVATIONS	•					
E109	ELECTRICAL DETAILS	•					
E110	ELECTRICAL ONE LINE DIAGRAM	•					
E111	ELECTRICAL SPECIFICATIONS	•					
E112	LIGHTING ENERGY FORMS	•					
E113	LIGHTING ENERGY FORMS	•					

GC TO LEAVE A COPY OF AS-BUILT DRAWINGS IN MANAGER'S OFFICE AT TURN OVER.











SUBMITTAL SCHEDULE

GC TO LEAVE A COPY OF AS-BUILT DRAWINGS IN MANAGER'S OFFICE AT TURN OVER.

SUBMITTAL SCHEDULE				REQUIRED APPROVALS		
GC TO LEAVE A COPY OF AS-BUILT DRAWINGS IN MANAGER'S OFFICE AT TURN OVER.				REVIEW/SUBMIT	APPROVE	COORDINATE
				GC	ARCHITECT	SAG PM
STATUS	ITEM	SPECIFICATION	TIMING			
DIGITAL SAMPLES		SEND (1) PHYSICAL COPY TO ARCHITECT AND SAG PM				
SHOP DRAWINGS AND SPECIFICATIONS		EMAIL PDF TO ARCHITECT AND SAG PM				
ARCHITECTURAL						
	CANOPY SHOP DRAWINGS		COORDINATE WITH LEAD TIME AND APPROVAL TIME	X	X	X
	STOREFRONT FIXED WINDOWS (if not installing specified window per drawings)		SUBMIT WITHIN 1 WEEK OF CONTRACT AWARD			
STRUCTURAL						
	STEEL PACKAGE		SUBMIT WITHIN 1 WEEK OF CONTRACT AWARD	X	X	
	TRUSSES		SUBMIT WITHIN 1 WEEK OF CONTRACT AWARD	X	X	
	CONCRETE FOUNDATION AND REBAR		SUBMIT WITHIN 1 WEEK OF CONTRACT AWARD	X	X	X
MEP						
	ELECTRICAL SWITCHGEAR/PANELS		SUBMIT WITHIN 1 WEEK OF CONTRACT AWARD	X	X	X
	HVAC EQUIPMENT (RTUs and Controls)		SUBMIT WITHIN 1 WEEK OF CONTRACT AWARD	X	X	X
	LIGHT FIXTURES (including Site Lighting)		SUBMIT WITHIN 1 WEEK OF CONTRACT AWARD	X	X	X
MISCELLANEOUS						
	DOOR HARDWARE		SUBMIT WITHIN 1 WEEK OF CONTRACT AWARD	X	X	X
MOCKUPS						
FINISHES		COORDINATE WITH PM				
	MOCKUP AREA OF EXTERIOR FINISHES FOR SAG/PM APPROVAL	SITE/AREA OF MOCKUP TO BE DETERMINE BY SAG PM	PRIOR TO PROCEEDING WITH INSTALLATION			X
ALL SUBMITTALS ARE TO BE CLEARLY MARKED TO INCLUDE THE PROJECT NAME, GENERAL CONTRACTOR NAME AND SUBCONTRACTOR INFORMATION. SAMPLES TO BE CLEARLY LABELLED TO REFERENCE THE MATERIAL CALLOUT FROM THE FINISH SCHEDULE OR APPLICABLE SPECIFICATION SECTION.						
NOTE: GC MUST REVIEW AND SIGN SUBMITTALS PRIOR TO SENDING TO ARCHITECT/ENGINEER FOR REVIEW. UNSIGNED SUBMITTALS WILL BE AUTOMATICALLY REJECTED. GC TO INCLUDE PRICES.						

ALL SUBMITTALS ARE TO BE CLEARLY MARKED TO INCLUDE THE PROJECT NAME, GENERAL CONTRACTOR NAME AND SUBCONTRACTOR INFORMATION. SAMPLES TO BE CLEARLY LABELLED TO REFERENCE THE MATERIAL CALLOUT FROM THE FINISH SCHEDULE OR APPLICABLE SPECIFICATION SECTION.

NOTE: GC MUST REVIEW AND SIGN SUBMITTALS PRIOR TO SENDING TO ARCHITECT/ENGINEER FOR REVIEW. UNSIGNED SUBMITTALS WILL BE AUTOMATICALLY REJECTED. GC TO INCLUDE PRICES.

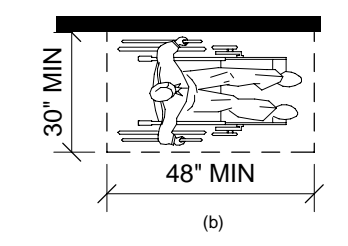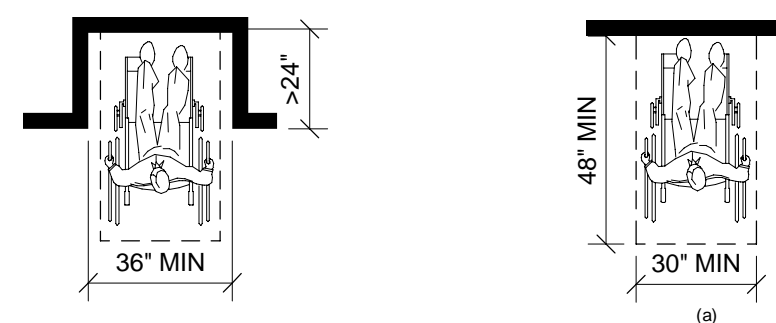

1. ALL ACCESSIBILITY DIAGRAMS ARE DESIGNED TO COMPLY WITH:
 - A. INTERNATIONAL BUILDING CODE STATED ON G001
 - B. 2009 ACCESSIBLE AND USUABLE BUILDINGS AND FACILITIES




CONTRACTOR SHALL VERIFY ALL
CONDITIONS AND DIMENSIONS AT THE
JOB SITE AND NOTIFY THE ARCHITECT
OF ANY DIMENSIONAL ERRORS,
OMISSIONS OR DISCREPANCIES BEFORE
BEGINNING OR FABRICATING ANY WORK
DO NOT SCALE DRAWINGS.

PROJECT INFORMATION	
PROJECT NO:	24-0087
ORIGINAL ISSUE:	06/01/2023
SCALE:	AS NOTED
DRAWN BY:	P. C.
CHECKED BY:	J. JEFFERY

ACCESSIBILITY DETAILS

G002



LIFE SAFETY		
<u>EXITS:</u>	<u>REQUIRED</u>	<u>PROVIDED</u>
	1 - PUBLIC	1-PUBLIC
EXIT WIDTH REQUIRED = 14 OCC X 0.2 = 2.8 IN. EXIT WIDTH PROVIDED = 42 IN.		
<u>EGRESS CALCULATION:</u>		
	MAXIMUM ALLOWABLE TRAVEL DISTANCE = 75 FT	
	MAXIMUM PROVIDED TRAVEL DISTANCE = 40 FT	
	*NON-SPRINKLERED	
	<u>FLAME SPREAD RATING:</u>	
	1. FLAME SPREAD RATING FOR ALL PROPOSED INTERIOR FINISHES SHALL COMPLY WITH LOCAL BUILDING CODE.	
	<u>INTERIOR FINISH NOTES:</u>	
	1. INTERIOR WALL AND CEILING FINISH MATERIALS SHALL BE CLASS C WITH FLAME SPREAD RATING LESS THAN 200 AND SMOKE DEVELOPED LESS THAN 450.	
	2. FLOOR COVERINGS INT HE EXIT PATH OF ALL COMMON AREAS SHALL MEET CLASS A REQUIREMENTS	
	<u>FURNISHING NOTES:</u>	
	1. HEIGHT OF COUNTERS SHALL BE 28" MINIMUM - 34" MAXIMUM AFF.	
	2. MANEUVERING CLEARANCE SHALL BE 30" X 52"	
	3. KNEE CLEARANCE SHALL BE 27" HIGH, 17" DEEP, AND 30" WIDE	
	<u>GENERAL NOTES, WHEN APPLICABLE:</u>	
	1. 67" DIAMETER CLEARANCE FOR WHEELCHAIR ACCESSIBILITY	
	2. FIRE EXTINGUISHER PLACED PER FIRE INSPECTOR'S REQUIREMENTS	

PROJECT R-VALUES	
COMPONENT	R-VALUE
ROOF INSUL.	30
WALLS CAVITY	21
WALLS CONT. INSUL.	4.5
FLOOR	N/A



COMcheck Software Version COMcheckWeb
Envelope Compliance Certificate

Project Information		
Energy Code:	2018 IECC	
Project Title:	2001 Chipman and NW Ward - Lee's Summit MO	
Location:	Lees Summit, Missouri	
Climate Zone:	4a	
Project Type:	New Construction	
Vertical Glazing / Wall Area:	6%	
Construction Site:	Owner/Agent:	Designer/Contractor:
NW Chipman and NW Ward Lee's Summit, Missouri	Andy Hulsey Salad and Go 5555 East Van Buren Street Phoenix, Arizona 85008 410-371-1563 Andy@SaladandGo.com	Steven Cox Rogue Architects 513 Main Street Fort Worth, Texas 76102 817-820-0433 Joseph@Roguearchitects.com

Additional Efficiency Package(s)
Credits: 1.0 Required 1.0 Proposed
Enhanced Interior Lighting Controls, 1.0 credit

Building Area	Floor Area
1-Dining: Cafeteria/Fast Food : Nonresidential	1000

Envelope Assemblies					
Assembly	Gross Area or Perimeter	Cavity R-Value	Cont. R-Value	Proposed U-Factor	Budget U-Factor _(a)
Roof: Insulation Entirely Above Deck, [Bldg. Use 1 - Dining: Cafeteria/Fast Food]	900	---	30.0	0.032	0.032
Floor: Unheated Slab-On-Grade, [Bldg. Use 1 - Dining: Cafeteria/Fast Food] (c)	130	---	---	0.730	0.540
NORTH					
Ext. Wall: Wood-Framed, 16in. o.c., [Bldg. Use 1 - Dining: Cafeteria/Fast Food]	355	21.0	4.5	0.046	0.064
Window: Metal Frame: Fixed, Perf. Specs.: Product ID N/A, SHGC 0.48, PF 0.13, [Bldg. Use 1 - Dining: Cafeteria/Fast Food] (b)	65	---	---	0.380	0.380
Window: Metal Frame: Operable, Perf. Specs.: Product ID N/A, SHGC 0.48, [Bldg. Use 1 - Dining: Cafeteria/Fast Food] (b)	15	---	---	0.450	0.450
EAST					
Ext. Wall: Wood-Framed, 16in. o.c., [Bldg. Use 1 - Dining: Cafeteria/Fast Food]	687	21.0	4.5	0.046	0.064
Window: Metal Frame: Fixed, Perf. Specs.: Product ID N/A, SHGC 0.36, PF 1.33, [Bldg. Use 1 - Dining: Cafeteria/Fast Food] (b)	15	---	---	0.380	0.380
Window: Metal Frame: Operable, Perf. Specs.: Product ID N/A, SHGC 0.36, PF 0.60, [Bldg. Use 1 - Dining: Cafeteria/Fast Food] (b)	15	---	---	0.450	0.450
SOUTH					
Ext. Wall: Wood-Framed, 16in. o.c., [Bldg. Use 1 - Dining: Cafeteria/Fast Food]	256	21.0	4.5	0.046	0.064

Project Title: 2001 Chipman and NW Ward - Lee's Summit MO Report date: 03/27/24
Data filename: Page 1 of 9

Assembly	Gross Area or Perimeter	Cavity R-Value	Cont. R-Value	Proposed U-Factor	Budget U-Factor _(a)
WEST					
Ext. Wall: Wood-Framed, 16in. o.c., [Bldg. Use 1 - Dining: Cafeteria/Fast Food]	698	21.0	4.5	0.046	0.064
Window: Metal Frame: Fixed, Perf. Specs.: Product ID N/A, SHGC 0.36, PF 0.64, [Bldg. Use 1 - Dining: Cafeteria/Fast Food] (b)	15	---	---	0.380	0.380
Door: Uninsulated Single-Layer Metal, Swinging, [Bldg. Use 1 - Dining: Cafeteria/Fast Food]	28	---	---	0.610	0.610

(a) Budget U-factors are used for software baseline calculations ONLY, and are not code requirements.
(b) Fenestration product performance must be certified in accordance with NFRC and requires supporting documentation.
(c) Slab-On-Grade proposed and budget U-factors shown in table are F-factors.

Envelope PASSES: Design 3% better than code

Envelope Compliance Statement
Compliance Statement: The proposed envelope design represented in this document is consistent with the building plans, specifications, and other calculations submitted with this permit application. The proposed envelope systems have been designed to meet the 2018 IECC requirements in COMcheck Version COMcheckWeb and to comply with any applicable mandatory requirements listed in the Inspection Checklist.

Steven Cox - Senior Project Manager

Signature

04.10.24

Date

Project Title: 2001 Chipman and NW Ward - Lee's Summit MO Report date: 03/27/24
Data filename: Page 2 of 9



#2001

610 NW CHIPMAN ROAD

LEE'S SUMMIT, MO 64086 PROPOSED LOT 3

PROTOTYPE VERSION 2.00



513 MAIN STREET #300
FORT WORTH TX 76102

SEAL



PERMIT SET: 04/12/2024

CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DIMENSIONAL ERRORS. OMISSIONS OR DISCREPANCIES BEFORE BEGINNING OR FABRICATING ANY WORK. DO NOT SCALE DRAWINGS.

ISSUE	DATE	DESCRIPTION

PROJECT INFORMATION	
PROJECT NO:	24-0087
ORIGINAL ISSUE:	06/01/2023
SCALE:	AS NOTED
DRAWN BY:	P. C
CHECKED BY:	J. JEFFERY

SHEET TITLE

COMCHECK

SHEET NUMBER

G005

RESPONSIBILITY MATRIX

REVISION DATE: 2024.03.25

THIS SCHEDULE IS PROVIDED FOR QUICK REFERENCE ONLY.
THE GENERAL CONTRACTOR IS RESPONSIBLE FOR ALL WORK DESCRIBED IN THE CONSTRUCTION DOCUMENTS.
CONFLICTS BETWEEN THIS SCHEDULE AND THE REST OF THE CONTRACT DOCUMENTS SHALL BE BROUGHT TO THE ARCHITECT'S ATTENTION PRIOR TO BEGINNING WORK.

DESCRIPTION	FURNISHED			INSTALLED			REMARKS
	GENERAL CONTRACTOR	OWNER	LANDLORD	GENERAL CONTRACTOR	OWNER	LANDLORD	
DIVISION 01: GENERAL REQUIREMENTS							
1.1 PERMITS AND FEES							
1.1.1 PERMIT FEES		•		•			GENERAL CONTRACTOR TO PULL PERMITS FOR THE BUILDING, DEMO, MECHANICAL, ELECTRICAL, PLUMBING, HEALTH AND/OR ENVIRONMENT AS REQUIRED BY AHJ - GC TO COORDINATE WITH SALAD AND GO PRECONSTRUCTION MANAGER
1.1.2 OTHER PERMITS AND FEES	•			•			GENERAL CONTRACTOR TO SECURE AND PAY FOR OTHER REQUIRED PERMITS AND FEES NOT NOTED IN LINE ITEM 1.1.1 E.G. DUST CONTROL
1.2 TEMPORARY UTILITIES	•			•			
1.3 TEMPORARY BARRICADES OR SITE FENCING	•			•			
1.3.1 BARRICADE GRAPHICS	•			•			SALAD AND GO TO PROVIDE SALAD AND GO BRANDED GRAPHICS/SIGNAGE (OFCI) - GC TO PROVIDE AHJ REQUIRED SIGNAGE
1.4 CONSTRUCTION DUMPSTERS AND TRASH BINS	•			•			GENERAL CONTRACTOR TO COORDINATE WITH LANDLORD, WASTE MANAGEMENT, CITY AND COUNTY
1.5 FINAL CLEANING	•			•			SITE TO BE PROFESSIONALLY CLEANED PRIOR TO STOCKING, TRAINING AND OPENING
1.6 CERTIFICATE OF OCCUPANCY	•			•			TO INCLUDE BUILDING, FIRE AND HEALTH INSPECTIONS - ALL REQUIRED BY AHJ
1.7 SITE PREPARATION FOR NEW PAD	•			•			
DIVISION 02: EXISTING CONDITIONS							
2.1 DEMOLITION	•			•			
DIVISION 03: CONCRETE							
3.1 CONCRETE SLAB AND FOUNDATION	•			•			REFER TO STRUCTURAL DRAWINGS AND ARCHITECTURALS FOR ADDITIONAL INFORMATION
3.2 CONCRETE CUTTING AND CORING	•			•			
DIVISION 04: MASONRY							
4.1 MASONRY AND STUCCO	•			•			
DIVISION 05: METALS							
5.1 STRUCTURAL STEEL	•			•			SCOPE OF WORK INCLUDES ROOF AND WALL PENETRATIONS
5.2 CLEARANCE BARS	•			•			VENDOR NO. 22
5.3 ROOF LADDER AND HATCH	•			•			
5.4 FRAMING	•			•			
5.5 REVEALS AND TRIMS	•			•			
5.6 UNISTRUT, THREADED ROD	•			•			
5.7 RAILINGS	•			•			
5.8 STRUCTURAL FRAMING	•			•			SCOPE OF WORK TO INCLUDE REINFORCEMENT IN ROOF PENETRATIONS
5.9 CANOPIES AND AWNINGS							
5.9.1 DRIVE THRU CANOPY	•			•			
5.9.2 AWNINGS	•			•			
DIVISION 06: WOOD, PLASTICS AND COMPOSITES							
6.1 FINISH CARPENTRY							
6.1.1 MANAGERS DESK & LAMINATE	•			•			
DIVISION 07: THERMAL AND MOISTURE PROTECTION							
7.1 INSULATION	•			•			
7.2 ROOF PENETRATIONS	•			•			
7.3 PRE-FINISHED PARAPET COPING	•			•			
7.4 SEALANTS AND CAULKING	•			•			
7.5 EXTERIOR INSULATION AND FINISH SYSTEM (EIFS)	•			•			
DIVISION 08: OPENINGS							
8.1 DOORS AND FRAMES	•			•			INCLUDES PEEPHOLES
8.2 STOREFRONT SYSTEMS	•			•			
8.3 DOOR HARDWARE	•			•			
8.4 DRIVE THRU WINDOWS	•			•			GENERAL CONTRACTOR TO PURCHASE FROM VENDOR NO. 9
DIVISION 09: FINISHES							
9.1 GYPSUM WALLBOARD AND ACCESSORIES	•			•			
9.2 PLYWOOD WALLBOARD	•			•			
9.3 CEMENT BOARD	•			•			
9.4 SUSPENDED "T" BAR LAY-IN CEILING	•			•			
9.5 EXTERIOR CLADDING	•			•			
9.6 FLOORING							
9.6.1 TILE FLOORING AND COVE BASE	•			•			GENERAL CONTRACTOR TO PURCHASE FROM VENDOR NO. 4 VENDOR SUBSTITUTION IS NOT PERMITTED
9.6.2 THRESHOLDS	•			•			
9.6.3 REDUCERS	•			•			
9.6.4 WALK-IN COOLER AND FREEZER TILE	•			•			ALL TILE TO BE INSTALLED PRIOR TO INSTALLATION OF COOLER, GC TO MAKE FINAL ELECTRICAL CONNECTION
9.7 PAINT	•			•			GENERAL CONTRACTOR TO UTILIZE NATIONAL ACCOUNT VENDOR NO. 23
DIVISION 10: SPECIALTIES							
10.1 IDENTIFICATION DEVICES							
10.1.1 EXTERIOR MOUNTED BUILDING SIGNAGE		•		•			GENERAL CONTRACTOR TO COORDINATE AND REVIEW SIGN PACKAGE WITH VENDOR NO. 20 (A OR B DEPENDING ON MARKET) FOR ADDITIONAL SCOPE OF WORK (E.G. PROVIDING POWER AND BLOCKING)
10.1.2 TACTILE SIGNAGE	•			•			
10.1.3 SERVICE DOOR IDENTIFICATION	•			•			
10.1.4 ACCESSIBILITY AND MISCELLANEOUS RESTROOM SIGNAGE	•			•			
10.1.5 BAND LETTERS (CANOPY)		•		•			GENERAL CONTRACTOR TO COORDINATE AND REVIEW SIGN PACKAGE WITH VENDOR NO. 20 (A OR B DEPENDING ON MARKET) FOR ADDITIONAL SCOPE OF WORK (E.G. PROVIDING POWER, BLOCKING, AND SUPPORT)
10.1.6 MENU BOARD		•		•			GENERAL CONTRACTOR TO COORDINATE WITH VENDOR NO. 15 FOR ADDITIONAL SCOPE OF WORK (E.G. PROVIDING BLOCKING), POWER, DATA CONSULT
10.1.7 MENU BOARD PAD/ISLAND & FOOTING W/ ANCHOR BOLTS	•			•			GENERAL CONTRACTOR TO INSTALL PER DRAWINGS AND CONFIRM LOCATION WITH SAG PM AND CONFIRM BOLT SIZE AND PATTERN NEEDED, ANCHOR BOLTS ARE OFCI
10.1.8 CLEARANCE BARS	•	•		•			GENERAL CONTRACTOR TO INSTALL PER DRAWINGS AND CONFIRM LOCATION WITH SAG PM AND CONFIRM BOLT SIZE AND PATTERN NEEDED, ANCHOR BOLTS ARE OFCI
10.2 FIRE PROTECTION DEVICES							
10.2.1 FIRE EXTINGUISHERS AND HANGING HARDWARE	•			•			GENERAL CONTRACTOR TO COORDINATE WITH THE FIRE DEPARTMENT, NO CABINET
10.2.2 RISER ROOM IDENTIFICATION	•			•			GENERAL CONTRACTOR TO COORDINATE WITH THE FIRE DEPARTMENT
10.2.3 KNOX BOX	•			•			GENERAL CONTRACTOR TO COORDINATE WITH THE FIRE DEPARTMENT
10.3 TOILET ROOMS							
10.3.1 TOILET ROOM ACCESSORIES	•			•			REFER TO RR ACCESSORIES SCHEDULE FOR OFCI ITEMS
10.3.2 TOILET ROOM HARDWARE	•			•			SUPPLIED BY VENDOR NO. 18
10.4 KITCHEN DISPLAY SYSTEM (KDS) MOUNTS	•	•		•	•		
10.5 OFFICE SAFE		•		•			VENDOR NO. 14
10.6 FIBERGLASS REINFORCED PLASTIC (FRP) PANELS AND ACCESSORIES	•			•			
10.7 STAINLESS STEEL KITCHEN CORNER GUARDS AND END CAPS	•			•			
10.8 CHEMICAL DISPENSING	•	•		•	•		VENDOR NO. 7

DESCRIPTION	FURNISHED			INSTALLED			REMARKS
	GENERAL CONTRACTOR	OWNER	LANDLORD	GENERAL CONTRACTOR	OWNER	LANDLORD	
DIVISION 11: EQUIPMENT							
11.1 FOOD SERVICE EQUIPMENT		•		•	•		SUPPLIED BY VENDOR NO. 17 GENERAL CONTRACTOR SCOPE OF WORK TO INCLUDE FINAL UTILITY CONNECTIONS, REFER TO KITCHEN EQUIPMENT SCHEDULE FOR CLARIFICATION
11.2 FOOD SERVICE EQUIPMENT STARTUP	•			•			GENERAL CONTRACTOR RESPONSIBLE FOR INSTALLATION, FINAL CONNECTION, AND STARTUP OF ALL KITCHEN EQUIPMENT WITH THE EXCEPTION OF W/B AND STOCKING, REFER TO KITCHEN EQUIPMENT SCHEDULE FOR CLARIFICATION
11.3 STAINLESS STEEL FABRICATED COUNTERS AND SHELVING		•		•	•		SUPPLIED BY VENDOR NO. 17. GENERAL CONTRACTOR TO COORDINATE DELIVERY AND INSTALL, REFER TO KITCHEN EQUIPMENT SCHEDULE FOR CLARIFICATION
11.4 STORAGE RACKS AND SHELVING		•		•			GENERAL CONTRACTOR TO COORDINATE WITH VENDOR NO. 17 FOR ADDITIONAL SCOPE OF WORK (E.G. PROVIDING BLOCKING), REFER TO KITCHEN EQUIPMENT SCHEDULE FOR CLARIFICATION
DIVISION 12: FURNISHINGS							
12.1 NON-PERISHABLE DELIVERY #1		•		•			INCLUDING BUT NOT LIMITED TO: HAIR NET HOLDER, MAGNETIC KNIFE HOLDER, SOAP DISPENSERS, CLEAR FILE HOLDER, FIRST AID KIT, ICE SCOOPS, ETC.
12.1.1 PAPER TOWEL DISPENSERS	•			•			GC TO PROCURE AND INSTALL ALL PAPER TOWEL DISPENSERS, ONE PER HANDWASH SINK. CONFIRM QUANTITY WITH SAG PM. SPEC FROM AMAZON: SAN JAMAR 11190TBK, OCEANS, BLACK PEARL, 12 1516 x 9 1/4 x 16 1/2
12.2 OFFICE SUPPLIES		•			•		VENDOR NO. 25
12.3 WALL MOUNT COAT RACK		•			•		GENERAL CONTRACTOR TO INSTALL OFCI, PROVIDED WITH OFFICE SUPPLIES VENDOR NO. 25
12.4 INTERIOR TRASH RECEPTACLES		•			•		SUPPLIED AND INSTALLED BY VENDOR NO. 17
12.5 EMPLOYEE STORAGE		•					
DIVISION 13: SPECIAL CONSTRUCTION							
13.1 WALK-IN COOLER		•			•		GENERAL CONTRACTOR TO COORDINATE INSTALLATION DETAILS WITH VENDOR NO. 17 AND PM
DIVISION 21: FIRE SUPPRESSION							
21.1 FIRE SUPPRESSION IDENTIFICATION							
21.1.1 PIPING SYSTEM IDENTIFICATION	•			•			
21.1.2 VALVE TAGS	•			•			
21.2 SPRINKLER STANDPIPE	•			•			AS REQUIRED BY AHJ
21.2.1 BACKFLOW PREVENTER	•			•			AS REQUIRED BY AHJ
21.2.2 ISOLATION VALVE	•			•			AS REQUIRED BY AHJ
21.3 AUTOMATIC SPRINKLER SYSTEM							AS REQUIRED BY AHJ
21.3.1 SYSTEM ENGINEERING (E.G. STAMPED PLANS AND CALCULATIONS)	•			•			AS REQUIRED BY AHJ
21.3.2 SPRINKLER COVERAGE	•			•			AS REQUIRED BY AHJ
21.3.3 SPRINKLER GRID APPURTENANCES (E.G. AIR VALVES AND DRAINS)	•			•			AS REQUIRED BY AHJ
DIVISION 22: PLUMBING							
22.1 PLUMBING IDENTIFICATION							
22.1.1 PIPING SYSTEM IDENTIFICATION	•			•			MATERIAL TO CONSIST OF 2" VINYL LETTERING, UNLESS OTHERWISE NOTED IN SPECIFICATIONS
22.1.2 UTILITY SHUT OFF IDENTIFICATION IN KITCHEN	•			•			MATERIAL TO CONSIST OF 2" VINYL RED LETTERING, UNLESS OTHERWISE NOTED IN SPECIFICATIONS
22.1.3 VALVE TAGS AND CHART	•			•			
22.2 DRAINS AND CLEANOUTS							
22.2.1 DRAINS AND FLOOR SINKS	•			•			
22.2.2 THROUGH DRAIN FOR ICE MACHINE	•			•			REFER TO KITCHEN AND PLUMBING SHEET FOR SPECIFICATIONS
22.3 PIPING SYSTEMS AND SPECIALTIES							
22.3.1 STORM DRAINAGE	•			•			
22.3.2 STORM DETENTION SYSTEM	•			•			REFER TO CONTRACT, PURCHASED BY GC UNLESS LEAD TIME PROHIBITS IN WHICH SALAD AND GO PURCHASES DIRECTLY FROM VENDOR NO. 6
22.3.3 DOMESTIC WATER	•			•			
22.3.4 GREASE WASTE	•			•			
22.3.5 CONDENSATE	•			•			
22.3.6 VENT	•			•			
22.3.7 SANITARY WASTE	•			•			
22.3.8 PIPING FITTINGS	•			•			
22.3.9 VALVES AND SHUT OFF VALVES	•			•			
22.3.10 WATER BOOSTER PUMP	•			•			AS REQUIRED BY AHJ
22.3.11 GREASE INTERCEPTOR	•			•			
22.4 INCOMING WATER FILTER SYSTEM	•						GENERAL CONTRACTOR TO FURNISH AND INSTALL 1 4"x10" CANISTER FILTER HOUSING WITH 30 MICRON SEDIMENT FILTER. SPEC: HOUSING: GXWH35F, FILTER: FXHSC, COORDINATE WITH PLANS AND SAG PM FOR LOCATION
22.5 WATER HEATER	•			•			GENERAL CONTRACTOR TO PURCHASE FROM NATIONAL ACCOUNT VENDOR NO. 13
22.6 MOP SINK							
22.6.1 FLOOR MOUNTED MOP SINK	•			•			REFER TO KITCHEN AND PLUMBING SHEET FOR SPECIFICATION
22.6.2 SERVICE FAUCET FOR MOP SINK	•			•			
22.7 PLUMBING FIXTURES							
22.7.1 TOILETS, URINAL, AND LAVATORIES	•			•			GENERAL CONTRACTOR SCOPE OF WORK TO INCLUDE ALL NECESSARY FITTINGS (E.G. FLUSH VALVES, FAUCETS, AND FITTINGS)
22.7.2 KITCHEN FAUCETS	•	•		•			GENERAL CONTRACTOR SCOPE OF WORK TO INCLUDE FINAL UTILITY CONNECTIONS
22.8 WATER SOFTENER	•			•			IF CALLED OUT IN DRAWINGS
DIVISION 23: HEATING, VENTILATING, AND AIR CONDITIONING							
23.1 HVAC DUCTWORK AND PIPING IDENTIFICATION	•			•			
23.2 ROOF CURBS	•			•			
23.3 HVAC DUCTWORK SYSTEM COMPONENTS	•			•			
23.4 MECHANICAL PIPING SYSTEM COMPONENTS							
23.4.1 WALK-IN COOLER REFRIGERATION		•			•		WALK-IN COOLER SUPPLIED BY VENDOR NO. 17 GENERAL CONTRACTOR SCOPE OF WORK TO INCLUDE PIPING AND FINAL CONNECTION
23.4.2 W/B CONDENSATION LINE	•			•			
23.4.3 REFRIGERATION FOR OTHER HVAC EQUIPMENT	•			•			
23.4.4 W/B FINAL ELECTRICAL CONNECTION	•			•			
23.4.5 W/B PENETRATIONS AND FINAL SEALING	•			•			
23.5 HVAC EQUIPMENT							GENERAL CONTRACTOR SCOPE OF WORK TO INCLUDE RIGGING FOR ALL ROOFTOP EQUIPMENT
23.5.1 SUPPLY FAN	•			•			
23.5.2 TOILET EXHAUST FAN	•			•			
23.5.3 KITCHEN EXHAUST FAN	•			•			
23.5.4 DUCTED AND NON-DUCTED HEATING AND COOLING UNITS	•			•			
23.5.5 HVAC CONDENSING UNITS	•			•			
23.5.6 REFRIGERATION CONDENSING UNITS		•			•		
23.6 COMMISSIONING ACTIVITIES							
23.6.1 TESTING AIR BALANCE (TAB) REPORT	•			•			
23.7 AIR CURTAINS	•			•			GENERAL CONTRACTOR TO PURCHASE FROM VENDOR NO. 3
23.8 DEHUMIDIFIER	•			•			*ONLY FOR HOUSTON AREA STORES. GC TO PROVIDE AND INSTALL DRAIN LINE RAN TO FLOOR SINK

DESCRIPTION	FURNISHED			INSTALLED			REMARKS
	GENERAL CONTRACTOR	OWNER	LANDLORD	GENERAL CONTRACTOR	OWNER	LANDLORD	
DIVISION 26: ELECTRICAL							
26.1 ELECTRICAL IDENTIFICATION	•			•			
26.2 POWER DISTRIBUTION SYSTEM							
26.2.1 MAIN SERVICE GEAR AND TRANSFORMERS	•			•			
26.2.2 MAIN SERVICE CONDUIT	•			•			
26.2.3 MAIN SERVICE WIRING	•			•			
26.2.4 MAIN SERVICE FUSES	•			•			
26.2.5 TRANSFORMER	•			•			TYPICALLY PROVIDED BY UTILITY PROVIDER. GENERAL CONTRACTOR TO VERIFY, IF NOT PROVIDED BY UTILITY GENERAL CONTRACTOR TO PROVIDE AND INSTALL.
26.2.6 TENANT DISTRIBUTION PANELS AND BREAKERS	•			•			
26.2.7 CONDUIT, WIRE, OUTLETS, AND SWITCHES	•			•			
26.2.8 KITCHEN EQUIPMENT FINAL CONNECTION	•			•			
26.2.9 SIGNAGE CONDUIT AND WIRING	•			•			
26.3 LIGHTING DEVICES							
26.3.1 PARKING LOT LIGHTING	•			•			GENERAL CONTRACTOR SCOPE OF WORK TO INCLUDE POWER TO LIGHTING FIXTURES
26.3.2 INTERIOR AND EXTERIOR LIGHTING	•			•			GENERAL CONTRACTOR TO PURCHASE FROM VENDOR NO. 1 VENDOR SUBSTITUTION IS NOT PERMITTED
26.3.3 EMERGENCY LIGHTING	•			•			GENERAL CONTRACTOR TO PURCHASE FROM VENDOR NO. 1 VENDOR SUBSTITUTION IS NOT PERMITTED
26.4 LOW VOLTAGE							SCOPE OF WORK TO INCLUDE INTERIOR AND EXTERIOR
26.4.1 CONDUIT AND WIRING	•			•			INCLUDE CAMERA CONDUIT
26.4.2 DEVICES AND COVERPLATES	•			•			
26.5 CAMERA WIRING		•			•		
DIVISION 27: COMMUNICATIONS							
27.1 TELECOMMUNICATIONS IDENTIFICATION		•			•		
27.2 TELECOMMUNICATIONS							
27.2.1 DATA TERMINATIONS		•			•		
27.2.2 WIFI EXTENDER (EXTERIOR MOUNTED)		•			•		IF REQUIRED
27.2.3 LOW VOLTAGE WIP FOR WIFI EXTENDER		•			•		ROOF PENETRATION WITH CONDUIT PER DETAIL
27.2.4 DATA PATCH PANEL		•	•		•	•	SPEC: TRIPP LITE 24-PORT 1U RACKMOUNT CAT6 110 PATCH PANEL 568B, RJ45 ETHERNET(252-024)
27.2.5 IT RACK AND SHELVES		•	•		•	•	SPEC FOR RACK: NAVEPONT 15U WALL MOUNT IT OPEN FRAME 19 INCH RACK WITH SWING OUT HINGED GATE BLACK SPEC FOR SHELVES 3 MIN. STARTECH CABSHLF116V (REQUIRED 3 TOTAL) GENERAL CONTRACTOR TO COORDINATE WITH SALAD AND GO PM FOR EXACT FIELD INSTALLATION LOCATION
27.3 MONITORS							
27.3.1 CONDUIT AND WIRING		•			•		
27.3.2 MOUNTS			•			•	
27.3.3 DEVICES			•				
27.4 DRIVE THRU LOOPS					•	•	GENERAL CONTRACTOR TO COORDINATE WITH SALAD AND GO PM FOR EXACT INSTALLATION LOCATION
DIVISION 28: ELECTRONIC SAFETY AND SECURITY							
28.1 SECURITY ALARM SYSTEM							
28.1.1 CONDUIT		•			•		
28.1.2 WIRING AND DEVICES			•		•		
28.2 SECURITY CAMERAS					•		
28.2.1 WIRING			•		•		
28.2.2 DEVICES			•				
28.3 MENU SPEAKERS							
28.3.1 CONDUIT		•			•		GENERAL CONTRACTOR TO FURNISH AND INSTALL 1 POWER AND 2 DATA CONDUIT TO EACH MENU BOARD. EACH CONDUIT TO BE DEDICATED BACK TO BUILDING. DATA CONDUIT TO BE STUBBED FROM MENU BOARD TO ABOVE CEILING IN BUILDING. CLARIFY WITH SAG PM PRIOR TO INSTALLATION
28.3.2 WIRING		•	•		•	•	
28.3.3 DEVICES			•			•	
28.3.4 MENU SPEAKER FOUNDATION		•			•		
28.4 FIRE ALARM SYSTEM							AS REQUIRED BY AHJ
28.4.1 SYSTEM ENGINEER		•			•		
28.4.2 CONNECTION TO BASE BUILDING SYSTEM		•			•		AS NEEDED
28.4.3 DEVICES		•			•		
DIVISION 32: EXTERIOR IMPROVEMENTS							
32.1 IRRIGATION SYSTEM		•			•		
32.2 PARKING LOT PATCH SEAL, AND STRIPE		•			•		
32.3 RAMPS					•		
32.4 PAVING AND HARDSCAPE		•			•		
32.5 CONCRETE CURBS		•			•		
32.6 TRASH ENCLOSURE		•			•		
32.7 LANDSCAPE PLANT MATERIAL		•			•		

SITE PLAN GENERAL NOTES

- A. COORDINATE SITE PLAN WITH LANDSCAPE, ARCHITECTURAL, CIVIL, MECHANICAL, AND ELECTRICAL SITE PLAN. REPORT ANY DISCREPANCIES TO THE ARCHITECT.
- B. SIGNAGE TO BE DIFFERED SUBMITTAL. REF: TO SHEET A201 FOR BUILDING MOUNTED SIGNAGE LOCATIONS. REF: ELEC FOR ELECTRICAL INFORMATION.
- C. DRIVE-THRU EQUIPMENT INCLUDING WIRELESS COMMUNICATION AND MONITORS SHALL BE COORDINATED BY GENERAL CONTRACTOR. REF: ELEC FOR ELECTRICAL INFORMATION.
- D. GENERAL CONTRACTOR TO APPLY CONCRETE SEALER TO ALL EXTERIOR CONCRETE PATIO AND WALKWAY SURFACES.
- E. PROVIDE DETECTABLE WARNING (IF APPLICABLE PER LOCAL CODE) AT TRANSITION FROM SIDEWALK TO DRIVE AISLE.
- F. ACCESSIBLE PARKING SPACE AND ACCESS AISLE SHALL HAVE SURFACE SLOPE NOT TO EXCEED 2% IN ALL DIRECTIONS.
- G. REFER TO ELECTRICAL DRAWINGS FOR SITE RELATED ELECTRICAL WORK.
- H. UTILITY BOXES, PEDESTALS AND METER PANELS SHALL BE PAINTED TO BLEND IN WITH SURROUNDINGS. ALL UTILITY BOXES AND METER PANELS ON WALLS SHALL BE PAINTED TO MATCH THE BUILDING WALLS WITH UTILITY COMPANY APPROVALS.
- I. REFERENCE LANDSCAPE DRAWINGS IN CIVIL SET FOR LANDSCAPING DESIGN.

REF: CIVIL FOR LEGAL DESCRIPTION, DIMENSIONS AND UTILITY LOCATIONS.

ARCHITECTURAL SITE PLAN KEYNOTES

1. TRASH ENCLOSURE, REF: DETAILS ON SHEET AS002
2. LANDSCAPING, REF: CIVIL.
3. PLANTER BOXES: OLD TOWN FIBERGLASS, STANDARD RECTANGLE, FINISH: FLAME 28 (SAND), 18" HIGH, REF: LANDSCAPING.
4. SITE ACCESS, REF: CIVIL.
5. ACCESSIBLE PARKING, REF: CIVIL.
6. ACCESSIBLE PARKING RAMP, REF: CIVIL.
7. 36" WIDE MINIMUM ACCESSIBLE PATH OF TRAVEL TO ACCESSIBLE PARKING. NO ABRUPT CHANGES IN ELEVATION ALONG THE PATH OF TRAVEL SHOWN. THE SLOPE AND CROSS SLOPE ALONG THE PATH OF TRAVEL SHALL NOT EXCEED 5% AND 2% RESPECTIVELY, REF: CIVIL.
8. PROPERTY LINE.
9. DRIVE THRU LANE.
10. CONDUIT STUB UNDER CURB TO LOOP VERTICAL DETECTION BY GC. REF: ELEC
11. OUTLINE OF CANOPY ABOVE.
12. GREASE TRAP, REF: CIVIL AND PLUMBING



#2001
610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3
PROTOTYPE VERSION 2.00



513 MAIN STREET #300
FORT WORTH TX 76102

SEAL



PERMIT SET: 04/12/2024

CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DIMENSIONAL ERRORS, OMISSIONS OR DISCREPANCIES BEFORE BEGINNING OR FABRICATING ANY WORK. DO NOT SCALE DRAWINGS.

ISSUE	DATE	DESCRIPTION

PROJECT INFORMATION


PROJECT NO: 24-0087
ORIGINAL ISSUE: 06/01/2023
SCALE: AS NOTED
DRAWN BY: P. C
CHECKED BY: J. JEFFERY

SHEET TITLE

ARCHITECTURAL
SITE PLAN

SHEET NUMBER

AS001









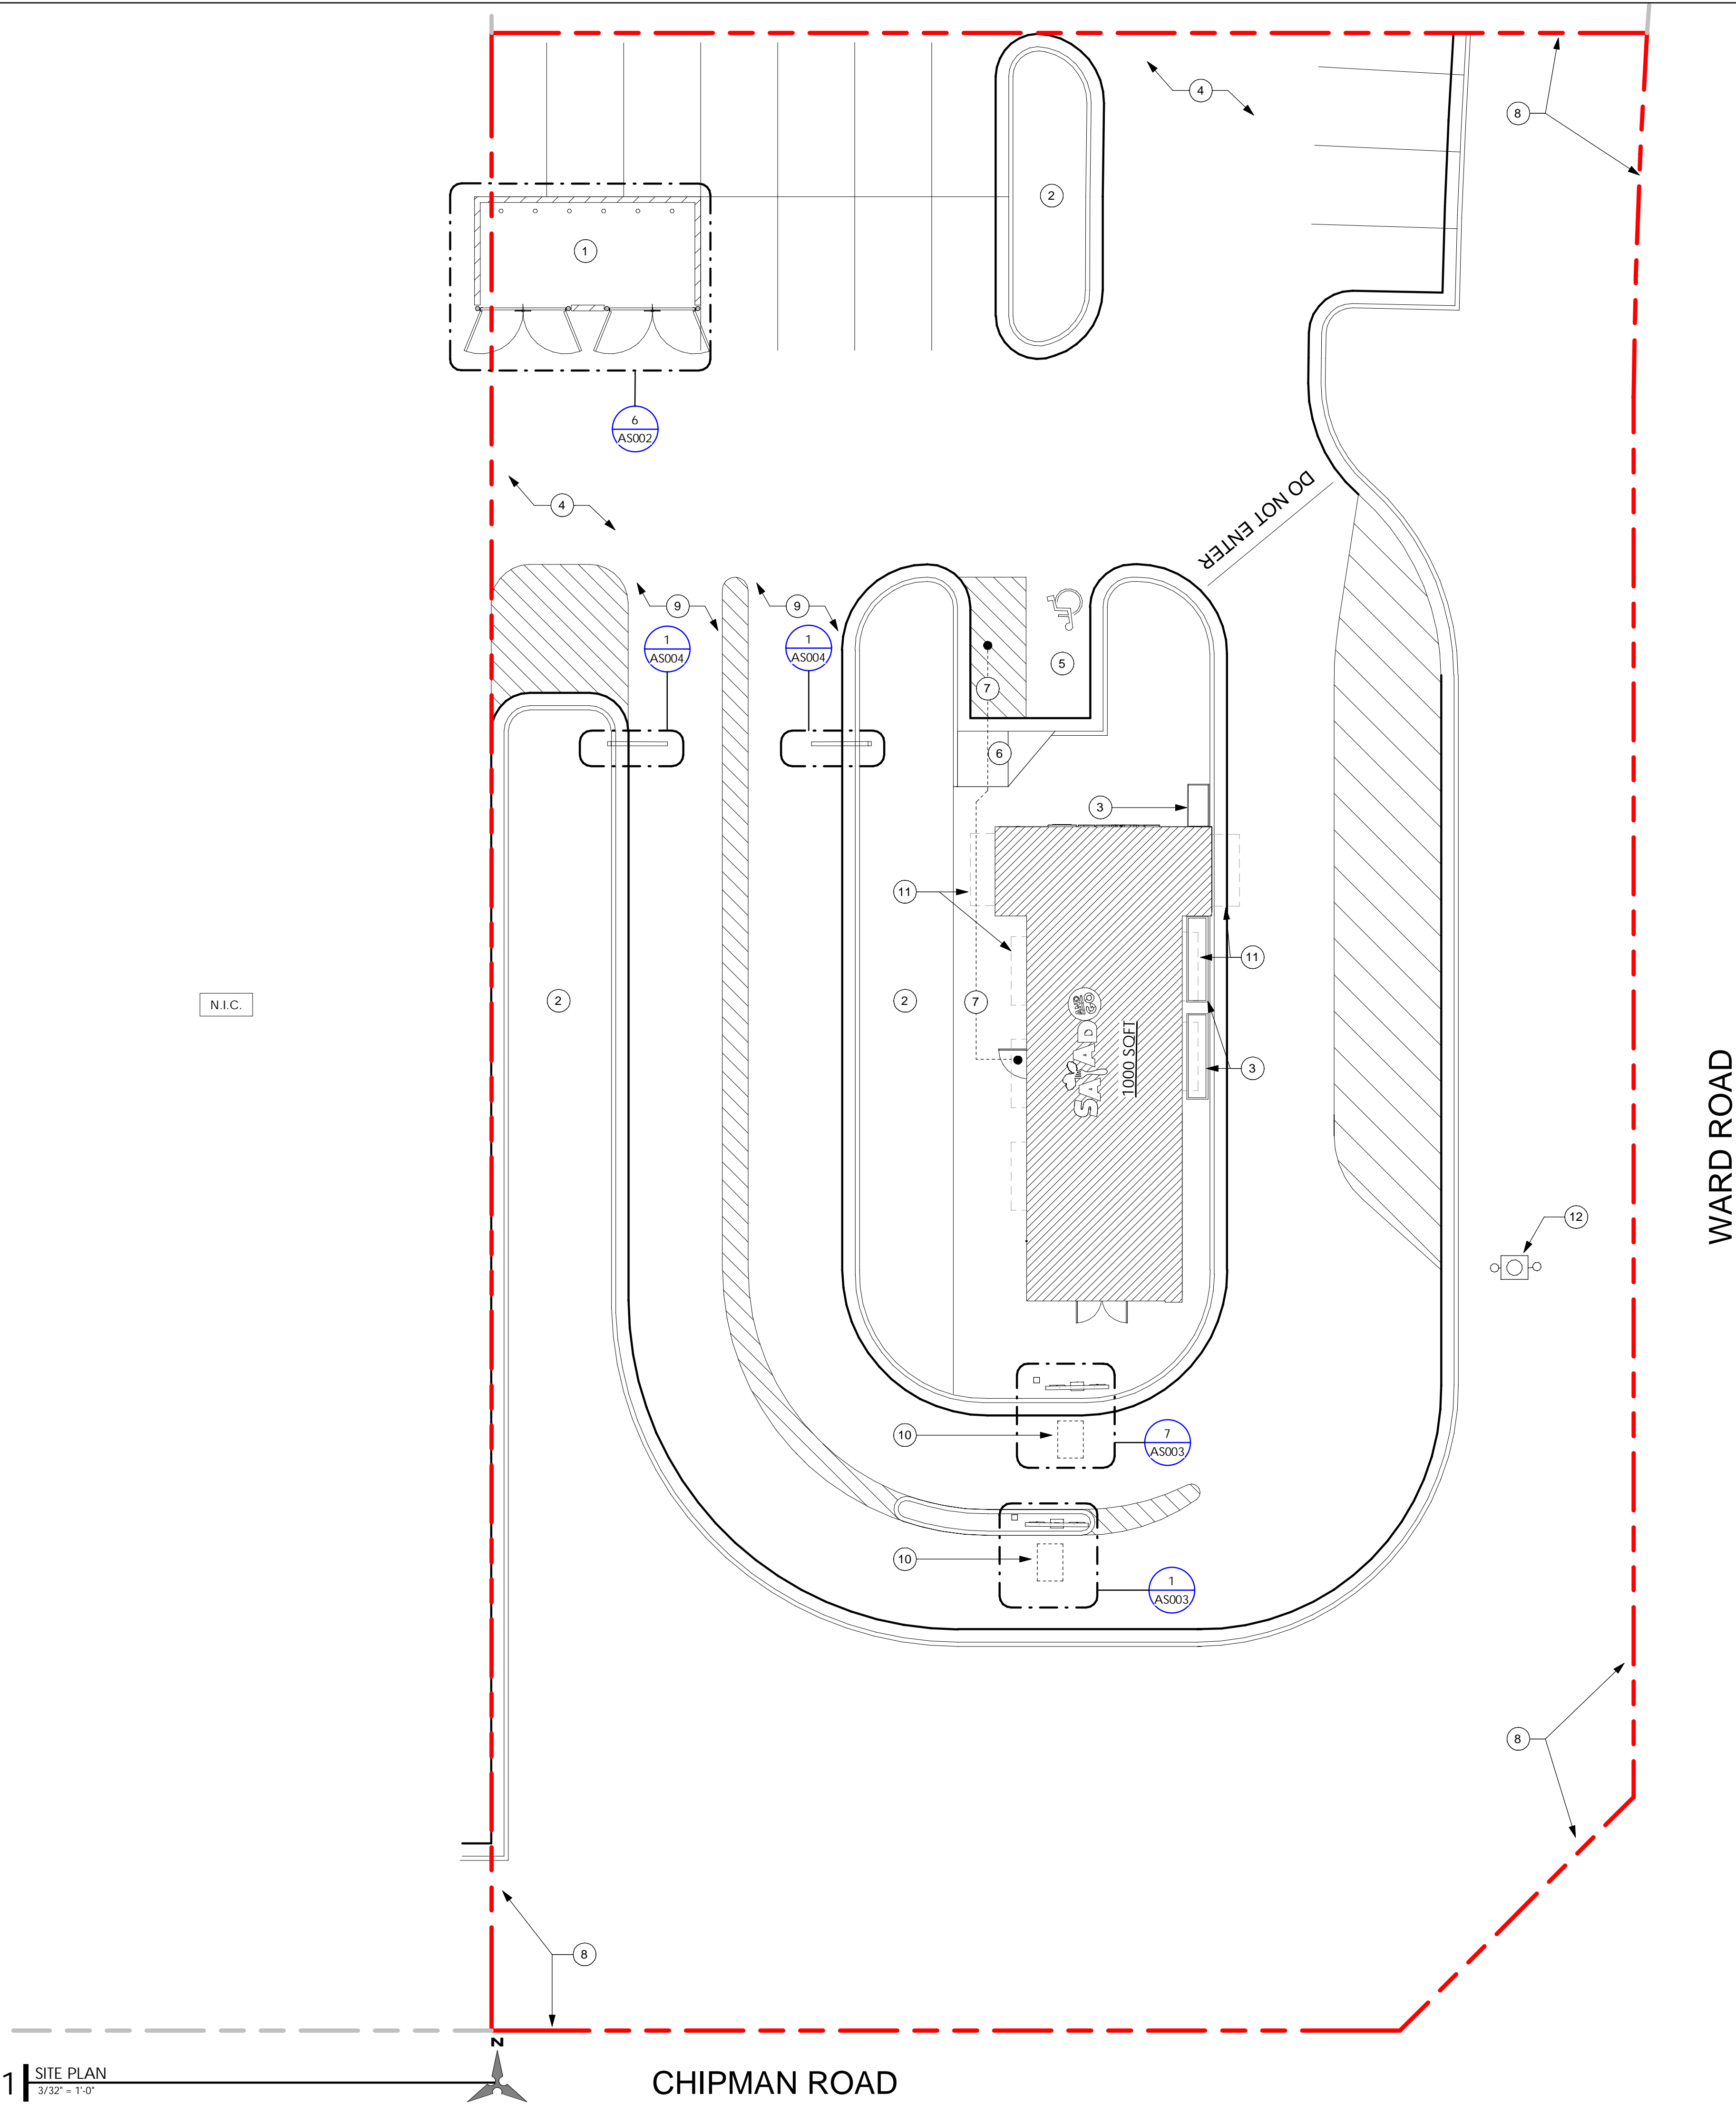


WARD ROAD

CHIPMAN ROAD

1 SITE PLAN
1/32" = 1'-0"

N.I.C.

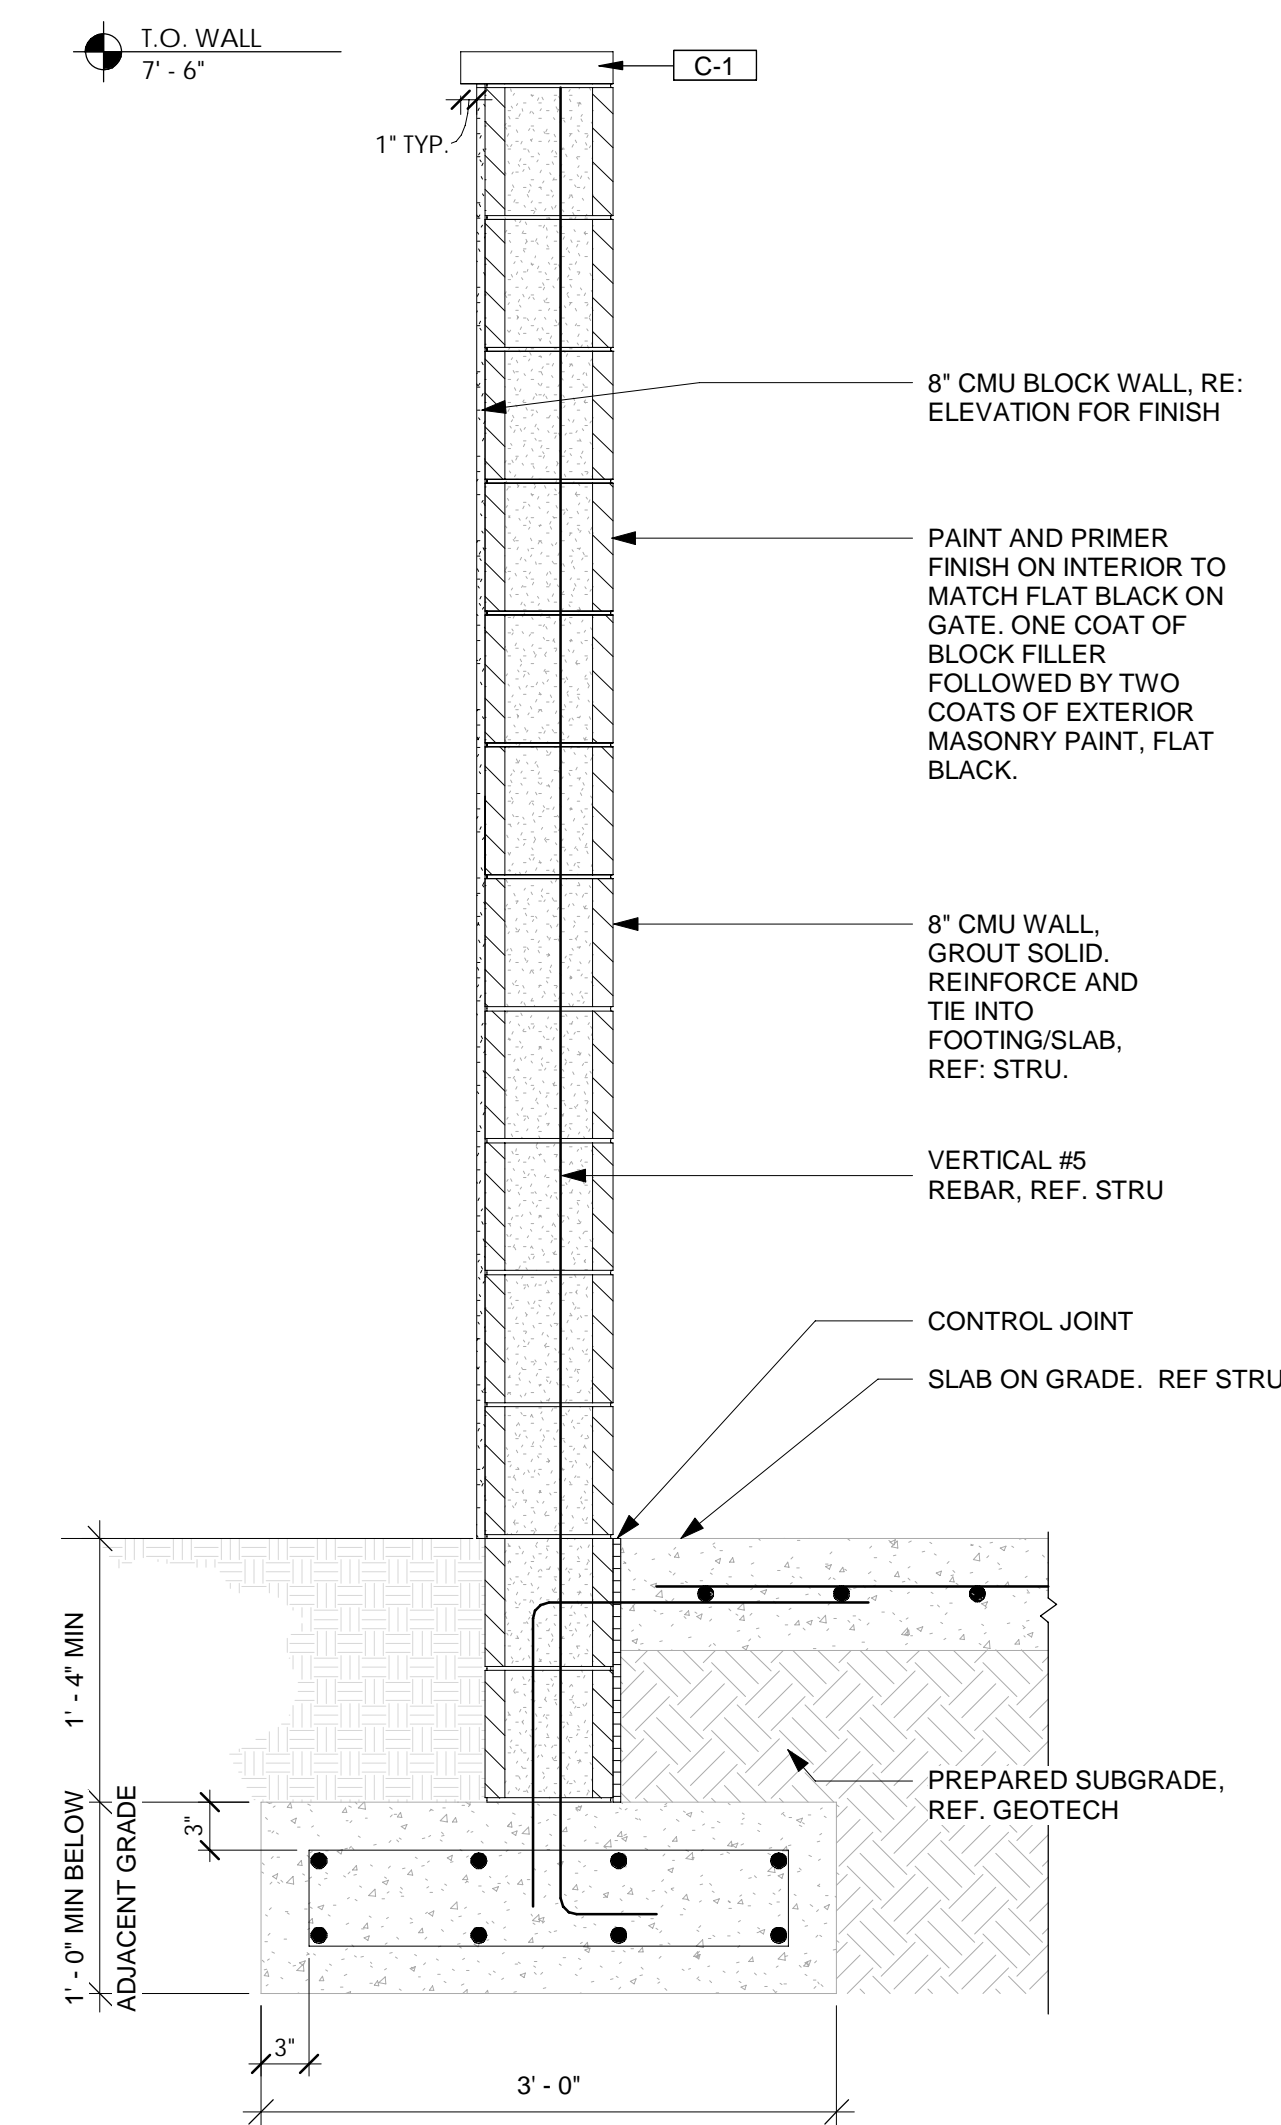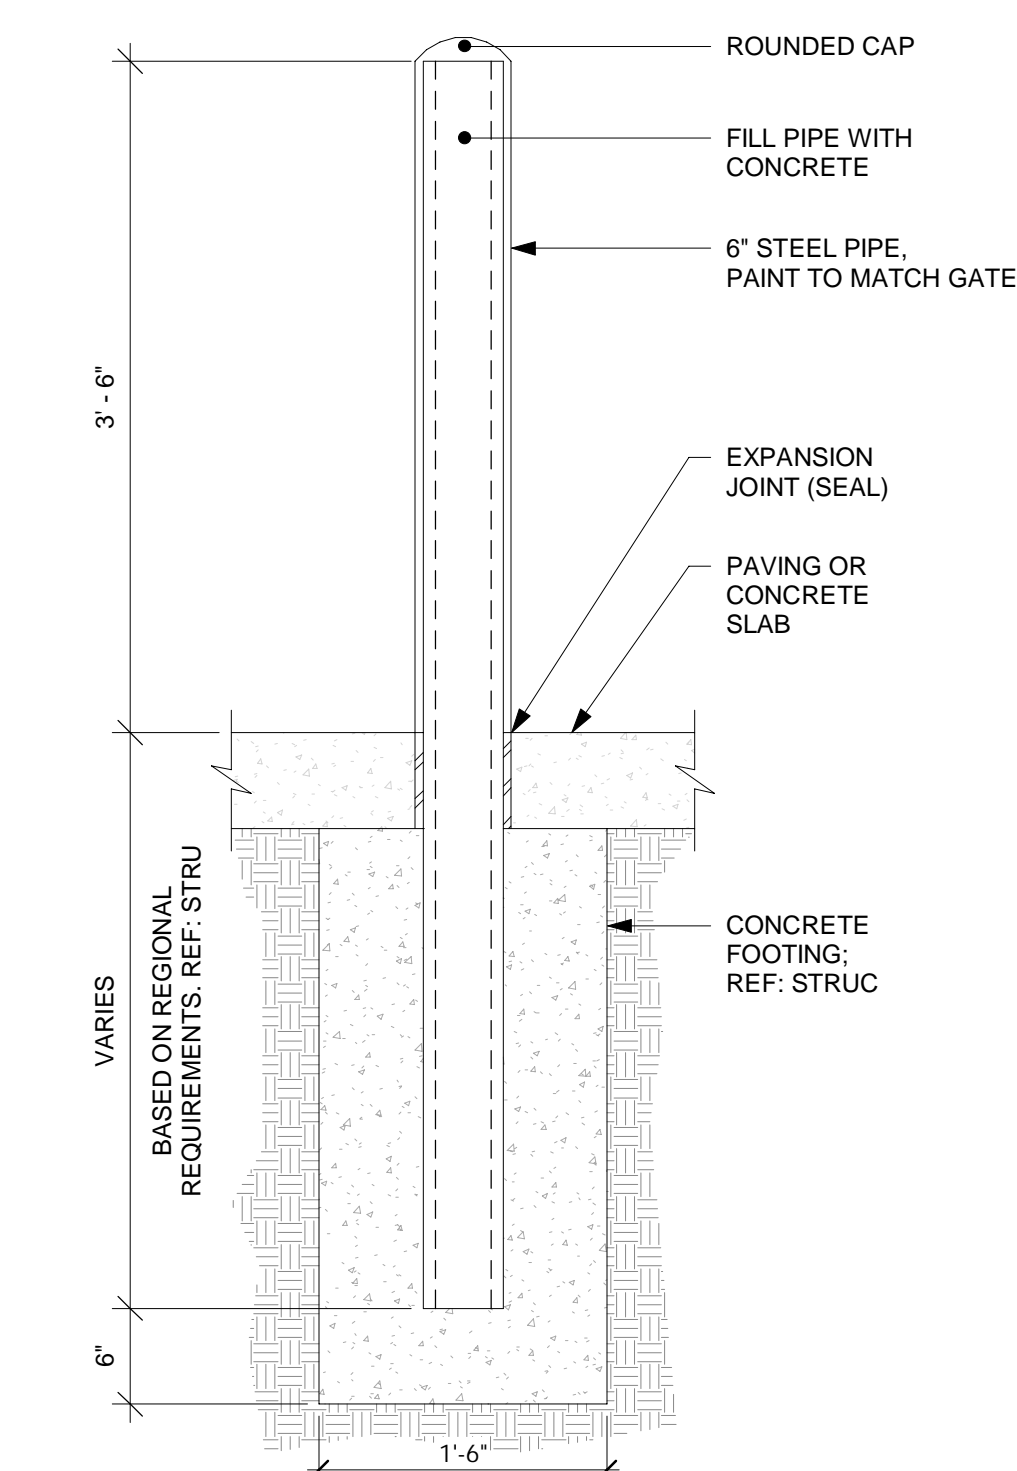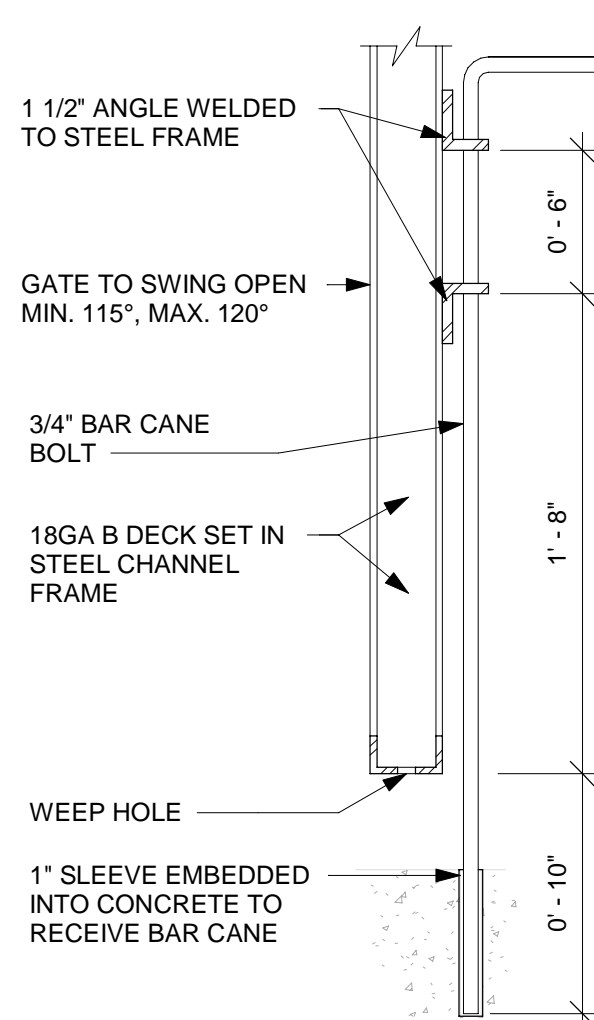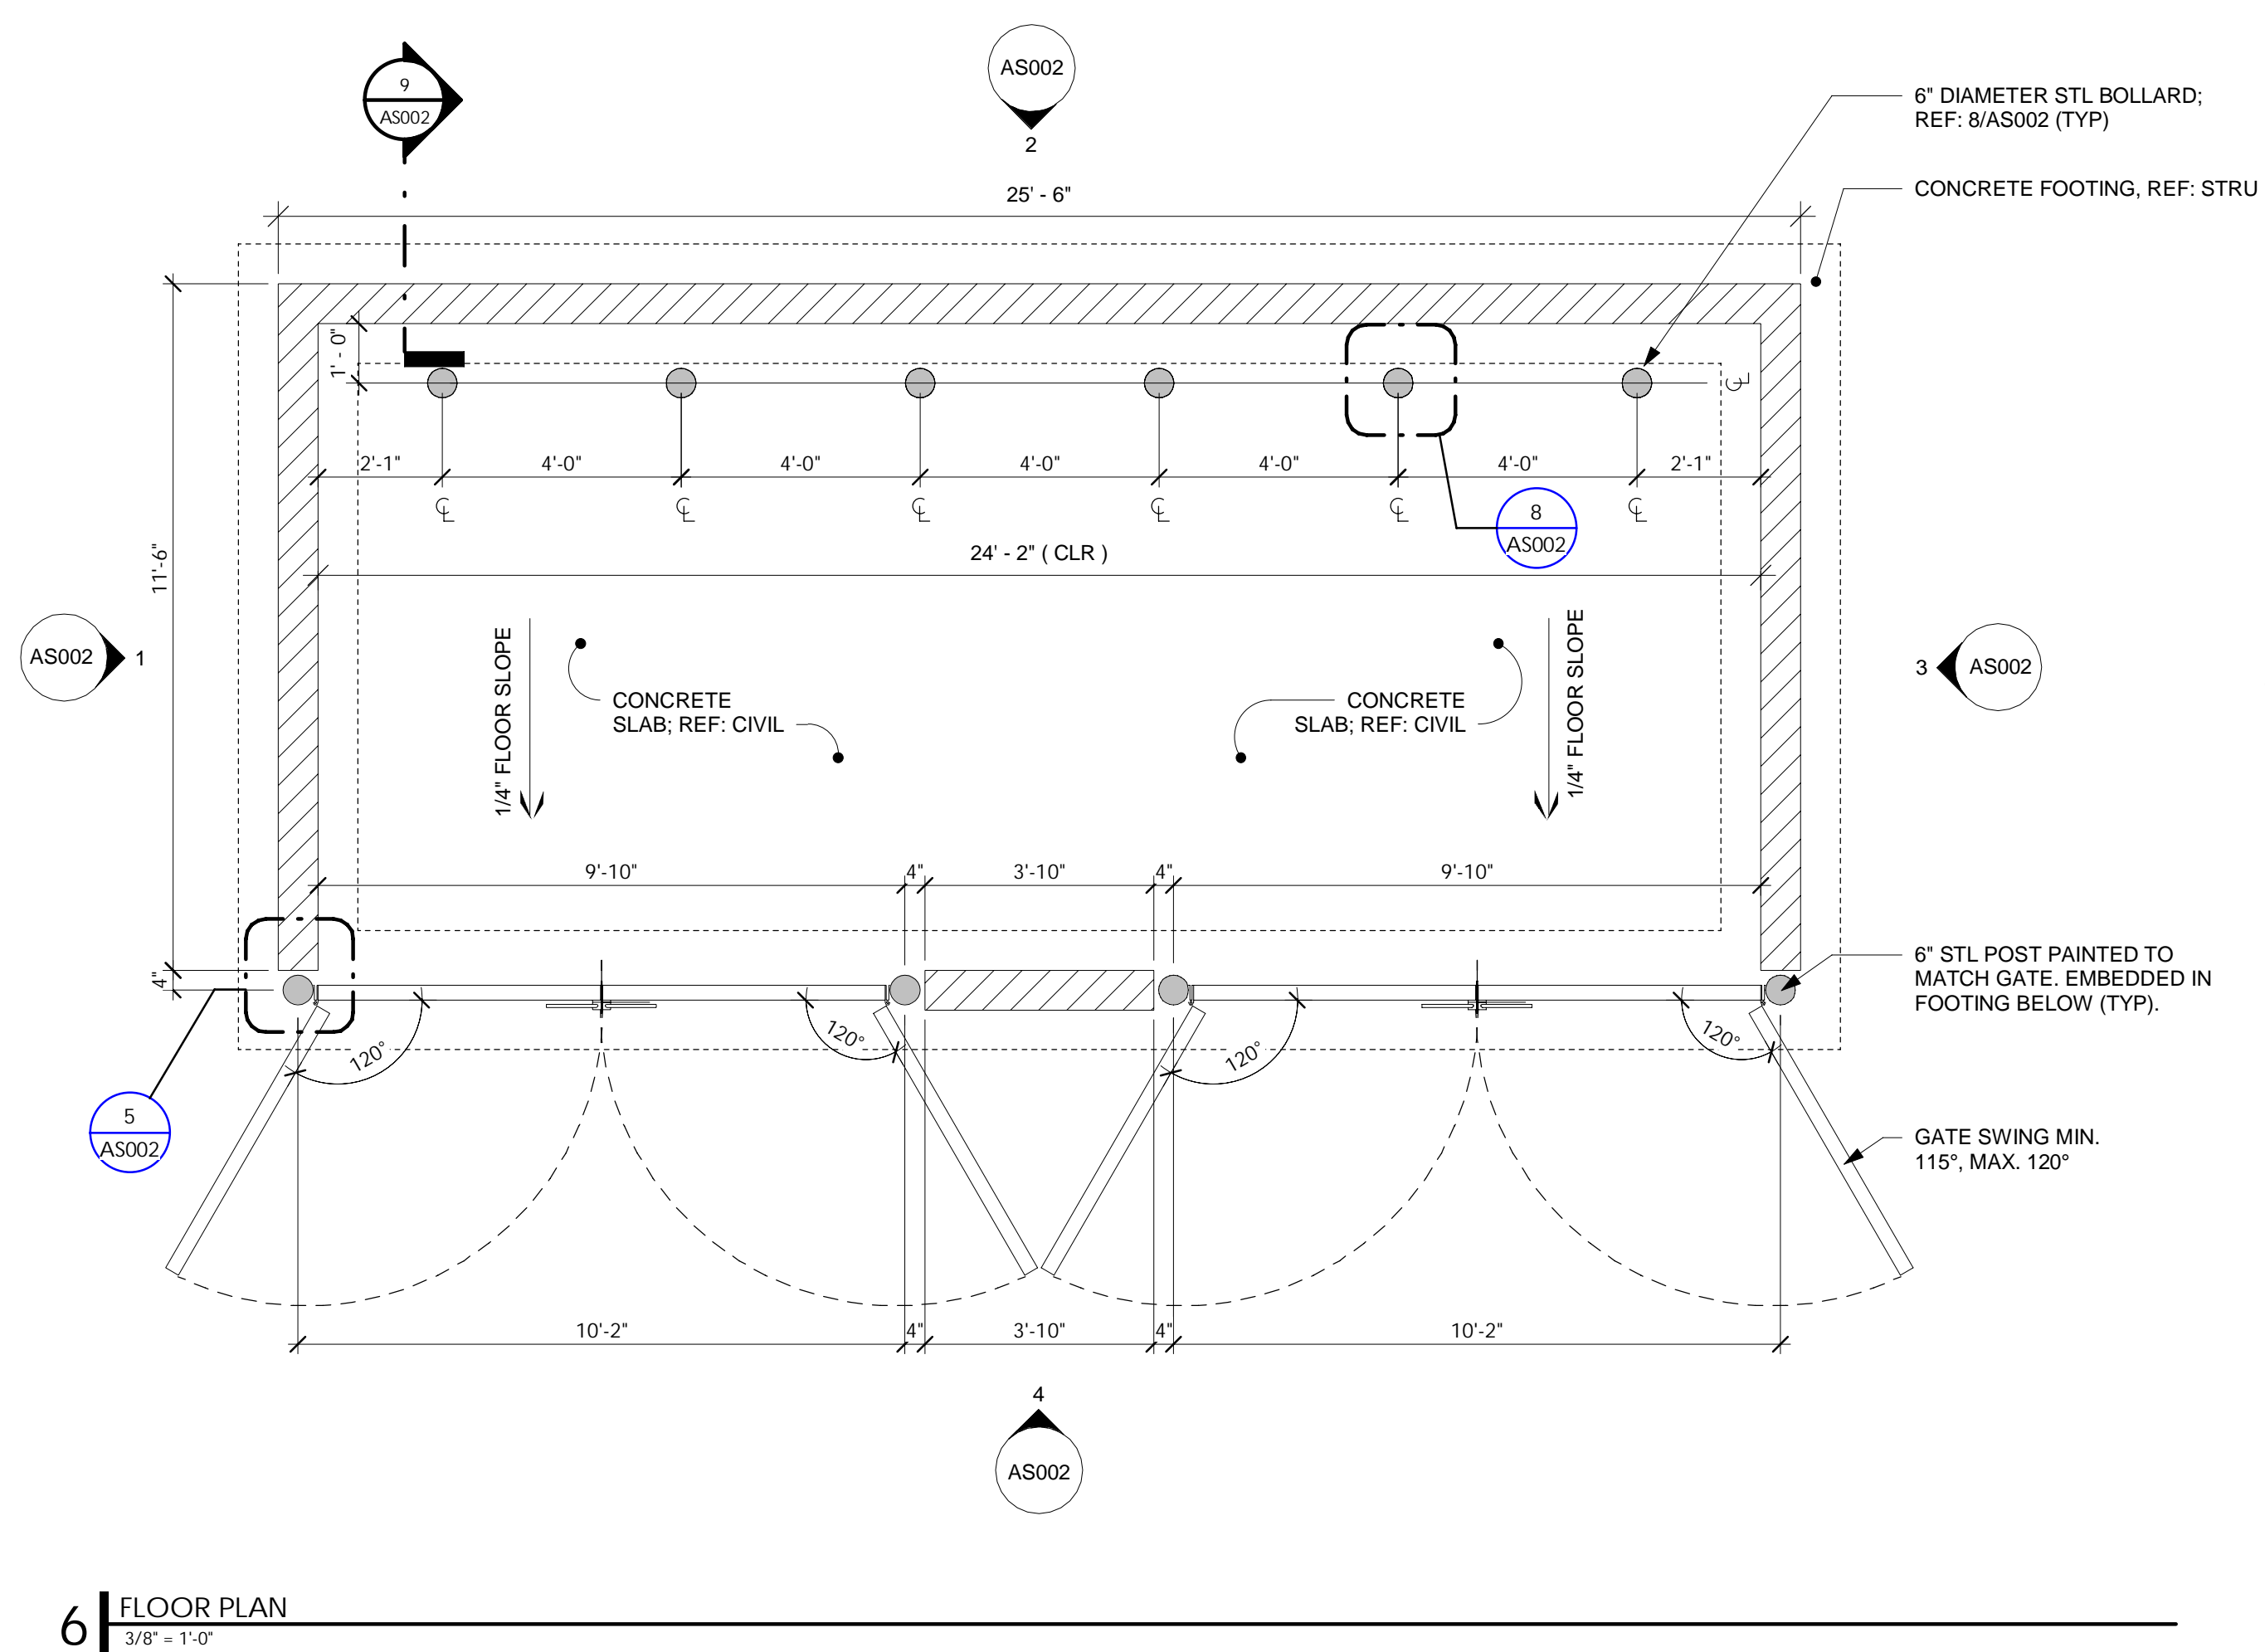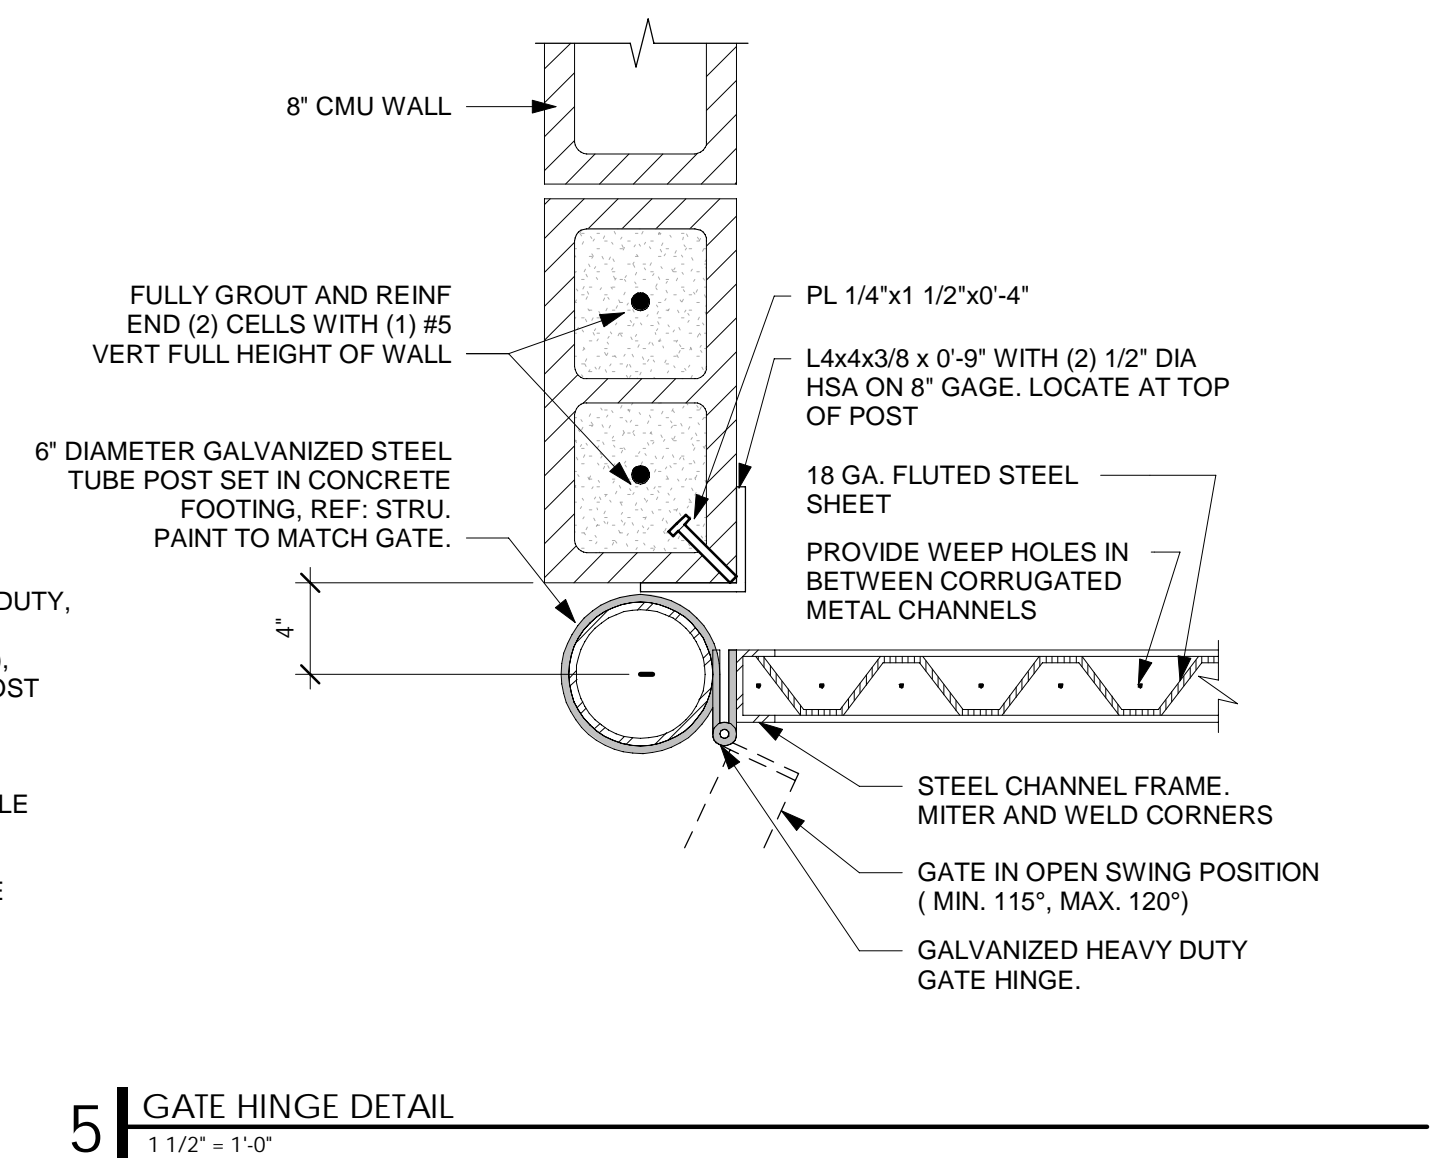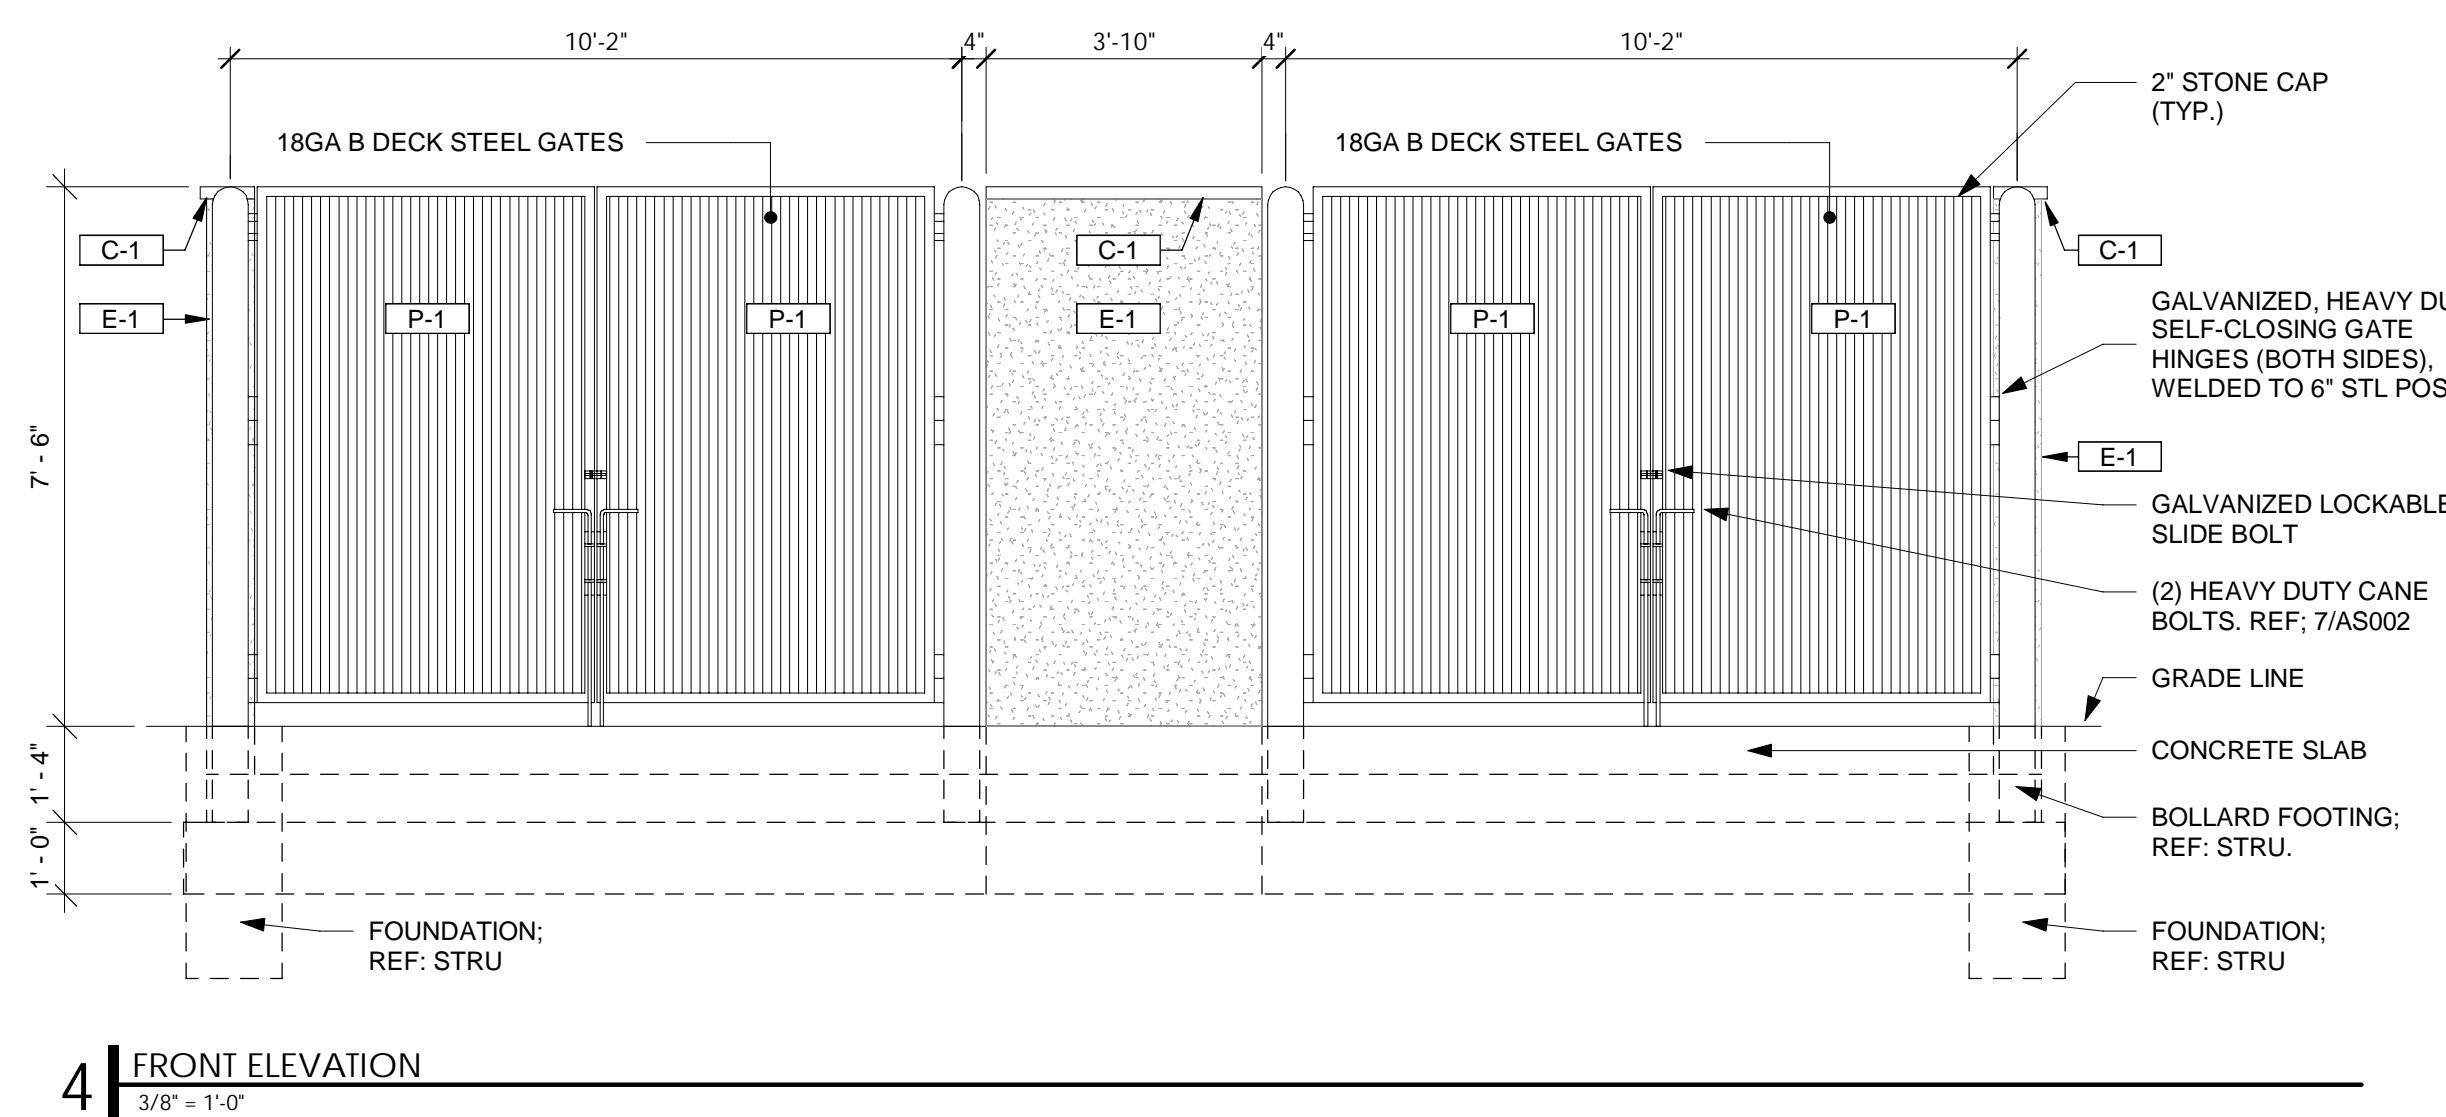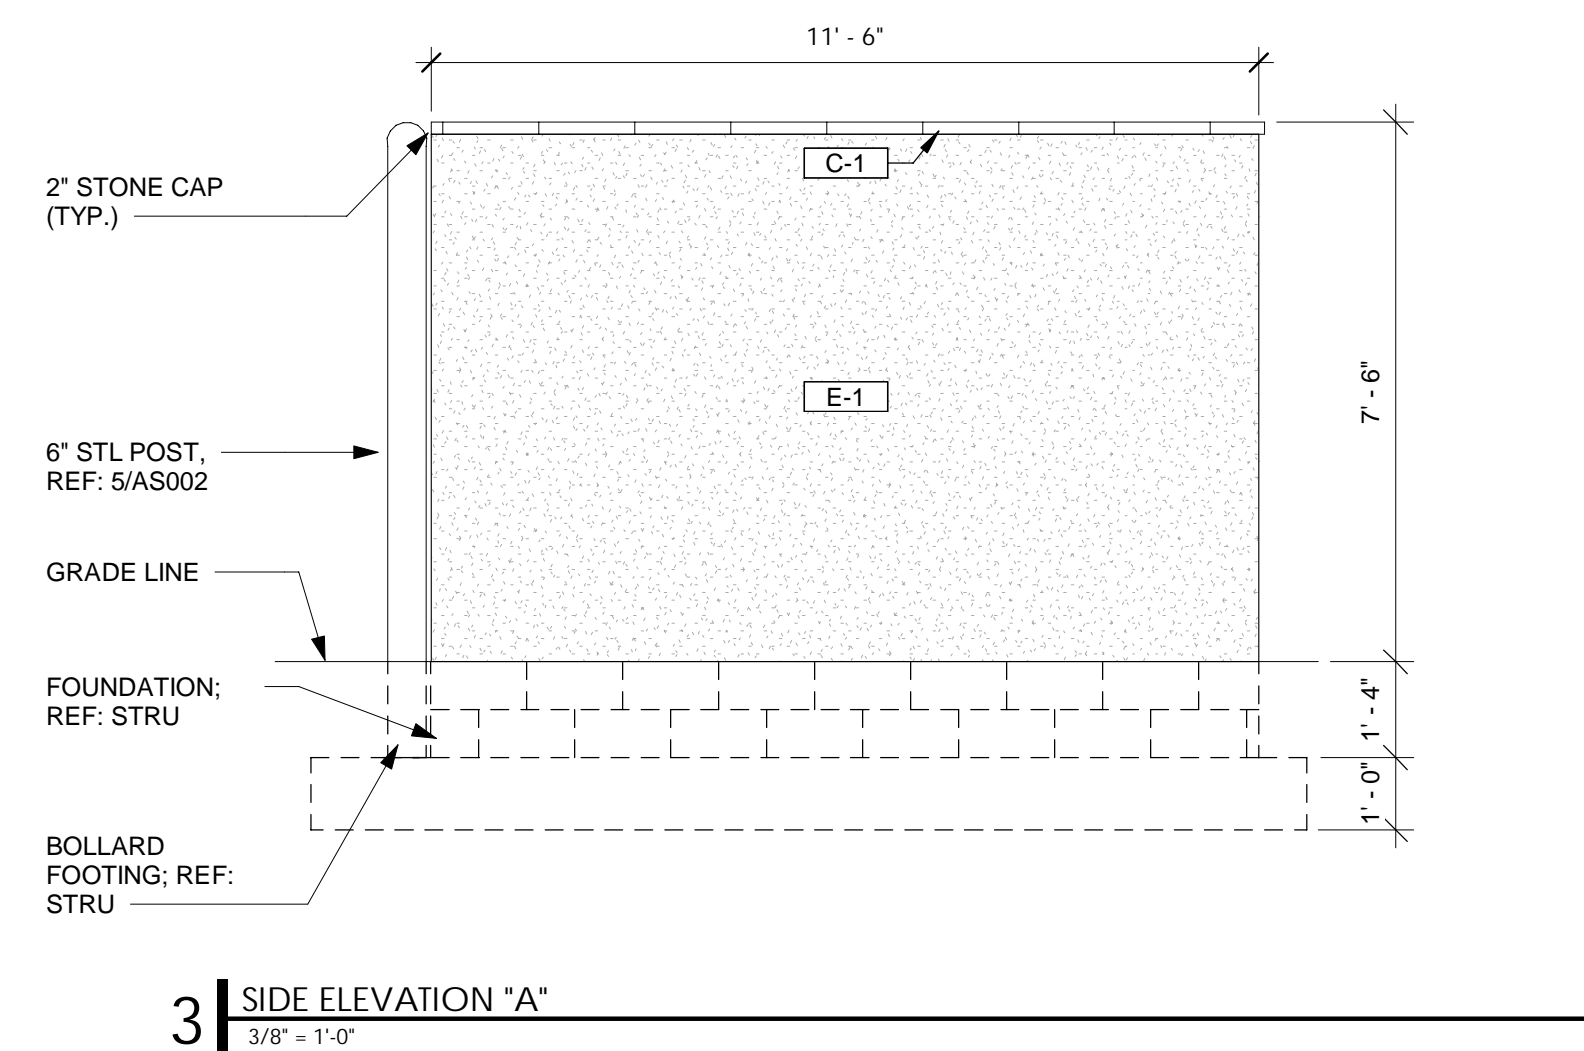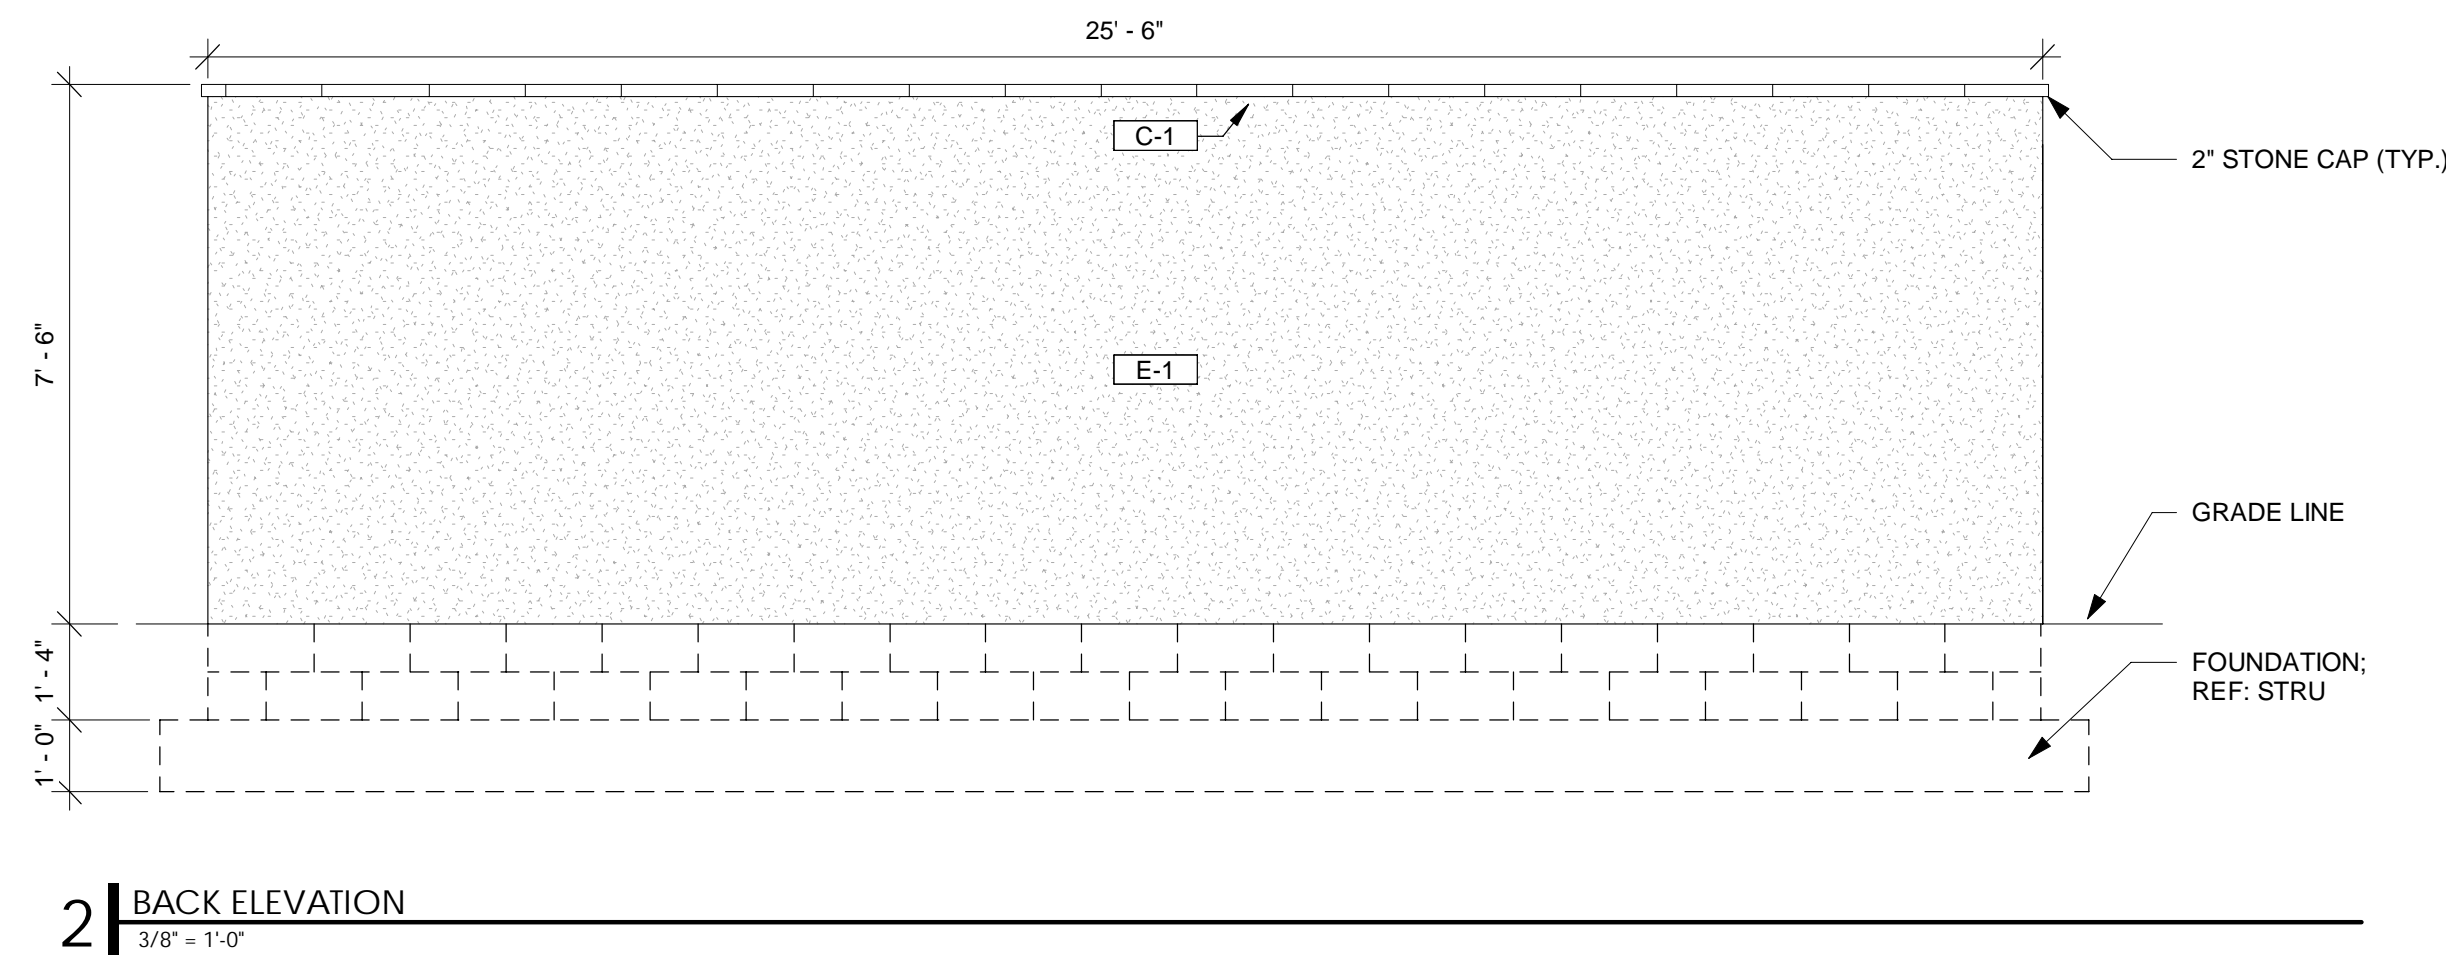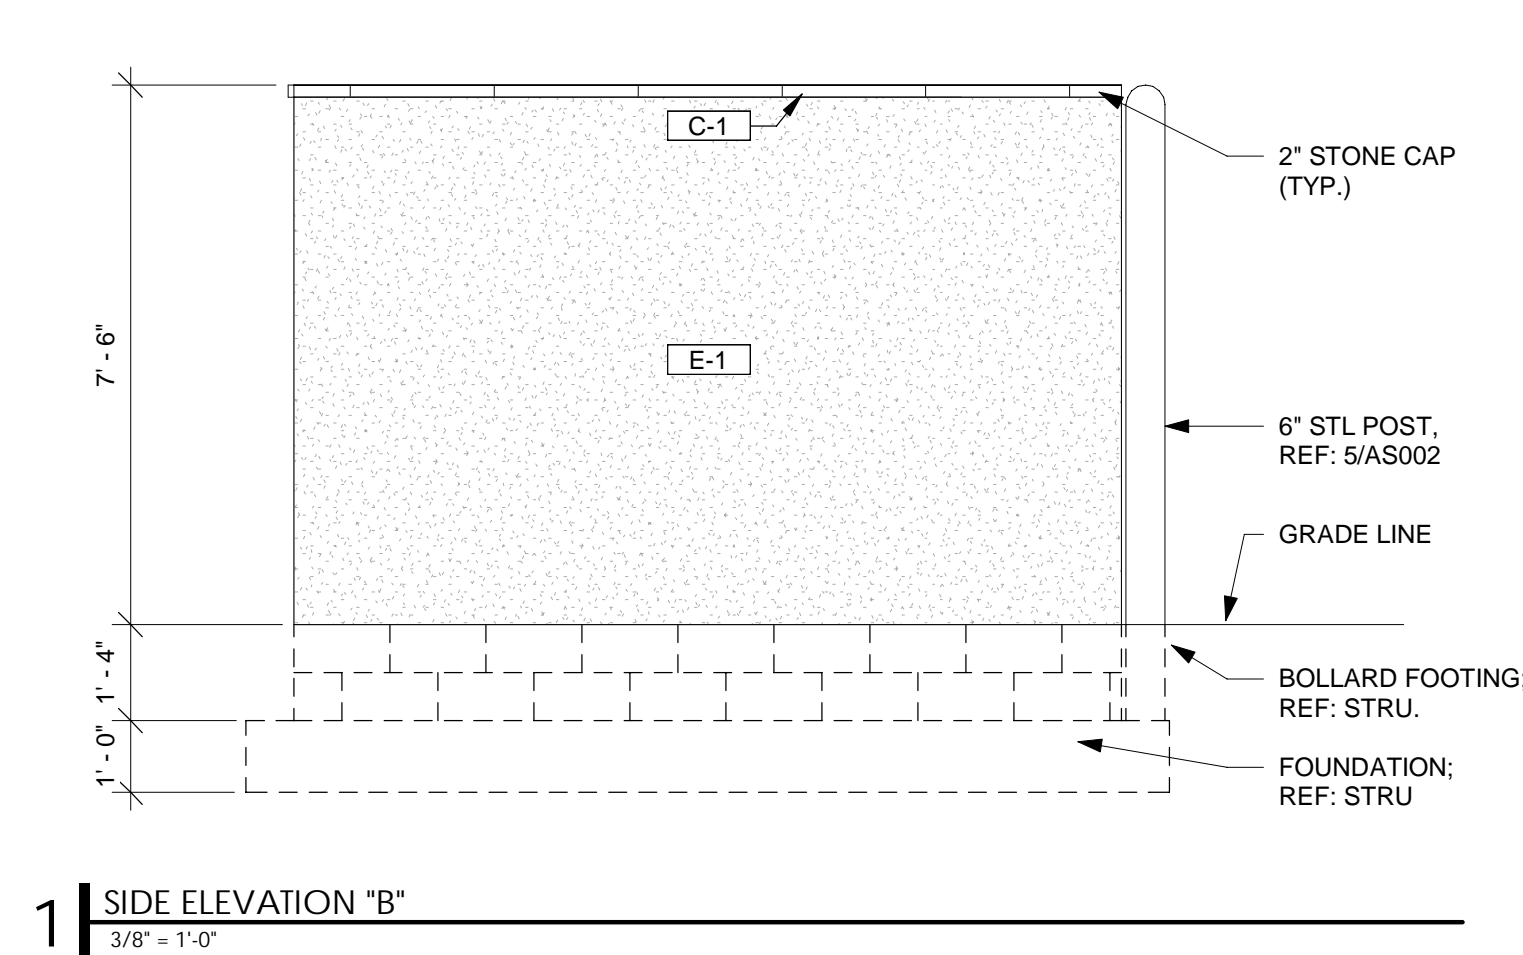

TRASH ENCLOSURE FINISH SCHEDULE			
MARK	MATERIAL	DESCRIPTION	
E-1	E.I.F.S.	PRODUCT: DRYVIT CCP-2 FINISH: SAND COLOR: MATCH SHERWIN WILLIAMS SW-6095 TOASTY	
P-1	PAINT	COLOR: SW-7048 URBANE BRONZE	
C-1	STONE CAP	PRODUCT: CORONADO STONE FINISH: FLAGSTONE WALL CAP COLOR: CHARCOAL	



#2001
610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3
PROTOTYPE VERSION 2.00



513 MAIN STREET #300
FORT WORTH TX 76102



PERMIT SET: 04/12/2024

CONTRACTOR SHALL VERIFY ALL
CONDITIONS AND DIMENSIONS AT THE
JOB SITE AND NOTIFY THE ARCHITECT
OF ANY DIMENSIONAL ERRORS,
OMISSIONS OR DISCREPANCIES BEFORE
BEGINNING OR FABRICATING ANY WORK
DO NOT SCALE DRAWINGS.

[illegible]

PROJECT INFORMATION			
---------------------	--	--	--

PROJECT NO:	24-008
ORIGINAL ISSUE:	06/01/2023
SCALE:	AS NOTED
DRAWN BY:	V. PEREZ
CHECKED BY:	J. JEFFERSON

SHEET TITLE

TRASH ENCLOSURE DETAILS

SHEET NUMBER

AS002



- 

#2001
610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3
PROTOTYPE VERSION 2.00



513 MAIN STREET #300
FORT WORTH TX 76102



PERMIT SET: 04/12/2024

CONTRACTOR SHALL VERIFY ALL
CONDITIONS AND DIMENSIONS AT THE
JOB SITE AND NOTIFY THE ARCHITECT
OF ANY DIMENSIONAL ERRORS,
OMISSIONS OR DISCREPANCIES BEFORE
BEGINNING OR FABRICATING ANY WORK.
DO NOT SCALE DRAWINGS.

PROJECT INFORMATION	
PROJECT NO:	24-0087
ORIGINAL ISSUE:	06/01/2023
SCALE:	AS NOTED
DRAWN BY:	V. PEREZ
CHECKED BY:	J. JEFFERY

SHEET TITLE

SITE DETAILS

SHEET NUMBER

AS003

- | GENERAL NOTES: | |
|----------------|--|
| 1. | REFERENCE STRUCTURAL DRAWINGS FOR FOOTING SIZING AND DETAILS. |
| 2. | GC TO FOLLOW MANUFACTURERS WRITTEN INSTRUCTIONS FOR INSTALLATION OF ALL EQUIPMENT, FIXTURES, FURNISHINGS, FINISHES, ETC. |
| 3. | GC TO COORDINATE ALL SITE WORK WITH CIVIL DRAWINGS. |
| 4. | FINISH TO BE PAINTED BLACK, MATCH SW 6991 BLACK MAGIC. |



#2001
610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3
PROTOTYPE VERSION 2.00



513 MAIN STREET #300
FORT WORTH TX 76102

SEAL



PERMIT SET: 04/12/2024

CONTRACTOR SHALL VERIFY ALL
CONDITIONS AND DIMENSIONS AT THE
JOB SITE AND NOTIFY THE ARCHITECT
OF ANY DIMENSIONAL ERRORS,
OMISSIONS OR DISCREPANCIES BEFORE
BEGINNING OR FABRICATING ANY WORK.
DO NOT SCALE DRAWINGS.

[illegible]

PROJECT INFORMATION


PROJECT NO:	24-0087
ORIGINAL ISSUE:	06/01/2023
SCALE:	AS NOTED
DRAWN BY:	V. PEREZ
CHECKED BY:	J. JEFFERY

SHEET TITLE


SITE DETAILS

SHEET NUMBER

AS004

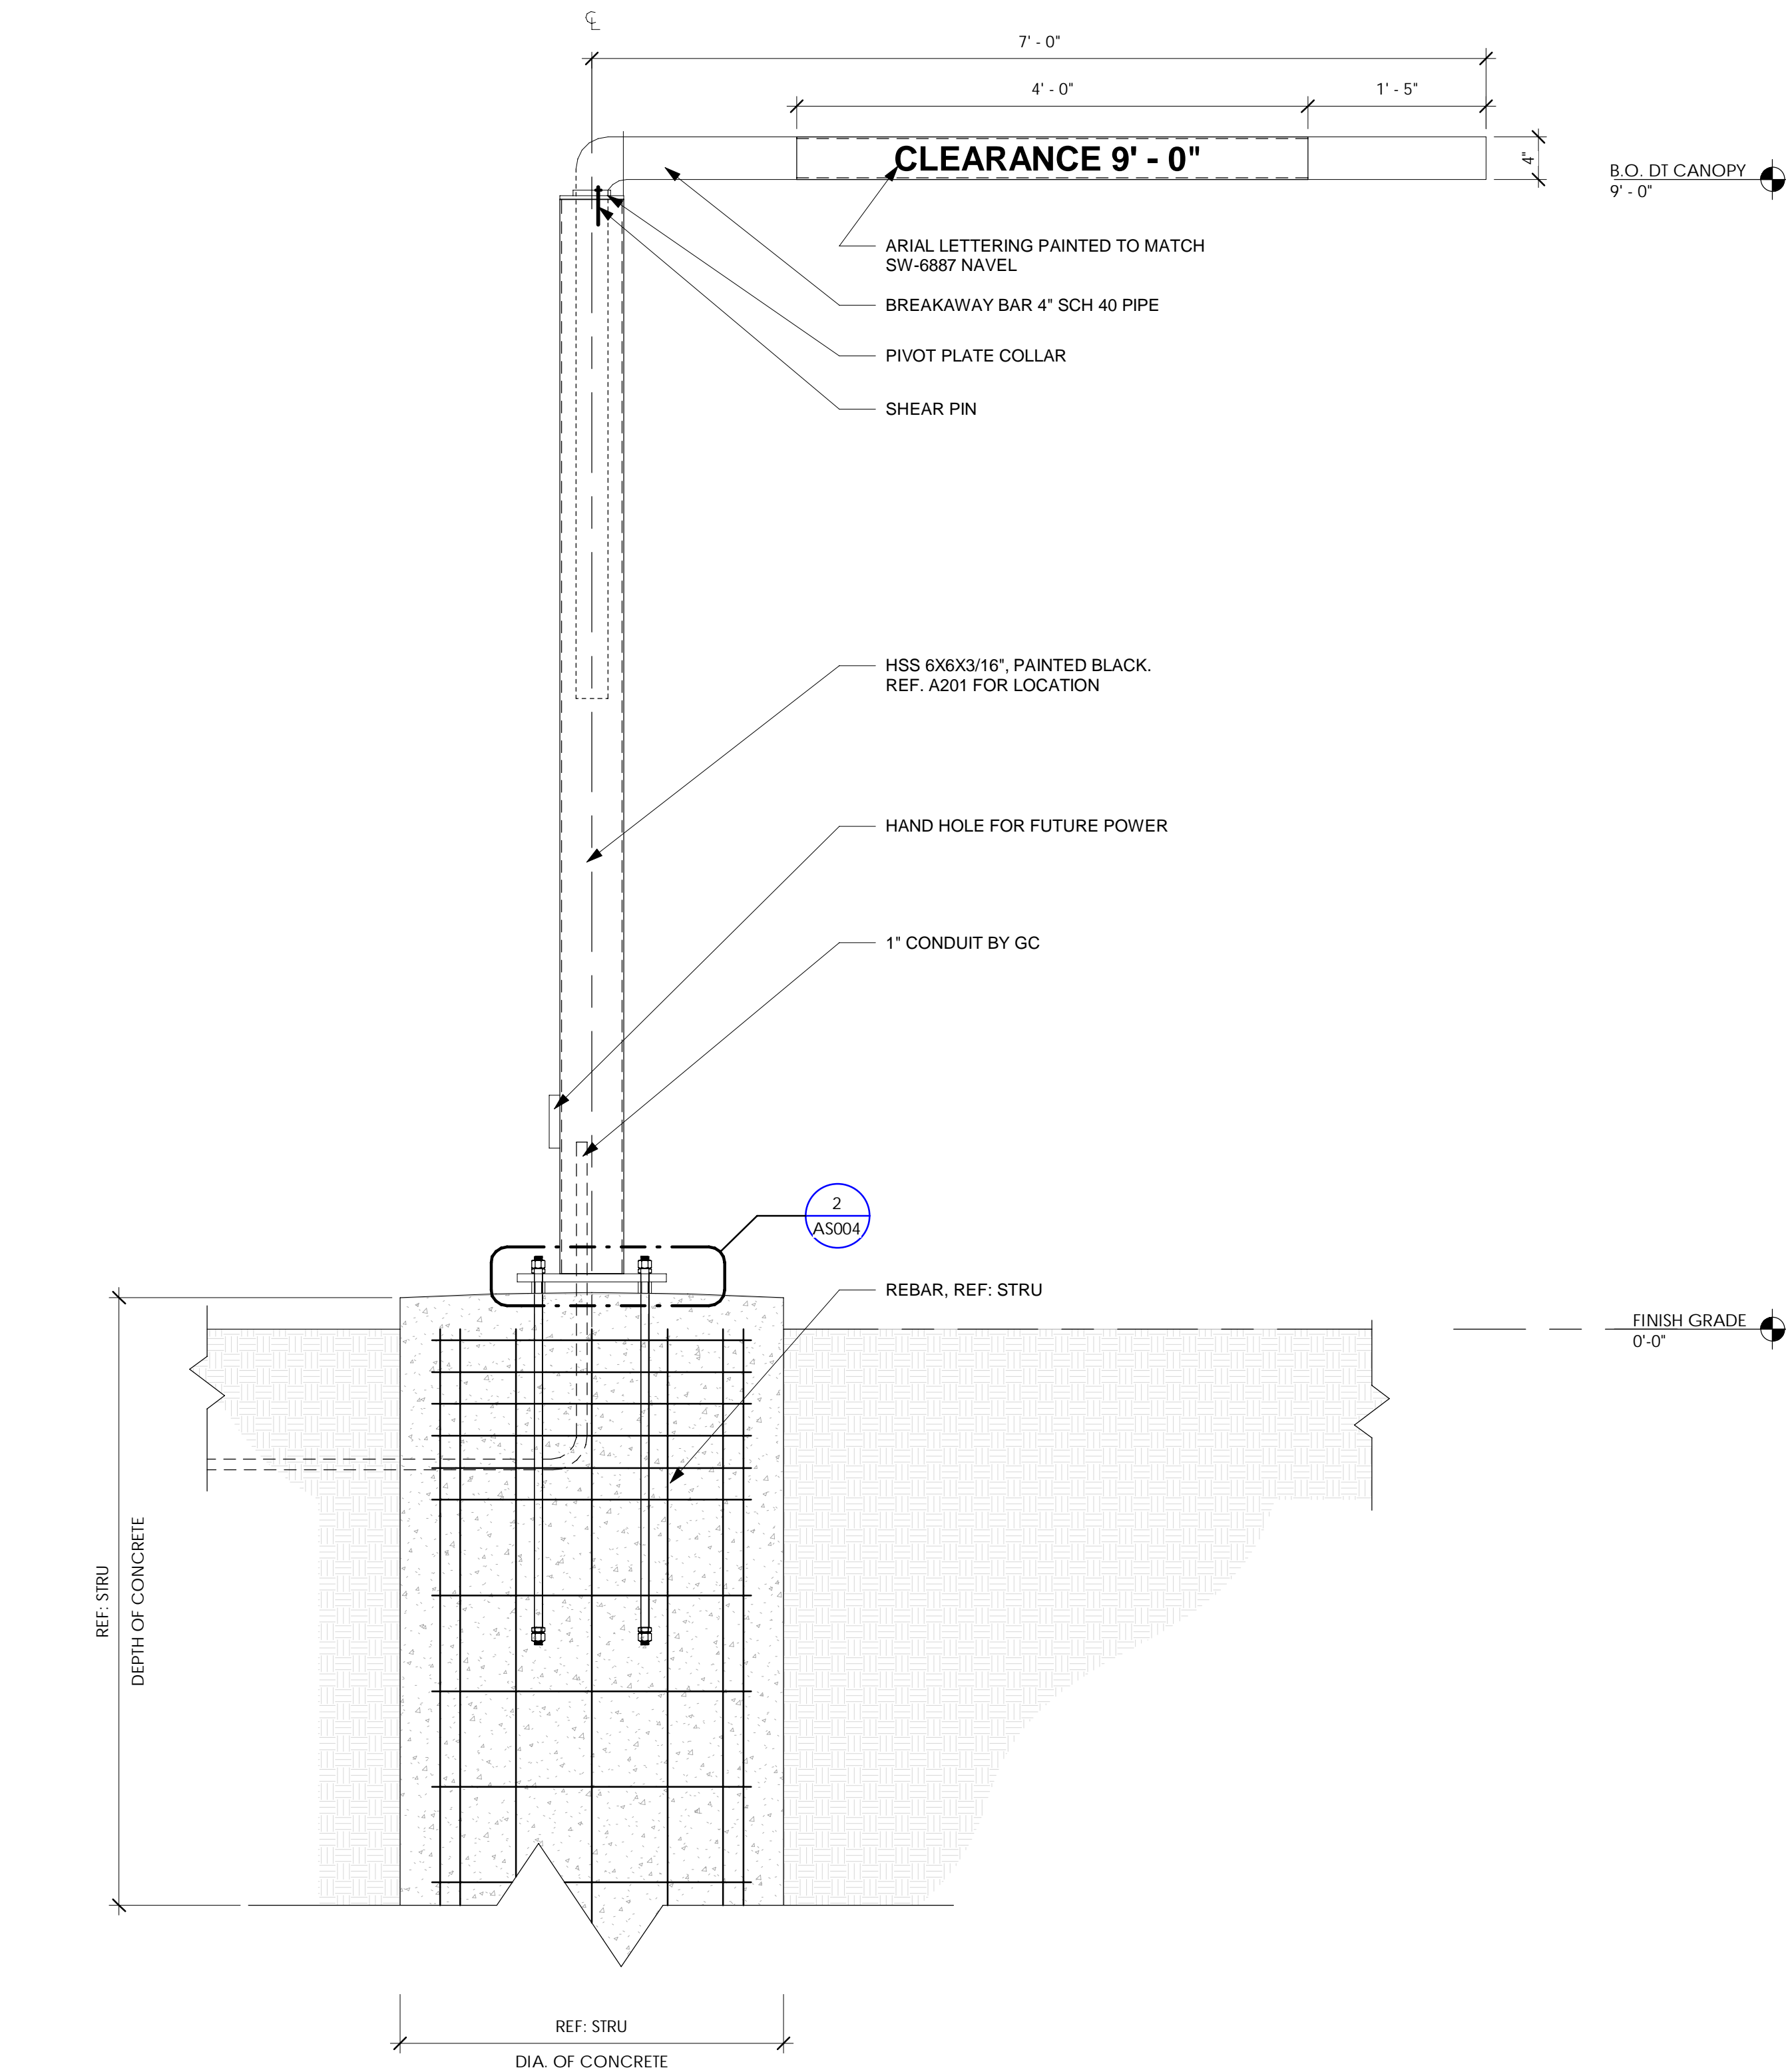


1 | DT CLEARANCE BAR
1" = 1'-0"

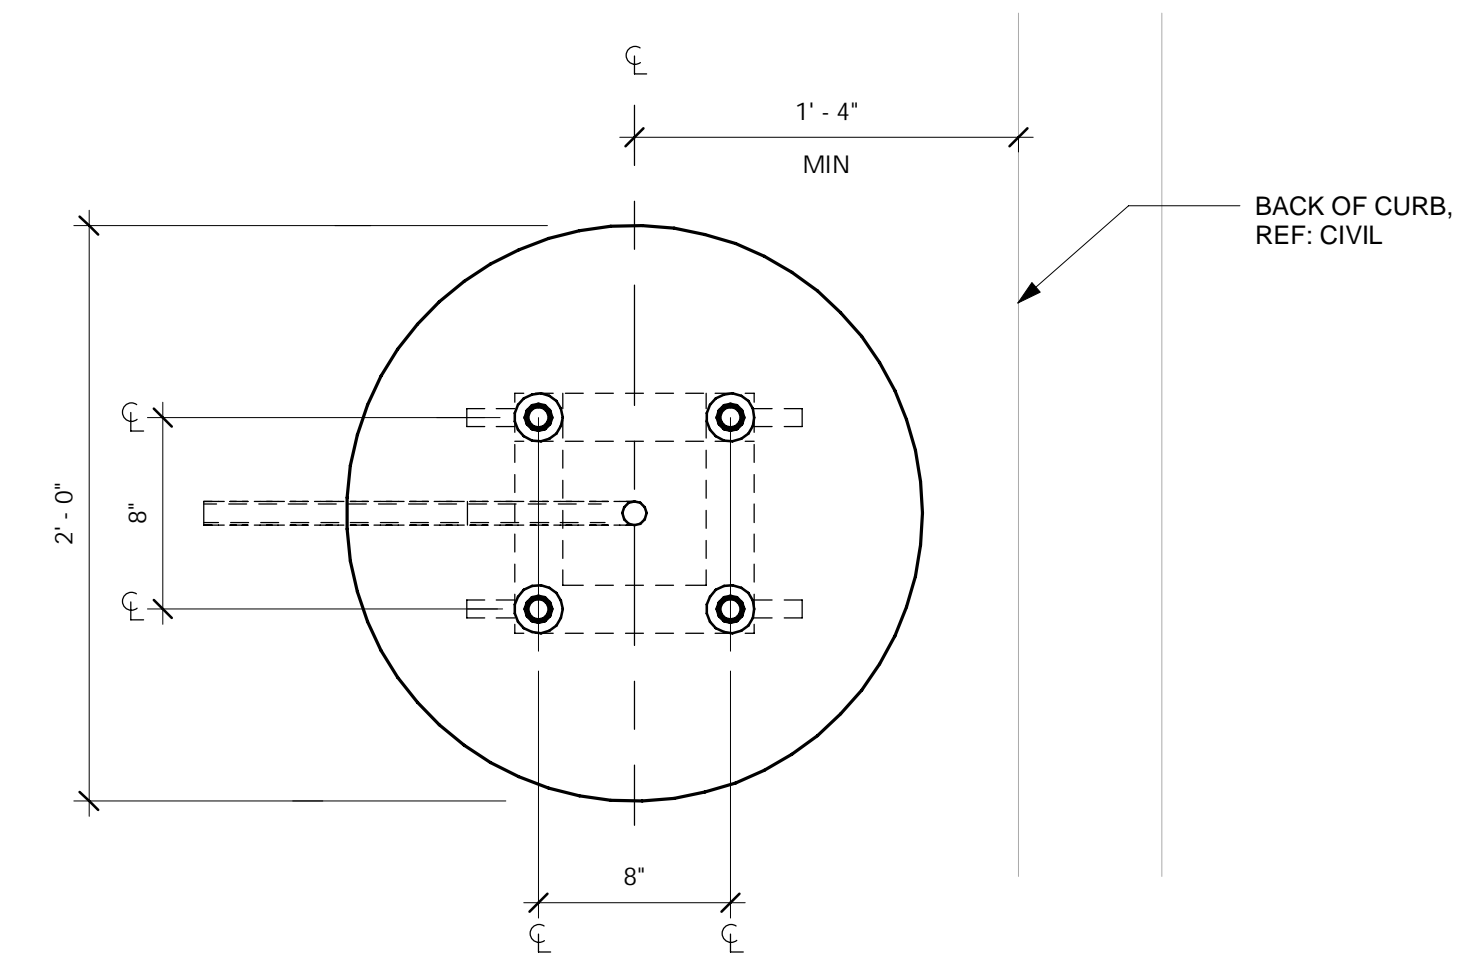

NOTE: SET ANCHOR BOLTS PARALLEL TO BACK OF CURB

2 | DT CLEARANCE BAR BASE PLATE
1 1/2" = 1'-0"

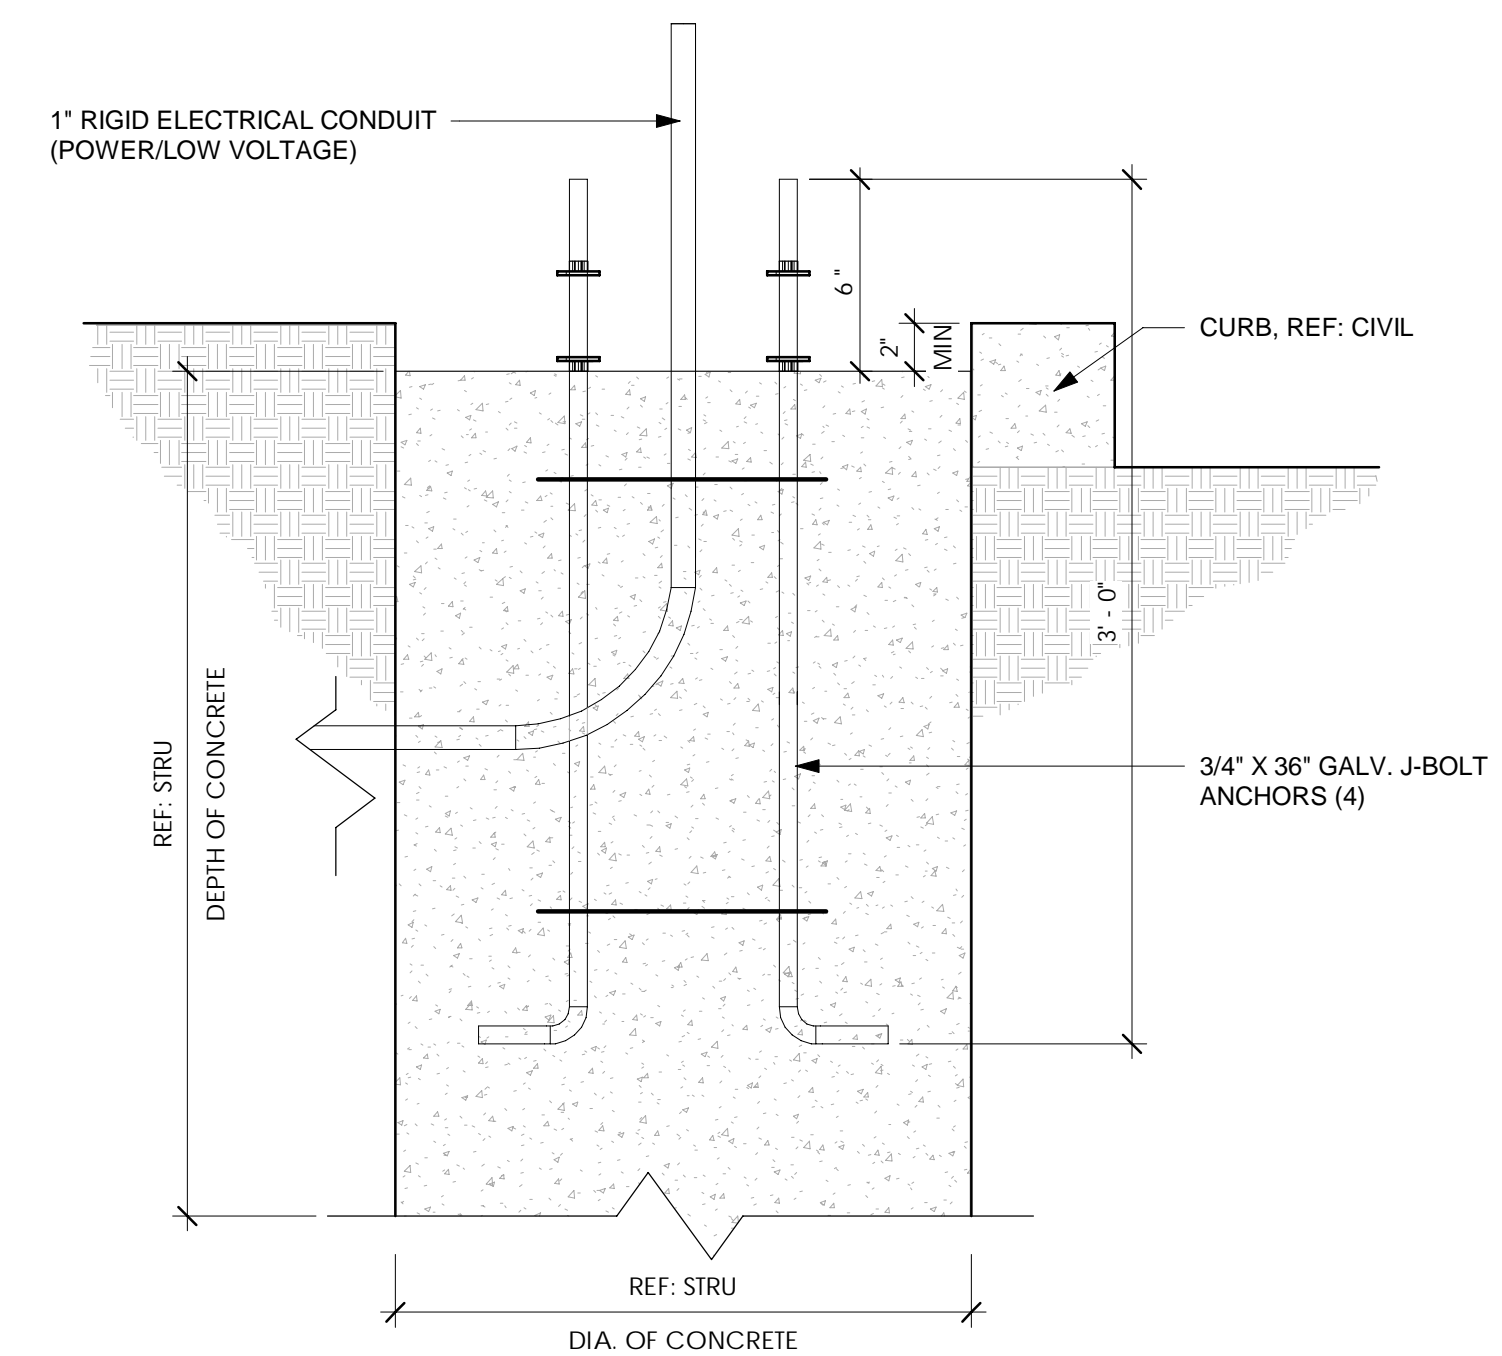

3 DT CLEARANCE BAR BASE PLATE - ELEVATION
1 1/2" = 1'-0"

- A. CONTRACTOR TO COORDINATE THE LOCATION OF ALL FLOOR DRAINS AND FLOOR SINKS WITH PLUMBING DRAWINGS AND KITCHEN DRAWINGS.
- B. CONTRACTOR TO COORDINATE THE LOCATION OF ALL FLOOR OUTLETS WITH OWNER, ARCHITECT AND ELECTRICAL DRAWINGS.
- C. COORDINATE FLOOR SINK ELEVATION WITH LOCAL JURISDICTION, TYP.

1. SLAB EDGE DIMENSION START POINT.
2. FLOOR DRAIN, REF: PLUMBING.
3. PRE-MANUFACTURED WALK IN COOLER BY OWNER.
4. MOP SINK PENETRATION LOCATION, INSTALL PER MANUFACTURER SPECIFICATIONS.
5. FLOOR SINK TYP, REF: PLUMBING, ALIGN TO FINISH FLOOR.
6. WASTELINE IN CENTER OF WALL FOR SINK, REF: PLUMBING.
7. TOILET PENETRATION, REF: PLUMBING.
8. 1" HME CONDUIT STUBBED THROUGH SLAB INTO WALL.
9. COLUMN EMBEDDED IN WALL, REF. STRU. DIMENSIONED TO CENTER.
10. FLOOR CLEAN OUT, TYP. REF: PLUMBING

1. ALL PLAN DIMENSIONS, UNLESS OTHERWISE NOTED, ARE TO:
 - A. FACE OF STUD
 - B. CENTERLINE OF DOOR OR WINDOW
 - C. EDGE OF SLAB EDGE
2. NOTED DIMENSIONS SHALL TAKE PRECEDENCE OVER SCALE DIMENSIONS; DETAILS OVER SMALLER SCALE DRAWINGS.
3. "FINISH FLOOR" REFERS TO TOP OF SLAB.
4. VERIFY ALL ROUGH-IN, CONCRETE PAD, OR PLATFORM DIMENSIONS FOR EQUIPMENT PROVIDED IN THIS PROJECT OR BY OTHERS.
5. CEILING HEIGHT DIMENSIONS ARE TO FINISHED SURFACES, UNLESS NOTED OTHERWISE.

- A. GENERAL CONTRACTOR SHALL VERIFY ALL CONDITIONS PRIOR TO CONSTRUCTION. REPORT ANY SIGNIFICANT DISCREPANCIES TO THE ARCHITECT.
- B. APPROVED SIGN INDICATING MAXIMUM OCCUPANCY FOR THE ROOM SHALL BE LOCATED NEAR MAIN EXIT. FINAL LOCATION SHALL BE VERIFIED BY FIRE MARSHAL.
- C. DO NOT SCALE DRAWINGS.
- D. PROVIDE BLOCKING IN WALLS FOR WALL MOUNTED EQUIPMENT/ACCESSORIES PER PLAN.
- E. REFER TO EQUIPMENT PLAN SHEET FOR ALL EQUIPMENT SCHEDULE INFORMATION AND LAYOUT.
- F. DIMENSION SHOWN ON THIS PLAN IS FROM FACE OF STUD TO FACE OF STUD AT INTERIOR, UNO.
- G. GENERAL CONTRACTOR TO COORDINATE ALL FLOOR SINKS AND FLOOR DRAINS WITH EQUIPMENT PLAN PRIOR TO PLACEMENT
- H. PROVIDE INTERNAL WALL BLOCKING FOR LADDERS, GRAB BARS, MIRRORS, COUNTERTOPS, CEILING FANS, AND OVERHEAD SHELVING.
- I. COORDINATE WITH STRUCTURAL, MECHANICAL, PLUMBING, ELECTRICAL, CIVIL DRAWINGS AND SLOPE REPORTS.
- J. WALL DIMENSIONS SHOWN FROM FACE OF STUD TO FACE OF STUD, UNO.
- K. WALLS SHOWN ON ALIGNMENT ARE IN ALIGNMENT WITH FINISH SURFACE
- L. FLOOR LEVEL 0'-0" IS TOP OF SLAB PER ARCHITECTURAL PLAN AND ELEVATION. THIS DOES NOT INCLUDE FLOOR FINISH. REFER TO CIVIL DRAWINGS FOR ACTUAL GRADE LEVEL.

Diagram illustrating the partitioning algorithm block:


- Input: $X \# m$
- Outputs:
 - PARTITION TYPE
 - CORE WIDTH
 - TOP OF WALL CONDITION
 - PARTITION MODIFIER(S)

*REFER TO A611 FOR INTERIOR WALL ASSEMBLIES
*REFER TO A621 FOR EXTERIOR WALL ASSEMBLIES


DOOR & WINDOW TAGS, REFER TO A631& A641

101 ← DOOR NUMBER


 STOREFRONT TYPE

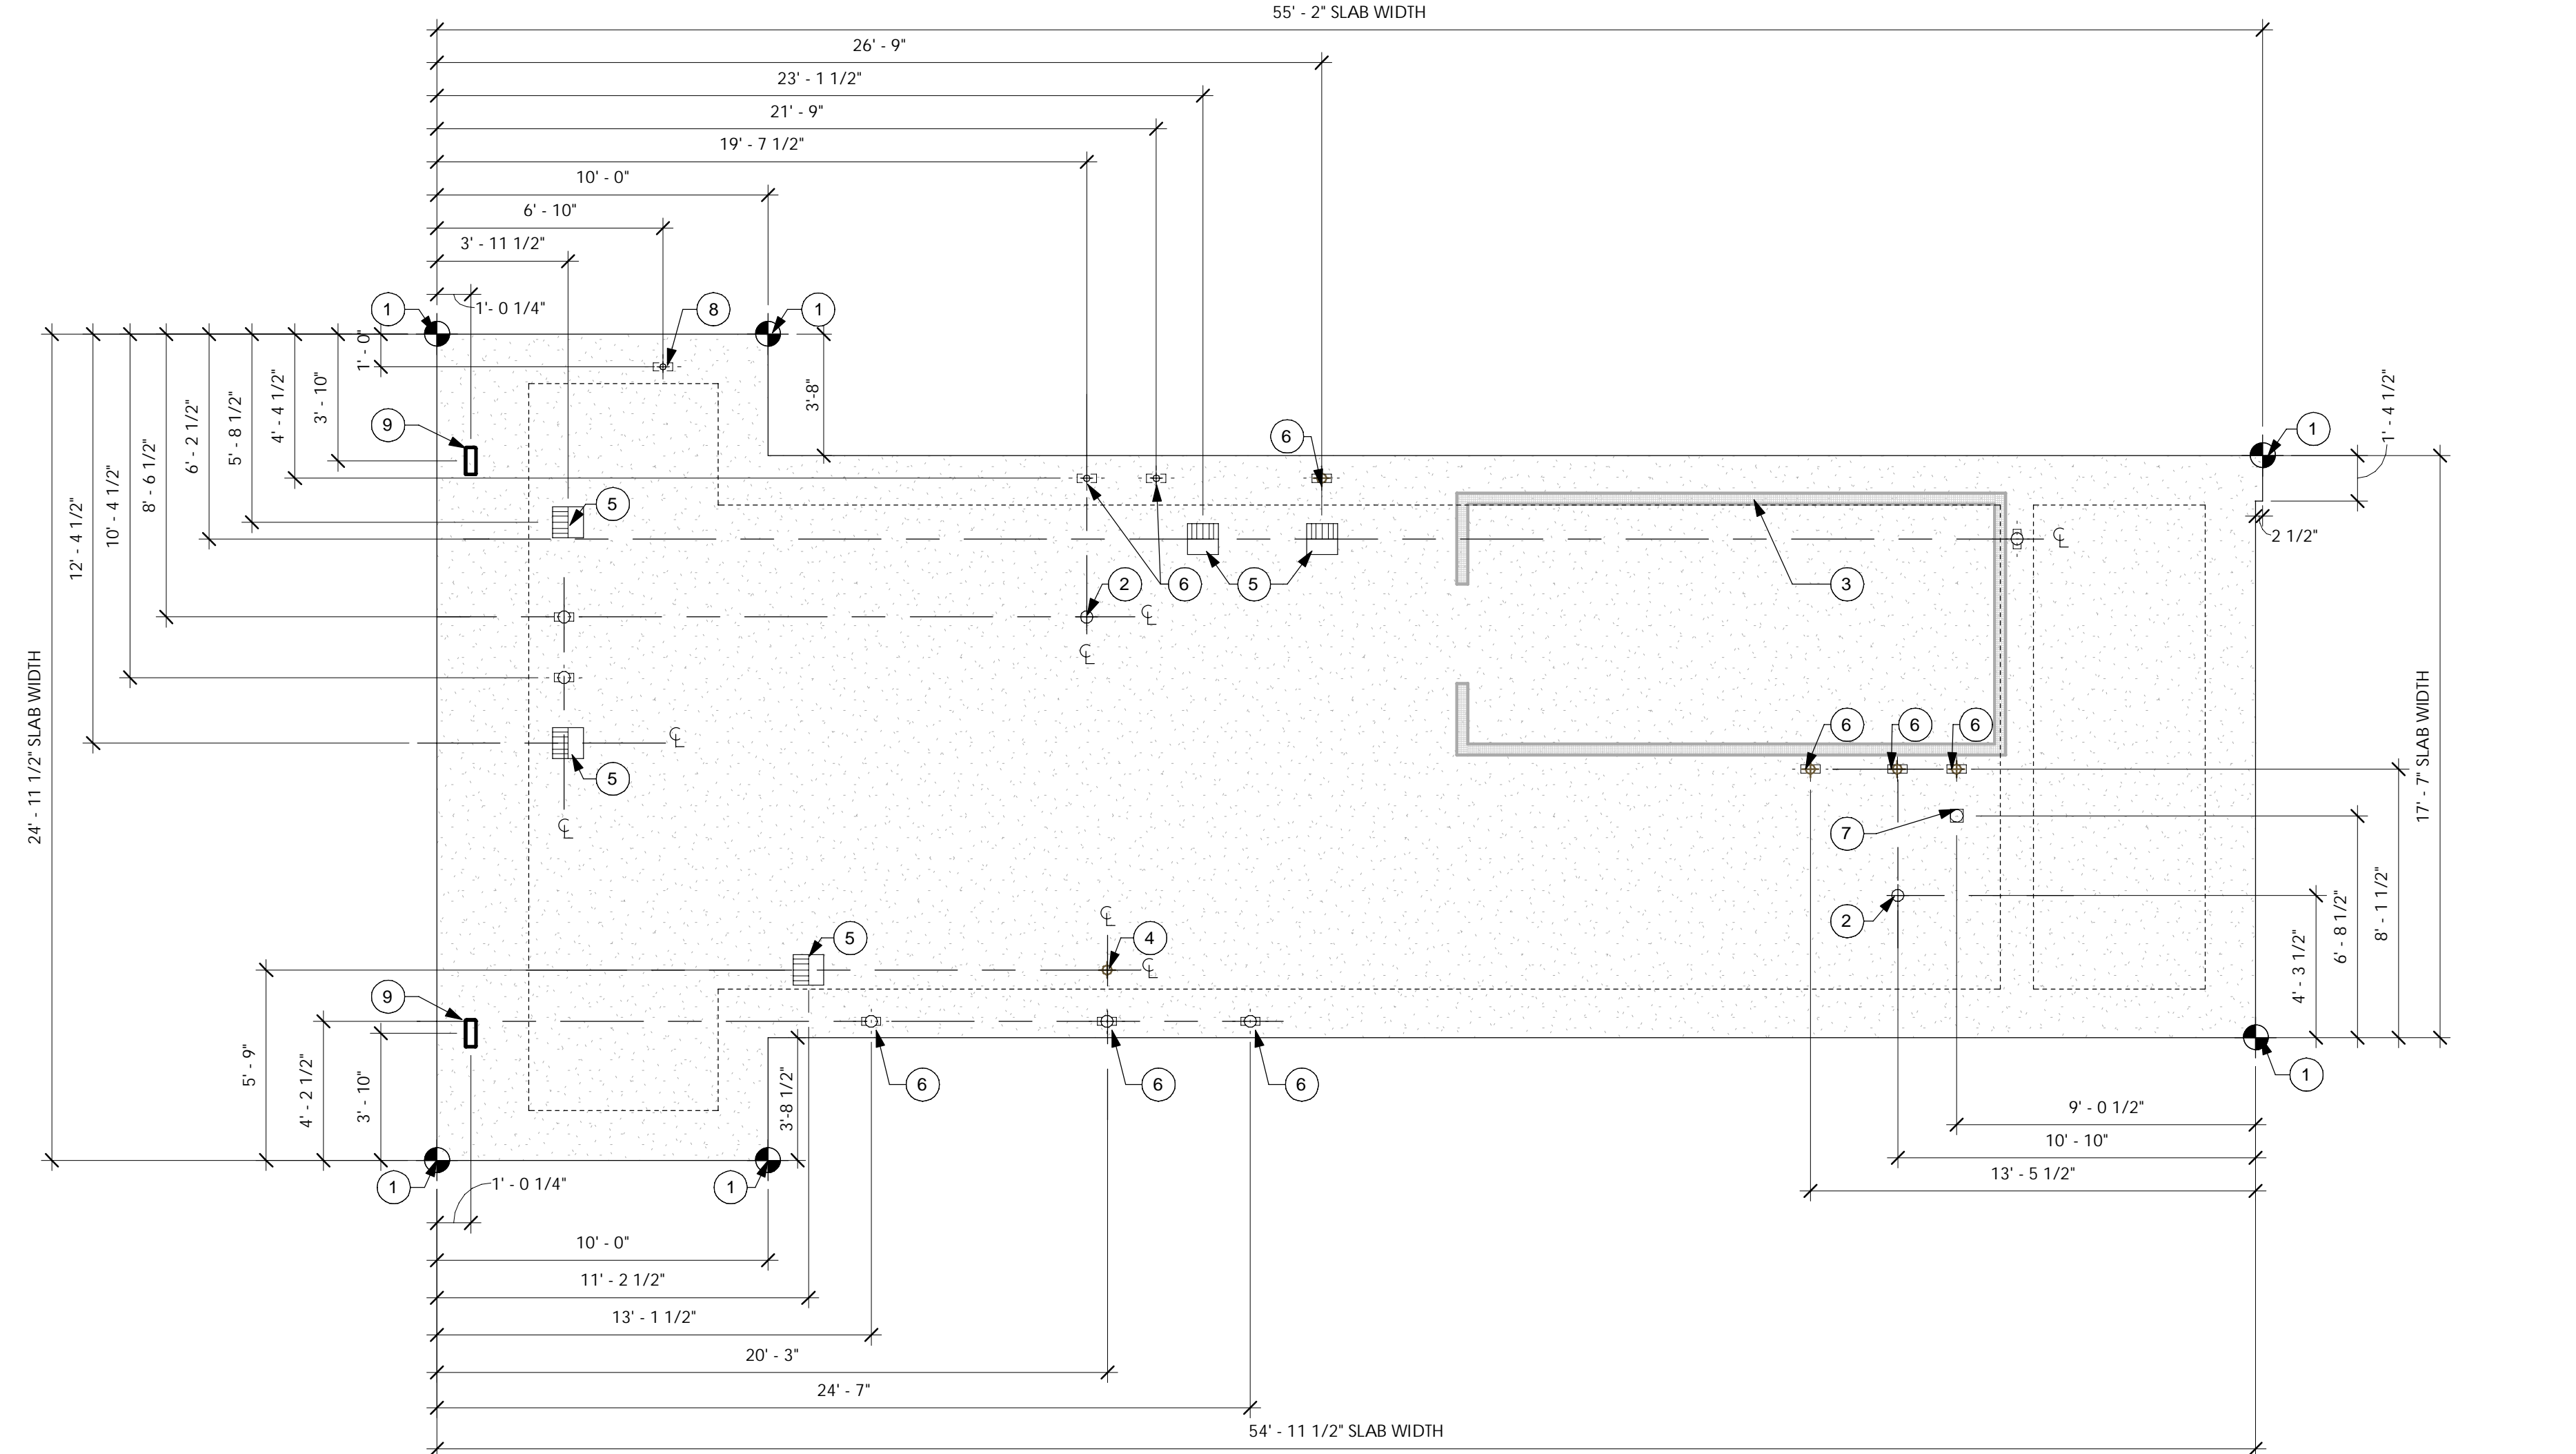

1 | SLAB PENETRATION PLAN
1/4" = 1'-0"

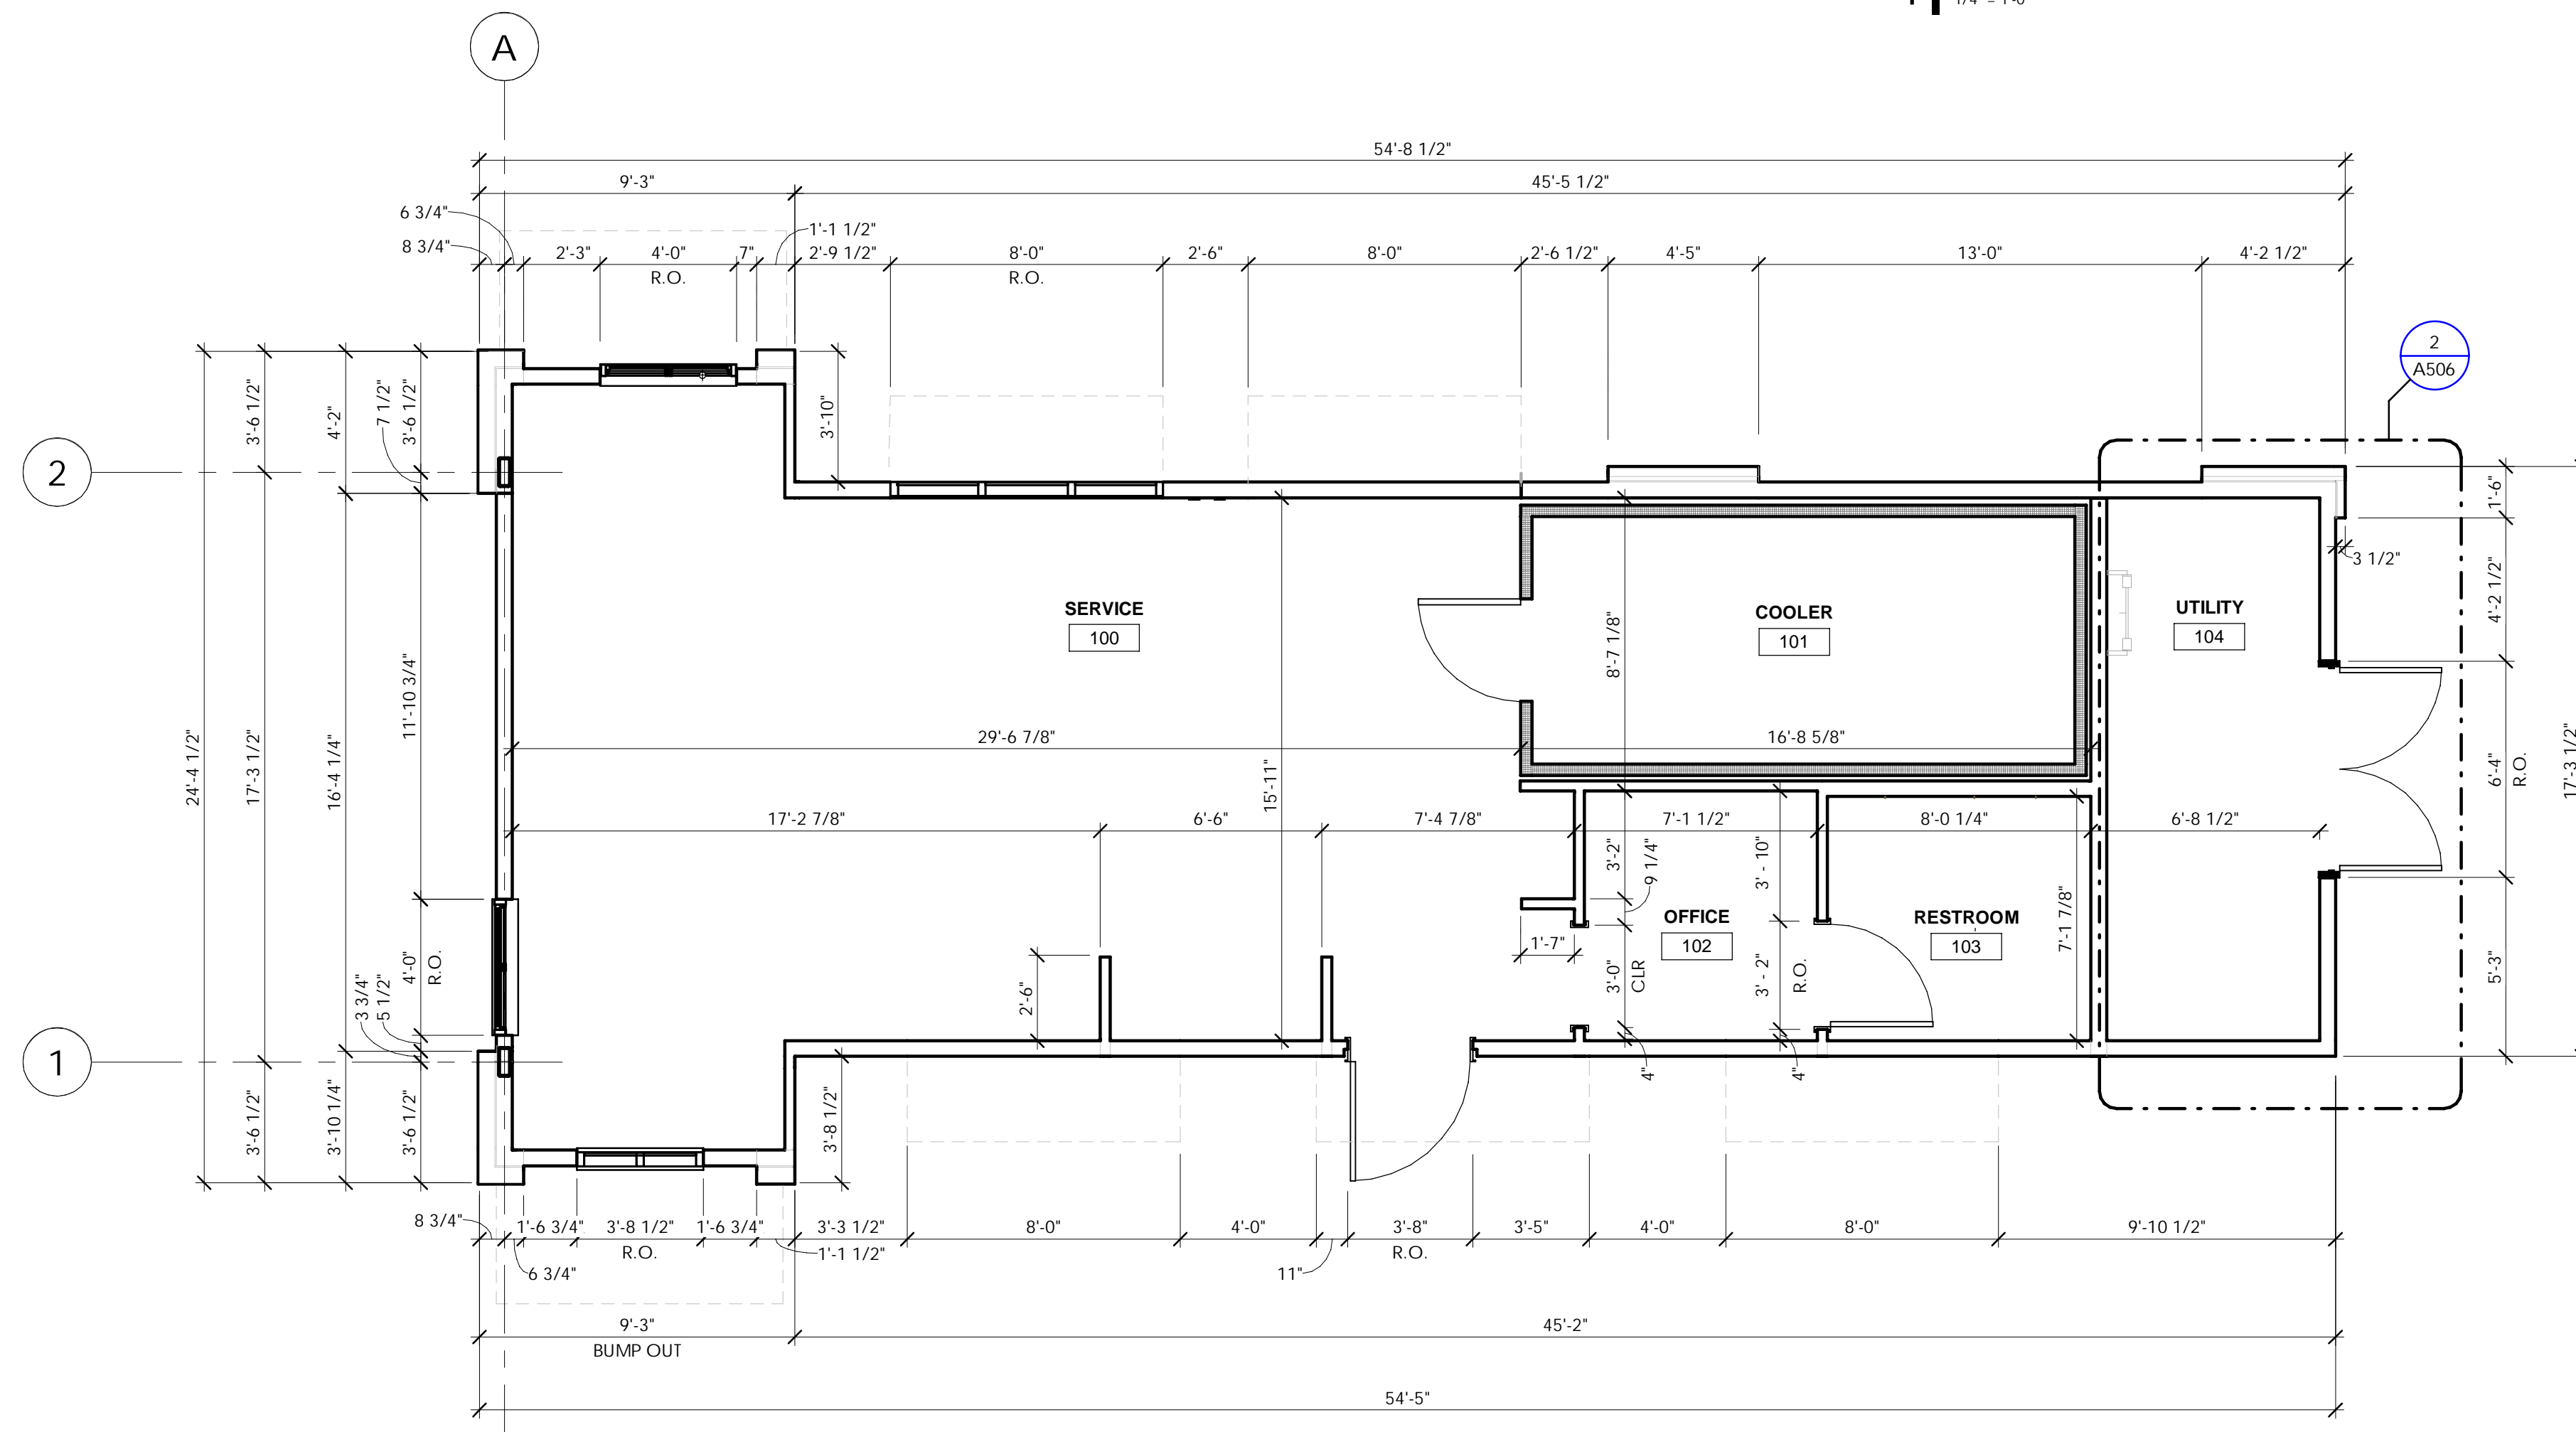

2 | DIMENSION FLOOR PLAN



CONTRACTOR SHALL VERIFY ALL
CONDITIONS AND DIMENSIONS AT THE
JOB SITE AND NOTIFY THE ARCHITECT
OF ANY DIMENSIONAL ERRORS,
OMISSIONS OR DISCREPANCIES BEFORE
BEGINNING OR FABRICATING ANY WORK.
DO NOT SCALE DRAWINGS.

[illegible]

PROJECT INFORMATION

PROJECT NO:	24-0087
ORIGINAL ISSUE:	06/01/2023
SCALE:	AS NOTED
DRAWN BY:	V. PEREZ
CHECKED BY:	J. JEFFERY

SHEET TITLE

DIMENSION FLOOR PLANS

SHEET NUMBER

A101

- A. GENERAL CONTRACTOR SHALL VERIFY ALL CONDITIONS PRIOR TO CONSTRUCTION. REPORT ANY SIGNIFICANT DISCREPANCIES TO THE ARCHITECT.
- B. APPROVED SIGN INDICATING MAXIMUM OCCUPANCY FOR THE ROOM SHALL BE LOCATED NEAR MAIN EXIT. FINAL LOCATION SHALL BE VERIFIED BY FIRE MARSHAL.
- C. DO NOT SCALE DRAWINGS.
- D. PROVIDE BLOCKING IN WALLS FOR WALL MOUNTED EQUIPMENT/ACCESSORIES PER PLAN.
- E. REFER TO EQUIPMENT PLAN SHEET FOR ALL EQUIPMENT SCHEDULE INFORMATION AND LAYOUT.
- F. DIMENSION SHOWN ON THIS PLAN IS FROM FACE OF STUD TO FACE OF STUD AT INTERIOR, UNO.
- G. GENERAL CONTRACTOR TO COORDINATE ALL FLOOR SINKS AND FLOOR DRAINS WITH EQUIPMENT PLAN PRIOR TO PLACEMENT
- H. PROVIDE INTERNAL WALL BLOCKING FOR LADDERS, GRAB BARS, MIRRORS, COUNTERTOPS, CEILING FANS, AND OVERHEAD SHELVING.
- I. COORDINATE WITH STRUCTURAL, MECHANICAL, PLUMBING, ELECTRICAL, CIVIL DRAWINGS AND SOIL REPORTS.
- J. WALL DIMENSIONS SHOWN FROM FACE OF STUD TO FACE OF STUD, UNO.
- K. WALLS SHOWN ON ALIGNMENT ARE IN ALIGNMENT WITH FINISH SURFACE
- L. FLOOR LEVEL 0'-0" IS TOP OF SLAB PER ARCHITECTURAL PLAN AND ELEVATION. THIS DOES NOT INCLUDE FLOOR FINISH. REFER TO CIVIL DRAWINGS FOR ACTUAL GRADE LEVEL.

*REFER TO A611 FOR INTERIOR WALL ASSEMBLIES
*REFER TO A621 FOR EXTERIOR WALL ASSEMBLIES

101 — DOOR NUMBER

X — STOREFRONT TYPE

- A. FLOOR FINISHES ARE CONTINUOUS. ALL FLOORING IS TO CONTINUE BENEATH ALL ELEMENTS IN CONTACT WITH THE FLOOR. CONTRACTOR TO COORDINATE OPENINGS AND PROVIDE FLOORING WITHIN OPENINGS NOT SPECIFICALLY IDENTIFIED.
- B. ALL PRODUCTS ARE TO BE PROVIDED AND INSTALLED PER MANUFACTURER'S PUBLISHED REQUIREMENTS AND FASTENED AND ADHERED ACCORDING TO APPROVED METHODS.
- C. ALL EXPOSED SURFACES ARE TO BE PREPARED TO RECEIVE NEW FINISHES.
- D. ALL WIRE FRAMES, CONDUIT, ACCESS PANELS, GILLES, FIRE EXTINGUISHER CABINETS, ELECTRICAL PANELS AND MECHANICAL DEVICES SHALL BE FINISHED TO MATCH THE ADJACENT SURFACE UNLESS NOTED OTHERWISE.
- E. CONTRACTOR TO REPORT ANY DISCREPANCIES IN PRODUCT QUALITY TO ARCHITECT FOR REVIEW.
- F. COMMENCEMENT OF WORK ON ANY SURFACE BY THE CONTRACTOR MEANS ACCEPTANCE OF THOSE SURFACES.
- G. FLOOR TRANSITION HEIGHTS NOT TO EXCEED 1/4" MAXIMUM. PROVIDE APPROPRIATE TRANSITION AT EACH LOCATION WHERE FLOOR MATERIAL CHANGES.
- H. RUN FLOORING UP TO MILLWORK AND UNDER OPEN COUNTERTOPS.
- I. COORDINATE COUNTERTOP FINISHES WITH OWNER
- J. THE PAINT COATING SYSTEM SHALL INCLUDE A PRIMER THAT SHALL CONTRAST WITH THE WHITE OR SPECIAL COLOR SELECTED FOR THE INTERMEDIATE AND FINISH COATS TO ALLOW OWNER AND CONTRACTOR TO VERIFY EACH COAT OF PAINT HAS BEEN INSTALLED
- K. COMPLY WITH REQUIREMENTS OF IBC SECTION 803.1.2, TABLE 805.13 FOR INTERIOR FINISH FLAME SPREAD CLASSIFICATION. CLASS C RATING FOR NON-SPRINKLERED SPACES.
- L. WALK IN COOLER SHALL COMPLY WITH IBC SECTION 2603 CENTER AND FREEZER WALLS. FOAM PLASTIC INSTALLED IN A MAXIMUM THICKNESS OF 10 INCHES IN COOLER AND FREEZER WALL SHALL:
 - a. HAVE FLAME SPREAD INDEX OF 25 OR LESS AND SMOKE DEVELOPED INDEX OF NOT MORE THAN 450, WHEN TESTED IN 4 INCHES (102mm) THICKNESS
 - b. HAVE FLASH IGNITION AND SELF-IGNITION TEMPERATURES OF NOT LESS THAN 600 DEG F TO 600 DEG F
 - c. HAVE A COVERING OF NOT LESS THAN 0.032 INCH ALUMINUM OR CORROSION RESISTANT STEEL HAVE A BASE METAL THICKNESS NOT LESS THAN 0.0160 INCH (0.4mm) AT ANY POINT.

BASE FINISH SCHEDULE		
MARK	MATERIAL	DESCRIPTION
QT-B	QUARRY TILE	DALTILE - HARVEST RED BLEND 5x6 COVE BASE Q-3565



- FLOOR FINISH, REFER TO "FLOOR FINISH SCHEDULE"
- BASE FINISH, REFER TO "BASE FINISH SCHEDULE"
- WALL FINISH, REFER TO "INTERIOR WALL FINISH SCHEDULE"

1. ALL PLAN DIMENSIONS, UNLESS OTHERWISE NOTED, ARE TO:
A. FACE OF STUD
B. CENTERLINE OF DOOR ON CENTERLINE OF ROOM OR CORRIDOR.
2. NOTED DIMENSIONS SHALL TAKE PRECEDENCE OVER SCALE DIMENSIONS; DETAILS OVER SMALLER SCALE DRAWINGS.
3. "T.O.SLAB" REFERS TO TOP OF SLAB
4. VERIFY ALL ROUGH-IN, CONCRETE PAD, OR PLATFORM DIMENSIONS FOR EQUIPMENT PROVIDED IN THIS PROJECT, OR BY OTHERS.
5. CEILING HEIGHT DIMENSIONS ARE TO FINISHED SURFACES, UNLESS NOTED OTHERWISE.

1. SERVICE WINDOW.
2. ADA COMPLIANT THRESHOLD, REF: A631.
3. PRE-MANUFACTURED WALK IN COOLER BY OWNER.
4. CONCRETE SLAB WITH BROOM FINISH.
5. DASHED LINE INDICATES CANOPY ABOVE.
6. MOP SINK PENETRATION LOCATION, INSTALL PER MANUFACTURER SPECIFICATIONS
7. SERVICE WINDOW W/ 4" DEEP SOLID SURFACE SHELF. REF: 11/A503
8. PROVIDE IN-WALL BLOCKING TO INSTALL COUNTERTOP SUPPORTS. REFER TO A400
9. ELECTRICAL SERVICE ENTRY AND TELEPHONE SERVICE LOCATION, REF: ELEC.
10. 3200 SERIES RECESSED KNOXBOX AT 60" AFF
11. WATER HEATER WITH MOP SINK BELOW
12. "NO SMOKING" SIGN LOCATION
13. ROOF ACCESS LADDER, REF: A506
14. ROOF DRAIN LEADERS
15. RECESSED COVERED HOSE BIB, ZURN WALL HYDRANT Z1350.
REF: PLUMB, REF: 9/A504
16. POS MONITOR MOUNTED ON STAINLESS STEEL SHELVES BY OWNER. REF:
EQUIPMENT PLAN, TYP


A. WALK IN COOLER WALLS, CEILINGS, AND FLOOR / WALL JUNCTURES SHALL BE METAL OR EQUAL AND PROPERLY COVERED

B. PROVIDE 2/3" RADIUS QUARRY TILE COVE BASE.


C. GROUT AND MORTAR SHALL BE SEALED, SMOOTH AND FINISHED FLUSH WITH THE SURFACE OF ALL TILES, BRICK, STONE, AND OTHER SIMILAR SURFACES. IF EPOXY GROUT NOT USED, GROUT NEEDS TO BE SEALED.

1. TILE TO CONTINUE UNDER COOLER WALLS.
2. ADA COMPLIANT THRESHOLD, REF: A631.
3. PRE-MANUFACTURED WALK IN COOLER BY OWNER.
4. CONCRETE SLAB WITH BROOM FINISH.
5. DASHED LINE INDICATES CANOPY ABOVE.
6. ROOF DRAIN LEADERS.
7. FLOOR DRAIN, REF: PLUMBING.
8. FLOOR SINK TYP, REF: PLUMBING.
9. FLOOR CLEAN OUT, TYP, REF: PLUMBING

INTERIOR WALL FINISH SCHEDULE		
MARK	MATERIAL	DESCRIPTION
FRP-1	FRP (WHITE)	MARLITE S100G WHITE SMOOTH SURFACE, CLASS C
P-1	PAINT	DOORS: 1 COAT PRIMER WITH 2 COATS SEMI GLOSS LATEX. SHERWIN WILLIAMS SW-7004 SNOWBOUND WHITE
P-2	PAINT	STEEL: GLOSS LATEX. DOORS: 1 COAT EXTERIOR PRIMER, 2 COATS EXTERIOR SEMI GLOSS. SHERWIN WILLIAMS SW-7048 URBANE BRONZE
IP	INSULATED PANELS	INSULATED WALL PANELS BY COOLER MANUFACTURER
S-1	SS U-CHANNEL	FULL HEIGHT STAINLESS STEEL U-CHANNEL WITH 2" WING SIZE; 18 GAUGE; #4 SATIN FINISH; 90° ANGLES
S-2	SS CORNER GUARD	4" - 0" HEIGHT STAINLESS STEEL CORNER GUARD WITH 2" WING SIZE; 18 GAUGE; #4 SATIN (BRUSHED) FINISH; 90° ANGLE. TYPE 304

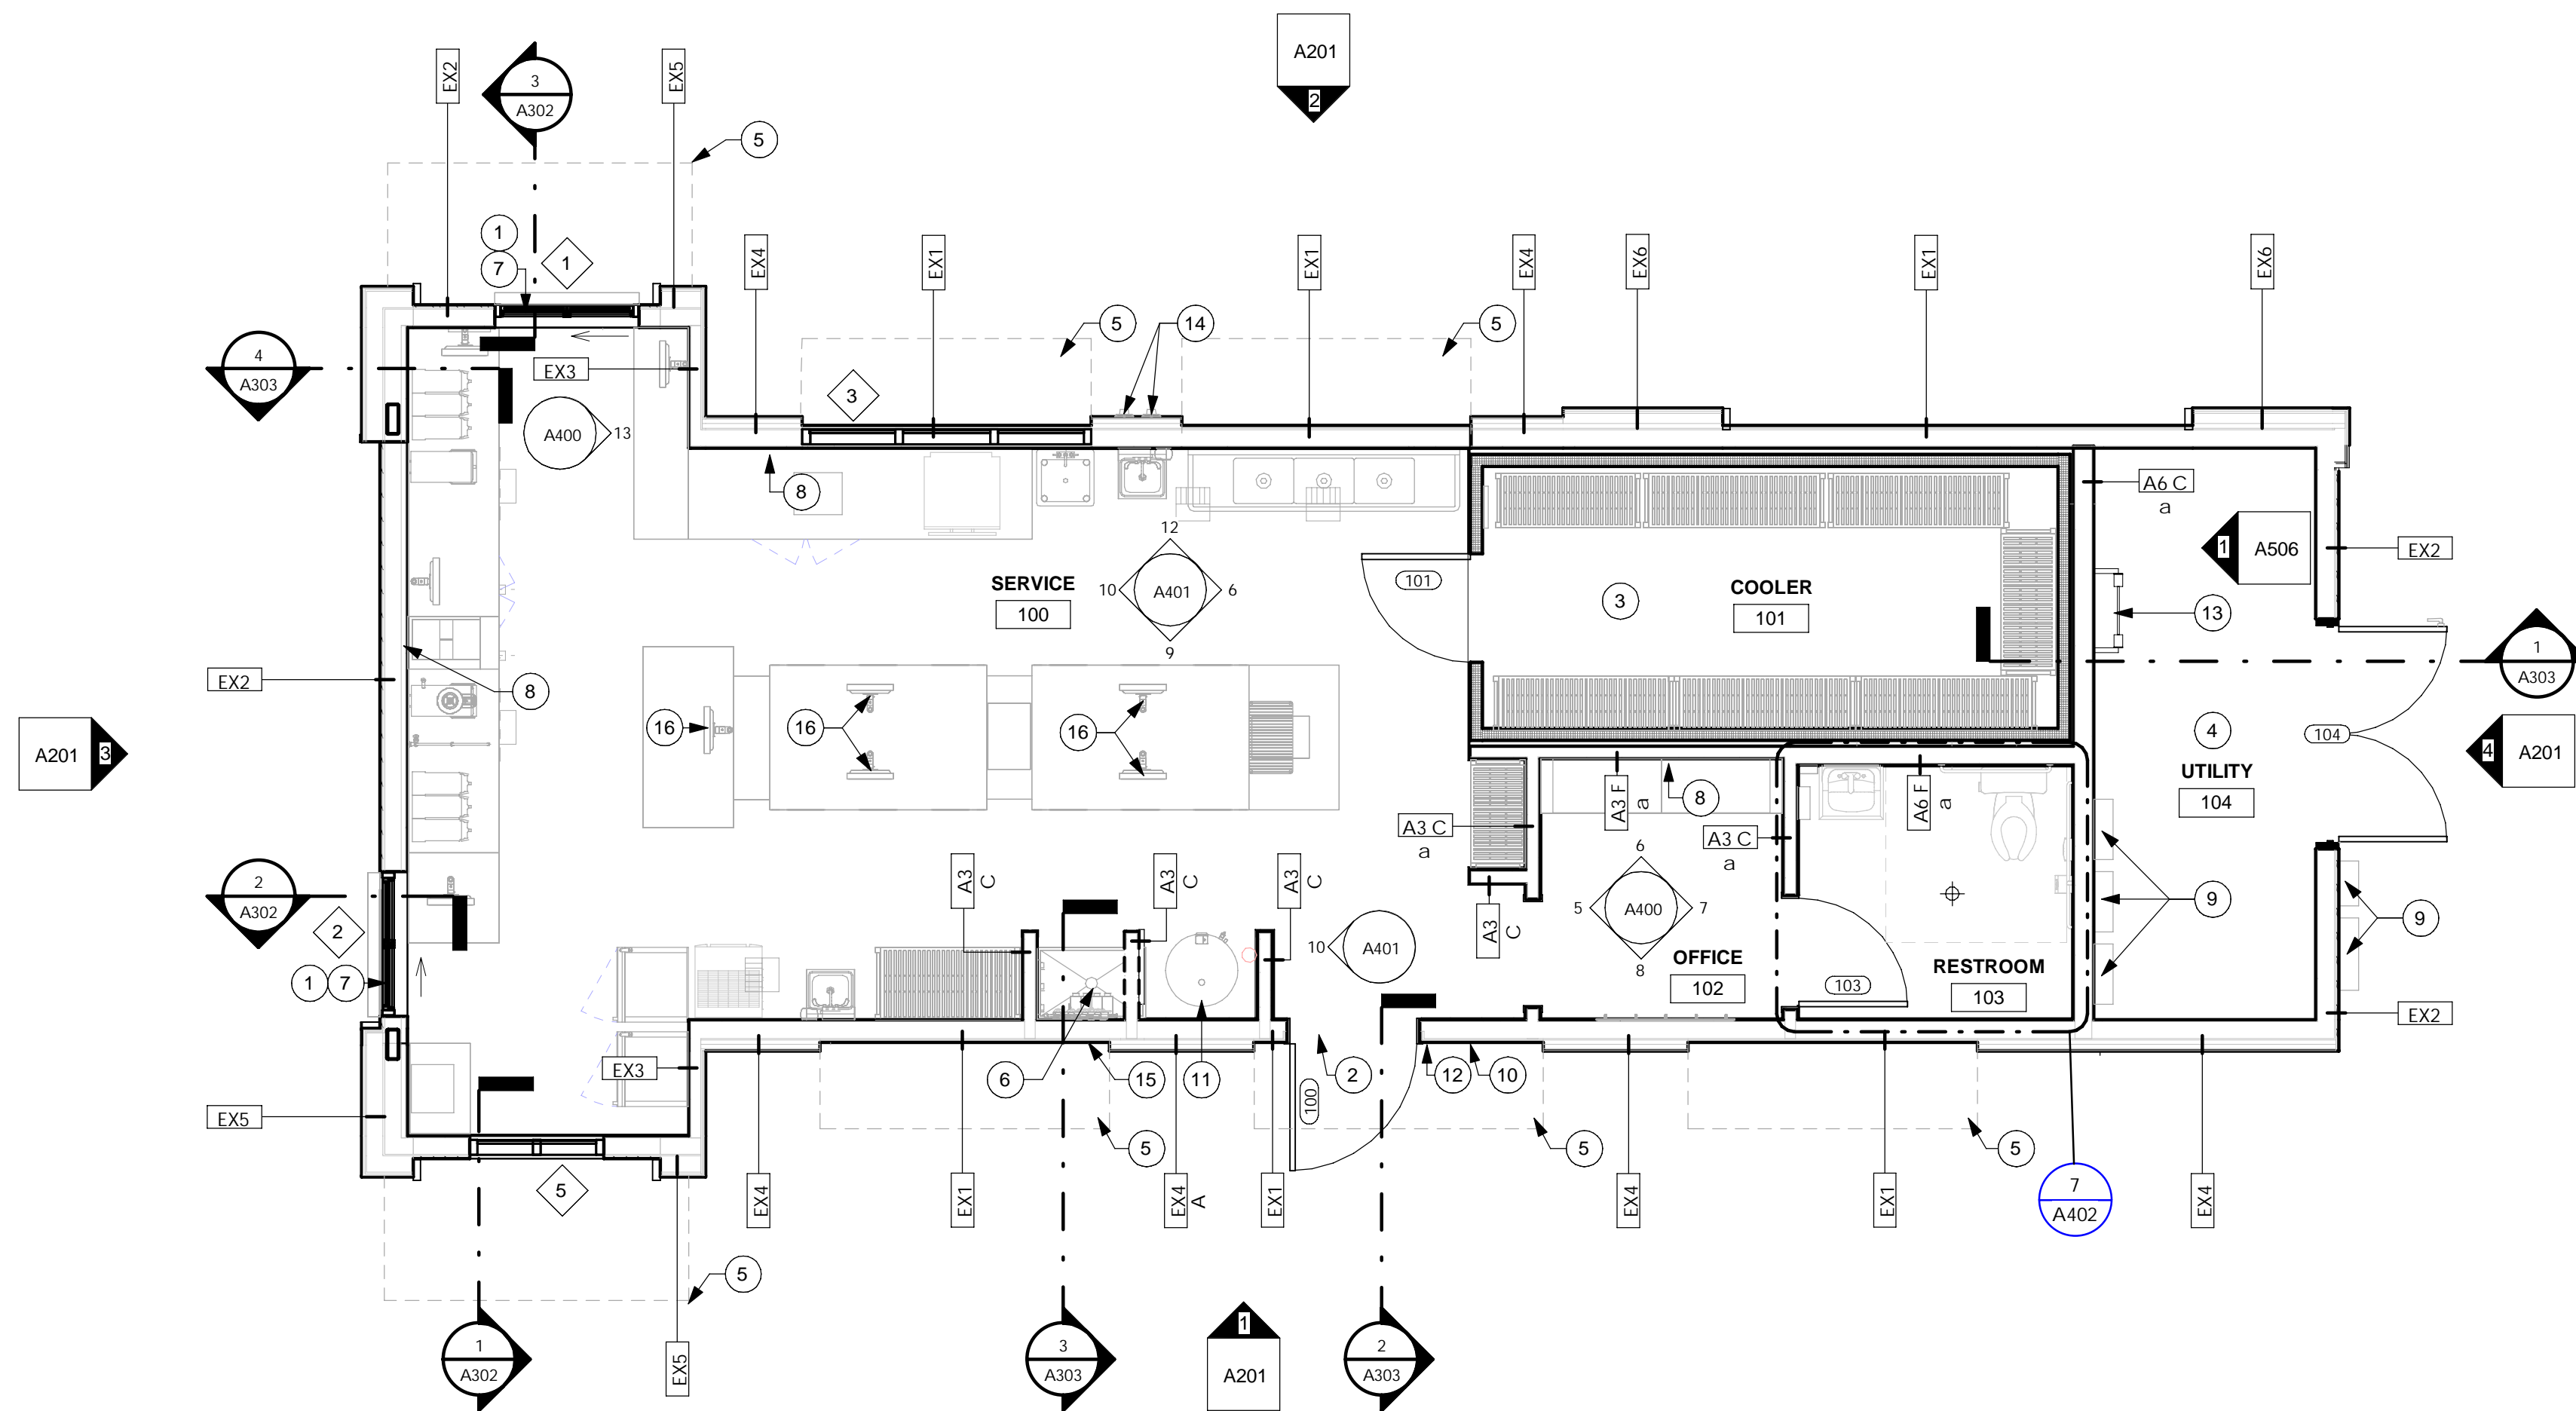

1 FLOOR PLAN
1/4" = 1'-0"

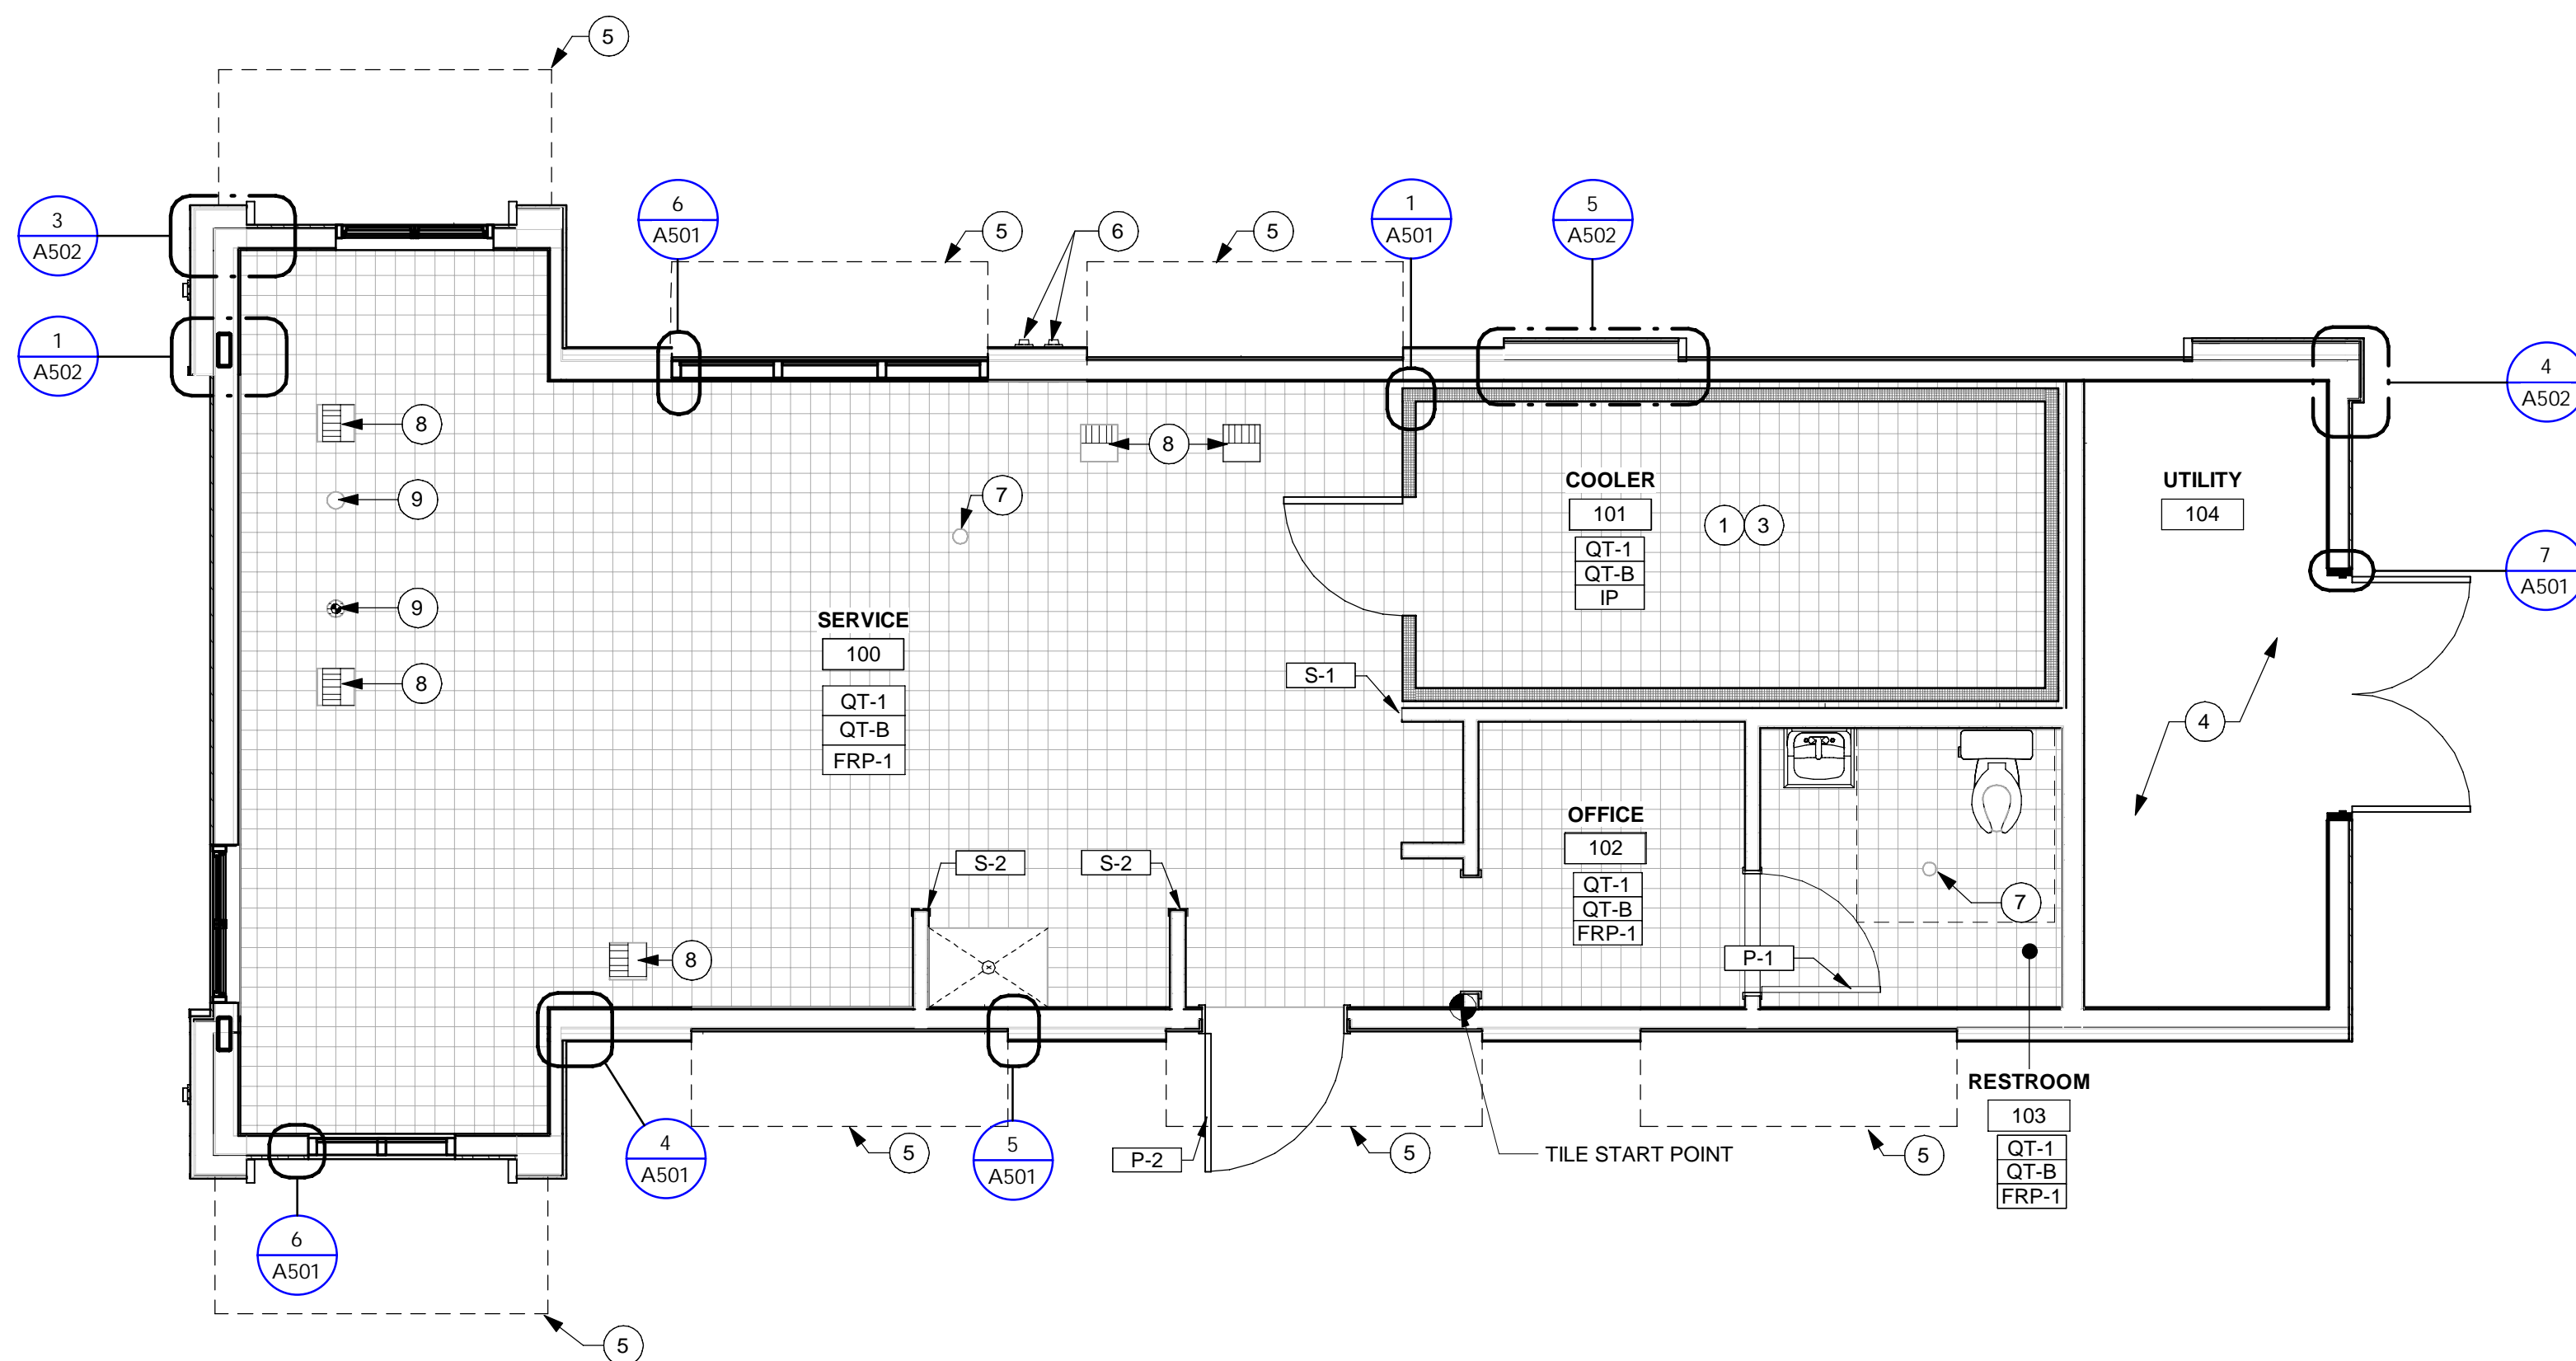

2 | FINISH FLOOR PLAN
1/4" = 1'-0"



#2001
610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3
PROTOTYPE VERSION 2.00

PROTOTYPE VERSION 2.00



513 MAIN STREET #300
FORT WORTH TX 76102

SEAL



PERMIT SET: 04/12/2024

CONTRACTOR SHALL VERIFY ALL
CONDITIONS AND DIMENSIONS AT THE
JOB SITE AND NOTIFY THE ARCHITECT
OF ANY DIMENSIONAL ERRORS,
OMISSIONS OR DISCREPANCIES BEFORE
BEGINNING OR FABRICATING ANY WORK
DO NOT SCALE DRAWINGS.

[illegible]

PROJECT NO:	24-0087
ORIGINAL ISSUE:	06/01/2023
SCALE:	AS NOTED
DRAWN BY:	V. PEREZ
CHECKED BY:	J. JEFFERY

SHEET TITLE

FLOOR PLANS

SHEET NUMBER

A111

513 MAIN STREET #300
FORT WORTH TX 76102

SEAL



PERMIT SET: 04/12/2024

CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DIMENSIONAL ERRORS. OMISSIONS OR DISCREPANCIES BEFORE BEGINNING OR FABRICATING ANY WORK. DO NOT SCALE DRAWINGS.

ISSUE	DATE	DESCRIPTION

PROJECT INFORMATION

PROJECT NO:	24-0087
ORIGINAL ISSUE:	06/01/2023
SCALE:	AS NOTED
DRAWN BY:	P. C
CHECKED BY:	J. JEFFERY

SHEET TITLE

REFLECTED CEILING PLAN

SHEET NUMBER

A121

LATERAL FORCE BRACING MEMBERS MUST BE SPACED A MIN OF 6' FROM ALL HORIZONTAL PIPING OR DUCT WORK THAT IS NOT PROVIDED W/ BRACING RESTRAINTS FOR HORIZ FORCES. BRACING WIRES MUST BE ATTACHED TO THE GRID & TO THE STRUCTURE IN SUCH A MANNER THAT THEY CAN SUPPORT A DESIGN LOAD OF NOT LESS THAN 200 POUNDS OR THE ACTUAL LOAD, WHICHEVER IS GREATER, WITH A SAFETY FACTOR OF 2.

TWO (2) NO. 12 GAUGE WIRES MUST BE SECURED FROM LIGHT & MECHANICAL FIXTURES AT OPPOSING CORNERS ALONG THE FIXTURE'S DIAGONAL. WIRES MAY BE SLACK.

NOTE:
FOUR NO. 12 GAUGE WIRES MUST BE SECURED TO THE MAIN RUNNER WITHIN 2' OF THE CROSS RUNNER INTERSECTION AND SPAYED 90 DEGREES FROM EACH OTHER AT AN ANGLE NOT EXCEEDING 45 DEGREES FROM THE PLANE OF THE CEILING. (MAY BE SLACK)

PROVIDE MINIMUM OF 2 SCREWS AT OPPOSITE CORNERS OF SUPPORT WIRES, OR SCREW ON T-BAR SAFETY CLIPS AT SIDES OR ENDS.

SUSPENDED
CEILING GRIDLIGHT FIXTURE
(LESS THAN 56 LBS)2 | CEILING LIGHT DETAIL
3/8" = 1'-0"


REFLECTED CEILING PLAN GENERAL NOTES

- GENERAL CONTRACTOR SHALL VERIFY ALL CONDITIONS, DIMENSIONS, AND ASSEMBLIES PRIOR TO CONSTRUCTION. REPORT ANY SIGNIFICANT DISCREPANCIES TO THE OWNER AND ARCHITECT.
- MECHANICAL, PLUMBING, ELECTRICAL, FIRE SPRINKLER, AND CEILING SUBCONTRACTORS SHALL COORDINATE THEIR WORK. IN CASE OF CONFLICT, THE REFLECTED CEILING PLAN SHALL TAKE PRECEDENCE.
- COORDINATE WITH MECHANICAL AND ELECTRICAL FOR ADDITIONAL REQUIREMENTS.
- CEILING HEIGHTS SHOWN ARE ABOVE FINISH FLOOR
- DO NOT SCALE DRAWINGS.
- ALL ELECTRICAL EQUIPMENT SHALL BE NEW. SUB-CONTRACTOR TO PROVIDE COPY OF DATED SALES RECEIPT IF REQUIRED BY THE OWNER.
- INSTALL EXHAUST FAN PER MANUFACTURER'S INSTRUCTION. PROVIDE BLOCKING AS REQUIRED PER MANUFACTURER'S RECOMMENDATION.
- GC TO COORDINATE SECURITY CAMERA AND SPEAKER LOCATIONS SHOWN WITH ELEC.


REFLECTED CEILING PLAN GENERAL NOTES

FRP	FIBER REINFORCED PANELS - MARLITE S100G, SMOOTH WHITE
ACT	WHITE CEILING TILE - 2X4 VINYL WASHABLE TILE IN SURFACE MOUNTED GRID. GRID TO BE SUSPENDED. USG OR APPROVED EQUIVALENT
IP	INSULATED PANELS: INSULATED PANEL BY COOLER MANUFACTURER
OTS	OPEN TO STRUCTURE. PAINT AND PRIME EXPOSED SURFACES WHITE

CEILING TAG



MATERIAL TAG

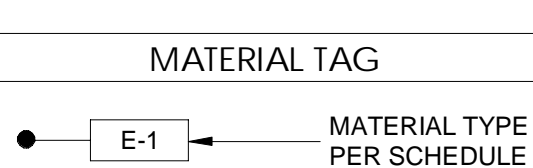

NO SUSPENDED LIGHT FIXTURE, DECORATIVE ITEM OR SIMILAR DECORATIVE ITEMS SHALL BE INSTALLED LOWER THAN 80" A.F.F. AT ANY CIRCULATION PATH OR ACCESSIBLE ROUTE

NO DEVICE OR DECORATIVE OBJECT LESS THAN 80" A.F.F. SHALL PROJECT MORE THAN 4" FROM ANY WALL IN ANY CIRCULATION PATH OR ACCESSIBLE ROUTE


ELECTRICAL/MECHANICAL LEGEND

NOTE: COORDINATE WITH ELECTRICAL AND MECHANICAL DRAWINGS

G4	2x4 LED BACKLIT FLAT PANEL MODEL # NUVO 65-572
S4	1x4 LED BACKLIT FLAT PANEL MODEL # NUVO 65-573
D	6" ROUND DIRECT MOUNT RECESSED LED MODEL # SMD6R129SWHE / SMD6RTRMWH
W	LED WALL PACK MODEL # SLIM18N
WS	WALL SCONCE - CAMMAN MODEL # W425 LANE, TO BE MOUNTED 5' - 0" AFF
---	TAPE LIGHT - NOVA FLEX - WET LOCATION 24VDC HIGH DENSITY LED: NF-PRO-O-60-24V-4100K
⊗	AIR SUPPLY DIFFUSER
▧	AIR RETURN REGISTER
⊠	EXHAUST FAN
SD	SMOKE DETECTOR

REFLECTED CEILING PLAN KEYNOTES

- STAINLESS STEEL SHELVES SUSPENDED FROM TRUSSES. SEE EQUIPMENT PLAN.
- WALL/CEILING MOUNTED EMERGENCY/EXIT SIGN.
- PRE-MANUFACTURED WALK IN COOLER WITH INTEGRAL CEILING.
- CANOPY ABOVE.
- ROOF ACCESS LADDER.
- ACT START POINT.
- TAPE LIGHT ON ALL THREE SIDES.
- ELECTRICAL CONDUIT THROUGH CEILING, TYP. REFER TO LOW VOLTAGE PLANE.
- EXHAUST FAN, REF: MECHANICAL.
- AIR SUPPLY, REF: MECHANICAL.
- AIR RETURN, REF: MECHANICAL.
- ISO CORD FASTENED TO VERTICAL, FED FROM OVERHEAD, HANGING 4" AFF.
- CEILING MOUNTED OCCUPANCY SENSOR.
- SMOKE DETECTOR
- THERMOSTAT SENSOR
- CONDUIT FOR SECURITY CAMERA

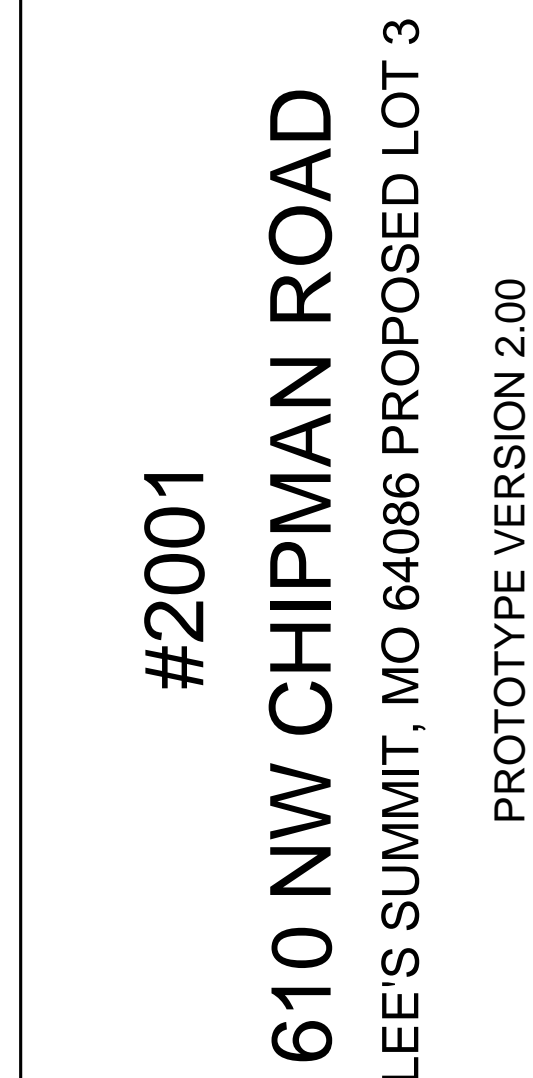


CONTRACTOR SHALL VERIFY ALL
CONDITIONS AND DIMENSIONS AT THE
JOB SITE AND NOTIFY THE ARCHITECT
OF ANY DIMENSIONAL ERRORS,
OMISSIONS OR DISCREPANCIES BEFORE
BEGINNING OR FABRICATING ANY WORK.
DO NOT SCALE DRAWINGS.

[illegible]


PROJECT NO:	24-0087
ORIGINAL ISSUE:	06/01/2023
SCALE:	AS NOTED
DRAWN BY:	P. C
CHECKED BY:	J. JEFFERY

ROOF PLAN

A131

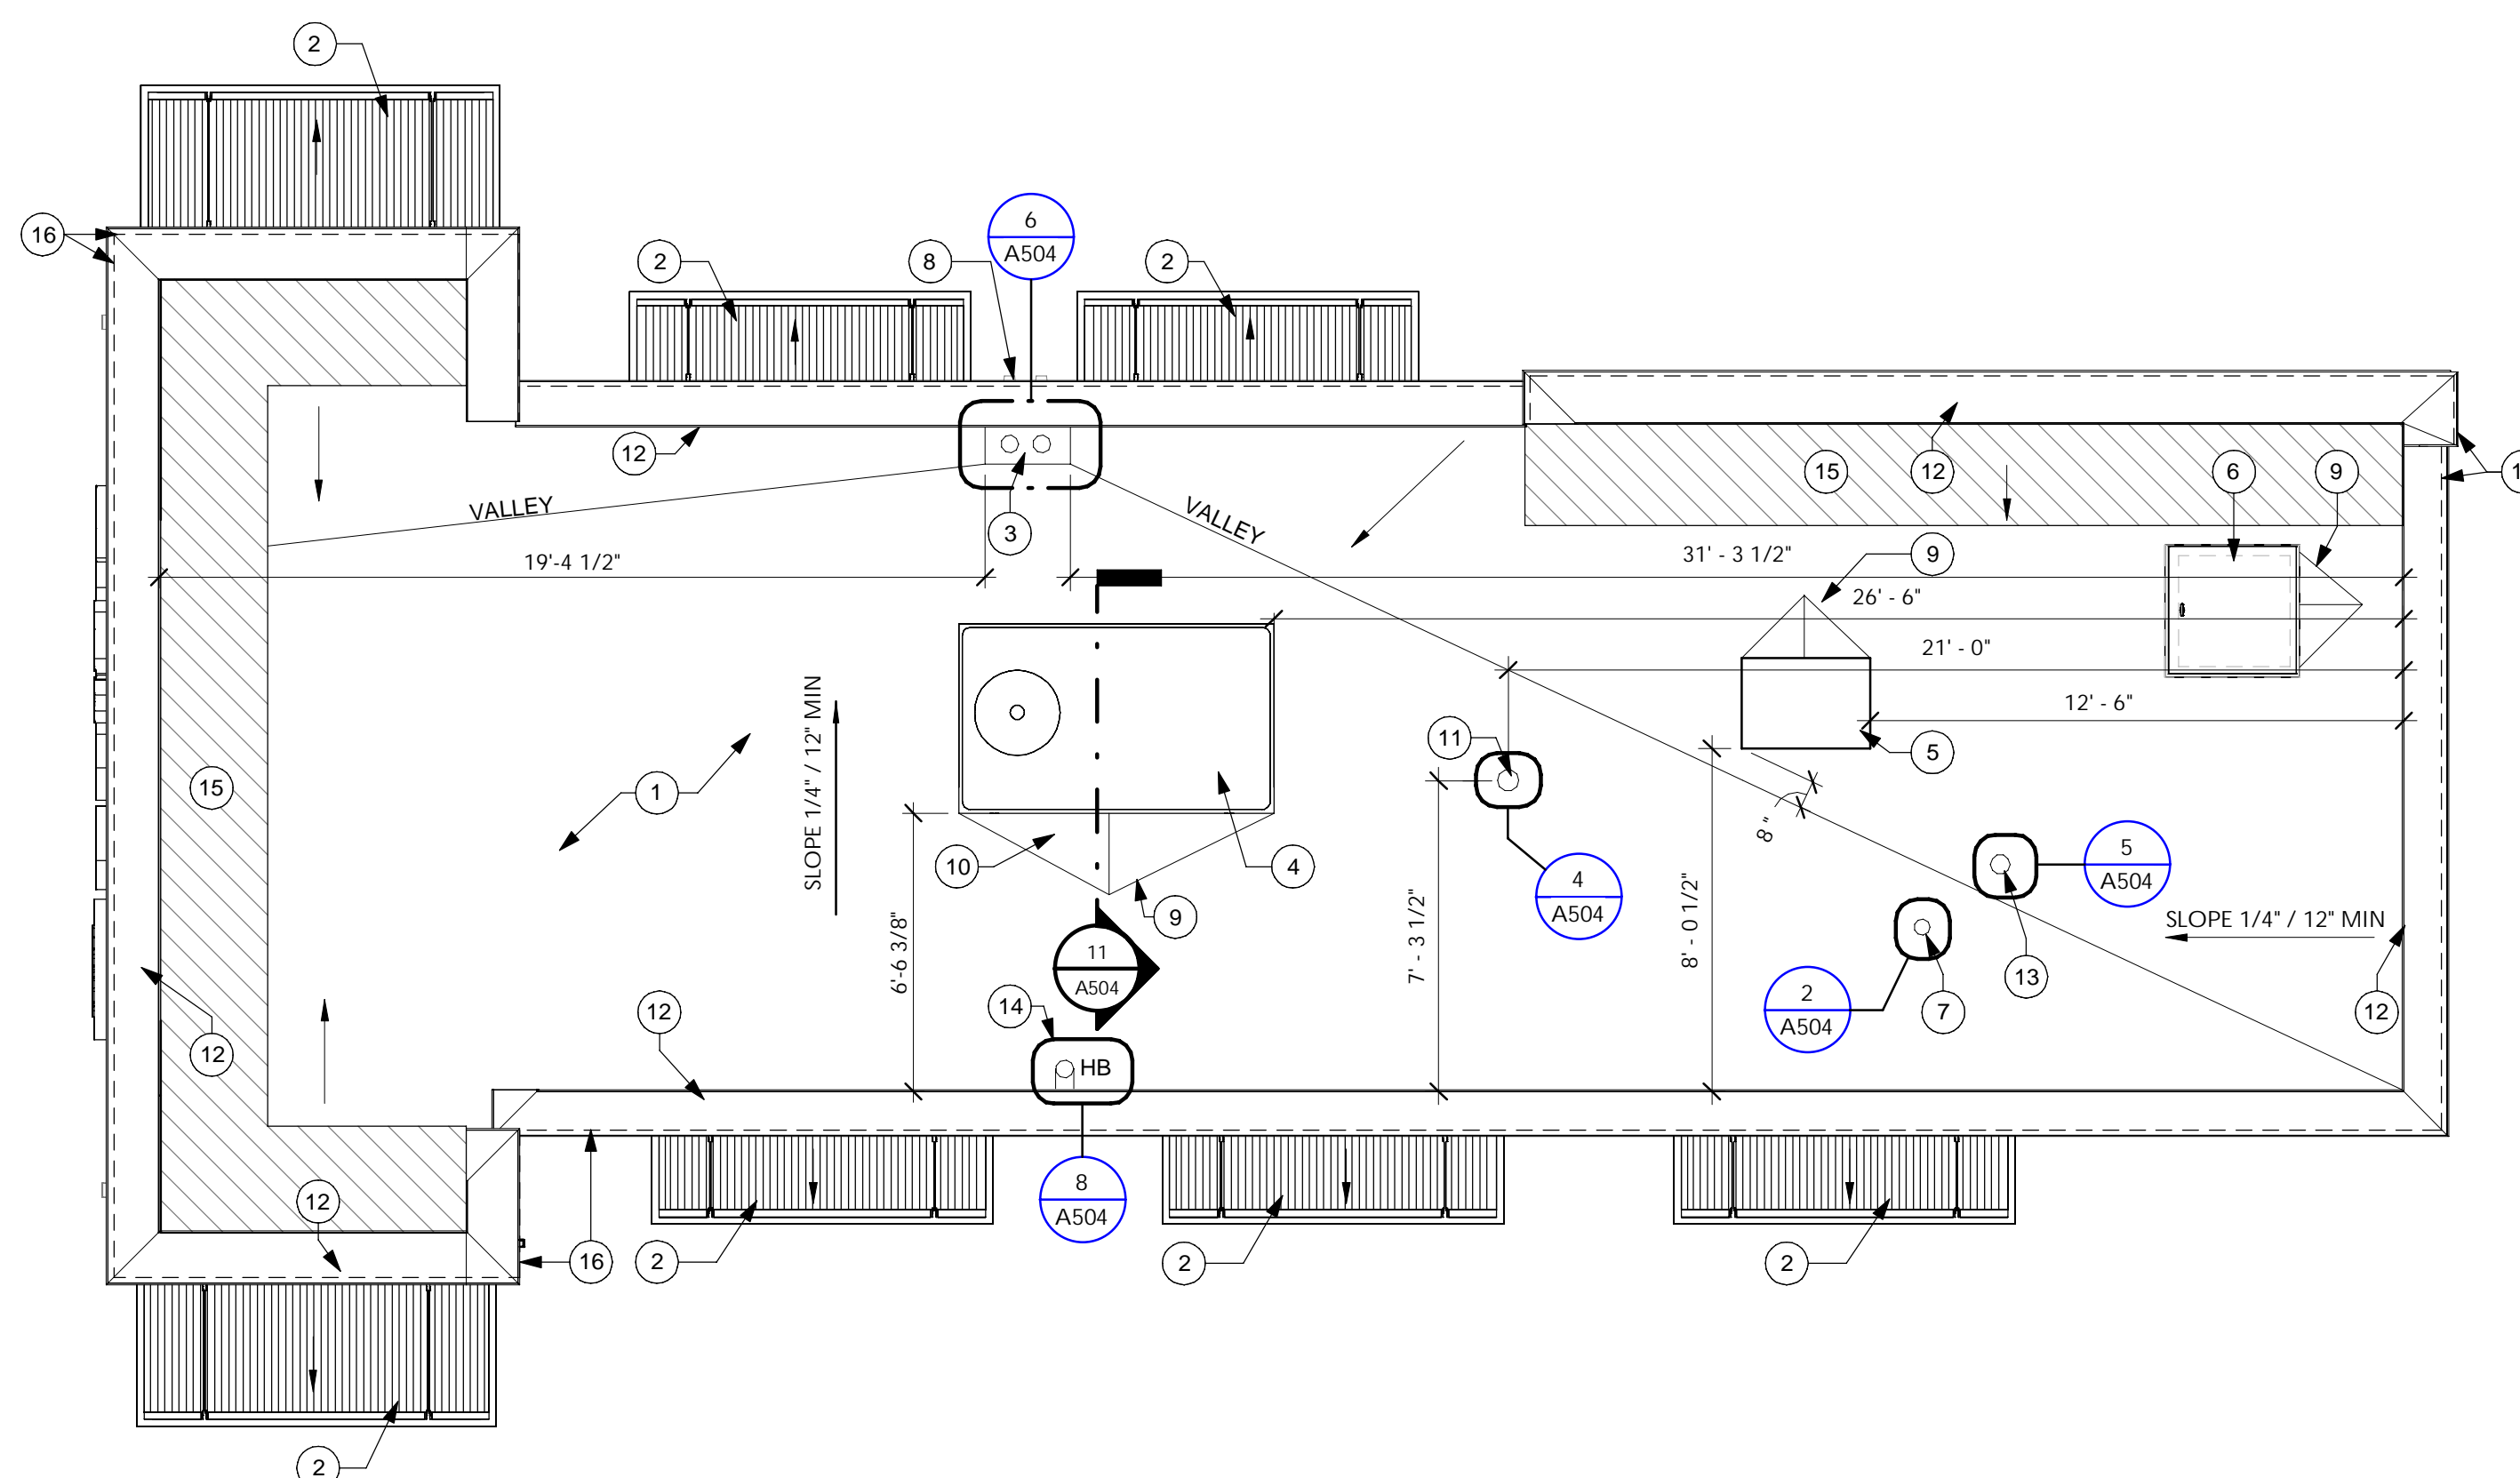

1 | ROOF PLAN
1/4" = 1'-0"



- A. REFER TO ELECTRICAL, MECHANICAL, PLUMBING, AND STRUCTURAL DRAWINGS AND SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- B. RIDGE AND VALLEY OF ROOF SLOPES OCCUR BY SLOPING ROOF FRAMING AND WARPED DECK (TYPICAL), EXCEPT WHERE TAPERED INSULATION IS INDICATED. PROVIDE CRICKETS OF TAPERED INSULATION AT EQUIPMENT CURBS, ROOF DRAINS, SCUPPERS OR ANY OTHER INTERRUPTIONS IN THE SLOPE OF THE ROOF TO MAINTAIN 1/4" SLOPE PER FOOT.
- C. REFER TO PLUMBING DRAWINGS FOR ROOF DRAIN/LEADER SIZES
- D. CONTRACTOR WILL ENSURE POSITIVE DRAINAGE OF THE ROOF DRAINS AND SCUPPERS WITHOUT PONDING.
- E. INSTALLATION OF ROOFING SHALL BE IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS AND PER THE DETAILS ON THE ROOF PLAN.
- F. FLASHING TO BE 24 GAUGE GALVANIZED STEEL

1. TPO ROOFING SYSTEM INSTALLED PER MANUFACTURERS INSTRUCTIONS. JOHNS MANVILLE STERM-S/I, 60 MIL MEMBRANE (OR EQUAL) OVER RIGID INSULATION BOARD, MIN R-25 INSULATION VALUE WITH 20 YEAR WARRANTY.
2. 22 GA MIN THICKNESS CORROSION RESISTANT METAL ROOF DECK, REF: STRU.
3. ROOF DRAIN AND OVERFLOW DRAIN.
4. RTU, REF: MECH.
5. WALK-IN COOLER CONDENSING UNIT ON 6" CURB, REF: MECH & 1/A504
6. ROOF ACCESS HATCH.
7. EXHAUST VENT, WATER-PROOF AROUND PENETRATION.
8. ROOF DRAIN LEADER, DRAINS TO DAYLIGHT.
9. ROOF CRICKETS, TYP.
10. MECHANICAL UNIT CURB. PROVIDE CRICKET AT BASE.
11. CELL BOOSTER.
12. METAL COPING AT PARAPET, TYP.
13. EXHAUST FAN. WATER-PROOF AROUND PENETRATION.
14. HOSE BIB THROUGH PARAPET. ZURN WALL HYDRANT Z1350. WATER-PROOF AROUND PENETRATION.
15. AREA OF PARAPET BRACING, REF: STRU
16. TAPE LIGHT UNDER COPING, REF: ELEC AND WALL SECTIONS.




GENERAL NOTES

- A. CONSIDERATION WILL NOT BE GRANTED FOR ANY ALLEGED MISUNDERSTANDINGS OF THE AMOUNT OF WORK TO BE PERFORMED. TENDER OF PROPOSAL SHALL CONVEY FULL AGREEMENT TO THE ITEMS AND CONDITIONS INDICATED ON THE DRAWINGS. SHOULD THE CONTRACTOR FIND DISCREPANCIES OR OMISSIONS IN THE CONTRACT DOCUMENT OR BE IN DOUBT AS TO THE INTENT THEREOF, THE CONTRACTOR SHALL OBTAIN CLARIFICATION FROM THE ARCHITECT AND/OR THE OWNER'S REPRESENTATIVE PRIOR TO SUBMITTING A PROPOSAL FOR WORK.
- B. WATERPROOFING MEMBRANE TO BE TWO LAYERS TYVEK COMMERCIAL WRAP WITH TAPED SEAMS, INSTALLED PER MANUFACTURER SPECIFICATIONS. SPECIAL INSPECTION NEEDED FOR WRB.
- C. FLASHING TO BE 24 GA GALVANIZED STEEL UNO.

ELEVATION KEYNOTES

1. METAL PARAPET CAP, PAINTED, TAPE LIGHTS UNDER COPING, REF: ELEC.
2. ARCHITECTURAL PANELS. REF: A501, A502, A503, A504.
3. THIN BRICK
4. STUCCO, REF: TO A501 & A502
5. CONTROL JOINTS, REF: A501.
6. OPERABLE WINDOW, REF: A641 FOR WINDOW SCHEDULE.
7. FIXED WINDOW, REF: A641 FOR WINDOW SCHEDULE.
8. BUILDING SIGNAGE SHOWN FOR PLACEMENT AND SCALE ONLY. SIGNAGE UNDER SEPARATE PERMIT. GC TO PROVIDE BLOCKING AS REQUIRED.
9. 6" TALL BUILDING NUMBER. ARIAL FONT, CONTRASTING COLOR. COORDINATE LOCATION WITH FIRE MARSHALL.
10. DECORATIVE METAL CUTOUTS. REF: SEPARATE SIGNAGE PERMIT FOR DETAILS.
11. TAPE LIGHT UNDER COPING, REF: ELEC
12. BUILDING ACCESS KEYPAD
13. C-CHANNEL AWNING, ALL EXPOSED STEEL TO BE FIELD-PAINTED.
14. RECESSED COVERED HOSE BIB, REF: A503.
15. ROOF LINE, BEHIND.
16. ROOF DRAIN.
17. RTU, REF: ELEC & MECH.
18. METAL ACCENT FRAME WITH TAPE LIGHT. REF: ELEC.
19. WALL PACK LIGHTS, REF: ELEC.
20. WALL SCONCE, TO BE MOUNTED 40" AFF, REF: ELEC.
21. FIRE DEPARTMENT RECESSED KNOX BOX 3200. MOUNTED 60" AFF.
22. S.S CORNER GUARDS. PAINTED SW 7048 URBANE BRONZE
23. ELECTRICAL PANELS, COLOR MATCH TO BUILDING. REF: ELEC
24. CONDUIT FOR SECURITY CAMERA. REF: ELEC
25. WIRELESS DOORBELL. AVANTEK, LD-DB-21-A



CONTRACTOR SHALL VERIFY ALL
CONDITIONS AND DIMENSIONS AT THE
JOB SITE AND NOTIFY THE ARCHITECT
OF ANY DIMENSIONAL ERRORS,
OMISSIONS OR DISCREPANCIES BEFORE
BEGINNING OR FABRICATING ANY WORK.
DO NOT SCALE DRAWINGS.

PROJECT INFORMATION	
PROJECT NO:	24-0087
ORIGINAL ISSUE:	06/01/2023
SCALE:	AS NOTED
DRAWN BY:	P. C
CHECKED BY:	J. JEFFERY

SHEET TITLE

EXTERIOR ELEVATIONS

SHEET NUMBER

A201



513 MAIN STREET #300
FORT WORTH TX 76102

SEAL



PERMIT SET: 04/12/2024

CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DIMENSIONAL ERRORS, OMISSIONS OR DISCREPANCIES BEFORE BEGINNING OR FABRICATING ANY WORK. DO NOT SCALE DRAWINGS.

ISSUE	DATE	DESCRIPTION

PROJECT INFORMATION


PROJECT NO:	24-0087
ORIGINAL ISSUE:	06/01/2023
SCALE:	AS NOTED
DRAWN BY:	P. C
CHECKED BY:	J. JEFFERY

SHEET TITLE


BUILDING SECTIONS

SHEET NUMBER

A301

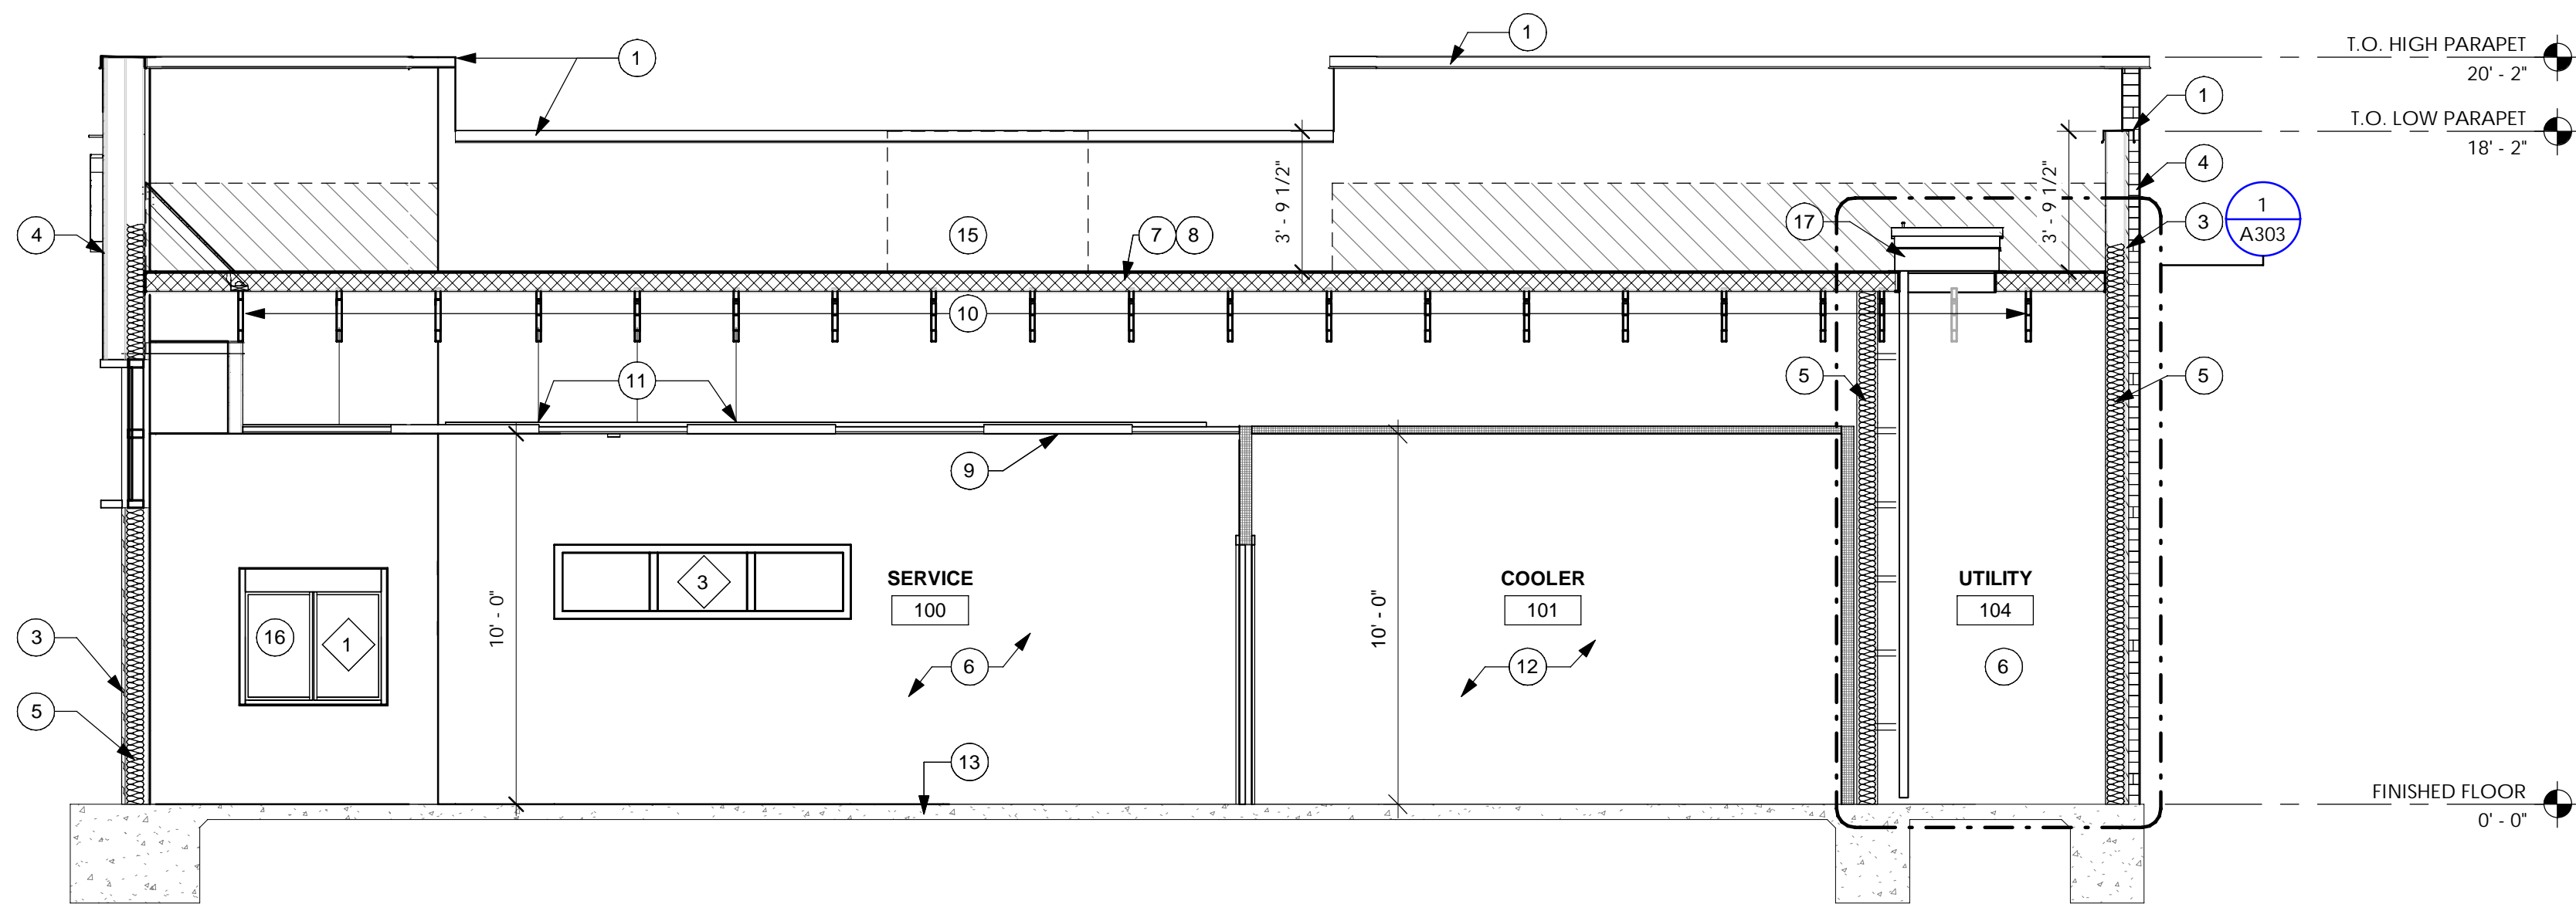

1 BUILDING SECTION
1/4" = 1'-0"

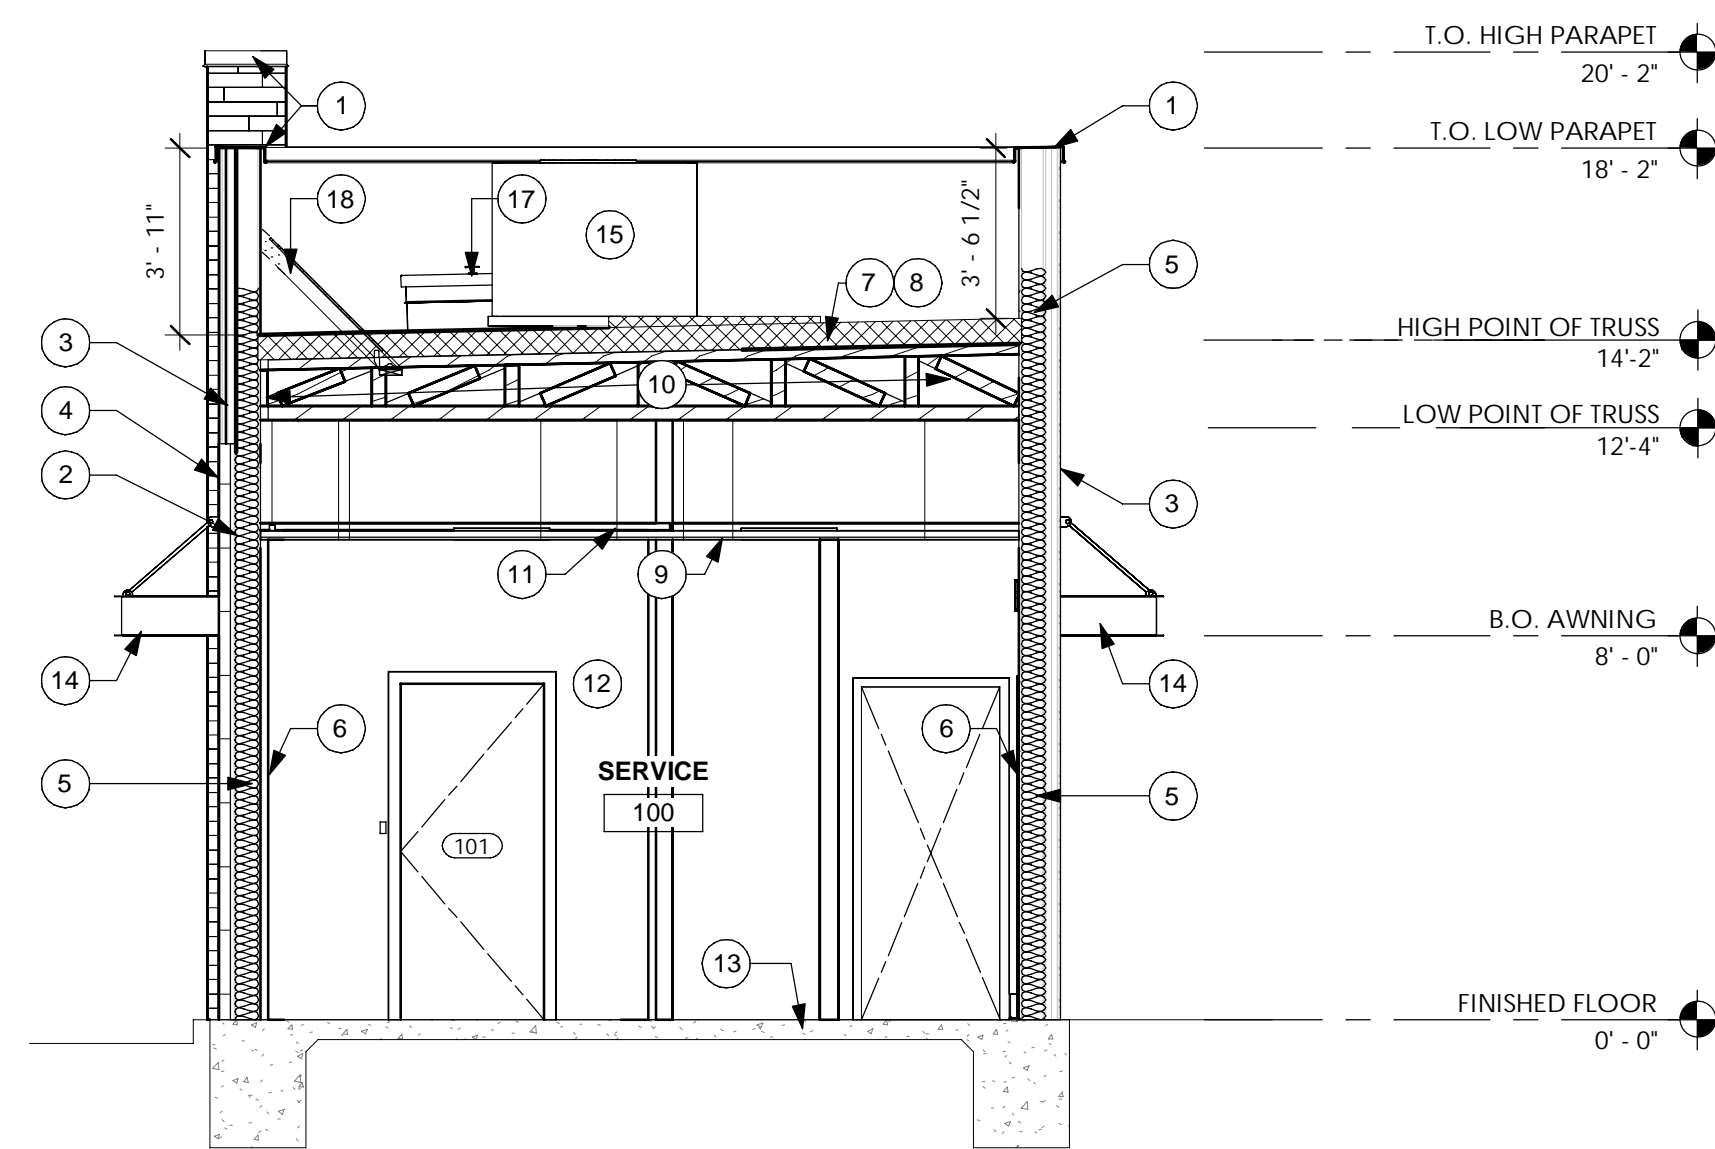


2 BUILDING SECTION
1/4" = 1'-0"

GENERAL NOTES

- ALL DIMENSIONS ARE SHOWN TO FINISH FACE OF WALLS UNLESS NOTED OTHERWISE
- GC TO COORDINATE AND PROVIDE ALL BLOCKING FOR EQUIPMENT, MILLWORK, AND FIXTURES.
- WALLS TO STRUCTURAL DECK MUST BE THOROUGHLY SEALED AROUND PENETRATIONS
- REFER TO WALL TYPE LEGEND FOR ALL NEW WALLS.
- ALL INSTALLED INTERIOR FINISHES SHALL COMPLY WITH THE FLAME SPREAD REQUIREMENTS OF ADOPTED IBC, CHAPTER 8.
- GC TO PROVIDE MOISTURE RESISTANT GYPSUM BOARD AT ALL LOCATIONS WHERE WALL TILE IS PRESENT.

BUILDING SECTION KEYNOTES

- METAL PARAPET CAP PER WALL PANEL MANUFACTURER.
- STUCCO ON WATER RESISTIVE BARRIER.
- LAP SIDING.
- THIN BRICK.
- INSULATION AT WALL CAVITY; REF: G005.
- FRP ON INTERIOR SHEATHING.
- TPO ROOFING SYSTEM. SINGLE PLY WATERPROOF MEMBRANE.
- ROOF INSULATION TO BE RIGID INSULATION OR APPROVED EQUAL SPRAY FOAM INSULATION. REF: G005
- ACOUSTICAL CEILING TILE SUSPENDED FROM STRUCTURE.
- WOOD TRUSS, REF: STRU.
- SHELVING SUSPENDED FROM UNISTRUT AND THREADED RODS FROM STRUCTURE.
- INSULATED WALL & CEILING BY COOLER MANUFACTURER.
- CONCRETE FLOOR SLAB, REF: STRU.
- 22 GA. MIN. THICKNESS CORROSION RESISTANT METAL DECK ON 2X STEEL TUBES AT 6'-0" OC. SLOPE DECK TO DRAIN, REF: STRU
- MECHANICAL UNITS ON 8" MAX CURBS, REF: MECH.
- SERVICE WINDOW.
- ROOF ACCESS HATCH
- PARAPET BRACE, REF: STRU

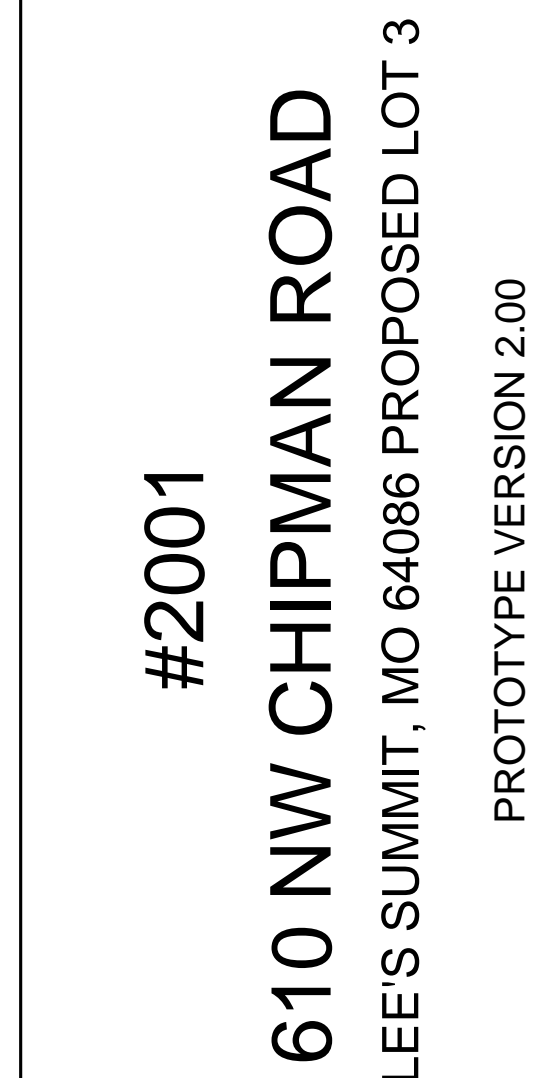

CONTRACTOR SHALL VERIFY ALL
CONDITIONS AND DIMENSIONS AT THE
JOB SITE AND NOTIFY THE ARCHITECT
OF ANY DIMENSIONAL ERRORS,
OMISSIONS OR DISCREPANCIES BEFORE
BEGINNING OR FABRICATING ANY WORK.
DO NOT SCALE DRAWINGS.

[illegible]

PROJECT INFORMATION	
---------------------	--


PROJECT NO:	24-0087
ORIGINAL ISSUE:	06/01/2023
SCALE:	AS NOTED
DRAWN BY:	V. PEREZ
CHECKED BY:	J. JEFFERY

SHEET TITLE


WALL SECTIONS

SHEET NUMBER


A302

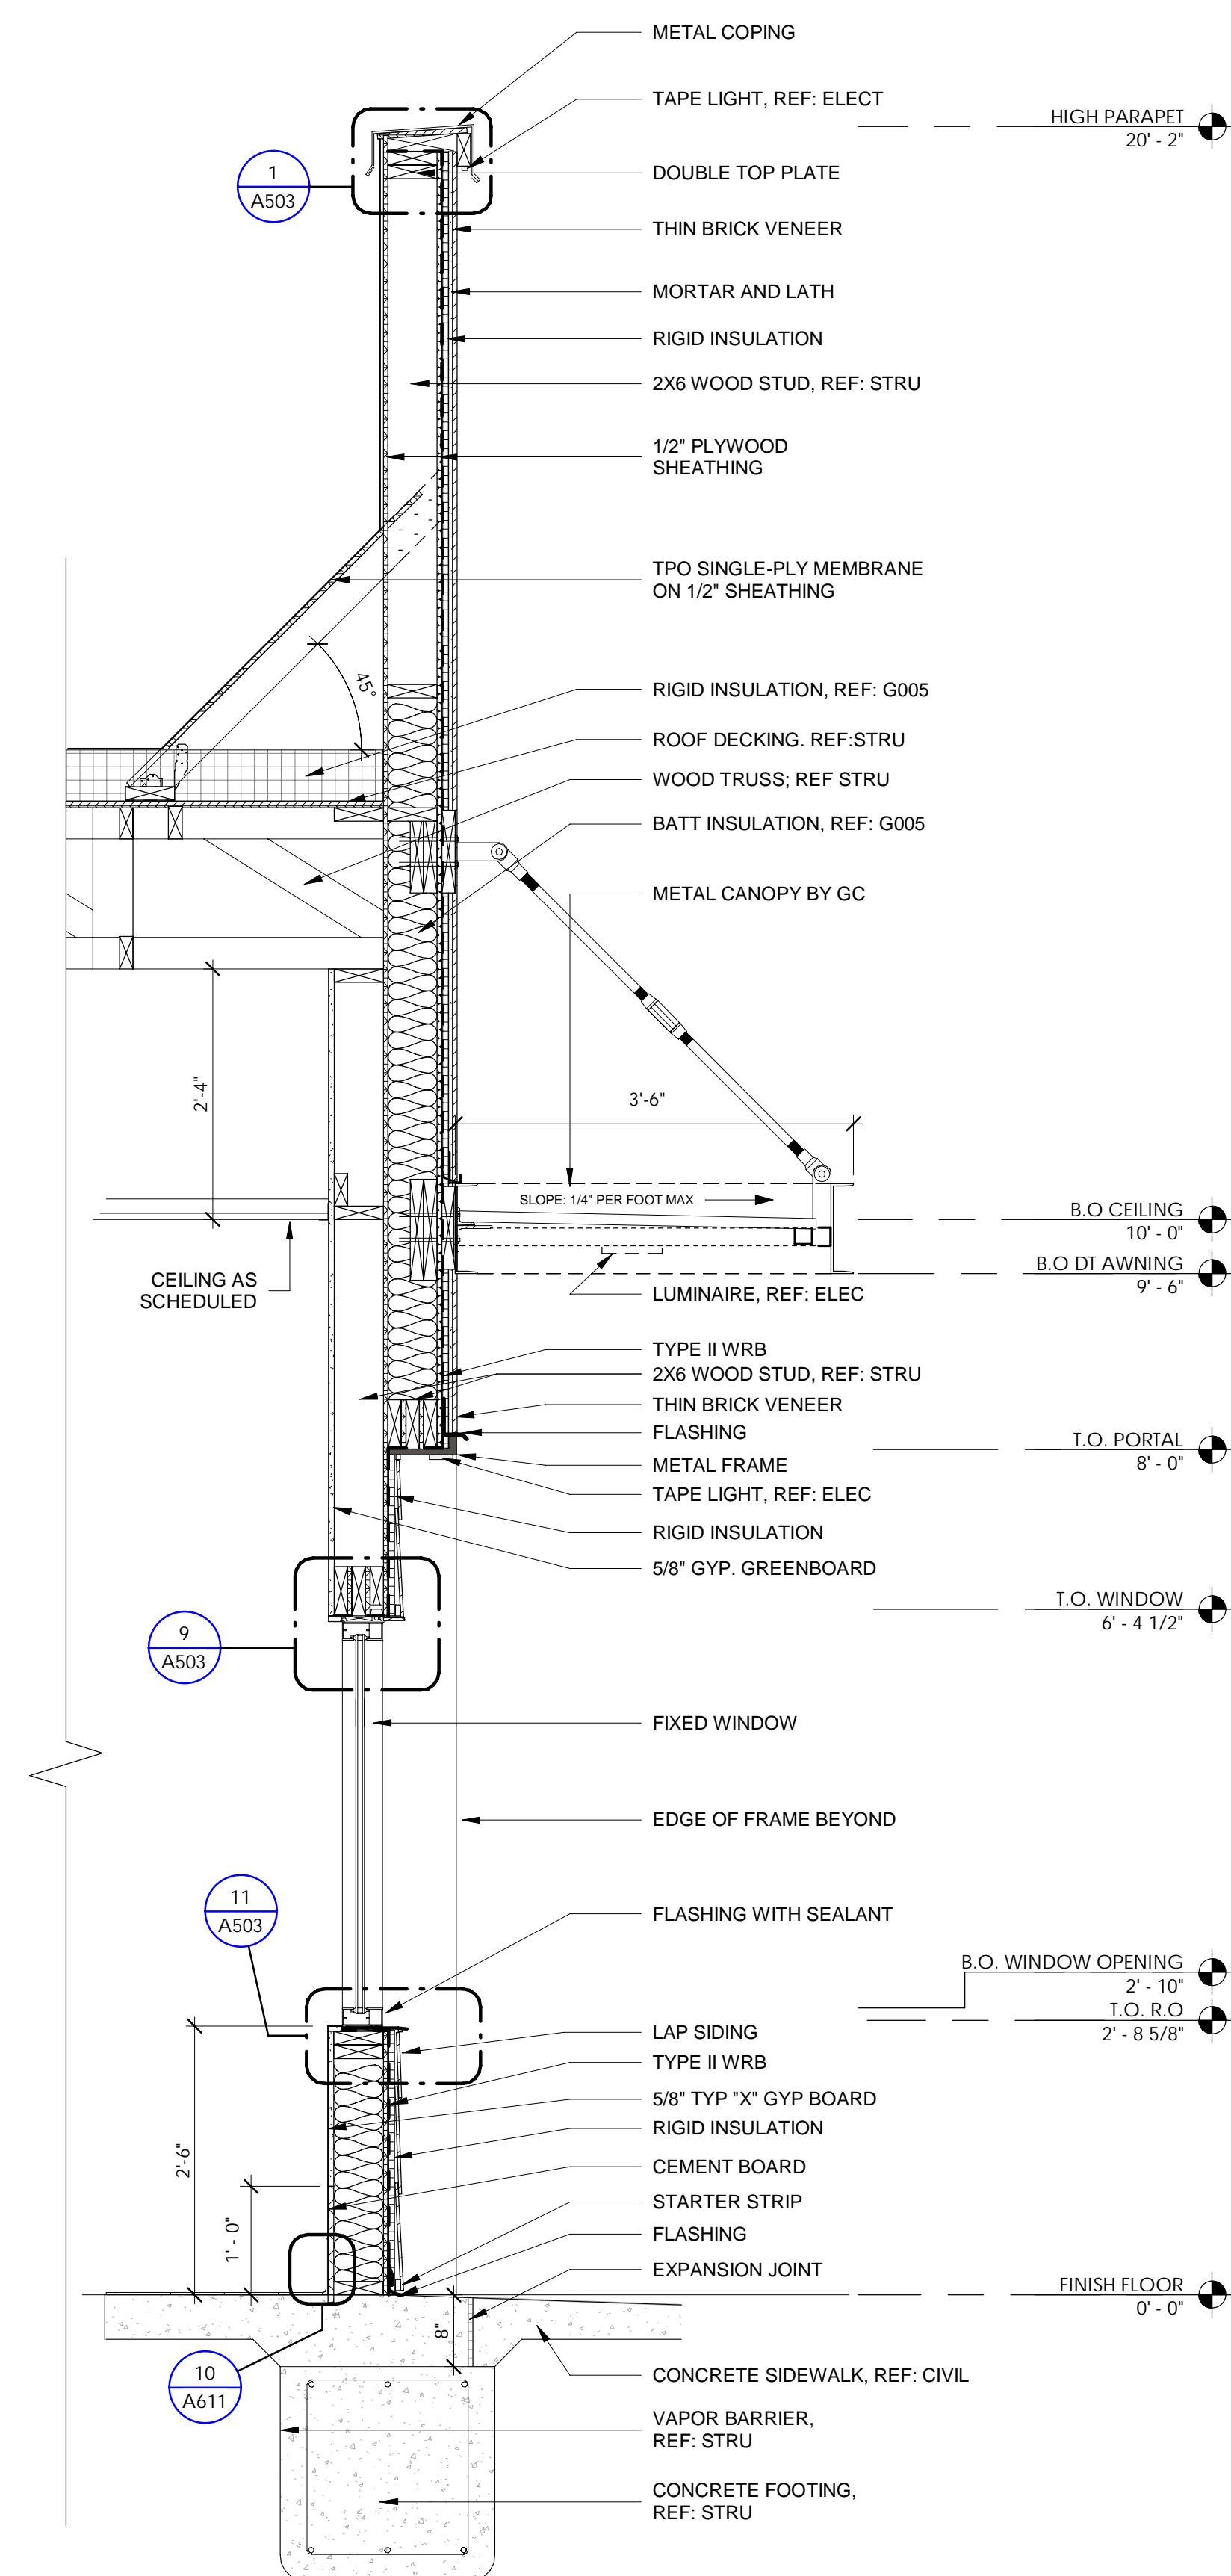

1 | WALL SECTION AT WINDOW
3/4" = 1'-0"

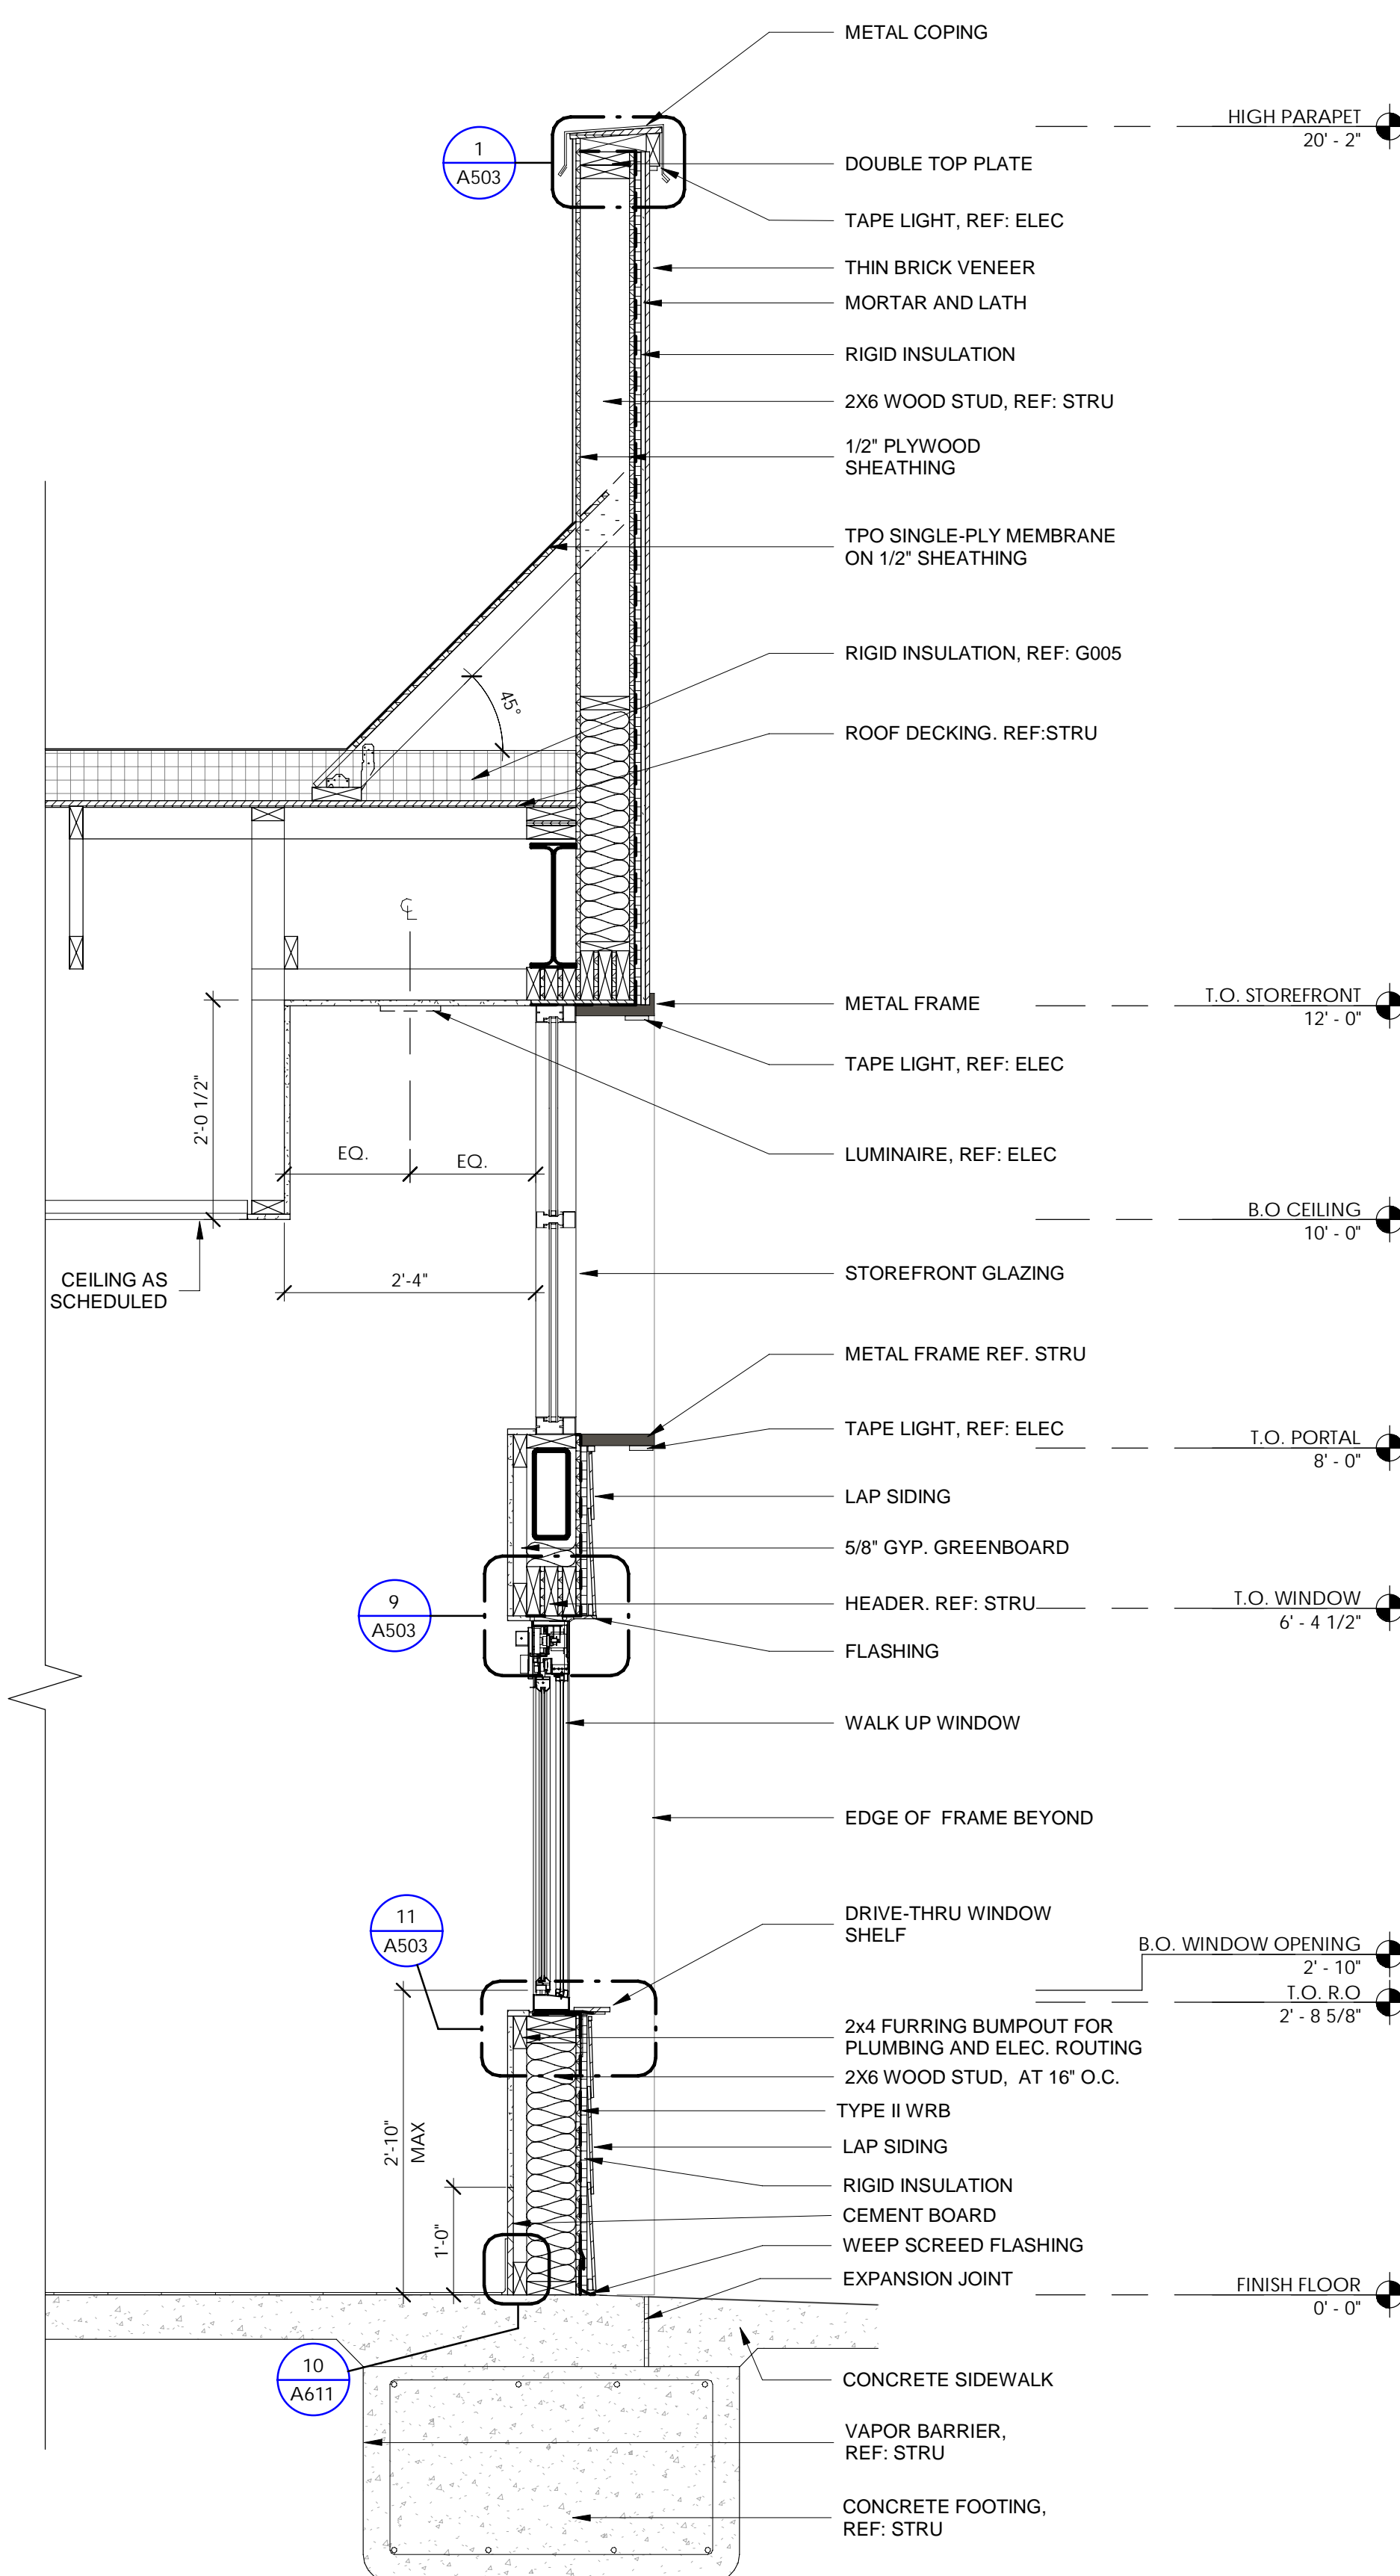


2 | WALL SECTION AT WALK UP WINDOW
3/4" = 1'-0"

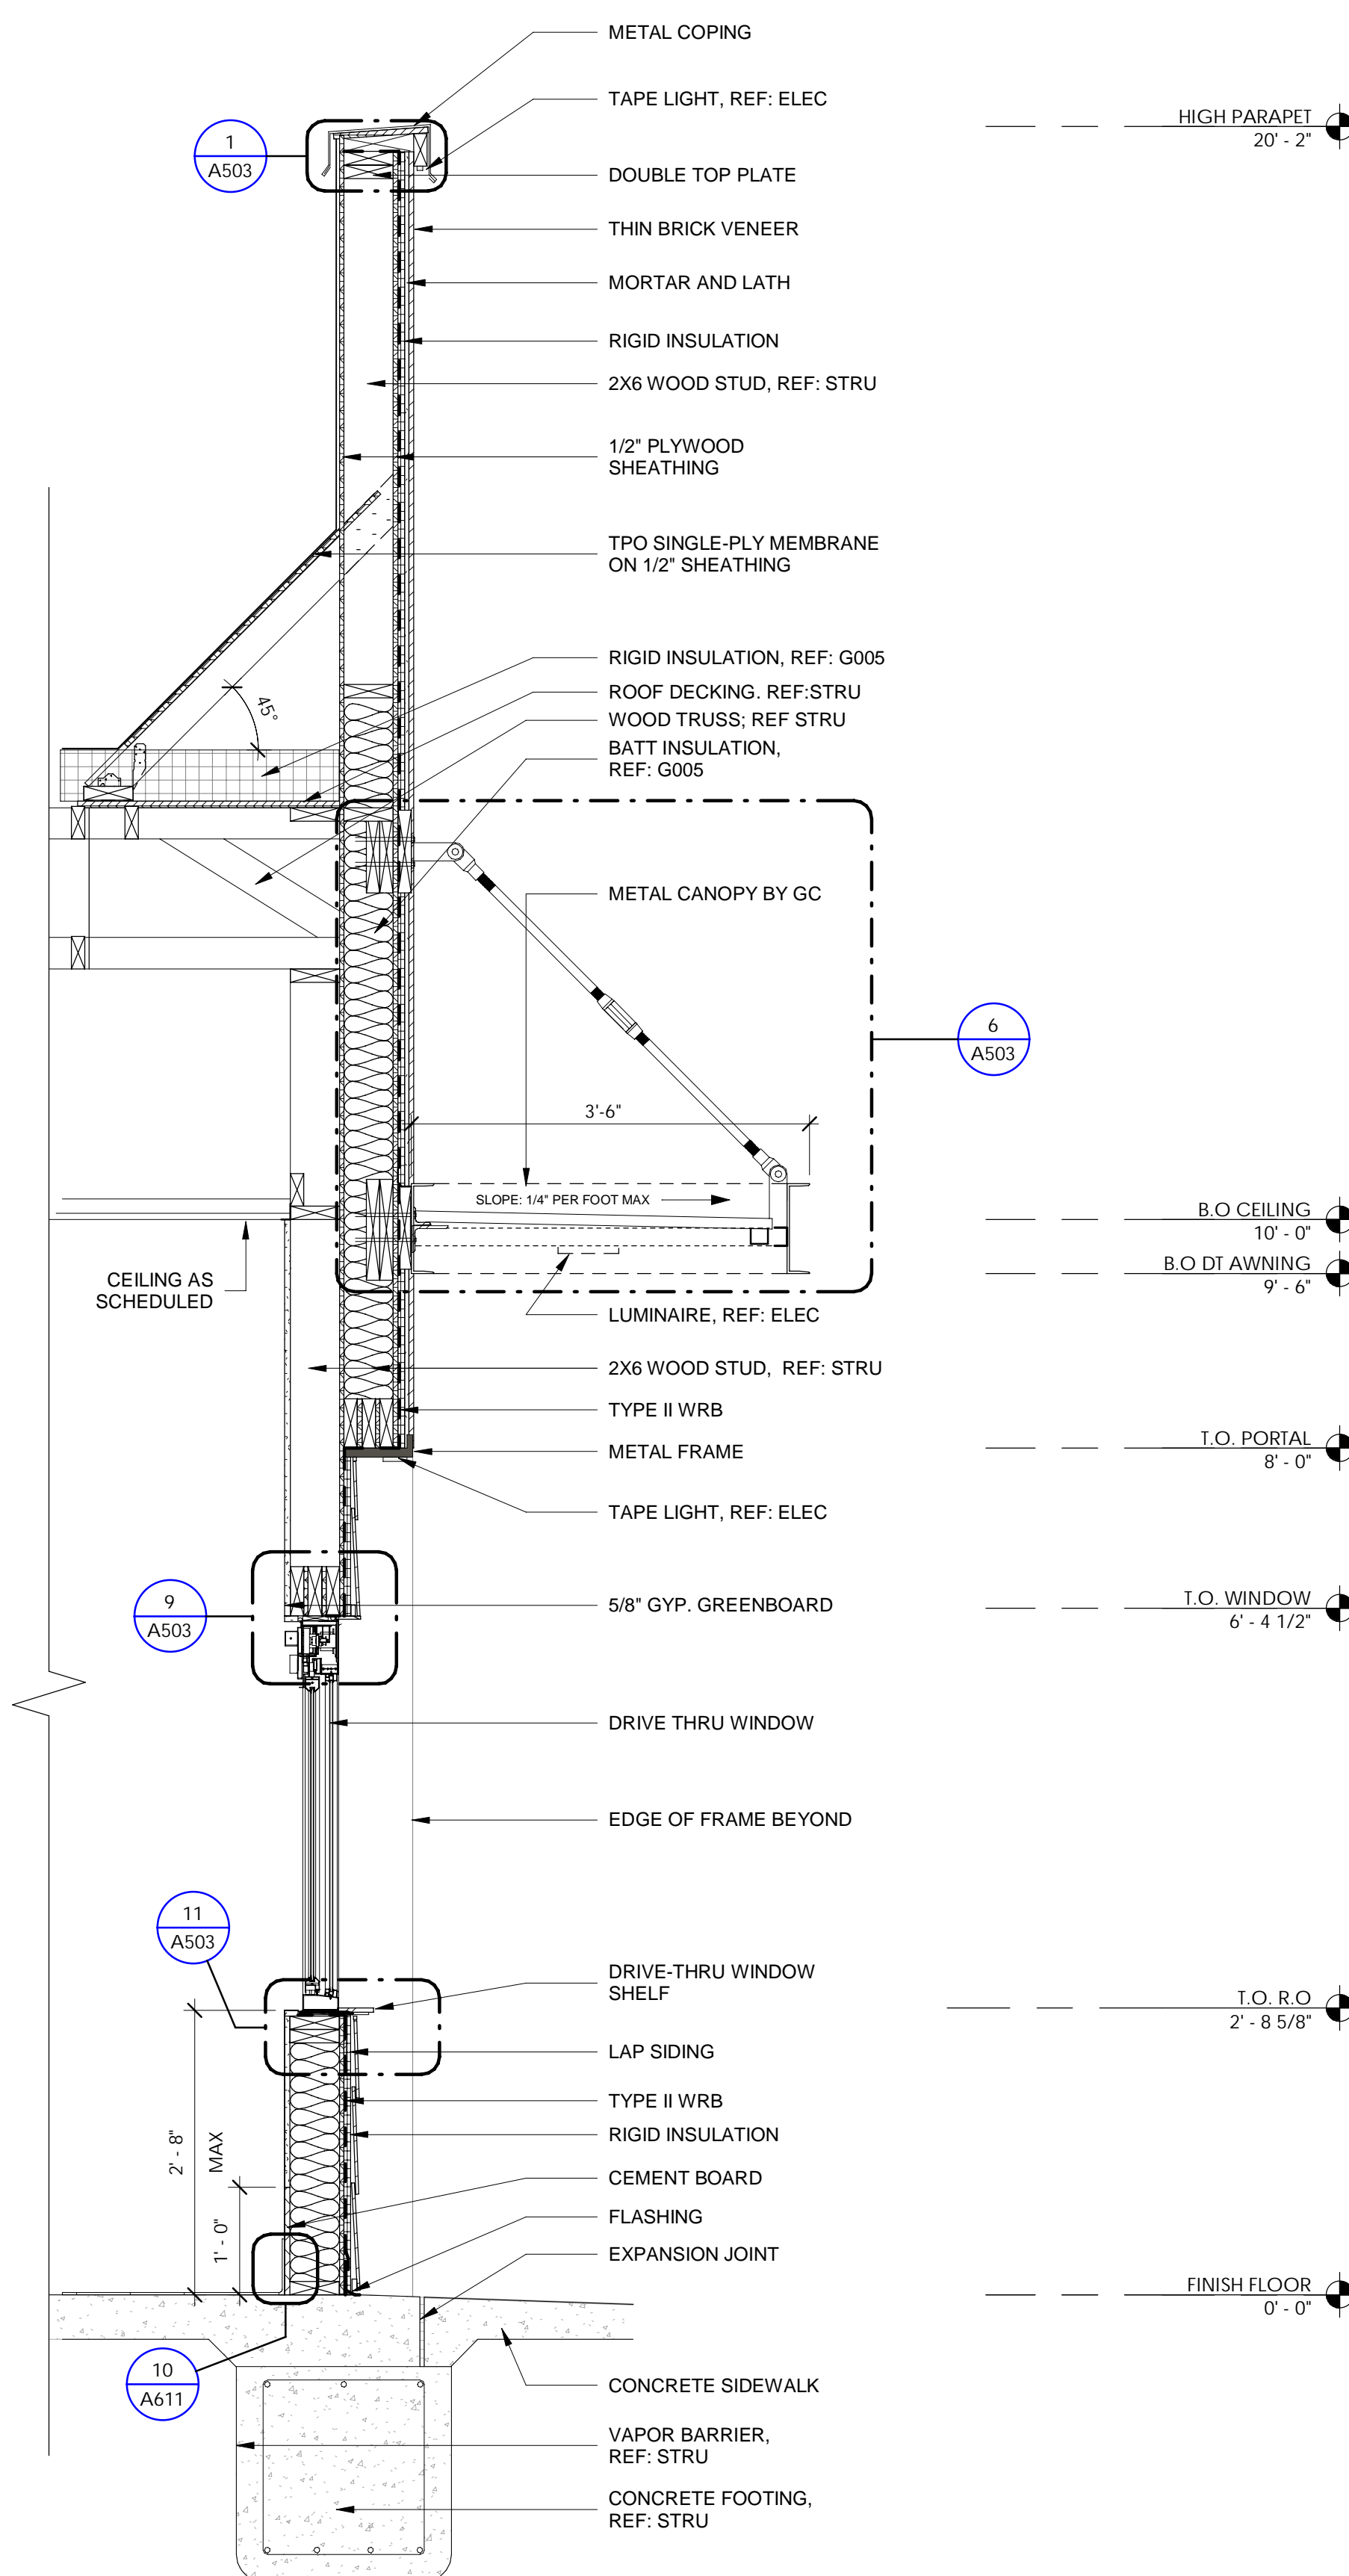


3 | WALL SECTION AT DRIVE THRU WINDOW
3/4" = 1'-0"

PROJECT INFORMATION	
PROJECT NO:	24-008
ORIGINAL ISSUE:	06/01/2024
SCALE:	AS NOTED
DRAWN BY:	V. PEREZ
CHECKED BY:	J. JEFFERSON




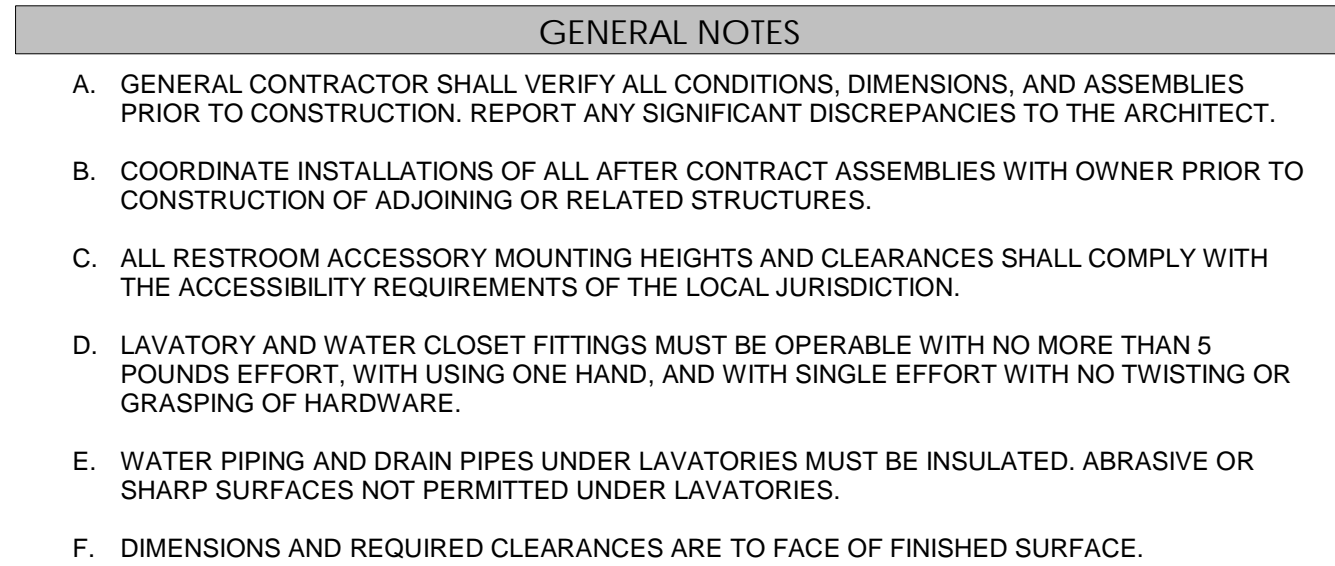

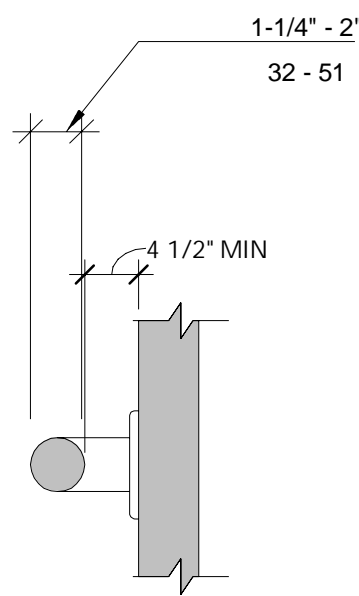


(A) CIRCULAR


GRAB BARS

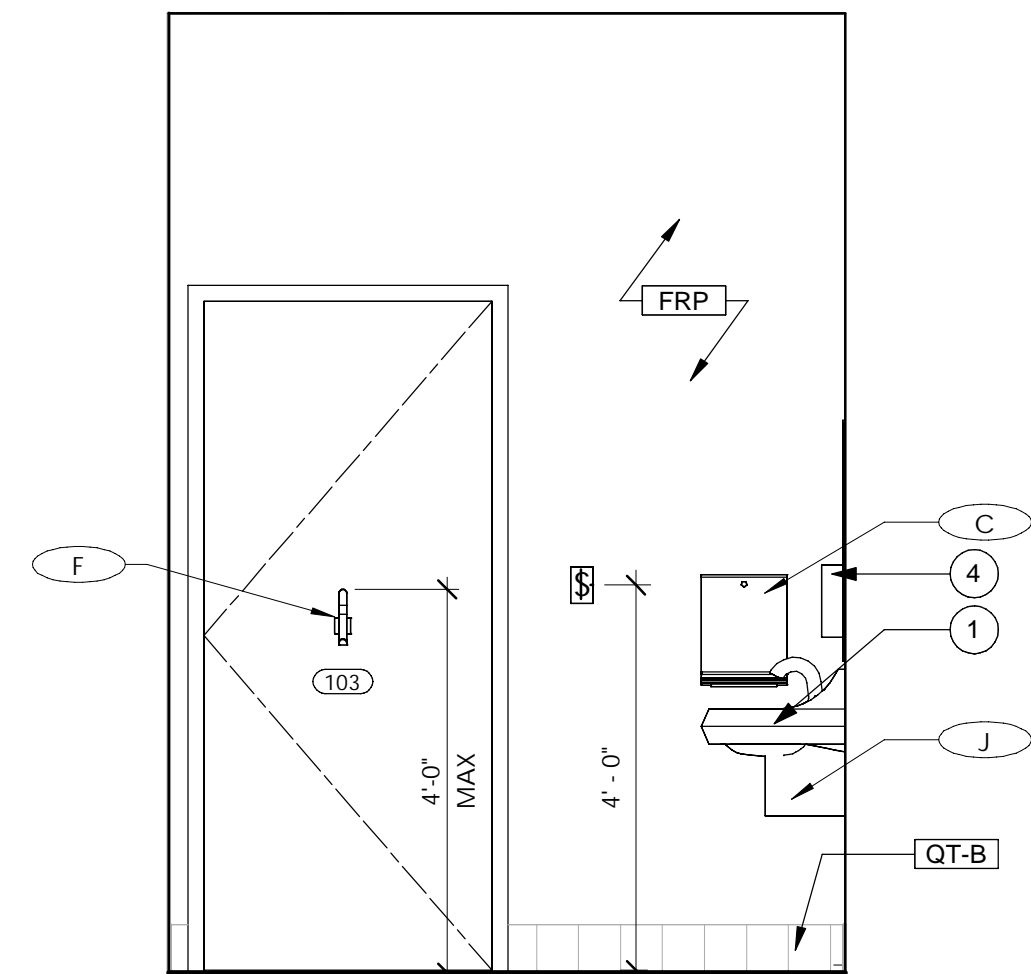


1 ELEVATION AT RESTROOM DOOR
1/2\" = 1'-0"

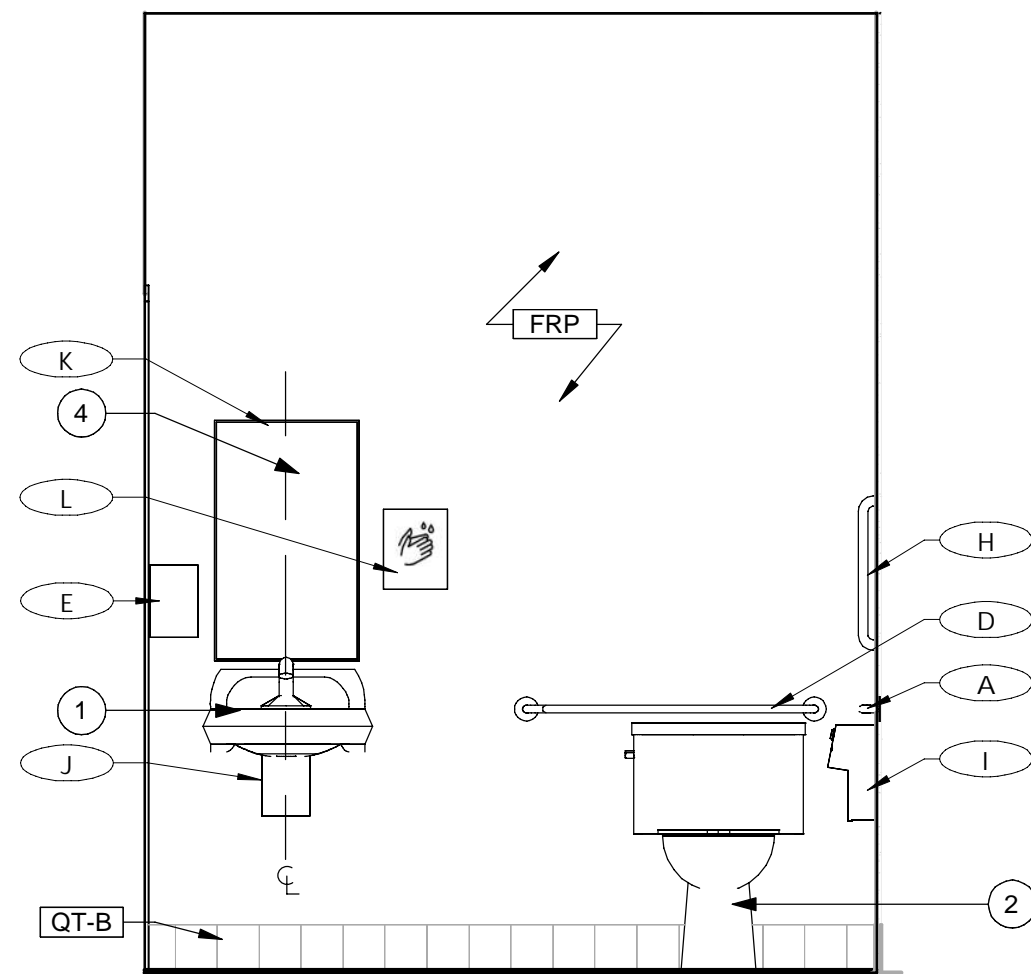


2 ELEVATION AT RESTROOM SINK
1/2\" = 1'-0"

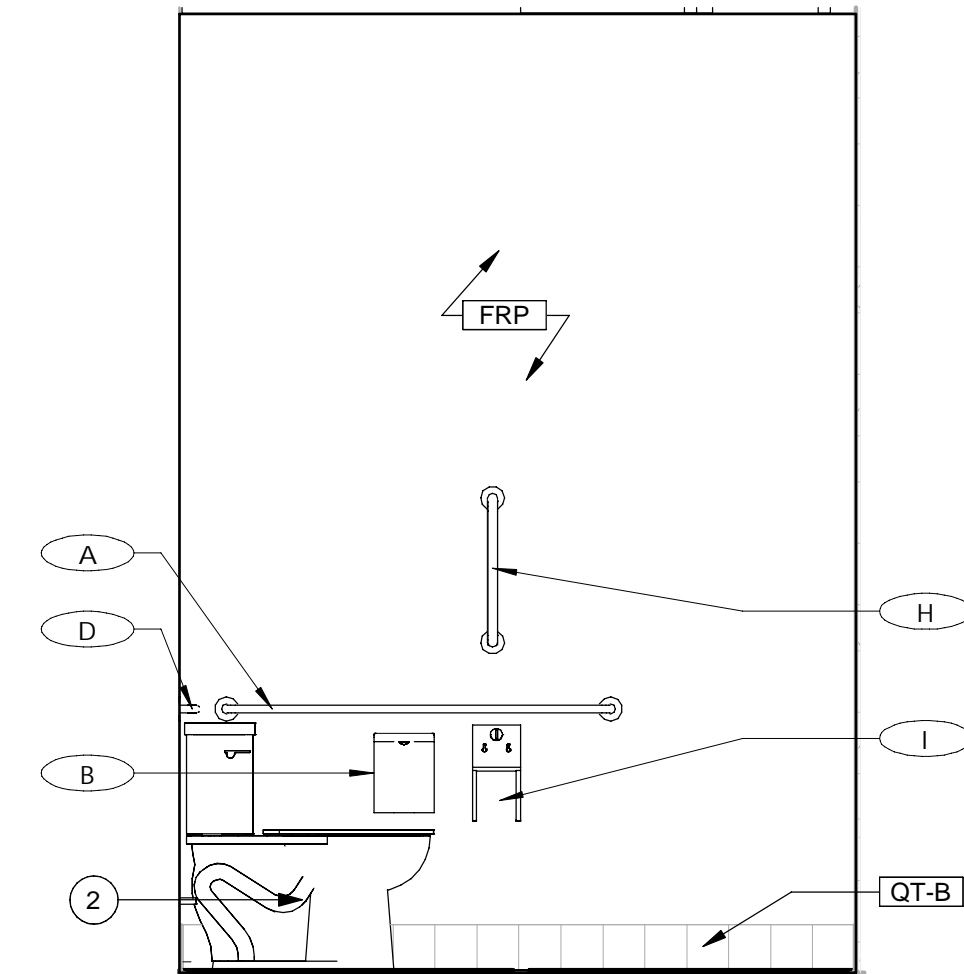


3 ELEVATION AT RESTROOM FIXTURES
1/2\" = 1'-0"

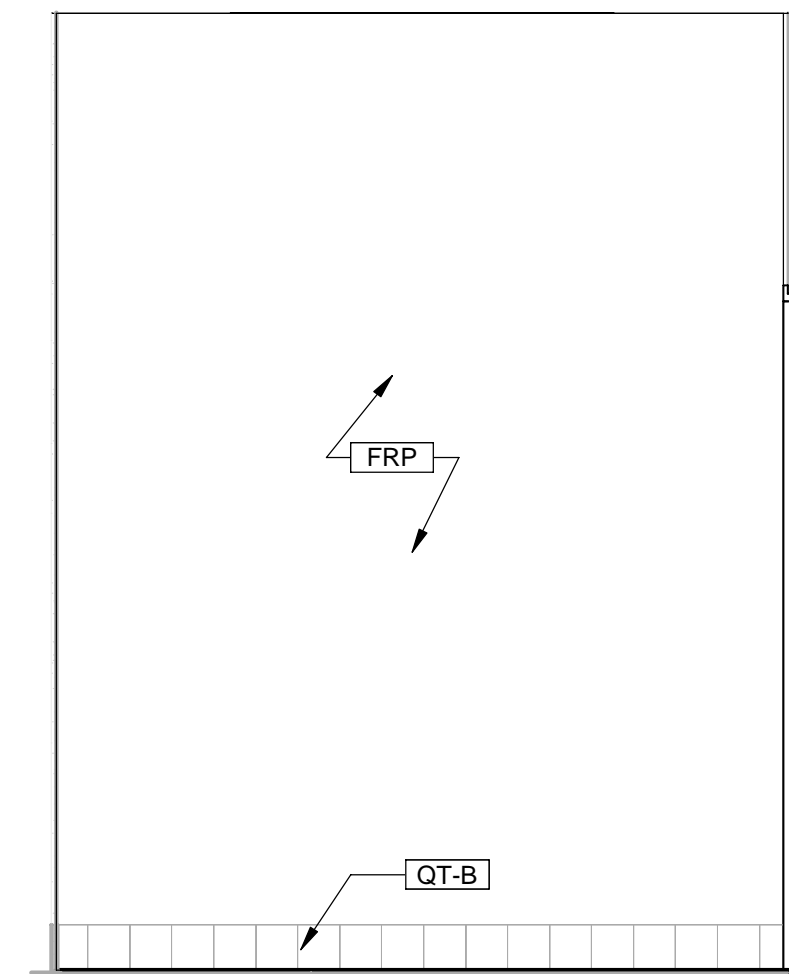


4 ELEVATION AT RESTROOM WALL
1/2\" = 1'-0"

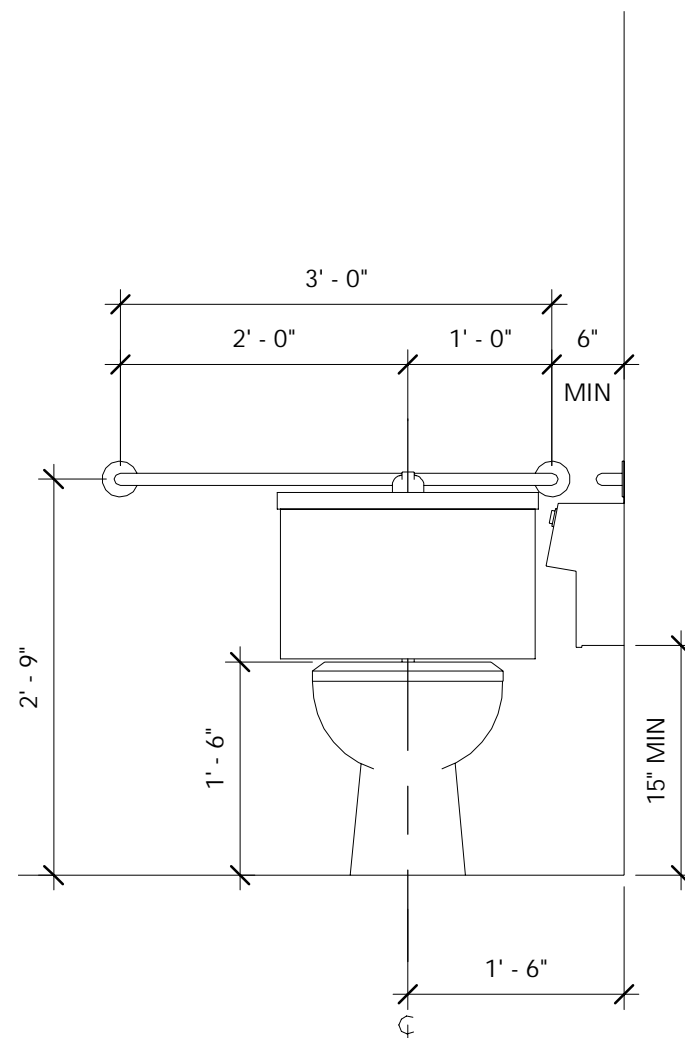


TOILET
FRONT ELEVATION

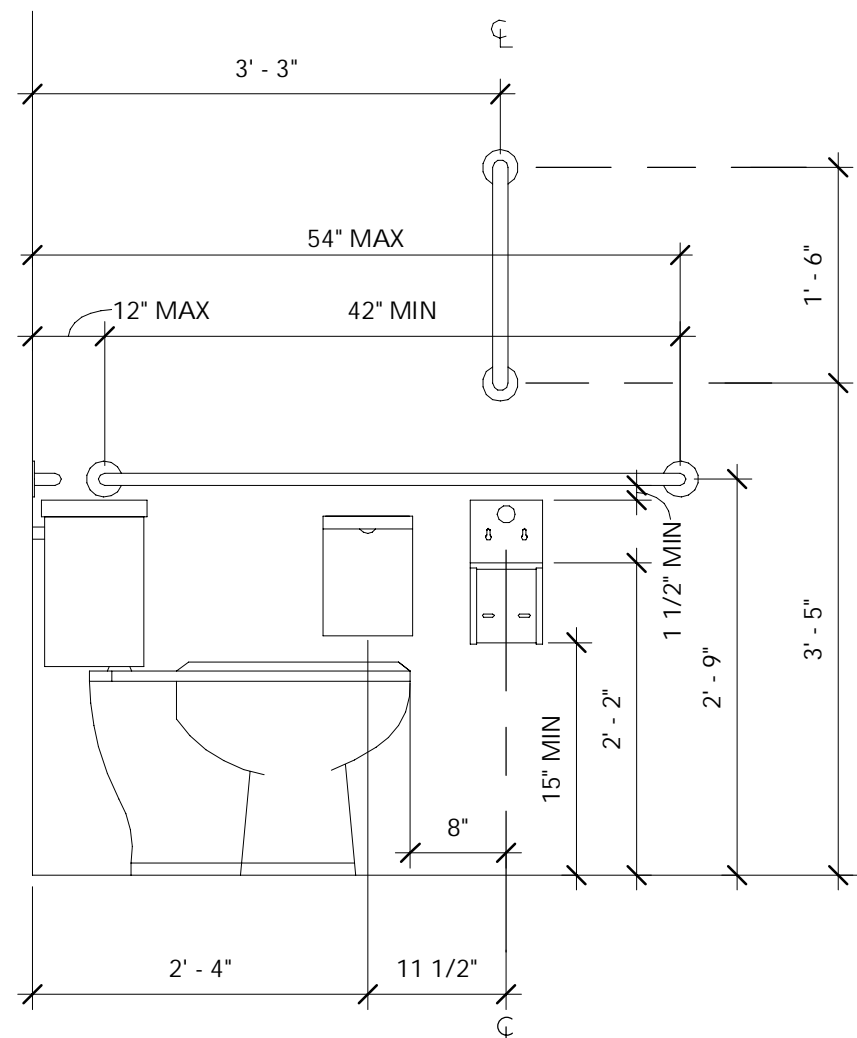


TOILET
SIDE ELEVATION

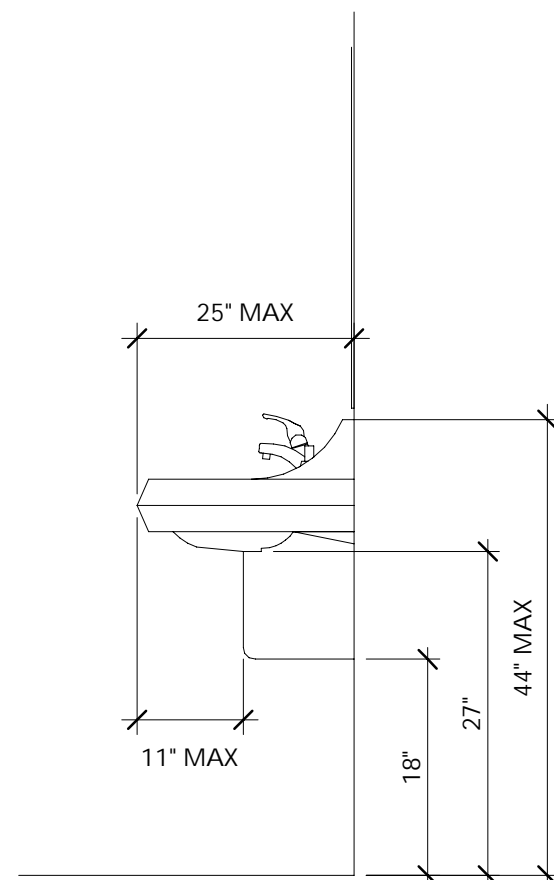


HAND SINK
SIDE ELEVATION

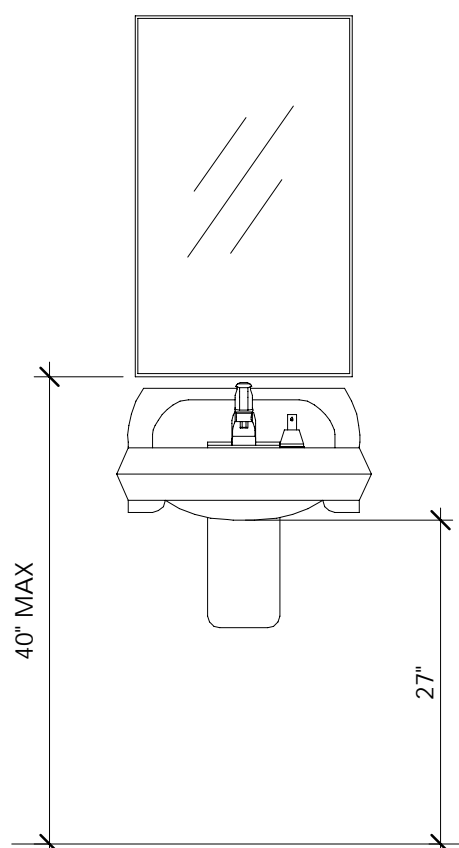

HAND SINK
FRONT ELEVATION

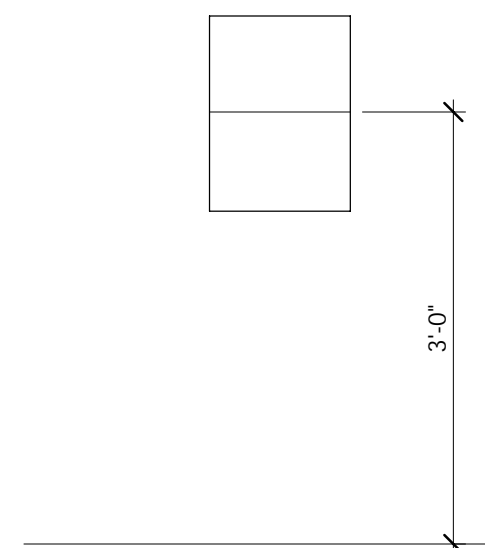

PAPER TOWEL DISPENSER
FRONT ELEVATION

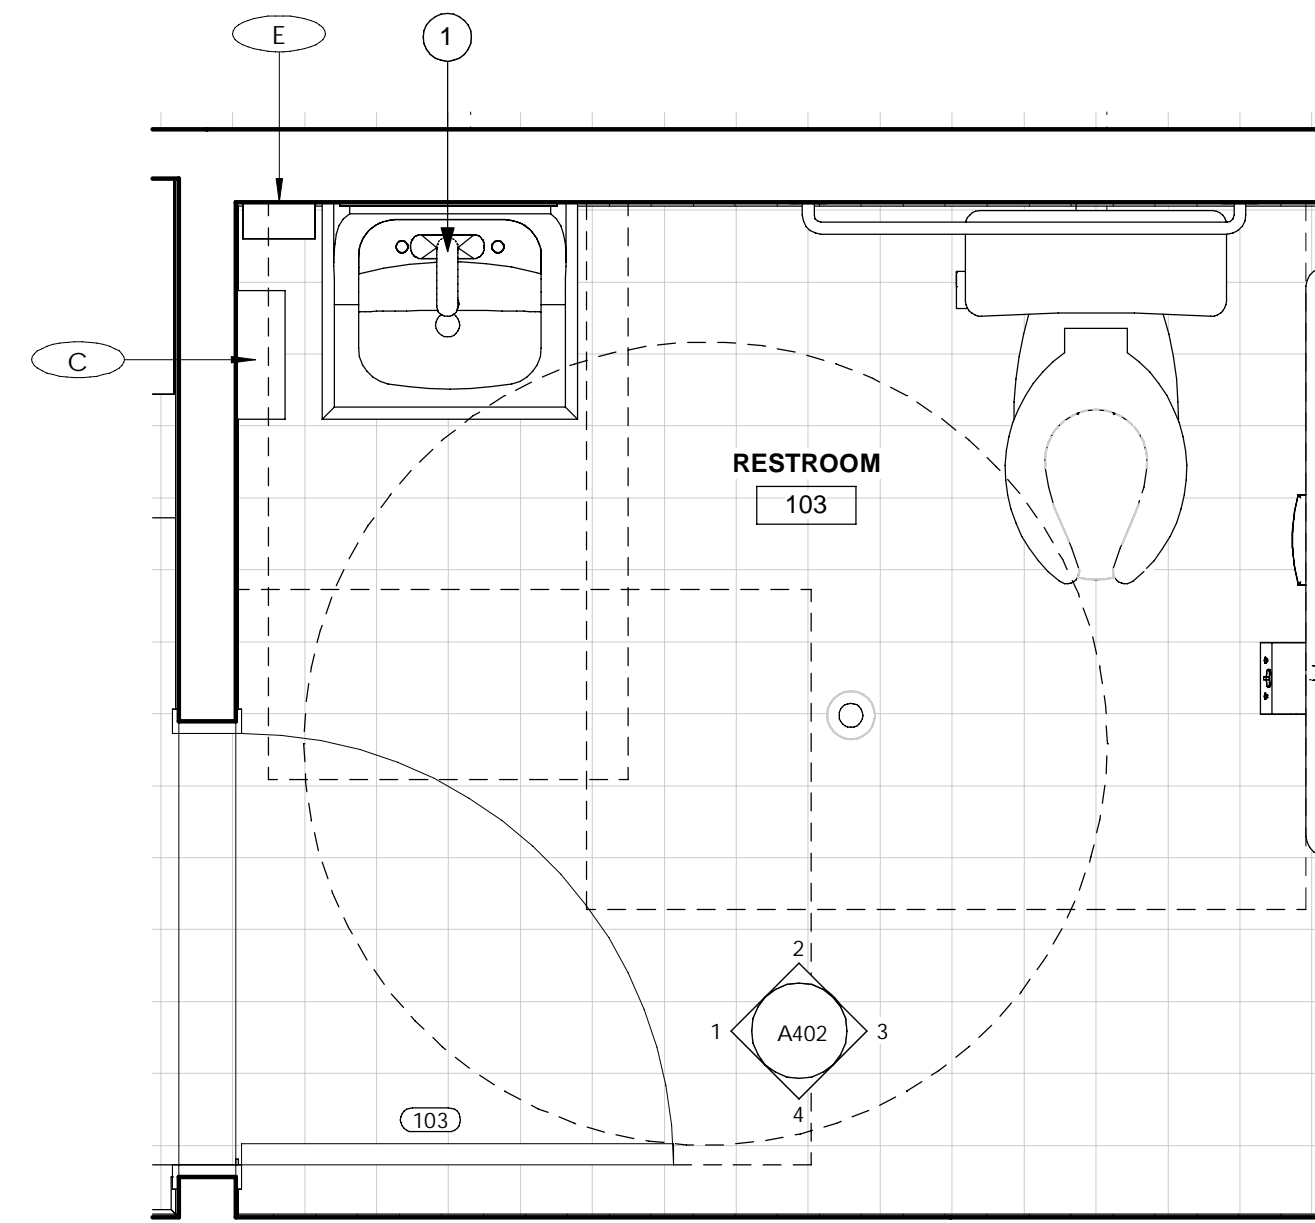

7 ENLARGED RESTROOM PLAN
3/4\" = 1'-0"


5 TOILET PLACEMENT
3/4\" = 1'-0"

6 HAND SINK MOUNTING LOCATIONS
3/4\" = 1'-0"

TOILET ACCESSORY NOTES


- ALL REFERENCE DIMENSIONS ARE TO FACE OF WALL FINISH, UNO
- ALL APPLICABLE ACCESSORIES SHALL COMPLY WITH AMERICAN DISABILITIES STANDARDS ACT (ADA) OF 2012
- EXAMINE ROUGH OPENINGS FOR CORRECT DIMENSIONS, PLUMBING, AND FOR DEFECTS THAT WOULD PREVENT PROPER INSTALLATION OF ACCESSORIES. DO NOT PROCEED WITH INSTALLATION UNTIL DEFECTS ARE CORRECTED.
- EACH ITEM SHALL BE INSTALLED PLUMB, LEVEL, SECURE, AND IN PROPER RELATION TO FLOORS, PARTITIONS, AND OTHER FIXTURES.

MATERIAL TAG



MATERIAL
TYPE PER
SCHEDULE

FIXTURE TAG



EQUIPMENT
PER SCHEDULE

GENERAL NOTES

- GENERAL CONTRACTOR SHALL VERIFY ALL CONDITIONS, DIMENSIONS, AND ASSEMBLIES PRIOR TO CONSTRUCTION. REPORT ANY SIGNIFICANT DISCREPANCIES TO THE ARCHITECT.
- COORDINATE INSTALLATIONS OF ALL AFTER CONTRACT ASSEMBLIES WITH OWNER PRIOR TO CONSTRUCTION OF ADJOINING OR RELATED STRUCTURES.
- ALL RESTROOM ACCESSORY MOUNTING HEIGHTS AND CLEARANCES SHALL COMPLY WITH THE ACCESSIBILITY REQUIREMENTS OF THE LOCAL JURISDICTION.
- LAVATORY AND WATER CLOSET FITTINGS MUST BE OPERABLE WITH NO MORE THAN 5 POUNDS EFFORT, WITH USING ONE HAND, AND WITH SINGLE EFFORT WITH NO TWISTING OR GRASPING OF HARDWARE.
- WATER PIPING AND DRAIN PIPES UNDER LAVATORIES MUST BE INSULATED, ABRASIVE OR SHARP SURFACES NOT PERMITTED UNDER LAVATORIES.
- DIMENSIONS AND REQUIRED CLEARANCES ARE TO FACE OF FINISHED SURFACE.

RESTROOM FIXTURE SCHEDULE

TAG	Count	DESCRIPTION	MANUFACTURER	MODEL NUMBER
A	1	42" GRAB BAR	BOBRICK WASHROOM EQUIPMENT, INC	B-6806 x 42
B	1	SANITARY NAPKIN DISPOSAL BIN	BOBRICK WASHROOM EQUIPMENT, INC	B-270
C	1	PAPER TOWEL DISPENSER	EMPRESS	EMP7400
D	1	36" GRAB BAR	BOBRICK WASHROOM EQUIPMENT, INC	B-6806 x 36
E	1	WALL MOUNTED SOAP DISPENSER	BY OWNER	
F	1	COAT HOOK	BOBRICK WASHROOM EQUIPMENT, INC	B-233
H	1	18" VERTICAL GRAB BAR	BOBRICK WASHROOM EQUIPMENT, INC	B-6806 x 18
I	1	TOILET PAPER DISPENSER	SAN JAMER	R-1200XC
J	1	PIPE INSULATION BOOT		
K	1	SURFACE MOUNTED MIRROR WITH FRAME	BOBRICK WASHROOM EQUIPMENT, INC	B-165 1836
L	1	WALL MOUNTED HAND WASH SIGNAGE	SETON	L-0715GGVPLYVAD

RESTROOM KEYNOTES

- ADA COMPLIANT SINK & FAUCET, REFER TO PLUMBING
- ADA COMPLIANT TOILET, REFER TO PLUMBING
- 67" CLEAR FLOOR SPACE
- CENTER MIRROR OVER SINK



1. GC TO SUBMIT SEALANT SAMPLE TO CONSTRUCTION MANAGER FOR APPROVAL PRIOR TO PURCHASE & INSTALLATION.
2. ALL COMPONENTS, PRODUCTS, EQUIPMENT, FASTENERS, FINISHES, ETC TO BE INSTALLED PER MANUFACTURERS WRITTEN INSTRUCTIONS.
3. ANY DIMENSIONAL IRREGULARITIES OR CONFLICTS ARE TO BE BROUGHT TO THE ARCHITECTS ATTENTION IMMEDIATELY & PRIOR TO COMMENCEMENT OF WORK.
4. GC TO COORDINATE WORK WITH SPECIFICATIONS FOR PROPER INSTALLATION & ADDITIONAL REQUIREMENTS.
5. COLOR OF TRIM PIECES SPECIFIED WITHIN THE DETAILS ON THIS SHEET TO MATCH COLOR OF ADJACENT WALL.



#2001
610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3
PROTOTYPE VERSION 2.00



513 MAIN STREET	#300
FORT WORTH	TX 76102
SEAL	



PERMIT SET: 04/12/2024

CONTRACTOR SHALL VERIFY ALL
CONDITIONS AND DIMENSIONS AT THE
JOB SITE AND NOTIFY THE ARCHITECT
OF ANY DIMENSIONAL ERRORS,
OMISSIONS OR DISCREPANCIES BEFORE
BEGINNING OR FABRICATING ANY WORK.
DO NOT SCALE DRAWINGS.

[illegible][illegible]






PROJECT NO:	24-0087
ORIGINAL ISSUE:	06/01/2023
SCALE:	AS NOTED
DRAWN BY:	V. PEREZ
CHECKED BY:	J. JEFFERY

SHEET TITLE

PLAN DETAILS

SHEET NUMBER

A501

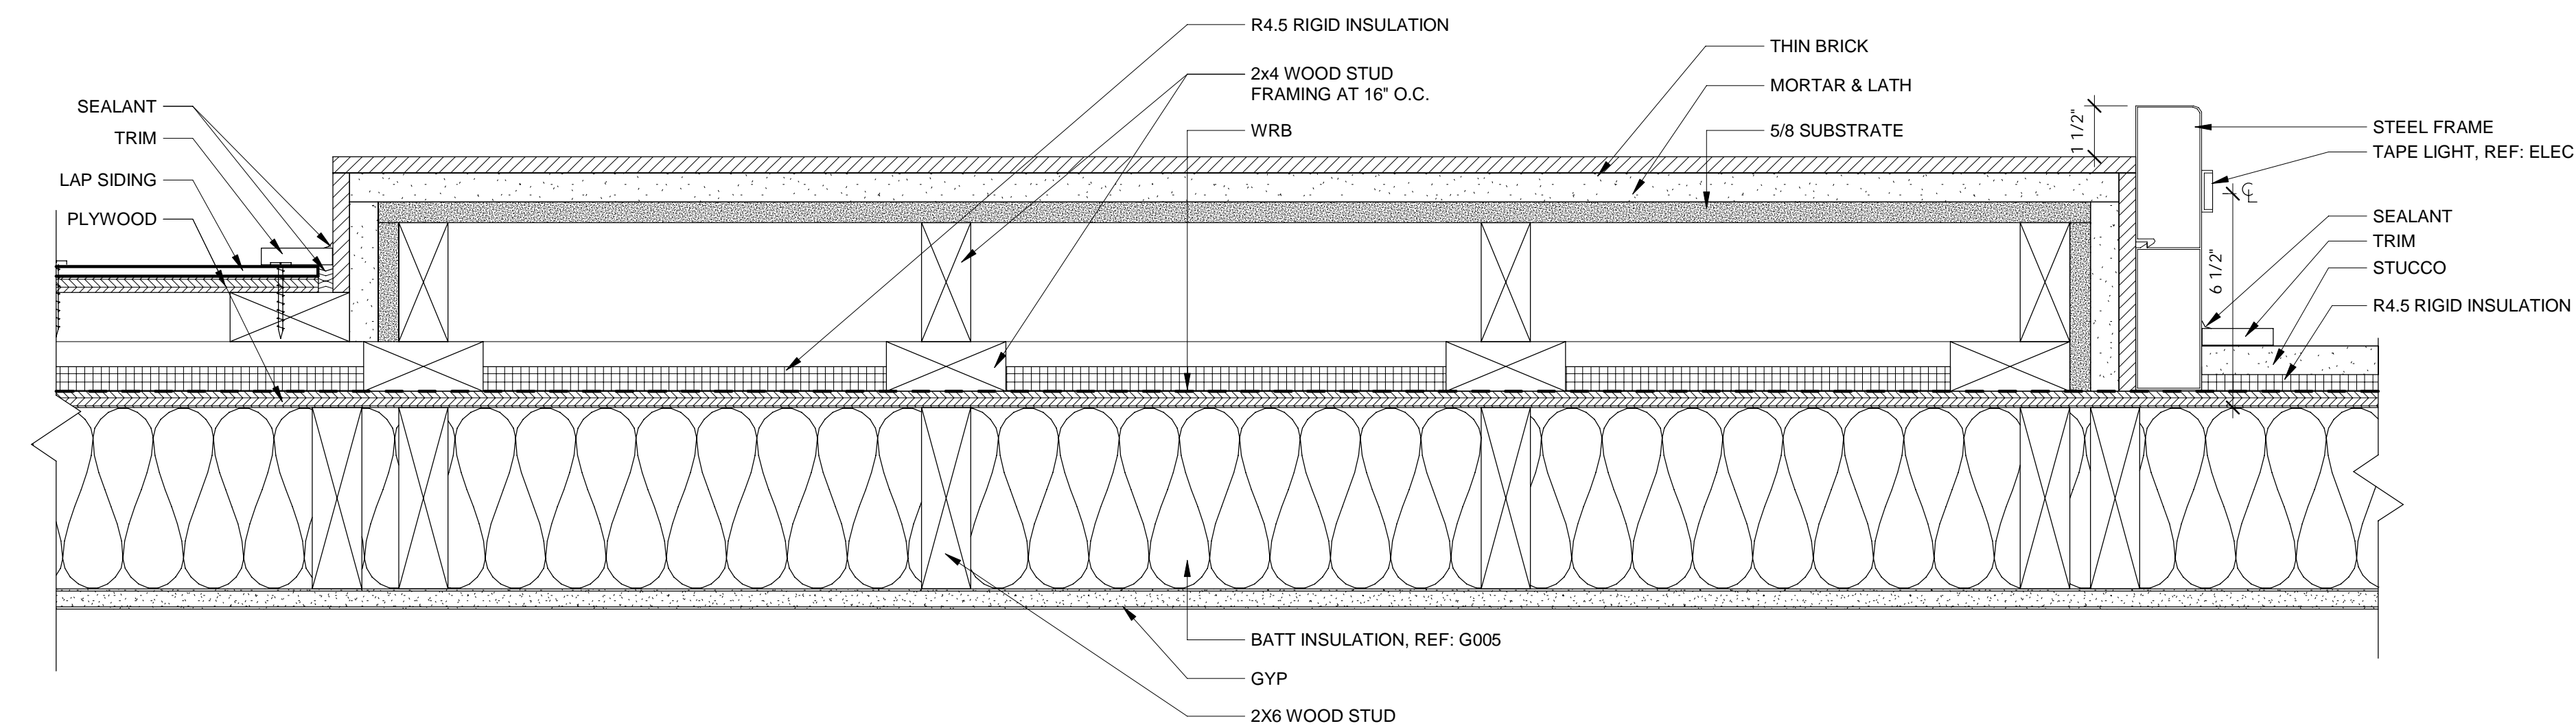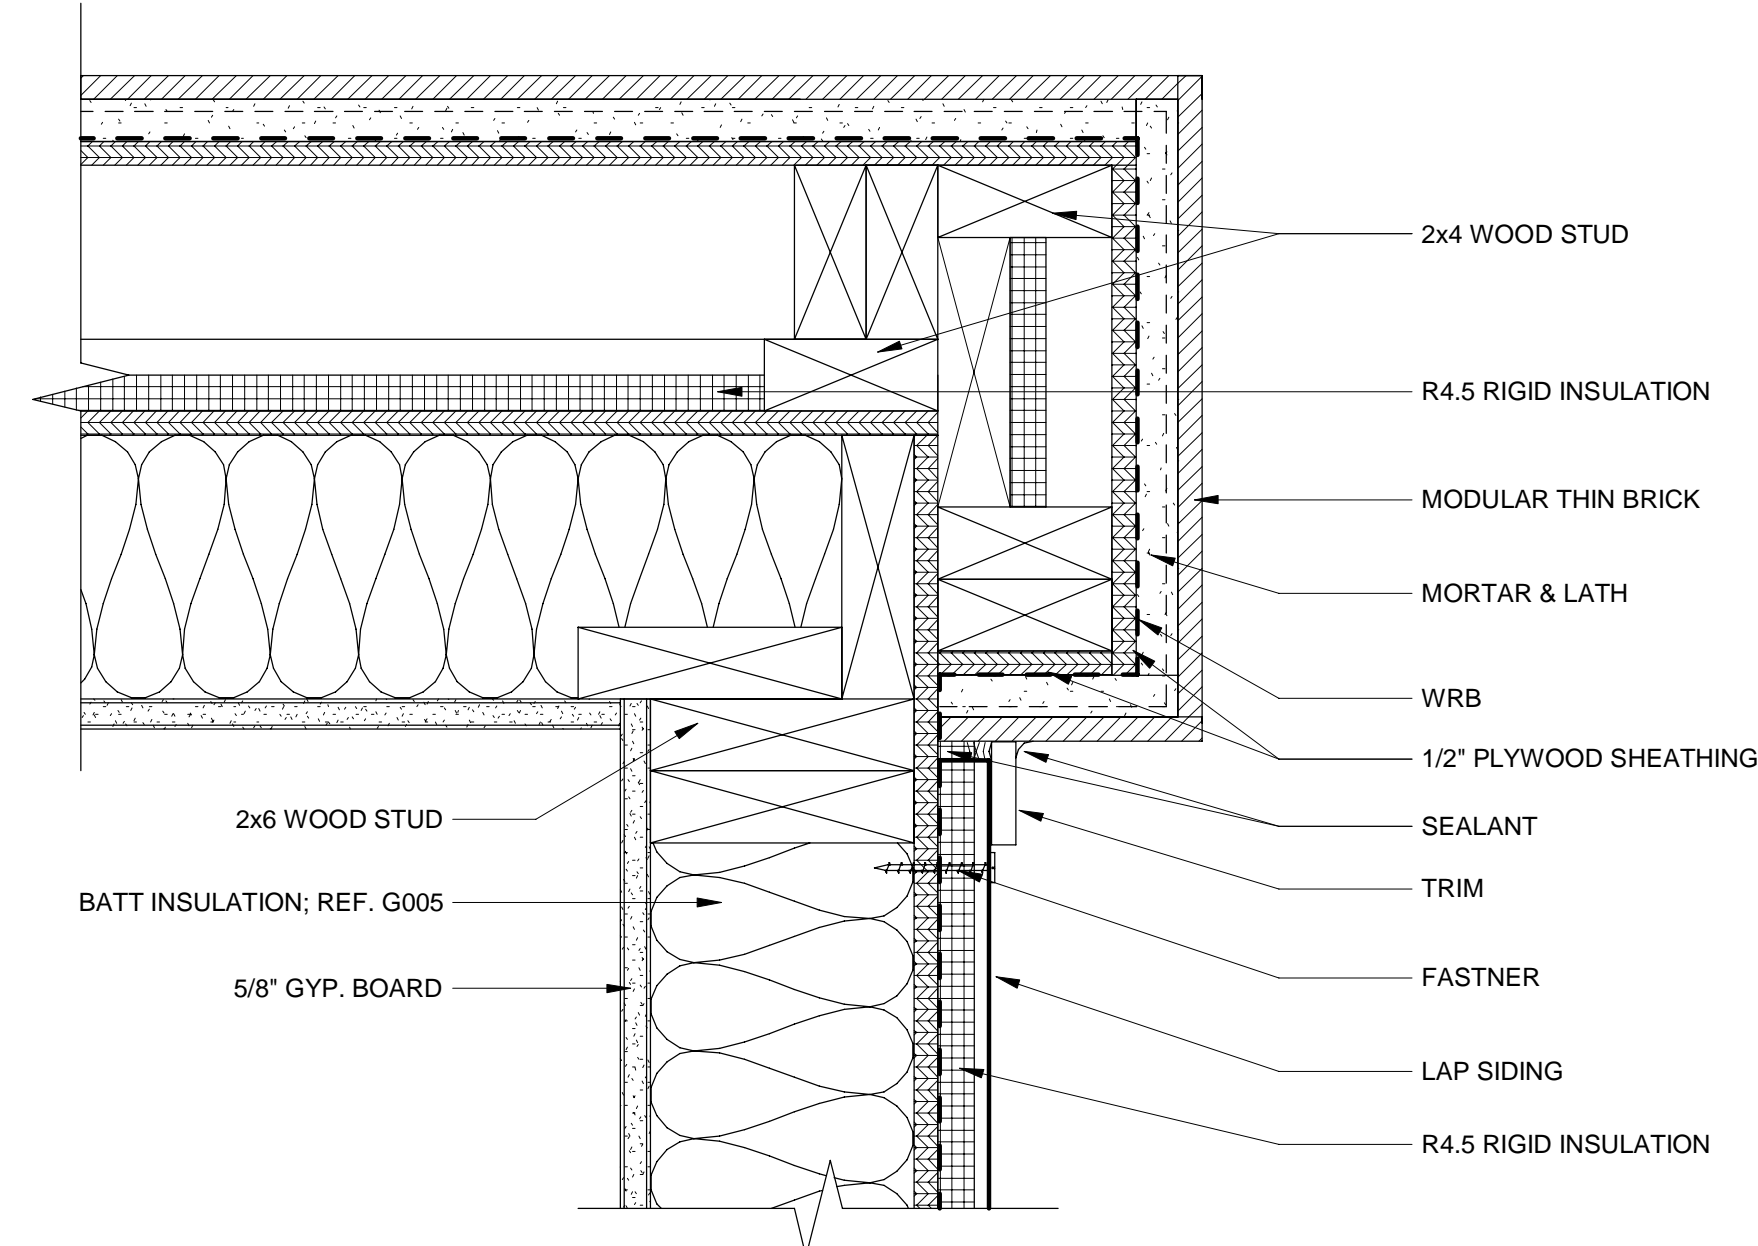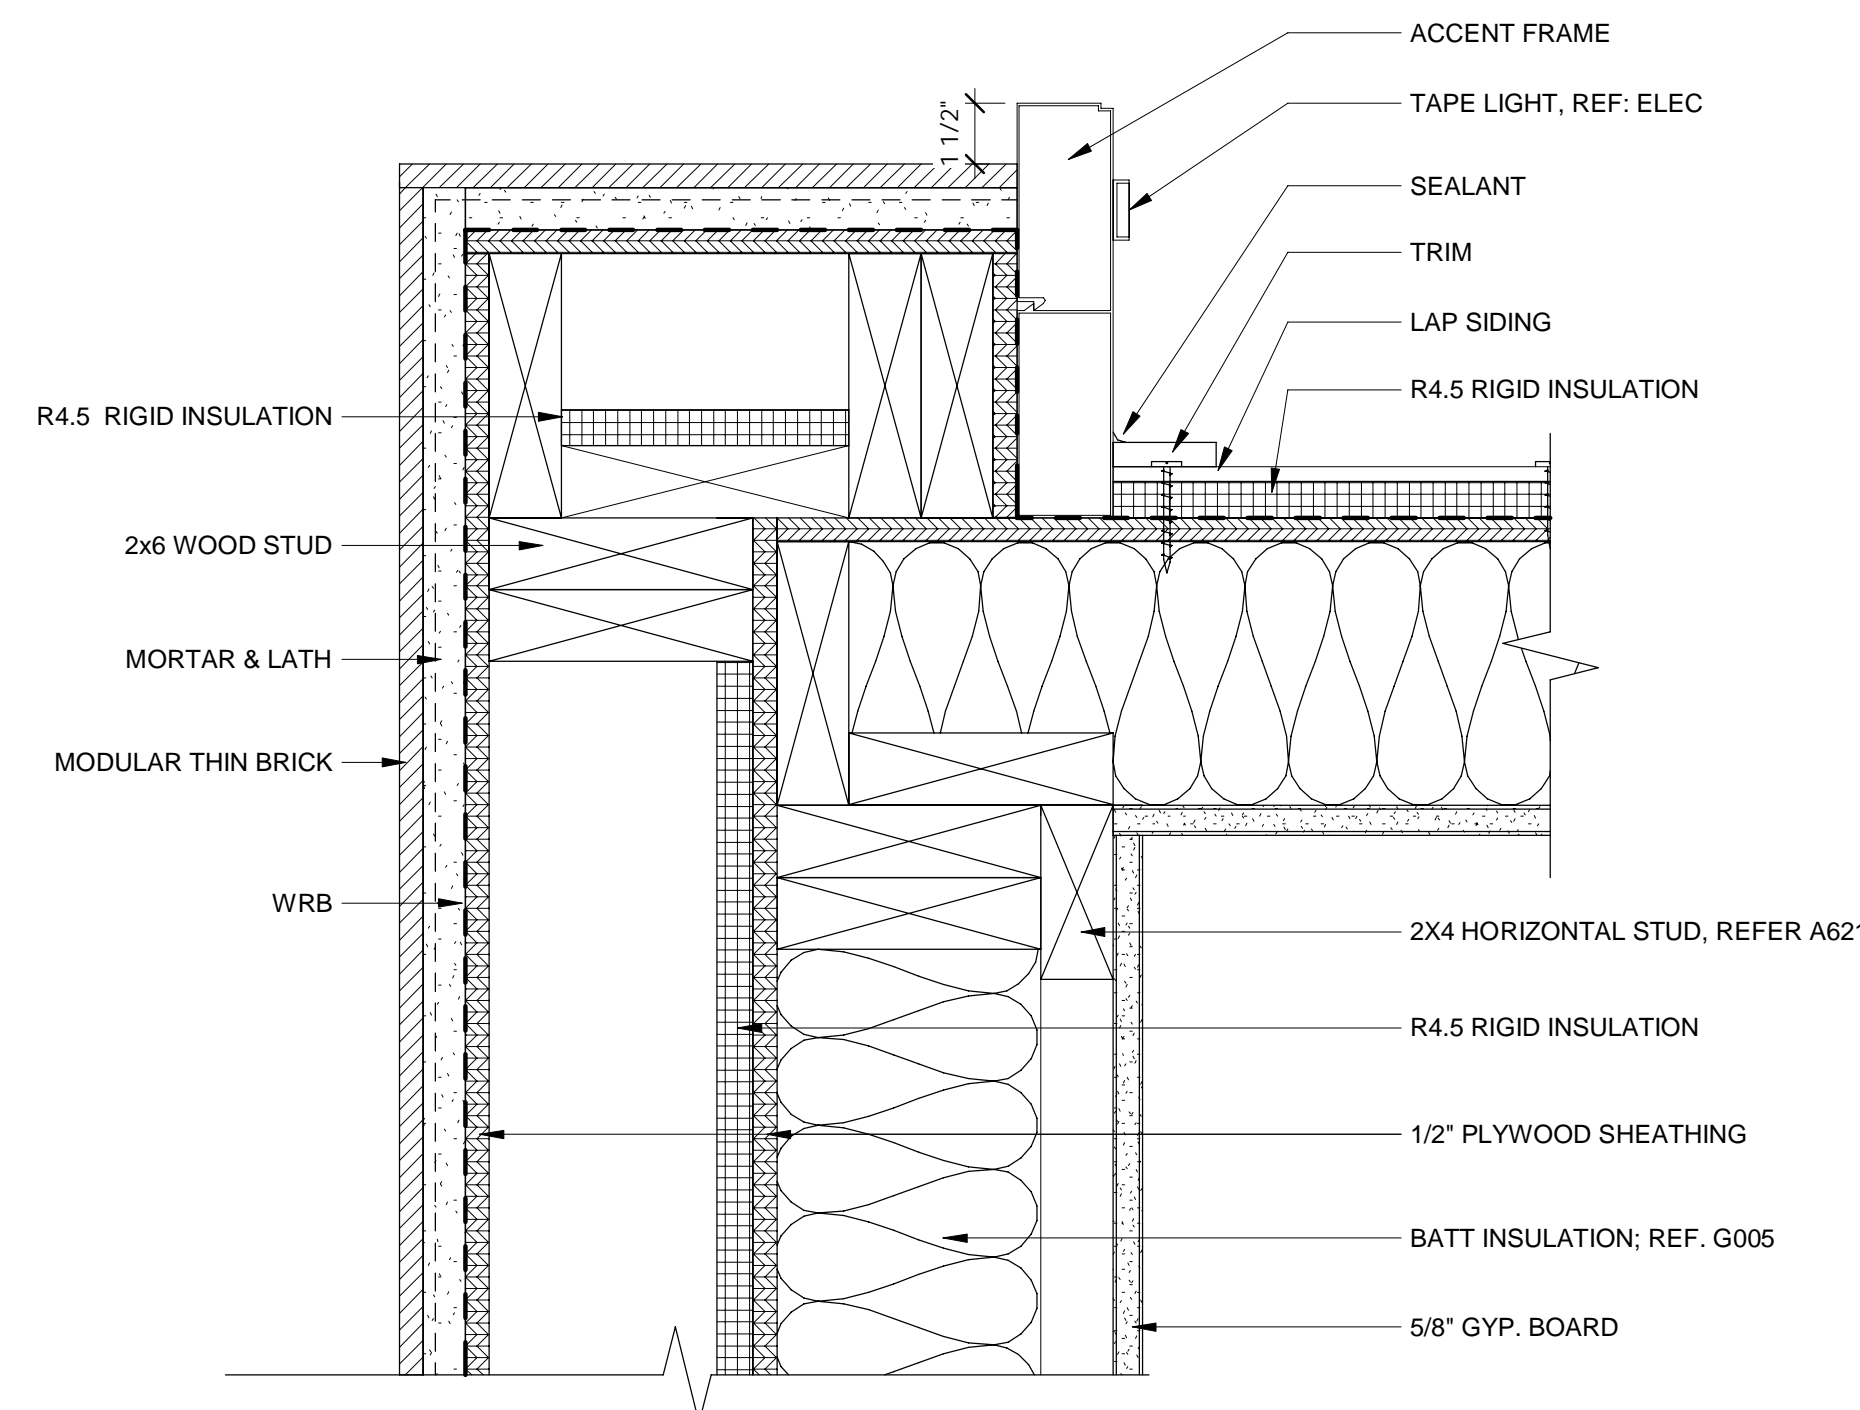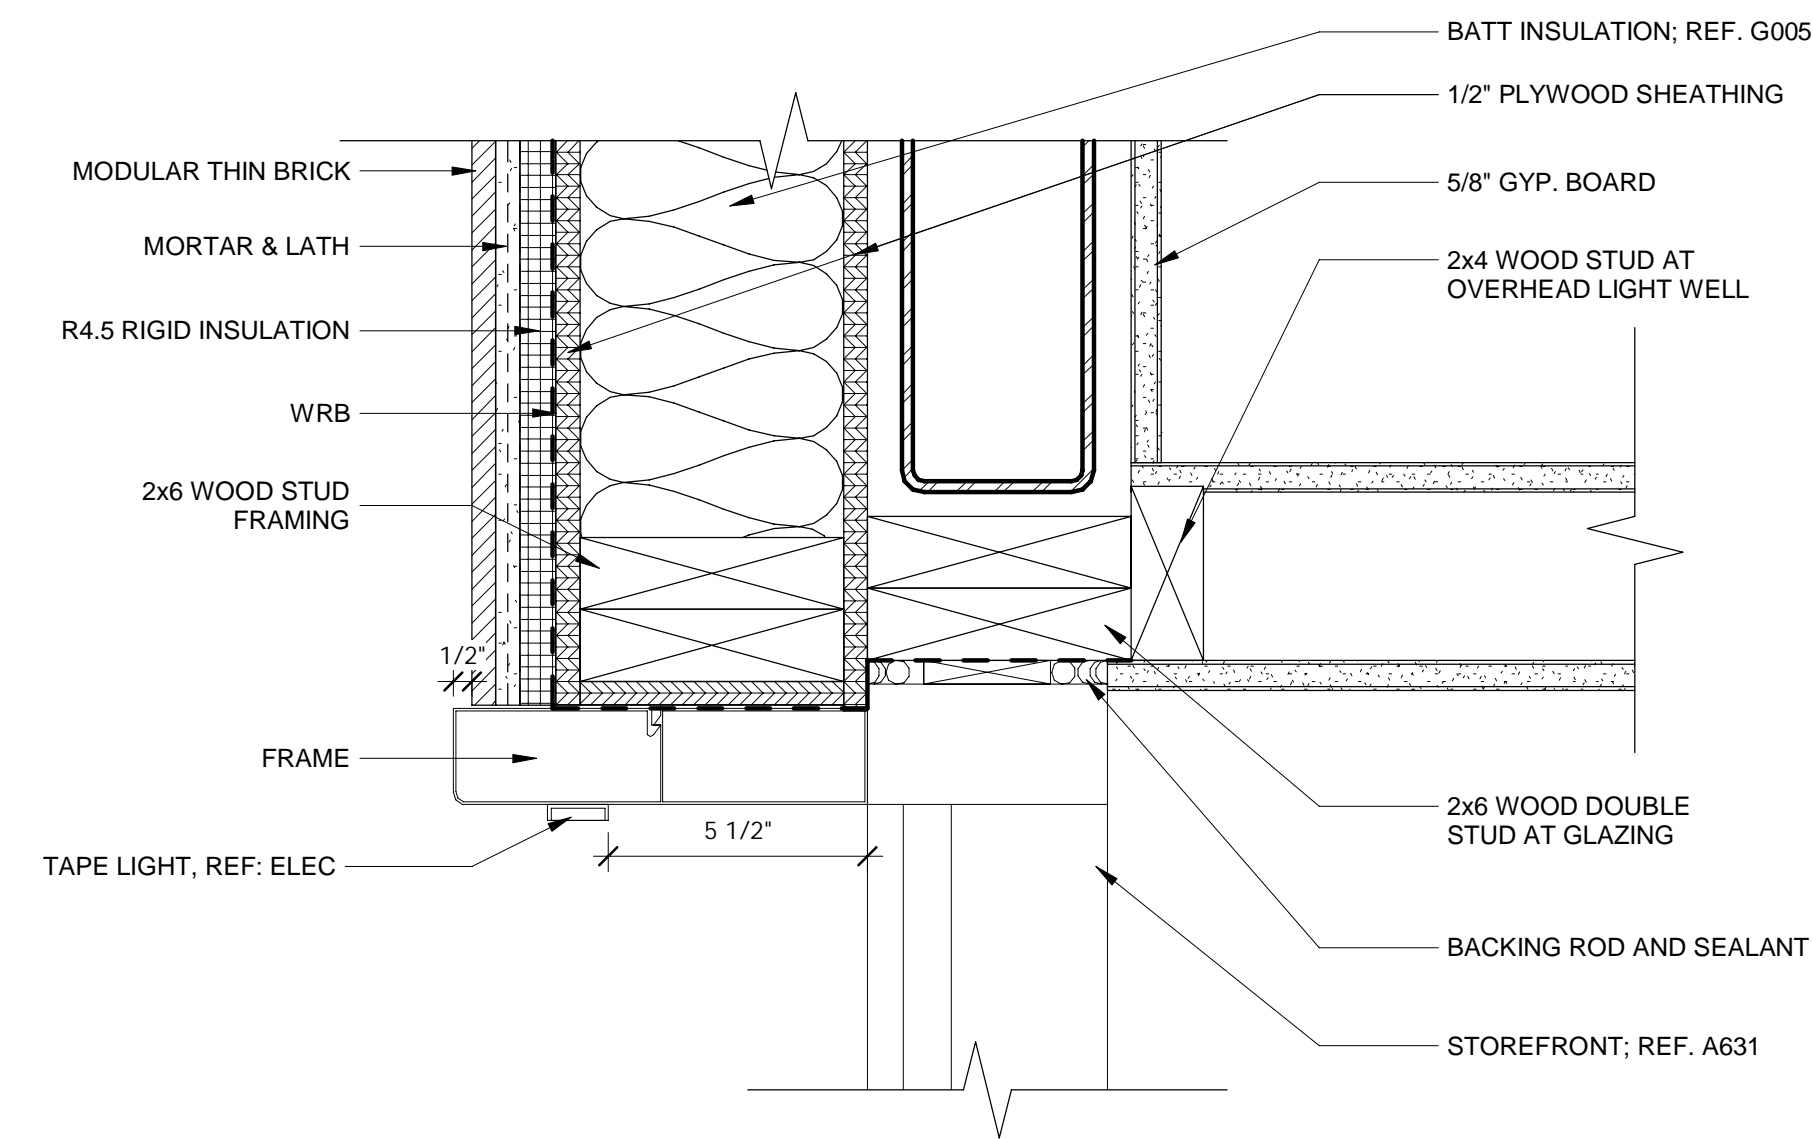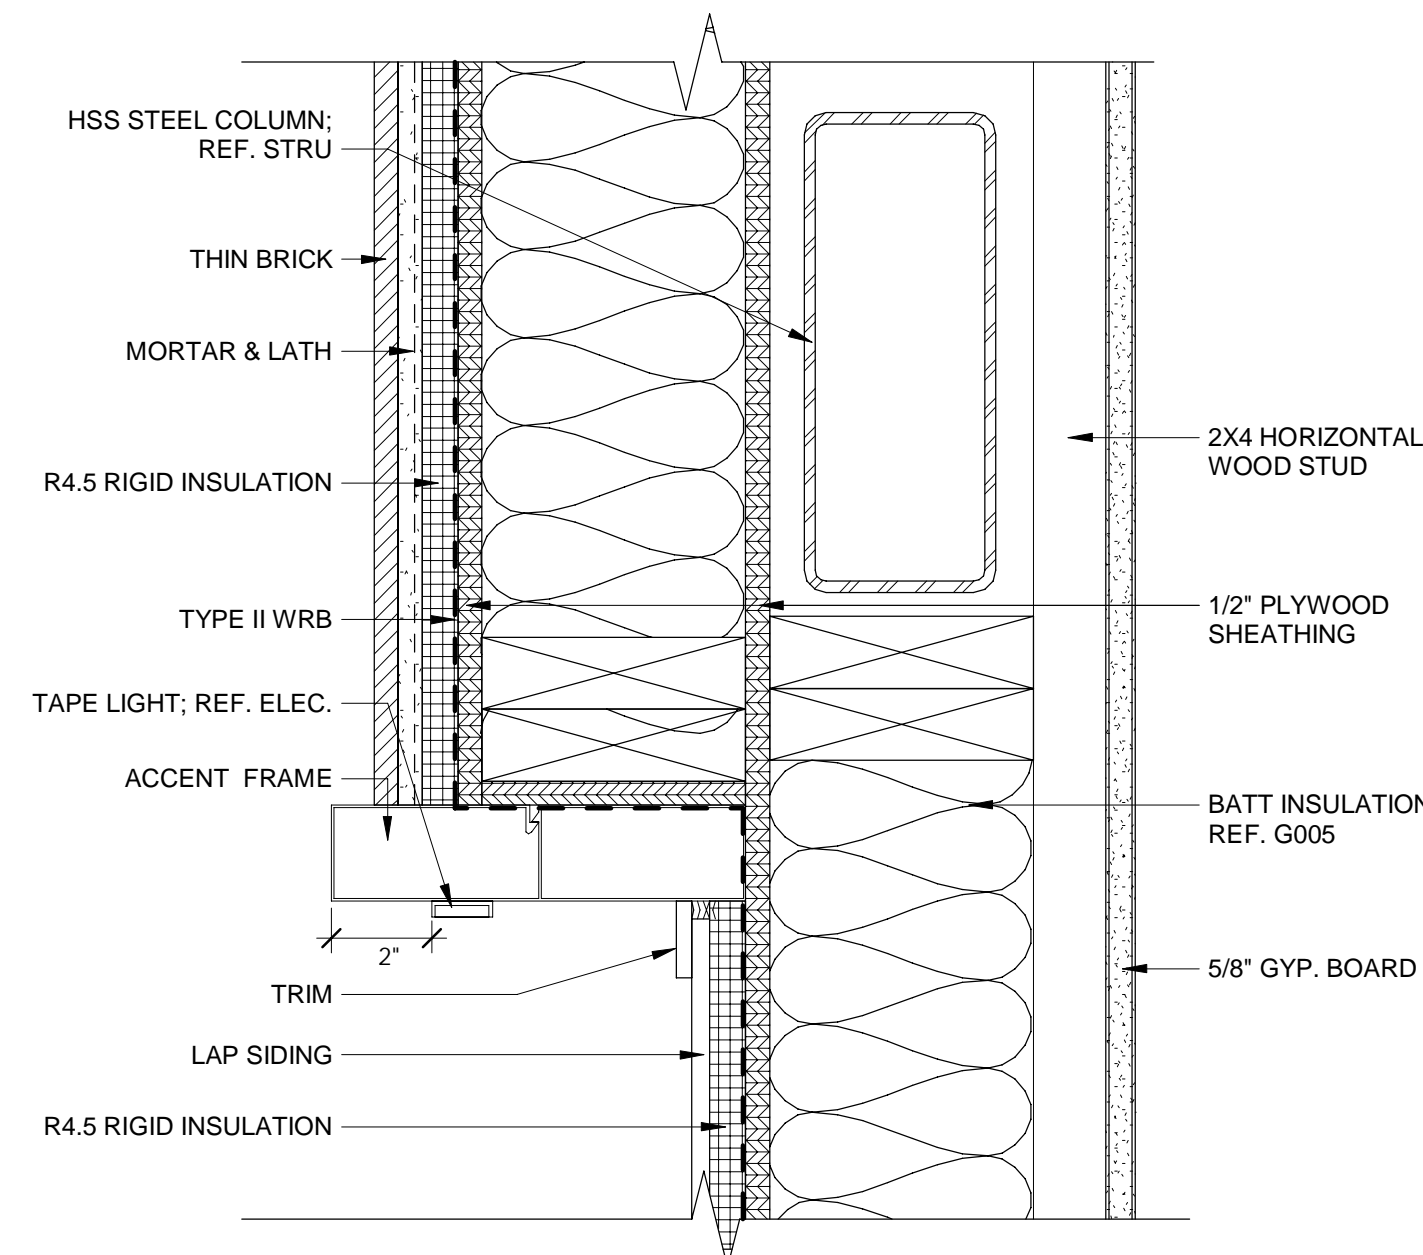

#2001
610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3
PROTOTYPE VERSION 2.00



513 MAIN STREET #300
FORT WORTH TX 76102



PERMIT SET: 04/12/2024

CONTRACTOR SHALL VERIFY ALL
CONDITIONS AND DIMENSIONS AT THE
JOB SITE AND NOTIFY THE ARCHITECT
OF ANY DIMENSIONAL ERRORS,
OMISSIONS OR DISCREPANCIES BEFORE
BEGINNING OR FABRICATING ANY WORK.
DO NOT SCALE DRAWINGS.

[illegible]

PROJECT INFORMATION	
---------------------	--


PROJECT NO:	24-0087
ORIGINAL ISSUE:	06/01/2023
SCALE:	AS NOTED
DRAWN BY:	V. PEREZ
CHECKED BY:	J. JEFFERY

SHEET TITLE

PLAN DETAILS

SHEET NUMBER

A502

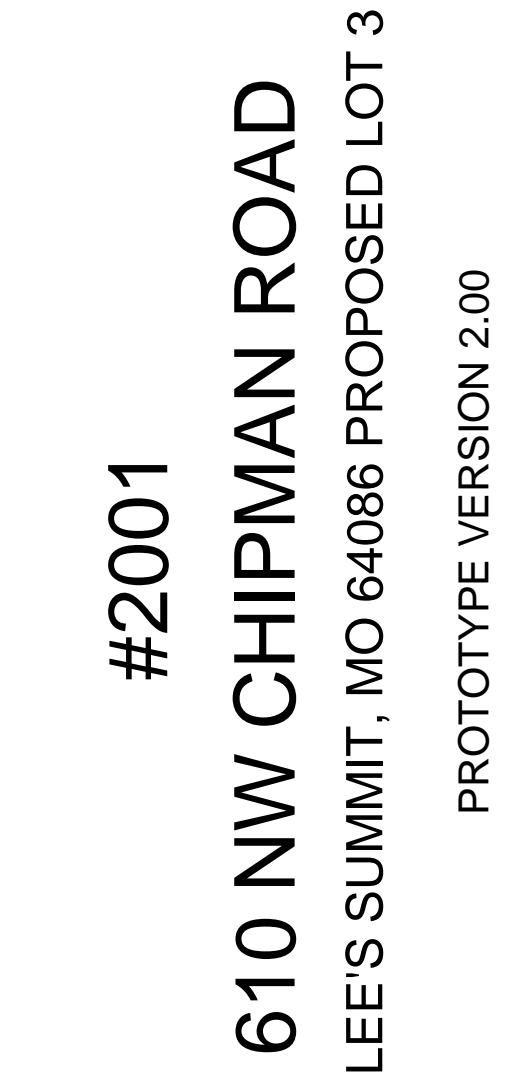

ISSUE	DATE	DESCRIPTION
-------	------	-------------

PROJECT INFORMATION

SHEET TITLE

SHEET NUMBER

4'-2" GC TO VERIFY ANTENNA HEAD 6" ABOVE PARAPET

ANTENNA HEAD

SEALING GASKET

ACW-651 SS316 COUPLER BY PEPLINK

THREAD SEALING PLUMBING TAPE

THREADS TAPED INTO CONDUIT, REF ANTENNA MANUFACTURER TO MATCH THREADS

2" CONDUIT

CONTINUOUS SEALANT

CLAMP RING

MASTIC SEALANT

PRE-MOLDED CONDUIT BOOT

BONDING CEMENT

CONTINUOUS SEALANT

EXTEND ROOF MEMBRANE UNDER BOOT

WOOD BLOCKING


WOOD TRUSS

POLYISO RIGID FOAM INSULATION, TYP. RE: G005


VAPOR BARRIER, TYP.

PLYWOOD, TYP. RE: STRUCTURAL


4 ROOFTOP CELL BOOSTER
1 1/2" = 1'-0"

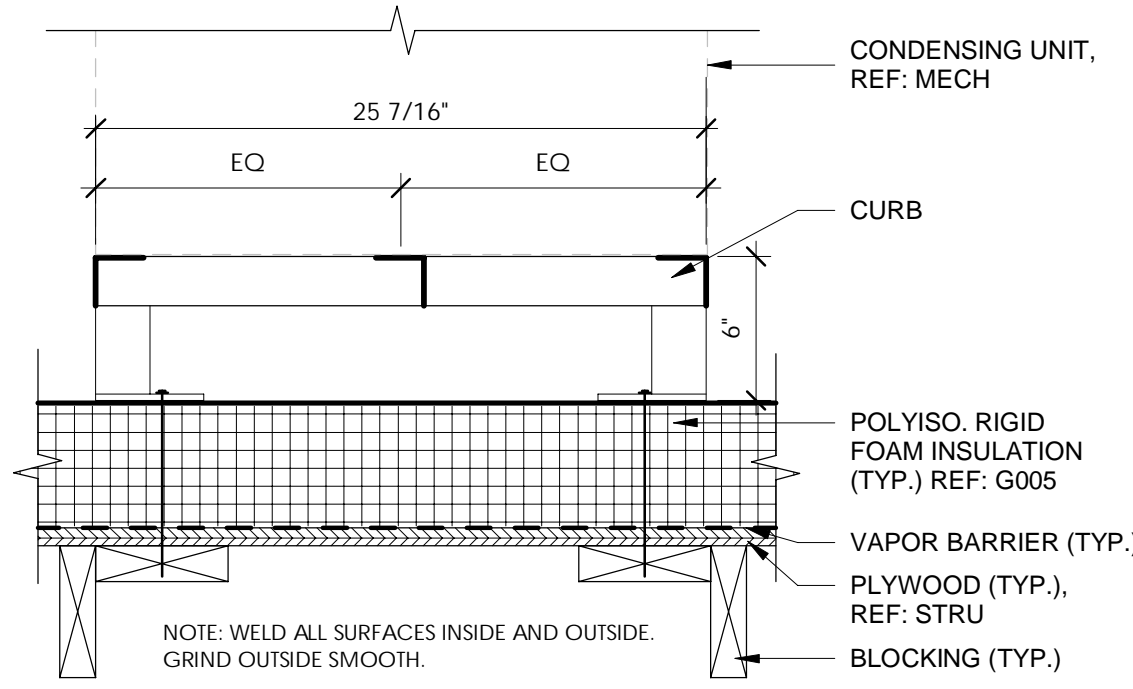


1 CONDENSING UNIT CURB
1 1/2" = 1'-0"

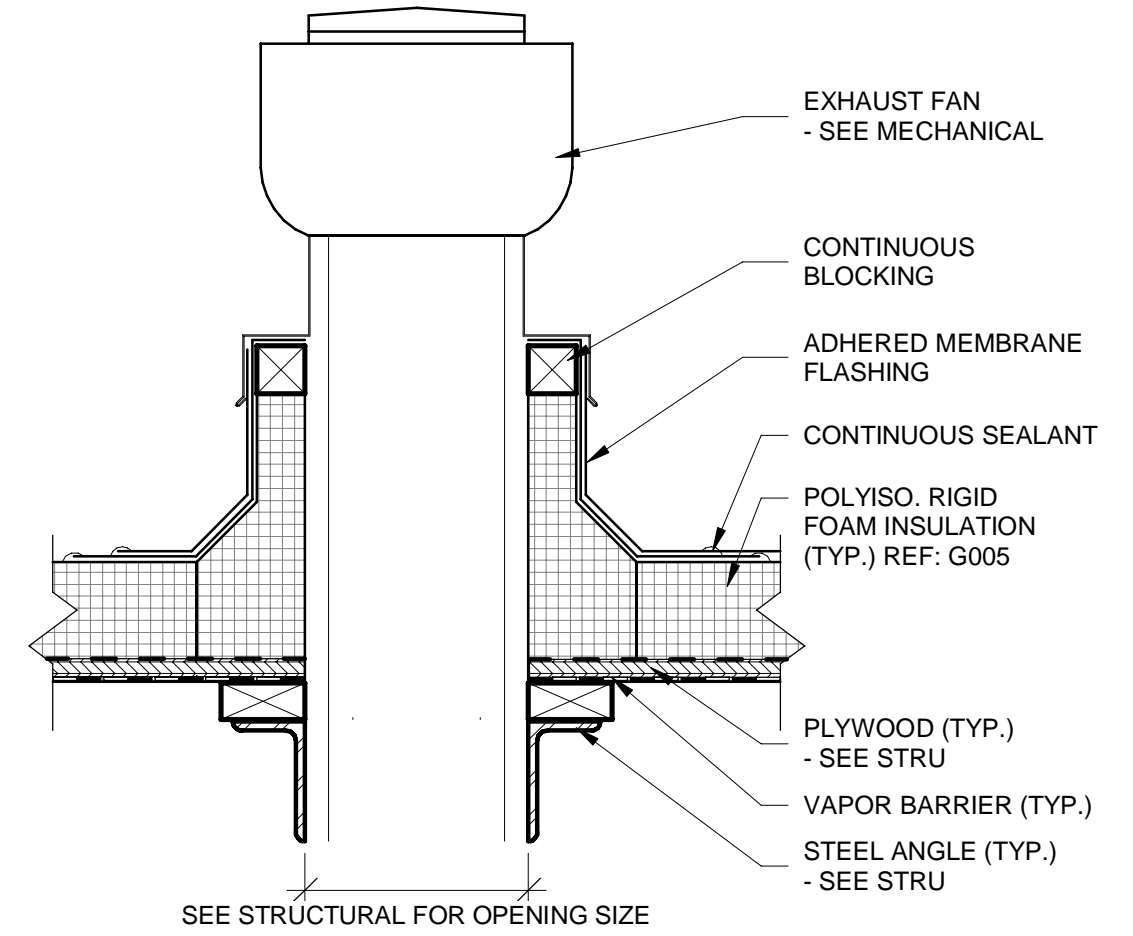


5 EXHAUST FAN PENETRATION (TYP.)
1 1/2" = 1'-0"

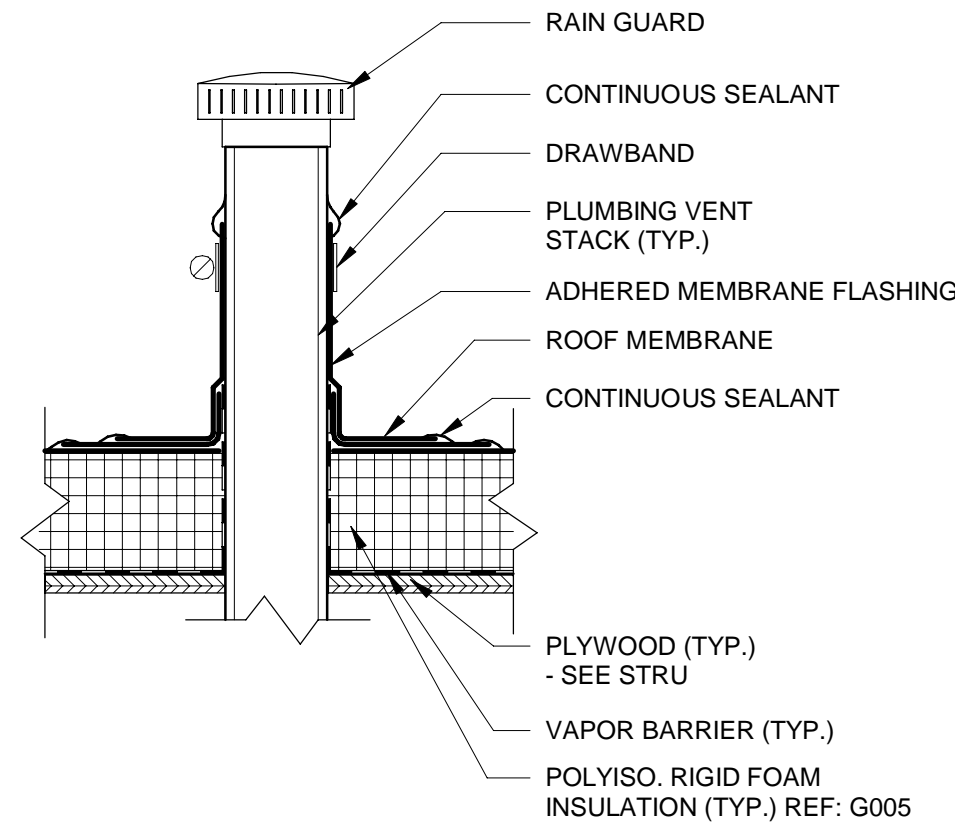


2 | VENT PENETRATION (TYP.)
1 1/2" = 1'-0"

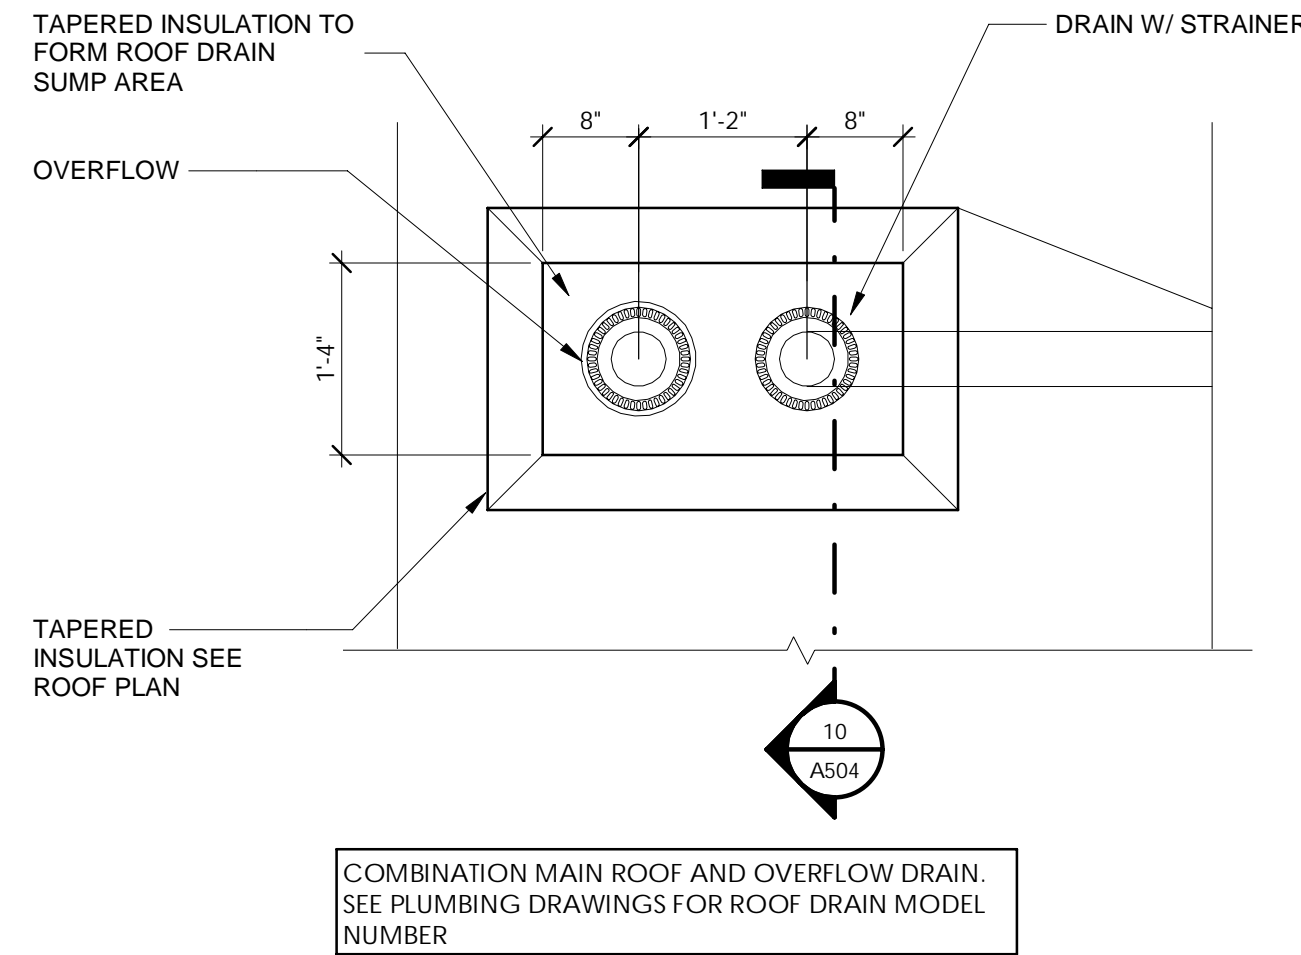


6 | ROOF DRAIN DETAIL PLAN
3/4" = 1'-0"

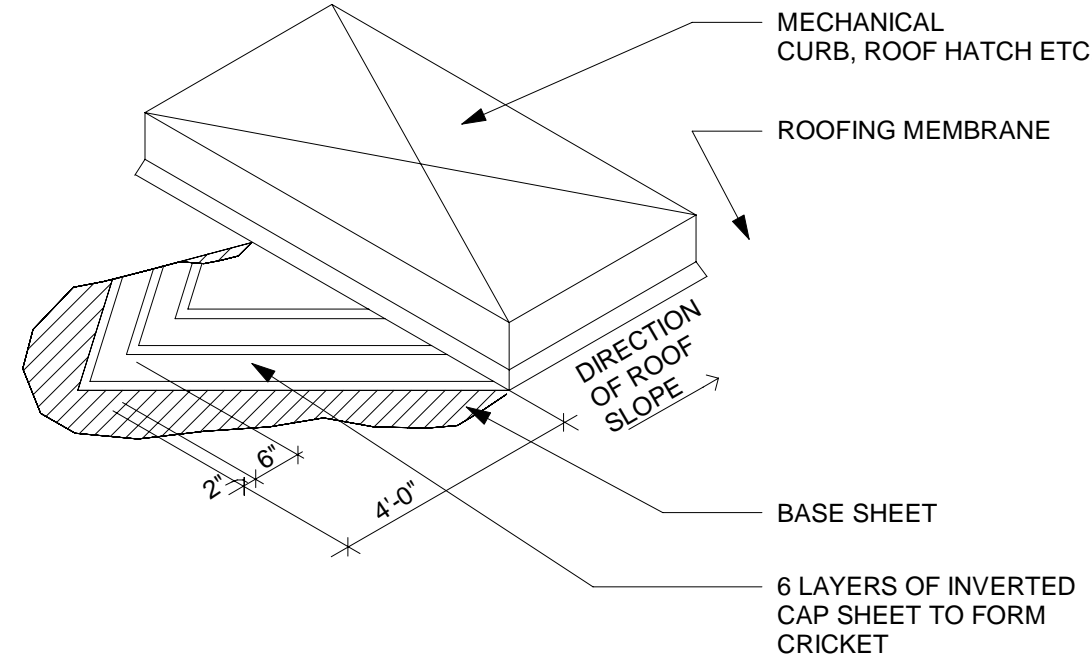


3 BUILT-UP ROOFING CRICKET

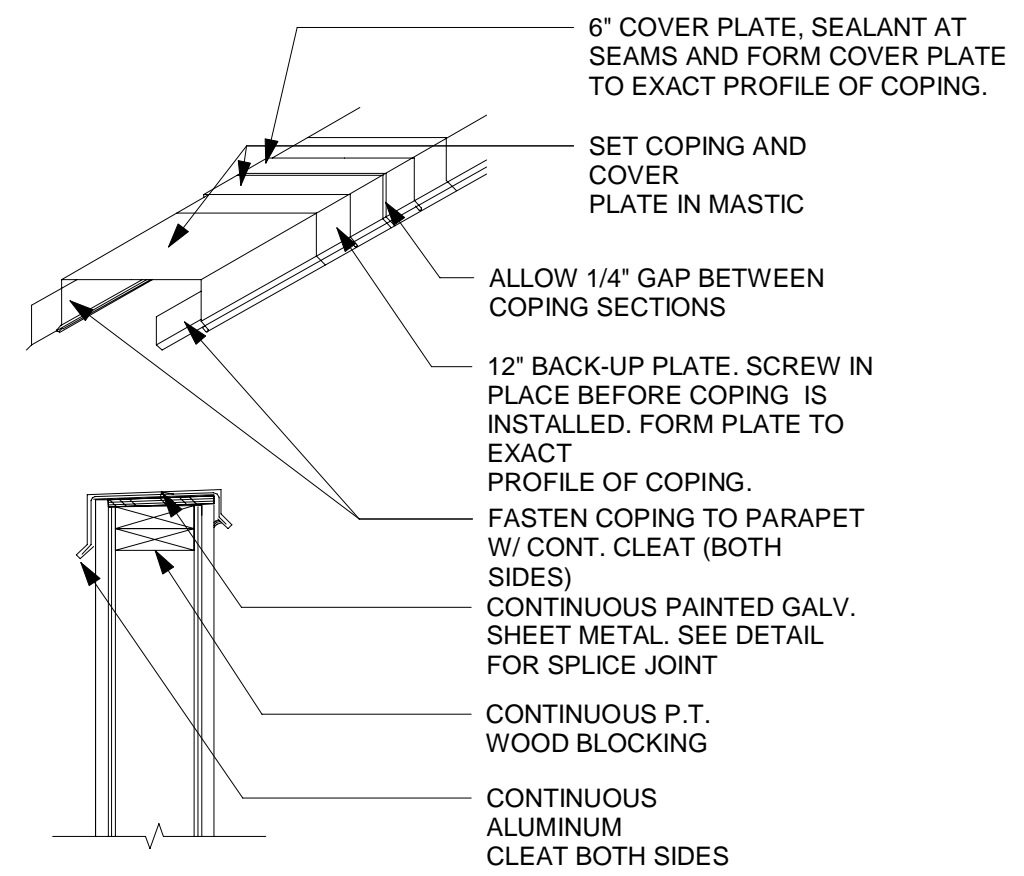


7 METAL COPING DETAIL
1 1/2" = 1'-0"

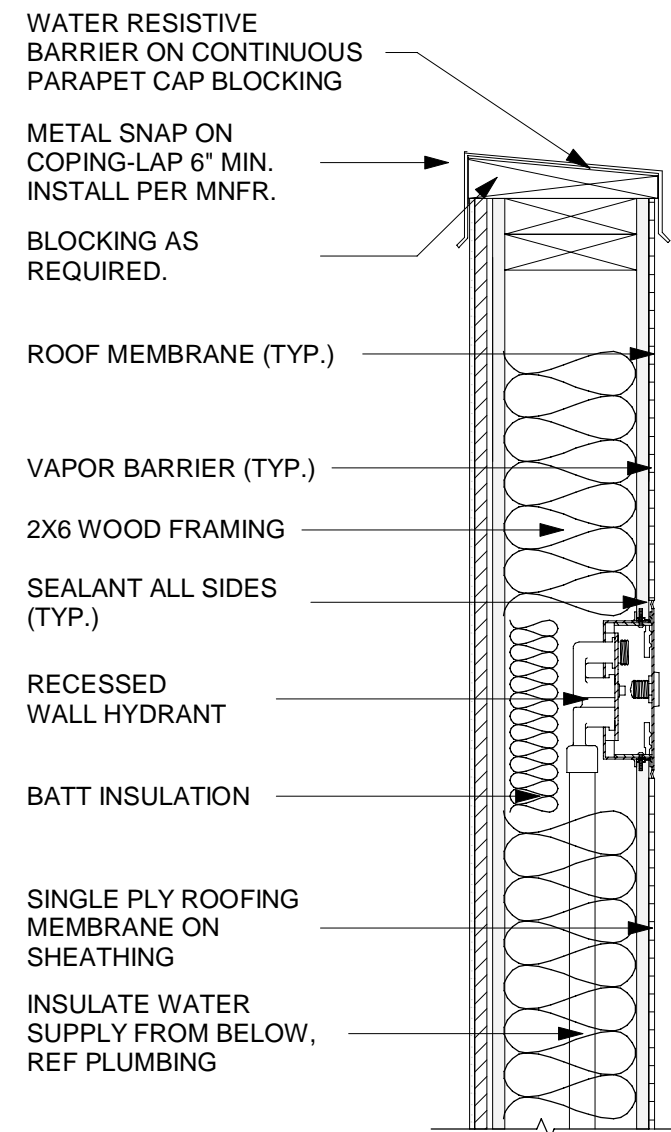


8 ROOFTOP HOSE BIB
1 1/2" = 1'-0"




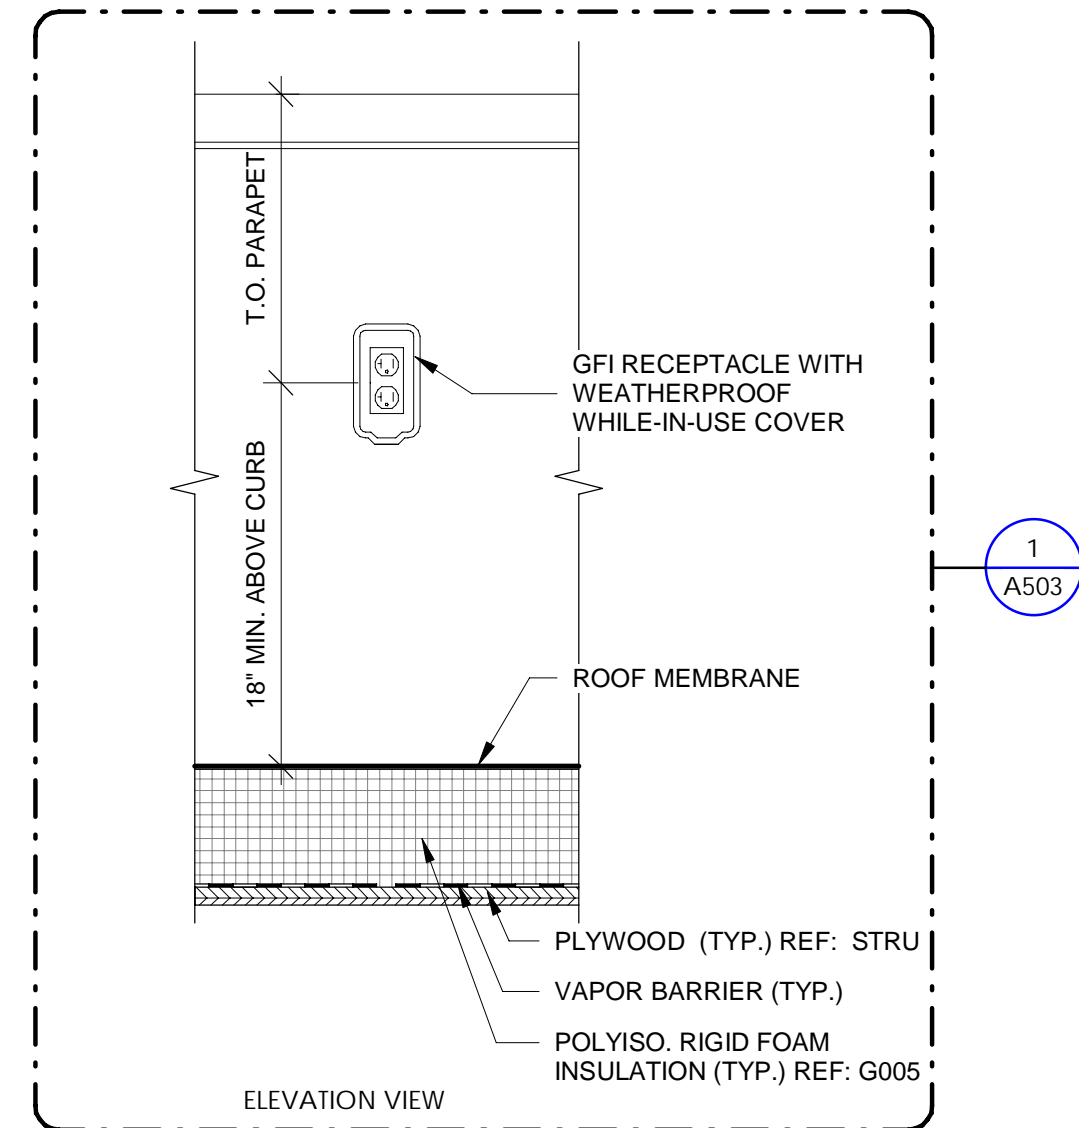


9 | ROOFTOP RECEPTACLE (TYP.)
1 1/2" = 1'-0"

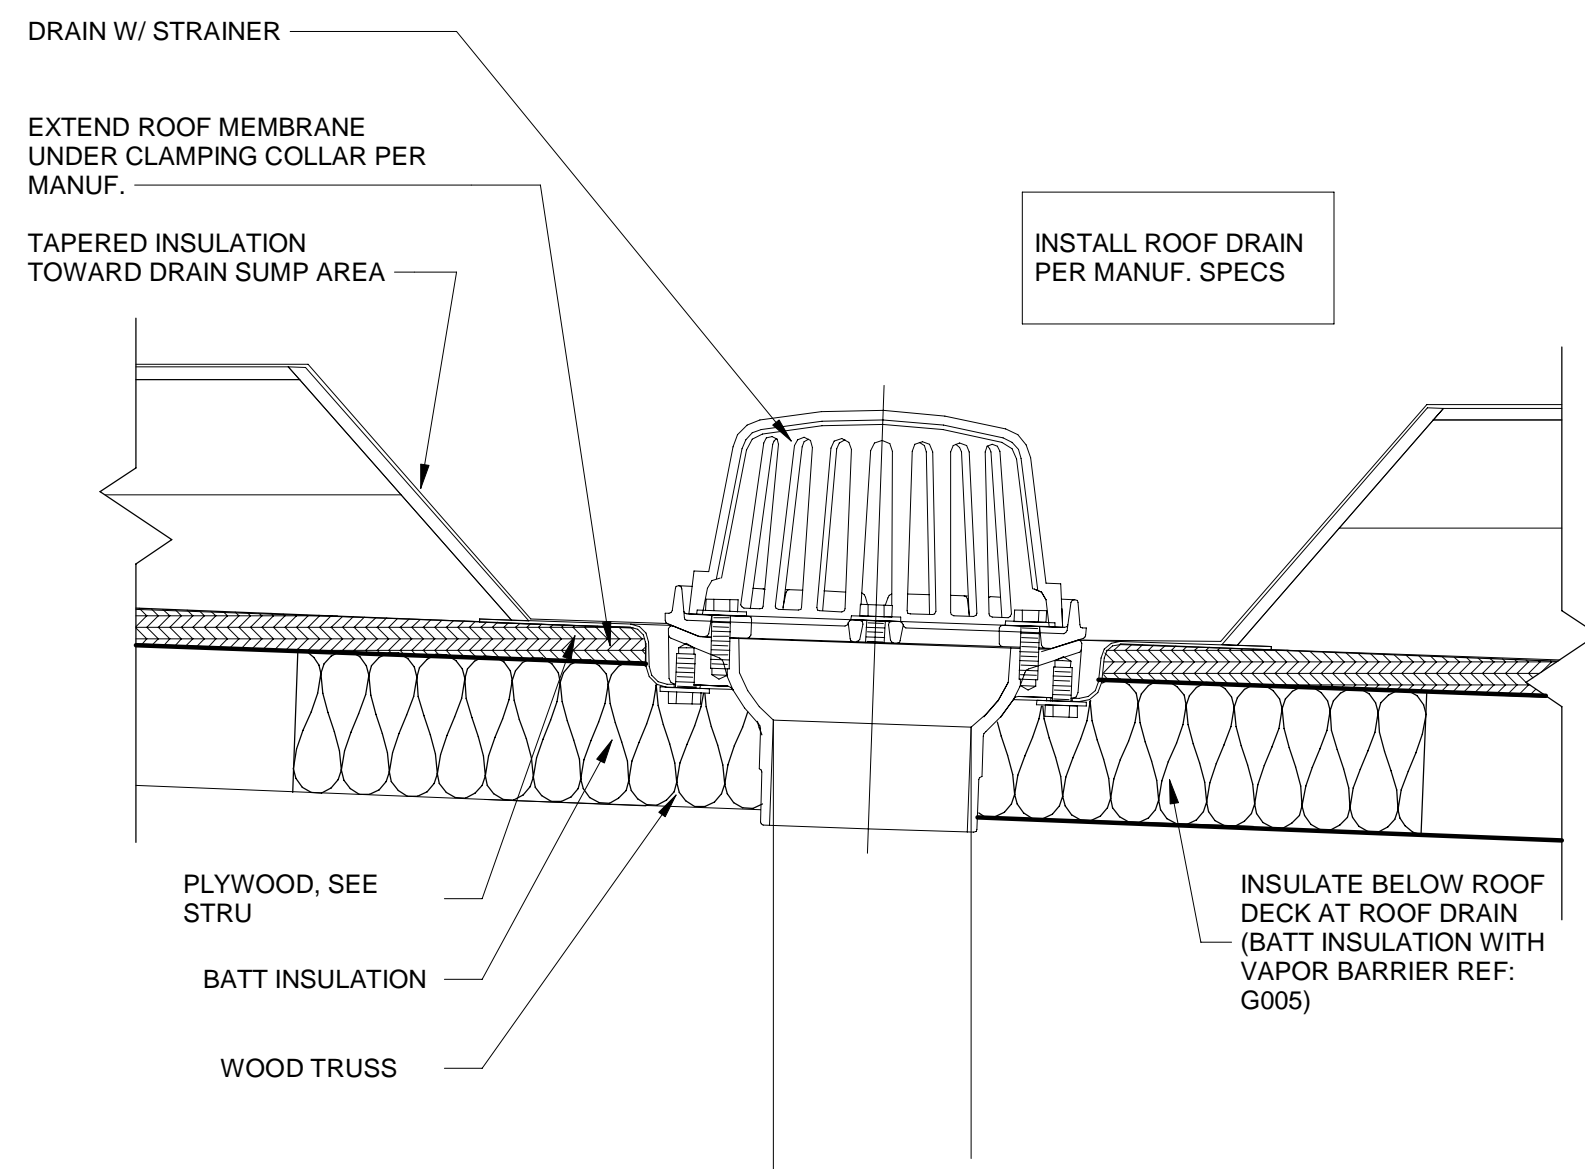

10 | ROOF DRAIN DETAIL
NOT TO SCALE

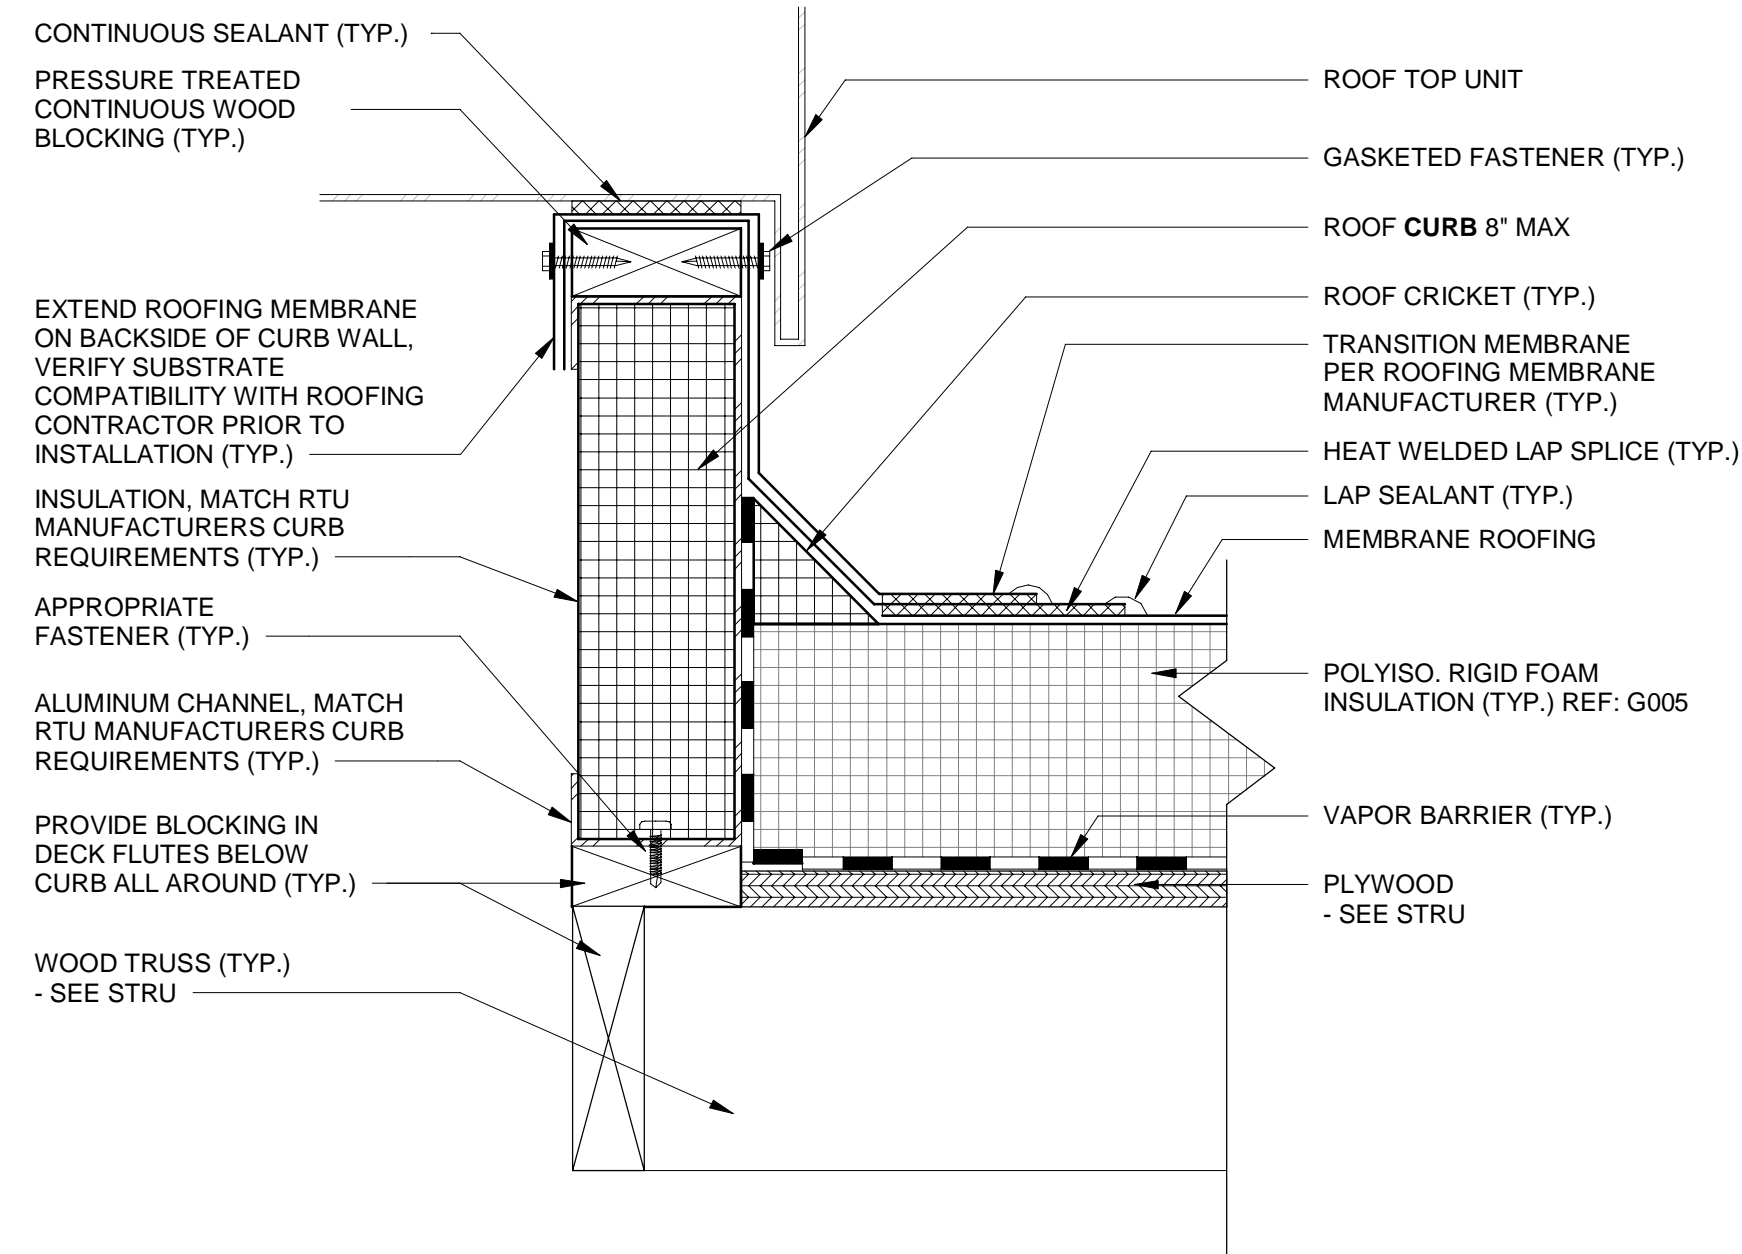11 | ROOF CURB DETAIL
3" = 1'-0"

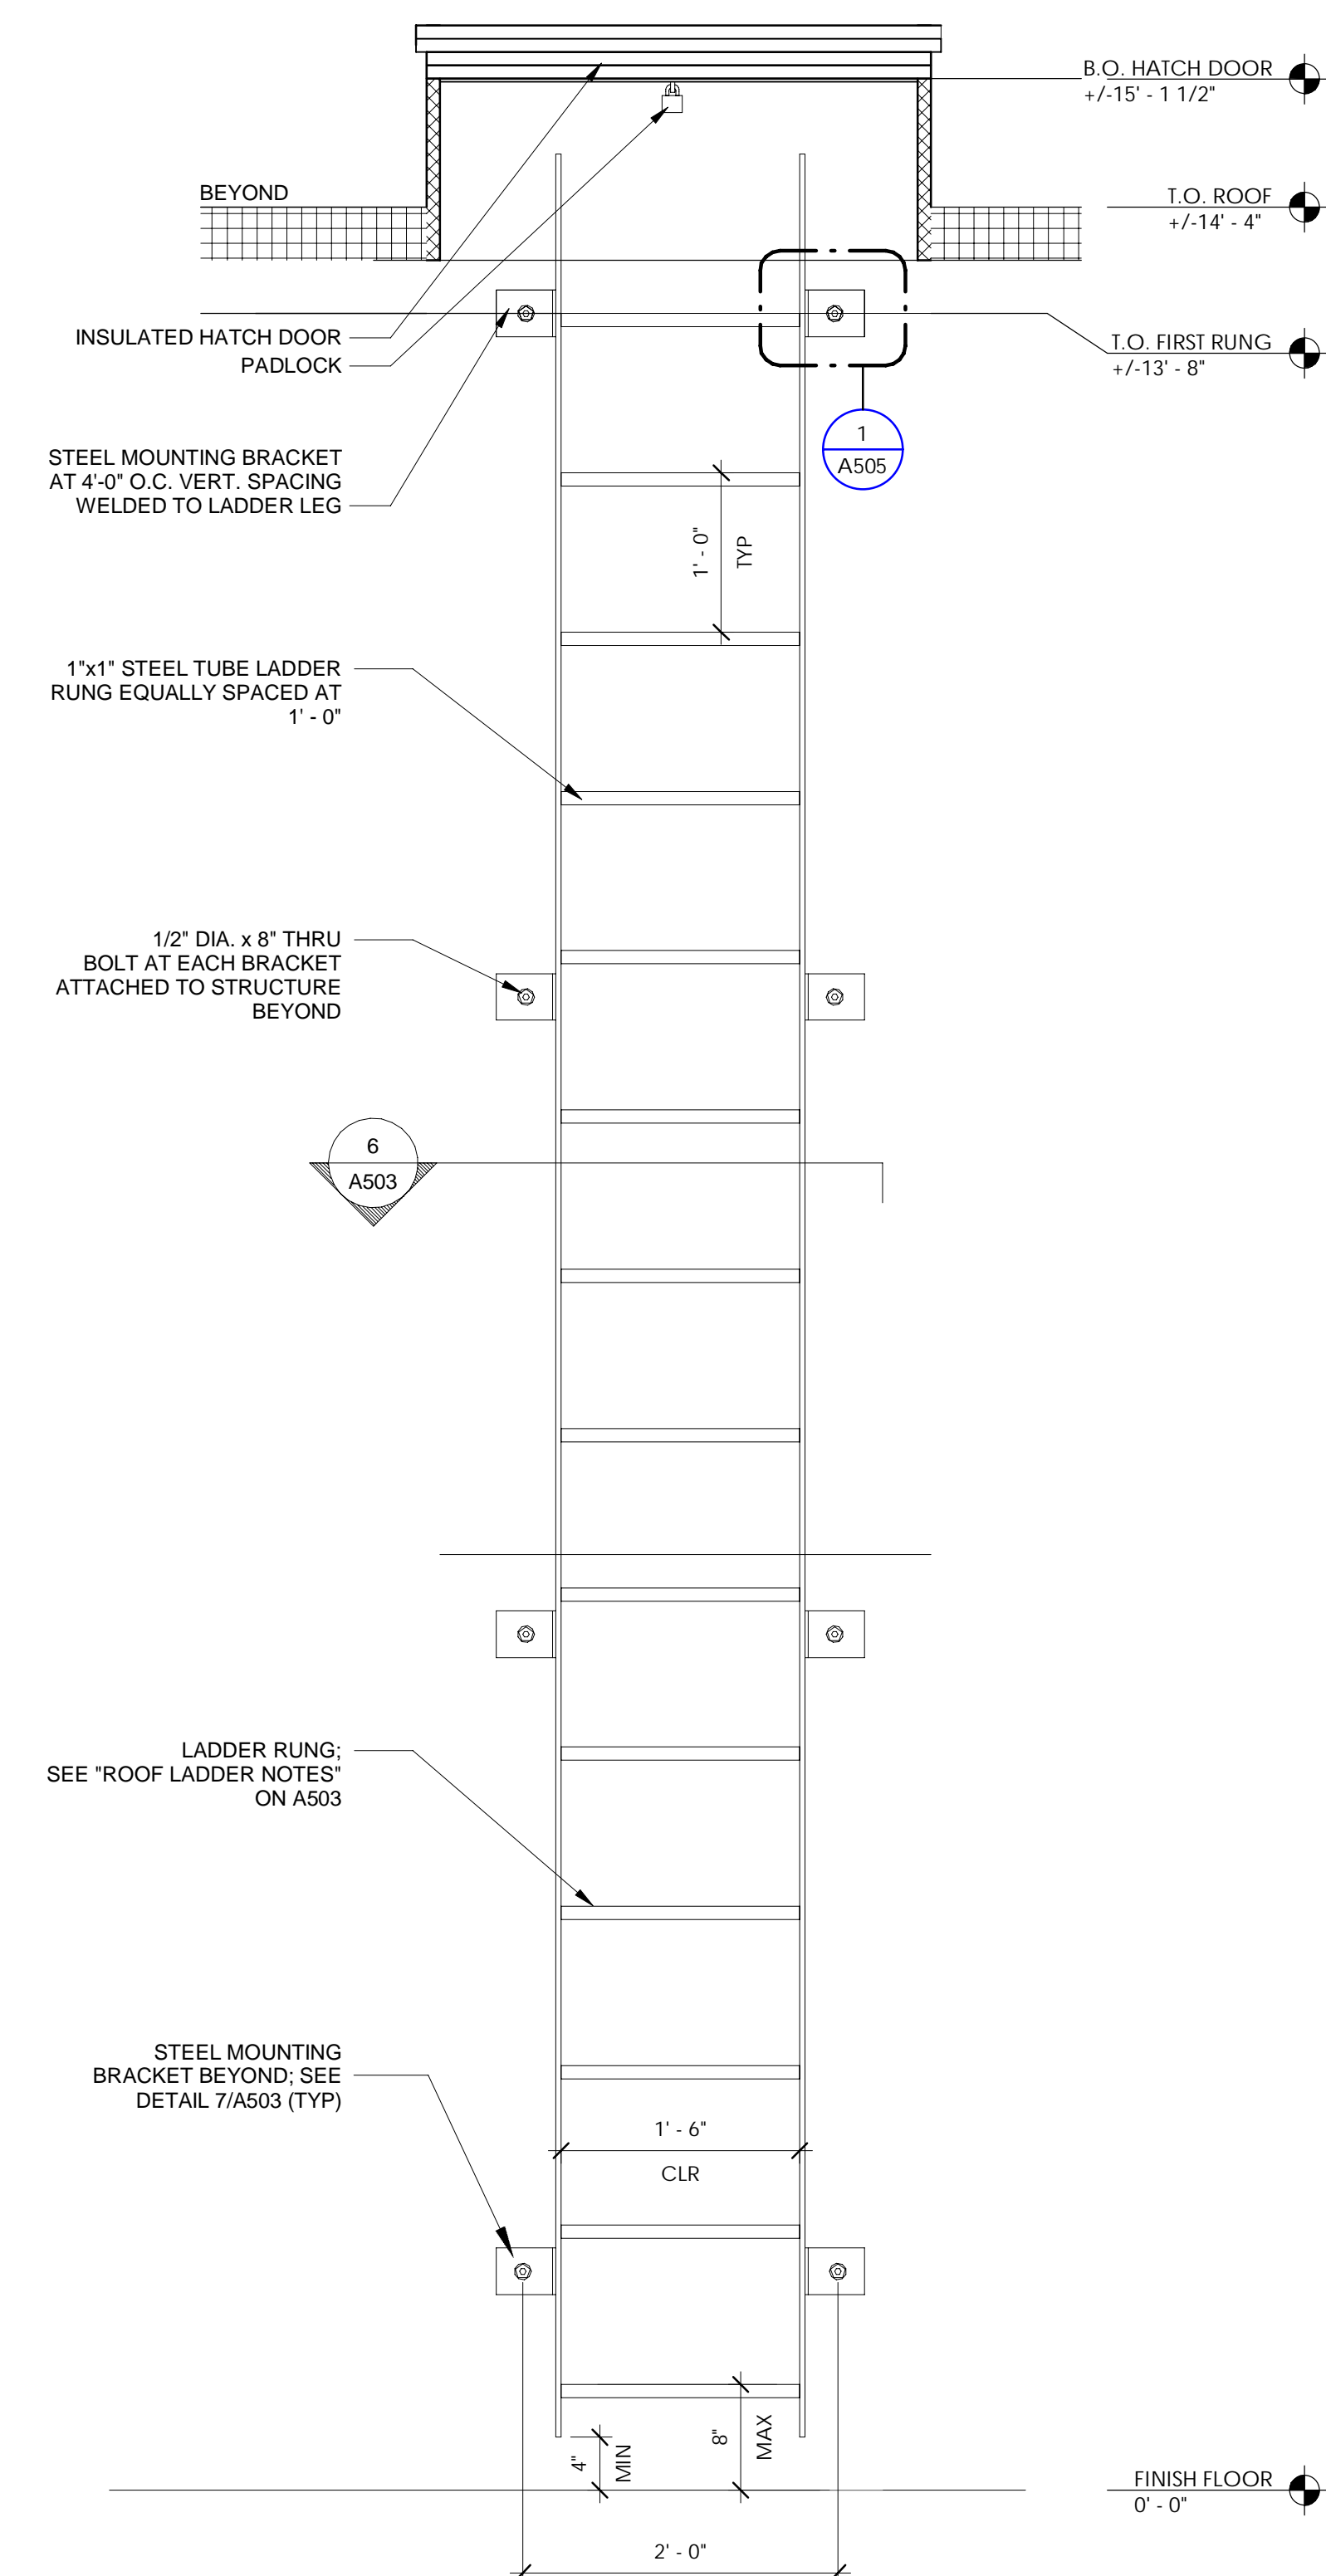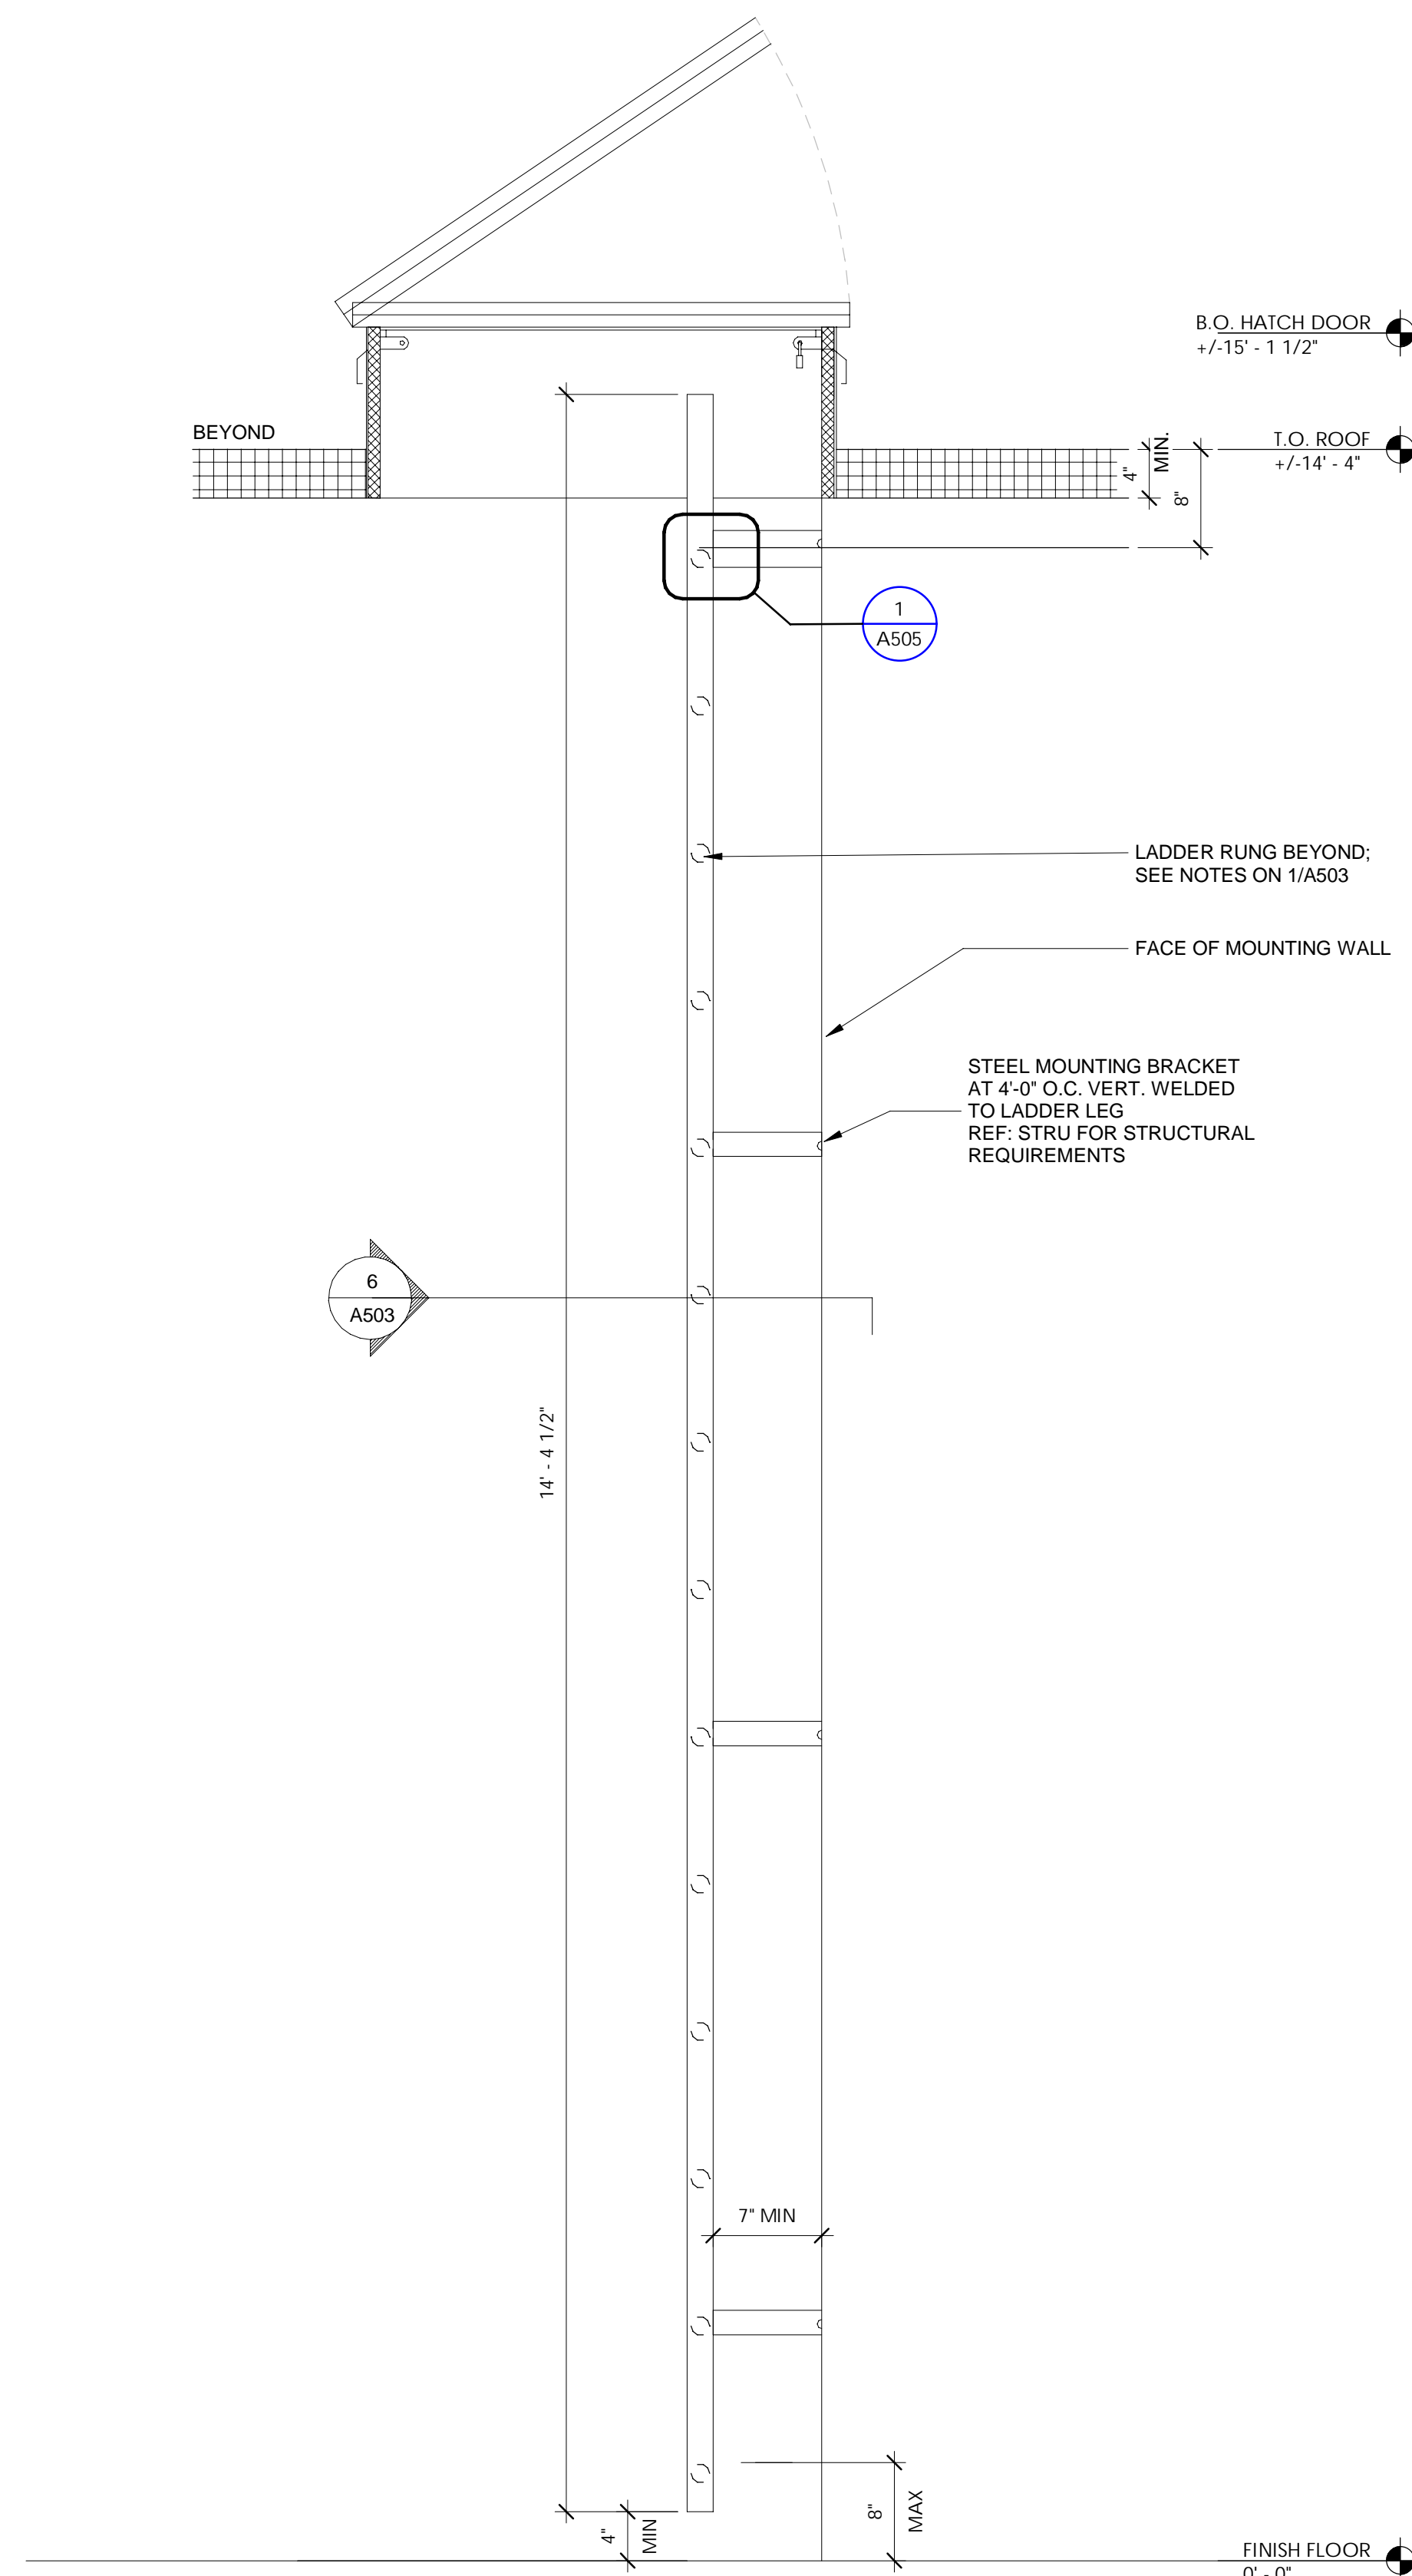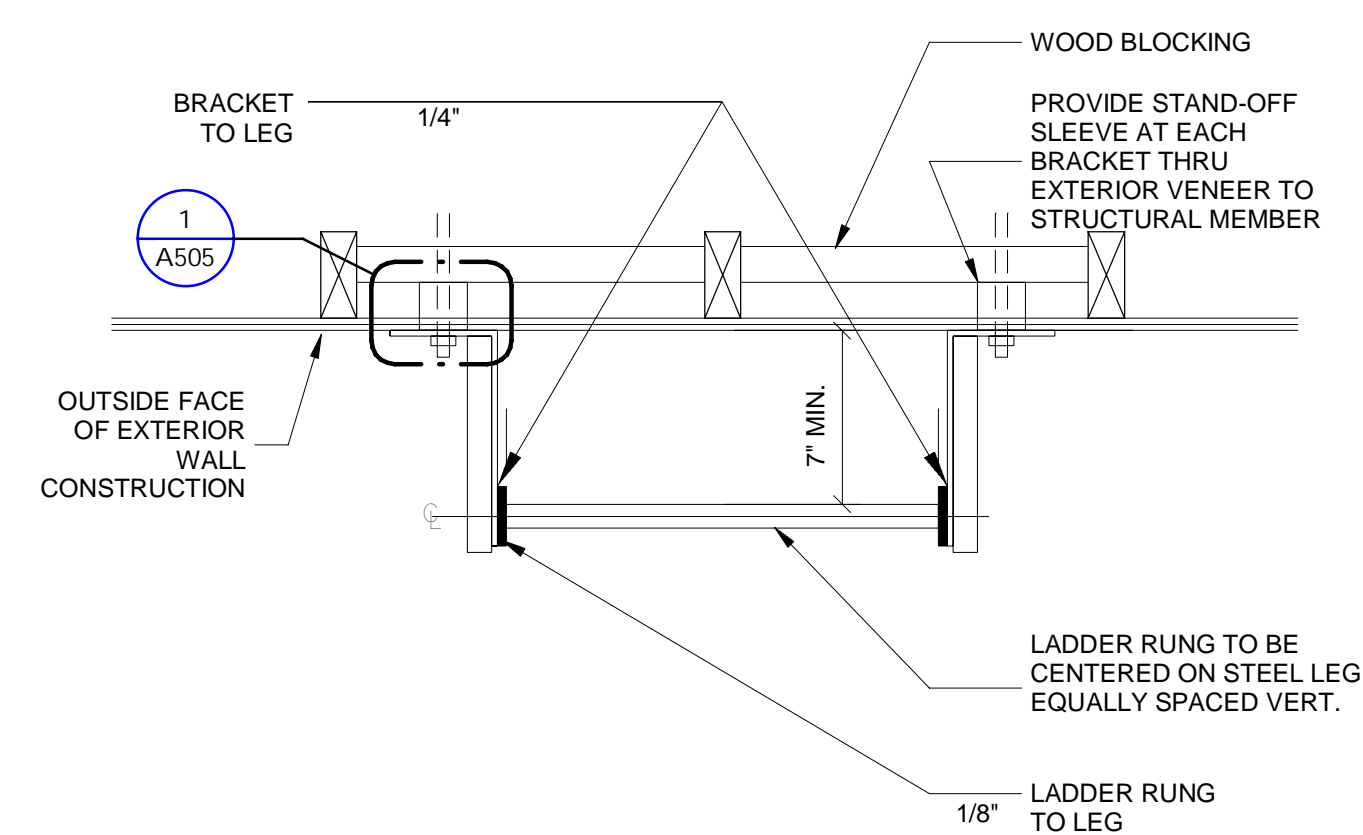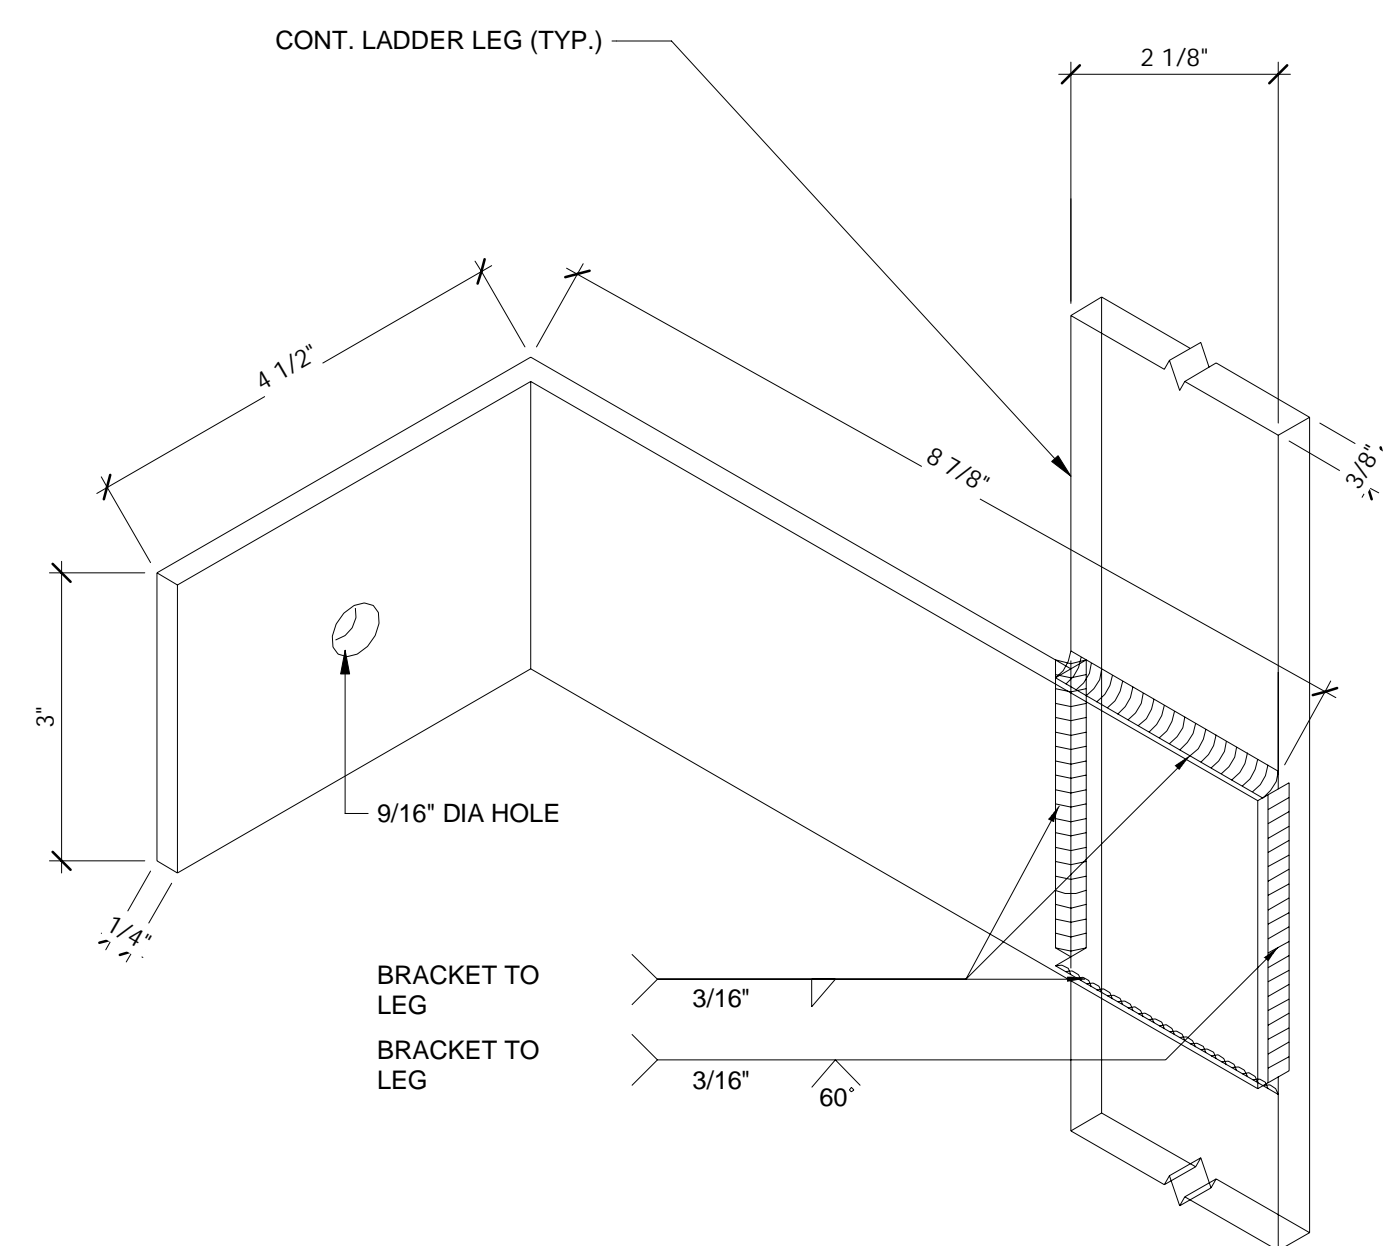

GENERAL NOTES

1. LADDER CONSTRUCTION IS TO MEET ALL REQUIREMENTS ACCORDING TO SECTION 1923.1053 OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION GUIDELINES
2. THE LADDER RUNGS SHALL BE CORRUGATED, KNURLED, DIMPLED, COATED WITH SKID-RESISTANT MATERIAL, OR OTHERWISE TREATED TO MINIMIZE SLIPPING.
3. ALL WELDS ARE TO BE 3/16" FILLET WELDS U.N.O.
4. ALL STEEL TO BE GALVANIZED
5. GC TO VERIFY EXISTING CONDITIONS & NOTIFY ARCHITECT IF THERE ARE ANY CONFLICTS WITH THE DRAWINGS
6. GC TO PROVIDE "SELF RETRACTING LIFELINE" FOR ALL LADDER HEIGHTS THAT EXCEED 24FT.



#2001
610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3
PROTOTYPE VERSION 2.00



513 MAIN STREET #300
FORT WORTH TX 76102



PERMIT SET: 04/12/2024

CONTRACTOR SHALL VERIFY ALL
CONDITIONS AND DIMENSIONS AT THE
JOB SITE AND NOTIFY THE ARCHITECT
OF ANY DIMENSIONAL ERRORS,
OMISSIONS OR DISCREPANCIES BEFORE
BEGINNING OR FABRICATING ANY WORK.
DO NOT SCALE DRAWINGS.

[illegible][illegible]


PROJECT NO:	24-0087
ORIGINAL ISSUE:	06/01/2023
SCALE:	AS NOTED
DRAWN BY:	P. C
CHECKED BY:	J. JEFFERY

SHEET TITLE


ROOF LADDER DETAILS

SHEET NUMBER


A505

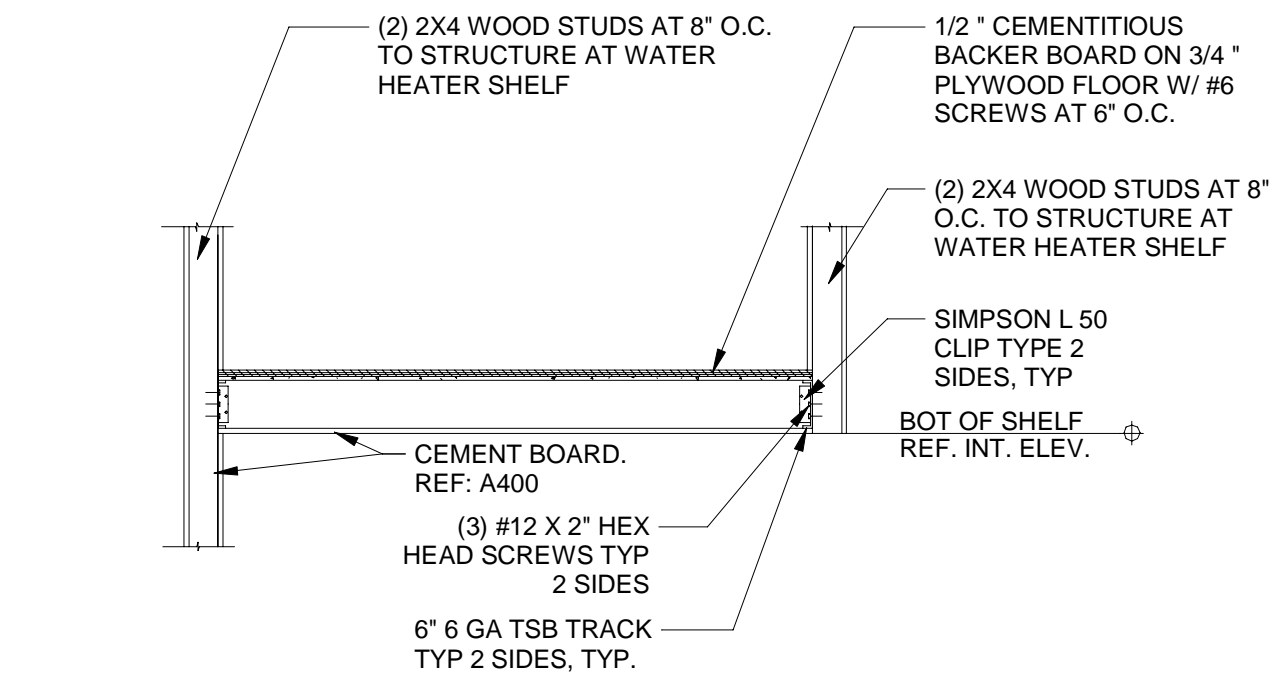


1 WATER HEATER SHELF
1/2" = 1'-0"

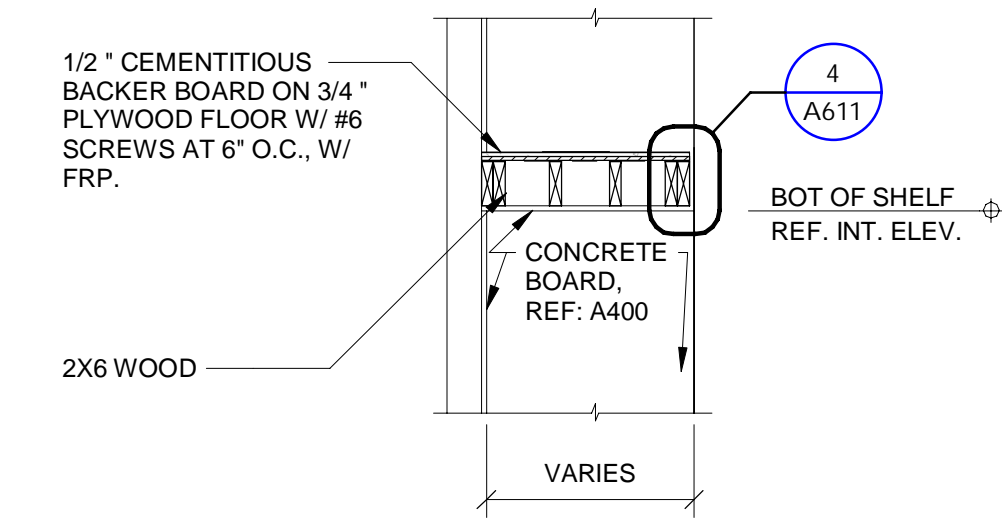




2 WATER HEATER SHELF
1/2" = 1'-0"

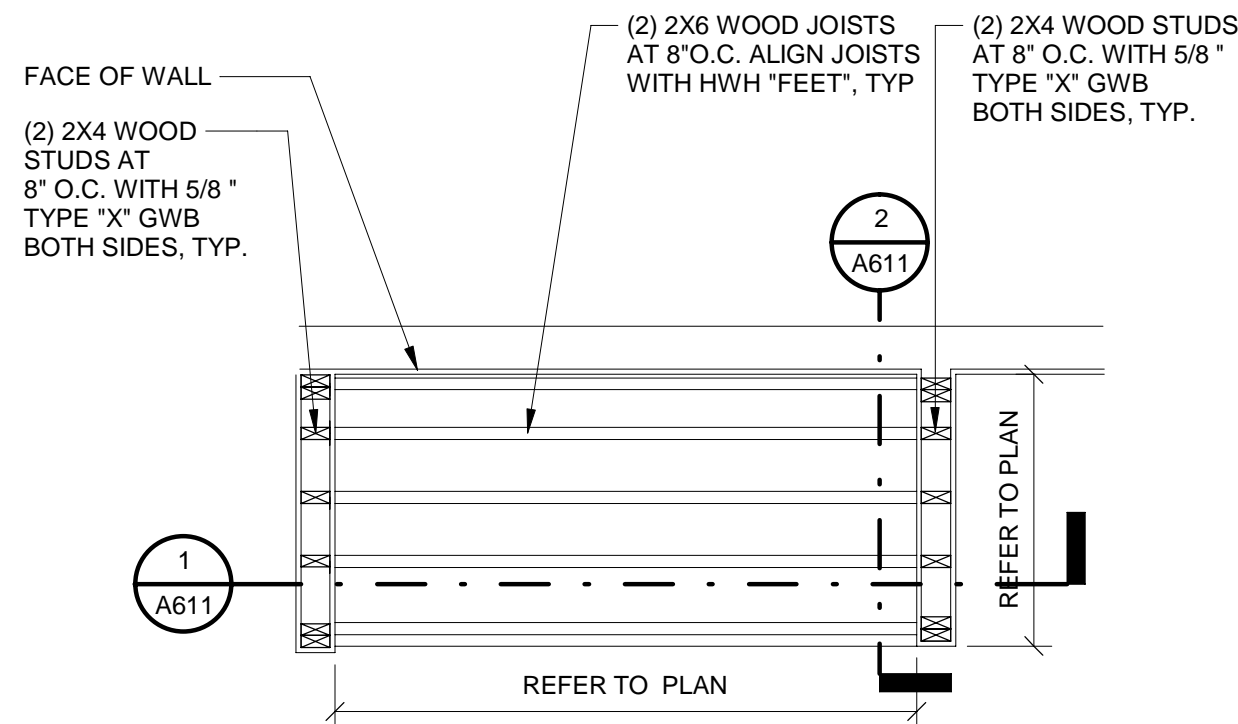


3 WATER HEATER SHELF
1/2" = 1'-0"

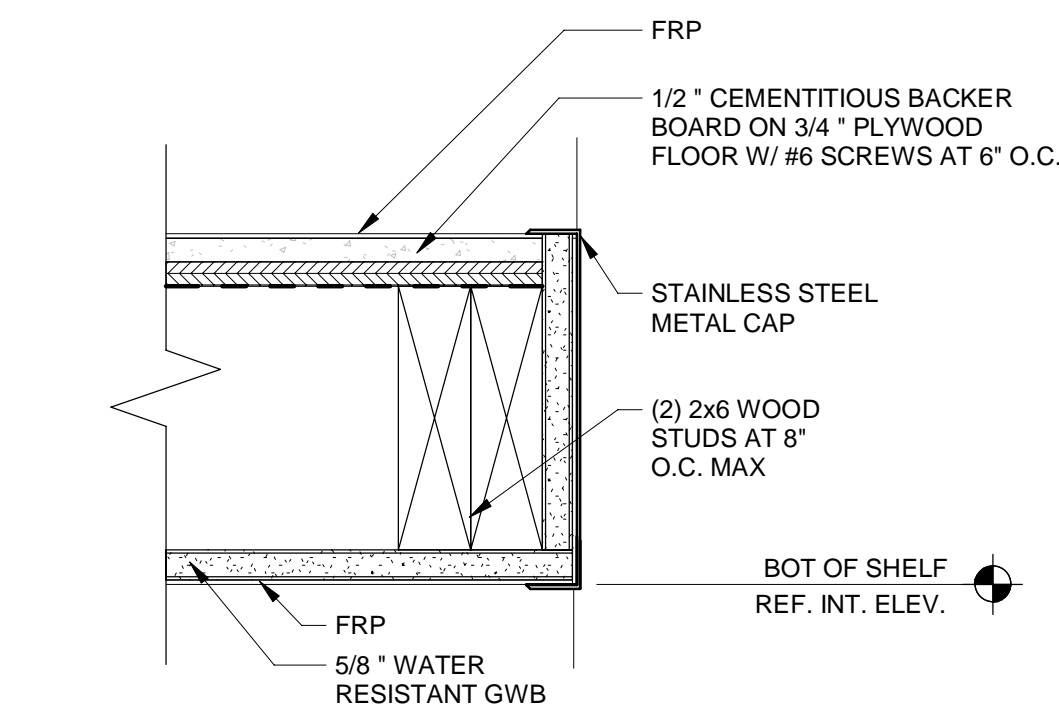


4 SHELF EDGE DETAIL
3" = 1'-0"

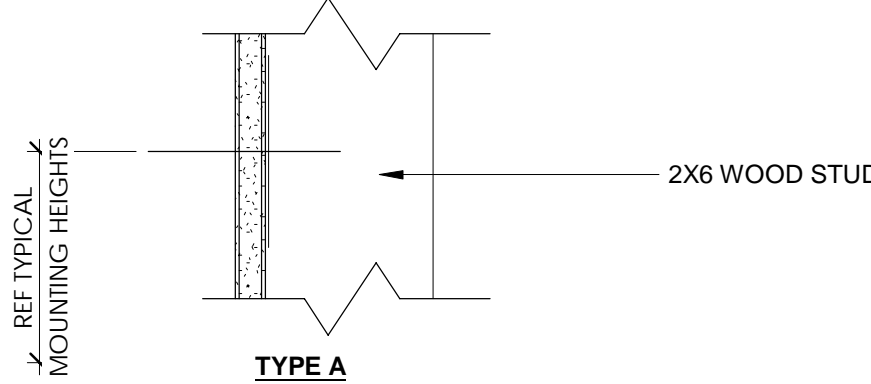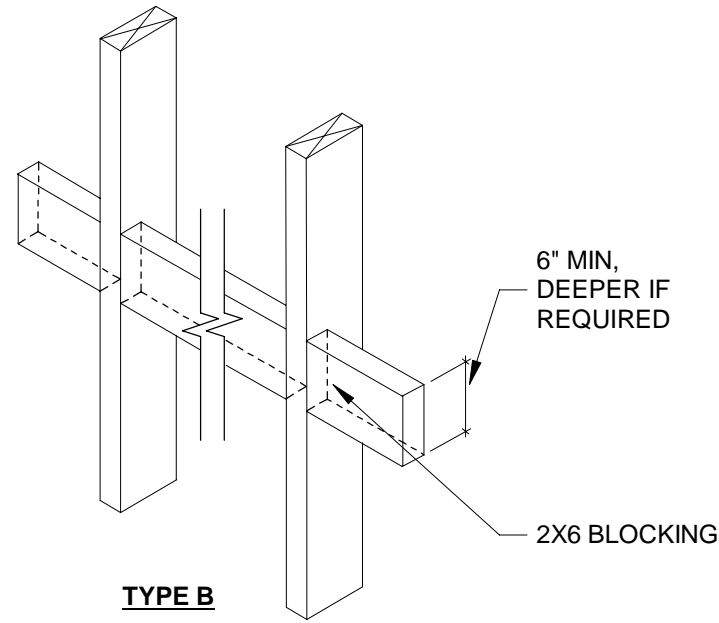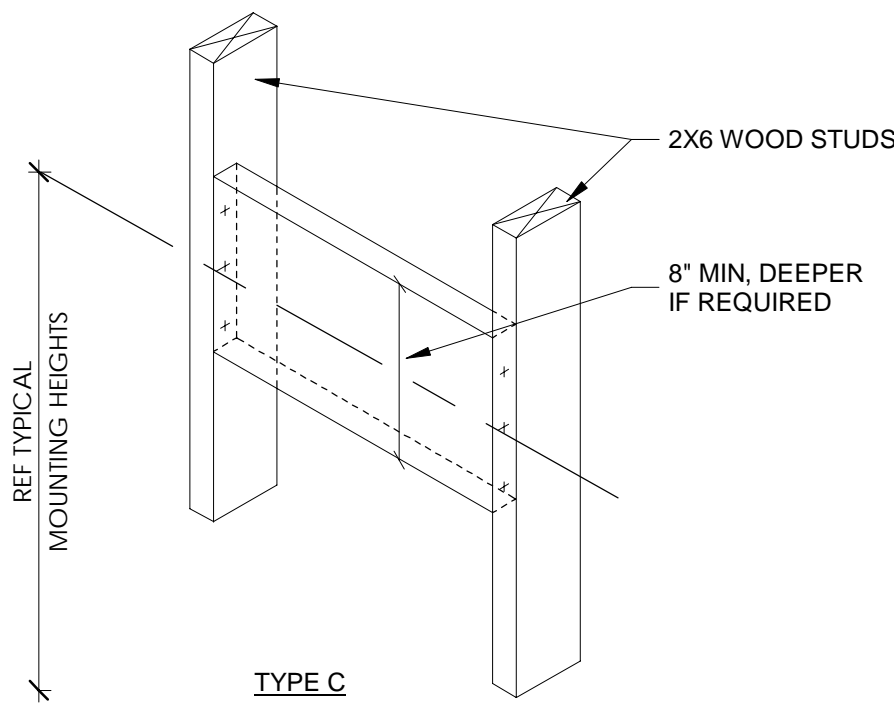

6 BLOCKING DETAILS FOR ACCESSORIES & EQUIPMENT
3" = 1'-0"

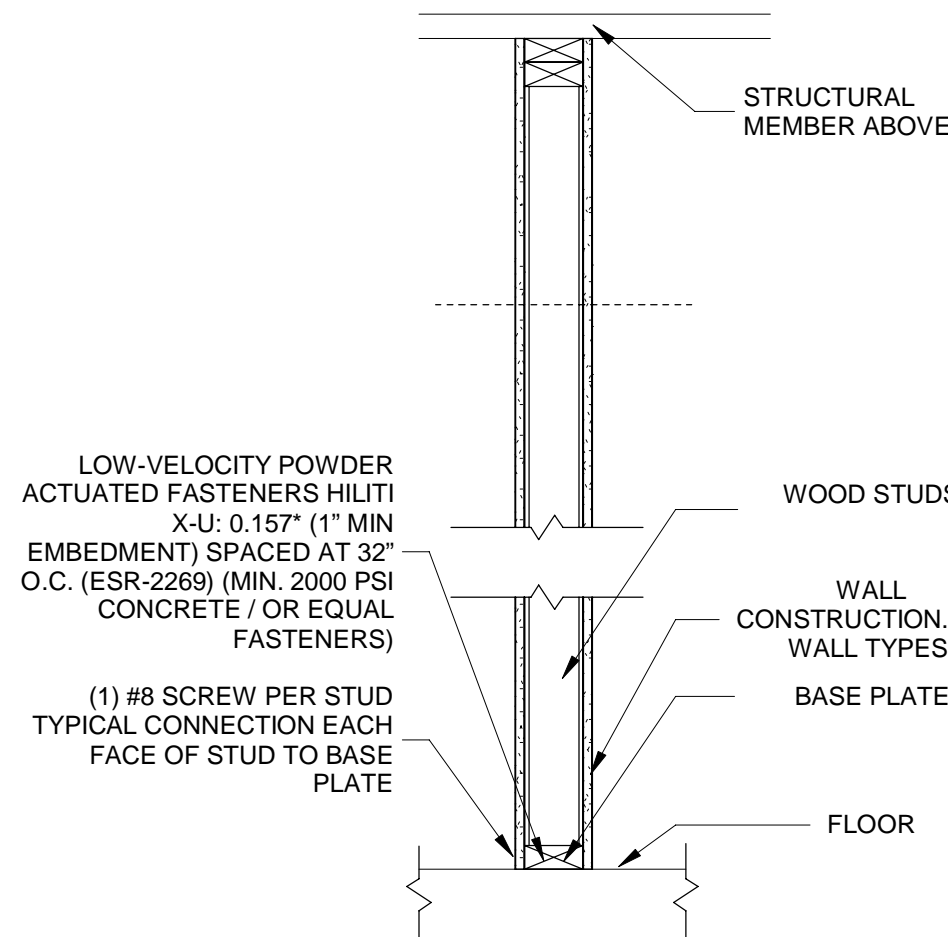


8 NON-BEARING STUD WALL PARTITION
3" = 1'-0"

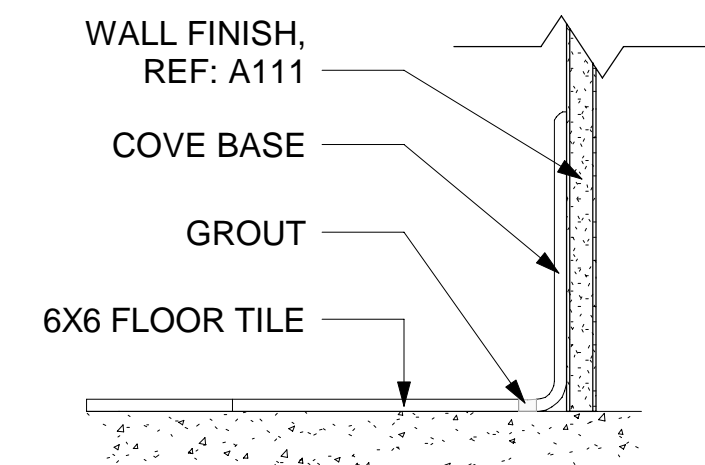


10 FLOOR TILE INSTALLATION DETAIL
3" = 1'-0"

DETAIL GENERAL NOTES


1. STUDS BRACED BY GYPSUM WALLBOARD EACH SIDE. MAXIMUM SCREW SPACING SHALL NOT EXCEED 12" O.C.
2. 5LBS / SQ. FT. MAX LATERAL LOAD
3. FY (MIN) = 33KSL
4. DEFLECTION LIMIT 1/120
5. FOR H > 16'-0" AND BRACING > 8'-0" SEPARATE ENGINEERED DRAWINGS WILL BE REQUIRED
6. NOT APPLICABLE TO SHEAR WALLS

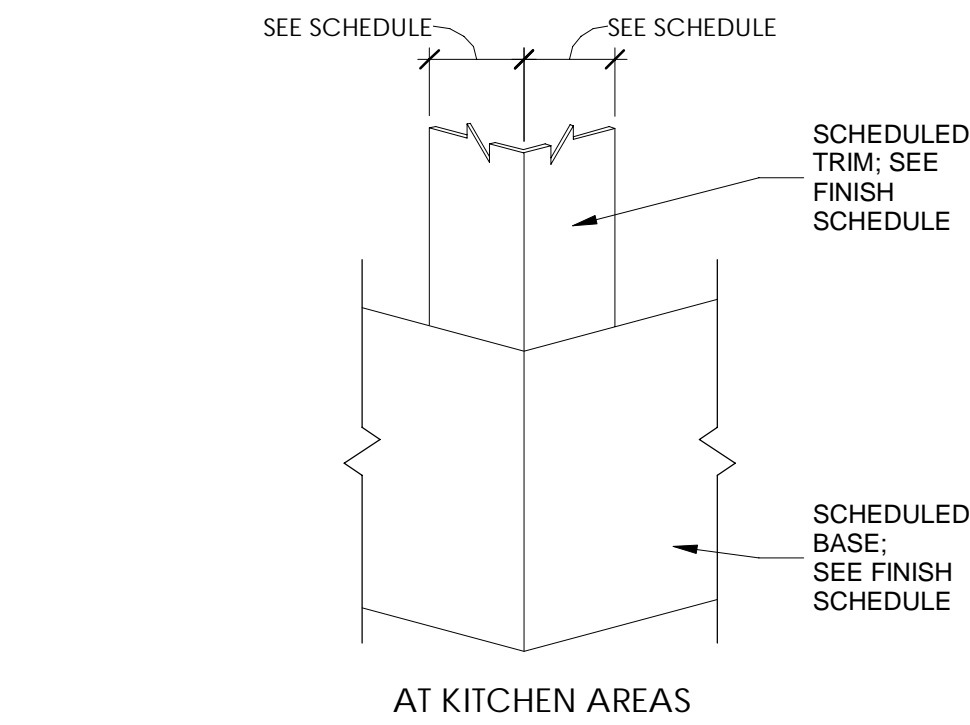

5 CORNER GUARD DETAIL
3" = 1'-0"

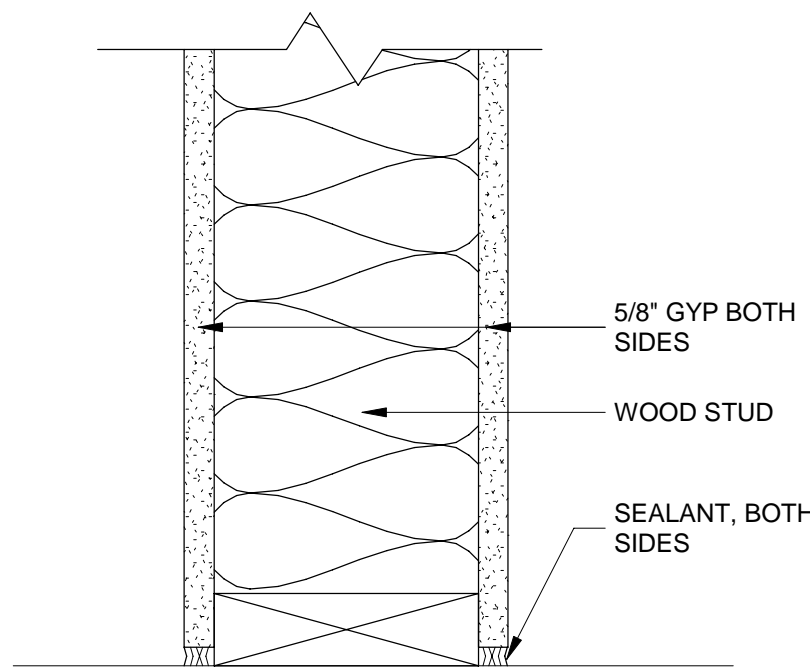

7 PARTITION TYPE A
3" = 1'-0"

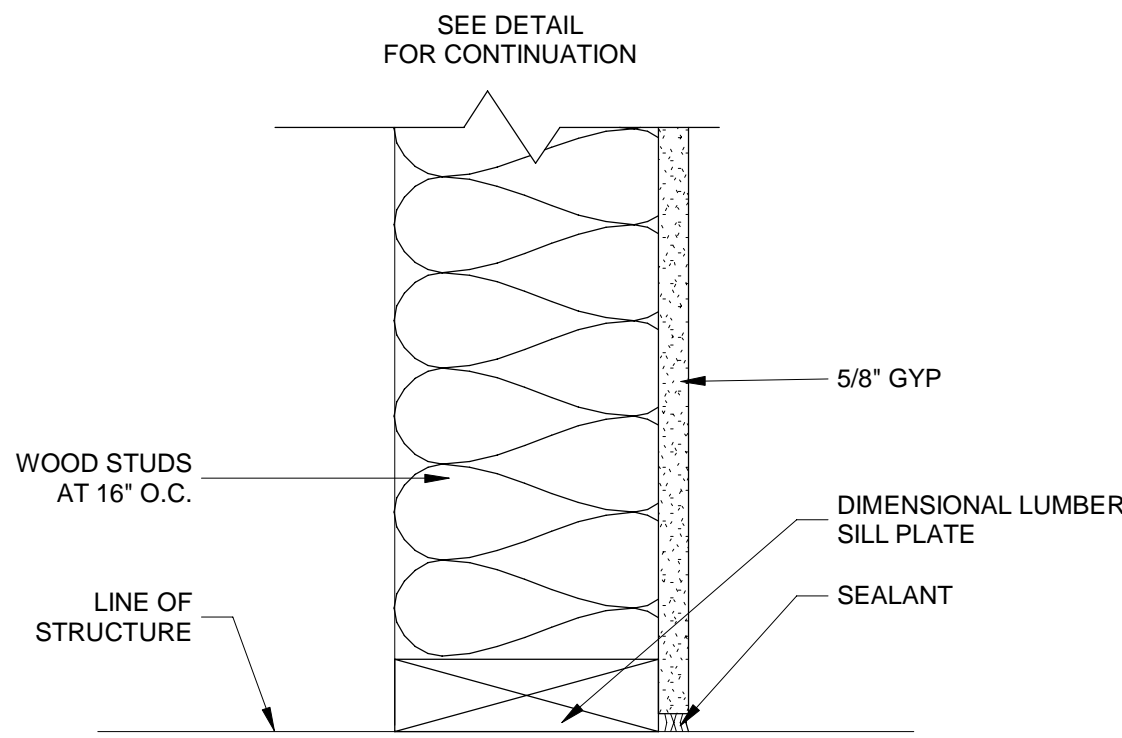


9 PARTITION TYPE F
3" = 1'-0"

PARTITION GENERAL NOTES

1. PARTITIONS ARE DISTINGUISHED ON FLOOR PLANS BY SYMBOL DESIGNATION, GRAPHIC DESIGNATION OR A COMBINATION OF BOTH DESIGNATIONS. SOME PARTITION TYPES SHOWN ON THIS SHEET MAY NOT BE USED ON THIS PROJECT.
2. ALL WALLS NOT DESIGNATED WITH A GRAPHIC OR TAG TO BE TYPE 'A'. IF UNCLEAR CONTACT ARCHITECT.
3. SOUND TRANSMISSION CLASS (STC) IS A RATING SYSTEM THAT DESCRIBES THE ABILITY OF AN ASSEMBLY TO REDUCE THE TRANSMISSION OF SOUND. STC RATINGS LISTED ARE BASED ON LABORATORY TESTING AND ARE NOT INDICATIVE OF RESULTS IN FIELD.
4. SEE SPECIFICATIONS FOR SOUND ATTENUATION BATTS (SAB) REQUIREMENTS. WHERE SAB ARE INDICATED, THEY SHALL EXTEND CONTINUOUSLY FROM FLOOR TO STRUCTURE ABOVE.
5. PARTITIONS ARE INDICATED WITH CONVENTIONAL GYPSUM WALLBOARD U.N.O.: UPGRADE TO PREMIUM TYPES OF WALLBOARD (I.E., MOISTURE-RESISTANT, TILE-BACKER BOARD, ACOUSTICALLY ENHANCED, ETC.) BASED ON THEIR LOCATION AND ACCORDING TO REQUIREMENTS LISTED IN THE SPECIFICATIONS.
6. SEALANTS INDICATED MAY BE FOR FIRE RATING, SMOKE RATING, AIR PRESSURE CONTAINMENT, ACOUSTIC RATING, VERMIN CONTROL, MOVEMENT (CRACK) CONTROL AND/OR BIOLOGICAL CONTAINMENT. SEALANT JOINTS ARE TO BE SIZED FOR EXPECTED MOVEMENT OF JOINT WITH EXPANSION/CONTRACTION CAPACITY OF SEALANT MATERIAL TO MAINTAIN THE INTEGRITY OF THE SEAL FOR THESE APPLICABLE PARAMETERS - SEE SPECIFICATIONS.
7. ALL DIMENSIONS ARE TO COLUMN CENTERLINES OR TO FACE OF FRAMING, U.N.O. CLEAR DIMENSIONS INDICATE DIMENSION BETWEEN FINISHES.
8. FIRE RESISTANT AND FIRE RESISTANT SMOKE BARRIER RATINGS ARE TO CONTINUE THROUGH ALL OPENINGS IN RATED PARTITIONS.
9. SMOKE RESISTANT, FIRE RESISTANT, AND FIRE RESISTANT SMOKE BARRIER PARTITIONS SHALL EXTEND AND SEAL TO INSIDE FACE OF EXTERIOR SHEATHING, INCLUDING EXTENSIONS THROUGH SOFFITS.
10. REFER TO THE TOILET ACCESSORIES SHEET AND CASEWORK SHEET FOR MOUNTING DETAIL INFORMATION.
11. PARTITIONS REQUIRED TO BE SMOKE RESISTANT, FIRE RESISTANT, OR BOTH FIRE AND SMOKE RESISTANT ARE SHOWN GRAPHICALLY ON PLANS WITH HATCH PATTERNS.
12. ALL PARTITIONS EXTEND TO DECK UNLESS NOTED OTHERWISE.

INTERIOR WALL TAG LEGEND

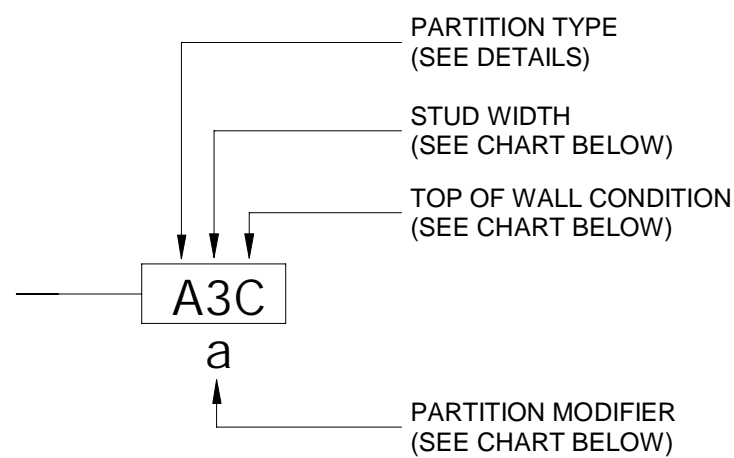

STUD WIDTH

#	WOOD STUD WIDTH	WOOD STUD WIDTH
1	1 5/8"	
2	2 1/2"	3 1/2"
3	3 5/8"	
6	6"	5 1/2"
8	8"	7 1/4"
10	10"	
12	12"	

TOP OF WALL CONDITION

ALL WALL ASSEMBLIES EXTEND TO DECK UNLESS NOTED OTHERWISE

- B** PARTITION EXTENDS TO BOTTOM OF CEILING
C PARTITION EXTENDS TO A MINIMUM OF 6" ABOVE CEILING
P PARTIAL HEIGHT WALL

PARTITION MODIFIER

- a** PROVIDE SOUND ATTENUATION BATTS TO FILL STUD CAVITY TO TOP OF ADJACENT CEILING
c PROVIDE 5/8" CEMENT BOARD ON WET SIDE AND 5/8" GWB ON OTHER SIDE.
t PROVIDE R-19 THERMAL BATTS TO FILL STUD CAVITY



#2001
610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3
PROTOTYPE VERSION 2.00



513 MAIN STREET FORT WORTH TX 76102

SEAL



PERMIT SET: 04/12/2024

CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DIMENSIONAL ERRORS. OMISSIONS OR DISCREPANCIES BEFORE BEGINNING OR FABRICATING ANY WORK. DO NOT SCALE DRAWINGS.

ISSUE DATE DESCRIPTION

PROJECT INFORMATION

PROJECT NO: 24-0087
ORIGINAL ISSUE: 06/01/2023
SCALE: AS NOTED
DRAWN BY: P. C
CHECKED BY: J. JEFFERY

SHEET TITLE

INTERIOR PARTITION
TYPES AND DETAILS

SHEET NUMBER

A611



#2001
610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3
PROTOTYPE VERSION 2.00



513 MAIN STREET #300
FORT WORTH TX 76102

SEAL



PERMIT SET: 04/12/2024

CONTRACTOR SHALL VERIFY ALL
CONDITIONS AND DIMENSIONS AT THE
JOB SITE AND NOTIFY THE ARCHITECT
OF ANY DIMENSIONAL ERRORS,
OMISSIONS OR DISCREPANCIES BEFORE
BEGINNING OR FABRICATING ANY WORK.
DO NOT SCALE DRAWINGS.

[illegible]

PROJECT INFORMATION


PROJECT NO:	24-008
ORIGINAL ISSUE:	09/20/2024
SCALE:	AS NOTED
DRAWN BY:	Author
CHECKED BY:	Checker

SHEET TITLE


EXTERIOR PARTITION TYPES

SHEET NUMBER


A621

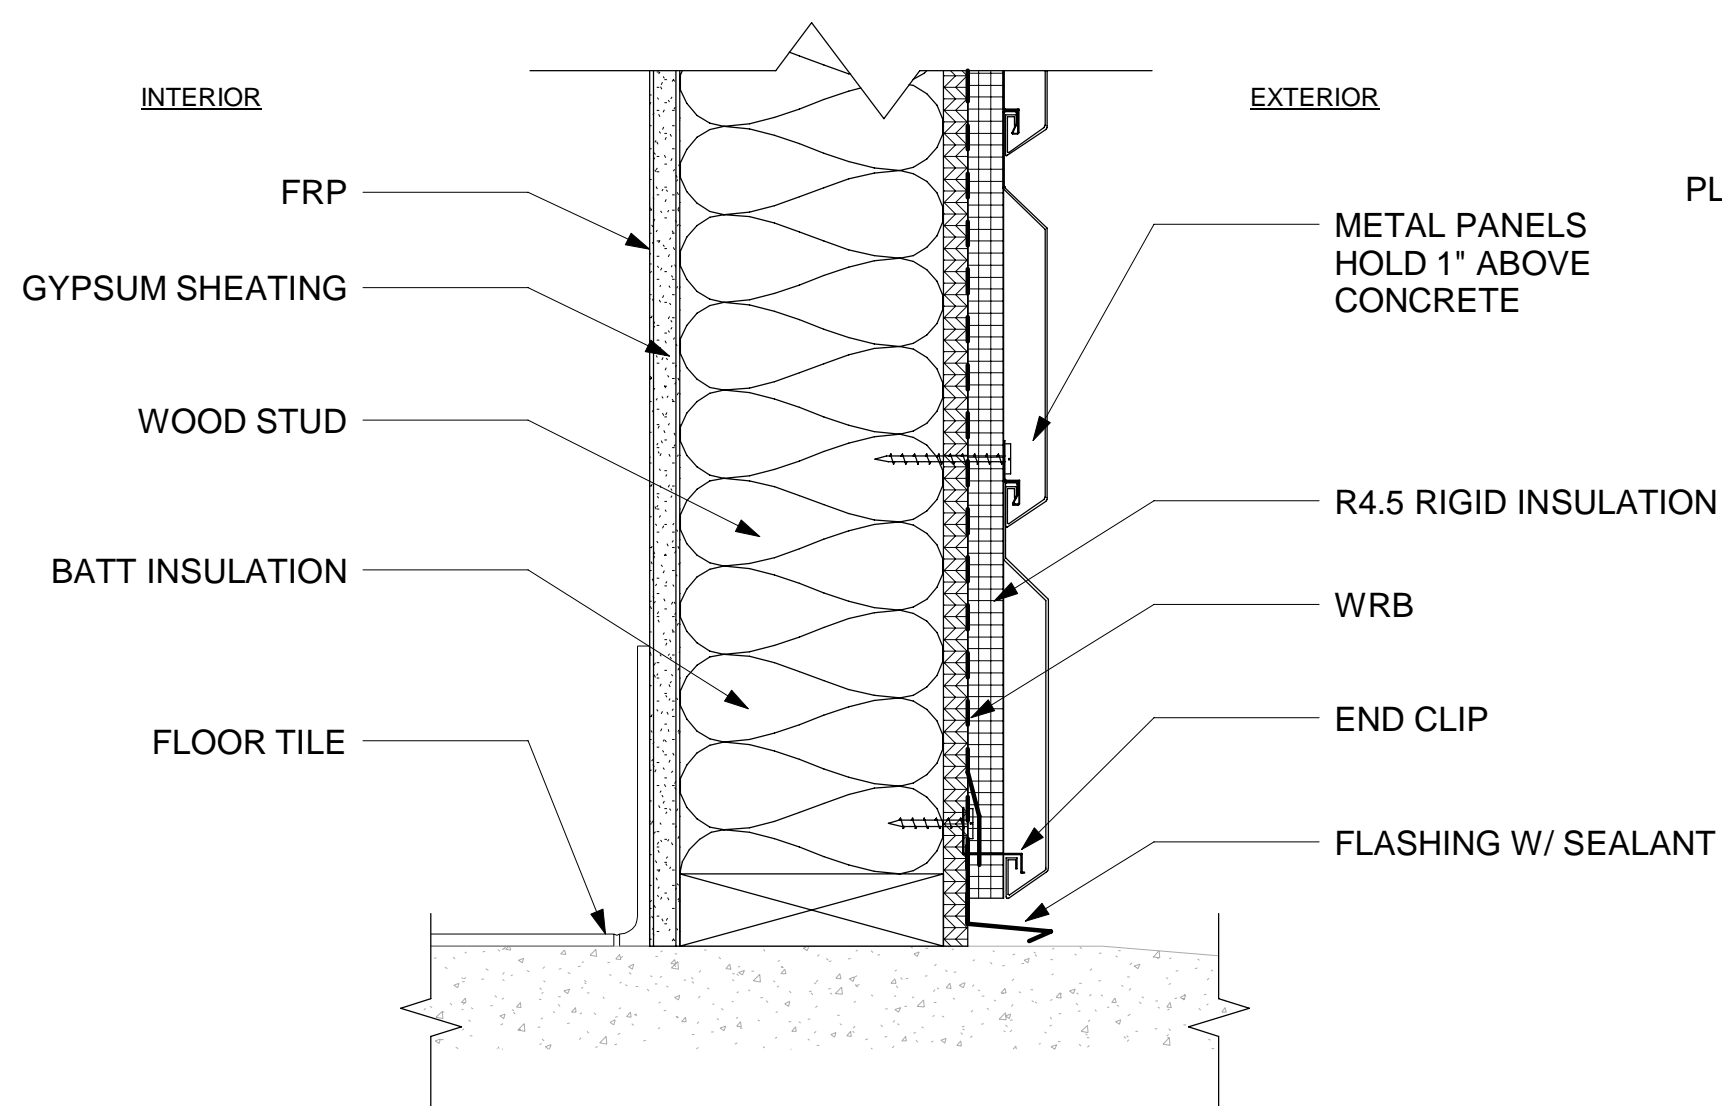


1 | EXTERIOR FINISH 1 - METAL PANELS ON SHEATHING - EX1
3" = 1'-0"

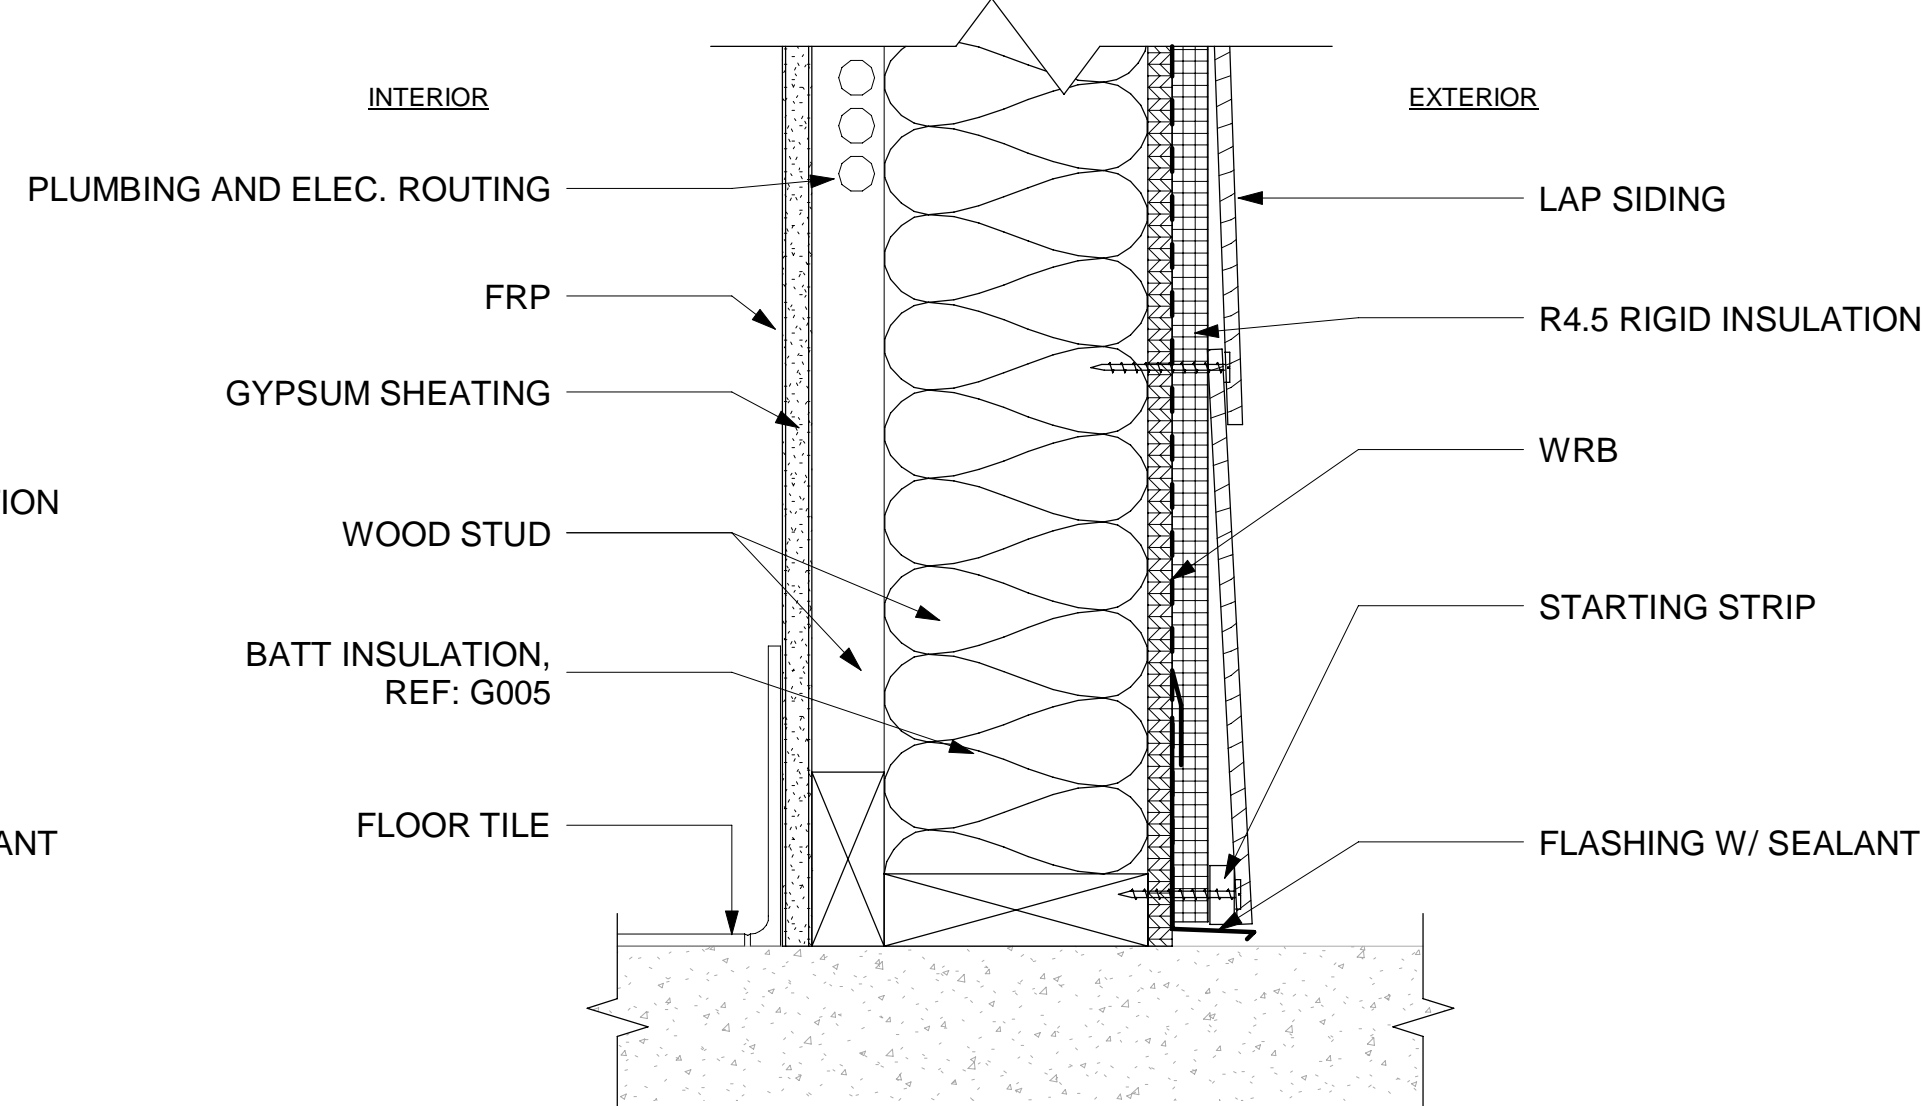


2 | EXTERIOR FINISH 2 - ARCH. PANEL ON SHEATHING - EX2
3' = 1'-0"

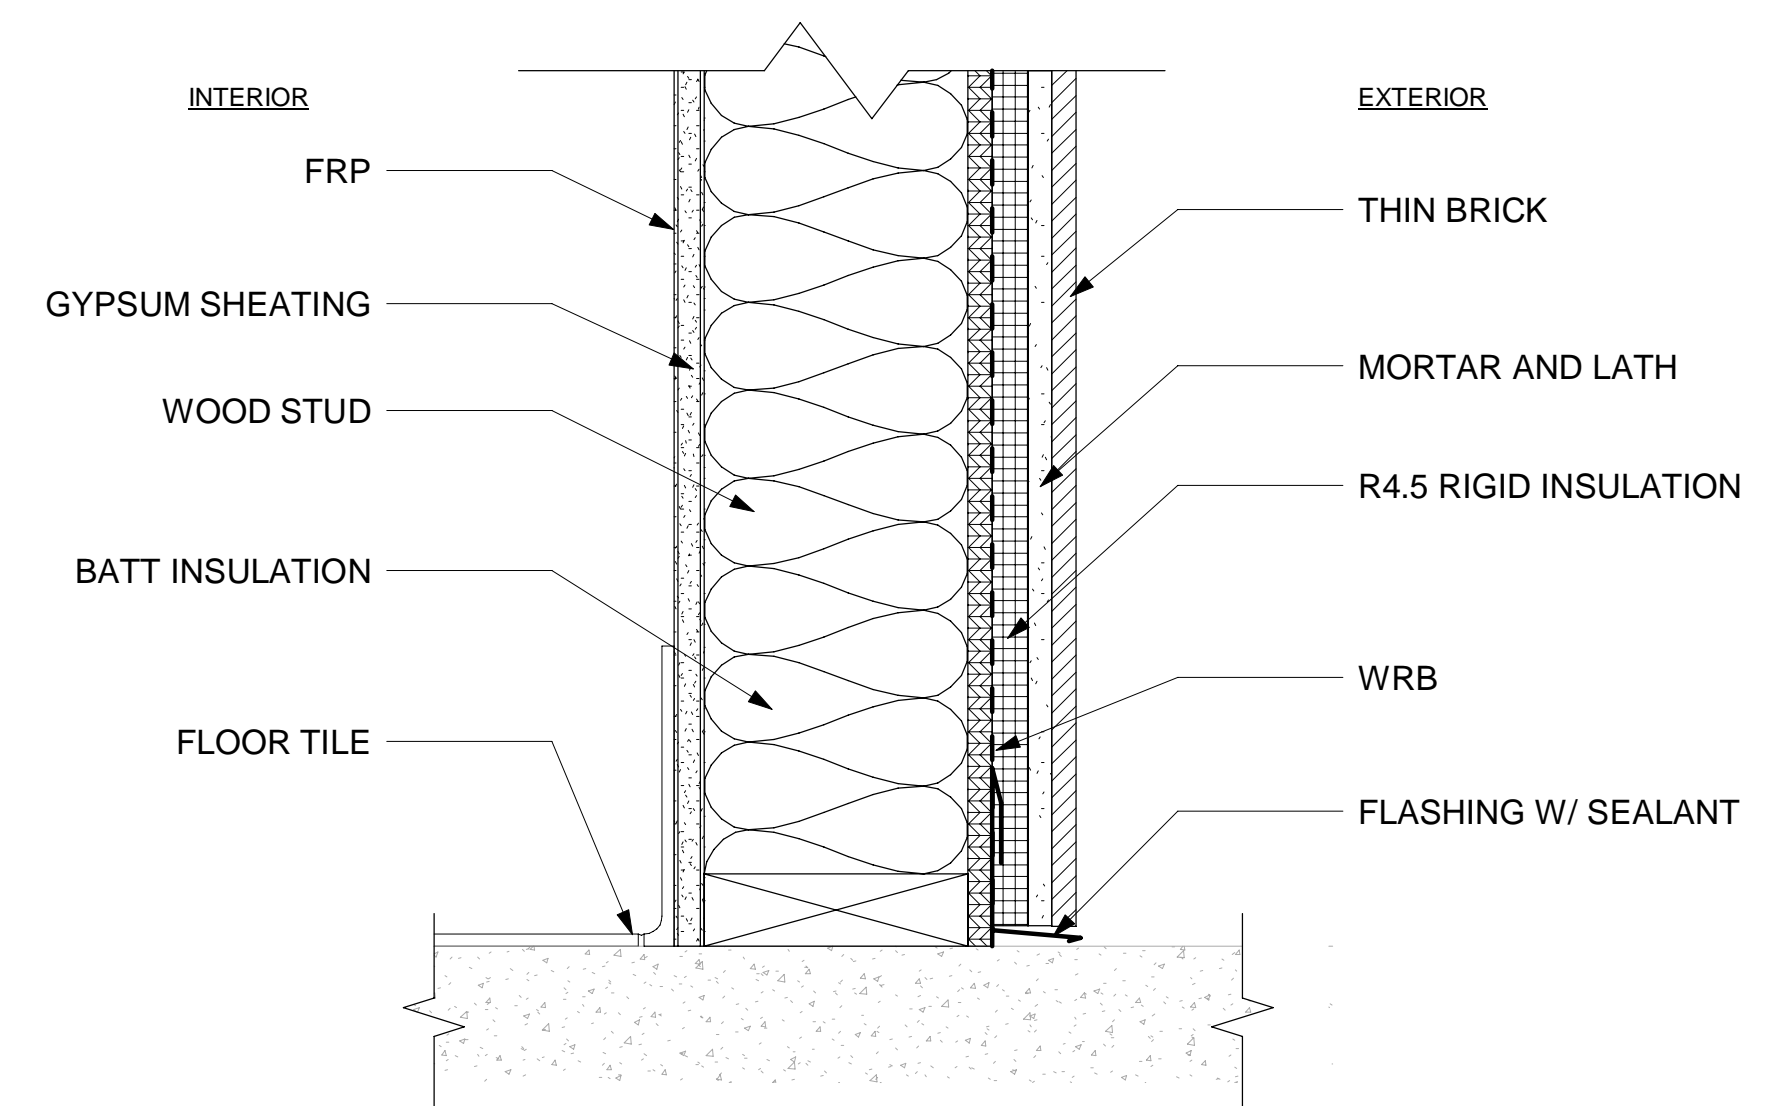


3 | EXTERIOR FINISH 3 - BRICK ON SHEATHING - EX3
3' = 1'-0"

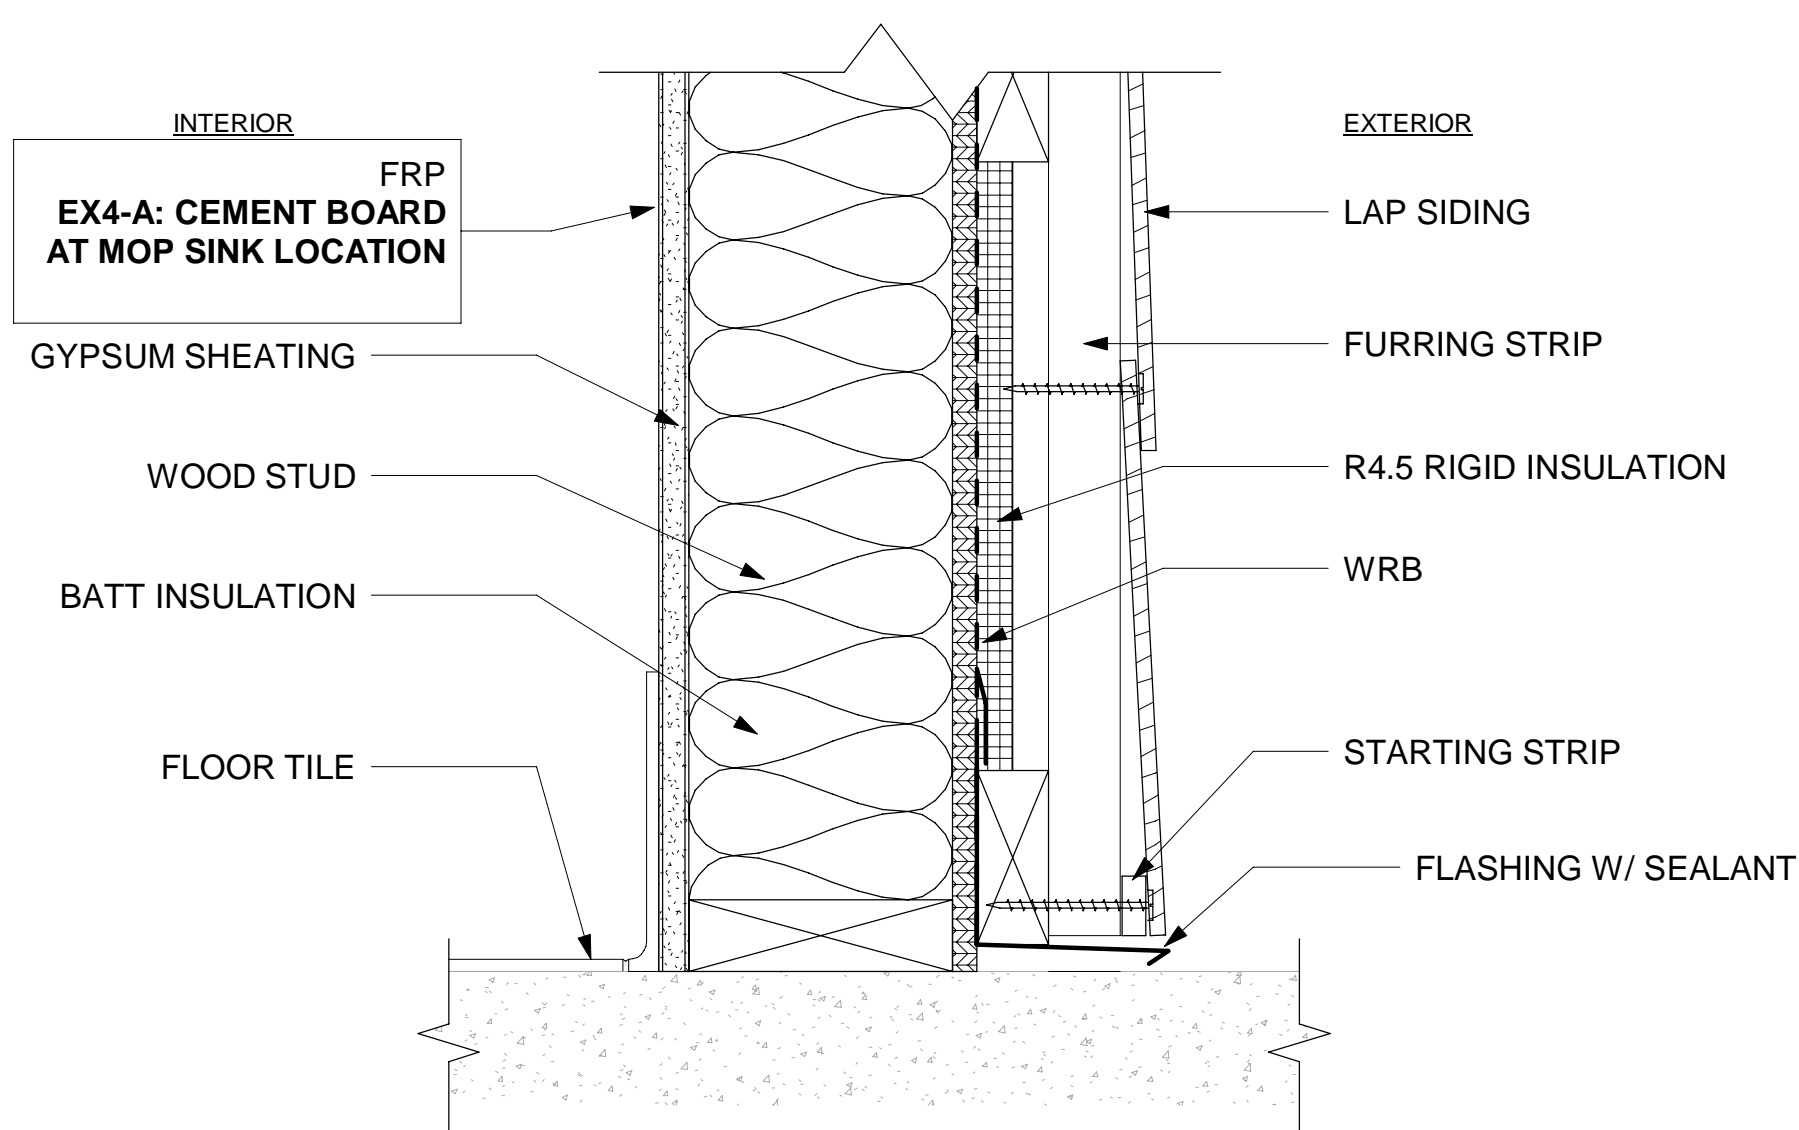


4 | EXTERIOR FINISH 4 - ARCH.PANEL BUMP OUT - EX4
3" = 1'-0"

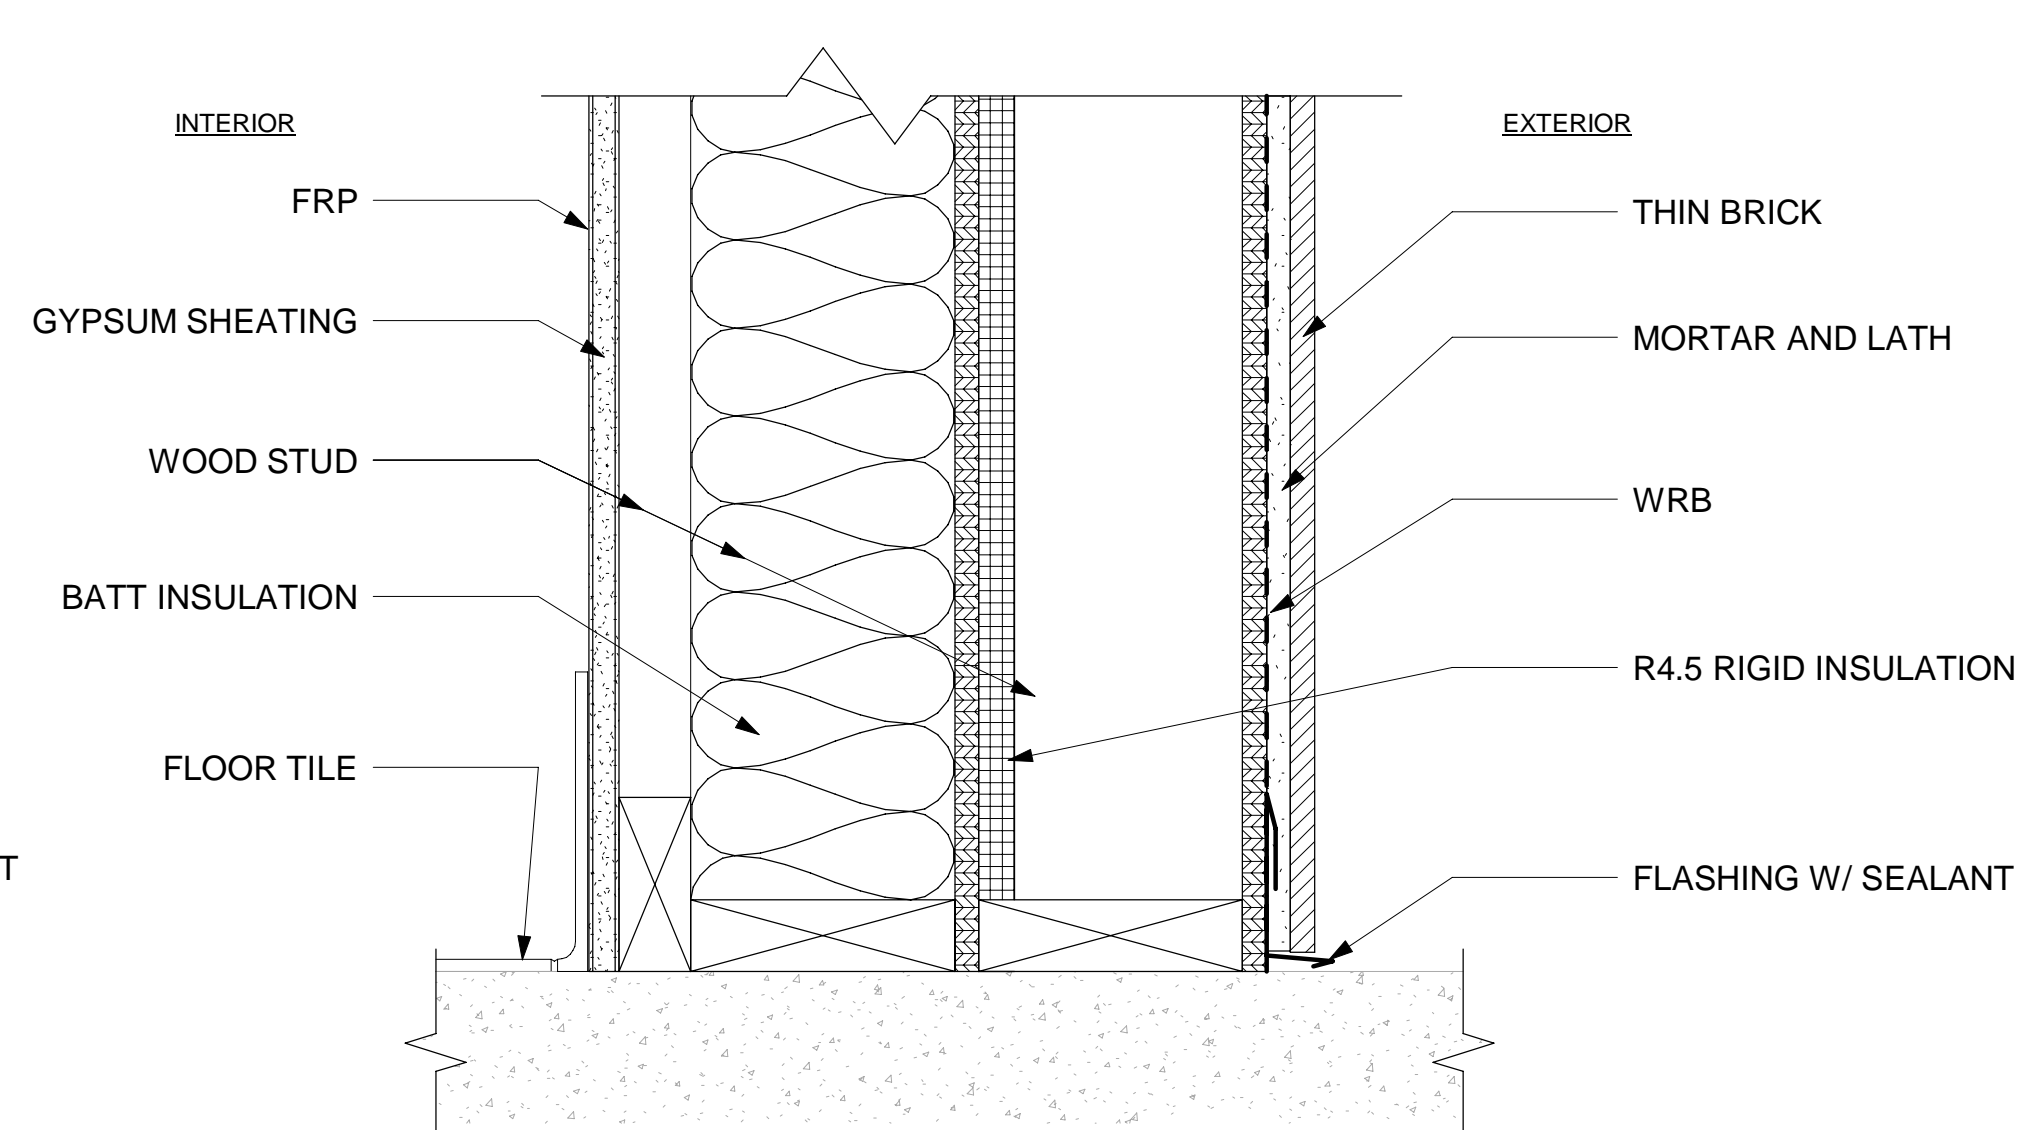






5 | EXTERIOR FINISH 5 - BRICK ON DOUBLE STUD - EX5
3" = 1'-0"

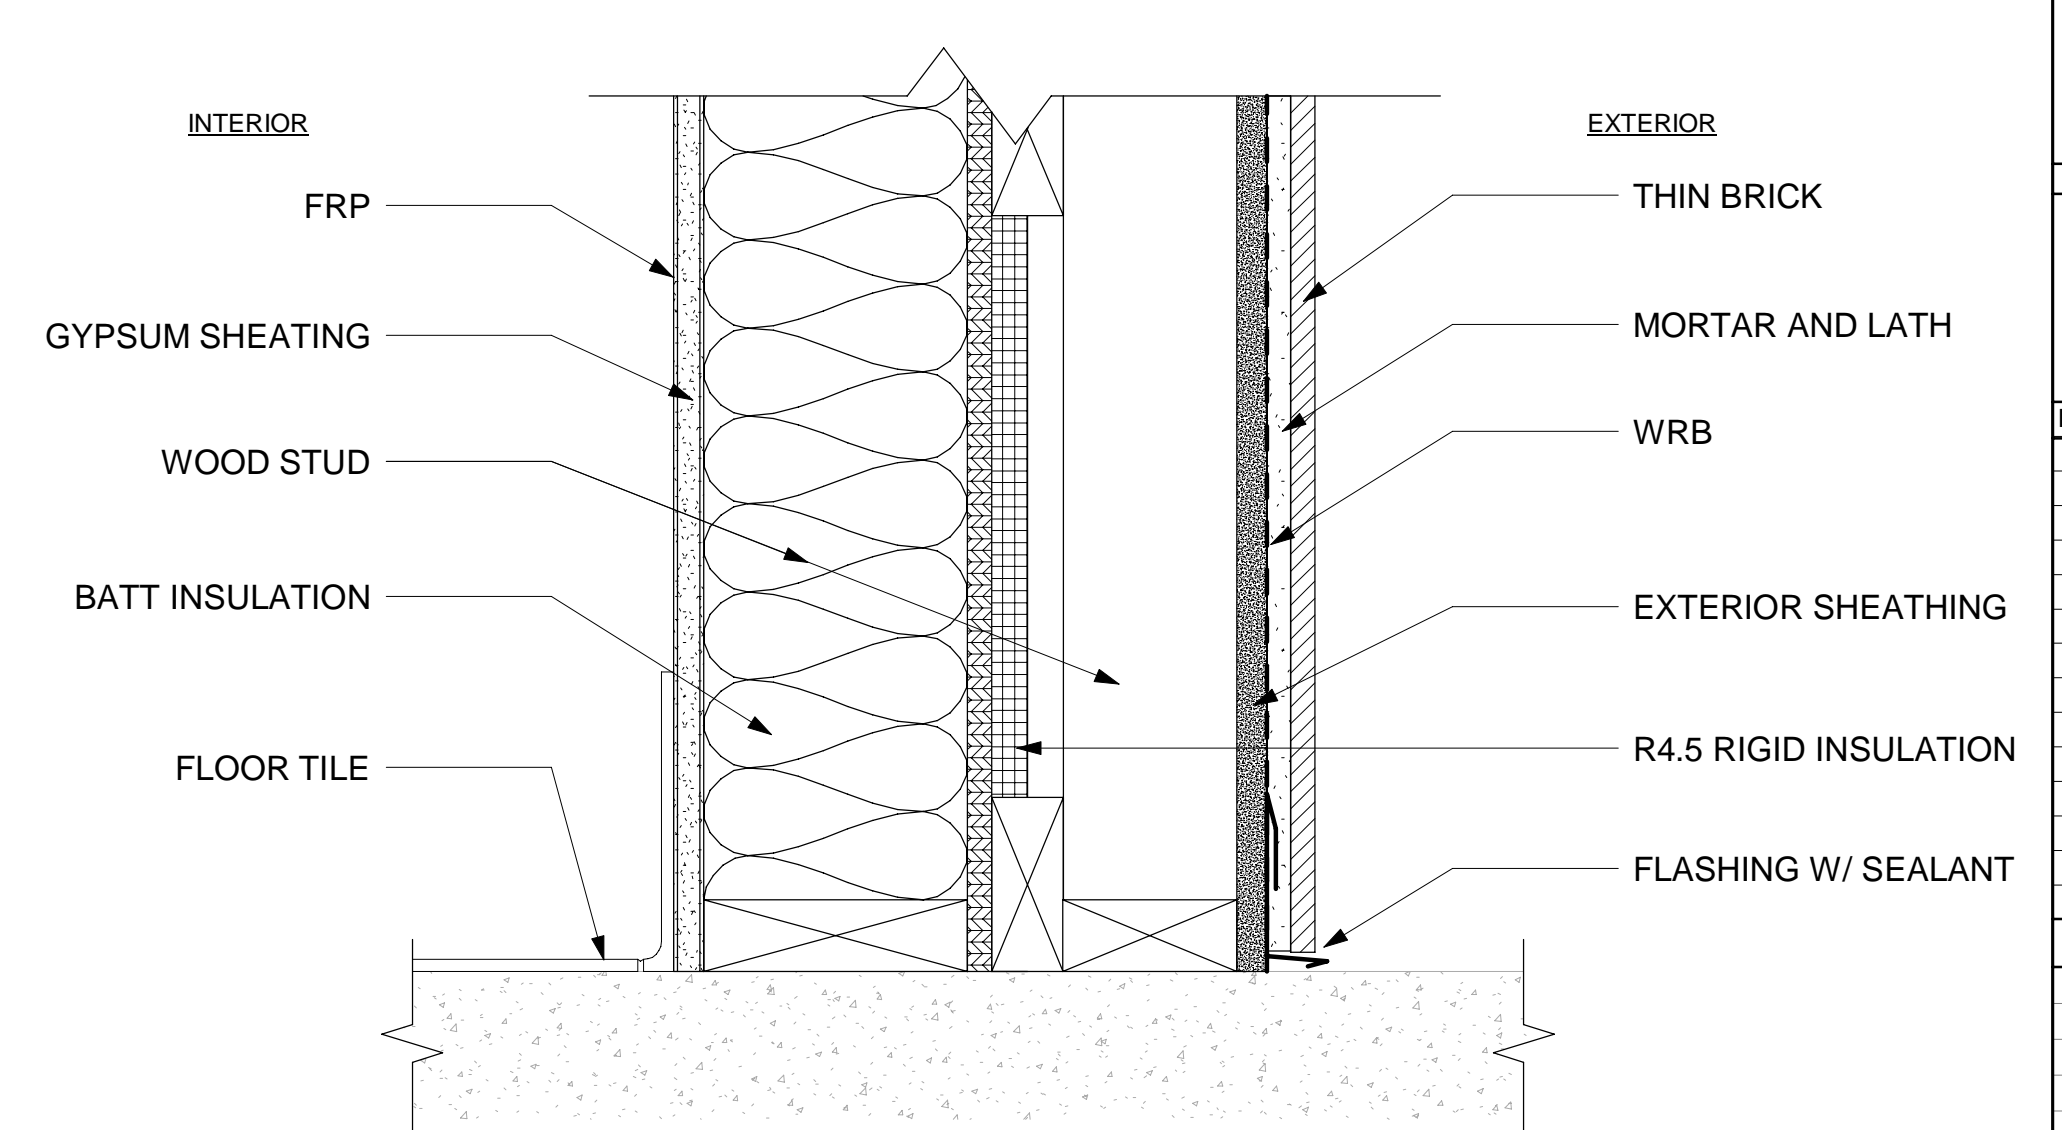

6 | EXTERIOR FINISH 6 - BRICK ON DOUBLE STUD AT REAR - EX6
3' = 1'-0"

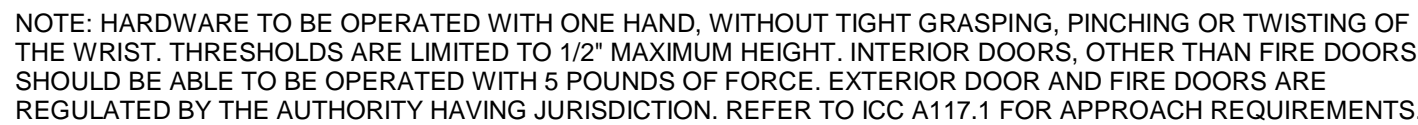

1/4" = 1'-0"



HARDWARE GROUP - 03 UTILITY		FINISH	MANF
6 EA	HINGE - 58B1HW 5 X 4.5 NRP	630	IVE
1 EA	ENTRANCE LOCK - ND53PD RHO	626	SCH
1 EA	PERM CORE - 23-030 "C" KEYWAY	626	SCH
1 EA	LOCK GUARD - LG12	630	IVE
1 EA	SURFACE CLOSER - 1461 SHCUSH TBWNS	689	LCN
1 EA	KICK PLATE - 8400 12" X 2" LDW B-CS	630	IVE
1 EA	RAIN DRIP - 142AA	AA	ZER
1 EA	WEATHERSTRIP - 8303AA	AA	ZER
1 EA	DOOR SWEEP - 39A	A	ZER
1 EA	THRESHOLD - 8655A 223	A	ZER
1 EA	KICK DOWN DOOR STOP	626	



#2001
610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3
PROTOTYPE VERSION 2.00



513 MAIN STREET #300
FORT WORTH TX 76102



PERMIT SET: 04/12/2024

CONTRACTOR SHALL VERIFY ALL
CONDITIONS AND DIMENSIONS AT THE
JOB SITE AND NOTIFY THE ARCHITECT
OF ANY DIMENSIONAL ERRORS,
OMISSIONS OR DISCREPANCIES BEFORE
BEGINNING OR FABRICATING ANY WORK
DO NOT SCALE DRAWINGS.

[illegible]

PROJECT INFORMATION	
---------------------	--

PROJECT NO:	24-008
ORIGINAL ISSUE:	06/01/2024
SCALE:	AS NOTED
DRAWN BY:	P. J.
CHECKED BY:	J. JEFFERSON

SHEET TITLE

DOOR SCHEDULE

SHEET NUMBER

A631



CONTRACTOR SHALL VERIFY ALL
CONDITIONS AND DIMENSIONS AT THE
JOB SITE AND NOTIFY THE ARCHITECT
OF ANY DIMENSIONAL ERRORS,
OMISSIONS OR DISCREPANCIES BEFORE
BEGINNING OR FABRICATING ANY WORK.
DO NOT SCALE DRAWINGS.




PROJECT INFORMATION	
PROJECT NO:	24-0087
ORIGINAL ISSUE:	09/28/23
SCALE:	AS NOTED
DRAWN BY:	P. C
CHECKED BY:	J. JEFFERY

SHEET TITLE

WINDOW SCHEDULE

SHEET NUMBER



A641



GLAZING SCHEDULE	
G-1	CLEAR 1" GUARDIAN TEMPERED W/ SN68 (SUNGUARD SUPERNEUTRAL) LOW-E COATING

WINDOW GENERAL NOTES:

- A. THE CONTRACTOR IS TO VERIFY THE DIMENSIONS OF ALL OPENINGS PRIOR TO THE FABRICATION OF ALL DOORS AND FRAMES.
- B. DUE TO MULTIPLE USE, SOME OF THE DETAILS REFERRED TO ON THE DOOR SCHEDULE ARE REVERSED OR TURNED FROM THE DIRECTION SHOWN ON THE FLOOR PLANS. THE INTENT OF THE DETAILS IS TO BE FOLLOWED. CONSULT THE ARCHITECT WHEN QUESTIONS ARISE.
- C. CAULK HEAD, JAMBS, AND SILLS OF ALL DOORS AND WINDOWS WITH SEALANT CONTINUOUSLY APPLIED TO BOTH SIDES OF THE FRAMES.
- D. PROVIDE END DAMS AT BOTTOM OUTSIDE CORNERS OF ALUMINUM STOREFRONT SYSTEMS. INSTALL PER MANUFACTURERS STANDARDS AND REQUIREMENTS.
- E. FRAME DIMENSIONS SHOWN ARE NOMINAL. ACTUAL DIMENSIONS MAY VARY DEPENDING ON WINDOW MANUFACTURER AND SYSTEM.
- F. ALL OPERABLE SERVICE WINDOWS SHALL HAVE CORIAN SOLID SURFACE SHELF INSTALLED BY GC BELOW, REF. A302, A303, AND A503 FOR DETAILS.



SPECIFICATIONS AND GENERAL CONDITIONS

GENERAL CONDITIONS A201 – 2007 AIA GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION

DIVISION 1 - GENERAL REQUIREMENTS

- 01 10 00 SUMMARY
- 01 12 00 MULTIPLE CONTRACTS
- 01 32 00 SURVEY
- 01 33 00 SUBMITTALS
- 01 43 00 TESTING AND SPECIAL INSPECTIONS
- 01 50 00 CONSTRUCTION FACILITIES
- 01 73 00 DEMOLITION
- 01 74 00 CONSTRUCTION WASTE
- 01 77 00 CONTRACT CLOSE OUT

DIVISION 3 - CONCRETE

- 03 30 00 CAST IN PLACE CONCRETE (REFER TO STRUCTURAL SET)

DIVISION 4 - MASONRY

- 04 21 50 THIN BRICK VENEER

DIVISION 5 - METALS

- 05 58 00 METALS FABRICATION (REFER TO STRUCTURAL SET)

DIVISION 6 - WOOD, PLASTIC AND COMPOSITES

- 06 11 00 WOOD FRAMING
- 06 20 00 FINISH CARPENTRY
- 06 40 00 ARCHITECTURAL WOODWORK
- 06 42 19 THERMALLY FUSED LAMINATE PANELS

DIVISION 7 - THERMAL AND MOISTURE PROTECTION

- 07 13 00 MEMBRANE WATERPROOFING
- 07 14 00 FLUID APPLIED WATERPROOFING
- 07 21 00 THERMAL INSULATION
- 07 24 00 EXTERIOR INSULATION AND FINISH SYSTEM
- 07 25 00 SOUND ATTENUATION BATTS
- 07 42 43 COMPOSITE PANELS
- 07 46 46 CEMENT PANELS
- 07 54 23 TPO ROOFING
- 07 65 00 FLASHING
- 07 72 00 ROOF ACCESSORIES
- 07 92 00 JOINT SEALANTS

DIVISION 8 - OPENINGS

- 08 11 00 METAL DOORS AND FRAMES
- 08 71 00 DOOR HARDWARE
- 08 81 00 GLASS GLAZING

DIVISION 9 - FINISHES

- 09 24 23 DRYVIT SYSTEMS
- 09 28 00 GYPSUM BOARD
- 09 30 00 TILE
- 09 51 00 ACOUSTICAL TILE CEILING
- 09 91 00 PAINTING
- 09 93 00 PRE-FINISH PANEL (FRP)

DIVISION 10 - SPECIALTIES

- 10 73 16 METAL CANOPIES

DIVISION 31- EARTHWORK

- 31 31 00 TERMITES TREATMENT

GENERAL CONDITIONS

THE FOLLOWING SUPPLEMENTS MODIFY THE AIA DOCUMENT A201 - 2007 AIA GENERAL CONDITIONS OF THE CONTRACT FOR CONSTRUCTION WHICH IS MADE A PART OF THESE CONTRACT DOCUMENTS. WHERE AN ARTICLE, SECTION OR SUBSECTION IN THE GENERAL CONDITIONS IS AMENDED, VOIDED OR SUPERSEDED BY THE FOLLOWING PARAGRAPHS, THE PROVISIONS OF SUCH ARTICLE, SECTION OR SUBSECTION NOT SO AMENDED, VOIDED OR SUPERSEDED SHALL REMAIN IN EFFECT.

CONTRACTOR SHALL EMPLOY A COMPETENT SUPERINTENDENT AND NECESSARY ASSISTANTS WHO SHALL ATTEND AT THE PROJECT SITE ON A FULL TIME BASIS DURING THE PERFORMANCE OF THE WORK. THE SUPERINTENDENT SHALL NOT DIVIDE THEIR DUTIES OR RESPONSIBILITIES AMONG OTHER PROJECTS THAT ARE NOT A SPECIFIC PORTION OF THIS AGREEMENT.

CONTRACTOR SHALL PROVIDE FOR THE COORDINATION OF THE WORK OF OWNERS FORCES AND OF EACH SEPARATE CONTRACTOR WITH THE WORK OF CONTRACTOR.

DEFECTIVE WORK NOT REMEDIED, OR FAILURE TO BEGIN REMEDIAL ACTION WITHIN 5 DAYS FOLLOWING WRITTEN NOTIFICATION.

REFER TO SUBMITTAL SCHEDULE AND RESPONSIBILITY MATRIX ON SHEETS G001 AND G006.

SECTION 01 50 00 / SUMMARY

- THE WORK INCLUDES WORK INDICATED OR SPECIFIED WITHIN THE CONTRACT LIMIT LINES UNLESS THE WORK IS INDICATED AS NIC (NOT IN CONTRACT) ALSO INCLUDED IS WORK NECESSARY TO PROVIDE WATER, GAS, SEWER, TELEPHONE, CABLE AND ELECTRICAL SERVICE TO THE SITE, INCLUDING REPLACEMENT OF PAVING TO MEET THE REQUIREMENTS OF GOVERNING MUNICIPAL AUTHORITIES.
- PROVIDE COORDINATION FOR UTILITIES INCLUDING APPLICATIONS, NOTICES, MEETINGS, SCHEDULING, FINAL CONNECTIONS, AND OTHER TASKS NECESSARY TO PROVIDE UTILITIES TO THE PROJECT.
 - INCLUDE COORDINATION BETWEEN UTILITIES AND TENANTS AS WELL AS OTHERS ON THE PROJECT SITE.
 - WORK SHALL BE IN ACCORDANCE WITH UTILITY COMPANY REQUIREMENTS.
 - SEND PROPER NOTICES, MAKE NECESSARY ARRANGEMENTS AND PERFORM SERVICES REQUIRED IN THE CARE AND MAINTENANCE OF PUBLIC UTILITIES DURING THE CONSTRUCTION PERIOD AND UNTIL FINAL ACCEPTANCE OF THE WORK BY OWNER.
- LIMIT THE STORAGE OF MATERIALS AND EQUIPMENT TO AREAS INDICATED BY OWNER. NO MATERIAL OR EQUIPMENT SHALL BE PLACED AT LOCATIONS THAT WOULD IMPEDE ACCESS TO, OR FROM, EXISTING FACILITIES FOR CUSTOMERS, EMPLOYEES, OR DELIVERIES. COOPERATE WITH OWNER IN PROVIDING TRAFFIC CONTROL DURING THE COURSE OF CONSTRUCTION TO ENSURE MINIMUM INCONVENIENCE TO OWNERS CUSTOMERS.
- IN GENERAL, THE DRAWINGS INDICATE DIMENSIONS, POSITIONS AND DETAILS OF CONSTRUCTION; THE SPECIFICATIONS DESCRIBE QUALITIES OF MATERIAL AND METHODS OF WORKMANSHIP. WORK DESCRIBED IN THE SPECIFICATIONS, SHOWN ON THE DRAWINGS, OR NECESSARY FOR PROPER COMPLETION OF THE WORK, SHALL BE EXEMUTED IN A COMPETENT MANNER AND SHALL BE OF THE MATERIALS BEST ADAPTED TO THE PURPOSE WHERE SUCH WORK OR MATERIALS ARE NOT SPECIFICALLY MENTIONED.
- SHOULD CONFLICTS OCCUR IN OR BETWEEN DRAWINGS AND SPECIFICATIONS, CONTRACTOR IS DEEMED TO HAVE ESTIMATED ON THE MORE EXPENSIVE PRODUCT, METHOD, AND MATERIAL.
- WORK AND MATERIALS SHALL BE THE BEST OF THE KINDS SPECIFIED AND INDICATED. SHOULD WORK OR MATERIALS BE REQUIRED WHICH ARE NOT DIRECTLY OR INDIRECTLY CALLED FOR IN THE SPECIFICATIONS OR SHOWN ON THE DRAWINGS, BUT WHICH ARE NECESSARY FOR PROPER FULFILLMENT OF THE OBVIOUS INTENT, SAID WORK OR MATERIALS SHALL BE THE SAME AS SIMILAR PARTS THAT ARE DETAILED, INDICATED OR SPECIFIED, AND CONTRACTOR SHALL UNDERSTAND THE SAME TO BE IMPLIED AND PROVIDE FOR IT IN THEIR PROPOSAL AS FULLY AS IF IT WERE PARTICULARLY DESCRIBED OR DELINEATED.
- EXECUTE WORK IN ACCORDANCE WITH CONTRACT DOCUMENTS. MAKE NO CHANGES WITHOUT HAVING FIRST RECEIVED WRITTEN PERMISSION, WHERE DETAILED INFORMATION IS LACKING, BEFORE PROCEEDING WITH WORK, REFER MATTER TO ARCHITECT FOR SUPPLEMENTAL INSTRUCTIONS.
- IF CONTRACTOR OBSERVES ERRORS, DISCREPANCIES OR OMISSIONS IN CONTRACT DOCUMENTS, CONTRACTOR SHALL PROMPTLY NOTIFY ARCHITECT, REQUESTING CLARIFICATION. IF CONTRACTOR PROCEEDS WITH WORK AFFECTED BY SUCH ERRORS, DISCREPANCIES OR OMISSIONS WITHOUT RECEIVING SUCH CLARIFICATION, THEY DO SO AT THEIR OWN RISK. ADJUSTMENTS INVOLVING SUCH CIRCUMSTANCES MADE BY CONTRACTOR, PRIOR TO APPROVAL BY ARCHITECT, SHALL BE AT CONTRACTOR'S RISK AND THE SETTLEMENT OF COMPLICATIONS OR DISPUTES SHALL BE AT CONTRACTOR'S SOLE EXPENSE.
- NEITHER OWNER NOR ARCHITECT ASSUME RESPONSIBILITY FOR AN UNDERSTANDING OR REPRESENTATION MADE BY THEIR AGENTS OR REPRESENTATIVES PRIOR TO THE EXECUTION OF THE AGREEMENT UNLESS SUCH UNDERSTANDINGS OR REPRESENTATIONS ARE EXPRESSLY STATED IN THE AGREEMENT, AND THE AGREEMENT EXPRESSLY PROVIDES THAT RESPONSIBILITY IS ASSUMED BY OWNER.
- FAILURE OF CONTRACTOR TO ACQUAINT THEMSELVES WITH AVAILABLE INFORMATION CONCERNING THE

WORK SHALL NOT RELIEVE CONTRACTOR FROM THE RESPONSIBILITY FOR ESTIMATING PROPERLY THE DIFFICULTY OR COST OF SUCCESSFULLY PERFORMING THE WORK.

- NEITHER THE PRESENCE NOR ABSENCE OF OWNER OR ARCHITECT, NOR THEIR AUTHORIZED REPRESENTATIVES, SHALL RELIEVE CONTRACTOR FROM REQUIREMENTS OF THE CONTRACT DOCUMENTS.
- WHEN REQUESTED BY ARCHITECT, CONTRACTOR SHALL DELIVER TO ARCHITECT (PRIOR TO FINAL ACCEPTANCE OF THE WORK AS A WHOLE) SIGNED CERTIFICATES FROM SUPPLIERS OF MATERIALS AND MANUFACTURED ITEMS STATING THAT SUCH ITEMS CONFORM TO CONTRACT DOCUMENTS.
- CONTRACTOR, UPON AWARD OF THE CONTRACT, OR WHERE SHOWN ON DRAWINGS, PRODUCT DATA OR SAMPLES ARE REQUIRED, UPON RECEIPT OF THEIR APPROVAL) SHALL PLACE ORDERS FOR MATERIALS, WORK, FABRICATION AND EQUIPMENT TO BE INCORPORATED IN THE WORK. CONTRACTOR SHALL KEEP ARCHITECT INFORMED AS TO THE AVAILABILITY OF MATERIALS, WORK, FABRICATIONS AND EQUIPMENT SPECIFIED AND TO ADVISE ARCHITECT, IN WRITING, OF ORDERS PLACED AND OF SUCH MATERIAL, WORK, FABRICATION AND EQUIPMENT, WHICH MAY NOT BE AVAILABLE FOR THE PURPOSES OF THE CONTRACT.
- LABOR SHALL BE PERFORMED IN THE BEST MOST COMPETENT MANNER, BY MECHANICS SKILLED IN THEIR RESPECTIVE TRADES. STANDARDS FOR WORK REQUIRED THROUGHOUT SHALL BE OF SUCH GRADE AS WILL RESULT IN FIRST CLASS WORK.
- REPLACING, PATCHING AND REPAIRING OF MATERIALS AND SURFACES CUT OR DAMAGED IN THE EXECUTION OF THE WORK SHALL BE PERFORMED BY EXPERIENCED MECHANICS. SUCH REPLACING, REPAIRING AND PATCHING SHALL BE DONE WITH THE APPLICABLE MATERIALS, IN SUCH A MANNER THAT SURFACES SO REPLACED WILL MATCH THE SURROUNDING SIMILAR SURFACES.
- CONTRACTOR AGREES THAT EACH SUBCONTRACT SHALL CONTAIN AN EXPRESS PROVISION SATISFACTORY IN FORM AND CONTENT TO OWNER WHEREBY SUCH SUBCONTRACTOR OR MATERIAL SUPPLIER EXPRESSLY AGREES THAT FOR THE BENEFITS OF OWNER, IT WAIVES RIGHTS TO FILE MECHANICS LIENS WITH RESPECT TO UNPAID SERVICES OR MATERIALS PROVIDED BY IT AS SPECIFIED BY CURRENT STATE STATUTES.
- IN THE EVENT THAT THE BUILDING INSPECTOR OR OTHER PUBLIC OFFICIAL REQUIRES THAT ADDITIONAL WORK BE DONE OR THAT THE WORK UNDER CONTRACT DOCUMENTS BE MODIFIED, CONTRACTOR SHALL NOTIFY ARCHITECT IN WRITING OF THE REQUESTED CHANGE. ARCHITECT WILL REVIEW THE REQUESTED CHANGE AND ADVISE CONTRACTOR IN WRITING. THE WORK PERFORMED WITHOUT WRITTEN PERMISSION SHALL BE AT THE EXPENSE OF CONTRACTOR.

SECTION 01 12 00 / MULTIPLE CONTRACTS

- CONSTRUCTION ACTIVITIES, UNDER DIRECT SUPERVISION OF OWNER, ARE CONTEMPLATED IN THE SAME AREA OF WORK DURING THE CONSTRUCTION PERIOD. OTHER CONTRACTORS BEGINNING PROGRESS DURING THE SAME PERIOD SHALL HAVE EQUAL RIGHTS TO USE THE ROADS, GROUNDS, AND AREAS.
- OWNER WILL REQUIRE THE OCCUPANCY OF VARIOUS PORTIONS OF THE BUILDING IN ADVANCE OF THE DATE ESTABLISHED IN THE CONTRACT DOCUMENTS FOR THE COMPLETION OF WORK. THE SCHEDULE OF DATES REQUIRED BY OWNER FOR USES OF THE VARIOUS AREAS PRIOR TO THE COMPLETION OF THE WORK SHALL BE PROVIDED BY OWNER. OWNER SHALL HAVE THE RIGHT TO OCCUPY PORTIONS OF THE BUILDING THAT ARE COMPLETED ON OR AFTER THE SPECIFIED COMPLETION DATE. SUCH OCCUPANCY BY OWNER WILL NOT RELEASE CONTRACTOR OR THEIR BONDING AGENCY FROM WARRANTIES OR GUARANTEES AND COMPLETION OF WORK IN ACCORDANCE WITH CONTRACT DOCUMENTS AND THE CERTIFICATE OF OCCUPANCY OR EQUIVALENT HAVE BEEN ISSUED BY THE APPLICABLE GOVERNMENTAL AGENCY.
 - OWNER'S FORCES MAY BE EITHER UNION OR NON-UNION

SECTION 01 32 00 / SURVEY

- VERIFY LAYOUT INFORMATION SHOWN ON DRAWINGS IN RELATION TO PROPERTY SURVEY AND EXISTING BENCHMARKS BEFORE PROCEEDING WITH LAYOUT OF WORK. RECORD DEVIATIONS FROM REQUIRED LINES AND LEVELS AND ADVISE OWNER PROMPTLY UPON DETECTION OF DEVIATIONS.
- IMMEDIATELY AFTER THE INSTALLATION OF THE BUILDING FOUNDATIONS, PREPARE A SURVEY SHOWING THE ACTUAL LOCATION OF PERIMETER FOUNDATIONS WITH RESPECT TO PROPERTY LINES. ALSO INCLUDE THE SQUARE FOOTAGE OF THE BUILDING BASED ON THE FOUNDATION. SUBMIT ONE COPY OF SURVEY TO OWNER.
- CONTRACTOR SHALL COMPARE CONDITIONS AT THE SITE WITH CONTRACT DOCUMENTS. CONTRACTOR SHALL NOTIFY ARCHITECT OR OWNER, IN WRITING, AT OR BEFORE SUBMITTING THEIR BID, OF DISCREPANCIES BETWEEN CONTRACT DOCUMENTS AND THE EXISTING CONDITIONS AT THE SITE.
- MAPS, SOIL INVESTIGATION REPORTS AND SIMILAR REFERENCE DATA MADE AVAILABLE TO CONTRACTOR ARE GIVEN FOR CONTRACTOR'S INFORMATION ONLY, AND NEITHER OWNER NOR ARCHITECT ASSUME RESPONSIBILITY FOR CONCLUSIONS CONTRACTOR MAY DRAW.

SECTION 01 33 00 / SUBMITTALS

SCHEDULES AND COST BREAKDOWN

- DELIVER TO OWNER A CONSTRUCTION SCHEDULE, SHOWING THE DATES OF COMMENCEMENT AND COMPLETION OF EACH OF THE VARIOUS SUBDIVISIONS OF THE WORK REQUIRED UNDER THE CONTRACT DOCUMENTS.
- SUBMIT MONTHLY: AN UPDATED PROGRESS REPORT INDICATING WORK COMPLETED DURING THE PRECEDING MONTH AND INDICATE REVISIONS TO THE CONSTRUCTION SCHEDULE.
- SUBMIT A SCHEDULE OF THE ANTICIPATED MONTHLY PAYMENTS THAT WILL BECOME DUE IN ACCORDANCE WITH THE PROGRESS SCHEDULE. ALSO, SUBMIT AN ITEMIZED BREAKDOWN OF THE COSTS OF THE VARIOUS SUBDIVISIONS OF THE WORK. THE FIGURES USED IN MAKING THESE SCHEDULES WILL BE USED FOR DETERMINING THE BASIS OF PARTIAL PAYMENTS AND WILL NOT BE CONSIDERED AS FIXING A BASIS FOR ADDITIONS OR DEDUCTIONS THE CONTRACT PRICE.
 - THE PROVISIONS OF THIS SUBPARAGRAPH PROVIDING FOR ADJUSTMENT OF PRICE SHALL NOT APPLY IF CONTRACTOR HAS PROPOSED A SUBCONTRACTOR UNQUALIFIED UNDER APPLICABLE STATE LAW.
- 3 APPLICATION FOR PAYMENT SHALL BE MADE ON AIA FORM G-702 AND G-703, APPLICATION AND CERTIFICATE FOR PAYMENT, (4 COPIES) UTILIZING COMPLETE PROVISIONS PROVIDED BY THE FORM. PROVIDE SIGNATURE SPACE FOR OWNERS APPROVAL.
- CONTRACTOR AGREES TO ACCOMPANY PAYMENT REQUESTS, EXCEPT THE FIRST, WITH LIEN WAIVERS PERTAINING TO THE WORK PERFORMED AND MATERIALS PROVIDED BY CONTRACTOR, SUBCONTRACTORS AND MATERIAL SUPPLIER; AND FURTHER AGREE THAT OWNER SHALL HAVE THE RIGHT TO ISSUE CHECKS MADE JOINTLY PAYABLE TO CONTRACTOR AND SUCH SUBCONTRACTOR OR MATERIAL SUPPLIER.
 - SUCH SUBCONTRACTOR OR MATERIAL SUPPLIER SHALL AGREE TO GIVE WRITTEN NOTICE TO OWNER OF NONPAYMENT FOR MATERIALS AND SERVICES, WHICH NOTICE SHALL INCLUDE A SPECIFIC DETAIL LISTING OF THE SERVICES AND MATERIALS WITH RESPECT TO WHICH PAYMENT HAS NOT BEEN MADE. IF LIENS ARE FILED AGAINST OWNER'S PROPERTY, OWNER MAY, AT THEIR OPTION, REQUIRE CONTRACTOR TO PROVIDE A BOND IN ACCORDANCE WITH STATE STATUTES. FINAL LIEN WAIVERS SHALL ACCOMPANY THE FINAL PAYMENT REQUEST. LIEN WAIVERS SHALL BE ON AIA DOCUMENT G-206A.
- CONTRACTOR SHALL REIMBURSE OWNER BY DEDUCTIVE CHANGE ORDER, FOR ARCHITECT'S ADDITIONAL SERVICES MADE NECESSARY BY CONTRACTOR'S FAILURE TO COMPLETE THE WORK WITHIN FIFTEEN DAYS FROM SUBSTANTIAL COMPLETION.
- NEITHER THE FINAL PAYMENT NOR THE REMAINING RETAINED PERCENTAGE SHALL BECOME DUE UNTIL REQUIREMENTS LISTED IN SECTION 01 77 00 CONTRACT CLOSEOUT ARE COMPLETED.
- BONDS SHALL BE IN ACCORDANCE WITH STATE LAWS WITH AMOUNT SHOWN EQUAL TO 100% OF THE TOTAL AMOUNT PAYABLE BY TERMS OF THE CONTRACT. SURELY SHALL BE COMPANY LICENSED TO DO BUSINESS IN THE STATE IN WHICH WORK IS LOCATED AND SHALL BE ACCEPTABLE TO OWNER. BOND AMOUNT SHALL BE INCREASED TO INCLUDE CHANGE ORDER ADDED

SHOP DRAWINGS, DATA AND SAMPLES

- SUBMIT SHOP DRAWINGS, MATERIAL LISTS, MANUFACTURER'S LITERATURE, SAMPLES AND OTHER INFORMATION IN SUFFICIENT TIME TO PERMIT PROPER CONSIDERATION AND ACTION ON SAME BEFORE MATERIALS OR ITEMS ARE ORDERED.
- FURNISH TO ARCHITECT FOR REVIEW, 1 DIGITAL SET OF EACH SHOP DRAWING AND SCHEDULES FOR PARTS OF THE WORK AS SPECIFIED. ARCHITECT WILL CHECK FOR CONFORMANCE WITH CONTRACT DOCUMENTS. DO NOT EXECUTE WORK UNTIL CONFIRMATION OF REVIEW IS OBTAINED. AFTER THE SUBMITTAL HAS BEEN REVIEWED IT IS CONTRACTOR'S RESPONSIBILITY TO RETRIEVE THE SHOP DRAWINGS FROM ARCHITECT.
- BEFORE SUBMITTING SHOP DRAWINGS FOR REVIEW, CHECK SHOP DRAWINGS FOR ACCURACY, ASCERTAIN THAT WORK CONTIGUOUS WITH AND HAVING BEARING ON OTHER WORK SHOWN ON SHOP DRAWINGS IS ACCURATELY DRAWN, AND THAT WORK SHOWS ITS CONFORMITY WITH CONTRACT REQUIREMENTS. SHOP DRAWINGS, WHEN SUBMITTED, MUST BEAR A STAMP OF APPROVAL FROM CONTRACTOR. DRAWINGS

SUBMITTED WITHOUT SUCH EXECUTED STAMP OF APPROVAL, OR WHENEVER IT IS EVIDENT THAT THE DRAWINGS HAVE NOT BEEN CHECKED, WILL BE RETURNED FOR RESUBMISSION.

- PREPARE COMPOSITE DRAWINGS AND INSTALLATION LAYOUTS, WHEN REQUIRED TO SOLVE TIGHT FIELD CONDITIONS, SUCH DRAWINGS SHALL CONSIST OF DIMENSIONED PLANS AND ELEVATIONS AND MUST GIVE INFORMATION PARTICULARLY AS TO SIZE AND LOCATION OF SLEEVES, INSERTS, ATTACHMENTS, OPENINGS, CONDUITS, DUCTS OR STRUCTURAL INTERFERENCES.

- WHEN PRODUCT DATA, CONSISTING OF MANUFACTURER'S PRINTED LITERATURE IS REQUIRED TO BE SUBMITTED TO ARCHITECT, IT SHALL BE SUBMITTED IN ORIGINAL FORM, IN DIGITAL (PDF, DWG, ETC) SUBMISSION OR A MINIMUM OF 3 EACH IS REQUIRED, 2 FOR ARCHITECT AND ONE TO BE RETURNED TO CONTRACTOR.

EQUIPMENT LISTS

- SUBMIT 3 COPIES OF A COMPLETE LIST OF MAJOR ITEMS OF MECHANICAL, PLUMBING AND ELECTRICAL EQUIPMENT AND MATERIALS WITHIN 30 DAYS AFTER AWARD OF CONTRACT.
- SUBMITTALS SHALL INCLUDE THE MANUFACTURER'S SPECIFICATIONS, PHYSICAL DIMENSIONS AND RATINGS OF EQUIPMENT. FURNISH PERFORMANCE CURVES FOR PUMPS AND FANS. WHERE SUBMITTAL SHEET DESCRIBES ITEMS IN ADDITION TO THAT ITEM BEING SUBMITTED, THE SUBMITTED ITEM SHALL BE CLEARLY MARKED ON THE SHEET AND SUPERFLUOUS INFORMATION SHALL BE CROSSED OUT.
- EQUIPMENT SUBMITTALS SHALL BE COMPLETE INCLUDING SPACE REQUIREMENTS, WEIGHT, ELECTRICAL AND MECHANICAL REQUIREMENTS, PERFORMANCE DATA AND SUPPLEMENTAL INFORMATION REQUESTED BY ARCHITECT.

SECTION 01 43 00 / TESTING AND SPECIAL INSPECTION

- THE RESPECTIVE SECTIONS OF THESE SPECIFICATIONS CONTAIN REQUIREMENTS FOR MATERIALS TESTING AND INSPECTIONS. COSTS INCURRED FOR INSPECTION, SPECIAL INSPECTION AND TESTING LABORATORY SERVICES SHALL BE PAID FOR BY CONTRACTOR. SPECIAL INSPECTION SHALL BE PERFORMED BY A LICENSED STRUCTURAL ENGINEER.
- PROVIDE THE SERVICES OF A TESTING LABORATORY APPROVED BY ARCHITECT. TESTING LABORATORY SHALL REPORT THE RESULTS OF TESTS, IN WRITING, SIMULTANEOUSLY TO THE FOLLOWING: ARCHITECT 1 COPY, STRUCTURAL ENGINEER 1 COPY, CONTRACTOR 2 COPIES.

SECTION 01 50 00 / CONSTRUCTION FACILITIES

- UTILITIES: PROVIDE TEMPORARY ADEQUATE LIGHT AND POWER AND WATER SUPPLY FOR CONSTRUCTION, MAKING NECESSARY ARRANGEMENTS WITH SERVING UTILITY. RECEIPTS STATING THAT CHARGES HAVE BEEN PAID SHALL ACCOMPANY APPLICATION FOR FINAL PAYMENT.
- FIRE PROTECTION: PROVIDE ADEQUATE FIRE EXTINGUISHERS, OF THE TYPE AND SIZES RECOMMENDED BY THE NFPA, ON THE PREMISES DURING THE COURSE OF CONSTRUCTION, IN THE USE OF HAZARDOUS TYPES OF EQUIPMENT, NO WORK SHALL BE COMMENCED OR EQUIPMENT USED UNLESS FIRE EXTINGUISHERS OF AN APPROVED TYPE AND CAPACITY ARE PLACED IN THE WORK AREA.
- TEMPORARY ENCLOSURES, BARRIERS, AND FENCES: PROVIDE AND MAINTAIN FENCES, BARRICADES, LIGHTS, SHORING AND OTHER PROTECTIVE STRUCTURES OR DEVICES NECESSARY FOR THE SAFETY OF WORKERS, EQUIPMENT, THE PUBLIC AND PROPERTY. ABIDE BY STATE OR MUNICIPAL LAWS AND REGULATIONS, AND LOCAL ORDINANCES, LAWS AND OTHER REQUIREMENTS OF THE COUNTY AND OTHER AUTHORITIES HAVING JURISDICTION WITH REGARD TO SAFETY PRECAUTIONS, OPERATION AND FIRE HAZARDS.
- SECURITY: ARCHITECT AND OWNER DO NOT ASSUME RESPONSIBILITY FOR THE PROTECTION OF THE BUILDING AND PREMISES OR FOR LOSS OF MATERIALS, FROM THE TIME THAT THE CONTRACT OPERATIONS HAVE COMMENCED UNTIL THE FINAL ACCEPTANCE OF THE WORK BY OWNER. IF WATCHMAN SERVICE IS DEEMED NECESSARY BY CONTRACTOR, SUCH PROTECTION SHALL BE PROVIDED BY CONTRACTOR.
- FACILITY AND EQUIPMENT: PROVIDE, INSTALL, MAINTAIN AND OPERATE A COMPLETE AND ADEQUATE FACILITY FOR THE HANDLING, EXECUTION, DISPOSAL AND DISTRIBUTION OF MATERIAL AND EQUIPMENT REQUIRED FOR THE PROPER AND TIMELY PERFORMANCE OF WORK CONNECTED WITH THE CONTRACT.
- TOILET FACILITIES: PROVIDE PROPER SANITARY AND ADEQUATE TOILET FACILITIES, LOCATED WHERE DIRECTED, FOR THE USE OF WORKERS ON THE PROJECT AND ENFORCE THEIR USE BY PERSONNEL ON THE PROJECT.
- HEATING: SHOULD IT BECOME NECESSARY TO DO WORK IN THE BUILDING, SUCH AS PLASTERING, CEMENT WORK OR PAINTING, AT TIMES WHEN THE TEMPERATURE IS BELOW 40 DEGREES F CONTRACTOR SHALL PROVIDE TEMPORARY HEAT FOR SUCH LENGTH OF TIME AS NECESSARY FOR THE PROTECTION OF THE WORK.
- SCAFFOLD: THE WORK SHALL INCLUDE PROVIDING, INSTALLING AND MAINTAINING SCAFFOLD NECESSARY FOR THE WORK IN CONFORMITY WITH APPLICABLE LAWS AND ORDINANCES.
- PROJECT IDENTIFICATION: FURNISH AND ERECT A PROJECT SIGN GIVING THE NAME OF THE PROJECT, OWNER, ARCHITECTS, ENGINEERS, AND CONTRACTOR. SIGN SHALL MEET LOCAL ORDINANCE REQUIREMENTS.
- VISIT THE SITE AND REVIEW THE NATURE OF WORK UNDER THIS SECTION PRIOR TO SUBMITTING THE BID. NOTIFY ARCHITECT OF DISCREPANCIES BEFORE PROCEEDING WITH THE WORK.
- MATERIALS LISTED FOR REUSE OR SALVAGE, WHICH IS DAMAGED TO THE EXTENT THAT THEY CANNOT BE REUSED, SHALL BE REPLACED BY CONTRACTOR WITH EQUAL QUALITY MATERIAL. COORDINATE WITH OWNER ON DISPOSITION OF SALVAGE ITEMS.
- REBUILD EXISTING WORK THAT HAS TO BE REMOVED TO ALLOW FOR THE INSTALLATION OF NEW WORK. REPAIR DAMAGE TO THE ROOF, OTHER SURFACES, AND ITEMS.
- THE INSURANCE REQUIRED BY SUBSECTION 11.1 SHALL BE WRITTEN FOR NOT LESS THAN THE FOLLOWING, OR GREATER IF REQUIRED BY LAW:
 - WORKER'S COMPENSATION INSURANCE:
 - STATE, TO BE STATUTORY, APPLICABLE FEDERAL, TO BE STATUTORY, EMPLOYER'S LIABILITY \$100,000
 - COMPREHENSIVE GENERAL LIABILITY INSURANCE (INCLUDING PREMISES-OPERATION, INDEPENDENT CONTRACTORS PROTECTION, PRODUCTS AND COMPLETED OPERATIONS):
 - BODILY INJURY: \$1,000,000 EACH OCCURRENCE, \$2,000,000 ANNUAL AGGREGATE PROPERTY DAMAGE: \$1,000,000 EACH OCCURRENCE, \$2,000,000 ANNUAL AGGREGATE
 - PRODUCTS AND COMPLETED OPERATIONS INSURANCE TO BE MAINTAINED INSURED FOR ONE YEAR AFTER FINAL PAYMENT. PROPERTY DAMAGE LIABILITY INSURANCE WILL PROVIDE U GOVERAGE
 - CONTRACTUAL LIABILITY INSURANCE:
 - BODILY INJURY: \$1,000,000 EACH OCCURRENCE PROPERTY DAMAGE: \$1,000,000 EACH OCCURRENCE, \$2,000,000 ANNUAL AGGREGATE
 - PERSONAL INJURY INSURANCE, WITH EMPLOYMENT EXCLUSION DELETED:
 - \$2,000,000 ANNUAL AGGREGATE
 - COMPREHENSIVE AUTOMOBILE LIABILITY INSURANCE:
 - BODILY INJURY: \$1,000,000 EACH PERSON, \$2,000,000 EACH OCCURENCE PROPERTY DAMAGE: \$1,000,000 EACH OCCURRENCE
 - CONTRACTOR SHALL PROVIDE THE LIMITS OF LIABILITY BY A COMBINATION OF THE ABOVE-DESCRIBED POLICY FORMS AND AN UMBRELLA EXCESS LIABILITY POLICY.
- CONTRACTOR'S EXCESS LIABILITY, UMBRELLA FORM, BODILY INJURY AND PROPERTY DAMAGE COMBINED:
 - \$2,000,000 EACH OCCURRENCE, \$10,000,000 AGGREGATE

BUILDING DEMOLITION

- CONTRACTOR SHALL, BEFORE COMMENCING WORK, VERIFY GRADES, LINES, LEVELS AND DIMENSIONS SHOWN ON THE DRAWINGS AND SHALL REPORT ERRORS OR INCONSISTENCIES TO ARCHITECT. CONTRACTOR SHALL NOT PROCEED UNTIL SUCH ERRORS OR INCONSISTENCIES ARE CORRECTED
- CONTRACTOR SHALL ESTABLISH AND MAINTAIN BUILDINGS AND CONSTRUCTION GRADES, LINES, LEVELS AND BENCHMARKS AND SHALL BE RESPONSIBLE FOR THEIR ACCURACY AND PROTECTION. THIS WORK SHALL BE PERFORMED BY A LICENSED SURVEYOR.
 - CONTRACTOR SHALL PROTECT TEMPORARY BENCHMARKS AND MAINTAIN THEM IN PLACE FOR THE DURATION OF THE CONTRACT OR UNTIL SUCH TIME AS THEIR REMOVAL DOES NOT AFFECT COMPLETION OF THE PROJECT.
 - CONTRACTOR SHALL NOT REMOVE PROPERTY LINE MARKERS OR MONUMENTS OR DATA ESTABLISHED BY OWNER. IF SUCH ARE DAMAGED OR REMOVED CONTRACTOR SHALL BEAR COST OF REPLACEMENT.
- CONTRACTOR SHALL BE RESPONSIBLE FOR EXISTING STRUCTURE AND IMPROVEMENTS, BOTH ABOVEGROUND AND UNDERGROUND, INCLUDING THE FINISHES WITHIN THE ADJOINING WORKING AREAS, AND SHALL PROVIDE ADEQUATE PROTECTION, EITHER BY BARRICADES, COVERING OR TEMPORARY REMOVAL. EXISTING IMPROVEMENTS DAMAGED DURING CONSTRUCTION SHALL BE REPAIRED AND REPLACED WITH MATERIALS, WORKMANSHIP, FIXTURES OR EQUIPMENT OF THE SAME

QUALITY AND SIZE AS REQUIRED BY CONTRACT DOCUMENTS.

- DEBRIS FROM THE DEMOLITION SHALL NOT BE ALLOWED TO ACCUMULATE WITHIN THE BUILDING OR ON THE SITE. UNLESS LISTED FOR REUSE OR SALVAGE, DEMOLISHED MATERIALS SHALL BECOME THE PROPERTY OF CONTRACTOR, AND SHALL BE REMOVED FROM THE SITE. SPRINKLE DEBRIS, AND USE TEMPORARY ENCLOSURES, AS NECESSARY, TO LIMIT DUST. DO NOT USE WATER TO THE EXTENT OF CAUSING FLOODING, CONTAMINATION OR RUNOFF.
- BREAK CONCRETE AND MASONRY INTO SECTIONS LESS THAN 3 FEET IN DIMENSION. LOWER STRUCTURAL FRAMING MEMBERS TO GROUND BY HOIST OR CRANE.
- REMOVE FLOORS OVER BASEMENT CONSTRUCTION AND REMOVE ON GRADE SLABS. REMOVE EXTERIOR BASEMENT WALLS AND FOOTINGS IN TOTAL. REMOVE BELOW GRADE WOOD AND METAL FROM BUILDING DEMOLITION AREA.
- PERFORM THE REMOVAL, CUTTING AND DRILLING OF EXISTING WORK WITH CARE, AND USING SMALL TOOLS IN ORDER NOT TO JEOPARDIZE THE STRUCTURAL INTEGRITY OF THE BUILDING. STORE EXISTING CONSTRUCTION WHEN EXISTING SUPPORTS ARE REMOVED, TO ALLOW FOR THE INSTALLATION OF NEW WORK. PERFORM CUTTING OF EXISTING CONCRETE AND MASONRY WITH SAWS AND CORE DRILLS. DO NOT USE JACKHAMMERS.
- CONTRACTOR SHALL BE LIABLE FOR DAMAGE CAUSED BY CONTRACTOR TO OWNER'S PREMISES. CONTRACTOR SHALL HOLD AND SAVE OWNER AND THEIR AGENTS, FREE AND HARMLESS FROM LIABILITY OF ANY KIND ARISING FROM THE USE, TRESPASS OR DAMAGE OCCASIONED BY THEIR OPERATIONS ON PREMISES OR THIRD PERSONS.

PROTECTION OF EXISTING ROOFING

- PROVIDE PROTECTION FROM WEATHER WHERE OPENINGS IN EXISTING ROOF ARE CUT FOR NEW WORK, OR WHERE EXISTING ROOFING IS REMOVED TO ALLOW NEW CONSTRUCTION TO JOIN EXISTING.
- PROVIDE WORKING DECK OF EXTERIOR GRADE PLYWOOD AND WOOD SKIDS, OR OTHER APPROVED MATERIAL, OVER EXISTING ROOFING WHEN ADJOINING NEW WORK.

SECTION 01 74 00 / CONSTRUCTION WASTE

- CONDUCT CLEANUP AND DISPOSAL OPERATIONS TO COMPLY WITH LOCAL ORDINANCES AND ANTIPOLLUTION LAWS. ONLY USE CLEANING MATERIALS RECOMMENDED BY THE MANUFACTURER FOR THE SURFACE TO BE CLEANED.
- DURING THE CONSTRUCTION PERIOD, THE MATERIALS TO BE USED IN THE WORK SHALL BE KEPT IN AN ORDERLY MANNER, NEATLY STACKED OR PILED. CLEAN UP FREQUENTLY (AT LEAST WEEKLY) SCRAP MATERIALS, AND DEBRIS CAUSED BY OPERATIONS, TO THE END, THE SITE OF THE WORK SHALL PRESENT A CLEAN AND ORDERLY APPEARANCE AT ALL TIMES.
- PROVIDE FOR THE DISPOSAL OF SCRAP MATERIALS, AND DEBRIS; MAKE NECESSARY ARRANGEMENTS FOR LEGAL DISPOSAL OF SAME OFF THE SITE. PROVIDE TRASH CONTAINERS FOR USE BY TRADES.

SECTION 01 77 00 / CONTRACT CLOSEOUT

RECORD DRAWINGS

- PROVIDE RECORD DRAWINGS WHICH SHALL CLEARLY SHOW DIFFERENCES BETWEEN THE CONTRACT WORK AS DRAWN AND INSTALLED, AS WELL AS WORK ADDED TO THE CONTRACT WHICH IS NOT SHOWN ON THE CONTRACT DRAWINGS. MAINTAIN A SET OF RECORD DRAWINGS AT THE JOB SITE. THESE SHALL BE KEPT CURRENT AND SHALL BE AVAILABLE FOR INSPECTION.
- IN SHOWING CHANGES IN THE WORK, USE THE SAME LEGENDS AS WERE USED ON THE CONTRACT DRAWINGS. INDICATE EXACT LOCATIONS OF DIMENSIONS AND EXACT ELEVATIONS GIVEN IN JOB DATUM, BY DEPTH. GIVE DIMENSIONS FROM A PERMANENT POINT. GIVE ELEVATIONS TO SEWER AND STORM DRAINAGE LINES TO THE INVERT ELEVATION.
- MECHANICAL AND ELECTRICAL RECORD DRAWINGS SHALL INDICATE ROUTING OF PIPING, DUCT WORK, POWER, CONTROL WIRING, LOCATION, AND FUNCTION OF CONTROLS AND WHETHER MANUAL OR AUTOMATIC AND NORMAL AMPERAGE READINGS FOR MOTORS TAKEN AT THE EQUIPMENT UNDER NORMAL LOAD CONDITIONS.
- RECORD DRAWINGS PACKAGE SHALL INCLUDE ONE SET OF FINAL TRUSS SHOP DRAWINGS AND STRUCTURAL CALCULATIONS. RECORD DRAWINGS SHALL CONTAIN THE NAMES, ADDRESSES AND PHONE NUMBER OF THE SUBCONTRACTORS.
- UPON SUBSTANTIAL COMPLETION OF THE WORK, SUBMIT ONE SET OF RECORD DRAWINGS AND OTHER CLOSE-OUT DOCUMENTS TO ARCHITECT FOR REVIEW. UPON RECEIPT OF NOTICE OF COMPLETION OF REVIEW OF THE RECORD DRAWINGS AND DOCUMENTS DELIVER 3 SETS OF RECORD DOCUMENTS TO OWNER.

WARRANTY, MAINTENANCE MANUAL AND OPERATING INSTRUCTIONS

- UPON COMPLETION OF THE INSTALLATION OF WORK, FURNISH ONE BOUND COPY OF WARRANTIES, OPERATING AND MAINTENANCE INSTRUCTIONS AND SPARE PARTS LISTS FOR MATERIALS AND EQUIPMENT, INCLUDING ELECTRICAL AND CONTROL ITEMS.
- OPERATING INSTRUCTIONS SHALL INCLUDE COMPLETE OPERATING SEQUENCE, CONTROL DIAGRAMS, DESCRIPTION OF METHOD OF OPERATING MACHINERY, MACHINE SERIAL NUMBERS, FACTORY ORDER NUMBERS, PARTS LISTS, INSTRUCTION BOOKS, SUPPLIER'S PHONE NUMBERS AND ADDRESSES AND INDIVIDUAL EQUIPMENT GUARANTEES. PARTS LISTS SHALL BE COMPLETE, SHOWING PARTS AND PART NUMBERS FOR READY REFERENCE.
- ASSEMBLE WARRANTY, MAINTENANCE MANUAL AND OPERATING INSTRUCTIONS IN 3-RING BINDERS. LABEL AND INDEX MATERIAL CONTAINED FOR READY REFERENCE. USING THE SECTION NUMBERS LISTED IN THE PROJECT MANUAL. UPON SUBSTANTIAL COMPLETION OF THE WORK, SUBMIT ONE COPY OF THE WARRANTY, MAINTENANCE MANUAL AND OPERATING INSTRUCTIONS TO ARCHITECT.
- SUBMIT REQUIRED GUARANTEES IN WRITING. GUARANTEE PERIODS SHALL BE IN ACCORDANCE WITH THE GENERAL CONDITIONS. IN ADDITION, PROVIDE WRITTEN GUARANTEES OR CERTIFICATES REQUIRED AS SPECIFIED IN THIS SECTION AND THE PROJECT MANUAL.

SECTION 03 30 00 / CAST IN PLACE CONCRETE (REFER TO STRUCTURAL SET)

SECTION 04 21 50 / ADHERED THIN BRICK VENEER UNITES

PART 1 - GENERAL

QUALITY ASSURANCE

- CONTINUOUS INSPECTION: EMPLOY A QUALIFIED MASONRY INSPECTOR FOR CONTINUOUS INSPECTION OF THE MASONRY. WORK ACCEPTANCE BY A STATE OR MUNICIPALITY HAVING A PROGRAM OF EXAMINING AND CERTIFYING MASONRY INSPECTORS WILL BE CONSIDERED ADEQUATE QUALIFICATIONS. THE MASONRY INSPECTOR SHALL BE AT THE SITE DURING ALL MASONRY CONSTRUCTION AND PERFORM THE FOLLOWING DUTIES:
 - REVIEW DRAWINGS AND SPECIFICATIONS AND MEET WITH THE CONTRACTOR TO DISCUSS REQUIREMENTS BEFORE WORK COMMENCES.
 - BEFORE MASONRY WORK COMMENCES, CONTRACTOR AND THE CONTRACTOR'S QUALITY CONTROL REPRESENTATIVE SHALL ATTEND MEETING WITH ENGINEER TO REVIEW THE REQUIREMENTS FOR SURVEILLANCE AND QUALITY CONTROL OF THE MASONRY WORK.
 - CHECK BRAND AND TYPE OF CEMENT, LIME (IF USED), AND SOURCE OF SAND.
 - ENSURE THAT THE BACKING IS CONTINUOUS, ROUGH, AND MOISTURE RESISTANT TO RECEIVE UNITS.
 - OBSERVE FIELD PROPORTIONING OF MORTAR. VISUALLY CHECK AGGREGATE TO DETERMINE UNIFORMITY OF GRADING, CLEANLINESS, AND MOISTURE.
 - ENSURE THAT JOINTS ARE FULL OF MORTAR AND KEPT TIGHT DURING WORK.
 - CONTINUOUSLY OBSERVE PLACING OF GROUT.
 - PERFORM OR SUPERVISE PERFORMANCE OF REQUIRED SAMPLING AND TESTING.
- KEEP COMPLETE RECORD OF INSPECTIONS. REPORT DAILY TO THE CONTRACTOR'S QUALITY CONTROL REPRESENTATIVE THE PROGRESS OF THE MASONRY INSPECTION.
- MOCK-UP:
 - PRIOR TO STARTING CONSTRUCTION OF MASONRY, CONSTRUCT MINIMUM 4 FOOT SQUARE MOCK-UP.
 - USE ACCEPTED MATERIALS, CONTAINING EACH DIFFERENT KIND AND COLOR OF BRICK MASONRY UNITS TO ILLUSTRATE WALL DESIGN.
 - SHOW COLOR RANGE, TEXTURE RANGE, BOND, MORTAR COLOR, JOINT TOOLING, CRITICAL DESIGN



#2001

610 NW CHIPMAN ROAD

LEE'S SUMMIT, MO 64086 PROPOSED LOT 3

PROTOTYPE VERSION 2.00



513 MAIN STREET #300
FORT WORTH TX 76102

SEAL



PERMIT SET: 04/12/2024

CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DIMENSIONAL ERRORS. OMISSIONS OR DISCREPANCIES BEFORE BEGINNING OR FABRICATING ANY WORK. DO NOT SCALE DRAWINGS.

ISSUE	DATE	DESCRIPTION

PROJECT INFORMATION


PROJECT NO:	24-0087
ORIGINAL ISSUE:	06/01/2023
SCALE:	AS NOTED
DRAWN BY:	P. C
CHECKED BY:	J. JEFFERY

SHEET TITLE

SPECIFICATIONS

SHEET NUMBER

A800

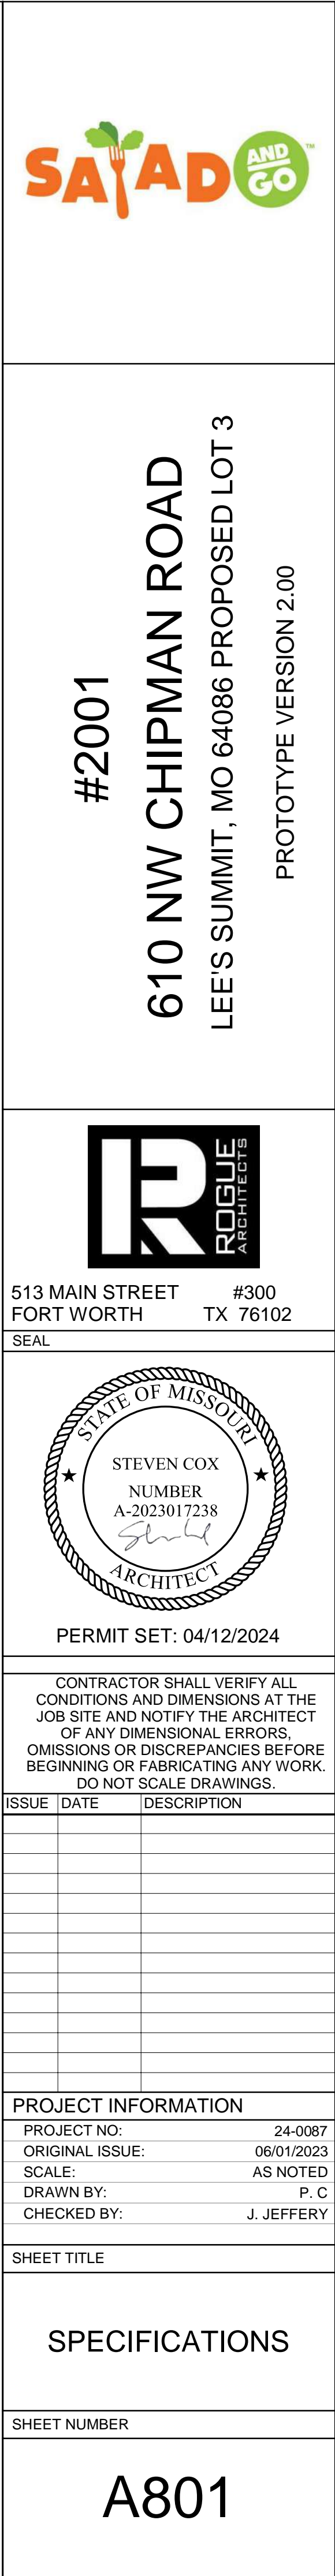

C. INSTALLATION OF THE SIDING. PROTECT SIDING FROM OTHER TRADES		COATS HIGH QUALITY ALKALI RESISTANT 100 PERCENT ACRYLIC OR LATEX, EXTERIOR GRADE TOPCOAT WITHIN 90 DAYS OF INSTALLATION. FOLLOW PAINT MANUFACTURER'S WRITTEN PRODUCT RECOMMENDATION AND WRITTEN APPLICATION INSTRUCTIONS.	AND SELF-ADHERING CAPABILITIES IN A WIDE INSTALLATION TEMPERATURE RANGE. BASIS OF DESIGN: JM TPO SA – FLASHING MEMBRANE A. SERVICEABLE INSTALLATION SUBSTRATE TEMPERATURE: 20°F (-7°C) AND RISING	INDICATED FOR SLOPING TO DRAIN. FABRICATE TO SLOPES INDICATED. BASIS OF DESIGN: TAPERED FESCO EDGE STRIPS.
3.4	MINIMUM 20 GAUGE (1 MM) 3-5/8 INCH (92 MM) C-STUD 16 INCHES MAXIMUM ON CENTER OR 16 GAUGE (1.6 MM) 3-5/8 INCHES (92 MM) C-STUD 24 INCHES (610 MM) MAXIMUM ON CENTER METAL FRAMING COMPLYING WITH LOCAL BUILDING CODES, INCLUDING THE USE OF WATER-RESISTIVE BARRIERS AND/OR VAPOR BARRIERS WHERE REQUIRED. MINIMUM 1-1/2 INCHES (38 MM) FACE AND STRAIGHT, TRUE, OF UNIFORM DIMENSIONS AND PROPERLY ALIGNED. A. INSTALL WATER-RESISTIVE BARRIERS AND CLADDINGS TO DRY SURFACES. B. REPAIR ANY PUNCTURES OR TEARS IN THE WATER-RESISTIVE BARRIER PRIOR TO THE INSTALLATION OF THE SIDING. C. PROTECT SIDING FROM OTHER TRADES.	3.48 FINISH FACTORY PRIMED SIDING WITH A MINIMUM OF ONE COAT OF HIGH QUALITY 100 PERCENT ACRYLIC OR LATEX OR OIL BASED EXTERIOR GRADE PAINT WITHIN 180 DAYS OF INSTALLATION. FOLLOW PAINT MANUFACTURER'S WRITTEN PRODUCT RECOMMENDATION AND WRITTEN APPLICATION INSTRUCTIONS.	2.6 BONDING ADHESIVE: MANUFACTURER'S STANDARD [SOLVENT] [WATER]-BASED BONDING ADHESIVE FOR MEMBRANE, AND [SOLVENT] [WATER]-BASED BONDING ADHESIVE FOR BASE FLASHINGS. BASIS OF DESIGN: [JM MEMBRANE BONDING ADHESIVE (TPO&EPDM)] [JM LVOC MEMBRANE ADHESIVE (TPO & EPDM)] [JM TPO WATER BASED MEMBRANE ADHESIVE] [JM TPO 1168 MEMBRANE ADHESIVE] [JM ALL SEASON SPRAYABLE BONDING ADHESIVE] 1. SERVICEABLE INSTALLATION AMBIENT AIR TEMPERATURE: 25°F AND RISING	2.35 FASTENERS: FACTORY-COATED STEEL FASTENERS AND METAL OR PLASTIC PLATES MEETING CORROSION-RESISTANCE PROVISIONS IN FMG 4470, DESIGNED FOR FASTENING ROOF INSULATION TO SUBSTRATE, AND FURNISHED BY ROOFING SYSTEM MANUFACTURER. BASIS OF DESIGN: [ULTRAFAST FASTENERS AND ULTRAFAST PLATES] [ALL PURPOSE FASTENERS AND ULTRAFAST PLATE] [LITE-DECK FASTENERS AND PLATES]
		PROTECTION 3.49 PROTECT INSTALLED PRODUCTS UNTIL COMPLETION OF PROJECT.	2.7 FLASHING ADHESIVE: MANUFACTURER'S STANDARD [SOLVENT] [WATER]-BASED BONDING ADHESIVE FOR BASE FLASHINGS. BASIS OF DESIGN: [JM MEMBRANE BONDING ADHESIVE (TPO&EPDM)] [JM LVOC MEMBRANE ADHESIVE (TPO & EPDM)] [JM TPO WATER BASED MEMBRANE ADHESIVE] [JM TPO 1168 MEMBRANE ADHESIVE] [JM ALL SEASON SPRAYABLE BONDING ADHESIVE] 1. SERVICEABLE INSTALLATION AMBIENT AIR TEMPERATURE: 25°F AND RISING	2.36 POLYMER FASTENERS: GLASS-REINFORCED NYLON FASTENERS WITH 1/4" SQUARE DRIVE AND 1" HEAD WITH GALVALUME®-COATED 3" METAL STRESS PLATES. DESIGNED TO LOCK INTO THE FASTENER HEAD. FASTENERS DESIGNED FOR FASTENING ROOF INSULATION TO SUBSTRATE AND FURNISHED BY ROOFING SYSTEM MANUFACTURER. BASIS OF DESIGN: POLYMER AUGER FASTENERS AND PLATES
		3.50 TOUCH-UP, REPAIR OR REPLACE DAMAGED PRODUCTS BEFORE SUBSTANTIAL COMPLETION.	2.8 URETHANE ADHESIVE: MANUFACTURER'S TWO COMPONENT NO VOC URETHANE ADHESIVE FORMULATED TO ADHERE FLEECE-BACKED MEMBRANE TO SUBSTRATE. BASIS OF DESIGN: ROOFING SYSTEMS URETHANE ADHESIVE (RSUA)	2.37 URETHANE ADHESIVE: MANUFACTURER'S TWO COMPONENT POLYURETHANE ADHESIVE FORMULATED TO ADHERE INSULATION TO SUBSTRATE. BASIS OF DESIGN: [JM TWO-PART URETHANE INSULATION ADHESIVE (UA)] [JM ONE-STEP FOAMABLE ADHESIVE] [ROOFING SYSTEMS URETHANE ADHESIVE (RSUA)] [JM TWO-PART URETHANE INSULATION ADHESIVE CANISTER]
PREPARATION 3.5 CLEAN SURFACES THOROUGHLY PRIOR TO INSTALLATION.		SECTION 07 54 23 / THERMOPLASTIC POLYOLEFIN (TPO) MEMBRANE ROOFING PART 1 – GENERAL	2.9 URETHANE ADHESIVE: MANUFACTURER'S SELF-CONTAINED TWO-PART, LOW-RISE FOAM ADHESIVE FORMULATED TO ADHERE FLEECE-BACKED MEMBRANES TO SUBSTRATE. BASIS OF DESIGN: JM TWO-PART URETHANE INSULATION ADHESIVE CANISTER	2.38 WOOD NAILER STRIPS: COMPLY WITH REQUIREMENTS IN DIVISION 06 SECTION "MISCELLANEOUS ROUGH CARPENTRY."
3.6	PREPARE SURFACES USING THE METHODS RECOMMENDED BY THE MANUFACTURER FOR ACHIEVING THE BEST RESULT FOR THE SUBSTRATE UNDER THE PROJECT CONDITIONS.	REFERENCES 1.1 ROOFING TERMINOLOGY: REFER TO THE FOLLOWING PUBLICATIONS FOR DEFINITIONS OF ROOFING WORK RELATED TERMS IN THIS SECTION: A. ASTM D 1078 "STANDARD TERMINOLOGY RELATING TO ROOFING AND WATERPROOFING." B. GLOSSARY OF NRCA'S "THE NRCA ROOFING AND WATERPROOFING MANUAL." C. ROOF CONSULTANTS INSTITUTE "GLOSSARY OF BUILDING ENVELOPE TERMS."	2.10 SELF-ADHERED PRIMER: ONE-PART PENETRATING PRIMER SOLUTION TO ENHANCE THE ADHESION OF SELF-ADHERING MEMBRANES. BASIS OF DESIGN: [SA PRIMER] [SA PRIMER LOW VOC]	VAPOR RETARDER 2.39 GLASS-FIBER FELTS: ASTM D 2178, TYPE IV, ASPHALT-IMPREGNATED, GLASS-FIBER FELT. BASIS OF DESIGN: GLASPLY IV.
3.7	INSTALL A WATER-RESISTIVE BARRIER IS REQUIRED IN ACCORDANCE WITH LOCAL BUILDING CODE REQUIREMENTS.	1.2 SHEET METAL TERMINOLOGY AND TECHNIQUES: SMACNA "ARCHITECTURAL SHEET METAL MANUAL."	2.11 ROOFING ASPHALT: ASTM D 312-15, TYPE IV	2.40 TORCH APPLIED SBS VAPOR RETARDER: [ASTM D 6163, GRADE S, TYPE I, GLASS-FIBER-REINFORCED] [ASTM D 6164, GRADE S, TYPE I, POLYESTER-REINFORCED], SBS-MODIFIED ASPHALT SHEET, SMOOTH SURFACED, SUITABLE FOR APPLICATION METHOD SPECIFIED. BASIS OF DESIGN: [DYNABASE HW] [DYNABASE HW] [DYNABASE HW]
3.8	THE WATER-RESISTIVE BARRIER MUST BE APPROPRIATELY INSTALLED WITH PENETRATION AND JUNCTION FLASHING IN ACCORDANCE WITH LOCAL BUILDING CODE REQUIREMENTS.	DESIGN CRITERIA 1.3 GENERAL: INSTALLED ROOFING MEMBRANE SYSTEM SHALL REMAIN WATERTIGHT, AND RESIST SPECIFIED WIND UPLIFT PRESSURES, THERMALLY INDUCED MOVEMENT, AND EXPOSURE TO WEATHER WITHOUT FAILURE.	2.12 LIQUID APPLIED FLASHING: MANUFACTURER'S SINGLE PLY LIQUID AND FABRIC REINFORCED FLASHING SYSTEM CREATED WITH A FLEECE POLYESTER SCRM AND A TWO-COMPONENT POLYURETHANE-BASED LIQUID APPLIED FLASHING MATERIAL, CONSISTING OF A LIQUID RESIN AND A CURING AGENT. BASIS OF DESIGN: JM SP LIQUID FLASHING RESIN AND JM SP LIQUID FLASHING SCRM	2.41 SELF-ADHERED SBS VAPOR RETARDER: [ASTM D 6163, GRADE S, TYPE I, GLASS-FIBER-REINFORCED], SBS-MODIFIED ASPHALT SHEET, SAND SURFACED, SUITABLE FOR APPLICATION METHOD SPECIFIED. BASIS OF DESIGN: DYNAGRIP BASE SD/SA
3.9	INSTALL ENGINEERED FOR CLIMATE HARDIEWRAP WEATHER BARRIER IN ACCORDANCE WITH LOCAL BUILDING CODE REQUIREMENTS.	1.4 MATERIAL COMPATIBILITY: ROOFING MATERIALS SHALL BE COMPATIBLE WITH ONE ANOTHER UNDER CONDITIONS OF SERVICE AND APPLICATION REQUIRED, AS DEMONSTRATED BY ROOFING SYSTEM MANUFACTURER BASED ON TESTING AND FIELD EXPERIENCE.	2.13 LIQUID APPLIED FLASHING PRIMER: MANUFACTURER'S SINGLE PLY LIQUID FLASHING PRIMER. BASIS OF DESIGN: JM SP LIQUID FLASHING TPO AND PVC PRIMER, JM SP LIQUID FLASHING CONCRETE PRIMER, OR JM SP LIQUID FLASHING METAL AND WOOD PRIMER	2.42 ASPHALT PRIMER: ASTM D 41. BASIS OF DESIGN: JM ASPHALT PRIMER
3.10	USE HARDIEWRAP SEAM TAPE AND JOINT AND LAPS.	1.5 INSTALLER SHALL COMPLY WITH CURRENT CODE REQUIREMENTS BASED ON AUTHORITY HAVING JURISDICTION.	2.14 SLIP SHEET: MANUFACTURER'S RECOMMENDED SLIP SHEET, OF TYPE REQUIRED FOR APPLICATION. BASIS OF DESIGN: [JM 3 –OZ POLYESTER SLIPSHEET] [JM POLYESTER MAT PROTECTION SLIPSHEET]	2.43 SELF-ADHERED SBS VAPOR RETARDER: TRI-LAMINATE WOVEN POLYETHYLENE, NONSLIP UV PROTECTED TOP SURFACE, SUITABLE FOR APPLICATION METHOD SPECIFIED. BASIS OF DESIGN: [JM VAPOR BARRIER SAR]
3.11	INSTALL AND HARDIEWRAP FLASHING, HARDIEWRAP FLEX FLASHING.	1.6 WIND UPLIFT PERFORMANCE: ROOFING SYSTEM SHALL MEET THE INTENT OF SYSTEMS THAT HAVE BEEN SUCCESSFULLY TESTED BY A QUALIFIED TESTING AND INSPECTING AGENCY TO RESIST WIND UPLIFT PRESSURE CALCULATED IN ACCORDANCE WITH ASCE 7.	2.15 METAL TERMINATION BARS: MANUFACTURER'S STANDARD PREDRILLED STAINLESS-STEEL OR ALUMINUM BARS, WITH ANCHORS. BASIS OF DESIGN: JM TERMINATION SYSTEMS	2.44 SELF-ADHERED PRIMER: [ONE-PART] [LOW VOC AEROSOL] PENETRATING PRIMER SOLUTION TO ENHANCE THE ADHESION OF SELF-ADHERING MEMBRANES. BASIS OF DESIGN: [SA PRIMER] [SA PRIMER LOW VOC] [JM ALL SEASON SPRAYABLE BONDING ADHESIVE]
INSTALLATION – HARDIEPLANK H210 LAP SIDING, ARTISAN H210 LAP SIDING, AND ARTISAN H210 LAP SIDING WITH LOCK JOINT SYSTEM		1.7 FMG LISTING: ROOFING MEMBRANE, BASE FLASHINGS, AND COMPONENT MATERIALS SHALL COMPLY WITH REQUIREMENTS IN FMG 4450 AND FMG 4470 AS PART OF A ROOFING SYSTEM AND THAT ARE LISTED IN FMG'S "ROOFNAV" FOR CLASS 1 OR NONCOMBUSTIBLE CONSTRUCTION, AS APPLICABLE. IDENTIFY MATERIALS WITH FMG MARKINGS. A. ROOFING SYSTEM SHALL COMPLY WITH ROOFNAV #. B. FIRE/WINDSTORM CLASSIFICATION: CLASS [I] [INCA]-INSERT NUMBER C. HAIL RESISTANCE: [MH] [SH] [VSH].	2.16 FASTENERS: FACTORY-COATED STEEL FASTENERS AND METAL PLATES MEETING CORROSION-RESISTANCE PROVISIONS IN FMG 4470, DESIGNED FOR FASTENING MEMBRANE TO SUBSTRATE, AND ACCEPTABLE TO MEMBRANE ROOFING SYSTEM MANUFACTURER. BASIS OF DESIGN: [HIGH LOAD FASTENERS AND PLATES] [EXTRA HIGH LOAD FASTENERS AND PLATES] [JM PURLIN FASTENERS] [ALL PURPOSE FASTENERS AND HIGH LOAD PLATES]	2.45 POLYETHYLENE VAPOR RETARDER: ASTM D 4397, (6 MILS (0.15 MM)) [10 MILS (0.25 MM)] THICK, MINIMUM, WITH MAXIMUM PERMEANCE RATING OF 0.13 PERM (7.5 NG/PA X S X SQ. M).
3.12	INSTALL MATERIALS IN STRICT ACCORDANCE WITH MANUFACTURER'S INSTALLATION INSTRUCTIONS.	1.8 FIRE-TEST-RESPONSE CHARACTERISTICS: PROVIDE ROOFING MATERIALS WITH THE FIRE-TEST-RESPONSE CHARACTERISTICS INDICATED AS DETERMINED BY TESTING IDENTICAL PRODUCTS PER TEST METHOD BELOW BY UL, FMG, OR ANOTHER TESTING AND INSPECTING AGENCY ACCEPTABLE TO AUTHORITIES HAVING JURISDICTION. MATERIALS SHALL BE IDENTIFIED WITH APPROPRIATE MARKINGS OF APPLICABLE TESTING AND INSPECTING AGENCY. A. EXTERIOR FIRE-TEST EXPOSURE: CLASS [A] [B] [C], UL 790, FOR APPLICATION AND ROOF SLOPES INDICATED.	2.17 POLYMER FASTENERS: GLASS-REINFORCED NYLON FASTENERS WITH 1/4" SQUARE DRIVE AND 1" HEAD WITH GALVALUME®-COATED 2" METAL STRESS PLATES. DESIGNED TO LOCK INTO THE FASTENER HEAD. FASTENERS DESIGNED FOR FASTENING ROOF INSULATION TO SUBSTRATE AND FURNISHED BY ROOFING SYSTEM MANUFACTURER. BASIS OF DESIGN: POLYMER AUGER FASTENERS AND PLATES	BASE-SHEET MATERIALS 2.46 BASE SHEET: ASTM D 4601, TYPE II NON-PERFORATED, ASPHALT-IMPREGNATED AND -COATED, GLASS-FIBER SHEET, DUSTED WITH FINE MINERAL SURFACING ON BOTH SIDES. BASIS OF DESIGN: [PERMAPLY 28] [GLASSBASE PLUS]
3.13	STARTING: INSTALL A MINIMUM 1/4 INCH (6 MM) THICK LATH STARTER STRIP AT THE BOTTOM COURSE OF THE WALL. APPLY PLANKS HORIZONTALLY WITH MINIMUM 1-1/4 INCHES (32 MM) WIDE LAPS AT THE TOP. THE BOTTOM EDGE OF THE FIRST PLANK OVERLAPS THE STARTER STRIP.	1.9 INSTALLER QUALIFICATIONS: QUALIFIED FIRM THAT IS APPROVED, AUTHORIZED, OR LICENSED BY ROOFING SYSTEM MANUFACTURER TO INSTALL MANUFACTURER'S PRODUCT AND WHO IS ELIGIBLE TO RECEIVE THE SPECIFIED MANUFACTURER'S GUARANTEE.	2.18 INDUCTION WELDING PLATE: A ROUND SPECIALLY COATED GALVALUME® PLATE WITH A RECESSED CENTER AND RAISED FLAT BONDING SURFACE SPECIFICALLY DESIGNED FOR INDUCTION WELDING APPLICATION. BASIS OF DESIGN: JM TPO RHINOPLATES	2.47 BASE SHEET: ASTM D 4897, TYPE II, VENTING, NON-PERFORATED, HEAVYWEIGHT, ASPHALT-IMPREGNATED AND -COATED, GLASS-FIBER BASE SHEET WITH COARSE GRANULAR SURFACING OR EMBOSSED VENTING CHANNELS ON BOTTOM SURFACE. BASIS OF DESIGN: VENTSULATION FELT
3.14	ALLOW MINIMUM VERTICAL CLEARANCE BETWEEN THE EDGE OF SIDING AND ANY OTHER MATERIAL IN STRICT ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.	1.10 MANUFACTURER QUALIFICATIONS: QUALIFIED DOMESTIC U.S. OWNED AND BASED MANUFACTURER THAT HAS [UL LISTING] OR ACCREDITED TESTING AGENCY LISTING FOR ROOFING SYSTEM IDENTICAL TO THAT USED FOR THIS PROJECT.	2.19 MISCELLANEOUS ACCESSORIES: PROVIDE ALL ACCESSORIES TO MEET THE ROOFING MANUFACTURER'S GUARANTEE REQUIREMENTS.	2.48 BASE-SHEET FASTENERS: TWIN LEGGED FACTORY-COATED STEEL FASTENERS AND GALVALUME METAL PLATES MEETING CORROSION-RESISTANCE PROVISIONS IN FMG 4470, DESIGNED FOR FASTENING BASE-SHEET TO SUBSTRATE. TESTED BY MANUFACTURER FOR REQUIRED PULLOUT STRENGTH, AND PROVIDED BY THE ROOFING SYSTEM MANUFACTURER. PRODUCT: LIGHTWEIGHT CONCRETE (LWC) BASE SHEET FASTENERS
3.15	ALIGN VERTICAL JOINTS OF THE PLANKS OVER FRAMING MEMBERS.	1.11 TESTING AGENCY QUALIFICATIONS: AN INDEPENDENT TESTING AGENCY WITH THE EXPERIENCE AND CAPABILITY TO CONDUCT THE TESTING INDICATED, AS DOCUMENTED ACCORDING TO ASTM E 329.	WALKWAYS AND SAFETY STRIPS 2.20 FLEXIBLE WALKWAYS: FACTORY-FORMED, NONPOROUS, HEAVY-DUTY, SLIP-RESISTING, SURFACE-TEXTURED WALKWAY PADS SOURCED FROM MEMBRANE ROOFING SYSTEM MANUFACTURER. BASIS OF DESIGN: [JM TPO WALKPAD] [JM TPO SAFETY WALKPAD]	2.49 BASE-SHEET FASTENERS: TUBE, DISK AND LOCKING STAPLE DESIGN, FACTORY-COATED STEEL FASTENERS AND GALVALUME METAL BATTENS MEETING CORROSION-RESISTANCE PROVISIONS IN FMG 4470, DESIGNED FOR FASTENING BASE-SHEET TO SUBSTRATE, TESTED BY MANUFACTURER FOR REQUIRED PULLOUT STRENGTH, AND PROVIDED BY THE ROOFING SYSTEM MANUFACTURER. PRODUCT: ULTRALOK LOCKING IMPACT FASTENER
3.16	BUTT JOINTS MUST NOT FALL WITHIN 4 INCHES (102 MM) OF A STUD. DO NOT NAIL WITHIN 2 INCHES (51 MM) OF THE END OF PLANKS.	1.12 TEST REPORTS: A. ROOF DRAIN AND LEADER TEST OR SUBMIT PLUMBER'S VERIFICATION. B. CORE CUT, IF REQUIRED. C. ROOF DECK FASTENER PULLOUT TEST, IF REQUIRED.	2.21 SAFETY STRIPS: MANUFACTURER'S MINIMUM 65 MILS TOTAL THICKNESS, COMPRISE OF 30 MIL YELLOW NON-REINFORCED TPO MEMBRANE LAMINATED TO 35 MIL WHITE CURED SEAMING TAPE. BASIS OF DESIGN: JM SINGLE PLY SAFETY STRIP 1. EXPOSED FACE COLOR: YELLOW	2.50 BASE SHEET FASTENERS: 32 GAUGE, 1-5/8" DIAMETER TIN CAPS WITH 11-GAUGE ANNULAR RING SHANK NAILS.
3.17	MAINTAIN CLEARANCE BETWEEN SIDING AND ADJACENT FINISHED GRADE.	QUALITY ASSURANCE	COVER BOARD 2.22 POLYISOCYANURATE BOARD: ASTM C 1289, TYPE II, CLASS [1] [2], GRADE [2 (20 PSI)] [3 (25 PSI)]. POLYISOCYANURATE BONDED IN-LINE TO [FIBER GLASS REINFORCED] [INORGANIC COATED GLASS] FACER. BASIS OF DESIGN: [SEPARATOR] [SEPARATOR CGF]	SUBSTRATE BOARD 2.51 GYPSUM BOARD: ASTM C 1177, COATED GLASS-MAT FACER, WATER-RESISTANT GYPSUM SUBSTRATE FOR MECHANICALLY ATTACHED ROOF APPLICATIONS, [1/4 INCH (6 MM)] [1/2 INCH (13 MM)] [5/8 INCH (16 MM)] THICK. BASIS OF DESIGN: [DEXCELL ULTRALIGHT GLASS-MAT ROOF BOARD] [DEXCELL GLASS MAT ROOF BOARD] [DENS DECK ROOF BOARD]
3.18	LOCATE SPLICES AT LEAST ONE STUD CAVITY AWAY FROM WINDOW AND DOOR OPENINGS.	1.13 MOISTURE SURVEY, IF REQUIRED: A. SUBMIT PRIOR TO INSTALLATION, RESULTS OF A NON-DESTRUCTIVE MOISTURE TEST OF ROOF SYSTEM COMPLETED BY APPROVED THIRD PARTY. UTILIZE ONE OF THE APPROVED METHODS: i. INFRARED THERMOGRAPHY ii. NUCLEAR BACKSCATTER	2.23 PERLITE BOARD: ASTM C 728, TYPE 3, COMPOSED OF EXPANDED PERLITE, CELLULOSIC FIBERS, BINDERS AND WATERPROOFING AGENTS WITH TOP SURFACE SEAL COATED. BASIS OF DESIGN: RETROPLUS ROOF BOARD	2.52 GYPSUM BOARD: ASTM C 1177, HEAVY DUTY COATED GLASS-MAT FACER, WATER-RESISTANT GYPSUM SUBSTRATE FOR ADHERED ROOF APPLICATIONS, 5/8 INCH (16 MM) THICK. BASIS OF DESIGN: [DEXCELL FA GLASS MAT ROOF BOARD] [DENS DECK PRIME ROOF BOARD]
3.19	FOR PROPER FASTENER SELECTION AND FASTENING SCHEDULES FOR VARIOUS WIND LOAD REQUIREMENTS AND FRAMING OPTIONS, REFER TO THE TECHNICAL DATA SHEET AT WWW.ASPYREDESIGN.COM .	1.14 SOURCE LIMITATIONS: OBTAIN ALL COMPONENTS FROM THE SINGLE SOURCE ROOFING MANUFACTURER GUARANTEEING THE ROOFING SYSTEM. ALL PRODUCTS USED IN THE SYSTEM SHALL BE LABELED BY THE SINGLE SOURCE ROOFING MANUFACTURER ISSUING THE GUARANTEE	2.24 HIGH-DENSITY POLYISOCYANURATE: ASTM C 1289, TYPE II, CLASS 4, GRADE 1, HIGH-DENSITY POLYISOCYANURATE TECHNOLOGY BONDED IN-LINE TO INORGANIC COATED GLASS FACERS WITH GREATER THAN 80 LBS OF COMPRESSIVE STRENGTH. BASIS OF DESIGN: PROTECTOR HD A. THICKNESS: 1/2 INCH (13 MM) B. R-VALUE: 2.5	2.53 GYPSUM FIBER BOARD: ASTM C 1278, NON-FACED, GYPSUM AND CELLULOSE FIBER SUBSTRATE, [1/4 INCH (6 MM)] [3/8 INCH (9.5 MM)] [1/2 INCH (13 MM)] [5/8 INCH (16 MM)] THICK. BASIS OF DESIGN: SECURCOK GYPSUM-FIBER ROOF BOARD
3.20	FACE NAIL TO SHEATHING.	DELIVERY, STORAGE, AND HANDLING 1.15 DELIVER ROOFING MATERIALS IN ORIGINAL CONTAINERS WITH SEALS UNBROKEN AND LABELED WITH MANUFACTURER'S NAME, PRODUCT BRAND NAME AND TYPE, DATE OF MANUFACTURE, AND DIRECTIONS FOR STORAGE.	2.25 GYPSUM BOARD: ASTM C 1177, COATED GLASS-MAT FACER, WATER-RESISTANT GYPSUM SUBSTRATE FOR MECHANICALLY ATTACHED ROOF APPLICATIONS, [1/4 INCH (6 MM)] [1/2 INCH (13 MM)] [5/8 INCH (16 MM)] THICK. BASIS OF DESIGN: [SECURCOK ULTRALIGHT GLASS-MAT ROOF BOARD] [DEXCELL GLASS MAT ROOF BOARD] [DENS DECK ROOF BOARD]	2.54 HIGH-DENSITY POLYISOCYANURATE: ASTM C 1289, TYPE II, CLASS 4, GRADE 1, HIGH-DENSITY POLYISOCYANURATE TECHNOLOGY BONDED IN-LINE TO INORGANIC COATED GLASS FACERS WITH GREATER THAN 80 LBS OF COMPRESSIVE STRENGTH. BASIS OF DESIGN: PROTECTOR HD 1. THICKNESS: 1/2 INCH (13 MM) 2. R-VALUE: 2.5
3.21	LOCATE SPLICES AT LEAST 12 INCHES (305 MM) AWAY FROM WINDOW AND DOOR OPENINGS.	1.16 STORE LIQUID MATERIALS IN THEIR ORIGINAL UNDAMAGED CONTAINERS IN A CLEAN, DRY, PROTECTED LOCATION AND WITHIN THE TEMPERATURE RANGE REQUIRED BY ROOFING SYSTEM MANUFACTURER.	ROOF INSULATION – FLUTE FILLER 2.26 GYPSUM BOARD: ASTM C 1177, HEAVY DUTY COATED GLASS-MAT FACER [WITH EONIC PRIMED FACE], WATER-RESISTANT GYPSUM SUBSTRATE FOR ADHERED ROOF APPLICATIONS, [1/4 INCH (6 MM)] [1/2 INCH (13 MM)] [5/8 INCH (16 MM)] THICK. BASIS OF DESIGN: [DEXCELL FA GLASS MAT ROOF BOARD] [DENS DECK PRIME ROOF BOARD]	EDGE METAL COMPONENTS 2.55 EXPANSION JOINTS: PROVIDE FACTORY FABRICATED WEATHERPROOF, EXTERIOR COVERS FOR EXPANSION JOINT OPENINGS CONSISTING OF FLEXIBLE RUBBER MEMBRANE, SUPPORTED BY A CLOSED CELL FOAM TO FORM FLEXIBLE BELLOWES, WITH TWO METAL FLANGES, ADHESIVELY AND MECHANICALLY COMBINED TO THE BELLOWES BY A BIFURCATION PROCESS. PROVIDE PRODUCT FROM SINGLE-SOURCE ROOFING SYSTEM SUPPLIER THAT IS INCLUDED IN THE NO DOLLAR LIMIT GUARANTEE. BASIS OF DESIGN: [EXPAND-O-FLASH] [EXPAND-O-GARD]
INSTALLATION – HARDIETRIM H210 BOARDS		1.17 PROTECT ROOF INSULATION MATERIALS FROM PHYSICAL DAMAGE AND FROM DETERIORATION BY SUNLIGHT, MOISTURE, SOILING, AND OTHER SOURCES. COMPLY WITH INSULATION MANUFACTURER'S WRITTEN INSTRUCTIONS FOR HANDLING, STORING, AND PROTECTING DURING INSTALLATION.	2.27 GYPSUM FIBER BOARD: ASTM C 1278, NON-FACED, GYPSUM AND CELLULOSE FIBER SUBSTRATE, [1/4 INCH (6 MM)] [3/8 INCH (9.5 MM)] [1/2 INCH (13 MM)] [5/8 INCH (16 MM)] THICK. BASIS OF DESIGN: SECURCOK GYPSUM-FIBER ROOF BOARD	2.56 COPING SYSTEM: MANUFACTURER'S FACTORY FABRICATED COPING CONSISTING OF A BASE PIECE AND A SNAP-ON CAP. PROVIDE PRODUCT FROM SINGLE-SOURCE ROOFING SYSTEM SUPPLIER THAT IS INCLUDED IN THE NO DOLLAR LIMIT GUARANTEE. BASIS OF DESIGN: [PRESTO-LOCK COPING] [PRESTO-LOCK GOLD COPING]
3.22	INSTALL MATERIALS IN STRICT ACCORDANCE WITH MANUFACTURER'S INSTALLATION INSTRUCTIONS.	1.18 HANDLE AND STORE ROOFING MATERIALS AND PLACE EQUIPMENT IN A MANNER TO AVOID PERMANENT DEFLECTION OF DECK.	ROOF INSULATION 2.28 GENERAL: PREFORMED ROOF INSULATION BOARDS THAT COMPLY WITH REQUIREMENTS AND REFERENCED STANDARDS, SELECTED FROM MANUFACTURER'S STANDARD SIZES AND OF THICKNESSES INDICATED.	2.57 FASCIA SYSTEM: MANUFACTURER'S FACTORY FABRICATED FASCIA CONSISTING OF A BASE PIECE AND A SNAP-ON COVER. PROVIDE PRODUCT FROM SINGLE-SOURCE ROOFING SYSTEM SUPPLIER THAT IS INCLUDED IN THE NO DOLLAR LIMIT GUARANTEE. BASIS OF DESIGN: [PRESTO-TITE FASCIA] [PRESTO-TITE EDGE ONE FASCIA]
3.23	INSTALL OVER BRACED WOOD. SEE GENERAL FASTENING REQUIREMENTS. IRREGULARITIES IN FRAMING AND SHEATHING CAN MIRROR THROUGH THE FINISHED APPLICATION. CORRECT IRREGULARITIES BEFORE INSTALLING SIDING.	PROJECT CONDITIONS 1.19 WEATHER LIMITATIONS: PROCEED WITH INSTALLATION ONLY WHEN CURRENT AND FORECASTED WEATHER CONDITIONS PERMIT ROOFING SYSTEM TO BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S WRITTEN INSTRUCTIONS AND GUARANTEE REQUIREMENTS.	2.29 POLYISOCYANURATE BOARD INSULATION: ASTM C 1289, TYPE II, CLASS 1, GRADE 2, PRODUCT: ENRGY 3 A. PROVIDE METAL ROOF FLUTE FILLER INSULATION PACKAGE WITH THICKNESS TO FILL FLUTES THE HEIGHT OF THE STANDING SEAM.	2.58 METAL EDGE SYSTEM: MANUFACTURER'S FACTORY FABRICATED METAL EDGE SYSTEM USED TO TERMINATE THE ROOF AT THE PERIMETER OF THE STRUCTURE. PROVIDE PRODUCT FROM SINGLE-SOURCE ROOFING SYSTEM SUPPLIER THAT IS INCLUDED IN THE NO DOLLAR LIMIT GUARANTEE. BASIS OF DESIGN: [PRESTO-WELD DRIP EDGE] [JM TPO-COATED METAL]
3.24	A WATER-RESISTIVE BARRIER (WRB) IS REQUIRED IN ACCORDANCE WITH LOCAL BUILDING CODE REQUIREMENTS. THE WATER-RESISTIVE BARRIER MUST BE APPROPRIATELY INSTALLED WITH PENETRATION AND JUNCTION FLASHING IN ACCORDANCE WITH LOCAL BUILDING CODE REQUIREMENTS. JAMES HARDIE WILL ASSUME NO RESPONSIBILITY FOR WATER INFILTRATION. JAMES HARDIE DOES MANUFACTURE HARDIEWRAP WEATHER BARRIER, A NON-WOVEN NON-PERFORATED HOUSEWRAP, WHICH COMPLIES WITH BUILDING CODE REQUIREMENTS.	PART 2 – PRODUCTS THERMOPLASTIC POLYOLEFIN ROOFING MEMBRANE – TPO 2.1 FABRIC-REINFORCED THERMOPLASTIC POLYOLEFIN SHEET: ASTM D 6878, UNIFORM, FLEXIBLE SHEET FORMED FROM A THERMOPLASTIC POLYOLEFIN, INTERNALLY FABRIC OR SCRM REINFORCED. BASIS OF DESIGN: JM TPO A. MEMBRANE THICKNESS: 60MILS B. EXPOSED FACE COLOR: [WHITE]	INSULATION ACCESSORIES 2.33 GENERAL: ROOF INSULATION ACCESSORIES RECOMMENDED BY INSULATION MANUFACTURER FOR INTENDED USE AND COMPATIBLE WITH MEMBRANE ROOFING.	2.59 METAL FLASHING SHEET: METAL FLASHING SHEET IS SPECIFIED IN DIVISION 07 SECTION "SHEET METAL FLASHING AND TRIM."
3.25	WHEN INSTALLING HORIZONTALLY, A WRB WITH MIN. 90 PERCENT DRAINAGE EFFICIENCY SHALL BE USED.	2.2 SELF-ADHERED MEMBRANE THICKNESS: 60 MILS (1.52 MM), NOMINAL A. EXPOSED FACE COLOR: WHITE B. SERVICEABLE INSTALLATION TEMPERATURE: 20°F (-7°C) AND ABOVE.	2.34 PROVIDE SADDLES, CRICKETS, TAPERED EDGE STRIPS, AND OTHER INSULATIONS SHAPES WHERE	EXAMINATION 3.1 EXAMINE SUBSTRATES, AREAS, AND CONDITIONS FOR COMPLIANCE WITH THE REQUIREMENTS AFFECTING PERFORMANCE OF ROOFING SYSTEM. GENERAL: 3.2 VERIFY THAT ROOF OPENINGS AND PENETRATIONS ARE IN PLACE AND SET AND BRACED AND THAT ROOF DRAINS ARE SECURELY CLAMPED IN PLACE. 3.3 VERIFY THAT WOOD CANTS, BLOCKING, CURBS, AND NAILERS ARE SECURELY ANCHORED TO ROOF DECK AT PENETRATIONS AND TERMINATIONS AND THAT NAILERS MATCH THICKNESSES OF INSULATION. STEEL DECKS: 3.4 VERIFY THAT SURFACE PLANE FLATNESS AND FASTENING OF STEEL ROOF DECK COMPLIES WITH
3.26	ADJACENT FINISHED GRADE MUST SLOPE AWAY FROM THE BUILDING IN ACCORDANCE WITH LOCAL BUILDING CODES - TYPICALLY A MINIMUM OF 6 IN. IN THE FIRST 10 FT.	AUXILIARY ROOFING MATERIALS – SINGLE PLY 2.3 GENERAL: AUXILIARY MATERIALS RECOMMENDED BY ROOFING SYSTEM MANUFACTURER FOR INTENDED USE AND COMPATIBLE WITH MEMBRANE ROOFING. A. LIQUID-TYPE AUXILIARY MATERIALS SHALL MEET VOC LIMITS OF AUTHORITIES HAVING JURISDICTION.		
3.27	DO NOT USE HARDIE ARCHITECTURAL PANELS IN FASCIA OR TRIM APPLICATIONS.	2.4 SHEET FLASHING: MANUFACTURER'S INTERNALLY REINFORCED OR SCRM REINFORCED. BASIS OF DESIGN: JM TPO 60 MIL		
3.28	DO NOT INSTALL THAT PRODUCT REMAINS IN CONTACT WITH STANDING WATER.	2.5 SHEET FLASHING (SELF-ADHERED): 60 MIL (1.5 MM) THICK, MANUFACTURER'S INTERNALLY REINFORCED OR SCRM REINFORCED WITH WELDABLE SELVAGE EDGES ON EACH SIDE OF ROLL, ONE ENCAPSULATED EDGE		
3.29	FOR LARGER PROJECTS WHERE THE SPAN OF THE WALL IS SIGNIFIC			

SECTION 07 65 00 / FLASHING

SUBMIT SHOP DRAWINGS COMPLYING WITH SECTION 01 33 00 FOR WORK IN THIS SECTION. DRAWINGS SHALL INDICATE TYPE OF MATERIAL, GAUGE, DIMENSIONS, FASTENING AND ANCHORING METHODS, JOINTS, AND PROVISIONS OF EXPANSION AND CONTRACTION

- 1.1STANDARDS: QUALITY, PROCEDURES AND METHODS RECOMMENDED BY SMACNA ARCHITECTURAL SHEET METAL MANUAL.
- 1.2COORDINATE TRADE JURISDICTION WITH RESPECT TO INSTALLING SHEET METAL ITEMS IN CONJUNCTION WITH THE ROOFING. REFER TO MEMBRANE ROOFING SECTION OR ROOFING MATERIAL SECTIONS FOR INSTALLATION PROCEDURES FOR ROOFING RELATED ITEMS.
- 1.3PROVIDE THE SHEET METAL ITEMS IN SUFFICIENT TIME TO AVOID DELAYS TO THE CONSTRUCTION PROGRESS.
- 1.4INVESTIGATE THE REQUIREMENTS OF THE ROOFING MANUFACTURER AS RELATED TO SHEET METAL ITEMS. QUALITY AND INSTALLATION SHALL CONFORM TO THE ROOFING MANUFACTURER'S REQUIREMENTS, TO PERMIT THE ISSUANCE OF THE REQUIRED GUARANTEES.
- 1.5TO BE PAINTED IN FIELD.

MATERIALS

- 2.1GALVANIZED SHEET METAL: ASTM A 525, GAUGES AS INDICATED (24-GAUGE MINIMUM). SOLDER: ASTM B 32, 50% TIN AND 50% LEAD, USED WITH ROSIN FLUX.
- 2.2PLASTIC CEMENT: FS SS C 153, TYPE 1.
- 2.3SEALANT: ASTM C 920 TYPE M, GRADE NS, CLASS 25, USE NT,M,A,O.
- 2.4REGLETS 8 COUNTERFLASHING: AS MANUFACTURED BY FRY REGLET CORPORATION, TYPE ST, MA, CO, SM.
- 2.5SOFFIT LOUVER STRIPS: AS MANUFACTURED BY AMPCOR, ANDERSON METAL PRODUCTS, INC., TAYLORSVILLE, MISSISSIPPI, TYPE SAL 8, 2 3/4" WIDTH.
- 2.6NAILS, SCREWS, RIVETS: SAME MATERIAL AS FLASHING SHEET, OR AS RECOMMENDED BY MANUFACTURER OF FLASHING SHEET.
- 2.7CLEATS: METAL AND GAUGE AS SHEETS BEING ANCHORED, 2" WIDE, PUNCHED FOR 2 ANCHORS.
- 2.8ROOFING FELT: ASTM D 226, 15 POUND TYPE OR 30 POUND TYPE.
- 2.9BITUMINOUS COATING: FS TT C 494 OR SSPC PAINT 12, DRY FILM 15 MILS PER COAT.

EXECUTION

- 3.1SURFACES TO RECEIVE SHEET METAL SHALL BE SOUND, CLEAN, DRY, AND FREE FROM PROJECTIONS OR OTHER DEFECTS THAT WOULD AFFECT THE APPLICATION. REPORT ANY UNSATISFACTORY SURFACES TO THE ARCHITECT.
- 3.2WHERE DISSIMILAR MATERIALS ABUT, PROVIDE PROPER SEPARATION OR PROTECTION TO MINIMIZE THE POSSIBILITY OF GALVANIC ACTION.
- 3.3PROVIDE FOR THERMAL EXPANSION OF RUNNING TRIM, FLASHING, EXPANSION JOINTS, AND OTHER ITEMS EXPOSED FOR MORE THAN 15 FEET CONTINUOUS LENGTH. MAINTAIN A WATERTIGHT INSTALLATION AT EXPANSION SEAMS. LOCATE EXPANSION SEAMS AS SHOWN, OR IF NOT SHOWN, AT THE FOLLOWING MAXIMUM SPACING FOR EACH GENERAL FLASHING USE:
- 3.4FLASHING, EXPANSION JOINTS, GRAVEL STOPS, AND TRIM: AT 10 FOOT INTERVALS, AND 24" ON EACH SIDE OF GORNERS AND INTERSECTIONS.
- 3.5SEALANT TYPE EXPANSION JOINTS: WHERE SEALANT FILLED EXPANSION JOINTS ARE USED, EMBED THE HOOKED FLANGES OF THE JOINT MEMBERS NOT LESS THAN 1" INTO THE SEALANT. FORM JOINTS TO COMPLETELY CONCEAL THE SEALANT. WHEN AMBIENT TEMPERATURE IS MODERATE AT THE TIME OF INSTALLATION (40 TO 70 F.), SET JOINT MEMBERS FOR 50% MOVEMENT EITHER WAY. ADJUST SETTING PROPORTIONATELY FOR INSTALLATION AT HIGHER AMBIENT TEMPERATURES. DO NOT INSTALL SEALANT TYPE JOINTS AT TEMPERATURES BELOW 400 F. INSTALLATION OF SEALANT IS SPECIFIED IN SECTION 07900.
- 3.6FABRICATE AND INSTALL SHEET METAL WITH LINES, ARISE, AND ANGLES SHARP AND TRIM, AND PLANE SURFACES FREE FROM OBJECTIONAL WAVE, WARP OR BUCKLE. HEM EXPOSED EDGES TO FORM A 1/2" WIDE HEM ON THE SIDE CONCEALED FROM VIEW.
- 3.7FORMING, ANCHORING, EXPANSION AND CONTRACTION DETAILS, SHALL CONFORM TO THE CURRENT EDITION OF THE SMACNA MANUAL.

SOLDERING

- 4.1EXCEPT WHERE OTHER METHODS OF JOINING ARE INDICATED OR SPECIFIED, SOLDER JOINTS, AND CONNECTIONS OF SHEET METAL WORK.
- 4.2REMOVE GREASE AND DIRT FROM METAL SURFACES TO BE JOINED.
- 4.3REMOVE FLUX RESIDUE BY SCRUBBING, NEUTRALIZING WITH AMMONIA OR A 5 10% SOLUTION OF WASHING SODA AND FOLLOWED BY A CLEAR WATER RINSE.
- 4.4ASSEMBLE PARTS AND SOLDER USING REGULAR NON-CORROSIVE ROSIN FLUX. HEAT METAL THOROUGHLY, TO COMPLETELY SWEAT SOLDER THROUGH FULL CONTACT AREA.

REGLETS

- 5.1PROVIDE WATERTIGHT REGLETS IN MASONRY, CONCRETE OR STUCCO TO RECEIVE CAP FLASHINGS.

COUNTERFLASHING

- 6.1PROVIDE METAL COUNTERFLASHING AT TOP EDGES OF BUILT-UP BASE FLASHINGS AND AT OTHER LOCATIONS INDICATED.
- 6.2FORM FLASHING IN 8 OR 10 FOOT LENGTHS, EXCEPT WHERE SHORTER PIECES ARE REQUIRED; LAP END JOINTS A MINIMUM OF 3". DO NOT SOLDER OR WELD JOINTS. MAKE FLASHING CONTINUOUS AT ANGLES. COUNTERFLASHING SHALL OVERLAP BASE FLASHING A MINIMUM OF 4", UNLESS OTHERWISE INDICATED.
- 6.3WHERE COUNTERFLASHING TERMINATES IN REGLETS, FASTEN FLASHING WITH LEAD WEDGES EVERY 12". FILL REGLETS CONTINUOUSLY WITH SEALING COMPOUND AS HEREINBEFORE SPECIFIED WHEN PREFABRICATED COUNTERFLASHING AND REGLET SYSTEM IS USED. FORM THE UPPER EDGE OF COUNTERFLASHING WITH AN APPROVED SNAP LOCK FLANGE TO ENGAGE THE REGLET RECEIVER AND TO PROVIDE A SPRING ACTION AT BOTTOM EDGE AGAINST THE BUILT-UP FLASHING.

COPINGS AND METAL CAP FLASHING

- 7.1COVER TOP OF PARAPET WALLS WHERE INDICATED WITH 24 GAUGE GALVANIZED METAL COPING FORMED TO DESIGN SHOWN. BEFORE APPLYING METAL, COVER TOP OF WALL OR WOOD BLOCKING WITH ASPHALT FELT. FABRICATE THE CROSS JOINTS BETWEEN COPING SHEETS WITH A 3/16" EXPANSION JOINT BETWEEN SHEETS AND A 6" WIDE BACK UP PLATE OR COVER PLATE FORMED TO PROFILE OF COPING. FILL SPACE BETWEEN COPING AND PLATES WITH SYNTHETIC RUBBER SEALANT. THE METHOD OF FORMING CROSS-JOINTS IN COPING SHALL BE IN ACCORDANCE WITH DETAILS ON PLATE 76, CHART 12, J2, J4, J5 OF THE SMACNA ARCHITECTURAL SHEET METAL MANUAL.
- 7.2EXTEND FRONT EDGE OF COPING COVERING DOWN OVER THE LOCK INTO A PREVIOUSLY PLACED CONTINUOUS EDGE STRIP. SECURE EDGE STRIPS WITH NAILS SPACED 12" APART. JOIN REAR EDGE OF COPING COVERING TO ADJACENT FLASHINGS AS INDICATED. MITER CORNERS OF COPING, SEAM AND SEAL WITH SOLDER.

SECTION 07 72 00 / ROOF ACCESSORIES

- 1.1SPECIFICATION IS BASED ON PRODUCTS MANUFACTURED BY ROOF PRODUCTS, INC.
- 1.2COMPARABLE PRODUCTS MEETING OR EXCEEDING SPECIFICATION REQUIREMENTS AS MANUFACTURED BY THYBAR CORP OR ROOF PRODUCTS AND SYSTEMS CORP, ARE ACCEPTABLE.

ROOF CURBS (STRUCTURAL)

- 2.1CURBS SHALL BE MODEL RPC-1 OF BOX SE ATION DESIGN, 18-GAUGE GALVANIZED STEEL CONSTRUCTION, CONTINUOUS MITERED AND WELDED CORNER SEAMS, INTEGRAL BASE PLATE, FACTORY INSTALLED WOOD NAILER, INSULATED WITH 1 1/2" THICK RIGID FIBERGLASS BOARD INSULATION, EQUIPMENT SUPPORTS.
- 2.2EQUIPMENT SUPPORTS SHALL BE MODEL RPES-1 OF MONOLITHIC CONSTRUCTION, 18-GAUG E GALVANIZED STEEL, CONTINUOUS MITERED AND WELDED CORNER SEAMS, INTEGRAL BASE PLATE, AND FACTORY INSTALLED 2 X 4 WOOD NAILER, AND 18-GAUGE GALVANIZED STEEL COUNTER FLASHING.

EXPANSION JOINT CURBS (SINGLE SIDE)

- 3.1CURBS SHALL BE MODEL RPCL-1 10" HIGH, MONOLITHIC CONSTRUCTED OF 20-GAUGE GALVANIZED STEEL WITH WELDED COMPONENTS, FULL MITERED CORNERS, FACTORY INSTALLED 1/2" THICK RIGID FIBERGLASS BOARD INSULATION, ATTACH ED PRESSURE-TREATED WOOD 2X2 NAILER AND 2" MOUNTING FLANGE.

PIPE SEAL

- 4.1PIPE SEALS SHALL BE 3" OR 6" CONSISTING OF A SPUN ALUMINUM BASE HAVING A MINIMUM 5" ROOF SURFACE FLANGE, A STEPPED PVC BOOT TO BE SECURED TO THE BASE AND THE PIPE WITH ADJUSTABLE STAINLESS-STEEL CLAMPS AS FURNISHED. USE AT ROOF PIPE PENETRATIONS UP TO 6" OD, EXCEPT PLUMBING STALKS.

PIPE CURB ASSEMBLIES (VERTICAL)

- 5.1PIPE CURB ASSEMBLIES SHALL BE MODEL RPVP-3 WITH CURB CONSTRUCTED OF 18-GAUGE GALVANIZED STEEL WITH CONTINUOUS WELDED CORNER SEAMS, FACTORY INSTALLED 2X2 PRESSURE-TREATED WOOD NAILER AND SHALL BE INSULATED WITH 1 1/2" THICK RIGID FIBERGLASS BOARD INSULATION, COUNTER FLASHING CAP SHALL BE 20-GAUGE GALVANIZED STEEL INCLUDING GRADUATED STEP PVC BOOTS, ADJUSTABLE STAINLESS STEEL CLAM PS AND CAP FASTENING SCREWS, EACH ASSEMBLY TO INCLUDE CURB, CAP, BOOTS AND CLAMP.

SECTION 07 92 00 / JOINT SEALANTS

GUARANTEE

- 1.1CAULKING AND SEALANT SHALL RECEIVE A WRITTEN 5 YEAR GUARANTEE.

JOB CONDITIONS

- 2.1DO NOT APPLY SEALANTS IN TEMPERATURES OR ON MATERIALS BELOW 40° F. DO NOT APPLY SEALANTS TO SURFACES THAT ARE WET. CAULK JOINTS BEFORE FINAL COAT OF PAINT OR BEFORE APPLICATION OF COLOR OR STAIN WATERPROOFING COMPOUNDS.

MATERIALS

- 3.1SEALANT SHALL BE SILICONE BASE CONFORMING TO FS TT S 001543, TYPE II, AND CLASS A, AS MANUFACTURED BY DOW CORNING CORPORATION OR GENERAL ELECTRIC COMPANY. COLOR OF SEALANT SHALL BE AS SELECTED. SEALANTS SHALL CONFORM TO THE FOLLOWING:
A. TRAFFIC JOINTS AND HORIZONTAL JOINTS: ASTM TYPE S GRADE P, CLASS 25, USE T
- 3.2OTHER JOINTS: ASTM TYPE S, GRADE NS, CLASS 25, USE NT, M, A, O
- 3.3SEALANT SHALL BE ACRYLIC LATEX BASE CONFORMING TO ASTM C834. COLORS SHALL BE AS SELECTED.
- 3.4SEALANTS USED ON EXTERIOR OF PROJECT ARE TO BE SINGLE COMPONENT POLYURETHANE BASE, INCLUDING INSIDE SURFACE OF EXTERIOR JOINTS.
- 3.5SEALANTS USED ON INTERIOR OF PROJECT ARE TO BE ACRYLIC LATEX BASE.
- 3.6SEALANTS IN FOOD SERVICE, FOOD PREPARATION AND FOOD STORAGE AREAS ARE TO BE SILICONE OR POLYURETHANE BASE.
- 3.7PRIMER, OF A TYPE COMPATIBLE WITH EACH SPECIFIC SEALANT AS RECOMMENDED BY THE SEALANT MANUFACTURER. THE PRIMER SHALL HAVE BEEN TESTED FOR NON-STAINING CHARACTERISTICS.
- 3.8BACK UP MATERIALS AND PREFORMED JOINT FILLERS SHALL BE NON-STAINING, COMPATIBLE WITH SEALANT AND PRIMER, AND OF A RESILIENT NATURE, SUCH AS CLOSED CELL POLYETHYLENE ROD, GLOSED CELL URETHANE OR NEOPRENE ROD, OR ELASTOMERIC TUBING OR ROD (NEOPRENE, BUTYL, OR EPDM). MATERIALS IMPREGNATED WITH OIL, BITUMEN OR SIMILAR MATERIALS SHALL NOT BE USED. SIZE AND SHAPE SHALL BE AS RECOMMENDED BY SEALANT MANUFACTURER. SEALANT SHALL NOT ADHERE TO BACK UP MATERIAL.
- 3.9BOND BREAKERS (WHERE REQUIRED;) SHALL BE POLYETHYLENE TAPE AS RECOMMENDED BY MANUFACTURER OF SEALANT.
- 3.10SOLVENTS, CLEANING AGENTS AND ACCESSORY MATERIALS SHALL BE AS RECOMMENDED BY SEALANT MANUFACTURER.

EXECUTION

- 4.1APPLY SEALANT UNDER PRESSURE WITH HAND OR POWER ACTUATED GUN. GUN SHALL HAVE NOZZLE OF PROPER SIZE AND PROVIDE SUFFICIENT PRESSURE TO COMPLETELY FILL JOINTS AS DESIGNED. JOINT SURFACES SHALL BE TOOLED TO PROVIDE THE CONTOUR AS INDICATED.

PREPARATION:

- 5.1THOROUGHLY CLEAN JOINTS, REMOVING FOREIGN MATTER SUCH AS DUST, OIL, GREASE, WATER, SURFACE DIRT AND FROST. SEALANT MUST BE APPLIED TO THE BASE SURFACE. PREVIOUSLY APPLIED PAINT OR PRIMER MUST BE ENTIRELY REMOVED.
- 5.2POROUS MATERIALS SUCH AS CONCRETE OR MASONRY SHALL BE CLEANED WHERE NECESSARY BY GRINDING, BLAST CLEANING, MECHANICAL ABRADING, ACID WASHING OR COMBINATION OF THESE METHODS TO PROVIDE A CLEAN, SOUND BASE SURFACE FOR SEALANT ADHESION. LAITANCE SHALL BE REMOVED BY ACID WASHING, GRINDING OR MECHANICAL ABRADING. FORM OILS SHALL BE REMOVED BY BLAST CLEANING.
- 5.3LOOSE PARTICLES PRESENT OR RESULTING FROM GRINDING, ABRADING OR BLAST CLEANING SHALL BE REMOVED BY BLOWING OUT JOINTS WITH OIL FREE COMPRESSED AIR OR VACUUMING PRIOR TO APPLICATION OF PRIMER OR SEALANT.
- 5.4NON-POROUS SURFACES, SUCH AS METAL AND GLASS, SHALL BE CLEANED EITHER MECHANICALLY OR CHEMICALLY. PROTECTIVE COATINGS ON METALLIC SURFACES SHALL BE REMOVED BY A SOLVENT THAT LEAVES NO RESIDUE. SOLVENT SHALL BE USED WITH CLEAN CLOTHS. DO NOT ALLOW SOLVENT TO AIR DRY WITHOUT WIPING.
- 5.5FOR JOINTS IN CONCRETE OR MASONRY: DEPTH OF THE SEALANT MAY BE EQUAL TO THE WIDTH IN JOINTS UP TO 1/4" WIDE. FOR JOINTS 1/2" TO 1" WIDE: DEPTH SHALL BE 1/2". FOR EXPANSION AND OTHER JOINTS 1" TO 2" WIDE, DEPTH SHALL NOT BE GREATER THAN 1/2 THE APPLIED SEALANT WIDTH. FOR JOINTS EXCEEDING 2" IN WIDTH, DEPTH SHALL BE AS DIRECTED BY SEALANT MANUFACTURER.
- 5.6FOR JOINTS IN METAL, GLASS, AND OTHER NON-POROUS SURFACES: SEALANT DEPTH SHALL BE A MINIMUM OF 1/2 THE APPLIED SEALANT WIDTH AND SHALL NOT EXCEED THE SEALANT WIDTH.
- 5.7JOINTS TO RECEIVE SEALANT, BACK UP MATERIAL OR PRE-FORMED JOINT FILLER SHALL BE CLEANED, RAKED TO FULL WIDTH AND DEPTH AS REQUIRED. JOINTS SHALL BE OF SUFFICIENT WIDTH AND DEPTH TO ACCOMMODATE SPECIFIED BACK UP MATERIAL OR PREFORMED JOINT FILLER AND SEALANT.
- 5.8APPLICATION: INSTALL BACK UP MATERIAL OR JOINT FILLER, OF TYPE AND SIZE SPECIFIED, AT PROPER DEPTH TO PROVIDE SEALANT DIMENSIONS. BACK UP MATERIAL SHALL BE OF SUITABLE SIZE AND SHAPE, AND COMPRESSED 25% TO 50% TO FIT JOINTS AS REQUIRED. SEALANT SHALL NOT BE APPLIED WITHOUT BACK UP MATERIAL OR BOND BREAKER STRIP, WHEN USING BACK UP TUBE AVOID LENGTHWISE STRETCHING.
- 5.9APPLY MASKING TAPE, WHERE REQUIRED, IN CONTINUOUS STRIPS IN ALIGNMENT WITH JOINT EDGE.
- 5.10PRIME SURFACES WITH PRIMER WHERE RECOMMENDED BY MANUFACTURER. FOLLOW MANUFACTURER'S INSTRUCTIONS REGARDING MIXING, SURFACE PREPARATION, PRIMING, APPLICATION LIFE, AND APPLICATION PROCEDURE.
- 5.11CLEAN ADJACENT SURFACES OF SEALANT AS WORK PROGRESSES. USE SOLVENT OR CLEANING AGENT AS RECOMMENDED BY MANUFACTURER.

SCHEDULE

- 6.1PROVIDE CAULKING AT FOLLOWING LOCATIONS INTERIOR AND EXTERIOR: (THIS SGCHEDULE IS NOT TO BE CONSTRUED TO BE COMPLETE. PROVIDE CAULKING AT OTHER AREAS AS REQUIRED.)
A. CONTROL JOINTS IN MASONRY AND CONCRETE SURFACES.
B. PERIMETER OF WINDOW AND DOOR FRAMES.
C. PERIMETER OF LOUVERS AND GRILLES.
D. PERIMETER OF ALUMINUM SECTIONS AND BELOW SILL MEMBERS.
E. TOP EDGE OF REGLET AND COUNTER FLASHING ASSEMBLIES.
F. TOP OF EDGE OF ELASTOMERIC FLOOR FINISH AND CONCRETE CURBS.
G. AT INTERIOR PARTITIONS BULKING IS REQUIRED AT JOINTS BETWEEN DISSIMILAR MATERIALS WHERE THE JOINT WIDTH EXCEEDS 1/16".

SANITARY CAULKING

- 7.1TYPICAL JOINTS TO BE CAULKED ARE AS FOLLOWS: JUNCTURE OF WALL PANELS WITH FLOOR OR BASE;

JUNCTURE OF EXHAUST HOODS WITH WALLS; JUNCTURE OF DOOR JAMBS OR JAMB COVERS WITH WALLS; JUNCTURE OF FIXTURE AND EQUIPMENT BASES AND LEGS WITH FLOOR AND WALL; JUNCTURE OF CONCRETE CURBS TO WALLS; AROUND PLUMBING FIXTURES.

- 7.2CONTRACTOR SHALL BE RESPONSIBLE FOR ACCEPTANCE OF CAULKING UNDER THIS DIVISION BY THE HEALTH DEPARTMENT.

SECTION 08 71 00 / DOOR HARDWARE

PART 1 GENERAL

- 1.1SUMMARY
A. SECTION INCLUDES: HARDWARE AND RELATED ITEMS FOR INTERIOR AND EXTERIOR DOORS, OTHER THAN SPECIFIED IN SPECIFIC DOOR SECTIONS.

SYSTEM DESCRIPTION

- 1.2PERFORMANCE REQUIREMENTS: THE MANUFACTURER OR AUTHORIZED DISTRIBUTOR SHALL CONFIRM THAT THERE IS AN ESTABLISHED LOCAL AGENCY WHICH STOCKS A FULL COMPLEMENT OF PARTS AND OFFERS SERVICE DURING NORMAL WORKING HOURS FOR THE FINISH HARDWARE TO BE FURNISHED AND THAT THE AGENCY WILL SUPPLY PARTS WITHOUT DELAY AND AT REASONABLE COST.

- 1.3FURNISH HARDWARE ITEMS OF PROPER DESIGN FOR USE IN DOORS AND FRAMES OF THE THICKNESSES, PROFILE, SECURITY AND SIMILAR REQUIREMENTS INDICATED, AS NECESSARY FOR PROPER INSTALLATION AND FUNCTION, REGARDLESS OF OMISSIONS OR CONFLICTS IN THE INFORMATION IN THE CONTRACT DOCUMENTS.

SUBMITTALS

- 1.4SUBMIT SHOP DRAWINGS AND PRODUCT DATA OF EACH TYPE OF HARDWARE REQUIRED FOR PROJECT, IN ACCORDANCE WITH SECTION 01 33.00. INDICATE THE FOLLOWING:
A. STYLE AND FINISH.
B. LOCATIONS AND MOUNTING HEIGHTS OF EACH ITEM OF HARDWARE. USE ESTABLISHED NUMBERING SYSTEM.
C. INCLUDE A COMPLETE LISTING OF EQUIPMENT AND MATERIALS INCLUDING MANUFACTURER, CATALOG NUMBER, FINISH, DIAGRAMS, (INCLUDING CUT-SHEETS), SCHEMATICS AND ALL OTHER PERTINENT DATA.
- 1.5TEMPLATES: SUPPLY TO DOOR AND FRAME MANUFACTURER(S) TO ENABLE PROPER AND ACCURATE SIZING AND LOCATIONS OF CUTOUTS FOR HARDWARE.
- 1.6CERTIFICATION:
A. AT THE COMPLETION OF INSTALLATION, CERTIFY THAT MATERIAL IS PROPERLY INSTALLED ACCORDING TO MANUFACTURERS PRINTED INSTRUCTIONS.
B. SUBMIT CERTIFICATION THAT HARDWARE FOR FIRE RATED DOORS (INCLUDING DOORS AND FRAMES AS A UNIT) WILL COMPLY WITH UL 10C (POSITIVE PRESSURE TESTING).
- 1.7OPERATING AND MAINTENANCE DATA: SUBMIT IN ACCORDANCE WITH SECTION 01 77.00. PROVIDE OWNER WITH MANUFACTURER'S PARTS LIST AND MAINTENANCE INSTRUCTIONS FOR EACH TYPE OF HARDWARE SUPPLIED AND NECESSARY WRENCHES AND TOOLS REQUIRED FOR PROPER MAINTENANCE OF HARDWARE.

QUALITY ASSURANCE

- 1.8STANDARDS: COMPLY WITH THE FOLLOWING:
A. ANSINFPFA 80 - FIRE DOORS AND WINDOWS.
B. UL STANDARD 305 - PANIC HARDWARE.
- 1.9REGULATORY REQUIREMENTS:
A. COMPLY WITH THE FOLLOWING:
i. ANSII A117.1, 2003 "ACCESSIBLE AND USABLE BUILDINGS AND FACILITIES."
ii. PUBLIC LAW 101-336 "THE AMERICANS WITH DISABILITIES ACT OF 1990 (ADA).
iii. ADA ACCESSIBILITY GUIDELINES (ADAAG).
iv. THE ARIZONANS WITH DISABILITIES ACT OF 1992 ADMINISTRATIVE RULES (AZDAAG)
- 1.10HARDWARE LISTED OR FURNISHED SHALL MEET REQUIREMENTS OF FEDERAL, STATE AND LOCAL CODES HAVING JURISDICTION.
- 1.11ANY ITEM FURNISHED OR INSTALLED THAT DOES NOT MEET CODE REQUIREMENTS SHALL BE REMOVED AND PROPER ITEMS SUBSTITUTED AT NO ADDITIONAL COST OR EXPENSE TO THE OWNER.
- 1.12PROVIDE HARDWARE FOR FIRE-RATED OPENINGS IN COMPLIANCE WITH A.I.A. (NBFU) PAMPHLET NO. 80 AND NFPA STANDARDS NO. 80 AND NO. 101 AND UL 10(C) (POSITIVE PRESSURE TESTING). THIS REQUIREMENT SHALL TAKE PRECEDENCE OVER OTHER REQUIREMENTS FOR SUCH HARDWARE.
- 1.13PROVIDE HARDWARE WHICH HAS BEEN TESTED AND LISTED BY U.L. FOR THE TYPES AND SIZES OF DOORS REQUIRED, AND WHICH COMPLIES WITH THE REQUIREMENTS OF THE DOORS AND DOOR FRAME LABELS.
- 1.14PROVIDE 3-POINT LATCHES AT ALUMINUM DOUBLE DOORS USED AS ENTRANCE, NOT EGRESS EXIT.
- 1.15HARDWARE ON ALL DOORS LEADING TO OR FROM ELECTRICAL ROOMS, MECHANICAL ROOMS, SERVICE STAIRS, DOCK AREAS AND THE LIKE WHICH REPRESENT A HAZARD TO THE BLIND, SHALL HAVE KNURLING OR ABRASIVE COATING ON THE DOOR LEVER, HANDLE, OR BAR WHICH WILL ALERT THE USER TO POTENTIAL PERILS PRESENT. THE HARDWARE PRODUCT AND INSTALLATION SHALL SATISFY ALL GOVERNING HANDICAPPED CODES.
- 1.16SUPPLIER QUALIFICATIONS:
A. EMPLOY AN AHC MEMBER OF THE DHI.
B. FACTORY AUTHORIZED STOCKING DISTRIBUTOR OF THE APPROVED ITEMS.
C. HOLDER OF LEGALLY REQUIRED LICENSES.
- 1.17MANUFACTURER QUALIFICATIONS: 5 YEARS' EXPERIENCE IN MANUFACTURE OF COMPARABLE SYSTEMS.

DELIVERY, STORAGE AND HANDLING

- 1.18PACKING AND SHIPPING: PACKAGE EACH ITEM OF HARDWARE IN ORIGINAL AND INDIVIDUAL CONTAINERS, COMPLETE WITH ALL NECESSARY FASTENINGS, KEYS, INSTRUCTIONS, AND TEMPLATES FOR SPOTTING MORTISING TOOLS.
A. MARK EACH CONTAINER WITH ITS ITEM NUMBER CORRESPONDING TO THE ITEM NUMBER ON THE FINISH HARDWARE SCHEDULE.
B. CONTAINERS HOLDING LOCKS SHALL SHOW THE FOLLOWING CORRESPONDING TO THAT SHOWN ON THE FINISH HARDWARE SCHEDULE:
i. HEADING NUMBER
ii. DOOR NUMBER
iii. HAND OF DOOR (WHEN REQUIRED)
iv. KEYING SYMBOL (DEVELOPED BY OWNER)
v. A TYPEWRITTEN SCHEDULE IN DHI FORMAT CONFORMING WITH THE APPROVED SCHEDULE SHALL ACCOMPANY EACH SHIPMENT.
- 1.19WHEN HARDWARE MUST BE INSTALLED AT THE FACTORY, THE HARDWARE SUPPLIER SHALL SEND ALL SUCH NEEDED ITEMS TO THE RESPECTIVE SUPPLIER FOR THEIR USE IN INSTALLATION. THE COST OF THIS SHIPPING REQUIREMENT SHALL BE BORNE BY THE HARDWARE SUPPLIER.
- 1.20ACCEPTANCE AT SITE: UPON DELIVERY OF THE FINISH HARDWARE TO THE JOB SITE, CHECK IN AND SIGN FOR ALL MATERIAL DELIVERED AND THEREAFTER BE RESPONSIBLE FOR SAME.
- 1.21STORAGE AND PROTECTION: PROVIDE A SECURED AREA WITH SUFFICIENT SPACE AND SHELVING IN WHICH TO STORE AND INVENTORY ALL MATERIALS UNDER LOCK AND KEY. PROTECT HARDWARE FROM DAMAGE AT ALL TIMES.

WARRANTY

- 1.22WARRANTY HARDWARE AGAINST DEFECTS IN MATERIALS AND WORKMANSHIP REPAIR, REPLACE OR OTHERWISE CORRECT DEFICIENT MATERIALS AT NO ADDITIONAL COST TO OWNER.
A. LOCKSETS: TEN-YEAR WARRANTY.
B. CLOSERS: THIRTY-YEAR WARRANTY.
C. EXIT DEVICE THREE-YEAR WARRANTY

PART 2 PRODUCTS

MANUFACTURERS

- 2.1PRODUCT REQUIREMENTS OF THE SPECIFIED PRODUCT AS MANUFACTURED BY THE FOLLOWING.
A. BUTT HINGES: IVES (IVE) NO SUBSTITUTION.
B. EXIT DEVICES: VON DUPRIN (VON) NO SUBSTITUTION.
C. LOCKSETS: SCHLAGE (SCH) NO SUBSTITUTION.
D. CORE/CYLINDER: SCHLAGE (SCH) NO SUBSTITUTION.
E. DOOR CLOSERS: LCN (LCN) NO SUBSTITUTION.
F. THRESHOLDS, DOOR BOTTOMS, WEATHERSTRIPPING: ZERO (ZER) NO SUBSTITUTION.
G. STOPS, KICKPLATES, PULLS, PUSH PLATES: IVES (IVE) NO SUBSTITUTION.

- H. OVERHEAD STOPS: GLYNN JOHNSON (GJ) NO SUBSTITUTION.
I. POCKET DOOR SYSTEM: CAVITY SLIDERS (CS) NO SUBSTITUTION.
- 2.2OBTAIN ALL SWINGING DOOR FINISHED HARDWARE FROM ALLEGION MANUFACTURES LISTED ABOVE.

HARDWARE

- 2.3GENERAL:
A. PROVIDE ITEMS AS LISTED IN SCHEDULE COMPLETE TO FUNCTION AS INTENDED.
B. MANUFACTURE HARDWARE SUPPLIED FOR METAL DOORS OR JAMBS TO TEMPLATE AND SECURE WITH MACHINE SCREWS.
C. WHERE CYLINDRICAL LOCKS ARE USED IN HOLLOW METAL DOORS, FURNISH LOCK REINFORCING IN THE DOOR AT THE TIME OF MANUFACTURE.
D. FURNISH FINISH HARDWARE WITH ALL NECESSARY SCREWS, BOLTS, OR OTHER FASTENINGS OF SUITABLE SIZE AND TYPE TO ANCHOR THE HARDWARE IN POSITION FOR HEAVY USE AND LONG LIFE, AND OF COMPATIBLE MATERIAL AND FINISH.
E. FURNISH FASTENINGS WITH ANCHORS ACCORDING TO THE MATERIAL TO WHICH IT IS APPLIED, AND AS RECOMMENDED BY THE MANUFACTURER.
F. FURNISH HARDWARE FASTENED TO CONCRETE WITH MACHINE SCREWS AND TAMPINS.
G. FASTEN CLOSERS ON WOOD OR MINERAL CORE DOORS WITH FASTENERS RECOMMENDED BY THE CLOSER MANUFACTURER FOR THE APPARENT INTENDED USE OF THE DEVICE. UNLESS THE INSTALLATION IS IN AN OPENING REQUIRING UL-RATED HARDWARE IN WHICH CASE SEX NUTS AND BOLTS (APPROVED BY UL) ARE REQUIRED BY UL.
- 2.4BUTT HINGES:
A. DETERMINE CORRECT CLEARANCE FROM THE DRAWINGS.
B. PROVIDE NON-REMOVABLE PINS AT OUT SWINGING DOORS.
C. DOORS WITH CLOSERS SHALL HAVE BALL BEARING BUTTS.
D. FLAT BUTTON, TOP AND BOTTOM TIPS REQUIRED.
E. BUTT HINGE LENGTH: AS RECOMMENDED BY MANUFACTURER.
F. NUMBER OF BUTT HINGES REQUIRED: AS RECOMMENDED BY MANUFACTURER.
- 2.5DOOR LOCKS: LEVER AS LISTED IN HARDWARE SETS.
A. DESIGN SHALL PERMIT REMOVAL OF CYLINDER WITHOUT REMOVING LOCK FROM DOOR.
B. PROVIDE LOCKS AND LATCHES WITH 2-3/4 INCH (70MM) BACKSET UNLESS OTHERWISE NOTED.
C. PROVIDE STRIKES WITH EXTENDED LIP WHERE REQUIRED TO PROTECT TRIM FROM BEING MARRED BY LATCH BOLT.
D. ANSII 156.2 SERIES 4000 & 1000 GRADE 1.
- 2.6DOOR CLOSERS: SERIES
A. SURFACE MOUNTED WITHOUT COVERS. FINISH SPRAYED TO MATCH OTHER HARDWARE.
B. BODIES TO BE EXPOSED GRAINED MALLEABLE IRON, WITH 3 SEPARATE CONTROL VALVES (INCLUDING BACKCHECK) ANSII GRADE 1.
C. CLOSER TO BE EQUIPPED WITH SIZE ADJUSTMENT (1 THROUGH 6) IN THE FIELD BY THE INSTALLER.
D. EQUIP CLOSERS MOUNTED ON WOOD OR MINERAL CORE DOORS WITH CONVENTIONAL FASTENERS UNLESS THE MANUFACTURER OF THE CLOSER RECOMMENDS SEX NUTS AND BOLT BECAUSE OF THE APPARENT FREQUENCY USE OF THE CLOSER. IN THE EVENT THE DOOR IS INDICATED TO BE UL-RATED, THE SEX NUTS AND BOLTS SHALL BE UL APPROVED.
E. PROVIDE TYPE AS LISTED IN HARDWARE SETS.
- 2.7EXIT DEVICES: SERIES
A. U.L. APPROVED FOR CASUALTY.
B. PROVIDE CYLINDERS AS REQUIRED FOR EXIT DEVICE AND PROPER OPERATION
C. LEVER DESIGN TO MATCH LOCKSETS, TYPES FUNCTIONS AS LISTED IN HARDWARE SETS
- 2.8KICK PLATES: SIZE AS LISTED IN HARDWARE SETS. .050 (3MM) STAINLESS STEEL WITH NO. 4 FINISH, B4E, CS
- 2.9OVERHEAD HOLDERS OR STOPS: AS LISTED IN HARDWARE SETS.
- 2.10STOPS: WALL STOPS SHALL BE USED WHEREVER POSSIBLE. USE OVERHEAD STOPS WHERE WALL STOPS CANNOT BE USED OR AS LISTED IN HARDWARE SETS. WALLS TO RECEIVE PROPER BACKING FOR WALL BUMPERS AS SPECIFIED IN SECTION 06100 - ROUGH CARPENTRY.
- 2.11SILENCERS: AT METAL FRAMES: 3 AT EACH JAMB OF SINGLE DOORS, 2 AT EACH JAMB OF DOUBLE DOORS. NOT REQUIRED ON DOORS HAVING WEATHERSTRIP OR SEALS.
- 2.12WEATHERPROOFING, SMOKE SEALS AND DOOR BOTTOMS:
A. CONTINUOUS AT HEAD AND JAMB OF EXTERIOR DOORS; CONTINUOUS SMOKE SEALS AT HEAD AND JAMB OF CORRIDOR DOORS.
- 2.13THRESHOLDS: SIZED FOR OPENING; TO MEET HANDICAPPED CONDITIONS. AS LISTED IN HARDWARE SETS.

KEYING

- 2.14DOOR LOCKS: KEY ALL LOCKS INTO NEW KEY SYSTEM IN ACCORDANCE WITH OWNER'S INSTRUCTIONS
- 2.15SUPPLY 2 KEYS FOR EACH LOCK.
- 2.16SUPPLY ADDITIONAL KEYS IN FOLLOWING QUANTITIES:
A. 5 - MASTER KEYS
B. 3 - CONSTRUCTION KEYS
C. 2 - CONTROL KEYS
- 2.17SUBMERANT KEYS WILL NOT BE MADE AVAILABLE TO THE GENERAL CONTRACTOR OR ANY SUBCONTRACTOR OR SUPPLIER UNDER ANY CIRCUMSTANCES.

FINISHES

- 2.18PROVIDE MATCHING FINISHES FOR HARDWARE ITEMS AT EACH DOOR OPENING TO THE GREATEST EXTENT POSSIBLE, EXCEPT AS OTHERWISE INDICATED.
A. PROVIDE FINISHES WHICH COMPLY WITH THOSE ESTABLISHED BY BHMA LISTED IN "MATERIALS AND FINISHES STANDARD 1301".
B. FINISHES FOR THIS PROJECT ARE AS FOLLOWS:
i. HINGES 630
ii. LOCKSETS 626
iii. EXIT DEVICES 626
iv. FLAT GOODS 630
v. STOPS 630
vi. CLOSERS 669

PART 3 EXECUTION

- 3.1EXAMINATION
A. VERIFICATION OF CONDITIONS. EXAMINE CONDITIONS UNDER WHICH FINISH HARDWARE WILL BE INSTALLED. REPORT DEFICIENCIES TO THE ARCHITECT.
- 3.2INSTALLATION
A. INSTALL HARDWARE IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS, USING PROPER TEMPLATES.
B. MAINTAIN ANSI STANDARD MOUNTING HEIGHTS FOR DOORS, FROM FINISHED FLOOR TO CENTER LINE OF HARDWARE ITEM.
C. KNOX BOX: RECESSED INTO WALL CONSTRUCTION AND RIGIDLY ANCHORED IN PLACE AT LOCATIONS INDICATED ON DRAWINGS IN ACCORDANCE WITH REQUIREMENTS FOR FIRE DEPARTMENT ACCESS.
- 3.3CLEANING
A. DURING THE COURSE OF THE WORK AND ON COMPLETION, REMOVE AND DISPOSE OF EXCESS MATERIALS, EQUIPMENT AND DEBRIS AWAY FROM PREMISES. LEAVE WORK IN CLEAN CONDITION.
- 3.4PROJECT INFORMATION
A. OPT0255205, V1, 03.29.2022
- 3.5HARWARE
A. WHILE THE FOLLOWING HARDWARE SETS ARE INTENDED TO COVER ALL DOORS, AND ESTABLISH A TYPE AND STANDARD OF QUALITY, IT IS THE RESPONSIBILITY OF THE HARDWARE SUPPLIER TO EXAMINE THE PLANS AND SPECIFICATIONS AND FURNISH PROPER HARDWARE FOR ALL OPENINGS. THE HARDWARE SUPPLIER SHALL REVIEW THE ENTIRE SPECIFICATION VERSUS THE DOOR SCHEDULE AND NOTIFY THE ARCHITECT OF ANY ERRORS, INCONSISTENCIES, OR OMISSIONS DURING THE BID PERIOD.
- 3.6ELECTRICAL DRAWINGS
A. ELEVATION RISER DIAGRAMS INCLUDED IN THIS SECTION AND/OR SECTION 28 1300 ARE BASED ON THE ELECTRIFIED PRODUCTS LISTED IN THE HARDWARE SETS. ANY DEVIATION FROM SPECIFIED HARDWARE PRODUCTS SHALL MAKE THE ELEVATION RISER DIAGRAMS NULL AND VOID. IF NON-SPECIFIED




#2001


610 NW CHIPMAN ROAD

LEE'S SUMMIT, MO 64086 PROPOSED LOT 3

PROTOTYPE VERSION 2.00



513 MAIN STREET
FORT WORTH TX 76102

STEVEN COX
NUMBER
A-2023017238

ARCHITECT

PERMIT SET: 04/12/2024

CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DIMENSIONAL ERRORS, OMISSIONS OR DISCREPANCIES BEFORE BEGINNING OR FABRICATING ANY WORK. DO NOT SCALE DRAWINGS.

ISSUE	DATE	DESCRIPTION

PROJECT INFORMATION

PROJECT NO:	24-0087
ORIGINAL ISSUE:	06/01/2023
SCALE:	AS NOTED
DRAWN BY:	P. C
CHECKED BY:	J. JEFFERY

SHEET TITLE

SPECIFICATIONS

SHEET NUMBER

A805

4/8/2024 10:53:21 AM

PRODUCTS ARE SUBMITTED ON MATERIAL SUPPLIER TO PROVIDE NEW ELEVATION RISER DIAGRAMS AS PART OF THEIR SUBMITTAL PACKAGE.

SECTION 08 11 00 / METAL DOORS AND FRAMES

- 1.1 SUBMIT SHOP DRAWINGS COMPLYING WITH SECTION 01 33 00 FOR WORK IN THIS SECTION.
- 1.2 EXERCISE CARE IN CUTTING OPERATIONS AND PERFORM SUCH OPERATIONS UNDER ADEQUATE SUPERVISION BY COMPETENT MECHANICS SKILLED IN THE APPLICABLE TRADE. OPENINGS SHALL BE NEATLY CUT AND SHALL BE KEPT AS SMALL AS POSSIBLE TO AVOID UNNECESSARY DAMAGE.

HOLLOW METAL FRAMES

- 2.1 FRAMES SHALL MEET SPECIFIED REQUIREMENTS AND SDI 100 FOR UNIT WELDED FRAMES, AND THE NAMM HOLLOW METAL TECHNICAL AND DESIGN MANUAL.
- 2.2 FRAMES TO BE PRESSED STEEL TO PROFILE INDICATED, 16-GAUGE (UNLESS OTHERWISE NOTED) COLD ROLLED, PICKLED, ANNEALED STEEL, UNIT TYPE WELDED CONSTRUCTION, WITH ANGLES, MOLDS, RETURNS AND MITERS NEATLY WELDED AND WELD BEADS GROUND SMOOTH. PREPARE FRAMES TO RECEIVE MORTISED TYPE HARDWARE. SPOT WELD REINFORCING PLATES TO INNER SURFACE OF JAMBS AT HINGE, LOCK, LATCH, AND OTHER HARDWARE LOCATIONS.
- 2.3 HINGE REINFORCEMENTS SHALL BE 10-GAUGE STEEL FOR LIGHTWEIGHT CORE DOORS, 7-GAUGE STEEL FOR OTHERS. OTHER HARDWARE SHALL CONFORM TO TABLE IV, SDI 100. SPOT WELD 24-GAUGE GALVANIZED STEEL PLASTER GUARDS OVER HARDWARE FROM TEMPLATES FURNISHED TO FRAME MANUFACTURER BY HARDWARE SUPPLIER. PROVIDE REINFORCEMENTS FOR SURFACE APPLIED HARDWARE. PUNCH DOORSTOPS TO RECEIVE RUBBER SILENCERS.
- 2.4 PROVIDE FRAMES WITH FIXED INSERT ANCHORS WELDED TO FACE AND FLANGE RETURNS 12" DOWN FROM TOP, THEN 24" ON CENTER. PROVIDE FRAMES WITH MINIMUM 18-GAUGE FLOOR CLIPS WELDED TO EACH JAMB, FACE AND FLANGES PUNCHED FOR ANCHORING TO FLOOR. AT DOOR OPENINGS WIDER THAN 42" AND AT MULTIPLE OPENINGS, REINFORCE HEAD MEMBERS FULL LENGTH WITH 12-GAUGE STEEL, CHAN NEL BRACE DOORFRAMES WITH TEMPORARY WOOD OR METAL SPREADERS TO INSURE MAINTAINING SQUARE AND TRUE SHAPES IN SHIPPING.
- 2.5 PROVIDE FRAMES WITH UL LABELS AS REQUIRED OR AS INDICATED.
- 2.6 PROVIDE FRAMES WITH LOOSE GLAZING BEADS WITH SCREWS FOR FLUSH COUNTERSUNK INSTALLATION TO RECEIVE GLASS PER SDI 100.
- 2.7 PRIMING: FRAMES SHALL RECEIVE ONE SHOP COAT OF RUST INHIBITIVE PRIMER. PRIMER SHALL BE SMOOTH SURFACE, READY TO RECEIVE FINISH COATS WHEN INSTALLED. NO RUNS, OVERSPRAY, DUST OR OTHER DEFECTS WILL BE ALLOWED. PRIMER SHALL BE BONDED TO THE METAL SUFFICIENTLY THAT UPON AGING IT WILL NOT CHIP OR FLAKE WHEN SCRAPPED THROUGH. WIPE COAT GALVANIZED STEEL IS AN ACCEPTABLE SUBSTITUTION FOR THE SHOP COAT OF PRIMER.

INTERIOR PRE-FINISHED STEEL DOOR FRAMES

- 3.1 FRAMES SHALL BE OF 18-GAUGE STEEL AS MANUFACTURED BY TIMELY INDUSTRIES, (818-492-3500) WITH ALUMINUM CASINGS #TA-23. PROVIDE FRAMES AND CASINGS WITH FACTORY-FINISHED COLOR AS SELECTED BY ARCHITECT.
- 3.2 PRE-FINISHED STEEL DOOR FRAMES SHALL BE FORMED FROM COLD ROLLED SHEET STEEL CONFORMING TO ASTM A 138. PREPARE FRAMES FOR HEAT TREATED ZINC PLATED CASING RETAINER CLIPS MECHANICALLY FASTENED FOR SECURE, PROPERLY ALIGNED INSTALLATION OF CASINGS.
- 3.3 FRAMES SHALL HAVE 14-GAUGE HINGE-REIN FORCEMENT PLATES WITH EXTRUDED TAPPED HOLES, FOR A MINIMUM OF 3/16" THREAD PENETRATION DEPTH.
- 3.4 STRIKES: PROVIDE FOR 2-3/4" ADJUSTABLE T. PROVIDE STANDARD FIELD-APPLIED REINFORCEMENT FOR SURFACE MOUNTED HARDWARE. PROVIDE UL FIRE RATED FRAMES WHERE SHOWN ON THE DRAWINGS.
- 3.5 FACTORY FINISH: STEEL SHALL BE CHEMICALLY CLEANED, BONDERIZED, PRIMED AND PAINTED WITH IMPACT-RESISTANT, POLYESTER BAKED ENAMEL. PROVIDE AEROSOL TOUCH-UP PAINT FOR AFTER INSTALLATION, ON-SITE REPAIR AS RECOMMENDED BY MANUFACTURER.

HOLLOW METAL DOORS

- 4.1 DOORS SHALL MEET SPECIFIED REQUIREMENTS AND SDI 100, AND THE NAAAM HOLLOW METAL TECHNICAL AND DESIGN MANUAL.
- 4.2 CONSTRUCT DOORS, FLUSH TYPE, 1 3/4" THICK, WITH A FINEST GRADE 18-GAUGE COLD ROLLED STEEL SHEET ON THE INTERIOR FACE AND A 16-GAUGE COLD ROLLED STEEL SHEET ON THE EXTERIOR FACE OF THE DOOR. VERTICAL STIFFENERS SHALL BE 22-GAUGE STEEL "U" FORMS, SPOT-WELDED TO EACH INSIDE FACE OF THE DOOR FULL HEIGHT AND NOT MORE THAN 6" APART.
- 4.3 REINFORCE TOP AND BOTTOM OF DOORS HORIZONTALLY BY STEEL CHANNELS, FULL WIDTH, SPOT-WELDED TO EACH FACE AT LEAST 6" ON CENTER. JOINTS AT THE EDGES OF DOORS SHALL BE CONTINUOUSLY WELDED, AUTOMATICALLY BY THE GAS SHIELDED METHOD ARC PROCESS.
- 4.4 DOORS SHALL HAVE SOUND DEADENING MATERIAL OF AN APPROVED TYPE APPLIED TO THE INTERIOR SURFACE OF PANELS. SOUND DEADENER SHALL ELIMINATE METALLIC REVERBERATIONS INCIDENTAL TO NORMAL DOOR OPERATION.
- 4.5 PROVIDE DOUBLE DOORS WITH ONE-PIECE ASTRAGALS OF 12-GAUGE STEEL.
- 4.6 MORTISE DOORS FOR LOCKS AND HINGES. PROVIDE REINFORCEMENT IN ACCORDANCE WITH TABLE IV SDI 100, AND NAAAM CHM 1. PROVIDE DOORS WITH UL LABELS AS REQUIRED OR INDICATED.
- 4.7 PROVIDE LOUVER DOORS AS SCHEDULED. PROVIDE SIGHT-PROOF LOUVERS EITHER PIERCED INTO THE PANELS OF THE DOOR OR INSERTED INTO THE PANELS. FORM LOUVER FRAMES OF MINIMUM 20-GAUGE STEEL. WELD MINIMUM 24-GAUGE BLADES TO FRAME AND FASTEN THE ENTIRE ASSEMBLY TO THE DOOR WITH MOLDINGS. THE MOLDINGS, WHEN USED, SHALL BE AN INTEGRAL PART OF THE LOUVER.
- 4.8 PROVIDE FOR GLAZING IN DOORS AS SCHEDULED. NON-REMOVABLE MINIMUM 20-GAUGE GLAZING STOPS SHALL OCCUR ON THE OUTSIDE OF EXTERIOR DOORS AND ON THE REVERSE SIDE OF INTERIOR DOORS. GLAZING BEADS ON THE INSIDE OF GLASS PANELS SHALL BE REMOVABLE.

PRIMING

- 5.1 DOORS AND FRAMES TO BE CLEANED, BONDERIZED AND PRIMED WITH SHOP COAT OF LIGHT GRAY ZINC CHROMATE RUST INHIBITIVE PRIMER.
- 5.2 PRIMER SHALL BE SMOOTH SURFACE, READY TO RECEIVE FINISH COATS WHEN INSTALLED. NO RUNS, OVERSPRAY, DUST OR OTHER DEFECTS WILL BE ALLOWED. PRIMER SHALL BE BONDED TO THE METAL SUFFICIENTLY THAT UPON AGING IT WILL NOT CHIP OR FLAKE WHEN SCRAPPED THROUGH. WIPE COAT GALVANIZED STEEL IS AN ACCEPTABLE SUBSTITUTION FOR THE SHOP COAT OF PRIMER.

INSTALLATION

- 6.1 INSTALL DOORS COMPLETELY AND ACCURATELY, COMPL ETE WITH FINISH HARDWARE. INSTALL FINISH HARDWARE IN A NEAT WORKMAN LIKE MANNER IN ACCORDANCE WITH THE HARDWARE SCHEDULE USING ONLY MECHANICS SKILLED IN THIS TYPE OF WORK.

SECTION 08 41 13 / ALUMINUM-FRAMED STOREFRONTS

PART 1 – GENERAL

- A. INSTALLER QUALIFICATIONS: AN ENTITY THAT EMPLOYS INSTALLERS AND SUPERVISORS WHO ARE TRAINED AND APPROVED BY MANUFACTURER
- B. TESTING AGENCY QUALIFICATIONS: QUALIFIED ACCORDING TO ASTM E 699 FOR TESTING INDICATED AND ACCREDITED BY IAS OR ILAC MUTUAL RECOGNITION ARRANGEMENT AS COMPLYING WITH ISO/IEC 17025.
- C. PRODUCT OPTIONS: INFORMATION ON DRAWINGS AND IN SPECIFICATIONS ESTABLISHES REQUIREMENTS FOR AESTHETIC EFFECTS AND PERFORMANCE CHARACTERISTICS OF ASSEMBLIES. AESTHETIC EFFECTS ARE INDICATED BY DIMENSIONS, ARRANGEMENTS, ALIGNMENT, AND PROFILES OF COMPONENTS AND ASSEMBLIES AS THEY RELATE TO SIGHTLINES, TO ONE ANOTHER, AND TO ADJOINING CONSTRUCTION.
- D. DO NOT CHANGE INTENDED AESTHETIC EFFECTS, AS JUDGED SOLELY BY ARCHITECT, EXCEPT WITH ARCHITECT'S REVIEW.

DELIVERY, STORAGE, AND HANDLING

- 1.1 DELIVER ALUMINUM WORK PALLETIZED, PACKAGED, OR CRATED TO PROVIDE PROTECTION DURING TRANSIT AND PROJECT-SITE STORAGE. DO NOT USE NON-VENTED PLASTIC. PROVIDE ADDITIONAL PROTECTION TO PREVENT DAMAGE TO FACTORY-FINISHED UNITS.
- A. STORE ALUMINUM WORK VERTICALLY UNDER COVER AT PROJECT SITE WITH HEAD UP. PLACE ON

MINIMUM 4- INCH- (102-MM-) HIGH WOOD BLOCKING. PROVIDE MINIMUM 1/4-INCH (6-MM) SPACE BETWEEN EACH STACK TO PERMIT AIR CIRCULATION.

WARRANTY

- 1.2 SPECIAL WARRANTY: MANUFACTURER AGREES TO REPAIR OR REPLACE COMPONENTS OF ALUMINUM-FRAMED STOREFRONTS THAT DO NOT COMPLY WITH REQUIREMENTS OR THAT FAIL IN MATERIALS OR WORKMANSHIP WITHIN SPECIFIED WARRANTY PERIOD.
- A. WARRANTY PERIOD: FIVE YEARS FROM DATE OF SUBSTANTIAL COMPLETION.
- B. SPECIAL FINISH WARRANTY: STANDARD FORM IN WHICH MANUFACTURER AGREES TO REPAIR FINISHES OR REPLACE ALUMINUM THAT SHOWS EVIDENCE OF DETERIORATION OF FACTORY-APPLIED FINISHES WITHIN SPECIFIED WARRANTY PERIOD.
- I. WARRANTY PERIOD: 10 YEARS FROM DATE OF SUBSTANTIAL COMPLETION.

PART 2 – PRODUCTS

PERFORMANCE REQUIREMENTS

- 2.1 GENERAL PERFORMANCE: COMPLY WITH PERFORMANCE REQUIREMENTS SPECIFIED, AS DETERMINED BY TESTING OF ALUMINUM-FRAMED ENTRANCES AND STOREFRONTS REPRESENTING THOSE INDICATED FOR THIS PROJECT WITHOUT FAILURE DUE TO DEFECTIVE MANUFACTURE, FABRICATION, INSTALLATION, OR OTHER DEFECTS IN CONSTRUCTION.
- A. ALUMINUM-FRAMED ENTRANCES AND STOREFRONTS SHALL WITHSTAND MOVEMENTS OF SUPPORTING STRUCTURE INCLUDING, BUT NOT LIMITED TO, STORY DRIFT, TWIST, COLUMN SHORTENING, LONG-TERM CREEP, AND DEFLECTION FROM UNIFORMLY DISTRIBUTED AND CONCENTRATED LIVE LOADS.
- B. FAILURE ALSO INCLUDES THE FOLLOWING:
- i. THERMAL STRESSES TRANSFERRING TO BUILDING STRUCTURE.
- ii. GLASS BREAKAGE.
- iii. LOOSENING OR WEAKENING OF FASTENERS, ATTACHMENTS, AND OTHER COMPONENTS.
- 2.2 FAILURE OF OPERATING UNITS.
- A. STRUCTURAL LOADS:
- B. WIND LOADS: AS INDICATED ON DRAWINGS.
- C. OTHER DESIGN LOADS: AS INDICATED ON DRAWINGS.
- 2.3 DEFLECTION OF FRAMING MEMBERS: AT DESIGN WIND PRESSURE, AS FOLLOWS:
- A. DEFLECTION NORMAL TO WALL, LIMITED TO PLANE OF GLASS IN A DIRECTION PERPENDICULAR TO GLASS. PLANE NOT EXCEEDING 1/175 OF THE GLASS EDGE LENGTH FOR EACH INDIVIDUAL GLAZING LITE OR AN AMOUNT THAT RESTRICTS EDGE DEFLECTION OF INDIVIDUAL GLAZING LITES TO 3/4 INCH (19.1 MM), WHICHEVER IS LESS.
- A. DEFLECTION PARALLEL TO GLAZING PLANE: LIMITED TO AMOUNT NOT EXCEEDING THAT WHICH REDUCES GLAZING BITE TO LESS THAN 75 PERCENT OF DESIGN DIMENSION AND THAT WHICH REDUCES EDGE CLEARANCE BETWEEN FRAMING MEMBERS AND GLAZING OR OTHER FIXED COMPONENTS TO LESS THAN 1/8 INCH (3.2 MM).
- 2.4 STRUCTURAL: TEST ACCORDING TO ASTM E 330 AS FOLLOWS:
- A. WHEN TESTED AT POSITIVE AND NEGATIVE WIND-LOAD DESIGN PRESSURES, ASSEMBLIES DO NOT EVIDENCE DEFLECTION EXCEEDING SPECIFIED LIMITS.
- B. WHEN TESTED AT 150 PERCENT OF POSITIVE AND NEGATIVE WIND-LOAD DESIGN PRESSURES, ASSEMBLIES, INCLUDING ANCHORAGE, DO NOT EVIDENCE MATERIAL FAILURES, STRUCTURAL DISTRESS, OR PERMANENT DEFORMATION OF MAIN FRAMING MEMBERS EXCEEDING 0.2 PERCENT OF SPAN.
- C. TEST DURATIONS: AS REQUIRED BY DESIGN WIND VELOCITY, BUT NOT LESS THAN 10 SECONDS.
- 2.5 AIR INFILTRATION: TEST ACCORDING TO ASTM E 283 FOR INFILTRATION AS FOLLOWS:
- A. FIXED FRAMING AND GLASS AREA: MAXIMUM AIR LEAKAGE OF 0.06 CFM/SQ. FT. (0.30 L/S PER SQ. M) AT A STATIC-AIR-PRESSURE DIFFERENTIAL OF 6.24 LBF/SQ. FT. (300 PA).
- 2.6 WATER PENETRATION UNDER STATIC PRESSURE: TEST ACCORDING TO ASTM E 331 AS FOLLOWS:
- A. NO EVIDENCE OF WATER PENETRATION THROUGH FIXED GLAZING AND FRAMING AREAS WHEN TESTED ACCORDING TO A MINIMUM STATIC-AIR-PRESSURE DIFFERENTIAL OF 20 PERCENT OF POSITIVE WIND-LOAD DESIGN PRESSURE, BUT NOT LESS THAN 10 LBF/SQ. FT. (500 PA).
- 2.7 ENERGY PERFORMANCE: CERTIFIED AND LABELED BY MANUFACTURER FOR ENERGY PERFORMANCE AS FOLLOWS:
- A. THERMAL TRANSMITTANCE (U-FACTOR): FIXED GLAZING AND FRAMING AREAS: U-FACTOR FOR THE SYSTEM OF NOT MORE THAN 0.41 BTU/SQ. FT. X H X DEG F (2.33 W/SQ. M X K) AS DETERMINED ACCORDING TO NFRC 100.
- 2.8 SOLAR HEAT-GAIN COEFFICIENT (SHGC): FIXED GLAZING AND FRAMING AREAS: SHGC FOR THE SYSTEM OF NOT MORE THAN 0.40 AS DETERMINED ACCORDING TO NFRC 200.
- 2.9 AIR LEAKAGE:
- A. FIXED GLAZING AND FRAMING AREAS: AIR LEAKAGE FOR THE SYSTEM OF NOT MORE THAN 0.06 CFM/SQ. FT. (0.30 L/S PER SQ. M) AT A STATIC-AIR-PRESSURE DIFFERENTIAL OF 6.24 LBF/SQ. FT. (300 PA) WHEN TESTED ACCORDING TO ASTM E283.
- 2.10 CONDENSATION RESISTANCE FACTOR (CRF): FIXED GLAZING AND FRAMING AREAS: CRF FOR THE SYSTEM OF NOT LESS THAN 25 AS DETERMINED ACCORDING TO AAMA 1503.
- 2.11 THERMAL MOVEMENTS: ALLOW FOR THERMAL MOVEMENTS RESULTING FROM AMBIENT AND SURFACE TEMPERATURE CHANGES
- A. TEMPERATURE CHANGE: 120 DEG F (67 DEG C), AMBIENT; 180 DEG F (100 DEG C), MATERIAL SURFACES.

MANUFACTURERS

BASIS OF DESIGN: MANUFACTURER: KAWNEER, AN ARCONIC COMPANY; HYPERLINK "http://www.kawneer.com" WWW.KAWNEER.COM

PRODUCTS: EXTERIOR: TRIFAB 451T FRAMING SYSTEM (THERMAL)

FRAMING

- 2.12 FRAMING MEMBERS: MANUFACTURER'S EXTRUDED- OR FORMED-ALUMINUM FRAMING MEMBERS OF THICKNESS REQUIRED AND REINFORCED AS REQUIRED TO SUPPORT IMPOSED LOADS.
- A. CONSTRUCTION: THERMALLY BROKEN FOR ALL EXTERIOR FRAMING AND NONTHERMAL FOR INTERIOR FRAMING; SILL AND HEAD MEMBERS ARE CONTINUOUS.
- B. SYSTEM DIMENSIONS: 2 BY 4.5 INCHES (50.8 BY 114.3 MM) NOMINAL.
- C. GLAZING SYSTEM: RETAINED MECHANICALLY WITH GASKETS ON FOUR SIDES.
- D. GLAZING PLANE: FRONT SET OF FRAME.
- E. FINISH: ANODIZED ALUMINUM
- 2.13 FABRICATION METHOD: SHOP-FABRICATED CREW SPLINE OR SHEAR BLOCK.
- A. BACKER PLATES: MANUFACTURER'S STANDARD, CONTINUOUS BACKER PLATES FOR FRAMING MEMBERS, IF NOT INTEGRAL, WHERE FRAMING ABUTS ADJACENT CONSTRUCTION.
- B. BRACKETS AND REINFORCEMENTS: MANUFACTURER'S STANDARD HIGH-STRENGTH ALUMINUM WITH NONSTAINING, NONFERROUS SHIMS FOR ALIGNING SYSTEM COMPONENTS.
- C. FASTENERS AND ACCESSORIES: MANUFACTURER'S STANDARD CORROSION-RESISTANT, NONSTAINING, NONBLEEDING FASTENERS AND ACCESSORIES COMPATIBLE WITH ADJACENT MATERIALS, WHERE EXPOSED SHALL BE STAINLESS STEEL.
- D. PERIMETER ANCHORS: WHEN STEEL ANCHORS ARE USED, PROVIDE INSULATION BETWEEN STEEL MATERIAL AND ALUMINUM MATERIAL TO PREVENT GALVANIC ACTION.
- 2.14 MATERIALS:
- A. ALUMINUM: ALLOY AND TEMPER RECOMMENDED BY MANUFACTURER FOR TYPE OF USE AND FINISH INDICATED.
- B. SHEET AND PLATE: ASTM B 209 (ASTM B 209M).
- C. EXTRUDED BARS, RODS, PROFILES, AND TUBES: ASTM B 221 (ASTM B 221M).

- 2.15 EXTRUDED STRUCTURAL PIPE AND TUBES: ASTM B 429/B 429M.

GLAZING

- 2.16 GLAZING: COMPLY WITH SECTION 088000 "GLAZING."
- 2.17 GLAZING GASKETS: MANUFACTURER'S STANDARD COMPRESSION TYPES; REPLACEABLE, EXTRUDED EPDM RUBBER.
- 2.18 SPACERS AND SETTING BLOCKS: MANUFACTURER'S STANDARD ELASTOMERIC TYPE.
- 2.19 GLAZING SEALANTS: AS RECOMMENDED BY MANUFACTURER.
- 2.20 WEATHERSEAL SEALANT: ASTM C 920 FOR TYPE S, GRADE NS, CLASS 25, USES NT, G, A, AND O; SINGLE-COMPONENT NEUTRAL-CURING FORMULATION THAT IS COMPATIBLE WITH STRUCTURAL SEALANT AND OTHER SYSTEM COMPONENTS WITH WHICH IT COMES IN CONTACT; RECOMMENDED BY STRUCTURAL-SEALANT, WEATHERSEAL-SEALANT, AND ALUMINUM-FRAMED-SYSTEM MANUFACTURERS FOR THIS USE.
- 2.21 VOC CONTENT: GLAZING SEALANTS APPLIED INSIDE THE WEATHERPROOFING SYSTEM OF THE BUILDING SHALL HAVE A VOC CONTENT OF 250 G/L OR LESS WHEN CALCULATED ACCORDING TO 40 CFR 59, SUBPART D (EPA METHOD 24).

ACCESSORY MATERIALS

- 2.22 JOINT SEALANTS: FOR INSTALLATION AT PERIMETER OF ALUMINUM-FRAMED SYSTEMS, AS SPECIFIED IN DIVISION 07 SECTION "JOINT SEALANTS".
- 2.23 BITUMINOUS PAINT: COLD-APPLIED, ASPHALT-MASTIC PAINT COMPLYING WITH SSPC-PAINT 12 REQUIREMENTS EXCEPT CONTAINING NO ASBESTOS, FORMULATED FOR 30 MIL (0.762 MM) THICKNESS PER COAT.

FABRICATION

- 2.24 FORM OR EXTRUDE ALUMINUM SHAPES BEFORE FINISHING.
- 2.25 WELD IN CONCEALED LOCATIONS TO GREATEST EXTENT POSSIBLE TO MINIMIZE DISTORTION OR DISCOLORATION OF FINISH. REMOVE WELD SPATTER AND WELDING OXIDES FROM EXPOSED SURFACES BY DESCALING OR GRINDING.
- 2.26 FABRICATE COMPONENTS THAT, WHEN ASSEMBLED, HAVE THE FOLLOWING CHARACTERISTICS:
- A. PROFILES THAT ARE SHARP, STRAIGHT, AND FREE OF DEFECTS OR DEFORMATIONS.
- B. ACCURATELY FITTED JOINTS WITH ENDS COPED OR MITERED.
- C. PHYSICAL AND THERMAL ISOLATION OF GLAZING FROM FRAMING MEMBERS.
- D. ACCOMMODATIONS FOR THERMAL AND MECHANICAL MOVEMENTS OF GLAZING AND FRAMING TO MAINTAIN REQUIRED GLAZING EDGE CLEARANCES.
- E. PROVISIONS FOR FIELD REPLACEMENT OF GLAZING FROM INTERIOR.
- F. FASTENERS, ANCHORS, AND CONNECTION DEVICES THAT ARE CONCEALED FROM VIEW TO GREATEST EXTENT POSSIBLE.
- 2.27 MECHANICALLY GLAZED FRAMING MEMBERS: FABRICATE FOR FLUSH GLAZING WITHOUT PROJECTING STOPS.
- 2.28 STOREFRONT FRAMING: FABRICATE COMPONENTS FOR ASSEMBLY USING MANUFACTURER'S STANDARD INSTALLATION INSTRUCTIONS.
- 2.29 AFTER FABRICATION, CLEARLY MARK COMPONENTS TO IDENTIFY THEIR LOCATIONS IN PROJECT ACCORDING TO SHOP DRAWINGS.

PART 3 – EXECUTION

EXAMINATION

- 3.1 EXAMINE OPENINGS, SUBSTRATES, STRUCTURAL SUPPORT, ANCHORAGE, AND CONDITIONS, WITH INSTALLER PRESENT, FOR COMPLIANCE WITH REQUIREMENTS FOR INSTALLATION TOLERANCES AND OTHER CONDITIONS AFFECTING PERFORMANCE OF WORK. VERIFY ROUGH OPENING DIMENSIONS, LEVELNESS OF SILL PLATE AND OPERATIONAL CLEARANCES. EXAMINE WALL FLASHINGS, VAPOR RETARDERS, WATER AND WEATHER BARRIERS, AND OTHER BUILT-IN COMPONENTS TO ENSURE A COORDINATED, WEATHER TIGHT FRAMED ALUMINUM- STOREFRONT SYSTEM INSTALLATION.
- A. PROCEED WITH INSTALLATION ONLY AFTER UNSATISFACTORY CONDITIONS HAVE BEEN CORRECTED.

INSTALLATION

- 3.2 GENERAL:
- A. COMPLY WITH MANUFACTURER'S WRITTEN INSTRUCTIONS.
- B. DO NOT INSTALL DAMAGED COMPONENTS.
- C. FIT JOINTS TO PRODUCE HAIRLINE JOINTS FREE OF BURRS AND DISTORTION.
- D. TIGHTLY SECURE NONMOVEMENT JOINTS.
- E. INSTALL ANCHORS WITH SEPARATORS AND ISOLATORS TO PREVENT METAL CORROSION AND ELECTROLYTIC DETERIORATION AND TO PREVENT IMPEDING MOVEMENT OF MOVING JOINTS.
- F. SEAL PERIMETER AND OTHER JOINTS WATERTIGHT UNLESS OTHERWISE INDICATED.
- 3.3 METAL PROTECTION:
- A. WHERE ALUMINUM IS IN CONTACT WITH DISSIMILAR METALS, PROTECT AGAINST GALVANIC ACTION BY PAINTING CONTACT SURFACES WITH MATERIALS RECOMMENDED BY MANUFACTURER FOR THIS PURPOSE OR BY INSTALLING NONCONDUCTIVE SPACERS.
- B. WHERE ALUMINUM IS IN CONTACT WITH CONCRETE OR MASONRY, PROTECT AGAINST CORROSION BY PAINTING CONTACT SURFACES WITH BITUMINOUS PAINT.
- 3.4 SET CONTINUOUS SILL MEMBERS AND FLASHING IN FULL SEALANT BED AS SPECIFIED IN SECTION 079200 "JOINT SEALANTS" TO PRODUCE WEATERTIGHT INSTALLATION.
- 3.5 INSTALL ALUMINUM-FRAMED STOREFRONT SYSTEM LEVEL, PLUMB, SQUARE, TRUE TO LINE, WITHOUT DISTORTION OR IMPEDING THERMAL MOVEMENT; ANCHORED SECURELY IN PLACE TO STRUCTURAL SUPPORT, AND IN PROPER RELATION TO WALL FLASHING AND OTHER ADJACENT CONSTRUCTION.
- 3.6 INSTALL ALUMINUM-FRAMED STOREFRONT SYSTEM AND COMPONENTS TO DRAIN CONDENSATION, WATER PENETRATING JOINTS, AND MOISTURE MIGRATING WITHIN ALUMINUM-FRAMED STOREFRONT SYSTEM TO THE EXTERIOR.
- 3.7 INSTALL GLAZING AS SPECIFIED IN SECTION 088000 "GLAZING."

ADJUSTING, CLEANING AND PROTECTION

- 3.8 CLEAN ALUMINUM SURFACES IMMEDIATELY AFTER INSTALLING ALUMINUM-FRAMED STOREFRONTS. AVOID DAMAGING PROTECTIVE COATINGS AND FINISHES. REMOVE EXCESS SEALANTS, GLAZING MATERIALS, DIRT, AND OTHER SUBSTANCES.
- 3.9 CLEAN GLASS IMMEDIATELY AFTER INSTALLATION. COMPLY WITH GLASS MANUFACTURER'S WRITTEN RECOMMENDATIONS FOR FINAL CLEANING AND MAINTENANCE. REMOVE NONPERMANENT LABELS, AND CLEAN SURFACES.
- 3.10 REMOVE AND REPLACE GLASS THAT HAS BEEN BROKEN, CHIPPED, CRACKED, ABRADED, OR DAMAGED DURING CONSTRUCTION PERIOD.

SECTION 08 81 00 / GLAZING

- 1.1 SUBMIT SAMPLES COMPLYING WITH SECTION 01 SB 00 FOR WORK IN THIS SECTION.
- A. REVIEW OF SAMPLES WILL BE FOR COLOR ONLY.
- 1.2 PROVIDE MATERIAL AND INSTALLATION IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS, RECOMMENDATIONS AND INSTALLATION INSTRUCTIONS FOR MATERIALS SPECIFIED.
- 1.3 WATERTIGHT AND AIRTIGHT INSTALLATION OF EACH PIECE OF GLASS IS REQUIRED. EACH INSTALLATION MUST WITHSTAND NORMAL TEMPERATURE CHANGES, WIND LOADING, IMPACT LOADING (FOR OPERATING DOORS) WITHOUT FAILURE INCLUDING LOSS OR BREAKAGE OF GLASS, FAILURE OF SEALANTS OR GASKETS TO REMAIN WATERTIGHT AND AIRTIGHT, DETERIORATION OF GLAZING MATERIALS AND OTHER DEFECTS IN THE WORK.
- 1.4 PROTECT GLASS FROM EDGE DAMAGE DURING HANDLING, INSTALLATION AND OPERATION OF THE BUILDING. GLASS BREAKAGE DURING THE GUARANTEE PERIOD WILL BE CONSIDERED A FORM OF FAULTY INSTALLATION (RESULTING FROM EDGE DAMAGE) UNLESS KNOWN TO RESULT FROM VANDALISM OR OTHER CAUSES NOT RELATED TO MATERIALS AND INSTALLATION.
- 1.5 GLAZING CHAN NEL DIMENSIONS AS SHOWN ARE INTENDED TO PROVIDE FOR NECESSARY MINIMUM BITE ON THE GLASS, MINIMUM EDGE GLEARANGE AND ADEQUATE SEALANT THICKNESSES, WITH REASONABLE TOLERANCES.

PRODUCTS

- 2.1 GLASS AND GLAZING PRODUCTS SHALL BE AS MANUFACTURED BY:
- A. GUARDIAN SUNGUARD ADVANCED ARCHITECTURAL GLASS.
- B. FLEETWOOD AND WESTERN INSULATED GLASS

MATERIALS

- 3.1 REGULAR GLASS: 1/4" THINK COMPLYING WITH FS DD G 451, TYPE I, CLASS I, QUALITY Q 3 PLATE OR FLOAT GLASS, CLEAR.
- 3.2 SHEET GLASS: 1/8" THICK COMPLYING WITH FS DD G 451, TYPE II, CLASS 1, QUALITY Q 5, CLEAR.
- 3.3 TEMPERED GLASS: 1/4" THICK FULLY TEMPERED PLATE GLASS, PERMANENTLY ETCH EACH LIGHT WITH MANUFACTURER'S NAME AND COMPLIANCE WITH ANSI Z 97.1, CLEAR OR TINTED AS INDICATED ON THE DRAWINGS.
- 3.4 CLEAR WIRE GLASS: 1/4" THICK POLISHED WIRE GLASS; SUPERLITE I-W AS MANUFACTURED BY SAFTI OF O'KEEFFE'S, INC., DIAMOND PATTEN WITH 20 / 45 / 60 OR 90 MINUTE RATING AS INDICATED ON THE DRAWINGS.
- 3.5 INSULATING GLASS: " THICK SOLARBAN 6 OR GUARDIAN SUNGUARD.
- 3.6 INTERIOR GLAZING COMPOUND: POLYMERIZE D BUTYL RUBBER AND INERT FILLERS (PIGMENTS), SOLVENT

BASED WITH MINIMUM 75% SOLIDS, NON-SAG CONSISTENCY, TACK FREE TIME OF 24 HOURS OR LESS, PAINTABLE AND NON-STAINING.

- 3.7 SETTING BLOCKS: NEOPRE NE, EPDM, MIN. LENGTH 4".

- 3.8 EXTERIOR GLAZING COMPOUND: CONFORMING TO ASTM 0920, TYPE S, GRADE NS USE G.

INSTALLATION

- 4.1 COMPLY WITH COMBINED RECOMMENDATIONS OF GLASS MANUFACTURER AND MANUFACTURER OF SEALANTS AND OTHER MATERIALS USED IN GLAZING, EXCEPT WHERE MANUFACTURER'S TECHNICAL REPRESENTATIVES DIRECT OTHERWISE. COMPLY WITH GLAZING MANUAL BY FLAT GLASS MANUFACTURER'S ASSOC IATION, AND EXCEPT AS SPECIFICALLY RECOMMENDED OTHERWISE BY THE MANUFACTURERS OF THE GLASS AND GLAZING MATERIALS.
- 4.2 CLEAN THE GLAZING, CHANNEL OR OTHER FRAMING MEMBERS TO RECEIVE GLASS, IMMEDIATELY BEFORE GLAZING. REMOVE COATINGS THAT ARE NOT FIRMLY BONDED TO THE SUBSTRATE. DO NOT ATTEM PT TO CUT, SEAM, NIP OR ABRADE GLASS THAT IS TEMPERED OR HEAT STRENGTHENED.
- 4.3 INSPECT EACH PIECE OF GLASS IMMEDIATELY BEFORE INSTALLATION AND ELIMINATE ANY THAT HAVE OBSERVABLE EDGE DAMAGE OR FACE IMPERFECTIONS. INSTALL SETTING BLOCKS OF PROPER SIZE AT QUARTER POINTS OF MILL RABBIT. SET BLOCKS IN THIS COURSE OF THE HEEL HEAD COMPOUND.
- 4.4 PROVIDE SPACERS INSIDE AND OUT, AND OF PROPER SIZE AND SPACING, FOR GLASS SIZES LARGER THAN 60 UNITED INCHES. PROVIDE 1/8" MINIMUM BITE OF SPACERS ON GLASS, AND USE THICKNESS EQUAL TO SEALANT WIDTH. UNIFY APPEARANCE OF EACH SERIES OF LIGHTS BY SETTING EACH PIECE TO MATCH OTHERS AS NEARLY AS POSSIBLE. INSPECT EACH PIECE AND SET WITH PATTERN, DRAW AND BOW ORIENTED IN THE NAME DIRECTION AS OTHER PIECES.
- 4.5 MITER CUT AND BOND ENDS TOGETHER AT CORNERS WHERE GASKETS ARE USED FOR CHANNEL GLAZING, SO THAT GASKETS WILL NOT PULL AWAY FROM CORNERS AND RESULT IN VOIDS OR LEAKS.

SECTION 09 24 23 / DRYVIT SYSTEMS

PART I - GENERAL

SUMMARY:

THIS DOCUMENT IS INTENDED TO BE USED IN PREPARING SPECIFICATIONS FOR PROJECTS UTILIZING COMMERCIAL CEMENT PLASTER 2 BY DRYVIT APPLIED TO PROPERLY FRAMED AND SHEATHED EXTERIOR WALL ASSEMBLIES. FOR COMPLETE PRODUCT DESCRIPTION AND USAGE REFER TO:

A. DRYVIT COMMERCIAL CEMENT PLASTER 2 DATA SHEET DS813

B. DRYVIT COMMERCIAL CEMENT PLASTER 2 INSTALLATION DETAILS DS825

C. DRYVIT COMMERCIAL CEMENT PLASTER BASE™ – SANDED DS817

D. DRYVIT COMMERCIAL CEMENT PLASTER BASE™ – CONCENTRATE DS818

SUBMITTALS

- 1.1 SUBMITTAL REQUIREMENTS BY THE CONTRACTOR ARE TO BE INDICATED IN THE CONSTRUCTION DOCUMENTS AS REQUIRED, INCLUDING:
- A. PRODUCT LITERATURE, SAMPLES OR MOCK UP.

DESCRIPTION

COMMERCIAL CEMENT PLASTER 2 CONSISTS OF DRYVIT CCP BASE - SANDED OR CONCENTRATE", DRYVIT ACRYLIC PRIMER AND DRYVIT ACRYLIC COATING OR FINISH. CCP BASE IS APPLIED DIRECTLY TO THE PROPERLY INSTALLED METAL LATH (AS SPECIFIED), OTHER APPROVED SCRATCH AND BROWN COATS MAY BE ACCEPTABLE. CONSULT DRYVIT SYSTEMS, INC. FOR SPECIFICS.

DESIGN REQUIREMENTS:

- 1.2 SUBSTRATES SHALL COMPLY WITH LOCAL CODE REQUIREMENTS AND PRACTICES FOR USE UNDER CEMENT PLASTER AND SHALL BE WOOD OR METAL FRAMED WALL ASSEMBLIES SHEATHED WITH APPROVED SUBSTRATES AS FOLLOWS:
- A. EXTERIOR GRADE GYPSUM SHEATHING MEETING ASTM C 1396 (FORMERLY C 79) REQUIREMENTS FOR WATER RESISTANT CORE OR TYPE X CORE AT THE TIME OF APPLICATION OF THE COMMERCIAL CEMENT PLASTER SYSTEM 2.
- B. EXTERIOR SHEATHING HAVING A WATER-RESISTANT CORE WITH FIBERGLASS MAT FACERS MEETING ASTM C 1177.
- C. EXTERIOR FIBER REINFORCED CEMENT OR CALCIUM SILICATE BOARDS.
- D. APA EXTERIOR OR EXPOSURE 1 RATED PLYWOOD, GRADE C-D OR BETTER, NOMINAL 1/2 IN (12.7 MM) MINIMUM, INSTALLED WITH THE C FACE OUT.
- E. APA EXTERIOR OR EXPOSURE 1 FIRE RETARDANT TREATED (FRT) PLYWOOD, GRADE C-D OR BETTER, NOMINAL 1/2 IN (12.7 MM) MINIMUM, INSTALLED WITH THE C FACE OUT.
- F. APA EXPOSURE 1 RATED ORIENTED STRAND BOARD (OSB) NOMINAL 1/2 IN (12.7 MM) MINIMUM. NOTE: APPLICATIONS OVER OSB SHEATHING REQUIRES A MINIMUM OF 2 COATS OF BACKSTOP NT – SMOOTH OR SPRAY. BACKSTOP NT – TEXTURE IS NOT RECOMMENDED FOR THE FIELD OF WALL APPLICATION OVER OSB.
- G. THE ROOFING MATERIALS SHALL BE LOADED ONTO THE ROOF AND INTERIOR WALLBOARD STOCKED IN THE BUILDING PRIOR TO THE INSTALLATION OF THE COMMERCIAL CEMENT PLASTER 2. DEFLECTION OF SUBSTRATE SYSTEMS SHALL NOT EXCEED L/800.
- H. THE SLOPE OF INCLINED SURFACES SHALL NOT BE LESS THAN 6:12 (27°) AND THE LENGTH SHALL NOT EXCEED 12 U/305 MM).
- I. SLOPES ON WINDOW/SILLS PROJECTING 4 IN (102 MM) OR LESS, SHALL NOT BE LESS THAN 3:12.

EXPANSION JOINTS:

- 1.3 DESIGN AND LOCATION OF EXPANSION JOINTS SHALL BE DETERMINED BY THE PROJECT DESIGN PROFESSIONAL AND INDICATED ON THE CONTRACT DOCUMENTS. AS A MINIMUM, EXPANSION JOINTS IN COMMERCIAL CEMENT PLASTER 2 ARE REQUIRED AT THE FOLLOWING LOCATIONS:
- A. WHERE EXPANSION JOINTS OCCUR IN THE SUBSTRATE SYSTEM.
- B. WHERE BUILDING EXPANSION JOINTS OCCUR.
- C. AT FLOOR LINES IN WOOD FRAME CONSTRUCTION.
- D. WHERE COMMERCIAL CEMENT PLASTER 2 ABUTS DISSIMILAR MATERIALS.
- E. WHERE THE SUBSTRATE CHANGES.
- F. WHERE SIGNIFICANT STRUCTURAL MOVEMENT OCCURS SUCH AS CHANGES IN ROOFLINE, BUILDING SHAPE OR STRUCTURAL SYSTEM.
- G. CONTROL JOINTS.

- 1.4 DESIGN AND LOCATION OF CONTROL JOINTS SHALL BE DETERMINED BY THE PROJECT DESIGN PROFESSIONAL IN ACCORDANCE WITH ASTM C 1063 AND INDICATED ON THE CONTRACT DRAWINGS. AS A MINIMUM, CONTROL JOINTS SHALL BE LOCATED AT THE FOLLOWING LOCATIONS:
- A. CORNERS OF OPENINGS.
- B. SUCH THAT MONOLITHIC WALL AREAS DO NOT EXCEED 144 FT2 (13.4 M2).
- C. LENGTH TO WIDTH RATIOS OF WALL AREAS SHALL NOT EXCEED 2.5:1.
- D. MAXIMUM SPACING OF CONTROL JOINTS SHALL NOT EXCEED 18 FT (5.5 M).

SEALANTS

REFER TO SECTION 07 90 00 | SHALL MEET ASTM C 920

- 1.5 USE, TYPE AND LOCATION OF SEALANTS IS THE RESPONSIBILITY OF THE PROJECT DESIGNER AND SHALL BE INDICATED ON THE CONTRACT DOCUMENTS.
- 1.6 REFER TO DRYVIT PUBLICATION DS153 FOR A LIST OF SEALANTS THAT HAVE BEEN TESTED FOR COMPATIBILITY WITH DRYVIT PRODUCTS.

VAPOR RETARDERS

- 1.7 USE AND LOCATION OF VAPOR RETARDERS WITHIN A WALL ASSEMBLY IS THE RESPONSIBILITY OF THE PROJECT DESIGNER AND SHALL COMPLY WITH LOCAL BUILDING CODE REQUIREMENTS. TYPE AND LOCATION SHALL BE NOTED ON THE CONTRACT DOCUMENTS. VAPOR RETARDERS MAY BE INAPPROPRIATE IN CERTAIN AREAS AND CAN RESULT IN CONDENSATION WITHIN THE WALL ASSEMBLY WHEN INCORRECTLY USED. REFER TO DRYVIT PUBLICATION DS159 FOR ADDITIONAL INFORMATION.

- 1.8 FLASHING SHALL BE PROVIDED AT ALL ROOF-WALL INTERSECTIONS, WINDOWS, DOORS, CHIMNEYS, DECKS, BALCONIES, AND OTHER AREAS AS NECESSARY TO PREVENT WATER PENETRATION BEHIND COMMERCIAL CEMENT PLASTER 2.

- 1.9 SITE COATED EPS SHAPES AND STARTER BOARDS: SHALL BE COATED ON SITE UTILIZING THE SAME MATERIALS (EPS, BASE MATERIAL MIXTURE, REINFORCING MESH, AND FINISH) AS SPECIFIED FOR THE PROJECT.

- 1.10 MACHINE-COATED EPS SHAPES AND STARTER BOARDS: SHALL BE SUPPLIED BY A MANUFACTURER THAT SUBSCRIBES TO THE DRYVIT THIRD PARTY CERTIFICATION AND QUALITY ASSURANCE PROGRAM.

QUALITY ASSURANCE

- 1.11 MANUFACTURER: SHALL BE DRYVIT SYSTEMS, INC. OR APPROVED SUPPLIERS. ALL MATERIALS SHALL BE OBTAINED FROM DRYVIT SYSTEMS, INC. OR ITS AUTHORIZED DISTRIBUTORS.
- 1.12 PLASTERING CONTRACTOR



#2001

610 NW CHIPMAN ROAD

LEE'S SUMMIT, MO 64086 PROPOSED LOT 3

PROTOTYPE VERSION 2.00



513 MAIN STREET
FORT WORTH TX 76102

STEVEN COX
NUMBER
A-2023017238
Architect

PERMIT SET: 04/12/2024

CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DIMENSIONAL ERRORS, OMISSIONS OR DISCREPANCIES BEFORE BEGINNING OR FABRICATING ANY WORK. DO NOT SCALE DRAWINGS.

PROJECT INFORMATION

PROJECT NO: 24-0087
ORIGINAL ISSUE: 06/01/2023
SCALE: AS NOTED
DRAWN BY: P. C
CHECKED BY: J. JEFFERY

SHEET TITLE

SPECIFICATIONS

SHEET NUMBER

A806

<div> <div>DELIVERY, STORAGE, AND HANDLING</div> <div> <div>3.1</div> <div> DELIVERY: DELIVER MANUFACTURER'S UNOPENED CONTAINERS TO THE WORK SITE. PACKAGING SHALL BEAR THE MANUFACTURER'S NAME, LABEL, AND THE FOLLOWING LIST OF INFORMATION. A. PRODUCT NAME, AND TYPE (DESCRIPTION). B. APPLICATION AND USE INSTRUCTIONS. C. SURFACE PREPARATION. D. VOC CONTENT. E. ENVIRONMENTAL HANDLING. F. BATCH DATE. G. COLOR NUMBER. </div> </div> </div> <div> <div>3.2</div> <div> STORAGE: STORE AND DISPOSE OF SOLVENT-BASED MATERIALS, AND MATERIALS USED WITH SOLVENT-BASED MATERIALS, IN ACCORDANCE WITH REQUIREMENTS OF LOCAL AUTHORITIES HAVING JURISDICTION. </div> </div> <div> <div>3.3</div> <div> STORE MATERIALS IN AN AREA THAT IS WITHIN THE ACCEPTABLE TEMPERATURE RANGE, PER MANUFACTURER'S INSTRUCTIONS. PROTECT FROM FREEZING. </div> </div> <div> <div>3.4</div> <div> HANDLING: MAINTAIN A CLEAN, DRY STORAGE AREA, TO PREVENT CONTAMINATION OR DAMAGE TO THE COATINGS. </div> </div> <div> <div>PROJECT CONDITIONS</div> <div> <div>4.1</div> <div> MAINTAIN ENVIRONMENTAL CONDITIONS (TEMPERATURE, HUMIDITY, AND VENTILATION) WITHIN LIMITS RECOMMENDED BY MANUFACTURER FOR OPTIMUM RESULTS. DO NOT INSTALL PRODUCTS UNDER ENVIRONMENTAL CONDITIONS OUTSIDE MANUFACTURER'S RECOMMENDED LIMITS. </div> </div> </div> <div> <div>EXTRA MATERIALS</div> <div> <div>5.1</div> <div> FURNISH EXTRA PAINT MATERIALS FROM THE SAME PRODUCTION RUN AS THE MATERIALS APPLIED AND, IN THE QUANTITIES, DESCRIBED BELOW. PACKAGE WITH PROTECTIVE COVERING FOR STORAGE AND IDENTIFY WITH LABELS DESCRIBING CONTENTS. DELIVER EXTRA MATERIALS TO OWNER. </div> </div> <div> <div>5.2</div> <div> FURNISH OWNER WITH AN ADDITIONAL ONE PERCENT OF EACH MATERIAL AND COLOR, BUT NOT LESS THAN 1 GAL (3.8 L) OR 1 CASE, AS APPROPRIATE. </div> </div> </div>			<div> <div>14.2</div> <div> PROCEED WITH WORK ONLY AFTER CONDITIONS HAVE BEEN CORRECTED AND APPROVED BY ALL PARTIES. OTHERWISE APPLICATION OF COATINGS WILL BE CONSIDERED AS AN ACCEPTANCE OF SURFACE CONDITIONS. </div> </div> <div> <div>14.3</div> <div> PREVIOUSLY PAINTED SURFACES: VERIFY THAT EXISTING PAINTED SURFACES DO NOT CONTAIN LEAD-BASED PAINTS, NOTIFY ARCHITECT IMMEDIATELY IF LEAD-BASED PAINTS ARE ENCOUNTERED. </div> </div> <div> <div>SURFACE PREPARATION</div> <div> <div>15.1</div> <div> GENERAL: SURFACES SHALL BE DRY AND IN SOUND CONDITION. REMOVE OIL, DUST, DIRT, LOOSE RUST, PEELING PAINT OR OTHER CONTAMINATION TO ENSURE GOOD ADHESION. </div> </div> <div> <div>15.2</div> <div> PRIOR TO ATTEMPTING TO REMOVE MILDEW, IT IS RECOMMENDED TO TEST ANY CLEANER ON A SMALL, INCONSPICUOUS AREA PRIOR TO USE. BLEACH AND BLEACHING TYPE CLEANERS MAY DAMAGE OR DISCOLOR EXISTING PAINT FILMS. BLEACH ALTERNATIVE CLEANING SOLUTIONS ARE ADVISED. </div> </div> <div> <div>15.3</div> <div> REMOVE MILDEW BEFORE PAINTING BY WASHING WITH A SOLUTION OF 1 PART LIQUID HOUSEHOLD BLEACH AND 3 PARTS OF WARM WATER. APPLY SOLUTION AND SCRUB THE MILDEWED AREA. ALLOW SOLUTION TO REMAIN ON THE SURFACE FOR 10 MINUTES. RINSE THOROUGHLY WITH CLEAN WATER AND ALLOW SURFACE TO DRY BEFORE PAINTING. WEAR PROTECTIVE GLASSES OR GOGGLES, WATERPROOF GLOVES, AND PROTECTIVE CLOTHING. QUICKLY WASH OFF ANY OF THE MIXTURE THAT COMES IN CONTACT WITH YOUR SKIN. DO NOT ADD DETERGENTS OR AMMONIA TO THE BLEACH/WATER SOLUTION. </div> </div> <div> <div>15.4</div> <div> REMOVE ITEMS INCLUDING BUT NOT LIMITED TO THERMOSTATS, ELECTRICAL OUTLETS, SWITCH COVERS AND SIMILAR ITEMS PRIOR TO PAINTING. AFTER COMPLETING PAINTING OPERATIONS IN EACH SPACE OR AREA, REINSTALL ITEMS REMOVED USING WORKERS SKILLED IN THE TRADES INVOLVED. </div> </div> <div> <div>15.5</div> <div> NO EXTERIOR PAINTING SHOULD BE DONE IMMEDIATELY AFTER A RAIN, DURING FOGGY WEATHER, WHEN RAIN IS PREDICTED, OR WHEN THE TEMPERATURE IS BELOW 50 DEGREES F (10 DEGREES C), UNLESS PRODUCTS ARE DESIGNED SPECIFICALLY FOR THESE CONDITIONS. ON LARGE EXPANSES OF METAL SIDING, THE AIR, SURFACE AND MATERIAL TEMPERATURES MUST BE 50 DEGREES F (10 DEGREES F) OR HIGHER TO USE LOW TEMPERATURE PRODUCTS. </div> </div> <div> <div>15.6</div> <div> ALUMINUM: REMOVE ALL OIL, GREASE, DIRT, OXIDE, AND OTHER FOREIGN MATERIAL BY CLEANING PER SSPC-SP1, SOLVENT CLEANING. </div> </div> <div> <div>15.7</div> <div> BLOCK (CINDER AND CONCRETE): REMOVE ALL LOOSE MORTAR AND FOREIGN MATERIAL. SURFACE MUST BE FREE OF LAITANCE, CONCRETE DUST, DIRT, FORM RELEASE AGENTS, MOISTURE CURING MEMBRANES, LOOSE CEMENT, AND HARDENERS. CONCRETE AND MORTAR MUST BE CURED AT LEAST 30 DAYS AT 75 DEGREES F (24 DEGREES C). THE PH OF THE SURFACE SHOULD BE BETWEEN 8 AND 9 UNLESS THE PRODUCTS ARE DESIGNED TO BE USED IN HIGH PH ENVIRONMENTS. ON TILT-UP AND POURED-IN-PLACE CONCRETE, COMMERCIAL DETERGENTS AND ABRASIVE BLASTING MAY BE NECESSARY TO PREPARE THE SURFACE. FILL BUG HOLES, AIR POCKETS, AND OTHER VOIDS WITH A CEMENT PATCHING COMPOUND. </div> </div> <div> <div>15.8</div> <div> CONCRETE, SSPC-SP13 OR NACE 6: THIS STANDARD GIVES REQUIREMENTS FOR SURFACE PREPARATION OF CONCRETE BY MECHANICAL, CHEMICAL, OR THERMAL METHODS PRIOR TO THE APPLICATION OF BONDED PROTECTIVE COATING OR LINING SYSTEMS. THE REQUIREMENTS OF THIS STANDARD ARE APPLICABLE TO ALL TYPES OF CEMENTITIOUS SURFACES INCLUDING CAST-IN-PLACE CONCRETE FLOORS AND WALLS, PRECAST SLABS, MASONRY WALLS, AND SHOTCRETE SURFACES. AN ACCEPTABLE PREPARED CONCRETE SURFACE SHOULD BE FREE OF CONTAMINANTS, LAITANCE, LOOSELY ADHERING CONCRETE, AND DUST, AND SHOULD PROVIDE A SOUND, UNIFORM SUBSTRATE SUITABLE FOR THE APPLICATION OF PROTECTIVE COATING OR LINING SYSTEMS. </div> </div> <div> <div>15.9</div> <div> CEMENT COMPOSITION SIDING/PANELS: REMOVE ALL SURFACE CONTAMINATION BY WASHING WITH AN APPROPRIATE CLEANER, RINSE THOROUGHLY AND ALLOW TO DRY. EXISTING PEELED OR CHECKED PAINT SHOULD BE SCRAPED AND SANDED TO A SOUND SURFACE. PRESSURE CLEAN, IF NEEDED, WITH A MINIMUM OF 2100 PSI PRESSURE. REMOVE ALL DIRT, DUST, GREASE, OIL, LOOSE PARTICLES, LAITANCE, FOREIGN MATERIAL, AND PEELING OR DEFECTIVE COATINGS. ALLOW THE SURFACE TO DRY THOROUGHLY. THE PH OF THE SURFACE SHOULD BE BETWEEN 8 AND 9 UNLESS THE PRODUCTS ARE DESIGNED TO BE USED IN HIGH PH ENVIRONMENTS. </div> </div> <div> <div>15.10</div> <div> COPPER AND STAINLESS STEEL: REMOVE ALL OIL, GREASE, DIRT, OXIDE, AND OTHER FOREIGN MATERIAL BY CLEANING PER SSPC-SP2, HAND TOOL CLEANING. </div> </div> <div> <div>15.11</div> <div> EXTERIOR COMPOSITION BOARD (HARDBOARD): SOME COMPOSITION BOARDS MAY EXUDE A WAXY MATERIAL THAT MUST BE REMOVED WITH A SOLVENT PRIOR TO COATING. WHETHER FACTORY PRIMED OR UNPRIMED, EXTERIOR COMPOSITION BOARD SIDING (HARDBOARD) MUST BE CLEANED THOROUGHLY AND PRIMED WITH AN ALKYD PRIMER. </div> </div> <div> <div>15.12</div> <div> DRYWALL - EXTERIOR: MUST BE CLEAN AND DRY. ALL NAIL HEADS MUST BE SET AND SPACKLED. JOINTS MUST BE TAPED AND COVERED WITH A JOINT COMPOUND. SPACKLED NAIL HEADS AND TAPE JOINTS MUST BE SANDED SMOOTH, AND ALL DUST REMOVED PRIOR TO PAINTING. EXTERIOR SURFACES MUST BE SPACKLED WITH EXTERIOR GRADE COMPOUNDS. </div> </div> <div> <div>15.13</div> <div> DRYWALL - INTERIOR: MUST BE CLEAN AND DRY. ALL NAIL HEADS MUST BE SET AND SPACKLED. JOINTS MUST BE TAPED AND COVERED WITH A JOINT COMPOUND. SPACKLED NAIL HEADS AND TAPE JOINTS MUST BE SANDED SMOOTH, AND ALL DUST REMOVED PRIOR TO PAINTING. </div> </div> <div> <div>15.14</div> <div> GALVANIZED METAL: CLEAN PER SSPC-SP1 USING DETERGENT AND WATER OR A DEGREASING CLEANER TO REMOVE GREASES AND OILS. APPLY A TEST AREA, PRIMING AS REQUIRED. ALLOW THE COATING TO DRY AT LEAST ONE WEEK BEFORE TESTING. IF ADHESION IS POOR, BRUSH BLAST PER SSPC-SP16 IS NECESSARY TO REMOVE THESE TREATMENTS. </div> </div> <div> <div>15.15</div> <div> PLASTER: MUST BE ALLOWED TO DRY THOROUGHLY FOR AT LEAST 30 DAYS BEFORE PAINTING UNLESS THE PRODUCTS ARE DESIGNED TO BE USED IN HIGH PH ENVIRONMENTS. ROOM MUST BE VENTILATED WHILE DRYING. IN COLD, DAMP WEATHER, ROOMS MUST BE HEATED. DAMAGED AREAS MUST BE REPAIRED WITH AN APPROPRIATE PATCHING MATERIAL. BARE PLASTER MUST BE CURED AND HARD, TEXTURED, SOFT, POROUS, OR POWDERY PLASTER SHOULD BE TREATED WITH A SOLUTION OF 1 PINT HOUSEHOLD VINEGAR TO 1 GALLON OF WATER. REPEAT UNTIL THE SURFACE IS HARD, RINSE WITH CLEAR WATER AND ALLOW TO DRY. </div> </div> <div> <div>15.16</div> <div> STEEL: STRUCTURAL PLATE, AND SIMILAR ITEMS: SHOULD BE CLEANED BY ONE OR MORE OF THE SURFACE PREPARATIONS DESCRIBED BELOW. THESE METHODS ARE USED THROUGHOUT THE WORLD FOR DESCRIBING METHODS FOR CLEANING STRUCTURAL STEEL. VISUAL STANDARDS ARE AVAILABLE THROUGH THE SOCIETY OF PROTECTIVE COATINGS. A BRIEF DESCRIPTION OF THESE STANDARDS TOGETHER WITH NUMBERS BY WHICH THEY CAN BE SPECIFIED FOLLOW. </div> </div> <div> <div>15.17</div> <div> SOLVENT CLEANING, SSPC-SP1: SOLVENT CLEANING IS A METHOD FOR REMOVING ALL VISIBLE OIL, GREASE, SOIL, DRAWING AND CUTTING COMPOUNDS, AND OTHER SOLUBLE CONTAMINANTS. SOLVENT CLEANING DOES NOT REMOVE RUST OR MILL SCALE. CHANGE RAGS AND CLEANING SOLUTION FREQUENTLY SO THAT DEPOSITS OF OIL AND GREASE ARE NOT SPREAD OVER ADDITIONAL AREAS IN THE CLEANING PROCESS. BE SURE TO ALLOW ADEQUATE VENTILATION. </div> </div> <div> <div>15.18</div> <div> HAND TOOL CLEANING, SSPC-SP2: HAND TOOL CLEANING REMOVES ALL LOOSE MILL SCALE, LOOSE RUST, AND OTHER DETRIMENTAL FOREIGN MATTER. IT IS NOT INTENDED THAT ADHERENT MILL SCALE, RUST, AND PAINT BE REMOVED BY THIS PROCESS. BEFOREHAND TOOL CLEANING, REMOVE VISIBLE OIL, GREASE, SOLUBLE WELDING RESIDUES, AND SALTS BY THE METHODS OUTLINED IN SSPC-SP1. </div> </div> <div> <div>15.19</div> <div> POWER TOOL CLEANING, SSPC-SP3: POWER TOOL CLEANING REMOVES ALL LOOSE MILL SCALE, LOOSE RUST, AND OTHER DETRIMENTAL FOREIGN MATTER. IT IS NOT INTENDED THAT ADHERENT MILL SCALE, RUST, AND PAINT BE REMOVED BY THIS PROCESS. BEFORE POWER TOOL CLEANING, REMOVE VISIBLE OIL, GREASE, SOLUBLE WELDING RESIDUES, AND SALTS BY THE METHODS OUTLINED IN SSPC-SP1. </div> </div> <div> <div>15.20</div> <div> WHITE METAL BLAST CLEANING, SSPC-SP5 OR NACE 1: A WHITE METAL BLAST CLEANED SURFACE, WHEN VIEWED WITHOUT MAGNIFICATION, SHALL BE FREE OF ALL VISIBLE OIL, GREASE, DIRT, DUST, MILL SCALE, RUST, PAINT, OXIDES, CORROSION PRODUCTS, AND OTHER FOREIGN MATTER. BEFORE BLAST CLEANING, VISIBLE DEPOSITS OF OIL OR GREASE SHALL BE REMOVED BY ANY OF THE METHODS SPECIFIED IN SSPC-SP1 OR OTHER AGREED UPON METHODS. </div> </div> <div> <div>15.21</div> <div> COMMERCIAL BLAST CLEANING, SSPC-SP6 OR NACE 3: A COMMERCIAL BLAST CLEANED SURFACE, WHEN VIEWED WITHOUT MAGNIFICATION, SHALL BE FREE OF ALL VISIBLE OIL, GREASE, DIRT, DUST, MILL SCALE, RUST, PAINT, OXIDES, CORROSION PRODUCTS, AND OTHER FOREIGN MATTER. BEFORE BLASTING, STAINING SHALL BE LIMITED TO NO MORE THAN 33 PERCENT OF EACH SQUARE INCH OF SURFACE AREA AND MAY CONSIST OF LIGHT SHADOWS, SLIGHT STREAKS, OR MINOR DISCOLORATION CAUSED BY STAINS OF RUST, STAINS OF MILL SCALE, OR STAINS OF PREVIOUSLY APPLIED PAINT. BEFORE BLAST CLEANING, VISIBLE DEPOSITS OF OIL OR GREASE SHALL BE REMOVED BY ANY OF THE METHODS SPECIFIED IN SSPC-SP1 OR OTHER AGREED UPON METHODS. </div> </div> <div> <div>15.22</div> <div> BRUSH-OFF BLAST CLEANING, SSPC-SP7 OR NACE 4: A BRUSH-OFF BLAST CLEANED SURFACE, WHEN VIEWED WITHOUT MAGNIFICATION, WHEN VIEWED WITHOUT MAGNIFICATION, SHALL BE FREE OF ALL VISIBLE OIL, GREASE, DIRT, DUST, MILL SCALE, RUST, PAINT, OXIDE CORROSION PRODUCTS, AND OTHER FOREIGN MATTER. SLIGHT RESIDUES OF RUST AND PAINT MAY BE LEFT IN THE LOWER PORTIONS OF PITS IF THE ORIGINAL SURFACE IS PITTED. PRIOR TO POWER TOOL SURFACE PREPARATION, REMOVE VISIBLE DEPOSITS OF OIL OR GREASE BY ANY OF THE METHODS SPECIFIED IN SSPC-SP1, SOLVENT CLEANING, OR OTHER AGREED UPON METHODS. </div> </div> <div> <div>15.23</div> <div> POWER TOOL CLEANING TO BARE METAL, SSPC-SP11: METALLIC SURFACES THAT ARE PREPARED ACCORDING TO THIS SPECIFICATION, WHEN VIEWED WITHOUT MAGNIFICATION, SHALL BE FREE OF ALL VISIBLE OIL, GREASE, DIRT, DUST, MILL SCALE, RUST, PAINT, OXIDE CORROSION PRODUCTS, AND OTHER FOREIGN MATTER. SLIGHT RESIDUES OF RUST AND PAINT MAY BE LEFT IN THE LOWER PORTIONS OF PITS IF THE ORIGINAL SURFACE IS PITTED. PRIOR TO POWER TOOL SUR</div></div></div>
--	--	--	--

FIXTURE & EQUIPMENT SCHEDULE												
ITEM NO.	DESCRIPTION	MODEL	QTY	FURNISHED BY		INSTALLED BY		PLUMBING		ELECTRICAL		REMARK
				OWNER	GC	OWNER	GC	WATER	WASTE	VOLT	AMP	
0 SHELVES, RACKS												
00A	WALK IN COOLER RACK W/ (4) SHELVES	60" L X 18"D X 72"H	5	X		X						
01A	WALK IN COOLER RACK W/ (4) SHELVES	48"L X 18"D X 72"H	2	X		X						
02	TORTILLA RACK W/ (2) SHELVES	24"L X 14"D	1	X		X						
03	KITCHEN RACK W/ (5) SHELVES	48"L X 24"D X 72"H	1	X		X						OFCL. DO NOT PLACE BOTTOM 2 SHELVES OVER FLOOR SINK.
03A	KITCHEN RACK W/ (5) SHELVES	36"L X 18"D X 72"H	1	X		X						OFCL. DO NOT PLACE BOTTOM 2 SHELVES OVER FLOOR SINK.
04	KITCHEN SHELF - HUNG FROM STRUCTURE	72" L X 24"D	5	X			X					OWNER FURNISHED CONTRACTOR INSTALLED
05	KITCHEN SHELF - HUNG FROM STRUCTURE	48" L X 24"D	6	X			X					OWNER FURNISHED CONTRACTOR INSTALLED
06	KITCHEN SHELF - HUNG FROM STRUCTURE	36" L X 24"D	2	X			X					OWNER FURNISHED CONTRACTOR INSTALLED
07	S S SHELF - HUNG FROM WALL	36" L X 18"D	4	X			X					
08	SOLID SURFACE SHELF	ASH AGGREGATE CORIAN SHELF	2		X		X					REFER TO DETAIL 11/A503.

1 TABLES												
10	WORK TABLE - STAINLESS STEEL	GSW USA WT-E304B	1	X		X						
11	FOOD PREP TABLE - STAINLESS STEEL	TRUE - TSSU-72-30M-B-DS-ST-ADA-HC	2	X		X				115	7.2	5-15R
12A	INTERMEDIATE TABLE - STAINLESS STEEL	15"W X 41 13/16"L X 27"H	1	X		X						
12B	INTERMEDIATE TABLE - STAINLESS STEEL	15"W X 41 13/16"L X 35"H	1	X		X						W/ CUTOUS FOR PANS
13	EXPO TABLE - STAINLESS STEEL	GSW - USA - WT-E3060	1	X		X						
14	DRINK TABLE - STAINLESS STEEL	14'-6"L X 30"D	1	X		X						USED W/ DOUBLE D/T UNITS
15	PREP TABLE - STAINLESS STEEL	9'-6"L X 30"D	1	X		X						RIGHT DRIVE THRU SIDE PREP TABLE
17	DESK - MANAGERS WORKSTATION	80" L X 18"D X 30"H	1		X		X					WALL MOUNTED
18	P.O.S TABLE - STAINLESS STEEL	30" L X 30"D	1	X		X						
19	DRIVE THRU TABLE - STAINLESS STEEL	70" L X 18"D	1	X		X						
19A	MOBILE EXPRESS TABLE - STAINLESS STEEL	30" L X 20"D	1	X		X						

2 WARMERS												
20	HIGH SPEED COMBINATION MICROWAVE OVEN	AMANA COMMERCIAL XPRESS IQ MXP221LT	1	X		X				208-240	40	6-30R
21	PANINI PRESS	WARING WFG275	1	X		X				120	15	5-15R
22	CAYENNE NITRO POWER RETHERMALIZER	VOLLRATH PC-21 72090-SW	1	X		X				120	12	5-15R
23	COUNTER TOP (SOUP) WARMER	NEMCO 6055A	2	X		X				120	10	5-15R


3 COOLERS												
30A	WALK IN COOLER 16'-7"L X 7'-11"W X 10"H EXT DIM	KOLPAK 15'-11" X 7'-3" CLEAR INTERIOR SPACE	1	X			X			208-240	20	
31A	BEVERAGE COOLER - SINGLE	TRUE GDM-23-HC - TSL01	2	X		X				120	5.4	5-15R
32A	REFRIGERATED REACH IN COOLER	TRUE TBR60-RIS21-L-B-GG1	1	X		X				120	2.7	5-15R
32B	REFRIGERATED REACH IN COOLER	TRUE TBR48-RIS21-L-B-GG-1	1	X		X				120	2.1	5-15R
33A	UNDER COUNTER ICE MAKER	ICE-O-MATIC ICEU220HA3	2	X		X		5/8" DIA	3/4" DIA	120	11.9	5-15R
33B	ELEVATION SERIES ICE CUBE MAKER	ICE-O-MATIC CIM0520A - B42PS ICE BIN	1	X		X		3/8" DIAM	3/4" DIA	120	17.8	

4 BEVERAGE												
40	FROZEN BEVERAGE DISPENSER	STOELTING F112-38	1	X		X				208-240	20	6-20P
41	HOT COFFEE BREWER	CURTIS - CBHS	1	X		X						
42	ICE TEA BREWER	BUNN ITB DUAL DILUTION 36700.0301 TB6	1	X		X		1/4" DIA		120	14	5-15R
43	LEMONADE BUBBLER	CRATHCO CLASSIC BUBBLERS D35-3	2	X		X				115	8.5	6-15R


5 WATER												
50	(3) COMPARTMENT SINK	GSW USA SE18183D	1	X			X	1/2" DIA	2" DIA			
51	S.S. WALL HUNG HAND SINK W/ FAUCET	GSW USA HS-1615S	2	X			X					T&S BRASS FAUCET B-0133 - 12CRB81P; GSW USA DRAIN AA-303
52	PREP SINK	GSW USA SE18181P	1	X			X					GSW USA FAUCET AA-410G W/ SPLASH GUARDS; STRAINER INCLUDED
53	WATER FILTER		1		X		X	1" DIA		120	16	
54	POT FILLER	B-0594	1	X			X	1/2" DIA				PC TO PROVIDE TO WATER SUPPLY LOOP WITH SHUTOFF VALVES; SEE P SHEETS FOR DETAILS
55	SINK - MOP - 36" X 24" X 10"	MUSTEE MOP BASIN MODEL 65M	1			X	X					SUPPLY FW; SEE PLUMBING SHEETS; DOUBLE JOINTED
55A	FAUCET - MOP SINK WALL MOUNTED	MUSTEE SERVICE FAUCET MODEL 63.006A	1			X	X					SEE SHEETS FOR DETAILS - GC TO FURNISH
56	WATER HEATER OVER MOP SINK	AO SMITH DEL-50	1			X	X					
57	CLICK AND GO CHEMICAL DISPENSER	ECOLAB LIQUID DILUTION SYSTEM	4	X			X					COORDINATE WITH PLUMBING

6 TECH												
60	KIOSK	NCR P1535 AND P1235	5	X		X	X					
61	POS MONITOR		7	X		X						EC TO PROVIDE DATA AND POWER CONNECTIVITY BOX
62	3M HEADSET CHARGER CONTROL STATION		1	X		X				115		5-15R
63	OFFICE MONITOR, PRINTER		2	X		X				115		5-15R
64	SECURITY DVR		1	X		X				120	3	5-15R
65	MUSIC SYSTEM		1	X		X				120	3	
66	DRIVE THRU DETECTOR		1	X			X			120	2	5-15R
67	NETWORK RACK	24 PORT PATCH PANEL	1	X			X					MOUNT AT 72" A.F.F.

7 OTHER												
70	COAT HOOK STRIP - 46IN 1170MM		2	X			X					
71	FIRE EXTINGUISHER	2A10BC	1		X		X					LOCATE AS DIRECTED BY FIRE MARSHAL; DO NOT MOUNT TO WIC
72	MOP RACK		1	X			X					

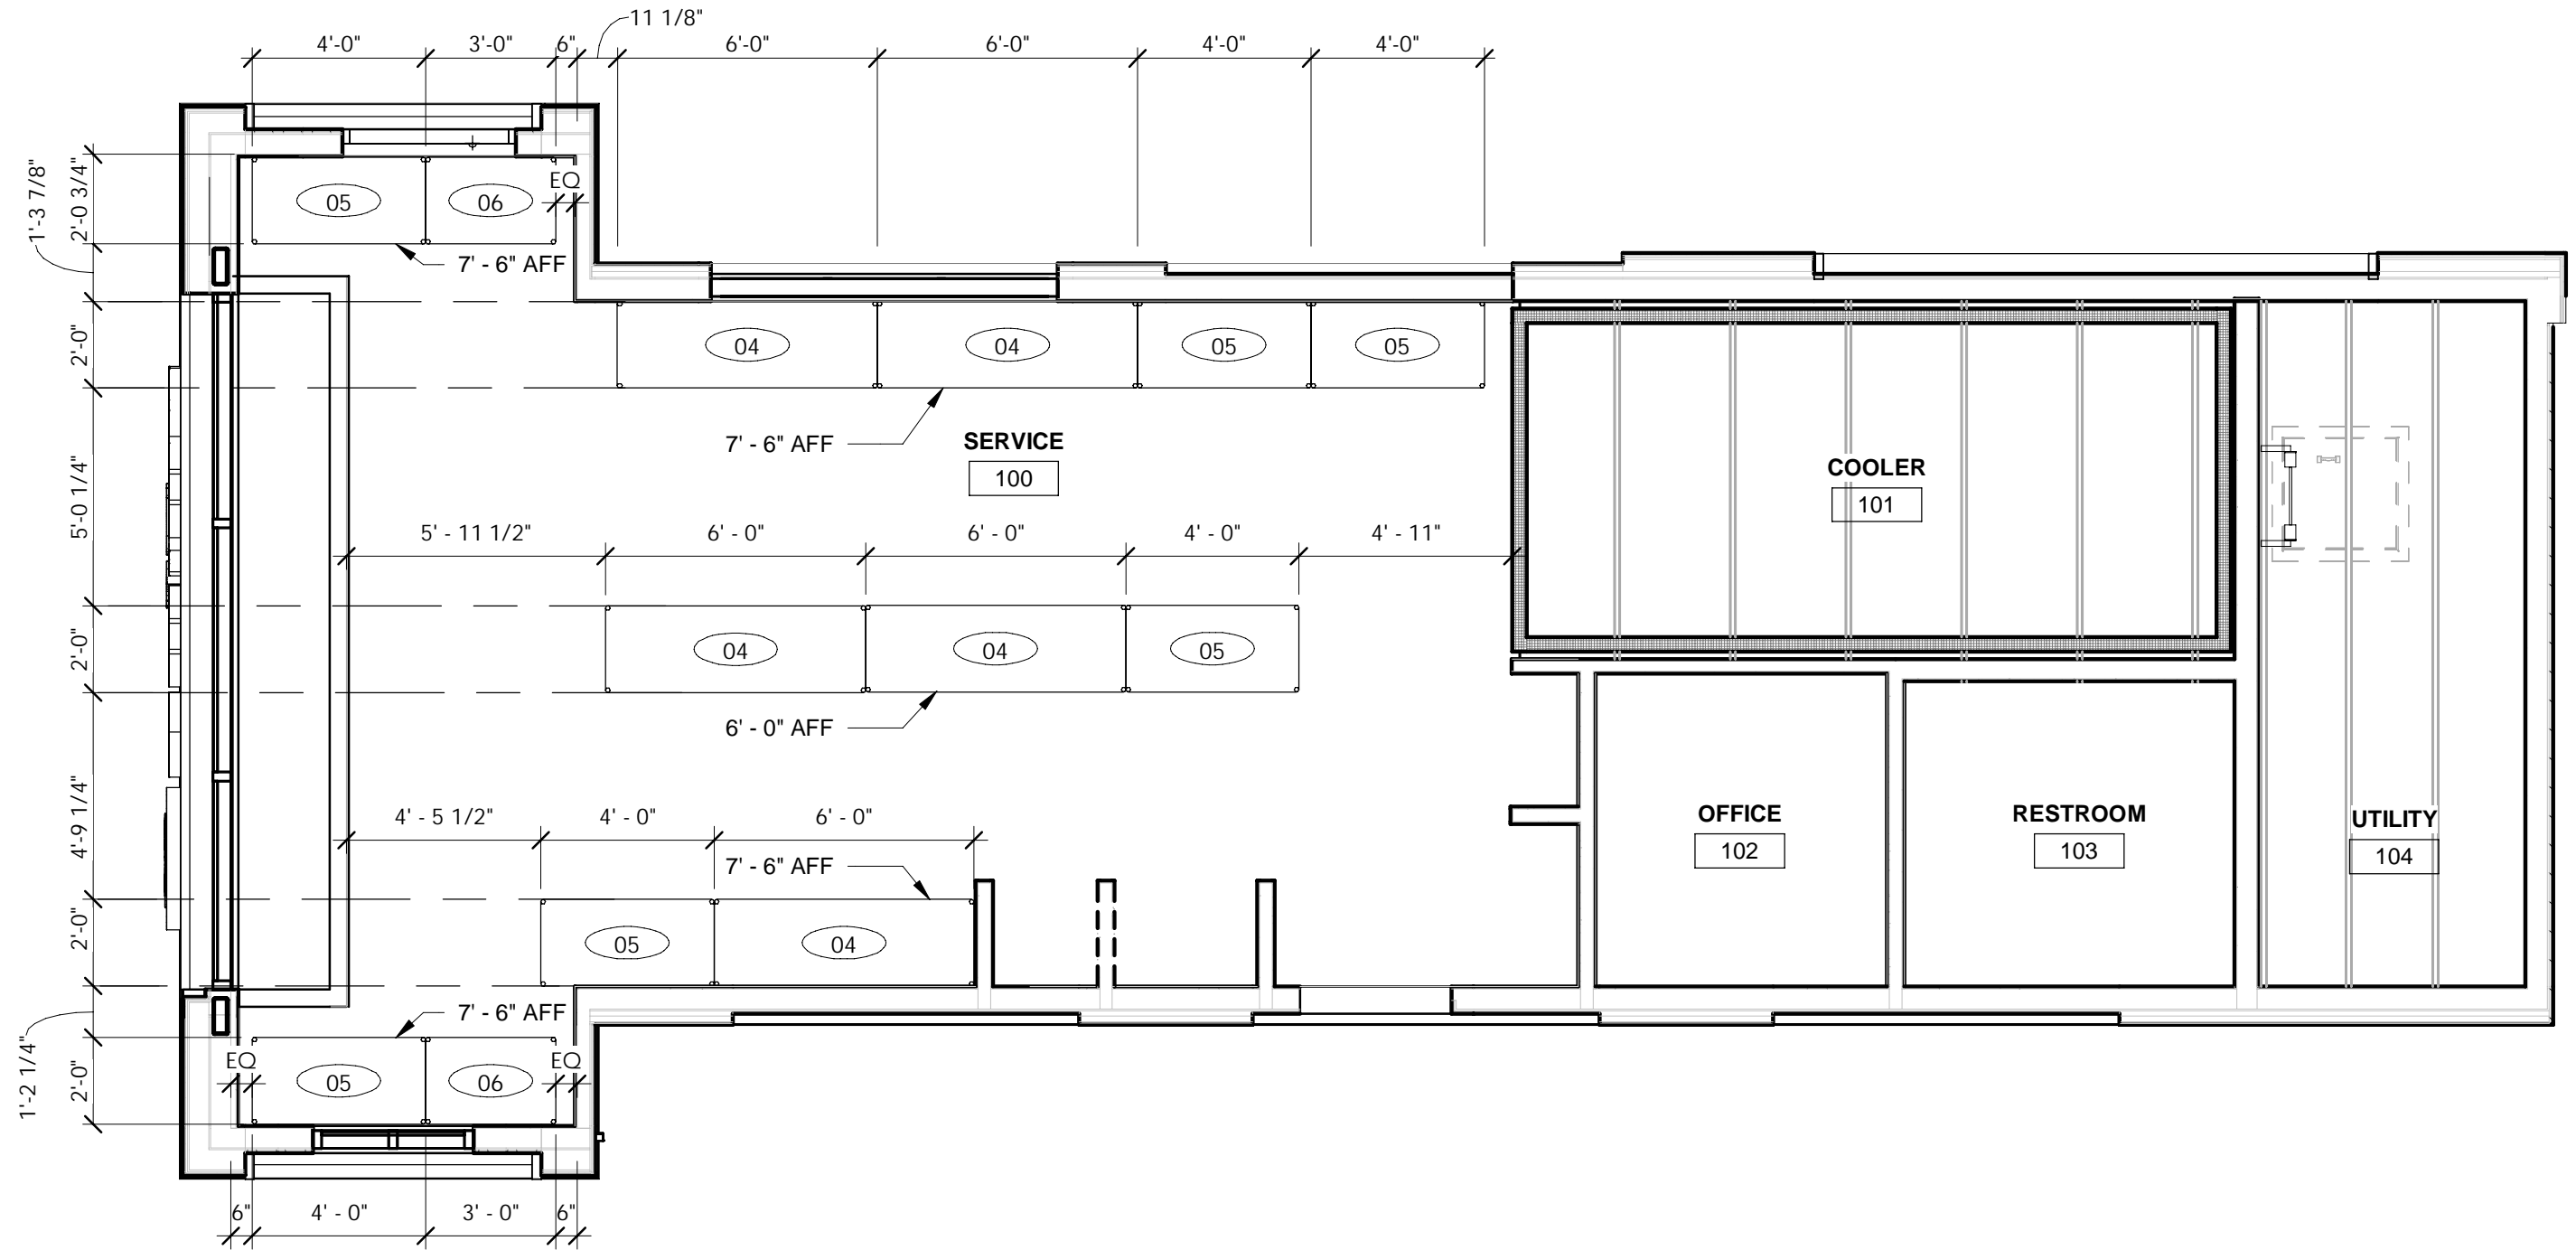

1 | EQUIPMENT REFLECTED CEILING PLAN
1/4" = 1'-0"

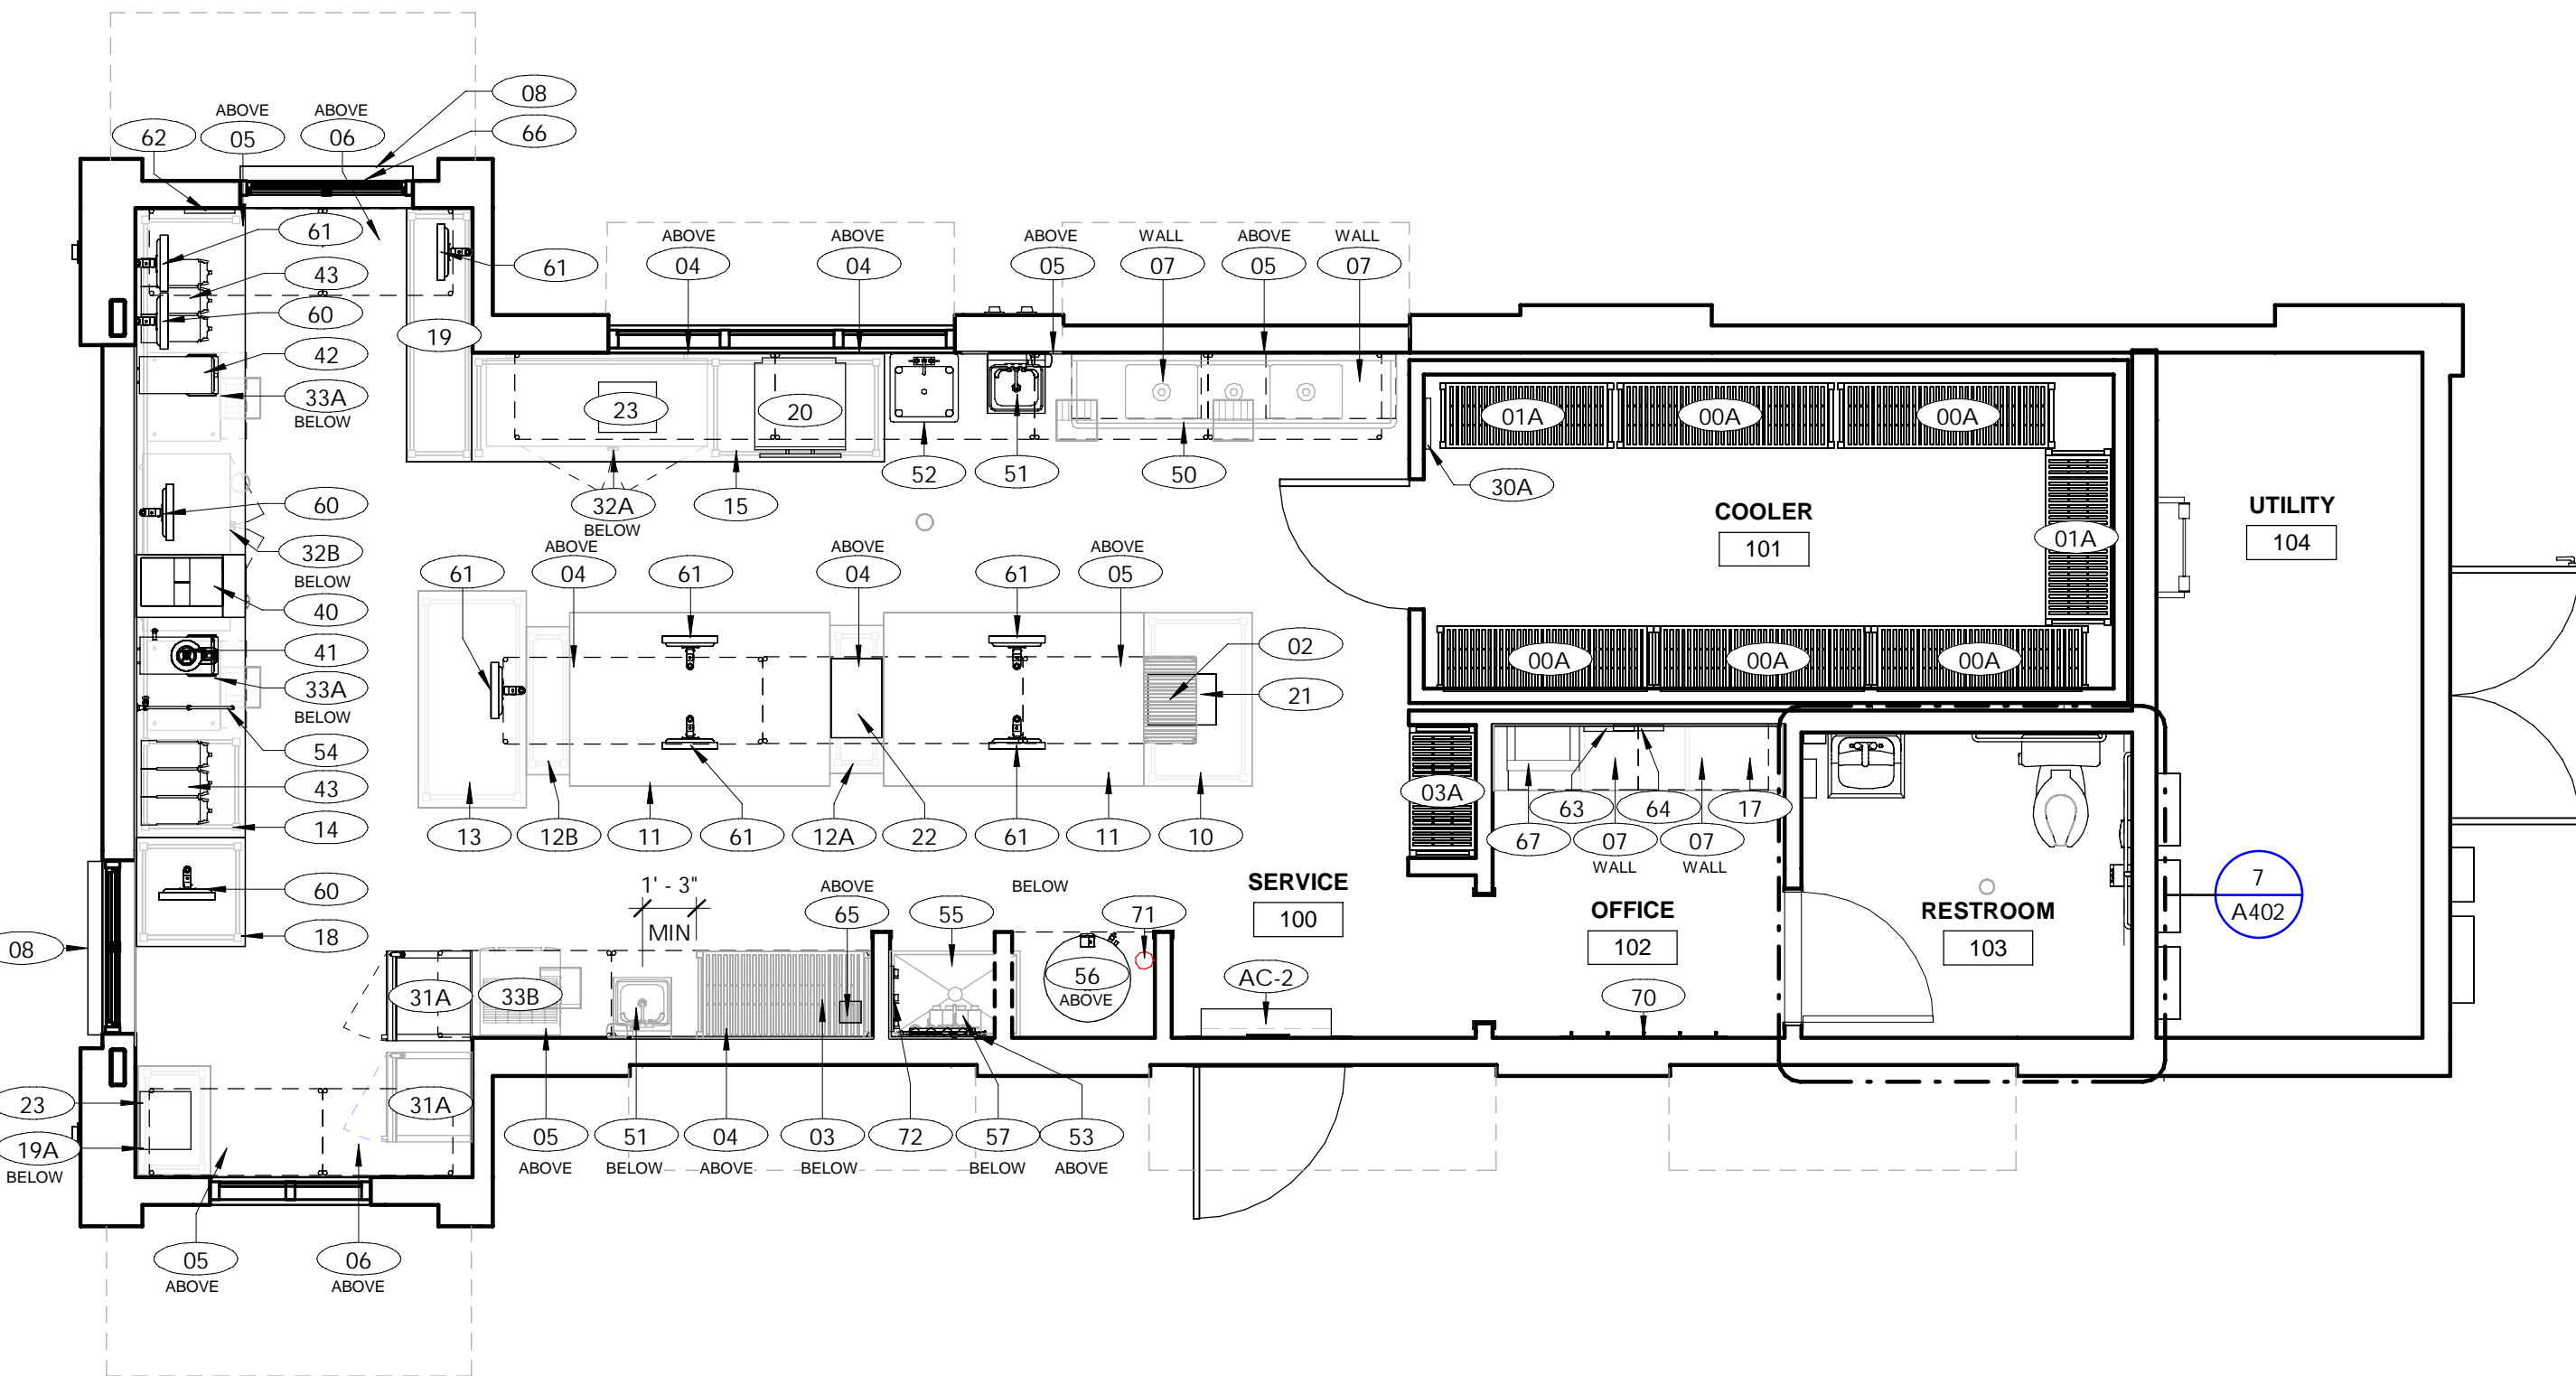

2 | EQUIPMENT FLOOR PLAN
1/4" = 1'-0"

REFRIGERATION

THE ICE MACHINE MUST BE INSTALLED BY A CERTIFIED REFRIGERATION TECHNICIAN. THE GENERAL CONTRACTOR MUST ACCOUNT FOR THIS IN ITS PROPOSAL AND SUBMIT THE TECHNICIAN'S QUALIFICATIONS TO THE OWNER FOR APPROVAL PRIOR TO COMMENCEMENT OF THE WORK. THE GENERAL CONTRACTOR IS SOLELY RESPONSIBLE FOR THE EXTENT OF THIS SCOPE OF WORK, AND SHALL COMPLETE IT IN ACCORDANCE WITH THE "RESPONSIBILITY SCHEDULE".

EQUIPMENT GENERAL NOTES:

- SEE ELECTRICAL FOR ADDITIONAL EQUIPMENT REQUIREMENTS AND ADDITIONAL INFORMATION.
- SEE MECHANICAL AND PLUMBING FOR ADDITIONAL GAS, WATER, AND DRAIN REQUIREMENTS AND INFORMATION.
- ELECTRICAL, MECHANICAL, AND PLUMBING INFORMATION SHOWN WITHIN THE EQUIPMENT SCHEDULE IS FOR REFERENCE ONLY. FOR ELECTRICAL, MECHANICAL, AND PLUMBING INFORMATION SEE CONSULTANT SHEETS AND EQUIPMENT SPECIFICATION SHEETS.
- FOR WALL MOUNTED SHELVING LOCATIONS SEE INTERIOR ELEVATIONS
- PROVIDE AND INSTALL CASEWORK AND SHELVING AS INDICATED ON FLOOR PLANS AND INTERIOR ELEVATIONS. ALL CASEWORK TO BE SOLID CLEAR STAIN GRADE WOOD EXTERIOR SURFACE WITH MELAMINE INTERIOR SURFACES AND SHELVES. ALL DOORS AND DRAWER FRONTS SHALL BE RAISED PANEL.
- CONTRACTOR SHALL FIELD MEASURE AND VERIFY DIMENSIONS AT LOCATIONS THAT ARE TO RECEIVE CUSTOM CASEWORK AND PROVIDE SHOP DRAWINGS FOR REVIEW AND APPROVAL PRIOR TO FABRICATION.



#2001
610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3
PROTOTYPE VERSION 2.00



513 MAIN STREET #300
FORT WORTH TX 76102

SEAL



PERMIT SET: 04/12/2024

CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DIMENSIONAL ERRORS. OMISSIONS OR DISCREPANCIES BEFORE BEGINNING OR FABRICATING ANY WORK. DO NOT SCALE DRAWINGS.

ISSUE	DATE	DESCRIPTION
-------	------	-------------

PROJECT INFORMATION

PROJECT NO:	24-0087
ORIGINAL ISSUE:	06/01/2023
SCALE:	AS NOTED
DRAWN BY:	P. C
CHECKED BY:	J. JEFFERY

SHEET TITLE

EQUIPMENT PLAN

SHEET NUMBER

Q101

NOTE: ALL SYMBOLS AND ABBREVIATIONS SHOWN
ARE NOT NECESSARILY USED ON THE DRAWINGS

VALVES AND FITTINGS

- | | | | |
|-----------------------------|---|----------|---|
| AE | ARCHITECT/ENGINEER | L | LENGTH |
| AF | ABOVE FINISHED FLOOR | LB | POUNDS |
| AHU | AIR HANDLING UNIT | LRA | LOCKED ROTOR AMPS |
| AV | ACID VENT | MAX | MAXIMUM |
| AW | ACID WASTE | MCA | MINIMUM CIRCUIT AMPACITY |
| BD | BUILDING DRAIN (BELOW FLOOR) | MIN | MINIMUM |
| B.F.G. BELOW FINISHED GRADE | | MSB MOP | SINK BASIN |
| BS | BUILDING SEWER (OUTSIDE OF BLDG) | N/A | NOT APPLICABLE |
| DCW | DOMESTIC COLD WATER | NFPA | NATIONAL FIRE PROTECTION ASSOCIATION |
| DHW | DOMESTIC HOT WATER | NFHW | NON-FREEZE WALL HYDRANT |
| DHWR | DOMESTIC HOT WATER RECIRCULATION LOOP | N/O N/C | NORMALLY OPEN, NORMALLY CLOSED |
| D | EQUIPMENT DRAIN | O/C | ON CENTER |
| DI | DEIONIZED WATER | OF | ROOF OVERFLOW DRAIN |
| DCO | TWO-WAY GRADE CLEANOUT | PCO PLUG | CLEANOUT |
| DSN | DOWNSPOUT NOZZLE | PH | PHASE |
| (E) | EXISTING | PROVIDE | FURNISH AND INSTALL |
| EQUIP | EQUIPMENT | PSI | POUNDS PER SQUARE INCH |
| EW | ELECTRIC WATER COOLER | RD | ROOF DRAIN |
| "F" | DEGREES FAHRENHEIT | RE | REFERENCE, REFER |
| FCO | FLOOR CLEANOUT | RM | ROOM |
| FCU | FAN COIL UNIT | RPBF | REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTER |
| FD | FLOOR DRAIN | RPZ | REDUCED PRESSURE ZONE |
| FS | FLOOR SINK | S | SINK |
| FT. | FOOT, FEET | SD | STORM DRAIN (BELOW FLOOR) |
| FVC | FIRE VALVE CABINET | ST | STORM WATER (ABOVE CEILING) |
| G | NATURAL GAS | SUBSD | SUBSURFACE DRAIN |
| GO | GRADE CLEANOUT | THRU | THROUGH |
| GW | NATURAL GAS WATER HEATER | TP | TRAP PRIMER |
| H | HEIGHT | TYP | TYPICAL |
| HB | HOSE BIBB | U | URINAL |
| HP | HORSEPOWER | UL | UNDERWRITERS LABORATORIES, INC. |
| HWT | HOT WATER TEMPERATURE MAINTENANCE CABLE | V | VANITARY VENT |
| HZ | HERTZ | VTR | VANITARY VENT THRU ROOF |
| IN | INVERT ELEVATION | W | WATER CLOSET |
| IE | INCH, INCHES | WCO | WALL CLEANOUT |
| J-BOX | JUNCTION BOX | W/ | WITH |
| KW | KILOWATT | WO | WITHOUT |

Diagram illustrating the structure of the reference code RE: 2/P1.71:

- REFER TO (points to the number 2)
- DRAWING/DETAIL NUMBER (points to the text P1)
- SHEET NUMBER (points to the number 71)

P.D.I. SIZE	A	B	C	D	E	F
FIXTURE UNITS	1-11	12-32	33-60	61-113	114-154	155-330

NOTES:

1. ALL WHA'S SHALL HAVE AN ACCESS PANEL.
2. SIZE AND LOCATE WATER HAMMER ARRESTERS IN ACCORDANCE WITH PDI PAMPHLET PDI-WH-201


PRIMARY CODES:
PLUMBING: 2018 INTERNATIONAL PLUMBING CODE.

Storm Drain Calculation		Storm Drain Calculation (Per Drain)	
Rainfall (in/hr)	6		
Area of Roof (Sqft)	860	Area of Roof (Sqft)	430.00
Gal/min	53.61	Gal/min	26.80
Pipe Size	8"	Pipe Size	4"
	Number of Drains		2

GREASE INTERCEPTOR CALCULATION		
PROJECT:		SALAD AND GO
FIXTURE	GPM	LBS OF GREASE
THREE COMPARTMENT SINK COMPARTMENT=18"X18"X12" = 3888 CU. IN. X 3 COMPARTMENTS = 11664 CU. IN. TOTAL CU IN = 11664/231X.75= 38 GALLONS. 38 GALLONS AT 2 MINUTE DRAIN DOWN PERIOD = 38/2 = 19 GPM.	19	38
HAND SINK= 5 GALLONS	0.5	1
PREP SINK=1 GALLON	1	2
HAND SINK=5 GALLONS	0.5	1
MOP SINK=1 GALLON	1	2
TOTAL POUNDS OF GREASE	21	44
GREASE INTERCEPTOR (GB-75)	75	861

PER PDI-G101, SECTION 8.0: IT IS RECOMMENDED THAT THE TOTAL CAPACITY IN GALLONS OF FIXTURES BEING SERVED BY AN INTERCEPTOR CONFORMING TO THE ABOVE STANDARD RATINGS, SHALL NOT EXCEED TWO AND ONE-HALF (2-1/2) TIMES THE CERTIFIED GALLONS PER MINUTE FLOW RATING OF THE SUBJECT INTERCEPTOR.

FIXTURE TYPE	QUANTITY	HOT WATER FIXTURE UNITS PER FIXTURE	TOTAL HOT WATER FIXTURE UNITS	GALLONS PER HOUR PER FIXTURE	TOTAL GALLONS PER HOUR
LAVATORY	1	1.5	1.5	5	5
HAND SINK	2	2.25	4.5	5	10
SINK (SERVICE/MOP)	1	2.25	2.25	10	10
SINK (THREE COMP.)	1	2.25	2.25	25	25
PREP SINK	1	2.25	2.25	5	5
TOTAL HFU:			12.75	TOTAL GPH:	55
TOTAL HOT WATER DEMAND (FLOW):				55	GPH
DEMAND FACTOR:				0.8	
ACTUAL HOT WATER DEMAND (FLOW):				44.0	GPH
WATER HEATER RECOVERY RATE:				46.0	GPH

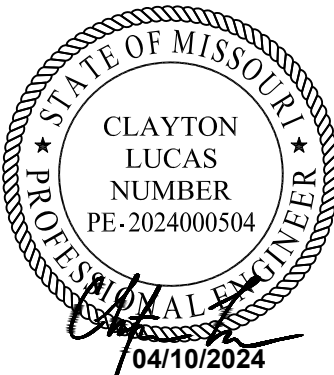

PERMIT SET 4.10.2024

CONTRACTOR SHALL VERIFY ALL
CONDITIONS AND DIMENSIONS AT THE
JOB SITE AND NOTIFY THE ARCHITECT
OF ANY DIMENSIONAL ERRORS,
OMISSIONS OR DISCREPANCIES BEFORE
BEGINNING OR FABRICATING ANY WORK.
DO NOT SCALE DRAWINGS.

[illegible]

PROJECT NO:	24-0087
ORIGINAL ISSUE:	09/06/2022
SCALE:	AS NOTED
DRAWN BY:	JB
CHECKED BY:	CL

PLUMBING LEGENDS AND NOTES

P101

PLUMBING FIXTURE SCHEDULE										
MARK	DESCRIPTION	ROUGH IN (MINIMUM)					MANUFACTURER AND MODEL NUMBER	ADA		
		W	V	CW	HW	E				
WC-1	WATERCLOSET, 1.1 GPF, HIGH PERFORMANCE FLUSHOMETER TANK, ELONGATED BOWL, 3" FLUSH VALVE WITHIN TANK, CLOSE-COUPLED TANK, VITREOUS CHINA, WHITE, 2 1/8" FULLY GLAZED TRAPWAY, 12" ROUGH-IN, ASME A112.19.2M (& 19.6M).	4"	2"	-	-	-	AMERICAN STANDARD, 2467.100			
	SUPPLY AND STOP, LOOSE KEY, CHROME PLATED BRASS VALVE AND CHROME PLATED COPPER RISER	-	-	1/2"	-	-	MCGUIRE; T&S BRASS; OR BRASSCRAFT			
	SEAT, EXTRA HEAVY WEIGHT, POSTURE MOLDED SOLID PLASTIC, ELONGATED, OPEN FRONT, LESS COVER, EXTERNAL CHECK HINGES, STAINLESS STEEL HINGE POSTS, WHITE	-	-	-	-	-	CHURCH; BEMIS			
LAV-1	LAVATORY, 20"x18" VITREOUS CHINA WALL MOUNT, SINGLE CENTER FAUCET HOLE, FRONT OVERFLOW, CONCEALED ARM CARRIER SYSTEM, DECK MOUNTED FAUCET, INTEGRAL 4" BACKSPASH, ANSI A112.19.2	2"	1 1/2"	-	-	-	AMERICAN STANDARD, 0356.041			
	TOUCHLESS METERING FAUCET, DECK MOUNT, SINGLE CENTER HOLE, POLISHED CHROME FINISH, BATTERY-POWERED, 0.35 GPM MAX	-	-	1/2"	1/2"	-	AMERICAN STANDARD; SELECTRONIC			
	SUPPLY AND STOPS, LOOSE KEY, CHROME PLATED BRASS VALVES, BRAIDED HOSE CONNECTIONS	-	-	-	-	-	MCGUIRE; T&S BRASS; OR BRASSCRAFT			
	P-TRAP, CHROME PLATED CAST BRASS BODY WITH CLEANOUT, SEAMLESS WALL BEND, 17 GA.	-	-	-	-	-	MCGUIRE; T&S BRASS; OR BRASSCRAFT			
	OFFSET TAILPIECE AND STRAINER, CHROME PLATED CAST BRASS	-	-	-	-	-	MCGUIRE; T&S BRASS; OR BRASSCRAFT			
	FIXTURE CARRIER, CONCEALED ARMS, LEVELING AND SECURING SCREWS, UPRIGHTS, WELDED FEET	-	-	-	-	-	JOSAM; WATTS; ZURN; OR JR SMITH			
	THERMOSTATIC MIXING VALVE, 0.25 GPM MINIMUM FLOW, INTEGRAL INLET CHECK VALVES AND STRAINER, SET TEMPERATURE TO 105°, ASSE 1070.	-	-	1/2"	1/2"	-	WATTS; LEONARD			
HB-1	NARROW WALL HYDRANT, ENCASED, ANTI-SIPHON WITH EXTERNAL VACUUM BREAKER, 3/4" MALE N.H.T OUTLET, CHROME PLATED CAST BRONZE WALL BOX WITH HINGED COVER.	-	-	3/4"	-	-	ZURN Z1350			
FD-1	FLOOR DRAIN, CAST IRON BODY, ANCHOR FLANGE, WEEPHOLES FOR DOUBLE DRAINAGE, 6" SQUARE STAINLESS STEEL FLAT STRAINER, ADJUSTABLE DRAIN HEAD W/ MACHINED INTEGRAL BODY THREADS, ASME A112.21.1	-	-	1/2"	-	-	ZURN Z-415-S6			
FS-1	FLOOR SINK, 12"x12"x8", CI BODY, DBL DRAINAGE FLANGE, STAINLESS STEEL DOME STRAINER, 1/2 GRATE, NON-PUNCTURING FLASHING COLLAR, PORCELAIN ENAMEL OR EPOXY COATED INTERIOR	-	-	1/2"	-	-	ZURN Z-1901			
MS-1	MOP SINK BASIN, ONE PIECE-MOLDED STONE 36"x24"x10", COLORFAST MARBLEIZED WHITE FINISH, SELF-DRAINING SHELF WITH REMOVABLE STRAINER, MOLDED-IN DRAIN, STAINLESS STEEL WALL GUARDS, STAINLESS STEEL BUMPER GUARDS, HOSE AND HOSE HOLDER, MOP HANGER, DRAIN SEAL	3"	2"	-	-	-	MUSTEE - 65M			
	FAUCET, HEAVY-DUTY, CHROME PLATED BRASS, DUAL HANDLE, TOP REINFORCING BAR, PAIL HOOK	-	-	3/4"	3/4"	-	MUSTEE - 63.600A			
WCO	WALL CLEANOUT, CI BODY, RECESSED, THREADED BRASS PLUG, STAINLESS STEEL ACCESS COVER	-	-	-	-	-	ZURN Z-1441			
FCO	FLOOR CLEANOUT, COATED CAST IRON BODY, COMBINATION ADJUSTABLE ROUND STAINLESS STEEL COVER AND PLUG TOP ASSEMBLY, GASKET SEAL, ASME 112.36.2	-	-	-	-	-	ZURN Z-1400			
GCO	GRADE CLEANOUT, HEAVY DUTY COATED CAST IRON ACCESS BODY WITH ANCHOR FLANGES, HEAVY DUTY DUCTILE IRON ACCESS COVER WITH VANDAL RESISTANT STAINLESS STEEL SCREWS	-	-	-	-	-	ZURN Z-1474-SG-VP			
DCO	2-WAY GRADE CLEANOUT, TWO-RISER CLEANOUT BODY WITH HEAVY DUTY COATED CAST IRON ACCESS BODY WITH ANCHOR FLANGES, HEAVY DUTY DUCTILE IRON ACCESS COVER WITH VANDAL RESISTANT STAINLESS STEEL SCREWS	-	-	-	-	-	ZURN Z-1474-SG-VP			
TP	TRAP PRIMER, DIAPHRAGM OPERATED BASED ON PRESSURE SPIKES OR PRESSURE DROPS, OPERATING RANGE BETWEEN 30 TO 70 PSIG. PROVIDE WITH DISTRIBUTION UNIT SERVING MULTIPLE DRAINS (UP TO 4). PROVIDE ACCESS PANEL FOR TRAP PRIMER MAINTENANCE.	-	-	1/2"	-	-	MIFAB, MI-500; PPP CPO-500 OR EQUAL			
BFP-1	1" DUAL CHECK VALVE ASSEMBLY, BRONZE VALVE BODY, STAINLESS STEEL SPRINGS, LED FREE, NSF COMPLIANT, ASME B1.20.1	-	-	1"	-	-	WATTS - LF850			
WH-1	ELECTRIC, TANK TYPE WATER HEATER, 50-GALLON, 208V, 1-PH, (2) 4500W SIMULTANEOUS HEATING ELEMENTS, 46-GPH RECOVERY RATE AT 80-DEG F TEMPERATURE RISE, SET TO 140-DEG F	-	-	3/4"	3/4"	YES	A.O. SMITH DEL-50			
CP-1	VARIABLE SPEED DOMESTIC HOT WATER RE-CIRCULATION PUMP, 120V/1-PH, 5-GPM AT 8-FEET OF HEAD, AQUA-STAT, TIME CLOCK SET TO BUSINESS HOURS	-	-	-	3/4"	YES	GRUNDFOS - UP			
GT-1	HYDROMECHANICAL GREASE TRAP, MOLDED POLYETHYLENE, 861 LB GREASE CAPACITY AT 75-GPM FLOW RATE, INTEGRAL AIR RELIEF AND ANTI-SIPHON, H-20 RATED CAST IRON COVER, ASME A112.14.3 (TYPE D), ACCESS RESISTOR	4"	-	-	-	-	SCHIER - GB-75			
SW-1	SAMPLING PORT, MOLDED POLYETHYLENE, H-20 CAST IRON COVER, WATER/GAS TIGHT SEAL, ACCESS RESTRICTOR	4"	-	-	-	-	SCHEIR - SV24			
PS-1	ONE COMPARTMENT SINK, 18"x18"x13" BOWL, STAINLESS STEEL LEGS WITH CROSS BRACING, EXTRA WELDS UNDER TUBS, STAINLESS STEEL STRAINER	2"	1 1/2"	-	-	-	GSW - SE18181P			
	DECK MOUNT FAUCET, 8" COMMERCIAL DUTY, 10-INCH SWING SPOUT, CHROME PLATED BRASS, SUPPLY AND STOPS, LOOSE KEY, CHROME PLATED BRASS VALVES, BRAIDED HOSE CONNECTIONS	-	-	1/2"	1/2	-	GSW - AA-710G			
	1-1/2" COPPER TUBE TO INDIRECTLY DISCHARGE INTO FLOOR SINK BELOW	1-1/2"	-	-	-	-	MCGUIRE; T&S BRASS; OR BRASSCRAFT			
HS-1	HAND SINK, WALL MOUNTED, STAINLESS STEEL, 12-1/2" x 9-3/4" x 5-5/8" BOWL, WELDED SPLASH GUARDS	2"	1 1/2"	-	-	-	GSW - HS-1615SSG			
	FAUCET, 4" WRISTBLADE HANDLES, GOOSE NECK SPOUT, CHROME PLATED BRASS, BACKSPASH MOUNTED	-	-	1/2"	1/2	-				
	SUPPLY AND STOPS, LOOSE KEY, CHROME PLATED BRASS VALVES, BRAIDED HOSE CONNECTIONS	-	-	-	-	-	MCGUIRE; T&S BRASS; OR BRASSCRAFT			
	P-TRAP, CHROME PLATED CAST BRASS BODY WITH CLEANOUT, SEAMLESS WALL BEND, 17 GA.	-	-	-	-	-	MCGUIRE; T&S BRASS; OR BRASSCRAFT			
	OFFSET TAILPIECE AND STRAINER, CHROME PLATED CAST BRASS	-	-	-	-	-	MCGUIRE; T&S BRASS; OR BRASSCRAFT			
	FIXTURE CARRIER, CONCEALED ARMS, LEVELING AND SECURING SCREWS, UPRIGHTS, WELDED FEET	-	-	-	-	-	JOSAM; WATTS; ZURN; OR JR SMITH			
	THERMOSTATIC MIXING VALVE, 0.25 GPM MINIMUM FLOW, INTEGRAL INLET CHECK VALVES AND STRAINER, SET TEMPERATURE TO 105°, ASSE 1070.	-	-	1/2"	1/2"	-	WATTS; LEONARD			
3COMP-1	3-COMPARTMENT SCULLERY SINK WITH TWO DRAINBOARDS, THREE-18"x18"x12" BOWLS, 24" DRAINBOARDS, ONE-PIECE DIE FORMED, INTEGRAL 9" HIGH REAR BACK SPLASH, 2'-180" ROLLED EDGES AT FRONT AND ENDS, WELDED CORNERS/EXPOSED CORNERS GROUND AND POLISHED TO BLEND WITH ADJACENT SURFACES, STAINLESS STEEL LEGS WITH ADJUSTABLE BULLET FEET	2"	-	-	-	-	GSW - SE18183D			
	PULL-DOWN PRE-RINSE UNIT: 8" WALL MOUNT MIXING FAUCET, QUARTER-TURN CERAMA CARTRIDGES W/ CHECK VALVES, LEVER HANDLES, ADD-ON FAUCET W/ 12-INCH SWING NOZZLE, ACCESSORY TEE, 12" RISER, 30" FLEXIBLE STAINLESS STEEL HOSE, 1.07 GPM SPRAYER, 6-INCH WALL BRACKET	-	-	1/2"	1/2"	-	T&S BRASS - B-0133-12CRB8TP			
	SUPPLY AND STOP, LOOSE KEY, CHROME PLATED BRASS VALVES AND BRAIDED HOSE CONNECTIONS	-	-	1/2"	1/2	-	UNIVERSAL STAINLESS, MODEL USF-10-S; T&S BRASS, B-2481-WH4			
	TWIST HANDLE LEVER DRAINS	-	-	-	-	-	MCGUIRE, H2167CCLK; OR EQUAL IN T&S BRASS OR BRASSCRAFT			
	MANIFOLD FOR INDIRECT DRAIN, CHROME PLATED CAST BRASS, OUTLET TEE TAILPIECE	-	-	-	-	-	GSW - AA-303			
	2" COPPER TUBE TO INDIRECTLY DISCHARGE INTO FLOOR SINK BELOW	2"	-	-	-	-	MCGUIRE; OR EQUAL IN T&S BRASS OR BRASSCRAFT			
PF-1	WALL MOUNTED POT FILLER FAUCET, 24" DOUBLE JOINT SWING NOZZLE, CHROME PLATED BRASS, ASME A112.18.1, NSF 61	-	-	1/2"	1/2	-	T&S BRASS - B-0594			
RD	ROOF DRAIN, LARGE SUMP, CAST IRON BODY, 12"DIA. CAST IRON OR DUCTILE IRON DOME STRAINER, ANCHOR FLANGE AND CLAMP, ADJUSTABLE/INTEGRAL GRAVEL STOP, ASME A112.21.2	-	-	-	-	-	ZURN, ZC-100-G			
OFD	OVERFLOW ROOF DRAIN, LARGE SUMP, ADJUSTABLE INTERNAL STANDPIPE DAM, CAST IRON BODY, 12" DIA. CAST IRON OR DUCTILE IRON DOME STRAINER, ANCHOR FLANGE AND CLAMP, ADJUSTABLE/INTEGRAL GRAVEL STOP, ASME A112.21.2	-	-	-	-	-	ZURN ZC-100-G-W2			
DSN-1	DOWNSPOUT NOZZLE, 2-PIECE, BRONZE, WALL FLANGE AND THREADED INLET. PROVIDE SAMPLES OF MATERIAL AND FINISHES FOR EXTERIOR DOWNSPOUT NOZZLE FOR ARCHITECTURAL SELECTION OF FINISH.	-	-	-	-	-	ZURN Z-199			
NOTES: 1. CONTRACTOR SHALL FURNISH AND INSTALL SUPPLIES, STOPS, TRAPS, TAILPIECES AND ALL APPURTENANCES NECESSARY FOR A COMPLETE INSTALLATION OF ALL FIXTURES. 2. ALL ADA ACCESSIBLE SINKS AND LAVATORIES SHALL BE EQUIPPED WITH TRUEBRO #103 UNDER SINK PROTECTIVE PIPE COVERS WHERE NOT CONCEALED BY MILLWORK. 3. COMPLY WITH THE PROVISIONS OF THE AMERICANS WITH DISABILITIES ACT (ADA) AND THE TEXAS ACCESSIBILITY'S STANDARD (TAS). PLUMBING CONTRACTOR SHALL PROVIDE PLUMBING FIXTURES WITH FLUSH VALVE HANDLES LOCATED ON THE WIDE SIDE OF EACH STALL OR ROOM. 4. FLOOR CLEANOUT ACCESS COVERS IN ALL FINISHED AREAS SHALL BE OF THE RECESSED TYPE TO ALLOW FOR INSERTION OF FINISHED FLOOR TREATMENT. TILE OR CARPET MARKER AS NECESSARY. 5. ABOVE THE FLOOR P-TRAPS ON LAVATORIES AND SINKS SHALL BE 17 GAUGE, CHROME PLATED BRASS. ACCEPTABLE MANUFACTURERS: MCGUIRE, T&S BRASS, OR BRASSCRAFT. 6. CONTRACTOR SHALL VERIFY FIXTURE SUPPLIES AND APPURTENANCES FOR EACH FIXTURE PRIOR TO BIDDING AND PURCHASING. 7. ALL FLOOR MOUNTED WATER CLOSETS SHALL HAVE 10" ROUGH-IN UNLESS OTHERWISE NOTED. 8. CONTRACTOR SHALL VERIFY PLUMBING FIXTURES PROVIDED COMPLY WITH HANDICAPPED ACCESSIBILITY STANDARDS INCLUDING HEIGHT AND CLEARANCE REQUIREMENTS. 9. ALL WATER CLOSET AND URINAL FLUSH VALVES SHALL INCLUDE CHROME PLATED CAST WALL FLANGE WITH SETSCREW AND COVER TUBE. 10. LAVATORIES INDICATED WITH SENSOR OPERATED FAUCETS SHALL BE BATTERY OPERATED AND PROVIDED WITH A OF TEMPERING VALVE SET FOR 85°F.										



610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3
PROTOTYPE VERSION V2-B



SEAL



PERMIT SET 4.10.2024

CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DIMENSIONAL ERRORS. OMISSIONS OR DISCREPANCIES BEFORE BEGINNING OR FABRICATING ANY WORK. DO NOT SCALE DRAWINGS.

ISSUE	DATE	DESCRIPTION

PROJECT INFORMATION	
PROJECT NO:	24-0087
ORIGINAL ISSUE:	09/06/2022
SCALE:	AS NOTED
DRAWN BY:	JB
CHECKED BY:	CL

SHEET TITLE

PLUMBING
SCHEDULES

SHEET NUMBER

P102

- NOTES BY SYMBOL
- 1

PROPOSED LOCATION FOR INSTALLATION OF GREASE TRAP AND SAMPLE WELL. COORDINATE EXACT INSTALLATION LOCATION WITH ARCHITECT AND CIVIL PRIOR TO INSTALLATION. INSTALL GREASE TRAP AND SAMPLE WELL PER MANUFACTURER'S PUBLISHED IOM.
- 2

4-INCH VENT THRU ROOF. MAINTAIN 10-FEET OF CLEARANCE BETWEEN VENT AND ALL OUTDOOR AIR INTAKES ON ROOF.
- 3

ROUTE CONDENSATE PIPING FROM WALK-IN COOLER TO FLOOR SINK AS SHOWN. CONDENSATE PIPING IS TO BE 82" AFF BEHIND WALL. PROVIDE 12" STUB-OUT FOR VENDOR TO CONNECT CONDENSATE FROM WALK-IN COOLER.
- 4

REFER TO CIVIL PLANS FOR CONTINUATION OF SANITARY WASTE PIPING.
- 5

CONTRACTOR SHALL COORDINATE EXACT OREINTATION OF GREASE INTERCEPTOR AND SAMPLE WELL WITH CIVIL DRAWINGS. OREINTATION SHOWN IS FOR LAYOUT OF EQUIPMENT AND CLEAN OUTS ONLY. CONTRACTOR SHALL CONFIRM ALL REQUIRED SANITARY DROPS WITH CIVIL PRIOR TO INSTALLATION.




610 NW CHIPMAN ROAD

LEE'S SUMMIT, MO 64086 PROPOSED LOT 3

PROTOTYPE VERSION V2-B



SEAL

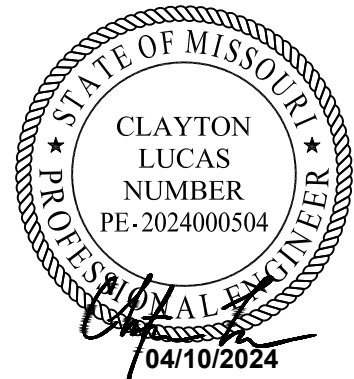

PERMIT SET 4.10.2024

CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DIMENSIONAL ERRORS. OMISSIONS OR DISCREPANCIES BEFORE BEGINNING OR FABRICATING ANY WORK. DO NOT SCALE DRAWINGS.

ISSUE	DATE	DESCRIPTION


PROJECT INFORMATION	
PROJECT NO:	24-0087
ORIGINAL ISSUE:	09/06/2022
SCALE:	AS NOTED
DRAWN BY:	JB
CHECKED BY:	CL

SHEET TITLE

GREASE/SANITARY WASTE PLAN

SHEET NUMBER


P103

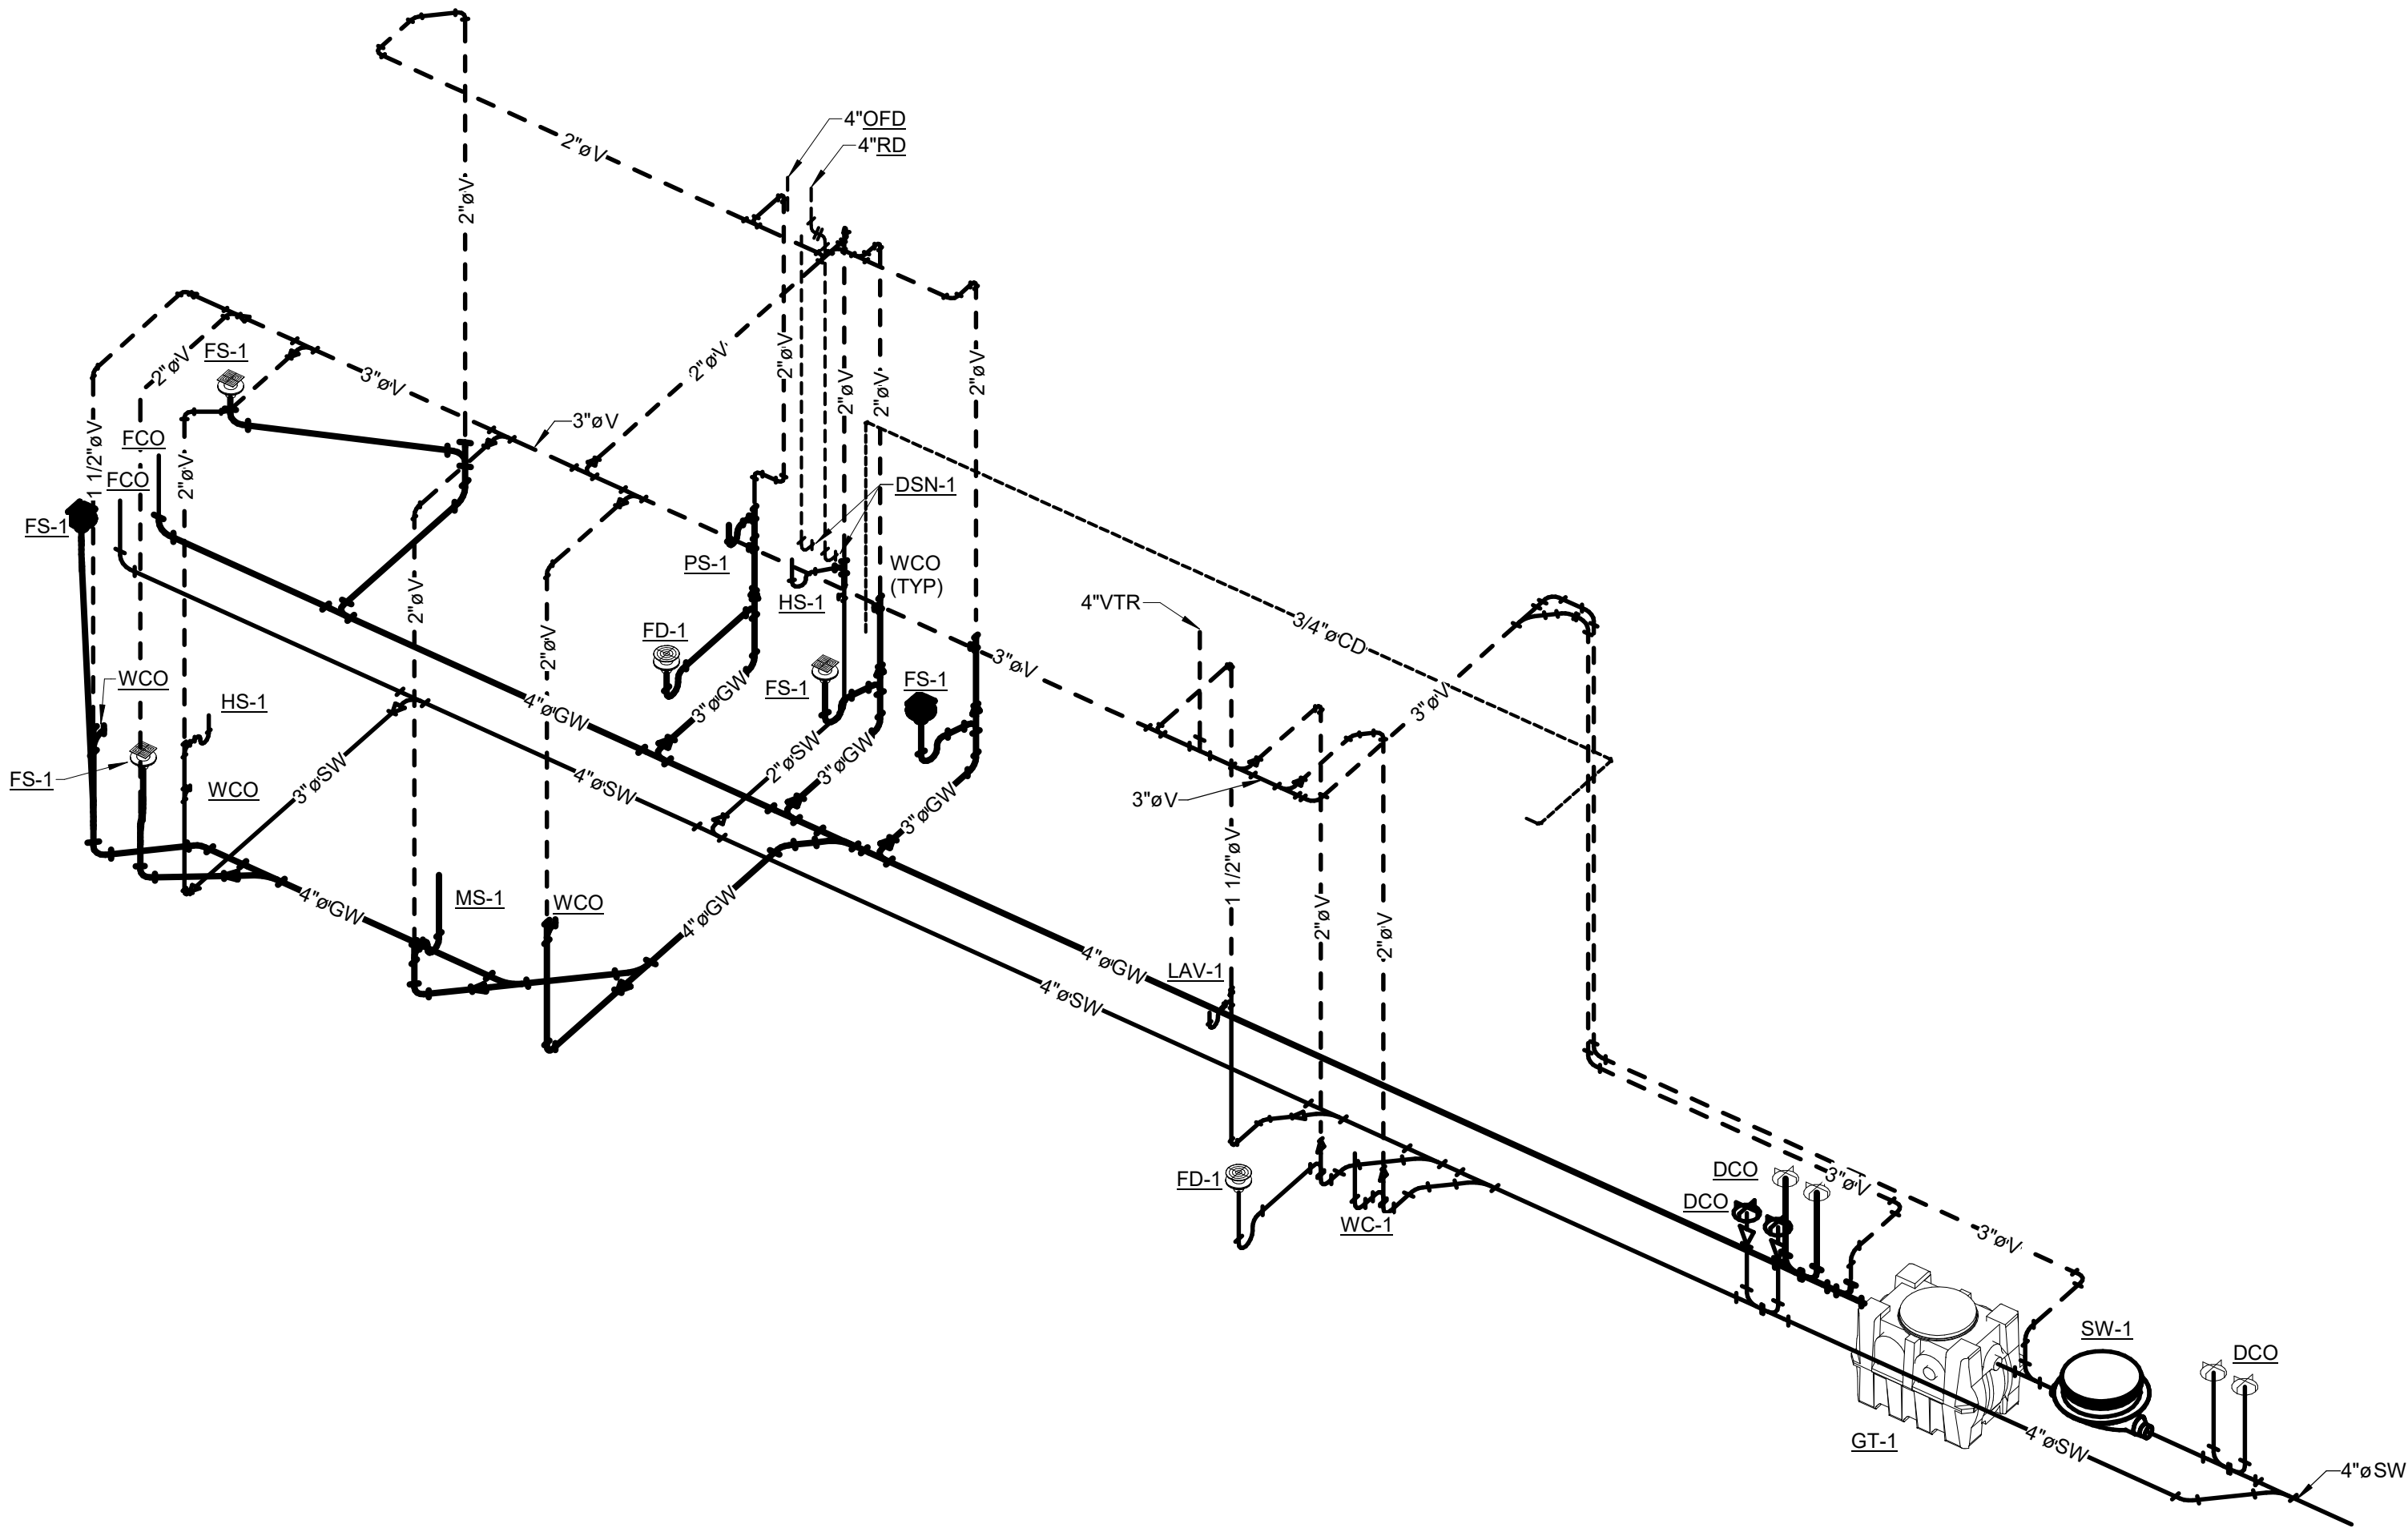

2

GREASE/SANITARY WASTE AND VENT RISER DIAGRAM


P103

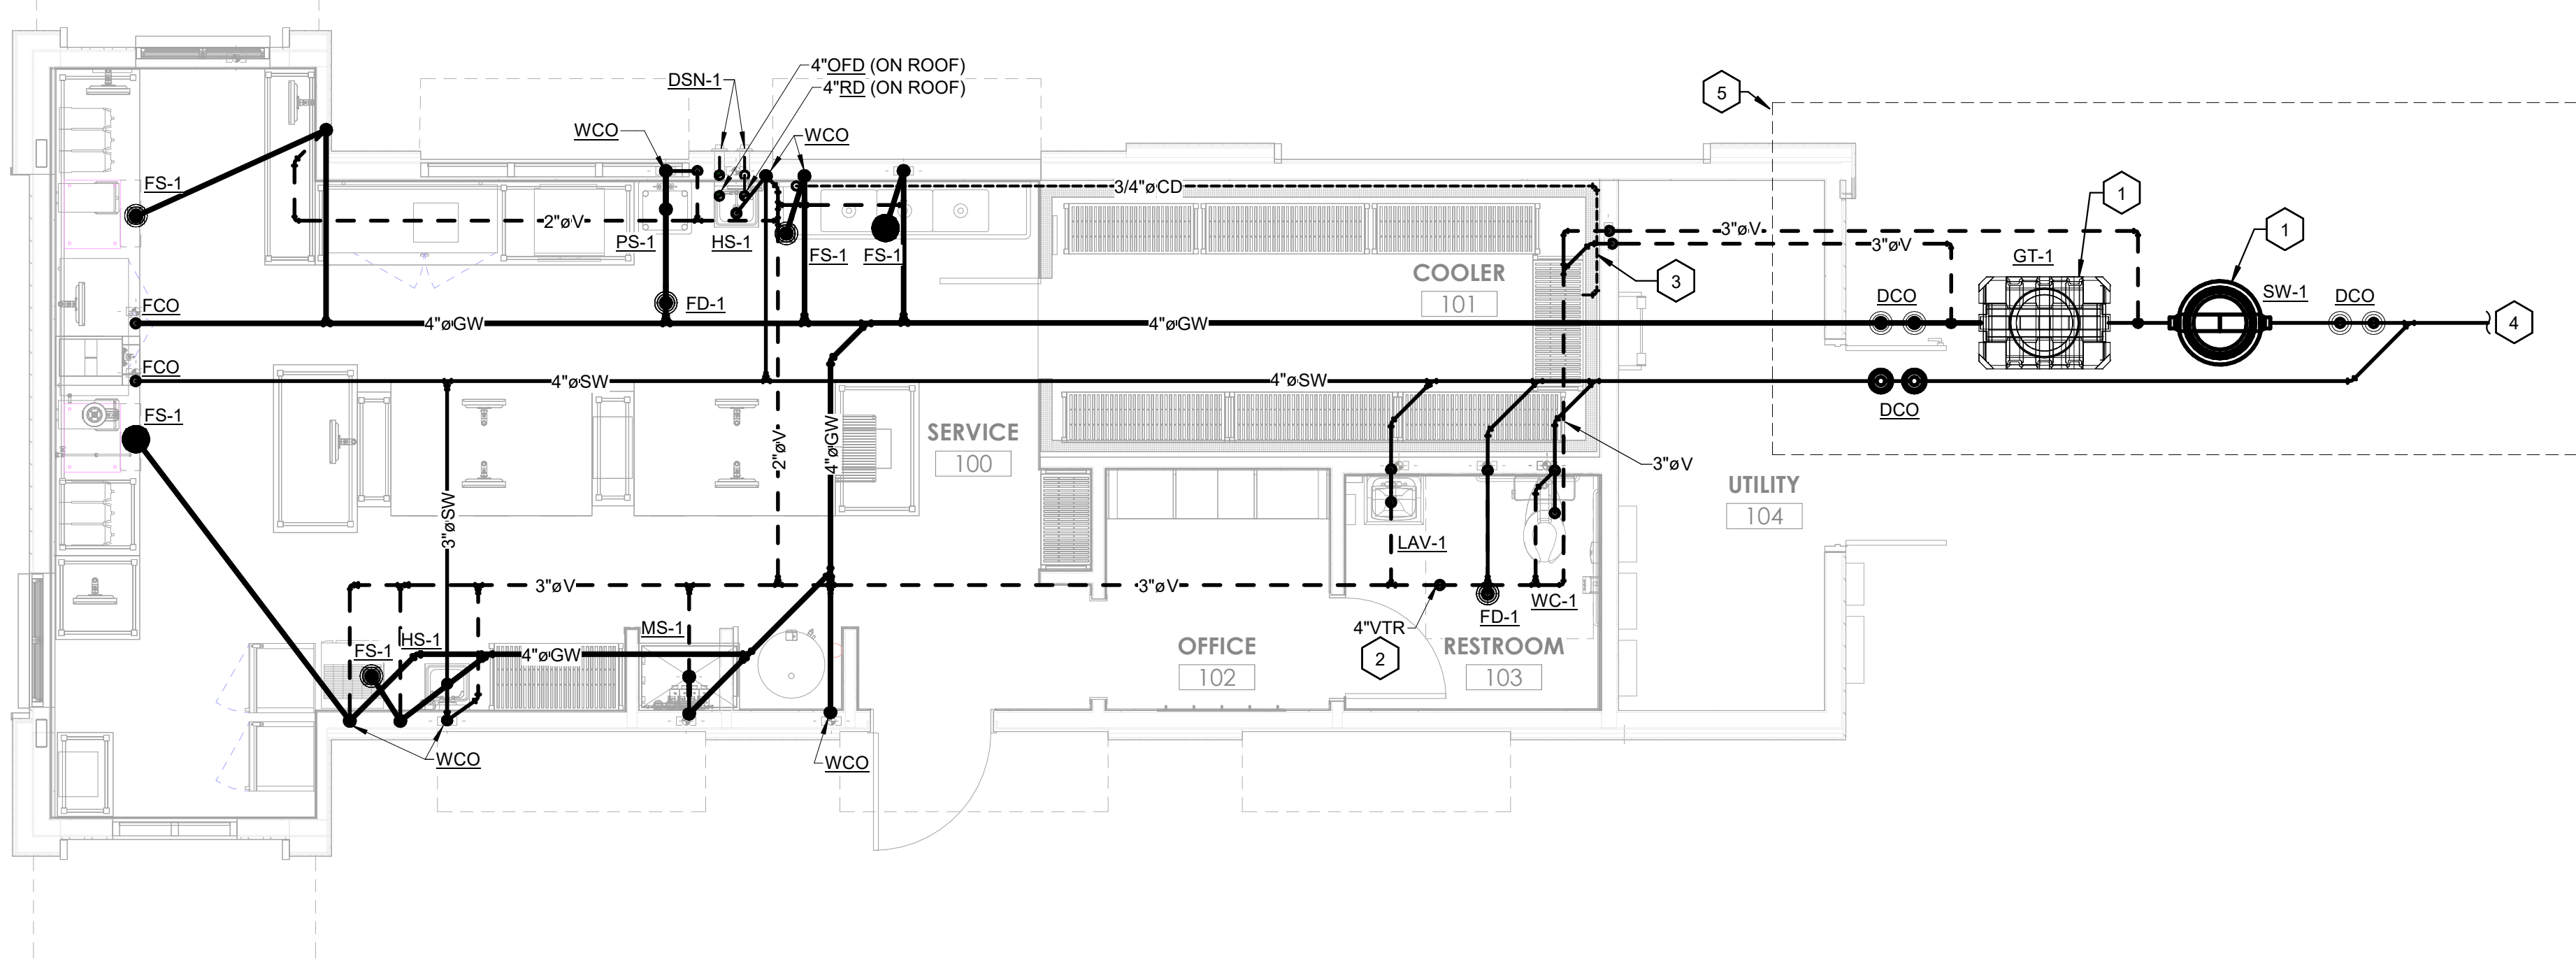


1

GREASE/SANITARY WASTE AND VENT PLAN

P103 1/4" = 1'-0"

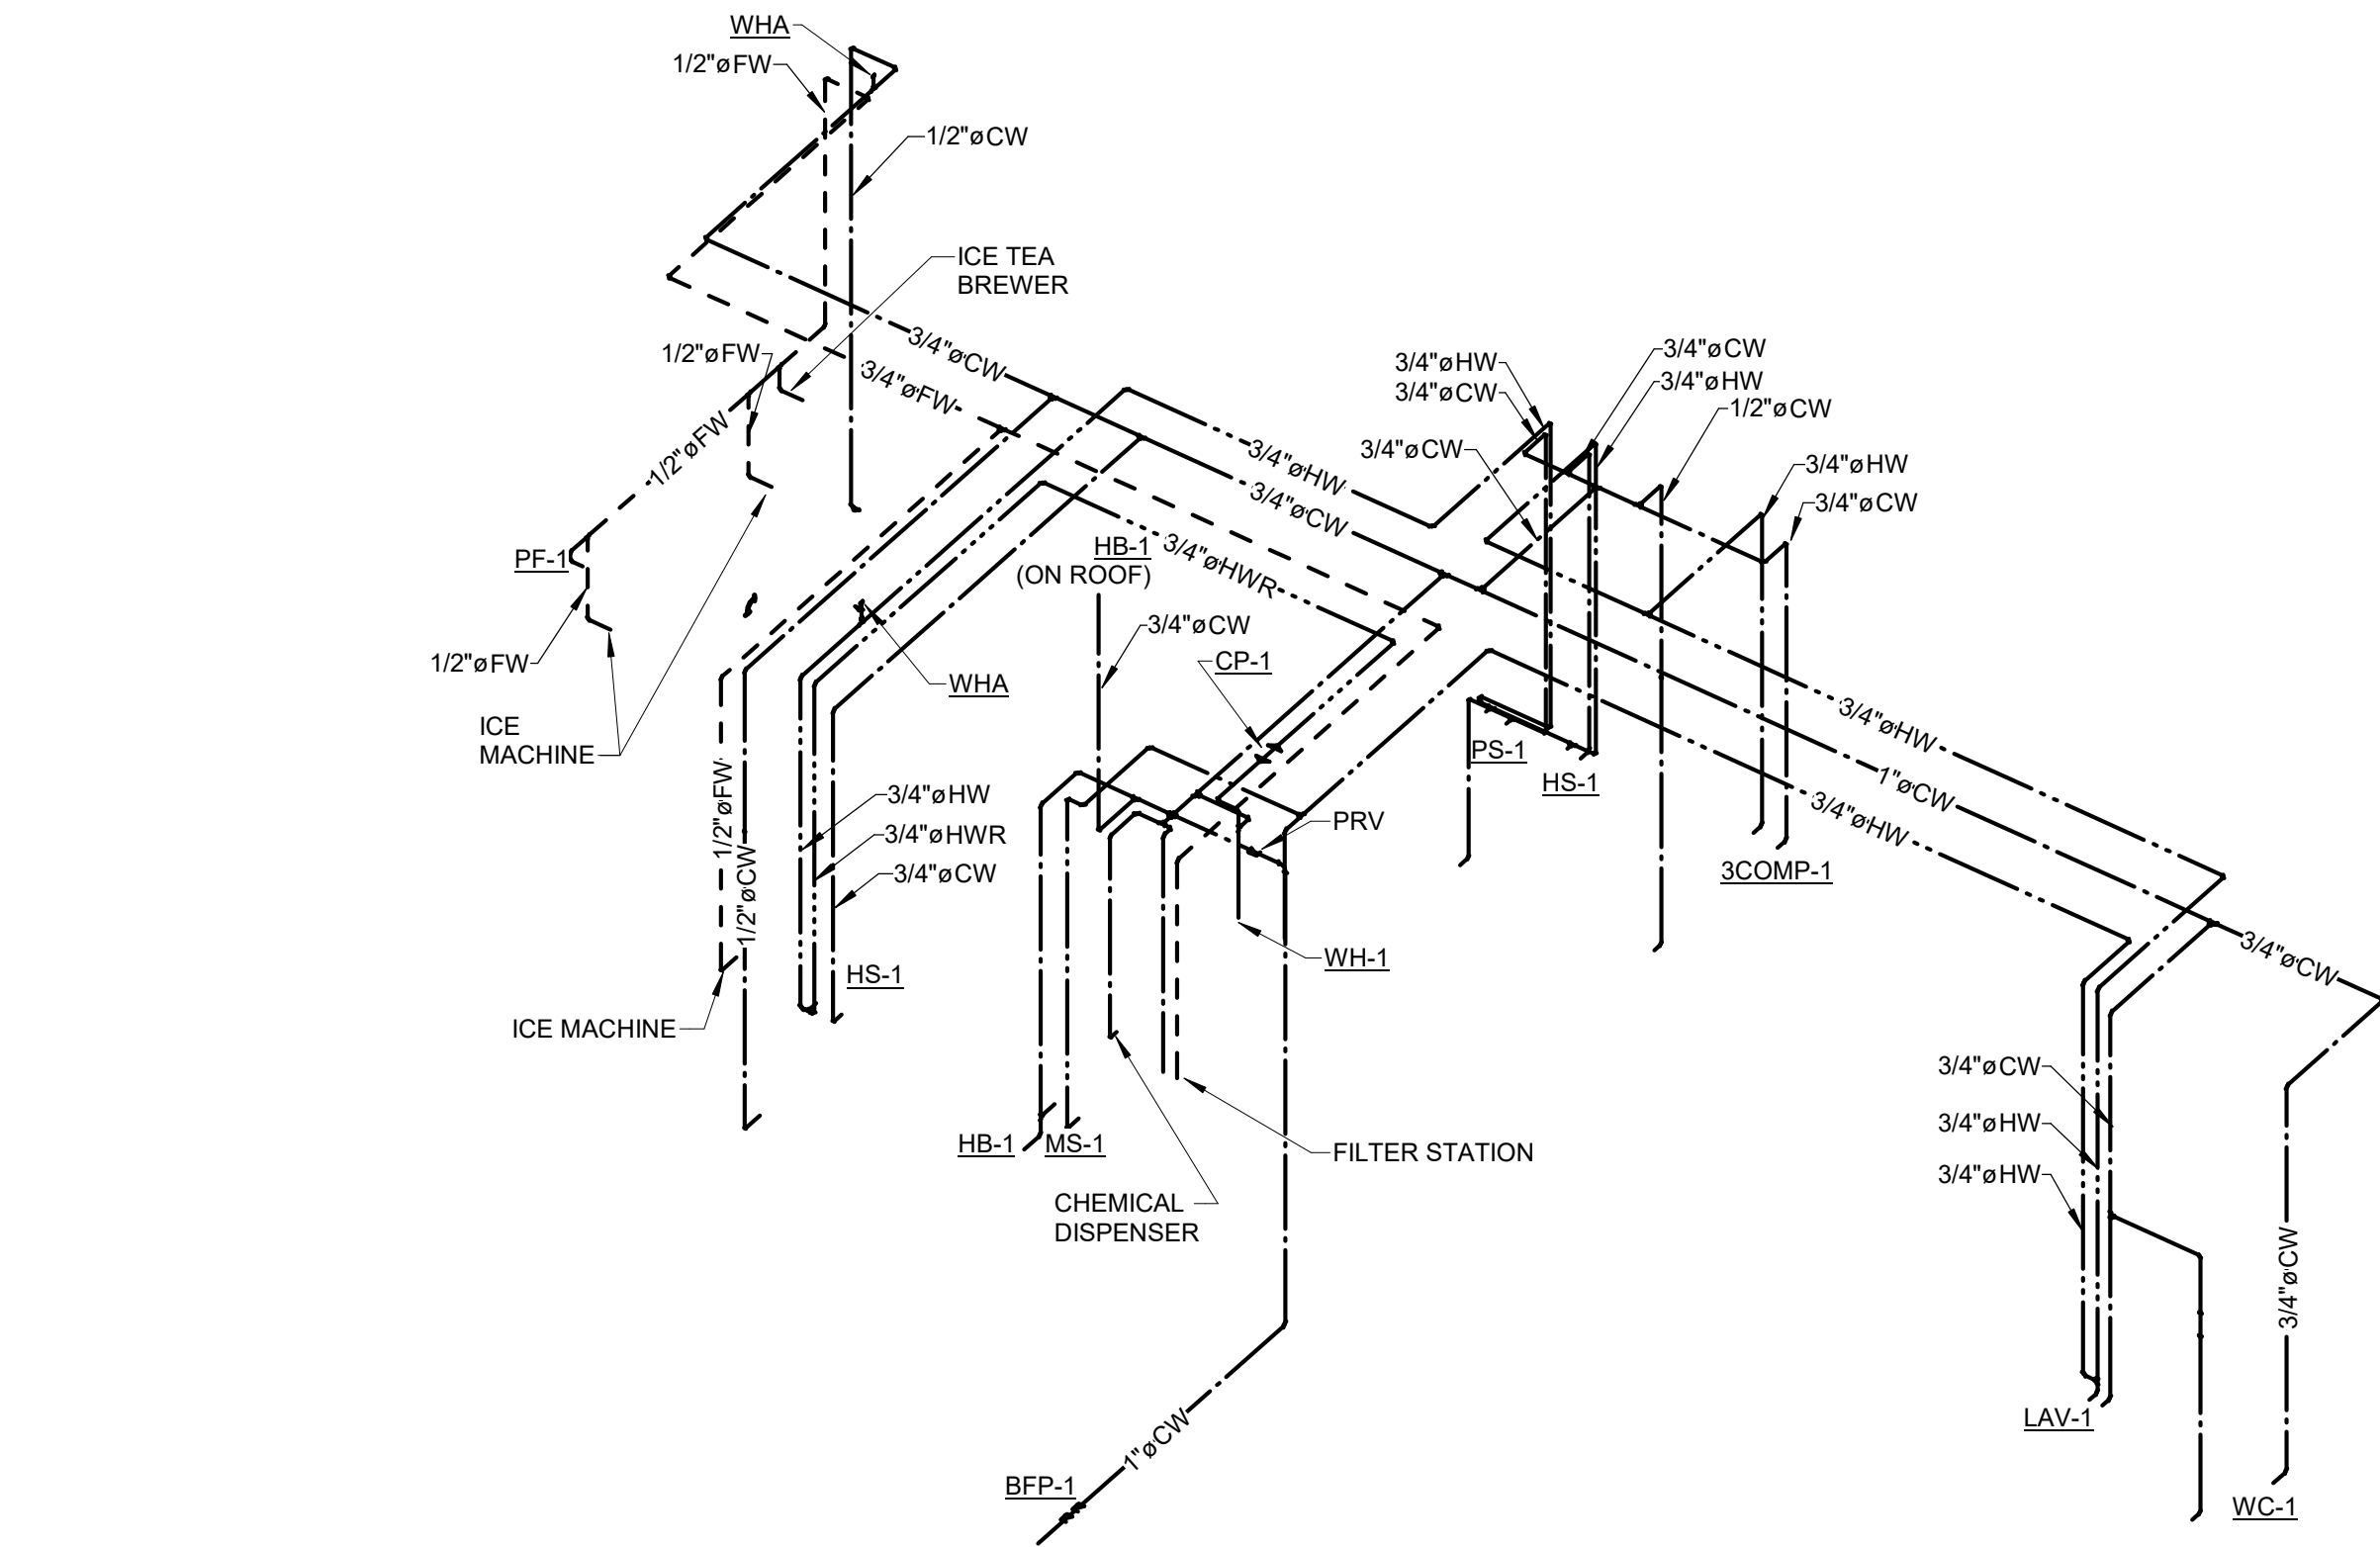

2 DOMESTIC WATER RISER DIAGRAM
P104

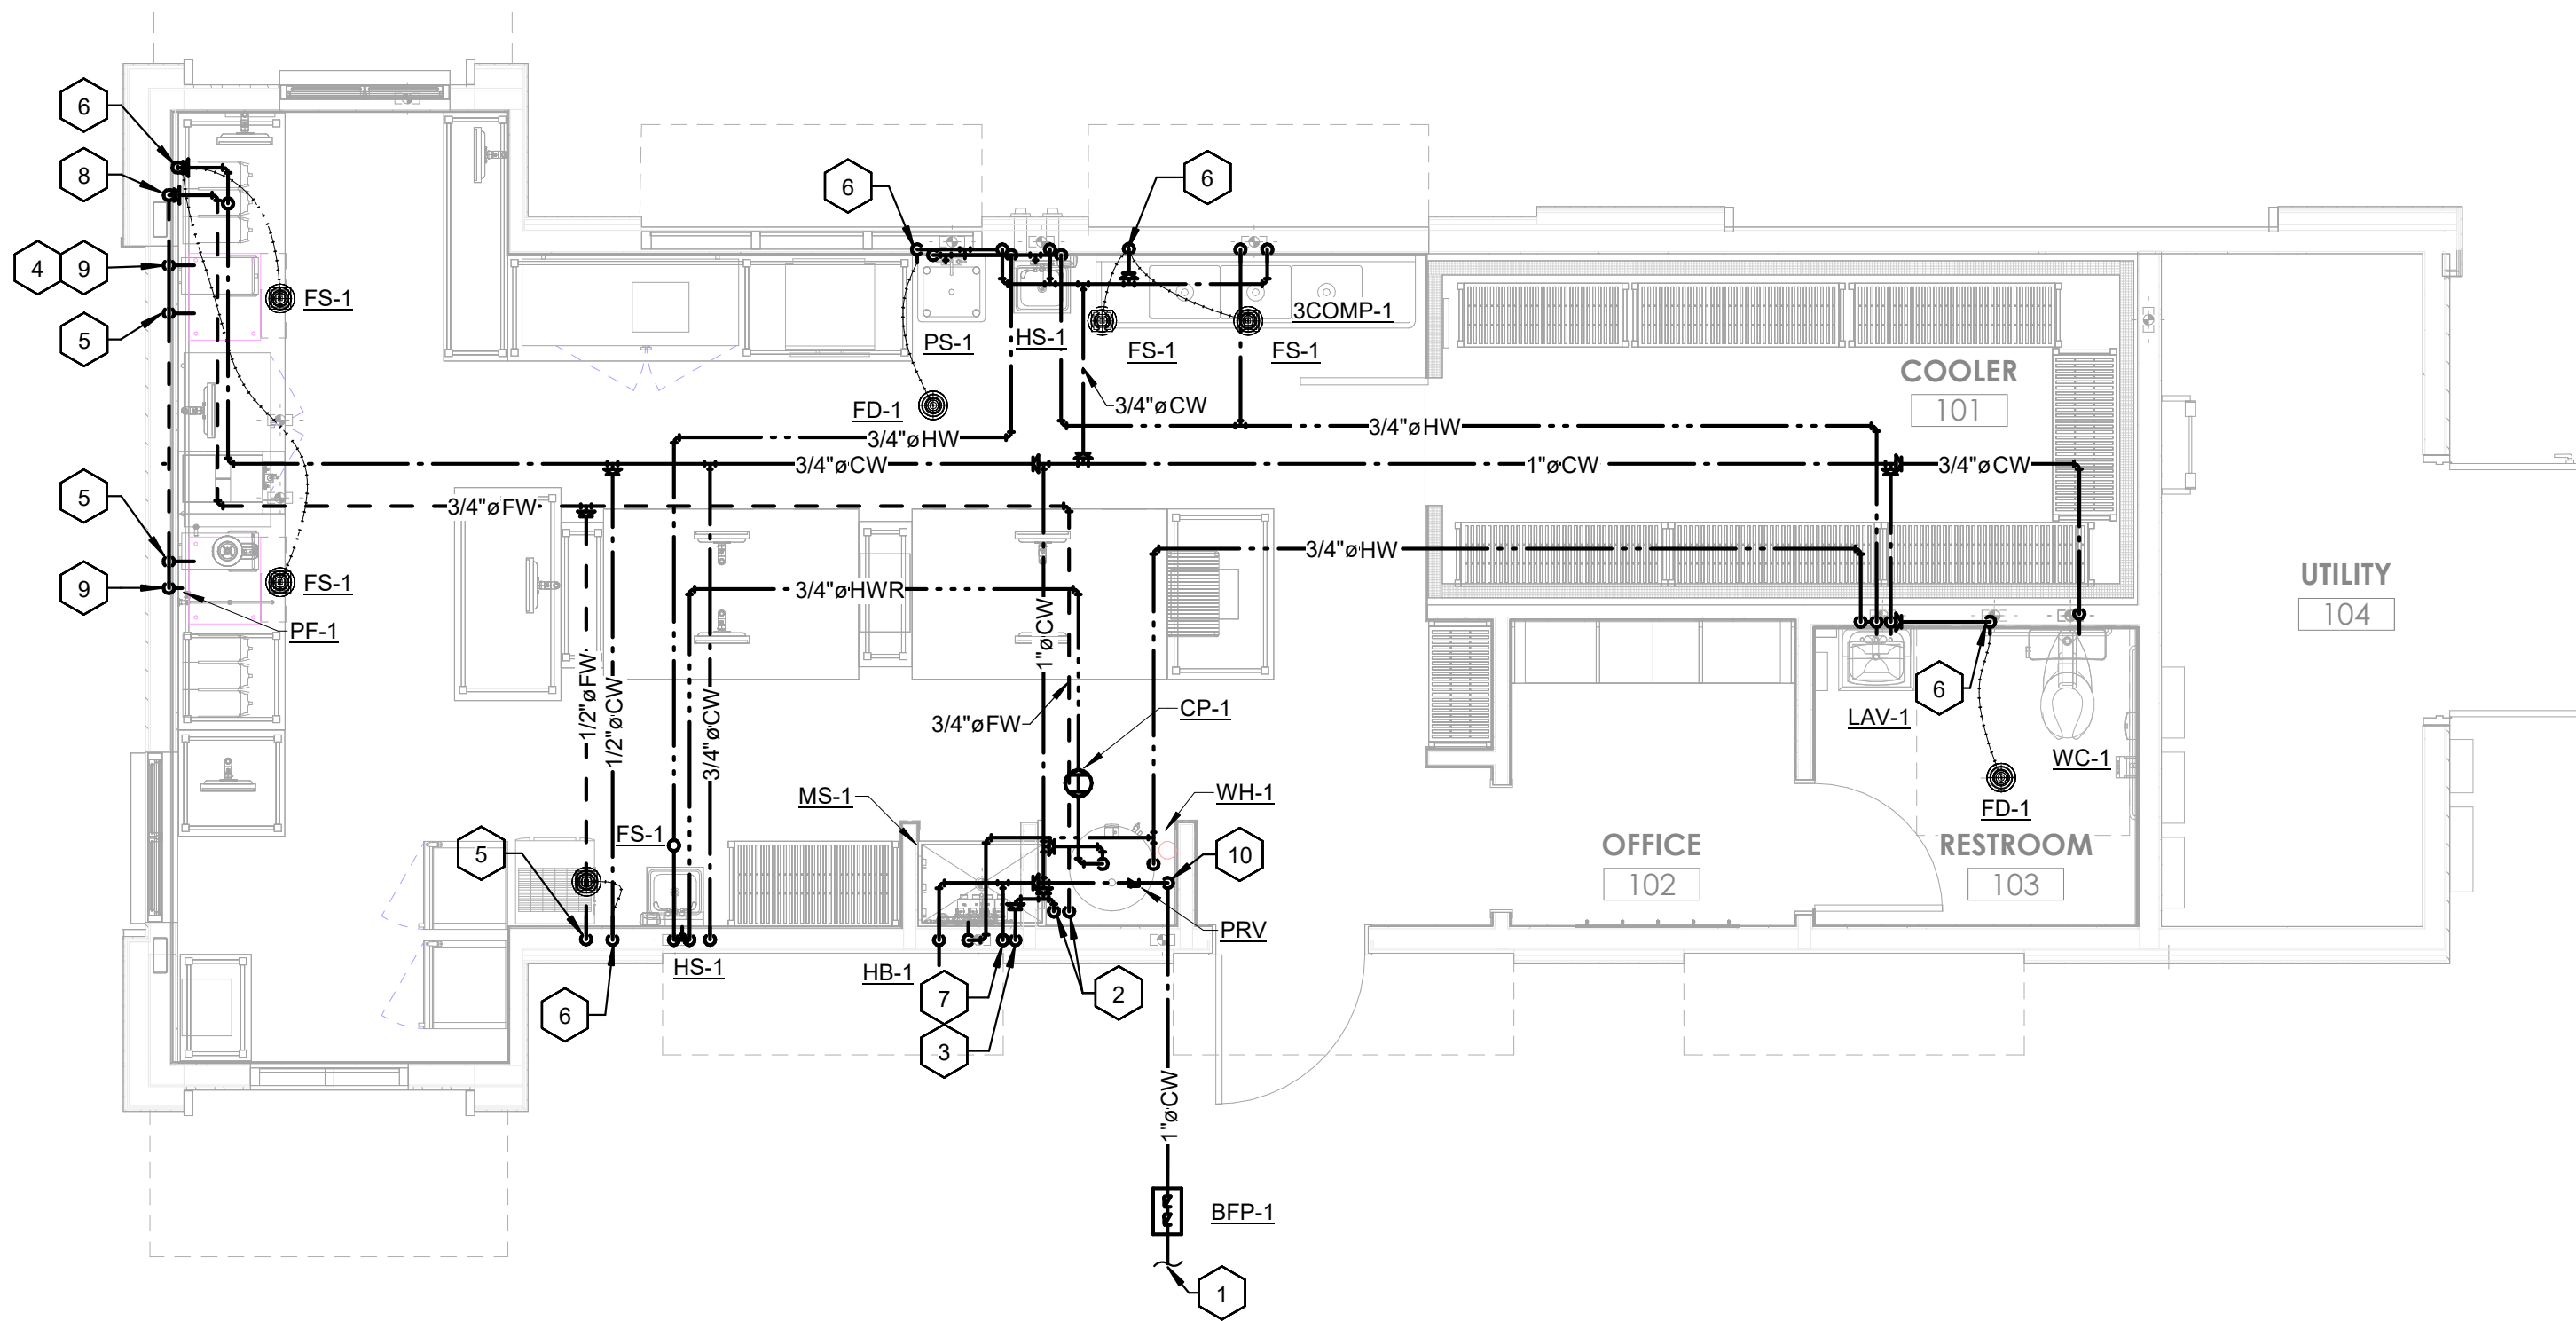

1 DOMESTIC WATER SUPPLY PLAN
P104 1/4" = 1'-0"

NOTES BY SYMBOL

- 1 REFER TO CIVIL PLANS FOR CONTINUATION OF DOMESTIC WATER SERVICE AND METER TO BUILDING.
- 2 3/4-INCH DOMESTIC/FILTERED WATER CONNECTIONS TO FILTERED WATER STATION (BY OTHERS). REFER TO ARCHITECTURAL PLANS FOR ADDITIONAL INFORMATION. PROVIDE AND INSTALL AN IN-LINE RPZ (WATTS LF009-QT) ON SUPPLY SIDE OF FILTERED WATER STATION. RPZ DRAIN LINE SHALL DISCHARGE INTO MOP SINK.
- 3 1/2-INCH DOMESTIC WATER PIPING DOWN TO CHEMICAL DISPENSER (BY OTHERS). PROVIDE AND INSTALL T&S BRASS, 9-0235LN FAUCET FOR CONNECTION TO CHEMICAL DISPENSER. REFER TO ARCHITECTURAL PLANS FOR ADDITIONAL INFORMATION. PROVIDE AND INSTALL AN IN-LINE BACKFLOW PREVENTION DEVICE (WATTS LF009-QT-FS OR EQUAL) .
- 4 CONNECT 1/2-INCH FILTERED WATER PIPING INTO ICE TEA BREWER (PROVIDED BY OTHERS). PROVIDE WITH ISOLATION VALVE AND IN-LINE BACKFLOW PREVENTION DEVICE (WATTS SD-3 OR APPROVED EQUAL). REFER TO ARCHITECTURAL PLANS FOR ADDITIONAL INFORMATION.
- 5 CONNECT 1/2-INCH FILTERED WATER PIPING INTO ICE MACHINE (PROVIDED BY OTHERS). PROVIDE WITH ISOLATION VALVE AND IN-LINE BACKFLOW PREVENTION DEVICE (WATTS SD-3 OR APPROVED EQUAL). REFER TO ARCHITECTURAL PLANS FOR ADDITIONAL INFORMATION.
- 6 1/2-INCH DOMESTIC WATER PIPING SERVING FLOOR DRAIN/FLOOR SINK TRAP PRIMER. INSTALL TRAP PRIMER IN ACCESSIBLE LOCATION OR PROVIDE WALL MOUNTED ACCESS PANEL. COORDINATE LOCATION OF ACCESS PANEL WITH ARCHITECT PRIOR TO INSTALLATION.
- 7 3/4-INCH DOMESTIC WATER UP TO HOSE BIBB (HB-1) ON ROOF PARAPET. REFER TO ARCHITECTURAL PLANS FOR ADDITIONAL INFORMATION.
- 8 PROTECT IN-WALL PIPING WITH NAIL PLATES
- 9 FILTERED WATER LINE CONNECTING TO POTFILLER AND TEA BREWER TO BE MADE OF FLEX LINE. 4'-11" MOUNTING HEIGHT.
- 10 PROVIDE DOMESTIC WATER SHUT OFF VALVE.



610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3
PROTOTYPE VERSION V2-B



SEAL



PERMIT SET 4.10.2024

CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DIMENSIONAL ERRORS. OMISSIONS OR DISCREPANCIES BEFORE BEGINNING OR FABRICATING ANY WORK. DO NOT SCALE DRAWINGS.

ISSUE	DATE	DESCRIPTION


PROJECT INFORMATION	
PROJECT NO:	24-0087
ORIGINAL ISSUE:	4/1/2024
SCALE:	AS NOTED
DRAWN BY:	JB
CHECKED BY:	CL

SHEET TITLE


DOMESTIC WATER PLAN

SHEET NUMBER


P104

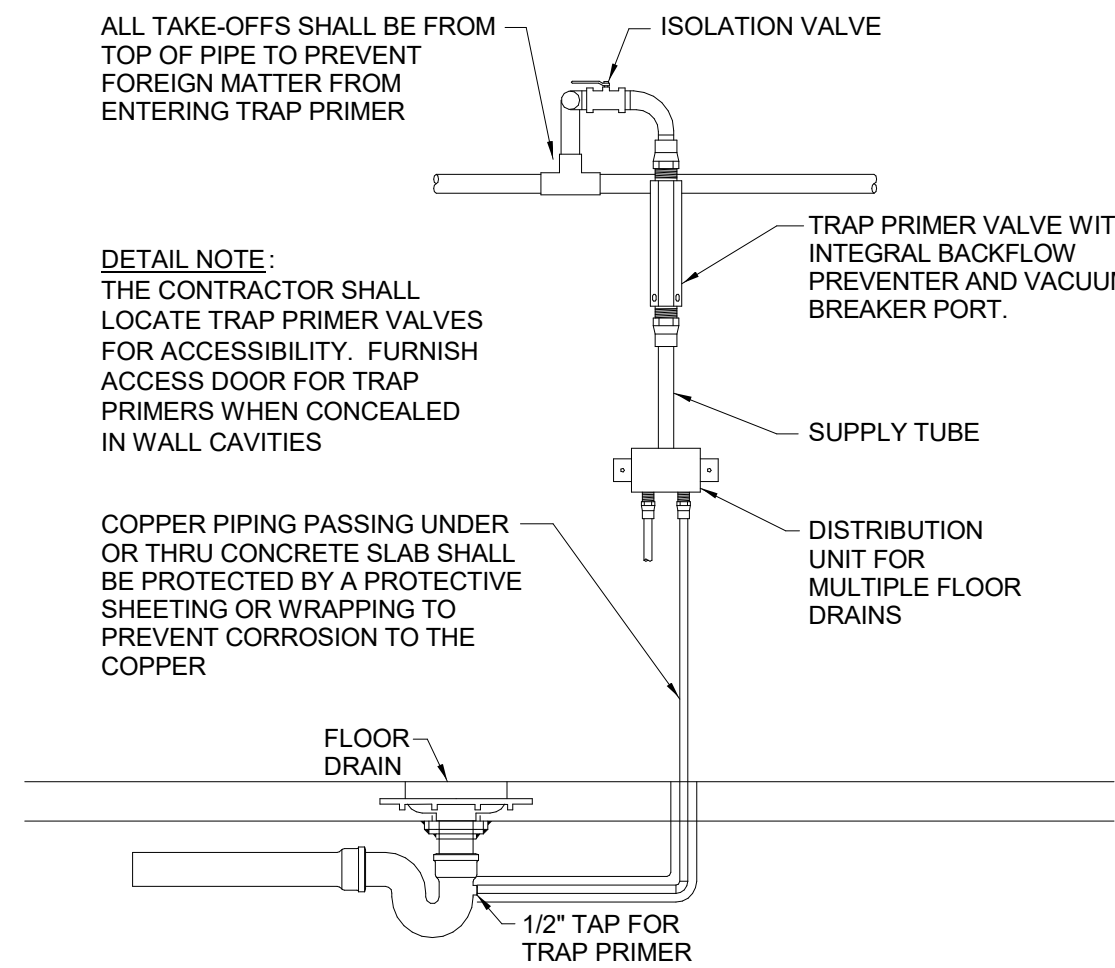


1 TRAP PRIMER
SCALE: NO SCALE

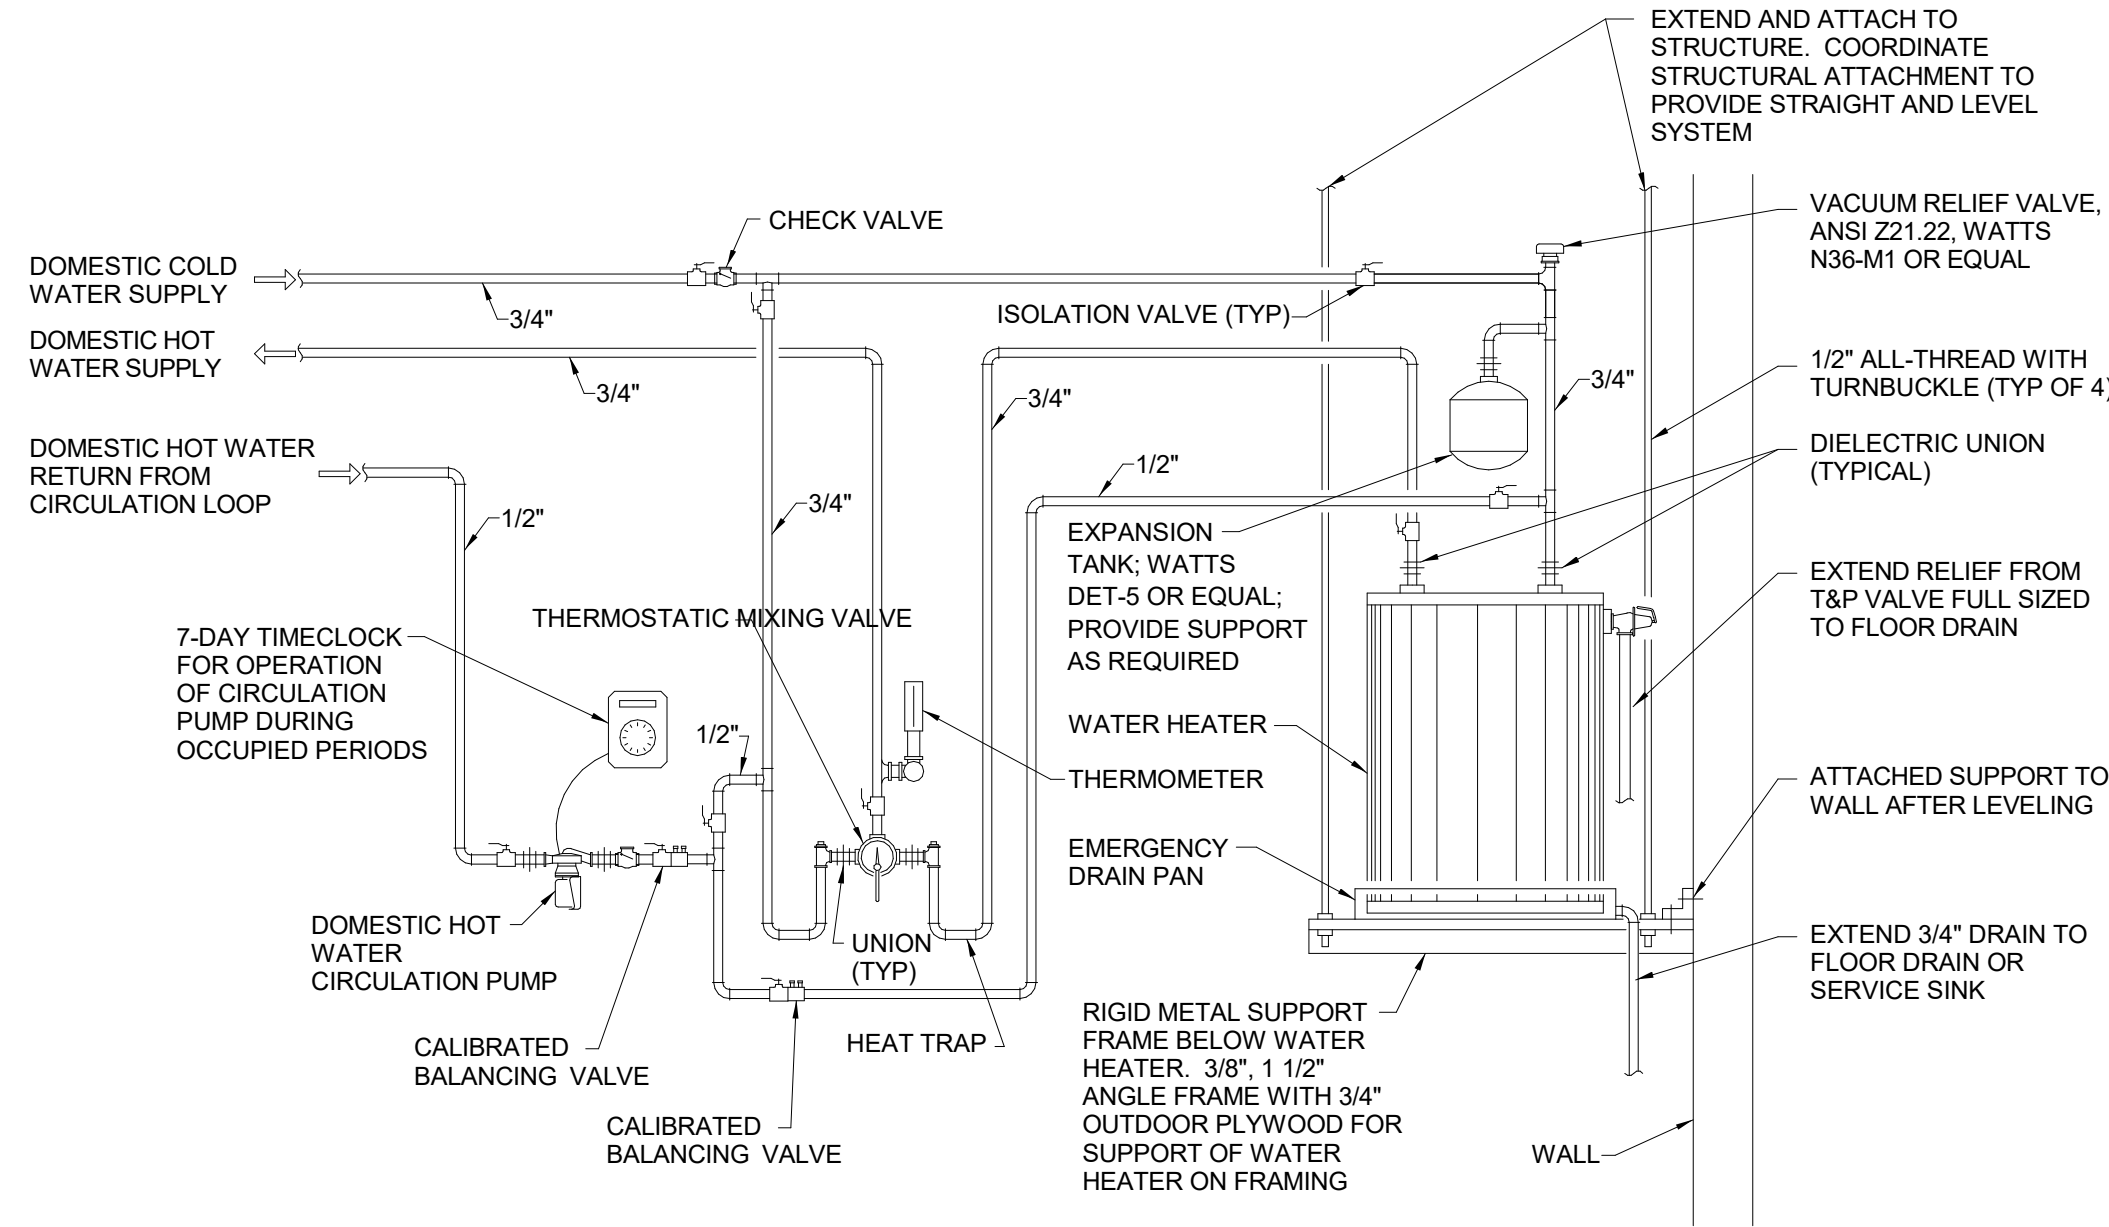


2 SUSPENDED WATER HEATER
SCALE: NO SCALE

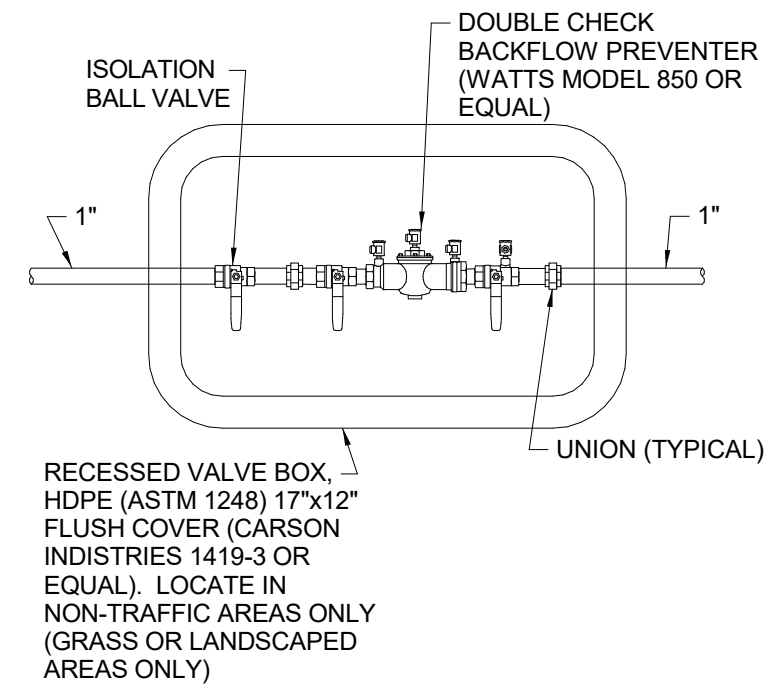


3 DOMESTIC WATER SERVICE ENTRANCE
SCALE: NO SCALE

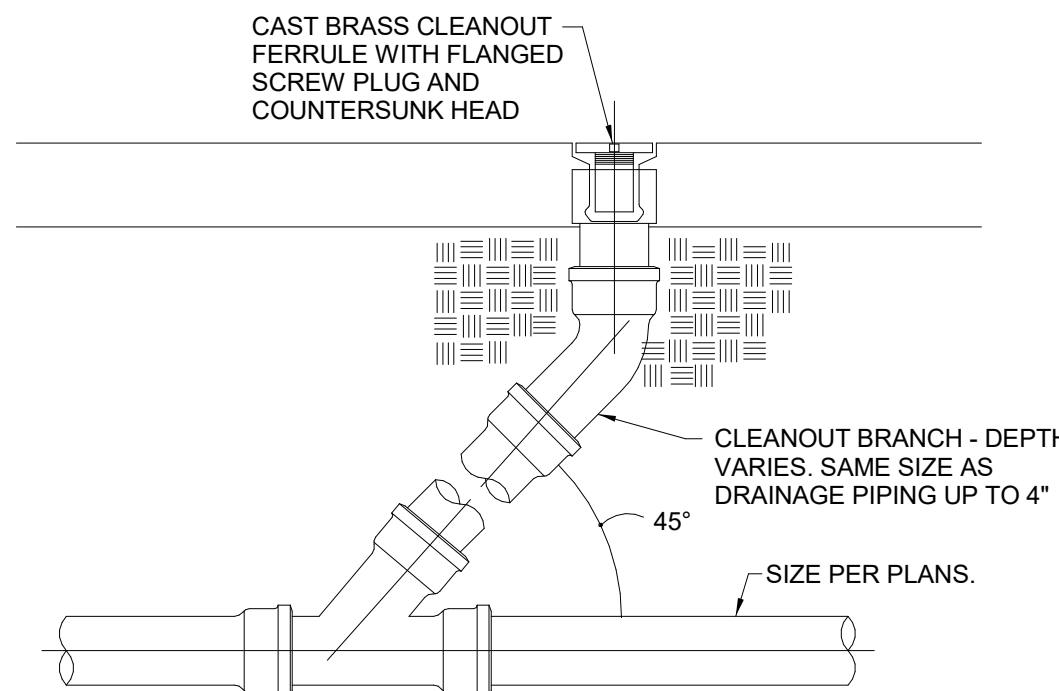


4 FLOOR CLEANOUT
SCALE: NO SCALE

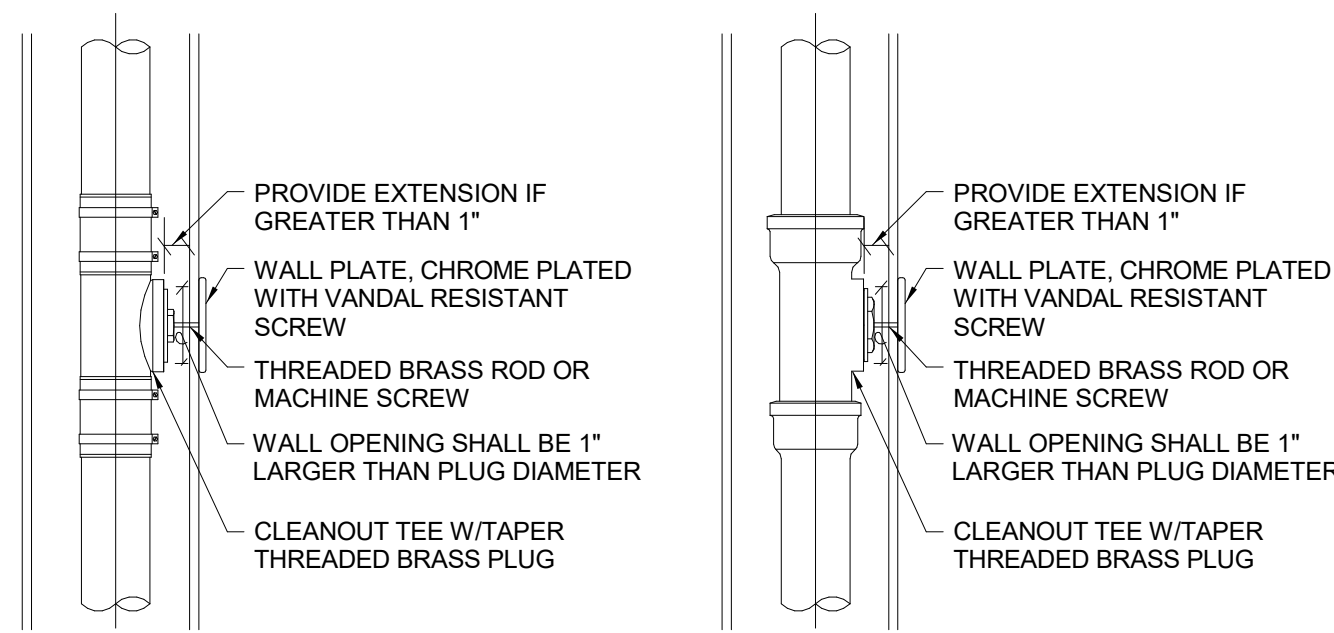


5 WALL CLEANOUT
SCALE: NO SCALE

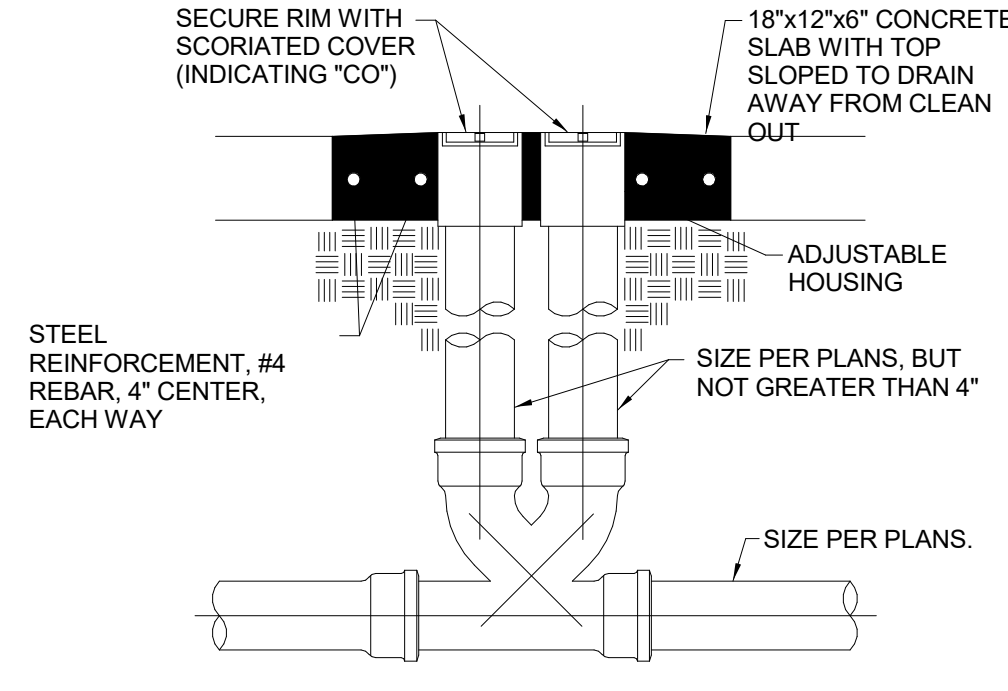


6 DOUBLE CLEANOUT
SCALE: NO SCALE

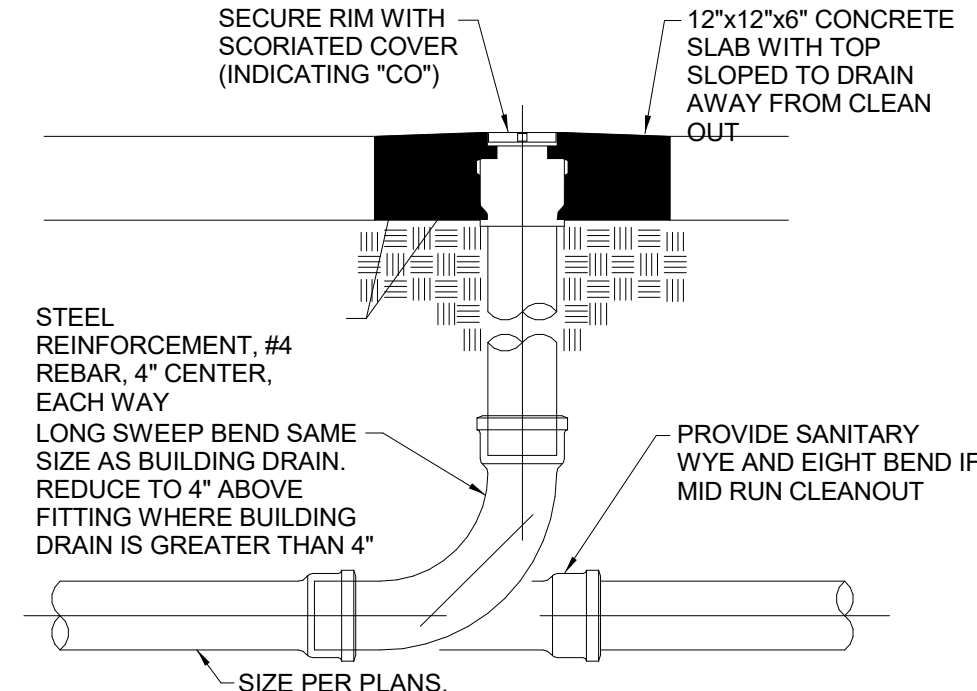

7 GRADE CLEANOUT
SCALE: NO SCALE

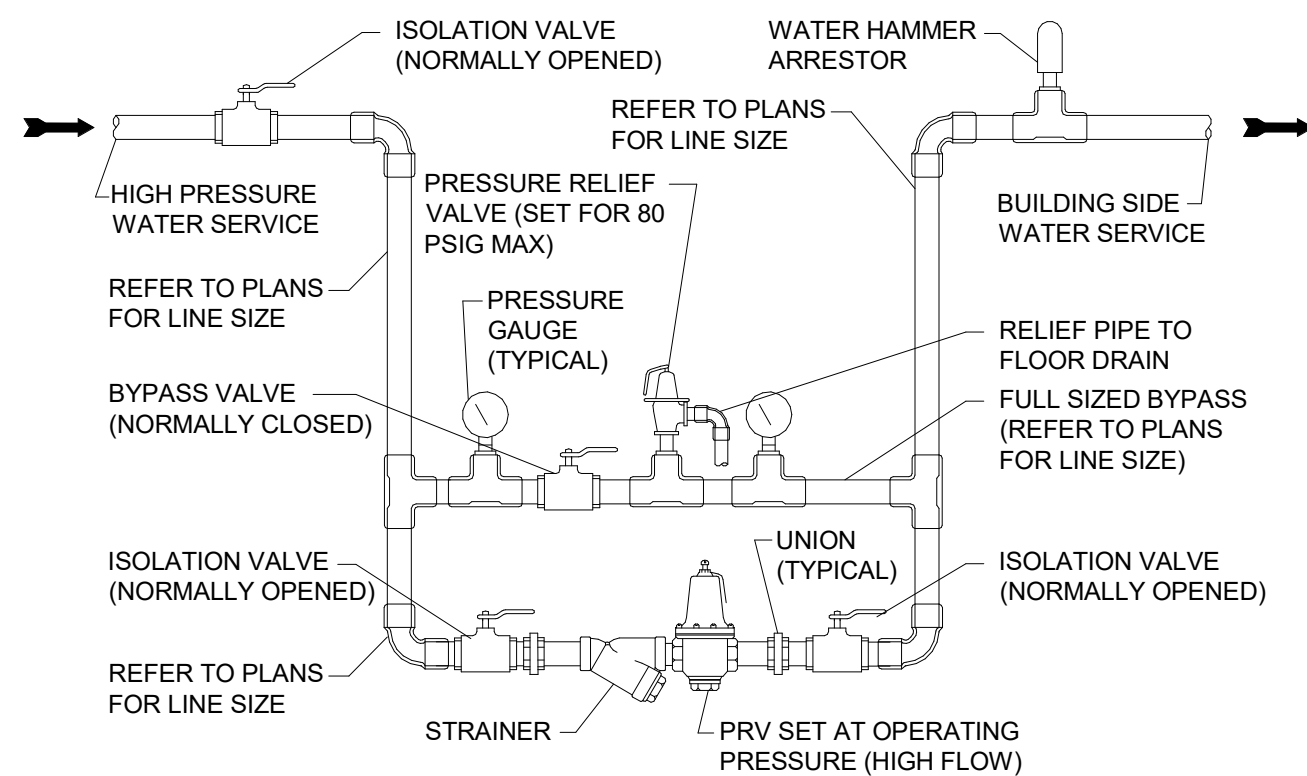

8 PRESSURE REDUCING VALVE PIPING DIAGRAM
SCALE: NO SCALE

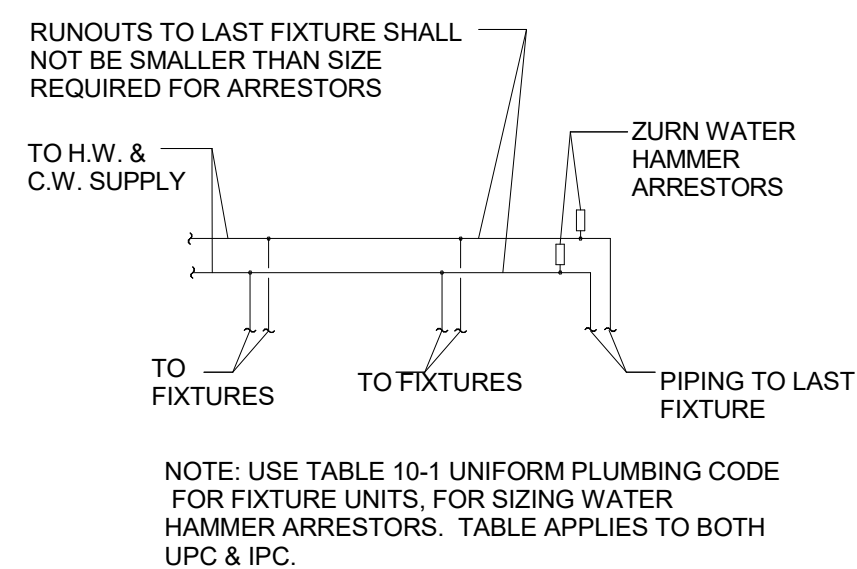

9 WATER HAMMER ARRESTOR DETAIL
SCALE: NO SCALE


WATER HAMMER ARRESTOR SIZING CHART		
FIXTURE UNIT RATING	CONNECTION TO SUPPLY LINE	
1-11	3/4"	
12-32	1"	
33-60	1"	
61-113	1"	
114-154	1"	
155-330	1"	



610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3
PROTOTYPE VERSION V2-B



SEAL

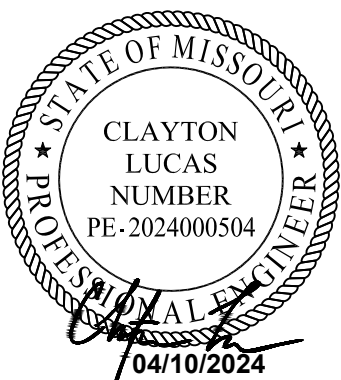

PERMIT SET 4.10.2024

CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DIMENSIONAL ERRORS. OMISSIONS OR DISCREPANCIES BEFORE BEGINNING OR FABRICATING ANY WORK. DO NOT SCALE DRAWINGS.

ISSUE	DATE	DESCRIPTION

PROJECT INFORMATION	
PROJECT NO:	24-0087
ORIGINAL ISSUE:	09/06/2022
SCALE:	AS NOTED
DRAWN BY:	JB
CHECKED BY:	CL

SHEET TITLE

PLUMBING DETAILS

SHEET NUMBER

P105

4/10/2024 2:10:34 PM

GENERAL NOTES

1.

PERFORM ALL WORK IN ACCORDANCE WITH ALL APPLICABLE CODES AND AUTHORITIES HAVING JURISDICTION. PROVIDE ALL PERMITS, INSPECTIONS, LICENSES AND FEES. FURNISH ALL LABOR, EQUIPMENT, SUPPLIES AND MATERIALS NECESSARY TO PROVIDE COMPLETE AND OPERATIONAL SYSTEMS.

2.

THE DRAWINGS AND SPECIFICATIONS INDICATE THE GENERAL DESIGN AND ARRANGEMENT OF PIPES, FIXTURES, EQUIPMENT, SYSTEMS, ETC. INFORMATION SHOWN IS DIAGRAMMATIC IN CHARACTER AND DOES NOT NECESSARILY INDICATE EVERY REQUIRED OFFSET, FITTING, ETC. DO NOT SCALE THE DRAWINGS FOR DIMENSIONS. TAKE ALL DIMENSIONS, MEASUREMENTS, EQUIPMENT LOCATIONS, LEVELS, ETC FROM THE ARCHITECTURAL DRAWINGS AND FROM THE EQUIPMENT TO BE FURNISHED. PIPING MAY BE RELOCATED OR OFFSET FOR PROPER CLEARANCES OR TO AVOID CONFLICTS WITH OTHER TRADES. THE DESIGN INTENT (I.E. PITCHES, VELOCITIES, PRESSURE DROPS, VOLTAGE DROPS, ETC) CANNOT BE GREATLY ALTERED WITHOUT THE APPROVAL OF THE ARCHITECT. THE COST OF THESE DEVIATIONS TO AVOID INTERFERENCES SHALL BE PART OF THE ORIGINAL CONTRACT BID.

3.

CONFER AND COOPERATE WITH ALL OTHER TRADES TO COORDINATE THEIR WORK. COORDINATION SHALL INCLUDE, BUT SHALL NOT BE LIMITED TO MATERIALS AND EQUIPMENT ROUTED IN CEILING AND WALL CAVITIES, EQUIPMENT ARRANGEMENT IN MECHANICAL SPACES, INCLUDING EQUIPMENT CLEARANCE REQUIREMENTS, ELEVATIONS AND DIMENSIONS OF STRUCTURAL MEMBERS AND OPENINGS, ETC. NOTIFY THE ARCHITECT OF ANY CONFLICTS.

4.

BASE FINAL INSTALLATION OF MATERIALS AND EQUIPMENT ON ACTUAL DIMENSIONS AND CONDITIONS AT THE PROJECT SITE. FIELD MEASURE FOR MATERIALS AND EQUIPMENT REQUIRING EXACT FIT. NO EXTRAS WILL BE GIVEN FOR THE CONTRACTOR'S FAILURE TO FIELD COORDINATE.

5.

THE OWNER OR ENGINEER ARE NOT RESPONSIBLE FOR THE CONTRACTOR'S SAFETY PRECAUTIONS OR FOR MEANS, METHODS, TECHNIQUES, CONSTRUCTION SEQUENCES, OR PROCEDURES REQUIRED TO PERFORM THE WORK.

6.

LOCATE ALL EQUIPMENT THAT MUST BE SERVICED, OPERATED, OR MAINTAINED IN FULLY ACCESSIBLE POSITIONS. EQUIPMENT SHALL INCLUDE (BUT NOT LIMITED TO) VALVES, MOTORS, CONTROLLERS, SWITCHGEAR, AND DRAIN POINTS IF REQUIRED FOR BETTER ACCESSIBILITY. FURNISH ACCESS DOORS FOR THIS PURPOSE. MINOR DEVIATIONS FROM THE DRAWINGS MAY BE ALLOWED TO PROVIDE FOR BETTER ACCESSIBILITY. ANY CHANGES SHALL BE APPROVED BY THE ARCHITECT AND CONSTRUCTION MANAGER/GENERAL CONTRACTOR PRIOR TO MAKING THE CHANGE.

7.

PROVIDE ACCESS DOORS, WALL OPENINGS, ROOF OPENINGS OR ANY OTHER CONSTRUCTION REQUIREMENT NEEDED TO ACCOMMODATE THE MECHANICAL EQUIPMENT. LOCATIONS OF THESE OPENINGS SHALL BE SUBMITTED IN SUFFICIENT TIME TO BE INSTALLED IN THE NORMAL COURSE OF WORK.

8.

COORDINATE ELECTRICAL REQUIREMENTS OF APPROVED MECHANICAL EQUIPMENT WITH THE ELECTRICAL SUB-CONTRACTOR PRIOR TO THE PURCHASE AND INSTALLATION OF ANY ELECTRICAL EQUIPMENT, DEVICES, WIRING, OR CONDUIT.

9.

PROVIDE GENERAL CONTROL WIRING, THERMOSTATS, MOTORIZED DAMPERS AND CONDUIT ASSOCIATED WITH HVAC EQUIPMENT. COORDINATE THE LOCATION OF ALL THERMOSTATS, ROOM SENSORS, ETC WITH THE ARCHITECT AND ALL OTHER TRADES PRIOR TO INSTALLATION. IF A CONFLICT WITH MILLWORK, LIGHT SWITCHES, WINDOWS, ETC EXISTS, NOTIFY THE ARCHITECT OF THE POTENTIAL INTERFERENCE PRIOR TO INSTALLATION. INSTALL THERMOSTATS WITH PROTECTIVE LOCKING COVER, CENTERED AT 4'-0" ABOVE FINISHED FLOOR, UNLESS OTHERWISE INDICATED. COMPLY WITH THE PROVISIONS OF THE AMERICANS WITH DISABILITIES ACT (ADA).

10.

ALL DIMENSIONS SHOWN ON THE DRAWINGS FOR DUCTWORK ARE NET INSIDE CLEAR DIMENSIONS. FOR RECTANGULAR DUCT, THE FIRST FIGURE OF THE DUCT SIZE INDICATES THE DIMENSION OF THE FACE SHOWN. VERIFY THAT THE DUCTWORK SPECIFIED WILL FIT IN THE SPACE AVAILABLE USING THE ARCHITECTURAL, STRUCTURAL AND ELECTRICAL DRAWINGS AS REFERENCE PRIOR TO FABRICATION AND INSTALLATION. ROUND DUCT OF EQUAL NET INSIDE CLEAR AREA MAY BE USED IN LIEU OF RECTANGULAR DUCT.

11.

PROVIDE TURNING VANES ON ALL RECTANGULAR SUPPLY, OUTDOOR AIR, EXHAUST AND RETURN DUCTWORK INCLUDING THE TOP AND BOTTOM OF VERTICAL DUCTS.

12.

PROVIDE A LOCKING QUADRANT VOLUME DAMPER AT THE TAP OF EACH RUN-OUT TO DIFFUSERS FOR BALANCING PURPOSES, UNLESS OTHERWISE INDICATED. THE RUN-OUT DUCT SIZE IS THE SAME SIZE AS THE DIFFUSER OR GRILLE NECK SIZE UNLESS OTHERWISE INDICATED.

13.

REFER TO ARCHITECTURAL DRAWINGS FOR LOCATION OF ALL FIRE RATED WALLS AND CEILINGS. PROVIDE FIRE DAMPERS AND/OR COMBINATION FIRE/SMOKE DAMPERS IN DUCTWORK AT ALL LOCATIONS WHERE DUCTS PASS THROUGH FIRE RATED ASSEMBLY. MECHANICAL SUB-CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING AND INSTALLING FIRE AND FIRE/SMOKE DAMPERS. COORDINATE CONSTRUCTION REQUIREMENTS AND PROVISIONS FOR CONNECTIONS TO FIRE ALARM SYSTEM.

14.

ALL DUCTWORK SHALL BE SHEET METAL FABRICATED IN ACCORDANCE WITH SMACNA STANDARDS. ALL DUCT WORK ASSOCIATED WITH CONSTANT VOLUME SYSTEMS SHALL BE CONSTRUCTED TO 2" W.G. AND SEALED TO SMACNA CLASS B. SEAL ALL SEAMS WITH MASTIC SEALANT U-181 LISTED FOR THE APPLICATION USED. SEALANT SHALL BE DESIGNED FOR USE ON METAL DUCT AND FLEXIBLE DUCT.

15.

ALL RECTANGULAR AND ROUND SUPPLY AND RETURN DUCTWORK LOCATED IN EXPOSED INTERIOR AREAS SHALL BE INTERNALLY LINED WITH DUCT LINER AND EXTERNALLY PAINTED. REFER TO ARCHITECT FOR COLOR SELECTION.

16.

PROVIDE VIBRATION ISOLATORS FOR MOTOR DRIVEN EQUIPMENT UNLESS NOTED OTHERWISE. PROVIDE ISOLATION AS INDICATED OR AS RECOMMENDED BY THE EQUIPMENT MANUFACTURER.

17.

SOME DUCTS SHOWN ON EACH FLOOR PLAN MAY BE SHOWN WITH AN OFFSET FOR CLARITY.

18.

SEAL ALL DUCT PENETRATIONS THROUGH FIRE RATED BUILDING ELEMENTS WITH AN APPROVED FIRE PROOFING MATERIAL.

19.

ALL EQUIPMENT SHALL HAVE IDENTIFICATION TAGS. TAGS SHALL BE PLASTIC LAMINATE, WHITE FACE WITH 1/2" TALL BLACK LETTERS. THE TAG SHALL MATCH THE UNIT DESIGNATIONS SHOWN ON THE SCHEDULES.

20.

EXPAND OR REDUCE DUCTS AT EQUIPMENT CONNECTIONS BASED ON THE EQUIPMENT PURCHASED, WITH TRANSITIONS NOT TO EXCEED 30 DEGREES. SIZES SHOWN ON SCHEDULES, ETC. ARE FOR GUIDANCE ONLY. ASPECT RATIO SHALL BE NO GREATER THAN 4:1, PER SMACNA'S GUIDELINES.

21.

ALL DUCTS WITH A DIMENSION GREATER THAN 12" PASSING THRU A NON-RATED WALL SHALL HAVE THE OPENING FRAMED IN WITH METAL STUDS. COORDINATE OPENING SIZE AND LOCATION WITH OTHER TRADES.

22.

WHERE DAMPERS ARE LOCATED ABOVE HARD CEILINGS PROVIDE CONCEALED YOUNG REGULATORS. REGULATORS SHALL NOT BE LOCATED IN CORRIDORS, PATIENT CARE, OR TREATMENT AREAS. EACH REGULATOR SHALL BE LABELED PER THE SPECIFICATIONS.

23.

TEST AND BALANCE SHALL BE PERFORMED BY AN AABC LICENSED FIRM IN THE TESTING, ADJUSTING, AND BALANCING (TAB) BUSINESS FOR A MINIMUM OF 10 YEARS. AABC FIRM SHALL SUBMIT A REPORT TO THE ENGINEER OF RECORD INDICATING EQUIPMENT NAMEPLATE DATA, DESIGN PERFORMANCE, INITIAL TESTED PERFORMANCE, AND FINAL ADJUSTED PERFORMANCE. REPORT SHALL BE SUBMITTED IN A TIMELY FASHION PRIOR TO JOB CLOSE-OUT. TAB SHALL BE PERFORMED ON ALL NEW SYSTEMS SPECIFIED AS PART OF THIS CONTRACT. TAB FIRM SHALL PERFORM A FUNCTIONAL PERFORMANCE TEST OF THE SYSTEM BASED ON THE CONTRACT DOCUMENTS HEREIN SHALL AND RELAY ALL DISCREPANCIES AND OUTSTANDING CONSTRUCTION ITEMS RELATING TO THE MECHANICAL EQUIPMENT AND PERFORMANCE TO THE ENGINEER OF RECORD.

SYMBOLS

SYMBOL

DESCRIPTION

20/20


</

610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3
PROTOTYPE VERSION V2-B

PROTOTYPE VERSION V2-B



SEAL

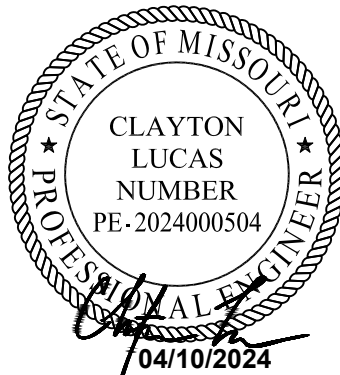

PERMIT SET 4.10.2024

CONTRACTOR SHALL VERIFY ALL
CONDITIONS AND DIMENSIONS AT THE
JOB SITE AND NOTIFY THE ARCHITECT
OF ANY DIMENSIONAL ERRORS,
OMISSIONS OR DISCREPANCIES BEFORE
BEGINNING OR FABRICATING ANY WORK.
DO NOT SCALE DRAWINGS.

[illegible]

PROJECT INFORMATION

PROJECT NO:	24-0087
ORIGINAL ISSUE:	09/06/2022
SCALE:	AS NOTED
DRAWN BY:	JB
CHECKED BY:	CL

SHEET TITLE

MECHANICAL LEGEND AND NOTES

SHEET NUMBER

M101

PACKAGED DX ROOFTOP UNIT WITH ELECTRIC HEAT SCHEDULE																																	
MARK RTU-	ARRANGEMENT	NOM. TONS	SUPPLY FAN				COMPRESSOR			CONDENSER			COOLING PERFORMANCE DATA								HEATING PERFORMANCE DATA						ELECTRICAL DATA				MANUFACTURER MAKE AND MODEL	UNIT WEIGHT (LBS)	NOTES
			S/A CFM	O/A CFM	EXT. S.P.	MOTOR H.P.	NO.	R.L.A. (EACH)	REF. TYPE	NO. FANS	AMBIENT TEMP		ENTERING AIR		NET CAPACITY (MBH)		LEAVING AIR		MIN. SEER / EER	KW	NO. STAGES	AMBIENT TEMP	EAT D.B.	LAT D.B.	V.	Ph.	MCA	MOCP					
1	DOWNFLOW	5	1750	180	0.8	1.0	2	15.9	R-410A	1	101	75	77	64	43.8	11.1	54.9	55	55	14.2	13.1	2	32	64	90	208	3	51	60	TRANE THJ	1,200	1-21	
1. TRANE IS THE BASIS FOR DESIGN. ACCEPTABLE MANUFACTURER'S ARE: AAO, YORK, LENNOX, AND CARRIER. NO EXCEPTIONS. CONTRACTOR IS RESPONSIBLE FOR COORDINATING VARIATIONS IN FIT, WEIGHT, AND ELECTRICAL SERVICE.																																	
2. PROVIDE WITH THE FOLLOWING WARRANTIES: 5-YEAR COMPRESSOR, 10-YEAR HEAT EXCHANGER, 1-YEAR ALL PARTS.																																	
3. CONTRACTOR SHALL PROVIDE UNIT START-UP SERVICES.																																	
4. PROVIDE WITH 2-IN. PLEATED MERV 8 FILTER.																																	
5. EQUIPMENT SHALL BE IDENTIFIED BY MEANS OF ENGRAVED LAMINATED PLASTIC OR ETCHED METAL NAMEPLATES PERMANENTLY ATTACHED TO EQUIPMENT.																																	
6. PROVIDE WITH 7-DAY, 24-HR. FULLY PROGRAMMABLE THERMOSTAT LOCATED PER CONSTRUCTION DOCUMENTS.																																	
7. EQUIPMENT SHALL BE SET PLUMB AND LEVEL. PROVIDE WITH 14-IN. TALL GALVANIZED INSULATED FACTORY ROOF CURB TO MATCH ROOF SLOPE.																																	
8. EQUIPMENT SHALL BE INSTALLED BY AUTHORIZED REPRESENTATIVE OF MANUFACTURER OR VERIFIED BY MANUFACTURER'S REPRESENTATIVE.																																	
9. EXTERNAL STATIC PRESSURE (IN. W.G.) INCLUDES DUCTWORK, BALANCING DAMPERS AND AIR DEVICES ONLY.																																	
10. CAPACITIES SHOWN ARE NET FROM UNIT DISCHARGE. UNITS MUST PERFORM TO LISTED CAPACITIES AND SATISFY BOTH SENSIBLE AND LATENT REQUIREMENTS.																																	
11. PROVIDE UNIT WITH SINGLE POINT ELECTRICAL CONNECTION. ELECTRICAL DATA PROVIDED INCLUDES ELECTRIC HEAT.																																	
12. PROVIDE FACTORY COIL PROTECTION PACKAGE INCLUDING CONDENSER HAIL GUARDS.																																	
13. PROVIDE UNIT WITH INTEGRAL DISCONNECT.																																	
14. PROVIDE WITH CORROSION RESISTANT CONDENSATE DRAIN PAIN.																																	
15. PROVIDE WITH DRY BULB ECONOMIZER WITH BAROMETRIC RELIEF WITH FAULT DETECTION DIAGNOSTICS PER IECC.																																	
16. PROVIDE WITH LOW-LEAK ECONOMIZER DAMPERS.																																	
17. PROVIDE UNIT WITH HOT-GAS REHEAT.																																	
18. PROVIDE WITH SPACE MOUNTED RELATIVE HUMIDITY SENSOR LOCATED PER CONSTRUCTION DOCUMENTS.																																	
19. PROVIDE UNIT WITH LOW-AMBIENT KIT SUITABLE DOWN TO 0-DEG. F. AND CRANKCASE HEATER.																																	
20. PROVIDE WITH SMOKE DETECTOR LOCATED IN RETURN DUCT INTERLOCKED TO SUPPLY FAN AS REQUIRED BY CODE.																																	
21. PROVIDE MINIMUM 2-STAGES OF COOLING. SUPPLY FAN SHALL MODULATE TO MATCH COMPRESSOR STAGING. PROVIDE WITH VFD AS REQUIRED.																																	

VENTILATION REQUIREMENT CALCULATION								PER UMC TABLE 402.1		
ROOM NAME	UNIT SERVICING	PEOPLE	CFM/PERSON	CFM/SF	AREA (SF)	PEOPLE X CFM/PERSON	SF X CFM/SF	REQUIRED O.A. CFM	PROVIDED O.A. CFM	
OFFICE	RTU-1	1	5	0.06	61	5	3.66	8.66	10	
KITCHEN	RTU-1	10	7.5	0.12	495	75	59.4	134.4	140	
FIRE RISER ROOM	-	-	-	-	50	-	-	0	0	
RESTROOM	-	-	-	-	50	-	-	0	0	
MINIMUM FRESH AIR CFM REQUIRED PER CODE									143.06	
ZONE AIR DISTRIBUTION EFFECTIVENESS (TABLE 403.3.1.2) = 0.8			=						178.825	
TOTAL O.A. PROVIDED									180	
RESTROOMS	70 CFM / FIXTURE		# FIXTURES=		1	70	CFM EXHAUST REQ'D	75	CFM EXHAUST PROVIDED	
NOTES: REPRESENTS CONDITIONS DURING NORMAL OPERATIONS AND NOT CONSIDERING ECONOMIZER OPERATION.										

FAN SCHEDULE												
MARK EF.	LOCATION	CFM	EXT. SP IN. W.G.	MOTOR DATA				DRIVE	MAX. SONES	MANUFACTURER AND MODEL NUMBER	WEIGHT (LBS.)	REMARKS
1	RESTROOM	75	0.25	(8)	950	120	1	DIRECT	4.5	GREENHECK SP-B110	11	1-5
2	ELECTRIC ROOM	50	0.25	(15.6)	790	120	1	DIRECT	0.4	GREENHECK SP-A70	12	1-5
1. OR APPROVED EQUAL 2. PROVIDE A GRAVITY BACKDRAFT DAMPER. 3. VIBRATION ISOLATION SUPPORT HANGERS. 4. PROVIDE WEATHERPROOF CAP WITH BIRD SCREEN AT DISCHARGE. 5. INTERLOCK FAN WITH LIGHT SWITCH.												

AIR DEVICE SCHEDULE								
MARK	SERVES	FACE SIZE	MOUNTING	TYPE	MATERIAL	MANUFACTURER MAKE AND MODEL	MAX NC	REMARKS
S1	SUPPLY	24" X 24"	LAY-IN	PERFORATED	STEEL	TITUS PAR	30	1,2,3
S2	SUPPLY	12" X 12"	LAY-IN	PERFORATED	STEEL	TITUS PAR	30	1,2,3
S3	SUPPLY	6" X 6"	SURFACE	PERFORATED	STEEL	TITUS PAR	30	1,2
R1	RETURN	24" X 24"	LAY-IN	PERFORATED	STEEL	TITUS PAR	30	1,2
1. UNITS SHALL BE FURNISHED WITH APPROPRIATE FRAMES, ETC. FOR MOUNTING IN RESPECTIVE CEILING/WALL TYPES AND CONDITIONS OR APPROVED EQUAL. 2. FINISH SHALL BE WHITE. 3. TRANSITION FROM BACK OF AIR DEVICE TO DUCT SIZE SHOWN ON PLANS.								

AIR CURTAIN SCHEDULE							
MARK	CFM	VOLTAGE/PHASE	FLA	AMPERAGE	MANUFACTURER MAKE AND MODEL	WEIGHT	REMARKS
AC-2	900	120/1	2.4	5	MARS AIR LPV242-1U-OB	35	1-6
1. INSTALL WITH AUTOMATIC ON/OFF SWITCH WITH DOOR OR WINDOW OPERATION. 2. PROVIDE FAN WITH BACKDRAFT DAMPER AND FAN SPEED CONTROLLER. 3. NO ELECTRIC HEAT. 4. PROVIDE WITH LOUVER AND FILTER. 5. PROVIDE WALL MOUNTING BRACKETS. 6. PAINT COLOR PER ARCHITECTURAL SPECIFICATIONS.							



610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3
PROTOTYPE VERSION V2-B



SEAL



PERMIT SET 4.10.2024

CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DIMENSIONAL ERRORS. OMISSIONS OR DISCREPANCIES BEFORE BEGINNING OR FABRICATING ANY WORK. DO NOT SCALE DRAWINGS.

ISSUE	DATE	DESCRIPTION

PROJECT INFORMATION	
PROJECT NO:	24-0087
ORIGINAL ISSUE:	09/06/2022
SCALE:	AS NOTED
DRAWN BY:	JB
CHECKED BY:	CL

SHEET TITLE


MECHANICAL
SCHEDULES

SHEET NUMBER

M102

NOTES BY SYMBOL

- 1
- PROVIDE NEW EXHAUST FAN PER SCHEDULE ON SHEET M102. SUSPEND FROM STRUCTURE. EXTEND EXHAUST DUCT UP THROUGH ROOF AND TERMINATE WITH GRAVITY VENT WITH BIRD SCREEN. ENSURE MINIMUM 10'-0" FROM ALL FRESH AIR INTAKES.
- 2
- EXHAUST DUCT THROUGH ROOF. PROVIDE WEATHERPROOF CAP AND BIRD SCREEN. MAINTAIN MINIMUM 10'-0" FROM FRESH AIR INTAKES.
- 3
- CONDENSING UNIT FOR WALK-IN COOLER SHOWN FOR REFERENCE ONLY. COMPLETE SYSTEM TO BE PROVIDED AND INSTALLED BY OWNER'S DESIGNATED CONTRACTOR. CONTRACTOR SHALL PROVIDE CONDENSING UNIT CURB MODEL B-LINE SINGLE TIER, PART # 18334.
- 4
- 3/4-INCH CONDENSATE CONNECTION TO RTU. REFER TO DETAIL 1/M104 FOR ADDITIONAL INFORMATION.
- 5
- PROVIDE 3-WAY DIFFUSER THROW AS INDICATED.
- 6
- PROVIDE 120V SMOKE DETECTOR IN RETURN AIR DUCT FOR AUTOMATIC SHUTDOWN OF UNIT. KIDDLE SUPERDUCT MODEL# K-70-160. INSTALL HVAC DUCT DETECTOR AUDIBLE/VISUAL ALARMS AND TROUBLE LIGHTS PER IMC 606.4.
- 7
- PROVIDE NEW THERMOSTAT AS INDICATED ON PLAN. MOUNT THERMOSTAT AT 48" AFF VERIFY LOCATION WITH ARCHITECT PRIOR TO ROUGH-IN. NOTIFY EOR IF LOCATION IS CHANGED PRIOR TO INSTALL.
- 8
- CONDENSATE PIPE DOWN THROUGH ROOF TO MOP SINK. DISCHARGE CONDENSATE AT MOP SINK VIA AIR GAP. SEE MECHANICAL FLOOR PLAN FOR ROUTING.

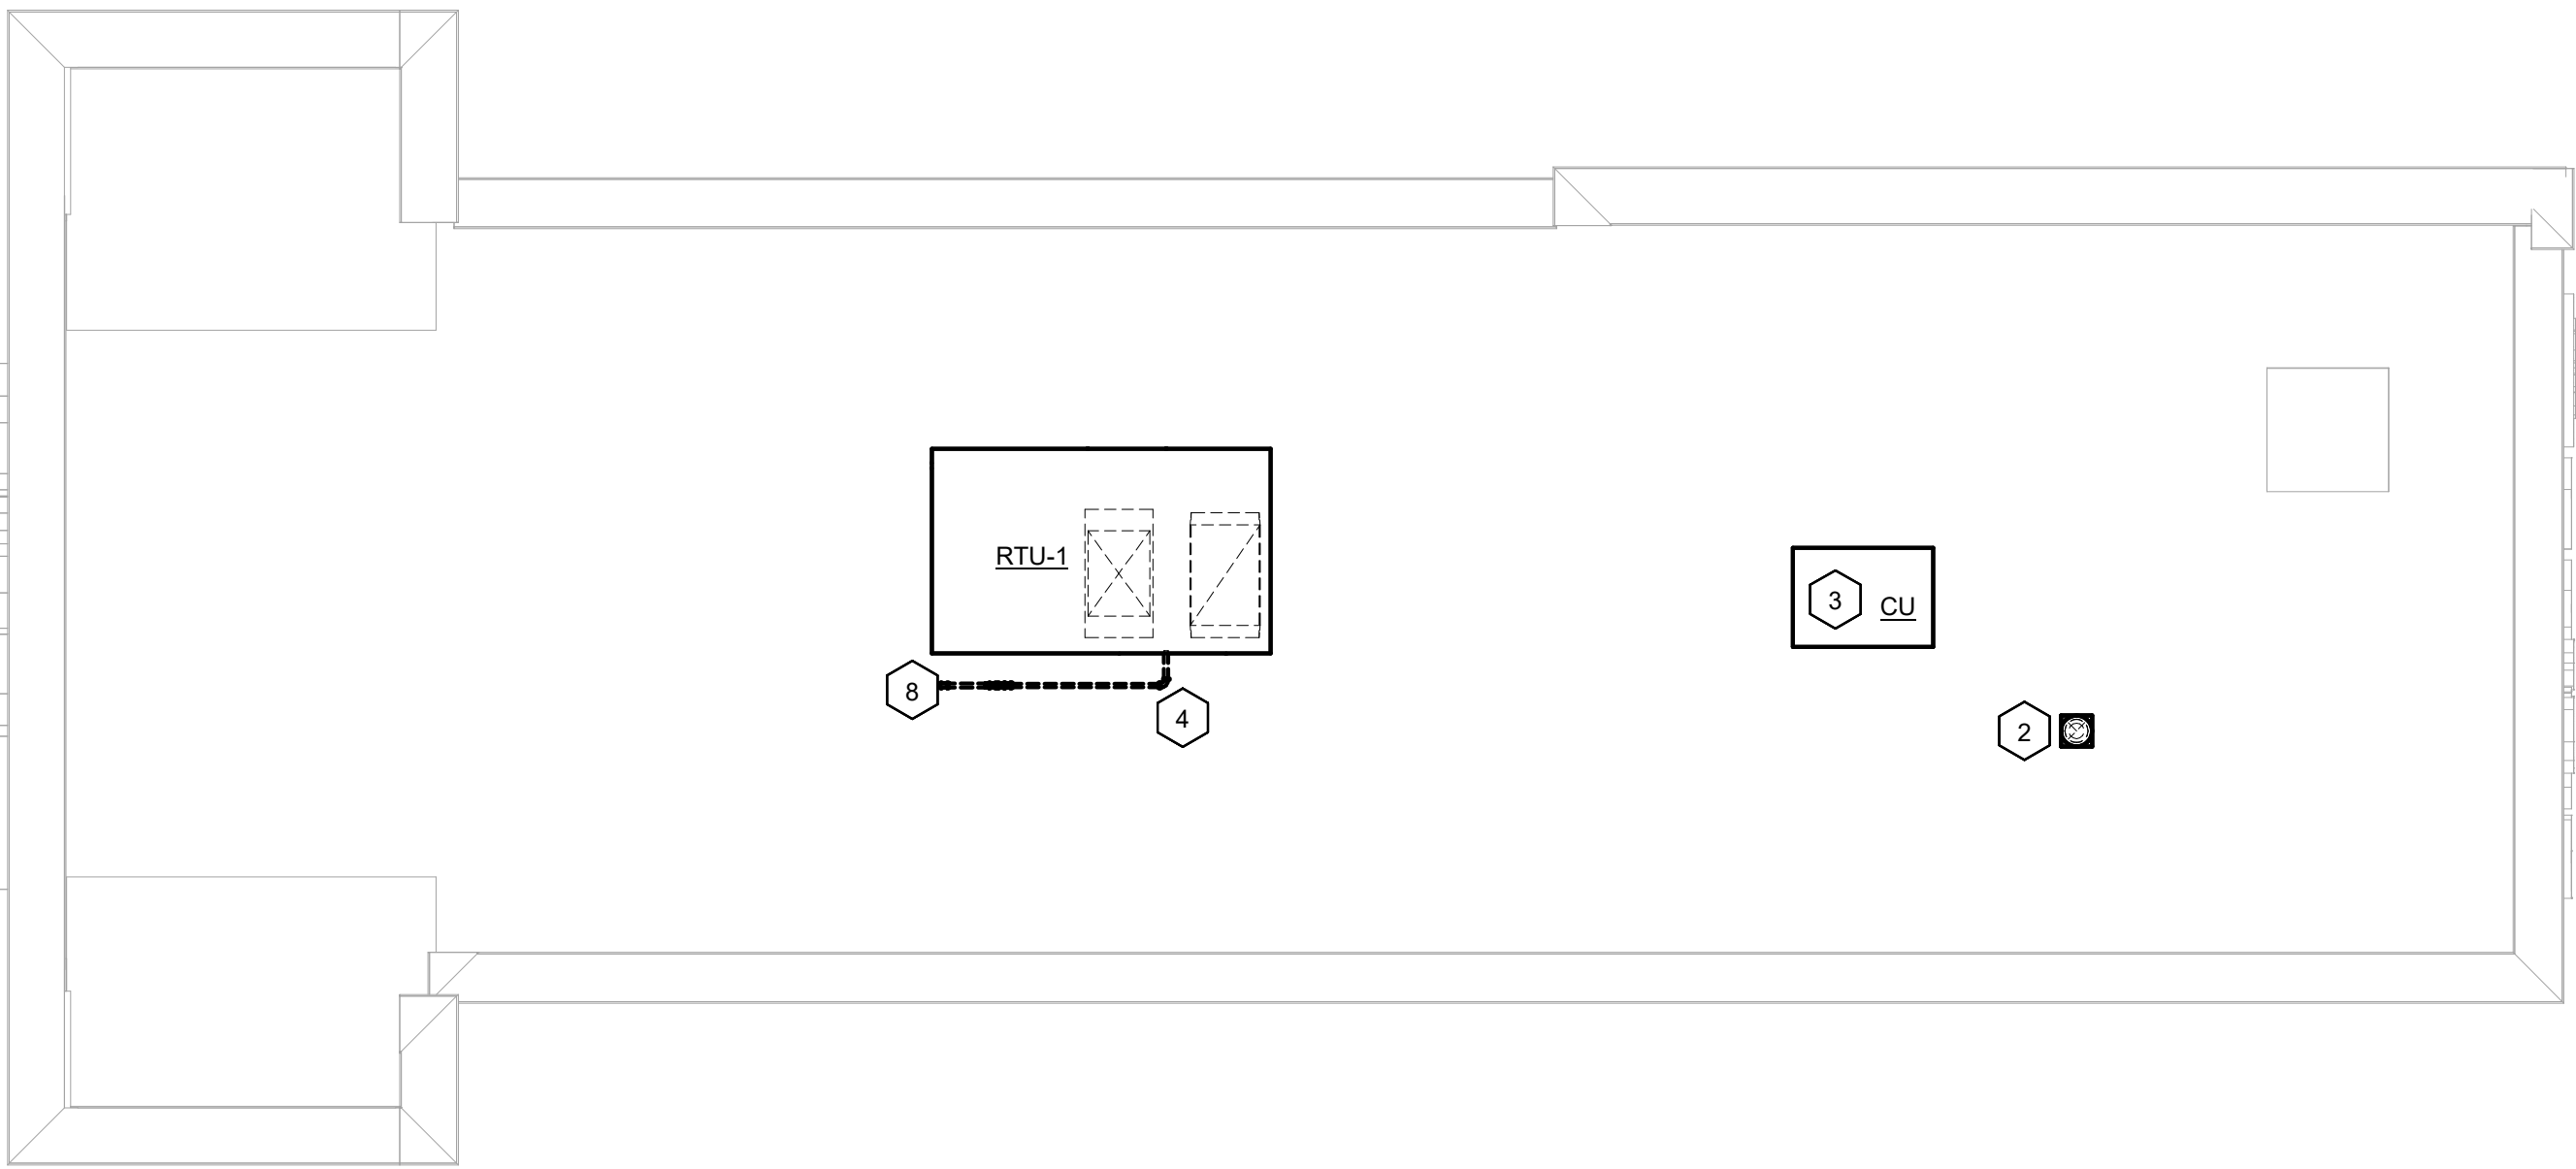


2

MECHANICAL ROOF PLAN

M103

1/4" = 1'-0"

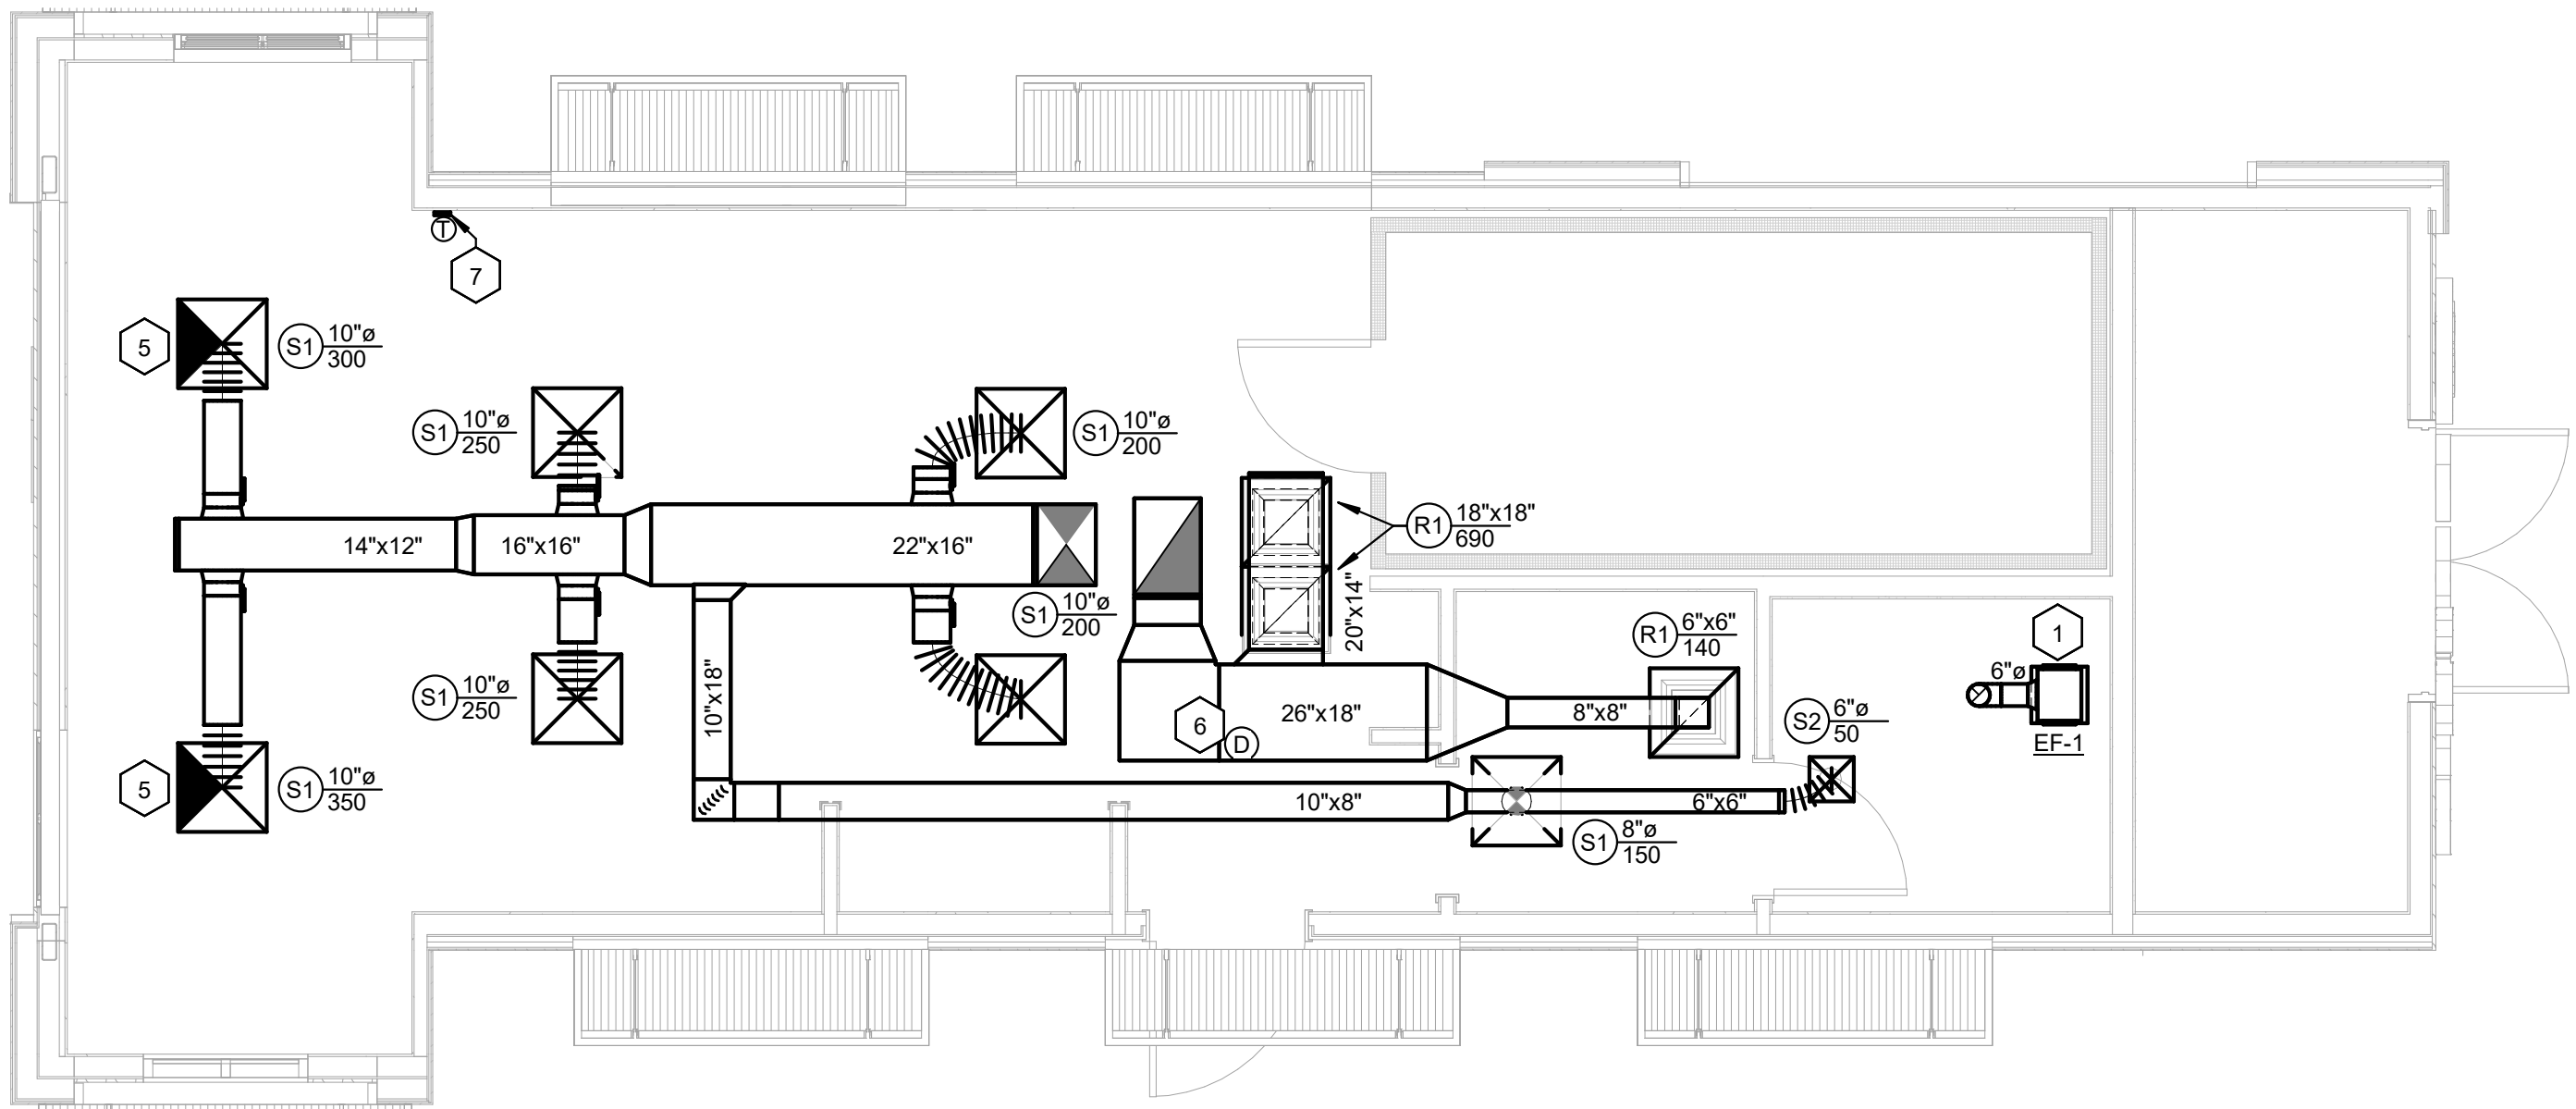

1

MECHANICAL FLOOR PLAN

M103

1/4" = 1'-0"



610 NW CHIPMAN ROAD

LEE'S SUMMIT, MO 64086 PROPOSED LOT 3

PROTOTYPE VERSION V2-B



SEAL



PERMIT SET 4.10.2024

CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DIMENSIONAL ERRORS. OMISSIONS OR DISCREPANCIES BEFORE BEGINNING OR FABRICATING ANY WORK. DO NOT SCALE DRAWINGS.

ISSUE	DATE	DESCRIPTION








PROJECT INFORMATION	
PROJECT NO:	24-0087
ORIGINAL ISSUE:	09/06/2022
SCALE:	AS NOTED
DRAWN BY:	JB
CHECKED BY:	CL

SHEET TITLE

MECHANICAL FLOOR PLANS

SHEET NUMBER

M103

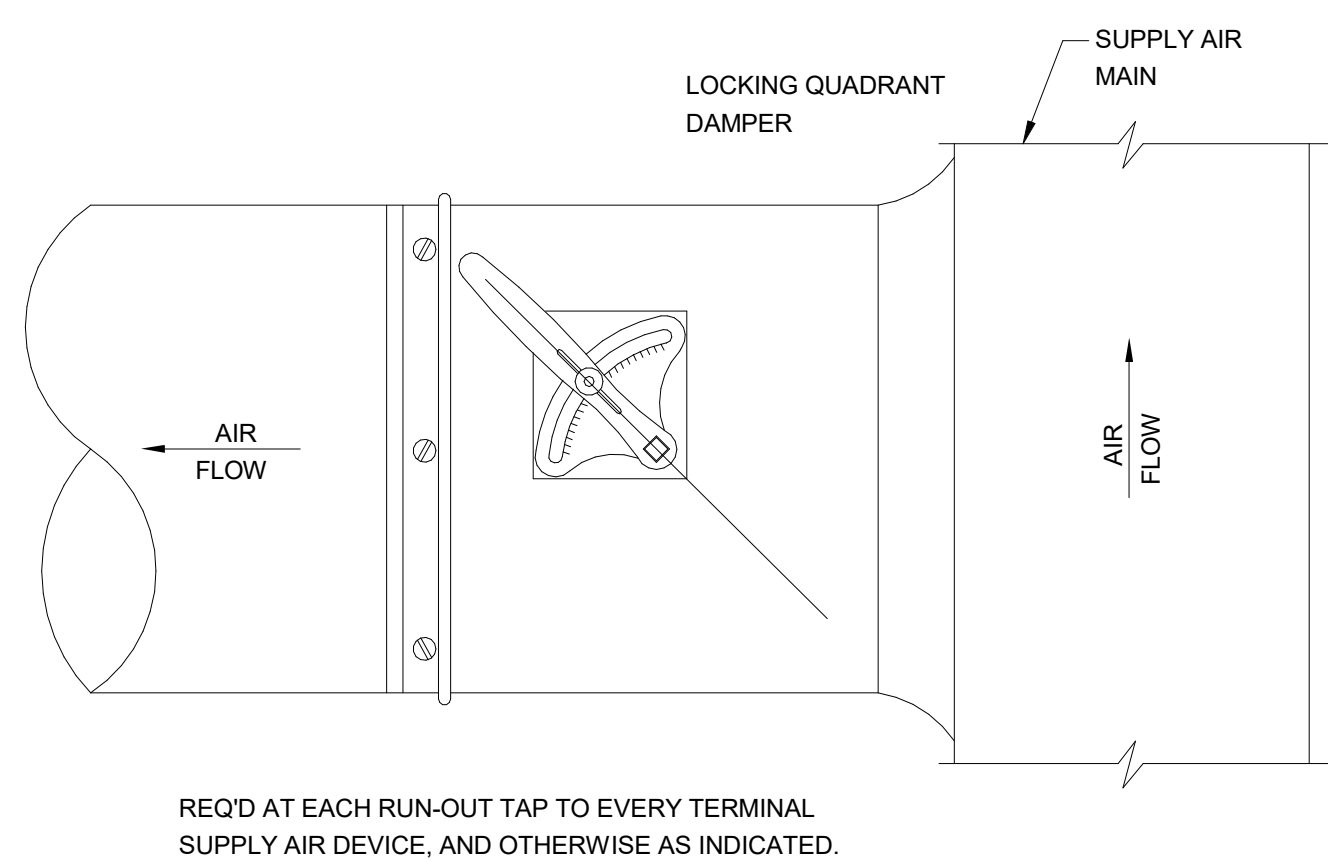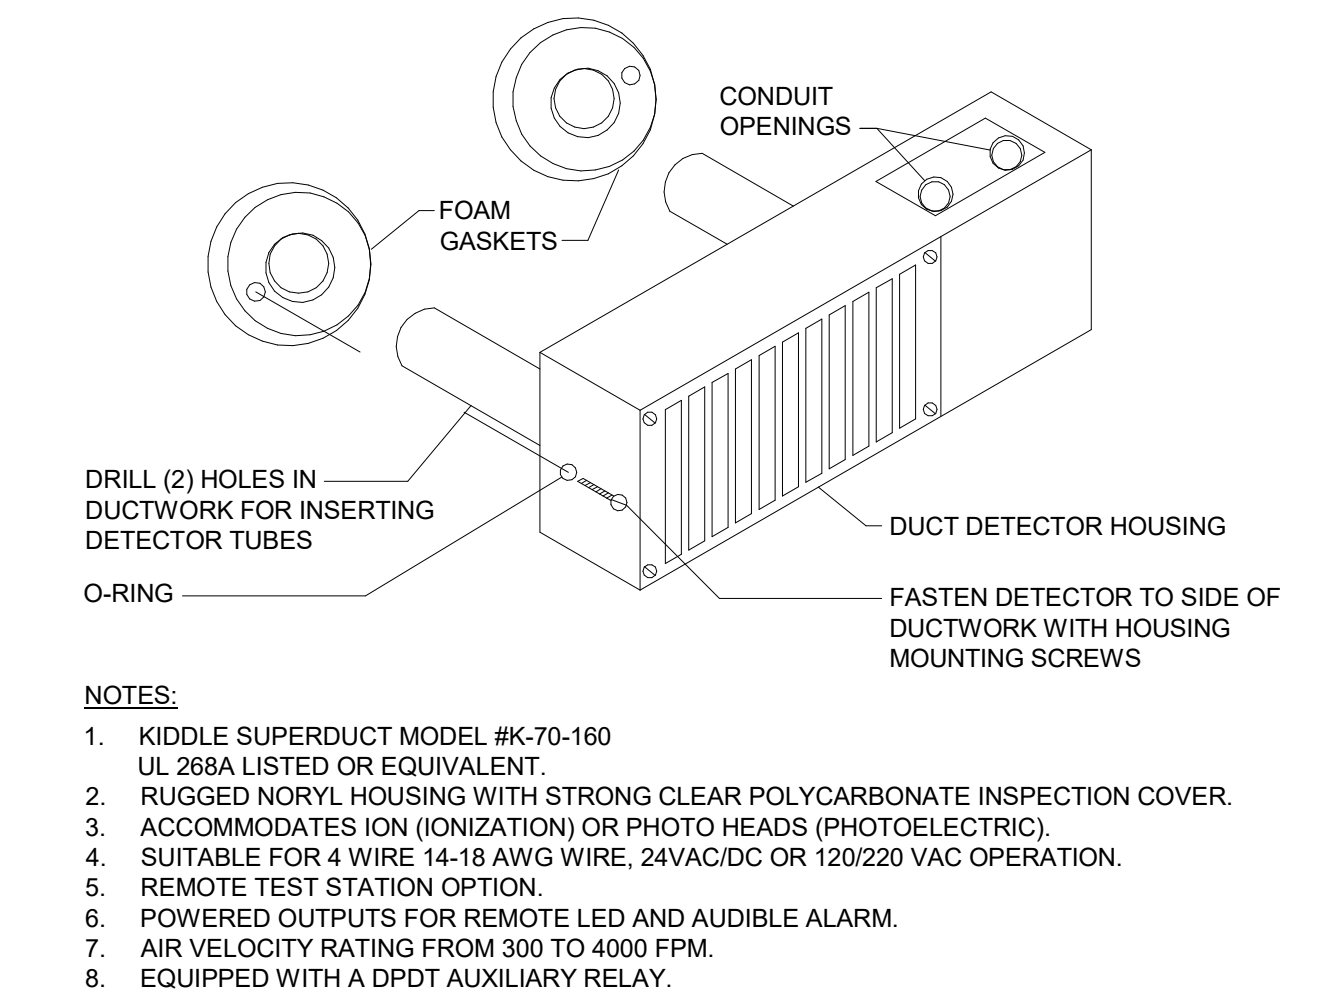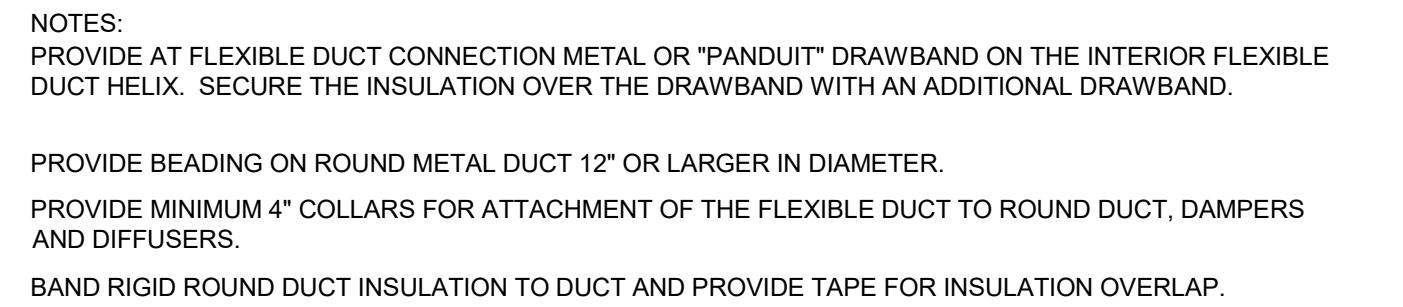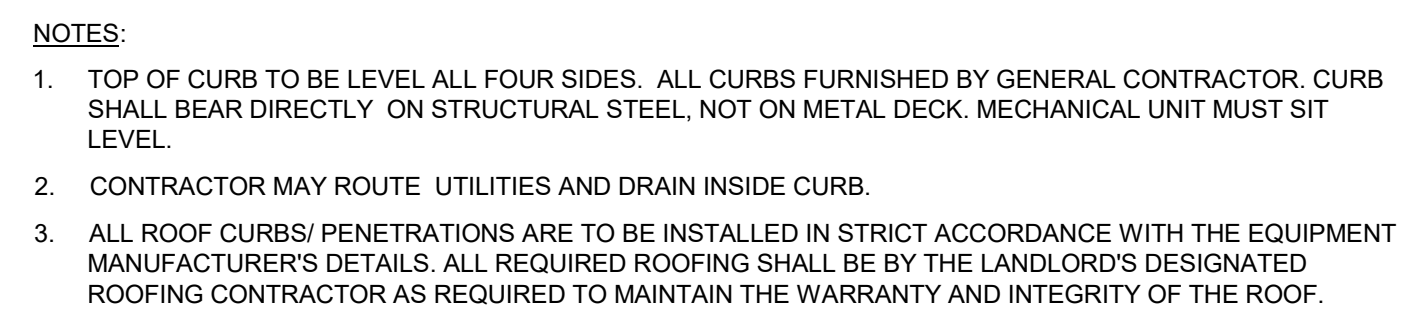

CONTRACTOR SHALL VERIFY ALL
CONDITIONS AND DIMENSIONS AT THE
JOB SITE AND NOTIFY THE ARCHITECT
OF ANY DIMENSIONAL ERRORS,
OMISSIONS OR DISCREPANCIES BEFORE
BEGINNING OR FABRICATING ANY WORK.
DO NOT SCALE DRAWINGS.

PROJECT INFORMATION	
PROJECT NO:	24-0087
ORIGINAL ISSUE:	09/06/2022
SCALE:	AS NOTED
DRAWN BY:	JB
CHECKED BY:	CL

SHEET TITLE

SHEET NUMBER

M104

4/10/2024 2:10:32 PM



COMcheck Software Version 4.1.5.5
Mechanical Compliance Certificate

Project Information

Energy Code: 2018 IECC
Project Title: Salad & Go
Location: Lees Summit, Missouri
Climate Zone: 4a
Project Type: New Construction

Construction Site:
610 NW Chipman Road
Lee's Summit, MO

Owner/Agent:

Designer/Contractor:
Gemini Engineering Group
101 Nightlinger Ln
Millsap, TX 76666
(817) 901-5191

Additional Efficiency Package(s)

Credits: 1.0 Required 1.0 Proposed
Reduced Lighting Power, 1.0 credit

Mechanical Systems List

Quantity	System Type & Description
1	HVAC System 1 (Single Zone): Single Package Heat Pump Heating Mode: Capacity = 34 kBtu/h, Proposed Efficiency = 8.30 HSPF, Required Efficiency = 8.00 HSPF Cooling Mode: Capacity = 52 kBtu/h, Proposed Efficiency = 16.20 SEER, Required Efficiency: 14.00 SEER Fan System: FAN SYSTEM 1 – Compliance (Motor nameplate HP method) : Passes Fans: FAN 1 Supply, Constant Volume, 1750 CFM, 1.4 motor nameplate hp, 0.0 fan efficiency grade
1	Water Heater 1: Electric Storage Water Heater, Capacity: 50 gallons w/ Circulation Pump Proposed Efficiency: 0.84 SL, %/h (if > 12 kW), Required Efficiency: 0.84 SL, %/h (if > 12 kW)

Mechanical Compliance Statement

Compliance Statement: The proposed mechanical design represented in this document is consistent with the building plans, specifications, and other calculations submitted with this permit application. The proposed mechanical systems have been designed to meet the 2018 IECC requirements in COMcheck Version 4.1.5.5 and to comply with any applicable mandatory requirements listed in the Inspection Checklist.

CLAYTON LUCAS, P.E.
Name - Title


Signature

04/10/2024
Date

Project Title: Salad & Go
Data filename: C:\Users\lboun\Gemini Engineering Group\Gemini Engineering Group - Documents\Projects\Retail, Commercial\Salad and Go\2024\24-001-05 Lee Summit, MO\Design\6_Energy\Salad&GO_Lee's Summit, MO_IECC 2018.cck

Report date: 04/09/24
Page 1 of 10

Section # & Req.ID	Plumbing Rough-In Inspection	Complies?	Comments/Assumptions
C404.5, C404.5.1, C404.5.2 [PL6] ²	Heated water supply piping conforms to pipe length and volume requirements. Refer to section details.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C404.5, C404.5.1, C404.5.2 [PL6] ²	Heated water supply piping conforms to pipe length and volume requirements. Refer to section details.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C404.6.1, C404.6.2 [PL3] ²	Automatic time switches installed to automatically switch off the recirculating hot-water system or heat trace.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C404.6.3 [PL7] ²	Pumps that circulate water between a heater and storage tank have controls that limit operation from startup to <= 5 minutes after end of heating cycle.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C404.6.3 [PL7] ²	Pumps that circulate water between a heater and storage tank have controls that limit operation from startup to <= 5 minutes after end of heating cycle.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C404.7 [PL8] ²	Demand recirculation water systems have controls that start the pump upon receiving a signal from the action of a user of a fixture or appliance and limits the temperature of the water entering the cold-water piping to 104°F.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C404.7 [PL8] ²	Demand recirculation water systems have controls that start the pump upon receiving a signal from the action of a user of a fixture or appliance and limits the temperature of the water entering the cold-water piping to 104°F.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.

Additional Comments/Assumptions:

1 High Impact (Tier 1) 2 Medium Impact (Tier 2) 3 Low Impact (Tier 3)

Project Title: Salad & Go
Data filename: C:\Users\lboun\Gemini Engineering Group\Gemini Engineering Group - Documents\Projects\Retail, Commercial\Salad and Go\2024\24-001-05 Lee Summit, MO\Design\6_Energy\Salad&GO_Lee's Summit, MO_IECC 2018.cck

Report date: 04/09/24
Page 4 of 10



COMcheck Software Version 4.1.5.5
Inspection Checklist

Energy Code: 2018 IECC

Requirements: 100.0% were addressed directly in the COMcheck software

Text in the "Comments/Assumptions" column is provided by the user in the COMcheck Requirements screen. For each requirement, the user certifies that a code requirement will be met and how that is documented, or that an exception is being claimed. Where compliance is itemized in a separate table, a reference to that table is provided.

Section # & Req.ID	Plan Review	Complies?	Comments/Assumptions
C103.2 [PR2] ¹	Plans, specifications, and/or calculations provide all information with which compliance can be determined for the mechanical systems and equipment and document where exceptions to the standard are claimed. Load calculations per acceptable engineering standards and handbooks.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C103.2 [PR3] ¹	Plans, specifications, and/or calculations provide all information with which compliance can be determined for the service water heating systems and equipment and document where exceptions to the standard are claimed. Hot water system sized per manufacturer's sizing guide.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C406 [PR9] ¹	Plans, specifications, and/or calculations provide all information with which compliance can be determined for the additional energy efficiency package options.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.

Additional Comments/Assumptions:

1 High Impact (Tier 1) 2 Medium Impact (Tier 2) 3 Low Impact (Tier 3)

Project Title: Salad & Go
Data filename: C:\Users\lboun\Gemini Engineering Group\Gemini Engineering Group - Documents\Projects\Retail, Commercial\Salad and Go\2024\24-001-05 Lee Summit, MO\Design\6_Energy\Salad&GO_Lee's Summit, MO_IECC 2018.cck

Report date: 04/09/24
Page 2 of 10

Section # & Req.ID	Mechanical Rough-In Inspection	Complies?	Comments/Assumptions
C402.2.6 [ME41] ²	Thermally ineffective panel surfaces of sensible heating panels have insulation >= R-3.5.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C403.8.4 [ME142] ²	Motors for fans that are not less than 1/12 hp and less than 1 hp are electronically commutated motors or have a minimum motor efficiency of 70 percent. These motors have the means to adjust motor speed.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C403.8.5 [ME143] ²	Each DX cooling system > 65 kBtu and chiller water/evaporative cooling system with fans > 1/4 hp are designed to vary the indoor fan airflow as a function of load and comply with detailed requirements of this section.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C403.12.1 [ME71] ²	Systems that heat outside the building envelope are radiant heat systems controlled by an occupancy sensing device or timer switch.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Exception: Requirement does not apply.
C403.2.3 [ME55] ²	HVAC equipment efficiency verified.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	See the Mechanical Systems list for values.
C403.2.2 [ME59] ²	Natural or mechanical ventilation is provided in accordance with International Mechanical Code Chapter 4. Mechanical ventilation has capability to reduce outdoor air supply to minimum per IMC Chapter 4.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C403.7.1 [ME59] ²	Demand control ventilation provided for spaces >500 ft2 and >25 people/1000 ft2 occupant density and served by systems with air side economizer, auto modulating outside air damper control, or design airflow >3,000 cfm.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C403.7.2 [ME115] ²	Enclosed parking garage ventilation has automatic contaminant detection and capacity to stage or modulate fans to 50% or less of design capacity.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C403.7.6 [ME141] ²	HVAC systems serving guestrooms in Group R-1 buildings with > 50 guestrooms: Each guestroom is provided with controls that automatically manage temperature setpoint and ventilation (see sections C403.7.6.1 and C403.7.6.2).	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Exception: Requirement does not apply.
C403.7.4 [ME57] ²	Exhaust air energy recovery on systems meeting Table C403.7.4(1) and C403.7.4(2).	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Exception: Requirement does not apply.
C403.7.5 [ME116] ²	Kitchen exhaust systems comply with replacement air and conditioned supply air limitations, and satisfy hood rating requirements and maximum exhaust rate criteria.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Exception: Requirement does not apply.

1 High Impact (Tier 1) 2 Medium Impact (Tier 2) 3 Low Impact (Tier 3)

Project Title: Salad & Go
Data filename: C:\Users\lboun\Gemini Engineering Group\Gemini Engineering Group - Documents\Projects\Retail, Commercial\Salad and Go\2024\24-001-05 Lee Summit, MO\Design\6_Energy\Salad&GO_Lee's Summit, MO_IECC 2018.cck

Report date: 04/09/24
Page 5 of 10

Section # & Req.ID	Footing / Foundation Inspection	Complies?	Comments/Assumptions
C403.12.2 [C403.12.3 [F09]] ²	Snow/ice melting system and freeze protection systems have sensors and controls configured to limit service for pavement temperature and outdoor temperature, future connection to controls.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Exception: Requirement does not apply.

Additional Comments/Assumptions:

1 High Impact (Tier 1) 2 Medium Impact (Tier 2) 3 Low Impact (Tier 3)

Project Title: Salad & Go
Data filename: C:\Users\lboun\Gemini Engineering Group\Gemini Engineering Group - Documents\Projects\Retail, Commercial\Salad and Go\2024\24-001-05 Lee Summit, MO\Design\6_Energy\Salad&GO_Lee's Summit, MO_IECC 2018.cck

Report date: 04/09/24
Page 3 of 10

Section # & Req.ID	Mechanical Rough-In Inspection	Complies?	Comments/Assumptions
C403.11.1 [C403.11.2 [ME60] ²	HVAC ducts and plenums insulated in accordance with C403.11.1 and constructed in accordance with C403.11.2, verification may need to occur during Foundation Inspection.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C403.4.3.2 [ME121] ²	Closed-circuit cooling tower within heat pump loop have either automatic bypass valve or lower leakage positive closure dampers. Open-circuit tower within heat pump loop have automatic valve to bypass all heat pump water flow around the tower. Open- or closed-circuit cooling towers used in conjunction with a separate heat exchanger have heat loss by shutting down the circulation pump on the cooling tower loop. Open- or closed circuit cooling towers have a separate heat exchanger to isolate the cooling tower from the heat pump loop, and heat loss is controlled by shutting down the circulation pump on the cooling tower loop.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C403.4.1 [ME63] ²	Heating for vestibules and air curtains with integral heating include automatic controls that shut off the heating system when outdoor air temperatures > 45F. Vestibule heating and cooling systems controlled by a thermostat in the vestibule with heating setpoint <= 60F and cooling setpoint >= 80F.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C408.2.2.1 [ME53] ²	Air outlets and zone terminal devices have means for air balancing.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C403.5, C403.5.1, C403.5.2 [ME123] ²	Refrigerated display cases, walk-in coolers or walk-in freezers served by remote compressors and remote condensers not located in a condensing unit, have fan-powered condensers that comply with Sections C403.5.1 and refrigeration compressor systems that comply with C403.5.2..	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.

Additional Comments/Assumptions:

1 High Impact (Tier 1) 2 Medium Impact (Tier 2) 3 Low Impact (Tier 3)

Project Title: Salad & Go
Data filename: C:\Users\lboun\Gemini Engineering Group\Gemini Engineering Group - Documents\Projects\Retail, Commercial\Salad and Go\2024\24-001-05 Lee Summit, MO\Design\6_Energy\Salad&GO_Lee's Summit, MO_IECC 2018.cck


Report date: 04/09/24
Page 6 of 10



610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3
PROTOTYPE VERSION V2-B



SEAL

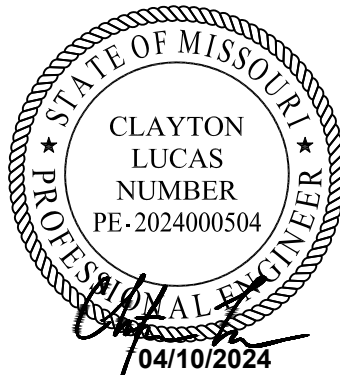

PERMIT SET 4.10.2024

CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DIMENSIONAL ERRORS. OMISSIONS OR DISCREPANCIES BEFORE BEGINNING OR FABRICATING ANY WORK. DO NOT SCALE DRAWINGS.

ISSUE DATE DESCRIPTION

ISSUE	DATE	DESCRIPTION

PROJECT INFORMATION

PROJECT NO: 24-0087
ORIGINAL ISSUE: 09/06/2022
SCALE: AS NOTED
DRAWN BY: JB
CHECKED BY: CL

SHEET TITLE

MECHANICAL
ENERGY FORMS

SHEET NUMBER

M106

Section # & Req ID	Rough-In Electrical Inspection	Complies?	Comments/Assumptions
C405.6 [EL26]?	Low-voltage dry-type distribution electric transformers meet the minimum efficiency requirements of Table C405.6.	<input type="checkbox"/> Complies <input checked="" type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C405.7 [EL27]?	Electric motors meet the minimum efficiency requirements of Tables C405.7(1) through C405.7(4). Efficiency verified through certification under an approved certification program or the equipment efficiency ratings shall be provided by motor manufacturer (where certification programs do not exist).	<input type="checkbox"/> Complies <input checked="" type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C405.8.2. C405.8.2. 1. [EL28]?	Escalators and moving walks comply with ASME A17.1/CSA B44 and have automatic controls configured to reduce speed to the minimum permitted speed in accordance with ASME A17.1/CSA B44 or applicable local code when not conveying passengers.	<input type="checkbox"/> Complies <input checked="" type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C405.9 [EL29]?	Total voltage drop across the combination of feeders and branch circuits <= 5%.	<input type="checkbox"/> Complies <input checked="" type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.

Additional Comments/Assumptions:

1	High Impact (Tier 1)	2	Medium Impact (Tier 2)	3	Low Impact (Tier 3)
---	----------------------	---	------------------------	---	---------------------

Project Title: Salad & Go
Data filename: C:\Users\jbout\Gemini Engineering Group\Gemini Engineering Group - Documents\Projects\Retail Commercial\Salad and Go\2024\24-001-05 Lee Summit, MO\Design\6_Energy\Salad&GO_Lee's Summit, MO_IECC 2018.cck

Section # & Req. ID	Final Inspection	Complies?	Comments/Assumptions
C303.3 C408.2.5.3 [F18]†	Furnished OEM manuals for HVAC systems within 90 days of system acceptance.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C403.2.2 [F127]†	HVAC systems and equipment capacity does not exceed calculated loads.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C403.2.4.1 [F147]†	Heating and cooling to each zone is controlled by a thermostat control. Minimum one humidity control device per installed humidification/dehumidification system.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C403.2.4.1.1 [F142]†	Heat pump controls prevent supplemental electric resistance heat from coming on when not needed.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C403.4.1.2 [F138]†	Thermostatic controls have a 5 °F deadband.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C403.2.4.1.3 [F120]†	Temperature controls have setpoint overlap restrictions.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C403.2.4.2 [F129]†	Each zone equipped with setback controls using automatic time clock or programmable control system.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C403.2.4.2.1, C403.2.4.2.2 [F140]†	Automatic Controls: Setback to 55°F (heat) and 85°F (cool); 7-day clock, 2-hour occupant override, 10-hour backup	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C403.2.4.2.3 [F141]†	Systems include optimum start controls.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C404.3 [F111]†	Heat traps installed on supply and discharge piping of non-circulating systems.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C404.4 [F125]†	All piping insulated in accordance with section details and Table C403.11.3.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C404.6.1 [F112]†	Controls are installed that limit the operation of a recirculation pump installed to maintain temperature of a storage tank. System return pipe is a dedicated return pipe or a cold water supply pipe.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.

1	High Impact (Tier 1)	2	Medium Impact (Tier 2)	3	Low Impact (Tier 3)
---	----------------------	---	------------------------	---	---------------------

Project Title: Salad & Go Report date: 04/09/24
Data filename: C:\Users\jbour\Gemini Engineering Group\Gemini Engineering Group - Documents\Projects\Retail_Commercial\Salad and Go\2024\24-001-05 Lee Summit, MO\Design\6_Energy\Salad&GO_Lee's Summit, MO_IECC 2018.cck Page 8 of 10

Section # & Req.ID	Final Inspection	Complies?	Comments/Assumptions
C408.1.1 [F157]†	Building operations and maintenance documents will be provided to the owner. Documents will cover manufacturers' information, specifications, programming procedures and means of illustrating to owner how building, equipment and systems are intended to be installed, maintained, and operated.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C408.2.1 [F128]†	Commissioning plan developed by registered design professional or approved agency.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C408.2.3.1 [F131]†	HVAC equipment has been tested to ensure proper operation.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C408.2.3.2 [F110]†	HVAC control systems have been tested to ensure proper operation, calibration and adjustment of controls.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C408.2.4 [F129]†	Preliminary commissioning report completed and certified by registered design professional or approved agency.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C408.2.5.1 [F17]†	Furnished HVAC as-built drawings submitted within 90 days of system acceptance.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C408.2.5.3 [F143]†	An air and/or hydronic system balancing report is provided for HVAC systems.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C408.2.5.4 [F120]†	Final commissioning report due to building owner within 90 days of receipt of certificate of occupancy.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.

Additional Comments/Assumptions:

1	High Impact (Tier 1)	2	Medium Impact (Tier 2)	3	Low Impact (Tier 3)
---	----------------------	---	------------------------	---	---------------------

Project Title: Salad & Go Report date: 04/09/24
Data filename: C:\Users\jbour\Gemini Engineering Group\Gemini Engineering Group - Documents\Projects\Retail Commercial\Salad and Go\2024\24-001-05 Lee Summit, MO\Design\6_Energy\Salad&GO_Lee's Summit, MO_IECC 2018.cck Page 9 of 10




610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3
PROTOTYPE VERSION V2-B

PROTOTYPE VERSION V2-B



SEAL

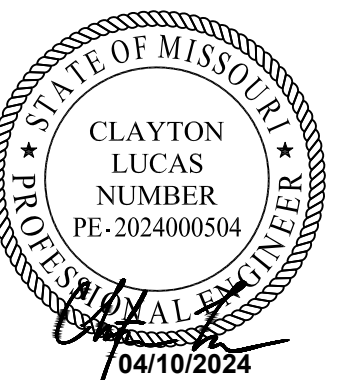

PERMIT SET 4.10.2024

CONTRACTOR SHALL VERIFY ALL
CONDITIONS AND DIMENSIONS AT THE
JOB SITE AND NOTIFY THE ARCHITECT
OF ANY DIMENSIONAL ERRORS,
OMISSIONS OR DISCREPANCIES BEFORE
BEGINNING OR FABRICATING ANY WORK.
DO NOT SCALE DRAWINGS.

[illegible]

PROJECT INFORMATION

PROJECT NO:	24-0087
ORIGINAL ISSUE:	09/06/2022
SCALE:	AS NOTED
DRAWN BY:	JB
CHECKED BY:	CL

SHEET TITLE

MECHANICAL ENERGY FORMS

SHEET NUMBER

M107

NON-STRUCTURAL ELECTRICAL COMPONENT NOTES	
A.	THE FOLLOWING ITEMS ARE TAKEN DIRECTLY FROM THE 2018 INTERNATIONAL BUILDING CODE AND FROM THE AMERICAN SOCIETY OF CIVIL ENGINEERS (ASCE) STANDARD 7. THE CONTRACTOR SHALL REFER TO THE ABOVE FOR ADDITIONAL INFORMATION, EXCEPTIONS, AND FURTHER DESCRIPTIONS. THE CONTRACTOR SHALL ADHERE TO REQUIREMENTS AND AS SUCH, SHALL BE INCLUDED WITHIN BID. ALSO REFER TO SPECIFICATIONS.
B.	2018 IBC, 1613.1, SCOPE: ARCHITECTURAL, MECHANICAL, ELECTRICAL, AND NON-STRUCTURAL COMPONENTS THAT ARE PERMANENTLY ATTACHED TO STRUCTURES AND THEIR SUPPORTS AND ATTACHMENTS SHALL BE DESIGNED AND CONSTRUCTED TO RESIST THE EFFECTS OF EARTHQUAKE MOTIONS IN ACCORDANCE WITH ASCE 7, EXCLUDING CHAPTER 14 AND APPENDIX 11A.
C.	ASCE 7-02, 11A.1.2, CONTRACTOR RESPONSIBILITY: THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE CONSTRUCTION OF A SEISMIC-FORCE-RESISTING SYSTEM, DESIGNATED SEISMIC SYSTEM, OR COMPONENT LISTED IN THE QUALITY ASSURANCE PLAN. SHALL SUBMIT A WRITTEN CONTRACTOR'S STATEMENT OF RESPONSIBILITY TO THE AUTHORITY HAVING JURISDICTION AND TO THE OWNER PRIOR TO THE COMMENCEMENT OF WORK ON THE SYSTEM OR COMPONENT. THE a. CONTRACTOR'S STATEMENT OF RESPONSIBILITY SHALL INCLUDE THE FOLLOWING: b. ACKNOWLEDGMENT OF AWARENESS OF THE SPECIAL REQUIREMENTS CONTAINED IN THE QUALITY ASSURANCE PLAN; c. ACKNOWLEDGMENT THAT CONTROL WILL BE EXERCISED TO OBTAIN CONFORMANCE WITH THE CONSTRUCTION DOCUMENTS APPROVED BY THE AUTHORITY HAVING JURISDICTION; d. PROCEDURES FOR EXERCISING CONTROL WITHIN THE CONTRACTOR'S ORGANIZATION, THE METHOD AND FREQUENCY OF REPORTING AND THE DISTRIBUTION OF THE REPORTS; AND e. IDENTIFICATION AND QUALIFICATIONS OF THE PERSON(S) EXERCISING SUCH CONTROL AND THEIR POSITION(S) IN THE ORGANIZATION.
D.	DIVISION 16 RESPONSIBILITIES: a. HANGERS AND SEISMIC BRACING FOR ELECTRICAL SYSTEMS SHALL BE DESIGNED AND SPECIFIED BY DIVISION 16. DIVISION 16 SHALL REFER TO THE ELECTRICAL DRAWINGS FOR LOCATIONS OF EQUIPMENT AND ELECTRICAL SYSTEMS AS STRUCTURAL DRAWINGS DO NOT SHOW THE LOCATIONS OF ELECTRICAL EQUIPMENT, RACEWAYS, AND OTHER COMPONENTS. b. DIVISION 16 SHALL COORDINATE THE SUPPORT SYSTEMS AND DESIGN LOADS FOR HUNG RACEWAYS AND OTHER ELECTRICAL SYSTEMS (INCLUDING COMBINED MULTIPLE RACEWAY RUNS) WITH THE GENERAL CONTRACTOR AND THE STEEL AND WOOD JOIST MANUFACTURERS IN ADDITION TO OTHER TRADES THAT MAY BE IMPACTED.

ENERGY CODE NOTES	
A.	RECORD DRAWINGS: SUBMIT TO THE BUILDING OWNER PER ENERGY CODE ENFORCED BY THE LOCAL AHJ.
B.	OPERATION AND MAINTENANCE MANUALS: SUBMIT TO THE BUILDING OWNER PER ENERGY CODE ENFORCED BY THE LOCAL AHJ.
C.	THIS BUILDING AND ITS ENERGY SYSTEMS HAVE BEEN DESIGNED TO COMPLY WITH ENERGY CODE ENFORCED BY THE LOCAL AHJ. CONTRACTOR IS RESPONSIBLE FOR CORRECT INSTALLATION OF ENERGY CONSERVATION MEASURES.
D.	LIGHTING CONTROL SYSTEMS COMMISSIONING AND COMPLETION REQUIREMENTS: TEST SYSTEMS TO ENSURE THAT BUILDING SYSTEMS HAVE BEEN INSTALLED AND FUNCTION PROPERLY AND EFFICIENTLY, AND CAN BE MAINTAINED IN ACCORDANCE WITH THE CONTRACT DOCUMENTS AND OPERATIONAL REQUIREMENTS PER ENERGY CODE ENFORCED BY THE AHJ. REFER TO SPECIFICATIONS FOR ADDITIONAL COMMISSIONING REQUIREMENTS.

GENERAL NOTES	
A.	PERFORM WORK IN ACCORDANCE WITH APPLICABLE NATIONAL AND STATE CODES AS AMENDED LOCALLY AND ENFORCED BY THE AHJ.
B.	OBTAIN AND PAY FOR PERMITS REQUIRED FOR INSTALLATION OF WORK. ARRANGE AND SCHEDULE REQUIRED INSPECTIONS.
C.	DRAWINGS ARE DIAGRAMMATIC IN NATURE. PROVIDE COMPONENTS AS REQUIRED FOR A COMPLETE OPERATIONAL SYSTEM WHETHER OR NOT SPECIFICALLY SHOWN ON THE DRAWINGS.
D.	DEVICE LOCATIONS ARE APPROXIMATE. COORDINATE DEVICE LOCATIONS AND ELEVATIONS WITH APPROPRIATE DOCUMENTS INCLUDING CASEWORK SHOP DRAWINGS AND ARCHITECT'S INTERIOR ELEVATIONS PRIOR TO ROUGH-IN.
E.	COORDINATE ELECTRICAL WORK WITH THAT OF OTHER TRADES. REFER TO MECHANICAL, ARCHITECTURAL, STRUCTURAL, CIVIL, AND LANDSCAPE DRAWINGS AND SPECIFICATIONS. COORDINATION SHALL OCCUR PRIOR TO FABRICATION, PURCHASE, AND INSTALLATION OF WORK.
F.	COORDINATE LOCATION OF LIGHT FIXTURES AND CEILING-MOUNTED DEVICES WITH ARCHITECTURAL REFLECTED CEILING PLANS AND ELEVATIONS.
G.	PROVIDE RATED ENCLOSURES AROUND ALL LIGHT FIXTURES PENETRATING RATED CEILINGS. COORDINATE WITH ARCHITECTURAL.
H.	REFER TO ARCHITECTURAL AND STRUCTURAL DRAWINGS FOR LOCATIONS OF EXPANSION/SEISMIC JOINTS. PROVIDE RACEWAY EXPANSION/SEISMIC JOINTS FOR RACEWAYS CROSSING BUILDING EXPANSION/SEISMIC JOINTS.
I.	DEMOLISH EXISTING SYSTEMS AS INDICATED ON PLANS OR AS REQUIRED FOR INSTALLATION OF NEW WORK. MATERIAL SHALL BE REMOVED FROM SITE AND LEGALLY DISPOSED OF OFF SITE UNLESS OTHERWISE DIRECTED. RETURN ITEMS TO OWNER IN EXISTING CONDITION WHEN DIRECTED BY OWNER.
J.	COMPLETION OF WORK SHALL BE EXECUTED IN ACCORDANCE WITH THE PROJECT SCHEDULE. SCHEDULE INSTALLATION WITH OTHER TRADES TO ENSURE PROJECT MILESTONES ARE MET.
K.	THE ELECTRICAL DRAWINGS ARE DIAGRAMMATIC AND DO NOT NECESSARILY SHOW EVERY RACEWAY, BOX, CONDUCTOR, OR SIMILAR ITEMS FOR A COMPLETE INSTALLATION. PROVIDE ITEMS NECESSARY FOR COMPLETE AND OPERATIONAL ELECTRICAL SYSTEM.
L.	BRANCH CIRCUIT HOMERUNS ARE SHOWN TO INDICATE CIRCUIT PROPERTIES AND CONFIGURATION. SINGLE-CIRCUIT HOMERUNS SERVED FROM THE SAME PANELBOARD MAY BE COMBINED IN ACCORDANCE WITH THE DIVISION SPECIFICATIONS, UNLESS INDICATED OTHERWISE. EXTEND AND CONNECT BRANCH CIRCUIT RACEWAY AND WIRING FROM HOMERUN TO DEVICES AND EQUIPMENT WITH CIRCUIT NUMBERS INDICATED. CONDUCTOR QUANTITIES AND SIZES ARE INDICATED AT HOMERUNS ONLY. SHOW ACTUAL RACEWAY ROUTING AND CIRCUITING ON RECORD DRAWINGS. MINIMUM CONDUCTOR SIZE #12 AWG.
M.	LIGHT FIXTURES MOUNTED IN CONTINUOUS ROWS SHALL BE THROUGH-WIRED VIA FIXTURE INTERNAL WIREWAYS. CIRCUITS AS INDICATED ON DRAWINGS. FIXTURES NOT LISTED FOR THROUGH WIRING SHALL BE WIRED VIA SEPARATE RACEWAY AND WIRING SYSTEM EXTERNAL TO THE FIXTURES. PROVIDE RACEWAYS, WIRING AND CONNECTIONS FOR A COMPLETE AND OPERATIONAL SYSTEM.
N.	PROVIDE BIDDER DESIGN FIRE ALARM SYSTEM MODIFICATIONS AS REQUIRED BY CODES ASSOCIATED WITH THE TENANT IMPROVEMENTS. REFER TO DIVISION 28 SPECIFICATIONS. DEVICES SHOWN ON DRAWINGS ARE FOR COORDINATION PURPOSES ONLY. PROVIDE ADDITIONAL DETECTION, NOTIFICATION AND SUPERVISORY DEVICES AS REQUIRED BY CODES.

LIGHTING CONTROLS SYMBOL LEGEND	
SYMBOL*	DESCRIPTION
	SINGLE POLE SWITCH
	SWITCH - 'X' INDICATES TYPE: 3 3-WAY 4 4-WAY D DIMMER T TIMER M MOTOR RATED MC MOMENTARY CONTACT OC OCCUPANCY SENSOR G GAS SHUT-OFF P PILOT-LIGHTED EPO EMERGENCY POWER OFF
	SWITCHING CIRCUIT 'a', 'b', etc. REFER TO LIGHTING FIXTURES ON PLANS.
	OCCUPANCY SENSOR, CEILING MOUNTED
	VACANCY SENSOR, CEILING MOUNTED
	OCCUPANCY SENSOR, WALL MOUNTED
	DAYLIGHT SENSOR, CEILING MOUNTED
* NOTES: 1. NOT ALL SYMBOLS MAY BE USED. 2. REFER TO ARCHITECTURAL DRAWINGS FOR MOUNTING HEIGHT AND LOCATION. 3. REFER TO SPECIFICATIONS FOR MORE INFORMATION.	


ELECTRICAL SYMBOLS	
SYMBOL*	DESCRIPTION
	REFER TO 'ELECTRICAL NOTES BY SYMBOL'
	REFER TO DETAIL/VIEW '1' ON SHEET 'E201'
	CONNECT TO EXISTING
	HOMERUN TO PANELBOARD '1-P1' CIRCUITS 1 & 3
	RECEPTACLE/DUPLEX, +18" AFF (OR AS INDICATED)
	RECEPTACLE, QUAD, +18" AFF (OR AS INDICATED)
	220V RECEPTACLE +18" AFF (OR AS INDICATED)
	RECEPTACLE FOR SPECIAL EQUIPMENT
GFI	GROUND FAULT INTERRUPT PROTECTED DEVICE
WP	WEATHERPROOF DEVICE
	FLOOR MOUNTED RECEPTACLE
	LOCATION OF FLOOR MOUNTED RECEPTACLE. COORDINATE DATA REQUIREMENTS WITH TECHNOLOGY DRAWINGS. REFER TO SPECIFICATIONS.
	JUNCTION BOX, 4" X 4" MINIMUM. WITH SINGLE GANG PLASTER RING & 1" CONDUIT(S) TURNED HORIZ. TO ABOVE CLG. WITH PROTECTIVE BUSHING AND PULL TAPE
	MICROPHONE OUTLET @ 18" AFF.
	DEVICE CLUSTER, FLAT SCREEN
	DEVICE CLUSTER, MEDIA CENTER
	AIR SENSOR REFER TO MECHANICAL PLANS AND/OR ARCHITECTURAL PLANS FOR TYPE, MOUNTING LOCATION AND ANY ADDITIONAL REQUIREMENTS.
	DOORBELL PUSH BUTTON REFER TO CONSULTANT PLANS AND/OR ARCHITECTURAL PLANS FOR TYPE, MOUNTING LOCATION AND ANY ADDITIONAL REQUIREMENTS.
	DOORBELL CONTACT/TRANSFORMER REFER TO CONSULTANT PLANS AND/OR ARCHITECTURAL PLANS FOR TYPE, MOUNTING LOCATION AND ANY ADDITIONAL REQUIREMENTS.
	EXHAUST FAN, CEILING MOUNTED
	EXHAUST FAN, INLINE / ABOVE CEILING
	EXHAUST FAN, ROOFTOP
	MECHANICAL EQUIPMENT (REFER TO MECHANICAL SCHEDULE FOR MORE INFORMATION).
	NON-FUSED DISCONNECT NEMA 1 (UNO). FOR AMP RATING, VOLTAGE AND PHASE REFER TO PLANS.
* NOT ALL SYMBOLS MAY BE USED.	

AUXILIARY SYSTEM SYMBOLS	
	FIRE ALARM CONTROL PANEL, COORDINATE EXACT LOCATION WITH LOCAL FIRE AUTHORITY.
	FIRE ALARM REMOTE ANNUNCIATOR, COORDINATE EXACT LOCATION WITH LOCAL FIRE AUTHORITY.

FIRE ALARM SYSTEM NOTES	
A.	COORDINATE FINAL LOCATION OF ALL DEVICES WITH LIGHT AND HVAC SYSTEM DEVICES.
B.	MAINTAIN CLEARANCES FROM ALL AIR MOVING DEVICES PER NFPA AND MANUFACTURER REQUIREMENTS.
C.	CENTER DEVICES BETWEEN CEILING ELEMENTS AND CEILING AREAS.
D.	EXACT LOCATION OF FIRE ALARM REMOTE ANNUNCIATOR TO BE APPROVED BY THE LOCAL FIRE MARSHALL.
E.	ALL DEVICES TO BE INSTALLED PER ALL APPLICABLE CODES.



610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3
PROTOTYPE VERSION V2-B

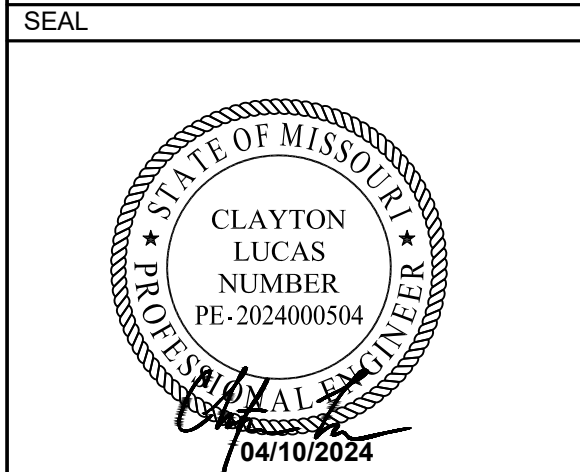

PERMIT SET 4.10.2024

CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DIMENSIONAL ERRORS. OMISSIONS OR DISCREPANCIES BEFORE BEGINNING OR FABRICATING ANY WORK. DO NOT SCALE DRAWINGS.

ISSUE	DATE	DESCRIPTION

PROJECT INFORMATION	
PROJECT NO:	24-0087
ORIGINAL ISSUE:	10/06/2023
SCALE:	AS NOTED
DRAWN BY:	JB
CHECKED BY:	CL

SHEET TITLE

ELECTRICAL LEGEND AND NOTES

SHEET NUMBER

E101

- A. FINAL CONNECTION TO ALL HARD-WIRED EQUIPMENT SHALL BE MADE WITH "SEAL-TITE" FLEXIBLE CONDUIT.
- B. THE ELECTRICAL CONTRACTOR SHALL MAKE FINAL ELECTRICAL CONNECTIONS TO ALL RELATED EQUIPMENT.
- C. "CALL OUT" INDICATES EQUIPMENT IDENTIFICATION NUMBER. REFER TO EQUIPMENT SCHEDULE. COORDINATE WITH EQUIPMENT SCHEDULE FOR ADDITIONAL INFORMATION.
- D. THE ELECTRICAL CONTRACTOR SHALL VERIFY ROUGH-IN REQUIREMENTS, LOCATIONS, MOUNTING HEIGHTS, VOLTAGE, PHASE, AMPS, HP, KW, ETC. FOR ALL EQUIPMENT PRIOR TO ROUGH-IN.
- E. PROVIDE SEAL-OFFS FOR ALL CONDUITS ENTERING OR LEAVING WALK-IN BOXES.
- F. ALL CIRCUIT BREAKERS PROVIDED WITH SHUNT TRIPPING DEVICES SHALL HAVE THE CONTROL CIRCUIT ROUTED THROUGH DRY CONTACTS PROVIDED IN THE FIRE PROTECTION SYSTEM. UPON ACTIVATION OF FIRE PROTECTION SYSTEM THOSE CIRCUIT BREAKERS SHALL BE AUTOMATICALLY TRIPPED.
- G. ALL CIRCUITS SHALL HAVE AN INSULATED GROUND WIRE (BOND) SIZED PER 2020 NEC 250.122, #12 MINIMUM GROUND, WIRE NOT SHOWN ON DRAWINGS.
- H. THE ELECTRICAL CONTRACTOR SHALL FURNISH AND INSTALL DISCONNECT SWITCHES, CONDUIT, WIRE AND INSTALL UNDER SUPERVISION OF THE EQUIPMENT SUPPLIER.
- I. THE ELECTRICAL CONTRACTOR SHALL VERIFY PLUG CONFIGURATIONS FOR APPLICABLE EQUIPMENT WITH SUPPLIER PRIOR TO ROUGH-IN.
- J. PROVIDE GFCI PROTECTION FOR ALL EQUIPMENT/KITCHEN RECEPTACLES PER 2017 NEC 210.8 (B)(2).


- A. VERIFY ALL MECHANICAL UNIT LOCATIONS WITH MECHANICAL PLANS.
- B. THE ELECTRICAL CONTRACTOR SHALL NOT MOUNT DISCONNECT EQUIPMENT DIRECTLY TO MECHANICAL UNITS FOR DISCONNECTS 200A AND LARGER. THE ELECTRICAL CONTRACTOR SHALL PROVIDE A SELF-SUPPORTING SYSTEM FOR DISCONNECT EQUIPMENT.
- C. PROVIDE WEATHERPROOF, HEAVY DUTY, NEMA 3R FUSIBLE DISCONNECT SWITCHES FOR ALL MECHANICAL UNITS LOCATED OUTSIDE.
- D. ALL EXTERIOR RECEPTACLES SHALL BE WEATHER RESISTANT GFCI (PASS & SEYMOUR 209SDSWRBK OR EQUAL), INSTALLED IN A WEATHERPROOF ENCLOSURE WITH A WHILE IN USE COVERPLATE (PASS & SEYMOUR #WUC10DCL OR EQUAL).
- E. EXHAUST FANS MOUNTED OUTSIDE SHALL HAVE A WEATHERPROOF DISCONNECT MOUNTED EXTERIOR TO THE UNIT. INTERNAL DISCONNECT SWITCHES SHALL NOT BE ALLOWED.

TAG #	DESCRIPTION	VOLTAGE	LOAD	BREAKER SIZE	WIRE SIZE	MOUNTING HEIGHT	NOTES
K7	NITRO WARMER	120 V	12 A	20	3/4"C, 2#12.#12G	42"	
K8	SOUP WARMER	120 V	10 A	20	3/4"C, 2#12.#12G	42"	
K9	UNDER COUNTER ICE MAKER	120 V	12 A	20	3/4"C, 2#12.#12G	18"	
K10	ICE MAKER	120 V	11 A	20	3/4"C, 2#12.#12G	18"	
K11	PANINI PRESS	120 V	15 A	20	3/4"C, 2#12.#12G	REFER TO PLANS	
K12	LEMONADE DISPENSER	120 V	9 A	20	3/4"C, 2#12.#12G	42"	
K13	DAIRY DISPENSER	120 V	1 A	20	3/4"C, 2#12.#12G	42"	
K14	BEVERAGE COOLER	120 V	5 A	20	3/4"C, 2#12.#12G	18"	
K17	FOOD PREP TABLE	120 V	7 A	20	3/4"C, 2#12.#12G	REFER TO PLANS	
K19	MICROWAVE	208 V	27 A	30	3/4"C, 3#10.#10G	42"	
K21	WALK-IN COOLER	208 V	11 A	20	3/4"C, 2#12.#12G	REFER TO PLANS	PROVIDE 30A/2P NEMA-3R DISCONNECT
K26	42" MARS AIR CURTAIN	120 V	2 A	20	3/4"C, 2#12.#12G	96"	
K29	ICE TEA BREWER	120 V	14 A	20	3/4"C, 2#12.#12G	42"	
K30	FROZEN BEV DISPENSER	208 V	29 A	30	3/4"C, 3#10.#10G	42"	
K31	REACH-IN COOLER	120 V	3 A	20	3/4"C, 2#12.#12G	18"	SIMPLEX RECEPTACLE
K35	WALL FAN	120 V	2 A	20	3/4"C, 2#12.#12G	92"	
K36	WATER FILTER	120 V	16 A	20	3/4"C, 2#12.#12G	84"	PROVIDE 2 WATER LOOPS FOR FILTERED WATER AND SOFTWATER
K39	SECURITY VCR	120 V	3 A	20	3/4"C, 2#12.#12G	18"	
K40	MUSIC SYSTEM	120 V	3 A	20	3/4"C, 2#12.#12G	18"	
K41	DRIVE THRU DETECTOR	120 V	2 A	20	3/4"C, 2#12.#12G	18"	
K44	DRIVE THRU WINDOW AND SERVING SHELF	120 V	5 A	20	3/4"C, 2#12.#12G	42"	
K45	BREWER SERVER SOFT HEAT	120 V	3 A	20	3/4"C, 2#12.#12G	42"	
K47	WATER SOFTNER	120 V	16 A	20	3/4"C, 2#12.#12G	18"	PROVIDE POWER FOR FUTURE WATER SOFTNER COORDINATE EXACT LOCATION WITH OWNER, ARCHITECT PRIOR TO INSTALLATION

- A. ALL EXTERIOR DISCONNECTS SHALL BE WP TYPE.
- B. ALL RECEPTACLES WITHIN 6'-0" OF A SINK TO BE GFCI RATED.
- C. REFER TO MECHANICAL AND PLUMBING PLANS FOR EXACT SIZE, LOCATION, AND ELECTRICAL REQUIREMENTS FOR ALL MECHANICAL AND PLUMBING EQUIPMENT.
- D. ELECTRICAL CONTRACTOR SHALL FIELD VERIFY ALL CONNECTION REQUIREMENTS (HP, AMPS, VOLTAGE, PHASE, MOUNTING HEIGHT, AND DISCONNECTING MEANS) FOR ALL EQUIPMENT SUPPLIED BY OTHERS BEFORE ROUGH-IN. DISCONNECT SWITCHES SHALL BE LOCATED WITH NEC CODE CLEARANCE OR PROVIDE LOCKOUT TYPE C/B.
- E. ELECTRICAL CONTRACTOR RESPONSIBLE FOR COORDINATING EXACT LOCATION, QUANTITIES, AND INSTALLATION REQUIREMENTS OF ELECTRICAL EQUIPMENT IN MILL WORK.
- F. ALL EXTERIOR RECEPTACLES SHALL BE WP/GFCI TYPE.
- G. ALL ELECTRICAL PANEL BOARDS SHALL MAINTAIN 3'-0" INFRONT WORKING CLEARANCE. REFER TO ONE-LINE FOR DETAILS.
- H. ELECTRICAL CONTRACTOR SHALL PROVIDE #6 COPPER GROUND TO ANY NEW METAL GAS PIPE SYSTEMS PER NEC 250.
- I. CONDUIT AND WIRING SHOWN FOR REFERENCE ONLY. IT IS THE RESPONSIBILITY OF THE ELECTRICAL CONTRACTOR TO PROVIDE THE NUMBER OF CONDUCTORS REQUIRED FOR HOT-LEGS, NEUTRAL, AND GROUNDING AT EACH DEVICE FOR PROPER BRANCH CIRCUITING SHOWN FOR EACH AREA OR ROOM.

- 1 PROVIDE DOORBELL SYSTEM (AVANTEK LD-DB-21-A) WITH LOW VOLTAGE TRANSFORMER AND INTERIOR BELL.
- 2 2 WALL FANS TO BE CONTROLLED BY A SINGLE SWITCH AT THE ENTRY DOOR.
- 3 PROVIDE GFCI POWER FOR FIRE BELL. COORDINATE EXACT LOCATION WITH OWNER AND ARCHITECT PRIOR TO INSTALLATION.
- 4 PROVIDE POWER DROP FOR POS STATION AND MONITORS COORDINATE OUTLET LOCATIONS & CONDUIT ROUTING WITH SHELFING PRIOR TO INSTALLATION.
- 5 RUN MC CABLE THROUGH CHASE AND UNDER WINDOW FOR RECEPTACLES BETWEEN COLUMNS.

Mark	Count	Panel	DISC	W. P.	WALL	ABV. CEILING	ROOF
CU-1	1	C	2P/30/20AF	•			•
RTU-1	1	A	3P/60A	•			•



2	POWER FLOOR PLAN - ISLAND DETAIL
E102	1/2" = 1'-0"

1	POWER FLOOR PLAN
E102	1/4" = 1'-0"



CONTRACTOR SHALL VERIFY ALL
CONDITIONS AND DIMENSIONS AT THE
JOB SITE AND NOTIFY THE ARCHITECT
OF ANY DIMENSIONAL ERRORS,
OMISSIONS OR DISCREPANCIES BEFORE
BEGINNING OR FABRICATING ANY WORK.
DO NOT SCALE DRAWINGS.

[illegible]




PROJECT NO:	24-0087
ORIGINAL ISSUE:	09/06/2022
SCALE:	AS NOTED
DRAWN BY:	JB
CHECKED BY:	CL

SHEET TITLE

POWER FLOOR PLAN

SHEET NUMBER

E102

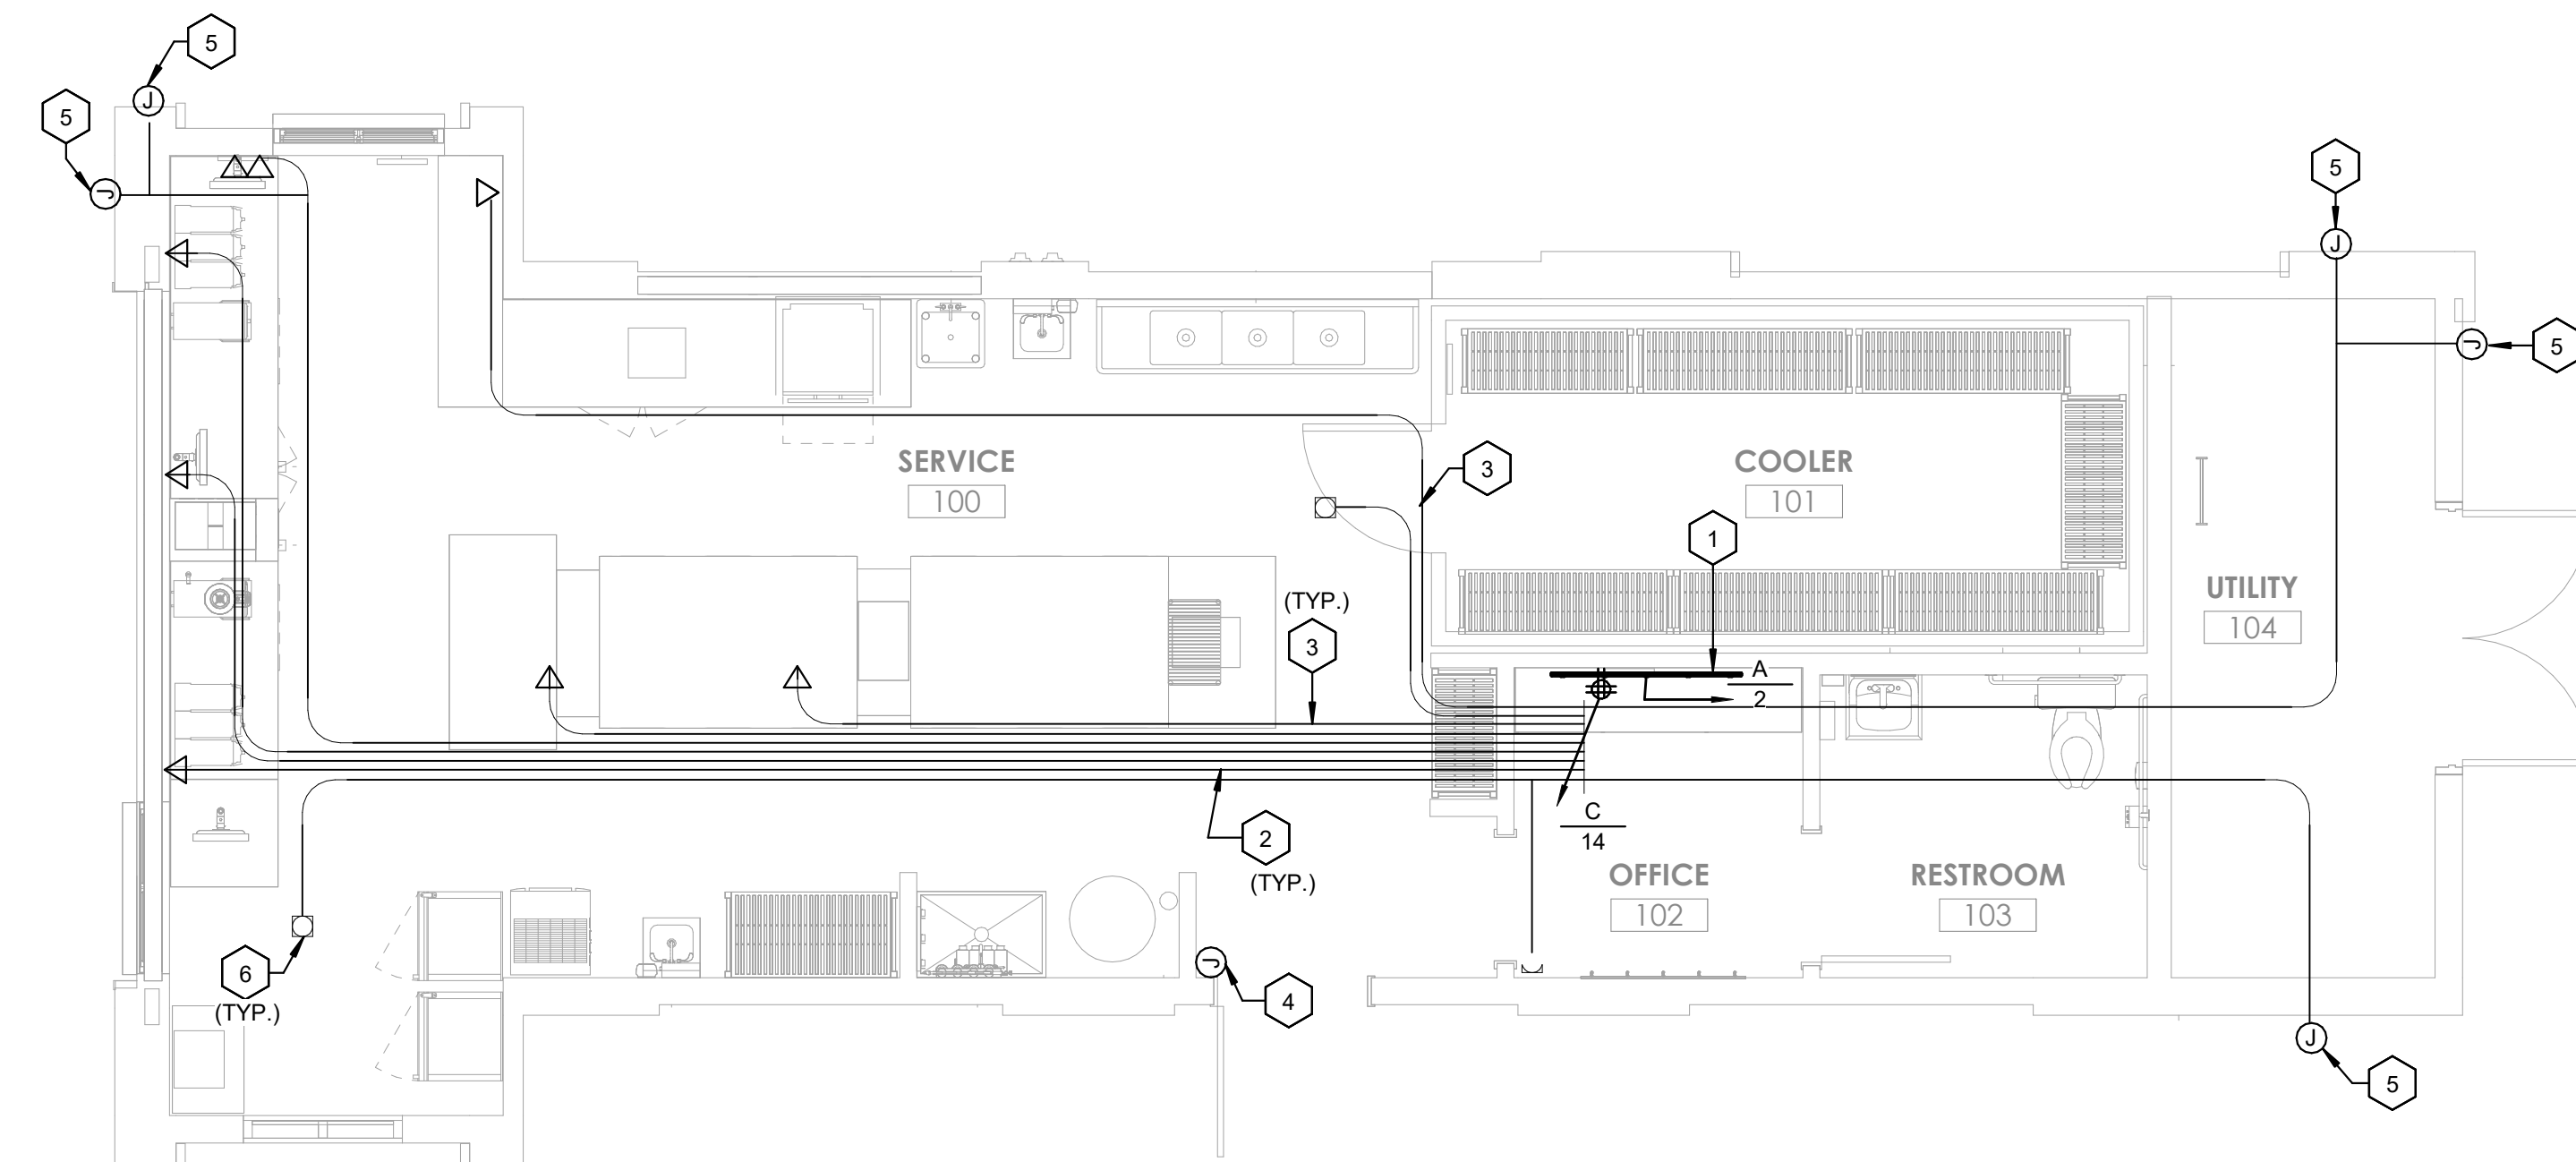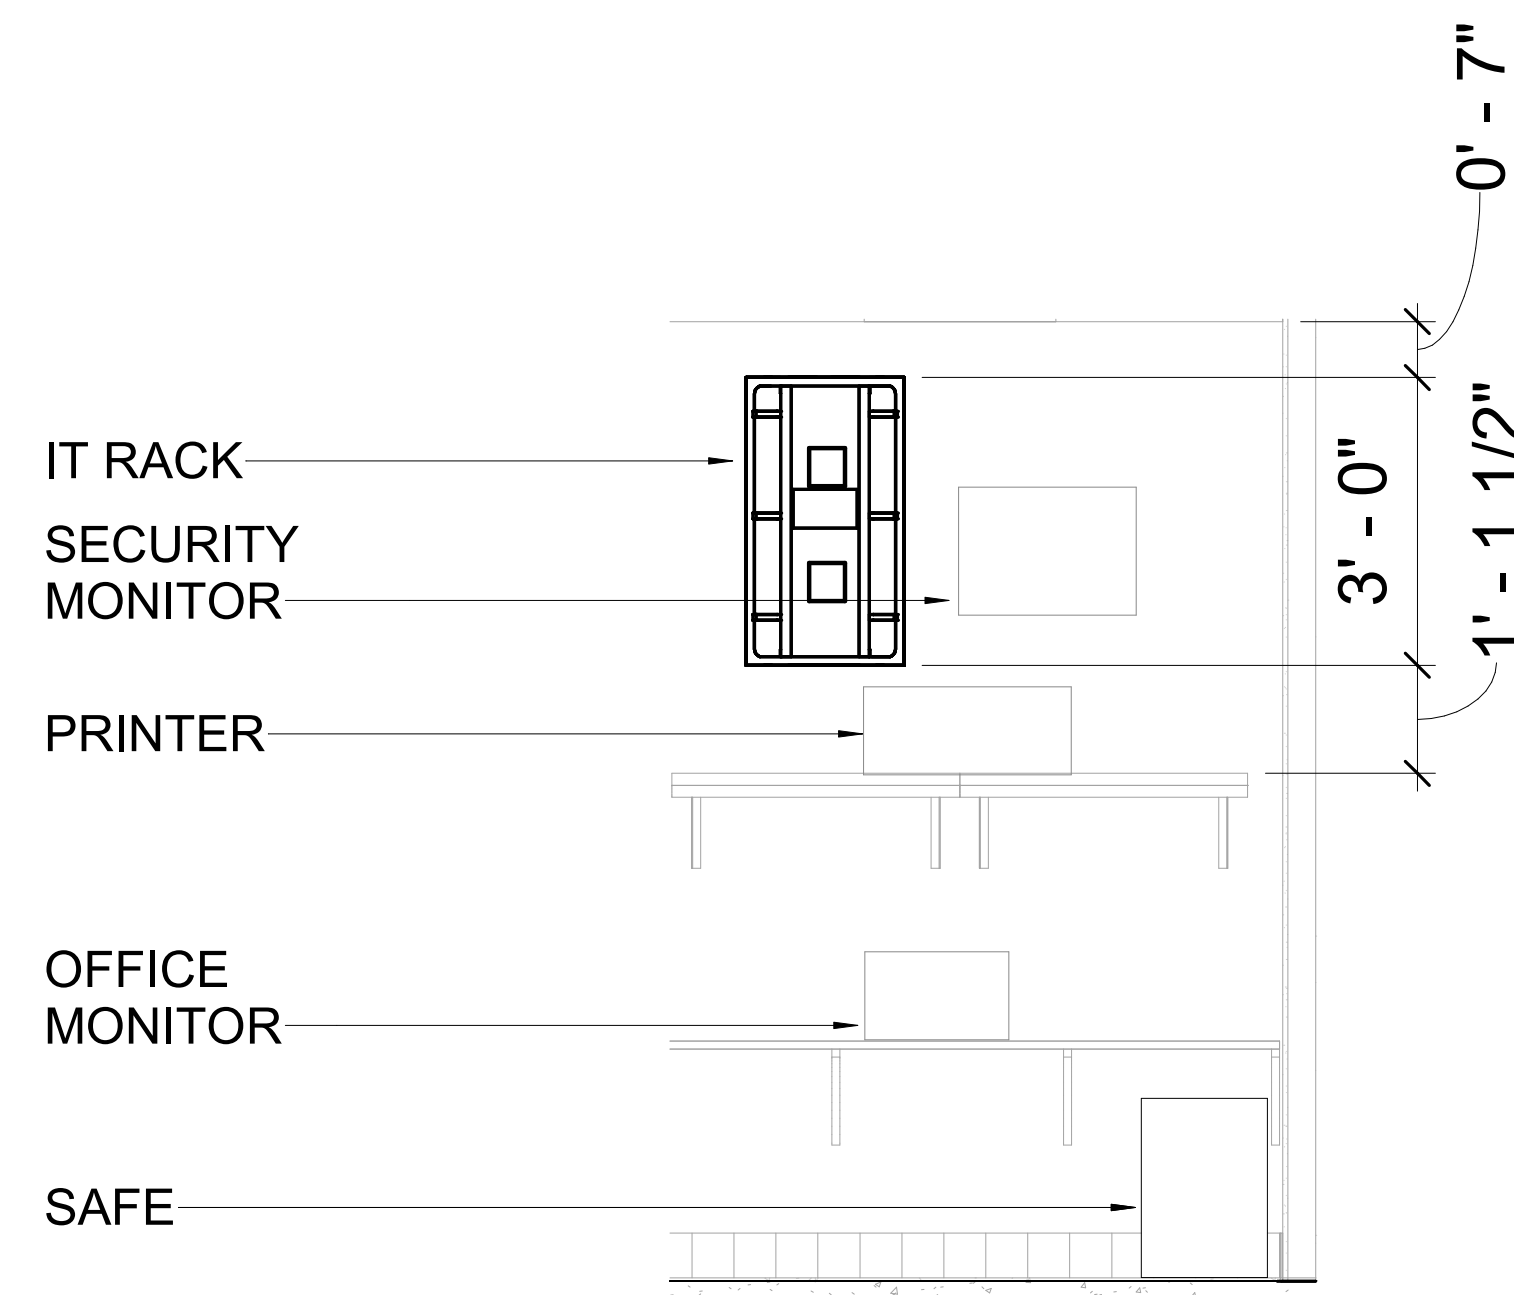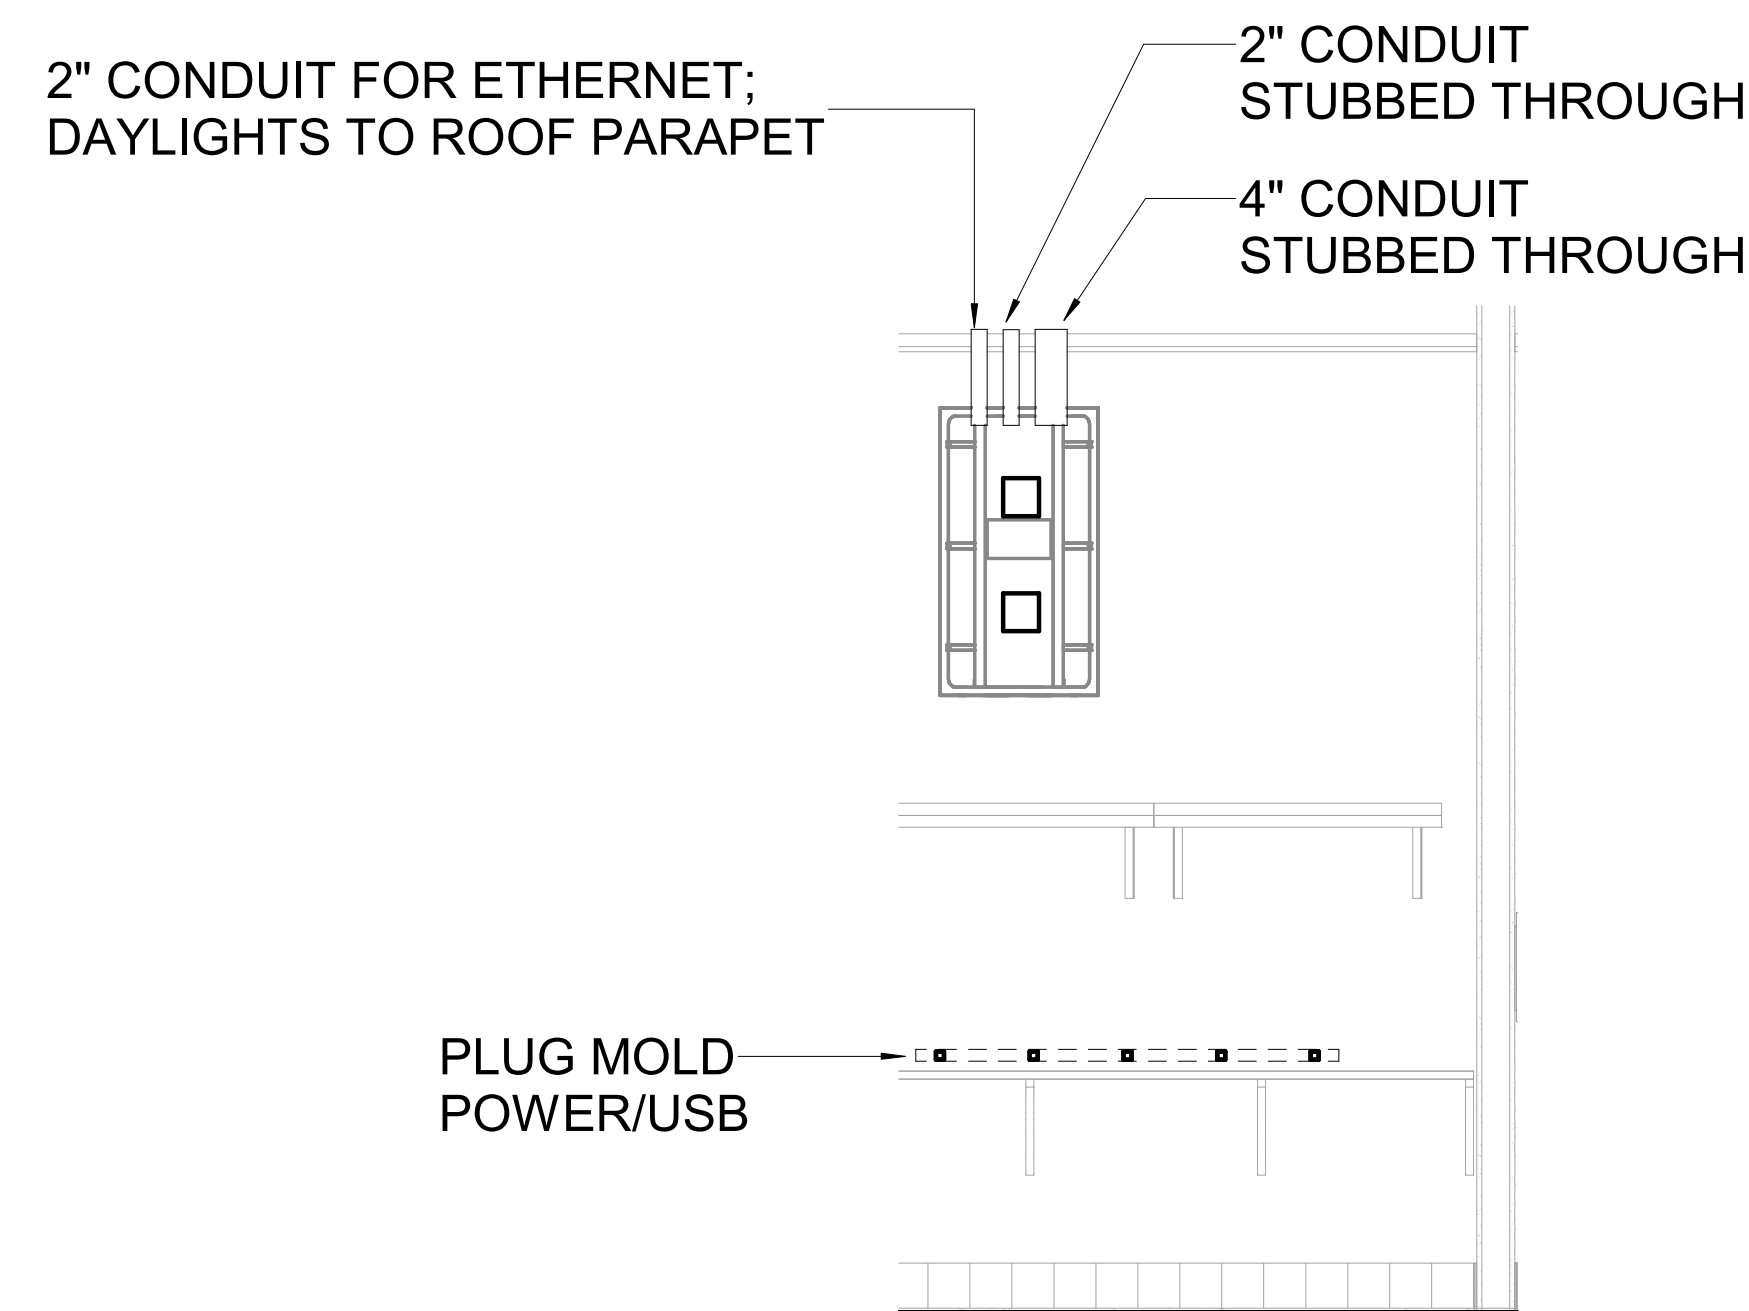

GENERAL NOTES

- A. ALL LOW VOLTAGE CABLING TO BE SUSPENDED SECURELY TO STRUCTURE; DO NOT SUSPEND OR ATTACH TO GRID.
- B. ALL RUNS SHOWN AS CAT 5E.
- C. ALL CABLE: EXTRA LENGTH OF CABLE COIL 5' ABOVE CEILING PRIOR TO CONNECTION POINT, BEFORE TURNING DOWN WALL TO MAKE CONNECTION.
- D. ALL DRINK LINE RECEPTACLES TO HAVE WATERPROOF COVERS. GC TO VERIFY AFTER INSTALLATION.

NOTES BY SYMBOL


- 1 PLUGMOLD 2000 SERIES STEEL MULTIOUTLET SYSTEM (OR SIMILAR). STANDARD RECEPTACLES AND USB; LAYOUT TO BE DETERMINED BY GC.
- 2 1-1/2" CONDUIT FOR DATA CABLING.
- 3 1" CONDUIT FOR DATA CABLING.
- 4 PROVIDE J-BOX WITH CONDUIT STUBBED ABOVE WALL FOR FUTURE ALARM KEYPAD.
- 5 PROVIDE J-BOX @ 9'-0" AFF FOR EXTERIOR WALL MOUNTED SECURITY CAMERA. ROUTE CONDUIT TO SERVER RACK. COORDINATE LOCATIONS AND HEIGHTS WITH EXTERIOR AWNINGS. GC TO VERIFY.
- 6 SECURITY CAMERA MOUNTED FLUSH TO CEILING. ROUTE CONDUIT TO SERVER RACK. GC TO VERIFY.



610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3
PROTOTYPE VERSION V2-B



SEAL

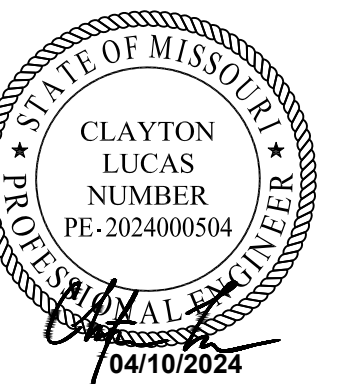

PERMIT SET 4.10.2024

CONTRACTOR SHALL VERIFY ALL
CONDITIONS AND DIMENSIONS AT THE
JOB SITE AND NOTIFY THE ARCHITECT
OF ANY DIMENSIONAL ERRORS,
OMISSIONS OR DISCREPANCIES BEFORE
BEGINNING OR FABRICATING ANY WORK.
DO NOT SCALE DRAWINGS.

[illegible]

PROJECT INFORMATION	
---------------------	--

PROJECT NO:	24-0087
ORIGINAL ISSUE:	12/06/22
SCALE:	AS NOTED
DRAWN BY:	JB
CHECKED BY:	CL

SHEET TITLE

LOW VOLTAGE PLAN

SHEET NUMBER

E104

NOTES BY SYMBOL

- 1

PROVIDE GFCI MAINTENANCE RECEPTACLE WITHIN 25' OF ALL MECHANICAL EQUIPMENT PER NEC 210.63.
- 2

APPROXIMATE LOCATION OF IT STUB OUT. TO BE CAPPED UNTIL EQUIPMENT INSTALLATION. GC TO PROVIDE PULL STRING IN CONDUIT FOR EASE OF INSTALLATION.
- 3

PROVIDE WP J-BOX AND TOGGLE SWITCH LOCATED ON SIGN IN CONCEALED LOCATION FOR EXTERIOR SIGNAGE PER NEC. COORDINATE EXACT LOCATIONS PRIOR TO INSTALLATION, EXTEND CIRCUIT THROUGH PHOTOCELL TIME CLOCK. VERIFY EXACT REQUIREMENTS WITH OWNER.
- 4

(DI-24-VLX5-40-XX-16-BL-MC-Q/O) (DRIVER: VLM200W-24-LPL). NO MORE THAN 40 FEET BETWEEN DRIVERS. TAPE TO BE PLACE ON INSIDE PERIMETER OF ALL 3 SIDES OF BOXOUT. REFER TO ARCHITECTURAL SHEET A131.
- 5

PROVIDE JBOX FOR EXTERIOR PERIMETER COPE TAPE LIGHT (DI-24-VLX5-40-XX-16-BL-MC-Q/O) (DRIVER: VLM200W-24-LPL). NO MORE THAN 40 FEET BETWEEN DRIVERS. TAPE TO BE PLACE ON INSIDE PERIMETER OF ALL 3 SIDES OF BOXOUT. REFER TO ARCHITECTURAL SHEET A201.



610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3
PROTOTYPE VERSION V2-B



SEAL



PERMIT SET 4.10.2024

CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DIMENSIONAL ERRORS. OMISSIONS OR DISCREPANCIES BEFORE BEGINNING OR FABRICATING ANY WORK. DO NOT SCALE DRAWINGS.

ISSUE	DATE	DESCRIPTION


PROJECT INFORMATION	
PROJECT NO:	24-0087
ORIGINAL ISSUE:	09/06/2022
SCALE:	AS NOTED
DRAWN BY:	JB
CHECKED BY:	CL

SHEET TITLE

MECHANICAL POWER
ROOF PLAN

SHEET NUMBER

E105

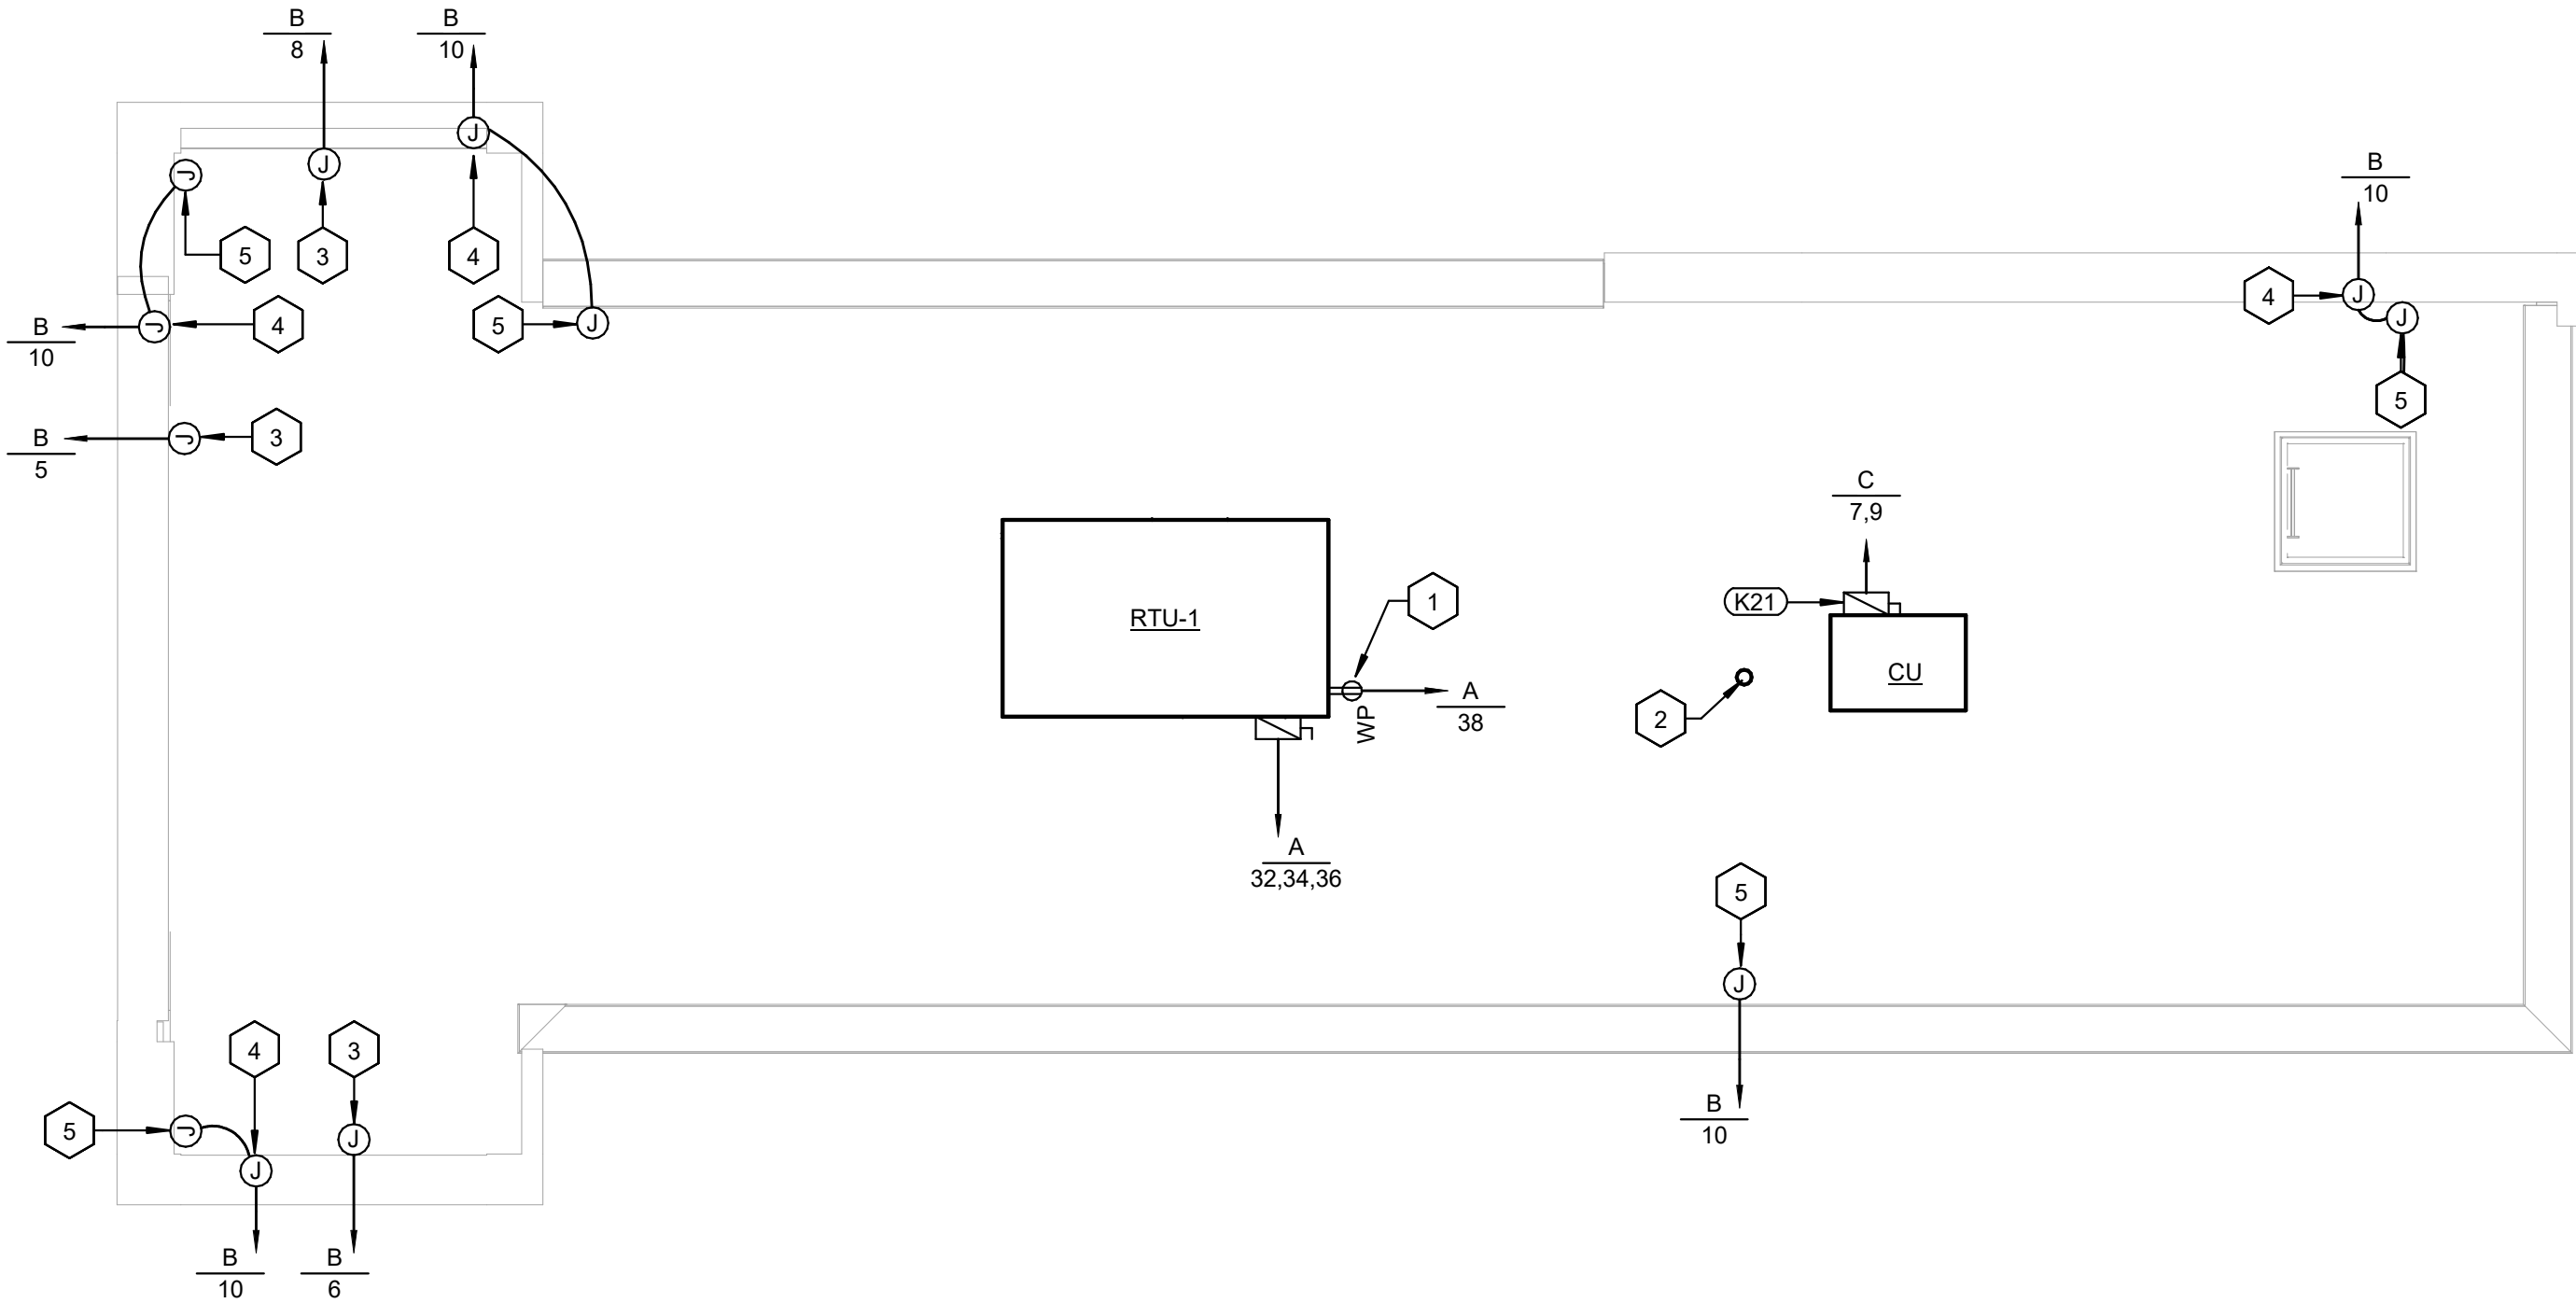

1 MECHANICAL POWER ROOF PLAN
E105 1/4" = 1'-0"



- 



SEAL



CONTRACTOR SHALL VERIFY ALL
CONDITIONS AND DIMENSIONS AT THE
JOB SITE AND NOTIFY THE ARCHITECT
OF ANY DIMENSIONAL ERRORS,
OMISSIONS OR DISCREPANCIES BEFORE
BEGINNING OR FABRICATING ANY WORK.
DO NOT SCALE DRAWINGS.

PROJECT INFORMATION	
PROJECT NO:	24-00
ORIGINAL ISSUE:	09/06/20
SCALE:	AS NOTED
DRAWN BY:	
CHECKED BY:	

SHEET TITLE

ELECTRICAL SITE PLAN

SHEET NUMBER

E106

NOTES BY SYMBOL	
1	WEATHER RATED WATERPROOF RECEPTACLES ALONG DRINK LINE.

1	WEATHER RATED WATERPROOF RECEPTACLES ALONG DRINK LINE.
---	--



610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3

FROM LIFE VERSION VZ-D






CONTRACTOR SHALL VERIFY ALL
CONDITIONS AND DIMENSIONS AT THE
JOB SITE AND NOTIFY THE ARCHITECT
OF ANY DIMENSIONAL ERRORS,
OMISSIONS OR DISCREPANCIES BEFORE
BEGINNING OR FABRICATING ANY WORK.
DO NOT SCALE DRAWINGS.


PROJECT INFORMATION	
PROJECT NO:	24-0087
ORIGINAL ISSUE:	10/12/23
SCALE:	AS NOTED
DRAWN BY:	JB
CHECKED BY:	CL

SHEET TITLE

SHEET NUMBER

SHEET NUMBER



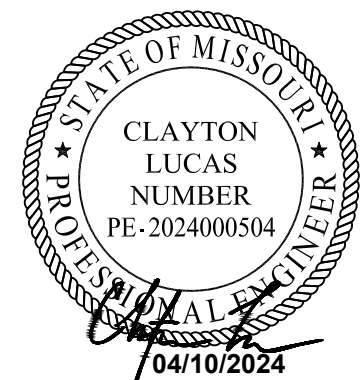

CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DIMENSIONAL ERRORS. OMISSIONS OR DISCREPANCIES BEFORE BEGINNING OR FABRICATING ANY WORK. DO NOT SCALE DRAWINGS.

ISSUE	DATE	DESCRIPTION


PROJECT INFORMATION	
PROJECT NO:	24-0087
ORIGINAL ISSUE:	09/06/2022
SCALE:	AS NOTED
DRAWN BY:	JB
CHECKED BY:	CL

SHEET TITLE


ELECTRICAL DETAILS

SHEET NUMBER

E109

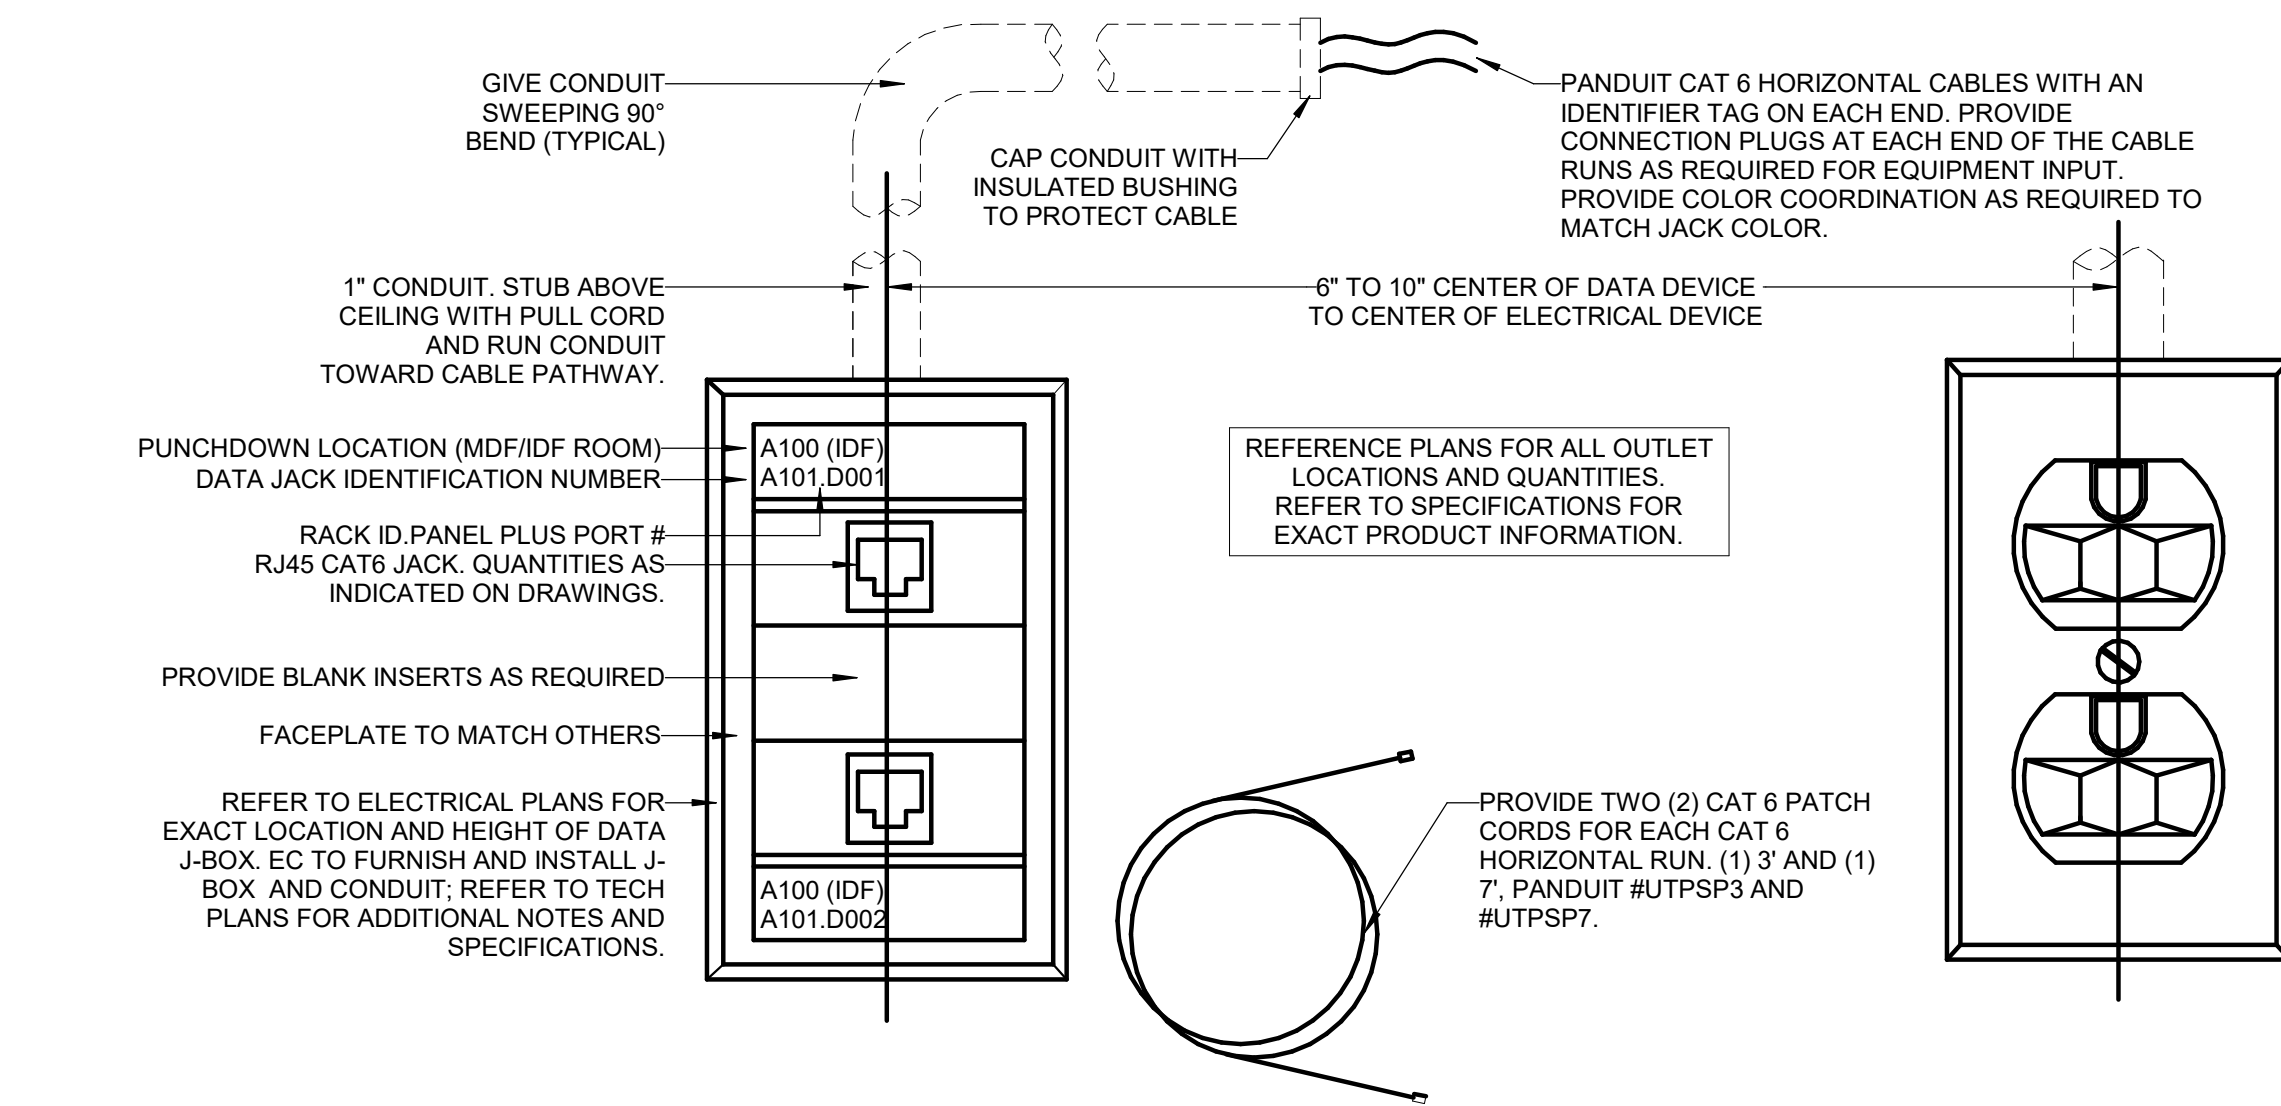

1 TYPICAL DATA JACK DETAIL
E109 N.T.S.

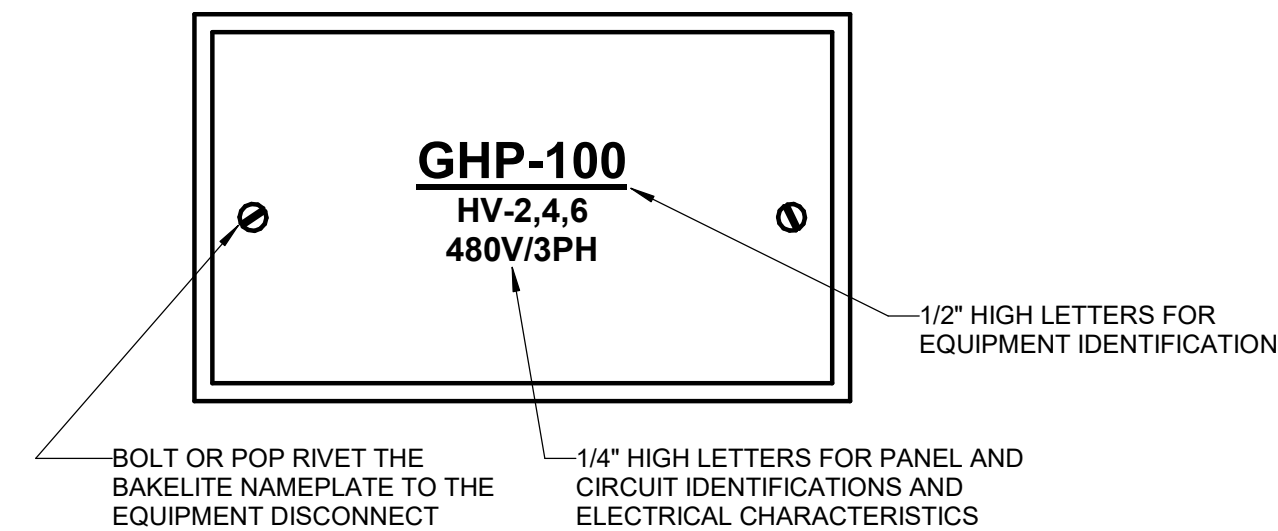


NOTE:
1. ALL NAMEPLATES SHALL BE CUSTOM ENGRAVED WHITE LETTERING ON BLACK PHENOLIC PLASTIC (BAKELITE).

2 TYPICAL EQUIPMENT DISCONNECT NAMEPLATE DETAIL
E109 N.T.S.


GROUNDING ELECTRODE FEEDER SCHEDULE:

SIZES ARE BASED ON COPPER (CU) THHN/THWN-2 INSULATION, UNO. ALL CONDUCTOR SIZES ARE BASED ON 75 DEG C RATED TERMINATIONS, UNO. CONDUIT SIZES SHOWN ARE APPROPRIATE FOR SCHEDULE 40 PVC, EMT, GRS, IMC AND RMC, ADJUST SIZE AS NEEDED FOR OTHER RACEWAY TYPES. FOR ANY OTHER CONDITIONS MODIFY SIZES PER CODE. REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION.

- G6 GND, #6 COPPER GROUND, 3/4" C
- G4 GND, #4 COPPER GROUND, 3/4" C
- G2 GND, #2 COPPER GROUND, 3/4" C
- G1/0 GND, #1/0 COPPER GROUND, 3/4" C
- G300 GND, #300CMIL COPPER GROUND, 1-1/4" C
- MJB MAIN BONDING JUMPER #6 COPPER

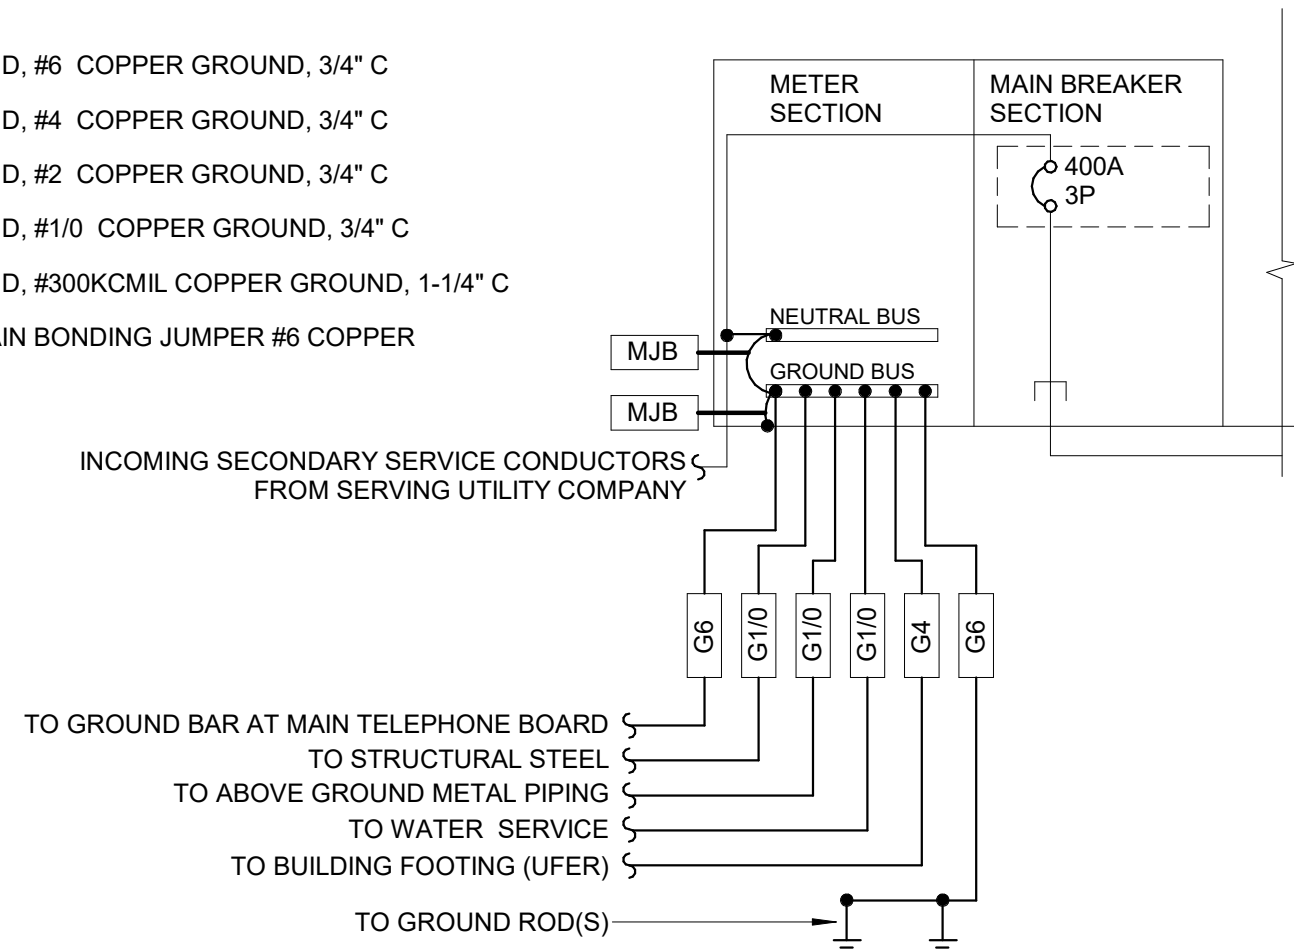

4 GROUNDING ELECTRODE SYSTEM DETAIL
E109 N.T.S.

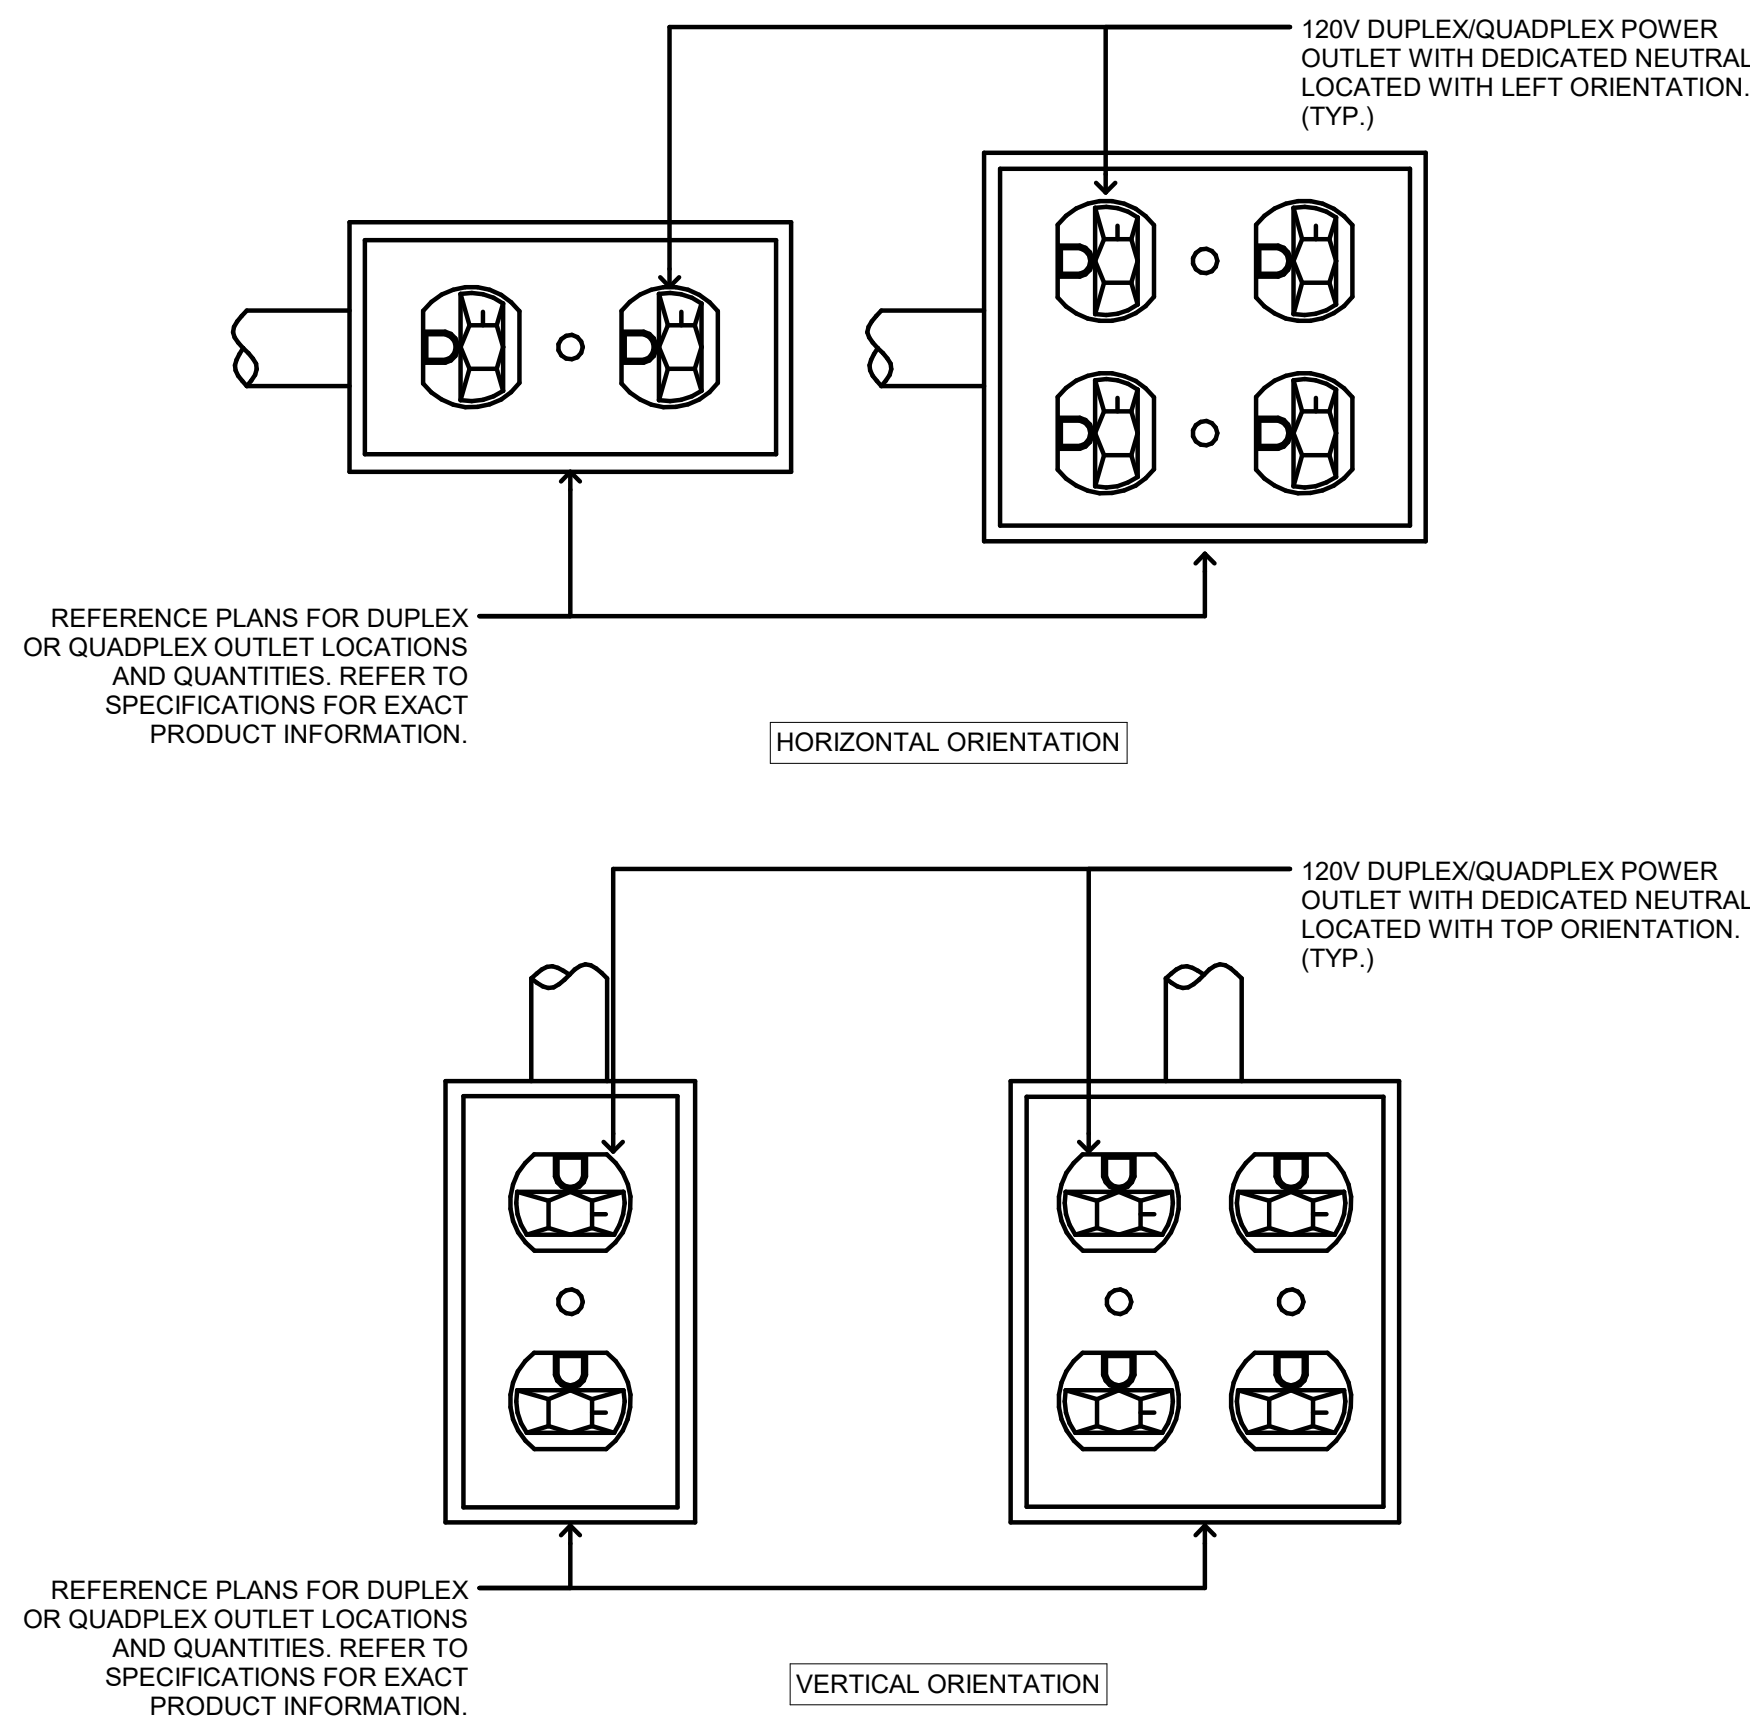

3 TYPICAL RECEPTACLE ORIENTATION DETAIL
E109 N.T.S.

Panel: A

PROVIDE 200% NEUTRAL

Location: UTILITY 104

Supply From: WIREWAY

Mounting: SURFACE

Volts: 120/208 Wye

Phas... 3

Wires: 4

A	B	C	A	B	C
	</				

Panel: B

Location: UTILITY 104

Supply From: WIREWAY

Mounting: SURFACE

Volts: 120/208 Vye

Phas... 3

Wires: 4

A.I.C. Rating: 22,000

Mains Rating: 200

Mains Type: MCB

PROVIDE 200% NEUTRAL

NO...	C...	CIRCUIT DESCRIPTION	WIRE	BRKR	#	A	B	C	A	B	C	#	BRKR	WIRE	CIRCUIT DESCRIPTION	C...	NO...	
1		UNDERCOUNTER ICE MAKER	12	20	1	1425			1600			1	20	12	MENUBOARD	2		
3		SPARE	--	20	1		0			400		1	20	12	SPEAKER BOX	4		
5		SIGNAGE	12	20	1			1200			1200	1	20	12	SIGNAGE	6		
7		SPARE	--	20	1	0			1200			1	20	12	SIGNAGE	8		
4	9	AC-2	12	20	1		240				1290	1	20	12	EXTERIOR LIGHTING	10	3	
11		TIMECLOCK	12	20	1			180				180	1	20	12	PANEL RECEPTACLE	12	
13		CP-1	12	20	1	400			800			1	20	12	MARQUEE SIGNS	14	3	
15		NITRO WARMER	12	20	1			1440			1200	1	20	12	DRIVE THRU WINDOW & SERVING...	16		
17		UNDERCOUNTER ICE MAKER	12	20	1			1425			78	1	20	12	EXTERIOR LIGHTING	18		
19		LEMONADE DISPENSER	12	20	1	1080			1080			1	20	12	LEMONADE DISPENSER	20		
21		MUSIC SYSTEM	12	20	1		360				0	1	20	--	SPARE	22		
4	23	AC-1	12	20	1			240			0	1	20	--	SPARE	24		
4	25	AC-1	12	20	1	480				0		1	20	--	SPARE	26		
4	27	AC-1	12	20	1		240				0	1	20	--	SPARE	28		
29		SPARE	--	20	1			0			0	1	20	--	SPARE	30		
31		SPARE	--	20	1	0				0		1	20	--	SPARE	32		
33		SPARE	--	20	1			0			4493	2	55	6	WATER HEATER	34	4	
35		SPARE	--	20	1			0			4493					36		
37		SPARE	--	20	1	0			3106							38		
39		SPARE	--	20	1			0			2446	3	60	4	PANEL C	40		
41		SPARE	--	20	1			0			3012					42		
Total Load:						11171 W			12109 W			12008 W						
Total Amps:						93			102			101						

NOTES:

Provide GFCI Breaker

Circuit Via Energy Management System

Circuit Via Photo Cell Operation / DDC Controller

Provide Breaker and Fuses Per Manufacturers Recommendation

Provide H.A.C.R. Breaker

Provide a Lock on Breaker

Total Conn. Load: 35288

Total Est. Demand: 35134

Total Conn.: 98

Total Est. Demand: 98

Panel: C

Location: UTILITY 104

Supply From: B

Mounting: SURFACE

Votes: 120/208 Wye

Phas... 3

Wires: 4

A.I.C. Rating: 22,000

Mains Rating: 60

Mains Type: MCB

PROVIDE 200% NEUTRAL

NO...	C...	CIRCUIT DESCRIPTION	WIRE	BRKR	#	A	B	C	A	B	C	#	BRKR	WIRE	CIRCUIT DESCRIPTION	C...	NO...
1		FIRE BELL	12	20	1	100			300			1	20	12	WALK IN COOLER LIGHT	2	
6	3	POS RECEPTACLE	12	20	1			180			720	1	20	12	INTERIOR LIGHTING	4	
5		WALK IN COOLER EVAP COIL	12	20	1			1932			180	1	20	12	POS RECEPTACLE	6	6
7		WALK IN CONDENSING UNIT	12	20	2	1186			360			1	20	12	POS RECEPTACLE	8	6
4,5	9					1186			360		360	1	20	12	SECURITY VCR	10	
6	11	POS RECEPTACLE	12	20	1			360			540	1	20	12	POS RECEPTACLE	12	6
6	13	POS RECEPTACLE	12	20	1	360			800			1	20	12	IT RECEIPTS	14	
16		SPACE	--	--	1		--	--		--		1	--	--	SPACE	16	
16		SPACE	--	--	1		--	--		--		1	--	--	SPACE	18	
Total Load:						3106 W	2446 W	20	3012 W								
Total Amps:						27	20	26									

NOTES:

Provide GFCI Breaker

Circuit Via Energy Management System

Circuit Via Photo Cell Operation / DDC Controller

Provide Breaker and Fuses Per Manufacturers Recommendation

Provide H.A.C.R. Breaker

Provide A Lock on Breaker

PANEL TOTALS

Total Conn. Load: 8564

Total Est. Demand: 8476

Total Conn.: 24

Total Est. Demand: 24

Section # & Req.ID	Rough-In Electrical Inspection	Complies?	Comments/Assumptions
C405.2.2 C405.2.3.1 C405.2.3.2 [EL23] ²	Daylight zones provided with individual controls that control the lights independent of general area lighting. See code section C405.2.3 Daylight-responsive controls for applicable spaces. C405.2.3.1 Daylight responsive control function and section C405.2.3.2 Sidelit zone.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Exception: Sidelit zones on first floor in Group A-2 and M occupancies.
C405.2.4 [EL26] ¹	Separate lighting control devices for specific uses installed per approved lighting plans.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C405.2.4 [EL27] ¹	Additional interior lighting power allowed for special functions per the approved lighting plans and is automatically controlled and separated from general lighting.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C405.2.5 [EL28] ^{1a}	Manual controls required by the energy code are in a location with ready access to occupants and located where the controlled lights are visible, or identify the area served and their status.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C405.2.6 [EL30] ^{1a}	Automatic lighting controls for exterior lighting installed. Controls will be daylight controlled, set based on business operation time-of-day, or reduce connected lighting > 30%.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C405.3 [EL6] ²	Exit signs do not exceed 5 watts per face.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C405.6 [EL26] ²	Low-voltage dry-type distribution electric transformers meet the minimum efficiency requirements of Table C405.6.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C405.7 [EL27] ²	Electric motors meet the minimum efficiency requirements of Tables C405.7(1) through C405.7(4). Efficiency verified through certification under an approved certification program or the equipment efficiency ratings shall be provided by motor manufacturer (where certification programs do not exist).	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C405.8.2 C405.8.2.1 [EL28] ²	Escalators and moving walks comply with ASME A17.1/CSA B44 and have automatic controls configured to reduce speed to the minimum permitted speed in accordance with ASME A17.1/CSA B44 or applicable local code when not conveying passengers.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C405.9 [EL29] ²	Total voltage drop across the combination of feeders and branch circuits <= 5%.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.

1 High Impact (Tier 1)2 Medium Impact (Tier 2)3 Low Impact (Tier 3)

Project Title: Salad & GoReport date: 04/09/24
Data filename: C:\Users\jbout\Gemini Engineering Group\Gemini Engineering Group - Documents\Projects\Retail_Commerical\Salad and Go\2024\24-001-05 Lee Summit, MO\Design\6_Energy\Salad&GO_Lee's Summit, MO_IECC 2018.cckPage 7 of 10

Project Title: Salad & GoReport date: 04/09/24
Data filename: C:\Users\jbout\Gemini Engineering Group\Gemini Engineering Group - Documents\Projects\Retail_Commerical\Salad and Go\2024\24-001-05 Lee Summit, MO\Design\6_Energy\Salad&GO_Lee's Summit, MO_IECC 2018.cckPage 10 of 10

Section # & Req.ID	Final Inspection	Complies?	Comments/Assumptions
C302.3 C408.2.5.2 [F117] ²	Furnished OEM instructions for systems and equipment to the building owner or designated representative.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C405.4.1 [F118] ²	Interior installed lamp and fixture lighting power is consistent with what is shown on the approved lighting plans, demonstrating proposed watts are less than or equal to allowed watts.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	See the interior Lighting fixture schedule for values.
C405.5.1 [F119] ²	Exterior lighting power is consistent with what is shown on the approved lighting plans, demonstrating proposed watts are less than or equal to allowed watts.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	See the Exterior Lighting fixture schedule for values.
C408.1.1 [F157] ²	Building operations and maintenance documents will be provided to the owner. Documents will cover manufacturers' information, specifications, programming procedures and means of illustrating to owner how building, equipment and systems are intended to be installed, maintained, and operated.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C408.2.5.1 [F116] ²	Furnished as-built drawings for electric power systems within 90 days of system acceptance.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C408.3 [F133] ²	Lighting systems have been tested to ensure proper calibration, adjustment, programming, and operation.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.


1 High Impact (Tier 1)2 Medium Impact (Tier 2)3 Low Impact (Tier 3)

Project Title: Salad & GoReport date: 04/09/24
Data filename: C:\Users\jbout\Gemini Engineering Group\Gemini Engineering Group - Documents\Projects\Retail_Commerical\Salad and Go\2024\24-001-05 Lee Summit, MO\Design\6_Energy\Salad&GO_Lee's Summit, MO_IECC 2018.cckPage 8 of 10


Section # & Req.ID	Final Inspection	Complies?	Comments/Assumptions
C302.3 C408.2.5.2 [F117] ²	Furnished OEM instructions for systems and equipment to the building owner or designated representative.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C405.4.1 [F118] ²	Interior installed lamp and fixture lighting power is consistent with what is shown on the approved lighting plans, demonstrating proposed watts are less than or equal to allowed watts.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	See the interior Lighting fixture schedule for values.
C405.5.1 [F119] ²	Exterior lighting power is consistent with what is shown on the approved lighting plans, demonstrating proposed watts are less than or equal to allowed watts.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	See the Exterior Lighting fixture schedule for values.
C408.1.1 [F157] ²	Building operations and maintenance documents will be provided to the owner. Documents will cover manufacturers' information, specifications, programming procedures and means of illustrating to owner how building, equipment and systems are intended to be installed, maintained, and operated.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C408.2.5.1 [F116] ²	Furnished as-built drawings for electric power systems within 90 days of system acceptance.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
C408.3 [F133] ²	Lighting systems have been tested to ensure proper calibration, adjustment, programming, and operation.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.

1 High Impact (Tier 1)2 Medium Impact (Tier 2)3 Low Impact (Tier 3)


Project Title: Salad & GoReport date: 04/09/24
Data filename: C:\Users\jbout\Gemini Engineering Group\Gemini Engineering Group - Documents\Projects\Retail_Commerical\Salad and Go\2024\24-001-05 Lee Summit, MO\Design\6_Energy\Salad&GO_Lee's Summit, MO_IECC 2018.cckPage 9 of 10



610 NW CHIPMAN ROAD
LEE'S SUMMIT, MO 64086 PROPOSED LOT 3
PROTOTYPE VERSION V2-B



SEAL



PERMIT SET 4.10.2024

CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DIMENSIONAL ERRORS. OMISSIONS OR DISCREPANCIES BEFORE BEGINNING OR FABRICATING ANY WORK. DO NOT SCALE DRAWINGS.

ISSUE	DATE	DESCRIPTION

PROJECT INFORMATION

PROJECT NO: 24-0087
ORIGINAL ISSUE: 12/13/23
SCALE: AS NOTED
DRAWN BY: JB
CHECKED BY: CL

SHEET TITLE

LIGHTING ENERGY FORMS

SHEET NUMBER

E113